


13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

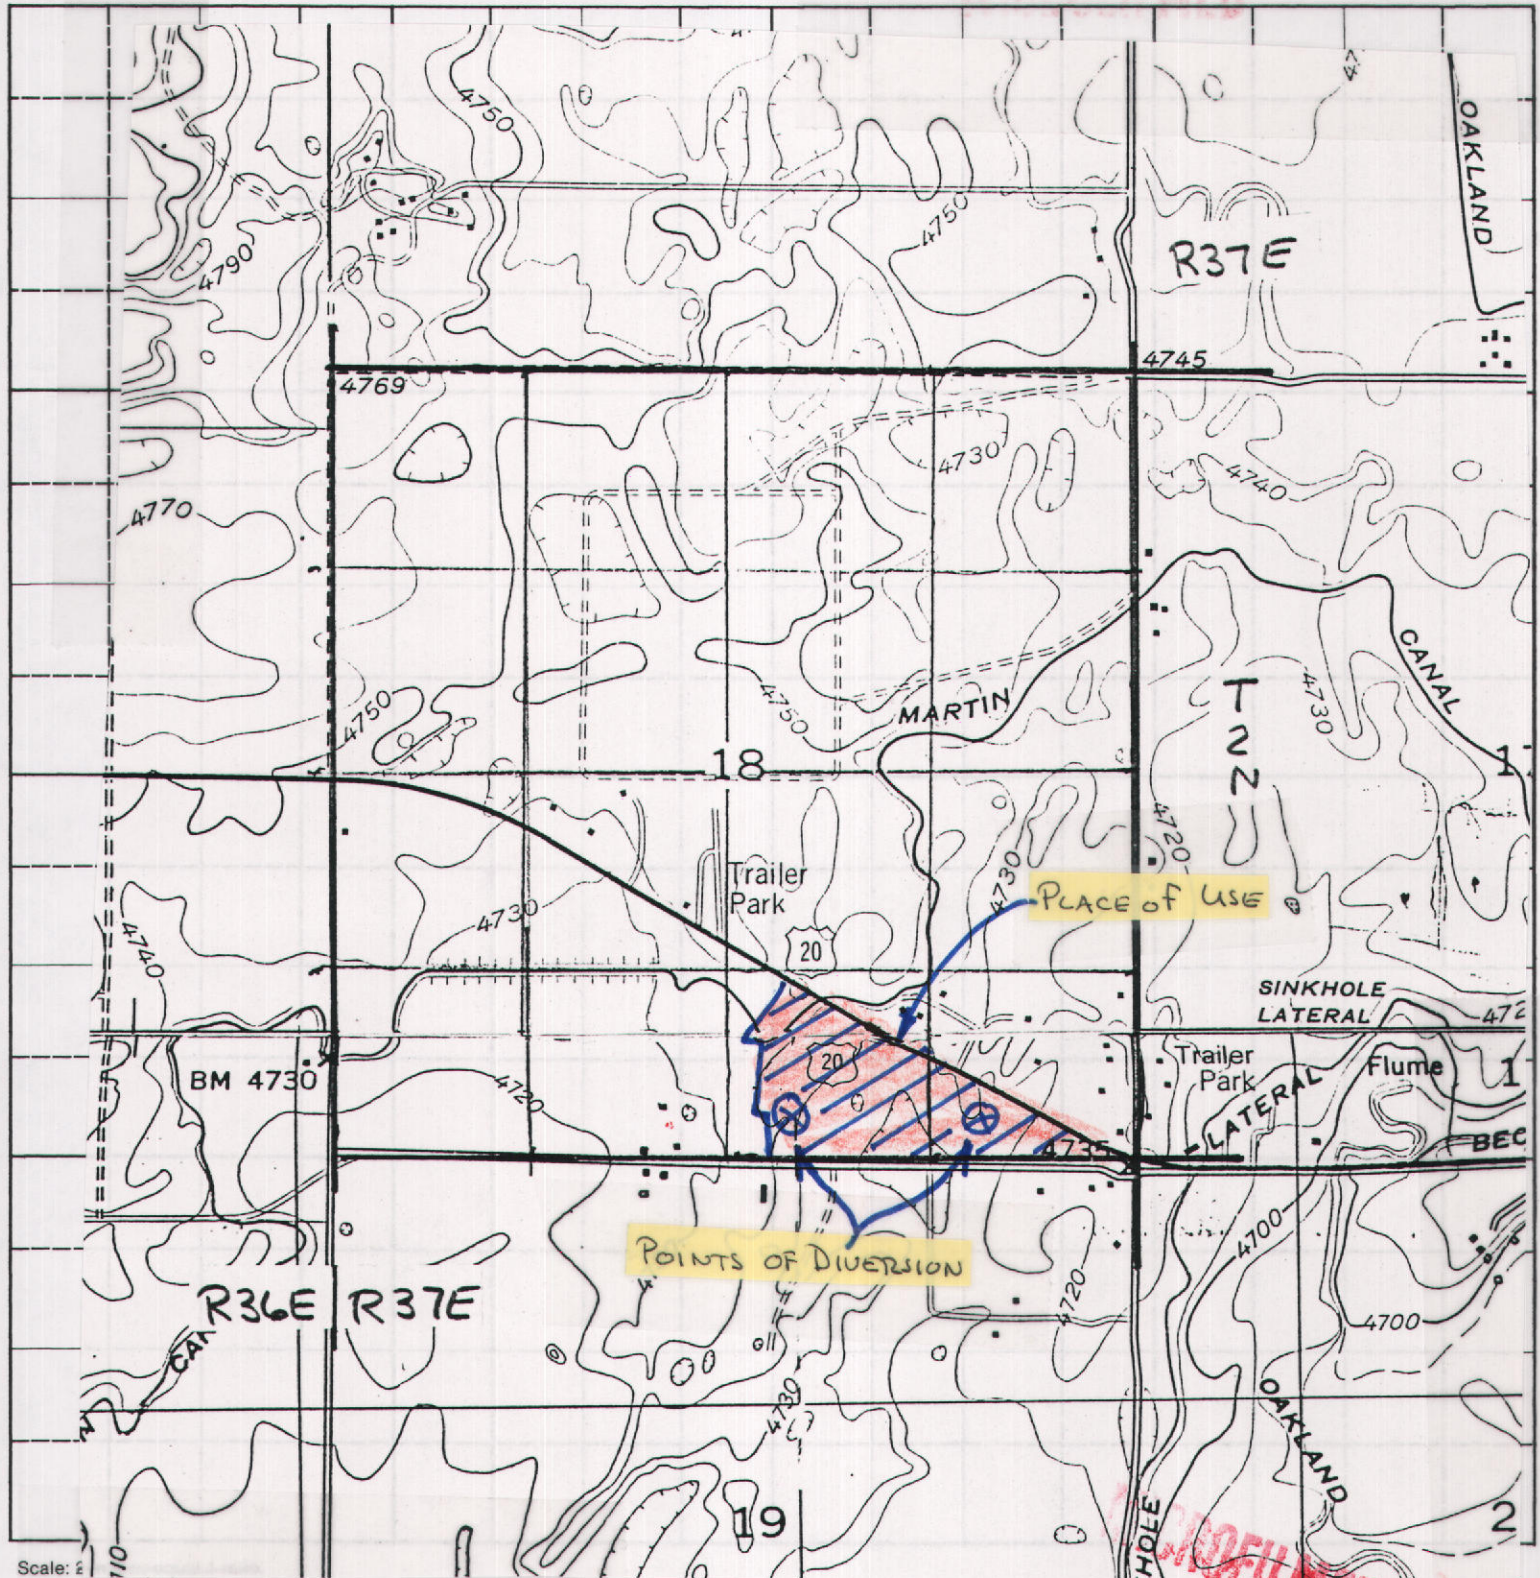


BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Wayne H. Georgeson President
(Applicant)

S 1/2 SE 1/4

SEC 18

T2N R37E

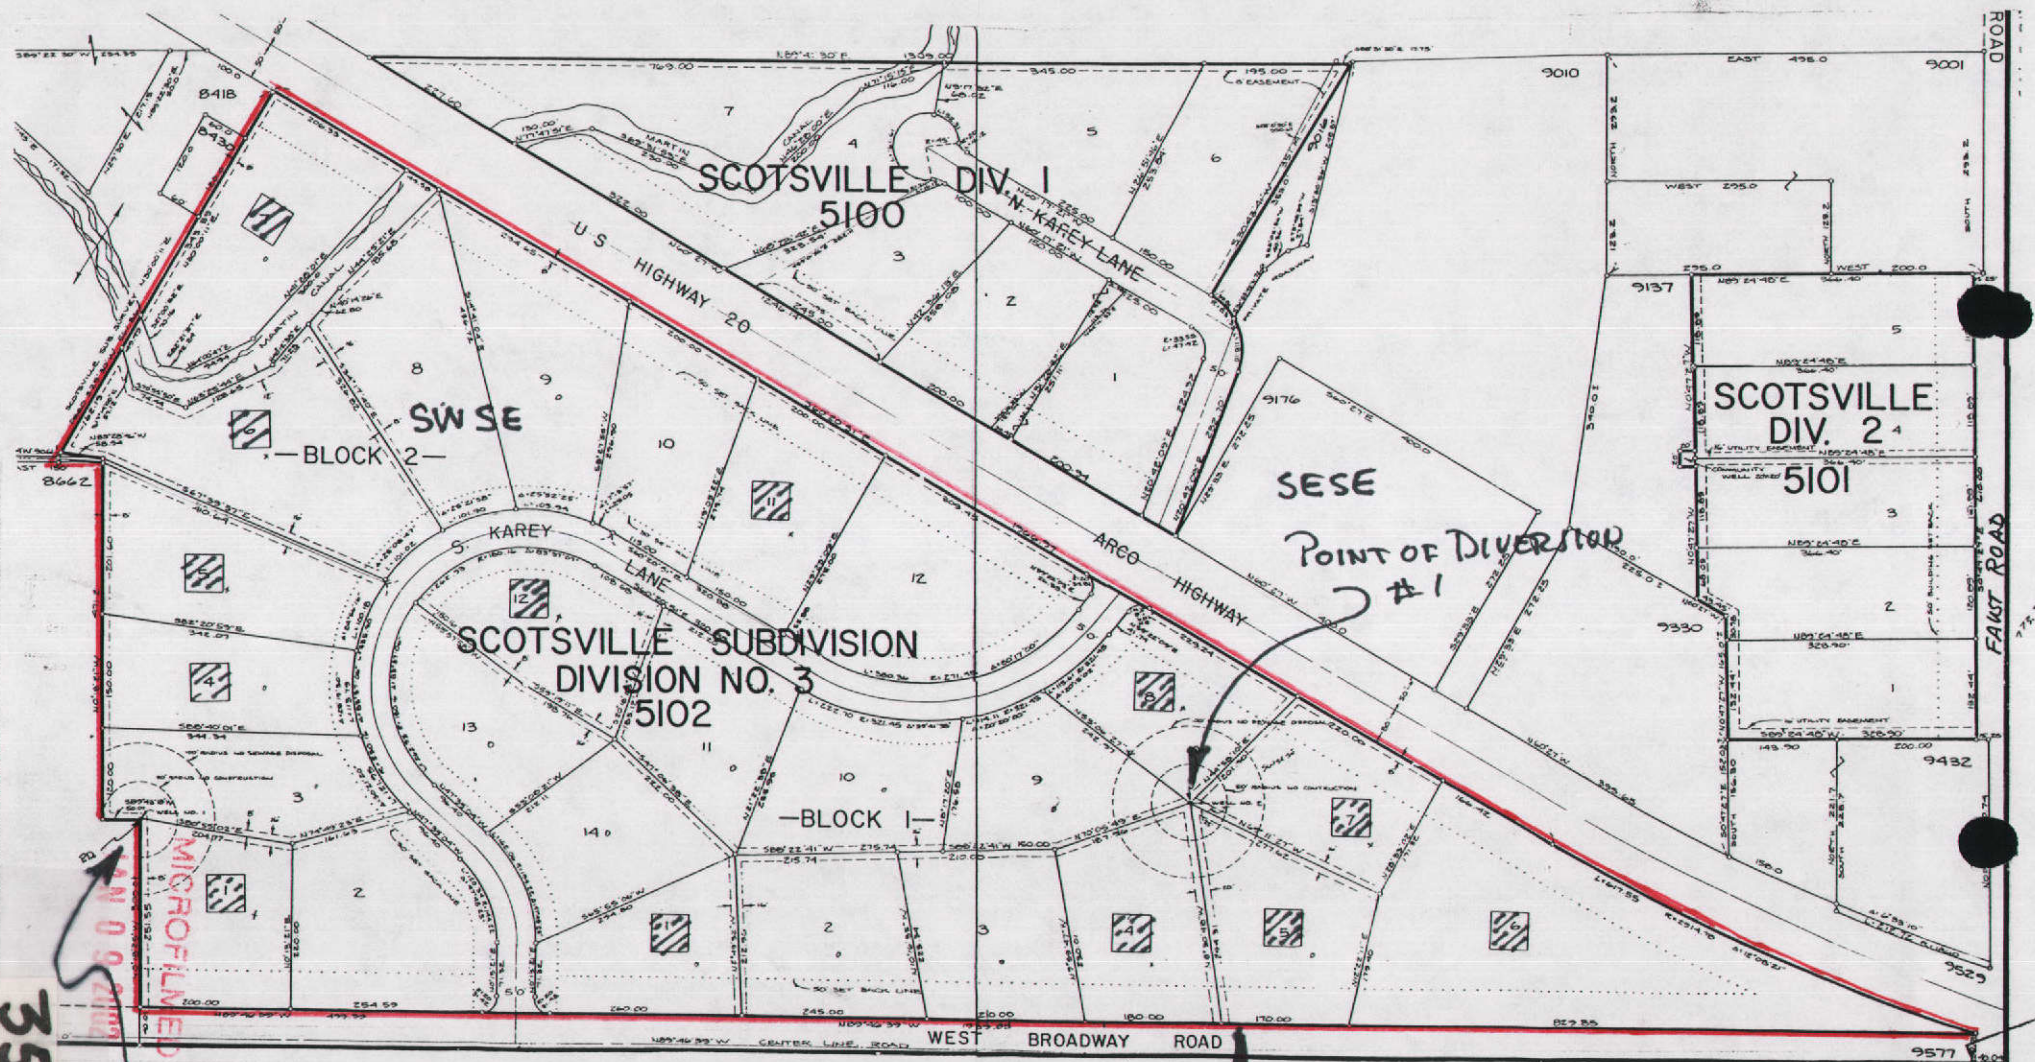

HOME SITES

PLACE OF USE

Point of Diversion #2

35-8943

35-08943

State of Idaho
Department of Water Resources
Water Right License

WATER RIGHT NO. 35-08943

Priority: May 3, 1991

Maximum Diversion Rate: 0.09 CFS

It is hereby certified that KAREY LANE WELL ASSOCIATION
C/O WAYNE GEORGESON
305 KAREY LANE
IDAHO FALLS ID 83402 has complied with the terms and
conditions of the permit, issued pursuant to Application for Permit dated May 3, 1991; and has
submitted Proof of Beneficial Use on December 12, 1991. An examination indicates that the works have
a diversion capacity of 0.23 cfs of water from:

SOURCE

GROUND WATER

and a water right has been established as follows:

BENEFICIAL USE

DOMESTIC

PERIOD OF USE

01/01 to 12/31

DIVERSION RATE

0.09 CFS

LOCATION OF POINT(S) OF DIVERSION:

GROUND WATER SW $\frac{1}{4}$ SW $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 18, Twp 02N, Rge 37E, B.M. BONNEVILLE County

GROUND WATER SW $\frac{1}{4}$ SE $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 18, Twp 02N, Rge 37E, B.M. BONNEVILLE County

PLACE OF USE: DOMESTIC

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
02N	37E	18															X	X	

CONDITIONS OF APPROVAL

1. The use of water under this right shall not give rise to any claim against the holder of a senior water right based upon the theories of forfeiture, abandonment, adverse possession, waiver, equitable estoppel, estoppel by laches or customary preference.
2. Domestic use is for 25 homes and does not include lawn, garden, landscape, or other types of irrigation.
3. Place of use is located within Lots 1-14, Blk. 1 and Lots 2-12, Blk. 2; Scottsville No. 3 Subdivision.
4. Right 35-7698 is also diverted through the points of diversion described above.
5. Rights 35-7698 and 35-8943 when combined shall not exceed a total annual maximum diversion volume of 15.6 af for use in 26 homes.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. The water right confirmed by this license is subject to all prior water rights and shall be used in accordance with Idaho law and applicable rules of the Department of Water Resources.

Signed and sealed this 4th day of JANUARY, 2002.

MICROFILMED
JAN 09 2002

Acting for 
KARL J. DREHER
Director

RECEIVED
DEC 12 1991

STATE OF IDAHO

For Office Use Only
Amt. of Fee \$ 50.00
Date 12-12-91
Receipt No. 002263
Received by SM

DEPARTMENT OF WATER RESOURCES

Department of Water Resources

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources will consider this form as a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

- Permit No. 35-08943 Telephone No. 524-4374
- Name(s) of Permit Holder(s): KAREY LANE WELL ASSOCIATION % WAYNE GEORGESON
- Post Office Address: 305 KAREY LANE IDAHO FALLS, ID. 83402
- Source of Water: GROUND WATER
 - If ground water, well driller's name: DENNING WELL DRILLING Date drilled: 1976
 - Pump horsepower: 5 Pressure (psi): 50 Dynamic pumping level (ft.): 200
- Extent of Use:

Domestic <u>25</u> (No. of households)	Irrigation _____ (No. of acres)
Stockwater _____ (No. and type of stock)	Other _____
- Total rate and/or volume for which proof is submitted 0.09 cfs 15.6 acre/feet
0.14
- Refer to the approval conditions on your permit and respond accordingly: 2/17/91 KLG

Measuring device: Required? Yes ☒ No Installed? Yes ☒ No
OR
Flow Measurement Port: Required? Yes ☒ No Installed? Yes ☒ No
- Fee Enclosed: \$ 50.00 (See License Examination Fee Schedule)
- Person to contact to accompany the Department representative during the field examination:

<u>WAYNE GEORGESON</u> Name	<u>524-4374 / 526-4668</u> Telephone No.
<u>305 KAREY LANE IDAHO FALLS, ID. 83402</u> Address	

10. The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

DEC. 9, 1991
Date

Wayne N. Georgeson, President
Signature (and title if on behalf of a company or organization)

DEC 23 1991

State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 35-08943

Proposed Priority: May 3, 1991 Maximum Diversion Rate: 0.09 CFS
This is to certify, that KAREY LANE WELL ASSOCIATION

C/O WAYNE GEORGESON
305 KAREY LANE
IDAHO FALLS, ID 83402

has applied for a permit to appropriate water from: GROUNDWATER
and a permit is APPROVED for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
DOMESTIC	01/01 to 12/31	0.09 CFS

<u>LOCATION OF POINT(S) OF DIVERSION:</u>	SWSE	Sec. 18, Township 02N, Range 37E
	SESE	Sec. 18, Township 02N, Range 37E
		BONNEVILLE County

PLACE OF USE: DOMESTIC
TWN RGE SEC

02N 37E 18	SWSE	SESE
------------	------	------

CONDITIONS/REMARKS:

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before July 1, 1992.
2. Subject to all prior water rights.
3. Permit holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
4. The right to the use of water acquired under this permit shall not give rise to any right or claim against the holder of a senior right based upon the theories of forfeiture, abandonment, adverse possession, waiver, equitable estoppel, estoppel by laches or customary preference.
5. The Director retains jurisdiction of the permit and any license subsequently issued to incorporate the use into a water district, require streamflow augmentation or other action needed to protect prior surface water and groundwater rights.
6. The issuance of this permit in no way grants any right-of-way or easement across the land of another.
7. Domestic use is for 25 homes.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this

15th day of July, 1991.

MICROFILMED

AUG 01 1991

R. Keith Higginson
R. Keith Higginson, Director

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

- Karey Lane Well Association
1. Name of applicant W. Wayne Georgeson Phone 526-5770
Post office address 305 Karey Lane, Idaho Falls, Id 83402
2. Source of water supply Groundwater which is a tributary of _____
3. Location of point of diversion is _____ 1/4 of SW 1/4 of SE 1/4, Govt. Lot _____
Sec. 18 Township 2N Range 37E B.M. Bonneville County; additional
points of diversion if any: SE 1/4 SE 1/4 Sec 18, T2N, R37E Bonneville
4. Water will be used for the following purposes:
Amount 0.09 for Domestic purposes from 1/1 to 12/31 (both dates inclusive)
(cfs or ~~acre-feet~~ per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
5. Total quantity to be appropriated is (a) 0.09 and/or (b) _____
cubic feet per second acre feet per annum
6. Proposed diverting works:
a. Description of ditches, flumes, pumps, headgates, etc. two wells, pumps, mainline to
25 single domestic homes
b. Height of storage dam _____ feet; active reservoir capacity _____ acre-feet; total
reservoir capacity _____ acre-feet; period of year when water will be diverted to storage:
_____ to _____ inclusive.
c. Proposed well diameter is 8" inches; proposed depth of well is 200 feet.
d. Is ground water with a temperature of greater than 90°F being sought? NO
7. Time required for the completion of the works and application of the water to the proposed beneficial use is
1 years (minimum 1 year).

AUG 01 1991

8. Description of proposed uses (if irrigation only, go to item 9):

- a. Hydropower; show total feet of head and proposed capacity in KW. _____
- b. Stockwatering; list number and kind of livestock. _____
- c. Municipal; show name of municipality. _____
- d. Domestic; show number of households. 25 domestic
- e. Other; describe fully. _____

9. Description of place of use:

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RANGE	SEC.	NE¼				NW¼				SW¼				SE¼				TOTALS
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	
2 N	37 E	18															D	D	

Total number of acres to be irrigated _____

10. Describe any other water rights used for the same purposes as described above. 35-7698


11. a. Who owns the property at the point of diversion? Association
- b. Who owns the land to be irrigated or place of use? Individual home owners
- c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing. _____

12. Remarks: This application will in combination w/ 35-7698 deliver 0.23 of which will cover 26 homes. Irrigation is with canal water

INDEXED

AUG 01 1991

13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

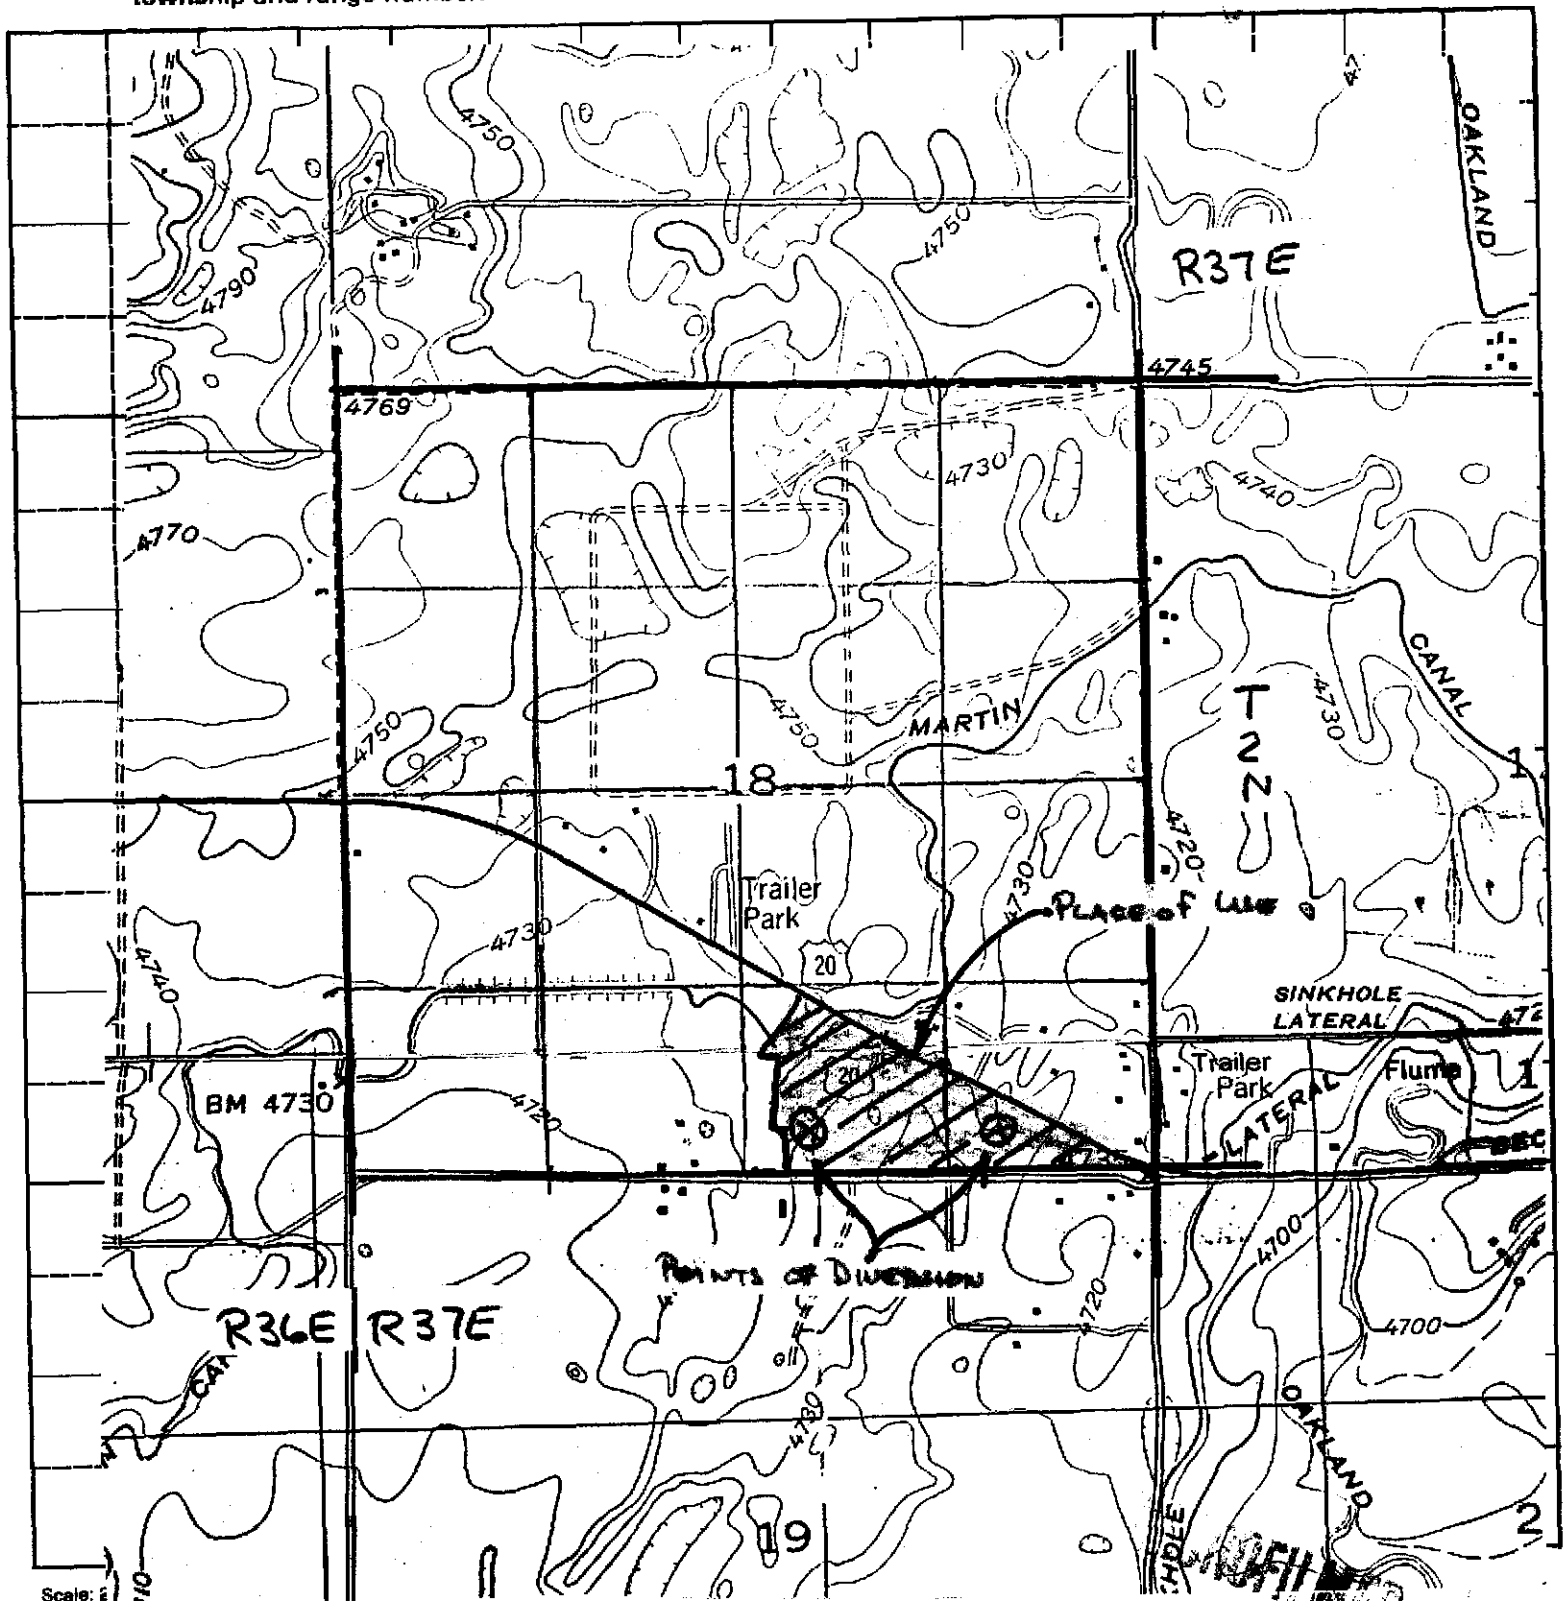

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Wayne H. Georgeson President
(Applicant)

FILED
AUG 01 1994

Assisted by KCW 30 April 91

Received by KCW Date 3 May 91 Time 0945 Preliminary check by _____

Fee \$ 30⁰⁰ Receipted by KCW # E016037 Date 3 May 91

Publication prepared by RB Date 6-6-91 Published in Last Register

Publication approved LB Date 6-17-91

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. _____, and said application is hereby _____.

1. Approval of said application is subject to the following limitations and conditions:

a. SUBJECT TO ALL PRIOR WATER RIGHTS.

b. Proof of construction of works and application of water to beneficial use shall be submitted on or before _____, 19 ____.

c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.

d. The water right acquired under this permit if for hydropower purposes shall be junior and subordinate to all rights to the use of water, other than hydropower, within the State of Idaho that are initiated later in time than the priority of this permit and shall not give rise to any right or claim against any future rights to the use of water, other than hydropower, within the State of Idaho initiated later in time than the priority of this permit.

e. Other:

MICROFILMED

AUG 01 1991

Proof of Publication
The Post-Register

RECEIVED

JUN 14 1991

Department of Water Resources
Eastern District Office

State of Idaho, }
County of Bonneville } ss

I, .. S. BOB BRIGHT or TED DELEZENE, first being duly sworn, depose and say: That I am the .. Production Supervisor or Asst. Prod. Supervisor of The Post Company, a corporation of Idaho Falls, Bonneville County, Idaho, publishers of The Post-Register, a newspaper of general circulation, published daily, except Saturday, at Idaho Falls, Idaho; said Post-Register being a consolidation of the Idaho Falls Times, established in the year 1890, The Idaho Register, established in the year 1880 and the Idaho Falls Post, established in 1903, such consolidation being made on the 1st day of November, 1931, and each of said newspapers have been published continuously and uninterruptedly, prior to consolidation, for more than seventy-eight (78) weeks and said Post-Register having been published continuously and uninterruptedly from the date of such consolidation, up to and including the last publication of notice hereinafter referred to.

That the notice, of which a copy is hereto attached and made a part of this affidavit, was published in said Post-Register for Two consecutive weeks, first publication having been made on the . 6th day of .. June , 1991 .., last publication having been made on the 13th day of .. June , 1991 .., and that the said notice was published in the regular and entire issue of said paper on the respective dates of publication, and that such notice was published in the newspaper and not in a supplement.

Subscribed and sworn to before me, this .13th.. day of .. June , 1991 ..

Steve Walker
Notary Public

My commission expires ... November .7th., 1996 ..

B10

35-08943
KAREY LANE WELL ASSOCIATION
305 KAREY LANE
IDAHO FALLS, ID 83402
Source: GROUNDWATER
Diversion Pt: SWSE Sec 18 T 02N R 37E
SESE Sec 18 T 02N R 37E
Use: DOMESTIC (.090 CFS)
Total Diversion: (.090 CFS)
Date Filed: 5/ 3/ 1991
In: T02N R37E S18 SWSE SESE
The permit(s) will be subject to all prior

water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code and/or the new public interest criteria of Sec. 42-203C, Idaho Code. Protests must be filed with the Director, Dept. of Water Resources, 150 Shoup Ave., Suite 15, Idaho Falls, Idaho 83402 on or before JUNE 24, 1991.
R. Keith Higginson, Director
Published: June 6, 13, 1991

RECEIVED
JUN 01 1991



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Boise, ID 83706 - P.O. Box 83720, Boise, ID 83720-0098
Phone: (208) 327-7900 Fax: (208) 327-7866 Web Site: www.idwr.state.id.us

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

January 7, 2002

KAREY LANE WELL ASSOCIATION
C/O WAYNE GEORGESON
305 KAREY LANE
IDAHO FALLS ID 83402

RE: License No. 35-8943 - Issuance of License

Dear Water Right Holder(s):

The Department of Water Resources has issued the enclosed Water Right License confirming that a water right has been established in accordance with your permit. Please be sure to thoroughly review the conditions of approval and remarks listed on your license.

The license is a PRELIMINARY ORDER issued by the Department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action by the Department unless a party petitions for reconsideration or files an exception and/or brief within fourteen (14) days of the service date as described in the enclosed information sheet.

Please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Failure to report these changes could result in a \$100 late filing fee. Contact any office of the Department or visit the Department's homepage on the Internet to obtain the proper forms and instructions.

If you have any questions, please contact me at 208-327-7946.

Sincerely,

Shelley W. Keen
Water Rights Supervisor

SWK:klt

Enclosure(s)


MICROFILMED
JAN 09 2002

CERTIFICATE OF MAILING

I hereby certify that on January 7, 2002 I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER(Approved License) to the person(s) listed below:

RE: WATER RIGHT NO. 35-8943

**KAREY LANE WELL ASSOCIATION
C/O WAYNE GEORGESON
305 KAREY LANE
IDAHO FALLS ID 83402**

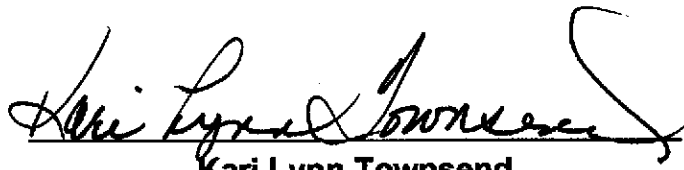A handwritten signature in cursive script, reading "Kari Lynn Townsend", written over a horizontal line.

**Kari Lynn Townsend
Secretary**

MICROFILMED

JAN 09 2002

**EXPLANATORY INFORMATION
TO ACCOMPANY A
PRELIMINARY ORDER**

The accompanying order or approved document is a "Preliminary Order" issued by the department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department of Water Resources (department) unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the department or the Idaho Water Resource Board (Board) is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01303 (Rules of Procedure 302 and 303).

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

Comment Report

35-8943

1. S. Keen 01/03/2002 Licensing Review

Comment: Licensing review and data entry by S. Keen on 1/3/2002. Place of use and point of diversion overlap is decreed water right 35-7698. Together they cover domestic use in 26 homes. Irrigation is from surface water.

2. VAULT 12/12/1991 Proof of Beneficial Use Rcvd

Comment: Proof of Beneficial Use Rcvd

MICROFILMED

JAN 09 2002

RECEIVED

MAY 5 - 1997

Form 219
6/86

Department of Water Resources

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCESDepartment of Water Resources
Eastern District Office

JUL 28 1995

BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

 Permit No. 35-8943
 Phone No. 524-4374/526-4668
 EXAM. DATE: 7-29-1992
 Phone No. _____


1. Owner: Karey Lane Well Association
 Current Address: % Wayne Georgeson, 305 Karey Lane, Idaho Falls 83402
2. Accompanied by: N/A
 Address: _____
 Relationship to Permit Holder: _____
3. Source: Groundwater tributary to _____

B. OVERLAP REVIEW

1. Other water rights with same place of use: _____
☐ Copies Attached
2. Other water rights with same point of diversion: _____
☐ Copies Attached ☐ Copies of Field Exam's Attached

C. SYSTEM DESCRIPTION

1. Diversion System Diagram: Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☐ Alternative diagram attached

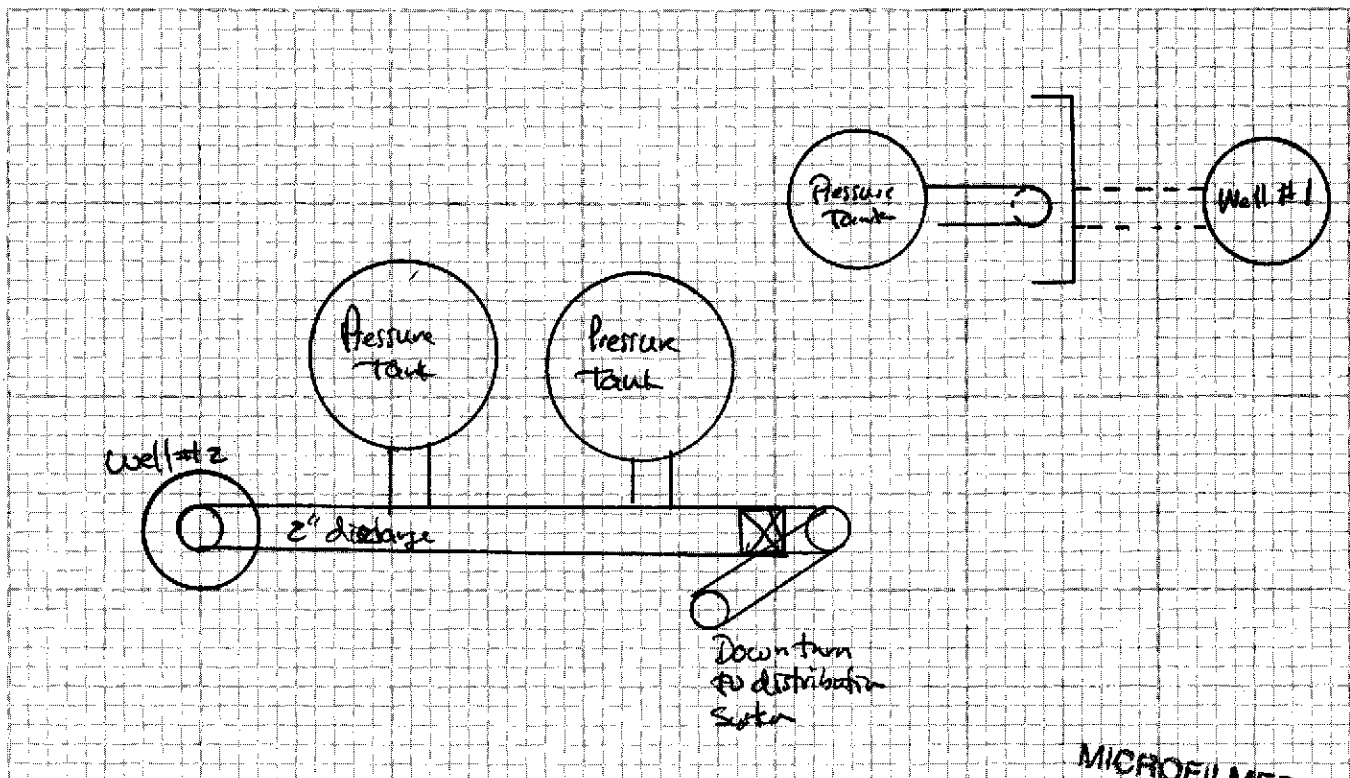

Scale: 1" = _____

2. ☒ Copy of U.S.G.S. Quadrangle Attached
 Showing location(s) of point(s) of diversion and
 place(s) of use (required). ☐ Aerial Photo Attached
 (required for irrigation of 10 acres or more).
- ☐ Photo of Diversion and System Attached
 (required for all but single household domestic groundwater, and stockwater).

MICROFILMED

JAN 09 2002

System Description (continued)

3. **Narrative:** Description (As operating at time of measurement. Indicate pressure, number of sprinklers, etc.)

2 wells pump mainline to pressure tanks to distribution lines to 13 homes @
time of exam. Lots 1, 4, 5, 6, 7, 8, & 12 Block 1; Lots 1, 4, 5, 6, 7, & 11 Scottville
Subdivision #3

Distribution lines to each lot count 26 home sites

☐ See Remarks on page 4 for continuation

4.

Well or Diversion Identification No.*	Motor Make	Hp	Model Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
#2 (SWSE)	Franklin	5	Model	Franklin	2"
	Electric		2821139103	Electric	
#1 (SESE)	Franklin Elec.	5	2821152201	"	"

*Code to correspond with No. on map and aerial photo

5. **Point(s) of Diversion:**

Ident. No.	Gov't. Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
			SW	SE	18	2N	37E	Barnesville	ON SITE/USGS QUAD/subdivision Plat
			SE	SE	18	2N	37E	Barnesville	

6. **Place(s) of Use:**

Indicate Method of Determination

Twp.	Rge.	Sec.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				Totals
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
2N	37E	18															D	D	

Do not use this space

JAN 03 2001

THEORETICAL PUMP FLOW CALCULATIONS

Formula: $Q_{cfs} = [(Hp) (8.814) (Eff)] \div [Lift + (psi \times 2.308)]$

SYSTEM: #1 (SE 1/4 SE 1/4 Sec 18, T2N, R37E)

Hp = Horsepower = 5
Eff = Efficiency = 70% (Usually 70%)
Lift: (Static Level + Assumed Draw down)
Static Water Level = 160 ft.
Assumed Draw down = + 10 ft.
Lift = 170

OR

Measured Dynamic Water Level = _____ ft.

psi = Operating Pressure = 35 psi

$$Q_{cfs} = \left[\frac{5}{Hp} \times 8.814 \times \frac{0.7}{eff} \right] \div \left[\frac{170}{Lift} + \left(\frac{35}{psi} \times 2.308 \right) \right]$$

$$Q_{cfs} = \left[\frac{30.8}{} \right] \div \left[\frac{250.8}{} \right]$$

$$Q_{cfs} = \underline{0.12} \text{ cfs SYSTEM}$$

SYSTEM: #2 (SW 1/4 SE 1/4 Sec 18, T2N, R37E)

Hp = Horsepower = 5
Eff = Efficiency = 70% (Usually 70%)
Lift: (Static Level + Assumed Draw down)
Static Water Level = 200 ft.
Assumed Draw down = + 10 ft.
Lift = 210

OR

Measured Dynamic Water Level = _____ ft.

psi = Operating Pressure = 35 psi

$$Q_{cfs} = \left[\frac{5}{Hp} \times 8.814 \times \frac{.7}{eff} \right] \div \left[\frac{210}{Lift} + \left(\frac{35}{psi} \times 2.308 \right) \right]$$


$$Q_{cfs} = \left[\frac{30.8}{} \right] \div \left[\frac{290.8}{} \right]$$

$$Q_{cfs} = \underline{0.11} \text{ cfs SYSTEM}$$

MICROFILMED
JAN 09 2002

PERMIT NO. 35-08943

S 1/2 SE 1/4 Sec 18 T2N R37E

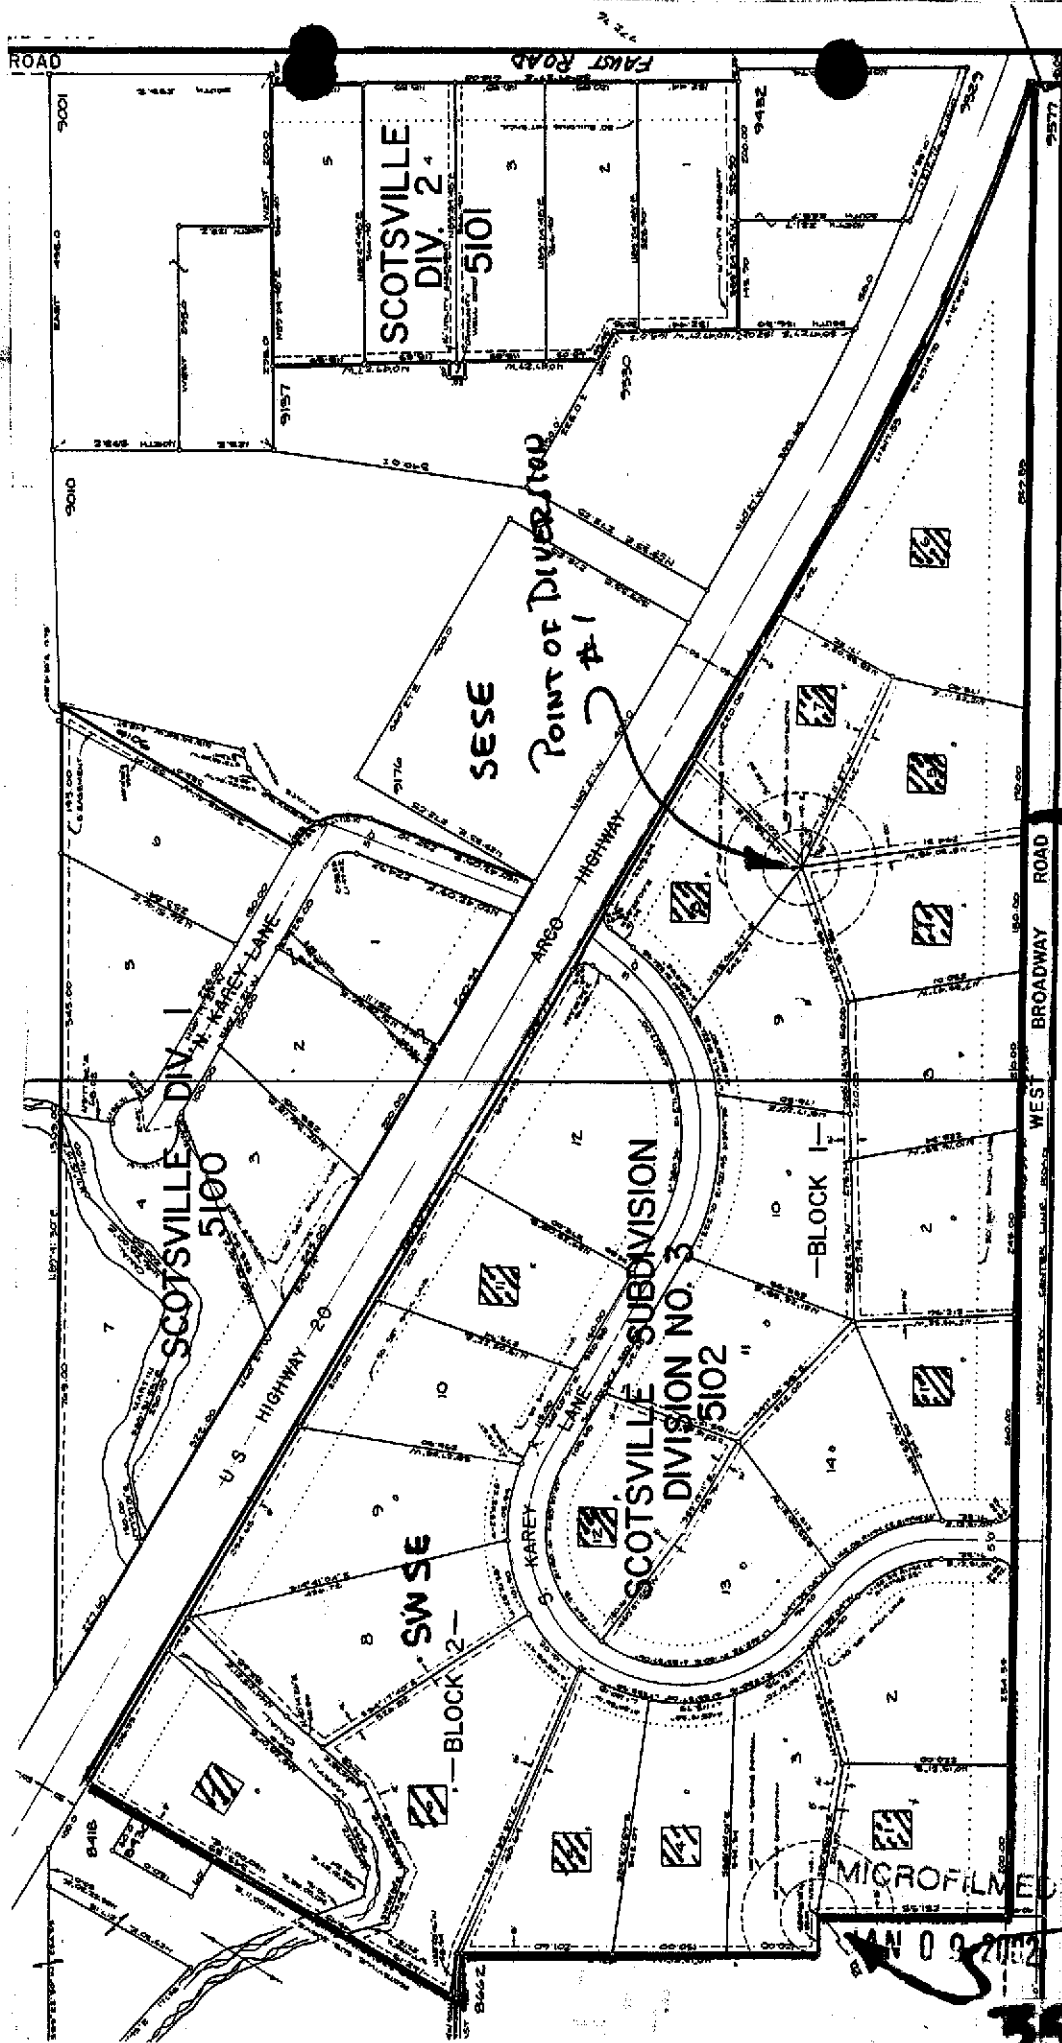

HOME SITES

PLACE OF USE

Point of Diversion #2

35-8943

35-08943

Do not use this space

D. FLOW MEASUREMENTS

☐ Additional Data Sheets Attached

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements:

Pressure 35-55psi 42psi (holding system off) at time of Exam

E. FLOW CALCULATIONS

☒ Additional Computation Sheets Attached

1. Measured Method: Theoretical $Q = 0.12 \text{ cfs} + 0.11 \text{ cfs} = 0.23 \text{ cfs}$

2. Alternate Method for Checking Purposes:

F. PUMP EFFICIENCY DATA (Optional)

Discharge Pressure: _____ psi x 2.31 = _____ ft (1); Dynamic pumping level: _____ ft (2)

Total Head: (1) + (2) = _____ (3) : Flow rate: _____ cfs (4)

Water HP: (3) x (4) ÷ 8.8 = _____ (5)

Meter Input KW: 3.6 x _____ KH x _____ CTR or _____ MULT x _____ PTR x _____ N/ _____ T = _____ (6)

Meter Input HP: (6) x 1.34 = _____ (7)

Panel Input KW: _____ Ave PF x _____ Ave Volts x _____ Ave Amps x .001732 = _____ (6)

Panel Input HP: (6) x 1.34 = _____ (7) Efficiency: (5)/(7) x 100 = _____ %

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$ _____

$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 =$ _____

$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$ _____

2. Volume Calculations for Other Uses:

MICROFILMED
JAN 03 2002

[illegible]

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion	Annual Volume
	From	To	Q (cfs)	V (afa)
DOMESTIC	1/1	12/31		
Totals:				

2. Recommended Amendments

- ☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

Field Examiner's Name Kerth C Wilson
Signature Kerth C Wilson
Certification Date _____
Field Report Preparation Date _____

CONSULTANT SEAL

- K. Licensing recommendation shall be prepared by an Idaho Department of Water Resources employee on a computer printout attached hereto.**

MICROFILMED
JAN 09 2002



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

December 17, 1991

Karey Lane Well Association
c/o Wayne Georgeson
305 Karey Lane
Idaho Falls, ID 83402

Re: Permit No. 35-08943

PROOF ACKNOWLEDGEMENT

Dear Permit Holder:

Enclosed is a copy of the proof of beneficial use you submitted to this office.

Please note the enclosed copy of your permit to appropriate water which indicates a rate of diversion of .09 cfs for domestic purposes. A license cannot be issued for a rate greater than the maximum rate you applied for on the permit.

The total volume for which proof is submitted has been amended to show .09 cfs. For water diverted at a rate of .09 cfs and .14 cfs the license exam fee is the same. Therefore, the Department will continue processing the proof by notifying the region that a field exam is needed.

For the additional cfs of water you have indicated on your proof of beneficial use form, you need to apply for another permit. For assistance in completing an application for permit, please contact our Regional Office.

If you have any questions or if I can be of any further assistance, please feel free to contact me.

Sincerely,

Karen L. Gustafson
Secretary/Records Manager

C: IDWR - Regional Office

RECEIVED
DEC 23 1991

ANALYSIS SHEET
FOR
PROOF OF BENEFICIAL USE

Permit No. 35-08943

Reviewed by KLG

Date 12/17/91

GENERAL CONSIDERATIONS

yes Name same as permit?
yes Address same as permit?
yes Proof timely received? If not, complete calculation below.

SOURCE OF WATER

 Surface water source

✓ Ground water source

NA Drilling permit required?

1976 / Copy in the file? Drilling Permit No.

/ Amount paid for permit Correct?

/ Well log in the file?

LICENSE EXAMINATION FEE

yes Required?

50 Amount Submitted

yes Correct?

MEASURING DEVICE

NA Required?

/ Installed?

/ Waiver requested?

PRIORITY CALCULATION

Date proof received NA

Date proof due -

No. of days late =

Priority Date +

New Priority Date

DEFICIENCIES OR ACTION ITEMS

can only issue license for .09 -
need to apply for another permit
for additional cfs

proof acceptable

DATA ENTRY

New Address

Proof Made 12/12/91

12/20/91 KLG



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

July 18, 1991

KAREY LANE WELL ASSOCIATION
C/O WAYNE GEORGESON
305 KAREY LANE
IDAHO FALLS, ID 83402

PERMIT APPROVAL NOTICE

RE: PERMIT NO. 35-08943

Dear Permit Holder:

Enclosed is a copy of your approved application for permit. We direct your attention to the conditions of approval on the final page.

Enclosed is a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit. Also enclosed is a form entitled "Proof of Beneficial Use". If your project is already completed you should complete and submit this form immediately.

Section 42-235, Idaho Code, requires that a "drilling permit" must be obtained from the department for all wells constructed after July 1, 1987. A drilling permit is a separate permit that must be issued in addition to your permit to appropriate water. Commencement of well construction or diversion of water under your permit to appropriate water is prohibited unless a drilling permit is obtained.

You should be aware that you are located within a drainage basin where surface water diversions are regulated by a watermaster. It is possible that diversion of groundwater under your permit may cause a reduction of surface water flow. Siting your well as far as possible from surface water channels and casing your well so that groundwater tributary to surface water flows are not diverted will reduce the potential for the watermaster to regulate your water use.

Sincerely,

PAMELA SKAGGS
Technical Records Specialist

MICROFILMED

AUG 01 1991

APPLICATION FOR PERMIT REVIEW

Application #: 35-8943
Date: 7-16-91

Reviewer: Pam Skaggs ^{CB}

✓ Existing:

✓ No - 26A-P17
✓ Complete in 1 year - P16

Yes

Proof not submitted - P16
Proof submitted - N/A

✓ Groundwater:

GT. 0.2 cfs - 01G-P03, 01C-P03 (existing well)
LT. 0.2 cfs - N/A

✓ Drilling Permit:

Approved w/permit - P99
Not included - 046-P23 (All GW, even existing wells)

✓ Location:

✓ Water Districts - WD No. 01
Surface water - 005, 005-01H-P01 (LT.2 w/pump)
005-01J-P08 (GT.2)

✓ Groundwater - P05

Irrigation Districts - 023

Canal Co. Areas - 023

Drainage Districts - 024

Boise Front (63) - 058 (Groundwater)

✓ Swan Falls Flag - / (1, Blank or Other)

Trust - 051-052-053-P74 (Consumptive Uses)

✓ Non Trust - 048-049

River Basins:

(Surface Water) Water District Control Condition &....

Boise (63) - 05A & 11E

Payette (65) - 047-P04, 059-P71

Snake (01, 02 & 03) - 11A-P04 (01), 061-P07 (02/03 No W.D. Cond.)

Use:

Fish Propagation - 06A, 09E-P10 & 010 (WQ/Choose One),
042 (req.), 002-P06 (MD), 07A (Spec.),
044 (Policy 5G)

Power - Use Power Review

Mining - 06A or 010, 09E-P10 & 054 (req.)

Storage - 18A-for multiple measuring devices (In WD),
18B-P09 (Size)

Rec. & Aesthetic - 027 (Non-Consumptive)

Domestic - 021 (restricted areas)

✓ Ownership:

✓ Non land owner - 004

Protested:

Agreement - 020

✓ Beneficial Use Due Date: - 07-01-1992
Other Conditions Recommended

MICROFILMED

AUG 01 1991

Dist. for staffing: 5-15-1991
Submitted for advertising: 5-20-1991

Form No. 202a
4/87

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATIONS FOR PERMIT ANALYSIS SHEET

35-8943

INITIAL REVIEW BY HWS DATE 5-20-91 APPLICATION NO. _____
APPLICANT NAME: KAREY LANE WELL ASSOCIATION

REQUIRED INFORMATION

- ☒ Name (If applicant is a corporation or partnership, names must be provided for the director, officers, & other partners.)
☒ Address
☒ Source (See USGS Quad for names of water sources)
☒ Point of Diversion (10 acres for spring, lot & block descriptions for subdivisions, local name, flow and/or volume)
☒ County
☒ Quantity (flow and/or volume)
☒ Period of Use
☒ Nature of proposed use (Include description of use.)
☒ Description of diverting works
☒ Time required for beneficial use of water
☒ Place of use or acres irrigated
☒ Map
☒ Signature (If applicant is corp. partnership, or municipality, title of signator is required)
☒ Fee
☒ Yes _____ No* In form to receipt

ADDITIONAL INFORMATION

- ☒ Overlapping place of use (Describe source & relationship to present application on the back.)
Overlapping point of diversion
Yes _____ No _____ Field check required
Field check by _____
Yes _____ No _____ Field report attached
Yes _____ No _____ Critical groundwater area
Yes _____ No _____ Groundwater management area
Yes _____ No _____ Send dam safety information
Yes _____ No _____ Send power requirement letter
Yes _____ No _____ Send fish farm requirement letter
Yes _____ No _____ Power residency affidavit
Yes _____ No _____ Power efficiency form
Yes _____ No _____ Within trustwater boundary (If yes, attach trust water supplementary analysis sheet.)
Yes _____ No _____ Diversion greater than 5 cfs or 500 acre ft. (If yes, attach large diversion supplementary analysis sheet.)

See reverse side for additional information

*REQUEST THE FOLLOWING ADDITIONAL INFORMATION FROM THE APPLICANT

Date Requested _____

RECEIVED
JUL 01 1991

Department of Water Resources

PROCESSING ☒ Yes ☐ No In form for advertising
☒ Yes ☐ No Statewide advertising
☒ Yes ☐ No Fee amount, receipt date & No. recorded on application

SEND COPIES TO NONE Idaho Dept. of Health & Welfare U.S. BLM
Idaho Dept. of Fish & Game U.S. Forest Service
Idaho Dept. of Lands Water District
Adjudication Bureau Unit Other

FINAL REGIONAL PROCESSING REVIEW

☒ Yes ☐ No Affidavit of publication received
☒ Yes ☐ No Application published correctly. If not, record action taken.

☒ Yes ☐ No Publication dates & paper, recorded on application
☐ Yes ☒ No Protests received
Final date for protest 6-24-91
☐ Yes ☐ No Protests, dates, resolution of protest, recorded on application
☐ Yes ☐ No Recommendations, attached
☐ Yes ☐ No Measuring device required
☐ Yes ☐ No Access port required
☐ Yes ☐ No Will water be delivered by watermaster? If yes, what Dist. _____
☐ Yes ☐ No Special conditions of approval or cover letter below. _____

See below for additional information
Date of priority recommended 5-03-91
By HWT Date 6-26-91

STATE OFFICE REVIEW

See below for additional information
By _____ Date _____

ADDITIONAL INFORMATION

Overlap - 35-7698

LOCAL PUBLIC INTEREST

Comments received from

_____ City	_____ Idaho Fish & Game	_____ Irrigation District
_____ County	_____ Idaho Health & Welfare	_____ Canal Company
_____ Reservations	_____ Division of Environment	_____ Other _____

Project impacts/implications report

COMMENTS

30-May-1991

WAYNE GEORGESON
KAREY LANE WELL ASSOC
305 KAREY LANE
IDAHO FALLS ID 83402

RE: Application No. 35-08943

Dear Water Right Applicant:

The Department of Water Resources acknowledges receipt of your water right permit. This office is currently in the process of advertising the application in Post-Register on June 6 & 13, 1991. The advertisement will be published for two consecutive weeks, and a period of ten days following the second publication will be allowed for the submittal of protests.

If the application is protested, you will be sent a copy of the protest. The protest must be resolved before the application is approved or denied. If the protest is not resolved voluntarily, this Department will conduct a conference and/or hearing on the matter.

If the application is not protested, it will be forwarded to our state office in about five weeks. State office personnel will conduct a complete review prior to final processing of the application and will notify you of the outcome of this review. When a permit is issued, you will be sent a copy. A typical processing time for an unprotested application is about eight weeks.

Please feel free to contact this office if you have any questions regarding this procedure.

Sincerely,

HAROLD W. JONES
Water Rights Supervisor

HWJ/rb

MICROFILMED

AUG 01 1991

35-08943

KAREY LANE WELL ASSOCIATION
305 KAREY LANE
IDAHO FALLS, ID 83402

Source: GROUNDWATER

Diversion Pt:	SWSE	Sec 18 T 02N R 37E
	SESE	Sec 18 T 02N R 37E

Use: DOMESTIC	(.090 CFS)
Total Diversion:	(.090 CFS)

Date Filed: 5/ 3/ 1991

In: T02N R37E S18	SWSE	SESE
-------------------	------	------

MICROFILMED

AUG 01 1991

The permit(s) will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code and/or the new public interest criteria of Sec. 42-203C, Idaho Code. Protests must be filed with the Director, Dept. of Water Resources, 150 Shoup Ave., Suite 15, Idaho Falls, Idaho 83402 on or before JUNE 24, 1991.

R. Keith Higginson, Director

Published 6/ 6/1991 & 6/13/1991

MICROFILMED

AUG 01 1991