



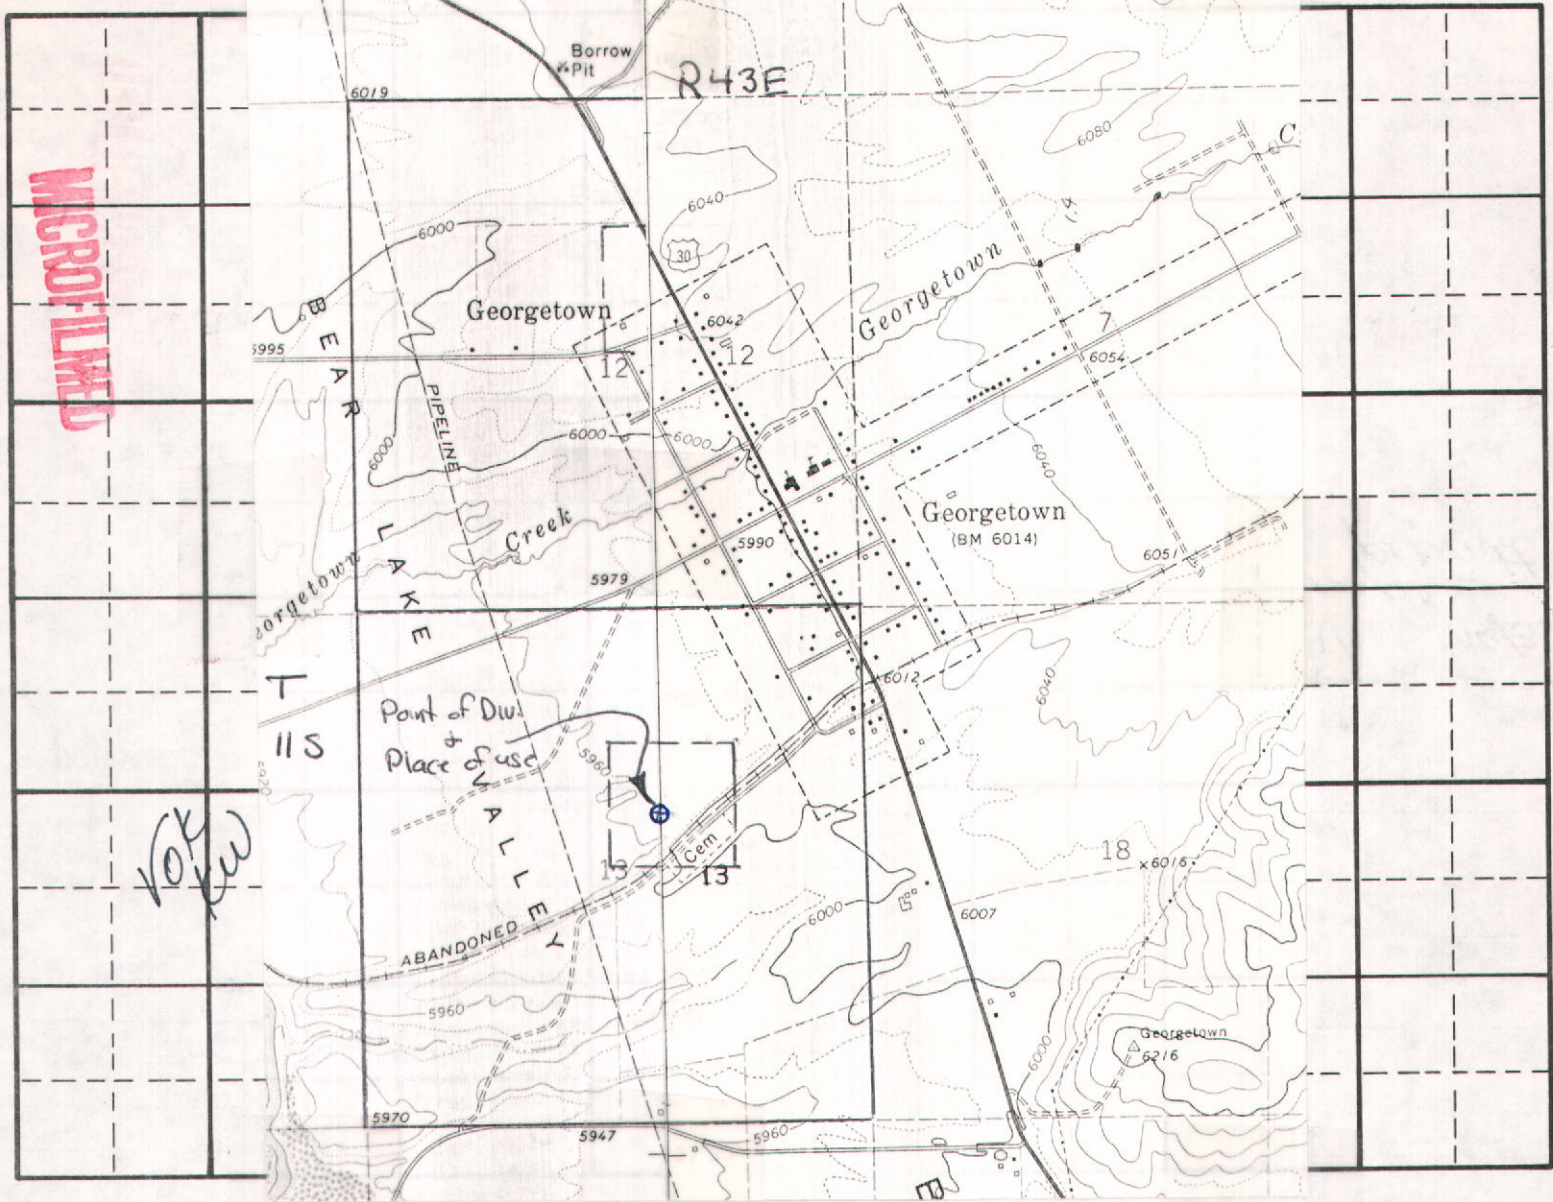

SCHEMATIC DIAGRAM OF SYSTEM

(Include distance from pump to measuring device, if applicable.)

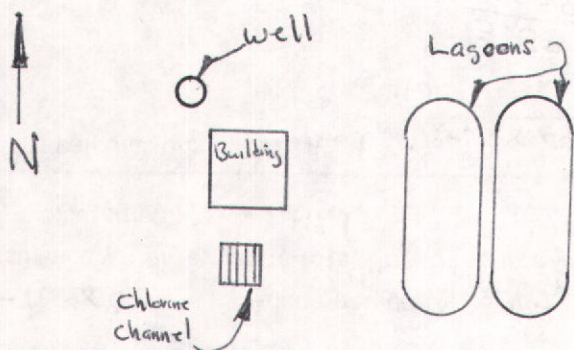

same as permit

Point(s) of diversion: SW 1/4 NE 1/4 Sect. 13 T11S R43E

Place(s) of Use *same as permit*

TWP.	RGE.	SEC.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				TOTALS
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
11S	43E	13			X														

Recommended Amendments:

- ☐ Change P.D. as reflected above
☐ Change P.U. as reflected above

- ☐ Add P.D. as reflected above
☐ Add P.U. as reflected above

- ☒ None
☐ Other

Examiner's Signature

Checked by

Approved by

Keith Wilson
Ray Walker

Date

Date

Date

1-5-83
12 Jan 1984
1-18-84

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

License of Water Right No. 11-7272 Priority October 22, 1981 Amount 0.02 cfs

THIS IS TO CERTIFY, that City of Georgetown
of Georgetown, Idaho, has complied with the terms and conditions of Permit
No. 11-7272 issued pursuant to Application for Permit dated October 22, 1981,
and has submitted proof to the Department of Water Resources on December 20, 1982,
that he has applied water to a beneficial use; an examination by the Department indicates that the works have a
capacity for the diversion of 0.03 cfs of water from a groundwater source,
tributary to _____, and that the permit holder has applied to a beneficial use and
established a right to use water as follows:

Beneficial Use	Period of Use	Rate of Diversion	Annual Volume
<u>Municipal</u>	from <u>January 1</u> to <u>December 31</u> at <u>0.02</u> cfs and <u>n/a</u>		
	from _____ to _____ cfs and _____		
	from _____ to _____ at _____ cfs and _____		
	(both dates inclusive)		

Subject, however, to the condition that no more than 0.02 cfs of water be diverted at any one time, and
that the amount of water so diverted and to which such right is entitled and confirmed is for the purpose
aforementioned and is limited to the amount which can actually be beneficially used and shall not exceed
n/a acre feet per year, said waters to be diverted within the SW $\frac{1}{4}$ NE $\frac{1}{4}$ Section 13
Twp 11S, Rge 43E in the County of Bear Lake

Description and location of place of use:

Twp.	Range	Sec.	NE $\frac{1}{4}$				NW $\frac{1}{4}$				SW $\frac{1}{4}$				SE $\frac{1}{4}$				Totals
			NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	
11S	43E	13			X														

Total number of acres irrigated _____

Municipal use is for operation of chlorination system of city sewer system.

NOTE: Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho Law. This right may be forfeited by five years of non-use.

The right to the use of the water hereby confirmed is restricted and appurtenant to the lands or place of use herein described, and is subject to all prior water rights, as provided by the laws of Idaho.

Witness the seal and signature of the Director, affixed at Boise, Idaho, this 28TH day of MARCH, 19 84.

Acting for the Director

Roman C Young

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

APPROVED

To appropriate the public waters of the State of Idaho

1. Name of applicant City of Georgetown Phone (208) 847-2120

Post office address Georgetown, Idaho 83239

2. Source of water supply ground water which is a tributary of _____

3. Location of point of diversion is SW $\frac{1}{4}$ of NE $\frac{1}{4}$ of Section 13 Township 11 S.

Range 43 E. B.M. Bear Lake County, additional points of diversion if any: _____

4. Water will be used for the following purposes:

Amount 0.02 for operate chlorination tanks for city sewer system (MUNICIPAL) purposes from Nov. 1 to Oct. 31 (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated:

a. 0.02 cubic feet per second and/or b. _____ acre-feet per annum.

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc. 230-V - Sup. Pump operated by a 1/2 H.P. motor - Well is to supply water to operate the chlorination system for the city sewer system.

b. Height of storage dam _____ feet, active reservoir capacity _____ acre-feet; total reservoir capacity _____ acre-feet, materials used in storage dam: _____

Period of year when water will be diverted to storage _____ to _____ inclusive.
(Month/Day) (Month/Day)

c. Proposed well diameter is 6 inches; proposed depth of well is 40 feet.

7. Time required for the completion of the works and application of the water to the proposed beneficial use is 1 years (minimum 1 year - maximum 5 years).

8. Description of proposed uses:

a. If water is not for irrigation:

(1) Give the place of use of water: SW $\frac{1}{4}$ of NE $\frac{1}{4}$ of Section 13 Township 11 S.
Range 43 E. B.M.

(2) Amount of power to be generated: _____ horsepower under _____ feet of head.

(3) List number of each kind of livestock to be watered _____

(4) Name of municipality to be served _____, or number of families to be supplied with domestic water _____

(5) If water is to be used for other purposes describe: Water will be used to operate the chlorination system for the city sewer system.

MICROFILMED

MICROCELL MED

10. Remarks

applicant to make this filing

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the

b. Who owns the land to be irrigated or place of use

City of Georgetown

9. a. Who owns the property at the point of diversion

City of Georgetown

c. Describe any other water rights used for the same purposes as described above.

Total number of acres to be irrigated

[illegible]

b. If water is for irrigation, indicate acreage in each subdivision in the tabulation below:

11. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

R. 43E

A hand-drawn map on a grid showing numbered points 9 through 22. Point 13 is marked with a dot and labeled "Point of diversion and place of use" with an arrow. The map is oriented with "T." (Top) at the top, "N." (North) on the right, "S." (South) on the left, and "W." (West) at the bottom.

Point Number	Approximate Grid Coordinates (Row, Column)	Notes
9	(1, 1)	
10	(1, 3)	
11	(1, 6)	
12	(1, 8)	
13	(2, 8)	Point of diversion and place of use
14	(2, 6)	
15	(2, 3)	
16	(2, 1)	
17	(3, 1)	
18	(3, 3)	
19	(3, 1)	
20	(3, 3)	
21	(3, 6)	
22	(3, 8)	

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

City of Georgetown

(Applicant)

(Applicant)
Allen L. Miller
City Clerk

MICROFILMED

Chief, Operations Bureau

J. Allen Saylor

Witness my hand this 4th day of January, 19 82.

d. Other:

c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.

for February 1, 19 83.

b. Proof of construction of works and application of water to beneficial use shall be submitted on or be-

a. SUBJECT TO ALL PRIOR WATER RIGHTS.

1. Approval of said application is subject to the following limitations and conditions:

of Idaho No. 11-7272, and said application is hereby APPROVED.

This is to certify that I have examined Application for Permit to appropriate the public waters of the State

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

Recommended for approval denial by BMC

Hearing held by _____ Date _____

Copies of protests forwarded by _____

Protests filed by: None

Publication approved OK Date 12-11-81

Publication dates 11-5 & 11-12-81

Published in Newspaper

Publication prepared by BMC Date 10-28-81

Received by OK Date 10-22-81 # 1929

Preliminary check by HUT Fee \$ 30.00

Received by OK Date 10/19/81 Time 11:05 am

Proposed Priority 10/22/1981

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO,
County of Bear Lake

ss.

being duly sworn,

deposes and says:

That he is the Editor of THE NEWS-EXAMINER, a weekly newspaper published at Montpelier, in the County of Bear Lake and State of Idaho; and said paper has been and is in general circulation in the county aforesaid, and in the vicinity of Montpelier; that the advertisement, a copy of which is attached hereto, was published in said newspaper once a week for 11 consecutive weeks in the regular and entire issue of said paper during the period and time of publication, and was published in the newspaper proper and not a supplement; that said paper has been established and regularly published for more than seventy-eight consecutive weeks prior to the date of first publication of said advertisement.

Such notice was published in the issue beginning with

11/5, 1981, and ending with the issue of 11/12, 1981.

Fees, 26.00

Subscribed and sworn to before me this 3rd day of December, 1981.

Notary Public, Residing at Montpelier, Idaho

My Commission Expires Nov, 1985

LEGAL NO. 1850

NOTICE OF APPLICATION FOR WATER RIGHT

Notice is hereby given that the following application(s) have been submitted for permit to appropriate the public waters of the State of Idaho:

11-7273

CITY OF GEORGETOWN
GEORGETOWN, ID 83230

Source: GROUNDWATER

Date Filed: 10-23-1981

Amount: 0.02 CFS

Diversion Point: SWNE Sec 13 T 11S R 43E, BEAR LAKE Co.

Use: MUNICIPAL (0.02 CFS)
from 11-01 to 10-31

Place of Use: SWNE Sec 13 T 11S R 43E

Diversion Means: WELL AND SUMP PUMP

11-7273

MORGAN, GRANT S.

P.O. BOX 53, OVID, ID 83360

Source: SPRING tributary to SINKS

Date Filed: 10-23-1981

Amount: 1.00 CFS

Diversion Point: NESE Sec 04 T 13S R 43E, BEAR LAKE Co.

Use: IRRIGATION (1.00 CFS)
from 04-15 to 10-15

Place of Use: NESE SWSE SESE Sec 04 T 13S R 43E FOR 60 ACRES

Diversion Means: HOLDING POND AND SPRINKLER SYSTEM

If issued, the permit(s) will be subject to all prior water rights. Protests against the granting of any permit must be filed with the Director of the Idaho Department of Water Resources, 160 Shoup Ave., Idaho Falls, Idaho 83402 on or before NOVEMBER 23, 1981.

A. KENNETH DUNN
Director

Published 11-5 & 11-12-81.

11-5, 11-12
48 LINES

RECEIVED

DEC 10 1981

Idaho Department of Water Resources
Eastern District Office

MICROFILMED

LEGAL NO. 1880

**NOTICE OF APPLICATION
FOR WATER RIGHT**

Notice is hereby given that the following application(s) have been submitted for permit to appropriate the public waters of the State of Idaho:

11-7272

CITY OF GEORGETOWN

GEORGETOWN, ID

Source: GROUNDWATER

Date Filed: 10-22-1960

Amount: 0.02 CFS

Diversion Point: SWNE Sec 13 T 11S R

43E, BEAR LAKE

Use: MUNICIPAL (0.02 CFS)

from 11-01 to 10-31

Place of Use: SWNE Sec 13 T 11S R

43E

Diversion Means: WELL AND SUMP

PUMP

March 29, 1984

RE: Permit No. 11-7272

City of Georgetown
Georgetown,
Idaho 83239

Gentlemen:

Enclosed herewith is a copy of the Water Right License issued on the above referenced Permit.

Sincerely,



JIM JOHNSON
Water Distribution Supervisor

JJ:kw
Enclosure

MICROFILMED

79-**RECEIVED**
JUN 16 1984

State of Idaho
DEPARTMENT OF WATER RESOURCES
FIELD REPORT

Department of Water Resources

11-7272
Permit No.

CONTACT WITH PERMIT HOLDER

DATE	INITIALS	REMARKS
------	----------	---------

- ☐ Appointment letter mailed: _____

☐ Telephone call made: _____
(List Telephone No. used) _____

☐ Appointment scheduled for: _____
(Date, time, location) _____

EXAMINATION

Date 8-16-83 Accompanied by NA Total Q measured (Theoretical) 0.03 fs

If source is surface water, estimate total flow of source

Methods of measurement Theoretical Meets Permit requirements? Yes

Measurement calculations: Theoretical $\frac{1/2 \text{ hp} \times 8.814 \times .8}{40' + (35 \text{ psi} \times 2.308')} = 0.03 \text{ cfs}$
 $\frac{3.53}{120.78} =$

[illegible]

System Description
The system is designed to provide a secure and efficient way to manage user accounts and permissions. It includes a user registration process, a login system, and a role-based access control (RBAC) system. The system is built using a modern web framework and a database.

**Code with map on reverse side. Disregard code if only one.*

RECOMMENDED AMOUNTS

USE
Mnemonic ✓

Irrigation requirement $\leq$ _____ AFA/Acre

Q (cfs)	V (afa)	FROM	TO
0.02		11	12-3

~~1-1~~ ~~1-2-3~~
11/1 10/31
(as per permit,

Total 0.02 N/A

Remarks Water used at Georgetown City Sewage treatment plant to dilute Chlorine in treating wastewater.

1-5-83
12 Jan 1984
1-18-84


☒ None

[illegible]

✓ Same as parent


SW 1/4 NE 1/4 Sect. 13 T11S R43E

same as parent.

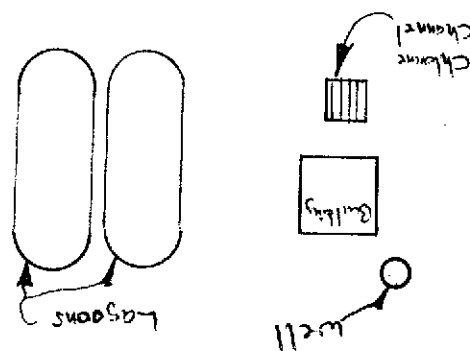

(Include distance from pump to measuring device, if applicable.)

SCHEMATIC DIAGRAM OF SYSTEM

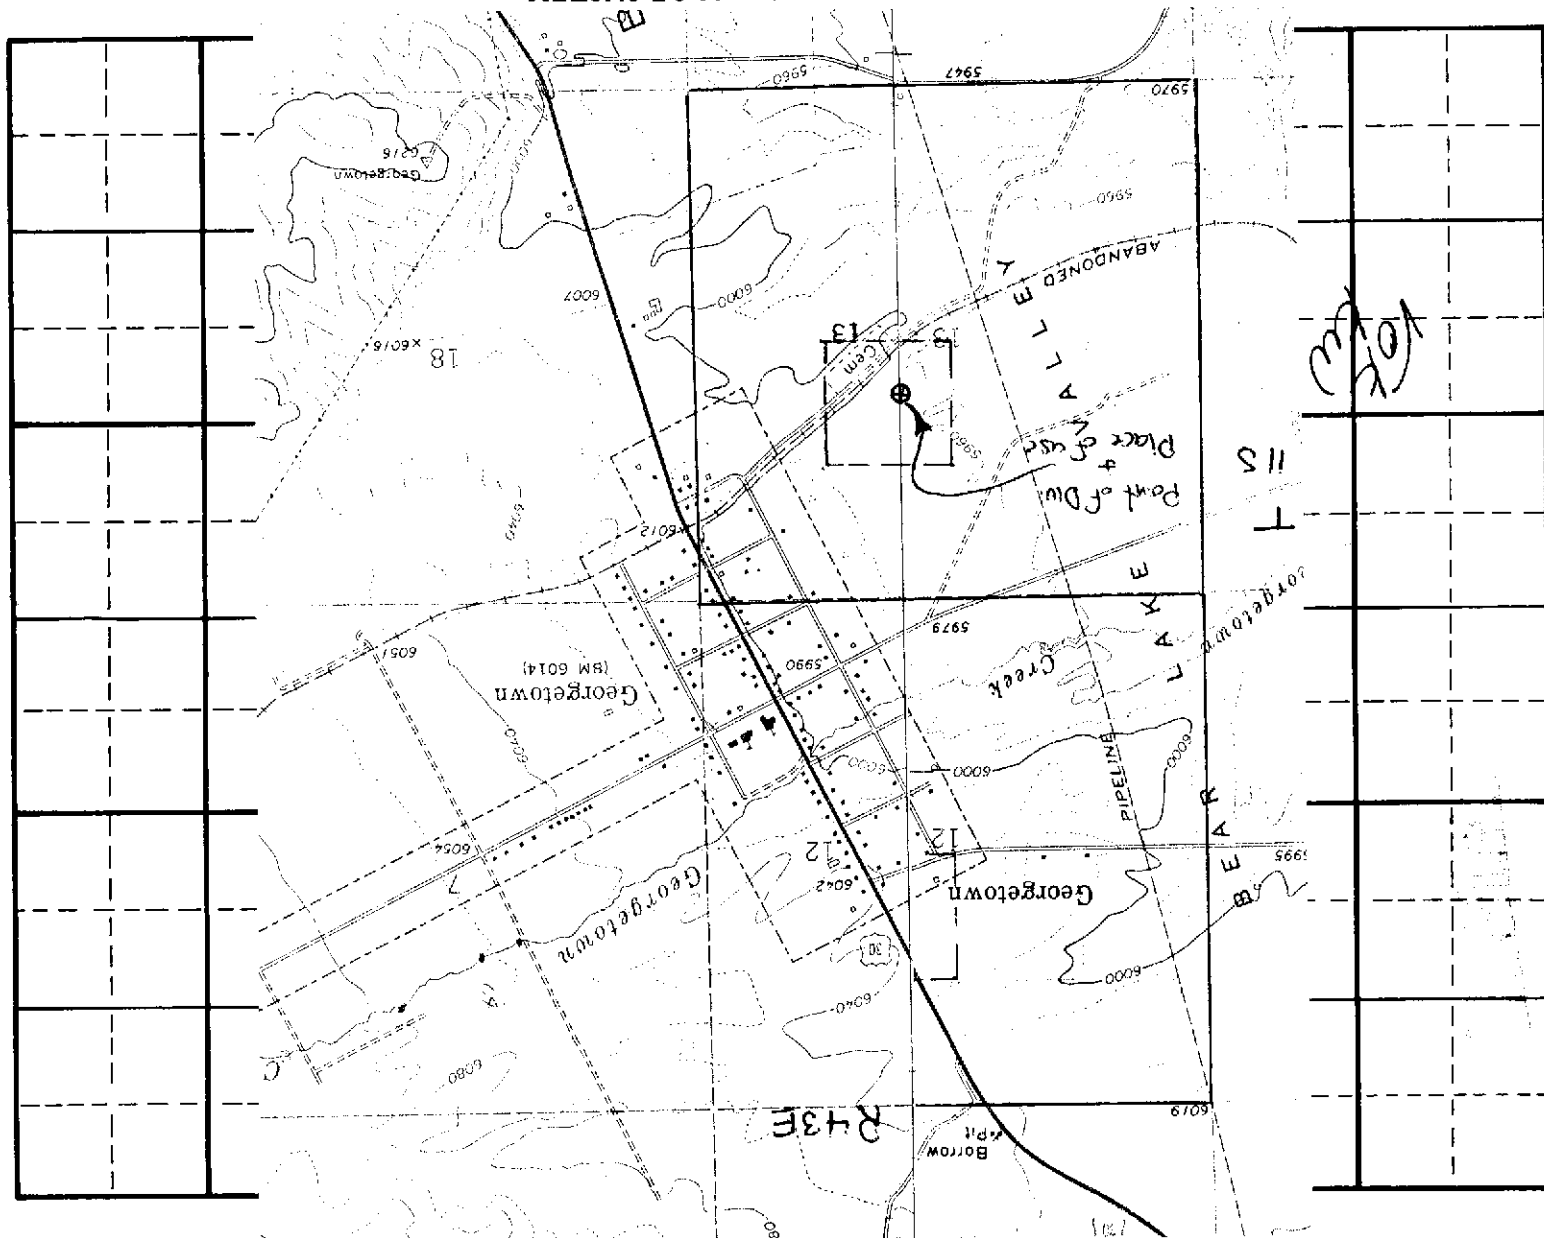

PERMIT NO. 11-7272 City of Georgetown
(Name)

EXAMINATION: DATE: 8-16-83 Accompanied by: NA

Motor Make	HP	Motor Serial No.	Pump Make	Pump Serial No.
NA	1/2	NA	NA	


Measuring Device Type: Throat
Meter # _____ Annubar # _____ Size # _____

Remarks: water used at city sewage treatment facility

Measurement calculations:
pump set at 40'

SCHEMATIC DIAGRAM OF SYSTEM

Mainline Diameter _____ Length _____

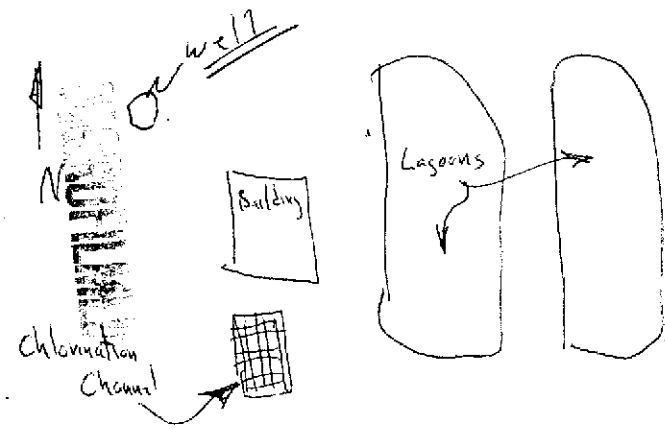



STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
EASTERN REGION

John V. Evans
Governor

150 Shoup
Idaho Falls, Idaho 83401
(208) 525-7161

A. Kenneth Dunn
Director

March 8, 1983

City of Georgetown
Georgetown,
Idaho 83239

RE: Permit No. 11-7272

Dear Permit Holder:

We acknowledge receipt of your statement submitted as proof of beneficial use for the above referenced permit.

Before a license can be issued, a field examination must be made by a representative of this Department.

☐ A field examination of your system has been scheduled for _____.

If this time and date is not convenient for you, please contact this office as soon as possible.

☒ A field examiner will contact you to arrange to examine your system.

If you have any questions regarding the field examination, please contact this office.

Sincerely,

HAROLD W. JONES
Sr. Resource Agent

HWJ:CM

RECEIVED

DEPARTMENT OF WATER RESOURCES

The Idaho Department of Water Resources will consider this card as a statement that the permit holder(s) has completed development to the extent shown below of Permit No. 11-7272

Name(s) of Permit Holder: City of Geopetown

Post Office Address: Geopetown, Idaho 83239

Tel. No. 847-2120

Source of Water: Spring

Extent of Use: ☒ Domestic 180 (number of households)
☐ Stockwater (number and type of stock)
☐ Irrigation (acres)
☐ Other

Measuring Device: Required? ☐ Yes ☒ No Installed? ☐ Yes ☐ No


Access Port: Required? ☐ Yes ☒ No Installed? ☐ Yes ☐ No

The above information is a true statement of the extent to which the above numbered permit has been developed.

12/13/82
Date

Bob C. Cook, Councilman
Signature of Permit Holder

City of Georgetown
Georgetown, Idaho 83237

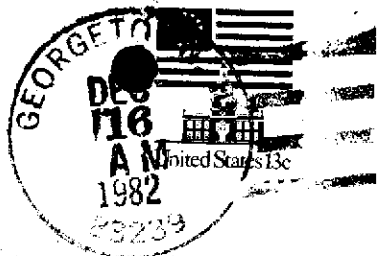

IDAHO DEPARTMENT OF WATER RESOURCES
STATEHOUSE
BOISE, IDAHO 83720

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

STATEHOUSE
BOISE, IDAHO 83720
(208) 334-4440
CERTIFIED MAIL

138947

CITY OF GEORGETOWN
GEORGETOWN, ID 83239

NOVEMBER 30, 1982

DEAR PERMIT HOLDER:

ONE OF THE CONDITIONS OF APPROVAL OF YOUR WATER PERMIT NO. 11-7272 WAS THAT EVIDENCE OF THE EXTENT OF DEVELOPMENT MUST BE SUBMITTED TO THIS OFFICE ON OR BEFORE FEBRUARY 01, 1983. (SEE LAST PAGE OF YOUR APPROVED PERMIT). ENCLOSED IS A POST CARD WHICH MAY BE USED TO SUBMIT THE REQUIRED PROOF OF BENEFICIAL USE.

IF YOU HAVE NOT FULLY COMPLETED YOUR PROJECT, AND YOU HAVE NOT PREVIOUSLY RECEIVED AN EXTENSION OF TIME, YOU MAY REQUEST AN EXTENSION OF TIME PROVIDED THE DELAY IS FOR REASONABLE CAUSE AS INDICATED IN SECTION 42-204, IDAHO CODE, AMENDED. IF YOU HAVE BEEN PREVENTED FROM PROCEEDING BY A GOVERNMENTAL AGENCY OR BY LITIGATION, MORE THAN ONE EXTENSION OF TIME CAN BE GRANTED.

EITHER THE BENEFICIAL USE POST CARD OR A REQUEST FOR AN EXTENSION OF TIME MUST BE RECEIVED BY THIS DEPARTMENT ON OR BEFORE THE ABOVE MENTIONED DATE, OTHERWISE, THE PERMIT WILL LAPSE AND BE OF NO FURTHER FORCE OR EFFECT WITHIN 60 DAYS.

SINCERELY,

RITA FLECK
SR. SECRETARY

ENC: 1

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

STATEHOUSE
BOISE, IDAHO 83720
(208) 334-4440

CITY OF GEORGETOWN
GEORGETOWN, ID 83239

JANUARY 13, 1982

RE: PERMIT NO. 11-7272

DEAR PERMIT HOLDER:

ENCLOSED IS A COPY OF YOUR APPROVED APPLICATION FOR PERMIT. WE DIRECT YOUR ATTENTION TO THE CONDITIONS OF APPROVAL ON THE FOURTH PAGE.

WE HAVE ENCLOSED A FORM ENTITLED "MAKING PROOF OF BENEFICIAL USE". PLEASE READ THE INSTRUCTIONS CAREFULLY SINCE YOU MUST TAKE FURTHER ACTION TO DEVELOP THIS PERMIT INTO A LICENSE.

SINCERELY,

DAVID R. TUTTILL, JR., P.E.
SUPERVISOR, WATER ALLOCATION SECTION

ENCLOSURE

11-7272-1000

State of Idaho
Department of Water Resources

APPLICATION FOR PERMIT ANALYSIS SHEET

11 7272

INITIAL REVIEW BY: HWS

APPLICATION NUMBER: 11-7272

CHECK:

- ☒ Source.
☒ Point of diversion.
☒ County.
☒ Quantity of water and period of use.
☒ Description of diverting works.
☒ Time required for beneficial use of water.
☒ Place of use or acres irrigated.
☒ Map.
☒ Signature.
☒ Fee.
☒ Yes ☒ No Field check required.
☒ Yes ☒ No Critical groundwater area.
☒ Yes ☒ No Request dam safety information. Sent by: _____ Date: _____
☒ Yes ☒ No* In form to receipt.

Field check by: _____

Date: _____

Comments: _____

*REQUEST THE FOLLOWING ADDITIONAL INFORMATION FROM THE APPLICANT: _____

SEND COPIES TO:

- ☐ Idaho State Health Department.
☐ Idaho Fish and Game Department.
☐ Idaho Department of Lands.
☐ U.S. Bureau of Land Management.
☐ U.S. Forest Service.
☐ Other _____

Copies sent by: _____ Date: _____

PROCESSING:

- ☐ Yes ☒ No Platted by: _____ Map No. _____
☐ Yes ☒ No Other rights on same place of use. _____
☒ Yes ☐ No* In form for advertising.
Final date for protests: Nov. 23, 81 ✓
☐ Yes ☒ No Protests received. If yes, record information on 4th page of application.

FINAL REGIONAL PROCESSING REVIEW:

- ☒ Affidavit of publication received. Date: Dec. 10, 1981 ✓
☒ Application published correctly. If not, record action taken: _____
☒ Fee amount, receipt date & number, recorded on application.
☒ Publication dates and paper, recorded on application.
☒ Protests, dates, withdrawal, etc., recorded on application.
☒ Recommendation & initial, recorded on application.
☐ Yes ☒ No Measuring device required.
☐ Yes ☒ No Access port required.
☐ Yes ☒ No Will water be delivered by watermaster? If yes, what district? _____
☒ 10-22-1981 Date of priority recommended.
✓ Special conditions of approval or cover letter. _____


By: Ernest Carlson Date: Jan 14, 1981

STATE OFFICE REVIEW:

return receipt w/ cover letter

- ☐ See attached sheet for more information.

By: [Signature] Date: 12/29/81

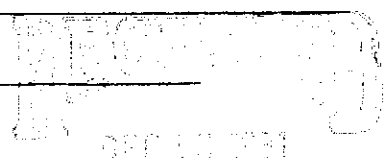

December 7, 1981

RE: Application for Permit No. 11-7272 CITY OF GEORGETOWN

News Examiner
P.O. Box 278
Montpelier, Idaho 83254

Gentlemen:

Would you please submit an affidavit of publication and certified bill in connection with the above referenced application(s). The legal notice was to have been published in your paper on November 5 and 12, 1981.

Your cooperation in this matter is greatly appreciated.

Very truly yours,

COLLEEN WRAY
Adm. Secretary

MICROFILMED

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Eastern Region

150 Shoup Ave.
Idaho Falls, Idaho 83402
(208) 525-7161

OCTOBER 29, 1981

The News-Examiner
P. O. Box 278
Montpelier, Idaho 83254

Gentlemen:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. We have allowed ample time for you to submit a galley proof to this office for review before the first publication date. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billings to this office before NOVEMBER 23, 1981.

Yours truly,

RONALD D. CARLSON
Supervisor
Eastern Region

Encl.

RECEIVED
OCT 30 1981
DEPT. OF WATER RESOURCES
EASTERN REGION
IDAHO FALLS, IDAHO

NOTICE OF APPLICATION FOR WATER RIGHT

Notice is hereby given that the following application(s) have been submitted for permit to appropriate the public waters of the State of Idaho:

If issued, the permit(s) will be subject to all prior water rights. Protests against the granting of any permit must be filed with the Director of the Idaho Department of Water Resources, 150 Shoup Ave., Idaho Falls, Idaho 83402 on or before NOVEMBER 23, 1981.

A. KENNETH DUNN

Director

Published 11/5 & 11/12/81.

11-7272_

CITY OF GEORGETOWN

GEORGETOWN, ID 83239

Source: GROUNDWATER

Date Filed: 10/22/1981

Amount: 0.02 CFS

Diversion Point: SWNE Sec 13 T 11S R 43E, BEAR LAKE Co.

Use: MUNICIPAL (0.02 CFS) from 11/01 to 10/31

Place of Use: SWNE Sec 13 T 11S R 43E

Diversion Means: WELL AND SUMP PUMP



STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
EASTERN REGION

John V. Evans
Governor

150 Shoup
Idaho Falls, Idaho 83401
(208) 525-7161

A. Kenneth Dunn
Director

October 20, 1981

Aleen Miller, Clerk
City of Georgetown
Box 797
Georgetown, Idaho 83239

Dear Ms. Miller:

Enclosed you will find Georgetown City's application for permit. In order for this office to process the application, two things must be done. Someone must sign the application stating the position they hold for the city. Secondly, a fee of \$30 will be required, made out to the Department of Water Resources.

Please send your check and completed application back to this office for final processing.

Sincerely,

Harold W. Jones
HAROLD W. JONES
Water Resource Agent

HWJ:brs

enc: as stated

12/20/81 11:11 AM
12/20/81 11:11 AM

October 20, 1981

Aleen Miller, Clerk
City of Georgetown
Box 797
Georgetown, Idaho 83239

Dear Ms. Miller:

Enclosed you will find Georgetown City's application for permit. In order for this office to process the application, two things must be done. Someone must sign the application stating the position they hold for the city. Secondly, a fee of \$30 will be required, made out to the Department of Water Resources.

Please send your check and completed application back to this office for final processing.

Sincerely,

HAROLD W. JONES
Water Resource Agent

HWJ:bra

enc: as stated

RECEIVED

City of Georgetown

GEORGETOWN, IDAHO 83239

October 16, 1981

Harold W. Jones
Idaho Falls, Idaho 83401

Dear Mr. Jones,

Enclosed you will find the complete application
for the water permit on the well that was drilled
at the sewer lagoon.

Sincerely

Aleen D. Miller, Clerk

September 19, 1981

City of Georgetown
Georgetown
Idaho 83239

Gentlemen:

We received a telephone call from Georgetown recently in response to our inquiry on an industrial well. This particular well ~~was~~ drilled for the city by Westlake Drilling in May of this year.

In accordance with state regulations, all wells will be filed on with the Department of Water Resources. The only exception is a domestic well for a single family residence.

I have enclosed an application for permit for the city's use.

If you have any questions, please feel free to call me.

Sincerely,

HAROLD W. JONES
Sr. Resource Agent

HWJ:brs

enc: as stated

RECEIVED