



Field Exam
Map

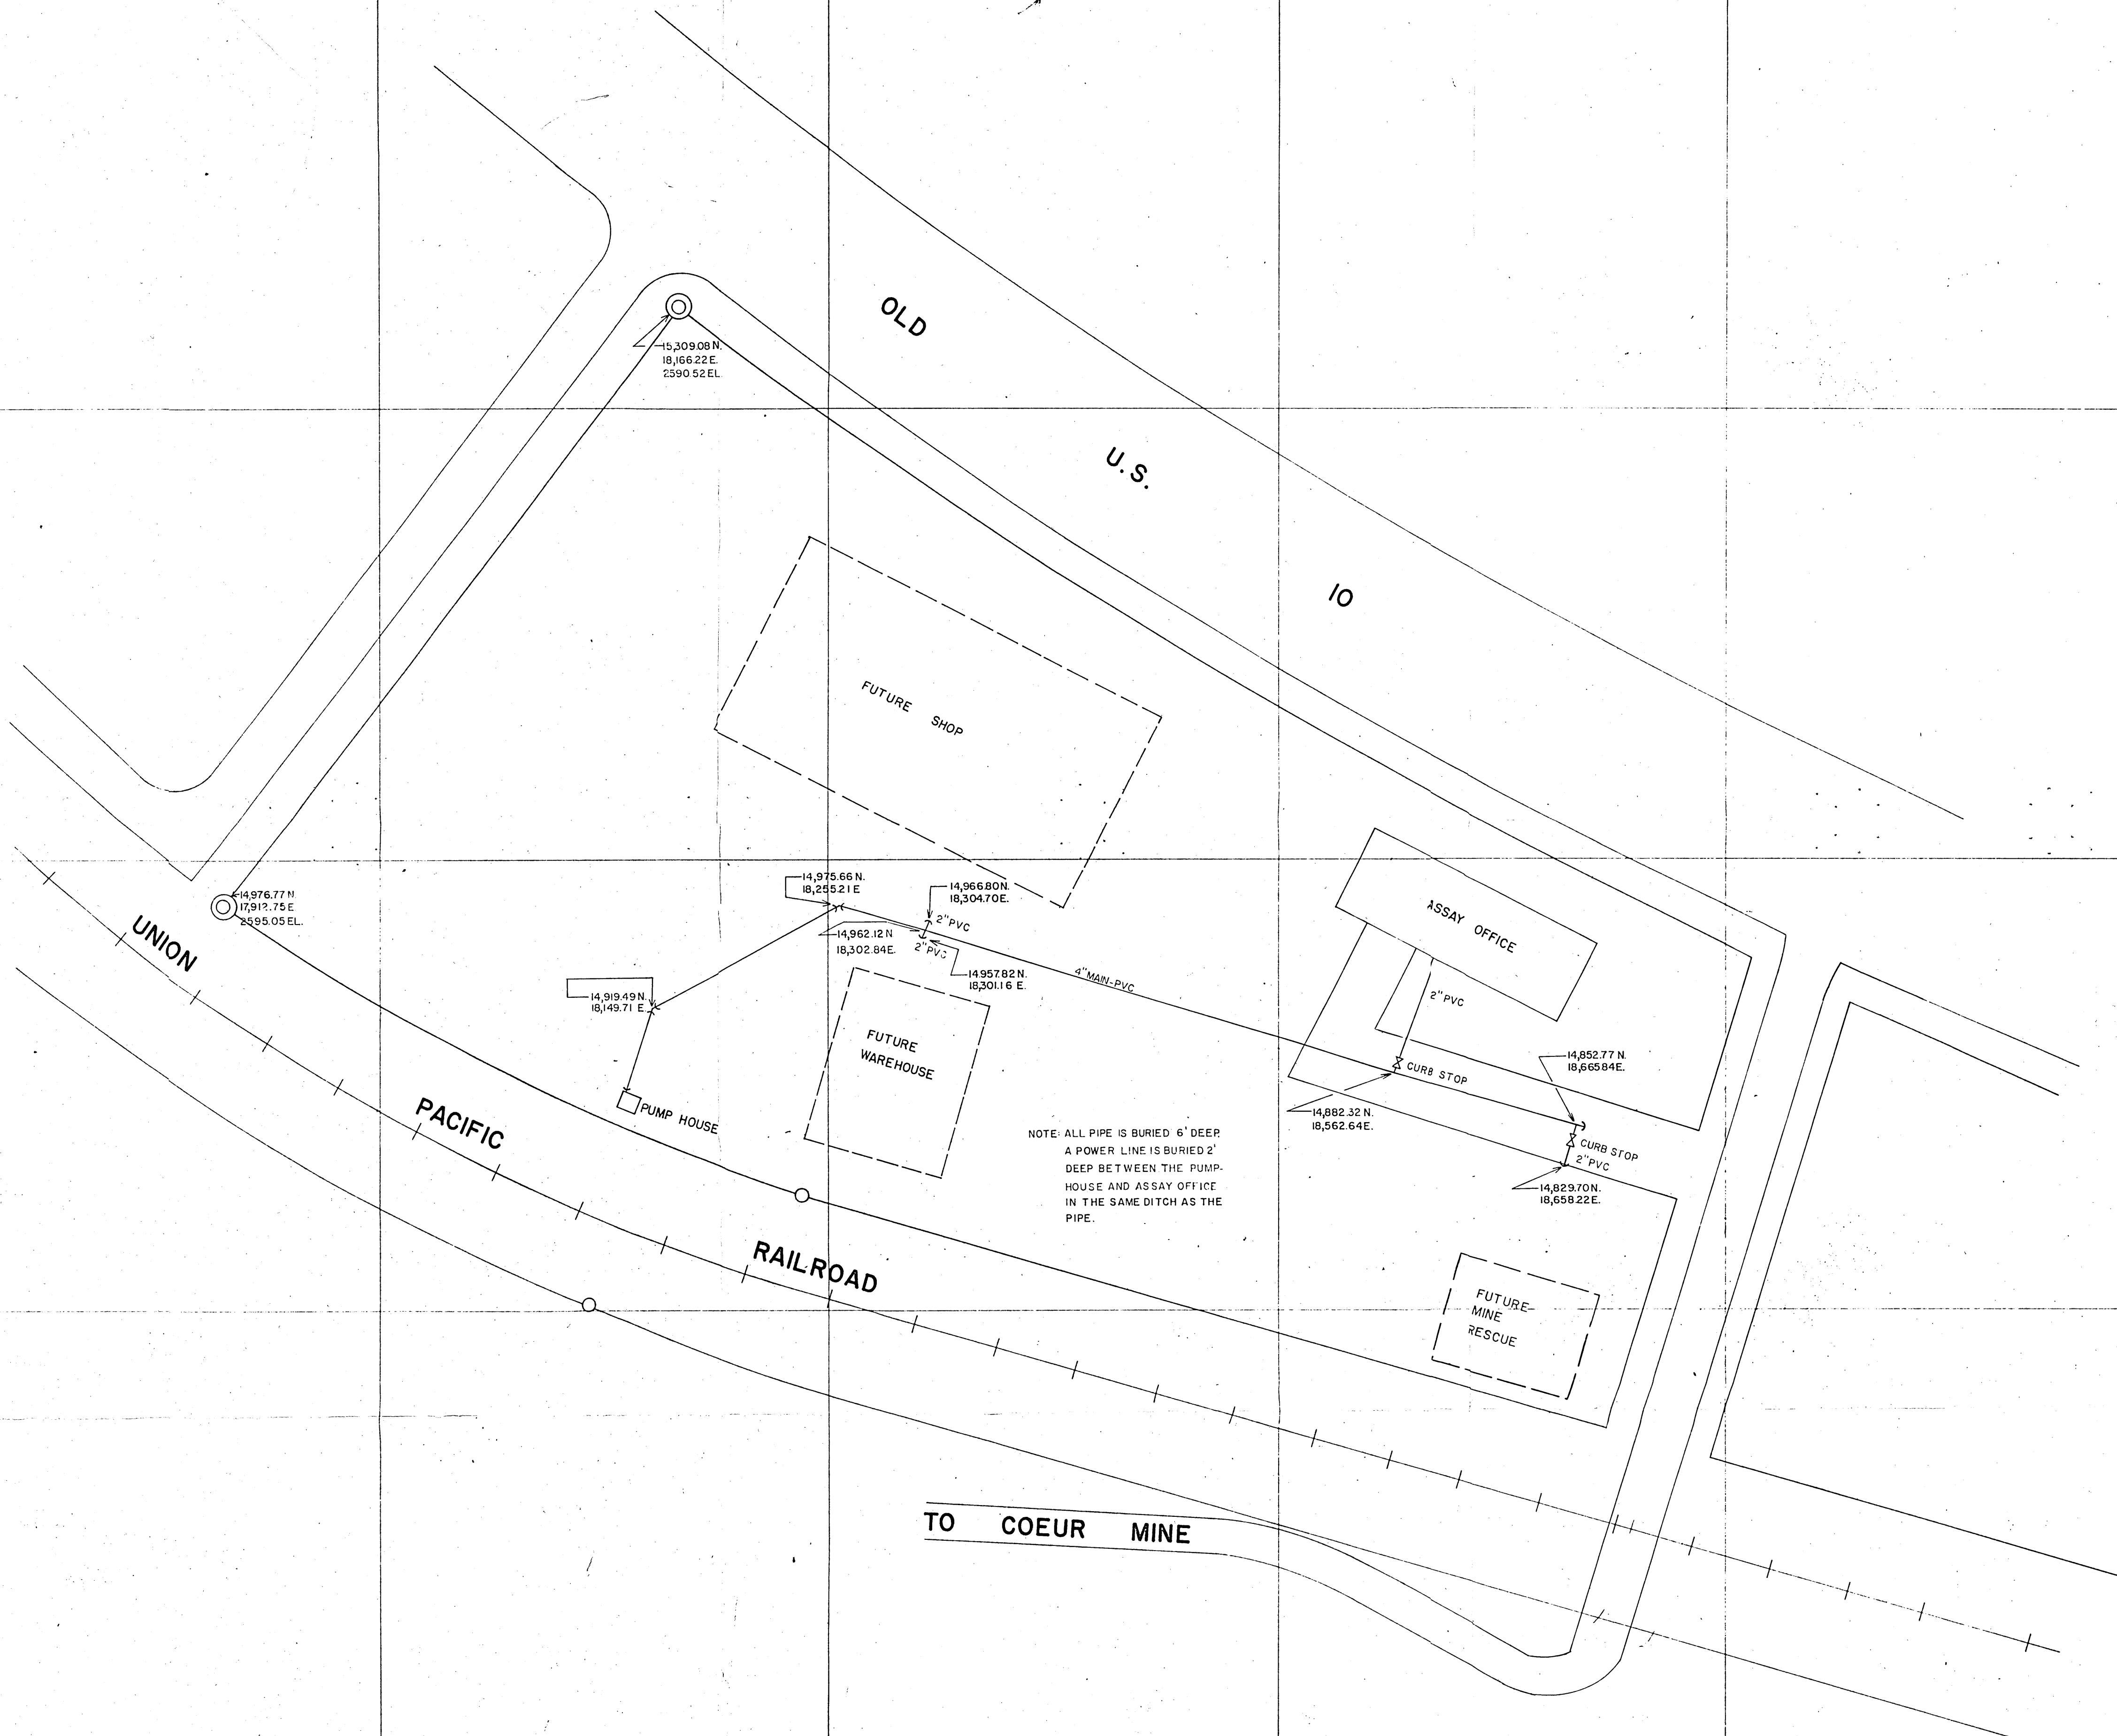

NOTE: ALL PIPE IS BURIED 6' DEEP.
A POWER LINE IS BURIED 2'
DEEP BETWEEN THE PUMP
HOUSE AND ASSAY OFFICE
IN THE SAME DITCH AS THE
PIPE.

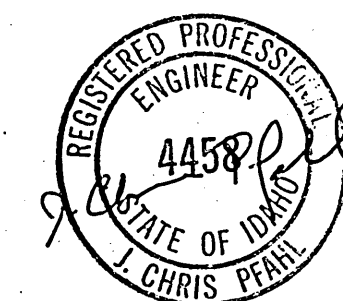

DWG. NO.	TITLE	DWG. NO.	TITLE	NO.	BY	DATE	DESCRIPTION
N-412-W-B-49	PUMP HOUSE						

CONFIDENTIAL MATERIAL. This drawing is the Property of ASARCO Incorporated and is loaned to the borrower with the understanding that it shall not be reproduced, copied, lent or disposed of directly or indirectly nor used for any purpose other than that for which it is specifically furnished.			
BY	DATE	DESCRIPTION	
JWB	10/26/83	PIPELINE COORDINATES ADDED	

PRELIMINARY	
REVISED-DESTROY PREVIOUS ISSUE	
RELEASED FOR CONSTRUCTION	
ISSUED BY	
DATE	

SCALE 1" = 50'	
DRAWN BY 9/29/81 JCP	
CHECKED BY	
APPROVED	
CHIEF DESIGN ENGINEER	
DATE PRINTED	

ASARCO Incorporated NORTHWESTERN MINING DEPARTMENT P.O. BOX 440 WALLACE, IDAHO 83873		UNIT: WALLACE OFFICE	
CENTRAL FACILITY		ASARCO	
WATER SYSTEM PIPING		DRAWING NO.	
		REV.	
N-412-W-E-79			