

State of Idaho
Department of Water Resources

RECOMMENDATION OF WATERMASTER

Application No: 71709
Water Right No: 36-16195 et al
Applicant Name: Larry Gulick

Watermaster's Recommendation:

- a) ☐ I do not oppose approval of this application
- b) ☒ I do not oppose approval of this application if it is conditioned as follows:


(115) Measuring device/data logger required

- c) ☐ I oppose approval of this application(s) for the following reasons:
- d) ☒ Additional comment:


Draft conditions ok. However there is a domestic/stock right 36-15028 and a second well which must be associated with the transfer because the two wells are interconnected.

Dated: August 18, 2005

Water District 130



Cindy Yenter, Watermaster

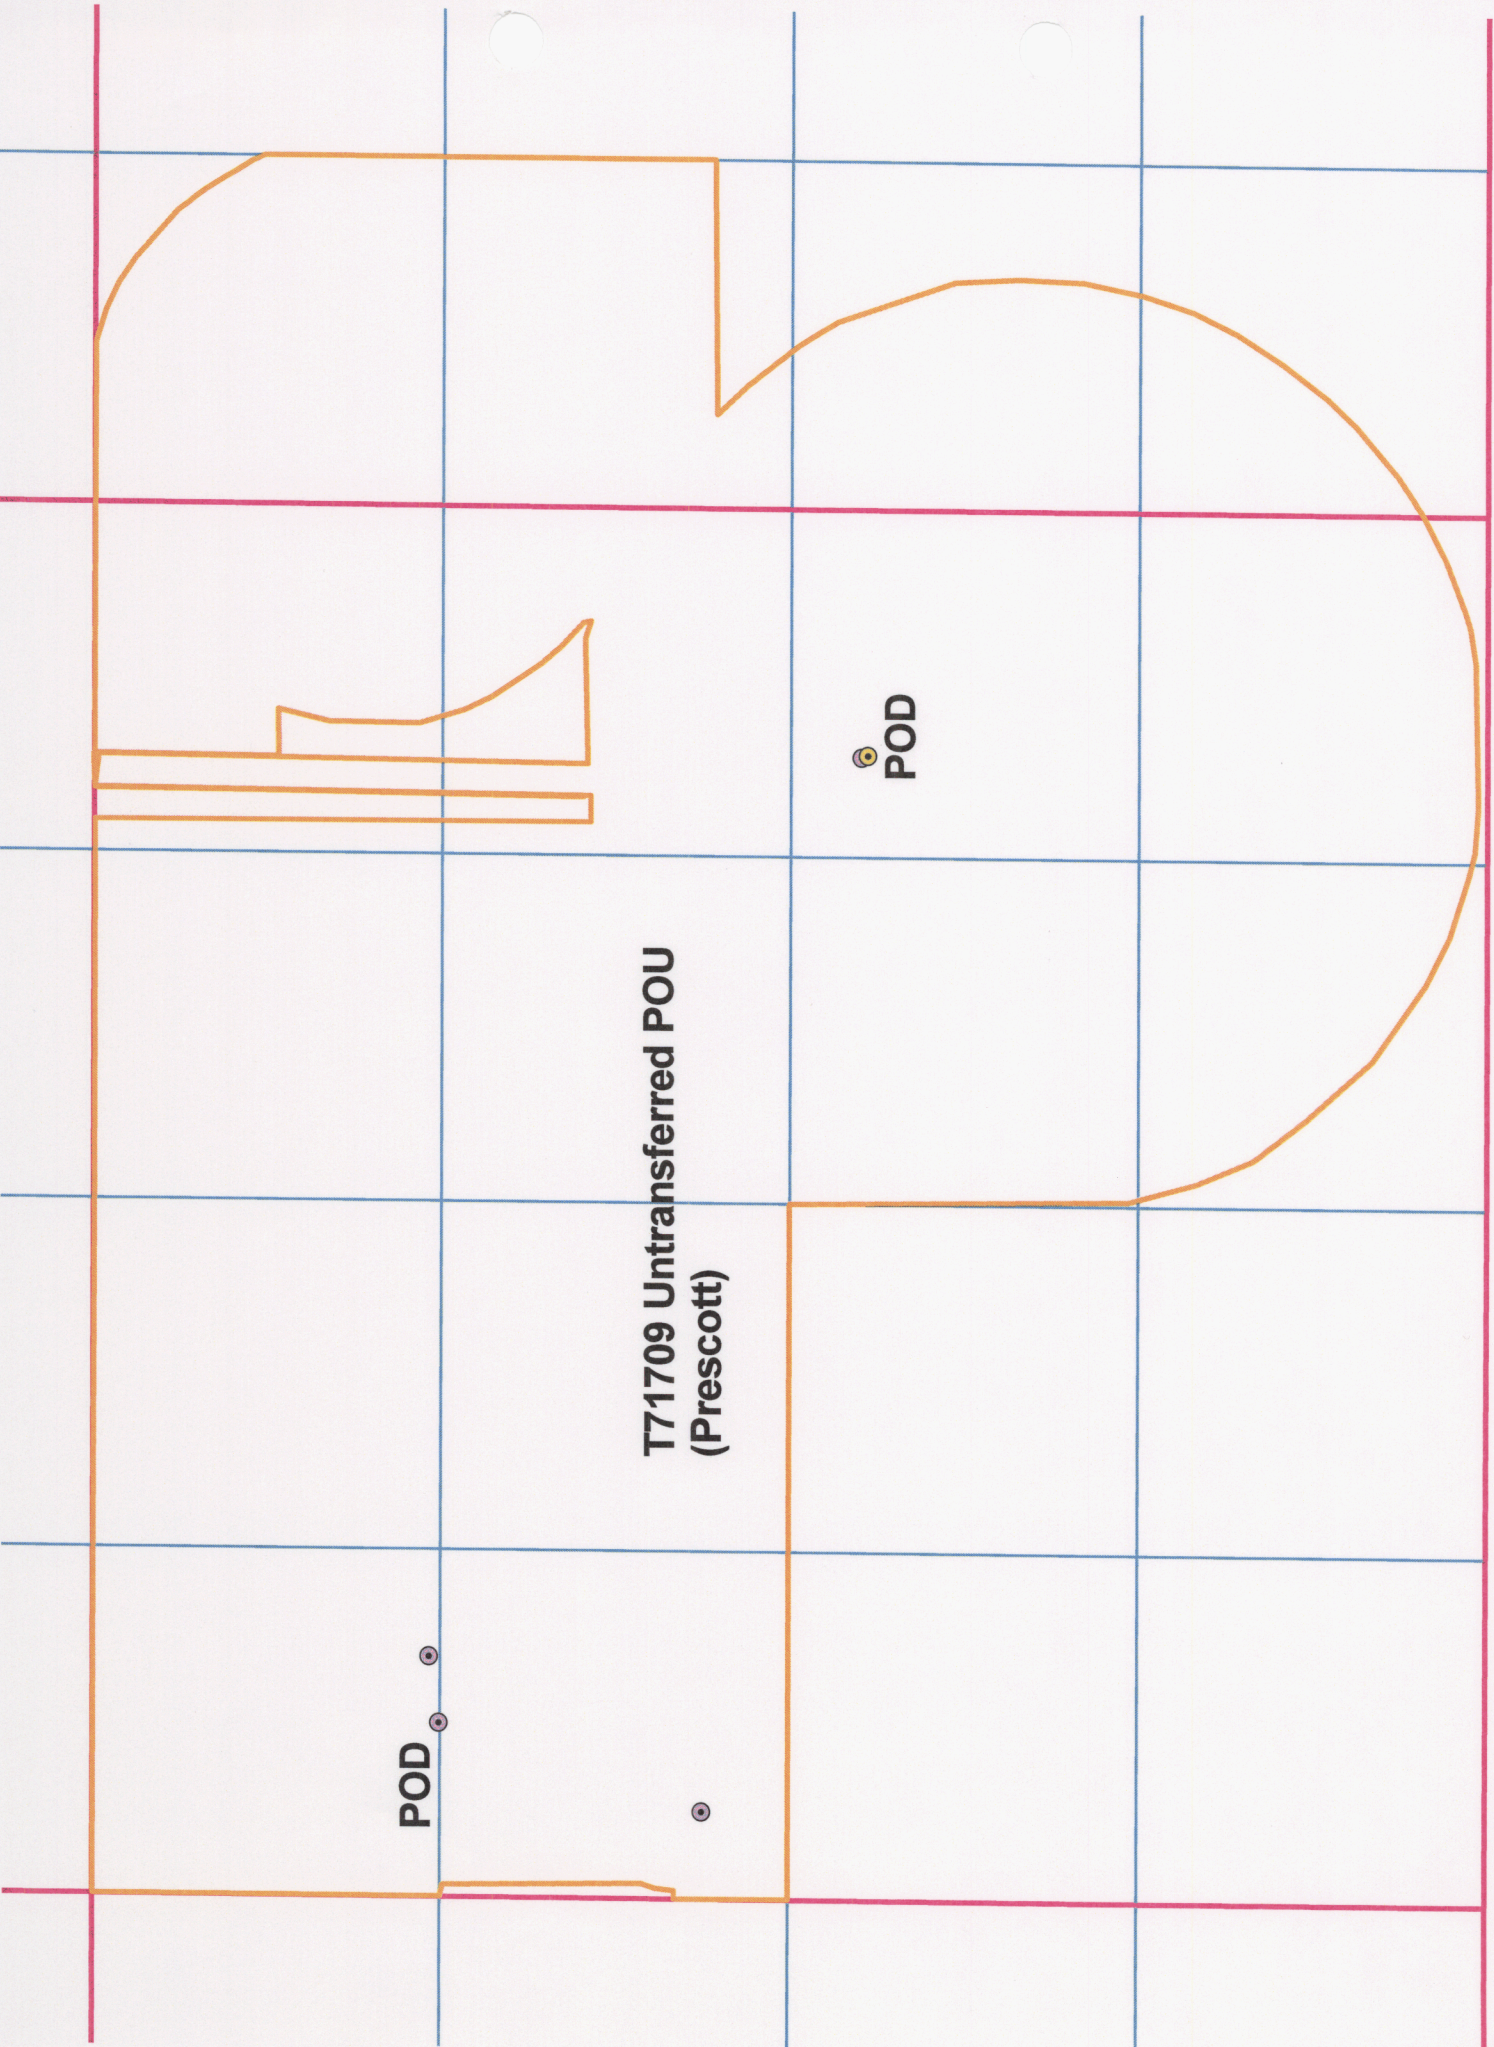

POD

T71709 Untransferred POU
(Prescott)

POD