


33-7069 HOWE WATER DIST.

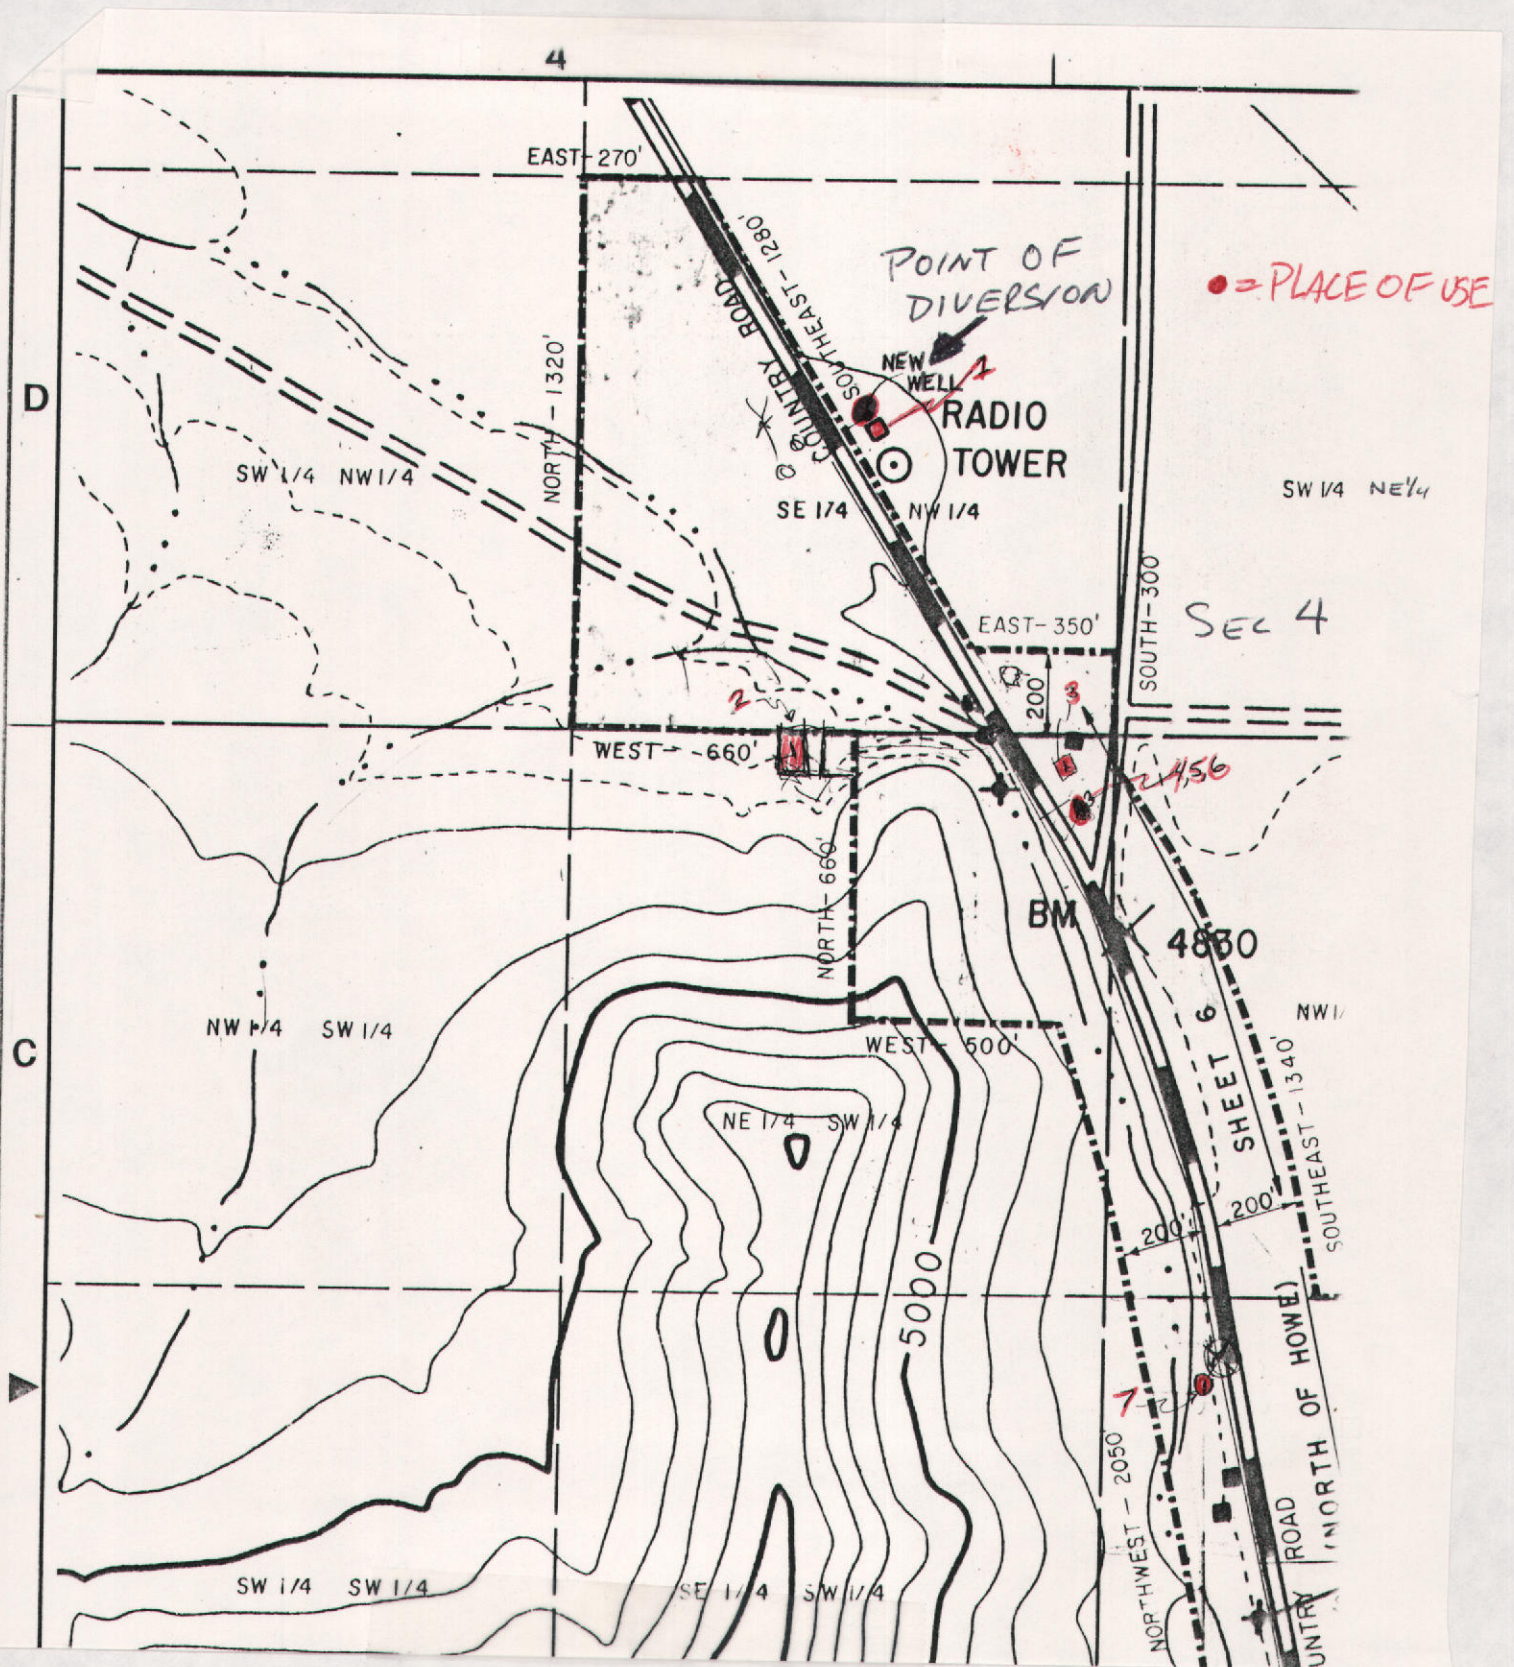


Fraction of Sec 4 T5N R29E

MICROFILMED

SEP 25 1990

HOWE WATER DIST.

RED • INDICATES
PLACE OF USE

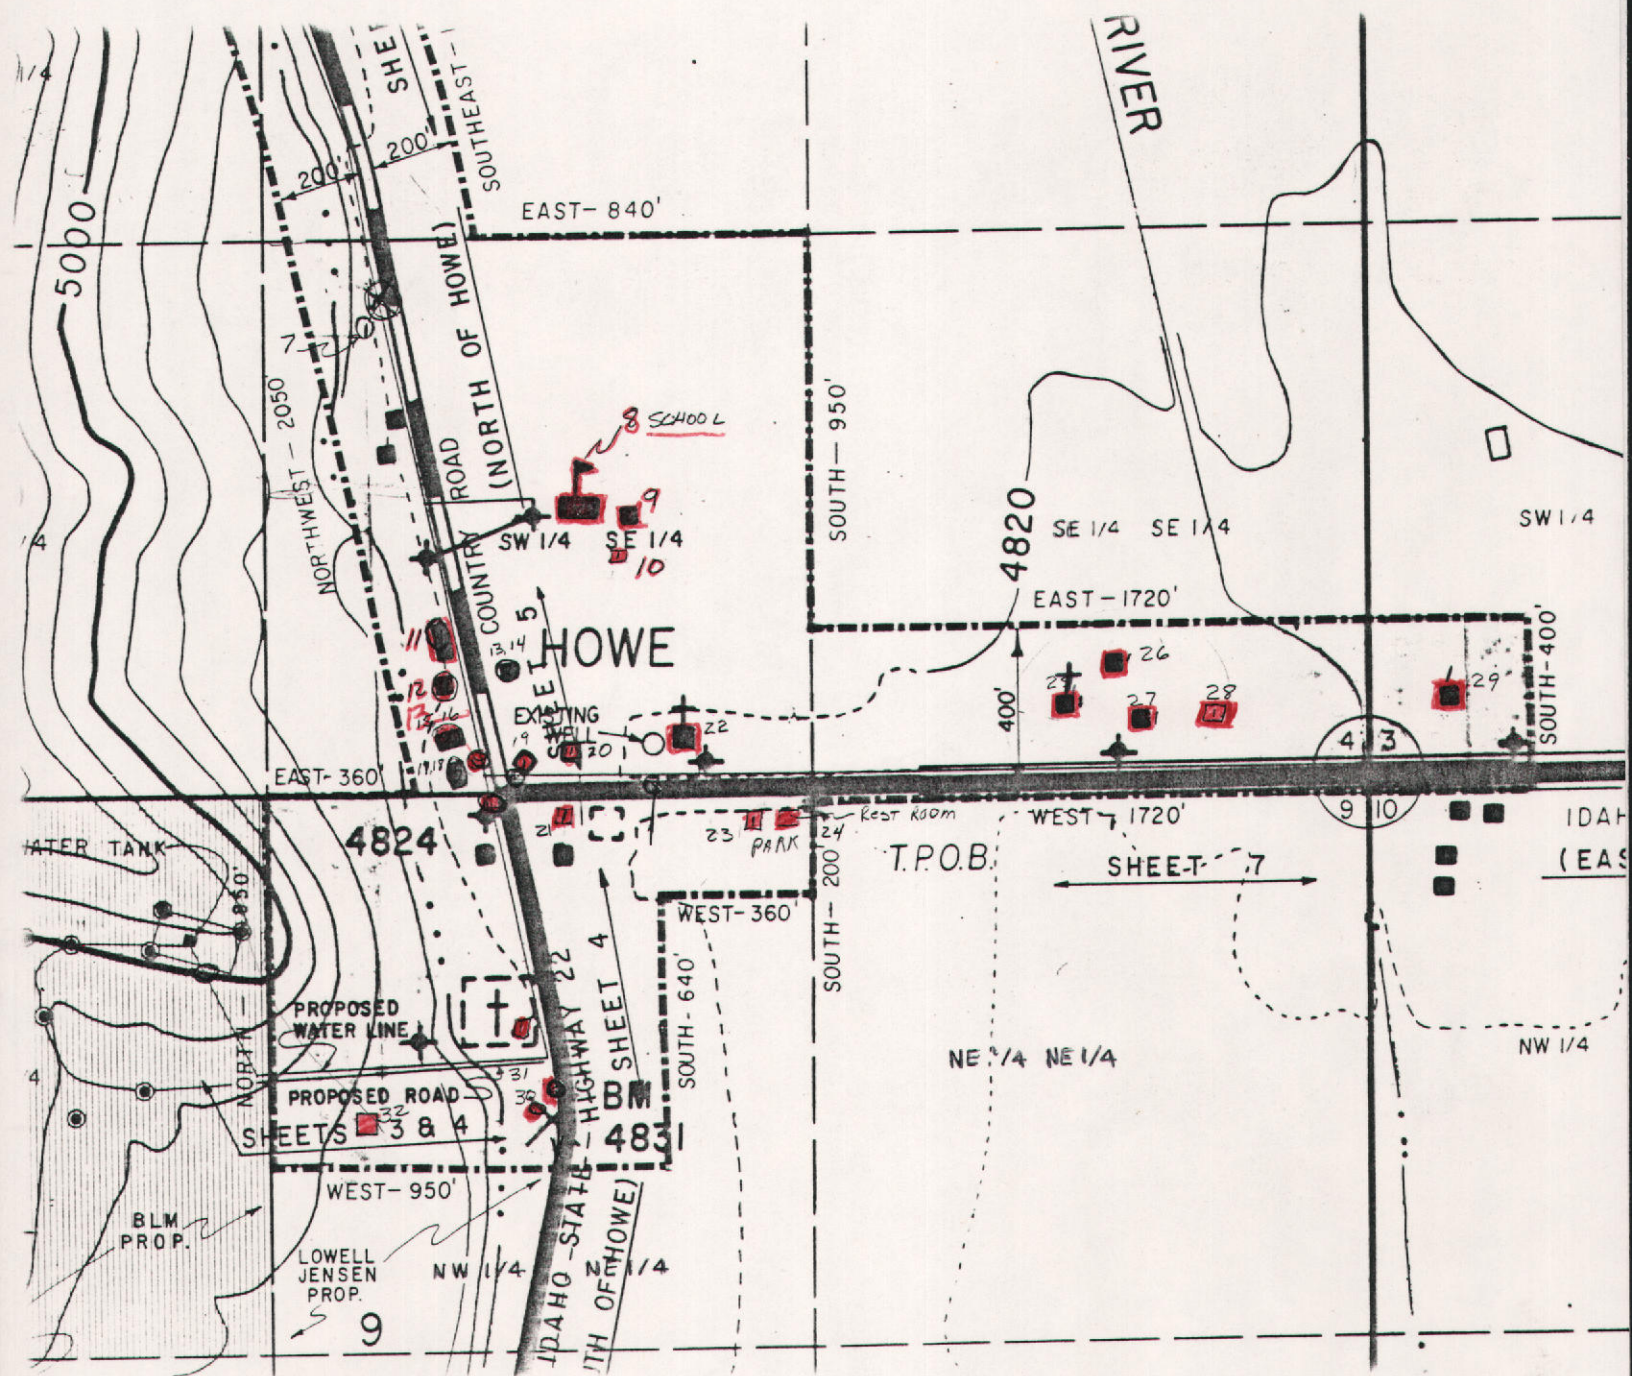


Fraction of Sec 3, 4, 9; 10 TSN R29E

NOT RECORDED


SEP 23 1990

HOWE WATER DISTRICT

33-7067

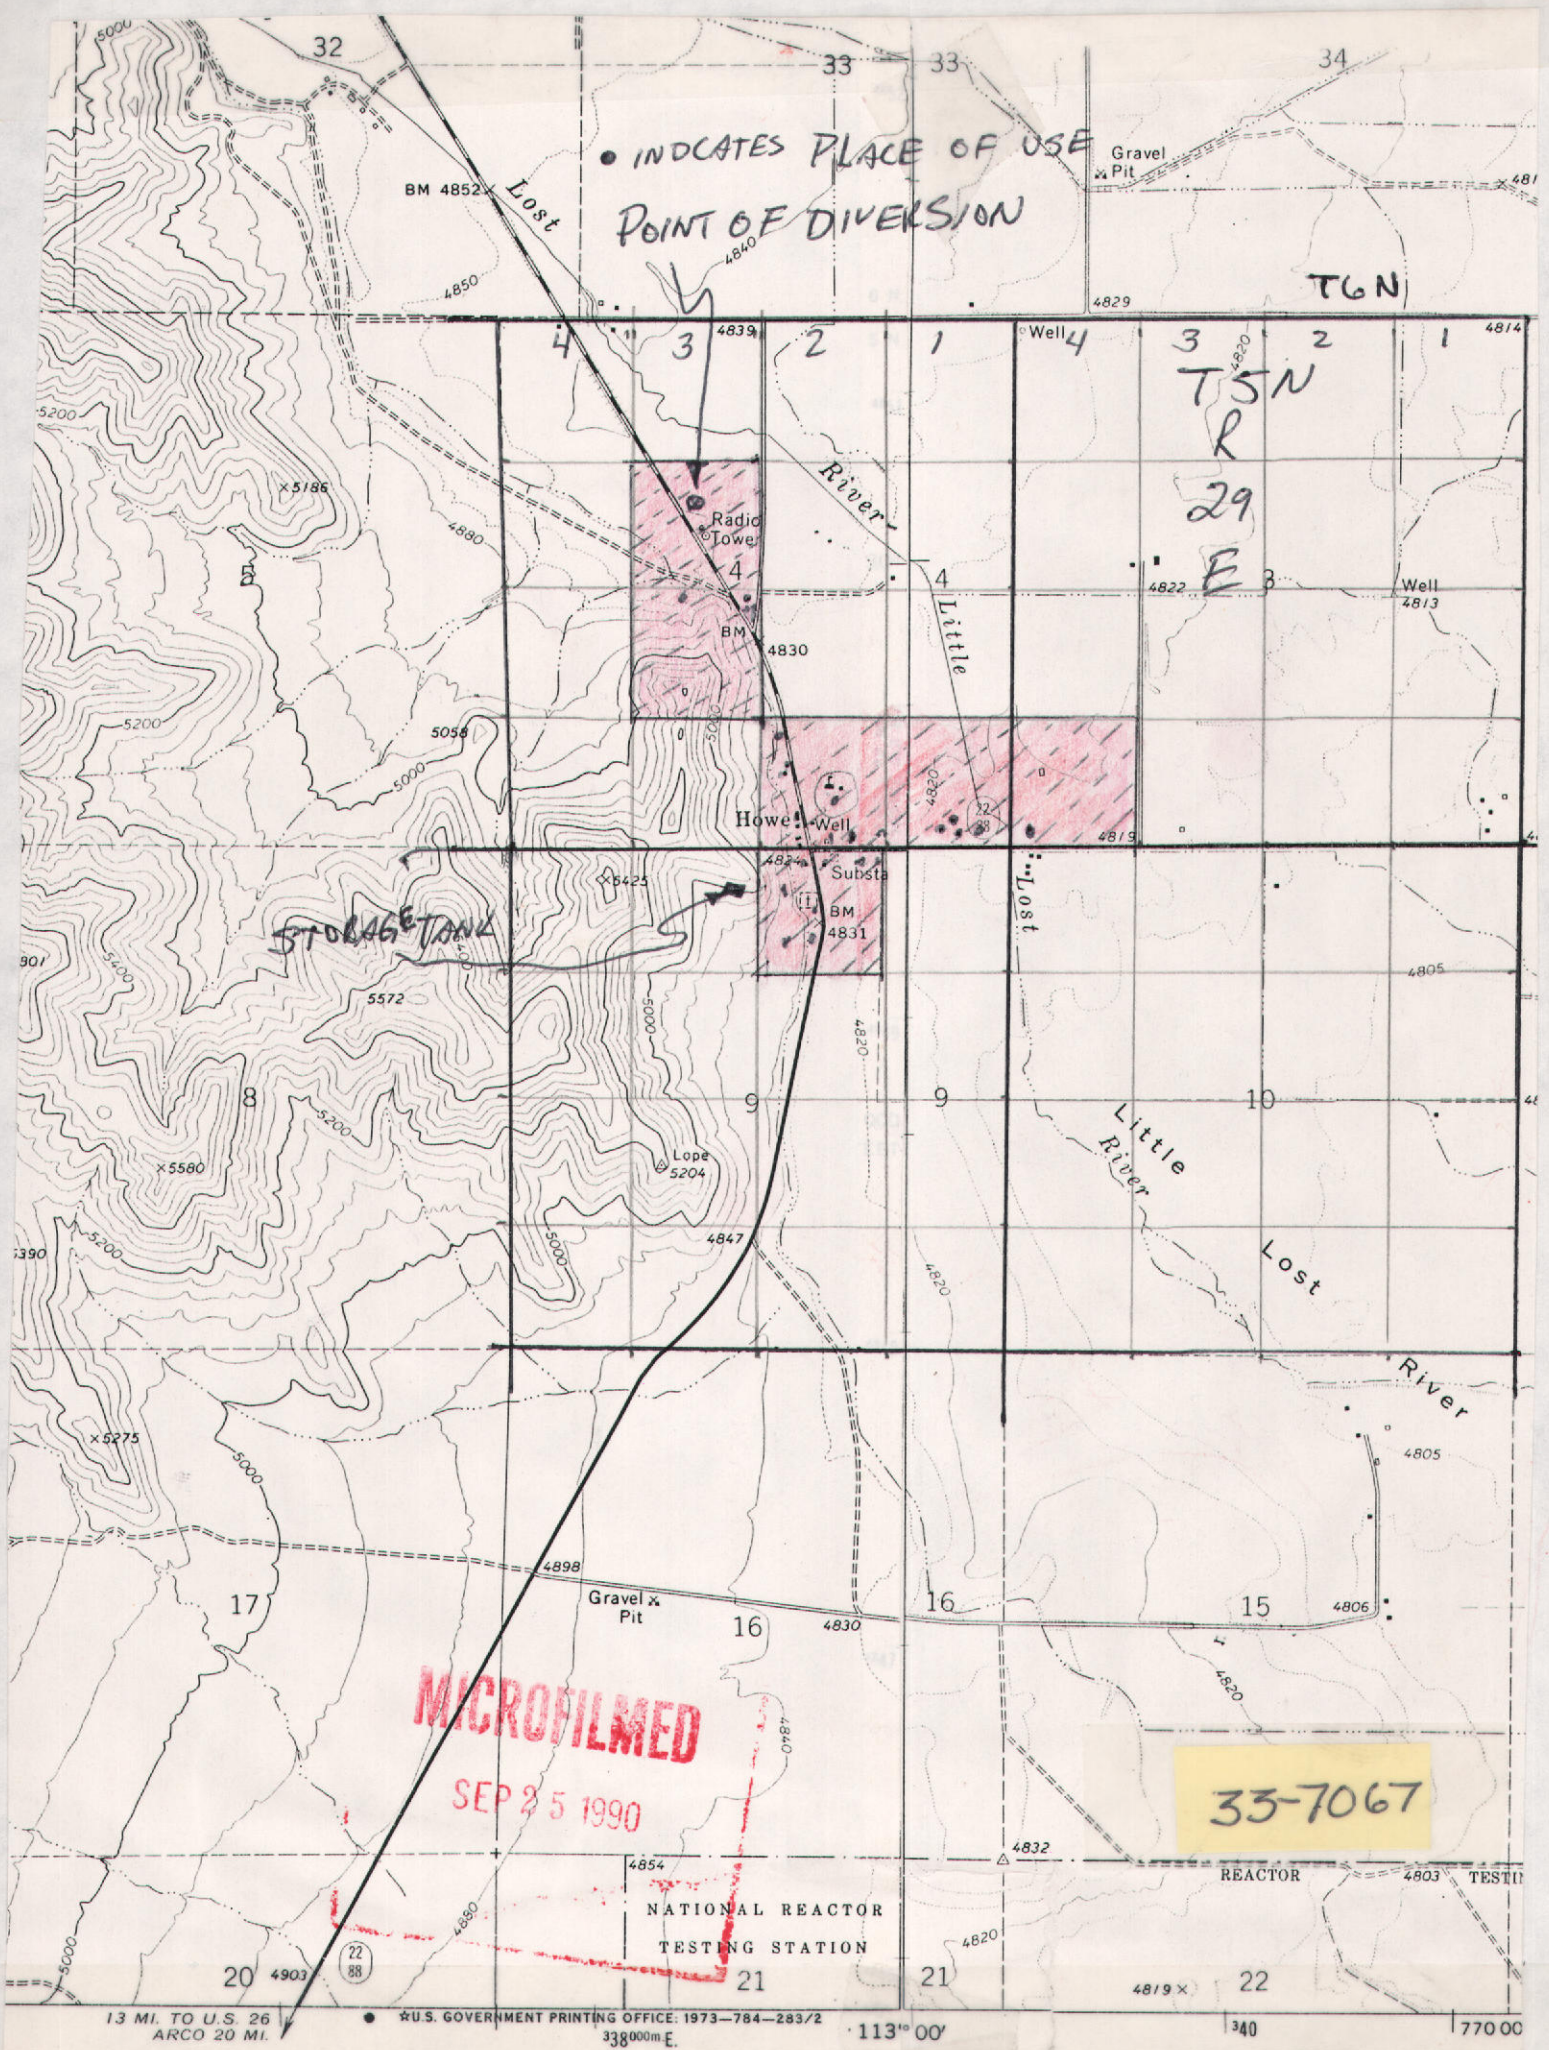

33-7067

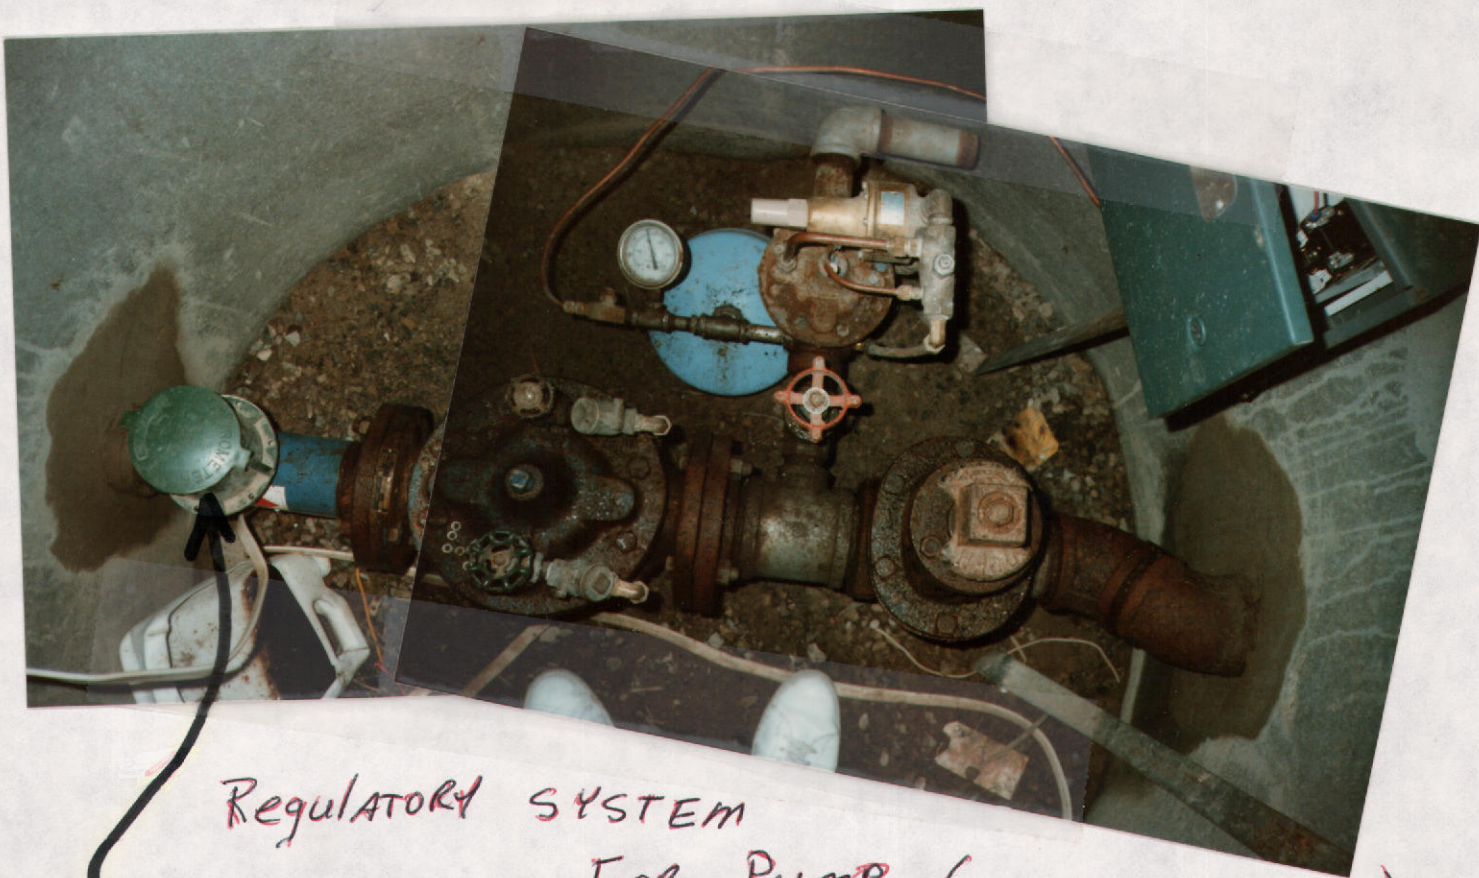

Regulatory SYSTEM

FOR PUMP (INSIDE MANHOLE)

Note: McCrometer had been set upon
mainline and was not connected (installed)



POINT OF DIVERSION
+
MAN HOLE


33-7067

MICROFILMED

SEP 40 1990

Regulatory
System
For 74,000
GAL
Storage
Tank

33-7067

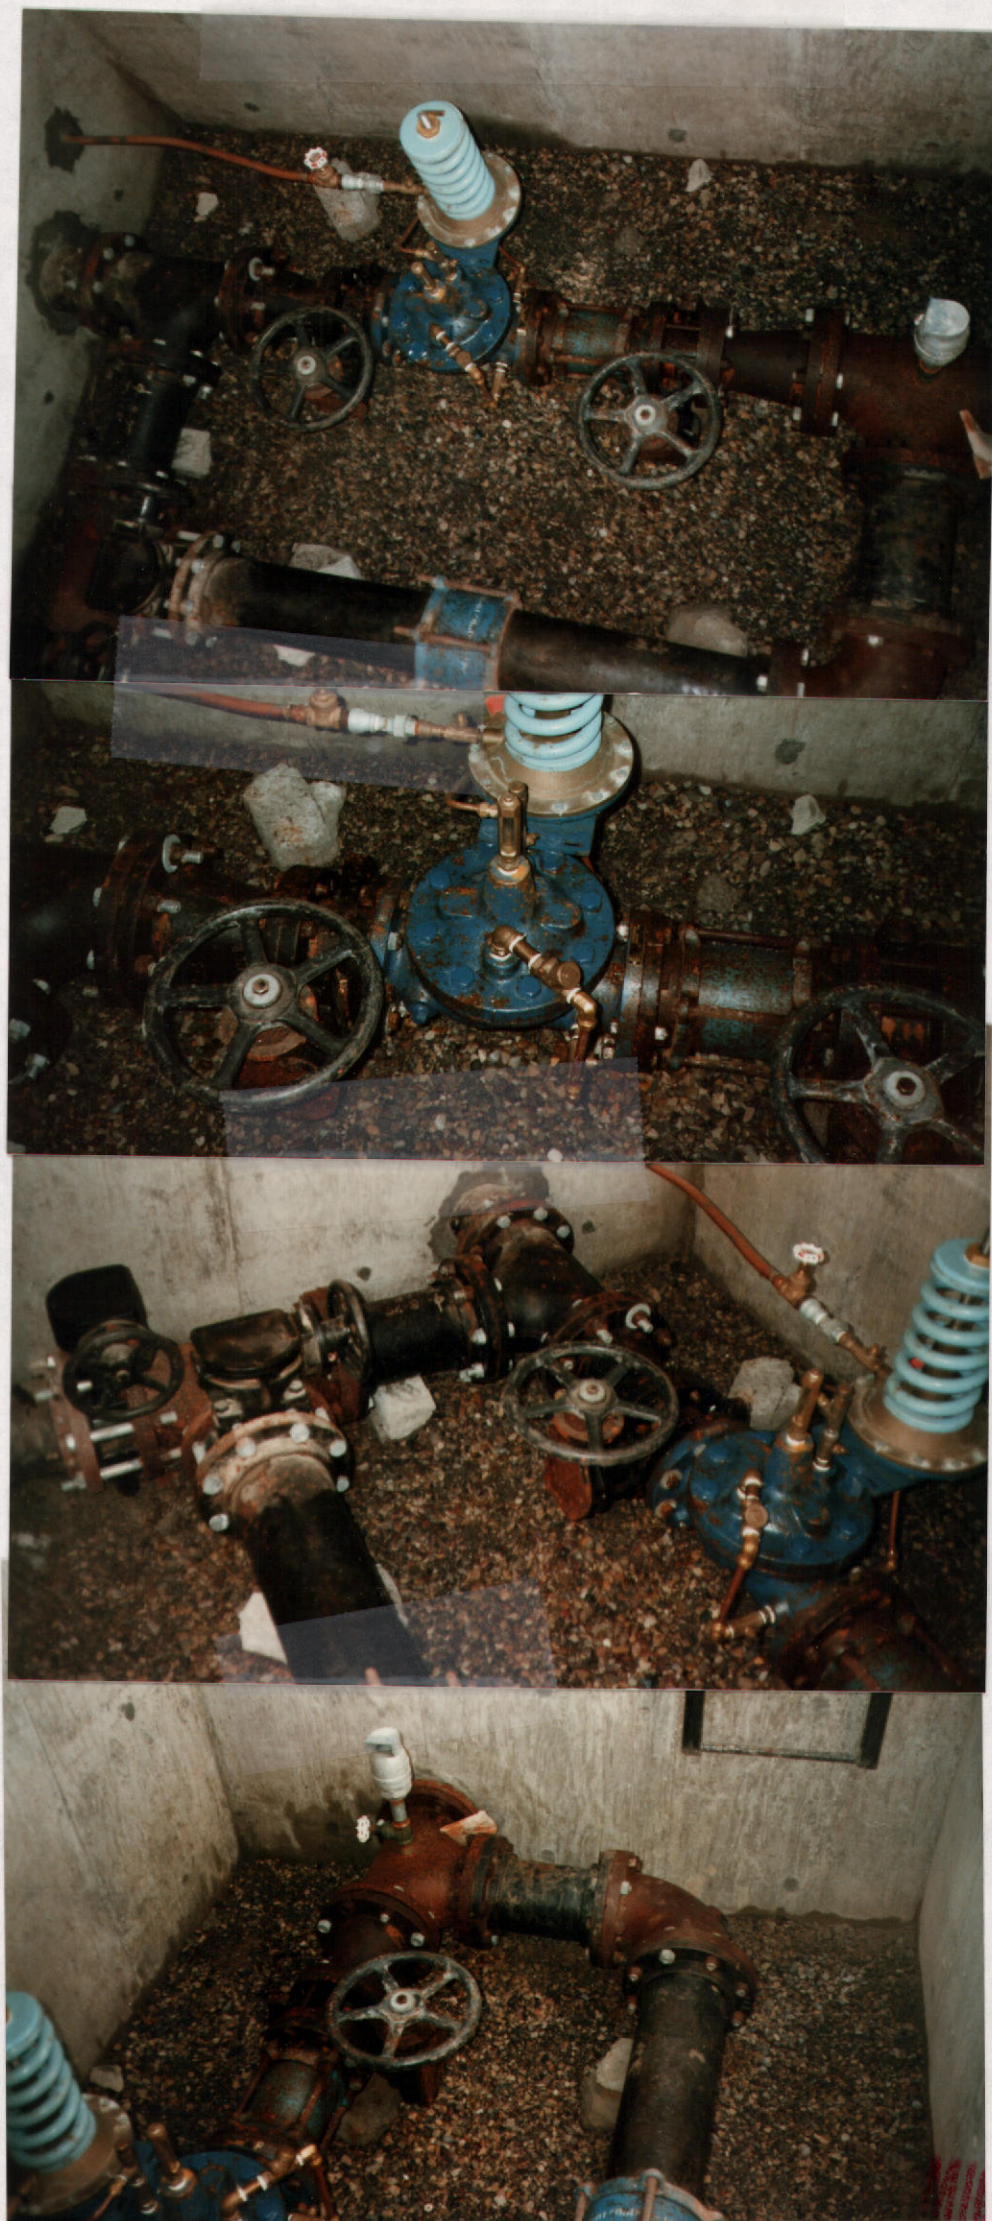

MICROFILMED
SEP 25 1990

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 33-07067

Priority: March 28, 1979

Maximum Diversion Rate: 0.70 CFS
Maximum Diversion Volume:¹ 35.6 AF

This is to certify, that HOWE WATER DISTRICT
C/O JERRY PANCHERI
HOWE, ID 83244

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated March 28, 1979; and has submitted Proof of Beneficial Use on November 28, 1980. An examination indicates that the works have a diversion capacity of .930 cfs of water from a **GROUNDWATER** source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	0.70 CFS	35.6 AF

LOCATION OF POINT(S) OF DIVERSION: SENW , Sec. 4, Township 05N, Range 29E
BUTTE County

PLACE OF USE: DOMESTIC

TWN RGE SEC

05N 29E	4	SWSE	SESE
	9	NWNE	

CONDITIONS/REMARKS:

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. Domestic use is for 20 homes, 2 churches, 3 restaurants, and a school.
6. Place of use also known as Howe Water District.

MICROFILMED

SEP 2 1990


State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 33-07067

This license is issued pursuant to the provisions of Section 42-219, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this 18TH
day of September, 1990.

Acting for

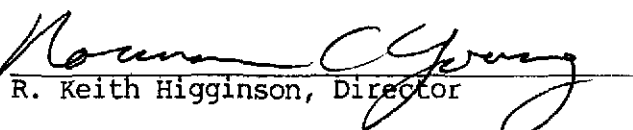
R. Keith Higginson, Director

MICROFILMED

SEP 20 1990

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT**APPROVED**

To appropriate the public waters of the State of Idaho

1. Name of applicant Howe Water District
% Jim Schondel - Chairman Phone 208-767-3369Post office address Howe, Idaho 832442. Source of water supply New Deep Well which is a tributary of _____3. Location of point of diversion is SE $\frac{1}{4}$ of NW $\frac{1}{4}$ of Section 4 Township 5NRange E 29 B.M. Butte County, additional points of diversion if any: _____

4. Water will be used for the following purposes:

Amount 1.00 for Domestic
Culinary purposes from Jan 1 to Dec 31 (both dates inclusive)
(cfs or acre-feet per annum)Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated:

a. 1.00 cubic feet per second and/or b. _____ acre-feet per annum.

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc. Well & Submersible Pumpb. Height of storage dam _____ feet, active reservoir capacity _____ acre-feet; total reservoir
capacity _____ acre-feet, materials used in storage dam: 74,000 Gallon Concrete TankPeriod of year when water will be diverted to storage Jan 31 to December 31 inclusive.
(Month/Day) (Month/Day)c. Proposed well diameter is 10 inches; proposed depth of well is 300 feet.7. Time required for the completion of the works and application of the water to the proposed beneficial
use is 1 years (minimum 1 year - maximum 5 years).

8. Description of proposed uses:

a. If water is not for irrigation: W $\frac{1}{2}$ SE $\frac{1}{4}$ 4
(1) Give the place of use of water: NW $\frac{1}{4}$ of NE $\frac{1}{4}$ of Section 9 Township 5NRange 29 B.M.

(2) Amount of power to be generated: _____ horsepower under _____ feet of head.

(3) List number of each kind of livestock to be watered N/A(4) Name of municipality to be served Howe Water District, or number of families to be
supplied with domestic water 40.(5) If water is to be used for other purposes describe: Culinary**NOT FILMED**

b. If water is for irrigation, indicate acreage in each subdivision in the tabulation below:

N/A

TWP	RANGE	SEC.	NE¼				NW¼				SW¼				SE¼				TOTALS
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	

Total number of acres to be irrigated _____

c. Describe any other water rights used for the same purposes as described above. _____


9. a. Who owns the property at the point of diversion Howe Water District

b. Who owns the land to be irrigated or place of use N/A

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing N/A

10. Remarks Well to serve entire Howe Community with culinary water. See attached legal description for well site location and vicinity map for present district boundaries.

11. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

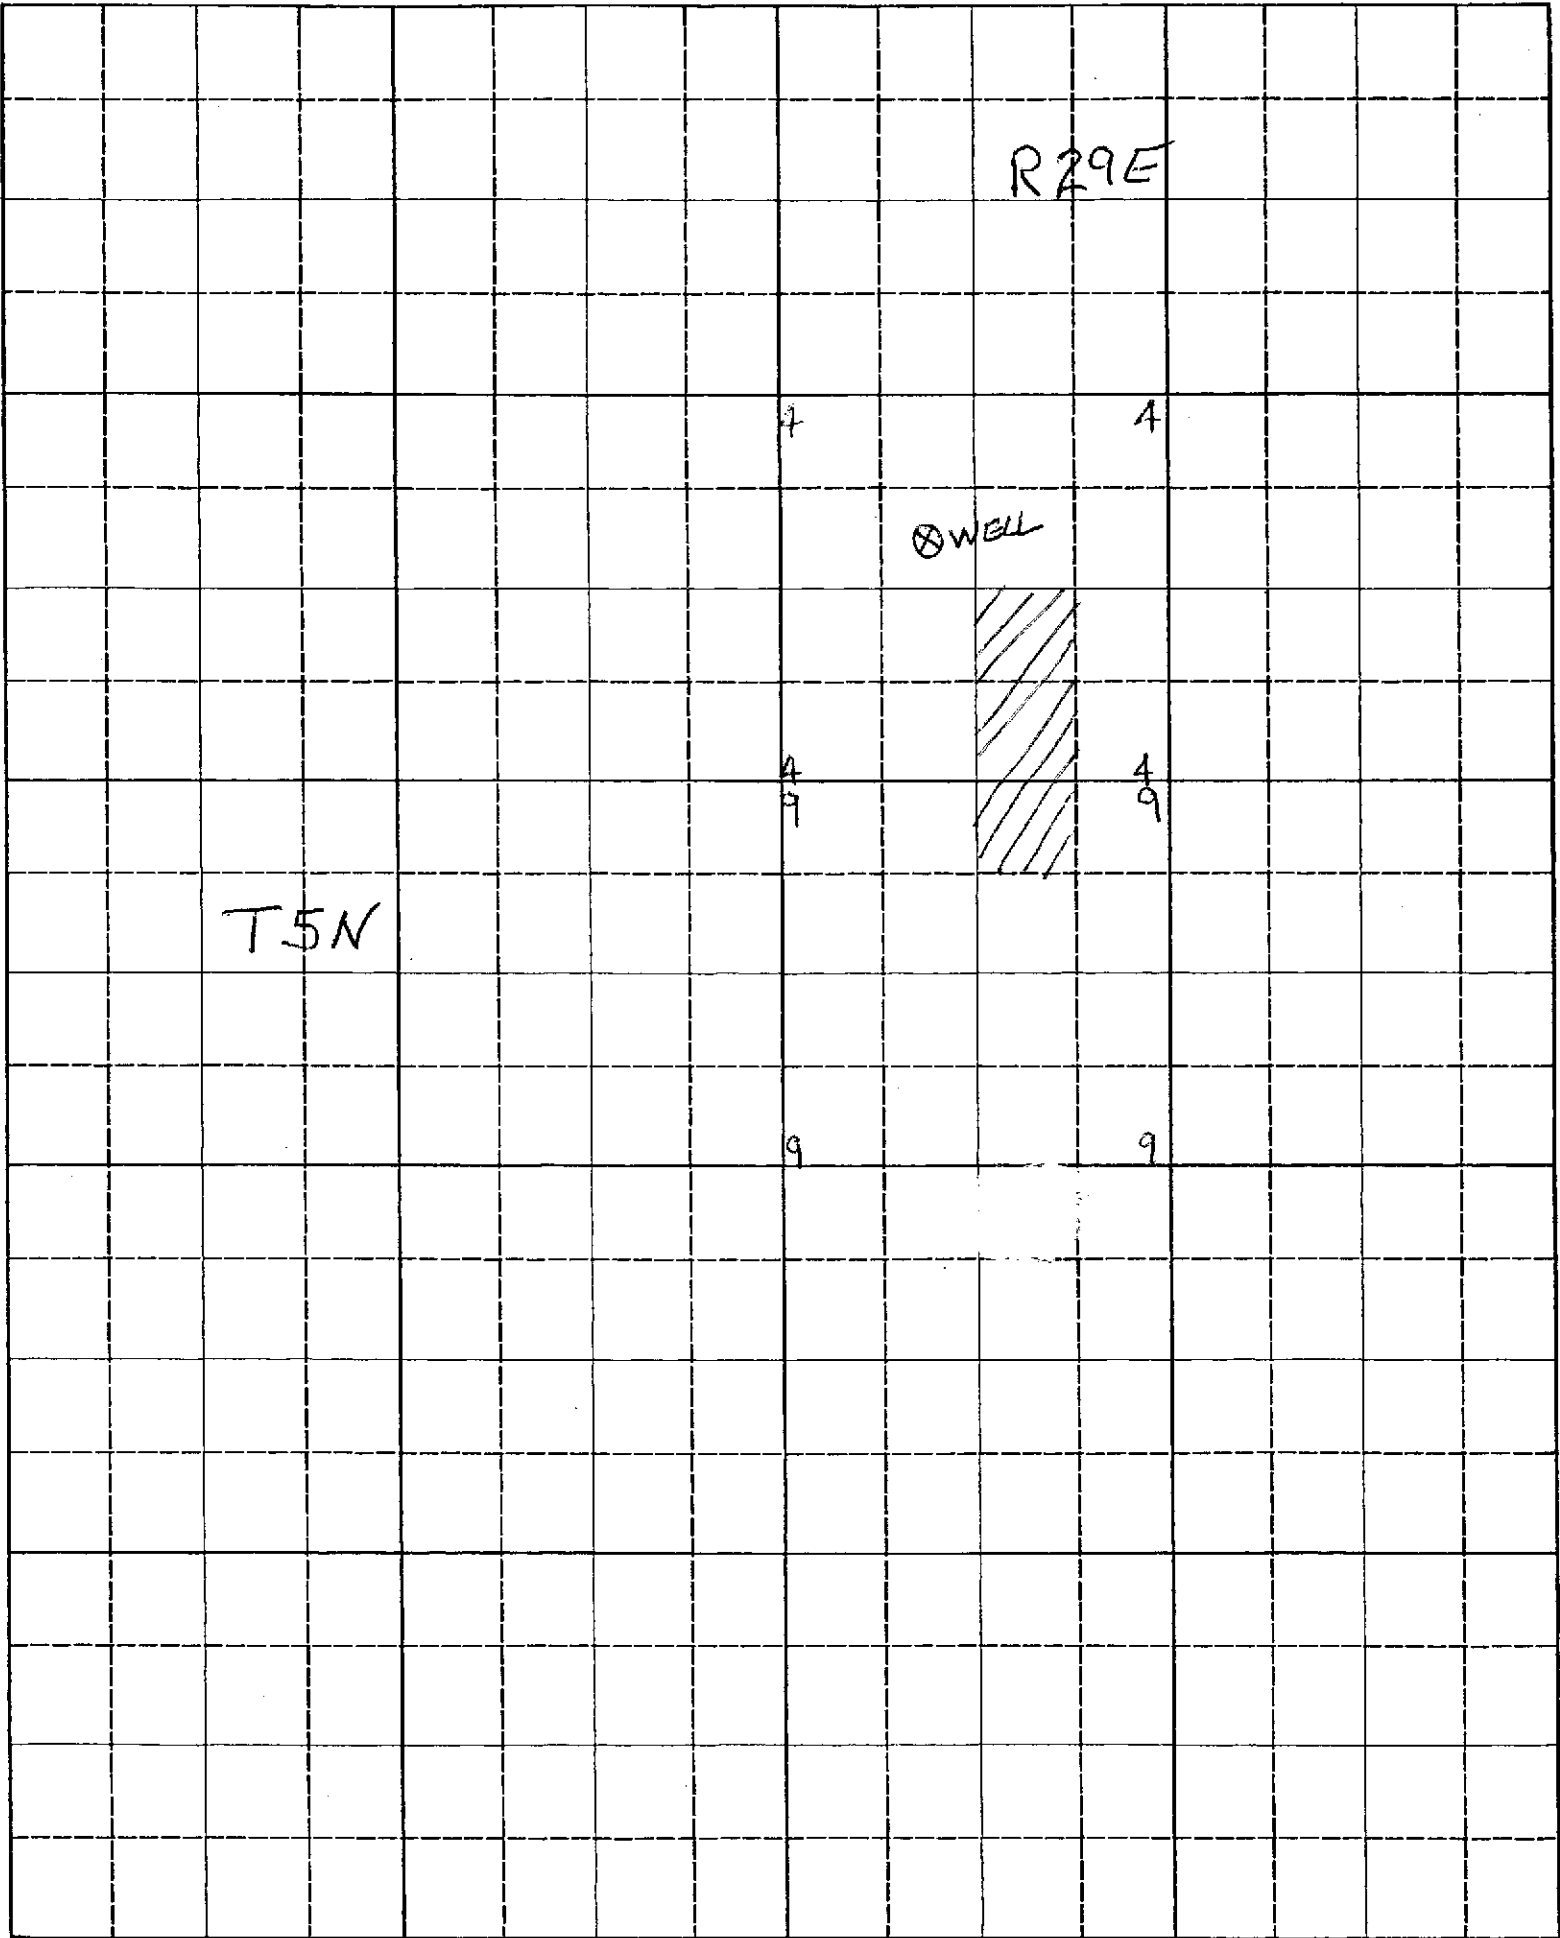

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

James E. Shonell
(Applicant)
HOWE WATER DISTRICT, CHAIRMAN

DESCRIPTION OF WELL SITE

A tract of land situated in the Southeast 1/4, Northwest 1/4, Section 4, Township 5 North, Range 29 East, Boise Meridian, Butte County, Idaho, also being a part of the land of Jerry Pancheri, being bounded on the South by the land of Butte County, containing 0.25 acre, and more particularly described as follows:

Commencing at a one-inch diameter iron bar, found in place and marking the South 1/4 Corner, Section 4, Township 5 North, Range 29 East, Boise Meridian; thence

South 88°31'46" East, 514.36 feet, to a point, said point also being designated as Station 5+00, Project F-6462(7), a point on the centerline of State Highway 22 and 88, the highway centerline bearing of North 89°32' East being the basis of all bearings in this description; thence

North 19°49'41" West, 3594.45 feet to a point on the Northeasterly right-of-way of Butte County Road, Project FAP Nos. 240(1), said point also being North 11°49'22" West, 3441.15 feet from the aforementioned South 1/4 Corner, Section 4, Township 5 North, Range 29 East, Boise Meridian, and being the Northwest Corner of the land of Butte County and being marked by a 1/2X30-inch steel pin set this survey; thence

Along a portion of the Northerly boundary of the Butte County land North 58°15'42" East, 104.35 feet to a 1/2X30-inch steel pin set this survey; thence

North 31°44'18" West, 104.35 feet to a 1/2X30-inch steel pin, set this survey; thence

South 58°15'42" West, 104.35 feet to a 1/2X30-inch steel pin set this survey, said point being on the Northeasterly right-of-way of Butte County Road, Project FAP Nos. 240(1); thence

Along said right-of-way South 31°44'18" East, 104.35 feet to the Point of Beginning.

March 1, 1979
Job No. 81005
JJ:pp

Proposed Priority

3/28/79

Received by _____ dh _____ Date 3-28-79 Time 11:30 p.m.

Preliminary check by BR Fee \$35.00

Receipted by _____ dh _____ Date 3-28-79 #12977

Publication prepared by _____ dh _____ Date 3-30-79

Published in Arco Advertiser

Publication dates April 5 & 12, 1979

Publication approved 80 Date 11/13/79

Protests filed by: _____

Copies of protests forwarded by _____

Hearing held by _____ Date _____

Recommended for approval denial by EMC. Jim

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. 33-7067, and said application is hereby approved.

1. Approval of said application is subject to the following limitations and conditions:

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
- b. Proof of construction of works and application of water to beneficial use shall be submitted on or before January 1, 19 81.
- c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.
- d. Other: (1) An access port or other device as specified by the Department shall be installed by the permit holder to provide for the installation of measuring equipment and the determination of the rate of diversion by the Department. (2) The issuance of this permit in no way grants any right-of-way or easement across the land of another.

Witness my hand this 12th day of December, 19 79.

L. Glen Saxton

Director, Department of Water Resources

Affidavit of Publication

Lella Cammack
of the Arco Advertiser, a weekly newspaper of
general circulation, published weekly at Arco,
Idaho, since March, 1909, do solemnly swear that
a copy of this notice, per clipping attached, was
published weekly in the regular and entire issue
of said newspaper, and not in any supplement
thereof,

for 2 consecutive weeks, commencing with

the issue dated 4-5-79

and ending with the issue dated 4-12-79

Lella Cammack

Subscribed and sworn to before me this

9 day of Nov, 1979

Betty D. Maye
Notary Public

Residence: Arco, Idaho.

My commission expires life, 19

NOV 10 1979
Department of Water Resources
Eastern District Office

PUBLIC NOTICE

NOTICE OF APPLICATION FOR WATER RIGHT

Notice is hereby given that the
following application has been
submitted for permit to appropriate
the public waters of the State of
Idaho:

33-7067

HOWE WATER DISTRICT
c/o JIM SCHONDEL, CHAIR-
MAN, HOWE, ID 83244

Source: GROUNDWATER

Date Filed: 03-28-1979

Amount: 1.00 CFS

Diversion Point: SENW Sec 04 T

05N R 29E, BUTTE COUNTY

Use: MUNICIPAL (1.00 CFS)

from 01-01 to 12-31

Place of Use: NWSE SWSE Sec 04

T 05N R 29E NWNE Sec 09 T 05N R

29E

Diversion Means: WELL, PUMP,
STORAGE TANK

If issued, the permit will be
subject to all prior water rights.
Protests against the granting of any
permit must be filed with the
Director of the Idaho Department
of Water Resources, 1515 Lincoln
Rd., Idaho Falls, Idaho 83401 on or
before APRIL 23, 1979.

C. STEPHEN ALLRED
Director

Published 4-5 & 4-12-79

80-A

September 18, 1990

HOWE WATER DISTRICT
C/O JERRY PANCHERI
HOWE, ID 83244

RE: PERMIT NO. 33-07067

Dear Permit Holder(s):

Enclosed herewith is a copy of the Water Right License issued on the above referenced permit.

Sincerely,

JIM JOHNSON
Water Rights Supervisor

JJ:sc

Enclosure

MICROFILMED
SEP 25 1990

March 23, 1990

HOWE WATER DISTRICT
C/O JERRY PANCHERI
HOWE, ID 83244

RE: PERMIT NO. 33-07067

Dear Permit Holder(s):

We previously forwarded to you an Amendment for Water Permit so that you could amend your permit to correspond with the findings of the Department's field examiner.

As of this date, we have not received this amendment. If we do not receive the amendment within fifteen (15) days, we will issue a Water Right License which reduces the amount that could have been allowable to you. Enclosed for your convenience is another amendment form in the event the first one was misplaced.

Since the license will be permanent water right you prompt attention to this matter will be appreciated.

Sincerely,

JIM JOHNSON
Water Rights Supervisor

JJ:sc

Enclosure

RECEIVED
MARCH 24 1990

July 5, 1988

HOWE WATER DISTRICT
C/O JERRY PANCHERI
HOWE, ID 83244

RE: PERMIT NO. 33-07067

Dear Permit Holder(s):

The above referenced water right is in the process of being licensed. However, before a license can be issued, your permit must be amended to correspond with the findings of the Department's field examiner.

The enclosed application for amendment contains information that will be included on the license when it is issued. Please review carefully and if you concur, sign the amendment and return with the \$20.00 filing fee within 30 days.

If you do not concur with these findings or if you have any questions, please contact us within the 30-day period.

Sincerely,

JIM JOHNSON
Water Rights Supervisor

JJ:sc

Enclosure

RECEIVED
SEP 20 1990

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
LICENSING REPORT

Permit No. _____

1. **Measurement Calculations**

- a) Field Measurement Calculations (Include theoretical capacities and system capacity)

Theoretical at 80% eff. which is normally used :

$$Q = \frac{50 \text{ HP} (8.814) (.80)}{180' + (86 \times 2.308)} = 0.93 \text{ cfs} \leftarrow \text{ALLOW CAPACITY OF}$$

Limit to 0.70 cfs since meas. device requirement was not complied with...

- b) Volume Calculations for Irrigation:

$$\begin{aligned} V_{I.R.} &= (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = \underline{\hspace{2cm}} \\ V_{D.R.} &= [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = \underline{\hspace{2cm}} \\ V &= \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = \underline{\hspace{2cm}} \end{aligned}$$

- c) Volume Calculations for Other Uses:

see examiner's report -

2. **Overlap Review** *per Natural:*

- a) Other water rights with same place of use: *not reviewed*

- b) Other water rights with same point of diversion: *none*

- c) Analysis:

MICROFILMED

SEP 25 1990

30 day
P/U

- Date 6/7/88

INTER-DEPARTMENT MEMO — 1

FROM E. Carlson.

DATE 6 Oct 87

TO Gary Spockman.

SUBJECT: It should be obvious from the attached memo that Keith & I have not been successful in getting the permit holder to respond. I really don't have a strong position for cancellation. Hopefully correspondence from S.O. will be sufficient stimulus to generate a response.

MICROFILMED

SEP 11 1987

Ernest.

SIGNATURE

MEMORANDUM

TO: Gary Spackman

FROM: Keith C. Wilson

RE: Cancellation of Permit No.33-7067 DATE: September 21, 1987

August 19, 1987: Office visit between Ernie Carlsen & Jerry Pancheri; letter requested within this week. Previous memo dated August 18, 1987, held until this memo.

August 28, 1987: Phone call from Jerry Pancheri; informed Ernie Carlsen that documents will be sent.

September 21, 1987(AM): Phone call to Boise and review of office files revealed no request or documentation received as of this date.

I recommend CANCELLATION OF PERMIT NO. 33-7067 for failure to abide by the conditions of approval.

MICROFILMED

SEP 25 1990

RECEIVED
OCT 07 1987

Department of Water Resources

September 16, 1986

Howe Water District
c/o Jerry Pancheri
Howe, Idaho 83244

Dear Sir:

On July 17, 1986 a department representative attempted to complete a field exam for permit 33-7067. During the exam the examiner found that a measuring device had not been installed, but a flow meter had been placed on the top of the mainline as though to give the impression that a meter had been installed. One of the approval conditions for the permit was that an access port or other device be provided to determine the rate of diversion. Since this condition is on the permit the Howe Water District must make the request to remove the condition in writing. The request should also include any additional information that the district feels would assist the department in reaching the decision. Your prompt attention to this matter will be appreciated.

Sincerely,

Keith C. Wilson
Sr. Resource Agent

KCW/md

cc: Wes Weston

MICROFILMED

SEP 25 1990

M E M O

TO: Gary Spackman
FROM: Keith Wilson
RE: Cancellation of Permit No. 33-7067
DATE: August 18, 1987

July 17, 1986, Examination - Flow meter placed on top of mainline as if to appear that meter installed.

August 18, 1986, Phone Call - Sam Filetti called and informed Mr. Pancheri of need to request, in writing, removal of measuring device.

September 16, 1986, Letter - Informing Mr. Pancheri of need to request removal of measuring device requirement (see attached copy).

November 3, 1986, Phone Call to Boise - No letter received.

November 20, 1986, (same as November 3).

November 20, 1986, Letter - Notice of pending cancellation of permit.

December 29, 1986, (11:27 a.m.) - Jerry Pancheri called, informed Harold Jones that letter was just received, said letter was in Lowell Jensen's box. Mr. Pancheri indicated he would write letter.

July 21, 1987, Phone Call to Boise - No request letter in file.

July 30, 1987, Phone Call - Sam Filetti left message for Mr. Pancheri to call.

July 30, 1987 - Jerry Pancheri called, informed Sam Filetti he would write letter.

August 18, 1987, Phone call to Boise - no request letter in file.

In light of the above sequence of events, I recommend
CANCELLATION OF PERMIT NO. 33-7067 for failure to abide by the
conditions of approval.

SEE ATTACHED UPDATE TO MEMO

MICROFILMED

SEP 25 1990



STATE OF IDAHO

DEPARTMENT OF WATER RESOURCES EASTERN REGION

John V. Evans
Governor

A. Kenneth Dunn
Director

150 Shoup — Suite 15
Idaho Falls, Idaho 83402
(208) 525-7161

November 20, 1986

Howe Water District
c/o Jerry Pancheri
Howe, Idaho 83244

Re: Permit 33-7067

Dear Mr. Pancheri:

NOTICE OF PENDING CANCELLATION OF PERMIT

On March 28, 1979 the Howe Water District filed with the Department of Water Resources an application to appropriate water, numbered 33-7067, for domestic purposes, for 40 homes. One of the conditions of approval is that "an access port or other device as specified by the Department shall be installed by the permit holder to provide for the installation of measuring equipment and the determination of the rate of diversion by the Department."

During the field examination on July 17, 1986, the examiner found that a measuring device had not been installed but a flow meter had been placed on top of the mainline as though to give the impression that a meter had been installed. The purpose of this letter is to request that the Howe Water District submit a written request to have the measuring device condition removed or explain why the Department should not cancel the permit.

If the Howe Water District fails to respond to this inquiry within thirty (30) days of the date of this letter, the Department will act to cancel the permit. The permit will be cancelled due to failure to abide by the conditions of approval.

Respectfully,

Keith C. Wilson
Sr. Resource Agent

KCW/md

MICROFILMED

SEP 25 1990

FROM Sam Filetti

TO FILE

SUBJECT Permit No. 33-7067

RECEIVED

OCT 07 1987

Aug 19 1987

Department of Water Resources

When on location of THE HOWE CITY WELL
The Flow Meter section of PIPE WAS INSTALLED
But the actual meter WAS NOT plumbed in. The
meter WAS ~~stapled~~ just set on top. I could pick
it up.

MICROFILMED


SEP 25 1990

Samuel D Filetti
SIGNATURE

Phone No. 767 3419

- | Place(s) of Use: | | Irrigation - give acres served by system at time of exam.
Indicate Method of Determination | | | | | | | | | | | | | | | | | |
|------------------|------|---|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| Twp. | Rge. | Sec. | NE 1/4 | | | | NW 1/4 | | | | SW 1/4 | | | | SE 1/4 | | | | Totals |
| | | | NE 1/4 | NW 1/4 | SW 1/4 | SE 1/4 | NE 1/4 | NW 1/4 | SW 1/4 | SE 1/4 | NE 1/4 | NW 1/4 | SW 1/4 | SE 1/4 | NE 1/4 | NW 1/4 | SW 1/4 | SE 1/4 | |
| 5N | 29E | 4 | | | | | | | | D | D | | | | | | D | D | |
| | # | UNITS | | | | | | | | 1 | 5 | | | | | | 15 | 4 | 25 |
| | | 9 | | | | | D | | | | | | | | | | | | |
| | # OF | UNITS | | | | | 8 | | | | | | | | | | | | 8 |
| | | 3 | | | | | | | | | | | D | | | | | | |
| | # | UNITS | | | | | | | | | | | 1 | | | | | | 1 |
| Total Acres | | | | | | | | | | | | | | | | | | | 34 |

10. Other water rights on these lands NONE
11. Other water right diverted from same p.d. NONE
12. **Diversion and Delivery System Diagram:** Indicate all major components and distances between components. Indicate ditch size/pipe i.d. as applicable. Indicate on systems with measurement port the distance between the port and the nearest component/pipe bend/restriction both upstream and downstream, and the inside pipe diameter at the measurement port. On multiple diversion systems indicate how diversion systems are connected.

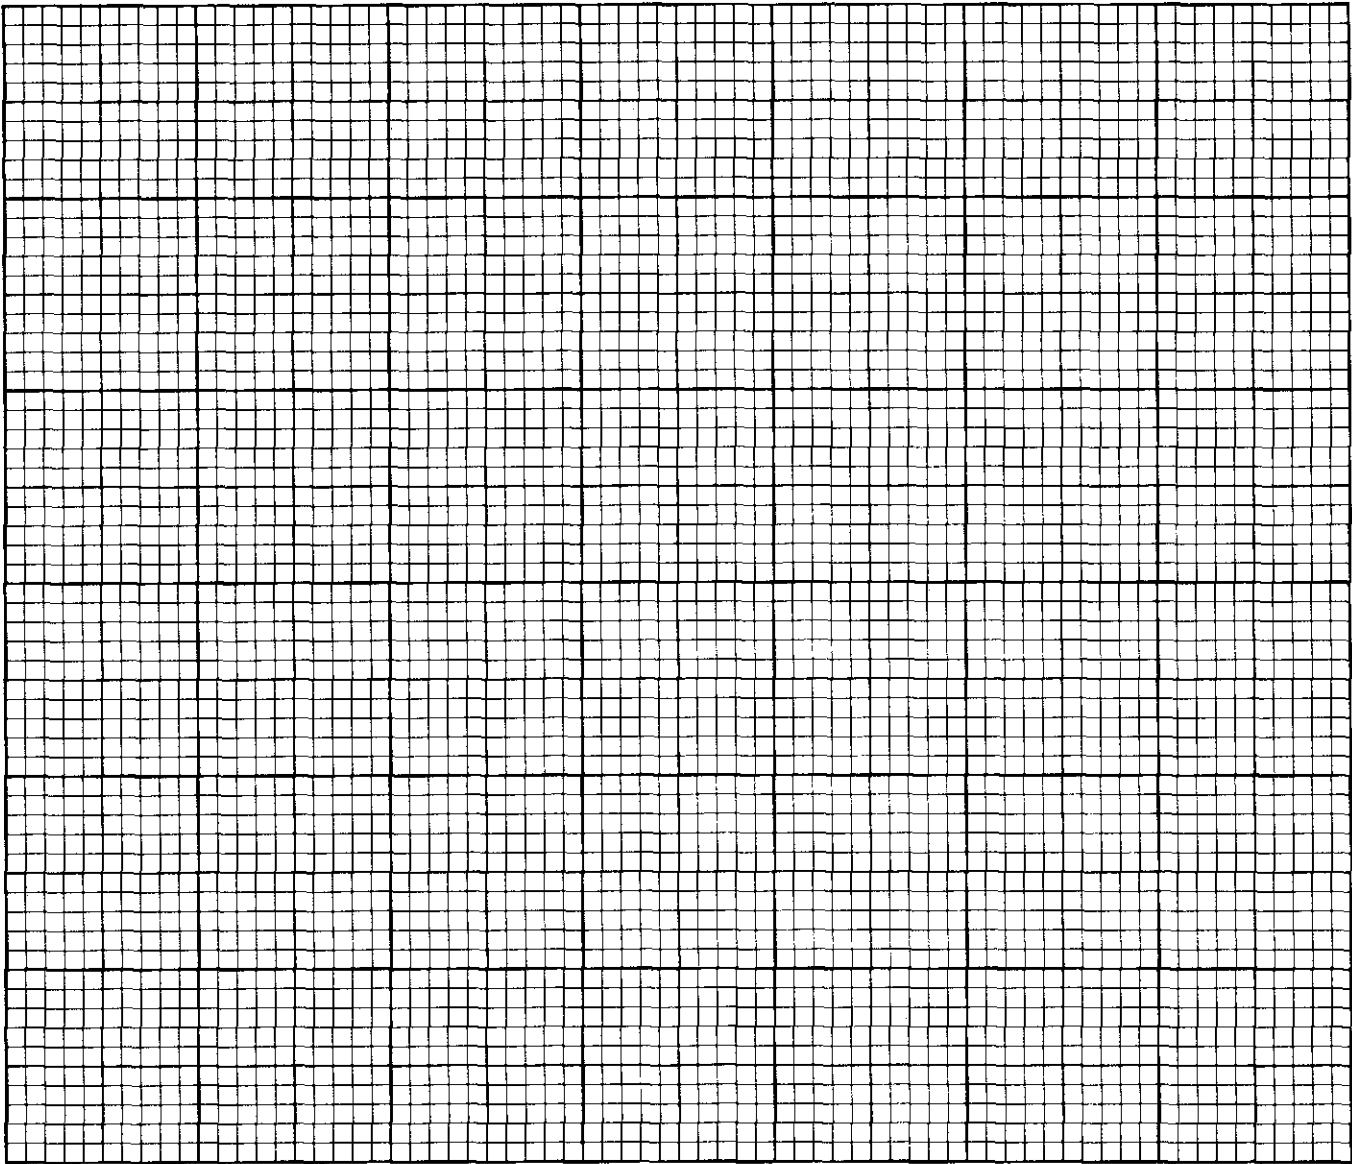

MAPS ATTACHED

13. ☒ Photo of Diversion & System Attached

☐ Aerial Photo of Place of Use Attached or Map of Irrigated Acreage Attached
14. Remarks _____
15. Recommended Amendments

☐ Change P.D. as reflected above

☐ Add P.D. as reflected above

☒ None

☐ Change P.U. as reflected above

☐ Add P.U. as reflected above

☐ Other
16. Examiner's/Consultant's Signature Sam Filletti Date 7/07/86

Consultant's License Number _____

IDWR Director's Authorization to Conduct


Beneficial Use Examination _____

Date _____

CONSULTANT SEAL

HOWE WATER DISTRICT

33-7067

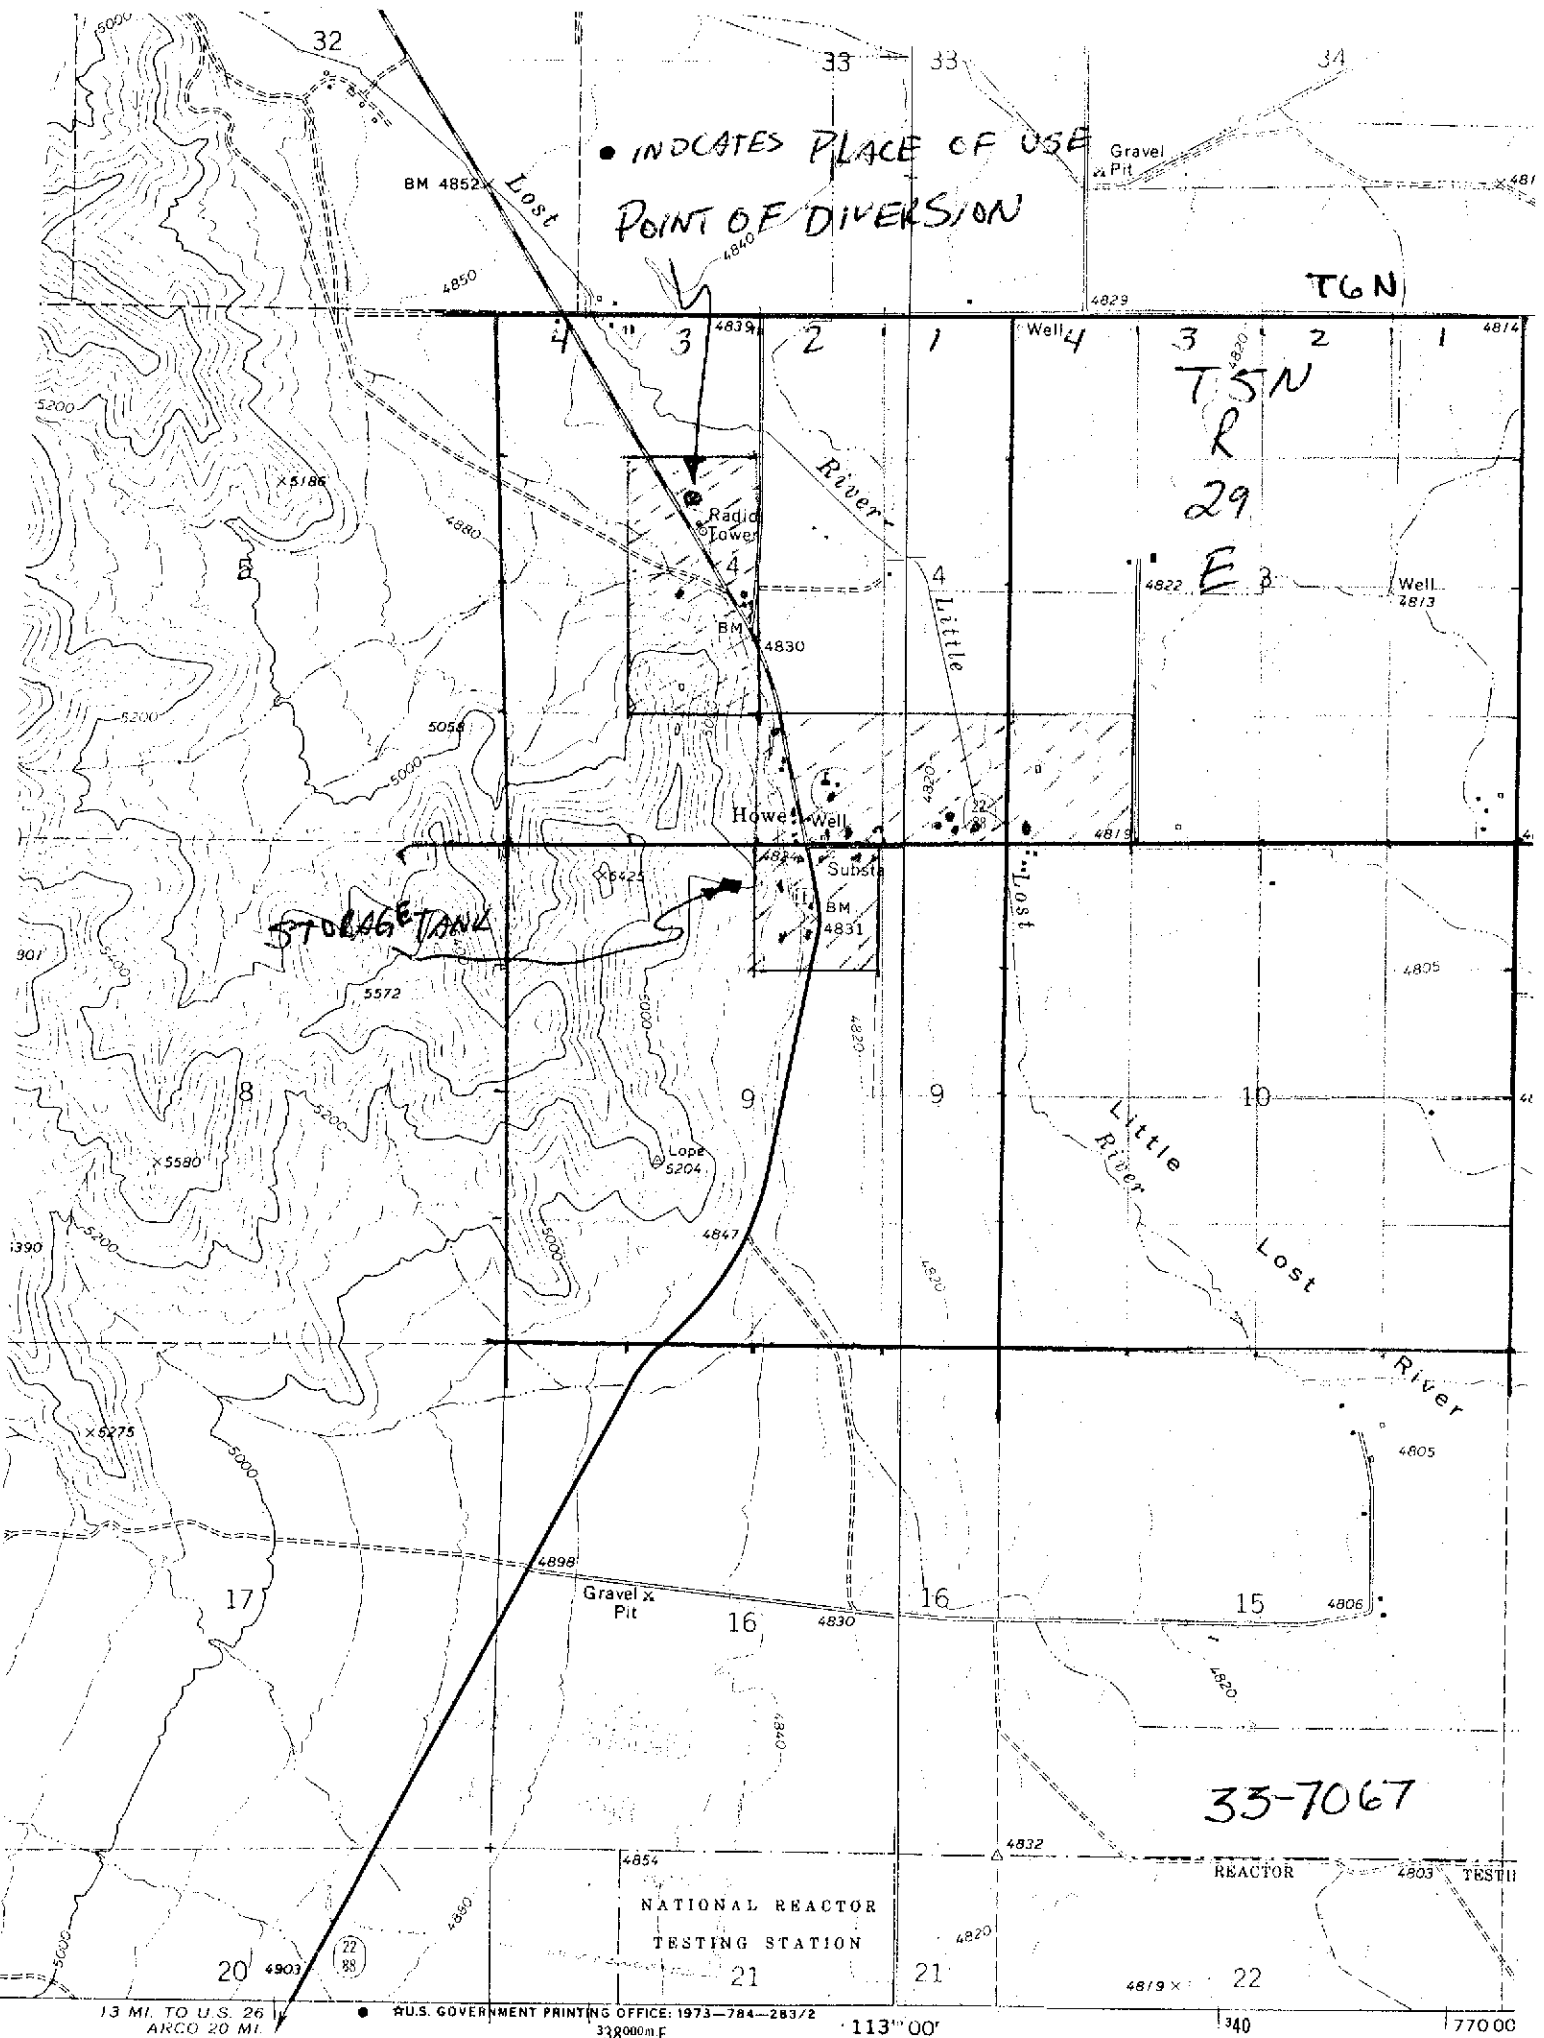

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

LICENSING REPORT OCT 07 1987

Department of Water Resources

33-7067
Permit No.

1. Measurement Calculations

a) Field Measurement Calculations (Include theoretical capacities and system capacity)

THEORETICAL
$$Q = \frac{50 \text{ HP} (8.814) (.89)}{180' + (86 \times 2.308)} = 1.04 \text{ cfs}$$

I would licence him for the PERMITTED AMOUNT
1.00 cfs.

b) Volume Calculations for Irrigation:

$V_{IR} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$
 $V_{DR} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 =$
 $V = \text{Smaller of } V_{IR} \text{ and } V_{DR} =$

c) Volume Calculations for Other Uses: $V_{\text{SCHOOL}} = 65 \text{ students} \times 190 \text{ days} \times 25 \frac{\text{gallons}}{\text{student}} = \frac{308750 \text{ g}}{325850 \text{ g/cfs}} = 0.94 \text{ cfs}$

$V_{\text{DOM}} = 27 \text{ Homes} \times 1.2 \text{ cfs} = 32.4 \text{ cfs}$

$V_{\text{CHURCH}} = 2 \text{ weekly} \times 52 \text{ weeks} \times 150 \text{ people} \times 25 \text{ gallons} = \frac{390,000}{325,850} = 1.2 \text{ cfs}$

$V_{\text{CHURCH}} = 2 \times 52 \text{ weeks} \times 100 \text{ people} \times 15 \text{ gallons} = \frac{156,000}{325,850} = .48 \text{ cfs}$

$V_{\text{RESTAURANT}} = 3 \times \frac{365 \text{ days}}{\text{yr}} \times 25 \text{ people} \times 7 \text{ gallons} = \frac{191,625}{325,850} = .59 \text{ cfs}$
Total cfs = 35.6

2. Overlap Review

a) Other water rights with same place of use:

NONE

b) Other water rights with same point of diversion:

NONE

c) Analysis:

* Figures obtained from Table 7 III-3

Vol 1ST CHURCH 25 gpd has cafeteria gym showers

Vol 2ND CHURCH 15 gpd does not have " " "

Vol of 3 RESTAURANTS 7 gpd small facilities with toilet

RECEIVED

SEP 20 1987

RECOMMENDED AMOUNTS

3.	Permit No.	Priority	Amount	App. Date	Date Proof Submitted	System Capacity

4. Permit Holder: _____

Address: _____

5. Source: _____ tributary to _____

6. Beneficial Use	Period of Use From To	Rate of Diversion Q (cfs)	Annual Volume V (afa)
-------------------	--------------------------	------------------------------	--------------------------

Domestic	27 Homes	1/1	12/31	1.0	35.6
----------	----------	-----	-------	-----	------

2 ARCHES

3 RESTAURANTS

Allowable Maximums: 1.0 cfs 35.6 gfa

7. Point(s) of Diversion:

[illegible]

8. Place(s) of Use

[illegible]

9. Recommended Conditions/Remarks: _____

10. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None

☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

11. Examiner's Signature Samuel R. Feltz

Date 7/17/86

Checked in Regional Office by Keith C. Wilson

Date 18 Aug 87

Approved in State Office by _____

Date _____

33-7067



REGULATORY SYSTEM

FOR PUMP (INSIDE MANHOLE)

Note: McCrometer had been set upon
mainline and was not connected (installed)



POINT OF DIVERSION


MANHOLE

33-7067

SEP 4 1960

REGULATORY
SYSTEM
FOR 74,000
GAL
STORAGE
TANK

33-7067

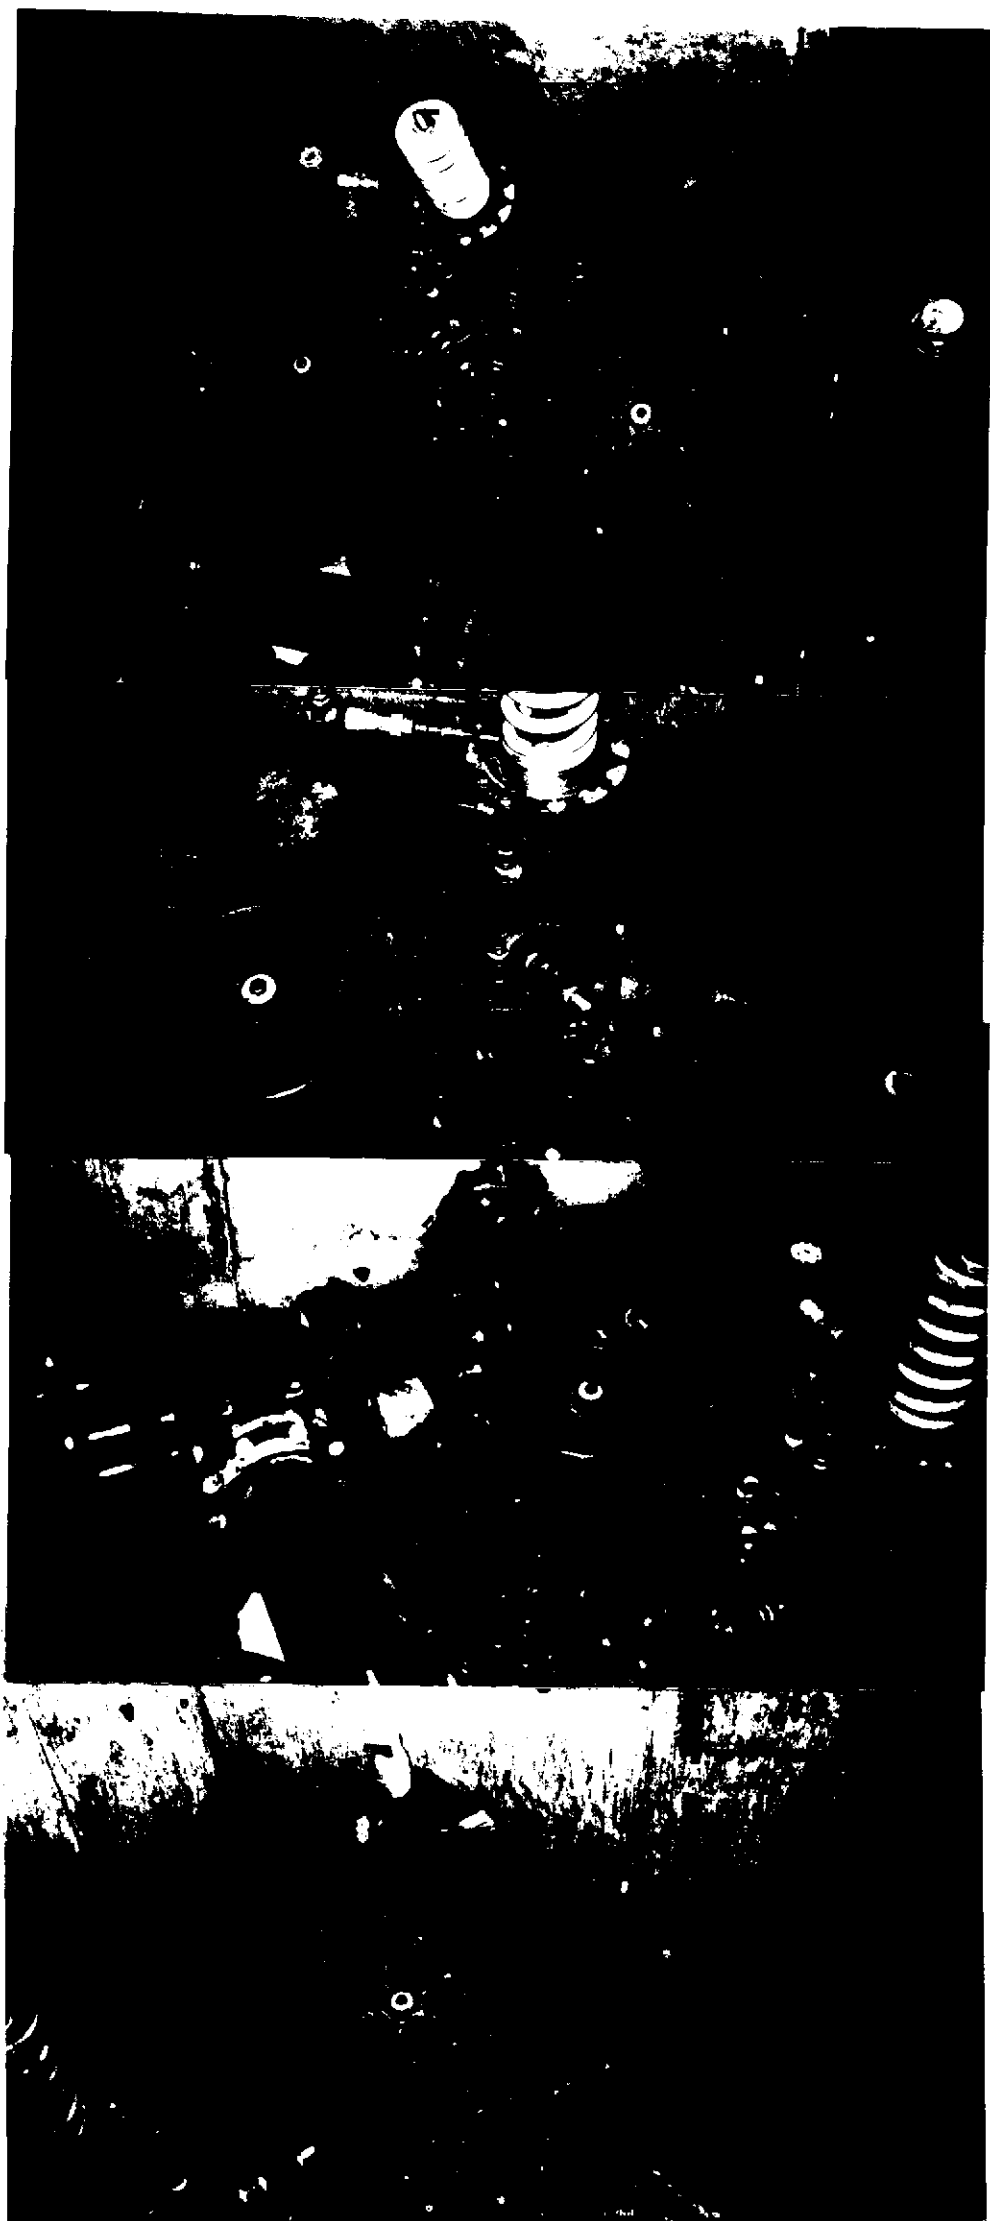

SEP 25 1959

4/86

RECEIVED
JUL 11 1986

STATE OF IDAHO
Department of Water Resources
Eastern District Office
EXAMINATION FEE INFORMATION

OK CW

For Office Use Only
Fee Received 100
Date 7-11-86
Receipt # 39772
Receipt by CW
Sent to S.O. 7-16-86

RECEIVED
JUL 22 1986

1. Permit No. 33-7067

ONE OF THE FOLLOWING BOXES SHOULD BE MARKED TO DESIGNATE YOUR CHOICE:

☒ I choose to have the department make the field examination of this permit; attached is the examination fee. (If this box is marked, complete items 1 thru 8.)

2. Permit Holder: Howe Water District % Jerry Pancheri

3. Post Office Address: Howe Idaho

Telephone No. 767-3419

4. Source of Water: Groundwater

5. Extent of Use:

Domestic 40 (No. of households) Stockwater _____ (No. and type of stock)

Irrigation _____ (acres) Other/Remark _____

6. Total rate &/or volume for which proof is submitted 1.0 cfs _____ acre-feet

7. Show the date water was first diverted and beneficially used under this permit:

1984 1982 Oct

8. Person to contact to accompany the department representative during the field examination:

Jerry Pancheri
(Name)

RECEIVED

(Address)

SEP 25 1990

767-3419

(Telephone Number)

☐ I choose to have the field examination conducted by a certified water right examiner. Attached is a statement from the certified examiner I have selected verifying that he has been retained to conduct the examination. (If this box is marked, complete items 1 thru 7.)

11 July 1986
Date

Jerry Pancheri
Signature of Permit Holder (and title, if appropriate)

copy retained for file

State of Idaho

Department of Water Resources

LICENSE EXAMINATION FEE SCHEDULE

(c.f.s. = cubic feet per second
AF = acre feet)

cfs	AF	Fee
0 - 0.04	0 - 4	\$ 0
.05 - 0.20	5 - 20	50.00
.21 - 1.0	21 - 100	100.00
1.01 - 2.0	101 - 200	125.00
2.01 - 3.0	201 - 300	150.00
3.01 - 4.0	301 - 400	175.00
4.01 - 5.0	401 - 500	200.00
5.01 - 6.0	501 - 600	225.00
6.01 - 7.0	601 - 700	250.00
7.01 - 8.0	701 - 800	275.00
8.01 - 9.0	801 - 900	300.00
9.01 - 10.0	901 - 1000	325.00
10.01 - 11.0	1001 - 1100	350.00
11.01 - 12.0	1101 - 1200	375.00
12.01 - 13.0	1201 - 1300	400.00
13.01 - 14.0	1301 - 1400	425.00
14.01 - 15.0	1401 - 1500	450.00
15.01 - 16.0	1501 - 1600	475.00
16.01 - 17.0	1601 - 1700	500.00
17.01 - 18.0	1701 - 1800	525.00
18.01 - 19.0	1801 - 1900	550.00
19.01 - 20.0	1901 - 2000	575.00
20.01 & over	2001 & over	600.00

Checks should be made payable to the
Department of Water Resources

No fee is required for single family
domestic use or stockwater use.



STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
EASTERN REGION

John V. Evans
Governor

150 Shoup — Suite 15
Idaho Falls, Idaho 83402
(208) 525-7161

A. Kenneth Dunn

Dir 33-7067
HOWE WATER DISTRICT
C/O JIM PANCHERI, CHAIRMAN
HOWE, ID 83244

June 16, 1986

138785
CERTIFIED MAIL

EXAMINATION FEE NOTICE

Dear Permit Holder:

Department records show that proof of beneficial use has been submitted for the above-referenced permit, but that a field examination has not yet been conducted to determine the extent of beneficial use of the water for licensing purposes.

House Bill 671 (effective April 4, 1986) enacted by the 1986 Idaho Legislature requires the payment of a fee before this department can conduct the field examination needed to issue a license confirming use of water under the permit. This letter is notification that the license examination fee is due within sixty (60) days of the date of this letter. The examination fee information sheet (enclosed) must be returned with the fee.

As an alternative to submitting the fee, the department will accept a field examination report completed by a certified water right examiner from the private sector. If you choose to have the examination done by a certified water right examiner, you need not submit the license examination fee to the department, but you must within sixty (60) days of the date of this letter return to the department, the examination fee information sheet showing appropriate information together with a statement from the certified examiner to verify that you have retained a certified examiner to conduct the field examination. If you choose this alternative, a completed field examination report must be submitted within one year of the date of this letter. You cannot later change your decision to use this alternative and submit the fee needed for the department to conduct the field examination, but you may change to another certified examiner.

Certified water right examiners are licensed engineers or geologists certified by the department to conduct water right examinations. The procedure for certifying examiners results from the recently enacted HB 671 and is being developed at this time. A listing of certified water

right examiners will be available from this department when examiners have been certified.

If your permitted use, in fact, has already been examined by the department and you have not asked to have the examination repeated, the fee requirement is not applicable to your permit. If you believe this is the case, please contact the department.

The license examination fee is to be based on the amount of water you indicate you have developed, as listed in item 6 on the examination fee information sheet. The amount of water on which the examination fee is based can be less than the permitted amount, if less water has been diverted and beneficially used. The licensed amount of water, however, will not exceed the amount you claim on the examination fee information sheet. The enclosed license examination fee schedule shows a listing of applicable fees.

FAILURE TO SUBMIT WITHIN THE SIXTY (60) DAY PERIOD, THE FEE OR THE STATEMENT THAT A CERTIFIED EXAMINER HAS BEEN RETAINED TO MAKE THE FIELD EXAMINATION, WILL BE CAUSE TO ADVANCE THE PRIORITY OF THE PERMIT ONE DAY FOR EACH DAY THAT THE FEE SUBMITTAL IS LATE.


FAILURE TO SUBMIT THE FEE OR THE COMPLETED FIELD EXAMINATION REPORT WITHIN A YEAR WILL BE CAUSE TO CONSIDER THE PROOF OF BENEFICIAL USE TO BE INCOMPLETE AND TO LAPSE THE PERMIT.

The attached examination fee information sheet and the fee may be submitted to the following department offices.

Eastern Region

Idaho Dept. of Water Resources
150 Shoup Avenue
Suite 15
Idaho Falls, ID 83401
Phone: 525-7161

Sincerely,

Ron D. Carlson 

RONALD D. CARLSON
Regional Manager

Enclosure

MICROFILMED

SEP 25 1990



STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
EASTERN REGION

John V. Evans
Governor

C. Stephen Allred
Director

1515 Lincoln Road
Idaho Falls, Idaho 83401
(208) 523-7186

December 15, 1980

RE: Permit No. 33-7067

Howe Water District
Howe, Idaho 83244
c/o Jerry Pancheri, Chairman

Dear Mr. Pancheri:

We acknowledge receipt of the proof of beneficial use card submitted for the above referenced permit.

Before a license can be issued, a field examination must be made by a representative of this department. We cannot tell just when this examination will be made, but our examiner will try to contact you at the time he makes the examination so that you may show him the system.

If you have any questions regarding the field examination, please contact our eastern regional office.

Very truly yours,

HAROLD W. JONES
Water Resource Agent

cc: IDWR - State Office

MICROFILMED

SEP 4 5 1990

DEPARTMENT OF WATER RESOURCES

The Idaho Department of Water Resources will consider this card as a statement that the permit holder(s) has completed development to the extent shown below of Permit No. **33-7067**

Name(s) of Permit Holder: Howe Water District

Post Office Address: Howe, Idaho 83244

Go Jerry Pancheri, Chairman Tel. No. 767-3419

Source of Water: Well

Extent of Use: ☒ Domestic 20 (number of households)

☐ Stockwater _____ (number and type of stock)

☐ Irrigation _____ (acres)

☐ Other Some lawn and garden sprinkling in summer

Measuring Device: Required? ☒ Yes ☐ No Installed? ☒ Yes ☐ No

Access Port: Required? ☒ Yes ☐ No Installed? ☒ Yes ☐ No

The above information is a true statement of the extent to which the above numbered permit has been developed.

20-80
Date

[Signature]
Signature of Permit Holder

Howe Water District
c/o Jerry Pancheri, Chairman
Howe, Idaho 83244

PEOPLE'S RIGHT TO
USA 10c



IDAHO DEPARTMENT OF WATER RESOURCES
STATEHOUSE
BOISE, IDAHO 83720

SEP 20 1980

Department of Water Resources

C

11

11

11

11

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

STATEHOUSE
BOISE, IDAHO 83720
(208) 334-4440
CERTIFIED MAIL

HOWE WATER DISTRICT
& JIM SCHONDEL, CHAIRMAN
HOWE, ID 83244

138500

OCTOBER 31, 1980

DEAR PERMIT HOLDER:

ONE OF THE CONDITIONS OF APPROVAL OF YOUR WATER PERMIT NO. 33-7067 WAS THAT EVIDENCE OF THE EXTENT OF DEVELOPMENT MUST BE SUBMITTED TO THIS OFFICE ON OR BEFORE JANUARY 01, 1981. (SEE LAST PAGE OF YOUR APPROVED PERMIT). ENCLOSED IS A POST CARD WHICH MAY BE USED TO SUBMIT THE REQUIRED PROOF OF BENEFICIAL USE.

IF YOU HAVE NOT FULLY COMPLETED YOUR PROJECT, AND YOU HAVE NOT PREVIOUSLY RECEIVED AN EXTENSION OF TIME, YOU MAY REQUEST AN EXTENSION OF TIME PROVIDED THE DELAY IS FOR REASONABLE CAUSE AS INDICATED IN SECTION 42-204, IDAHO CODE, AMENDED. IF YOU HAVE BEEN PREVENTED FROM PROCEEDING BY A GOVERNMENTAL AGENCY OR BY LITIGATION, MORE THAN ONE EXTENSION OF TIME CAN BE GRANTED. A REQUEST FOR EXTENSION OF TIME FORM IS ENCLOSED FOR YOUR CONVENIENCE. PLEASE NOTE THAT A FEE OF \$15.00 MUST BE SUBMITTED WITH THIS FORM.

EITHER THE BENEFICIAL USE POST CARD OR A REQUEST FOR AN EXTENSION OF TIME MUST BE RECEIVED BY THIS DEPARTMENT ON OR BEFORE THE ABOVE MENTIONED DATE, OTHERWISE, THE PERMIT WILL LAPSE AND BE OF NO FURTHER FORCE OR EFFECT WITHIN 60 DAYS.

SINCERELY,

RITA FLECK
SR. SECRETARY

ENCLOSURES

MICROFILMED

SEP 23 1980



State of Idaho

DEPARTMENT OF WATER RESOURCES

STATE OFFICE, 373 W. Franklin Street, Boise, Idaho

JOHN V. EVANS
Governor

C. STEPHEN ALLRED
Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 384-2215

December 12, 1979

Howe Water District
% Jim Schondel
Howe, Idaho 83244

Dear Mr. Schondel,

RE: Permit No. 33-7067

Enclosed is a copy of your approved Application for Permit. We direct your attention to the conditions of approval as listed on the fourth page.

Be sure to note the special condition requiring you to install an access port or other device to provide for the installation of measuring equipment by the Department. Enclosed are specifications for the installation of the access port, as well as a list of measuring device options.

Sincerely,

David R. Tuthill Jr.

DAVID R. TUTHILL, JR.
Supervisor, Water Allocations Section

DRT:lr

Enclosures

MICROFILMED

NATURAL RESOURCES LAW INSTITUTE

10015 S.W. TERWILLIGER BLVD. PORTLAND, OREGON 97219 PHONE (503) 281-6181 EXT. 633



TO: PAUE → Jim
RE: App. No. 33-7067

I have a QUESTION AS TO PROPER
NAME OF WATER USE FOR THIS
APP.

I don't believe that "Culinary" is
proper as my dictionary says this
refers to kitchen use.

I don't know if Howe, Idaho is
an incorporated. If not then per 11/5/79
Admin Memo the use would be
limited to domestic. That means
other uses made of this water would
not be covered on this application.

If Howe is incorporated then the
place of use discription needs to
be changed. Note! the advertizement
assumed the use municipal however
used the wrong place of use
discription.

I don't think the place of use discription
covers all of the place of use.
See up attachment.

(over)

my main question is. Do you think
this app needs to be readvertized if
the place of use covers a larger area
than identified?

Per telecon with Secretary of State
office (584-2300) Howe Idaho is
not incorporated. Therefore, we would have
to consider the use to be domestic.

we should probably make a telephone call
to Jim Schondel to see if this is the only
intended use. ^{domestic only per telecon 12/7/79 J.J.} If other uses are intended,
we could add them without readvertising
since "Municipal" includes all other uses.

Since the place of use would have to
be readvertised if expanded, they would benefit
~~strong~~ by waiting until licensing to amend
the place of use as found by the examiner, so only
one re-advertising fee would be paid.

Dave

State of Idaho
Department of Water Resources

APPLICATION FOR PERMIT ANALYSIS SHEET

INITIAL REVIEW BY: Parker APPLICATION NUMBER: _____

CHECK:

- ☒ Source.
☒ Point of diversion.
☒ County.
☒ Description of diverting works.
☒ Time required for beneficial use of water.
☒ Place of use or acres irrigated.
☒ Map.
☒ Signature.
☒ Fee.
☐ Yes ☒ No Field check required.
☐ Yes ☒ No Critical groundwater area.
☐ Yes ☒ No Request dam safety information. Sent by: _____ Date: _____
☐ Yes ☐ No* In form to receipt.

Field check by: _____

Date: _____

Comments: _____

*REQUEST THE FOLLOWING ADDITIONAL INFORMATION FROM THE APPLICANT: _____

SEND COPIES TO:

- ☒ Idaho State Health Department. Copies sent by: _____ Date: _____
☐ Idaho Fish and Game Department.
☐ Idaho Department of Lands.
☒ U.S. Bureau of Land Management.
☐ U.S. Forest Service.
☐ Other _____

PROCESSING:

- ☒ Yes ☐ No Platted by: PR Map No. 5N 296
☐ Yes ☒ No Other rights on same place of use. N/A
☒ Yes ☐ No* In form for advertising.
Final date for protests: APRIL 23, 1979
☐ Yes ☒ No Protests received. If yes, record information on 4th page of application.

FINAL REGIONAL PROCESSING REVIEW:

- ☒ Affidavit of publication received. Date: 11-13-79
☒ Application published correctly. If not, record action taken: _____
☒ Fee amount, receipt date & number, recorded on application.
☒ Publication dates and paper, recorded on application.
☐ Protests, dates, withdrawal, etc., recorded on application.
☒ Recommendation & initial, recorded on application.
☐ Yes ☒ No Measuring device required.
☒ Yes ☐ No Access port required.
☐ Yes ☒ No Will water be delivered by watermaster? If yes, what district? _____
☒ 3/28/79 Date of priority recommended.
Special conditions of approval or cover letter. _____

Send Snake River Tributary Letter.

By: Ernest Carlson Date: 11/14/79

STATE OFFICE REVIEW:

OIC, 04

Short letter w/access port

- ☐ See attached sheet for more information.

By: Jim Date: 12/7/79

Maureen change item 4

June 8, 1979

The Arco Advertiser
P. O. Drawer "C"
Arco, Idaho 83213

Gentlemen:

The batch of affidavits and their respective billings which you recently sent us included Amendment No. 33-7044 in the name of Stucki for which you previously billed us on April 20, 1979. Also, would you please send the affidavit and certified billing for Application for Permit No. 33-7067 in the name of Howe Water District.

If you have any questions regarding this matter, please contact me at this office.

Thank you,

DONNA HENRIQUES
Secretary

527-3038

Called for off

8-14-79

9-4-79

9-10-79

Called
post-79
ew



STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
EASTERN REGION

John V. Evans
Governor

1515 Lincoln Road
Idaho Falls, Idaho 83401
(208) 523-7186

C. Stephen Allred
Director

May 30, 1979

Arco Advertiser
Box "C"
Arco, Idaho 83213

Dear Sir:

Re: Amended Application for Permit No. 34-7223 - Sorensen
Application for Permit No. 33-7067 - Howe Water Dist.
Application for Permit No. 34-7226 - McAffee
Claim to Water Right No. 34-4036 - Taylor

Please send affidavits of publication and certified bills for the above referenced applications as soon as possible.

Thank you,

DONNA HENRIQUES
Secretary



STATE OF IDAHO

DEPARTMENT OF HEALTH AND WELFARE

RECEIVED

APR 12 1979

Department of Water Resources
Eastern District Office

DIVISION OF ENVIRONMENT
636 Pershing
Pocatello, Idaho
83201

11 April 1979

C
O
P
Y

Howe Water District
% Jim Schondel, Chairman
Howe, Idaho 83244

Re: Application #33-7067 (Butte
County)

Dear Mr. Schondel:

We have been apprised of your application for a permit to appropriate the public waters of the State of Idaho to provide culinary water for forty families (individual connections).

You need to be aware that Title 39-100 Idaho Code defines water systems of that magnitude as public water systems. Further, the Idaho Code requires plans and specifications, including the well and appendages, for public water facilities be submitted to our Department for review and approval prior to construction. Idaho Regulations for Public Drinking Water Systems set minimum requirements for construction, water quality, monitoring frequency, and maintenance and operation. A copy of the regulations is enclosed for your information.

If we may be of assistance in the clarification of our requirements, please do not hesitate to contact us.

Yours very truly,

Henry L. Moran, P.E.
Rgnl. Environmental Supervisor

HLM/md

Enc.

CC: Ron Carlson ✓



United States Department of the Interior

IN REPLY REFER TO

4210

BUREAU OF LAND MANAGEMENT
Idaho Falls District
940 Lincoln Road
Idaho Falls, Idaho 83401

April 6, 1979

Ronald D. Carlson
Idaho Dept. of Water Resources
1515 Lincoln Road
Idaho Falls, ID 83401

Dear Mr. Carlson:

We have reviewed the application for water permit no. 33-7067 and have no objection to the permit being issued. The Howe water district has made application with our agency for right-of-ways for a water line, storage tank and service road in connection with this project.

Thank you for the opportunity to comment on this application affecting Public Lands.

RECEIVED

APR 9 1979

Department of Water Resources
Eastern District Office

Sincerely yours,

Brent D. Jensen

Brent D. Jensen
Area Manager



Save Energy and You Serve America!

March 30, 1979

Bureau of Land Management
940 Lincoln Road
Idaho Falls, Idaho 83401

Dear Sirs:

Re: Application for Permit No. 33-7067

We are enclosing a copy of an application that may be of interest to your agency. Please review the application and submit any comments you may have to our Department as soon as possible. The last date of protest is April 23, 1979, and we are required to take final action shortly thereafter.

If we may be of further assistance, please feel free to contact us.

Very truly yours,

RONALD D. CARLSON
Supervisor
Eastern Region

RDC:dh

Enclosure

ENCLOSURE

March 30, 1979

Henry Moran, Reg. Supervisor
Division of Environment
636 Pershing
Pocatello, Idaho 83201

Dear Mr. Moran:

Re: Application for Permit No. 33-7067

We are enclosing a copy of an application that may be of interest to your agency. Please review the application and submit any comments you may have to our Department as soon as possible. The last date of protest is April 23, 1979, and we are required to take final action shortly thereafter.

If we may be of further assistance, please feel free to call.

Very truly yours,

RONALD D. CARLSON
Supervisor
Eastern Region

RDC:dh

Enclosure

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Eastern Region

1515 Lincoln Road
Idaho Falls, ID 83401
(208) 523-7186

MARCH 30, 1979

Arco Advertiser
Box "C"
Arco, Idaho 83213

Gentlemen:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. We have allowed ample time for you to submit a galley proof to this office for review before the first publication date. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before APRIL 23, 1979.

Yours truly,

RONALD D. CARLSON
Supervisor

Encl.

*Called for affidavit
5/22/79*

RECEIVED
MAY 1 1979

PUBLIC NOTICE

NOTICE OF APPLICATION FOR WATER RIGHT

Notice is hereby given that the following application has been submitted for permit to appropriate the public waters of the State of Idaho:

33-7067

**HOWE WATER DISTRICT
c-o JIM SCHONDEL, CHAIR-
MAN, HOWE, ID 83244
Source: GROUNDWATER
Date Filed: 03-28-1979
Amount: 1.00 CFS
Diversion Point: SENW Sec 04 T
05N R 29E, BUTTE COUNTY
Use: MUNICIPAL (1.00 CFS)
from 01-01 to 12-31
Place of Use: NWSE SWSE Sec 04
T 05N R 29E NWNE Sec 09 T 05N R
29E
Diversion Means: WELL, PUMP,
STORAGE TANK**

If issued, the permit will be subject to all prior water rights. Protests against the granting of any permit must be filed with the Director of the Idaho Department of Water Resources, 1515 Lincoln Rd., Idaho Falls, Idaho 83401 on or before APRIL 23, 1979.

**C. STEPHEN ALLRED
Director**

Published 4-5 & 4-12-79

NOTICE OF APPLICATION FOR WATER RIGHT

Notice is hereby given that the following application(s) have been submitted for permit to appropriate the public waters of the State of Idaho:

33-2062

HOWE WATER DISTRICT

% JIM SCHONDEL, CHAIRMAN, HOWE, ID 83244

Source: GROUNDWATER

Date Filed: 03/28/1979

Amount: 1.00 CFS

Diversion Point: SENW Sec 04 T 05N R 29E, BUTTE Co.

Use: MUNICIPAL (1.00 CFS) from 01/01 to 12/31

Place of Use: ^{NW SW} ~~NESE~~ ^{SE} ~~SESE~~ Sec 04 T 05N R 29E NWNE Sec 09 T 05N R 29E

Diversion Means: WELL, PUMP, STORAGE TANK

per telecon 4-3-79 dh

If issued, the permit(s) will be subject to all prior water rights. Protests against the granting of any permit must be filed with the Director of the Idaho Department of Water Resources, 1515 Lincoln Rd., Idaho Falls, Idaho 83401 on or before APRIL 23, 1979.

C. STEPHEN ALLRED

Director

Published 4/5 & 4/12/79.

March 29, 1979

Hamilton & Voeller, Inc.
P. O. Box 1358
Pocatello, Idaho 83201

Dear Sir:

Re: Application for Permit - Howe Water District

Attached herewith is Departmental receipt No. 12977 in the amount of \$35.00 for the above referenced application.

Very truly yours,

RONALD D. CARLSON
Supervisor
Eastern Region

RDC:dh

Attachment