

Ident. No. 97-17231

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

RECEIVED

JUL 05 2005

To appropriate the public waters of the State of Idaho

Department of Water Resources
Southern Region

1. Name of Applicant Salmon Tract Rural Fire District Phone 208-655-4222
Mailing address 2411 E. 2450 N Twin Falls, ID 83301
2. Source of water supply Groundwater which is a tributary of _____
3. Location of point of diversion is Township 12 South Range 16 East Sec. 27 in the NE $\frac{1}{4}$, NW $\frac{1}{4}$, SW $\frac{1}{4}$, Govt. Lot _____, B.M., Twin Falls County; additional points of diversion if any: _____
4. Water will be used for the following purposes:
Amount 0.11 cfs for Fire Protection purposes from Jan 1 to Dec 30 (both dates inclusive) ^{31 cfs.}
(cfs or acre-feet per annum)
Amount 0.04 cfs for Domestic purposes from Jan 1 to Dec 30 (both dates inclusive) ³¹
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
5. Total quantity to be appropriated is (a) 0.11 cubic feet per second and/or (b) _____ acre feet per annum
6. Proposed diverting works:
 - a. Describe type and size of devices used to divert water from the source well and pump (new)
6" well submersible pump 10 HP
 - b. Height of storage dam _____ feet; active reservoir capacity _____ acre-feet; total reservoir capacity _____ acre-feet
 - c. Proposed well diameter is 6" inches; proposed depth of well is 700 feet
 - d. Is ground water with a temperature of greater than 85°F being sought? No
 - e. If well is already drilled, when? N/A; Drilling firm _____
Well was drilled for (well owner) _____; Drilling Permit No. _____
7. Time required for completion of works and application of water to proposed beneficial use is 1 years (minimum 1 year)
8. Description of proposed uses (if irrigation only, go to item 9):
 - a. Hydropower; show total feet of head and proposed capacity in kW. _____
 - b. Stockwatering; list number and kind of livestock. _____
 - c. Municipal; show name of municipality. _____
 - d. Domestic; show number of households. one office
 - e. Other; describe fully. Fire truck fill water

a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.

b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols. N/A

Total number of acres to be irrigated 0

10. Describe any other water rights used for the same purposes as described above.


12. Remarks: The Fire District building will have a restroom to be used one day per week. The district will also fill fire trucks at a rate not to exceed 2500 gallons per day.


13. **MAP OF PROPOSED PROJECT REQUIRED** - Attach an 8½"x11" map clearly identifying the proposed point of diversion, place of use, section #, township & range. (A photocopy of a USGS 7.5 minute topographic quadrangle map is preferred.)

Robert B. Davis, File Chief
Signature of Applicant (and title, if applicable)

Received by C. SKINNER Date 7/5/2005 Time PM
Fee \$ 100.00 Receipted by C. SKINNER # 5027801 Preliminary check by C. SKINNER
Publication prepared by _____ Date _____ Published in _____ Date 7/5/2005
Publication approved _____ Date _____

SALMON TRACT RURAL FIRE
PROTECTION DISTRICT

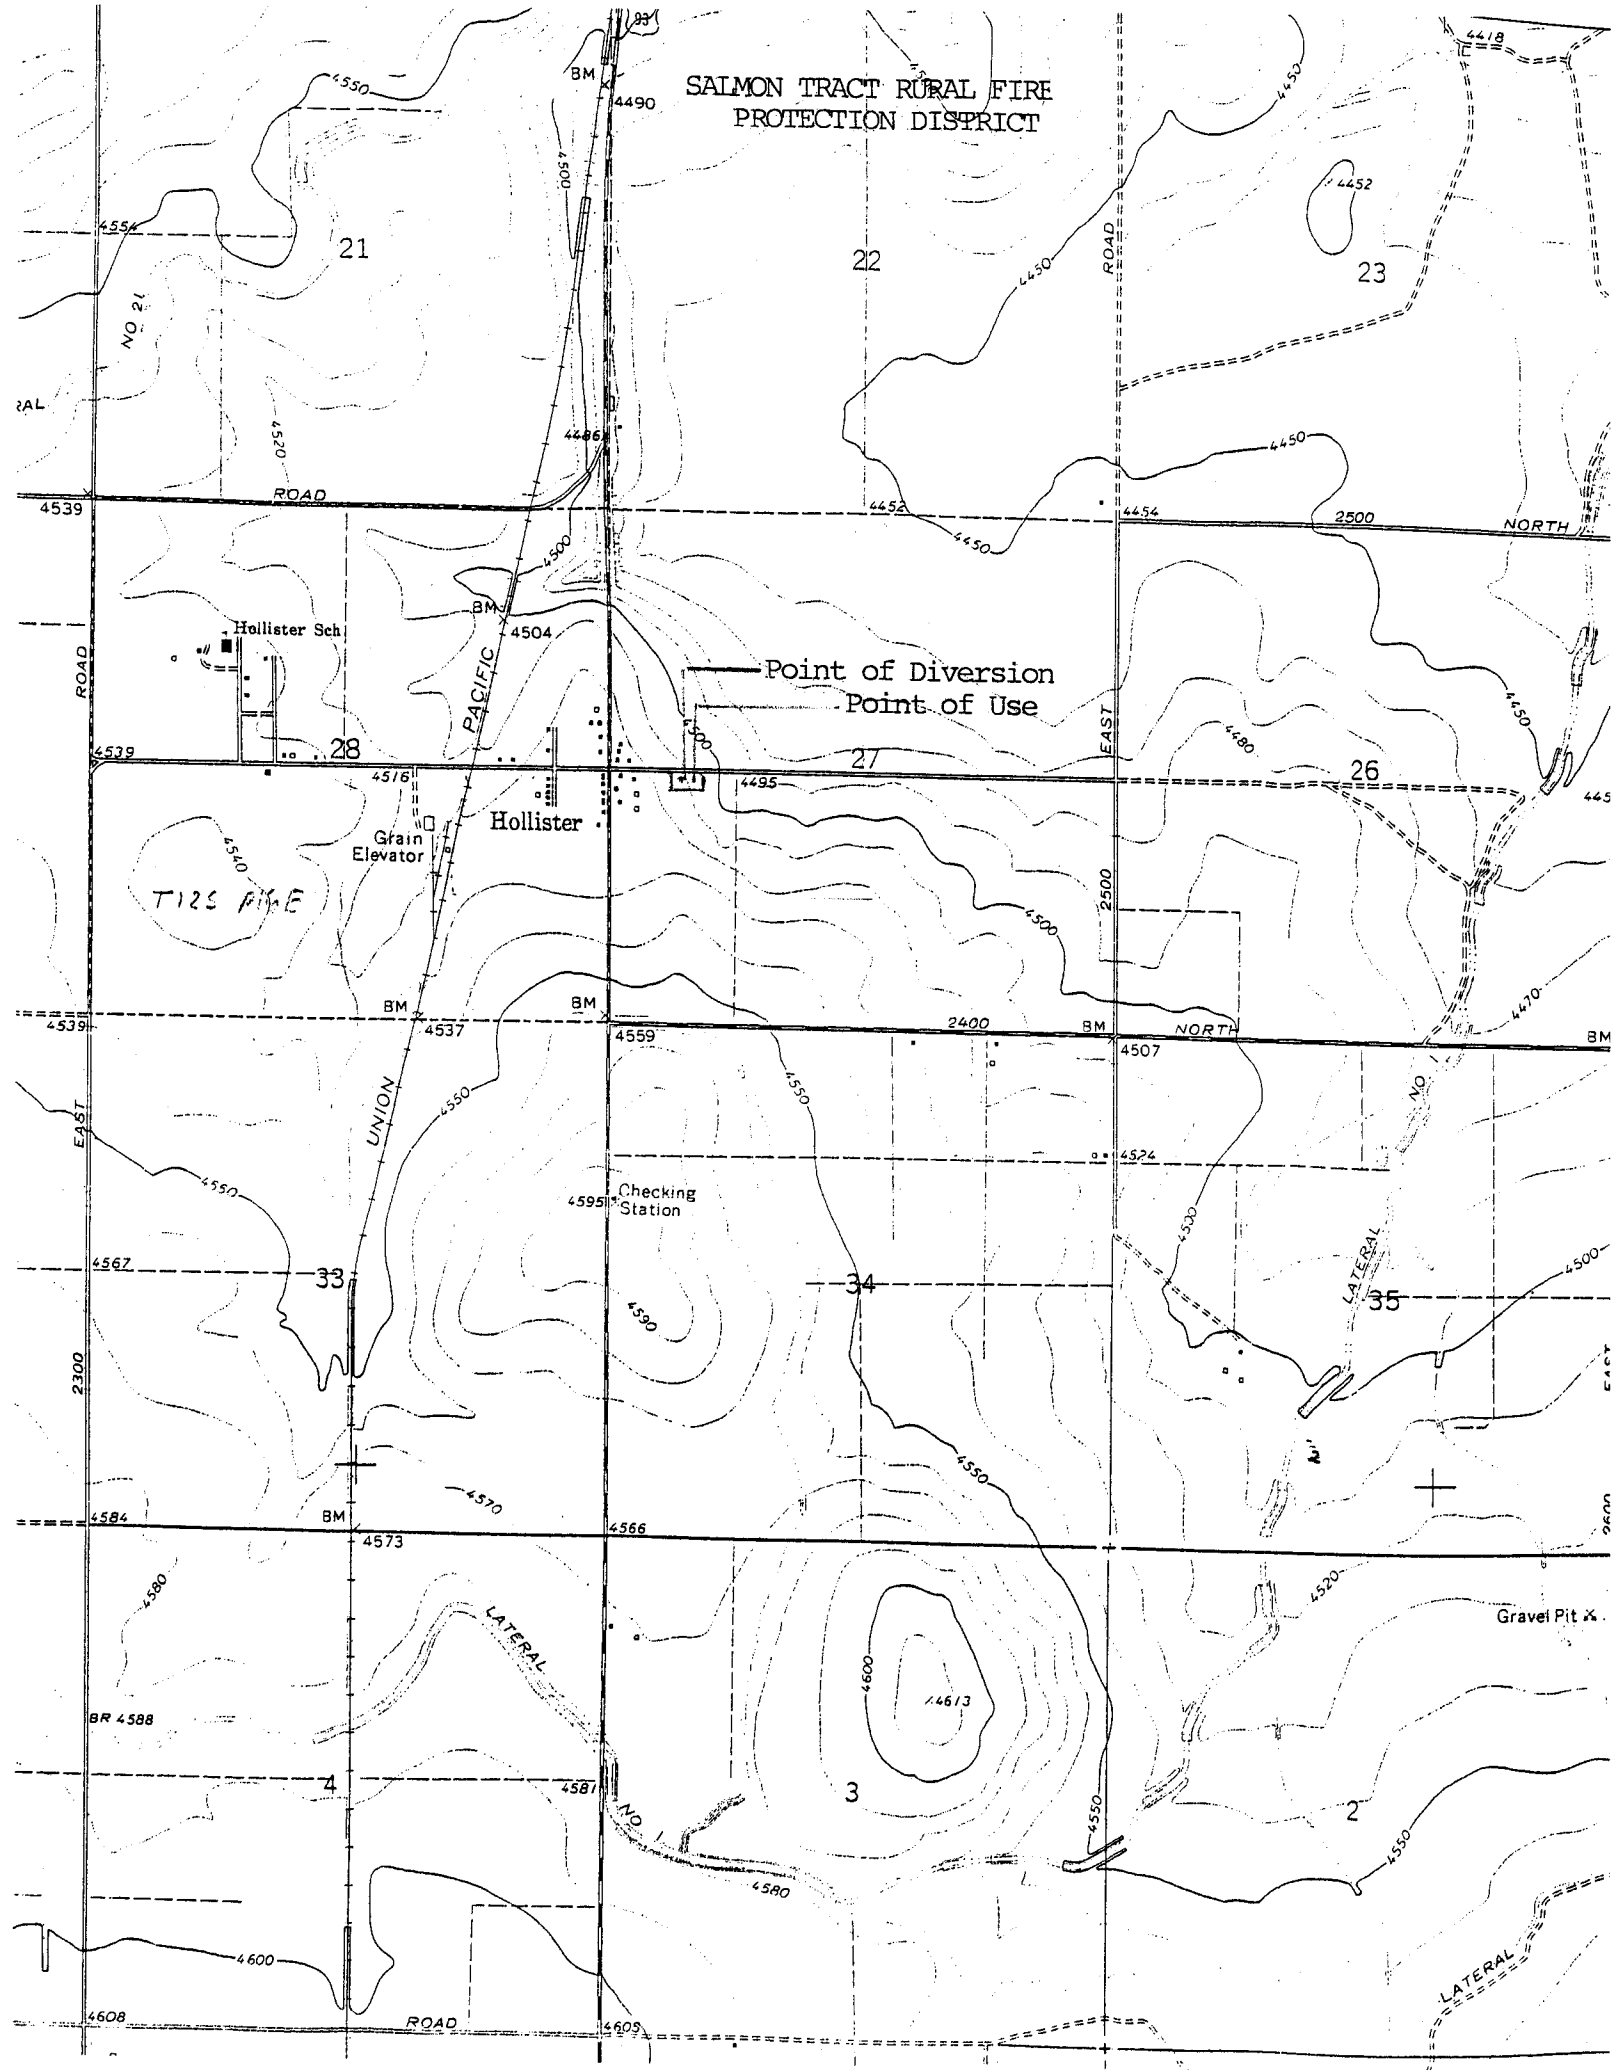



SALMON TRACT RURAL FIRE PROTECTION DISTRICT
2411 E 2450 N HOLLISTER, ID 83301
208-655-4222



COMMISSIONERS: WALTER HAMBY, MAURICE FULLER, CHARLES BOSS
FIRE CHIEF: RODNEY DAVIS
SECRETARY/TREASURER: CHERYL DAVID