


71-7144

X - 1963
X - 1970
ext. 1991


10 pch



71-7144

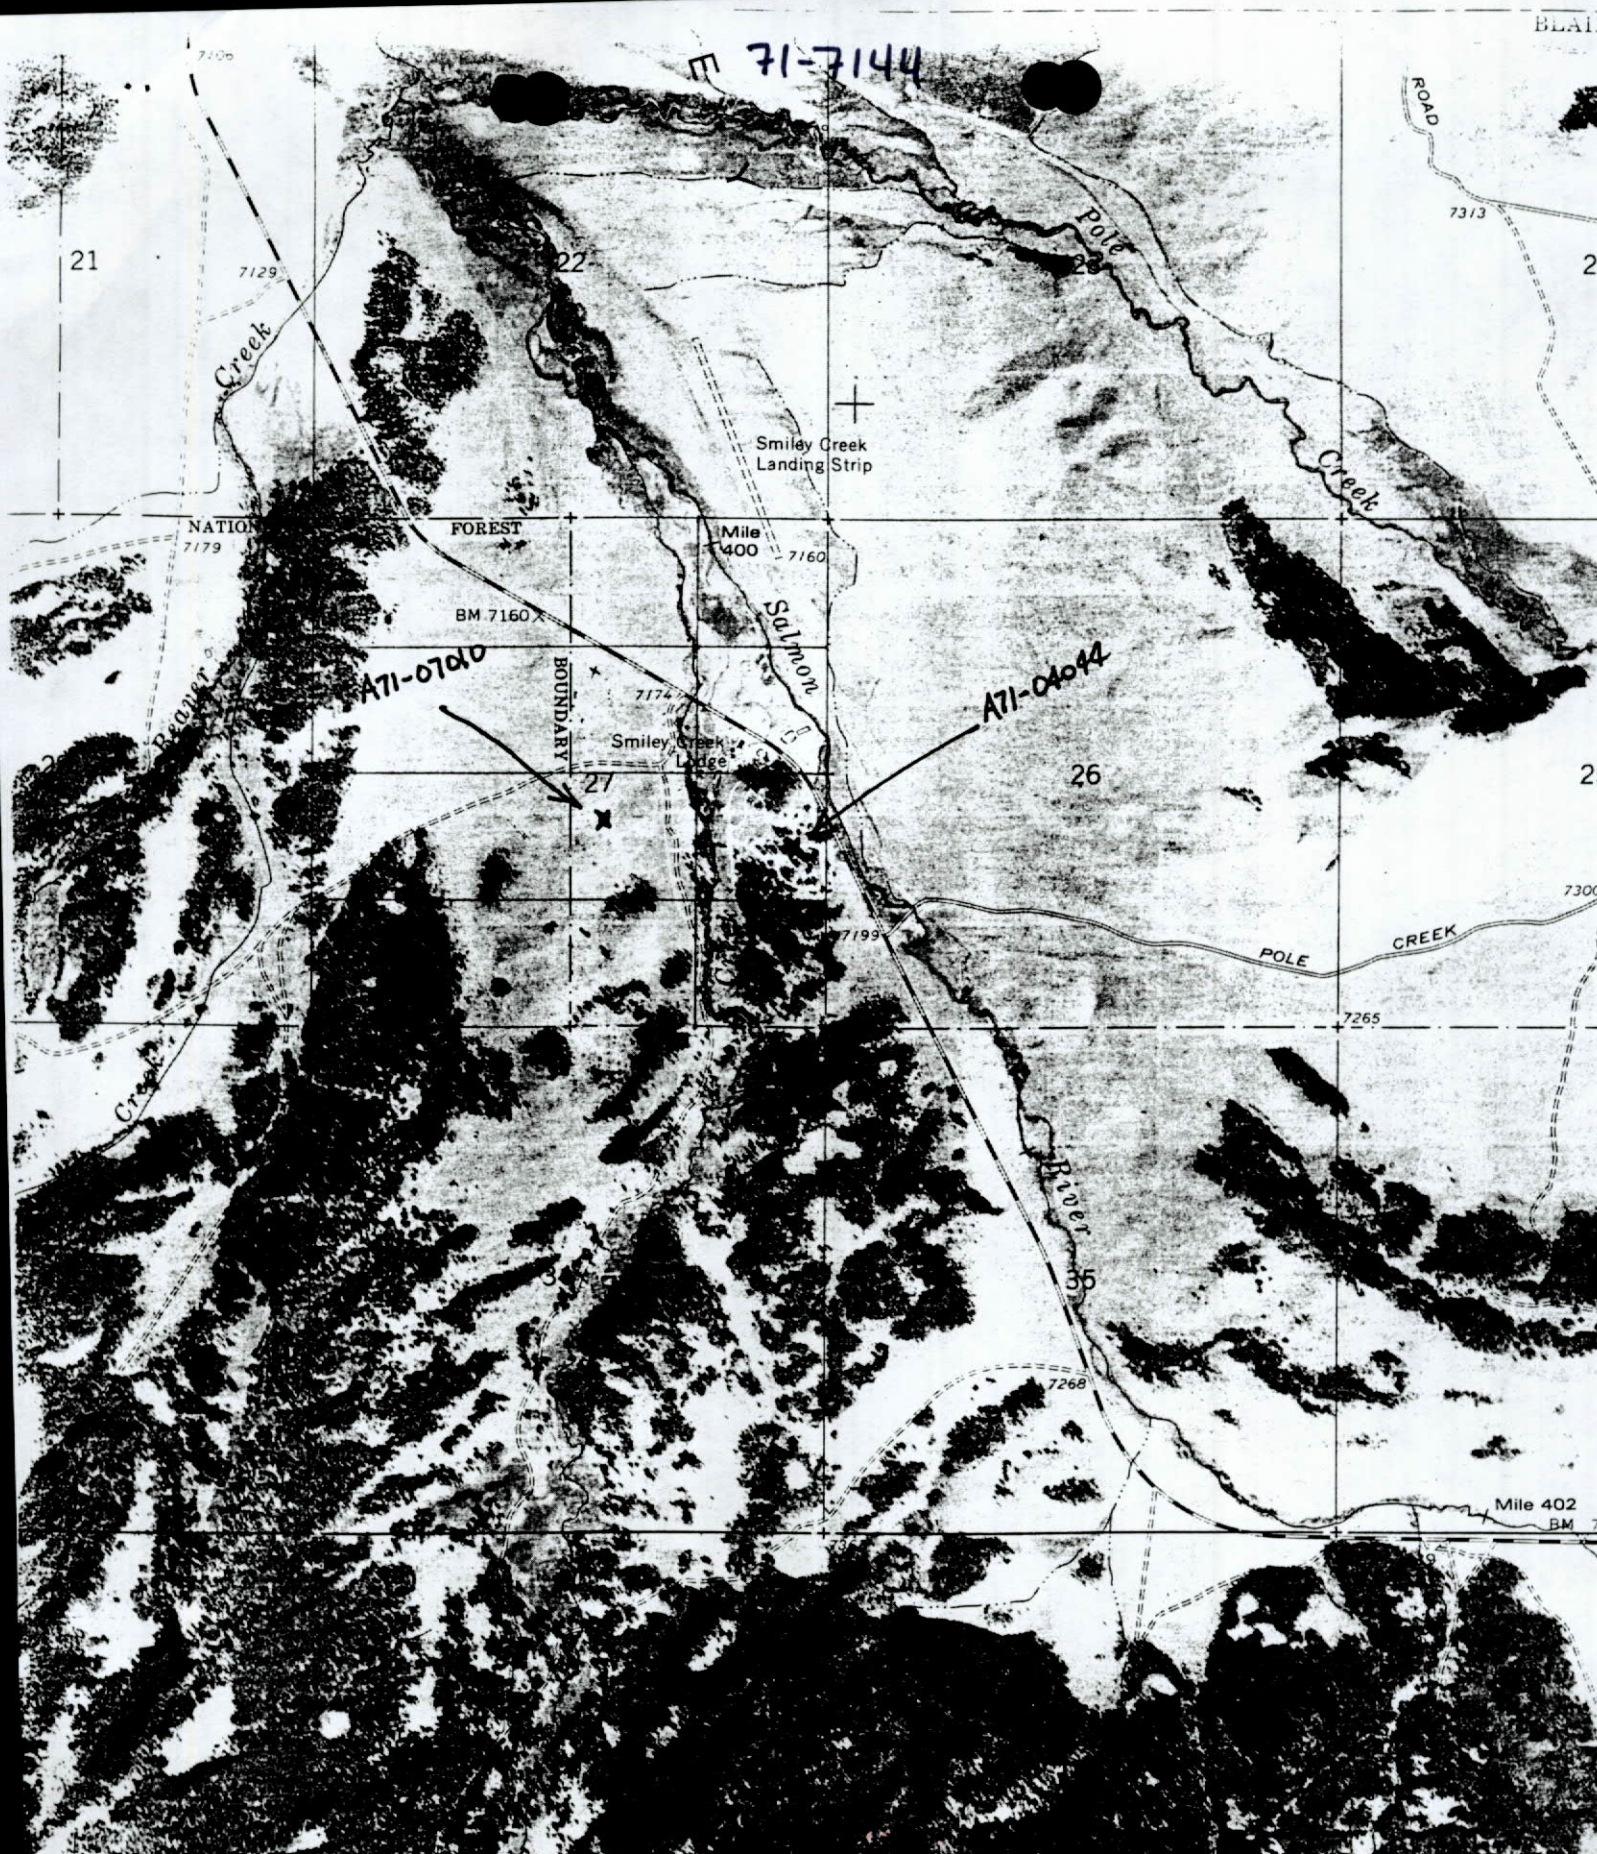


SCALE 1:24 000



1 MILE SEP 21 1992

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

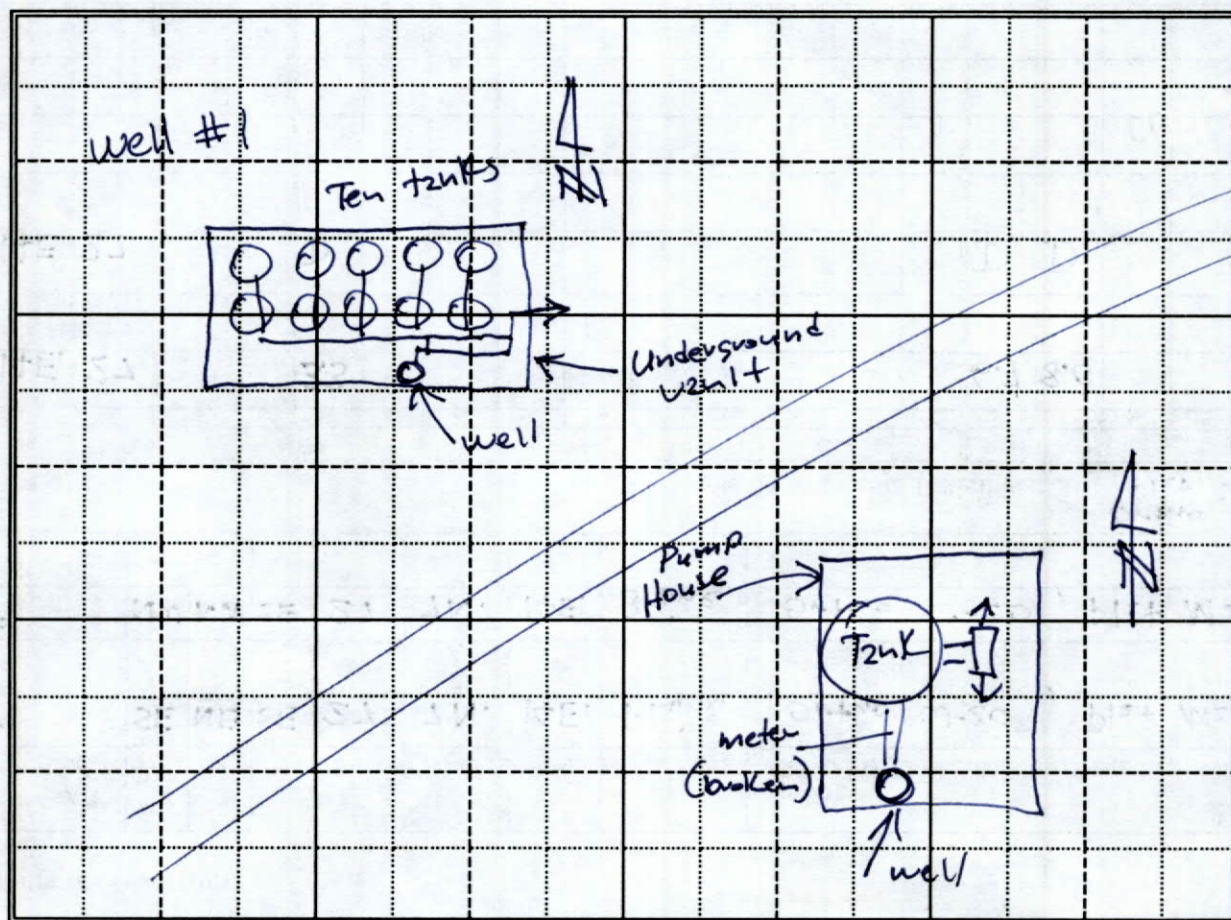

Scale: 1" = _____

____ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

____ Aerial Photo Attached (required for irrigation of 10+ acres)

____ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
Well #1		5	Jacuzzi		rated 62 gpm
Well #2		5	Jacuzzi		rated 62 gpm

*Code to correspond with No. on map and aerial photo


D. FLOW MEASUREMENTS

1.


Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
Polysonic well #1						
C2lc. well #2						

2. Measurements: Well #1 measured @ 61 gpm. Well #2 not measured. See attached sheet for calculation.
 Total $Q = Q_1 + Q_2 = 61 + 61 = 122 \text{ gpm} = 0.27 \text{ cfs}$

OCT 31 1994

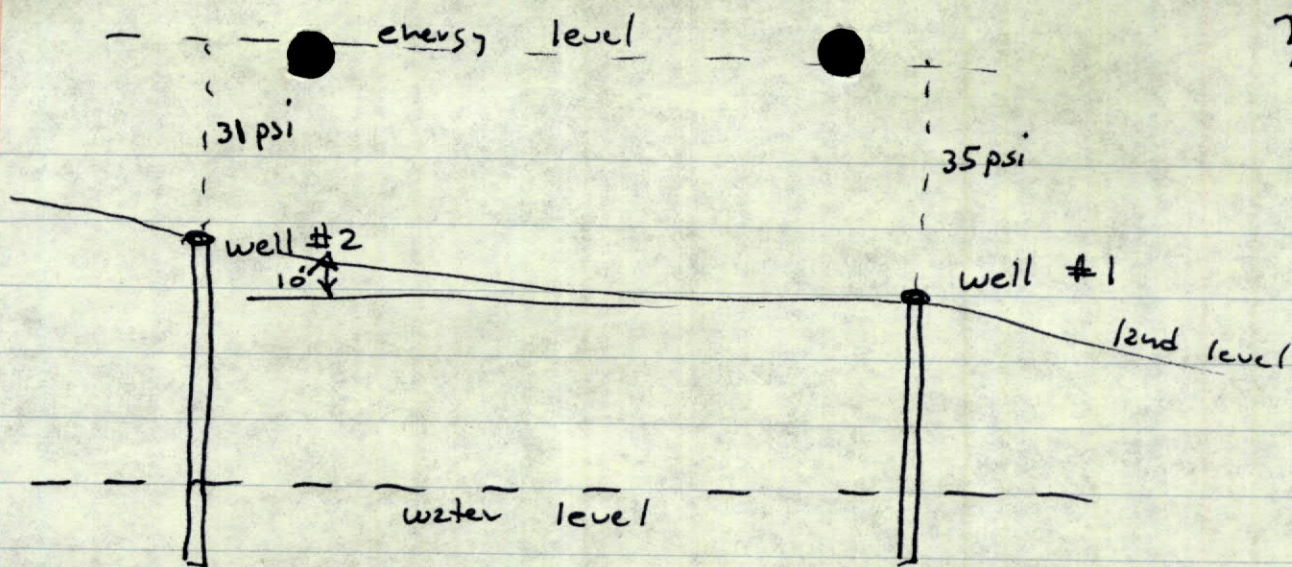

If the above condition is valid the 61 gpm for both is valid.

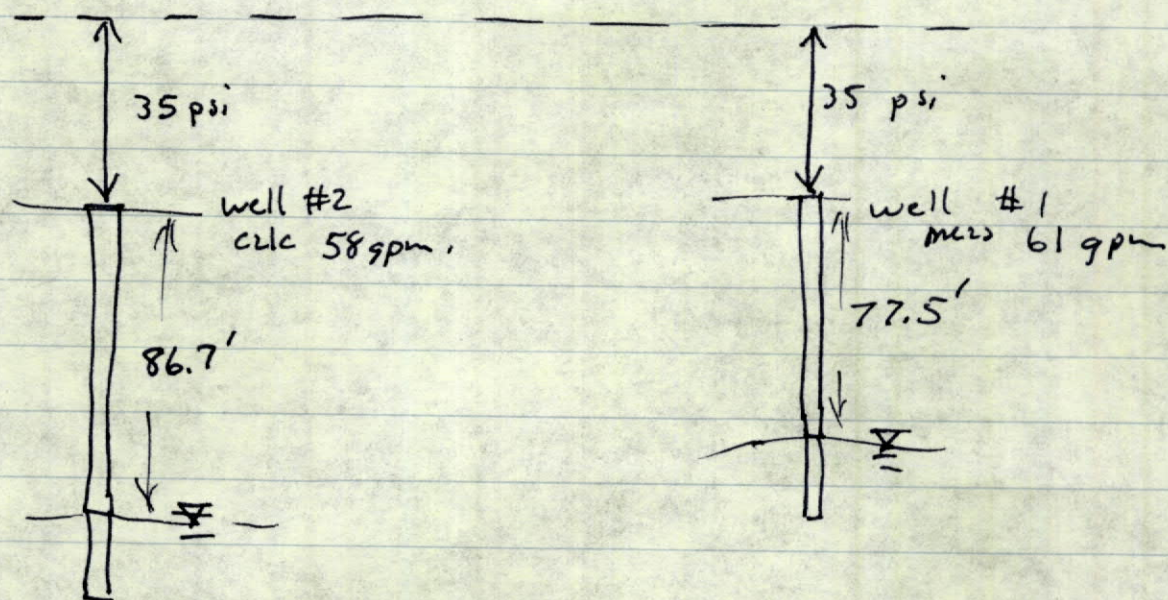


If the above worst case is assumed then well #2 would yield approx.

$$\frac{Q_2}{Q_1} = \frac{[(35 \times 2.1) + 77.5]}{[(35 \times 2.1) + 86.7]}$$

$$\therefore Q_2 = 58 \text{ gpm}$$

Since there is no real significant difference it is recommended that the total Q of well #1 + well #2 be recommended as 122 gpm or 0.27 cfs.

MICROFILMED
OCT 31 1994

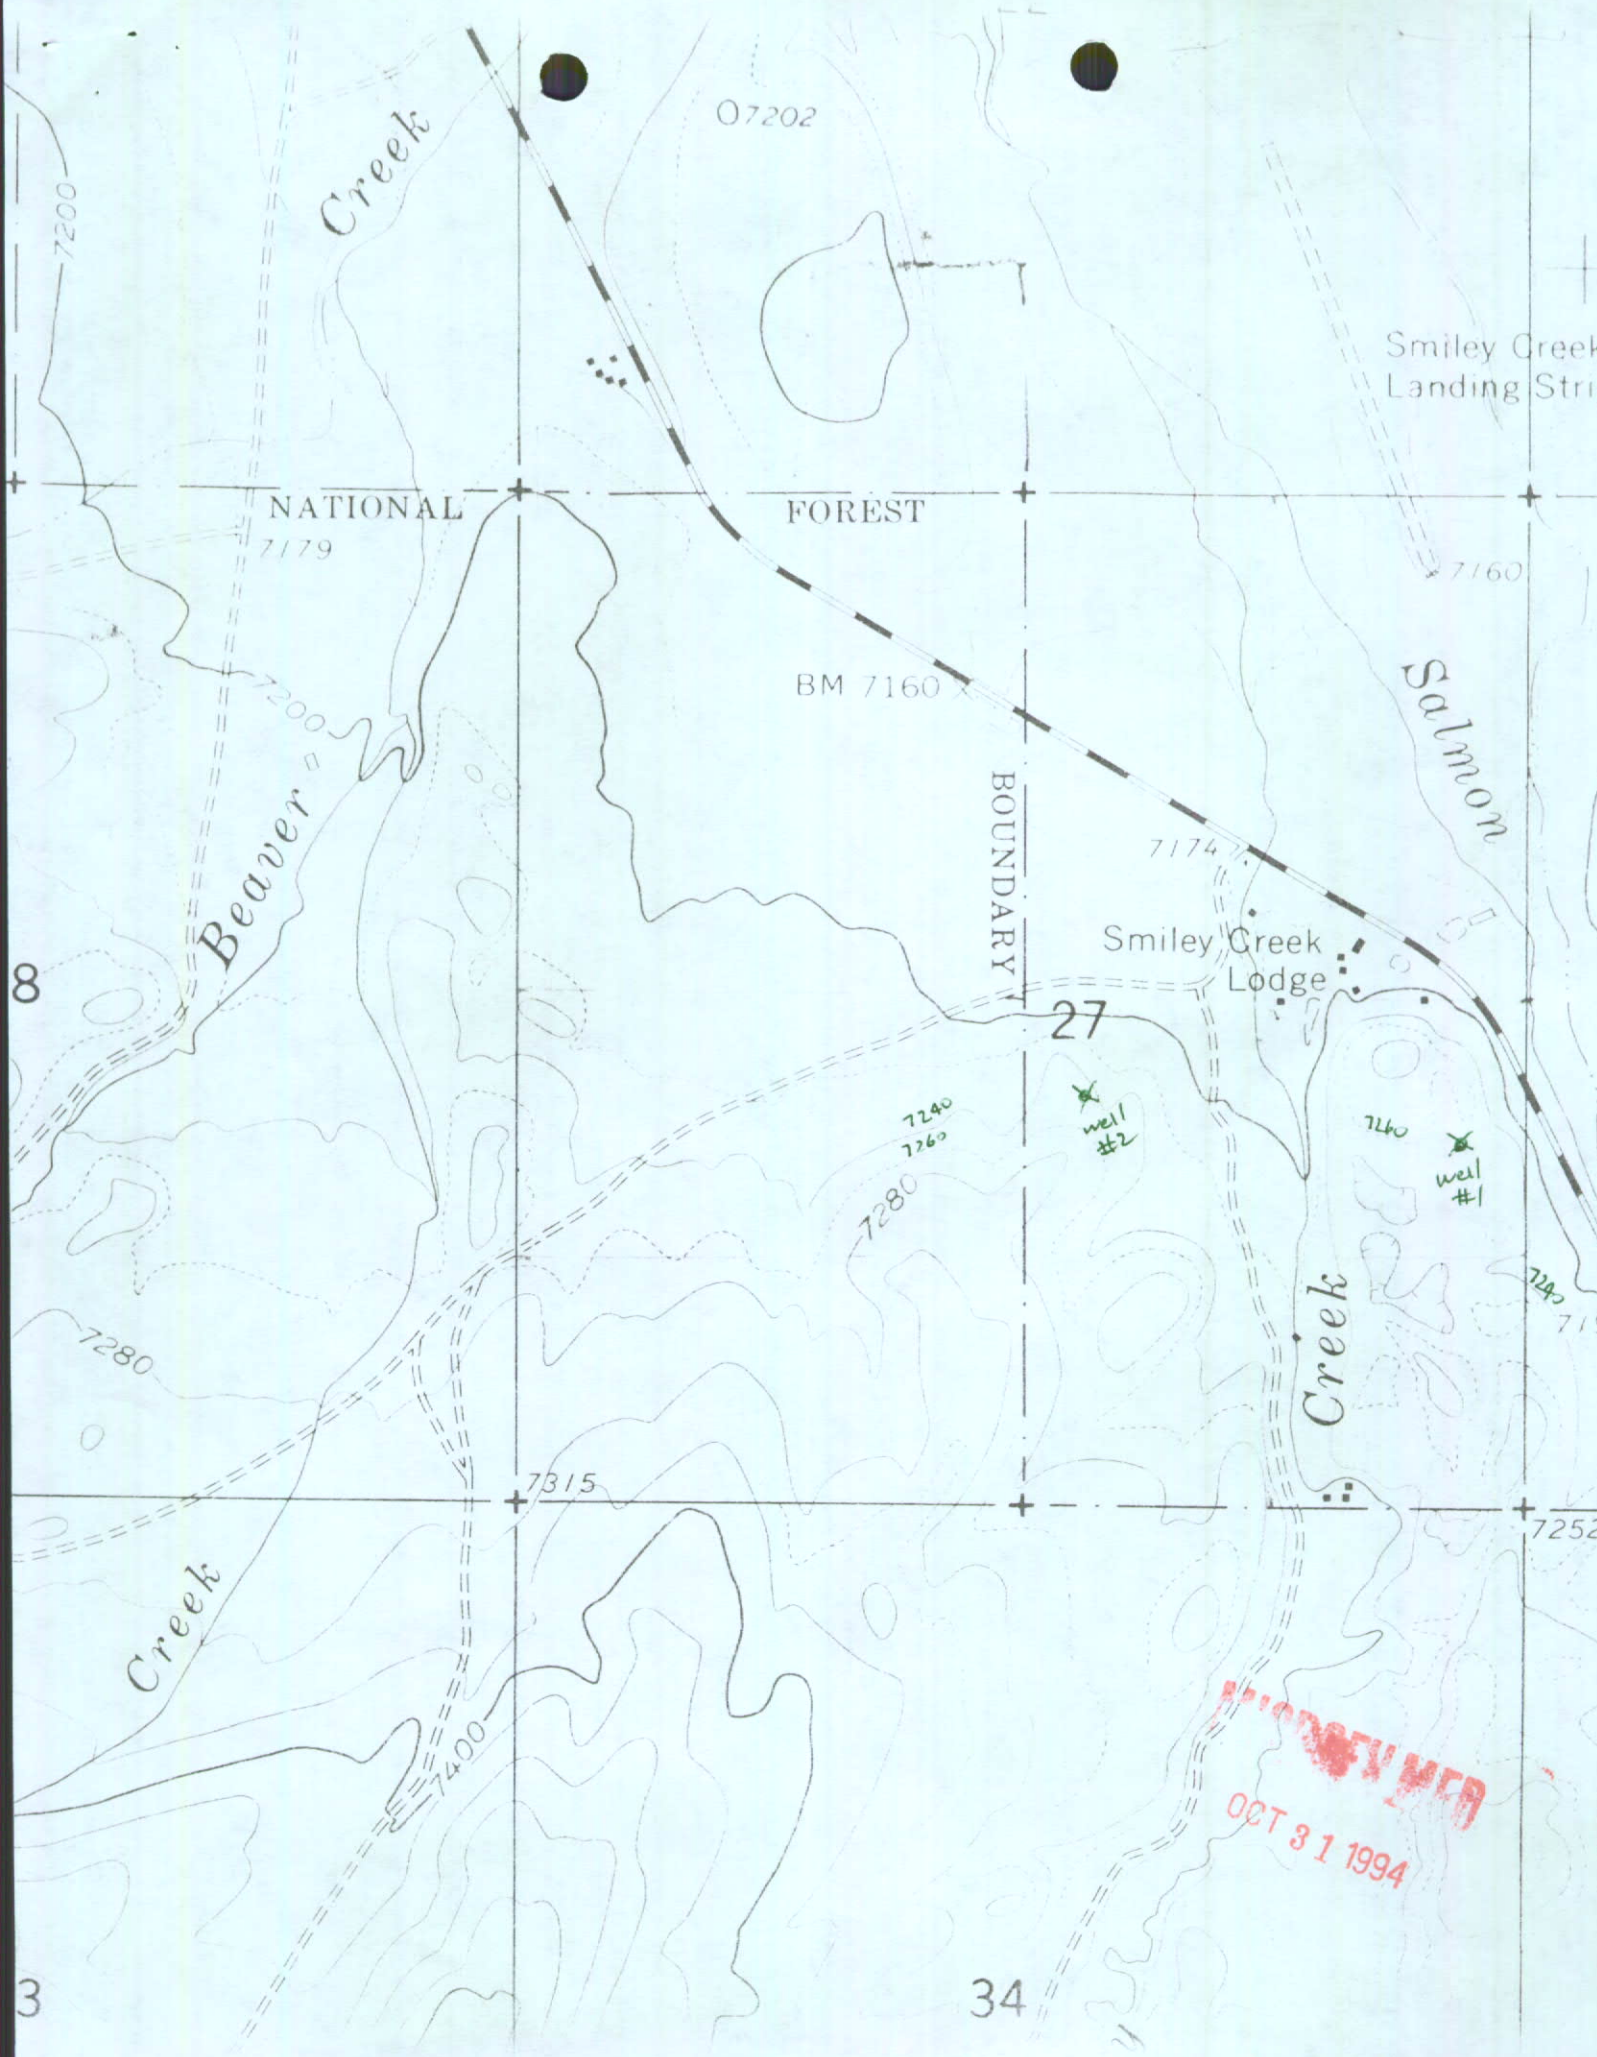

07202

NATIONAL

FOREST

Smiley Creek
Landing Strip

Beaver Creek

Salmon

Smiley Creek
Lodge

Smiley Creek

RECEIVED
OCT 31 1994

CLAIM

INTT

Adm

T. R. S. Q/Q

P/D 7N 14E

A71-04044

PHOTO W-20

A71-07010

DT.&ID.

Permit 71-07144

21

22

23

NATION

FOREST

Mile 400

Smiley Creek Landing Strip

Salmon

Smiley Creek Lodge

well #2
NW 1/4 SE

well #1
SENESE

Well Locations Confirmed, 9/29/93

OCT 5 1994

MODE SELECT
INPUT

OUTER DIAMETER
2.4064 IN

PIPE MATERIAL
? CS,SS

WALL THICKNESS
.15400 IN

INNER LINING
? NO LING.

KIND OF FLUID
? WATER

SENSOR MOUNTING
? U

TYPE OF SENSOR
? SMALL

DATA CHANGE
? NO

SPACING
1.057 IN U

ZERO MODE
CLEAR

ZERO MODE
AUT ZERO

ZERO MODE
ZERO OPR

09-29 08:4800 *R
-386.219E-16PM

09-29 08:5000 *R
-429.015E-16PM

09-29 08:5000 *R
-514.871E-16PM

09-29 08:5100 *R
-539.967E-16PM

09-29 08:5100 *R
-553.440E-16PM

09-29 08:5100 *R
-562.950E-16PM

09-29 08:5200 *R
-597.821E-16PM

09-29 08:5200 *R
-582.235E-16PM

09-29 08:5200 *R
-601.255E-16PM

09-29 08:5300 *R
-645.372E-16PM

09-29 08:5300 *R
-684.734E-16PM

09-29 08:5400 *R
-671.525E-16PM

09-29 08:5500 *R
-705.867E-16PM

09-29 08:5600 *R
-721.454E-16PM

09-29 09:0400 *R
-608.388E-16PM

09-29 09:0400 *R
-607.860E-16PM

well
#1

OCT 31 1994

pressure
no lining

71-07144

1" = 660'
1988

1/4 Cor

22 23
27 26

CLAIM
T. R. S.
P/D
PHOTO
DT. & ID. ASCS

SWNE
3.3 acres

well #2

NWSE
8 acres

NESE
6.7 acres

well #1

1/4 Cor

REPRODUCED
OCT 31 1994

10/12/93
Adm


71-07144

18 Existing houses ... X
36 Future houses ... (hookup exists)

#2 Well

#1 Well



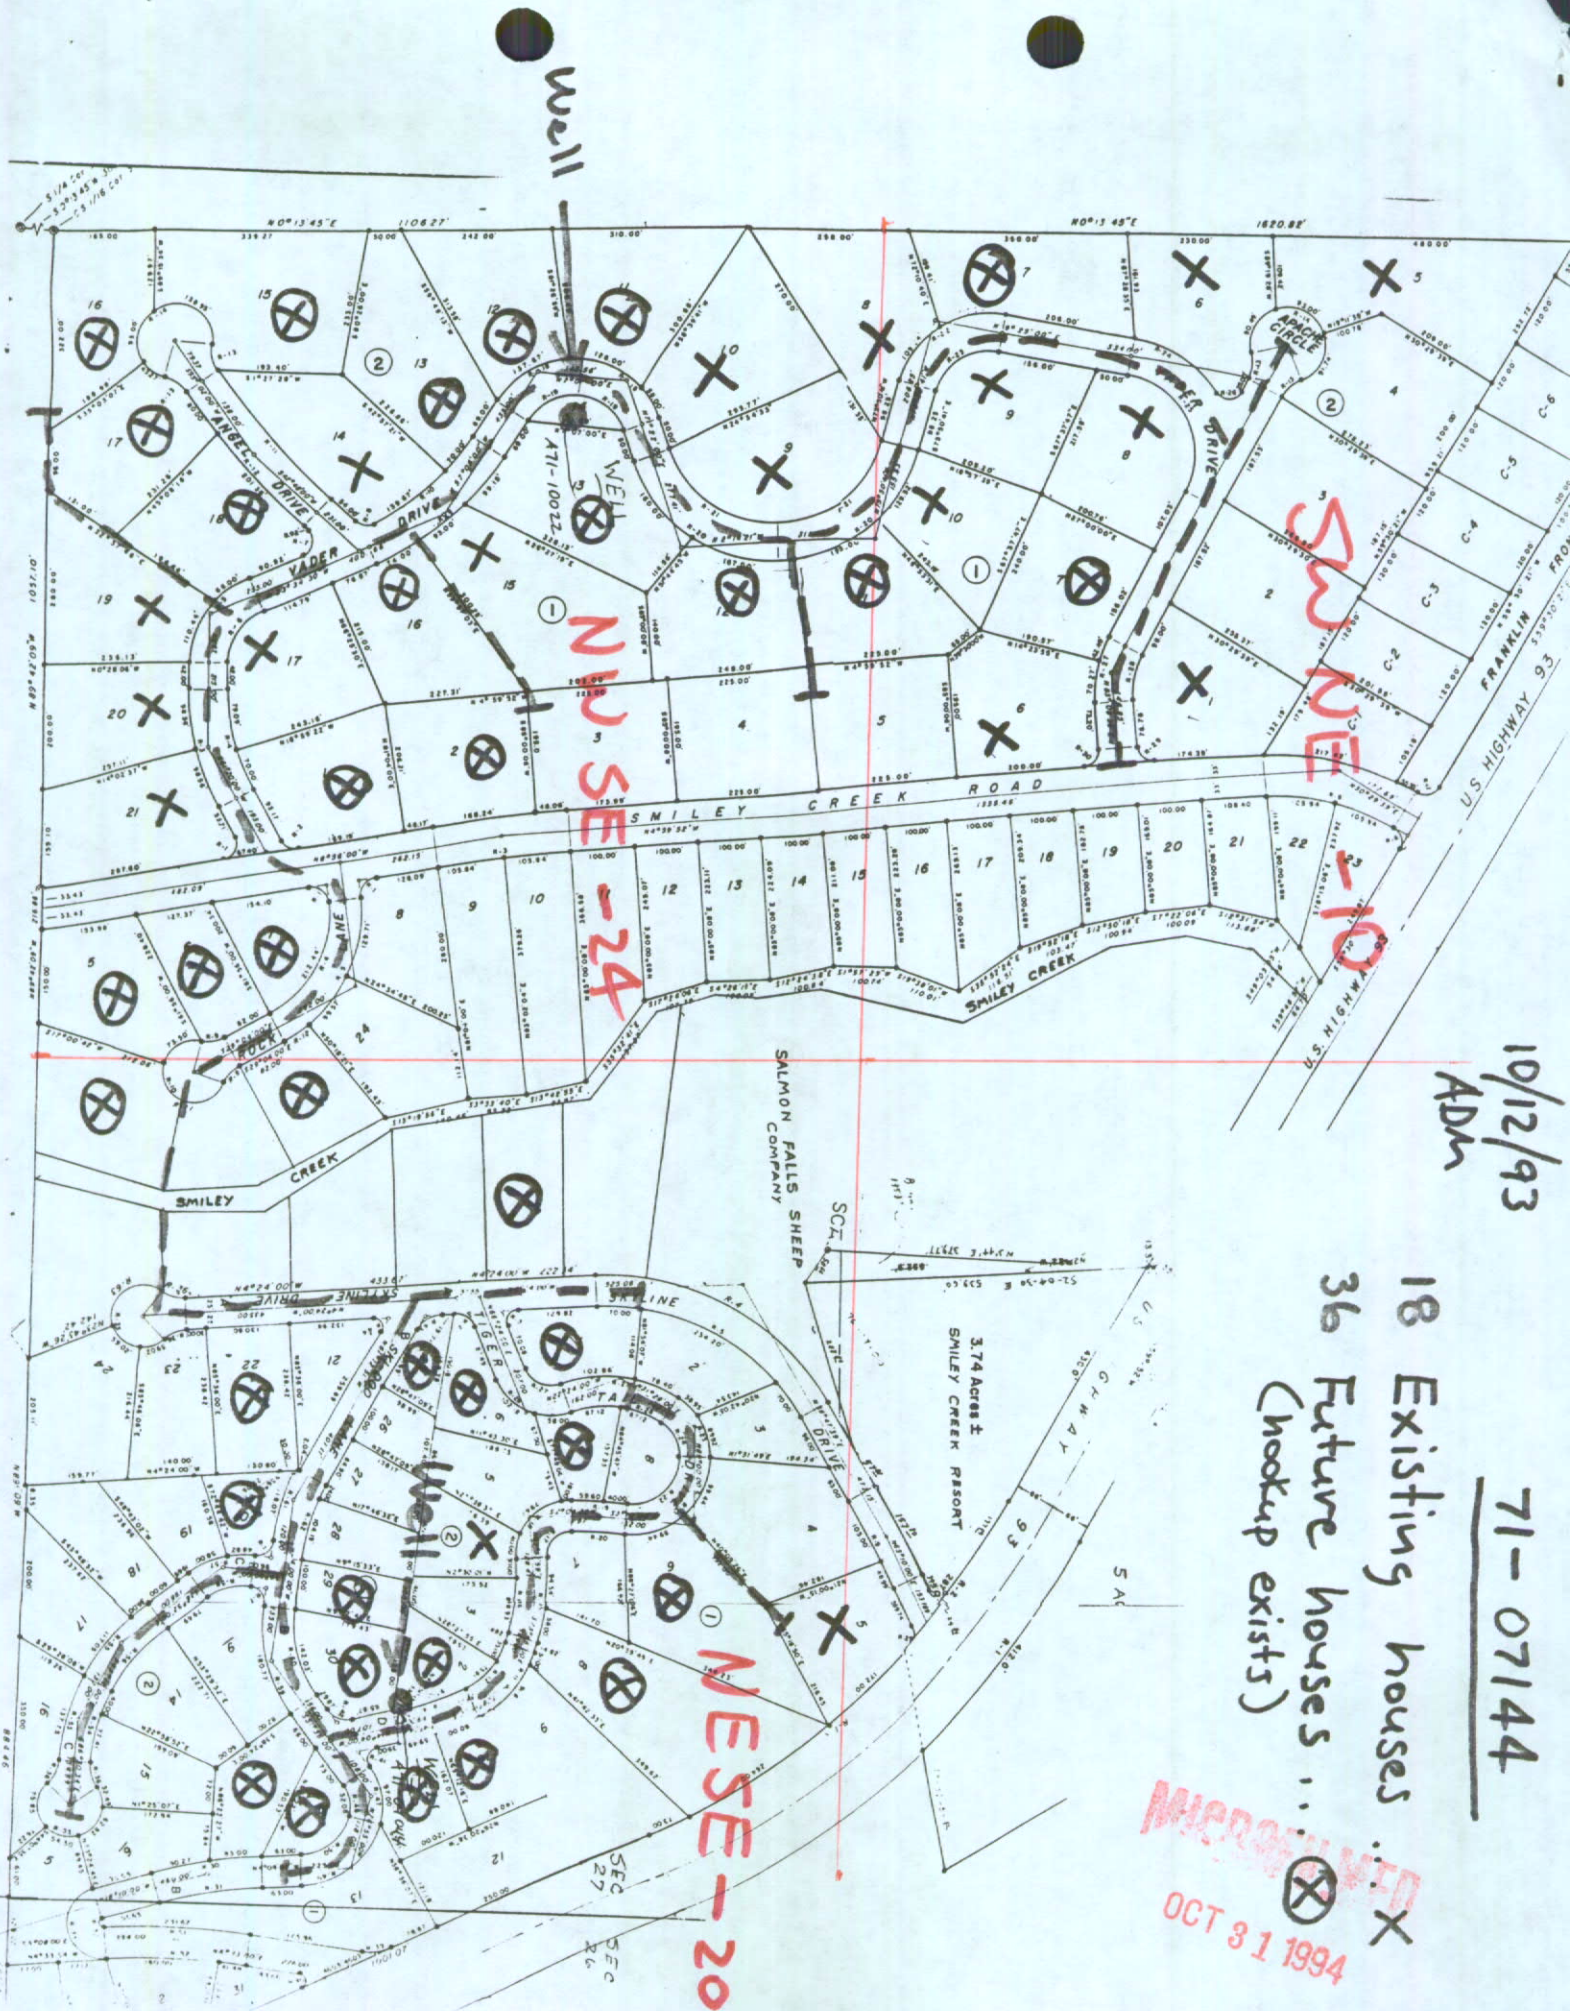

10/12/93
ADN

18 Existing houses
36 Future houses
(hookup exists)


71-07144


OCT 31 1994

10/12/93
ADM

71-07010
71-04044
71-07144

RECORDED
OCT 31 1994

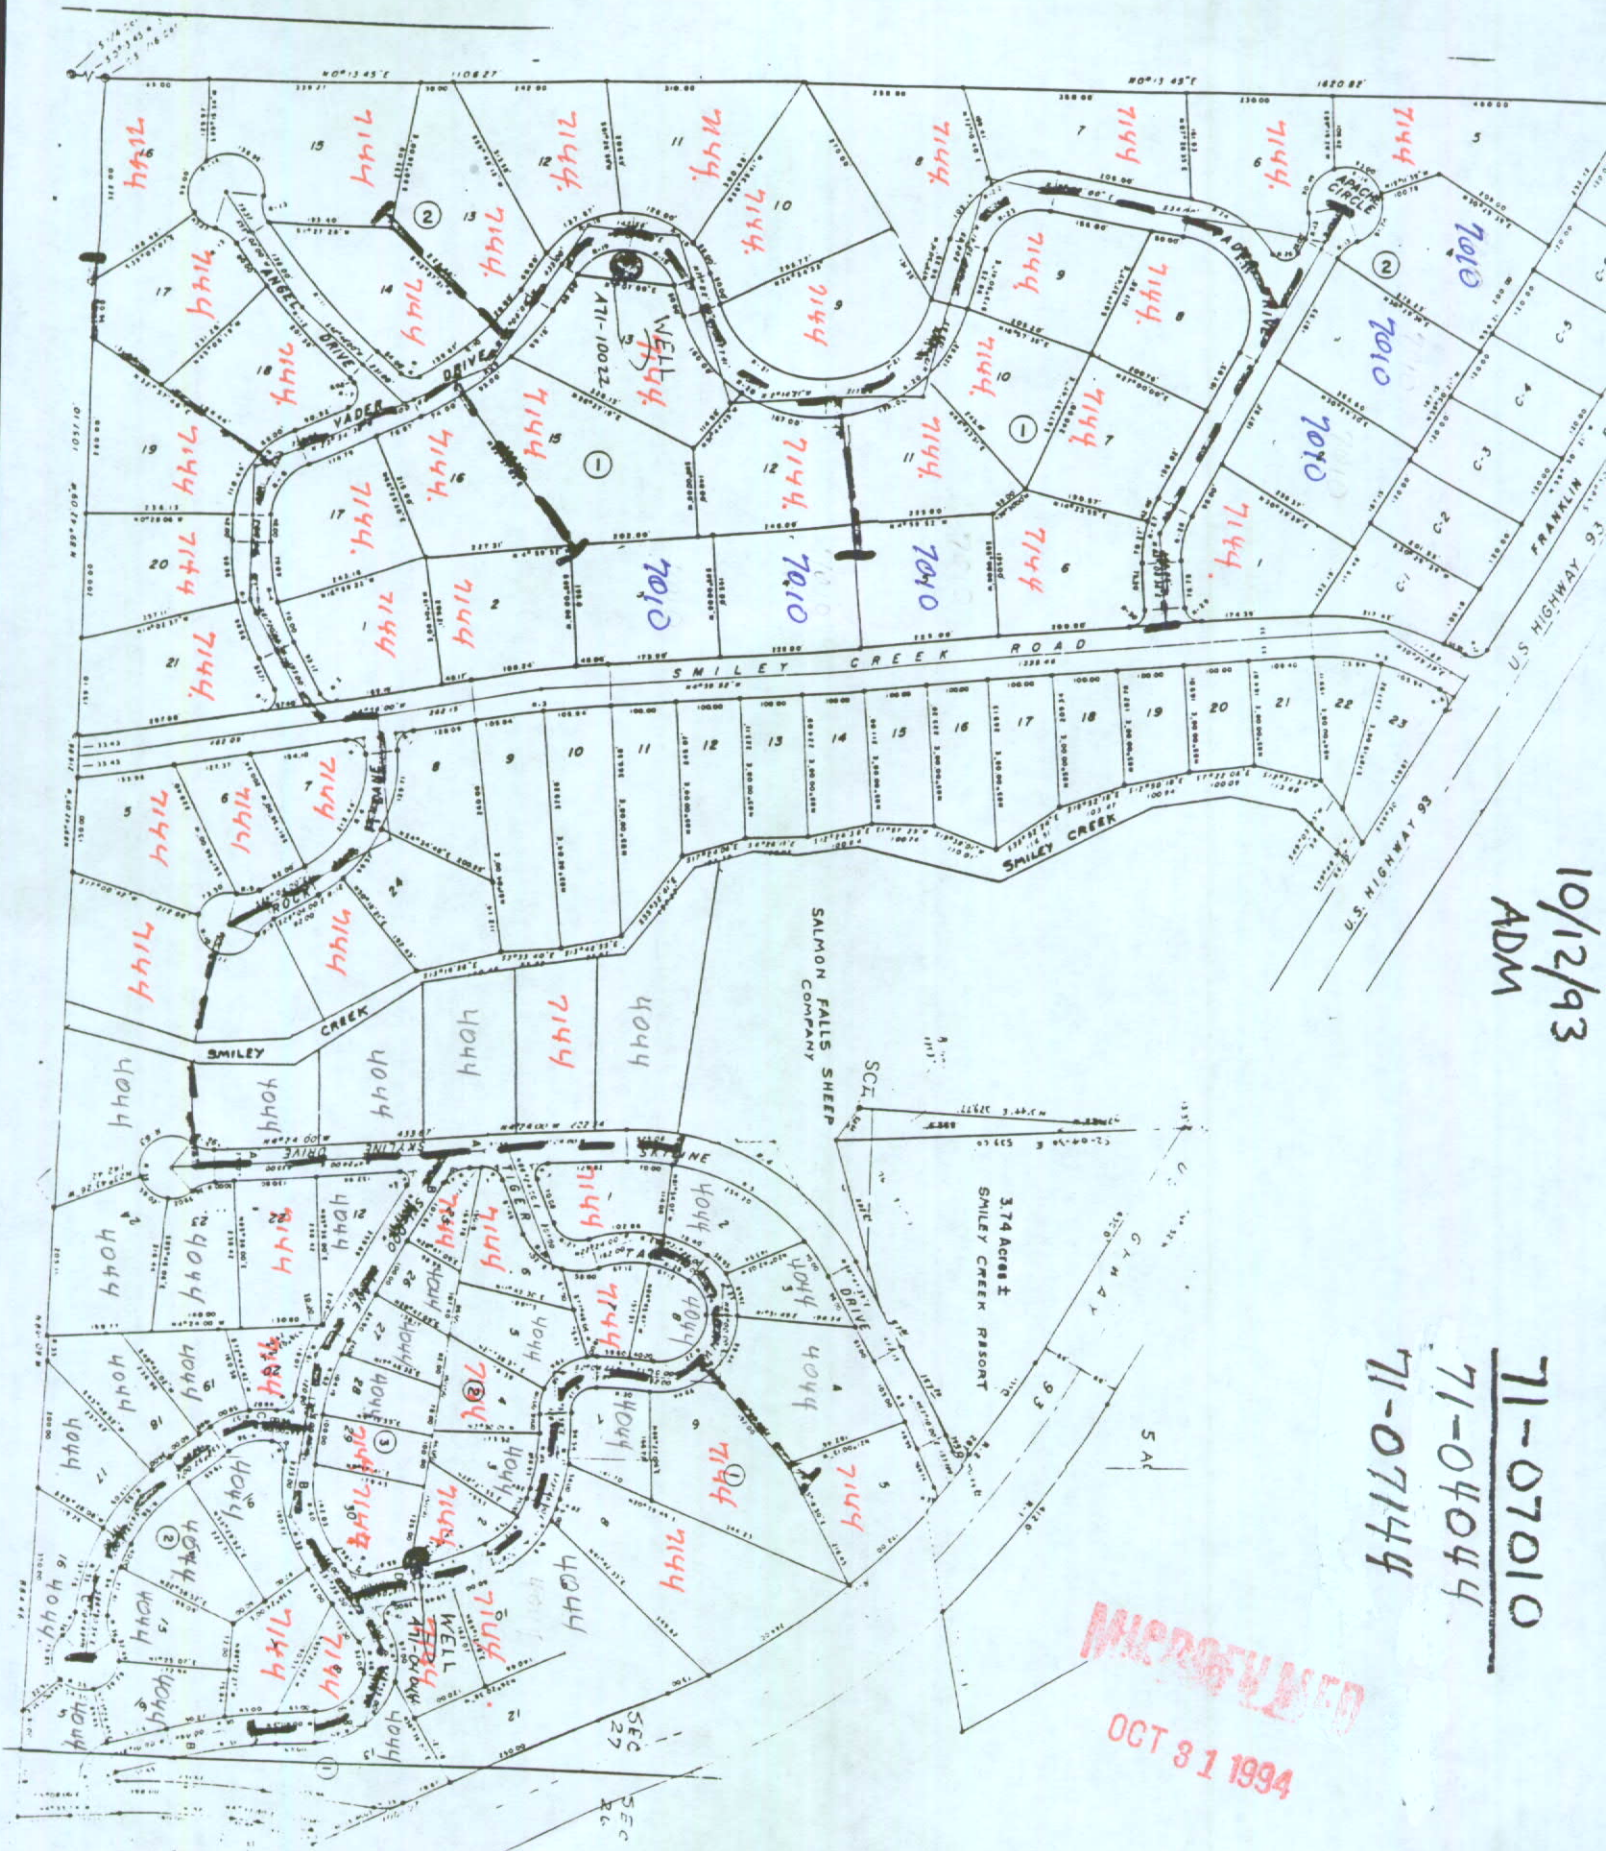

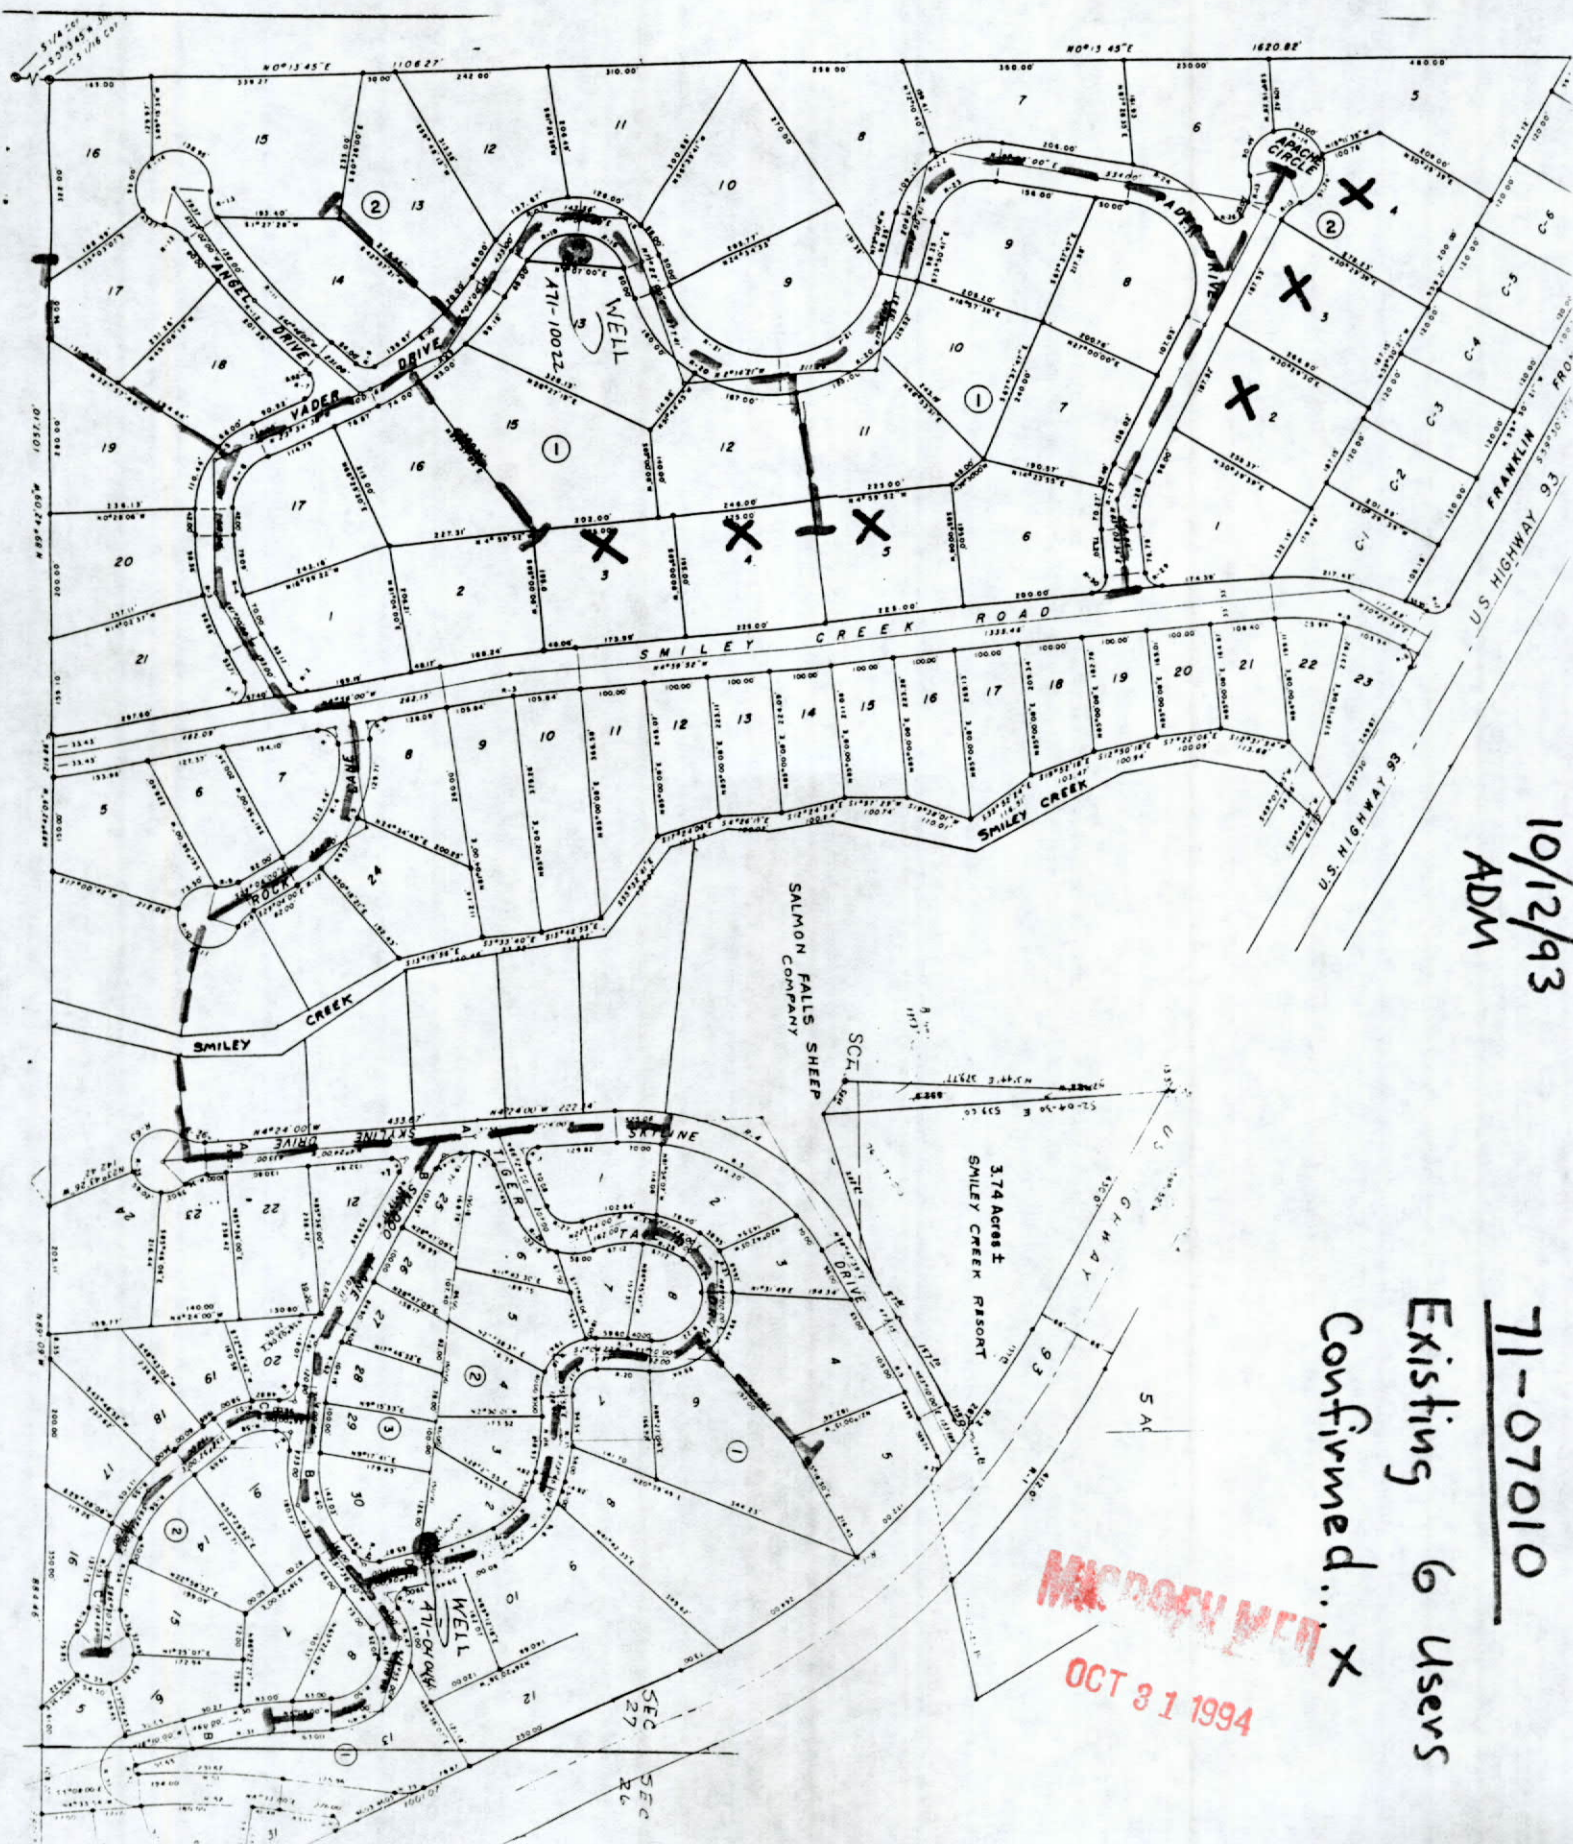


10/12/93
ADM

71-07010
Existing 6 Users
Confirmed.. X

MACROEX MEX
OCT 31 1994

SEC 27
SEC 26

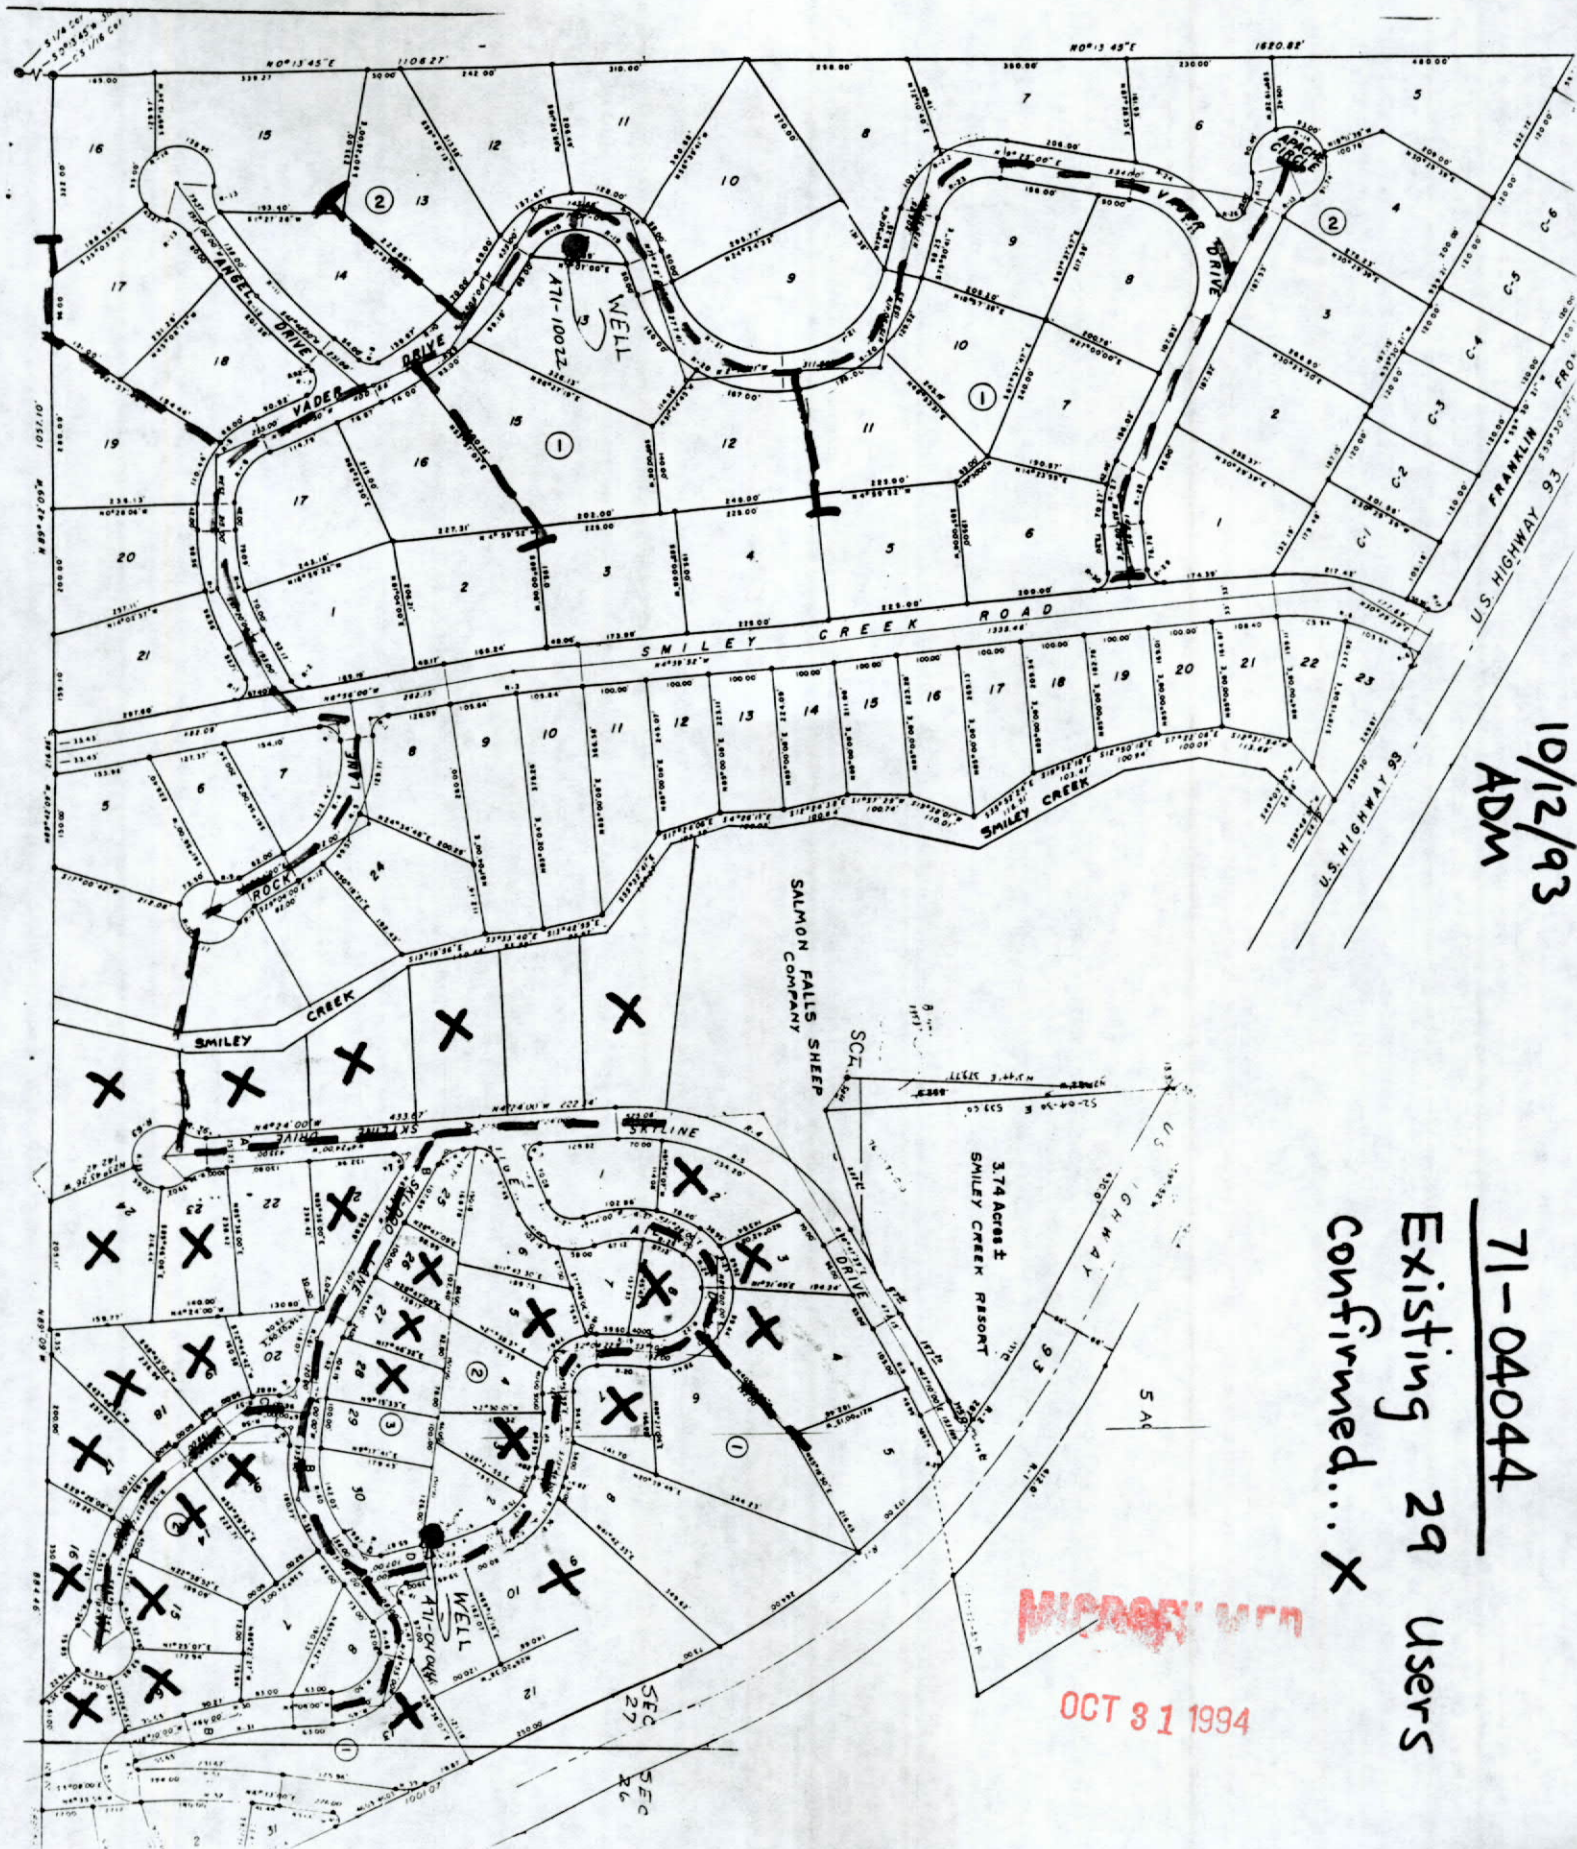

10/12/93
ADM

71-04044
Existing 29 Users
Confirmed... X

OCT 31 1994

1/3

Adm
9/29/93

71-04044
71-07010
71-07144 FE.



Well #1 Vzult

5 H.P. Jacuzzi Pump

10 tanks

186 gallon each

Originally had 5 H.P. Franklin Elec.
but replaced in 1983 with 5 H.P.

Jacuzzi Pressure setting @ 60psi high
40psi low

MIDWESTERN

OCT 31 1994

2/3


71-04044
71-07010
71-07144 FE.

Adm

9/29/93



well #2
well house

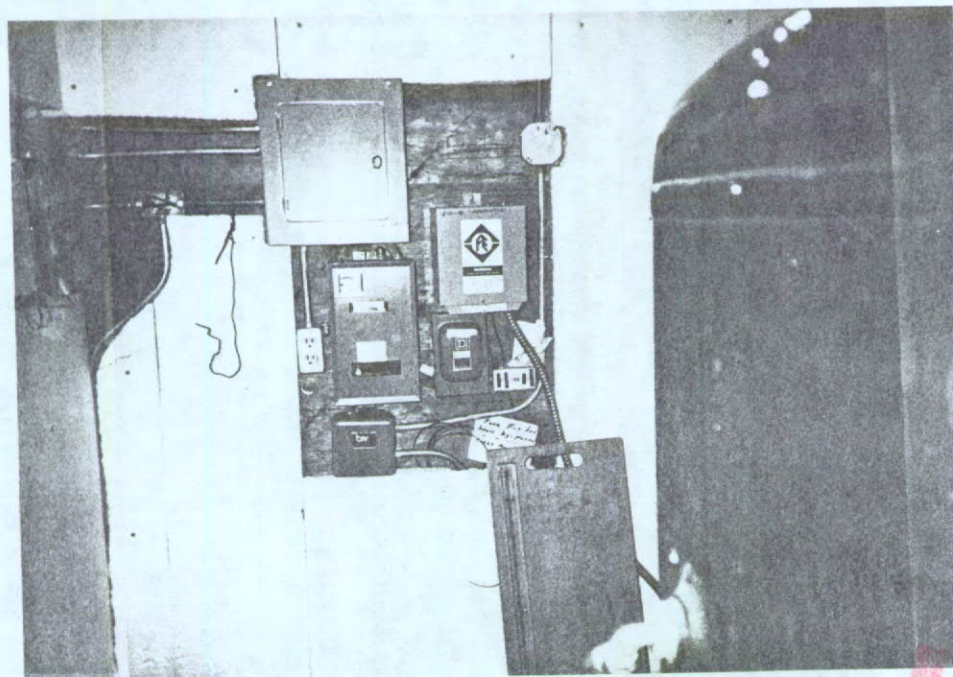

Control panel

RECEIVED

OCT 31 1994

3/3

Adm

9/29/93

71-04044

71-07010

71-07144 F.E.



Well #2

from well to
tank.
meter (broken)



Well #2

Outlet to
two buried
lines.

* No polysonic
meas. possible.

OCT 31 1994

AFFIDAVIT of PUBLICATION

RECEIVED

JUL 01 1992

State of Idaho, }
County of Blaine } SS.

Department of Water Resources
Southern Region Office

On this 24th day of June, in the year 1992, before me a Notary Public of said State, personally appeared **DANIEL J. GORHAM**, known or identified to me to be the person whose name is subscribed to be the within instrument, and being by me first duly sworn, declared that the statements therein are true, and acknowledged to me that he executed the same. As the publisher of the Wood River Journal, he/she attests that said newspaper has been continuously and and uninterruptedly published for a period of seventy-eight consecutive weeks prior to the first publication of the annexed notice, and is a newspaper qualified to publish legal notices as provided by act of the 1919 session of the legislature of the State of Idaho, known as House Bill 145; that the annexed advertisement was published once each week for 2 consecutive issues in said newspaper proper and not in a supplement; that the date of the first publication of said advertisement was on the 17 day of June, 1992, and the date of the last publication was on the 24 day of June, 1992.

Daniel J. Gorham

Subscribed and sworn to before me this 24th day of June, 1992.
(SEAL)

Roberta McKee

NOTARY PUBLIC

WOOD RIVER JOURNAL
Hailey, Idaho

COST OF PUBLICATION

Number of Picas per Line _____
Number of Lines in Notice 45
Number of Insertions _____
Lines tabular at _____ 6¢ / Pica
45 Lines straight at 22.50 5¢ / Pica
45 Subsequent lines at 20.25 4¢ / Pica
TOTAL COST 47.75 5.00

COPY OF NOTICE (Paste Here)

Assn. files on
trust water right

TITLE OF NOTICE

PLAINTIFF ATTORNEY

DEFENDANT

PLAINTIFF

Dept of Water Resources
BILL TO
Twin Falls

Assn. files on trust water right

NOTICE OF APPLICATION FOR TRUST WATER RIGHT

71-07144

SMILEY CREEK
WATER USERS ASSN
HC 64 BOX 9108
KETCHUM, ID 83340

Source: GROUNDWATER
Diversión Pt: NENESE Sec 27 T
07N R 14E in BLAINE County;
SENESE Sec 27 T 07N R 14E in
BLAINE County.

Use: DOMESTIC (.400 CFS)
IRRIGATION (.380 CFS)
Total Diversión: (.780 CFS)

Date Filed: 4/28/1992

In: BLAINE County
T07N R14E S27 SWNE NESE
NWSE

19.0 ACRES TOTAL

The permit(s) will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code, and/or the new public interest

criteria of Sec. 42-203C, Idaho Code. Protests must be filed with the Director, Dept. of Water Resources, 222 Shoshone Street East, Twin Falls, ID 83301, on or before JULY 6, 1992.

R. Keith Higginson, Director

Publish: Wood River Journal-
June 17 & 24, 1992.

Publication Rates As of Jan., 1990

(Idaho Code,
Reb. Statutes 1984)
7-8 pt./line straight: 5/pica
7-8 pt./line tabular: 6/pica
7-8 pt./line successive
insertion: 4/pica

MAILED
SEP 21 1992

8250

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 71-07144

Priority: April 28, 1992

Maximum Diversion Rate: 0.27 CFS
Maximum Diversion Volume: 64.8 AF

This is to certify, that SMILEY CREEK WATER USERS ASSN
HC 64 BOX 9108

KETCHUM ID 83340 has complied with the terms and conditions
of the permit, issued pursuant to Application for Permit dated April 28, 1992; and
has submitted Proof of Beneficial Use on October 5, 1993. An examination indicates
that the works have a diversion capacity of .270 cfs of water from a **GROUNDWATER**
source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
IRRIGATION	05/01 to 09/30	0.27 CFS	54.0 AF
DOMESTIC	01/01 to 12/31	0.27 CFS	10.8 AF
	Totals	0.27 CFS	64.8 AF

LOCATION OF POINT(S) OF DIVERSION:

NESE , Sec. 27, Township 07N, Range 14E
NWSE , Sec. 27, Township 07N, Range 14E
BLAINE County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
07N	14E	27	SWNE 3.3	NESE 6.7	NWSE 8	18

Total number of acres irrigated: 18

PLACE OF USE:

DOMESTIC, same as IRRIGATION use

CONDITIONS/REMARKS:

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount that can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. This right when combined with all other rights shall provide no more than .02 cfs per acre nor more than 3.0 afa per acre for the lands above.

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 71-07144

CONDITIONS/REMARKS:

6. Use of this right with Rights 71-04044 and 71-07010 is limited to a total combined diversion rate of 0.27 cfs, a total combined annual diversion volume for irrigation of 81.9 af, and to the irrigation of a combined total of 29.7 acres in a single irrigation season. In addition, the combined domestic limit is for 89 homes with a total combined annual diversion volume for domestic purposes of 17.8 af.
7. Rights 71-04044 and 71-07010 are also diverted through the points of diversion described above.
8. Domestic use is for 54 homes.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. Witness the seal and signature of the Director, affixed at Boise, this 25TH day of OCTOBER, 1994.

Acting for R. Keith Higginson, Director

RECEIVED

OCT 05 1993

OFFICE USE ONLY
Amt. of Fee \$ 100.00
Date 10-5-93
Receipt No. 5016271
Receipt by MTS

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Regional Office

RECEIVED

OCT 12 1993

Department of Water Resources

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 71-07144 Telephone No. 774-3387
2. Name(s) of Permit Holder(s): Smiley Creek Water Users Assn
3. Mailing Address: HC 64 Box 9108, Ketchum, ID 83340
4. Source of Water: Groundwater

If GROUNDWATER, Well Driller's Name: Ray Rossler Date Drilled: 1963
2 wells 1968

OPTIONAL: Pump horsepower: 2-5 H.P. Pressure (psi): 40-60 Dynamic pumping level (ft.): 71'
78'

5. Extent of Use (as authorized by the permit):

Domestic 65 (No. of households) Stockwater _____ (No. and type of stock)

Irrigation 19 (No. of acres) Other _____

6. Total rate and/or volume for which proof is submitted 0.78 cfs OR _____ acre/feet

7. Refer to the approval conditions on your permit and respond accordingly:

Measuring device: Required? ☒ Yes ☒ No Installed? _____ Yes ☒ No Request it be waived.

OR

Flow Measurement Port: Required? ☒ Yes _____ No Installed? _____ Yes _____ No

8. Fee Enclosed: \$ 100⁰⁰ (See License Fee Schedule on back of Instruction Sheet)

9. Person to contact to accompany the Department representative during field examination of the water system.

Bert Sanders or Roger Doer

Name _____ Telephone No. _____

HC 64 Box 9108 Ketchum ID 83340

Address _____

10. The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

MICROFILMED

OCT 25 1993

Sept 4 1993 Burton C Sanders Secy-Treas-Manager

Date _____ Signature (and title, if on behalf of a company or organization) _____

State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 71-07144

Proposed Priority: April 28, 1992 Maximum Diversion Rate: 0.78 CFS
This is to certify, that SMILEY CREEK WATER USERS ASSN

HC 64 BOX 9108
KETCHUM ID 83340

has applied for a permit to appropriate water from: GROUNDWATER
and a permit is APPROVED for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
IRRIGATION	05/01 to 09/30	0.38 CFS
DOMESTIC	01/01 to 12/31	0.40 CFS
	Totals	0.78 CFS

LOCATION OF POINT(S) OF DIVERSION: SENESE, Sec. 27, Township 07N, Range 14E
NWNSE, Sec. 27, Township 07N, Range 14E
BLAINE County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
07N	14E	27	SWNE 6	NESE 6	NWSE 7	19

Total number of acres irrigated: 19

PLACE OF USE: DOMESTIC, same as IRRIGATION use

CONDITIONS/REMARKS:

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before October 2, 1995.
2. Subject to all prior water rights.
3. Project construction shall commence within one year from the date of permit issuance and shall proceed diligently to completion unless it can be shown to the satisfaction of the Director of the Department of Water Resources that delays were due to circumstances over which permit holder had no control.
4. A flow measurement port or other device as specified by the Department shall be installed by the right holder to provide for the installation of measuring equipment and the determination of the rate of diversion by the Department.
5. The issuance of this right in no way grants any right-of-way or easement across the land of another.
6. The rate of diversion of water for irrigation under this right and all other water rights on the same land shall not exceed 0.02 cubic feet per second for each acre of land.

MICROFILMED

SEP 21 1992

State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 71-07144

CONDITIONS/REMARKS:

7. The domestic use authorized under this permit shall not exceed 13,000 gallons per day per dwelling.
8. This permit authorizes irrigation of up to 1/2 acre within each platted subdivision lot upon which a domestic dwelling has been constructed.
9. Domestic use is for 65 homes.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the signature of the Director, affixed at Boise, this

14th day of September, 1992.

for R. Keith Higginson, Director

MICROFILMED

SEP 21 1992

18 JUL 1992

Ident. No. 71-07144

APR 28 1992

Department of Water Resources
Southern Region Office

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

1. Name: SMILEY CREEK WATER USERS ASSN 208-774-3387
Address: HC 64 BOX 9108
KETCHUM ID 83340

2. Source: GROUNDWATER

3. Location of Point of Diversion: *NWNWSE (PER LETTER) BLM*
Trib. to:
~~SENESE~~ Sec. 27, Township 07N, Range 14E
SENESE Sec. 27, Township 07N, Range 14E
BLAINE County

4. Water will be used for the following purposes:

Purpose	From	To	OK CFS	(or)	AF
IRRIGATION	05/01	09/30	0.380		
DOMESTIC	01/01	12/31	0.400		

5. Total quantity to be appropriated is:

0.780 CFS (and/or) AF

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc.

TWO EXISTING WELL TO PIPELINE NETWORK

b. Height of storage dam feet; active reservoir capacity
acre-feet; total reservoir capacity acre-feet; period of
year when water will be diverted to storage: to inclusive.

c. Proposed well diameter is inches; proposed depth of well is
feet.

d. Is groundwater with a temperature greater than 90F being sought? NO

7. Time required for the completion of the works and application of
the water to the proposed beneficial use is 5 years.

8. Description of proposed uses:

DOMESTIC/ 65 HOMES

9. Place of Use: IRRIGATION

TWN	RGE	SEC	ACRES	ACRES	ACRES	TOTAL
07N	14E	27	SWNE 6	NESE 6	NESE 7	19

Total number of acres irrigated. 19

NOT RECORDED

SEP 21 1992

Place of Use: DOMESTIC

TWN RGE SEC
07N 14E 27

SWNE

NESE

NWSE

10. Describe any other water rights used for the same purposes.
36-07010 AND 36-04044 FOR EXISTING DEVELOPMENT OF SYSTEM.

- 71 71
11. a. Who owns the property at the point of diversion?
SMILEY CREEK WATER USERS ASSN
- b. Who owns the land to be irrigated or place of use?
INDIVIDUAL LOT OWNERS
- c. If the property is owned by a person other than the applicant,
describe the arrangement enabling the applicant to make this filing.
ASSOCIATION SUPPLIES WATER TO LOT OWNERS.

12. Remarks:

THIS APPLICATION IS FOR THE EXPANDED USE OF THE EXISTING SYSTEM.

13. Map of proposed point of diversion and place of use attached? []

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Roger T. Deen
Applicant

Over Pres.
Smiley Creek Water Users Assoc.

Received by MB Date 7-28-92 Time 10:02 Preliminary check by MTS

Fee \$ 45.00 Receipted by MB # 5014459 Date 7-28-92

Publication prepared by MB Date 6/11/92 Published in Wood River Journal

Publication approved MBaldwin Date 7-8-92


MICROFILMED

SEP 21 1992

71-7144


X - 1963
X - 1970
ext. 1991

10 feet

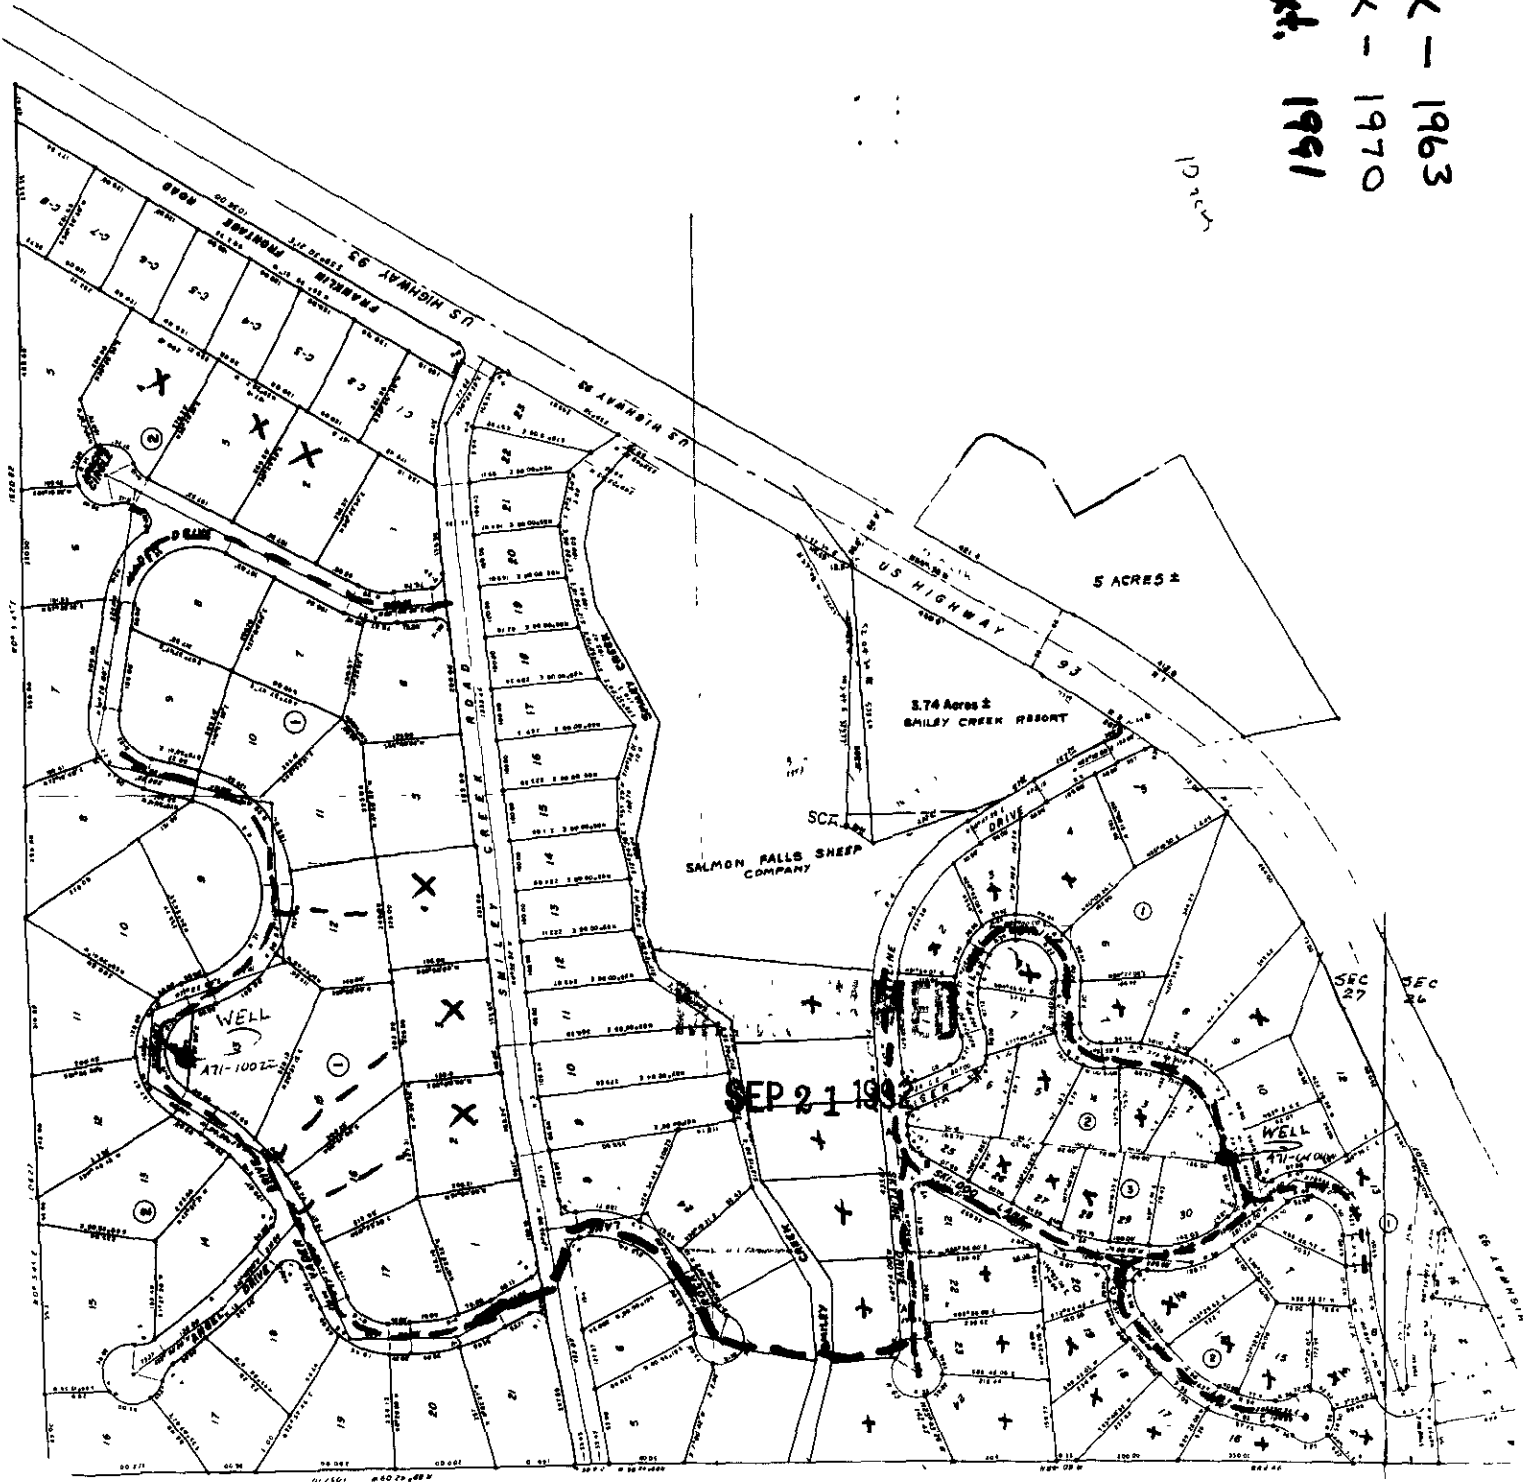



SCALE 1:24,000



1 MILE SEP 21 1992



State of Idaho
DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000
Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

October 25, 1994

SMILEY CREEK WATER USERS ASSN
HC 64 BOX 9108
KETCHUM ID 83340

RE: WATER RIGHT NO. 71-07144

Dear Water Right Holder(s):

Enclosed is a copy of the Water Right License issued on the above referenced permit. If you have any questions, please contact me within 10 days of receipt of this license.

Sincerely,

A handwritten signature in cursive script that reads "Shelley W. Keen".

Shelley W. Keen
Water Rights Supervisor

SK:dc

Enclosure

RECEIVED
OCT 31 1994

LICENSE REVIEW CHECKLIST

PERMIT NO. 71-07144 DATE 10-11-94



NAME Yes No ✓ Or Address Change?

PRIORITY DATE ✓ Advance? Advanced to:
 Order to reinstate needed?
 Incorrect fee for rate recommended? NO

SOURCE ✓ Changes or just clarification of originally intended source?
 Notice of Intent to Void necessary?

POINT OF DIV ✓ ✓ Amendment needed?
 Overlaps? 71-04044 and 71-07010 (R-RECORDS COMBINE BOTH PD'S)
 (well # 1) (well # 2)

PLACE OF USE ✓ Amendment needed?
 ✓ Overlaps?

DIV RATE ✓ Permit/fee limits: .78 cfs
 TOTAL CAPACITY = .27 cfs Meas Q = .27 Theo Q = Recommend: .27 cfs
R 71-04044 @ .27 WELL # 1 Q = 61 gpm } 122 gpm = .27 cfs
R 71-07010 .17 WELL # 2 Q = 61 gpm }
 ALL CAPACITY USED 0 Combined rates exceed capacity YES - CONDITION
 ANNUAL VOLUME Season of use: A/3.0 (5-1 to 9-30)
 CAPABLE OF: Calculations: 18 acres x 3.0 AF = 54 afa
(.27 x 365 x 1.9835 = 195.47 afa) 54 homes x 2 AF = 10.8 afa
 Flow limit: .27 cfs x 153 x 1.9835 = 81.9
 Combined volumes exceed capacity/allowable YES - CONDITION

USES ✓ Change in Nature of Use or additional uses?
 Amendment necessary?

REMARKS W28 W36 ✓ Multiple p/d(s) in 1/4?
Other DOMESTIC use FOR 54 homes

CONDITIONS ✓ Measuring/Locking Devices
(R29) ✓ Watermaster control - District
 ✓ Irrigation Overlap
 ✓ Water Quality
 ✓ Other Heat/Cool/ Fish verified

COMMENTS: Limited to 29.7 acres / 89 afa for irrigation / Div rate .27 cfs
89 homes / 17.8 afa
REDUCE RATE TO CAPACITY / COMBINED VOLUME limited by rate.

RECOMMENDED	CFS	VOL	SRBA Claim Filed	NO-NA
<u>Irrigation</u>	<u>.27</u>	<u>54</u>	Adjustment Memo Needed	<u>NO</u>
<u>Domestic</u>	<u>.27</u>	<u>10.8</u>		
<u>Totals</u>	<u>.27</u>	<u>64.8</u>	LICENSE	<u>✓</u>
			1ST AMENDMENT LETTER	<u> </u>
			FINAL AMENDMENT LETTER	<u> </u>

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
SEP 21 1994

Department of Water Resources

A. GENERAL INFORMATION

Permit No. 71-07144

1. Owner: Smiley Creek Water Users Assn. Phone No. _____

Current Address: HC 64 Box 9108, Ketchum, ID, 83340

2. Accompanied by: Bert Sanders & Roger Doerr EXAM DATE: 9/29/93

Address: _____ Phone No. _____

Relationship to Permit Holder: Officials of the Assn.

3. Source: Groundwater tributary to _____

B. OVERLAP REVIEW

1. Other water rights with the same place of use: None

2. Other water rights with the same point of diversion: 71-04044 & 71-07010

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident No.	Gov't Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
Well # 1		SE	NE	SE	27	7N.	14E.	Blaine	Ortho W-20, Plat Map
Well # 2		NW	NW	SE	27	7N.	14E.	Blaine	Ortho W-20, Plat Map

2. Place(s) of Use:


Indicate Method of Determination Ortho W-20 Plat Map.

TWP	RGE	SEC	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
7N	14E.	27			33										6.7	8.0			18
* 7N	14E	27			D										D	D			

* Total of 54 houses being recommended under this right.

OCT 31 1994

3. Delivery System Diagram: Indicate all major components and distances between components. Indicate well size/ditch size/pipe l.d. as applicable.

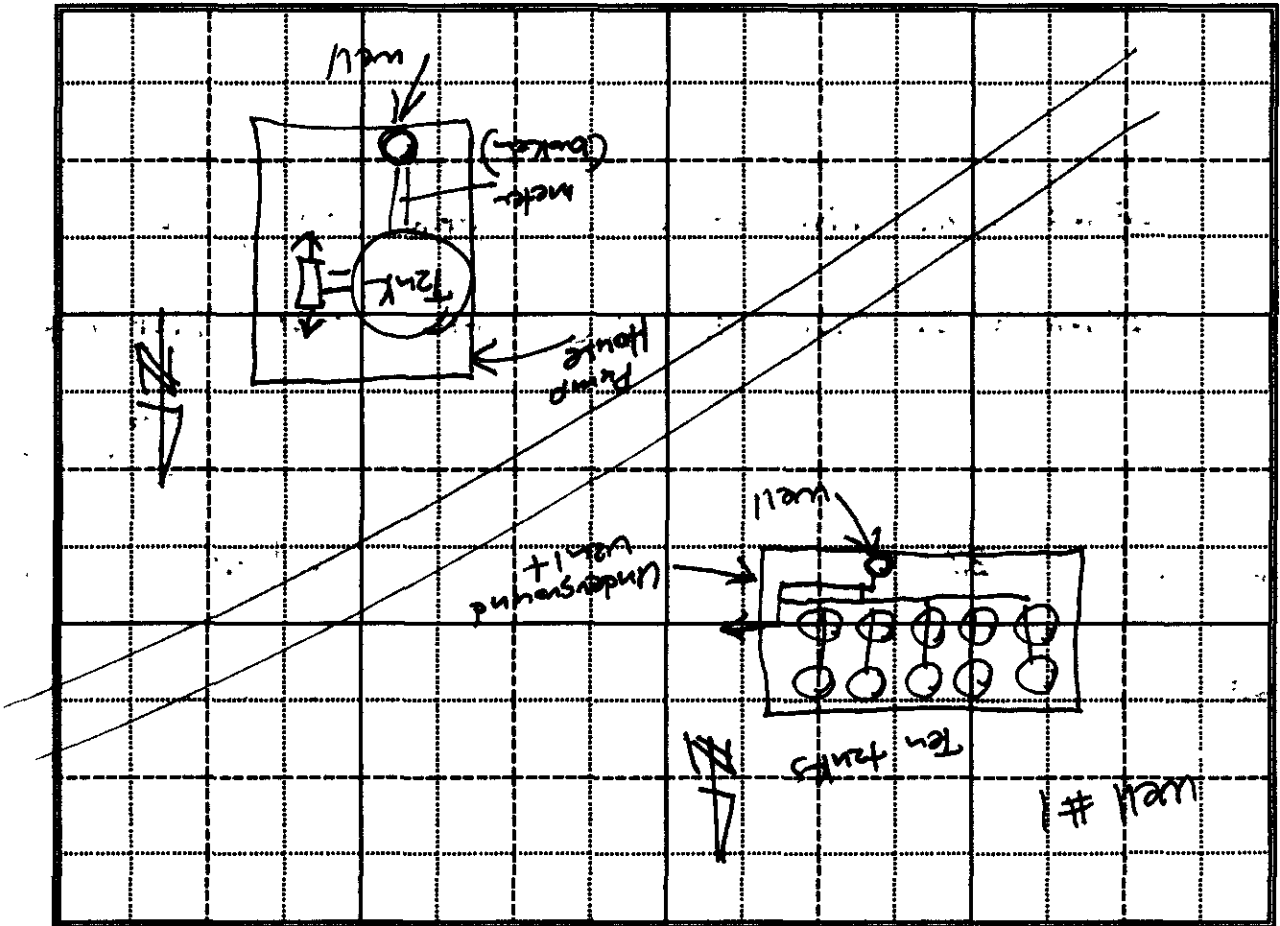

Scale: 1" = _____
 Copy of USGS Quadrangle Attached Showing location(s) of _____
 point(s) of diversion and place(s) of use (required).
 Aerial Photo Attached _____
 (required for irrigation of 10+ acres)
 Photo of Diversion and System Attached _____

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
Well #1		5	Jacuzzi		rated 62 gpm
Well #2		5	Jacuzzi		rated 62 gpm

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
Polysonic well #1						
Calc. well #2						

2. Measurements: Well #1 measured @ 61 gpm. Well #2 not

measured. See attached sheet for calculation.

$$\text{Total } Q = Q_1 + Q_2 = 61 + 61 = 122 \text{ gpm} = 0.27 \text{ cfs}$$

E. NARRATIVE/REMARKS/COMMENTS

This permit is for the additional lots served by the two interconnected wells beyond what they have historically served. Well #1 was drilled in 1963 and was developed to serve 29 cabins and irrigation of the respective lots (each lot waters no more than $\frac{1}{3}$ acre of mainly natural vegetation with occasional lawn.) This early development is being recommended in the SRBA as 71-04044. Well #2 was developed pursuant to license 71-07010 for 6 cabins & lots. It is being recommended for the same. This permit is for the remaining 54 lots served by the interconnected system. The attached 3 maps shows the location of the lots served by the system. Of the 54 lots being recommended 18 have existing houses and 36 lots have hookups. When all three rights are combined there shall exist $(29 + 6 + 54) = 89$ lots & cabins served and each lot will be allowed $\frac{1}{3}$ acre of irrigation. The combined rate of diversion of all rights shall be limited to the capacity of the two wells (61 gpm each) or 0.27 cfs.

Have conditions of permit approval been met? ☐ yes ☒ no

W2ived meas. device requirement.

RECEIVED
OCT 31 1994

F. FLOW CALCULATIONS

____ Additional Computation Sheets Attached

Measured Method:

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = 18 \times 3 = 54 \text{ A.F.}$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days In Irrigation Season}) \times 1.9835 = 0.27 \times 153 \times 1.9835 = 81.9 \text{ A.F.}$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$$

2. Volume Calculations for Other Uses:

The houses in this area are recreation in nature for the main part but some are used year round but others 1 or 2 wks per year.

Est. 3 people/house ... 50 gpd/person ... use 365 days/yr.

$$\frac{3 \times 50 \times 365}{325,700} \approx 0.2 \text{ AF/unit.}$$

$$54 \times 0.2 = 10.8 \text{ A.F.}$$

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
Irrig.	5/1	9/30	0.27	54.0
Domestic	1/1	12/31	0.27	10.8
Totals:			0.27	64.8

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

I. AUTHENTICATION

Field Examiner's Name

[Signature]

Date

10/18/93

Reviewer

Date

SEAL


RECEIVED
 OCT 31 1994

ADM
10/18/93


1/2

On 9/29/93 a polysonic measurement was made of well #1. The measurement was made such that the flow from the well was isolated thru one pipe. Enough spigots were turned on throughout the subdivision such that the pump remained on all the time and the pressure in the system stabilized at approx 35 psi on the gauge. At this point it was felt that the extra reserve in the pressure tanks had discharged and the pump was now operating at its design max. discharge. We measured -608.388 E - 6 PM (61 gpm) and Mr Sanders indicated that the pump was rated @ 62 gpm. That same day well #2 was visited and the piping configuration was such that there was no section of straight pipe where the polysonic could be installed. Well #2 has a meter but it was broken. Since well #2 has the same exact type of pump as well #1 it is reasonable to assume its capacity to be the same since it supplies the same pipeline network. Review of topo map finds that wells very close to same elevation and review of water levels measured by Assoc. indicates drawdown between both wells within 10' of each other (This may be an indication of elevation) well #1 may be approx 10' in elevation below well #2 so the assumption is if they are pumping to from the same water level to the same energy level then the rate would be the same.

0071
1994

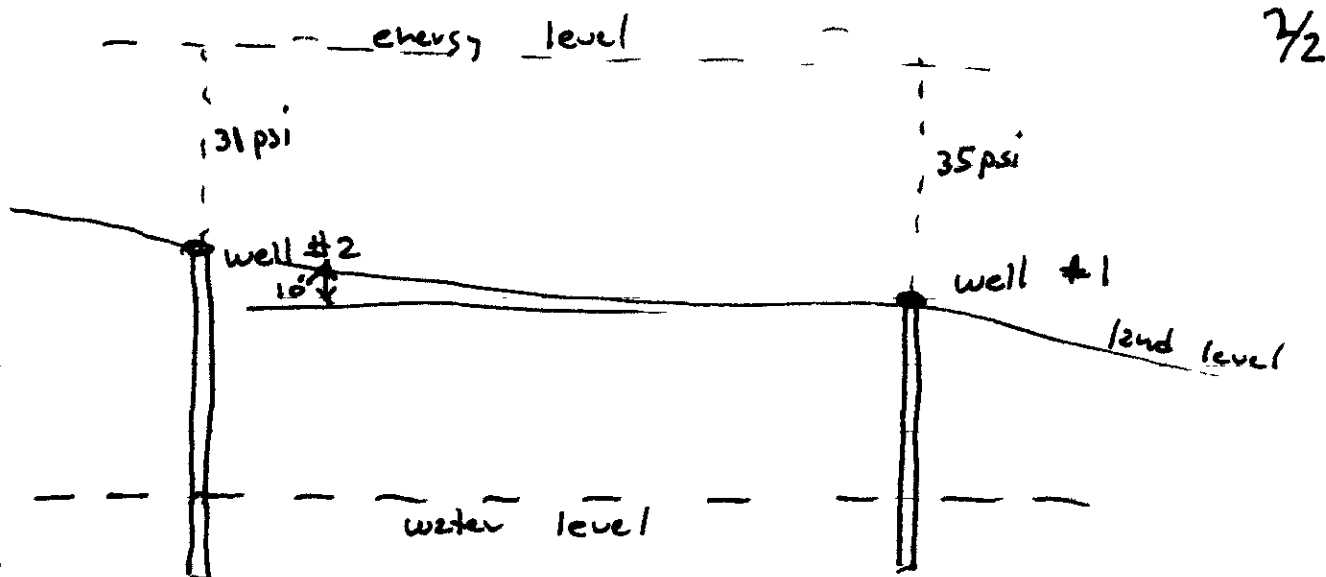

If the above condition is valid the 61 gpm for both is valid.

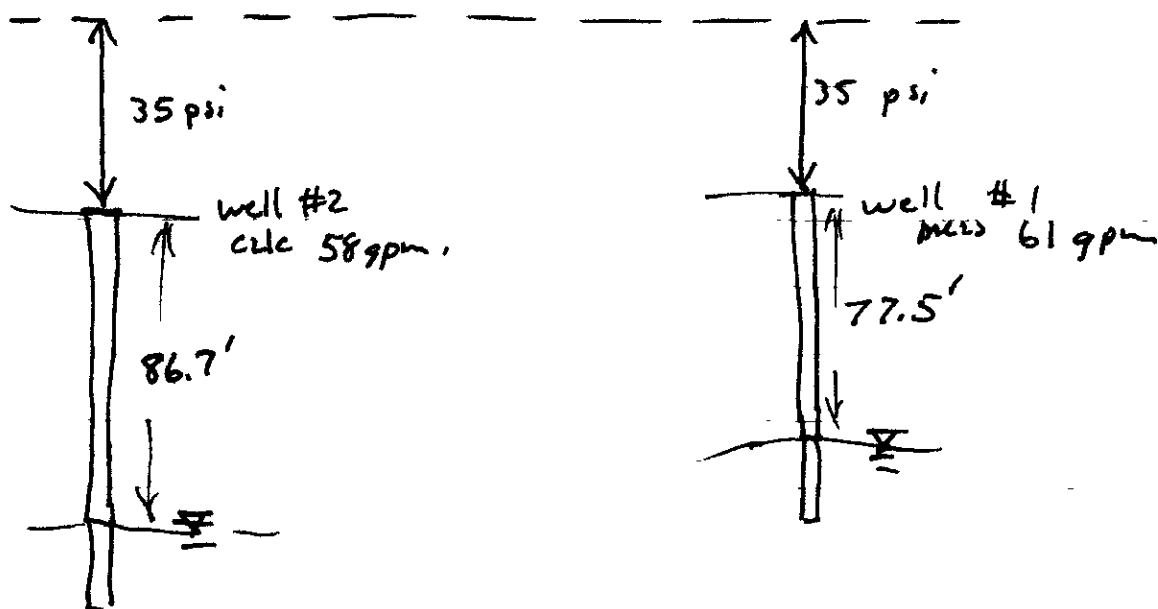


If the above worst case is assumed then well #2 would yield approx.

$$\frac{Q_2}{Q_1} = \frac{[(35 \times 2.31) + 77.5]}{[(35 \times 2.31) + 86.7]}$$

$$\therefore Q_2 = 58 \text{ gpm}$$

Since there is no real significant difference it is recommended that the total Q of well #1 + well #2 be recommended as 122 gpm or 0.27 cfs.

APPROVED
OCT 31 1994

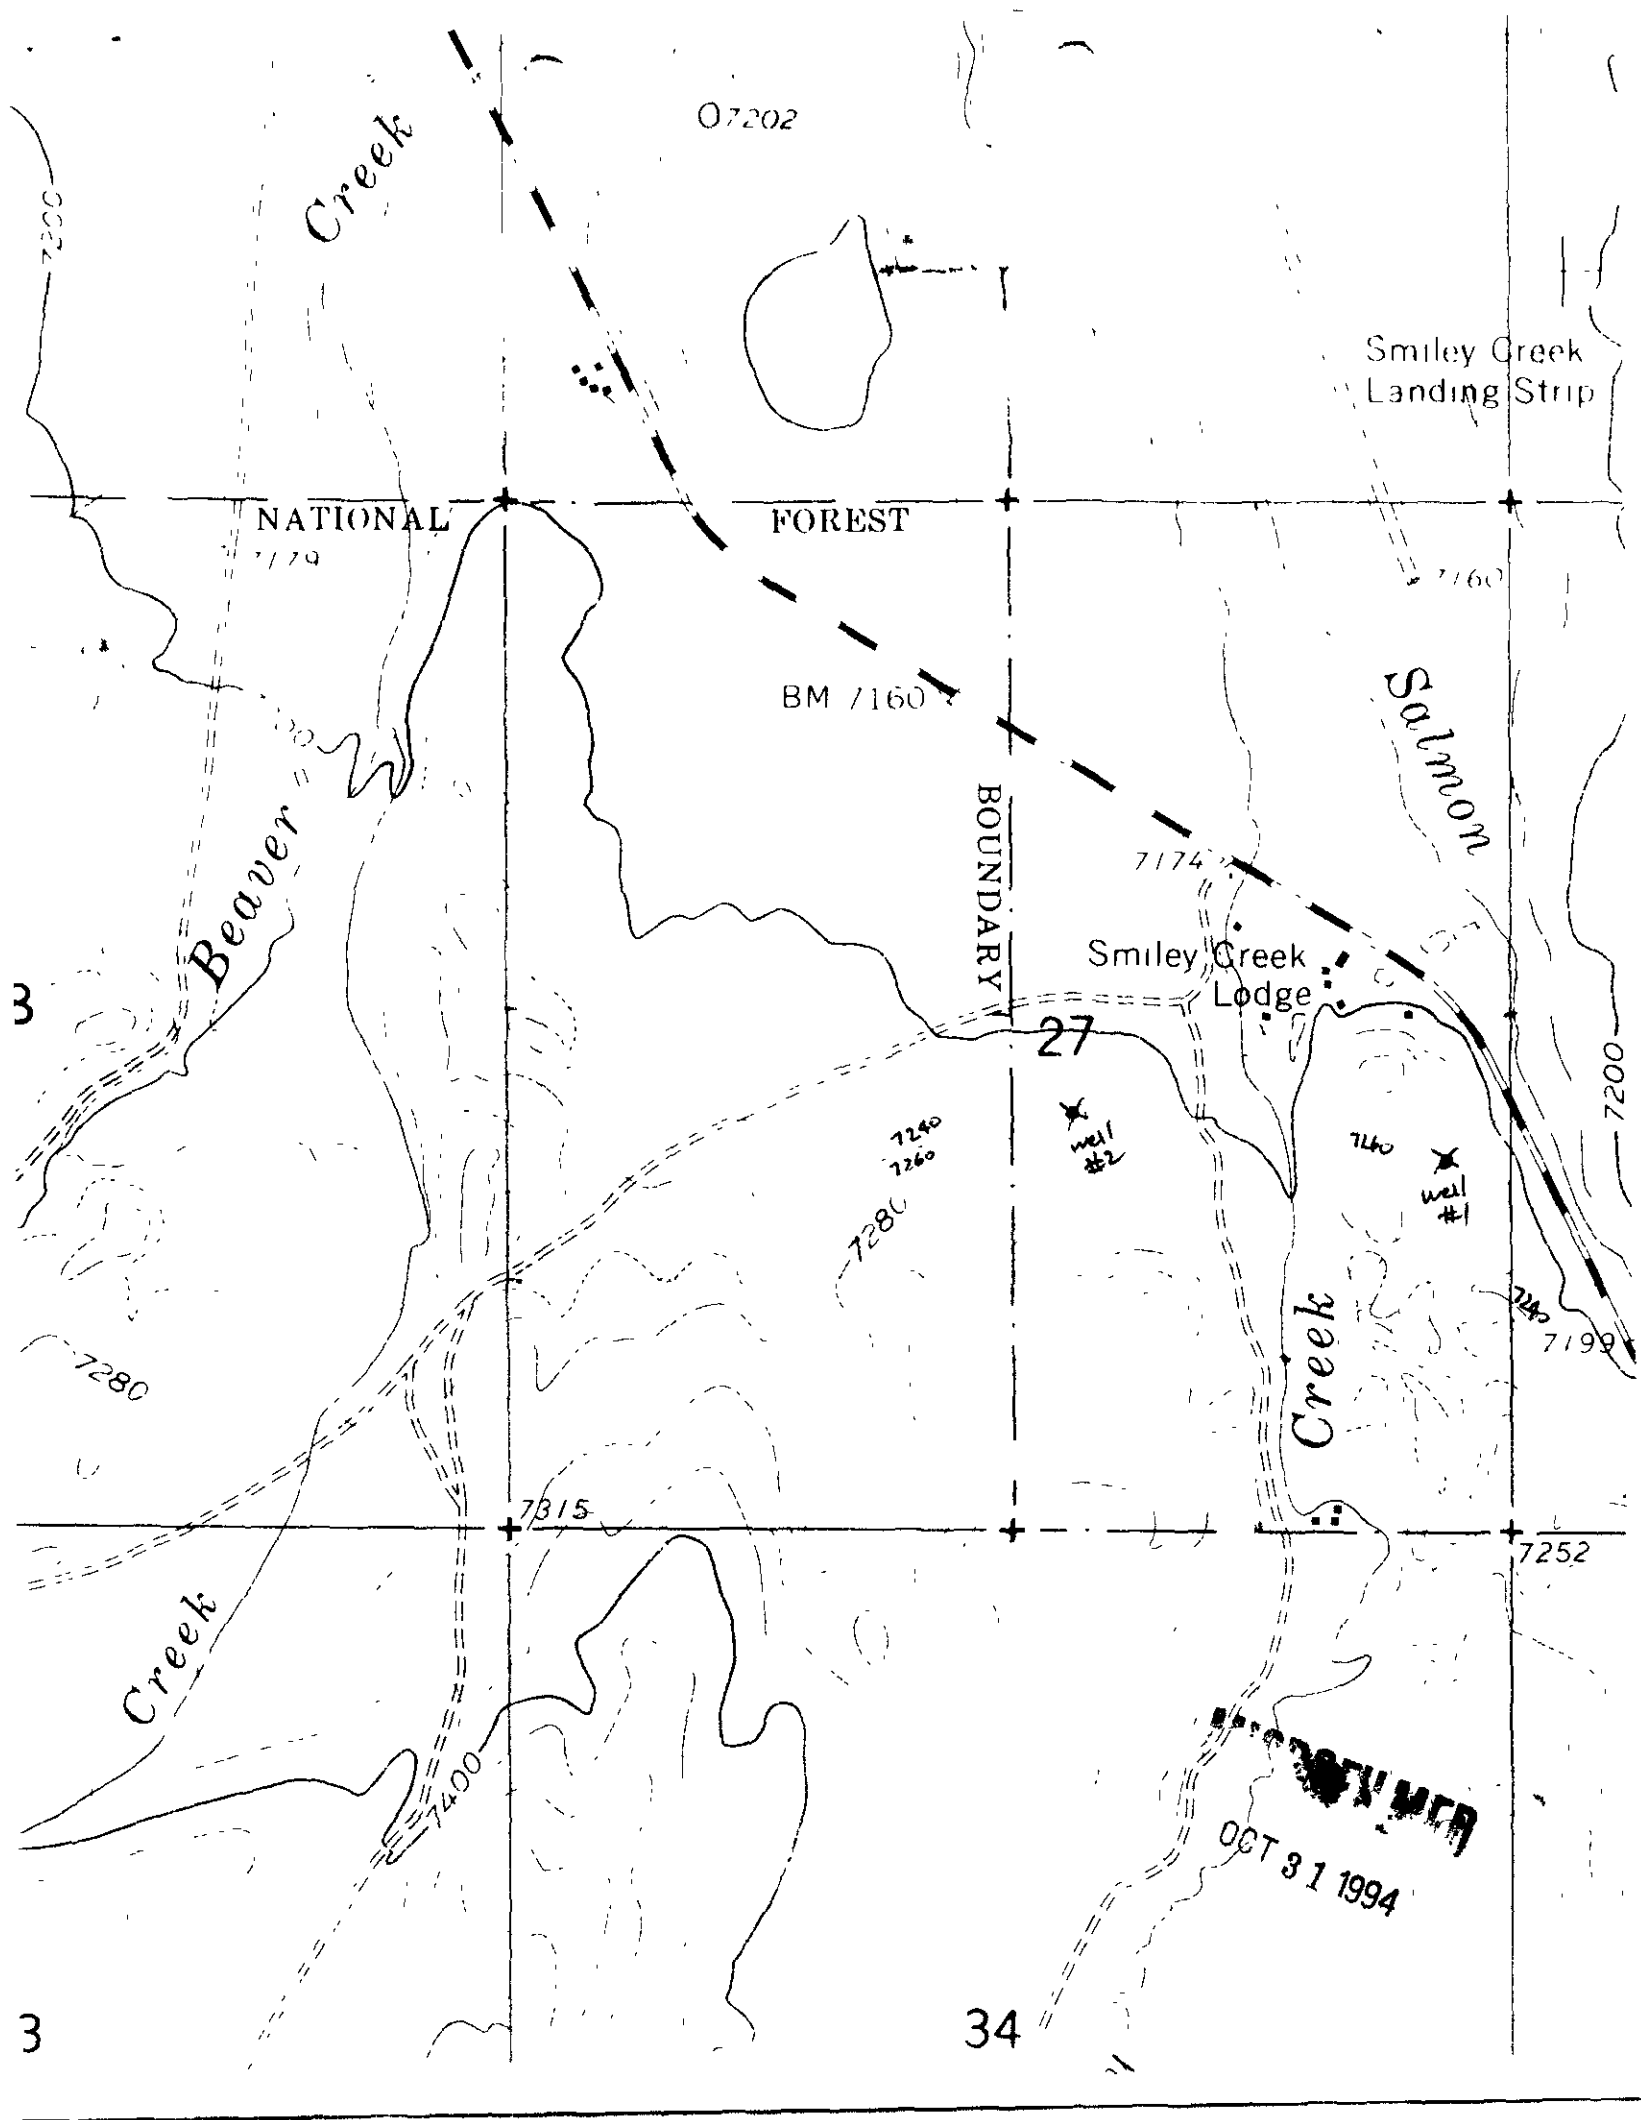

07202

Creek

Smiley Creek
Landing Strip

NATIONAL
7179

FOREST

BM 7160

BOUNDARY

7174

Smiley Creek
Lodge

Salmon

Beaver

27

7240
7260

7280

well #2

7140

well #1

7200

7199

Creek

7315

7252

Creek

7400

OCT 31 1994

34

3

3

Both 5 H.P.

95' + Pump
Total Depth 105'

Pump set @ ? 125'
Total Depth 165'

SMILEY CREEK WATER USERS ASSOC

WATER LEVEL IN WELLS

WELL #1			WELL #2		
Date	Static	Draw	Date	Static	Draw
9/26/90	73-0	76-0	9/26/90	83-0	86-0
6/22/91	70-6	73-6	6/22/91	80-0	83-0
5/23/92	76-0	78-6	6/1/92	84-6	87-6
6/30/92	79-0	81-6	6/30/92	85-0	88-0
8/10/92	81-0	84-0	8/10/92	87-0	89-0
1/10/93	81-0	84-0	1/24/93	88-0	91-0
3/21/93	81-6	84-0	3/21/93	90-0	93-0
5/17/93	73-0	75-0	5/17/93	84-6	87-6
5/21/93	70-0	73-0	5/21/93	82-0	85-0
5-29-93	68-0	72-0	5-29-93	81-0	82-6
5-29-93	68-0	71-0	5-29-93	79-0	82-0

	Static	Draw
9/26	Δ	Δ
6/22	10.0	10
5/23	9.5	9.5
6/30	8.5	7.0
8/10	6.0	6.5
1/10	6.0	5.0
3/21	7.0	7.0
5/17	8.5	9.0
5/21	11.5	12.5
5/29	12.0	12.0
5/29	12.0	11.5
5/29	11.0	11.0

Ave Draw
well #1 = 77.5'

Ave Draw = 86.7'
well #2

Ave Diff Draw = 9.2'
well #2 - well #1

Memo
OCT 31 1994

CLAIM

INIT

Adm

T. R. S. 9/9

P/D 7N 14E

AT-04044

PHOTO W-20

AT-07010

DT. & ID.

Permit 71-07144

21

Creek

Well Locations Confirmed, 9/24/93

$$\begin{array}{r}
 29 \\
 6 \\
 \hline
 35
 \end{array}
 \qquad
 \begin{array}{r}
 65 \\
 \hline
 70 \text{ new}
 \end{array}$$

Bic, Post Forms

MODE SELECT
INPUT

OUTER FILTER
2.4064 TH

PIPE MATERIAL
C-15

WALL THICKNESS
1.5400

INNER LINING
NO LINING.

KIND OF FILTER
C-15

SENSOR MATERIAL

DATE OF REPORT

DATE OF DATA

SPACING
1.057 TH

ZERO MODE
LEAP

ZERO MODE
AUT ZERO

ZERO MODE
ZERO CORR

09-29 08:4800 *P
-798.219E-16PM

09-29 08:5000 *P
-429.015E-16PM

09-29 08:5000 *P
-514.811E-16PM

09-29 08:5100 *P
-707.940E-16PM

09-29 08:5100 *P
-750.240E-16PM

09-29 08:5100 *P
-747.010E-16PM

09-29 08:5200 *P
-701.510E-16PM

09-29 08:5200 *P
-752.210E-16PM

09-29 08:5200 *P
-701.210E-16PM

09-29 08:5300 *P
-748.010E-16PM

09-29 08:5300 *P
-748.010E-16PM

09-29 08:5300 *P
-748.010E-16PM

09-29 08:5300 *P
-748.010E-16PM

09-29 08:5300 *P
-748.010E-16PM

09-29 08:5300 *P
-748.010E-16PM

09-29 08:5300 *P
-748.010E-16PM

well
#1

11/09/94
OCT 31 1994

11/09/94

71-07144

T₅ = 660'
1988

CLAIM

T. R. S.

P/D

PHOTO

DT. & ID.

4555

22 23

27 26

BY NE

0000

HOUSE

NE

2000

0000

well #1

WENTWELL


1984


71-07144

10/12/93
Adm

18 Existing houses ... X
36 Future houses ... ⊗
(hookup exists)

OCT 31 1994

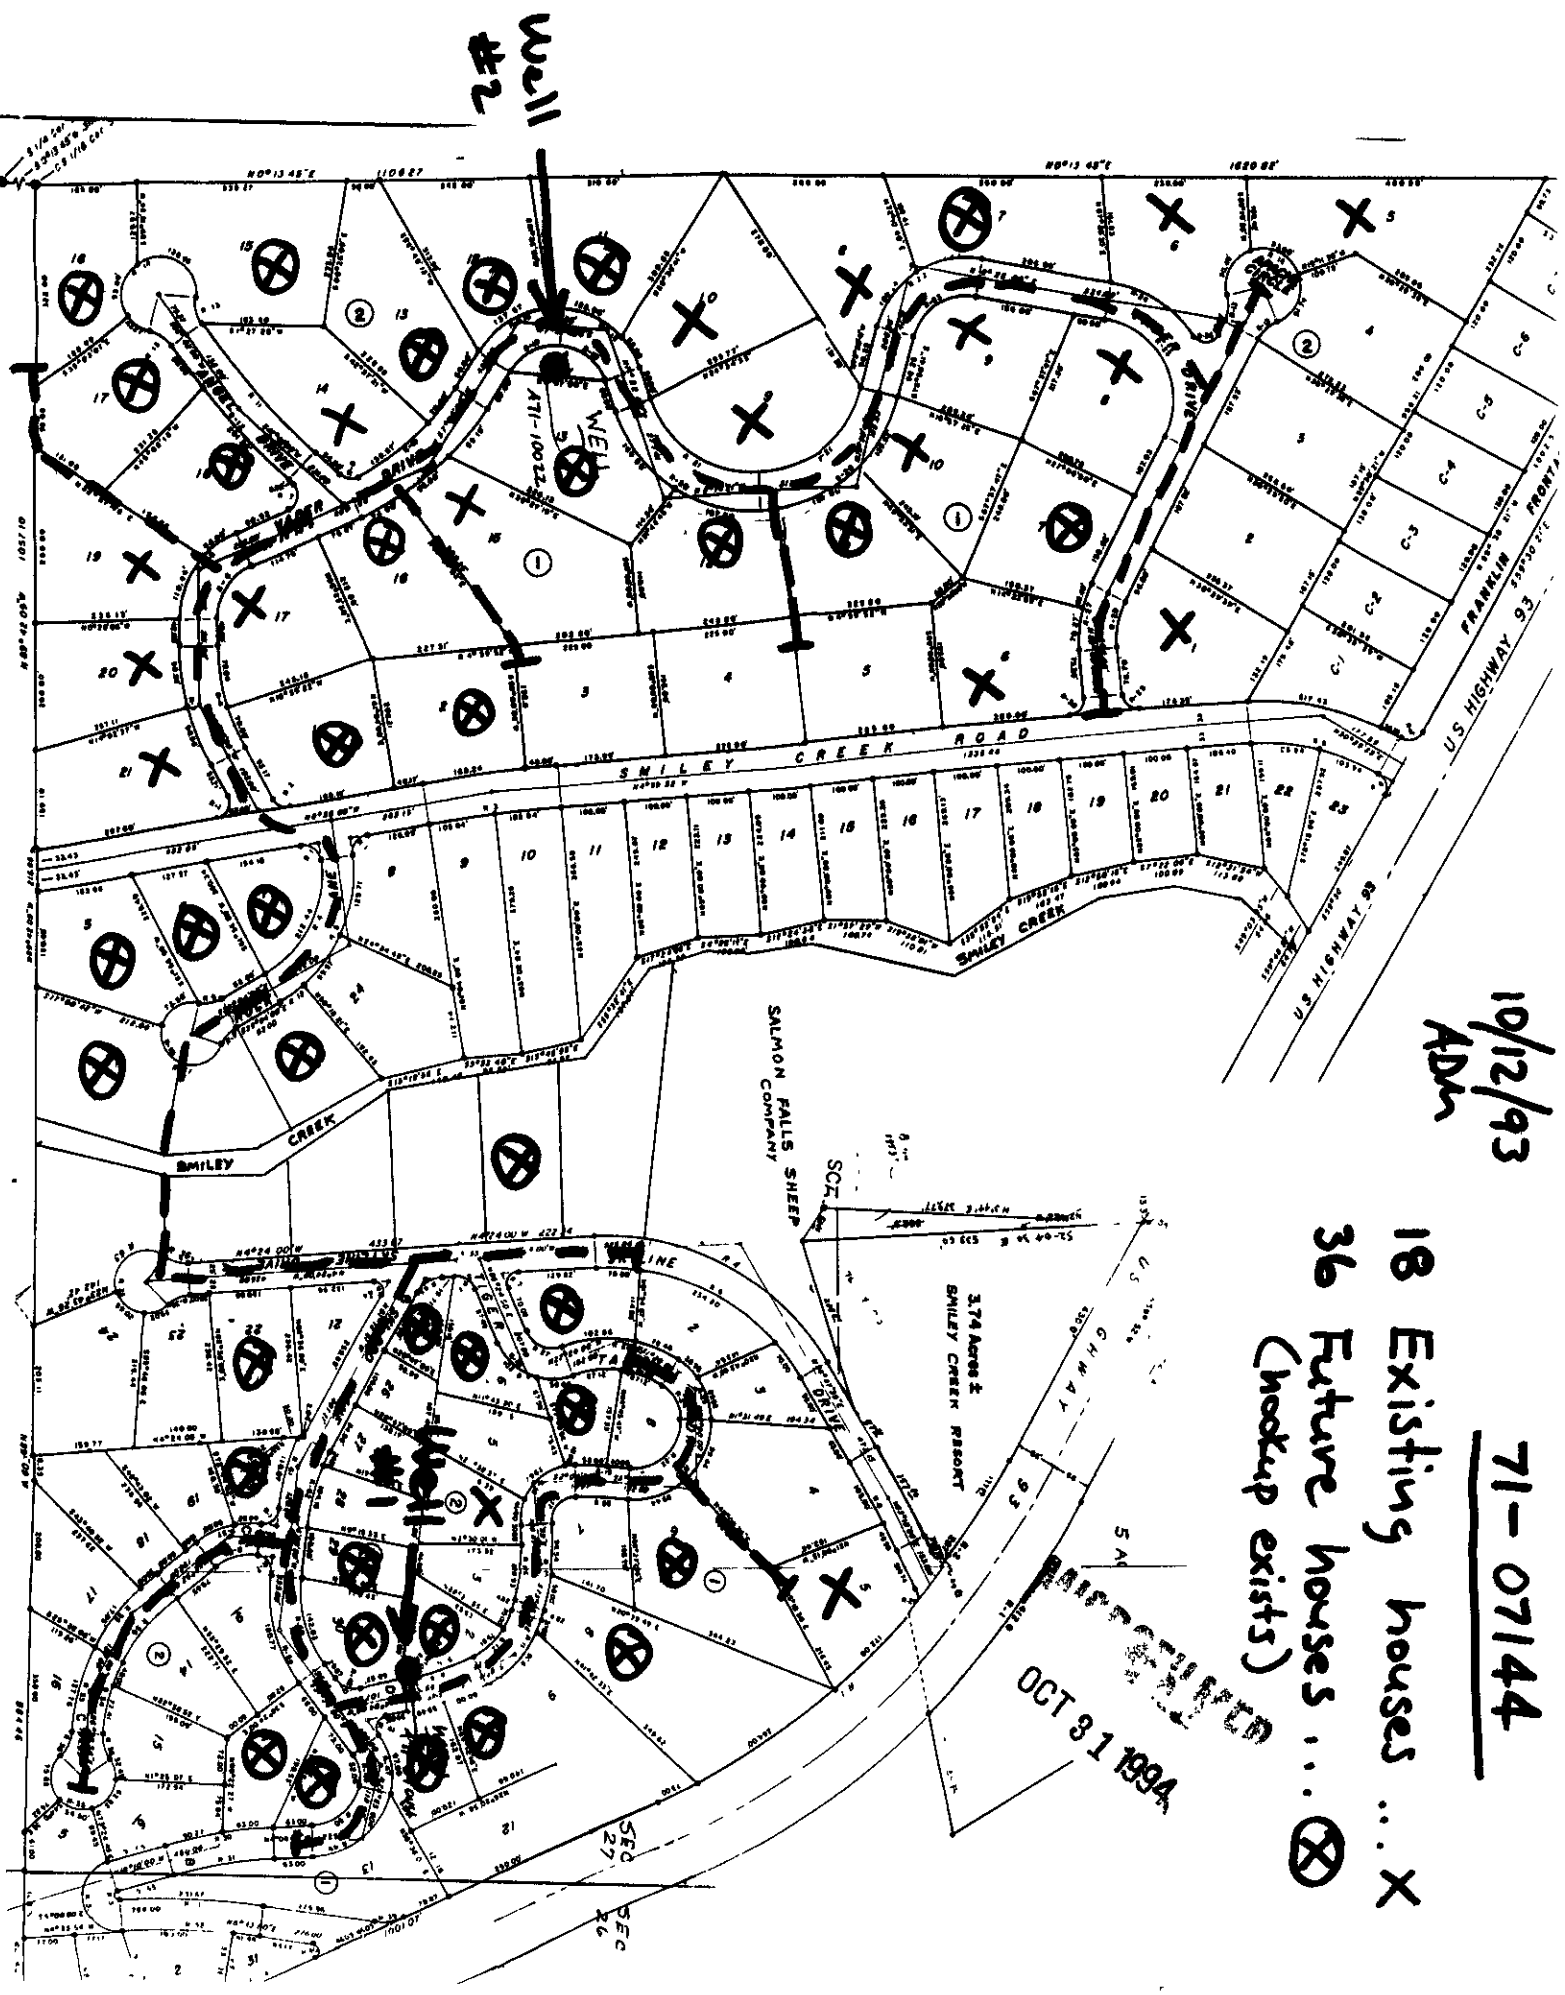

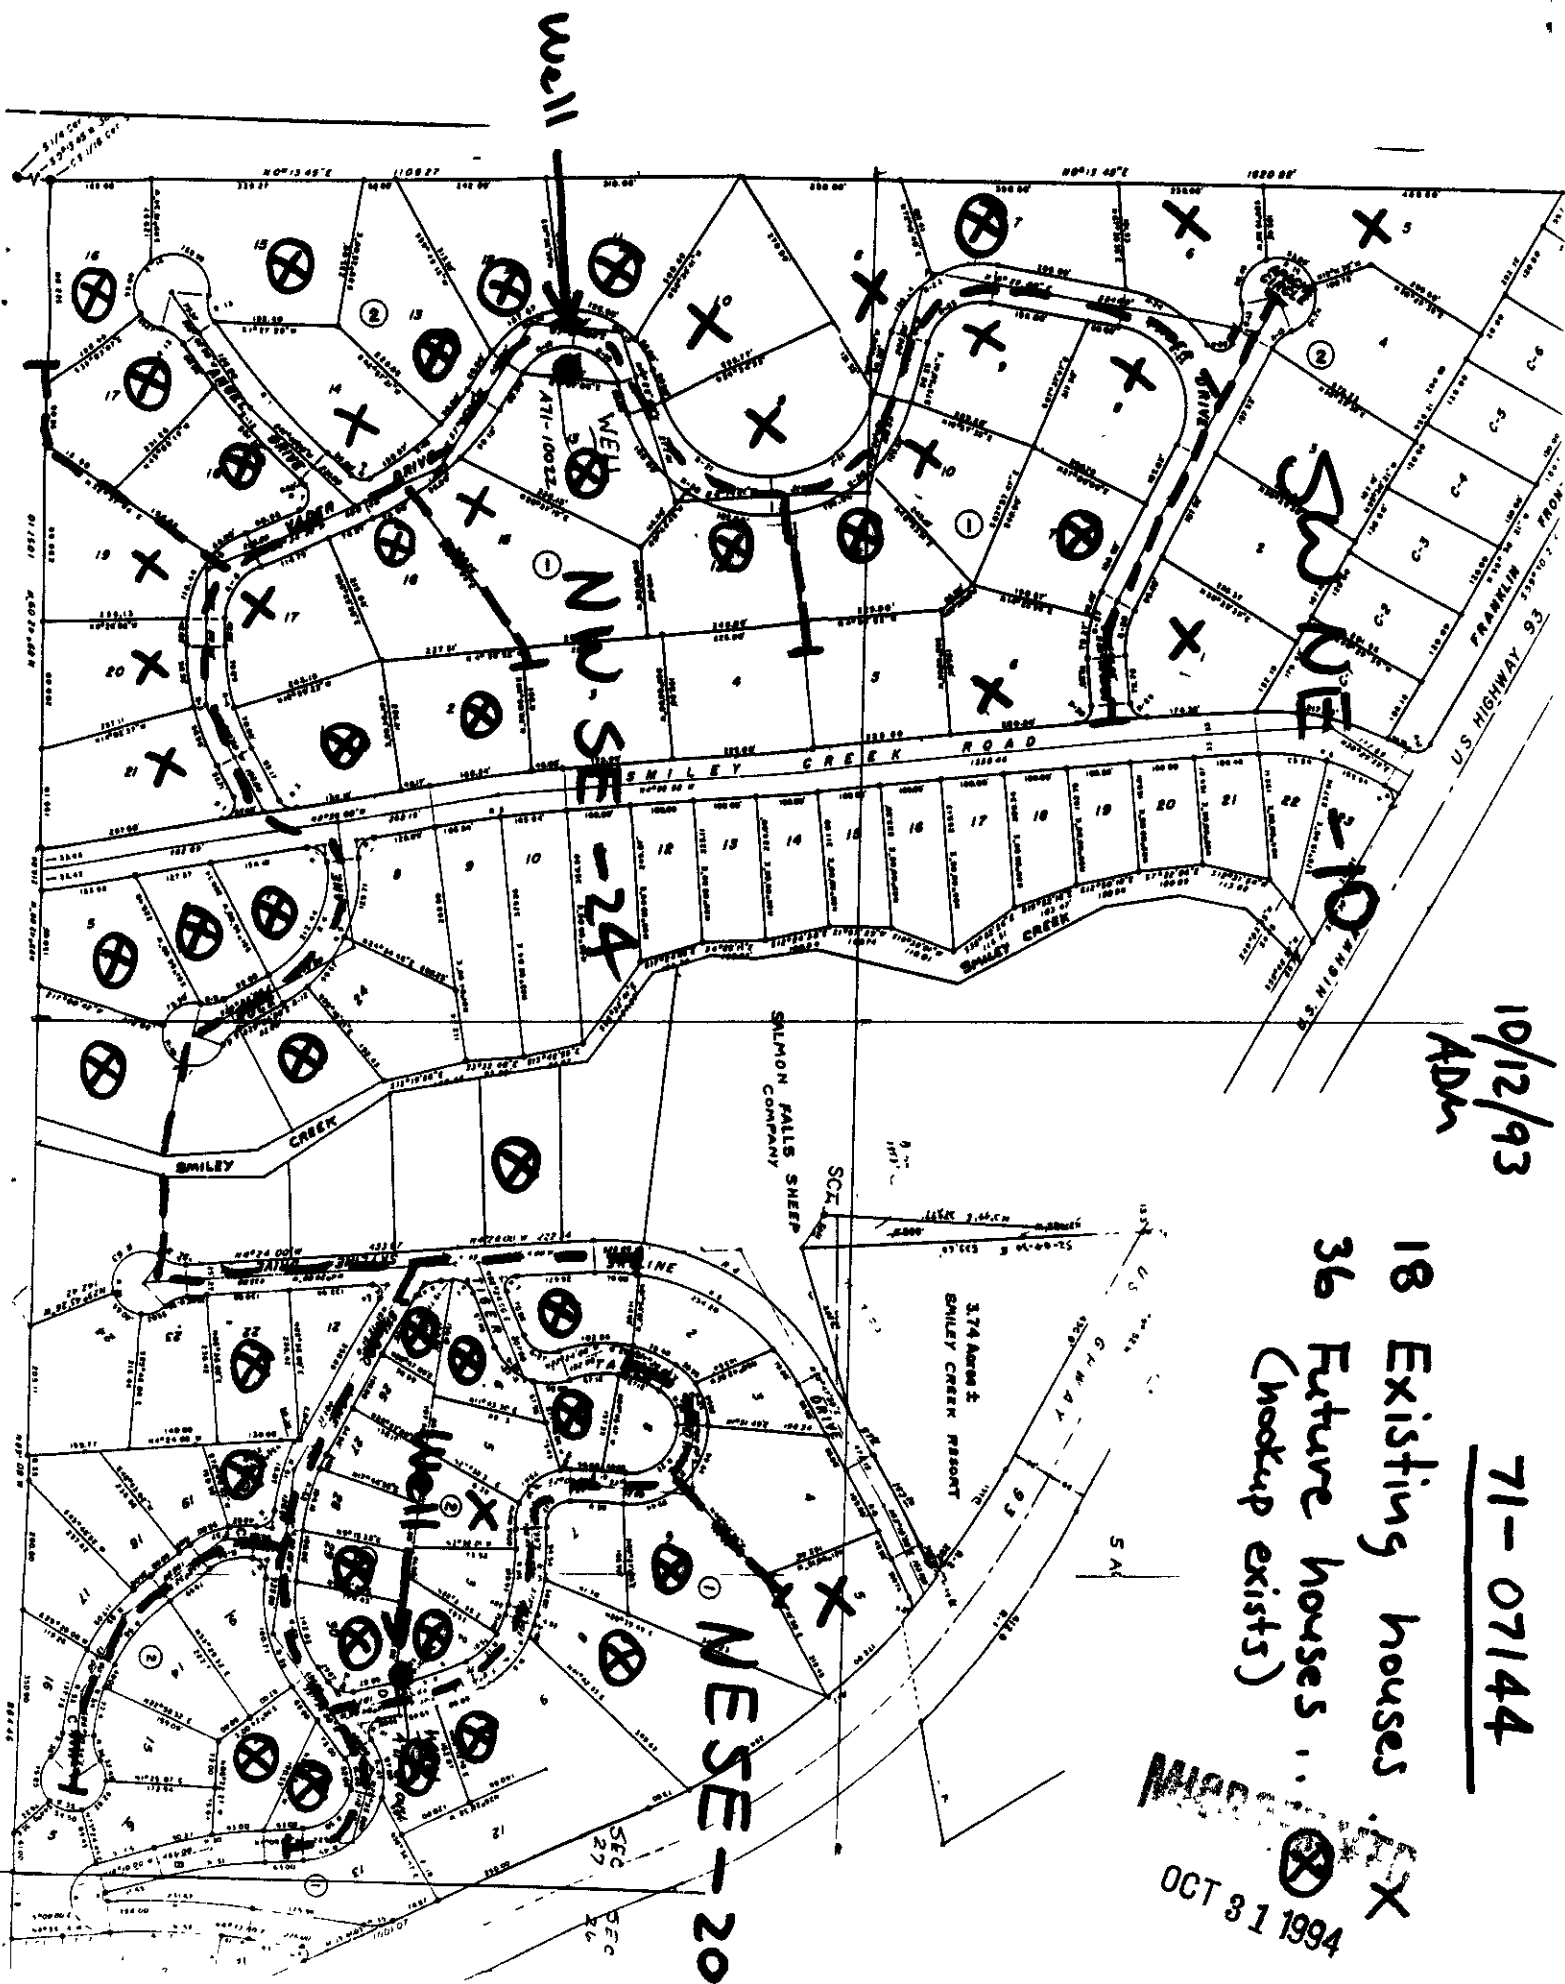

10/12/93
Adm

18 Existing houses
36 Future houses
(checkup exists)


71-07144

OCT 31 1994

ADDN

71-07144


OCT 31 1994

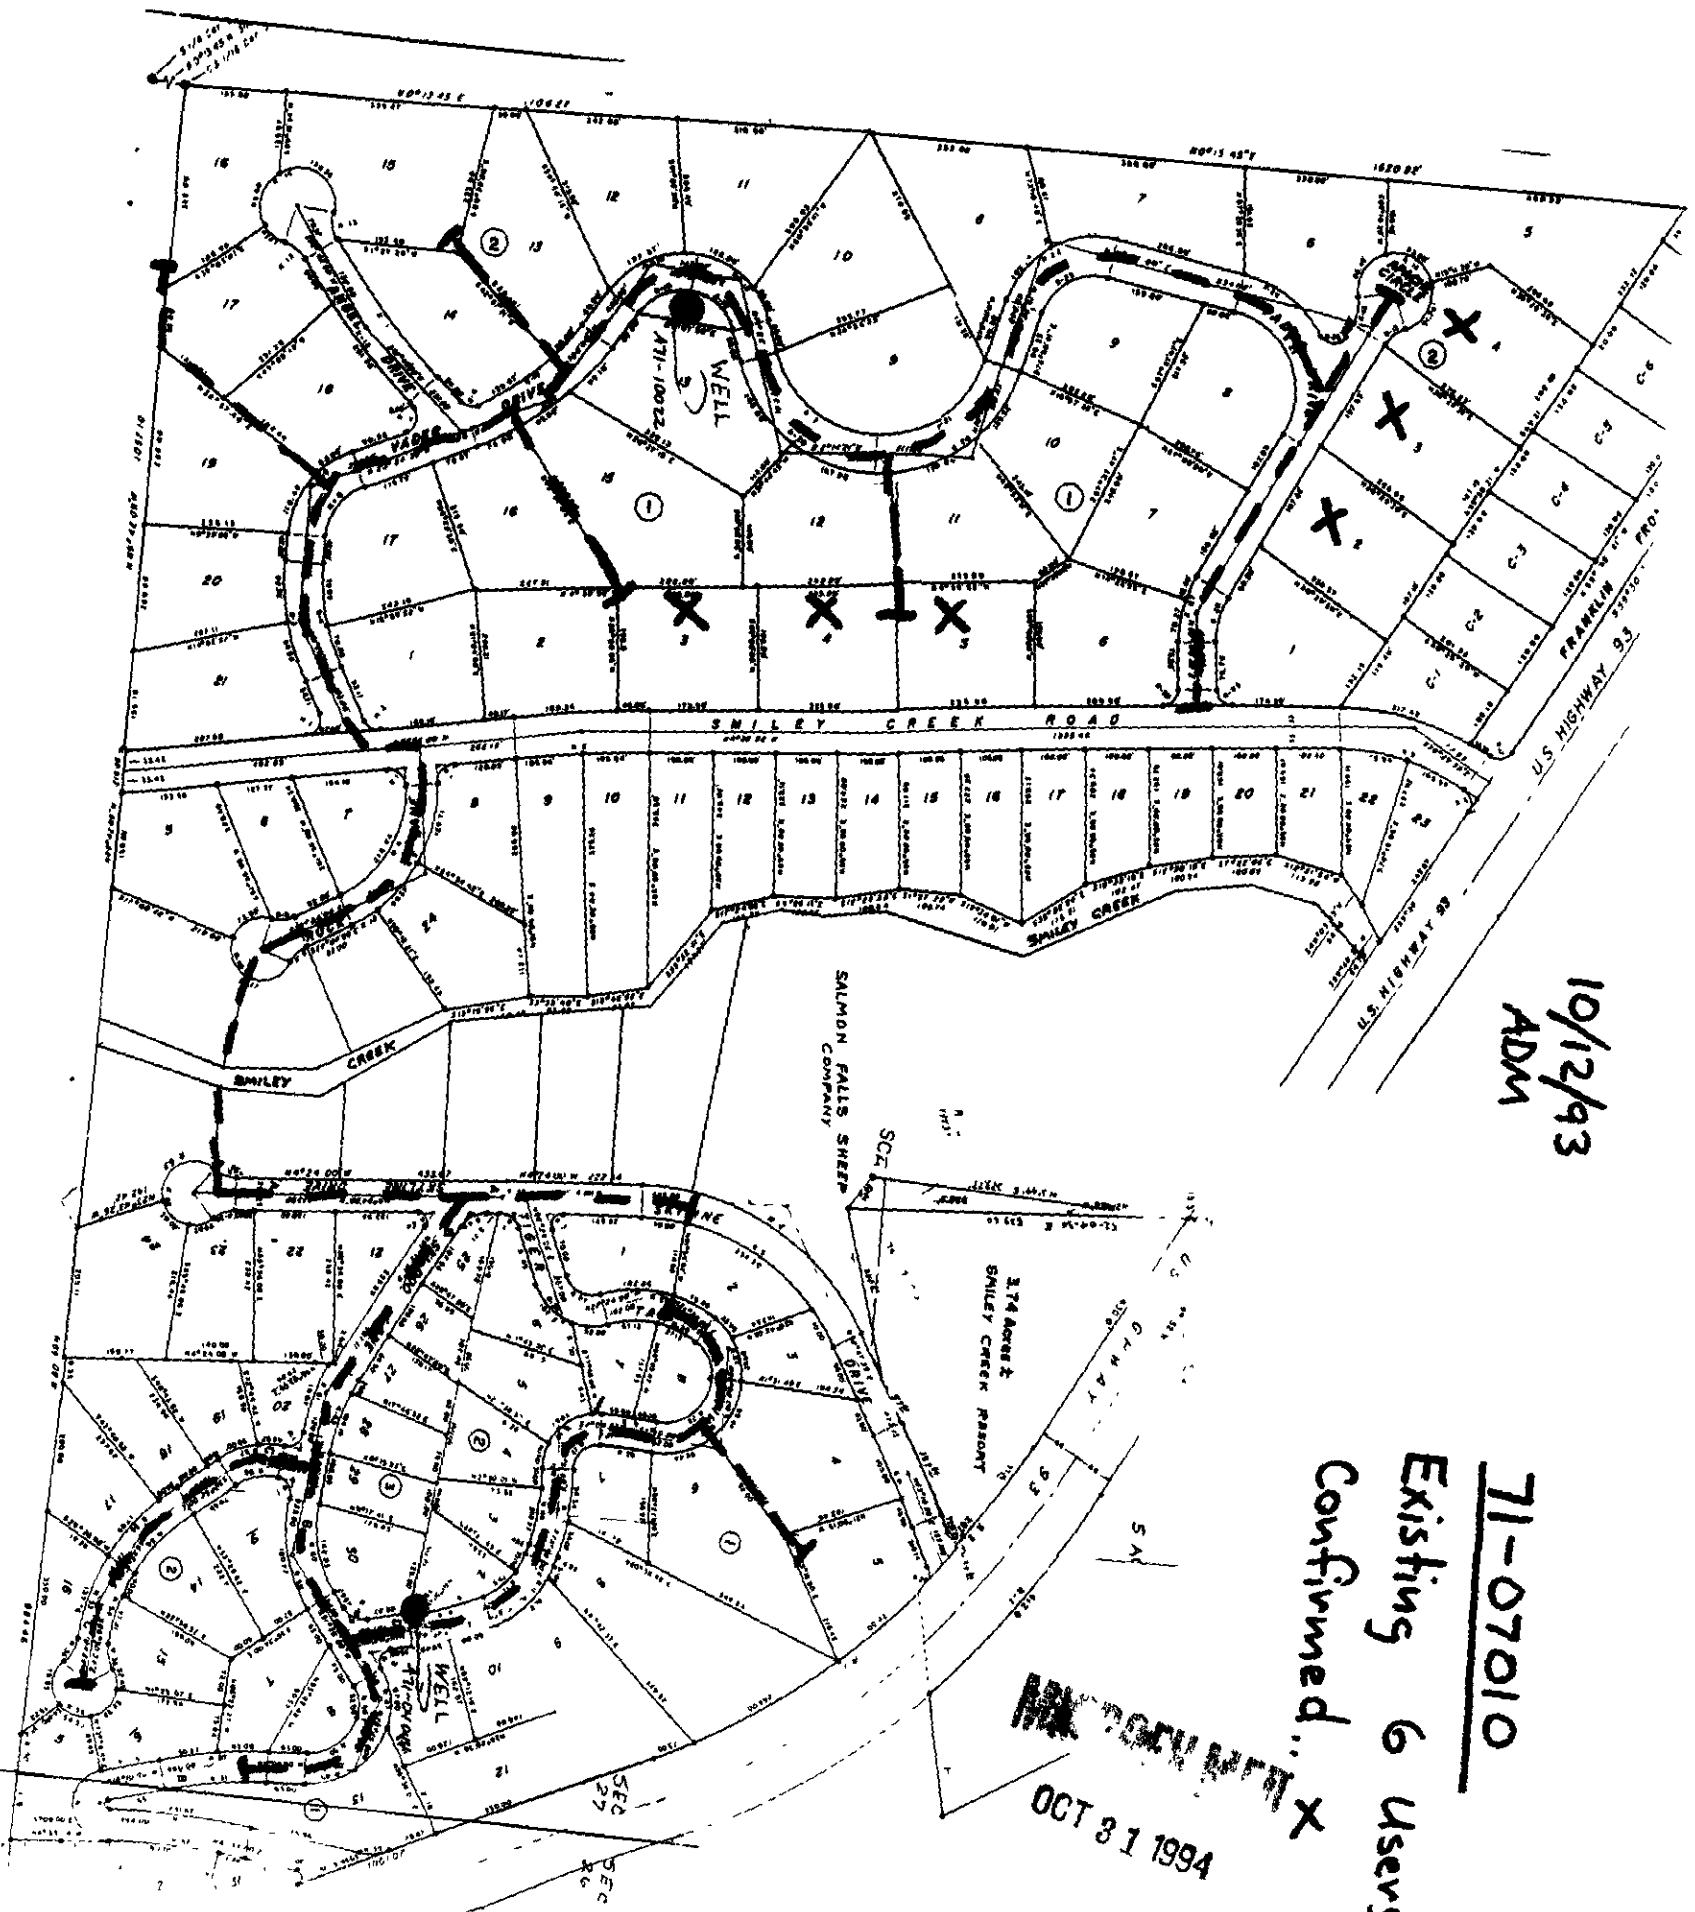

10/12/93
ADM

71-07010
Existing 6 Users
Confirmed.. X

OCT 31 1994

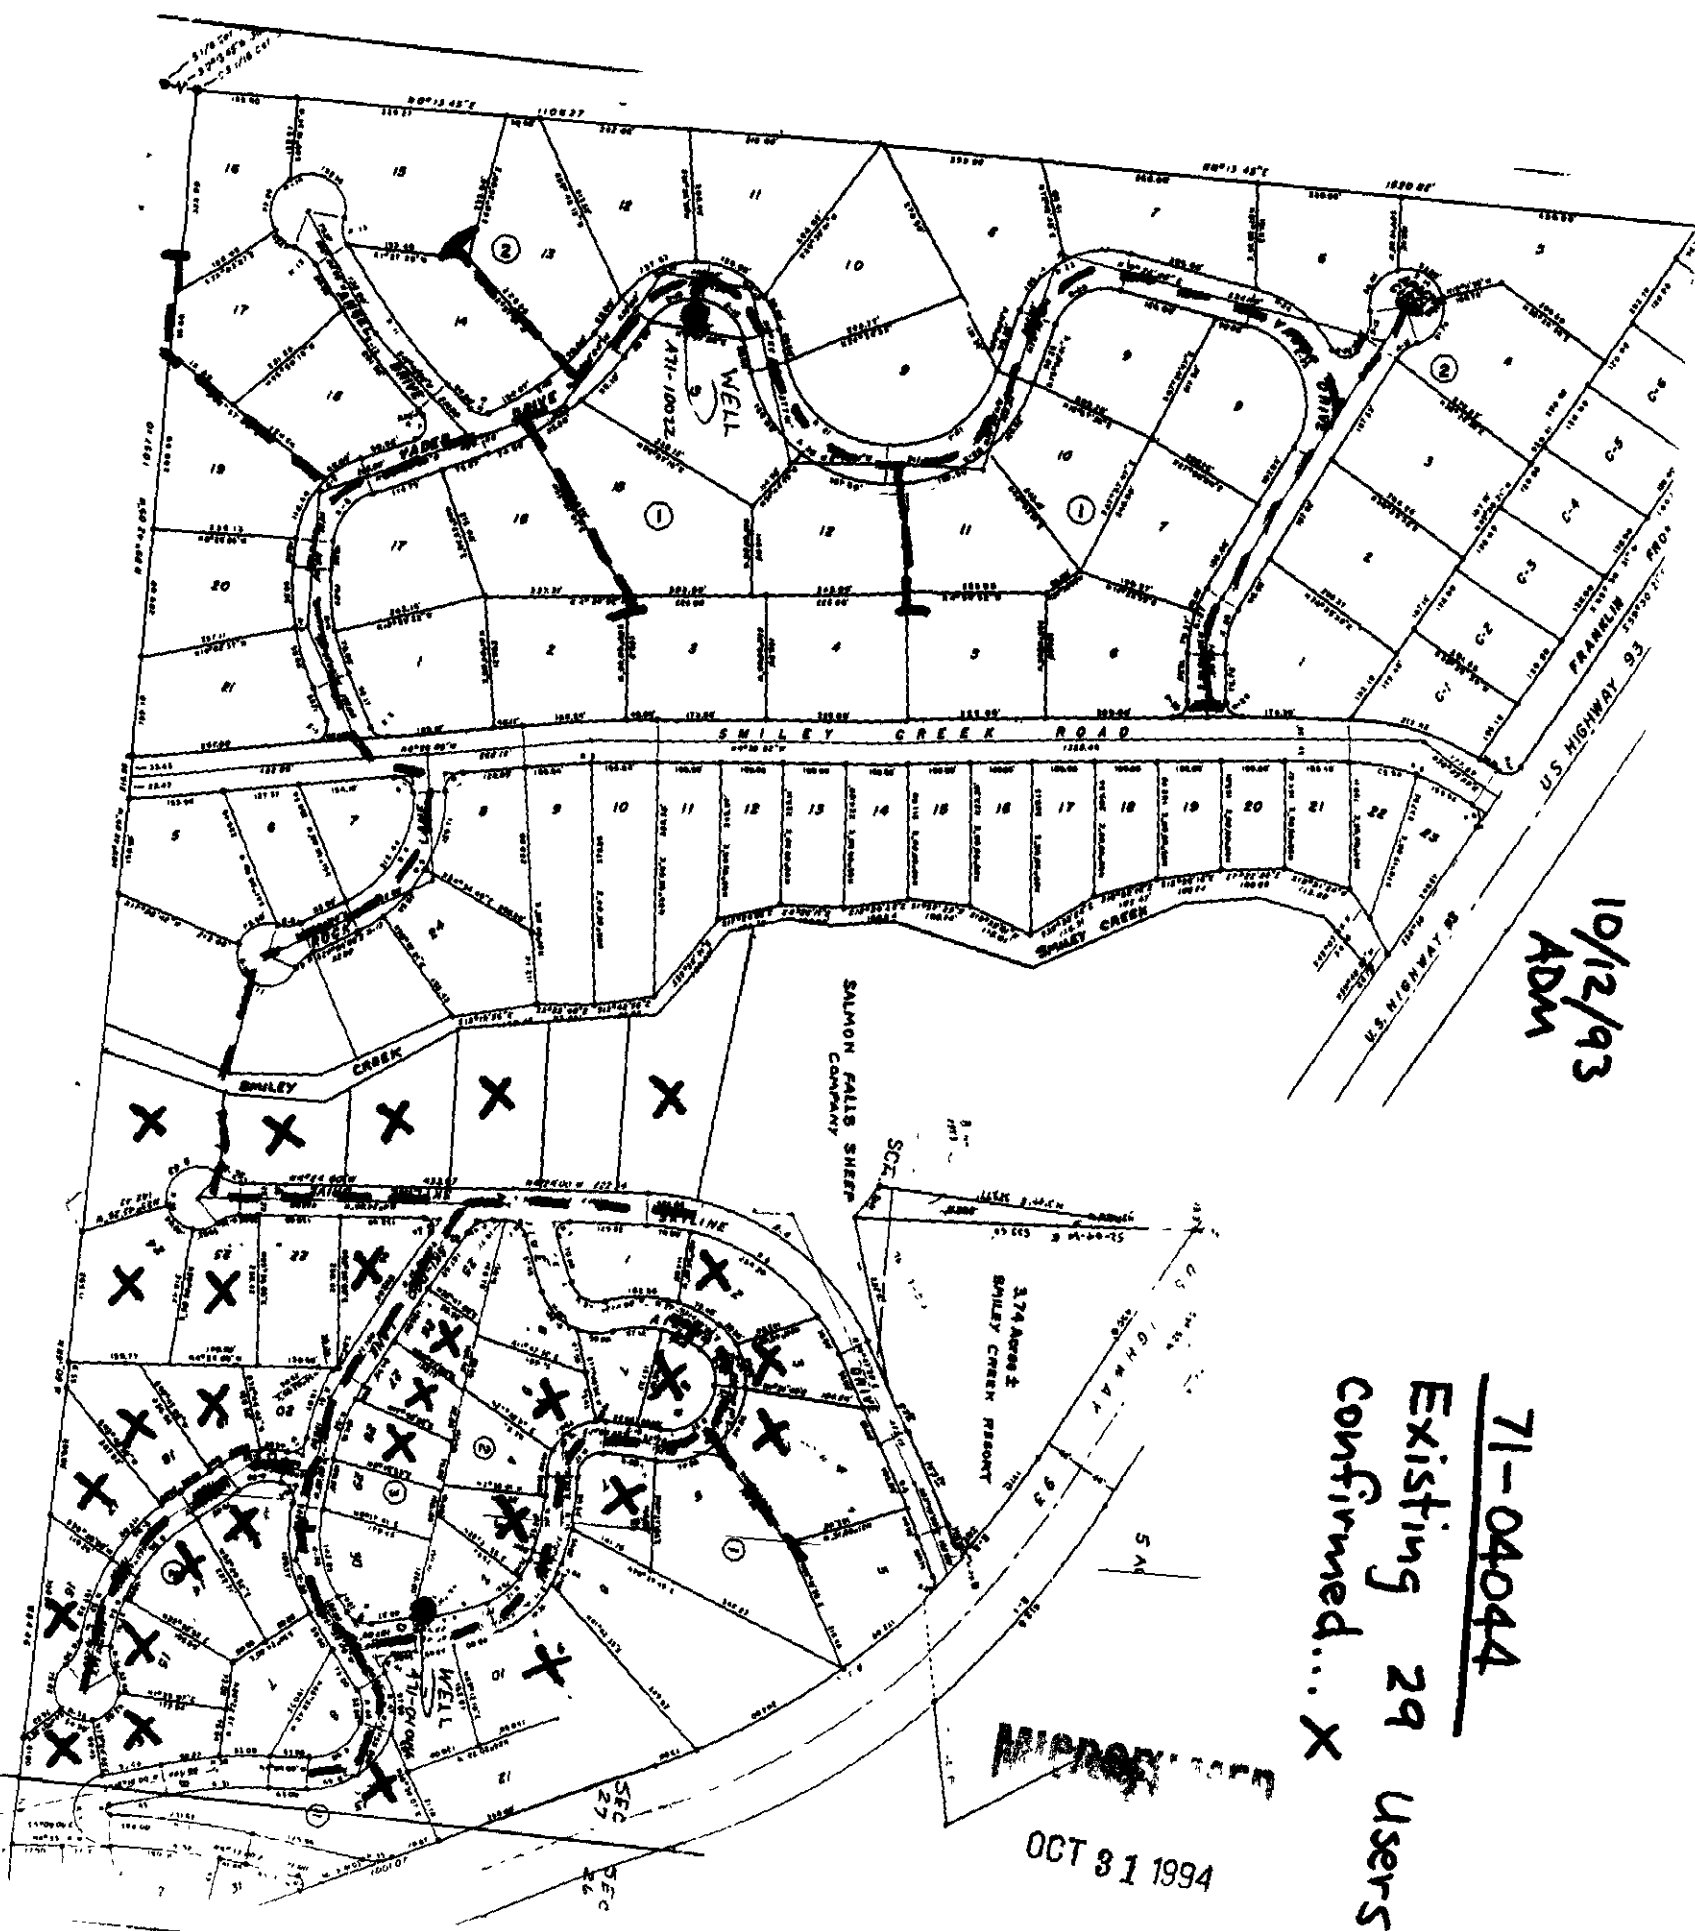

10/12/93
ADM

71-04044
Existing 29 Users
Confirmed... X

MICROFILM

OCT 31 1994

1/3
Adm 71-04044
9/29/93 71-07010
71-07144 FE.



Well #1 Vault

5 H.P. Jacuzzi Pump

10 tanks

186 gallon each

Originally had 5 H.P. Franklin Elec.
but replaced in 1983 with 5 H.P.

Jacuzzi Pressure setting @ 60psi high
40psi low

MEC

OCT 31 1994

2/3


Adm

9/29/93

71-04044


71-07010

71-07144 FE.

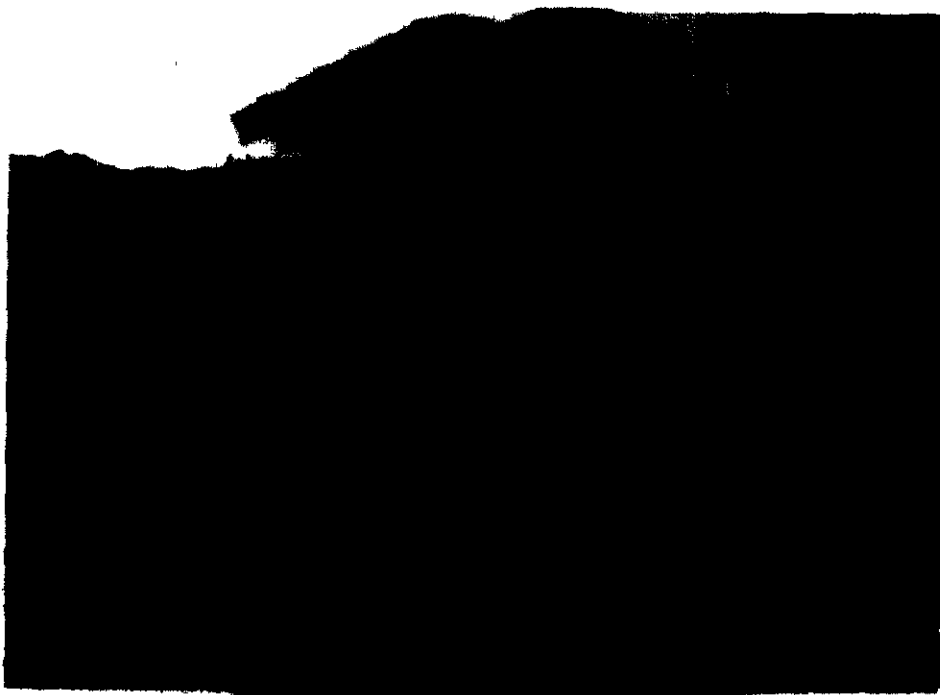

well #2

Well house

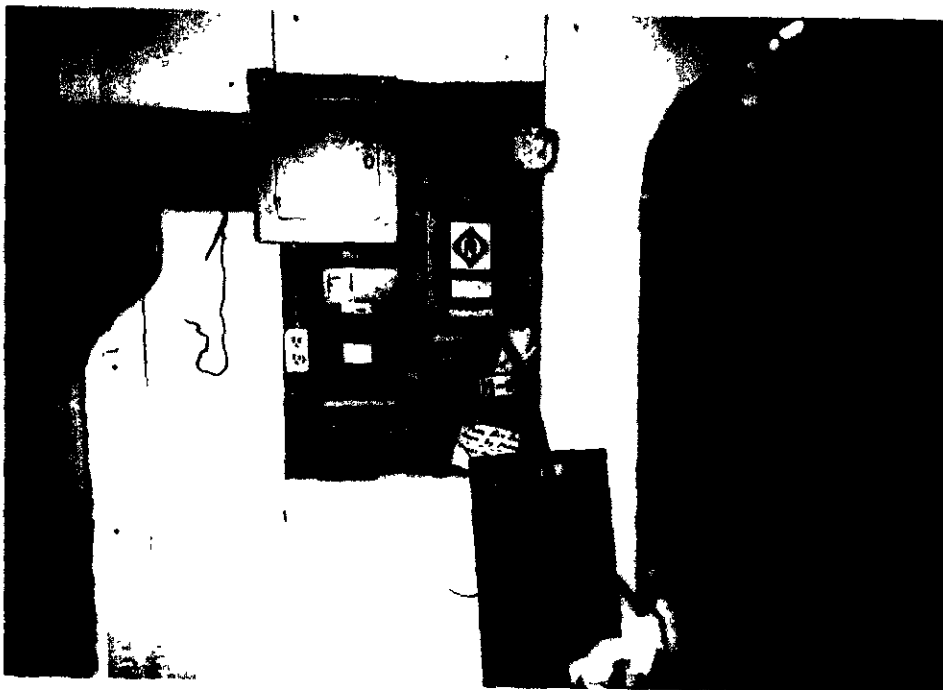


Control panel

OCT 31 1994

3/3

Adm
9/29/93

71-04044
71-07010
71-07144 F.E.

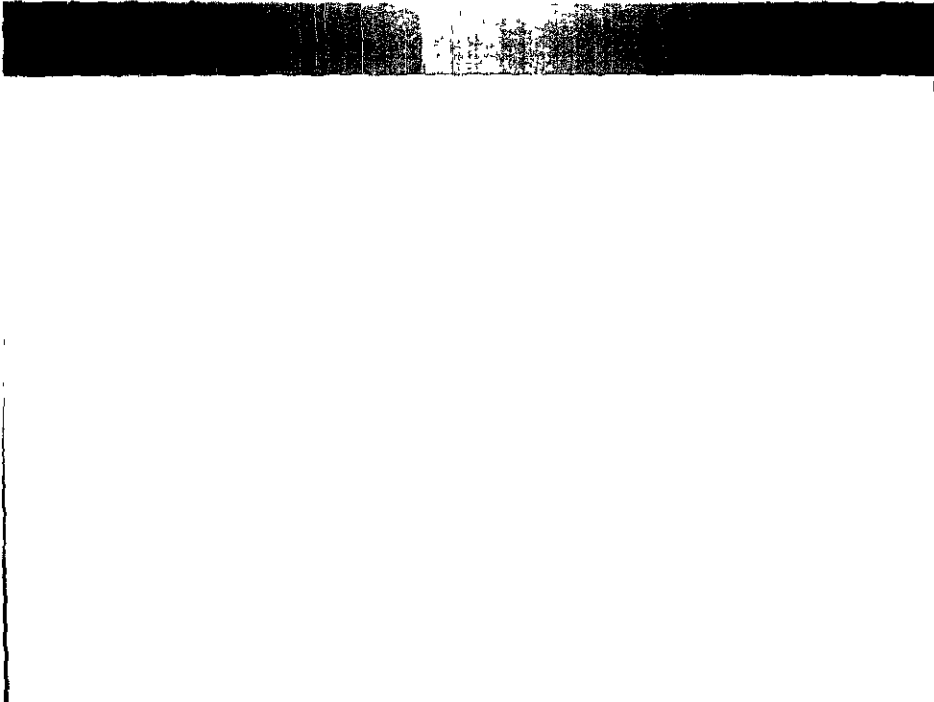

Well #2

from well to
tank.
meter (broken)



Well #2

Outlet to
two buried
lines.

* No polysonic
meas. possible.

OCT 31 1994

October 15, 1993

SMILEY CREEK WATER USERS ASSN
HC 64 BOX 9108
KETCHUM ID 83340

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 71-07144

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water.

If you have questions concerning this matter, please feel free to contact the SOUTHERN Regional Office in Twin Falls at (208)736-3033.

Sincerely,

Karen L. Gustafson
Senior Secretary

c: IDWR - Region

MICROFILMED

OCT 25 1993



State of Idaho
DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000
Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

September 15, 1992

SMILEY CREEK WATER USERS ASSN
HC 64 BOX 9108
KETCHUM ID 83340

PERMIT APPROVAL NOTICE

RE: PERMIT NO. 71-07144

Dear Permit Holder:

Enclosed is a copy of your approved application for permit. We direct your attention to the conditions of approval on the final page.

As a permit owner you must commence the excavation or construction of the diverting works within one year of the date the permit was issued, and you must proceed diligently until the project is completed. The date shown under condition no. 1 is the date when the project must be completed. You will receive a "Proof Due Notice" from this Department approximately 60 days prior to the completion date requiring you to file either a Proof of Beneficial Use form stating that the project has been completed or file a Request for an Extension of Time in which to file the proof statement.

Be sure to note the special condition requiring you to install a measuring device. Enclosed, for your reference, is a list of measuring device options.

Sincerely,

BRENDA L. MILLER
Water Resource Agent

BLM:cz

Enclosures

RECORDED

SEP 21 1992

Smiley Creek Water Users Association, Inc.

SAWTOOTH CITY

KETCHUM, IDAHO 83340

RECEIVED

SEP 9 1992

Dept. of Water Resources

September 6 1992

State of Idaho
Dept. of Water Resources
1301 Orchard St.
Statehouse Mail
Boise Idaho 83720-9000

Re: Application for Permit No. 71-07144

Dear Ms. Miller:

In response to your letter, we have reviewed our maps and applications and have concluded that the well location of NENESE shown on Application for Permit No. 71-07144 is incorrect. The correct location is NWNWSE as shown in your letter to us.

We have only the two wells, described as NWNWSE and SENESE in your letter to our Water Association. These wells are interconnected to provide water to the community.

We would appreciate your efforts to make this correction to the Application for Permit No. 71-07144 so that the Permit may be processed and approved.

sincerely,



Burton C. Sanders
Secretary-Treasurer
Smiley Creek Water Users Assn.

NOT RECORDED

SEP 21 1992



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

August 31, 1992

SMILEY CREEK WATER USERS ASSN
HC 64 BOX 9108
KETCHUM ID 83340

Application for Permit No. 71-07144

Dear Applicant:

The above referenced application has reached the State Office for final review and processing. Before the application process can continue, there is a point of diversion discrepancy that needs to be cleared up.

Your application indicates that the system's two existing wells are going to be the points of diversion. We have record of the well in the SENESE 1/41/4 (A71-04044); however, the NENESE point of diversion listed on the application is not the one for your other right, A71-07010. That well is located in the NWNWSE 1/41/4.

Are you drilling a new well or is it just a discrepancy on the application?

Thank you for your time and assistance with this matter. I will hold the application from further processing pending your reply. Please respond at your earliest convenience in order to prevent undue delay in processing this application.

Sincerely,

BRENDA L. MILLER
Water Resource Agent

MICROFILMED

SEP 21 1992

AFFIDAVIT of PUBLICATION

RECEIVED

JUL 01 1992

State of Idaho,
County of Blaine

} SS.

Department of Water Resources
Southern Region Office

On this 24th day of June, in the year 1992, before me a Notary Public of said State, personally appeared **DANIEL J. GORHAM**, known or identified to me to be the person whose name is subscribed to be the within instrument, and being by me first duly sworn, declared that the statements therein are true, and acknowledged to me that he executed the same. As the publisher of the Wood River Journal, he/she attests that said newspaper has been continuously and and uninterruptedly published for a period of seventy-eight consecutive weeks prior to the first publication of the annexed notice, and is a newspaper qualified to publish legal notices as provided by act of the 1919 session of the legislature of the State of Idaho, known as House Bill 145; that the annexed advertisement was published once each week for 2 consecutive issues in said newspaper proper and not in a supplement; that the date of the first publication of said advertisement was on the 17 day of June, 1992, and the date of the last publication was on the 24 day of June, 1992.

Daniel J. Gorham

Subscribed and sworn to before me this 24th day of June, 1992.
(SEAL)

Roberta J. Ketchum

NOTARY PUBLIC

WOOD RIVER JOURNAL
Hailey, Idaho

COST OF PUBLICATION

Number of Picas per Line _____
Number of Lines in Notice 45
Number of Insertions _____
_____45 Lines tabular at _____ 6c / Pica
_____45 Lines straight at 22.50 5c / Pica
_____45 Subsequent lines at 20.25 4c / Pica
TOTAL COST 47.75 5.00

COPY OF NOTICE
(Paste Here)

Assn. Files on

TITLE OF NOTICE

trust water right

PLAINTIFF ATTORNEY


DEFENDANT

PLAINTIFF

Dept of Water Resources

BILL TO

Twin Falls

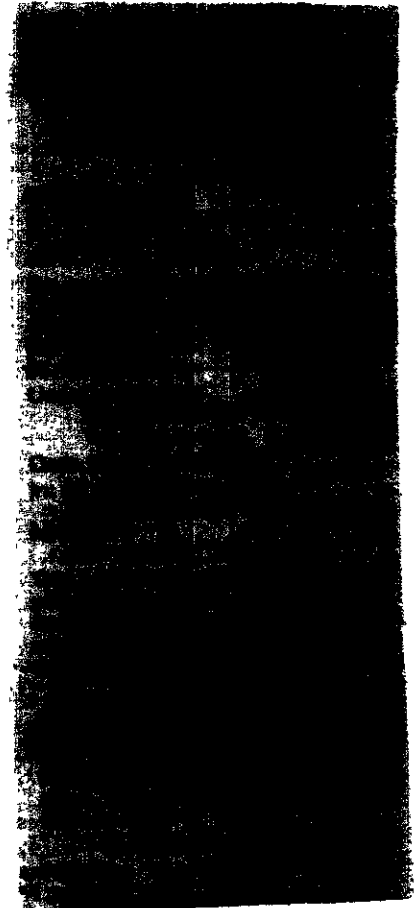

OK
MB
7-8-92

RECEIVED
SEP 21 1992

Publication Rates
As of Jan., 1990
(Idaho Code,
Reb Statutes 1984)
7-8 pt / line straight 5 / pica
7-8 pt / line tabular 6 / pica
7-8 pt / line successive
insertion 4 / pica

8250

Disk: Legals/1trust

RECEIVED

JUN 15 1992

Department of Water Resources
Southern Region Office

**Assn. files on
trust water right**

**NOTICE OF APPLICATION
FOR TRUST WATER RIGHT**

71-07144

SMILEY CREEK
WATER USERS ASSN
HC 84 BOX 9108
KETCHUM, ID 83340

Source: GROUNDWATER
Diversion Pt: NENESE Sec 27 T
07N R 14E in BLAINE County;
SENESE Sec 27 T 07N R 14E in
BLAINE County.

Use: DOMESTIC (.400 CFS)
IRRIGATION (.380 CFS)
Total Diversion: (.780 CFS)

Date Filed: 4/28/1992

In: BLAINE County
T07N R14E S27 SWNE NESE
NWSE
19.0 ACRES TOTAL

The permit(s) will be subject to all
prior water rights. Protests may
be submitted based on the criteria
of Sec. 42-203A, Idaho Code,
and/or the new public interest
criteria of Sec. 42-203C, Idaho
Code. Protests must be filed with
the Director, Dept. of Water
Resources, 222 Shoshone Street
East, Twin Falls, ID 83301, on or
before JULY 6, 1992.

R. Keith Higginson, Director

Publish: Wood River Journal-
June 17 & 24, 1992.

OK
MB
6/15/92

CONTINUED

JUN 21 1992

NOTICE OF APPLICATION FOR TRUST WATER RIGHT

71-07144

SMILEY CREEK WATER USERS ASSN
HC 64 BOX 9108
KETCHUM, ID 83340

Source: GROUNDWATER

Diversion Pt: NENESE Sec 27 T 07N R 14E in BLAINE County.
 SENESE Sec 27 T 07N R 14E in BLAINE County.

Use: DOMESTIC (.400 CFS)
 IRRIGATION (.380 CFS)
 Total Diversion: (.780 CFS)

Date Filed: 4/28/1992

In: BLAINE County
 T07N R14E S27 SWNE NESE NWSE

19.0 ACRES TOTAL

The permit(s) will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code and/or the new public interest criteria of Sec. 42-203C, Idaho Code. Protests must be filed with the Director, Dept. of Water Resources, 222 Shoshone Street East, Twin Falls, ID 83301 on or before JULY 6, 1992.

Published: 6/17/1992 & 6/24/1992 R. Keith Higginson, Director

MICROFILMED

SEP 21 1992

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Southern Region
222 Shoshone Street East
Twin Falls, ID 83301
(208)736-3033

JUNE 11, 1992

WOOD RIVER JOURNAL
PO BOX 988
HAILEY, ID 83333

Gentlemen:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before JULY 6, 1992.

Yours truly,

Mary Baldwin
Secretary/Office Coordinator

Enclosure

MESSAGE CONFIRMATION
TRANSMISSION

MICROFILMED

JUN-13-'92 FRI 08:12

SEP 21 1992

TERM ID: IDWP SOUTHERN

P-9999

TEL NO.: 1-208-736-3037

NO.	DATE	ST. TIME	TOTAL TIME	ABBR/SRD	ID	DEPT CODE	#PGS
705	06-12	08:10	00° 01' 28		2087880083		OK- 2 NG- 0



State of Idaho

DEPARTMENT OF WATER RESOURCES

Southern Region, 222 Shoshone St. East, Twin Falls, Idaho 83301 (208) 736-3033

11-Jun-1992

CECIL D. ANDRAUS
Governor

R. KEITH HIGGINSON
Director

ROGER T DEAN VICE PRESIDENT
SMILEY CREEK WATER USERS ASSN
HC 64 BOX 9108
KETCHUM ID 83340

Re: Application for Permit No. 71-07144

Dear Applicant (s):

The Department of Water Resources acknowledges receipt of your water right application for permit. The application has been assigned the above referenced identification number. Please refer to this number in all further correspondence.

This office will be advertising the application in the Wood River Journal on 6/17 & 6/24/92. A period of ten days following the second publication will be allowed for the submittal of protests.

If the application is protested you will be sent a copy of the protest. The protest must be resolved before the application is approved or denied. If the protest is not resolved voluntarily, this Department will conduct a conference and/or hearing on the matter.

If the application is not protested, it will be forwarded to our State Office in about five weeks. State office personnel will conduct a complete review prior to final processing of the application and will notify you of the outcome of this review. When a permit is issued, you will be sent a copy. A typical processing time for an unprotested application is about eight weeks.

Please feel free to contact this office if you have any questions regarding this procedure.

Very truly yours,

Mel Schulte
Water Rights Agent

MS::MB

RECEIVED

SEP 21 1992