


North Lakes Recreational
Sewer and Water District
Sewer System Layout


- STEP Systems
- Pump Stations
- 8" Gravity Sewer Lines
- 2" Pressure Sewer Lines
- 4" Pressure Sewer Lines
- 6" Pressure Sewer Lines
- 8" Pressure Sewer Lines

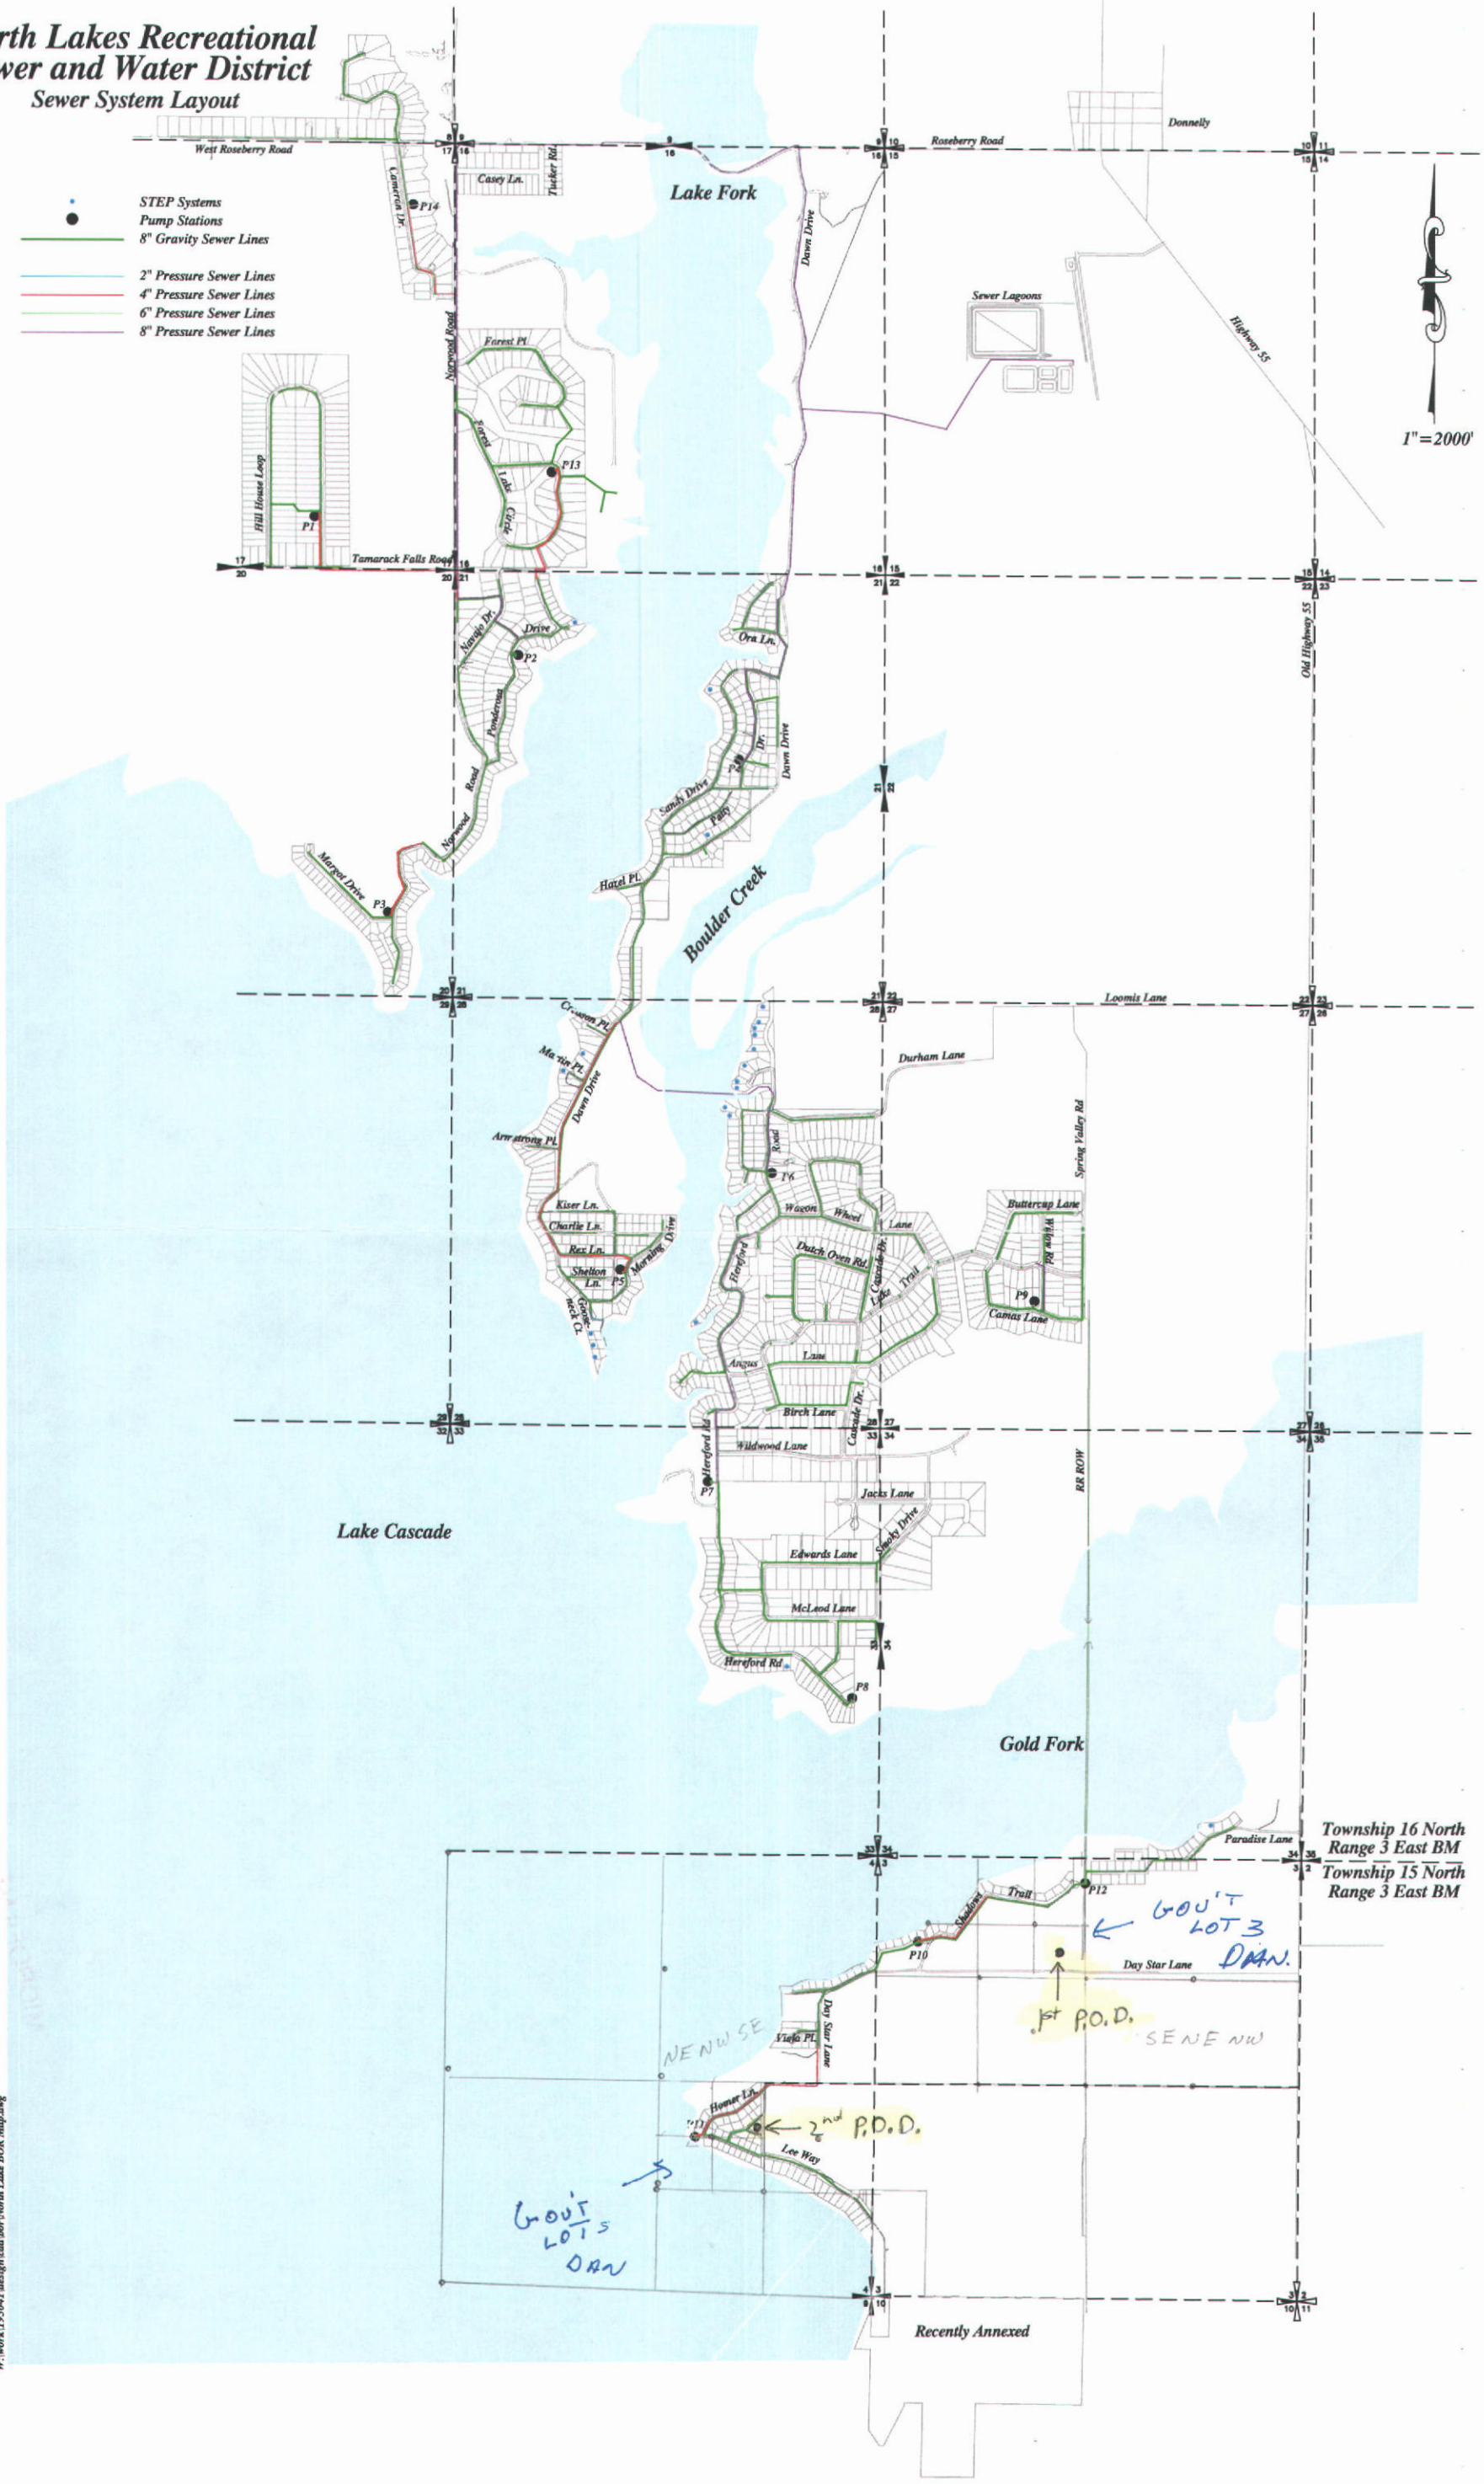

Township 16 North
Range 3 East BM
Township 15 North
Range 3 East BM


Range No 3 East of the Boise

MICROFILMED
SEP 19 2001

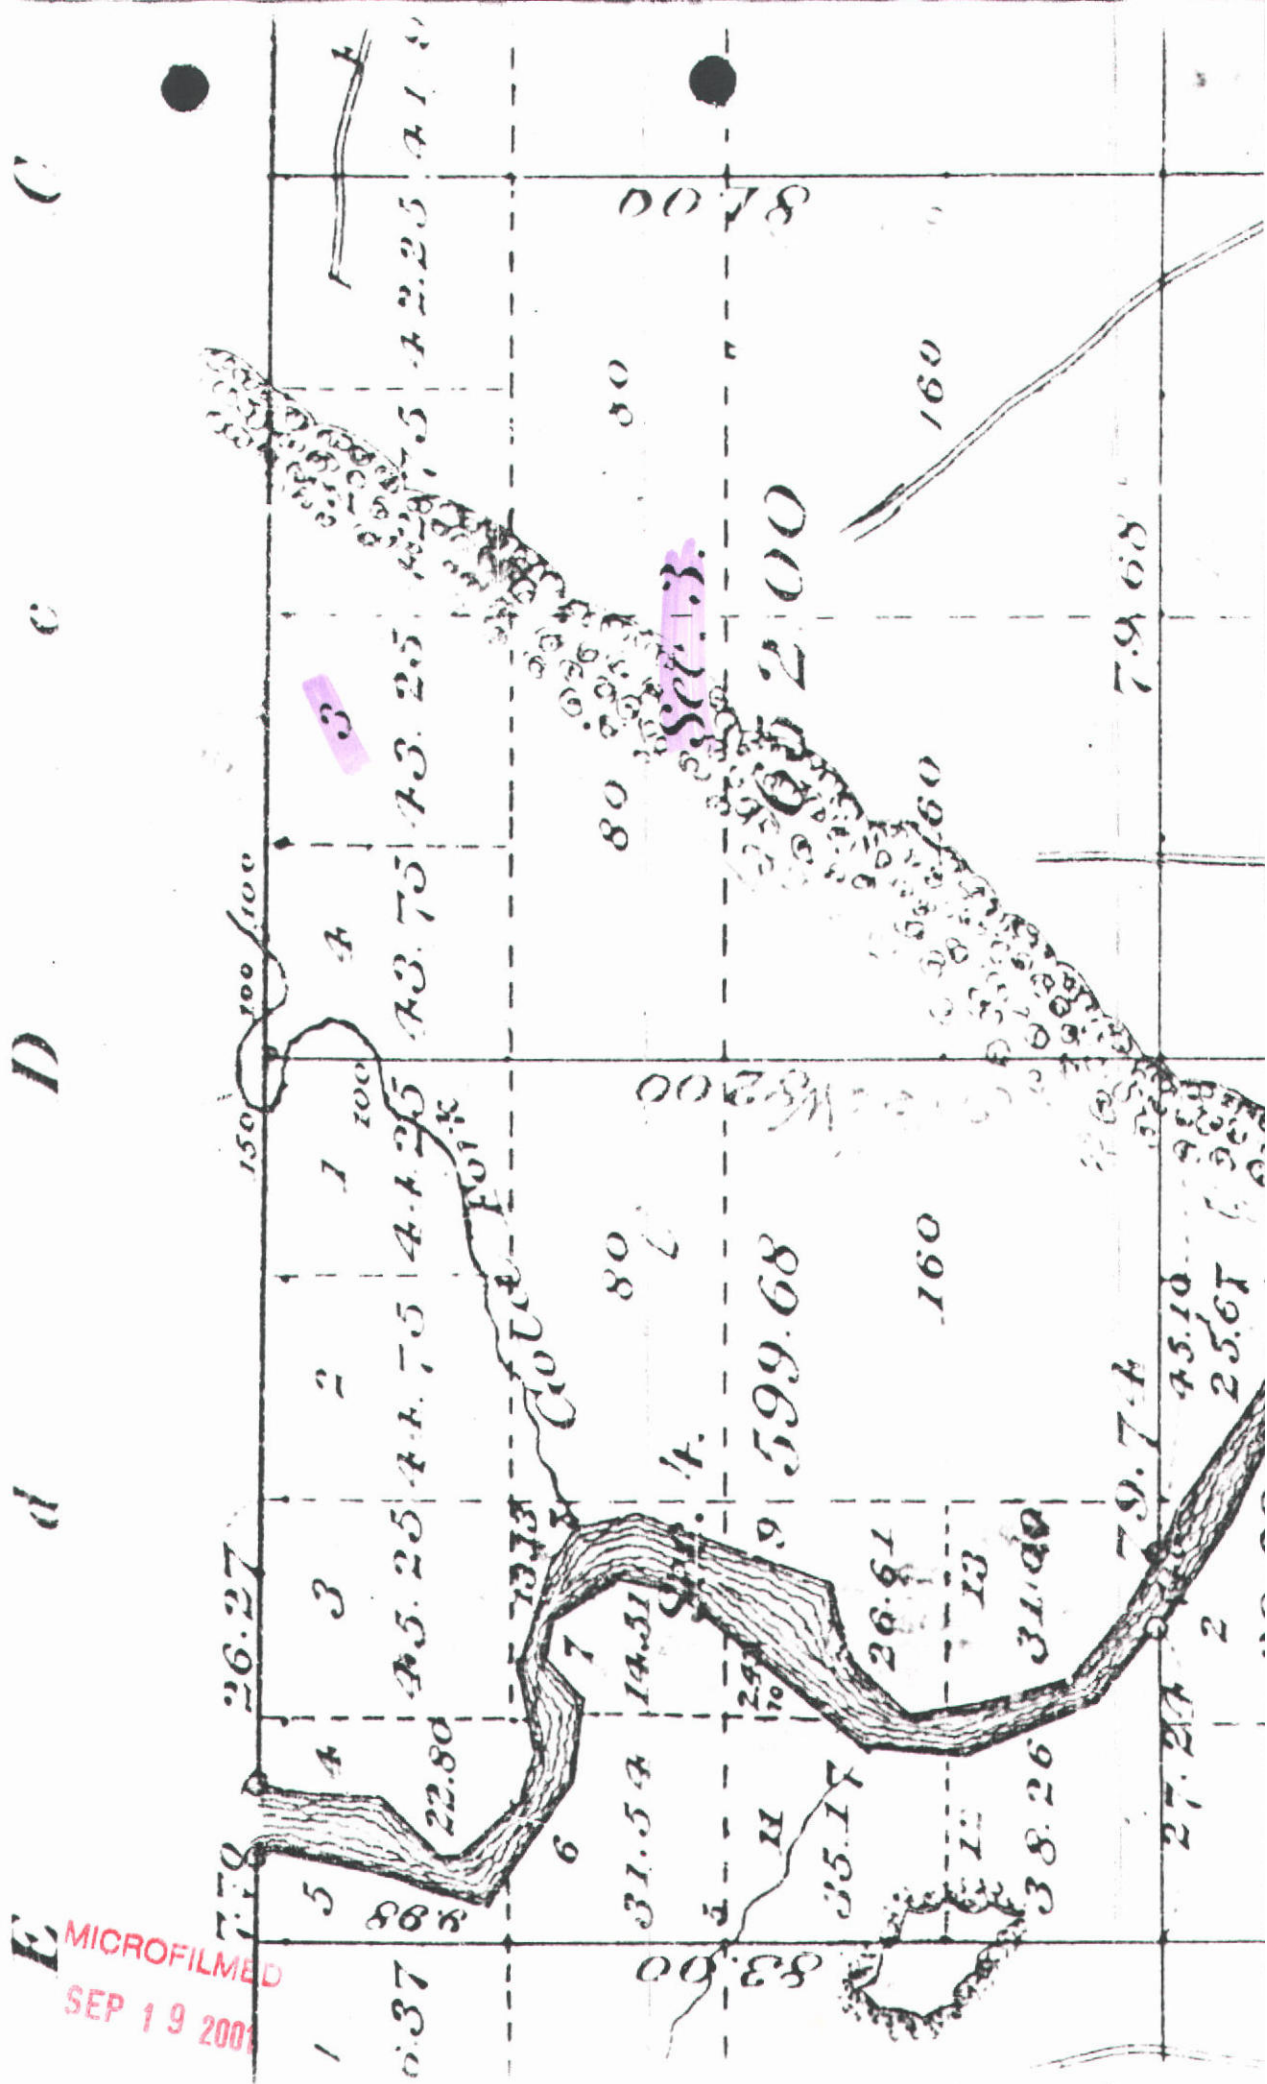


NORTH LAKE RECREATIONAL SEWER & WATER DISTRICT

WATER RIGHTS FIGURE

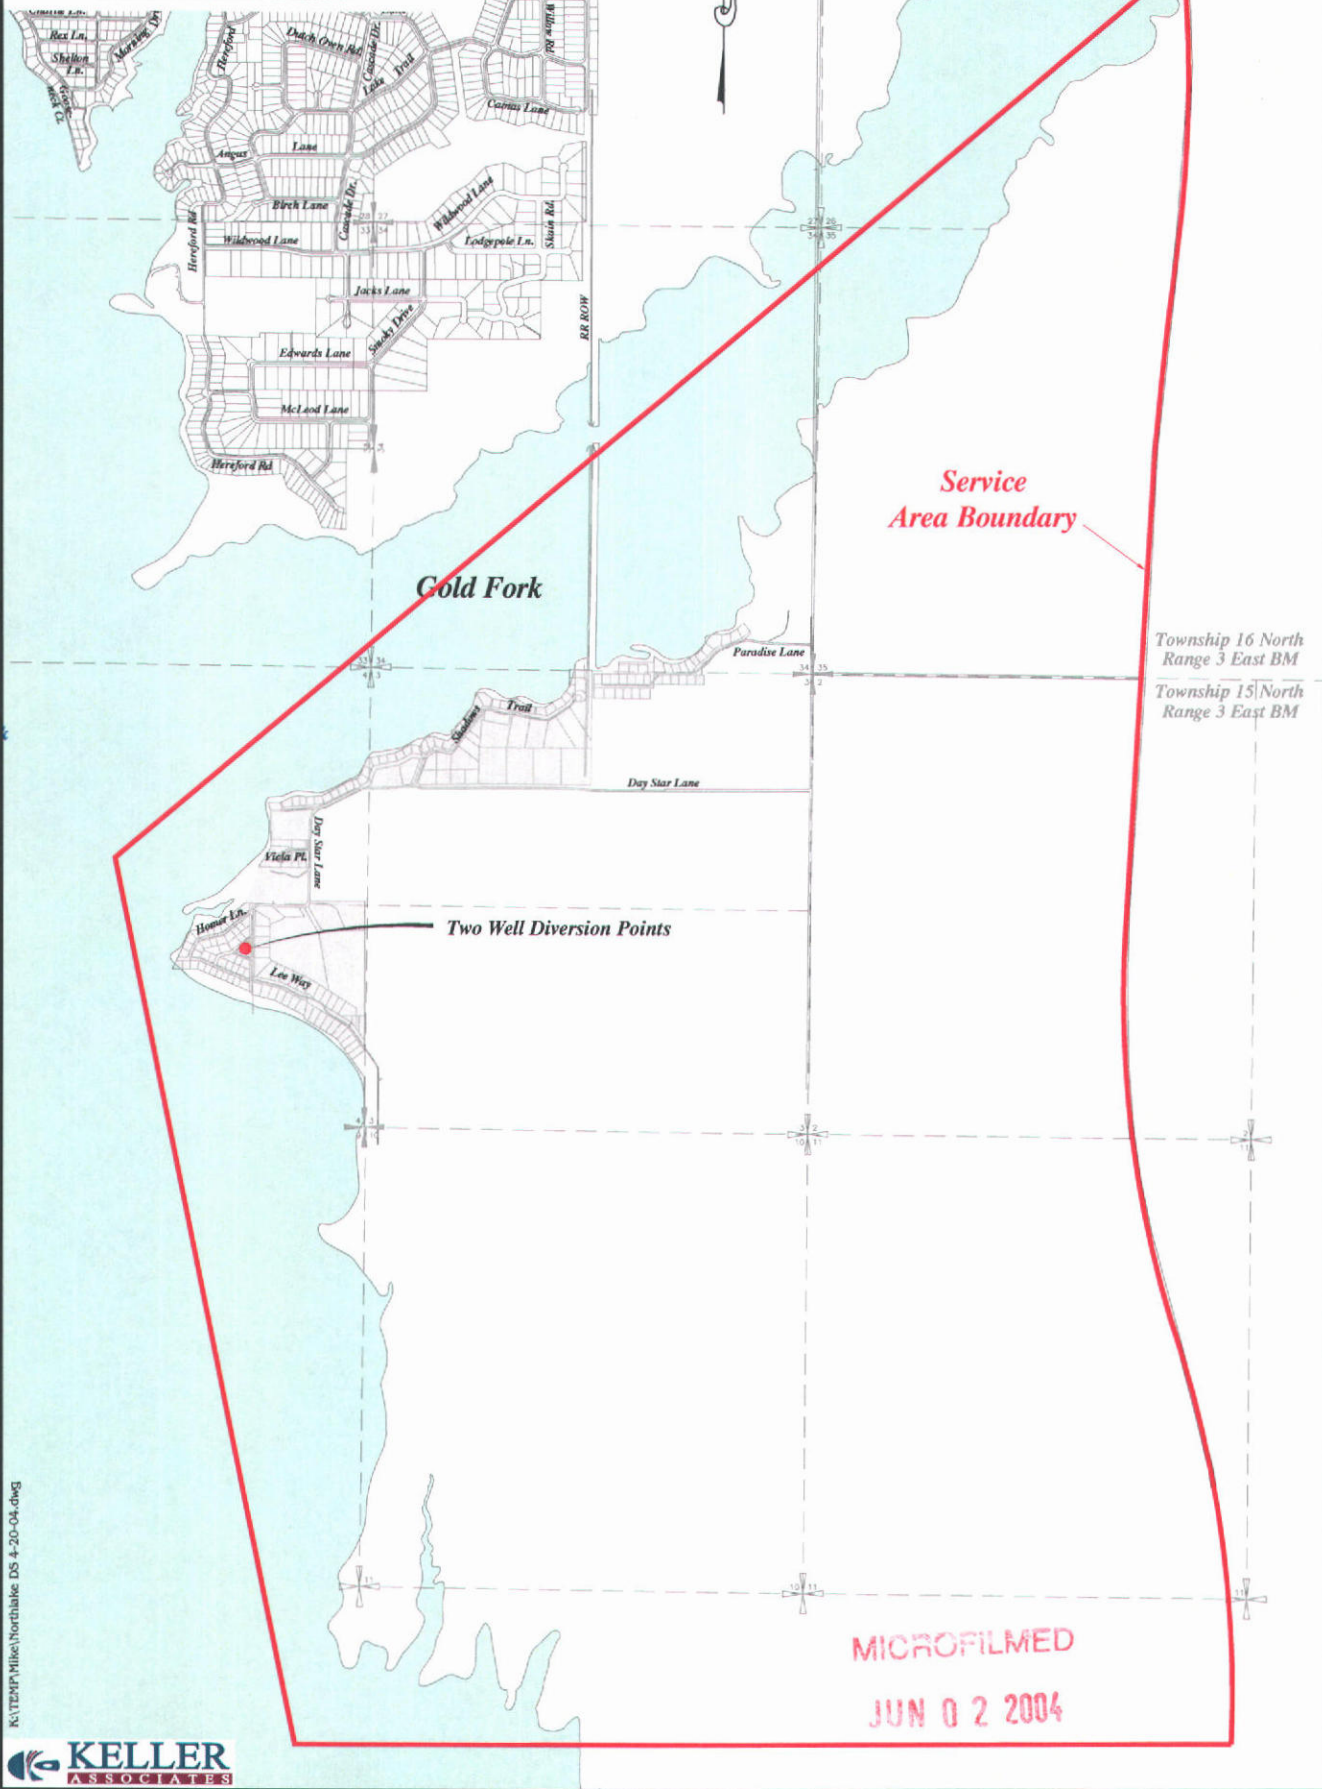

K:\TEMP\Mike\Northlake DS 4-20-04.dwg

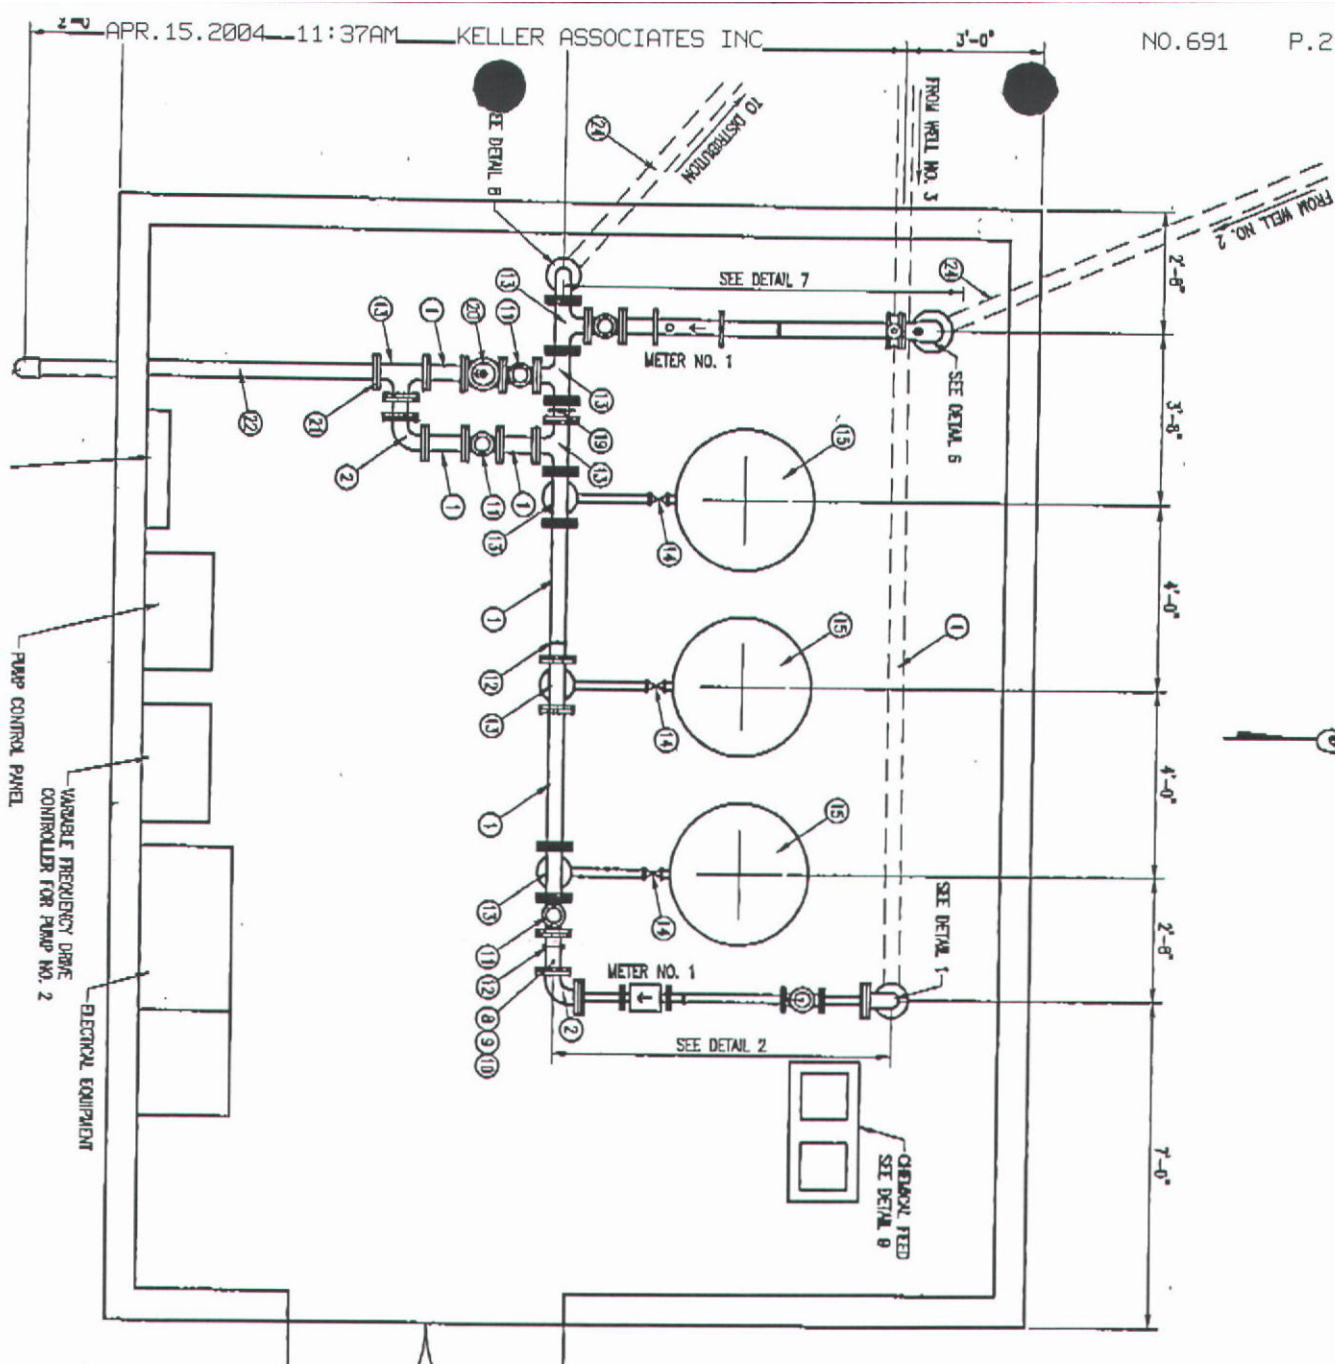

KEYNOTES

- ① 4 INCH DUCTILE IRON PIPE
- ② 4 INCH FLANGED DUCTILE IRON ELBOW
- ③ 9 INCH O.D. x 2 INCH THREADED FLANGE
- ④ 2 INCH GALV. STEEL PIPE
- ⑤ 2 INCH THREADED FLANGE
- ⑥ 2 INCH PRESSURE REDUCING VALVE WITH CHECK FEATURE (GLA-VVL 90-01 GLOBE PATTERN WITH FLANGED ENDS)
- ⑦ 2 INCH MAGNETIC FLOWMETER (WATER SPECIQUES MODEL UA-06 WITH INTERNALLY MOUNTED ELECTRONICS AND GROUNDING PINS)
- ⑧ 3/4 INCH TAPPING SADE
- ⑨ 3/4 INCH CORROSION STOP
- ⑩ CHEMICAL FEED
- ⑪ 4 INCH IRON GATE VALVE, OS & Y WITH FLANGED ENDS
- ⑫ PIPE SUPPORT
- ⑬ 4 INCH FLANGED DUCTILE IRON TEE
- ⑭ 2 INCH IRON GATE VALVE (SEE DETAIL 3)
- ⑮ 300 GALLON HYDROPHORIC TANK (SEE DETAIL 4)
- ⑯ 2 INCH GALV. WELDABLE IRON ELBOW
- ⑰ 2 INCH GALV. WELDABLE IRON UNION
- ⑱ GALV. STEEL NIPPLE TO FIT TANK OUTLET
- ⑲ PRESSURE CONTROL DEVICES (SEE DETAIL 5)
- ⑳ 4" PRESSURE RELIEF VALVE (GLA-VVL 90-01 GLOBE PATTERN WITH FLANGED ENDS)
- ㉑ 4" SLIP ON STEEL FLANGE
- ㉒ 4-1/2" O.D. STEEL PIPE
- ㉓ 4" FORGED STEEL 45 BEND (MOUNTED TURNED DOWN)
- ㉔ 6" DUCTILE IRON PIPE
- ㉕ 3/4" SMOOTH NOSE BEND
- ㉖ 6"x4" FLANGED REDUCING BEND
- ㉗ 4" CHECK VALVE (APOD SERIES 300)
- ㉘ 4" FLANGED DUCTILE IRON PIPE
- ㉙ 4" FLANGED TUBE UNITER (WATER SPECIQUES UA-03)
- ㉚ TRANSMITTER (WATER SPECIQUES TR-16)
- ㉛ 6" FLANGE ADAPTER WITH RESTRAINING UCCS
- ㉜ 6" FLANGED BEND
- ㉝ 6" WATER STYLE BUTTERFLY VALVE WITH HANDWHEEL OPERATOR
- ㉞ 4" FLANGE ADAPTER WITH RESTRAINING UCCS
- ㉟ 1/2" BRASS STOPCOCK TAPPED INTO TOP OF FITTING WITH OUTLET TURNED DOWN AND SCREEN OVER OUTLET

MICROFILMED

JUN 02 2004

FNUV - AG/HI Flow Division
BOB RANDALLGoulds Turbine Pump Selection ver. 5.042
07/23/02PUMP DATA SHEET
Goulds Turbine 60 Hz

Selection file: (untitled)

Catalog: TURB60.MPC v 1.6.1

Curve: E3039-2



Design Point: Flow: 450 US gpm
Head: 175 ftFluid: Water Temperature: 60 °F
SG: 1Pump: TURBINE - 3500 Size: 7CHC, (2 stages)
Speed: 3450 rpm Dia: 4.875 inViscosity: 1.122 cP
Vapor pressure: 0.2568 psi_a
Atm pressure: 14.7 psi_aLimits: Temperature: — °F Sphere size: 0.43 in
Pressure: 415 psi_g Power: — bhp

NPSHa: — ft

Specific Speed: Ns: 2300 Nss: —

Piping: System: —
Suction: — in
Discharge: — inVertical Turbine: Bowl Size: 7.13 in Max Lateral: 0.5 in
Thrust K Factor: 3.5Motor: 30 hp Speed: 3600 Frame: 286TS
NEMA Standard TEFC Enclosure
sized for Max Power on Design Curve

Suction Size-5" Discharge Sizes-5", 6"

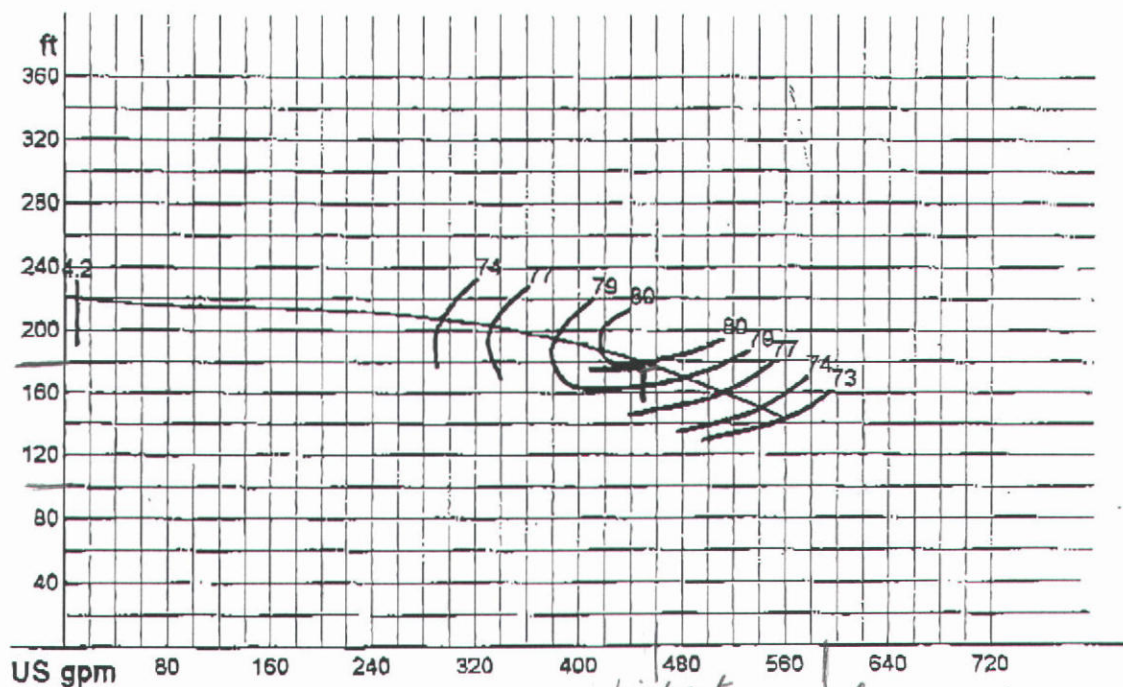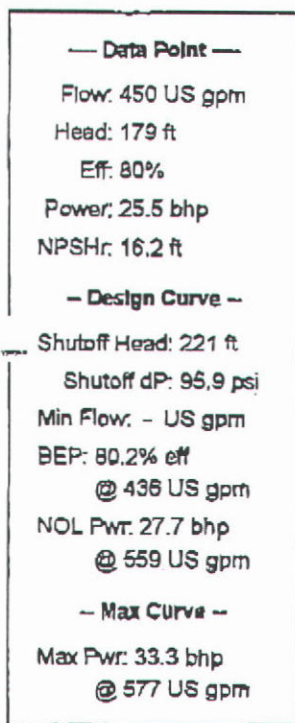

— PERFORMANCE EVALUATION —


Flow US gpm	Speed rpm	Head ft	Pump %eff	Power bhp	NPSHr ft	Motor %eff	Motor KW	Hrs/yr	Cost kWh
540	3450	150	74.2	27.6	22.4				
450	3450	179	80	25.5	16.2				
360	3450	198	78.1	23	13.2				
270	3450	208	68	20.2	12				
180	3450	213	45.9	17.8	12				

MICROFILMED

JUN 9 2 2004

well #3
T-44

Submersible Turbine Model 6TP-175

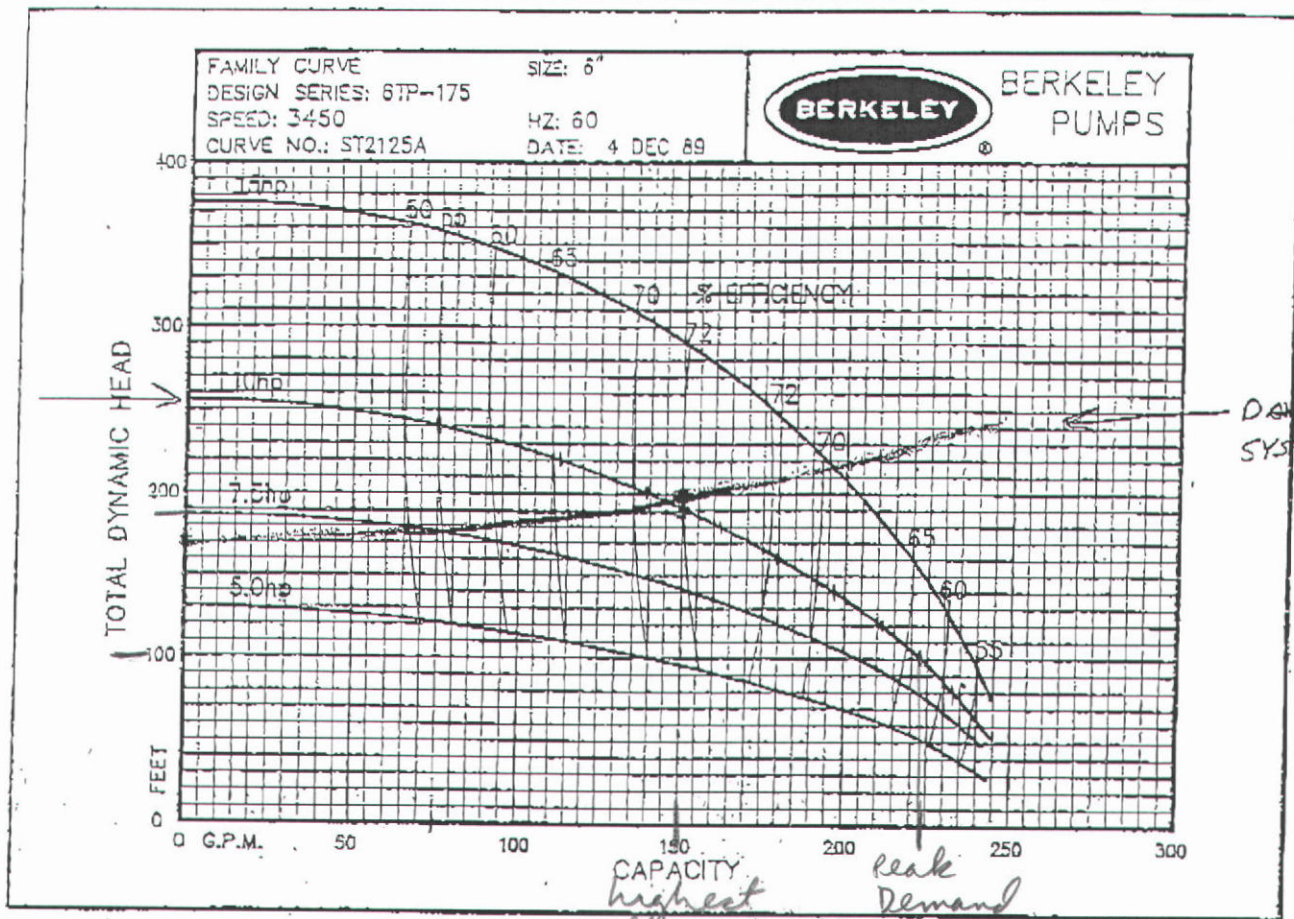

Specifications

LIQUID END WEIGHTS


DESCRIPTION	WEIGHT LBS.	HP RATING	MOTOR FLANGE
ONE STAGE L.E.	52.0	5-15	6"
ONE STAGE L.E.			
ONE STAGE L.E.			
EACH ADDED STAGE	15.0	ALL	ALL

CURVE No. ST2125A

IMPELLER DATA

TYPE: ENCLOSED EYE AREA 3.45 Sq. in.
THRUST CONSTANT K 1.88 Lbs./Ft of HEAD.

HP	IMPELLER No.	STAGES	IMPELLER Dia.
15	M06643	6	4.44"
10	M06643	4	4.44"
7.5	M06643	3	4.44"
5.0	M06643	2	4.44"

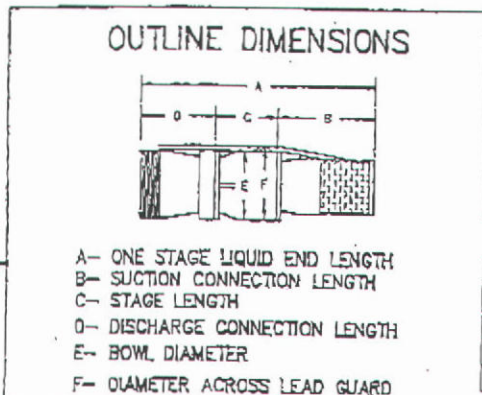

BOWL DATA

BOWL No. M06636 PUMP SHAFT Dia. 3/4"
TYPE: THREADED DISCHARGE SIZE 3" NPT (Female)
4" NPT (Male)

NOTE: For each additional stage add 'C'

A	B	C	D	E	F	HP RATING	MOTOR FLANGE
19.63	11.00	5.00	3.63	5.38	5.81	5-15	6"

MICROFILMED

02 2004

REVISED 15 May 90



KELLER ASSOCIATES


☒ Meridian Office
131 SW 5th Avenue, Suite A
Meridian, Idaho 83642
(208) 288-1992

☐ Pocatello Office
412 W Center, Suite 330
Pocatello, Idaho 83204
(208) 238-2146

Project Name: Day Star Water

Calculated By: M.K. A Date: 4/15/04

Project No. 100074 Sheet: 2 of 3

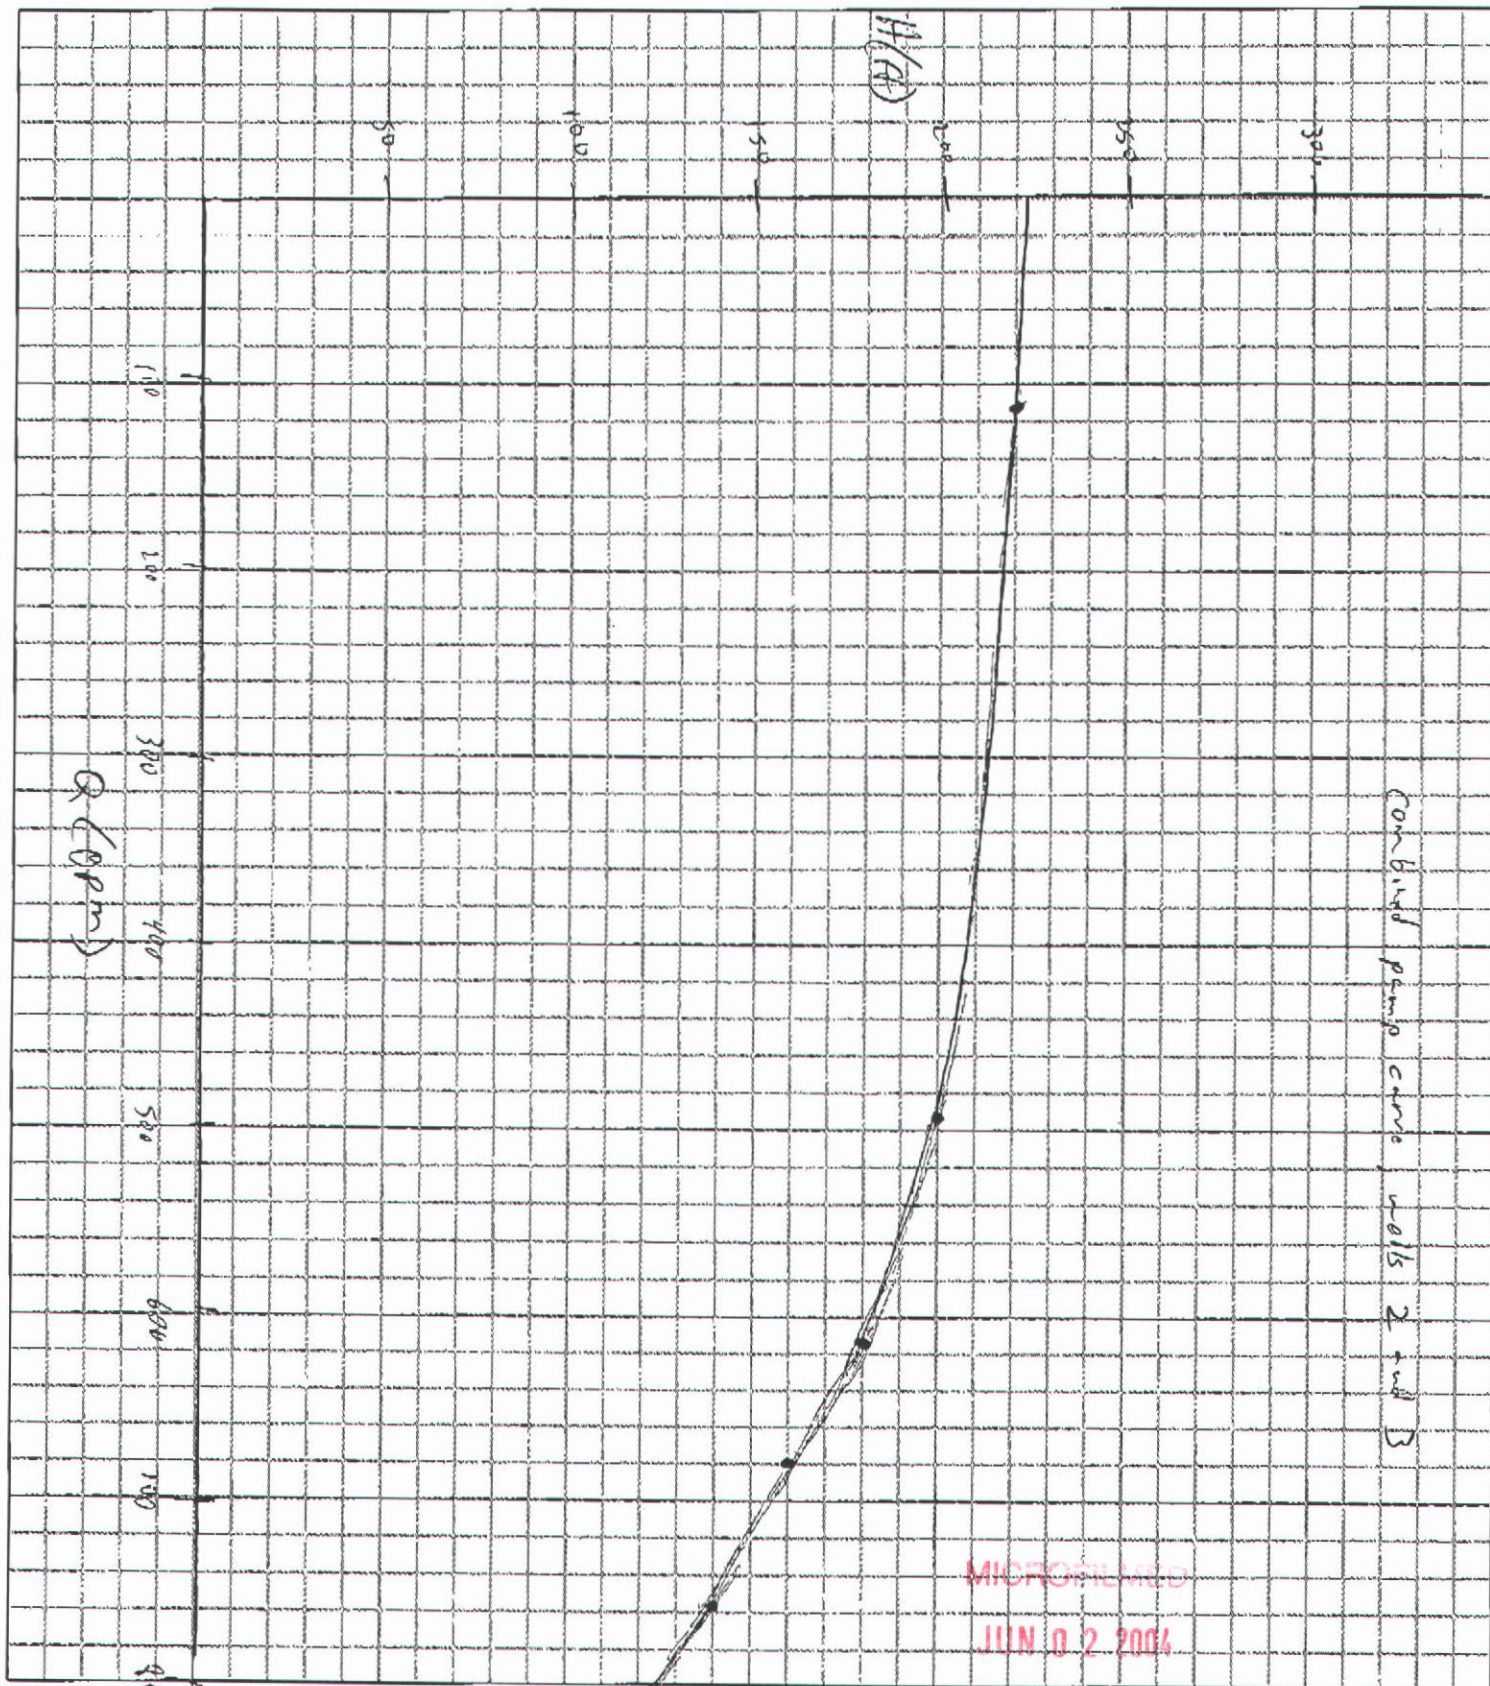



KELLER ASSOCIATES

☒ Meridian Office

131 SW 5th Avenue, Suite A
Meridian, Idaho 83642
(208) 288-1992

☐ Pocatello Office

412 W Center, Suite 330
Pocatello, Idaho 83204
(208) 238-2146

Project Name:

Day Star water

Calculated By:

Mike A

Date: 4/15/04

Project No.

100074

Sheet:

3 of 3

Energy Equation

$$\frac{P_1}{\gamma} + z_1 + \frac{V_1^2}{2g} = \frac{P_2}{\gamma} + z_2 + \frac{V_2^2}{2g} + h_f$$

$$P_1 = 0$$

$$z_1 = 0$$

$$\frac{V_1^2}{2g} - \frac{V_2^2}{2g} \approx 0$$


$$0 = \frac{40 \text{ psi}}{\gamma} + z_2 + h_f$$

$$h_f \approx 5 \text{ ft}$$

$$\frac{40 \text{ psi} - 10 \text{ psi}}{\gamma} + \frac{1 \text{ ft}^2}{62.4 \text{ lb}} - \frac{12 \text{ ft}^2}{62.4 \text{ lb}} = 92 \text{ ft}$$

$$0 = 92 \text{ ft} + z_2 + 5 \text{ ft}$$

$$z_2 = 97 \text{ ft}$$

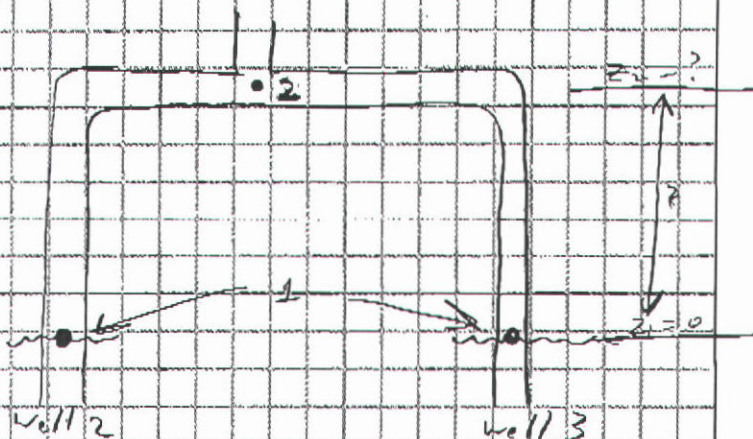

* Assume equal water pumping level
- wells are 20' apart

- So pumping water level is around 93 below ground at 40 psi in pump building.
- Therefore, combined pumping head is around 93 ft of elevation head plus around 5 ft of friction head for a total of 98 ft combined head.
- From combined pump curve, system can deliver around 830 gpm at 100 feet of head.

MICROFILMED

JUN 2 2004



10" WELL #2
25 HP SUB. PUMP

well 2 + 3 are 20' apart
Both located in the NENWSE 54
T15N R3E


AKA Lot 47, ARROWHEAD Pt. SUB.



10" WELL #3
10 HP SUB. PUMP

MICROFILMED 3 18 '04
JUN 02 2004

3 storage Tanks
300 gal/ea

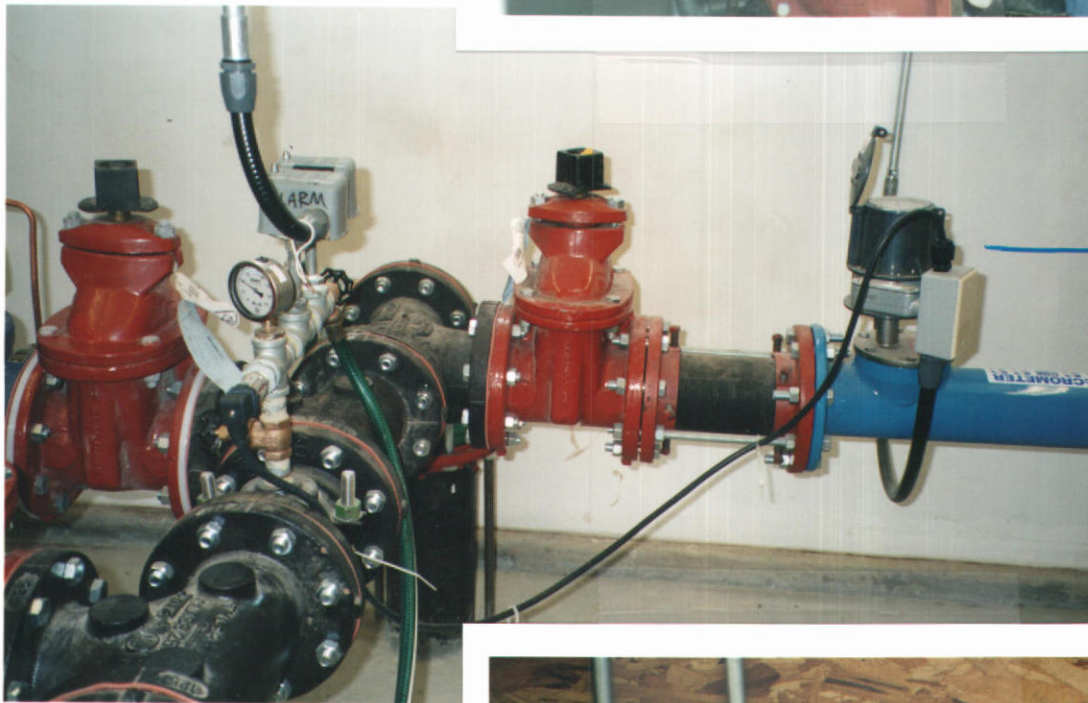


McCrometers
Flowmeter for
Fire hydrants

(McCrometers
Ultra Mag Meters
for domestic)

Pump Control
Panel

JUN 02 2004

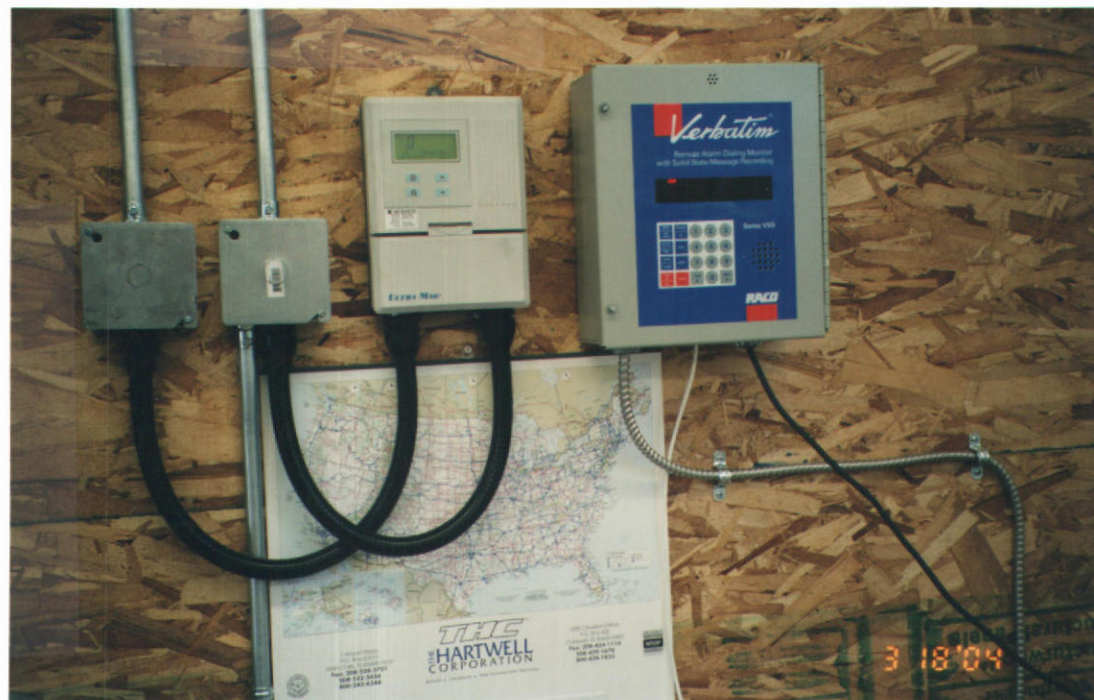

L L E

gov't lot except
 $5\frac{1}{2}$ NE $\frac{1}{4}$ & SE $\frac{1}{4}$.
normal size QCR street

SE cor of 90 N & W cont: 1
encounter gov't lots. Most
of N $\frac{1}{2}$ N $\frac{1}{2}$ includes QCR
4335-T. > 40 acres in size.

25- 20/11/2012

RESERVOIR
65-2927

Amendment Appl. 70300
Permit 65-22358

Microfilm
JUN 02 2004

12/11/02

① get changes ok-ed on orig.
title of signer = District Administrator
per other doc. RBW

② W/flow / L notice problems ... get info to SK in
cc of Regl. website

also - ① Remarks tab & d'entry ... did not RESET
to show purpose of amendment (maybe
because a pld to QA when already have
1 pld? nothing happened w/ RESET button).

② Applicant tab ... what is purpose of
"Copy Application" button?

Steve
Rob. Has the
Drilling Permit
ABandonment
& well Spec.

✓ get a connect. letter for file (RBW) ...
✓ send d'entry & Y & Com. ✓
e pld ✓
e comments ✓

MICROFILMED

JUN 02 2004

IDAHO DEPARTMENT OF WATER RESOURCES

Water Permit Report 65-22358

WATER RIGHT NUMBER: 65-22358

Owner TypeName and Address

Current Owner

NORTH LAKE RECREATIONAL SEWER & WATER DIST
PO BOX 729
DONNELLY, ID 83615

Priority Date: 04/05/2001

Basis:

Status: Active

SourceTributary

GROUND WATER

Beneficial UseFrom ToDiversion RateAnnual Volume

MUNICIPAL

01/01 to 12/31

2.000 CFS

Total Diversion:

2.000 CFS

Location of Point(s) of Diversion

GROUND WATER

VALLEY County

L3 SE1/4NE1/4NW1/4

Sec. 3,

Twp 15N, Rge 03E, B.M.

GROUND WATER

VALLEY County

NE1/4NW1/4SE1/4

Sec. 4,

Twp 15N, Rge 03E, B.M.

Place of UseConditions of Approval:

1. 004 The issuance of this right does not grant any right-of-way or easement across the land of another.
2. 01M After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to determine the amount of water diverted from power records and shall annually report the information to the Department.
3. 102 The right holder shall not provide water diverted under this right for the irrigation of land having appurtenant surface water rights as a primary source of irrigation water except when the surface water rights are not available for use. This condition applies to all land with appurtenant surface water rights, including land converted from irrigated agricultural use to other land uses but still requiring water to irrigate lawns and landscaping.

Remarks:

1. Place of use is within the service area of North Lake Recreational Sewer & Water District.
2. General Points of diversion are located within Lots 1 and 2, Blk. 1, Mountain Shadows #4 and Lot 47, Arrowhead Point Cottage Sites.

Comments:

MICROFILMED

JUN 02 2004

Dates and Other Information:

REVIEWER'S notes 12/11/02

65-22358-....
only P/O
Rec'd c
g.w. in the
5-ft

P/D g.w. 15N 3E S4 N6S6

8/5/02

orig = 15N 3E S4

Sequence Number	BASIN	Sequence Number	Basis	Status	Priority Date	RATE	Source List	Water Use List	Owner List	Source To Application
65	9624	Decreed	Active	6/1/1968	0.28	GROUND WATER	DOMESTIC	ARROWHEAD POINT PROPERTY ASSN (Current Owner)	BARTON, DAVID M (Current); BARTON, DOROTHY L (Current)	wrAdjudicationClaim
65	17155	Beneficial Use	Active	9/10/1972	0.04	GROUND WATER	DOMESTIC	STEWART, CAROL C (Current); STEWART, CHARLES R (Current)	BARTON, DAVID M (Current); BARTON, DOROTHY L (Current)	wrAdjudicationClaim
65	17186	Beneficial Use	Active	9/10/1969	0.04	GROUND WATER	DOMESTIC	STEWART, CAROL C (Current); STEWART, CHARLES R (Current)	BARTON, DAVID M (Current); BARTON, DOROTHY L (Current)	wrAdjudicationClaim
65	17155	Beneficial Use	Active	10/19/1977	0.04	GROUND WATER	DOMESTIC	STEWART, CAROL C (Current); STEWART, CHARLES R (Current)	BARTON, DAVID M (Current); BARTON, DOROTHY L (Current)	wrAdjudicationRecommendation
65	17186	Beneficial Use	Active	10/19/1977	0.04	GROUND WATER	DOMESTIC	STEWART, CAROL C (Current); STEWART, CHARLES R (Current)	BARTON, DAVID M (Current); BARTON, DOROTHY L (Current)	wrAdjudicationRecommendation
65	7837	Decreed	Active	2/28/1977	0.2	GROUND WATER	DOMESTIC	GLENDORA AND MOUNTAIN SHADOWS NO 3 SUB (Current)	WOODALL, JOANNE P (Current); WOODALL, JOSEPH I (Current)	wrWaterRight
65	17064	Decreed	Active	10/19/1977	0.04	GROUND WATER	DOMESTIC	WOODALL, JOANNE P (Current); WOODALL, JOSEPH I (Current)	WOODALL, JOANNE P (Current); WOODALL, JOSEPH I (Current)	wrWaterRight

orig

older w
wskl 1336
wskl just
per 1994

MICROFILMED
JUN 02 2004

older well previously used just for 1994, etc
used just for 1994, etc
used just for 1994, etc

BASIN	Sequence Number	Basis	Status	Priority Date	RATE	Source List	Water Use List	Owner List	Source Ta Application
65	17419	Decreed	Active	10/19/1977	0.04	GROUND WATER	DOMESTIC	CRIM, JOHN W (Current); CRIM, SHARON (Current); FISHER, ANN (Current); FISHER, BUDDY R (Current)	wrWaterRight
65	17508	Decreed	Active	10/19/1977	0.04	GROUND WATER	DOMESTIC	GUYER, DALE H (Current); GUYER, DONNA M (Current)	wrWaterRight
65	13361		Active	3/6/1992	0.29	GROUND WATER	DOMESTIC	ARROWHEAD POINT SUBD HOMES ASSN (Current Owner)	wrWaterPermit

MICROFILMED
JUN 02 2004

we will
not be
fixed
1995

P/O g.w. 15W 36 5.4 NWSE 8/5/02

Sequence Number	BASIN	Sequence Number	Basis	Status	Priority Date	RATE	Source List	Water Use List	Owner List	Source To Application
65	17155	17155	Beneficial Use	Active	9/10/1972	0.04	GROUND WATER	DOMESTIC	BARTON, DAVID M (Current); BARTON, DOROTHY L (Current)	wrAdjudicationClaim
65	17186	17186	Beneficial Use	Active	9/10/1969	0.04	GROUND WATER	DOMESTIC	STEWART, CAROL C (Current); STEWART, CHARLES R (Current)	wrAdjudicationClaim
65	17155	17155	Beneficial Use	Active	10/19/1977	0.04	GROUND WATER	DOMESTIC	BARTON, DAVID M (Current); BARTON, DOROTHY L (Current)	wrAdjudicationRecommendation
65	17186	17186	Beneficial Use	Active	10/19/1977	0.04	GROUND WATER	DOMESTIC	STEWART, CAROL C (Current); STEWART, CHARLES R (Current)	wrAdjudicationRecommendation

MICROFILMED
JUN 02 2004

BASIN	Sequence Number	Basis	Status	Priority Date	RATE	Source List	Water Use List	Owner List	Source Ta Application
65	13361		Active	3/6/1992	0.29	GROUND WATER	DOMESTIC	ARROWHEAD POINT SUBD HOMES ASSN (Current Owner)	wrWaterPermit
65	13574		Active	12/16/1994	0.12	GROUND WATER	DOMESTIC	ARROWHEAD POINT SUBD HOMES ASSN (Current Owner)	wrWaterPermit
65	22358		Active	4/5/2001	2	GROUND WATER	MUNICIPAL	NORTH LAKE RECREATIONAL SEWER & WATER DIST (Current)	wrWaterPermit

PER 1994-1995
 completed info
 1991 well now 5.4
 6.47 for considered
 10/45 e AP 5-666
 JUN 02 2007
 MICROFILM

The map shows a subdivision along the shore of Lake Cascade. Key features include:

- Township and Range Information:** Township 16 North, Range 3 East BM; Township 15 North, Range 3 East BM.
- Survey Points:** Numerous points are marked with numbers (e.g., 32, 33, 34, 4, 5, 8, 9, 10, 11) and symbols (crosses, circles).
- Handwritten Notes:**
 - "Diversion Point in existing permit. Remove for permit amendment application."
 - "One diversion point in existing permit. Add a second diversion point in permit amendment application."
- Lot 47:** A specific lot is identified with an arrow pointing to it.
- Arrowhead Point Subdivision:** Labeled with an arrow pointing to the area.
- LAKE CASCADE:** Labeled vertically on the left side.
- Stamp:** "MICROFILMED JUN 8 2 2004"

The map shows a subdivision along the shore of Lake Cascade. Key features include:

- Township and Range Information:** Township 16 North, Range 3 East BM; Township 15 North, Range 3 East BM.
- Survey Points:** Numerous points are marked with numbers (e.g., 32, 33, 34, 4, 5, 8, 9, 10, 11) and symbols (crosses, circles).
- Handwritten Notes:**
 - "Diversion Point in existing permit. Remove for permit amendment application."
 - "One diversion point in existing permit. Add a second diversion point in permit amendment application."
- Lot 47:** A specific lot is identified with an arrow pointing to it.
- Arrowhead Point Subdivision:** Labeled with an arrow pointing to the shoreline area.
- LAKE CASCADE:** The large body of water on the left side of the map.
- Microfilm Date:** JUN 8 2 2004.

[illegible]

LAKE CASCADE

Arrowhead Point Subdivision

Lot 47

One diversion point in existing permit.
Add a second diversion point in permit amendment application.

← Diversion Point in existing permit.
Remove for permit amendment application.

Township 16 North
Range 3 East BM

Township 15 North
Range 3 East BM

32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

MICROFILMED
JUN 02 2004

LAKE CASCADE

Arrowhead Point Subdivision

Lot 47

One diversion point in existing permit.
Add a second diversion point in permit amendment application.

← Diversion Point in existing permit.
Remove for permit amendment application.

Township 16 North
Range 3 East BM

Township 15 North
Range 3 East BM

32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

MICROFILMED
JUN 8 2 2004

LAKE CASCADE

Arrowhead Point Subdivision

Lot 47

One diversion point in existing permit.
Add a second diversion point in permit amendment application.

← Diversion Point in existing permit.
Remove for permit amendment application.

Township 16 North
Range 3 East BM

Township 15 North
Range 3 East BM

32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

MICROFILMED
JUN 8 2 2004

[illegible]

LAKE CASCADE

Arrowhead Point Subdivision

Lot 47

One diversion point in existing permit.
Add a second diversion point in permit amendment application.

← Diversion Point in existing permit.
Remove for permit amendment application.

Township 16 North
Range 3 East BM

Township 15 North
Range 3 East BM

32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

MICROFILMED
JUN 8 2 2004

Publisher's Affidavit of Publication

STATE OF IDAHO

} .ss

County of Valley

I, Carol J. Wright, being duly sworn and say, I am the receptionist of The Star-News, a weekly newspaper published at McCall, in the County of Valley, State of Idaho; that said newspaper is in general circulation in the county of afore said and is a legal newspaper; that the PUBLIC NOTICE, a copy of which is enclosed hereto and is a part hereof, was published in said newspaper once a week for a period of two weeks in the regular and entire issue of every number there of during the period of time of publication, and was published in the newspaper proper and not in a supplement; and that publication of such notice began December 19, 2002 and ended December 26, 2002.

Carol J. Wright

Subscribed and sworn before me this the 26th day of December, 2002.
STATE OF IDAHO

COUNTY OF VALLEY

}

On this 26th day of December, in the year of 2002, before me, a Notary Public, personally appeared Carol J. Wright, known or identified to me to be the person whose name subscribed to the within instrument, and being by me first duly sworn, declared that the statements therein are true, and acknowledged to me that she executed the same.

MICROFILMED
JUN 02 2004



Tom Grote
Notary Public for Idaho
Residing at McCall, Idaho
Commission Expires 2/8/06

NOTICE OF APPLICATION FOR AMENDMENT OF WATER PERMIT

North Lake Recreational Sewer & Water District of PO Box 729, Donnelly ID 83615 has applied to the Department of Water Resources to change the point of diversion pursuant to I.C. § 42-211 for the following ground water permit in T15N R3E, Valley County:

65-22358, priority 4-5-2001, two wells authorized in SENENW S3 (Mt. Shadows #4) and NENWSE S4 (Arrowhead Point Cottage Sites) for 2.0 cfs year around municipal use in district service area. The permit authorizes one well per subdivision site.

Proposed Amendment: drill a second well in Arrowhead Point site instead of Mt. Shadows site. Both wells will be in Lot 47 of Arrowhead Point site.

The permit will be subject to all prior water rights. Any protest against approval of the proposed amendment must be filed with the Department of Water Resources, Western Region, 2735 Airport Way, Boise, ID 83705-5082, together with a protest fee of \$25 for each

application on or before January 6, 2003. The protestant must also send a copy of the protest to the applicant.

Karl J. Dreher, Director 2tc12/26

04/11/2001

IDAHO DEPARTMENT OF WATER RESOURCES
Water Application Report

WATER RIGHT NO. 65-22358

<u>Owner Type</u>	<u>Name and Address</u>
Current Owner	NORTH LAKE RECREATIONAL SEWER & WATER DISTRICT PO BOX 729 DONNELLY, ID 83615

Priority Date: 04/05/2001
Status: Active

<u>Source</u>	<u>Tributary to</u>
GROUND WATER	

<u>Beneficial Use</u>	<u>From</u>	<u>To</u>	<u>Diversion Rate</u>	<u>Volume</u>	<u>Subuse Code</u>
MUNICIPAL	01/01	12/31	2 CFS		
Total Diversion			2 CFS		

Location of Point(s) of Diversion:

GROUND WATER	SENENW Lt 3	Sec. 03	Township 15N	Range 03E	VALLEY County
GROUND WATER	NENWSE	Sec. 04	Township 15N	Range 03E	VALLEY County

Place(s) of use: No POUs found for this right

Comments:

<u>Author</u>	<u>Date</u>	<u>Subject</u>	<u>Comment</u>
dnelson	4/11/01 11:48:30 AM	General Comments/Analysis	This application is for the current municipal needs of North Lake Recreational Sewer & Water District. The applicants have been the municipal provider to various subdivisions in the area for sewer and garbage collection for some time. They have now been asked by their customers to supply and maintain the water systems for several subdivisions. Please see service area map attached to the application to show all of the area that the District services. The District will be filing transfers on water rights 65-7837, 65-12115, and 65-7683 to incorporate them into their municipal system. Some of the remaining subdivisions will retain their own water rights for their homeowners associations within the borders of the district, but most will use the Districts services to maintain the wells. The well in Section 4 will be co-owned by the District and Arrowhead Point Homeowners Association. They have decided to retain possession of their water right 65-13361, but want to share the maintenance cost of the well with the District. The District plans to use this well as a backup well.
dnelson	4/11/01 11:48:30 AM	Legal Notice Remarks	Applicant agrees to mitigate consumptive use in the future as needed. Municipal use is for applicants service area

Dates:

Date Application Received:	04/05/2001
Date Application Denied:	
Last Date of Beneficial Use:	
Extension End Date:	
Protest Deadline Date:	
Number of Protests:	0
Enlargement Use Priority Date:	
Enlargement Statute Priority Date:	

Water Right 65-22358

State of Idaho
Department of Water Resources
Water Right License

WATER RIGHT NO. 65-22358

Priority: April 05, 2001

Maximum Diversion Rate. 1.85 CFS

It is hereby certified that NORTH LAKE RECREATIONAL SEWER & WATER DIST
PO BOX 729
DONNELLY ID 83615 has complied with the terms and
conditions of the permit, issued pursuant to Application for Permit dated April 05, 2001; and has
submitted Proof of Beneficial Use on June 20, 2003. An examination indicates that the works have a
diversion capacity of 1.85 cfs of water from:

SOURCE

GROUND WATER

and a water right has been established as follows

BENEFICIAL USE

MUNICIPAL

PERIOD OF USE

01/01 to 12/31

DIVERSION RATE

1.85 CFS

LOCATION OF POINTS OF DIVERSION:

GROUND WATER NE $\frac{1}{4}$ NW $\frac{1}{4}$ SE $\frac{1}{4}$ Sec 4, Twp 15N, Rge 03E, B.M., VALLEY County

GROUND WATER NE $\frac{1}{4}$ NW $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 4, Twp 15N, Rge 03E, B.M., VALLEY County

CONDITIONS OF APPROVAL

- 1 Points of diversion are located within Lots 1 and 2, Blk 1, Mountain Shadows Subdivision No. 4
- 2 Place of use is within the service area of North Lake Recreational Sewer & Water District as provided for under Idaho law. The place of use is generally located within Sections 2, 3, 4, 9, 10, and 11, Township 15N, Range 3E; Sections 26, 34 and 35, Township 16N, Range 3E
- 3 The issuance of this right does not grant any right-of-way or easement across the land of another.
- 4 After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to determine the amount of water diverted from power records and shall annually report the information to the Department.
- 5 The right holder shall not provide water diverted under this right for the irrigation of land having appurtenant surface water rights as a primary source of irrigation water except when the surface water rights are not available for use. This condition applies to all land with appurtenant surface water rights, including land converted from irrigated agricultural use to other land uses but still requiring water to irrigate lawns and landscaping

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. The water right confirmed by this license is subject to all prior water rights and shall be used in accordance with Idaho law and applicable rules of the Department of Water Resources

Signed and sealed this 10th day of May, 2004.

MICROFILMED

JUN 02 2004

[Signature]
for KARL J. DREHER
Director

(Internet)

RECEIVED

JUL 10 2002

Receipt No 4029688
 Received By KB
 Date 9/10/02

WATER RESOURCES WESTERN REGION

STATE OF IDAHO WESTE

DEPARTMENT OF WATER RESOURCES

RECEIVED

APPLICATION FOR AMENDMENT OF A PERMIT

APR 30 2004

Department of Water Resources

Applicant Northlake Recreational Sewer & Water District Phone (208) 325-8958

Address P.O. Box 729, Donnelly, ID 83615

I am the owner and holder of Permit to appropriate the Public Waters of the State of Idaho No. 65-22358, and request that the permit and permit map be amended and/or changed as follows:

Purpose of Amendment: X Change point of diversion _____ Add point of diversion
Change place of use Change nature of use Change period of use Other _____

1. Point of diversion: NE 1/4 NW 1/4 SE 1/4, Section 4, Township 15N, Range 3E, B.M.,
County of Valley. Other points of diversion Same location for the second point of
diversion as the first point of diversion.

2. Period and nature of use: (Irrigation, domestic, stockwatering, industrial, etc.)

Amount \$1.85 for Municipal purposes from 1/1 to 12/31 (both dates inclusive)
(rate per acre foot per annum) (water use) (Begin month) (End month)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre feet per annum) (water use) (Begin month) (End month)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre feet per annum) (water use) (Begin month) (End month)

3. Place of use or land to be irrigated:

[illegible]

Total number of acres to be irrigated =

4. a. Who owns the property at the point of diversion? North Lake Recreational Sewer & Water District
b. Who owns the land to be irrigated at the place of use? District Homeowner Members
c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: Applicant operates system for members

*per field exam - kw
4/5/02-298 dlc 5/7/04

MILANO, 22 MARZO

2006

See Attached Figure

Complete the following map by showing land and point of diversion as proposed by this amendment.

Show 1/4 1/4, section, township, range and ditches. (the smallest subdivision represents 40 acres)

Scale 2 inches equal 1 mile

I hereby request approval of this change subject to the fact that no one will be injured by the change, and that the change will be made at my own risk.

Signed this 25th day of JUNE, 2002.

Bill Eddy
District Administrator

ACTION OF THE DEPARTMENT OF WATER RESOURCES

Preliminary check by PL Publication prepared by _____ Date _____

Published in STAR NEWS 1-14-03 LMPublication dates 12-19 + 26-02

I, KARL J. DREHER, of the Department of Water Resources hereby
APPROVE the above Application for Amendment for Permit No. 65-22358.

Witness my hand this 10th day of May, 2004.

MICROFILMED

JUN 22 2004

Karl J. Dreher
for KARL J. DREHER, DIRECTOR

BEFORE THE DEPARTMENT OF WATER RESOURCES
OF THE STATE OF IDAHO

IN THE MATTER OF PERMIT NO.)
65-22358 IN THE NAME OF)
NORTH LAKE RECREATIONAL)
SEWER & WATER DISTRICT)
_____)

REINSTATEMENT ORDER

WHEREAS, the Department issued the above-captioned permit with the condition that proof of construction of works and application of water to beneficial use (proof of beneficial use) be submitted to the Department on or before July 1, 2002; and

WHEREAS, the Department granted the permit holder one extension of time for filing the proof of beneficial use for this permit, extending the proof of beneficial use deadline to July 1, 2003, and,


WHEREAS, the Department notified the permit holder on March 31, 2003, by certified mail that proof of beneficial use was due and instructed the permit holder of the steps to be taken to submit the proof of beneficial use or an extension of time request; and

WHEREAS, the Department inadvertently sent the permit holder a lapse notice on June 5, 2003, since the department had not received an acceptable proof of beneficial use statement or extension of time request; and

WHEREAS, Section 42-218a(3), Idaho Code, provides that the Department may reinstate a permit upon a showing of error or mistake of the department; and,

IT IS, THEREFORE, HEREBY ORDERED that Permit No. 65-22358 is **REINSTATED** with no advance in priority.

DATED this 18th day of July, 2003.

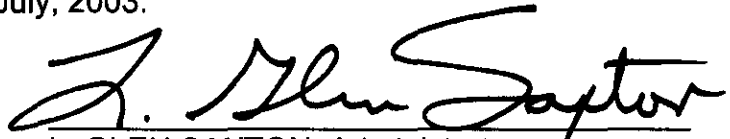
L. GLEN SAXTON, Administrator
Water Management Division

MICROFILMED
SEP 19 2003

RECEIVED

JUN 21 2003

FOR OFFICE USE ONLY
Amt of Fee \$ 125.00
Receipt No. 6069675
Receipt By [Signature]
Date Received 6-20-03

STATE OF IDAHO Department of Water Resources
DEPARTMENT OF WATER RESOURCES

to State office on 10/1/03
PROOF OF BENEFICIAL USE

*P.O. Box 83720
Boise, 83720-0098*

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or be accompanied by a completed field examination report prepared by a certified water right examiner.

- 1 Permit No. 65-22358 Telephone No. 208-325-8958
- 2 Name of Permit Holder(s): NORTH LAKE RECREATIONAL SEWER AND WATER DISTRICT
- 3 Mailing Address: P.O. Box 729
City DONNELLY State ID Zip 83615
- 4 Source of Water. GROUNDWATER If GROUNDWATER (well), Date Drilled: mo. SEPT / yr. 2001
Well Driller. STEVENS & SONS Drilling Permit Number: 785214 & 767090
- 5 Use(s) (as authorized by the water right permit): MUNICIPAL USE
Domestic (No. of households): _____ Stockwater (No. and type of stock): _____
Irrigation (No. of acres): _____ Other: _____
- 6 Total rate of diversion and/or volume for which proof is submitted: 2.0 cfs OR _____ acre-feet
- 7 Measuring Device Requirement (refer to the approval conditions on your permit and respond accordingly)
(This question is not optional Please check either yes or no Proofs returned not checked accordingly, will be considered incomplete)
Measuring Device: Is a measuring device required? Yes X or No _____
Has the measuring device been installed? Yes X or No _____
- 8 Fee Enclosed. \$ 125.00 (See Fee Schedule on back of the instructions for filing proof of beneficial use)
- 9 Person to contact to accompany the Department representative during field examination of the water system.
Name BILL EDDY, DISTRICT ADMINISTRATOR Telephone Number: 208-325-8958
Address 435 SOUTH ELD LANE DONNELLY, ID 83615
- 10 The information given on this form is my true statement of the extent to which the above numbered permit has been developed and water has been diverted. I agree to relinquish any undeveloped portion of the permit to the State of Idaho.
- Signature of permit holder. Bill Eddy Admin. Date: 6-15-03
(include your title, if on behalf of company or organization)

MICROFILMED

SEP 09 2003

RECEIVED

JUN 27 2002

For Office Use Only

\$50 Fee Received by KL

Date 6/25/02

Receipt No. 00029573

RECEIVED

JUN 25 2002

WATER RESOURCES
WESTERN REGION

Department of Water Resources

STATE OF IDAHO

DEPARTMENT OF WATER RESOURCES

REQUEST FOR EXTENSION OF TIME

TO PROVIDE ADDITIONAL TIME IN WHICH TO SUBMIT PROOF OF
BENEFICIAL USE FOR A WATER RIGHT PERMIT

The Idaho Department of Water Resources will consider this form as a request that the permit holder(s) be granted an additional period of time under the provisions of Section 42-204, Idaho Code in which to complete development of a water right.

Permit No. 65-22358

Name(s) of Permit Holder: North Lake Recreational Sewer and Water District

Mailing Address: P.O. Box 729, Donnelly, ID 83615

Date Proof is Due: July 1, 2002 Telephone No. (208) 325-8958

Describe what work has been completed toward the development of this water right:
(This must be filled out! If no work has been completed, show "none".)

One well at Lot 47 Arrowhead Point Cottage sites is complete. A submersible pump is installed and is operational. A sand separator is installed until a permanent rework of the well can be completed.

Costing \$ 90,000

The permit holder(s) has been unable to complete the remainder of the work for the following reasons:

The well that is operating is pumping sand and needs to be reworked before the full productive use can be obtained. Developing a suitable rework plan is currently under way. Drilling a second well is planned to start sometime in July.

Permit holder(s) request an extension to June 1, ~~19~~ 2003.

FEE: \$50.00

Russell V. Zarkusky
(Signature)*

*If other than permit holder, Power of Attorney must be supplied.

ACTION OF THE DEPARTMENT OF WATER RESOURCES

IT IS HEREBY ORDERED that the above request for extension of time be

APPROVED and the time within which to submit proof of beneficial use is extended to July 1, 2003.

Signed this 28th day of June, 2002.

MICROFILMED

JUN 28 2003

L. Glen Saxton

L. GLEN SAXTON, Chief
Water Allocation Bureau

State of Idaho
Department of Water Resources
Permit to Appropriate Water

NO. 65-22358

Priority: 04/05/2001

Maximum Diversion Rate: 2.00 CFS

This is to certify, that NORTH LAKE RECREATIONAL SEWER & WATER DISTRICT
PO BOX 729
DONNELLY ID 83615

has applied for a permit to appropriate water from:

Source: GROUND WATER

and a permit is APPROVED for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
MUNICIPAL	01/01 to 12/31	2.00 CFS


LOCATION OF POINT(S) OF DIVERSION:

GROUND WATER	L3 SE $\frac{1}{4}$ NE $\frac{1}{4}$ NW $\frac{1}{4}$	Sec. 3, Twp 15N, Rge 03E, B.M.	VALLEY County
GROUND WATER	NE $\frac{1}{4}$ NW $\frac{1}{4}$ SE $\frac{1}{4}$	Sec. 4, Twp 15N, Rge 03E, B.M.	VALLEY County

CONDITIONS OF APPROVAL

1. Proof of application of water to beneficial use shall be submitted on or before **July 1, 2002**.
2. Subject to all prior water rights.
3. The issuance of this right does not grant any right-of-way or easement across the land of another.
4. After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to determine the amount of water diverted from power records and shall annually report the information to the Department.
5. The right holder shall not provide water diverted under this right for the irrigation of land having appurtenant surface water rights as a primary source of irrigation water except when the surface water rights are not available for use. This condition applies to all land with appurtenant surface water rights, including land converted from irrigated agricultural use to other land uses but still requiring water to irrigate lawns and landscaping.
6. Points of diversion are located within Lots 1 and 2, Blk. 1, Mountain Shadows #4 and Lot 47, Arrowhead Point Cottage Sites.
7. Place of use is within the service area of North Lake Recreational Sewer & Water District.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code. Witness the signature of the Director, affixed at Boise, this 5th day of July, 2001.

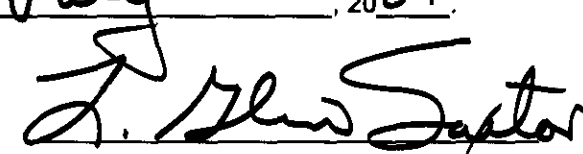
for
KARL J DREHER, Director

MICROFILMED

SEP 19 2001

RECEIVED

Form 202

APR 05 2001

WATER RESOURCES
WESTERN REGION

Ident No 65-22350

APP ID# 69021

STATE OF IDAHO

DEPARTMENT OF WATER RESOURCES

RECEIVED

AMENDED

APPLICATION FOR PERMIT

JUN -4 2001

To appropriate the public water of the State of Idaho

Department of Water Resources

All changes ok per MA. 4/18/01

1. Name of Applicant North Lake Recreational Sewer & Water District Phone (208) 325-9858
Post Office address P.O. Box 729, Donnelly, ID 83615
2. Source of Water Supply Groundwater
3. Location of point of diversion is 15N Range 3E Sec. 3, in the SE NW $\frac{1}{4}$,
SE NE $\frac{1}{4}$ NE NW $\frac{1}{4}$, Govt. Lot 3 B.M. Valley County
additional points of diversion if any T 15N, R 3E, SEC 4, SE 1/4, NE 1/4, NE 1/4
4. Water will be used for the following purposes.
Amount 2.00 for Municipal Purposes from Jan 1 to Dec. 31 (both dates inclusive)
(cfs or acre-feet annum)
Amount for Purposes from to (both dates inclusive)
(cfs or acre-feet annum)
Amount for Purposes from to (both dates inclusive)
(cfs or acre-feet annum)
Amount for Purposes from to (both dates inclusive)
(cfs or acre-feet annum)
5. Total Quantity to be appropriated is (a) 2.00 and/or (b) N/A
cubic feet per second acre feet per annum
6. Proposed diverting works:
 - a. Description of ditches, flume, pumps, headgate, etc. Submersible pump size is unknown until test well is drilled. It will discharge into 6 - 8 inch lines.
 - b. Height of storage dam N/A feet; active reservoir capacity acre-feet; total reservoir capacity acre-feet
 to inclusive.
 - c. Proposed well diameter is 12 inches; proposed depth of well is 400 feet.
 - d. Is ground water with a temperature of greater than 85 F being sought? NO
 - e. If well is already drilled, when? N/A; Drilling Firm
Well was drilled for (well owner) ; Drilling Well No
7. Time required for completion of works and application of water to proposed beneficial use is 1 years (minimum 1 year).
8. Description of proposed uses (if irrigation only, go to item 9):
 - a. Hydropower, show total feet of head and proposed capacity if KW. N/A
 - b. Stockwatering; list number and kind of livestock. N/A
 - c. Municipal; show name of municipality. North Lake Recreational Sewer & Water District
 - d. Domestic; show number of households. N/A
 - e. Other, describe fully. N/A

MICROFILMED
SEP 19 2001

9. Description of place of use: North Lake Recreation Sewer & Water District

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below
- b. If water is used for other purposes, place a symbol of use (example. D for Domestic) in the corresponding place of use below
See instruction for standard symbols

TWP	RGE	SEC	NE				NW				SW				SE				TOTALS
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	

Total number of acres to be irrigated _____

10. Describe any other water rights used for the same purpose as described above. Water Rights numbers 65-7837, 65-12115, 65-7683 will be submitted for transfer to the District. Water Rights number 65-13361 will remain in ownership of the Arrowhead Point Homeowners Association for the additional point of diversion referenced for Section 4.
- 11 a. Who owns the property at the point of diversion? Mr. Steve Loomis
- b. Who owns the land to be irrigated or place of use? Homeowners of the District
- c. If the property is owned by a person other than the applicant, describe the arrangement enable the applicant to make this filing:
There is an easement agreement between the District and Mr. Loomis for the point of diversion in section 3. The District has an agreement to buy the well and the land on the lot for the point of diversion in section 4, which is currently owned by the Arrowhead Point Homeowners Association.
12. Remarks: There is an agreement between the District and the Arrowhead Point Homeowners Association to use the point of diversion in section 4 with their existing water right 65-13361 as well as this new water right being applied for. One point of diversion will be the primary well and the other point of diversion will be the backup well. Both points of diversion and both water rights will be used for municipal services within the District. The Arrowhead Point Subdivision is part of the District
13. MAP OF PROPOSED PROJECT ATTACHED X Show clearly the proposed point of diversion, place of use, section number, township and range number

BE IT KNOW that the undersigned hereby makes the application for permit to appropriate the public waters of the State of Idaho as herein set forth.


NORTH LAKE RECREATIONAL
SEWER AND WATER DISTRICT
P.O. Box 729
Donnelly, Idaho 83615

Bill H. Eddy
(Applicant)

LONG VALLEY ADVOCATE

Received by DAN Date 4-5-01 Time 11:00 Preliminary check by DAN
Fee \$ see original Receipted by see original # see original Date see original
Publication prepared by AT Date 4-19-01 Published in see original
Publication approved AT Date 5-23-01

MICROFILMED
SEP 19 2001

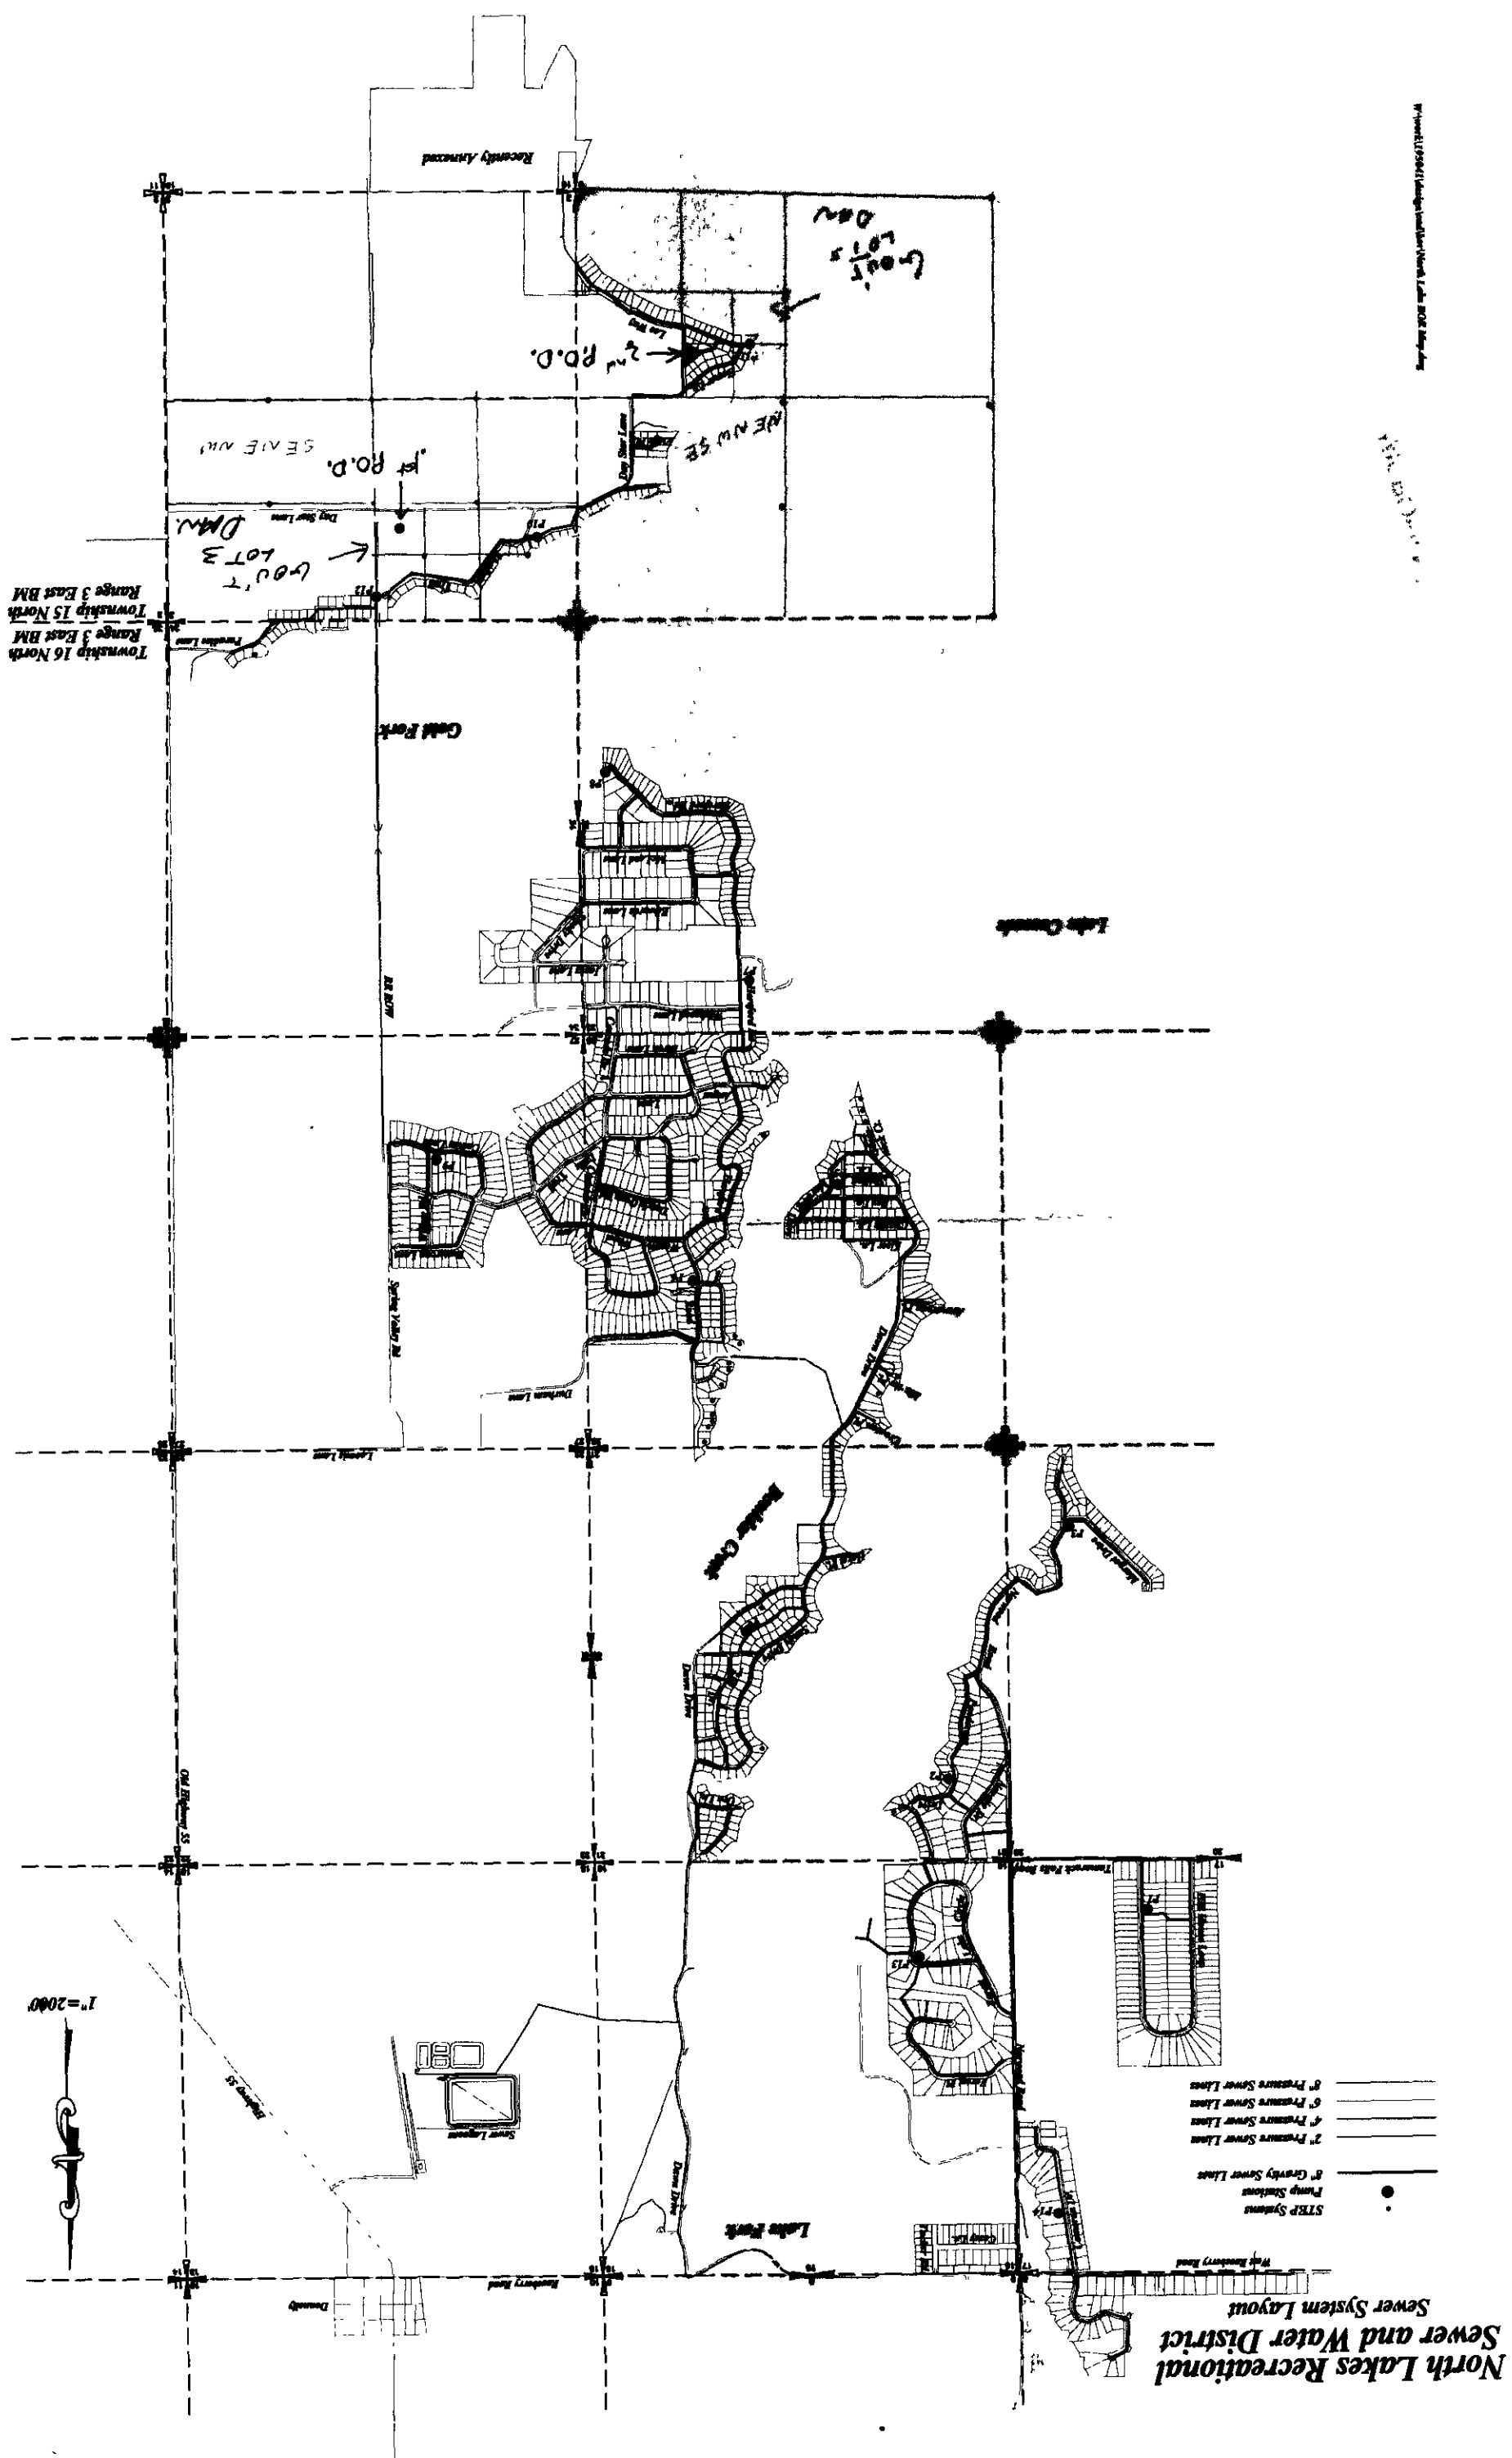

NORTH LAKE RECREATIONAL SEWER & WATER DISTRICT

BOARD MEMBERS

As of August 12, 2000 (Elected officers as of 8-12-00)

FIRST	LAST	ADDRESS	CITY	ST	ZIP	TITLE
RONALD V.	ZARBNISKY	PO BOX 397	DONNELLY	ID	83615	Chairman
GLENN L.	LOOMIS	PO BOX 458	DONNELLY	ID	83615	Vice Chairman
JAMES E.	BRUCE, JR	428 CASHMERE RD.	BOISE	ID	83702	Secretary
DOROTHY	RISING	PO BOX 10	DONNELLY	ID	83615	Treasurer
ROBERT W.	JONES	505 IOWA ST.	BOISE	ID	83706	Member


MICROFILMED

SEP 19 2001

Range No 3 East of the Boise

MICROFILMED
 SEP 19 2001

d d D C

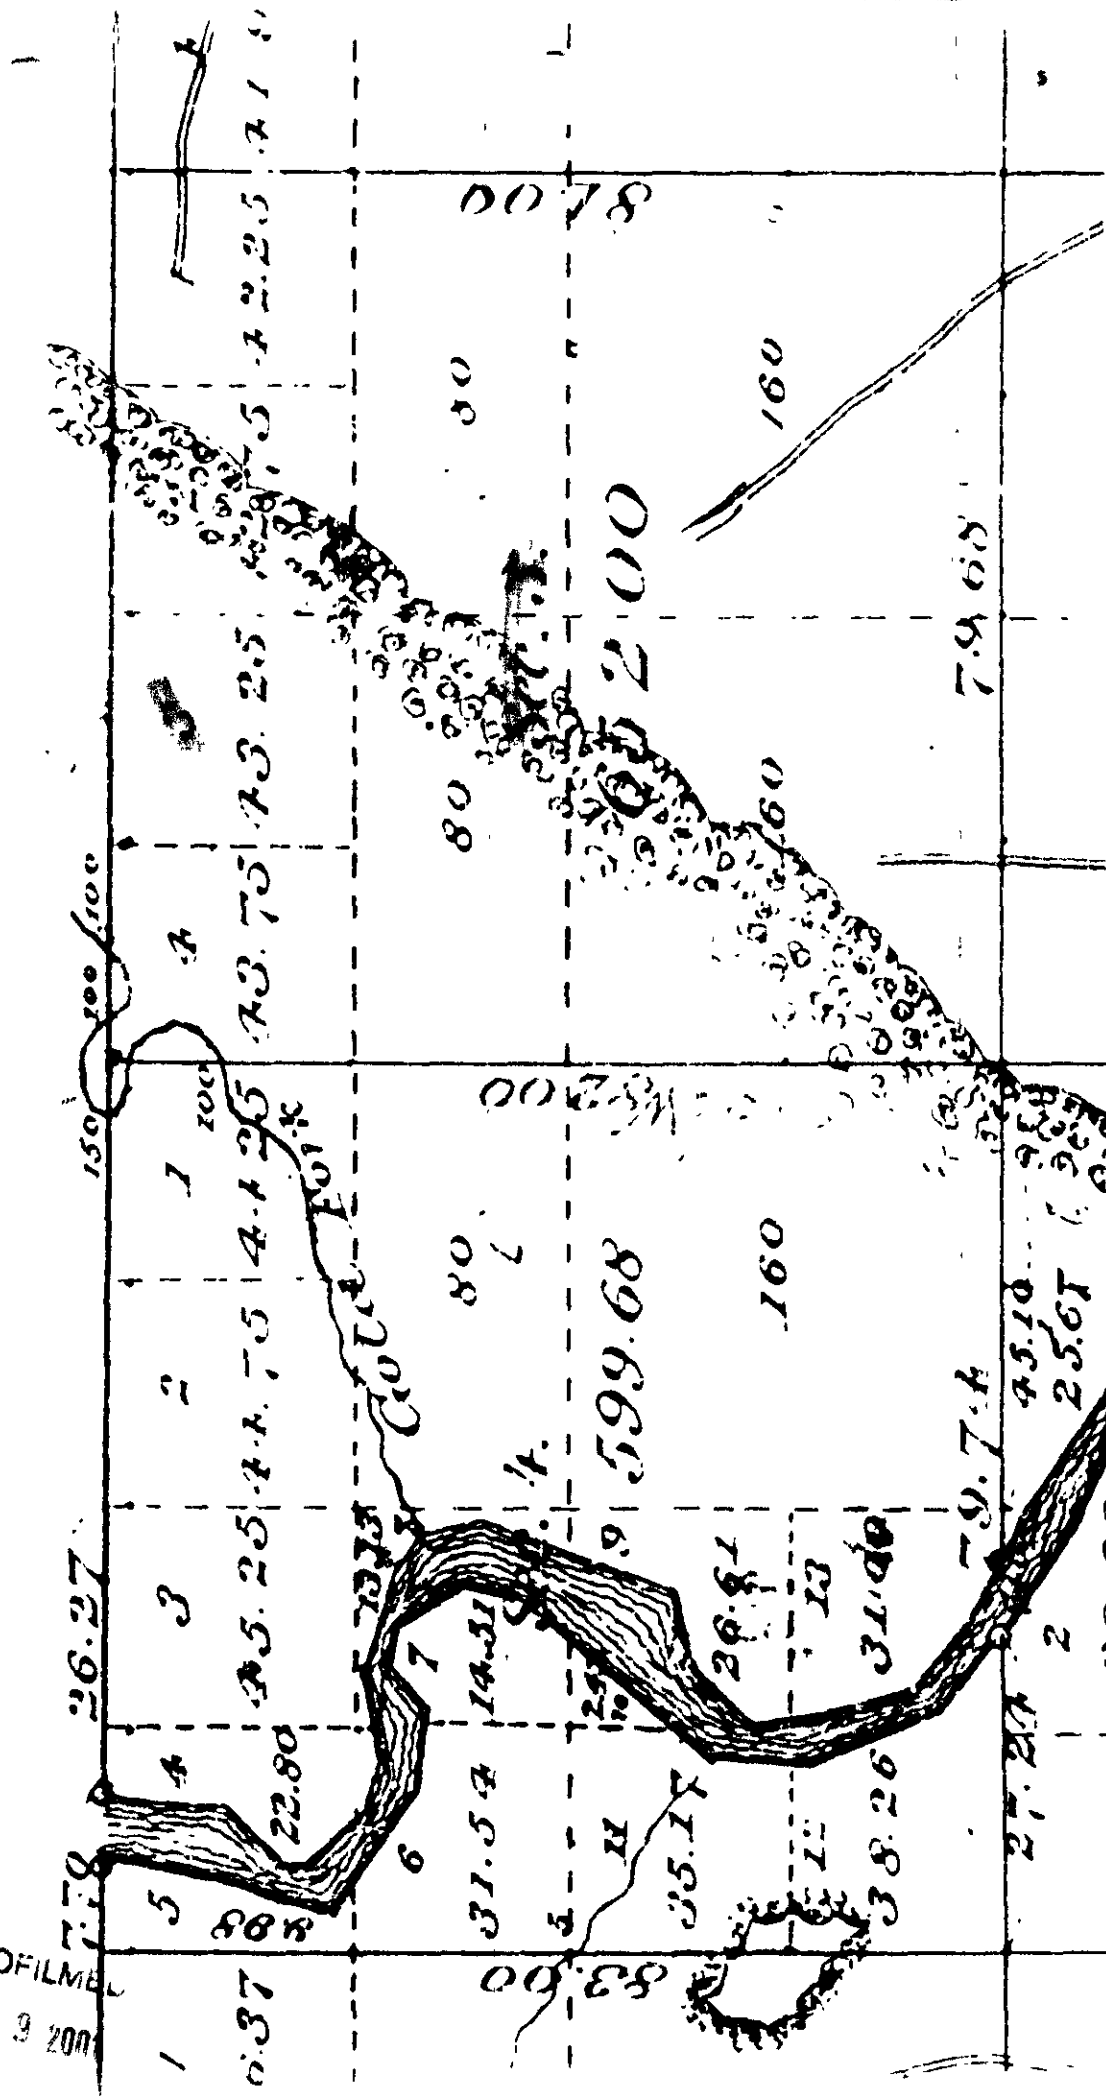

RECEIVED

FORM 202
12/99

FEB 12 2001

WATER RESOURCES
WESTERN REGION

Ident. No. _____

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

ORIGINAL

To appropriate the public waters of the State of Idaho

1. Name of Applicant North Lake Recreational Sewer & Water District Phone (208) 325-8958Mailing address P.O. Box 729, Donnelly, ID 836152. Source of water supply Groundwater which is a tributary of N/A3. Location of point of diversion is Township 15N Range 3E Sec. 3 in the NW $\frac{1}{4}$,
SE $\frac{1}{4}$, NW $\frac{1}{4}$, Govt. Lot N/A, S.M., Valley County;additional points of diversion if any: T 15N R 3E Sec 3 NW 1/4, SW 1/4, SW 1/4

4. Water will be used for the following purposes:

Amount 2.00 for municipal purposes from Jan. 1 to Dec. 31 (both dates inclusive)
(cfs or acre-feet per annum)Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)5. Total quantity to be appropriated is (a) 1.20 2.00 and/or (b) N/A
cubic feet per second acre feet per annum

6. Proposed diverting works:

a. Describe type and size of devices used to divert water from the source Submersible pump size is
unknown until test well is drilled. It will discharge into 6" to 8" distribution lines.b. Height of storage dam N/A feet; active reservoir capacity _____ acre-feet; total
reservoir capacity _____ acre-feetc. Proposed well diameter is 12 inches; proposed depth of well is 400 feet each.d. Is ground water with a temperature of greater than 85°F being sought? Noe. If well is already drilled, when? N/A; Drilling firm _____;
Well was drilled for (well owner) _____; Drilling Permit No. _____7. Time required for completion of works and application of water to proposed beneficial use is 1 years (minimum 1 year)

8. Description of proposed uses (if irrigation only, go to item 9):

a. Hydropower; show total feet of head and proposed capacity in kW. N/Ab. Stockwatering; list number and kind of livestock. N/Ac. Municipal; show name of municipality. N/Ad. Domestic; show number of households. 100e. Other; describe fully. N/A

MICROFILMED

SEP 13 2001

9. Description of place of use:

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RGE	SEC	NE				NW				SW				SE				TOTALS
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
15N	3E	3		D			D	D	D	D		D	D						
15N	3E	4				D									D				

Total number of acres to be irrigated _____

10. Describe any other water rights used for the same purposes as described above. Applications will be sent to transfer ownership of water right numbers 65-7837, 7683, and 12115.

11. a. Who owns the property at the point of diversion? Mr. Steve Loomis

b. Who owns the land to be irrigated or place of use? The residents are forming a LID.

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: There will be an easement agreement between the District and Mr. Loomis.

12. Remarks: _____

13. MAP OF PROPOSED PROJECT REQUIRED - Attach an 8 1/2"x11" map clearly identifying the proposed point of diversion, place of use, section #, township & range. (A photocopy of a USGS 7.5 minute topographic quadrangle map is preferred.)


BE IT KNOWN that the undersigned hereby makes this application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Bill Eddy ADMINISTRATOR
 Signature of Applicant (and title, if applicable)

Received by LM Date 2-12-01 Time 2:00pm Preliminary check by _____
 Fee \$ 290.00 Receipted by LM # W027358 Date 2-12-01
 Publication prepared by _____ Date _____ Published in _____
 Publication approved _____ Date _____

MICROFILMED

SEP 13 2001

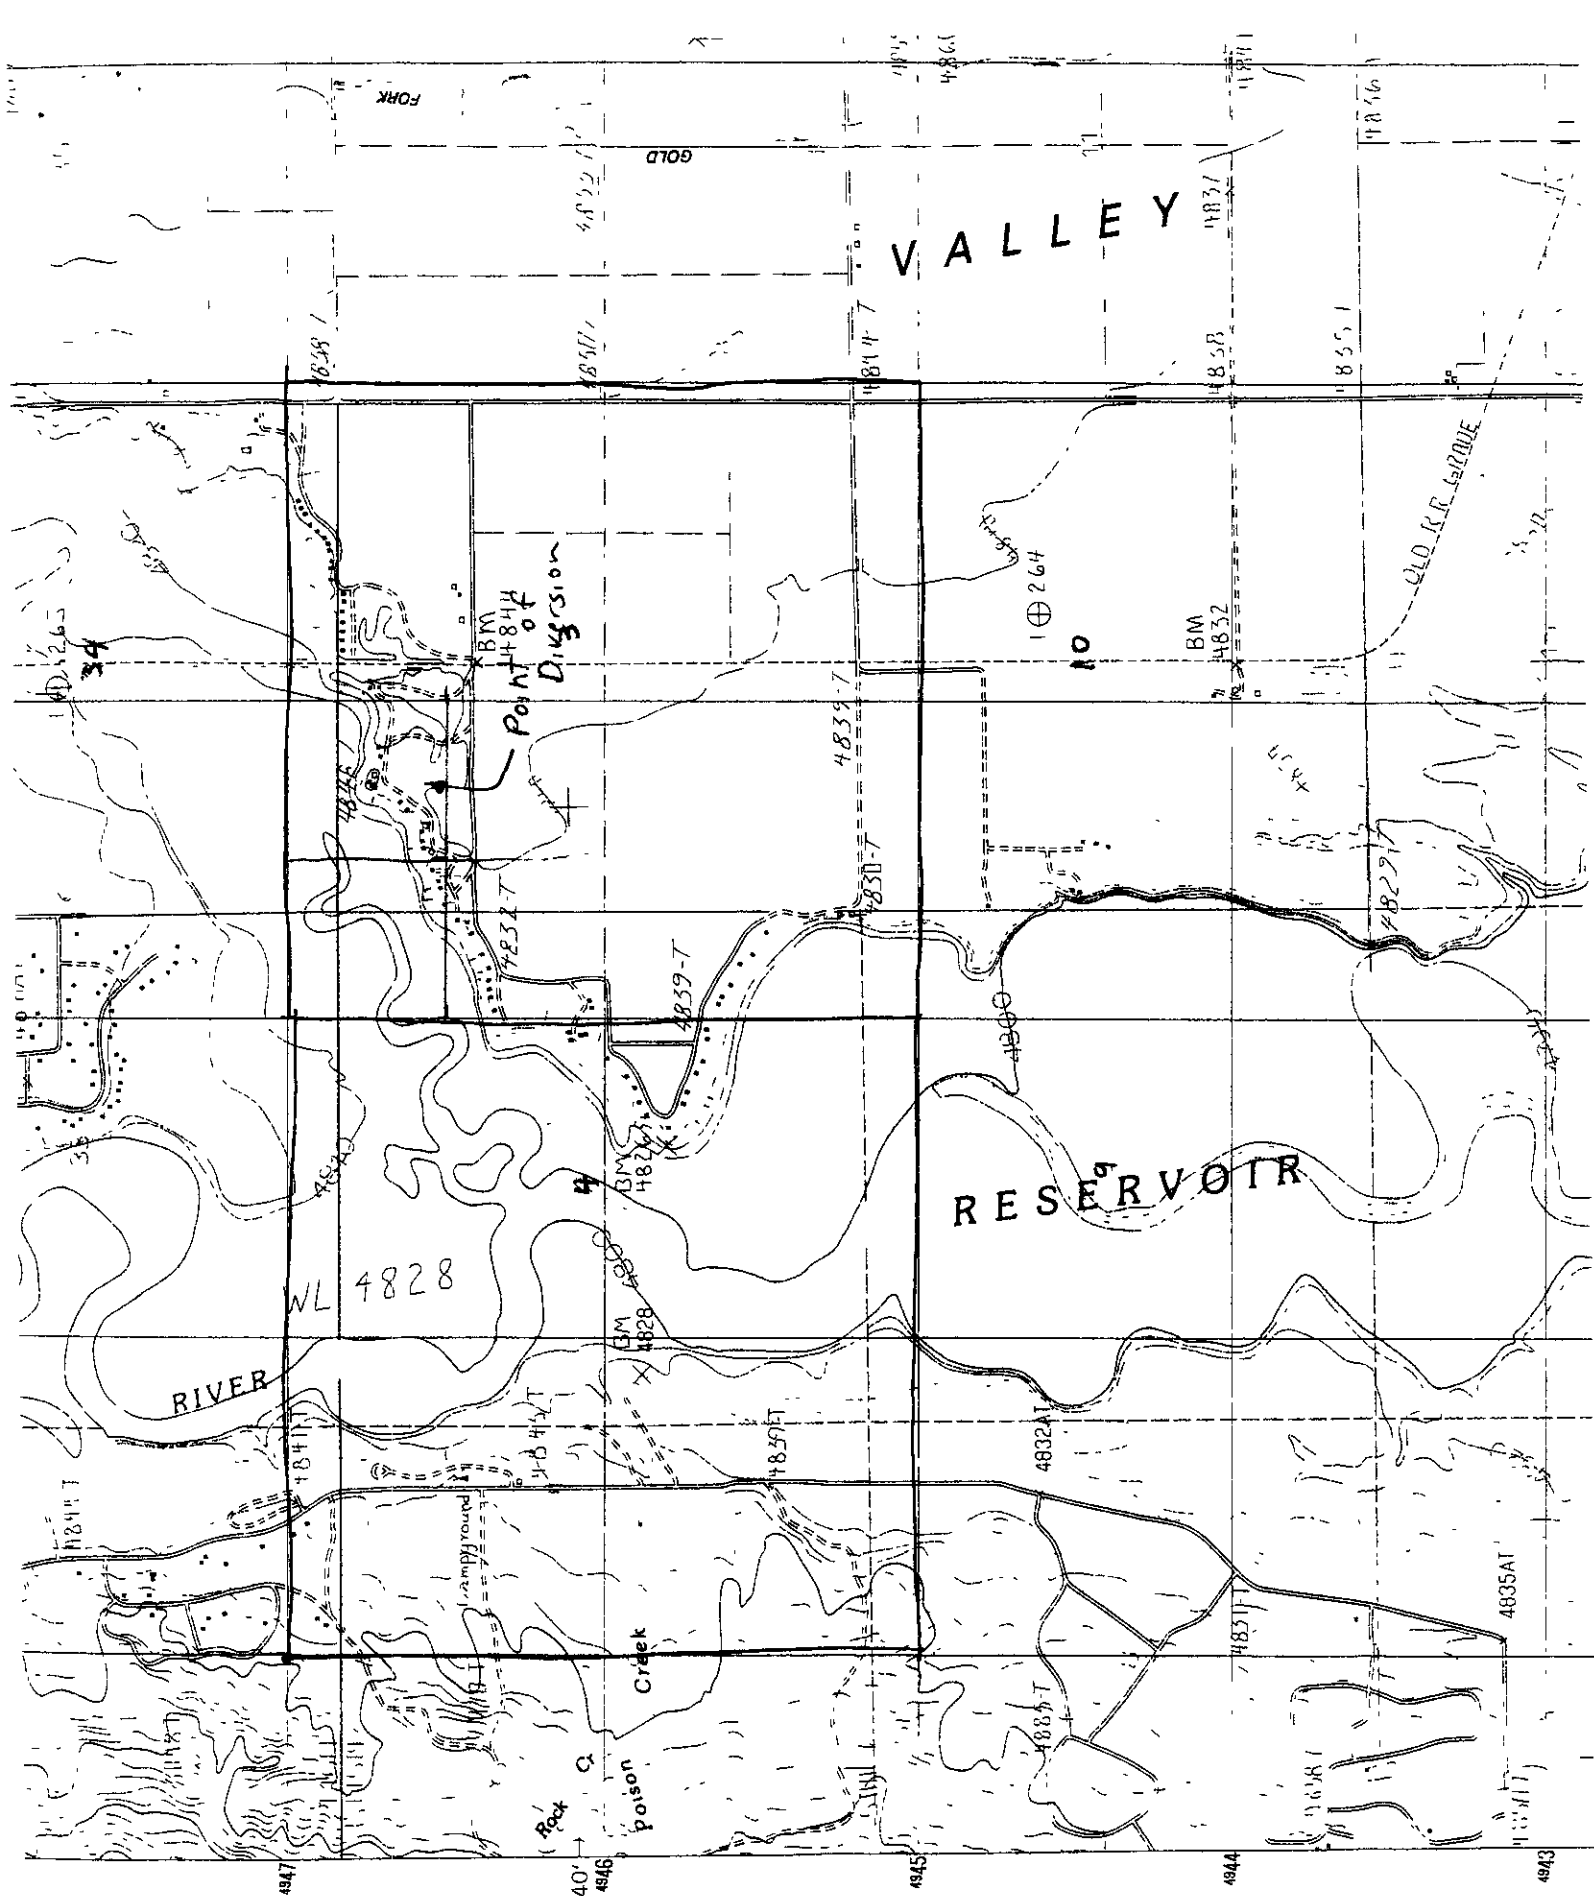

15N36

MICROFILMED
SEP 10 2001

REQUEST TO PROCESS

COMPLETE REQUEST IF YOU WANT YOUR APPLICATION TO BE PROCESSED USING ONE
OF THE THREE ALTERNATIVES BELOW

Name of Applicant North Lake Recreational Sewer and Water District

Mailing Address P.O. Box 729, Donnelly, ID 83615

Application No.
(if known)

 IN LOCAL PUBLIC INTEREST

Yes, I want my application processed and before it is advertised, I will amend my application to demonstrate that the proposed appropriations is in the local public interest including the need to preserve flows in the Snake River during the migration periods of anadromous fish.

 PROPOSE MITIGATION NOW

Yes, I want my application processed and before it is advertised, I will amend my application to include proposed mitigation to offset anticipated depletions in the Snake River during periods of anadromous fish migration.

 X WILL AGREE TO MITIGATION IN THE FUTURE IF NECESSARY

Yes, I want my application processed at this time, and I will accept a condition of approval that will require mitigation should the Director of the Idaho Department of Water Resources determine that mitigation is necessary to offset depletions from this appropriation to flows in the Snake River during periods of anadromous fish migration. I understand that mitigation is not required but may be needed in the future. I also understand that the Director will now require mitigation until I have an opportunity to review the process by which the need for mitigation is established and the amount of water required is quantified.

Signature

Date

Please return this form to:

Idaho Dept. of Water Resources
Western Regional Office
2735 Airport Way
Boise, ID 83705-5082

MICROFILMED
SEP 13 2001



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Boise, ID 83706 - P.O. Box 83720, Boise, ID 83720-0098
Phone: (208) 327-7900 Fax: (208) 327-7866 Web Site: www.idwr.state.id.us

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

May 10, 2004

NORTH LAKE RECREATIONAL SEWER & WATER DIST
PO BOX 729
DONNELLY ID 83615

RE: License No. 65-22358 - Issuance of License

Dear Water Right Holder(s):

The Department of Water Resources has issued the enclosed Water Right License confirming that a water right has been established in accordance with your permit. Please be sure to thoroughly review the conditions of approval and remarks listed on your license.

The license is a PRELIMINARY ORDER issued by the Department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action by the Department unless a party petitions for reconsideration or files an exception and/or brief within fourteen (14) days of the service date as described in the enclosed information sheet.

Enclosed is a copy of the approved Application for Amendment.

Please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Failure to report these changes could result in a \$100 late filing fee. Contact any office of the Department or visit the Department's homepage on the Internet to obtain the proper forms and instructions.

If you have any questions, please contact me at 208-327-7946.

Sincerely,

Shelley W. Keen

Water Rights Supervisor

SWK:klt

Enclosure(s)

cc: KELLER ASSOCIATES

MICROFILMED
JUN 02 2004


CERTIFICATE OF SERVICE

I hereby certify that on May 10, 2004 I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER(Approved License) to the person(s) listed below:

RE: WATER RIGHT NO. 65-22358

**KELLER ASSOCIATES
ATTN MIKE ANDERSON
131 S W 5TH AVENUE STE A
MERIDIAN ID 83642**

**NORTH LAKE RECREATIONAL SEWER
& WATER DIST
PO BOX 729
DONNELLY ID 83615**

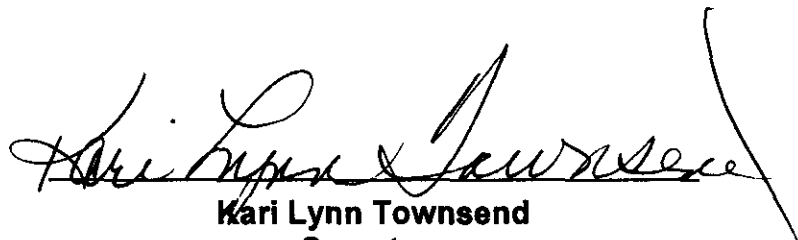
**Kari Lynn Townsend
Secretary**

RECORDED
JUN 02 2004

**EXPLANATORY INFORMATION
TO ACCOMPANY A
PRELIMINARY ORDER**

The accompanying order or approved document is a "Preliminary Order" issued by the department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department of Water Resources (department) unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the department or the Idaho Water Resource Board (Board) is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01303 (Rules of Procedure 302 and 303)

MICRO. LIME
JUN 02 2004

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

Comment Report

65-22358

2. dnelson 4/11/2001 General Comments/Analysis

Comment: This application is for the current municipal needs of North Lake Recreational Sewer & Water District. The applicants have been the municipal provider to various subdivisions in the area for sewer and garbage collection for some time. They have now been asked by their customers to supply and maintain the water systems for several subdivisions. Please see service area map attached to the application to show all of the area that the District services. The District will be filing transfers on water rights 65-7837, 65-12115, and 65-7683 to incorporate them into their municipal system. Some of the remaining subdivisions will retain their own water rights for their homeowners associations within the borders of the district, but most will use the District's services to maintain the wells. The well in Section 4 will be co-owned by the District and Arrowhead Point Homeowners Association. They have decided to retain possession of their water right 65-13361, but want to share the maintenance cost of the well with the District. The District plans to use this well as a backup well.

3. dnelson 4/11/2001 11:48:30 AM Legal Notice Remarks

Comment: Applicant agrees to mitigate consumptive use in the future as needed. Municipal use is for applicants service area

1. kwalker 5/7/2004 License Review

Comment: Recommend license be issued as prepared by regional office. Amendment of permit received by region in July of 2002 but never forwarded to state office. Region would like amendment to be used for licensing of the permit. There are no exams in files 65-13574 and 65-13361 which overlap the points of diversion under this permit.

MICR

JUN 07 2004

RECEIVED

APR 30 2004 *kw*
Page 1

Permit No: 65-22358

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

Department of Water Resources

A. GENERAL INFORMATION

Permit No. 65-22358

Exam Date 3/18/2004

1. Current Owner: NORTH LAKE RECREATIONAL SEWER & WATER DIST
PO BOX 729
DONNELLY ID 83615
(208)325-8958
2. Accompanied by: Mike Anderson, Bill Eddy
Phone No: 288-1992 for Mike and 325-8519 for Bill
Address: Meridian for Mike and Cascade for Bill
Relationship to Permit Holder: Mike is the project engineer and Bill is the Sewer District manager.

3. SOURCE

TRIBUTARY

GROUND WATER

B. OVERLAP REVIEW

1. Other water rights with the same place of use: N/A
2. Other water rights with the same point of diversion: 65-13574, 65-13361

C. DIVERSION AND DELIVERY SYSTEM

1. LOCATION OF POINT(S) OF DIVERSION:

GROUND WATER	NE1/4NW1/4SE1/4	Sec. 4,	Twp 15N,	Rge 03E, B.M
VALLEY County				
GROUND WATER	NE1/4NW1/4SE1/4	Sec. 4,	Twp 15N,	Rge 03E, B.M.
VALLEY County				

Method of Determination: Site visit

2. ☒ Delivery System Diagram Attached (required). Indicate all major components and distances between components. Indicate weir size/pipe as applicable.
☒ Map Attached Showing Location(s) of point(s) of diversion and place(s) of use (required). Scale must be 1:24,000 or greater
☒ Aerial Photo Attached (required for irrigation of 10+ acres).
☒ Photo of Diversion and System Attached

3.

<u>Well or Diversion</u> <u>ID No.*</u>	<u>Motor Make</u>	<u>Hp</u>	<u>Motor Serial No.</u>	<u>Pump Make</u>	<u>Pump Serial No. or Discharge</u> <u>Size</u>
Well No. 2	Submersible	25		Gould	7 CHC
Well No. 3	"	10		Berkeley	6TP-175

D. FLOW MEASUREMENTS

1

<u>Measurement</u> <u>Equipment</u>	<u>Type</u>	<u>Make</u>	<u>Model No.</u>	<u>Serial No.</u>	<u>Size</u>	<u>Calib. Date</u>
Pump Curves						

MICROFILMED

JUN 02 2004

2. Measurements: (Based on system operation between 40 and 60 psi)
 @ 40 psi or 100 TDH, system operates at 830 gpm or 1.85 cfs (peak demand rate)
 @ 60 psi or 180 TDH, system operates at 610 gpm or 1.36 cfs

Permit/proof limit: 2.0 cfs

Allow 1.85 cfs based on peak demand

E. FLOW CALCULATIONS

☒ Additional Computation Sheets Attached

Measured Method: See attached computations and pump curves from Mike Anderson

F. VOLUME CALCULATIONS

N/A for municipal use

- 1 Volume Calculations for Irrigation.

$$V_{IR} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$$

$$V_{DR} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation season}) \times 1.9835 =$$

$$V = \text{Smaller of } V_{IR} \text{ and } V_{DR} =$$

2. Volume Calculations for Other Uses:

G. NARRATIVE/REMARKS/COMMENTS

North Lake Recreational Sewer & Water District is a municipal provider for various subdivisions in the area. In 1991, they filed application no. 65-22358 for a well in the SENENW S3 located in Mtn Shadows No. 4 Sub. and a well in the NENWSE S4 located in Arrowhead Pt. Sub. (aka well no. 1). This well also serves rights 65-13361 and 65-13574 for Arrowhead Pt. Sub. Homeowners Association. Application no. 65-22358 was permitted in July, 2001. The Sewer District then amended their permit in June, 2002, to list two wells in the NENWSE S4, rather than just one well, and to take off S3 well. In August of 2002, well no. 1 was abandoned due to water quality problems and replaced with well no. 2. In October, 2002, the department allowed well no. 3 to be drilled next to well no. 2, prior to processing the amendment. Processing the amendment has been delayed due to typical backlog problems. Proof was filed in June of 2003 listing wells 2 and 3. Steve Lester stated that the permit amendment could be processed as a licensing amendment. Also, the area within the Sewer District's service area is developing rapidly and before the district files for additional water/wells, they need to know how much water will be licensed under this permit. For these reasons, an expedited field exam was conducted 3/18/2004.

The system consists of two wells, aka well no. 2 and well no. 3. Well no. 2 is equipped with a 25 hp submersible Gould pump and well no. 3 is equipped with a 10 hp submersible Berkeley pump. The well capacities exceed the pump capacities, however larger pumps would require three phase power, which is not yet available. The system kicks on at 38 psi and off at 58 psi, utilizing three storage tanks, 300 gallons each, for a total storage capacity of 900 gallons. A McCrometer flowmeter has been installed to measure fire protection water use and a McCrometer Ultra Mag meter has been installed to measure domestic water use. At the time of the exam, the system had been operating for 15 months. 8,145,200 gallons had been pumped for domestic use and 216,100 gallons had been pumped for fire protection. The fire protection water was used when the fire department tested the hydrants. They measured 700 to 1000 gpm flow rate from the wells, depending on the hydrant location. Please note that at this rate, the storage

MICROMETER

JUN 02 2004

water would not have been a factor after the first minute of testing. The hydrant tests support the following flow rate recommendation for the system.

Based on the pump curves, the system operates most efficiently at 60 psi or 180 TDH and 610 gpm (460 gpm for well/pump no. 2 and 150 gpm for well/pump no. 3). This flow rate does not account for peak demand times, in which the system operates at 40 psi or 100 TDH and 830 gpm (245 gpm for well/pump no. 2 and 585 gpm for well/pump no. 3). Applicant's engineer is Mike Anderson with Keller Associates. Mike designed the system and submitted technical pump information reflecting how both pumps operate in parallel, supporting the 830 gpm peak demand rate. The permit lists 2.0 cfs. 830 gpm equates to 1.85 cfs, which is the amount recommended for licensing based on the system's peak demand requirements.

P/d overlaps include rights 65-13574 and 65-13361 for Arrowhead Point Subdivision, which also use well no. 2 that replaced well no. 1. These rights will remain in the subdivision's name, but will be managed by the district. No other rights are used.

The permit holder has a large service area, encompassing separate systems. A map of this system's specific service area has been attached.

Have conditions of permit approval been met? ☒ Yes ☐ No

H. RECOMMENDATIONS

1. Recommended Amounts

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL VOLUME</u>
MUNICIPAL	01/01 to 12/31	1.850 CFS	
<u>Totals:</u>		1.850 CFS	

2. Recommended Amendments

☒ Change P.D. as reflected above ☐ Add P.D. as reflected above ☐ None

☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

I. AUTHENTICATION


Field Examiner's Name Lon G. Brown Date 4/19/04

Reviewer _____ Date _____


MICROFILM
JUN 02 2004

NORTH LAKE RECREATIONAL SEWER & WATER DISTRICT

WATER RIGHTS FIGURE

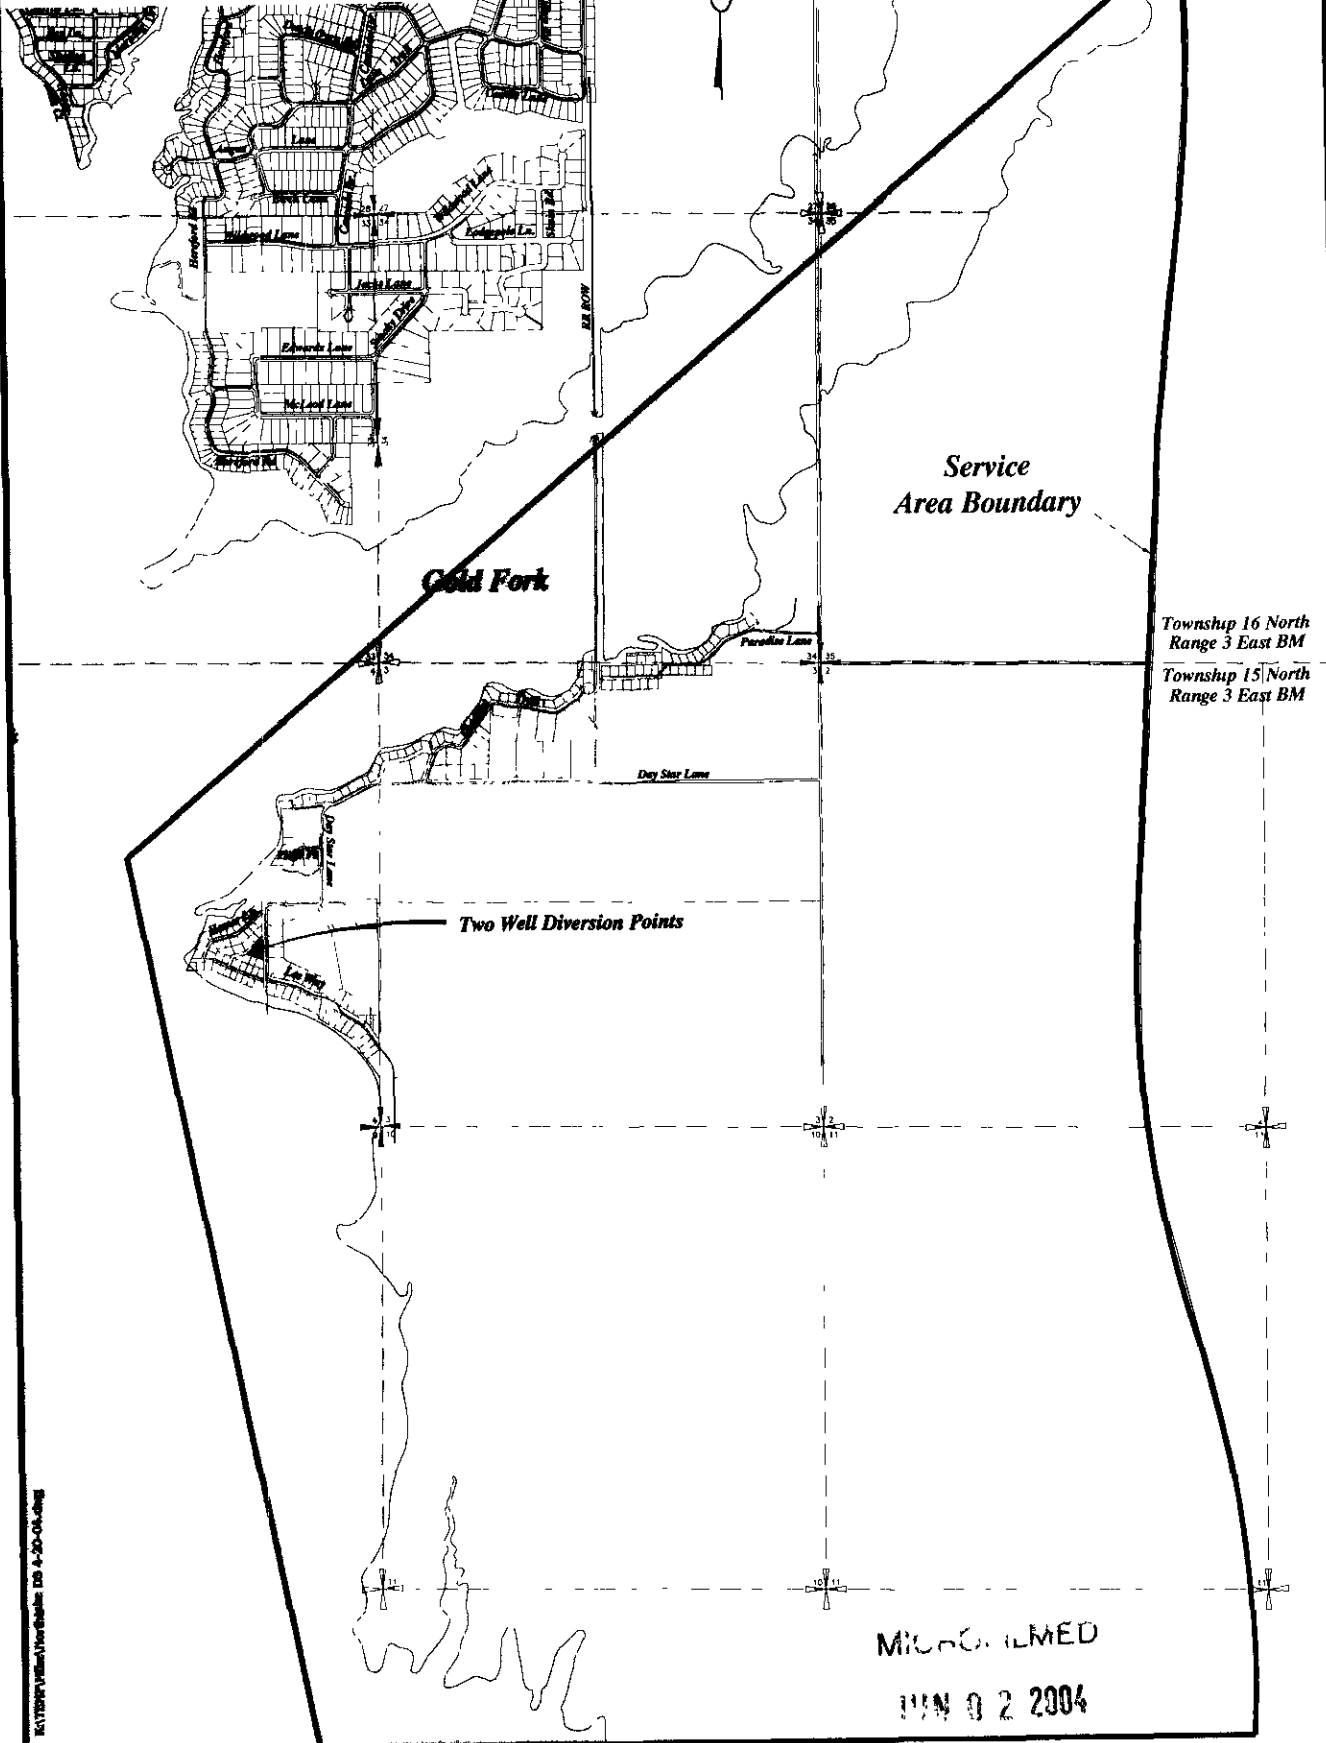

KENTONVILLE/Maple Ridge DB A-20-04-04

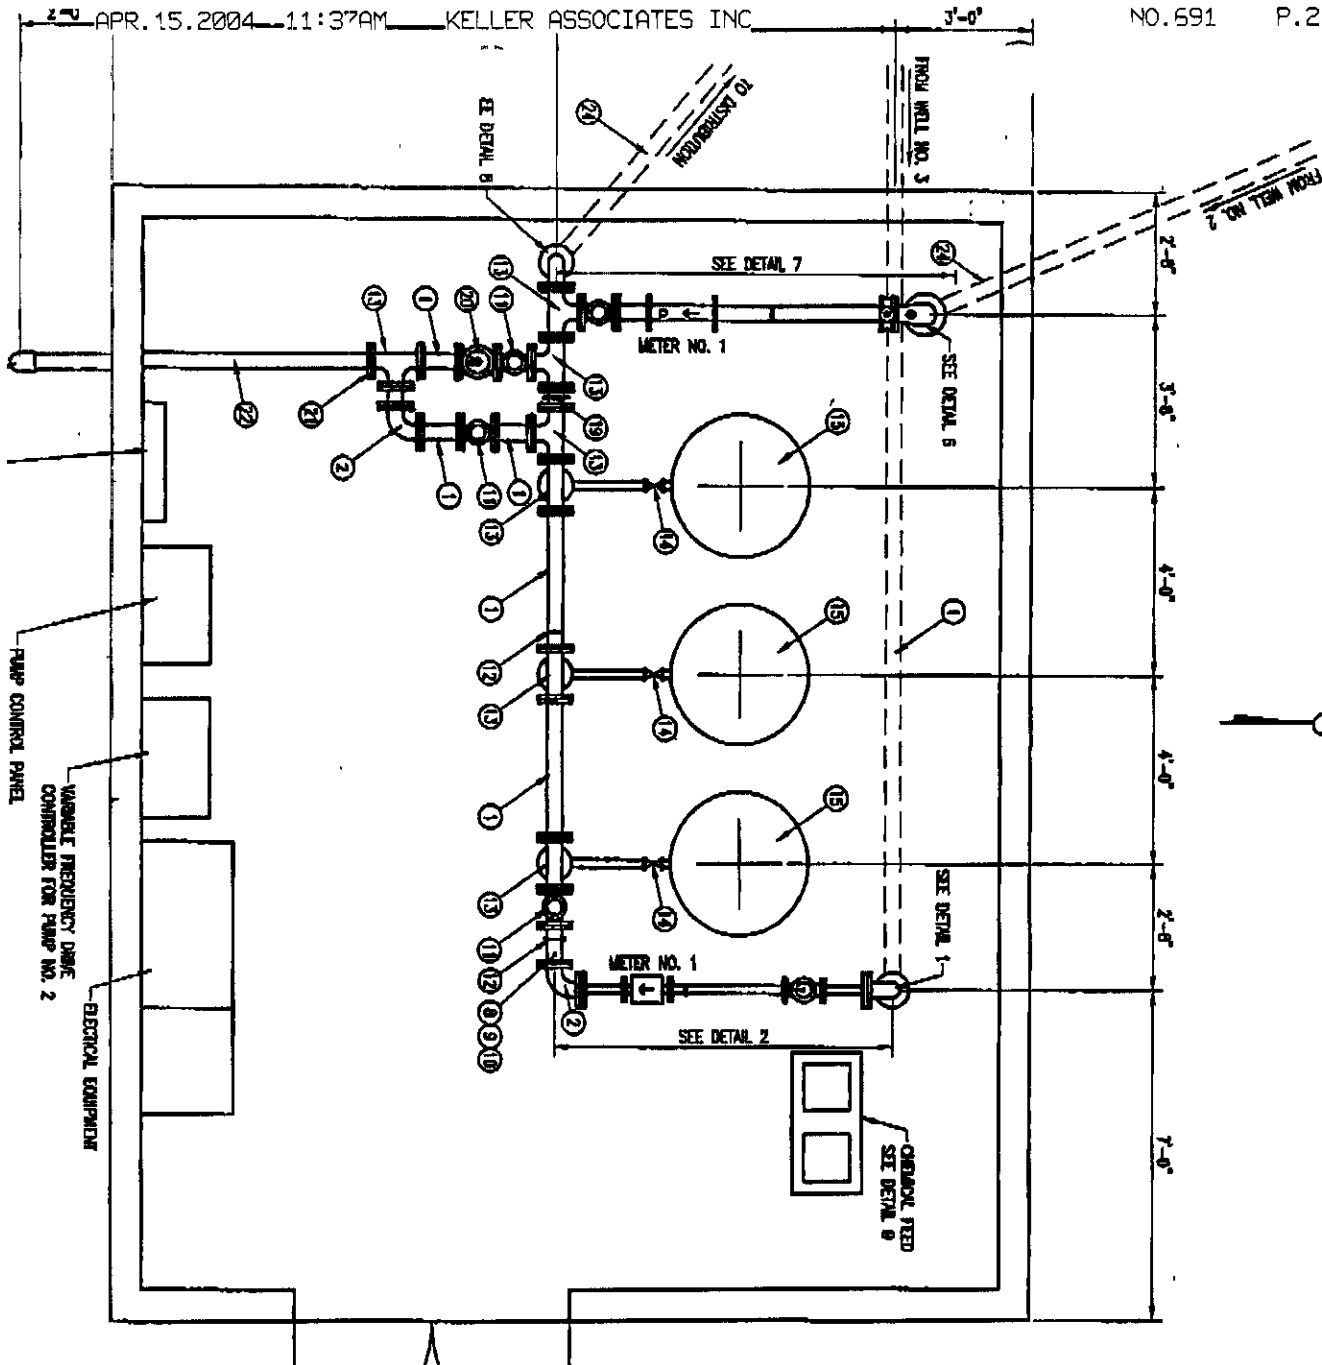

KEYNOTES

- ① 4 INCH DUCTILE IRON PIPE
- ② 4 INCH FLANGED DUCTILE IRON ELBOW
- ③ 8 INCH O.D. x 2 INCH THREADED FLANGE
- ④ 2 INCH GAV. STEEL PIPE
- ⑤ 2 INCH THREADED FLANGE
- ⑥ 2 INCH PRESSURE REDUCING VALVE WITH CHECK FEATURE (CLA-VIL 50-01 CLOSE PATTERN WITH FLANGED ENDS)
- ⑦ 2 INCH MAGNETIC FLOWMETER (WATER SPECIALTIES MODEL LW-406 WITH INTERCALLY MOUNTED ELECTRONICS AND GROUNDING RINGS)
- ⑧ 1/2 INCH TAPPING SADDLE
- ⑨ 1/2 INCH CORROSION STOP
- ⑩ CHEMICAL FEED
- ⑪ 4 INCH IRON GATE VALVE, OS & Y WITH FLANGED ENDS
- ⑫ PIPE SUPPORT
- ⑬ 4 INCH FLANGED DUCTILE IRONTEE
- ⑭ 2 INCH IRON GATE VALVE (SEE DETAIL 3)
- ⑮ 300 GALLON INTERMEDIATE TANK (SEE DETAIL 4)
- ⑯ 2 INCH GAV. WELDABLE IRON ELBOW
- ⑰ 2 INCH GAV. WELDABLE IRON UNION
- ⑱ GAV. STEEL NIPPLE TO FIT TANK OUTLET
- ⑲ PRESSURE CONTROL DEVICES (SEE DETAIL 5)
- ⑳ 4" PRESSURE RELIEF VALVE (CLA-VIL 50-01 CLOSE PATTERN WITH FLANGED ENDS)
- ㉑ 4" SLIP ON STEEL FLANGE
- ㉒ 4-1/2" O.D. STEEL PIPE
- ㉓ 4" FORGED STEEL 45 BEND (MOUNTED TURNED DOWN)
- ㉔ 6" DUCTILE IRON PIPE
- ㉕ 1/4" SMOOTH NOSE BEND
- ㉖ 6"x4" FLANGED REDUCING BEND
- ㉗ 4" CHECK VALVE (APCO SERIES 300)
- ㉘ 4" FLANGED DUCTILE IRON PIPE
- ㉙ 4" FLANGED TUBE WELDER (WATER SPECIALTIES LW-05)
- ㉚ TRANSDUCER (WATER SPECIALTIES TR-16)
- ㉛ 6" FLANGE ADAPTER WITH RESTRAINING LIPS
- ㉜ 6" FLANGED BEND
- ㉝ 6" WATER STALE BIRMINGHAM VALVE WITH HANDHELD OPERATOR
- ㉞ 4" FLANGE ADAPTER WITH RESTRAINING LIPS
- ㉟ 1/2" BRASS STOPCOCK, TAPPED INTO TOP OF FITTING WITH OUTLET TURNED DOWN AND SCREEN OVER OUTLET

MICRO TOWER

JUN 02 2004

IDAHO DEPARTMENT OF WATER RESOURCES

WELL INSPECTION FORM

1. DRILLING PERMIT NO: 767090 OTHER APPLICABLE NO: Well #2
2. OWNER: N. Lake Res. Sewer + Water Dist Phone: _____
Address: Donnelly
3. WELL LOCATION: Twp 15N, Rge. 3E, Sec. 4, NW 1/4 SE 1/4
County Valley (Provide sketch map and photo on reverse.)
4. DRILLER: Stevens + Son Lic. No. 153
When Drilled? 8/9/01
5. WELL CONSTRUCTION:
Casing Diameter 10 inches Water tight cap? ☒ Yes ☐ No Access Port: ☒ Yes ☐ No
Casing $\geq$ 12 inches above ground? ☒ Yes ☐ No - Describe _____
Depth of Casing 191 ft. Method Drilled Mud Rotary
Condition of Well Casing: ☒ Good ☐ Fair ☐ Poor Describe _____
Control Valve? ☒ Yes ☐ No Pressure Gauge: ☒ Yes ☐ No inside pump house
Condition of Piping and Valving great
Auger to a depth of _____ ft. Evidence of Annular Seal ☐ Yes ☐ No
Are there obvious construction problems that may be a source for contamination or waste of water?
☐ Yes ☒ No (Describe in Remarks and Attach Photo - On Reverse)
6. HYDROLOGIC INFORMATION:
Depth to Static Water 21 ft. Water Temperature cold °F
Flowing Artesian ☐ Yes ☒ No Pressure: 40-60 (psi)
Water Sample Taken? ☐ Yes ☒ No If yes, describe purpose _____
Water Quality Measurements/Observations (Describe) _____
7. WELL USE:
☐ Domestic ☐ Irrigation ☐ Stock
☐ Test ☒ Municipal ☐ Industrial
☐ Abandoned ☐ Waste Disposal/Injection ☐ Not Used
☐ Other: _____

MICROFILMED

JUN 8 2 2004

8. **POSSIBLE CONTAMINATION SOURCES:**

Is there evidence of Chemigation? ☐ Yes ☒ No

If yes, is there a check-valve present? ☐ Yes ☐ No

Is there a possible source of contamination nearby? ☐ Yes ☒ No


If yes, what Type? _____

How far away from the well is this source? _____

9. **REMARKS:** _____



Signature of Dept. Representative & Title



Inspection Date

PHOTOS, DRAWINGS, OTHER ATTACHMENTS:

PNV - Ag/HI Flow Division
BOB RANDALL

Goulds Turbine Pump Selection ver 5 042
07/23/02

PUMP DATA SHEET
Goulds Turbine 60 Hz

Selection file: (untitled)
Catalog: TURB60.MPC v 1.6.1

Curve: E3039-2

Design Point: Flow: 450 US gpm
Head: 175 ft

Fluid: Water Temperature: 80 °F

SG: 1

Viscosity: 1.122 cP

Vapor pressure: 0.2566 psi_a

Atm pressure: 14.7 psi_a

Pump: TURBINE - 3800 Size: 7CHC, (2 stages)
Speed: 3450 rpm Dia: 4.875 in

Limits: Temperature: — °F Sphere size: 0.43 in
Pressure: 415 psi_g Power: — bhp

NPSHa: — ft


Specific Speed: Ns: 2300 Nss: —

Piping: System: —
Suction: — in
Discharge: — in

Vertical Turbine: Bowl Size: 7.13 in Max Lateral: 0.5 in
Thrust K Factor 3.5

Motor: 30 hp Speed: 3600 Frame: 286TS
NEMA Standard TEFC Enclosure
sized for Max Power on Design Curve

Suction Size-5" Discharge Sizes-5", 6"

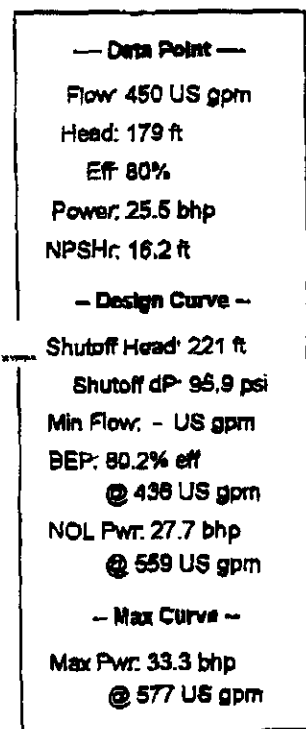

— PERFORMANCE EVALUATION —

Flow US gpm	Speed rpm	Head ft	Pump %eff	Power bhp	NPSHr ft	Motor %eff	Motor KW	Hrs/yr	Cost kWh
540	3450	150	74.2	27.6	22.4				
450	3450	179	80	25.5	16.2				
380	3450	198	78.1	23	13.2				
270	3450	208	88	20.2	12				
180	3450	213	45.9	17.8	12				

MICRO

MAR 2 2004

IDAHO DEPARTMENT OF WATER RESOURCES

WELL INSPECTION FORM

1. DRILLING PERMIT NO: 785214 OTHER APPLICABLE NO: WELL #3
2. OWNER: N. Lake Res. Sewer + Water Dist Phone: _____
Address: Donnelly
3. WELL LOCATION: Twp 15N, Rge. 3E, Sec. 4, NW 1/4 SE 1/4
County Valley (Provide sketch map and photo on reverse.)
4. DRILLER: Stevens + Sons Lic. No. 153
When Drilled? 10/10/02
5. WELL CONSTRUCTION:
Casing Diameter 10 inches Water tight cap? ☒ Yes ☐ No Access Port: ☒ Yes ☐ No
Casing $\geq$ 12 inches above ground? ☒ Yes ☐ No - Describe _____
Depth of Casing 397 ft. Method Drilled Mud Rotary
Condition of Well Casing: ☒ Good ☐ Fair ☐ Poor Describe _____
Control Valve? ☒ Yes ☐ No Pressure Gauge: ☒ Yes ☐ No inside pump house
Condition of Piping and Valving great
Auger to a depth of _____ ft. Evidence of Annular Seal ☐ Yes ☐ No
Are there obvious construction problems that may be a source for contamination or waste of water?
☐ Yes ☒ No (Describe in Remarks and Attach Photo - On Reverse)
6. HYDROLOGIC INFORMATION:
Depth to Static Water 18 ft. Water Temperature cold °F
Flowing Artesian ☐ Yes ☒ No Pressure: 40-60 (psi)
Water Sample Taken? ☐ Yes ☒ No If yes, describe purpose _____
Water Quality Measurements/Observations (Describe) _____
7. WELL USE:
☐ Domestic ☐ Irrigation ☐ Stock
☐ Test ☒ Municipal ☐ Industrial
☐ Abandoned ☐ Waste Disposal/Injection ☐ Not Used
☐ Other: _____

JUN 02 2004

8. **POSSIBLE CONTAMINATION SOURCES:**

Is there evidence of Chemigation? ☐ Yes ☒ No

If yes, is there a check-valve present? ☐ Yes ☐ No

Is there a possible source of contamination nearby? ☐ Yes ☒ No

If yes, what Type? _____

How far away from the well is this source? _____

9. **REMARKS:**



Signature of Dept. Representative & Title

3/18/04

Inspection Date


PHOTOS, DRAWINGS, OTHER ATTACHMENTS:

MICRO

JUN 02 2004

well #3

Submersible Turbine Model 6TP-175

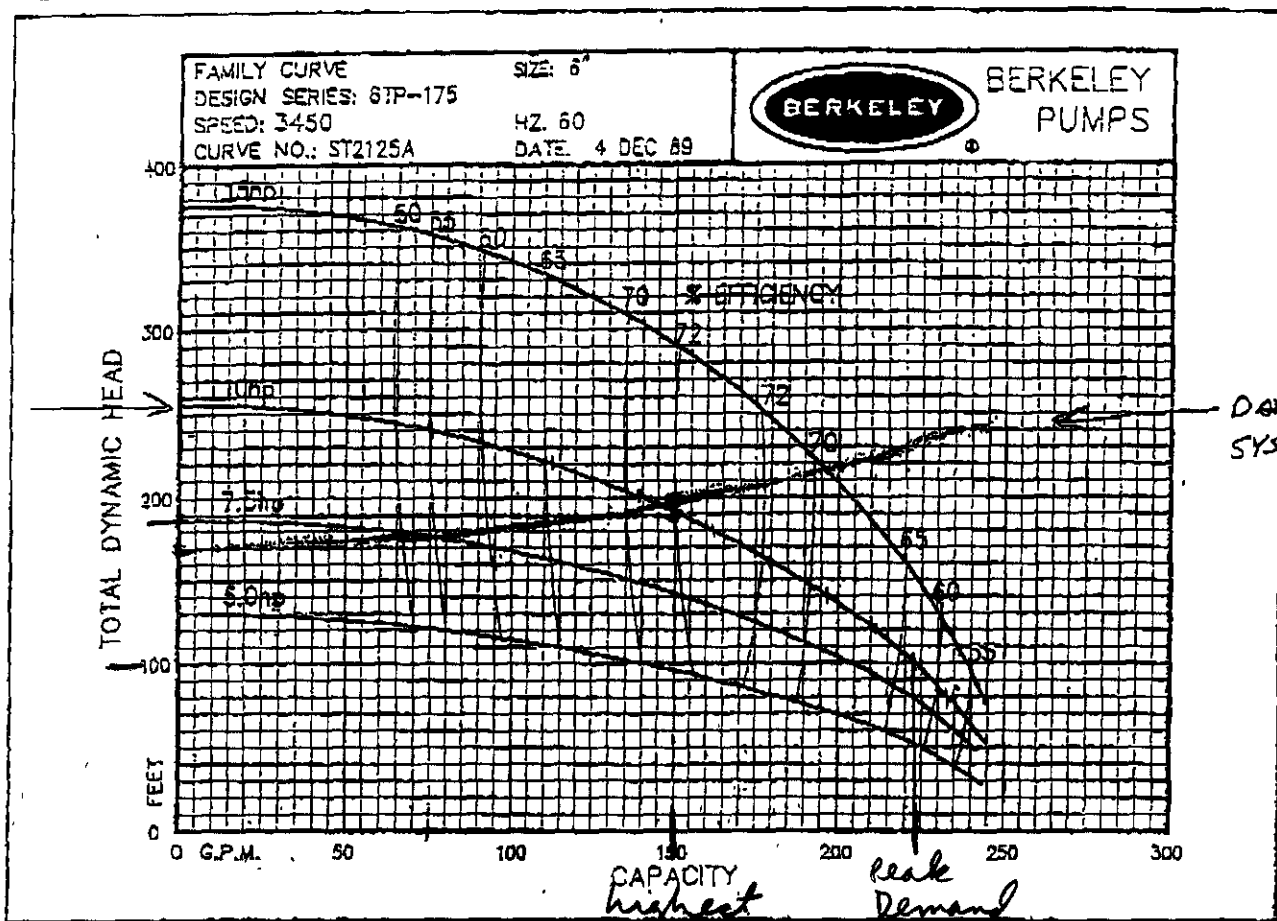

Specifications

LIQUID END WEIGHTS

DESCRIPTION	WEIGHT LBS.	HP RATING	MOTOR FLANGE
ONE STAGE L.E.	52.0	5-15	6"
ONE STAGE L.E.			
ONE STAGE L.E.			
EACH ADDED STAGE	15.0	ALL	ALL

CURVE No. ST2125A

IMPELLER DATA

TYPE: ENCLOSED EYE AREA 3.45 Sq. in.
 THRUST CONSTANT K 1.88 Lbs./Ft of HEAD.

HP	IMPELLER No.	STAGES	IMPELLER Dia.
15	M06643	6	4.44"
10	M06643	4	4.44"
7.5	M06643	3	4.44"
5.0	M06643	2	4.44"

OUTLINE DIMENSIONS

A- ONE STAGE LIQUID END LENGTH
 B- SUCTION CONNECTION LENGTH
 C- STAGE LENGTH
 D- DISCHARGE CONNECTION LENGTH
 E- BOWL DIAMETER
 F- DIAMETER ACROSS LEAD GUARD

BOWL DATA

BOWL No. M06636 PUMP SHAFT Dia. 3/4"
 TYPE: THREADED DISCHARGE SIZE 3" NPT (Female)
4" NPT (Male)

NOTE: For each additional stage add 'C'

A	B	C	D	E	F	HP RATING	MOTOR FLANGE
19.63	11.00	5.00	3.63	5.38	5.81	5-15	6"



☒ Meridian Office

131 SW 5th Avenue, Suite A
Meridian, Idaho 83642
(208) 288-1992

☐ Pocatello Office

412 W Centre, Suite 330
Pocatello, Idaho 83204
(208) 238-2146

Project Name: Day & night

Calculated By: nick A Date: 1/15/01

Project No. 100074 Sheet 1 of 3

Combined head and flow calculations for cells 2-13

H	$\frac{Z}{Q}$	$\frac{3}{Q}$	$\frac{2}{Q}$	$\frac{2}{Q}$	$\frac{Q}{Q}$	$\frac{2}{Q}$
60	-	242	-	54	-242	-
80	-	232	-	53	-232	-
100	-	222	-	63	-222	-
120	-	211	-	67	-211	-
140	560	197	73	69	757	72
160	590	180	77	72	690	76
180	450	162	80	73	612	78
200	353	138	79	71	493	76
220	0	112	0	65	112	-
240	-	75	-	55	-	-
260	-	0	-	-	-	-
280	-	0	-	-	-	-

Marked

JUN 17 2004



KELLER ASSOCIATES

☒ Meridian Office

131 SW 5th Avenue, Suite A
Meridian, Idaho 83642
(208) 288-1992

☐ Pocatello Office

412 W Center, Suite 330
Pocatello, Idaho 83204
(208) 238-2146


Project Name: Day Star Water

Calculated By: M. K. A

Date: 4/15/04

Project No. 100074

Sheet 2 of 3

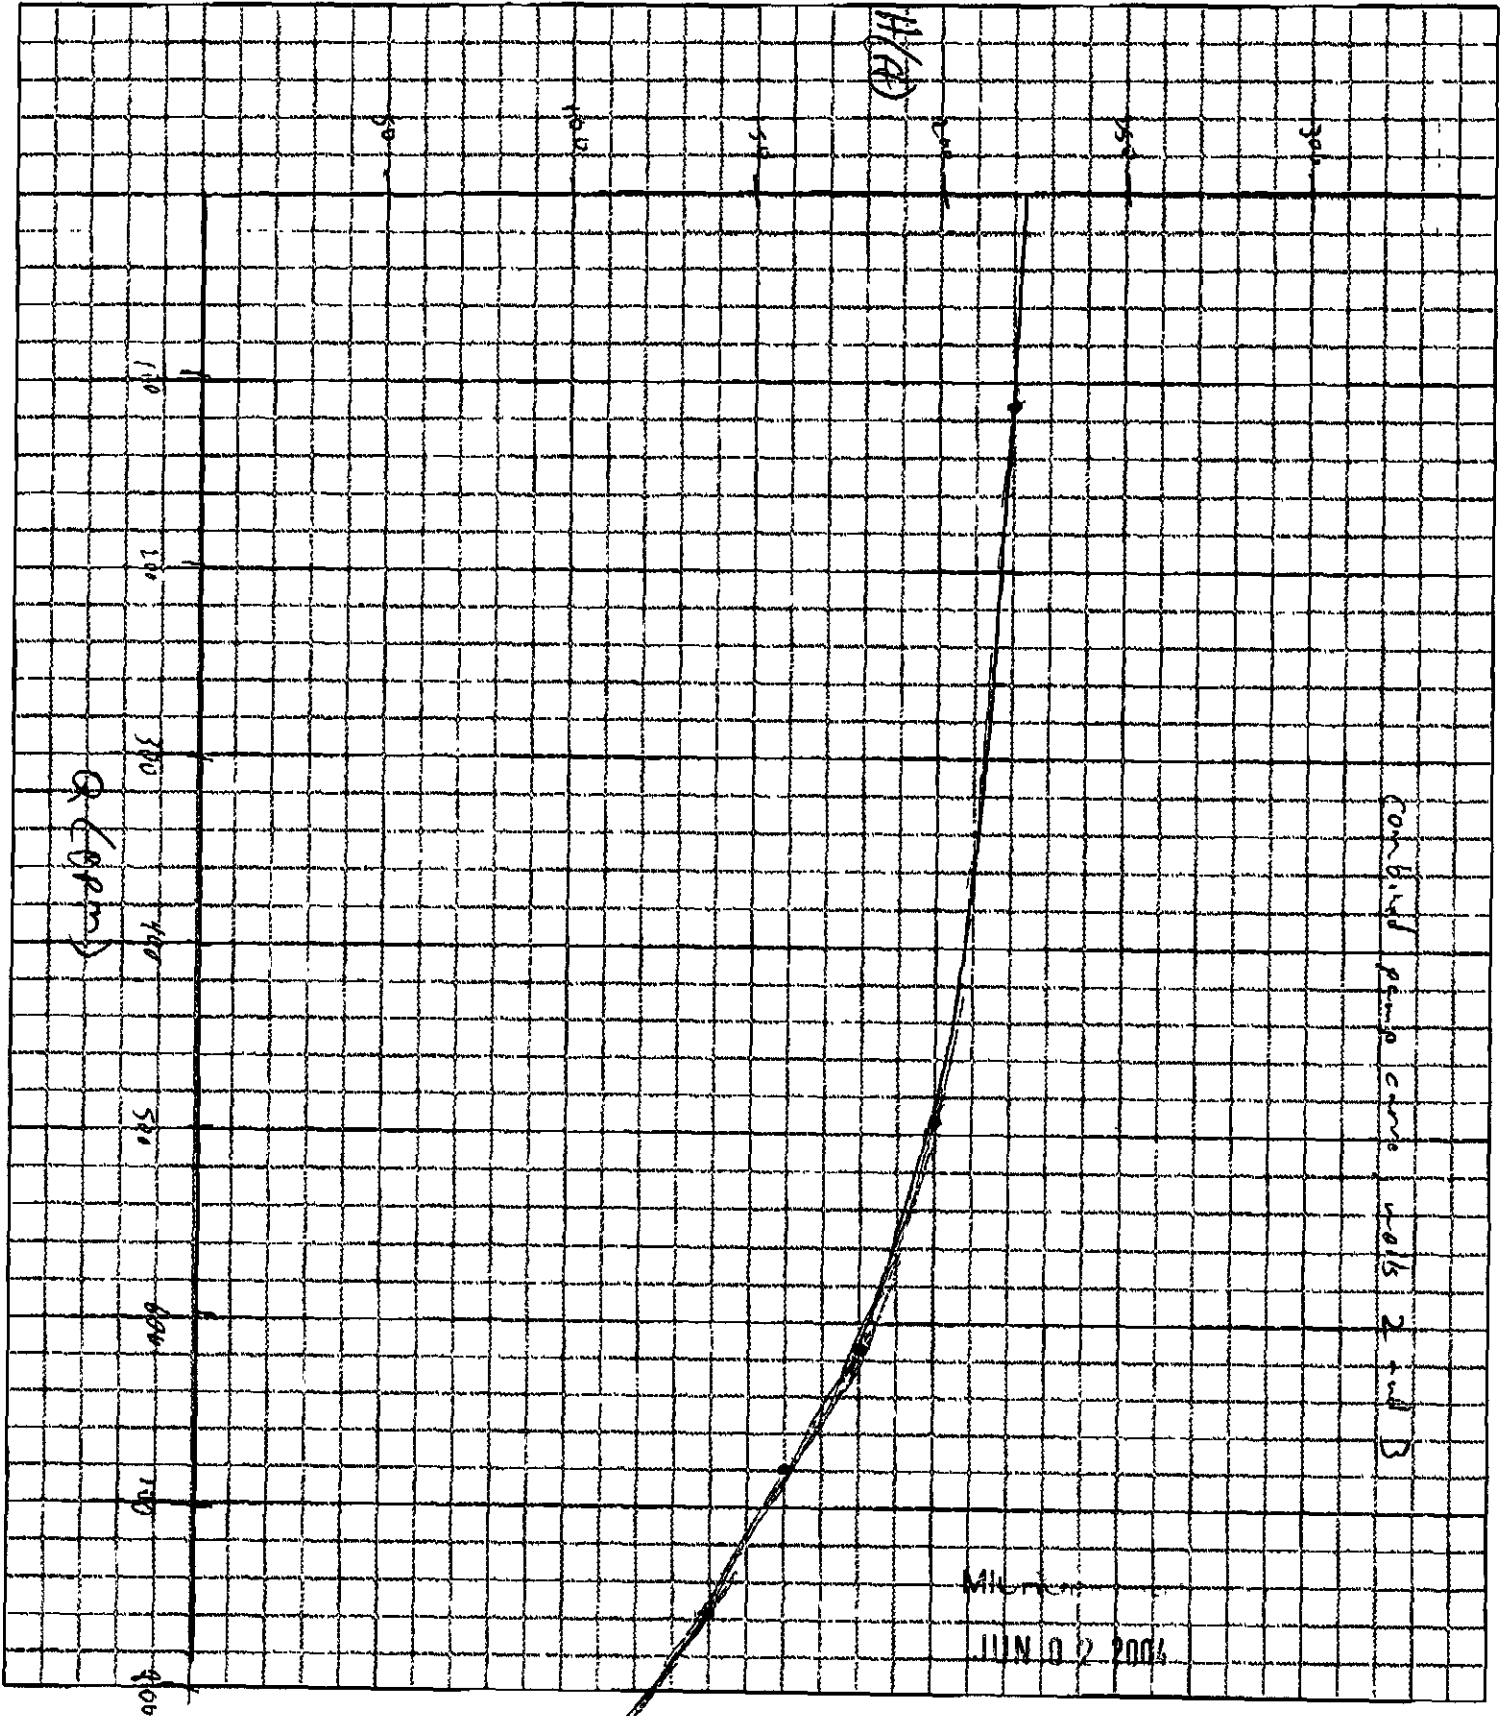



KELLER ASSOCIATES

☒ Meridian Office

131 SW 5th Avenue, Suite A
Meridian, Idaho 83642
(208) 288-1992

☐ Pocatello Office

412 W Center, Suite 330
Pocatello, Idaho 83204
(208) 238-2146

Project Name: Day Star water

Calculated By: Mike A

Date: 4/15/04

Project No. 100074

Sheet 3 of 3

Energy Equation

$$\frac{P_1}{\gamma} + z_1 + \frac{V_1^2}{2g} = \frac{P_2}{\gamma} + z_2 + \frac{V_2^2}{2g} + h_f$$

$$P_1 = 0$$

$$z_1 = 0$$

$$\frac{V_1^2}{2g} - \frac{V_2^2}{2g} \approx 0$$


$$0 = \frac{40 \text{ psi}}{\gamma} + z_2 + h_f$$

$$h_f \approx 5 \text{ ft}$$

$$\frac{40 \text{ psi}}{\gamma} = \frac{40 \text{ lb}}{\text{ft}^3} \cdot \frac{1 \text{ ft}}{62.4 \text{ lb}} = \frac{12 \text{ ft}}{\text{ft}^3} = 92 \text{ ft}$$

$$0 = 92 \text{ ft} + z_2 + 5 \text{ ft}$$

$$z_2 = 97 \text{ ft}$$

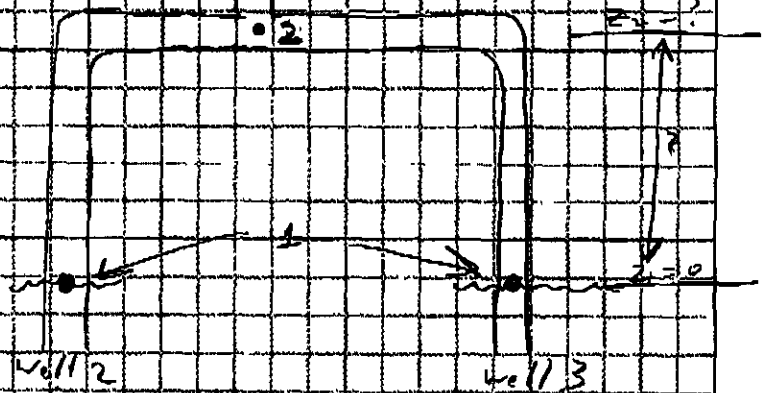

* Assume equal water pumping level
+ Wells are 20' apart

- So pumping water level is around 93 below ground at 40 psi in pump building.
- Therefore, combined pumping head is around 93 ft of elevation head plus around 5 ft of friction head for a total of 98 ft combined head.
- From combined pump curve, system can deliver around 830 gpm at 100 feet of head.

Mike A
4/15/04



10" WELL #2
25 HP SUB. PUMP

Well 2 + 3 are 20' apart
Both located in the NENWSE 54
T15N R3E


AKA LOT 47, ARROWHEAD PT. SUB.



10" WELL #3
10 HP SUB. PUMP

3 18 04

3 storage Tanks
300 gal/ea

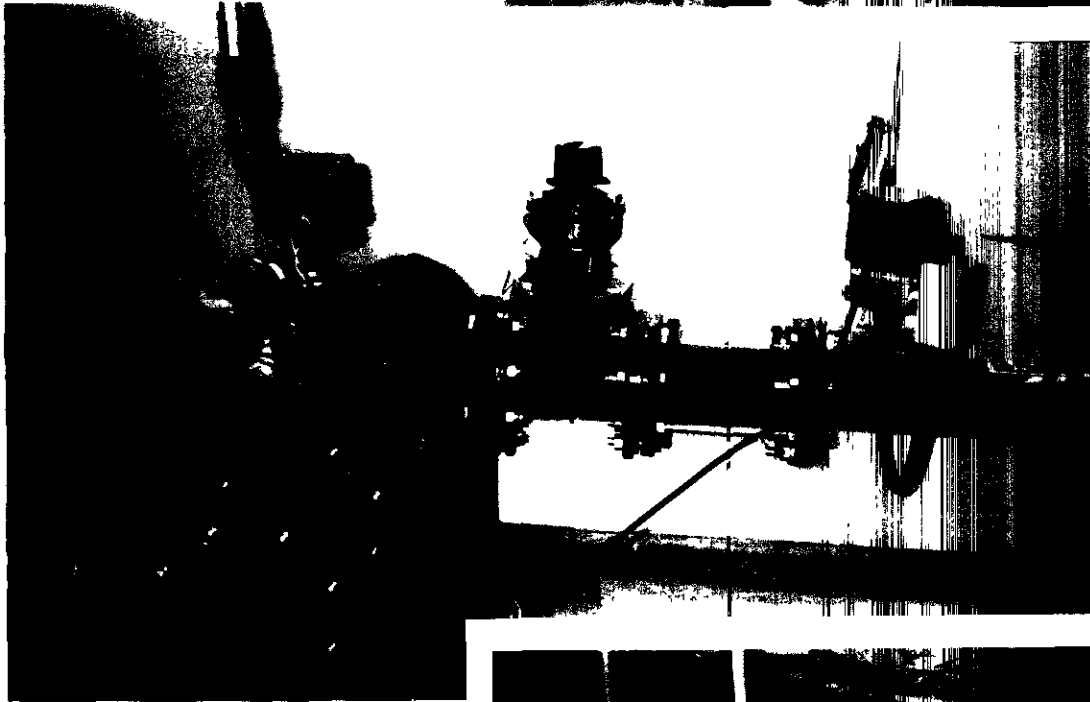

McCrometer
Flowmeter for
Fire hydrants

(McCrometer
Ultra Mag Meter
for domestic)

Pump Control
Panel →



65-22358

RECEIVED

APR 30 2004

Department of Water Resources

THIS INFORMATION

is to be used for

LICENSING AMENDMENT

PER 3/18/04 field exam.

Will need to update d'base

RE 70300 AS needed once

license issued

-JC 4/28/04

Microfilm

JUN 02 2004




12/11/02

- ① get changes ok'd on orig.
title of signer = District Administrator
per other doc. below
- ② W/flow / L notice problems --- get info to SK in
case of road incident

also - ① Remarks tab & d'entry ... did not RESET
to show purpose of amendment (maybe
because a pld to GO when already have
1 pld? nothing happened w/ RESET button).

② Applicant tab - what is purpose of
"Copy Applicant" button?

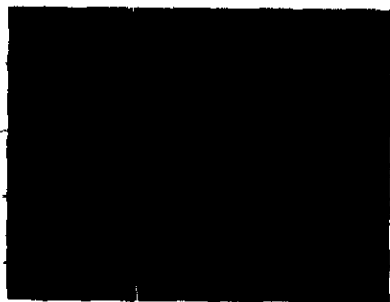

✓ get a Commit Letter for file (PBB) -
✓ amend d'entry & y c com. ✓
e pld ✓
e comments ✓

MA-111111

JUN 12 2004

Revised .. ROB 9/9/02 .. proceed this way

Well #1 pld 65-13361 } same well but
65-13574 } separate lanes per
1994-1995 Exam into

Well # 2 old replacement for Well A1 @ 2001-2002.

But production etc problems. - result was
did not abandon well 12.

WS11 #3 7/10/02 filing "represent WS11"

But really: new well ok as pit 65.22358.

Amount will look add well #2 as second
 old 65.2288 ... so will have 2 wells
 (#2 + #3) in 1.47 for nearest any

will absorb well #1

50 D.P. with
SE e well for
N. Lake re
their 2.47 gals
OK

NOT Result

well #1 Abundant

WGA #2 #14 GS. 13361 + 13574 (Replaced well #1)

1945

MA 02221

p 10 65-22358

WS11 #3

pH " (instead of pH is 5.3)

This is Summary
 Standard. Use to
 complete (2)
 13361/19574

Permit 65. 22358
1st 2

Pro
Notes

- pld
① AP L. 47 NWSE 5.4
② Mt Shaden #4 L. 1/2 BL. 1 NWSE 5.3

Amend → Delete #2
Appl keep #1

add second well in L. 47 to be drilled...
See remarks & background

Permit 65-13361

1st 2 pld

NWSE 5.4 } AP L. 47 NW 1/4 1st #
NWSE 5.4 }

7/94 ex by 12 permit info ... explained in Jan's memo 12/94
12/94 memo (5/94) = correction ...

8" 140' well 1991 NWSE 5.4 AP L. 47 *

O/S (19 lines, 26 studs) int. use only
prior to 1991:

1 well NWSE 5.4, >1991 Serial 013 65.7837
e Mt Shaden #3 + QKNOWNS 5.51

1 well NWSE 5.4 L. 47 (the 8" 140' one) for

O/S AP L. 47 where:

→ 0138 - 13361

017 - 13574

7/95 my Re-ex Confirmed 1 well L. 47 for O/S 2 permits

DEC 8 2004

(Longant 65.9824 Orig = 5.7.1991, claim = 9.10.1991, d. returned &
denied as disallowed ... dupl. cover claim # 65.13574)

* Coj shows well 65.12780 but logged, replaced by 65.13574 so OK

IDAHO DEPARTMENT OF WATER RESOURCES

Water Permit Report 65-22358

WATER RIGHT NUMBER. 65-22358

Owner Type Name and Address
 Current Owner NORTH LAKE RECREATIONAL SEWER & WATER DIST
 PO BOX 729
 DONNELLY, ID 83615

Priority Date 04/05/2001

Basis

Status Active

Source Tributary
 GROUND WATER

<u>Beneficial Use</u>	<u>From</u> <u>To</u>	<u>Diversion Rate</u>	<u>Annual Volume</u>
MUNICIPAL	01/01 to 12/31	2 000 CFS	
	<u>Total Diversion</u>	2 000 CFS	

Location of Point(s) of Diversion

GROUND WATER	L3 SE1/4NE1/4NW1/4	Sec 3,	Twp 15N, Rge 03E, B M
VALLEY County			
GROUND WATER	NE1/4NW1/4SE1/4	Sec 4,	Twp 15N, Rge 03E, B M
VALLEY County			

Place of UseConditions of Approval

- 1 004 The issuance of this right does not grant any right-of-way or easement across the land of another
- 2 01M After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to determine the amount of water diverted from power records and shall annually report the information to the Department
- 3 102 The right holder shall not provide water diverted under this right for the irrigation of land having appurtenant surface water rights as a primary source of irrigation water except when the surface water rights are not available for use. This condition applies to all land with appurtenant surface water rights, including land converted from irrigated agricultural use to other land uses but still requiring water to irrigate lawns and landscaping

Remarks

- 1 Place of use is within the service area of North Lake Recreational Sewer & Water District.
- 2 General Points of diversion are located within Lots 1 and 2, Blk. 1, Mountain Shadows #4 and Lot 47, Arrowhead Point Cottage Sites.

CommentsDates and Other Information

REVIEWER'S notes 12/11/02

15-22358....
 only PLO
 Record s
 g.w. in the
 - to

8/5/02

... Sunday ...

14. 1941

JUN 02 2004

wrAdjudicationRecommendation
 } Alder well previously
 wrWaterFlight } listed 13311 6x e'ly
 } wood just for 7837
 } per 1974, etc

<u>BASIN</u>	<u>Sequence</u> <u>Number</u>	<u>Basis</u>	<u>Status</u>	<u>Priority</u> <u>Date</u>	<u>RATE</u>	<u>Source List</u>	<u>Water Use List</u>	<u>Owner List</u>	<u>Source To Application</u>
65	17064	Decreed	Active	10/19/1977	0.04	GROUND WATER	DOMESTIC	WOODALL, JOANNE P (Current) WOODALL, JOSEPH I (Current)	wrWaterRight
65	17419	Decreed	Active	10/19/1977	0.04	GROUND WATER	DOMESTIC	CRIM, JOHN W (Current), CRIM, SHARON (Current), FISHER, ANN (Current), FISHER, BUDDY R (Current)	wrWaterRight
65	17508	Decreed	Active	10/19/1977	0.04	GROUND WATER	DOMESTIC	GUYER, DALE H (Current), GUYER, DONNA M (Current)	wrWaterRight
65	17588	Decreed	Active	6/4/1981	0.04	GROUND WATER	DOMESTIC	HETHERINGTON, BARBARA J (Current), HETHERINGTON, HERBERT G (Current)	wrWaterRight



65	13361		Active	3/6/1992	0.29	GROUND WATER	DOMESTIC	ARROWHEAD POINT SUBD HOMES ASSN (Current Owner)	wrWaterPermit
65	13574		Active	12/16/1994	0.12	GROUND WATER	DOMESTIC	ARROWHEAD POINT SUBD HOMES ASSN (Current Owner)	wrWaterPermit
65	22358		Active	4/5/2001	2	GROUND WATER	MUNICIPAL	NORTH LAKE RECREATIONAL SEWER & WATER DIST (Current)	wrWaterPermit

PER 1994-1995
CLARIFIED INFO
1991 WGLI PERMITS
6,477 for combined
w/45 & AP 5-64

EXPLANATION OF APPLICATIONS

There are two entities to mention. One is the Arrowhead Point Homeowners Association (AP). The second is the North Lake Recreational Sewer & Water District (NL). AP previously owned Lot 47 and one well constructed in the early 90's (water right no. 65-13361), referred to as Well 1. In 2001, AP drilled a test well with the intent to replace Well 1. In 2002 they completed Well 2. At the same time, NL formed a water LID, applied for and received water permit no. 65-22358, and purchased Lot 47, and both Wells 1 & 2 from AP. AP retained ownership of water right no. 65-13361. Well 1 still serves some residents in AP subdivision with right no. 65-13361. Well 2 is online and serving some residents in the surrounding subdivisions of District homeowners with permit no 65-22358.

NL's water permit calls for one point of diversion in Lot 47 of AP (Well 2) and one between Lots 1 and 2 in Mtn. Shadows Subdivision 4 in Section 3. The attached amendment application is to remove this other point of diversion and add a second point of diversion to Lot 47.

The attached drilling permit application and well abandonment application is to drill a new well to replace Well 1. The intent is to drill a new well (Well 3) with the new drilling permit and the water right for Well No. 1 (65-13361). Then Well 1 would be abandoned when Well 3 comes online after the building and pumping plans are finished. Before Well 3 is online with all building and pumping facilities in place, we expect to have the second point of diversion approved. Then the amended permit (65-22358) would be used for Wells 2 and 3 and turned on to the system delivering water to all surrounding subdivisions.


RECEIVED

JUL 10 2002


WATER RESOURCES
WESTERN REGION

6/11/02

JUN 10 2 2002

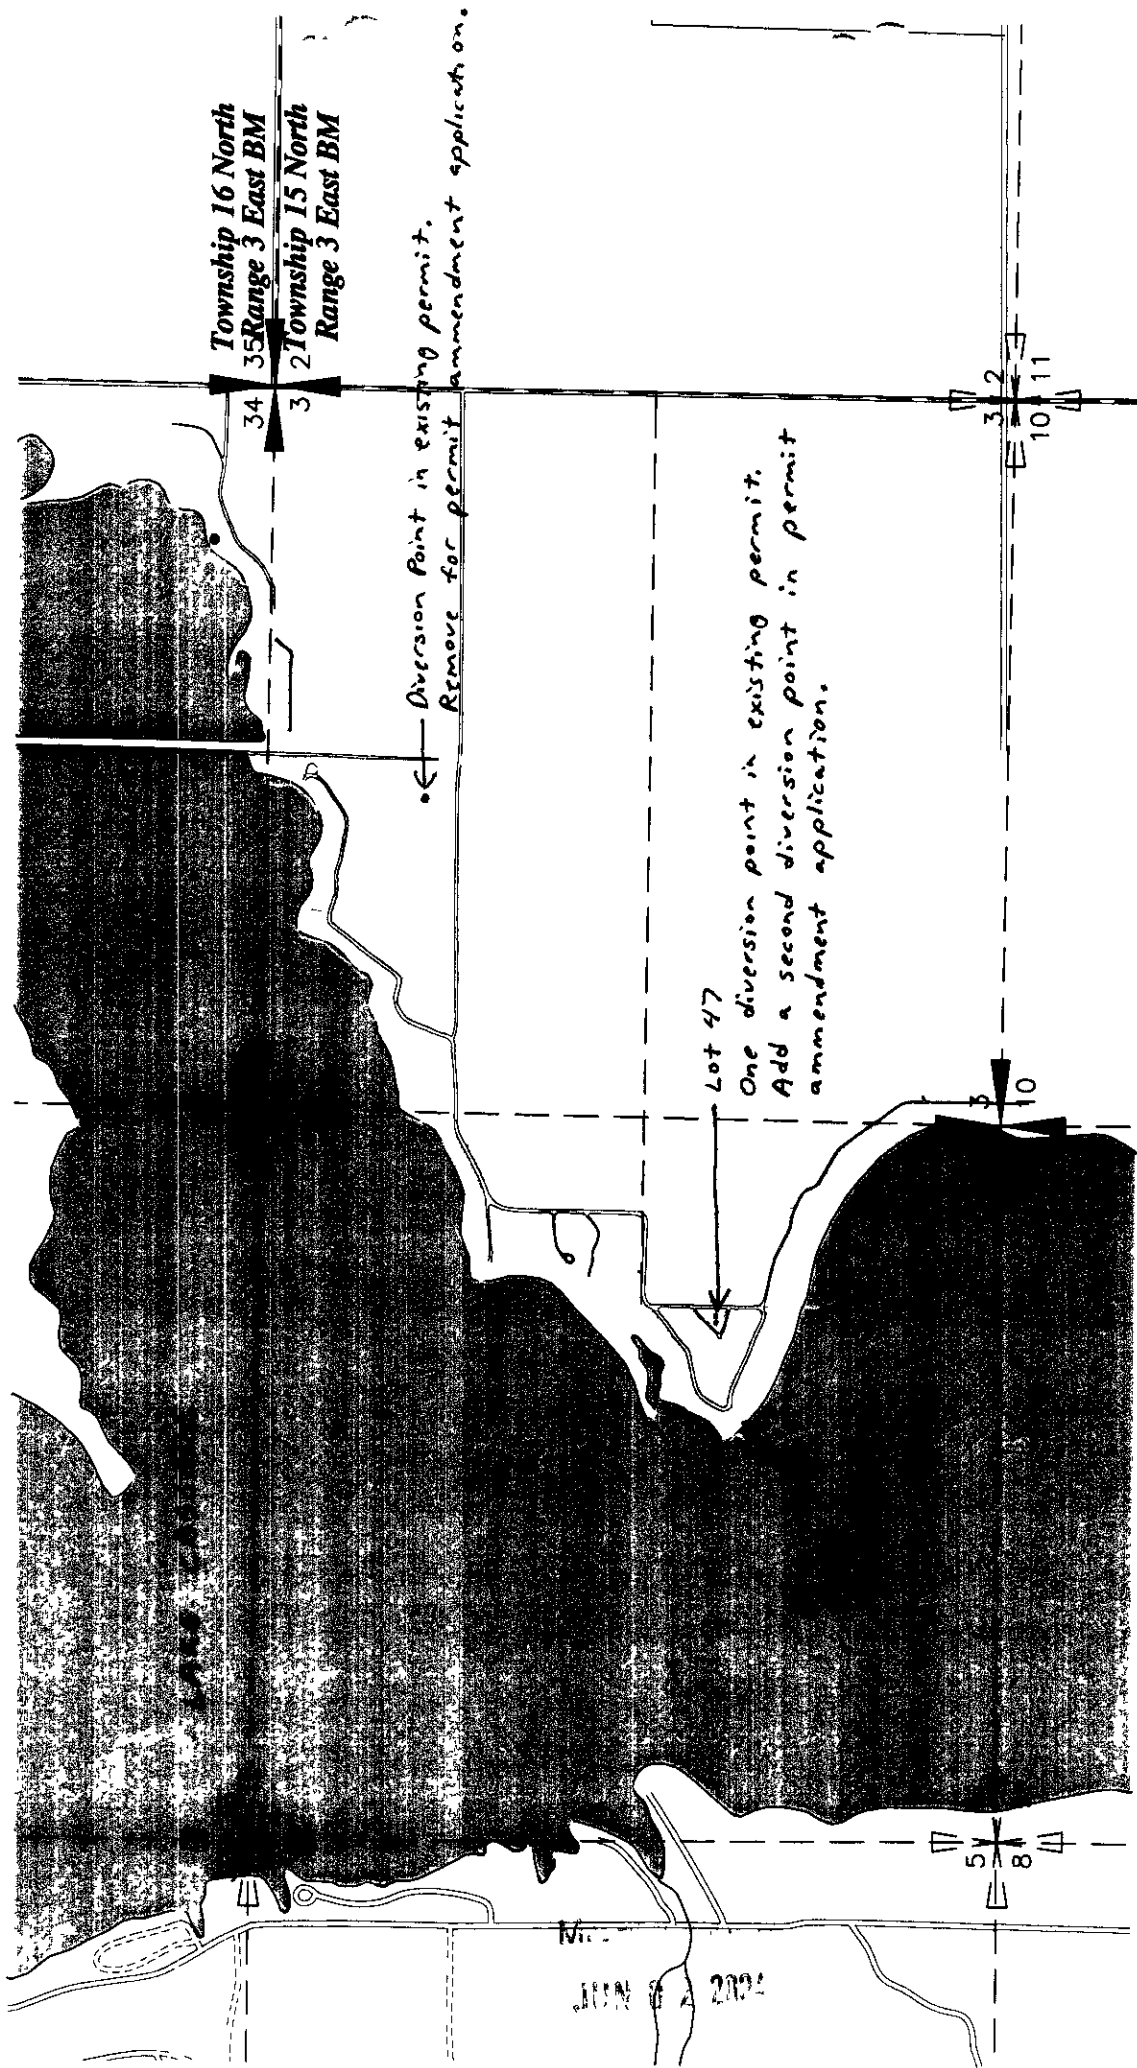

NORTH LAKE RECREATIONAL SEWER & WATER DISTRICT

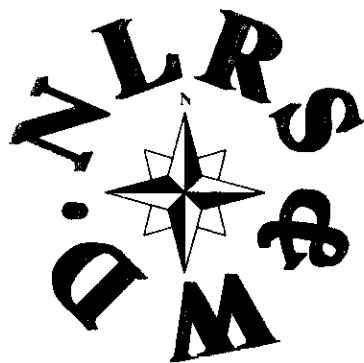

*Submitted
Amendment Appd.
Well drilling Appd.
for 65-22358*

CONSTRUCTION OF DAYSTAR WATER SYSTEM

RECEIVED

JUL 10 2002


WATER RESOURCES
WESTERN REGION

KA NO. 100074

JULY 2002



131 S.W. 5TH AVENUE, SUITE A
MERIDIAN, IDAHO 83642
(208) 288-1992

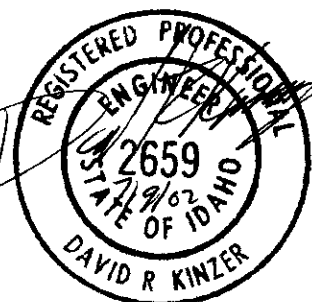

5. **CONDITION OF WELL, REPAIRS REQUIRED**

Well has a lot of iron bacteria and produces over 7ppm of iron in the drinking water. Well production is not sufficient for the demand in the new Day Star distribution system.

6. **PROPOSED METHODS OF REPAIR OR ABANDONMENT**

(This Application must be approved prior to commencement of operations)

Pumps and columnn will be removed and the pipe leaving the pitless adapter will be cut and capped. The well will be filled with bentonite grout by gravity through a tremie pipe. Grout will be filled to the ground surface. The top of the well casing will be capped and welded shut.

7. **NAME OF DRILLER OR INDIVIDUAL PERFORMING THE REPAIR OR ABANDONMENT**

Stevens and Sons Well Drilling

8. **DATE OF PROPOSED REPAIR OR ABANDONMENT** August or September of 2002 (See Attached Explanation)

9. **APPLICANT'S SIGNATURE**

Bill Eddy

DATE:

6-25-02

Title Bill Eddy, District Administrator

(Owner, Firm Representative, Other)

ACTION OF THE DEPARTMENT OF WATER RESOURCES

This application for repair/abandonment is _____ Date _____

This approval does not constitute an endorsement of the proper abandonment of this well, without an attached document prepared by an Idaho Licensed Water Well Driller, Professional Geologist or Engineer who witnessed the procedure. This approval is subject to the following conditions of approval. READ CAREFULLY!

CONDITIONS OF APPROVAL:

1. Pursuant to Section 42-238(4), Idaho Code. All repairs and/or abandonment must meet the requirements of the Department's Rules and Regulations for Well Construction Standards.
2. Abandonment or repair of this well may require the services of a well driller licensed in the State of Idaho.

Signature of Authorized Department Representative

*e well abandonment
described in
amendment explanation
Eddy's title
shows*

**IDWR WESTERN REGION
AMENDMENT OF PERMIT ANALYSIS SHEET**

Application i.d. # 70300 Permit # 65-22358

* Applicant North Lake Recreational Sewer + Water District

Reviewed by FL Data entry by FL Date 12/11/02

Legal Notice: Word filename AMENDMENT 65-22358

OR Use Workflow ad _____

Purpose of Amendment ☒ Change P/D _____ Add P/D _____ Increase Amount
_____ Change P/U _____ Other: _____

CHECK:

- ☒ Description of amended elements
- ☒ Ownership of P/D and P/U and arrangement for access if not owned by applicant.
- ☒ Map ☒ \$50 Fee.
- ☒ Signature, must be permit holder. Include title if applicant is an organization, partnership etc. ^{pending}
- ☒ Existing water rights from the same source for amended P/D or P/U?
Right No(s). Explained in memo (pending)
- yes Should amendment be advertised?
- NO Should date of priority be delayed? If yes, to what date? _____
- yes Send **comment Letters**? Check any of the following to indicate "yes":
 - _____ IDFG for surface water _____ Water District No. _____
 - _____ Water Planning Bureau for protected river or minimum flow reach – reviewer should forward copy of application instead of sending a letter
 - ☒ Other, ~~see attached mailing list~~ = DEQ
 - _____ Additional analysis information attached. Date of the information is _____

Local contact

→ Mike Anderson - Keller Associates 288-1992

FINAL REGIONAL PROCESSING REVIEW:

/ Affidavit of publication received

/ Published correctly? N/A Re-publication required if published incorrectly?

N/A Protests processed.

N/A Watermaster comments received on date: _____

N/A Other comment letters received? None from DEQ but IOWA will coordinate with DEQ in drilling permit work so ok.

Recommendation and Conditions of Approval: _____ APPROVE _____ DENY

By _____

Date _____

Copy for Region file after final recommendations are complete. Always include application, legal notice, staff analysis sheet, and analysis memo (if applicable). List other items to copy:

NOTE to S.O. STAFF - SEE my 12-11-02 NOTES

"Sample of Amendment Legal Notice ..."
Workflow continues to substitute amendment appl. data for existing permit data. This means one has to then tweak workflow product to make a sensible ad. But version posted e Interest remains inconsistent with requested desired result: show permit as it is, then list proposed changes in legal notice Remarks.

Publisher's Affidavit of Publication

STATE OF IDAHO

.SS

County of Valley

I, Carol J. Wright, being duly sworn and say, I am the receptionist of The Star-News, a weekly newspaper published at McCall, in the County of Valley, State of Idaho, that said newspaper is in general circulation in the county of afore said and is a legal newspaper, that the PUBLIC NOTICE, a copy of which is enclosed hereto and is a part hereof, was published in said newspaper once a week for a period of two weeks in the regular and entire issue of every number thereof during the period of time of publication, and was published in the newspaper proper and not in a supplement, and that publication of such notice began December 19, 2002 and ended December 26, 2002

Carol J. Wright


Subscribed and sworn before me this the 26th day of December, 2002
STATE OF IDAHO

COUNTY OF VALLEY

On this 26th day of December, in the year of 2002, before me, a Notary Public, personally appeared Carol J. Wright, known or identified to me to be the person whose name subscribed to the within instrument, and being by me first duly sworn, declared that the statements therein are true, and acknowledged to me that she executed the same

Tom Grote

Tom Grote
Notary Public for Idaho
Residing at McCall, Idaho
Commission Expires 2/8/06

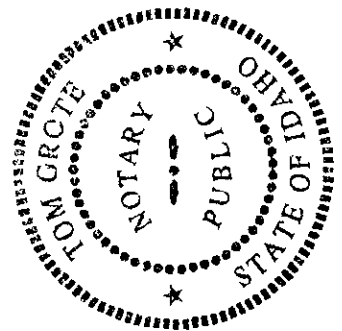

NOTICE OF APPLICATION FOR AMENDMENT OF WATER PERMIT

North Lake Recreational Sewer & Water District of PO Box 729, Donnelly ID 83615 has applied to the Department of Water Resources to change the point of diversion pursuant to I.C. § 42-411 for the following ground water permit in T15N R3E, Valley County:

1. 22358, priority 4-5-2001, two wells authorized in SENENW S3 (Mt. Shadows #4) and NENESE S4 (Arrowhead Point Cottage Sites) for 2.0 cfs year around municipal use in district service area. The permit authorizes one well per subdivision site.

2. Proposed Amendment: drill a second well in Arrowhead Point site instead of Mt. Shadows site. Both wells will be in Lot 47 of Arrowhead Point site.

The permit will be subject to all prior water rights. Any protest against approval of the proposed amendment must be filed with the Department of Water Resources, Western Region, 2135 Airport Way, Boise, ID 83705-5082, together with a protest fee of \$25 for each

application on or before January 6, 2003. The protestant must also send a copy of the protest to the applicant.

Karl J. Dreher, Director 20c12/26



State of Idaho

DEPARTMENT OF WATER RESOURCES

Western Region, 2735 Airport Way, Boise, Idaho 83705-5082 - (208) 334-2190

FAX (208) 334-2348

December 12, 2002

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

DIV OF ENV QUALITY
BOISE REGIONAL OFFICE
PO BOX 83720
BOISE ID 83706

Re: Application for Permit No. 65-22358 in the Name of North Lake Recreational Sewer & Water District.

Dear Sir or Madam:

Enclosed is a copy of the above-referenced application, which may be of interest to your agency. Please review the application and submit any comments you may have.

This office normally completes the processing of an application within a six-week period and is required to take final action shortly thereafter. However, if your agency desires to file a formal protest against the approval of this application, your written protest along with the \$25.00 protest fee must be received in this office by January 6, 2003.

If you have any questions regarding the application, please contact this office.

Sincerely,

A handwritten signature in black ink, appearing to read 'Steve Lester'.

Steve Lester

SL:lm

Encl: Copy of Application

Handwritten notes:
M...
...

Taylor, Sue

From: The Star-News [starnews@citlink.net]
Sent: Wednesday, December 11, 2002 3:01 PM
To: Taylor, Sue
Subject: Re. LegalNotice.RTF



Card for The
Star-News

Thank you. - Tom Grote, The Star-News, McCall

"Taylor, Sue" wrote:

> Hi. Please let me know when you receive this.Thanks,Sue

McCall, ID
11/11/02



State of Idaho

DEPARTMENT OF WATER RESOURCES

Western Region, 2735 Airport Way, Boise, Idaho 83705-5082 - (208) 334-2190

FAX (208) 334-2348

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

December 11, 2002

Legal Notice Department

STAR NEWS

1000 1ST ST

MC CALL ID 83638

RE: Application for Permit No. 65-22724

Dear LEGAL NOTICE DEPARTMENT:

Enclosed you will find a legal notice which we wish to have published in your newspaper on the dates indicated (once a week for two consecutive weekly issues). If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Please send the affidavit and bill to this office before 01/06/2003. Your cooperation is appreciated.

Sincerely

A handwritten signature in cursive script, appearing to read 'Sue', is written over a horizontal line.

Sue Taylor
Senior Secretary

MISSOURI

DEC 11, 2002

Notice of Application for Amendment of Water Permit

North Lake Recreational Sewer & Water District of PO Box 729, Donnelly ID 83615 has applied to the Department of Water Resources to change the point of diversion pursuant to I.C. § 42-211 for the following ground water permit in T15N R3E, Valley County:

65-22358, priority 4-5-2001, two wells authorized in SENENW S3 (Mt. Shadows #4) and NENWSE S4 (Arrowhead Point Cottage Sites) for 2.0 cfs year around municipal use in district service area. The permit authorizes one well per subdivision site.

Proposed Amendment: drill a second well in Arrowhead Point site instead of Mt. Shadows site. Both wells will be in Lot 47 of Arrowhead Point site.

The permit will be subject to all prior water rights. Any protest against approval of the proposed amendment must be filed with the Department of Water Resources, Western Region, 2735 Airport Way, Boise, ID 83705-5082, together with a protest fee of \$25 for each application on or before January 6, 2003. The protestant must also send a copy of the protest to the applicant.

Karl J. Dreher, Director

Published on December 19 and 26, 2002.

MICRO. 10/11/02
10/11/02

**NORTH LAKE RECREATIONAL
SEWER & WATER DISTRICT**

BILL EDDY
DISTRICT ADMINISTRATOR

**P.O. Box 729
DONNELLY, ID 83615**

**TELEPHONE: (208) 325-8958
FAX: (208) 325-5017**

MICROFILMED



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Boise, ID 83706 - P.O. Box 83720, Boise, ID 83720-0098
Phone: (208) 327-7900 Fax: (208) 327-7866 Web Site: www.idwr.state.id.us

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

July 18, 2003

NORTH LAKE RECREATIONAL SEWER AND WATER DISTRICT
PO BOX 729
DONNELLY ID 83615

PROOF ACKNOWLEDGEMENT LETTER

RE: PERMIT NO. 65-22358

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form and examination fee submitted for the above referenced permit. Enclosed is an order reinstating the permit advancing the priority since proof was submitted after the proof due date. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water. The regional office staff will contact you when that examination is to be conducted. At the time the examination is conducted the system must be in operation, otherwise this permit will be of no force nor effect.

Be advised that Section 42-248, Idaho Code, requires you or the owner of these water rights to maintain current ownership and address records on file with the department. Forms to file a change of ownership of a water right and/or a change in the address of the water right owner are available from any department office.

If you have questions concerning the field examination, please contact the **Western** Regional Office of the department in Boise at (208) 334-2190.

Sincerely,

Deborah J. Gibson
Administrative Assistant
Water Allocation Bureau

Enclosure

c: IDWR - Region (w/encl.)

MICROFILMED

SEP 09 2003

ANALYSIS SHEET FOR PROOF OF BENEFICIAL USE

Permit No.: 65-22358

Reviewed By: dgibson

Date: July 17, 2003

	<u>Yes</u>	<u>No</u>		<u>Yes</u>	<u>No</u>
Proof received timely?		X	Drilling permit required?		X
License examination fee required?	X		Drilling permit No :		
Appropriate fee submitted?	X		Drilling permit upgrade needed?		
Receipt No.:		W027358, C069675	Well driller's report filed?		
Additional Amount Due:			Measuring device required?		X
Name and address same as permit?	X		Measuring device installed?	X	
Are the water uses correct?	X		Measure device waiver requested?		

Priority Calculation

Date proof received	06/20/2003	
Date proof due	- ~~06/01/2003~~	<i>Permit shows 7/1/03</i>
Lapse notice sent	- 06/05/2003	
No. of days late	= 19	
Holiday allowance	+	
Priority date	+ 04/05/2001	
New priority date	= ~~04/24/2004~~	<i>no advance</i>

Deficiencies of Actions Items

Acknowledge proof. ~~Reinstate permit and advance priority to April 24, 2004~~

*Reinstated based on dept. Mktg. Database
Changes made.*

Gibson, Deborah

From: Lester, Steve
Sent: Friday, May 23, 2003 9:25 AM
To: Gibson, Deborah
Subject: 65-22358 North Lake Rec. Sewer & Water

Debbie:

I got a note from Dan about a call from Mike Anderson inquiring about amendment application & filing proof for this permit.

I have the amendment application, which was filed last July. Should have finished up with it long ago but you know how these things can linger sometimes. No problems with the amendment, which was advertised & not protested. I am 100% sure we will approve the amendment.

There is a long story behind the new well but should not be a problem with respect to this permit. The drilling permit was approved last September with a standard condition that drilling approval did not constitute water right approval. Probably should have had more explicit condition that well could not be used for 65-22358 until amendment approval occurred. Maybe the best thing is for them to file proof & for us to note that a timely amendment application was filed 7-10-2002 but other more urgent matters have prevented completion of the amendment process. Perhaps the amendment could be approved for a "retroactive ok" if I can use that term. Or we might decide it's better to hold the amendment application and use it to amend the permit within the licensing process (we could do an exam asap under this option). Not their fault that dept. delay prevented approval of the amendment prior to filing proof. There should be a fairly easy way to recognize use of the new well under 65-22358.

I think they should file proof and show what was developed based on the above outline. If this won't work for some reason &/or you need more information, please let me know. I have a call in to Mike to advise him along these lines so they can proceed with filing proof. They can meet their deadline and we can do any clean up as needed.

Steve

MICROFILMED

SEP 09 2003

June 5, 2003

NORTH LAKE RECREATIONAL SEWER & WATER DIST
PO BOX 729
DONNELLY, ID 83615

LAPSE NOTICE

RE: PERMIT NO. 65-22358

Dear Permit Holder:

You are hereby notified that under the provisions of Section 42-218A, Idaho Code, the above referenced permit has lapsed and is of no further force nor effect. The department provided the proper forms to you in the proof due notice dated March 31, 2003. No further construction or additional development is authorized under this permit unless it is reinstated.

The permit can only be reinstated if you submit an acceptable proof of beneficial use or an acceptable request for extension of time to the department within sixty (60) days of the mailing of this lapse notice. An acceptable proof of beneficial use submittal must include the examination fee or a completed field examination report. A request for extension of time must be accompanied by a fifty dollar (\$50.00) fee.

Enclosed again for your use are a proof of beneficial use form and a request for extension of time form. Please note that only one extension of time can be granted unless the project has not been completed because of lack of a necessary approval by a government agency or by litigation which may bring title to the water in question.

Sincerely,

L. Glen Saxton, Chief
Water Allocation Bureau

Enclosures

CERTIFICATION OF MAILING

I hereby certify that on 6/5/03
~~a copy~~ an original of this document was
deposited in the United States mail,
postage prepaid addressed to the
individual(s) named above.



MICROFILMED

JUN 9 2003

March 31, 2003

NORTH LAKE RECREATIONAL SEWER & WATER DIST
PO BOX 729
DONNELLY, ID 83615

PROOF DUE NOTICE

RE: PERMIT NO. 65-22358

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before June 01, 2003. (See last page of your approval permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a completed field examination report prepared by a certified water right examiner may be used to submit the required proof.

If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.


Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.

Sincerely,

Deborah J. Gibson, Administrative Assistant
Water Allocation Bureau

Enclosures

MICROFILMED
SEP 09 2003

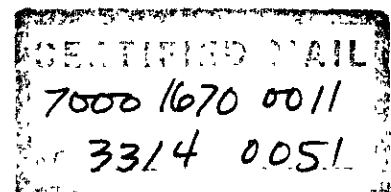



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Boise, ID 83706 - P.O. Box 83720, Boise, ID 83720-0098
Phone: (208) 327-7900 Fax: (208) 327-7866 Web Site: www.idwr.state.id.us

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

July 1, 2002

NORTH LAKE RECREATIONAL SEWER AND WATER DISTRICT
PO BOX 729
DONNELLY ID 83615

RE: PERMIT NO. 65-22358

Dear Permit Holder:

Enclosed is a copy of the approved request for extension of time submitted in connection with the above referenced permit which extends the time within which to submit proof of beneficial use of water to **July 1, 2003**.

Please note that the department granted this extension based on **due diligence**. It is important that you work diligently toward the completion of this project during the construction period allowed since the department may not be able to grant additional extensions based on due diligence.

Section 42-248, Idaho Code, requires you or the owner of this water right to maintain current ownership and address records on file with the department. Please contact any office of the department for the proper form to file a change of ownership of a water right and/or a change in the address of the owner.

Please feel free to contact the department if you have questions.

Sincerely,

Deborah J. Gibson
Administrative Assistant
Water Allocation Bureau

Enclosure

c: IDWR - Regional Office

MICROFILMED
SEP 09 2003

ANALYSIS SHEET FOR EXTENSION OF TIME

Permit No 65-22358

Reviewed By dgibson

Date June 28, 2002

	<u>Yes</u>	<u>No</u>		<u>Yes</u>	<u>No</u>
Request received timely?	X		Is delay by a government agency?		X
Appropriate fee	X		Is supporting documentation needed to support the file?		
Additional Amount Due.					
Receipt No		W027358, W029373	Has the permit been involved in litigation?		X
Name and signature same as permit?	X		Is supporting documentation needed to support the file?		
Is address same as permit?	X		Is the project more than 25,000 acre feet for irrigation or 10,000 acre feet for a reservoir?		
Has adequate work been completed to demonstrate due diligence?	X				

Priority Calculation

Extension request received	06/25/2002	New proof due date	06/01/2003
Date proof due	- 07/01/2002		
Lapse notice sent	-		
No of days late	= 0		
Holiday allowance	+		
Priority date	+ 04/05/2001		
New priority date	= 04/05/2001		

Action Taken

Acknowledge request and extend proof deadline to 7/1/2003

April 30, 2002

NORTH LAKE RECREATIONAL SEWER & WATER DISTRICT
PO BOX 729
DONNELLY, ID 83615

PROOF DUE NOTICE

RE: PERMIT NO. 65-22358

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before July 01, 2002. (See last page of your approval permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a completed field examination report prepared by a certified water right examiner may be used to submit the required proof.

If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.


Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.

Sincerely,

Deborah J. Gibson, Admin. Assistant
Water Allocation

Enclosures

MICROFILMED
SEP 09 2003

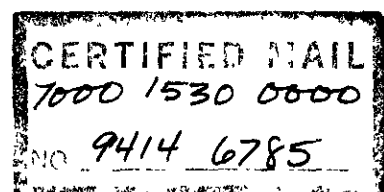



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Boise, ID 83706 - P.O. Box 83720, Boise, ID 83720-0098
Phone: (208) 327-7900 Fax: (208) 327-7866 Web Site: www.idwr.state.id.us

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

July 10 2001

NORTH LAKE RECREATIONAL SEWER & WATER DISTRICT
PO BOX 729
DONNELLY ID 83615

RE Permit No 65-22358

Permit Approval Notice

Dear Permit Holder

The Department of Water Resources has issued the enclosed permit authorizing you to establish a new water right. Please be sure to thoroughly review the conditions of approval and remarks listed on your permit.

The permit is a PRELIMINARY ORDER issued by the Department pursuant to Section 67-5243 Idaho Code. It can and will become a final order without further action by the Department unless a party petitions for reconsideration or files an exception and/or brief within fourteen (14) days of the service date as described in the enclosed information sheet.

Enclosed is a form entitled 'Instructions for Proof of Beneficial Use.' Please read the instructions carefully since you must take further action to develop this permit into a licensed water right. Also enclosed is a form entitled 'Proof of Beneficial Use.' If your project is already completed, you should complete and submit this form immediately.

The right to drill a well is not a part of this permit to appropriate water. Beginning in July of 1987, a statute was enacted which requires a drilling permit for new well construction and deepening of existing wells. If the well(s) proposed for use under this water right permit were drilled or deepened after July 1, 1987, a separate drilling permit must be obtained from this Department. Please contact the Ground Water Protection Section located here at this office or our regional office nearest you.

Also, please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Failure to report these changes could result in a \$100 late filing fee. Contact any office of the Department or visit the Department's homepage on the Internet to obtain the proper forms and instructions.

MICROFILMED
SEP 19 2001

If you have any questions, please contact me at 208-327-7946

Sincerely,

A handwritten signature in black ink, appearing to read "Shelley Keen". The signature is fluid and cursive, with the first name "Shelley" and last name "Keen" clearly distinguishable.

Shelley W. Keen
Water Rights Supervisor

SWK klt

Enclosure(s)

MICROFILMED
SEP 19 2001

CERTIFICATE OF MAILING

I hereby certify that on July 10, 2001 I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER(Approved Permit) to the person(s) listed below

RE: WATER RIGHT NO. 65-22358

**NORTH LAKE RECREATIONAL SEWER & WATER DISTRICT
PO BOX 729
DONNELLY ID 83615**

A handwritten signature in cursive script, reading "Kari Lynn Townsend", written over a horizontal line.

**Kari Lynn Townsend
Secretary**

**MICROFILMED
SEP 19 2001**

**EXPLANATORY INFORMATION
TO ACCOMPANY A
PRELIMINARY ORDER**

The accompanying order or approved document is a "Preliminary Order" issued by the department pursuant to section 67-5243, Idaho Code It can and will become a final order without further action of the Department of Water Resources (department) unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the department or the Idaho Water Resource Board (Board) is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01303 (Rules of Procedure 302 and 303)

MICROFILMED
SEP 19 2001

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

APPLICATION FOR PERMIT
STATE OFFICE ANALYSIS

Reviewed by Sharla Curtis on 6/13/01

No 65-22358 Name Nlake Reservoir Corp. Officers ☒ Ad ok ☒ Govt Lots

AREA OF CONCERN: ☒ No/Yes ☐ Moratorium ☒ GWMA ☒ TRUST/NON-TRUST

GROUNDWATER (✓Flow Chart)

DRILLING PERMIT

All wells - 046
Basin 34 - 084 (if necessary)
WMD - North/East/West
≤ 0.24 cfs/5 acres - No MD
✓ 0.24 cfs/5 acres - 067

~~WMD~~

Supply (irr = only use) - 065-104
Supply (+ other uses) - 100-105
≤ 0.24 cfs/5 acres - No MD
> 0.24 cfs/5 acres - 01M

LOCATION:

Boise Front LoGeo - 058 (<85 GW)
Mitigation - 121

Trust - 051 (consumptive uses)
Non-Trust - 048-049 (consumptive uses or non-cons > 10 cfs)

USES:

STORAGE - 18C-01H-01P-18B-NA
IRR ≤ 5 ac - R66/R67/R68/R69 (0.03 cfs/ac)
> 5 ac - R62/R63/R64/R65 (0.02 cfs/ac)
STOCKWATER - R37 (BLM/FS)-111 (instream stock)
MINING - 054-106
FISH PROP - 029 (70's only)-007-042-106
HEAT/COOL - R07 (injection well)
FIRE PROT - 077
COMMERCIAL/
INDUSTRIAL - 106-R07
DAIRY - 082-WD8

SURFACE WATER: (✓Flow Chart)

F&G contacted - Yes/No Response
In/Above MSF - WB9

PLANNING REVIEW/RESPONSE

WD - R04 (WD#)
≤ 0.20 cfs/others - 01H(P01), 01P or No MD
> 0.20 cfs - 01J

SPRINGS/SINK, INACTIVE WD or WD

≤ 0.24 cfs/5 acres - No MD
> 0.24 cfs/5 acres - 01M or No MD

RIVER BASINS: (SW special considerations)

Snake R (01) - W22, N/A
(02,03) - 007 (w/ remark WB9 if above Weiser)
Payette R (65) - W22, 047 (Payette Lake)
Salmon R (70's) - 029 (fish screens)
Weiser R (67) - 086-087

USES.

POWER - 17H or 17K (+uses)-17G (not under FERC)
or 17M (FERC regulated >25 cfs or 500hp)
08A-025-027-01N-106-W13 (if dewatering stream)

MUNICIPAL

Restricted area - 022,075
Irr, GW supp to SW - 102

DOMESTIC

Surface water - WB5 (Big Wood or Boise above Star Bridge)
27A (Payette R)
> 1 in restricted area - 070-071-075 (no parks/common areas, etc)
Irr use listed separate
or none allowed - WB5
Moratorium approvable - W03 (2500 gpd - meets domestic definition
i.e. D/convenience store)

BENEFICIAL USE DUE: 1/01/2002

MISC CONDITIONS/REMARKS:

Protested - 020-W19
Development Period
> 1 yr - 26A
Ownership - 004
Non-consumptive - 027
Water Quality - 106-R07

Multiple pd's per 1/4 - W32
Subd lot desc (pd) - W59 Lots 1 & 2, Blk 1, Mtn Shadows
Subd lot desc (pu) - W60 & Lot 47, Arrowhead Point
Use definitions - W02 example - S/50 range Cottages
Pre-1987 development - 068-074 (allow 120 days for proof due) Site
Single p/d intended - 076

IRRIGATION SEASON - (Per updated map)

IRR VOLUME/ACRE

OTHER CONDITIONS/REMARKS

COMMENTS This filing is for current needs only - no future needs as planning horizon info req'd

January 2001

TO DEPARTMENT OF WATER RESOURCES
APPROPRIATION APPLICATION ANALYSIS SHEET

INITIAL REVIEW BY: DAN DATE: 3-1-01 APPLICATION: 65-22358

APP ID # 69021

REQUIRED INFORMATION

- ☒ Name: (If applicant is a corporation or partnership, names and addresses for the director, officers, and other partners must be included.)
- ☒ Address:
- ☒ Source: (See USGS Quad for names of water sources)
- ☒ Point of Diversion: (10 acres for spring, lot & block descriptions for Subdivisions, local name)
- ☒ County:
- ☒ Quantity: (flow and/or volume)
- ☒ Period of use:
- ☒ Nature of proposed use: (Include description of use)
- ☒ Description of diverting works:
- ☒ Time required for beneficial use of water:
- ☒ Place of use or acres irrigated: municipal service area map supplied.
- ☒ Map: (show T, R, S, QQ &/or QQQ)
- ☒ Subdivision plat: (for > 1 home in restricted area. $\geq$ 5 homes in non-restricted area)
- ☒ Signature: (If applicant is corp., partnership, or municipality, title of signatory is required)
- ☒ Correct fee paid

Gov't. Lots:
YES P/D
N/A P/U

ADDITIONAL INFORMATION

RECEIVED

YES ADVERTISE REMARK(S)

(Reviewer identify which remarks)

JUN - 4 2001

YES NO

Department of Water Resources

- ☒ Overlapping place of use: (Describe source & relationship to present application on next page.) 65-7837, 65-12115, and 65-7683 will be TRANSFERRED
- ☒ Overlapping point of diversion. TO DISTRICT
- ☒ Critical groundwater area: 65-13361 will share the BACKUP well
- ☒ Groundwater management area:
- ☒ 1992 moratorium:
- ☒ Surface water source, IDFG letter needed.
- ☒ Protected river or minimum flow reach, notify water planning bureau.
- ☒ E-mail to SCA staff: (perennial stream, non-pump diversion &/or any mining).
- ☒ E-mail to Dam Safety staff: (for any storage)
- ☒ Mitigation plan: Check any that apply.
- ☐ immediate = acceptable plan required and submitted.
- ☒ future = open areas, acceptance of condition of approval is in file.
- ☒ Send power requirement letter &/or fish farm requirement letter.
- ☒ Power residency affidavit:
- ☒ Diversion greater than 5 cfs or 500 af or irrigation greater than 200 acres: (If yes, attach Large Diversion supplementary analysis sheet.)
- ☒ *REQUEST ADDITIONAL INFORMATION FROM THE APPLICANT

Date Requested _____ Date Response Received _____

PROCESSING

APP. NO. _____

YES NO

☒ ☐ In form for advertising:
☐ ☒ Statewide advertising: (> 10 cfs &/or 1000 af)
☒ ☐ Fee amount, receipt number and date recorded on application:

SEND COPIES TO: NOTE IF E-MAIL COMMENT LETTER USED.

YES NO

YES NO

☐ ☒ I.D. Health & Welfare
☒ ☐ I.D. District Health
☐ ☒ I.D. Fish & Game
☐ ☒ I.D. Lands

☐ ☒ U.S. BLM
☐ ☒ U.S. Forest Service
☐ ☒ Water Dist. # _____
☐ ☒ Water Planning Bureau
☐ ☒ Other _____

FINAL REGIONAL PROCESSING REVIEW:

YES NO

☒ ☐ Affidavit of publication received:
☒ ☐ Application published correctly: If not, record action taken.

☒ ☐ Publication dates and paper recorded on application:
☐ ☐ Final date for protest 5-7-01
☐ ☒ Protests received.
☐ ☒ Recommendations attached:
☐ ☒ Measuring device required:
☐ ☒ Water delivered by water master? District # _____
☒ ☐ Special conditions of approval or cover letter: 046, 121

See below for additional information

Recommended Date or Priority 2/12/01Recommended by: Gay S Date: 5/28/01

ADDITIONAL INFORMATION:

See comments in Profile Report

04/11/2001

IDAHO DEPARTMENT OF WATER RESOURCES
Water Application Report

WATER RIGHT NO 65-22358

<u>Owner Type</u>	<u>Name and Address</u>
Current Owner	NORTH LAKE RECREATIONAL SEWER & WATER DISTRICT PO BOX 729 DONNELLY, ID 83615

<u>Priority Date</u>	04/05/2001
<u>Status</u>	Active

<u>Source</u>	<u>Tributary to</u>
GROUND WATER	

<u>Beneficial Use</u>	<u>From</u>	<u>To</u>	<u>Diversion Rate</u>	<u>Volume</u>	<u>Subuse Code</u>
MUNICIPAL	01/01	12/31	2 CFS		
Total Diversion			2 CFS		

Location of Point(s) of Diversion

GROUND WATER	S 31ENW 1st 3	Sec 03	Township 15N	Range 03E	VALLEY County
GROUND WATER	NENWSE	Sec 04	Township 15N	Range 03E	VALLEY County

Place(s) of use: No POU's found for this right

Comments

<u>Author</u>	<u>Date</u>	<u>Subject</u>	<u>Comment</u>
dnelson	4/11/01 11:48:30 AM	General Comments/Analysis	This application is for the current municipal needs of North Lake Recreational Sewer & Water District. The applicants have been the municipal provider to various subdivisions in the area for sewer and ~~garbage~~ collection for some time. They have now been asked by their customers to supply and maintain the water systems for several subdivisions. Please see service area map attached to the application to show all of the area that the District services. The District will be filing transfers on water rights 65-7837, 65-12115, and 65-7683 to incorporate them into their municipal system. Some of the remaining subdivisions will retain their own water rights for their homeowners associations within the borders of the district, but most will use the District's services to maintain the wells. The well in Section 4 will be co-owned by the District and Arrowhead Point Homeowners Association. They have decided to retain possession of their water right 65-13361, but want to share the maintenance cost of the well with the District. The District plans to use this well as a backup well.
dnelson	4/11/01 11:48:30 AM	Legal Notice Remarks	Applicant agrees to mitigate consumptive use in the future as needed. Municipal use is for applicants service area.

Dates

Date Application Received	04/05/2001
Date Application Denied	
Last Date of Beneficial Use	
Extension End Date	
Protest Deadline Date	
Number of Protests	0
Enlargement Use Priority Date	
Enlargement Statute Priority Date	

Water Right 65-22358

Other Information.

Receipt Number(s). W027358

State or Federal:

Owner Name Connector:

Water District Number:

Generic Max Rate per Acre

Generic Max Volume per Acre:

Application Type: New Appropriation

Applicant Remarks. There is an agreement between the District and the Arrowhead Point Homeowners association to use the point of diversion in section 4 with their existing water right 65-13361 as well as this application. One point of diversion will be the primary well and the other point of diversion will be the backup well. Both points of diversion and both water rights will be used for municipal services within the district. The Arrowhead Point Subdivision is part of the District.

Other Water Rights: Water rights 65-7837, 65-12115, and 65-7683 will be submitted for transfer for the applicant. 65-13361 will share a common well, but will retain the ownership of their own rights.

Time to Complete Works: 1

Transfer Affected Description

Transfer Affected Contracts:

Old Transfer Number:

Transfer Reason:

Transfer Return Flows.

Swan Falls Trust or Nontrust:

Swan Falls Dismissed.

DLE Act Number

Cary Act Number

Mitigation Plan False

Mtn. Shadows #4 Point of Diversion

Mountain Shadows Subdivision No. 4

Block 1

Lot 1 and 2

S-3

Dan Nelson
IDWR

334-2190

Arrowhead Point Cottage Sites

Lot 47

S-#

Subdivisions
where
P/O's
are located
DAN

The following application(s) have been
filed to appropriate the public waters of
the State of Idaho

65-22358

NORTH LAKE RECREATIONAL
SEWER & WATER DISTRICT
PO BOX 729
DONNELLY, ID 83615

Point(s) of Diversion L3 SENENW S3
T15N R03E VALLEY County Source
GROUND WATER, GROUND WATER

Point(s) of Diversion NENWSE S4 T15N
R03E VALLEY County Source GROUND
WATER, GROUND WATER

Use MUNICIPAL01/01 TO 12/31 2 CFS

Total Diversion 2 CFS

Date Filed 04/05/2001

Remark Applicant agrees to mitigate con-
sumptive use in the future as needed
Municipal use is for applicants service
area

Permits will be subject to all prior water
rights. Protests may be submitted based
on the criteria of Sec 42-203A, Idaho Code

Any protest against the approval of this
application must be filed with the Director,
Dept of Water Resource, together with a
protest fee of \$25.00 for each application
on or before 05/07/2001. The protestant
must also send a copy of the protest to the
applicant

KARL J DREHER, Director
Publish on April 18 and 25, 2001

Affidavit of Publication

RECEIVED

STATE OF IDAHO COUNTY OF VALLEY

MAY 10 2001

I, Robin M. Simpson, being duly sworn deposes, and says, I am the Publisher of the McCall-Cascade Times Advocate, a weekly newspaper published at Cascade, in Valley County, Idaho, and having a general circulation therein and of legal status in said county.

The App for Water Rights, a copy of which is attached hereto, was published in said newspaper once a week for 2 consecutive weeks in the regular and entire issue of every number thereof during the period and time of publication, and was published in the newspaper proper and not in a supplement, and that publication of such notice began 4-10, 2001, and ended 4-25, 2001.

Robin M. Simpson

Robin M. Simpson

Signed this the 8 day of May, 2001

STATE OF IDAHO)
:SS.
COUNTY OF VALLEY)


On this the 8th day of May, 2001, before me, a Notary Public in and for said State, personally appeared Robin M. Simpson, known or identified to me to be the person whose name is subscribed to the within Instrument, and being by me first duly sworn, declared that the statements therein are true, and acknowledged to me that she executed the same.

Michael Stewart

Notary Public State of Idaho

Residing at: Cascade

Commission Expires: 10/30/2001

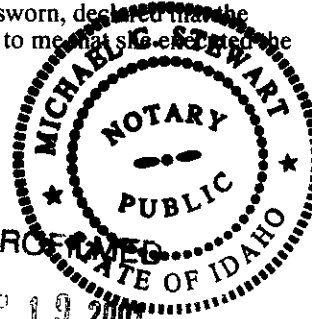



State of Idaho

DEPARTMENT OF WATER RESOURCES

Western Region, 2735 Airport Way, Boise, Idaho 83705-5082 - (208) 334-2190

FAX (208) 334-2348

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

April 18, 2001

ID DEPT OF HEALTH & WELFARE
DIV OF ENV QUALITY
BOISE REGIONAL OFFICE
PO BOX 83720
BOISE ID 83706

Re: Application for Water Right No. 63-31200 in the Name of Anchor Development LLC.
Application for Water Right No. 65-22358 in the Name of North Lake Recreational
Sewer & Water District.

Dear Sir:

Enclosed are copies of the above-referenced applications, which may be of interest to your agency. Please review the applications and submit any comments you may have.

This office normally completes the processing of an application within a six-week period and is required to take final action shortly thereafter. However, if your agency desires to file a formal protest against the approval of this application(s), your written protest along with the \$25.00 protest fee must be received in this office by May 7, 2001.

If you have any questions regarding the applications, please contact this office.

Sincerely,

Gary Spackman

GS:lm

Encl.

MICROFILMED

SEP 19 2001

Idaho Department of Water Resources Receipt


Receipt ID W027358

Payment Amount Date Received Region Status
Payment Type Check Number

Payer Comment

Fee Detail

Amount	Description	Fund	FD	PCA	SO
\$290.00	PERMITS	0229	21	62103	1155

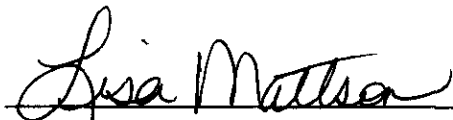

Signature Line (Dept. Representative)

MICROFILMED

SEP 19 2001

April 12, 2001

Legal Notice Department
Long Valley Advocate
PO Box 1079
Cascade ID 83611

RE: Application for Permit No. 65-22358

Dear LEGAL NOTICE DEPARTMENT:

Enclosed you will find a legal notice which we wish to have published in your newspaper on the dates indicated (once a week for two consecutive weekly issues). If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Please send the affidavit and bill to this office before 05/07/2001. Your cooperation is appreciated.

Sincerely

Sue Taylor
Senior Secretary

MICROFILMED

SEP 19 2001

The following application(s) have been filed to appropriate the public waters of the State of Idaho:

65-22358

NORTH LAKE RECREATIONAL SEWER & WATER DISTRICT

PO BOX 729

DONNELLY ID 83615

Point(s) of Diversion L3 SENENW S3 T15N R03E VALLEY County

**Source GROUND WATER, GROUND
WATER**

Point(s) of Diversion NENWSE S4 T15N R03E VALLEY County

**Source GROUND WATER, GROUND
WATER**

Use: MUNICIPAL

01/01 To 12/31 2 CFS

Total Diversion:

2 CFS

Date Filed: 04/05/2001

**Remark: Applicant agrees to mitigate consumptive use in the future as needed.
Municipal use is for applicants service area**

Permits will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec 42-203A, Idaho Code.

Any protest against the approval of this application must be filed with the Director, Dept. of Water Resource, together with a protest fee of \$25.00 for each application on or before 05/07/2001. The protestant must also send a copy of the protest to the applicant.

KARL J DREHER, Director

Published on April 18 and 25, 2001.

MICROFILMED
SEP 13 2001



Letter of Transmittal

Date: 04/06/01

To: Dan Nelson

Subject: North Lake Recreational Sewer and Water District – Water Right Application

RECEIVED

APR 06 2001

WATER RESOURCES
WESTERN REGION

Enclosed are the following items:

Date	Copies	No.	Description
	1		District Boundary Map

You should receive the amended application from Bill Eddy in the mail. The enclosed attachment belongs with the water right application.

These are transmitted:

☐ For your files ☐ For action specified above ☐ For review and comment ☒ For your use ☒ As requested

Sincerely,

KELLER ASSOCIATES, INC.

Michael T. Anderson, E.I.T.

Enclosure(s)

MICROFILMED

SEP 13 2001

131 SW 5TH AVENUE, SUITE A, MERIDIAN, IDAHO 83642 (208) 288-1992

If enclosures are not as noted, please notify us at once



State of Idaho

DEPARTMENT OF WATER RESOURCES

2735 Airport Way, Boise, Idaho 83705

Phone: (208) 334-2190 FAX: (208) 334-2348 www.idwr.state.id.us/idwr/idwrhome.htm

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

FAX TRANSMITTAL COVER SHEET

FAX # (208) 334-2348

DATE: 3-23-01

288-1999
Mike Anderson
Keller Associates.

TO: Bill EDDY

FROM: _____

NORTH LAKE RECREATIONAL
SEWER & WATER DISTRICT.
5017
1-208-325-~~8918~~

DOCUMENT DESCRIPTION: ADDITIONAL INFORMATION
REQUEST FOR APPLICATION FOR PERMIT

TOTAL PAGES SENT: 5 + COVER SHEET

CONTACT: _____

MICROFILMED

SEP 13 2001



State of Idaho

DEPARTMENT OF WATER RESOURCES

Western Region, 2735 Airport Way, Boise, Idaho 83705-5082 - (208) 334-2190

FAX (208) 334-2348

March 23, 2001

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

NORTH LAKE RECREATIONAL
SEWER & WATER DISTRICT
PO BOX 729
DONNELLY, ID 83615

Dear Applicant(s):

The Department of Water Resources received your application for permit on 2/12/2001. Processing of this application will be delayed to allow you to complete the necessary information described below.

- 1.) A list of the corporate officer's needs to be submitted (President, Vice President, and Secretary).
- 2.) The Map was not marked correctly and a subdivision map was not supplied. You may use the subdivision map if you mark the wells on the map.
- 3.) The Nature of Proposed Use was not provided correctly. In your area we will need to separate the domestic use (in-house) from the irrigation use. I have supplied an example of your front page that shows .41 cfs for domestic use and 1.00 cfs for irrigation for a total of 1.41 cfs. This is based on 100 homes with ½ acre yards. The increase of diversion rate from 1.20 cfs to 1.41 cfs will not increase your fees and should not adversely affect your application
- 4.) The Point of Diversion was not provided correctly on the map and we will need to verify the points marked to your legal description.
- 5.) The Place of Use or acres irrigated was not marked on the map and I am unable to verify the legal description given.
- 6.) A Request to Process form was not submitted. Please mark one of the three choices and return the form to my office.

I am faxing a copy of this letter to you and mailing the original. Please feel free to contact this office if you have any questions.

Sincerely,

Daniel A. Nelson
Sr. Water Right Agent

Enclosure:

MICROFILMED

SEP 19 2001