


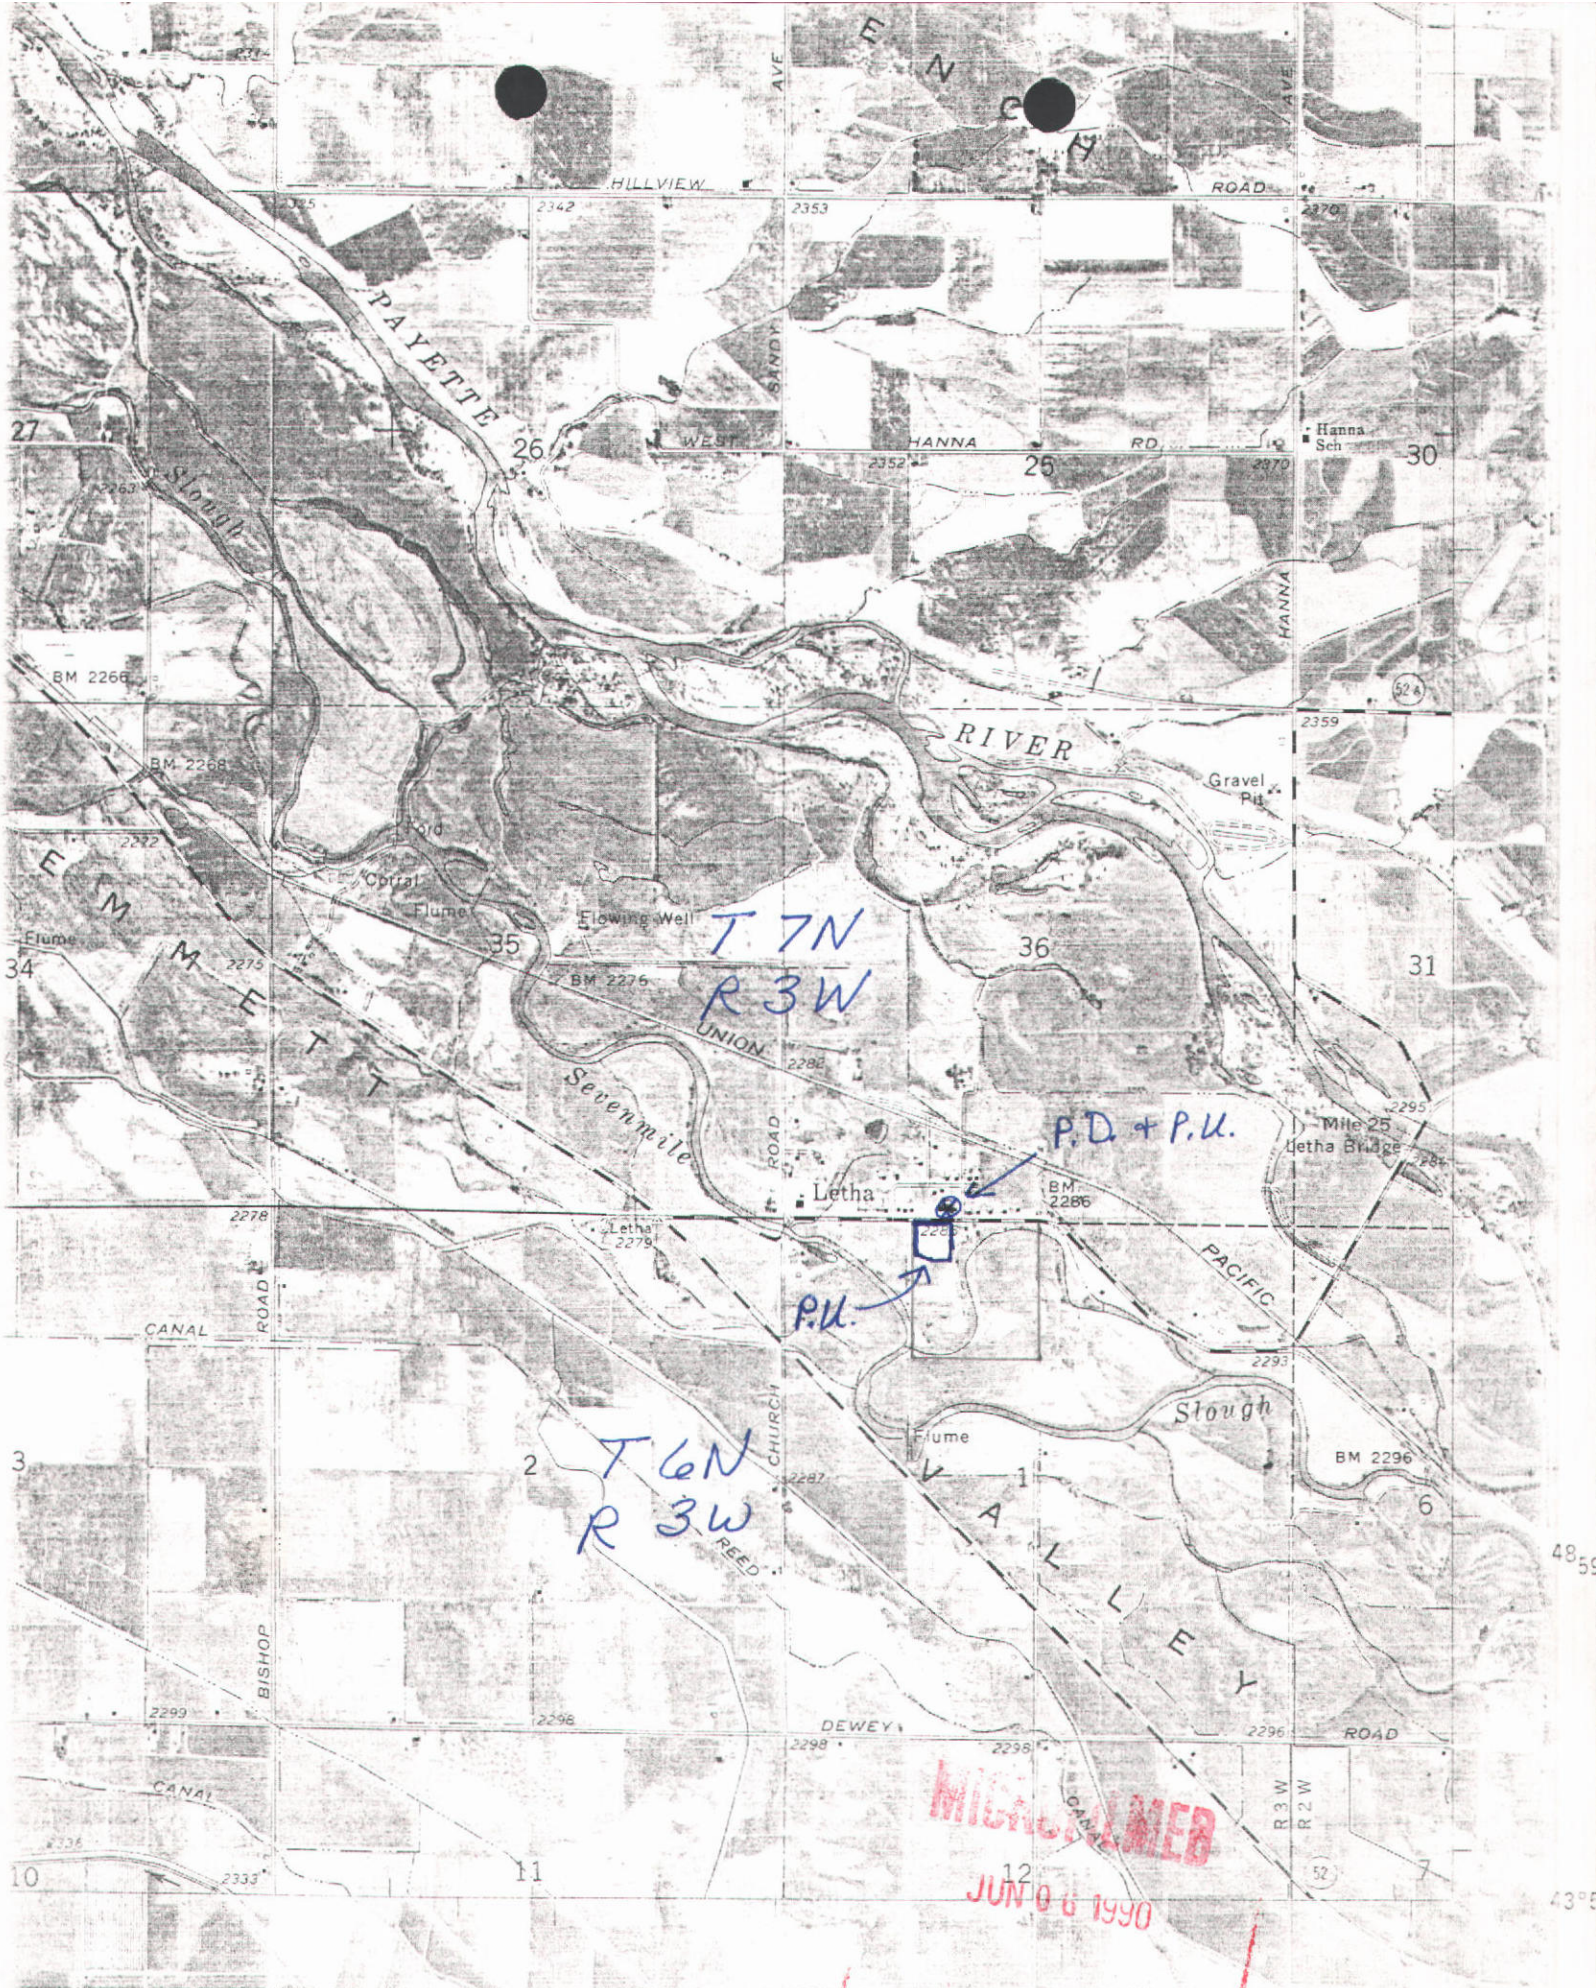

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
JAN 09 1995

Department of Water Resources

A. GENERAL INFORMATION


1. Owner: CHURCH OF JESUS CHRIST LATTER DAY SAINTS Permit No. 165-13110
Current Address: 12th floor 30 E. N. Temple St SALT LAKE CITY 84150 Phone No. 365-3865
2. Accompanied by: JOHN HARDEN EXAM. DATE: 10-15-94
Address: SAME Phone No. SAME
Relationship to Permit Holder: SAME
3. Source: GROUNDWATER tributary to NA

B. OVERLAP REVIEW

1. Other water rights with same place of use: 165-00082 + 2 OTHERS ☐ Copies Attached
2. Other water rights with same point of diversion: 165-03355 + 12 OTHERS ☐ Copies Attached ☐ Copies of Field Exam's Attached

C. SYSTEM DESCRIPTION

1. **Diversion System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☐ Alternative diagram attached

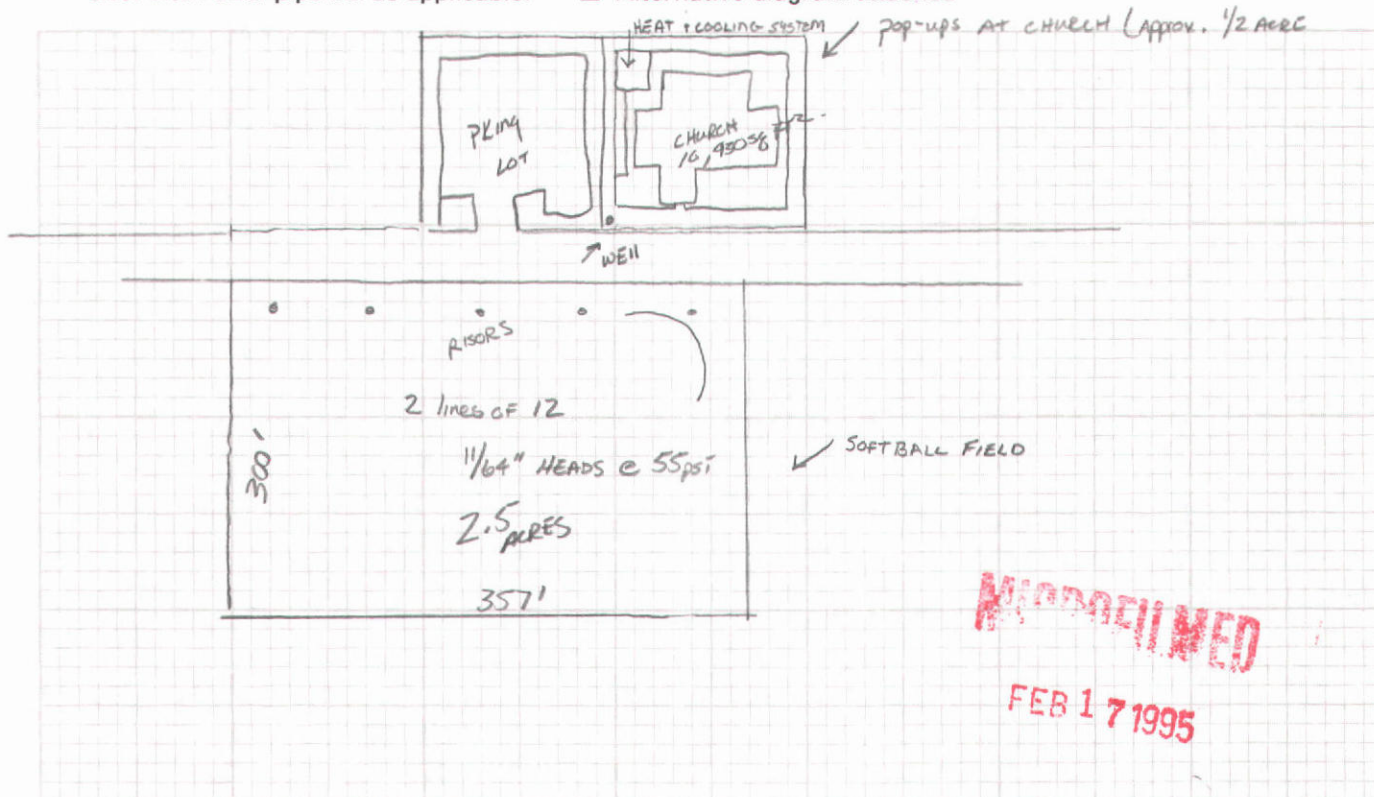


Scale: 1" = _____

2. ☒ Copy of U.S.G.S. Quadrangle Attached
Showing location(s) of point(s) of diversion and place(s) of use (required).
☒ Photo of Diversion and System Attached
(required for all but single household domestic groundwater, and stockwater.)
☒ Aerial Photo Attached
(required for irrigation of 10 acres or more).

PERMIT 65-13110 INIT
 T. R. S. Q/Q
 P/D 7N 3W 36 SWSESW
 SCALE
 PHOTO ID. W5

Handwritten annotations on the map include:
 - Blue circle around section 36.
 - Blue box around the Letha area.
 - Blue arrows pointing to the box with labels: "P/D", "P/w, heating, cooling, ice", and "P/w, ice".
 - Blue circle around section 1.
 - Red stamp in the bottom right corner: "RECEIVED FEB 17 1966".

Range N. 23 West, Boise Meridian

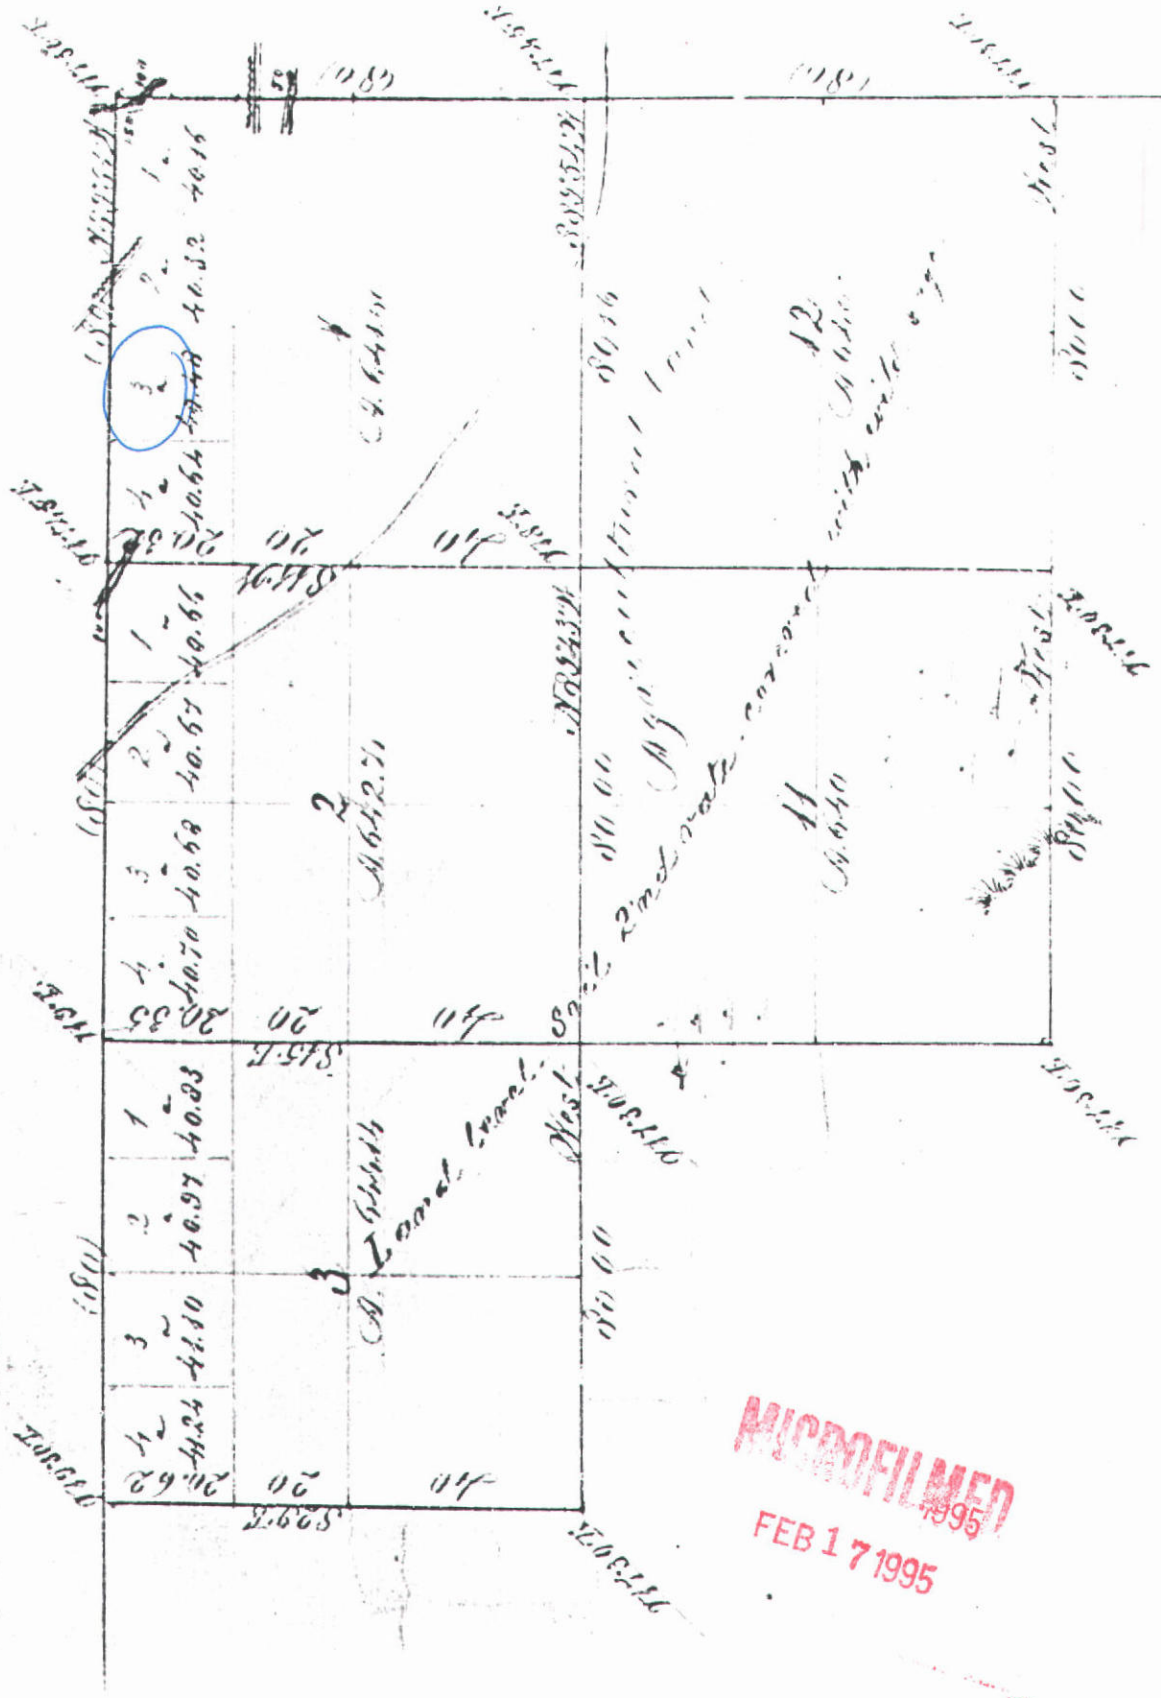

65-13110

P/O



P/u
heating/cooling



P/u
irrigation

RECORDED

FEB 17 1995

65-13110



P/u - Softball
field



Albuquerque

FEB 17 1995

RECEIVED

APR 13 1990

Department of Water Resources
Western Regional Office

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO,
ss.
COUNTY OF GEM,

Esma Reyes, being first
duly sworn, on his oath deposes and
says that she is the printer of Mes-
senger-Index, a legal weekly news-
paper published at Emmett, in Gem
County, Idaho; that said newspaper
is in general circulation in said
county and has been published unin-
terruptedly and continuously for
more than 78 weeks prior to the
first publication of the annexed
document; and that the document
notice, process, or advertisement
hereunto annexed was published in
the regular edition of Messenger-
Index for Two

consecutive weekly issues thereof,
beginning with the issue of
APRIL 4, 1990,
and ending with the issue of
APRIL 11, 1990

Esma Reyes

Subscribed and sworn to before me
this 11th day of

APRIL, 1990
May Ann Hanson

Notary Public,
Residing at Emmett, Idaho.

My Commission Expires 3-21-95

**NOTICE OF APPLICATION
FOR WATER RIGHT**

The Following application(s)
have been filed to appropriate
the public waters of the State of
Idaho:

65-13110
CHURCH OF JESUS CHRIST
OF LATTER DAY SAINTS
REAL ESTATE DIVISION
12TH FLOOR
50 E. N. TEMPLE ST.
SALT LAKE CITY, UT 84150
Source: GROUNDWATER
Diversion Pt: SWSESW Sec 36
T 07N R 03W
Use: IRRIGATION (.090 CFS)
HEATING (.200 CFS)
COOLING (.200 CFS)
Total Diversion: (.200 CFS)
Date Filed: 12/5/1989
In: T06N R03W S01 Lot 3
(NENW)
T07N R03W S36 SESW
3.0 ACRES TOTAL

65-13154
SUTTON, ALLEN L.
P.O. BOX 26
OLA, ID 83657
Source: SQUAW CREEK
Tributary: PAYETTE RIVER
Diversion Pt: NWSW Sec 12 T
10N R 01E
Use: IRRIGATION (.400 CFS)
Total Diversion: (.400 CFS)
Date Filed: 2/5/1990
In: T10N R01E S23 NWNE
SWNE NENW SENW
20.0 ACRES TOTAL

65-13157
LANHAM, REX E.
848 JACKSON
EMMETT, ID 83617
Source: WASTE WATER
Tributary: PAYETTE RIVER
Diversion Pt: NENE Sec 11 T
06N R 02W
Use: IRRIGATION (.800 CFS)
Total Diversion: (.800 CFS)
Date Filed: 2/7/1990
In: T06N R02W S11 NENE
NWNE Lot 2 (SWNE) Lot 3
(SENW)
40.0 ACRES TOTAL

65-13165
WOODIE, RONALD
WOODIE, JUDITH
P.O. BOX 785
EMMETT, ID 83617
Source: SPRING
Tributary: HAW CREEK
Diversion Pt: SWSESW Sec 3
T 07N R 01W
Use: STOCKWATER (.070 CFS)
Total Diversion: (.070 CFS)
Date Filed: 2/9/1990
In: T07N R01W S03 SENW

65-13168
KRAFT, DALLAS G.
KRAFT, SUSAN J.
7191 BILL BURNS RD.
EMMETT, ID 83617
Source: SPRING
Tributary: PAYETTE RIVER
Diversion Pt: NENWNW Sec 18
T 06N R 02W
Use: STOCKWATER (.040 CFS)
Total Diversion: (.040 CFS)
Date Filed: 2/13/1990
In: T06N R02W S18 NWNW

65-13169
CARLOCK, CARROLL
P.O. BOX 60
OLA, ID 83657
Source: SPRINGS
Tributary: SQUAW CREEK
Diversion Pt: SWNESW Sec 3
T 11N R 01E
SESESW Sec 3 T 11N R 01E
SENWSW Sec 26 T 12N R 01E
NENWNE Sec 34 T 12N R 01E
Use: STOCKWATER (.070 CFS)
Total Diversion: (.070 CFS)
Date Filed: 2/13/1990
In: T11N R01E S03 NESW
SESW NWSE
T12N R01E S26 NWSW

S34 NWNE

65-13170
CUNNINGHAM, MARILYN
P.O. BOX 59
OLA, ID 83657
Source: UNNAMED STREAM
Tributary: SQUAW CREEK, SE-
COND FORK
Diversion Pt: SENW Sec 6 T
11N R 02E
Use: STOCKWATER (.020 CFS)
STOCKWATER STORAGE (1.15
AF)
STOCKWATER FROM
STORAGE (1.15 AF)
Total Diversion: (.020 CFS) (1.15
AF)
Date Filed: 2/20/1990
In: T11N R02E S06 SENW

65-13171
CARLOCK, CARROLL
P.O. BOX 60
OLA, ID 83657
Source: SPRING
Tributary: LITTLE SQUAW
CREEK
Source: SPRINGS
Tributary: SQUAW CREEK
Diversion Pt: NENESW Sec 1
T 09N R 01E
NENWNE Sec 34 T 10N R 01E
NESWNE Sec 35 T 10N R 01E
Use: STOCKWATER (.070 CFS)
Total Diversion: (.070 CFS)
Date Filed: 2/13/1990
In: T09N R01E S01 NESW
T10N R01E S34 NWNE
S35 SWNE

65-13172
HILL, EVERRETT D.
5033 HWY. 52
EMMETT, ID 83617
Source: GROUNDWATER
Diversion Pt: NESE Sec 8 T
06N R 02W
Use: DOMESTIC (.040 CFS)
COMMERCIAL (.020 CFS)
STOCKWATER (.020 CFS)
Total Diversion: (.040 CFS)
Date Filed: 2/14/1990
In: T06N R02W S08 NESE

65-13199
MC CAULOU, MURRY RAY
MC CAULOU, ARLEEN
P.O. BOX 53
OLA, ID 83657
Source: SPRING
Tributary: SINKS
Diversion Pt: NWNWSW Sec
10 T 08N R 01E
Use: STOCKWATER (.020 CFS)
DOMESTIC (.020 CFS)
Total Diversion: (.040 CFS)
Date Filed: 2/12/1990
In: T08N R01E S10 SESW

65-13201
HUNTER, R.J.
HUNTER, MAE B.
BOX 98
EMMETT, ID 83617
Source: SPRINGS
Tributary: HAW CREEK
Diversion Pt: NESWNW Sec 16
T 07N R 01W
SESWNW Sec 16 T 07N R 01W
Use: STOCKWATER (.050 CFS)
Total Diversion: (.050 CFS)
Date Filed: 2/12/1990
In: T07N R01W S16 SWNW

65-13203
REINIG, DARRELL R.
9675 N. HWY. 52
HORSESHOE BEND, ID 83629
Source: PAYETTE RIVER
Tributary: SNAKE RIVER
Diversion Pt: SWSE Sec 15 T
07N R 01E
Use: IRRIGATION (.120 CFS)
STOCKWATER (.020 CFS)
Total Diversion: (.140 CFS)
Date Filed: 2/13/1990
In: T07N R01E S15 Lot 2
(SWSE)

6.0 ACRES TOTAL
The permit(s) will be subject
to all prior water rights. Protests
must be filed with the Director,
Dept. of Water Resources,
Western Region, 2735 Airport
Way, Boise, Idaho, 83705 on or
before APRIL 23, 1990.
R. KEITH HIGGINSON,
Director

Pub.: 4-4,11-90
Legal Notice No. 754
Pub. in the Messenger Index

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 65-13110

Priority: December 5, 1989

Maximum Diversion Rate: 0.20 CFS
Maximum Diversion Volume: 53.3 AF

This is to certify, that CHURCH OF JESUS CHRIST OF LATTER DAY SAINTS
REAL ESTATE DIVISION

12TH FLOOR

50 E NORTH TEMPLE ST

SALT LAKE CITY UT 84150

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated December 5, 1989; and has submitted Proof of Beneficial Use on June 15, 1990. An examination indicates that the works have a diversion capacity of 0.350 cfs of water from a GROUNDWATER source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
IRRIGATION	03/15 to 11/15	0.09 CFS	13.5 AF
HEATING	01/01 to 12/31	0.20 CFS	35.7 AF
COOLING	01/01 to 12/31	0.05 CFS	4.1 AF
	Totals	0.20 CFS	53.3 AF

LOCATION OF POINT(S) OF DIVERSION:

SESW , Sec. 36, Township 07N, Range 03W
GEM County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
06N	03W	1	Lot 3(NENW)	2.5		2.5
07N	03W	36	SESW	0.5		0.5

Total number of acres irrigated: 3

PLACE OF USE: HEATING

TWN RGE SEC

07N 03W 36 SESW

PLACE OF USE:

COOLING, same as HEATING use

CONDITIONS/REMARKS:

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.

FEB 17 1995

State of Idaho
Department of Water Resources


WATER RIGHT LICENSE

WATER RIGHT NO. 65-13110

CONDITIONS/REMARKS:

4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. Return flow if discharged to a subsurface system must be authorized by a separate injection well permit, and return flow if discharged to a surface water system shall meet Idaho Water Quality Standards.
6. This right when combined with 65-03483 and all other rights shall provide no more than .03 cfs per acre nor more than 4.5 afa per acre for the lands above.
7. Heating and cooling uses are for a heat-pump heating and cooling system.
8. Place of use is known as the Letha Ward.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. Witness the seal and signature of the Director, affixed at Boise, this 5TH day of FEBRUARY, 1995.

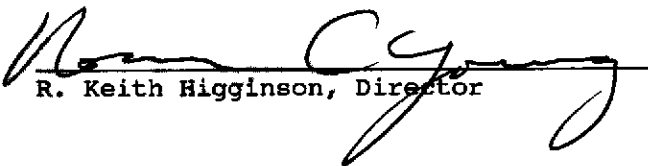Acting for 
R. Keith Higginson, Director

17 1995

STATE OF IDAHO

DEPARTMENT OF WATER RESOURCES

PROOF OF BENEFICIAL USE

RECEIVED
JUN 15 1990
Department of Water Resources

511-9782

The Idaho Department of Water Resources will consider this form as a statement that the permit holder(s) has completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

Permit No. P65-13110

Telephone No. 801-240-4074

Name(s) of Permit Holder(s): Church of Jesus Christ of Latter-day Saints

Post Office Address: Natural Resources, R.E. Div., 12th Fl., 50 E. North Temple, Salt Lake City, UT 84150

Source of Water: Ground water

If ground water, well driller's name: _____

Date drilled: _____

Extent of Use:

Domestic _____ (No. of households)

Irrigation 3 (No. of acres)

Stockwater _____ (No. and type of stock)

Other _____

Total rate and/or volume for which proof is submitted 0.20 cfs _____ acre/feet

Show date water was first diverted and beneficially used under this permit: at least 20 years ago

One of the following may be a condition of approval of your permit.

Measuring device: Required? Yes ☒ No Installed? Yes ☐ No

OR

Flow Measurement Port. Required? Yes ☒ No Installed? Yes ☐ No

Fee Enclosed: \$ 50.00 (See License Examination Fee Schedule)

Person to contact to accompany the Department representative during the field examination:

Ralph Mouritsen
Name

208-365-6679

RECORDED

7700 West Black Canyon Highway, Emmett, ID 83617

Address

NOV 27 1990

The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

Corporation of the Presiding Bishop of the Church of Jesus Christ of Latter-day Saints, a Utah Corporation sole

6-11-90
Date

J. A. Baker
Signature (and title if on behalf of a company or organization)

AUTHORIZED AGENT

State of Idaho
Department of Water Resources
Permit To Appropriate Water

NO. 65-13110

Proposed Priority: December 4, 1989 Maximum Diversion Rate: 0.20 CFS
This is to certify, that **CHURCH OF JESUS CHRIST LATTER DAY SAINTS**

REAL ESTATE DIVISION
12TH FLOOR
50 E. N. TEMPLE ST.
SALT LAKE CITY, UT 84150

has applied for a permit to appropriate water from: **GROUNDWATER**
and a permit is **APPROVED** for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
IRRIGATION	03/15 to 11/15	0.09 CFS
HEATING	01/01 to 12/31	0.20 CFS
COOLING	01/01 to 12/31	0.20 CFS
	Totals	0.20 CFS

LOCATION OF POINT(S) OF DIVERSION: SWSESW Sec. 36, Township 07N, Range 03W
GEM County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
06N	03W	1	LOT 3(NENW)	3		3

Total number of acres irrigated: 3

PLACE OF USE: HEATING

TWN RGE SEC

07N 03W 36 SESW

PLACE OF USE: COOLING, same as IRRIGATION use

CONDITIONS/REMARKS:

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before July 1, 1991.
2. Subject to all prior water rights.
3. Permit holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
4. Return flow if discharged to a subsurface system must be authorized by a separate injection well permit, and return flow if discharged to a surface water system shall meet Idaho Water Quality Standards.
5. The rate of diversion of water for irrigation under this permit and all other water rights on the same land shall not exceed 0.03 cubic feet per second for each acre of land.

RECEIVED
JUN 9 1990

State of Idaho
Department of Water Resources


Permit To Appropriate Water


NO. 65-13110

CONDITIONS/REMARKS:

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this

4th day of June, 1990.

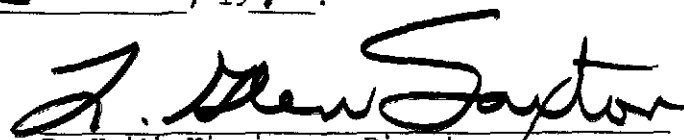for 
R. Keith Higginson, Director

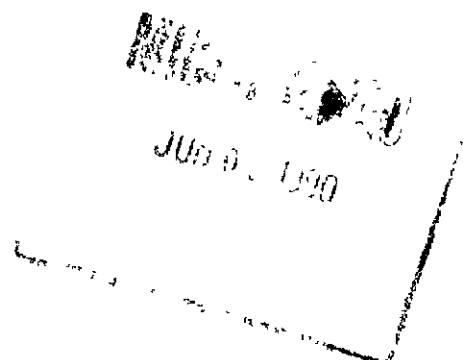

RECEIVED

DEC 4 1989

Ident. No. 65-13110

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

Department of Water Resources

APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

1. Name: CHURCH OF JESUS CHRIST LATTER DAY SAINTS
Address: REAL ESTATE DIVISION
12TH FLOOR
50 E. N. TEMPLE ST.
SALT LAKE CITY, UT 84150
801-240-2929
2. Source: GROUNDWATER Trib. to:
3. Location of Point of Diversion: SWSESW Sec. 36, Township 07N, Range 03W
GEM County
4. Water will be used for the following purposes:

Purpose	From	To	CFS	(or)	AF
IRRIGATION	03/15	11/15	0.090		
HEATING	01/01	12/31	0.200		
COOLING	01/01	12/31	0.200		
5. Total quantity to be appropriated is:
0.200 CFS (and/or) AF
6. Proposed diverting works:
 - a. Description of ditches, flumes, pumps, headgates, etc.
EXISTING WELL, FLOWING ARTESIAN, 5 HP PRESSURE PUMP
 - b. Height of storage dam feet; active reservoir capacity
acre-feet; total reservoir capacity acre-feet; period of
year when water will be diverted to storage: to inclusive.
 - c. Proposed well diameter is inches; proposed depth of well is
feet.
 - d. Is groundwater with a temperature greater than 90F being sought? NO
7. Time required for the completion of the works and application of
the water to the proposed beneficial use is 1 years.
8. Description of proposed uses:
IRRIGATION OF ATHLETIC FIELD, HEATING AND COOLING OF LETHA WARD
9. Place of Use: IRRIGATION

TWN RGE SEC ACRES
06N 03W 1 LOT 3(NENW) 3

ACRES ACRES TOTAL
JUN 06 1990 3

MICROFILMED

Ident. No. 65-13110
Page 2

Place of Use: HEATING

TWN RGE SEC
07N 03W 36 SESW

Place of Use: COOLING

TWN RGE SEC
07N 03W 36 SESW

Total number of acres irrigated: 3

10. Describe any other water rights used for the same purposes.
65-03483, LETHA IRRIGATION AND WATER CO.

11. a. Who owns the property at the point of diversion?
APPLICANT

b. Who owns the land to be irrigated or place of use?
APPLICANT

c. If the property is owned by a person other than the applicant,
describe the arrangement enabling the applicant to make this filing.

12. Remarks:

13. Map of proposed point of diversion and place of use attached? [X]

BE IT KNOWN that the undersigned hereby makes application for permit to
appropriate the public waters of the State of Idaho as herein set forth.

Corporation of the Presiding Bishop of the Church of
Jesus Christ of Latter-day Saints a Utah Corporation sole


June A. Bahr

Applicant AUTHORIZED AGENT

Received by D.K. Date 12/6/89 Time 1:40pm Preliminary check by RW
Fee \$ 30.00 Receipted by D.K. # C013257 Date 12-5-89
Publication prepared by GG Date 3-28-90 Published in Messenger-Index
Publication approved st date 5-4-90
4/5 & 4/12/90

RECORDED

JUN 06 1990

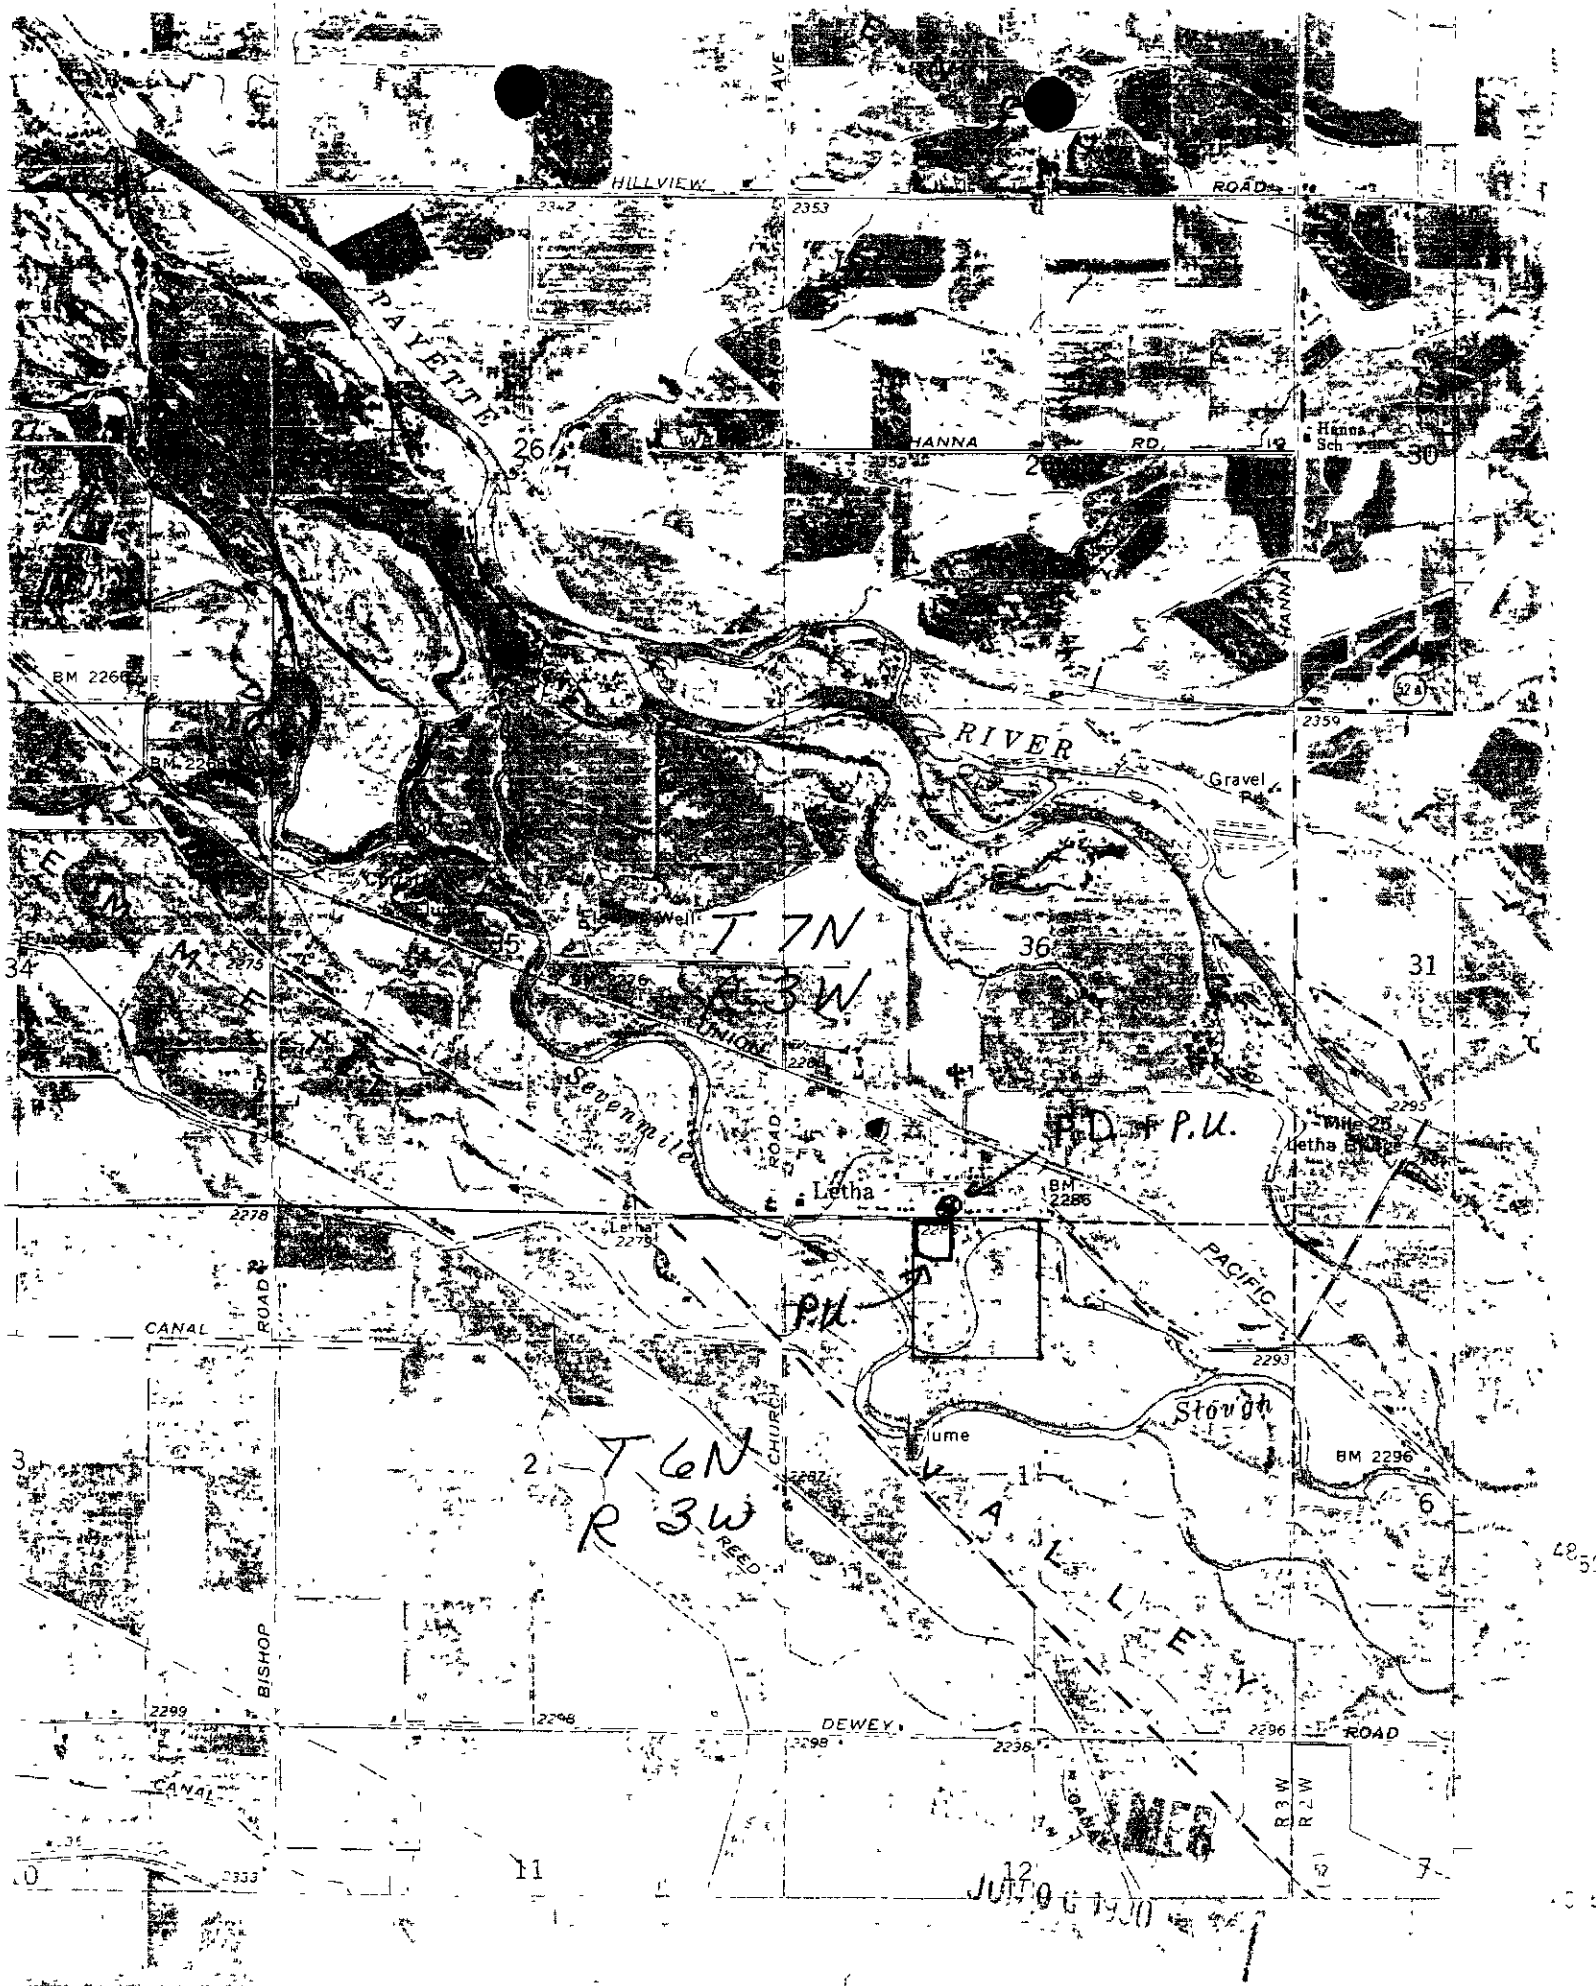

65-13110

19000m.E

116°37'30"



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000
Phone: (208) 327-7900 FAX: (208) 327-7866

PHILIP E. BATT
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

February 6, 1995

CHURCH OF JESUS CHRIST LATTER DAY SAINTS
REAL ESTATE DIVISION
12TH FLOOR
50 E NORTH TEMPLE ST
SALT LAKE CITY UT 84150

RE: WATER RIGHT NO. 65-13110

Dear Water Right Holder(s):

Enclosed is a copy of the Water Right License issued on the above referenced permit. If you have any questions, please contact me within 10 days of receipt of this license.

Sincerely,

Shelley W. Keen
Water Rights Supervisor

SK:rl

Enclosure

RECEIVED

FEB 17 1995

LICENSE REVIEW CHECKLIST

PERMIT NO. 65-13110 DATE 1-24-95



NAME	Yes <u> </u>	No <u>✓</u>	Or Address Change?
PRIORITY DATE	<u> </u>	<u>✓</u>	Advance? <u> </u> Advanced to: <u> </u> Order to reinstate needed? <u> </u> Incorrect fee for rate recommended? <u>NO</u>
SOURCE	<u> </u>	<u>✓</u>	Changes or just clarification of originally intended source? <u> </u> Notice of Intent to Void necessary? <u> </u>
POINT OF DIV	<u>✓</u>	<u>✓</u>	Amendment needed? <u> </u> Overlaps? <u>Letta Dr. E. WATER (65-0082)</u>
PLACE OF USE	<u>✓</u>	<u>✓</u>	Amendment needed? <u>Add. - SESW OF 7N 3W SEC 36</u> Overlaps? <u>(irrigation use) (65-3483)</u> <u>dom + ur</u>
DIV RATE	<u> </u>	<u>✓</u>	Permit/fee limits: <u>.20 cfs</u> SPRINKLER Meas Q = <u>.35</u> Theo Q = <u> </u> Recommend: <u>.20</u> <u>3 acres x .03 = .09 cfs</u> <u>HEATING adjusted to .20 cfs</u> <u>Cooling adjusted = .05</u> Combined rates exceed capacity <u> </u>
ANNUAL VOLUME	<u>✓</u>	<u> </u>	Volume Limit: <u> </u> Season: <u>D/4.5 (3-18 to 11-18)</u> Calculations: <u>3 x 4.5 = 13.5</u> <u>HEATING = 35.7</u> <u>COOLING = 4.1</u> Flow limit: <u> </u> cfs x <u> </u> x 1.9835 = <u> </u> Combined volumes exceed capacity/allowable <u> </u>
USES	<u> </u>	<u>✓</u>	Change in Nature of Use or additional uses? <u> </u> Amendment necessary? <u> </u>
REMARKS	<u> </u>	<u>✓</u>	Multiple, p/d(s) in <u>1/4</u> <u>1/4</u> ? <u> </u> Other <u> </u>
CONDITIONS	<u> </u>	<u>✓</u>	Measuring/Locking Devices <u> </u> <u> </u> Watermaster control - District <u> </u> <u> </u> Irrigation Overlap <u> </u> <u>09C</u> Water Quality <u> </u> <u> </u> Other <u> </u> (Heat/Cool/) Fish verified <u>✓</u>

COMMENTS: Supplemental Gu! is not the case per
1-31-95 conversation with Church
Case taken, John Hardin. Justice water
has not been used for 10 yrs.

RECOMMENDED	CFS	VOL	SRBA Claim Filed	<u>NO</u>
<u>Irrigation</u>	<u>.09</u>	<u>13.5</u>	Adjustment Memo Needed	<u>YES</u>
<u>Heating</u>	<u>.20</u>	<u>35.7</u>		
<u>Cooling</u>	<u>.05</u>	<u>4.1</u>	LICENSE	<u>✓</u>
<u>Total</u>	<u>.20</u>	<u>53.3</u>	1ST AMENDMENT LETTER	<u> </u>
			FINAL AMENDMENT LETTER	<u> </u>

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
JAN 09 1995

Department of Water Resources

A. GENERAL INFORMATION

Permit No. 165-13110

1. Owner: Church of Jesus Christ Latter Day Saints Phone No. 365-3865

Current Address: 12th Floor 30 E. N Temple St SALT LAKE CITY 84150

2. Accompanied by: JOHN HARDEN EXAM. DATE: 10-15-94

Address: SAME Phone No. SAME

Relationship to Permit Holder: SAME

3. Source: GROUNDWATER tributary to NA

B. OVERLAP REVIEW

1. Other water rights with same place of use: 15-00082 + 2 OTHERS


☐ Copies Attached

2. Other water rights with same point of diversion: 165-03355 + 12 OTHERS

☐ Copies Attached ☐ Copies of Field Exam's Attached

C. SYSTEM DESCRIPTION

1. **Diversion System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☐ Alternative diagram attached

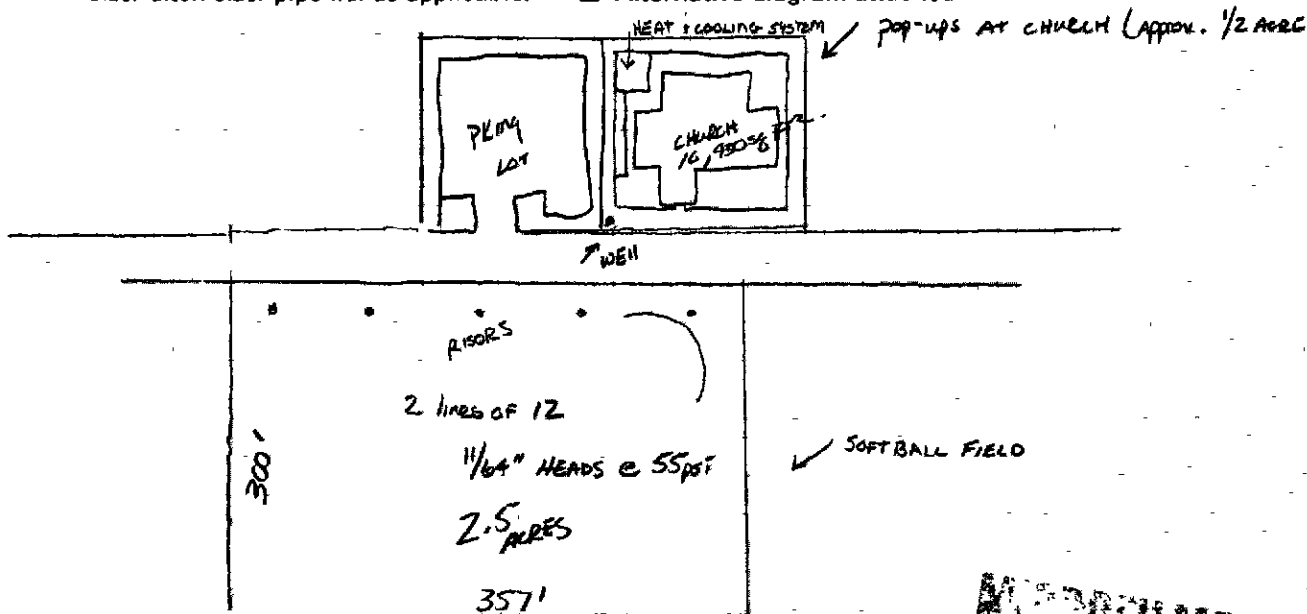

RECEIVED
FEB 17 1995

Scale: 1" = _____

2. ☒ Copy of U.S.G.S. Quadrangle Attached
Showing location(s) of point(s) of diversion and
place(s) of use (required).

☒ Photo of Diversion and System Attached
(required for all but single household domestic groundwater, and stockwater)

☒ Aerial Photo Attached
(required for irrigation of 10 acres or more).

System Description (continued)

3. **Narrative:** Description (As operating at time of measurement. Indicate pressure, number of sprinklers, etc.)

THIS SYSTEM USES A 3HP MOTOR TO DRAW WATER FROM A 0' dynamic level for irrigation, heating, & cooling uses. THE WELL IS 8" AND HAS A 4" DISCHARGE INTO TWO 100 GALLON TANKS THAT RUN 15-40 PSI. THE CHURCH HAS 400 MEMBERS THAT USE IT 2-5 WEEKLY AND EXTENDED HOURS OF 7-10pm. ON SUN WEDNES THURS.

☐ See Remarks on page 4 for continuation

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
SUBMERSIBLE	N/A	5	—	—	4"

*Code to correspond with No. on map and aerial photo

5. **Point(s) of Diversion:**

Ident. No.	Gov't. Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
		SW	SE	SW	36	7N	3W	6EM	Quads - FIELD Exam

6. **Place(s) of Use:**

Indicate Method of Determination _____

Twp.	Rge.	Sec.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				Totals
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
7N	3W	36					3 (60%)							30.5 H/C					30.5 3 (60%)
6N	3W	1					2.5 8 1.5												82.5 3.0

FEB 17 1995

Do not use this space

Do not use this space

D. FLOW MEASUREMENTS

☐ Additional Data Sheets Attached

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements:

$$\text{THEORETICAL} = \frac{5 \times 8.8 \times .70}{(23 \times 35) + 0} = \frac{30.8}{126.5} = .24$$

$$2 \text{ lines} \times 12 \text{ HEAD } (\frac{1}{4}) @ 55 \text{ psi} \quad 24 \times 6.48 = 155.52$$

$$448.8 \quad .35 \text{ cfs} \quad \text{SYSTEM CAPACITY}$$

IRR NEED 3AC .03 cfs .09 cfs

E. FLOW CALCULATIONS

☐ Additional Computation Sheets Attached

1. Measured Method:

Sprinkler Head = .35 cfs

2. Alternate Method for Checking Purposes:

THEORETICAL = .24 cfs

F. PUMP EFFICIENCY DATA (Optional)

Discharge Pressure: _____ psi x 2.31 = _____ ft (1); Dynamic pumping level: _____ ft (2)

Total Head: (1) + (2) = _____ (3)

Flow rate: _____ cfs (4)

Water HP: (3) x (4) ÷ 8.8 = _____ (5)

Meter Input KW: 3.6 x _____ KH x _____ CTR or _____ MULT x _____ PTR x _____ N/ _____ T = _____ (6)

Meter Input HP: (6) x 1.34 = _____ (7)

Panel Input KW _____ Ave PF x _____ Ave Volts x _____ Ave Amps x .001732 = _____ (6)

Panel Input HP: (6) x 1.34 = _____ (7) Efficiency: (5)/(7) x 100 = _____ %

NA

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation

$$V_{IR} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = 3 \times 4.5 = 13.5 \text{ AFA}$$

$$V_{DR} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = .09 \text{ cfs} \times 245 \times 1.9835 = 43 \text{ AFA}$$

$$V = \text{Smaller of } V_{IR} \text{ and } V_{DR} = 13.5 \text{ AFA}$$

2. Volume Calculations for Other Uses:

FEB 17 1995

H. REMARKS AND OVERLAP REVIEW ANALYSIS

* Heating & Cooling Calc =
SEE ATTACHMENT.

	Flow	Volume
HEAT	.13 cfs	21.82 AFA
COOL	.03 cfs	2.52 AFA

I. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
IRRIGATION	3-15	11-15	.09 cfs	13.5 AFA
Heating	1-1	12-31	.13 cfs	21.82 AFA
Cooling	1-1	12-31	.03 cfs	2.52 AFA
Totals:			.20 AFS.	37.84 AFA

2. Recommended Amendments

- ☐ Change P.D. as reflected above
 ☐ Add P.D. as reflected above
 ☒ None
☐ Change P.U. as reflected above
 ☒ Add P.U. as reflected above
 ☐ Other

J. AUTHENTICATION

Field Examiner's Name Cindy J. Hodges for
 Signature Dave Gray
 Certification Date _____
 Field Report Preparation Date 11/17/94

CONSULTANT SEAL

- K. Licensing recommendation shall be prepared by an Idaho Department of Water Resources employee on a computer printout attached hereto.

* See attached calculation sheets & memo. PC

FEB 17 1995

MEMORANDUM

TO: File 65-13110 / LDS Church (Letha Ward)
FROM: Brenda Chapman
DATE: January 24, 1995
RE: Recommendation Adjustment(s)

=====

The final licensing recommendations for the above referenced water right are based on the information below:

H. REMARKS AND OVERLAP REVIEW ANALYSIS

The heating and cooling recommendations have been adjusted based on guidelines from the September 28, 1992 Administrator's Memorandum Amended Application Processing No. 23. See Attached Lotus calculation sheets.

The Design Heat Load for BTU's should have been calculated for a 2 story building (by multiplying the BTU calculation by a factor of .8) which changed the BTU total from 302,887.2 to 242,310.

The Temperature Drop Across the System should have a multiplying factor or .3 instead of .6 which changes the temperature drop from -10.8 degrees to -5.4.

I. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use	Rate of Div	Annual Vol
Irrigation	3-15 to 11-15	.09	13.5
Heating	1-01 to 12-31	.20	35.7
Cooling	1-01 to 12-31	.05	4.1

See item H.

RECEIVED
FEB 17 1995

MEMORANDUM

TO: File 65-13110
FROM: BRENDA CHAPMAN
RE: GENERAL REVIEW OF HEATING USE REQUIREMENTS
DATE: 01/24/95

RATE OF FLOW AND ANNUAL VOLUME FOR HEATING USE

GIVEN:

Source Temperature	=	52 degrees
Area / 1 two story building	=	10430 sq. ft.
Temperature Outside	=	4 degrees
Temperature Inside	=	70 degrees
Building Efficiency	=	0.44
Temperature Required	=	70 degrees
Days per year temp below 70	=	180 days
Hours per day temp below 70	=	12 hours

CALCULATIONS:

Single Floor System Heat Load	=	302,887 btu/hr
Two Floor System Heat Load	=	242,310 btu/hr
Temp. Drop Across System	=	-5.4 degrees

FLOW RATE:

Single Floor Flow Rate	=	112 gpm
	=	0.25 cfs
Two Floor Flow Rate	=	90 gpm
	=	0.20 cfs

VOLUME:

Single Floor Annual Volume	=	44.6 af
Two Floor Annual Volume	=	35.7 af

EFFICIENCY RATING INFORMATION **

0.28 Best energy efficiency rating
0.44 Good energy efficiency rating
0.67 Average energy efficiency rating
1.11 Poor energy efficiency rating

** Source - Administrator's Memorandum dated 9/28/82

RECEIVED
FEB 17 1995

MEMORANDUM

TO: File 65-13110
FROM: BRENDA CHAPMAN
RE: GENERAL REVIEW OF COOLING USE REQUIREMENTS
DATE: 01/24/95

RATE OF FLOW AND ANNUAL VOLUME FOR COOLING USE

GIVEN:

Source Temperature	=	52 degrees
Area / 1 two story building	=	10430 sq. ft.
Temperature Outside	=	85 degrees
Temperature Inside	=	70 degrees
Building Efficiency	=	0.44
Temperature Required	=	70 degrees
Days per year temp above 70	=	90 days
Hours per day temp above 70	=	12 hours

CALCULATIONS:

Single Floor System Cool Load	=	(68,838)btu/hr
Two Floor System Cool Load	=	(55,070)btu/hr
Temp. Drop Across System	=	-5.4 degrees

FLOW RATE:

Single Floor Flow Rate	=	25 gpm
	=	0.06 cfs
Two Floor Flow Rate	=	20 gpm
	=	0.05 cfs

VOLUME:

Single Floor Annual Volume	=	5.1 af
Two Floor Annual Volume	=	4.1 af

EFFICIENCY RATING INFORMATION **

0.28 Best energy efficiency rating
0.44 Good energy efficiency rating
0.67 Average energy efficiency rating
1.11 Poor energy efficiency rating

** Source - Administrator's Memorandum dated 9/28/92.

APPROVED
7/1995

Given's = WATER TEMP (52°)

A = SQUARE FT (10,430 sq ft)

T_i = Temp desired (70° AW)

T_o = Avg Temp for AREA (4° Boise Area)

C = INSULATION / CFU (.44)

HEATING;

DESIGN HEAT LOAD; $E = (C \cdot \Delta T) A \rightarrow \text{GIVEN } (52^{\circ})$

$$T_i - T_o = 70 - 4 = 66^{\circ}$$

GIVEN
(.44)

DIFF OF (T_i - T_o)

$$* E = (.44 \cdot 66) 10,430 = 302,887.2 \text{ BTU's PER HOUR / WHOLE UNIT}$$

* TEMP DROP ACROSS SYSTEM;

$$\Delta T_s = (.6) [S - T_i]$$

CONSTANT

$$\Delta T_s = (.6) [52^{\circ} - 70^{\circ}]$$

$$\Delta T_s = -10.8^{\circ} \text{ TEMP DROP.}$$

$$\text{Flow RATE; } Q = \frac{E}{500 (\Delta T_s)} / 448.8$$

$$Q = \frac{302,887.2}{500 \cdot -10.8} / 448.8$$

$$Q = 56.09 / 448.8$$

$$Q = \underline{\underline{.13 \text{ CFS}}}$$

COOLING.

GIVEN A = SQUARE FT (10,430)

S = WATER TEMP (52°)

T_i = Temp desired (70°)

T_o = Avg TEMP in AREA (85°)

C = INSULATION sq (.44)

DESIGN HEAT LOAD;

$$E = (C \cdot \Delta T) A$$

$$E = (.44 \cdot 15) 10,430$$

$$E = (-6.6) 10,430$$

$$E = 68,838 \text{ BTUS.}$$

APPROVED
FEB 17 1995

* See attached memo. BC

TEMP Drop Across System.

RECEIVED

JAN 20 1995

Department of Water Resources

65-13110

$$\Delta T_s = (L.G) [S - T_i]$$

$$\Delta T_s = (L.G) [52 - 70]$$

$$\Delta T_s = -10.8^\circ$$

Flow RATE; $Q = \frac{E}{500(\Delta T_s)} / 448.8$

$$Q = \frac{68838}{500(-10.8)} / 448.8$$

$$Q = .03 \text{ CFS}$$

VOLUME:

COOLING; JUNE - Aug. 9 HRS DAY (8 A.M. - 5 P.M.) + 6 HRS
ON Sun WED THURS 12 WKS; 216 EXTRA HRS + 810 NORMAL

$$.03 \text{ CFS} \times 90 \text{ days} \times .47\% \text{ of day} \times 1.9835 = 2.52 \text{ AFA.}$$

$\begin{matrix} = 1036 \text{ HRS} \\ 2160 \text{ HRS TOTAL} \end{matrix} = 47\% \text{ of day USED}$

HEATING; $.13 \text{ CFS} \times 180 \text{ days} \times .47\% \text{ of day} \times 1.9835 = 21.82 \text{ AFA}$


HEAT: 6 MONTHS; 180 days x 24 HRS DAY (4320 HRS x .47% of day) = 2030 HRS used.

RECEIVED
FEB 17 1995

PERMIT 65-13110 INIT
T. R. S. Q/Q
P/D 7N 3W 36 SWSESW
SCALE
PHOTO ID. W.S.



Large N23 West Boise Meridian

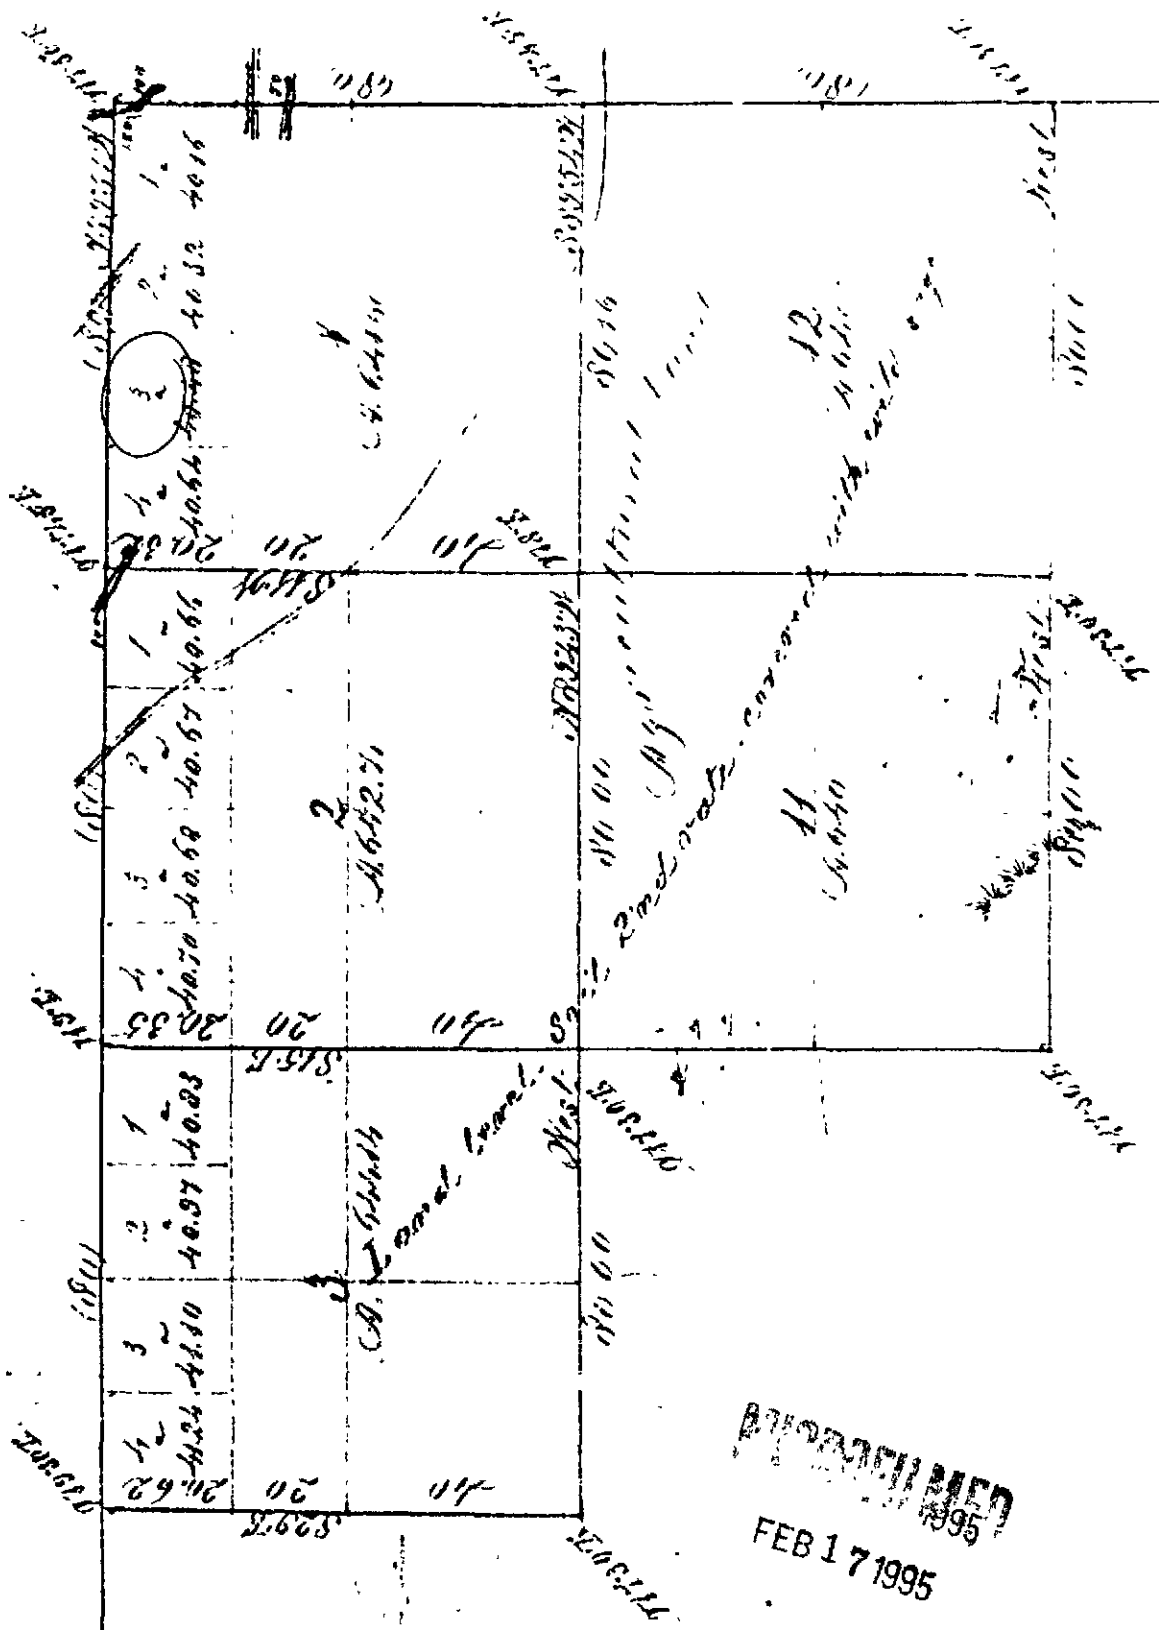

Department of Water Resources

WELL INSPECTION FORM

If well is associated with water right, provide WR# 65-13110

Otherwise provide legal description and a sketch map and/or address so that the well can be located easily.

1. Legal Description: TWP 7N, Rge 3W, Sec. 36, SE 1/4 SW 1/4 or Lot _____.

2. Owner: LDS, Church of

Address 12th Floor 50 E N Temple St., City SALT LAKE, St UT

3. Casing $\geq$ 12 inches above ground: Yes ☒ No _____

4. Access Port: Yes ☒ No _____

Static Water Level: 0

Pressure Gauge: Yes ☒ No _____

Casing Diameter: 6"

Flowing: Yes _____ No ☒

Temperature: _____

5. Are there any obvious construction problems that may be a source for contamination or waste of water: Yes _____ No ☒

If answer to Item 5 is Yes, describe in remarks and attach photo.

Remarks: _____

RECEIVED
FEB 17 1995

WELL DRILLER'S REPORT

State law requires that this report be filed with the Director, Department of Water Resources within 30 days after the completion or abandonment of the well.

[illegible]

65-13110

P/O

P/u


heating/cooling

P/u



irrigation

RECEIVED
FEB 17 1995

65-13110

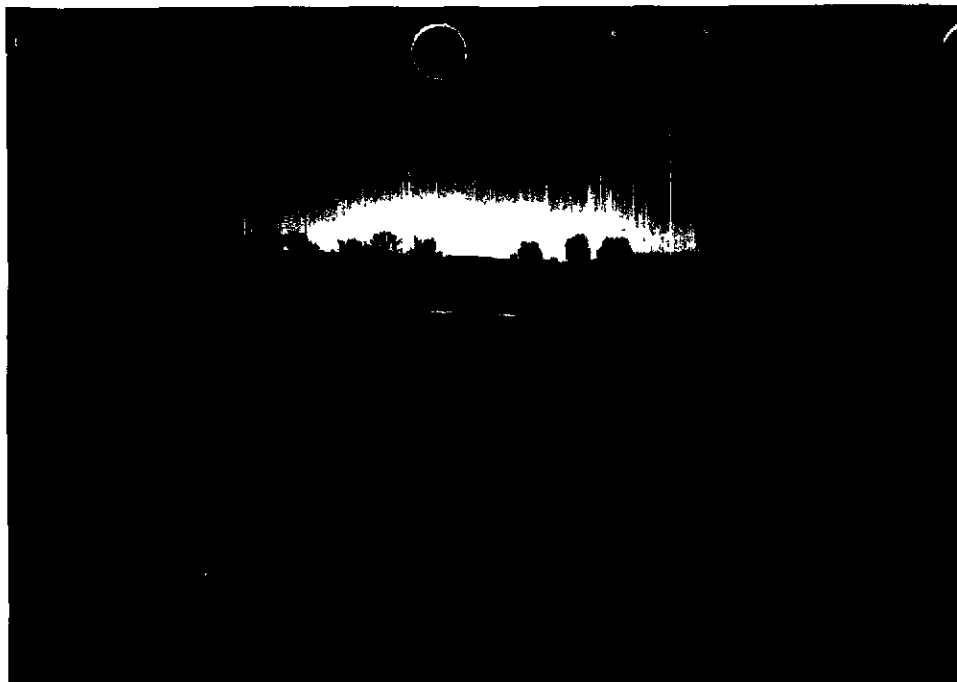

P/u - Softball
field

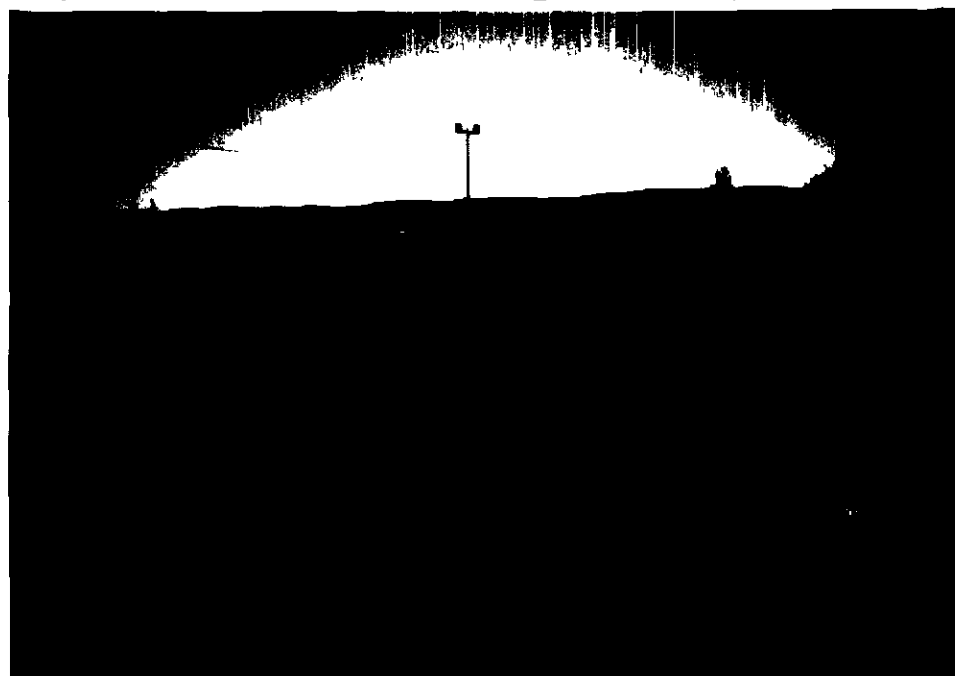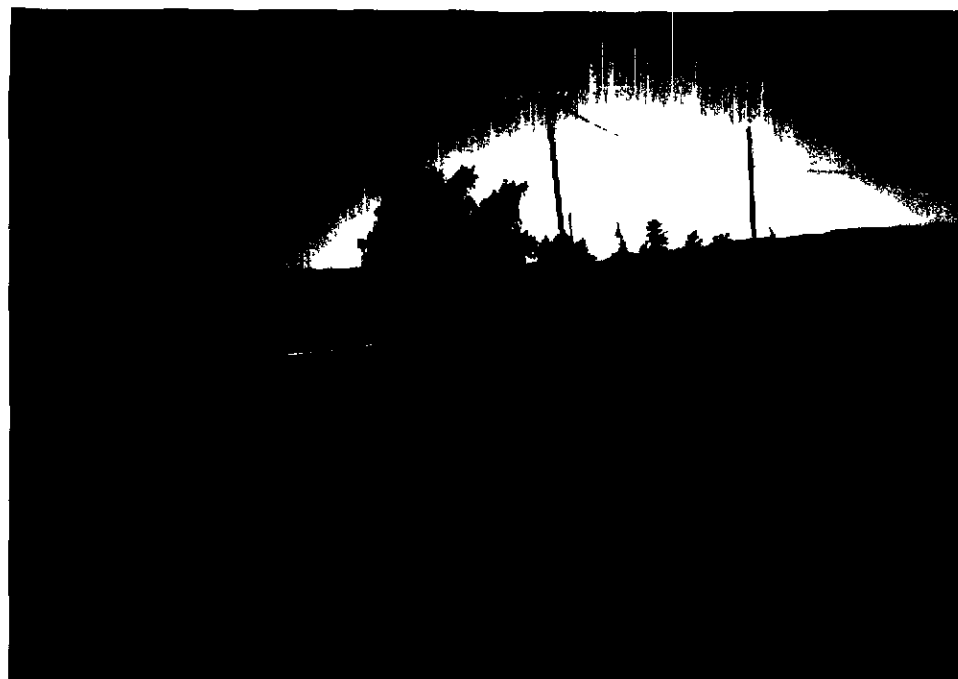

RECEIVED

FEB 17 1995

November 1, 1990

CHURCH OF JESUS CHRIST LATTER DAY SAINTS
REAL ESTATE DIVISION
12TH FLOOR
50 E. N. TEMPLE ST.
SALT LAKE CITY, UT 84150

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 65-13110

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water.

I note that the permit issued to you by the department requires the installation of a lockable device to allow the department to determine the rate of diversion. The proof which you submitted does not show that you have installed this equipment.

The installation of the lockable device must be complete by the time the department representative conducts the examination of your system unless the department has rescinded the requirement prior to the field examination. In some cases, the equipment requirement can be rescinded because the equipment cannot be physically installed, is not appropriate or can be accommodated with other measuring methods.

If you have questions concerning this matter, please feel free to contact the STATE Regional Office in Boise at (208)327-7900.

Sincerely,

Rita Fleck
Secretary/Records Manager

c: IDWR - Region

MICROFILMED

NOV 27 1990

THE CHURCH OF
JESUS CHRIST
OF LATTER-DAY
SAINTS

REAL ESTATE DIVISION
Twelfth Floor, RM-1241
50 East North Temple Street
Salt Lake City, Utah 84150
Phone (801) 240-4074

Reference reply to:

June 12, 1990

RECEIVED
JUN 15 1990

Department of Water Resources

Mr. Gary Spackman
Idaho Dept. of Water Resources
1301 North Orchard St.
Boise ID 83720

Dear Mr. Spackman,

Enclosed is our check in the sum of \$100.00 to cover the cost of field examinations of the two properties listed below.

<u>Permit #</u>	<u>Property #</u>	<u>Property Name</u>	<u>Quantity Requested</u>	<u>Fee</u>
P35-08732	527-7124	Blackfoot ID Rec-Wash Rd	0.10 cfs	\$50.00
P65-13110	511-9782	Letha Wd Rec-Moffat & 2nd	0.20 cfs	<u>\$50.00</u>
<u>TOTAL</u>				\$100.00

Thank you for your assistance.

Sincerely,

Ronald C. Johnson

Ronald C. Johnson
Water Analyst

RCJ:ja
enc.

cc: Terry F. Roylance
M. Glade Pincock

MICROFILMED
NOV 21 1991

S T A T E O F I D A H O

DEPARTMENT OF WATER RESOURCES

Statehouse
Boise, Idaho 83720
(208) 327-7900
June 4, 1990

CHURCH OF JESUS CHRIST LATTER DAY SAINTS
REAL ESTATE DIVISION
12TH FLOOR
50 E. N. TEMPLE ST.
SALT LAKE CITY, UT 84150

PERMIT APPROVAL NOTICE

RE: PERMIT NO. P65-13110

Dear Permit Holder:

Enclosed is a copy of your approved application for permit. We direct your attention to the conditions of approval on the final page.

You should be aware that the groundwater you propose to divert is located within a drainage basin where surface waters are regulated during the months of low flow. It is possible that diversion of groundwater may have an adverse impact on these surface water flows. Information available to us at this time does not warrant refusing to issue permits in your area, but we do caution that diversions of groundwater are not allowed to deplete flows available for surface water users with earlier priority dates. Siting your well as far from surface sources as possible and casing out upper water producing zones may reduce the potential of interference.

Section 42-235, Idaho Code, requires that a "drilling permit" must be obtained from the department for all wells constructed after July 1, 1987. A drilling permit is a separate permit that must be issued in addition to your permit to appropriate water. Commencement of well construction or diversion of water under your permit to appropriate water is prohibited unless a drilling permit is obtained.

We have enclosed a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit. Also enclosed for your convenience is a form entitled "Proof of Beneficial Use".

MICROFILMED

JUN 06 1990

Beneficial Use" that must be submitted to the Department when your project is completed. If development is complete, you may submit proof of beneficial use immediately.

Sincerely,

GARY SPACKMAN, Supervisor
Water Right Permits Section

GS: SC
Enclosures

RECORDED

JUN 06 1990

RECEIVED
APR 13 1990

Department of Water Resources
Western Regional Office

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO,

ss.

COUNTY OF GEM,

Esma Reyes, being first
duly sworn, on his oath deposes and
says that she is the her printer of Mes-
senger-Index, a legal weekly news-
paper published at Emmett, in Gem
County, Idaho; that said newspaper
is in general circulation in said
county and has been published unin-
terruptedly and continuously for
more than 78 weeks prior to the
first publication of the annexed
document; and that the document
notice, process, or advertisement
hereunto annexed was published in
the regular edition of Messenger-
Index for Two

consecutive weekly issues thereof,
beginning with the issue of
April 4, 1990,
and ending with the issue of
April 11, 1990

Esma Reyes

Subscribed and sworn to before me
this 11th day of

April, 1990
Mary Ann Hanson

Notary Public,
Residing at Emmett, Idaho.

My Commission Expires 3-21-95

NOTICE OF APPLICATION
FOR WATER RIGHT

The Following applications
have been filed to appropriate
the public waters of the State of
Idaho:

65-13110
CHURCH OF JESUS CHRIST
OF LATTER DAY SAINTS
REAL ESTATE DIVISION
12TH FLOOR
50 E. N. TEMPLE ST
SALT LAKE CITY, UT 84150
Source: GROUNDWATER
Division Pt. SW25SW Sec 36
T 07N R 03W
Use: IRRIGATION (100 CFS)
HEATING (200 CFS)
COOLING (200 CFS)
Total Diversion: (400 CFS)
Date Filed: 12/5/1989
In: T06N R03W S01 Lot 9
(NEMW)
T07N R03W S36 SE2W
30 ACRES TOTAL

65-13154
SUTTON, ALLEN L.
PO. BOX 25
OLA, ID 83857
Source: SQUAW CREEK
Tributary: FAYETTE RIVER
Division Pt. NW25W Sec 12 T
10N R 01E
Use: IRRIGATION (400 CFS)
Total Diversion: (400 CFS)
Date Filed: 2/5/1990
In: T10N R01E S23 NWNE
SWNE NEMW SENW
200 ACRES TOTAL

65-13157
LANHAM, REX E.
848 JACKSON
EMMETT, ID 83617
Source: WASTE WATER
Tributary: FAYETTE RIVER
Division Pt. NENE Sec 11 T
06N R 02W
Use: IRRIGATION (500 CFS)
Total Diversion: (500 CFS)
Date Filed: 2/7/1990
In: T06N R02W S11 NENE
NENE S12 (SWNE) Lot 3
(SENW)
400 ACRES TOTAL

65-13165
WOOD, RONALD
WOOD, JUDITH
PO. BOX 365
EMMETT, ID 83617
Source: SPRINGS
Tributary: SQUAW CREEK
Division Pt. SWSEW Sec 3
T 06N R 01W
Use: STOCKWATER (500 CFS)
Total Diversion: (500 CFS)
Date Filed: 2/8/1990
In: T07N R01W S02 SENW

65-13168
KRAFT, DALLAS E.
KRAFT, SUSAN J.
7191 BILL BURNS RD.
EMMETT, ID 83617
Source: SPRINGS
Tributary: FAYETTE RIVER
Division Pt. NEMW Sec 18
T 06N R 03W
Use: STOCKWATER (100 CFS)
Total Diversion: (100 CFS)
Date Filed: 2/13/1990
In: T06N R03W S18 NEMW

65-13169
CARLOCK, CARROLL
PO. BOX 44
OLA, ID 83857
Source: SPRINGS
Tributary: SQUAW CREEK
Division Pt. SWSEW Sec 3
T 11N R 01E
SE2SW Sec 3 T 11N R 01E
SEWSE Sec 3 T 11N R 01E
SEWSEW Sec 3 T 11N R 01E
NEMW Sec 34 T 12N R 01E
Use: STOCKWATER (100 CFS)
Total Diversion: (100 CFS)
Date Filed: 2/13/1990
In: T11N R01E S03 NEMW
SEW SEW NEMW
T12N R01E S25 NEMW

CHAL

CHURCH OF JESUS CHRIST
OF LATTER DAY SAINTS
REAL ESTATE DIVISION
12TH FLOOR
50 E. N. TEMPLE ST
SALT LAKE CITY, UT 84150
Source: GROUNDWATER
Division Pt. SW25SW Sec 36
T 07N R 03W
Use: IRRIGATION (100 CFS)
HEATING (200 CFS)
COOLING (200 CFS)
Total Diversion: (400 CFS)
Date Filed: 12/5/1989
In: T06N R03W S01 Lot 9
(NEMW)
T07N R03W S36 SE2W
30 ACRES TOTAL

65-13154
SUTTON, ALLEN L.
PO. BOX 25
OLA, ID 83857
Source: SQUAW CREEK
Tributary: FAYETTE RIVER
Division Pt. NW25W Sec 12 T
10N R 01E
Use: IRRIGATION (400 CFS)
Total Diversion: (400 CFS)
Date Filed: 2/5/1990
In: T10N R01E S23 NWNE
SWNE NEMW SENW
200 ACRES TOTAL

65-13157
LANHAM, REX E.
848 JACKSON
EMMETT, ID 83617
Source: WASTE WATER
Tributary: FAYETTE RIVER
Division Pt. NENE Sec 11 T
06N R 02W
Use: IRRIGATION (500 CFS)
Total Diversion: (500 CFS)
Date Filed: 2/7/1990
In: T06N R02W S11 NENE
NENE S12 (SWNE) Lot 3
(SENW)
400 ACRES TOTAL

65-13165
WOOD, RONALD
WOOD, JUDITH
PO. BOX 365
EMMETT, ID 83617
Source: SPRINGS
Tributary: SQUAW CREEK
Division Pt. SWSEW Sec 3
T 06N R 01W
Use: STOCKWATER (500 CFS)
Total Diversion: (500 CFS)
Date Filed: 2/8/1990
In: T07N R01W S02 SENW

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Western Region
2735 AIRPORT WAY

Boise, Idaho 83705
(208) 334-2190

MARCH 28, 1990

Messenger-Index
P.O. Box 577
Emmett, ID 83617

Dear Legal Dept.:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before APRIL 23, 1990.

Yours truly,

GAIL GARRETT
Secretary

Encl.

MicroFILMED

JUN 06 1990

65-13110

CHURCH OF JESUS CHRIST LATTER DAY SAINTS
REAL ESTATE DIVISION
12TH FLOOR
50 E. N. TEMPLE ST.
SALT LAKE CITY, UT 84150

Source: GROUNDWATER

Diversion Pt: SWSESW Sec 36 T 07N R 03W

Use: IRRIGATION	(.090 CFS)
HEATING	(.200 CFS)
COOLING	(.200 CFS)
Total Diversion:	(.200 CFS)

Date Filed: 12/ 5/ 1989

In: T06N R03W S01 Lot 3 (NENW)
T07N R03W S36 SESW

3.0 ACRES TOTAL

RECORDED & FILMED

JUN 06 1990

McKELLIP ENGINEERING, P.A.
mechanical & electrical

4205 Emerald Street
Boise, Idaho 83706

(208) 336-1116

March 2, 1990

RECEIVED
MAR 05 1990

Department of Water Resources
Mr. Rob Whitney
2735 Airport Way
Boise, ID. 83705

Department of Water Resources
Western Regional Office

Re: LDS Church, Letha Ward

Dear Rob:

After reviewing our files on the above referenced project, the Load Calculations indicate that maximum flow requirements of well water for all heat pump units at design conditions (96 degrees F summer and 10 degrees F winter) will approach 95 GPM. This figure does not include a probable diversity of 20% making maximum use at design temperature closer to 75 GPM.

If further information or verification is needed, please contact us.

Sincerely,



Richard T. Kartchner, P.E.
McKellip Engineering, P.A.

RTK/sb

low

RECEIVED

JUN 06 1990

ADJUDICATION FILING FEES FOR IDAHO

RECEIVED

DEC 4 1989

PROPERTY IDENTIFICATION

Idaho State Water Right Permit # 65-13110
LDS Church Property # 5119782

Department of Water Resources

FEE CALCULATIONS

Domestic, stockwatering, fire protection, etc. \$ _____
Flat fee for irrigation. \$ _____

VARIABLE FEE SCHEDULE


Irrigation (\$1.00 per acre). \$ _____
Power Generation (\$3.00 per kilowatt) \$ _____
Aquaculture (\$10.00 per cfs) \$ _____
All other uses (\$100.00 per cfs) \$ _____

Other charges. \$ 30.00 App. for Permit

TOTAL

\$ 30.00

DATE 10-27-89

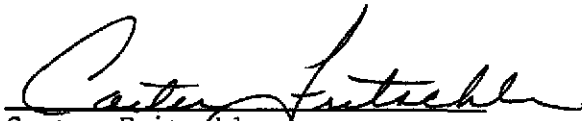

Carter Fritschle
Idaho Dept. of Water Resources



Glen Nielson
Field Representative
Church of Jesus Christ
of Latter-day Saints

459-0134

RECORDED

JUN 06 1990