
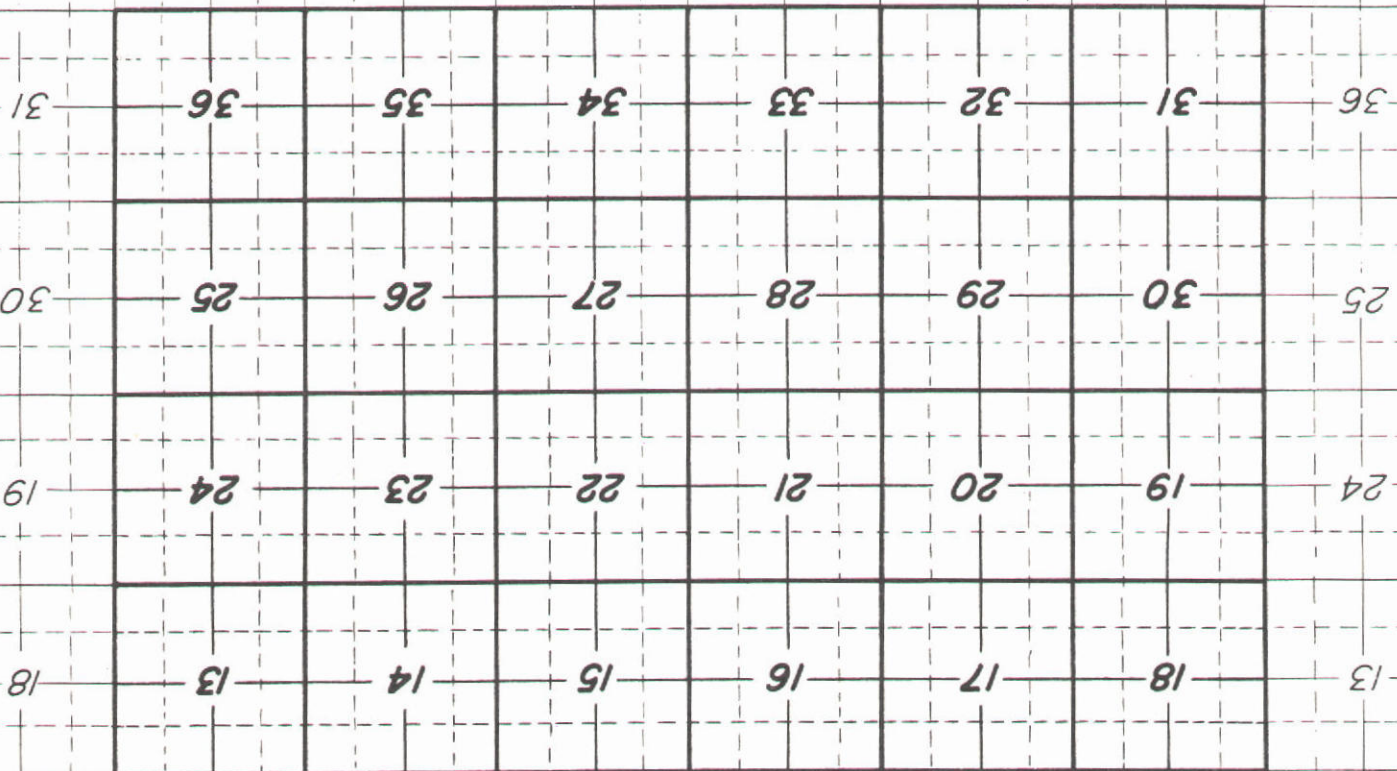


TWP 6N RANGE 20W COUNTY GEM SCALE: 1" = 1 MILE

LEGEND

1. APPLICANTS were

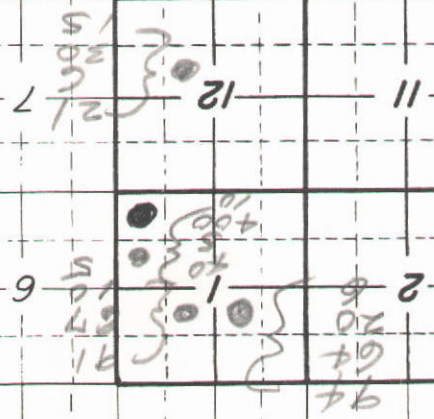

95-7113

RECEIVED
JUL 22 1970

Department of Water Administration

NOTICE OF APPLICATION
FOR PERMIT TO APPROPRIATE
THE PUBLIC WATERS OF
THE STATE OF IDAHO

Notice is hereby given that Frank D. Callender, Cascade, Idaho, has on June 22, 1970, submitted Application No. 65-7143 to appropriate the public waters of a ground water source.

The application proposes a maximum diversion and appropriation of 0.88 cubic feet per second of water to be diverted by a well and pump within the SE $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 1, T. 6 N., R. 2 W., B.M., Gem County and is to be used within the NW $\frac{1}{4}$ SW $\frac{1}{4}$ Sec. 6, T. 6 N., R. 1 W., B.M. and NE $\frac{1}{4}$ SE $\frac{1}{4}$, SE $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 1, T. 6 N., R. 2 W., B.M., for the domestic use of 44 families from Jan. 1 to Dec. 31.

Any permit issued pursuant to this application will be subject to ALL PRIOR WATER RIGHTS and subject to the CONTROL OF A STATE WATERMASTER. Any protest against this application must be filed with the Idaho Department of Water Administration on or before July 27, 1970.

R. Keith Higginson
Director

Published in the Emmett
Messenger-Index, Emmett, Idaho on
July 9th and July 16th, 1970.

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO,
COUNTY OF GEM, ss.

Anita Boles, being first
duly sworn, on his oath deposes and
says that he is the printer of Messenger-
Index, a legal weekly newspaper pub-
lished at Emmett, in Gem County, Idaho;
that said newspaper is in general circu-
lation in said county and has been pub-
lished uninterruptedly and continuously
for more than 78 weeks prior to the first
publication of the annexed document;
and that the document notice, process,
or advertisement hereunto annexed was
published in the regular edition of

Messenger-Index for 2
consecutive weekly issues thereof, be-

ginning with the issue of July 9,

1970, and ending with the issue of

July 16, 1970
Anita Boles

Subscribed and sworn to before me this

21st day of
July, 1970
Caro Yarno

Notary Public,
Residing at Emmett, Idaho.

65 7100

		RZW					
T							
G		X					
N		P.D.		X = place of use			

(Include distance from pump to measuring device, if applicable.)

Point(s) of diversion: NW SE Sec 1 T6N R2W

Place(s) of Use

[illegible]

Recommended Amendments:

- ☒ Change P.D. as reflected above
☐ Change P.U. as reflected above

- ☐ Add P.D. as reflected above
- ☐ Add P.U. as reflected above

- ☐ None
- ☐ Other

MICROFILMED

JUL 07 1988

Examiner's Signature

John K. Moyer DBS

Checked by

Rollins

Approved by

Date 4/8/91

ate 4/9/81

Date 4/14/81

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

License of Water Right No. 65-7143 Priority June 26, 1970 Amount .75 cfs
(late proof)

THIS IS TO CERTIFY, that BONNIE LAURA SUBDIVISION
of Emmett, Idaho, has complied with the terms and conditions of Permit
No 65-7143 issued pursuant to Application for Permit dated June 22, 1970,
and has submitted proof to the Department of Water Resources on October 9, 1980,
that he has applied water to a beneficial use, an examination by the Department indicates that the works have a
capacity for the diversion of .75 cfs of water from a groundwater source,
tributary to _____, and that the permit holder has applied to a beneficial use and
established a right to use water as follows

Beneficial Use	Period of Use	Rate of Diversion	Annual Volume
Domestic (25 units)	from <u>January 1</u> to <u>December 31</u>	at <u>.75</u> cfs and	<u>30</u> acre feet
	from _____ to _____	_____ cfs and	_____
	from _____ to _____	_____ cfs and	_____

(both dates inclusive)

Subject, however, to the condition that no more than .75 cfs of water be diverted at any one time, and
that the amount of water so diverted and to which such right is entitled and confirmed for the purpose
aforementioned and is limited to the amount which can actually be beneficially used and shall not exceed
30 acre feet per year, said waters to be diverted within the NW $\frac{1}{4}$ SE $\frac{1}{4}$, Sec. 1, Twp. 6N,
Rge. 2W, B.M. in the County of Gem

Description and location of place of use

Twp.	Range	Sec.	NE $\frac{1}{4}$				NW $\frac{1}{4}$				SW $\frac{1}{4}$				SE $\frac{1}{4}$				Totals
			NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	
6N	2W	1																	

Total number of acres irrigated _____

NOTE: Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho Law. This right may be forfeited by five years of non-use.

The right to the use of the water hereby confirmed is restricted and appurtenant to the lands or place of use herein described, as provided by the laws of Idaho.

Witness the seal and signature of the Director, affixed at Boise, Idaho, this 8th day of
May, 19 81.

[Signature]
Director

JUL 17 1980

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

RECEIVED

APR 23 1981

Licensing
APPLICATION FOR AMENDMENT OF A PERMIT

Department of Water Resources

To change the point of diversion and/or the place of use.

Comes now Bonnie Laura Subdivision

of (address) % Charles L. Rekow, Pres. 1029 Lilac Lane, Emmett, ID 83617, and represents to the
Director of the Idaho Department of Water Resources:

That he is the owner and holder of Permit to appropriate the Public Waters of the State of Idaho
No. 65-7143, and requests that the permit and permit map be changed as follows:

1. Point of diversion: NW 1/4 SE 1/4, Section 1, Township 6N, Range 2W, B.M.,
County of Gem. Other points of diversion: _____

2. Period and nature of use: (irrigation, domestic, stockwatering, industrial, etc.)

NO CHANGE
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre feet per annum)

3. Place of use or land to be irrigated: NO CHANGE

TWP	RGE	SEC	NE 1/4				NW 1/4				SW 1/4				SE 1/4				TOTALS
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	

MICROFILMED


JUL 07 1988

Total number of acres to be irrigated = 10

4. a. Who owns the property at the point of diversion? Bonnie Laura Waters Corp
b. Who owns the land to be irrigated or the place of use? Each individual owning his or her home & lot
c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: There is a Bonnie Laura Waters Corporation & at this time I am the president of the Corporation. Originally I did own the lots & they were sold off to individuals thereby making a Corp
Charles L. Rekow

Complete the following map by showing land and point of diversion as proposed by this amendment.

Show 40-acre subdivisions, townships, ranges and ditches.

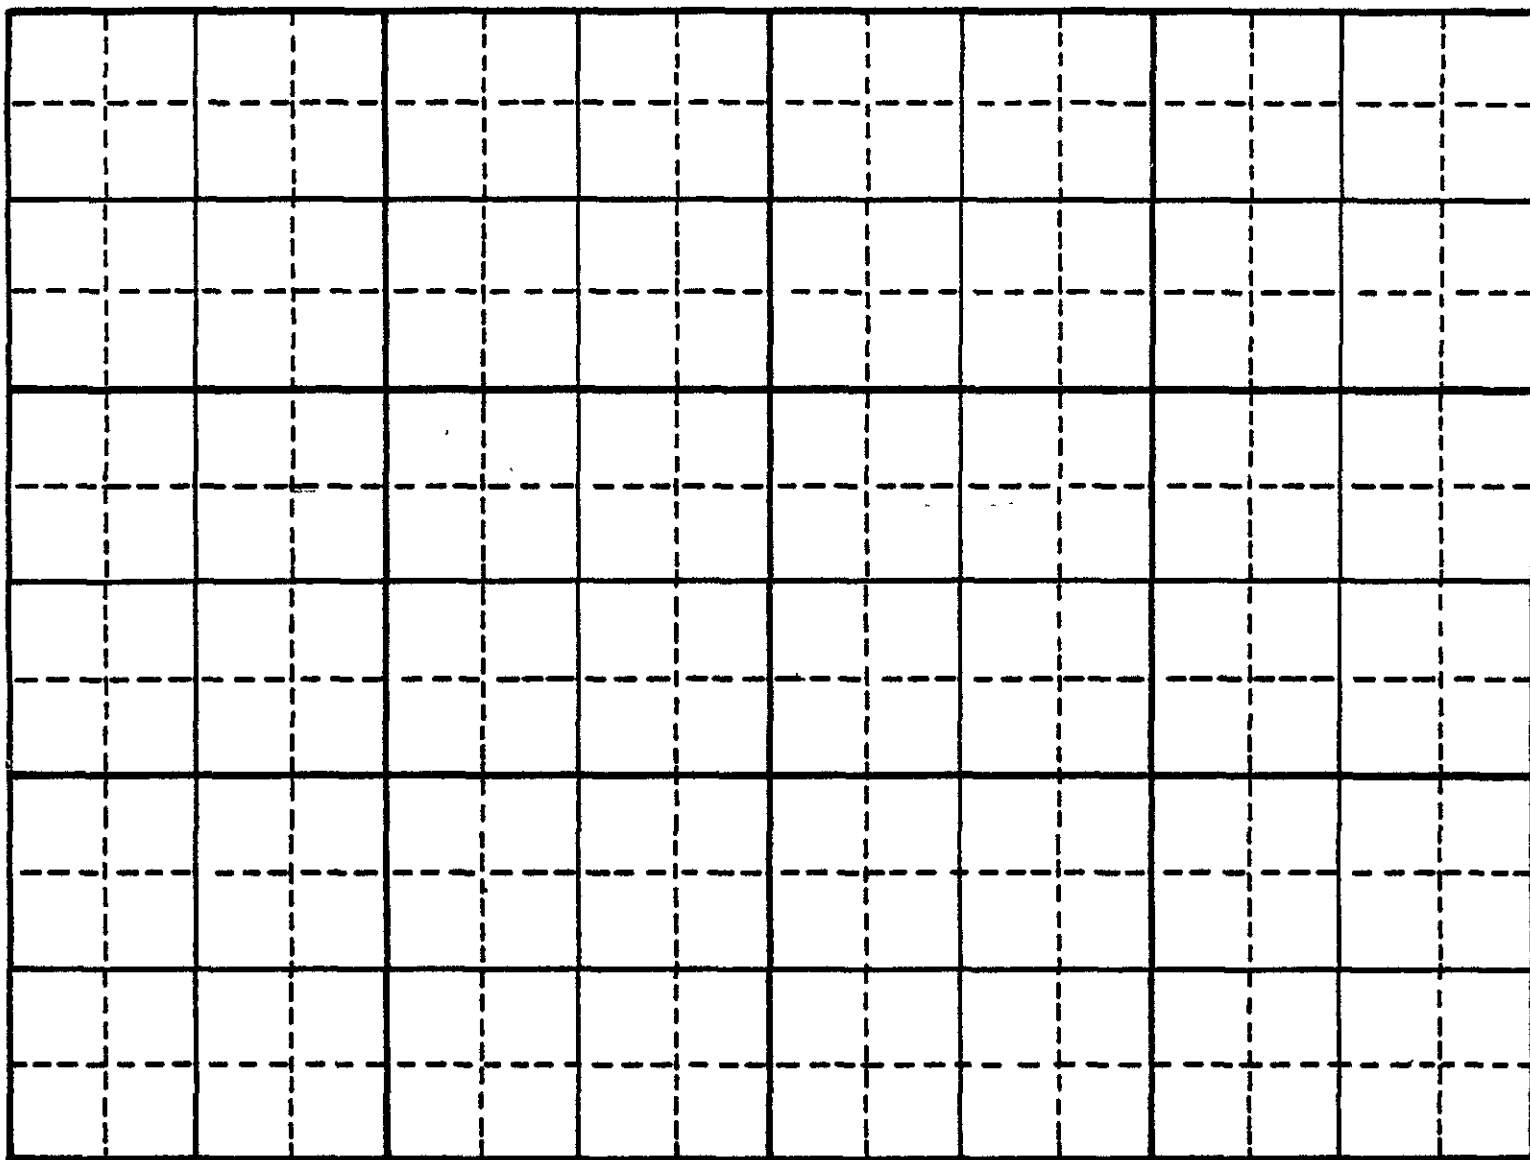

Scale: 2 inches equal 1 mile.

That no one will be injured by such change, and that such change will be made at permit holder's own risk.

Signed at Emmett Idaho, this 21 day of April, 19 81.
Charles L. Helms
(Signature)

FOR DEPARTMENT USE ONLY

#18578

Preliminary check by Jan Fee = \$20.00

Received by sg Date 4-28-81

Publication prepared by N/A Date _____

Published in _____

Publication dates N/A

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

I, A. KENNETH DUNN, Director of the Department of Water Resources hereby

APPROVE the above referenced Amendment for Permit No. 65-7143.

Witness my hand this

NOT RECORDED

May

19 81

JUL 07 1988

[Signature]
Director

DRT

BEFORE THE DEPARTMENT OF WATER RESOURCES
OF THE
STATE OF IDAHO

IN THE MATTER OF CHANGING THE MEASURING
DEVICE REQUIREMENT FOR PERMIT NO. 65-7143

ORDER

WHEREAS, the above numbered permit was approved with the condition that a measuring device of a type approved by the Department be permanently installed and maintained as part of the diverting works; and,

WHEREAS, on July 1, 1978, the Department adopted a new water measurement condition which states: "An access port or other device as specified by the Department shall be installed by the permit holder to provide for the installation of measuring equipment and the determination of the rate of diversion by the Department"; and,


WHEREAS, the former condition required the permit holder to purchase and install a measuring device or hire a professional engineer to certify the rate of diversion; and,

WHEREAS, the measuring device condition effective July 1, 1978, requires less capital expenditure by the permit holder; and,

WHEREAS, to be equitable to holders of permits issued prior to July 1, 1978, the new condition should be retroactive;

NOW THEREFORE, it is hereby ordered that the condition of approval of this permit related to water measurement is hereby changed as follows: "The permit holder shall either install a measuring device or provide a certified measurement by a professional engineer or install an access port or other device as specified by the Department".

Dated this 18th day of August, 1978.

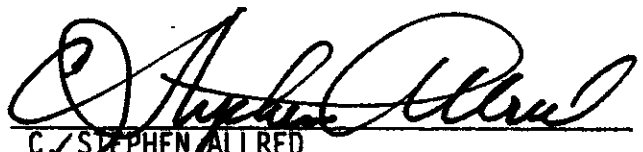
C. STEPHEN ALLRED
Director

MICROFILMED

Rge. 2 W

Twp. 6 N

1

**

That no one will be injured by such change, and that such change will be made at permit holders own risk.

(signature)

ok

Administrator, Operations Division

hereby approve the above application for amendment on Permit No. 65-7143.

November, 19 75
[Signature]
 Director

A. KENNETH DUNN
Administrator, Operations Division

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

RECEIVED
NOV 5 1975

APPLICATION FOR EXTENSION OF TIME

Department of Water Resources

State of Idaho)
County of Ada)

Permit No. 65-7143

Bonnie Laura Subdivision of Route 2, Box 266-6, Emmett, ID 83617
(name) (address)

State of Idaho, being first duly sworn, upon his oath deposes and says:

That he is the holder, or the duly authorized agent of the holder *, of Permit to
Appropriate the Public Waters of the State of Idaho No. 65-7143.

That under the terms and conditions of said permit, work thereunder was required
to be completed on or before November 1, 19 75.

That he has heretofore performed the following work described under said permit:
Approx. 15 homes have been completed within the subdivision and hooked up to the
water system.

Costing \$

That he is unable to complete the remainder of the work within the required time for
the following reasons, to-wit: Need additional time within which to construct homes
and therefore finish subdivision before licensing of permit.

Wherefore, he asks that the Department of Water Resources extend the time for the
completion of obligations under said permit to November 1, 19 80.

Charles L. Kekow
(signature) *

Charles L. Kekow, President

Subscribed and sworn before me this 5th day of November, 19 75.

seal

Marcia L. Brown
Notary Public residing at
Boise, Idaho

My commission expires 8-10-79

ok
11-1-80

ACTION OF THE DEPARTMENT OF WATER RESOURCES

IT IS HEREBY ORDERED that the above application for extension of time be APPROVED
and the time within which to submit proof of beneficial use under Permit No. 65-7143
be extended to November 1, 1980. IT IS FURTHER ORDERED that the permit be REINSTATED
and the priority be advanced to June 26, 1970.

Witness my hand this 5th day of November, 19 75.

A. Kenneth Dunn
Director A. KENNETH DUNN
Administrator, Operations Division

* IF OTHER THAN HOLDER, Power of Attorney must be supplied. Forms are available
through the Department of Water Resources, State Capitol, Boise, Idaho 83720.

MICROFILMED

RECEIVED

State of Idaho
Department of Water Resources

NOV 5 1975

ASSIGNMENT OF PERMIT

Department of Water Resources

I, Frank D. Callender, hereby assign to Bonnie Laura Subdivision
of Charles L. Rekow, Pres., Route 2, Box 266-6, Emmett, Idaho 83617
Address

CHECK ONE

☒ All my right, title, and interest in and to Permit No. 65-7143
to appropriate the public waters of the State of Idaho.

☐ The following described portion of my right, title, and interest in and to Permit
No. _____ to appropriate the public waters of the State of Idaho.

(Describe that portion of the permit being assigned by listing the acreage within
each 40 acre subdivision, the point of diversion and the amount of water in cubic
feet per second for direct diversion, or acre feet for storage)

Made this 5th day of November, 19 75.

Frank D. Callender
Permit Holder

Spouse of Permit Holder

State of Idaho)
County of Ada) ss.

On this 5th day of November, 19 75, personally
appeared before me the signer(s) of the above instrument, who duly acknowledged to me
that he (she) (they) executed the same.

seal

Marcia L. Brown
Notary Public residing at
Boise, Idaho

My commission expires:

8-10-79

RECEIVED

ASSIGNED TO: BONNIE LAURA SUBDIVISION
11-05-1975 Route 2, Box 266-8
Emmett, ID 83617

Identification No 65-7143
Application No _____

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
APPLICATION FOR PERMIT

To Appropriate the Public Waters of the State of Idaho
(TYPE OR PRINT IN INK)

APPROVED

1. Name of applicant FRANK D. CALLENDER
post office address CASCADE, IDAHO 83611

2 Source of water supply UNDEGROUND (GROUND) which is a tributary of _____

3. a. Location of point of diversion is SE $\frac{1}{4}$ of SE $\frac{1}{4}$ of Section 1 Township 6 N.
Range 2 W. B.M. GEM County; additional points of diversion if any _____

b If water is not consumed, it will be discharged into _____ at a point in _____ $\frac{1}{4}$
of _____ $\frac{1}{4}$ of Section _____ Township _____ Range _____ B.M. _____

4 Water will be used for the following purposes

Amount 0.88 C.F.S. for MULTIPLE DOMESTIC purpose from JAN 1 to DEC 31 (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purpose from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purpose from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated:

a 0.88 C.F.S. cubic feet per second and/or

b _____ acre feet per annum.

6 Proposed diverting works:

a Description of ditches, flumes, pumps, headgates, etc. HIGH PRESSURE
PUMP 20 H.P.

b. Height of storage dam _____ feet, active reservoir capacity _____ acre feet, total reservoir
capacity _____ acre feet, materials used in storage dam: _____

Period of year during which storage will occur _____ to _____ inclusive.
(Mo. Day) (Mo. Day)

c Proposed well diameter is 8 inches, proposed depth of well is 160 feet

7. a. Time required for the completion of the works and application of the water to the proposed beneficial use
is 5 years less

b Estimated construction cost is \$ 4,500.⁰⁰

8. Description of proposed uses

a If water is not for irrigation

	<u>NW</u> $\frac{1}{4}$	<u>SW</u> $\frac{1}{4}$	<u>6</u>	<u>6N 1W</u>
	<u>NE</u> $\frac{1}{4}$	<u>SE</u> $\frac{1}{4}$	<u>1</u>	<u>6N 2W</u>
(1) Give the place of use of water	<u>SE</u> $\frac{1}{4}$ of	<u>SE</u> $\frac{1}{4}$ of	<u>1</u> Township	<u>6N 2W</u>
	Range <u>2 W</u>	B.M.		

(2) Amount of power to be generated _____ hp under _____ feet of head

(3) List number of each kind of livestock to be watered 0

(4) Name of municipality to be served _____, or number of families to be
supplied with domestic water 44

(5) If water is to be used for other purposes describe LAWN

65 7143

1

[illegible]

Total number of acres to be irrigated _____

c. Describe any other water rights used for the same purposes _____

9. a. Who owns the property at the point of diversion FRANK D. CALLENDER
b. Who owns the land to be irrigated or place of use FRANK D. CALLENDER
c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing _____

10. Remarks _____

11. Map of proposed project:

See ATTACHED

Scale. 2 inches equal 1 mile

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

x Frank D. Callender
(Applicant)

Received by ey Date 6-22-70 Time 11:30 AM
Preliminary check by D Fee \$ 20.00
Received by ey Date 6-24-70
Publication prepared by du Date 7-2-70
Published in Emmett Messenger - Idaho
Publication dates 7-9+16-70
Publication approved du Date 7-22-70
Priority reduced to _____ Reason _____

Protests filed by: _____

Copies of protests forwarded by _____
Hearing held by _____ Date _____
Recommended for approval denial by Don Daley

ACTION OF STATE RECLAMATION ENGINEER

APPROVED

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No 65-7143, and said application is hereby APPROVED

1. Approval of said application is subject to the following limitations and conditions.

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
- b. Proof of construction of works and application of water to beneficial use shall be submitted on or before November 1, 1975.
- c. Other The permit holder shall permanently install and maintain a measuring device of a type approved by the department as part of the diverting works.

2. Denial of said application is for the following reasons _____

Witness my hand this 12th day of November 19 70.



Deputy State Reclamation Engineer

65 7143

TWP. 6N RANGE 2W COUNTY GEM SCALE: 1" = 1 MILE

LEGEND

- - APPLANTS WELL
- - INVESTIGATIONS
- - DOMESTIC

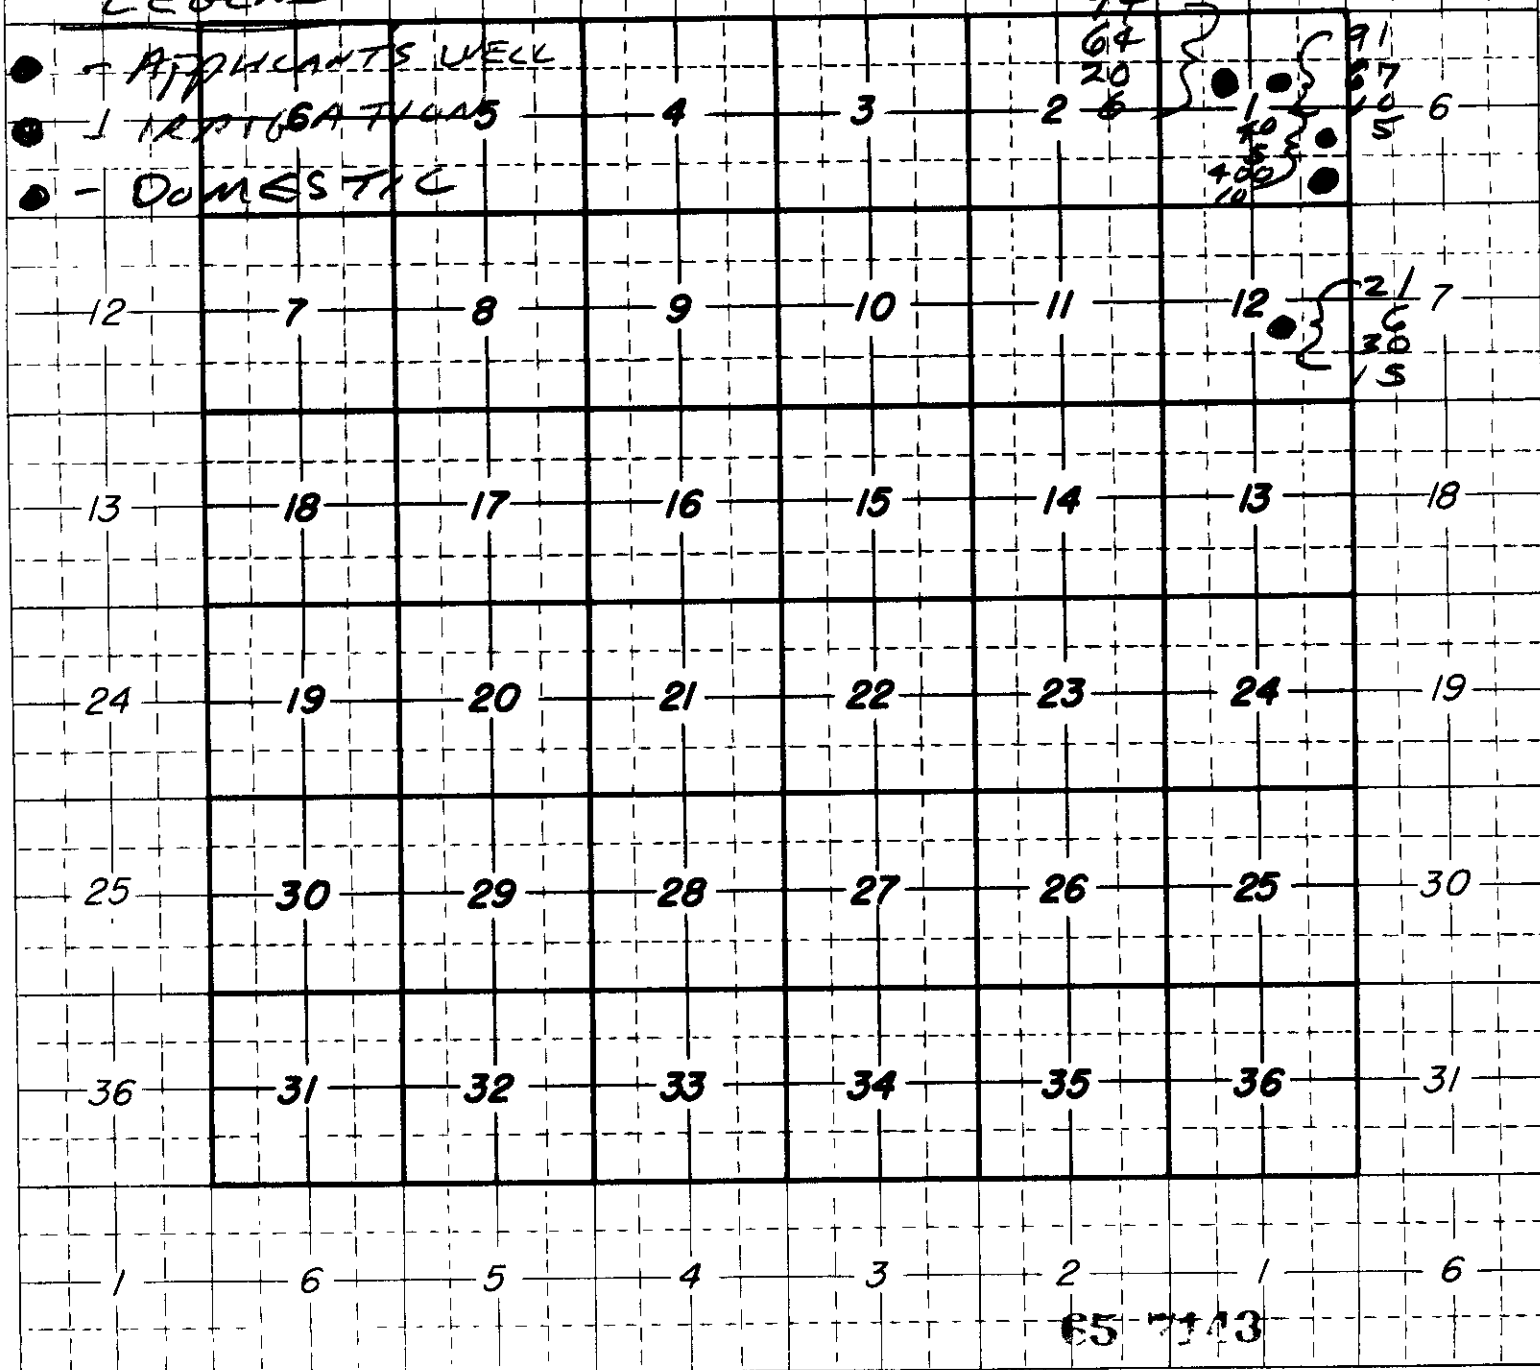

NOTICE OF APPLICATION
FOR PERMIT TO APPROPRIATE
THE PUBLIC WATERS OF
THE STATE OF IDAHO

Notice is hereby given that Frank D. Callender, Cascade, Idaho, has on June 22, 1970, submitted Application No. 65-7143 to appropriate the public waters of a ground water source.

The application proposes a maximum diversion and appropriation of 0.88 cubic feet per second of water to be diverted by a well and pump within the SE $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 1, T. 6 N., R. 2 W., B.M., Gem County and is to be used within the NW $\frac{1}{4}$ SW $\frac{1}{4}$ Sec. 6, T. 6 N., R. 1 W., B.M. and NE $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 1, T. 6 N., R. 2 W., B.M., for the domestic use of 44 families from Jan. 1 to Dec. 31.

Any permit issued pursuant to this application will be subject to ALL PRIOR WATER RIGHTS and subject to the CONTROL OF A STATE WATERMASTER. Any protest against this application must be filed with the Idaho Department of Water Administration on or before July 27, 1970.

R. Keith Higginson
Director

Published in the Emmett
Messenger-Index, Emmett, Idaho on
July 9th and July 16th, 1970.

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO, ss.
COUNTY OF GEM

Anita Boles, being first
duly sworn, on his oath deposes and
says that he is the printer of Messenger-
Index, a legal weekly newspaper pub-
lished at Emmett, in Gem County, Idaho;
that said newspaper is in general circu-
lation in said county and has been pub-
lished uninterruptedly and continuously
for more than 78 weeks prior to the first
publication of the annexed document;
and that the document notice, process,
or advertisement hereunto annexed was
published in the regular edition of

Messenger-Index for _____
consecutive weekly issues thereof, be-

ginning with the issue of July 9,

1970, and ending with the issue of

July 16, 1970
Anita Boles

Subscribed and sworn to before me this

21st day of
July, 1970
Caro Yarmo

Notary Public,
Residing at Emmett, Idaho.



State of Idaho
DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720 - (208) 334-7900

CECIL D. ANDRUS
GOVERNOR
R. KEITH HIGGINSON
DIRECTOR

March 14, 1988

Bonnie Laura Subdivision
c/o Charles ReKow
1029 Lilac Lane
Emmett, ID 83617

Re: Water Right License No. 65-7143

Dear Mr. ReKow:

I understand that you and Mr. Bob Doty spoke to John Beal of this Department concerning the well Mr. Doty completed for you in January, 1988.

License No. 65-7143 shows a point of diversion in the NW $\frac{1}{4}$ SE $\frac{1}{4}$ of Section 1. The well log Mr. Doty submitted shows a new point of diversion in SE $\frac{1}{4}$ SE $\frac{1}{4}$. A transfer must be submitted to the Department if a well is drilled in a different 40 acre tract. The transfer should include all points of diversion.

Sincerely,

GARY SPACKMAN, Supervisor
Water Allocation Section

GS:jf

3/30
Mr. ReKow was in - well is in NW, SE.
JWB

MAILED

JUL 07 1988



State of Idaho

DEPARTMENT OF WATER RESOURCES

STATE OFFICE, 1301 North Orchard Street Boise, Idaho 83706-2237 • (208) 334-4440

CECIL D. ANDRUS
Governor

R. KEITH HIGGINSON
Director

February 18, 1988

Bill Doty Drilling Inc.
Route 7, Box 311
Caldwell, ID 83605

RE: Drilling Permits
Fees

Dear Mr. Doty:

I am returning check No. 1023 in the amount of \$70. Please send me a check or checks for the following amount:

Bonnie Laura Sub.	\$100.00
Emmett Valley Livestock	10.00
Danny Smith	10.00
Edward Lappi	10.00

I assume the well for Emmett Valley Livestock is for single family domestic use. If not, the fee should be \$100.00 and they will need to file a water appropriation application.

The three shallow wells you drilled for Boise Cascade are less than 18 feet deep and will not require drilling permits or fees.

The well log for the Emmett Valley Livestock well shows the NW $\frac{1}{4}$ NE $\frac{1}{4}$ and the drilling permit application shows NE $\frac{1}{4}$ NE $\frac{1}{4}$. Which is correct?

The Bonnie Laura Subdivision well is in the SE $\frac{1}{4}$ SE $\frac{1}{4}$ whereas water right license 65-7143 has a point of diversion of the NW $\frac{1}{4}$ SE $\frac{1}{4}$. Well owners will be contacted and informed that a water right transfer must be submitted.

I have kept the drilling permit applications and well logs. Once I receive the \$130.00 fee, they will be processed and filed.

Sincerely,

JOHN E. BEAL, Manager
Groundwater Protection Section

JEB:ldt(GP8-1.41)

Enclosures

MAILED

JUL 07 1988

State law requires that this report be filed with the Director, Department of Water Resources within 30 days after the completion or abandonment of the well.

Bob Doty

Emmett

Boynice Laura

Bonnie Laura ~~dot~~ Laura

365-2274 Charles Kenbow

1029 Lylest Lane

3/6/67 1978 65-2895
65-7143

65-88-2-06
65-7143
RECEIVED

State of Idaho
Department of Water Resources

FEB 16 1988

DRILLING PERMIT

(Authorizing Construction of a Well)*Department of Water Resources

1. Applicant BONNIE LAURA SUBDIVISION C/O CHARLES REKOW

2. Address 1029 LILAC LANE EMMETT, ID. 83617

() Well Owner () Well Operator () Other, specify _____

3. Water right permit no. NW; Injection well permit no. _____

4. Proposed well location SE 1/4 SE 1/4 1/4, or Gov't lot No. _____,
Sec. 1, Twp. 8N, Rge. 2W, County Mer,
Lot, block and subdivision BONNIE LAURA

5. Proposed use of well: (Check all that apply)

☒ Domestic () Stockwater () Monitoring
() Irrigation () Industrial () Municipal
() Injection ☒ Other, Specify Subdivision

6. Well construction information:

() New well () Deepen ☒ Replace
Proposed surface diameter 16" Proposed depth 120'

Anticipated bottom hole temperature:

☒ 85°F or less (Cold water well)
() 85°F to 212°F (Low temp. geothermal well)
() 212°F or more (Geothermal well)

7. Anticipated construction start date 21 Dec 87

8. Well Driller (if known) BILL DOTY DRILLING CO., INC.

Address ROUTE 7 BOX 311 CALDWELL, ID. 83605

Date _____ Applicant's signature Charles Rekow

Title President

* After other pre-requisite approvals have been obtained.

JUL 07 1988

VERBAL Agreement TO Drill 12-21-87

ACTION OF IDWR

☒ Approved ☐ Denied

65-88-Z-06

The approval of this permit authorizes the construction of a well as described on this application subject to the conditions on this permit.

GENERAL CONDITIONS:

1. The well must be constructed in compliance with the applicable statutes, specific conditions of approval shown on the water right permit, injection well permit, transfer or amendment and the rules and regulations of the Department for water appropriation, injection wells and well construction standards.
2. This drilling permit is valid for two (2) months from its date of issuance for the start of construction and is valid for one (1) year from the date of issuance for completion of the well unless an extension has been granted.
3. The permit holder or his representative shall notify the Department ten (10) days prior to the start of construction unless good cause for later notification can be shown.
4. The well shall be constructed by a driller currently licensed in the State of Idaho who must maintain a copy of the drilling permit at the drilling site.
5. Issuance of this drilling permit does not authorize trespass on the land of another party.
6. This permit does not constitute other local, county, state or federal approvals which may be required for construction of a well.

SPECIFIC CONDITIONS:

7 The old well must be abandoned or capped.

Dated this 1 day of March, 1988.

Signed

Title

MICROFILMED

JUL 07 1988

Received by 12/980 Fee \$100.00 Date 2/24/88

Receipt No. 48471 Construction start date 12/87

Construction start extension to _____

Extension approved by _____

65- 7143

12/21/87

Bob Doty
requested verbal approval
to drill new well under
this well.

Will be in same $\frac{1}{4}$
 $\frac{1}{4}$ - will try to install
liner in old well (inter
date) and use for backup

I gave verbal - instructed
Bob that they must file
it to transfer if two wells
are left open.

J E Beal

INDEXED

JUL 07 1988

WATER RIGHT NUMBER 65-7143

OWNER LAST NAME - BONNIE LAURA SUBDIVISION

FIRST NAME -

1029 LILAC Ln.

ORIG OWNER -

ADDRESS LINE 1 - C/O CHARLES REKON

ADDRESS LINE 2 -

ROUTE 2, BOX 266-6

ADDRESS LINE 3 -

CITY - EMMETT

STATE - ID ZIP CODE - 83617

SOURCE - GROUNDWATER

TRIBUTARY OF -

06-26-1970

STAGE - LICENSE

STATUS -

PRIORITY - 06-02-1970 COUNTY - GFM

TOTAL DIV. RATE -

.75

.8800 - CFS

TOTAL DIV. VOLUME - 30.52.00 AFA

PRER/AMEND -

WATER DIST. - 65

DLE/CARRY ACT -

RIGHT BASIS -

DIVERSION POINT - SESE 01 06N 02W LOT 00 REDIV -

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

0.0

FROM - 01-01 TO - 12-31 USE - DOMESTIC

HSP DIV. RATE -

.75.8800 CFS

USE DIV. VOLUME -

30.0 52.00 AFA

USE - DOMESTIC

PLACE OF USE -

TWN 06N R. 6G 02W SEC 01

TRACT NWSE LOT

AC

DECKEE NAME -

DATE -

TOTAL ACRES

0

X → REMARKS - SOURCES FOR THIS RIGHT ARE TWO WELLS.

THIS PERMIT RIGHT IS NOT DECREEED BY THE PRESENT ADJUDICATION
PROCEDURE, AND IS INCLUDED FOR INFORMATION PURPOSES ONLY.

NORMAL STATUTORY PROCEDURES MUST BE COMPLETED FOR LICENSING.

NON IRRIG USE - 0/25 Homes.

OTHER RIGHTS FOR SAME USE -

PROOF DUE -

PERMIT/DENIED -

PROTESTED -

HEARING -

OLD NO. -

PROOF MADE - P FLD EXAM - COND. OF APPROVAL -

DIVERSION MEANS -

IDENT. NO. 65-7143

WATER RIGHT
DATA ENTRY LOG

[illegible]

June 16, 1981

Bonnie Laura Subdivision
% Charles L. Rekow, Pres.
1029 Lilac Lane
Emmett, ID 83617

Dear Mr. Rekow,

RE: Permit No. 65-7143

Enclosed is a copy of the Water Right License issued on the above referenced Permit. Also enclosed is a copy of your approved Application for Amendment, along with Receipt No. 18578 in the amount of \$20.00.

Sincerely,

JIM JOHNSON
Water Distribution Supervisor

Enclosure

MICROFILMED

JUL 07 1988

INTER-DEPARTMENT MEMO — 1

FROM DAVE Tutill

DATE 6/4/81

TO 65-7143

SUBJECT

In 1978 I conducted a field examination on the Charles Retow property in conjunction with the Payette River Adjudication.

At that time I became familiar with the Bonnie Laura Subdivision well. The well provides water that is used not only for in-house use but also for lawn watering use.

MICROFILMED

JUL 07 1988

DRT

SIGNATURE



State of Idaho
DEPARTMENT OF WATER RESOURCES
STATE OFFICE, 450 W. State Street, Boise, Idaho

JOHN V. EVANS
Governor

A. KENNETH DUNN
XXXXXXXXXX
Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 334-4440

April 20, 1981

Bonnie Laura Subdivision
% Charles L. Rekow, Pres.
1029 Lilac Lane
Emmett, Idaho 83617

Dear Mr. Rekow,

A representative of this Department made an examination of the works covered by your Permit No. 65-7143 on April 8, 1981, and has found the following:

Amount of water that can be recognized as beneficially used under Idaho law: .23 cfs Source: groundwater

The maximum quantity diverted shall not exceed 30 acre feet per year.

Point of diversion: NW $\frac{1}{4}$ SE $\frac{1}{4}$, Sec. 1, Twp. 6N, Rge. 2W, B.M.

Beneficial use: Domestic use for 25 units within the NW $\frac{1}{4}$ SE $\frac{1}{4}$, Sec. 1, Twp. 6N, Rge. 2W.

Priority date established: June 26, 1970 (late proof)

In order for the Department to issue the above license, it will be necessary for you to amend the permit to correspond with the findings of the field examiner. We are enclosing a partially completed amendment form for your use in this matter.

Please sign the amendment application and return it to this office along with a \$20.00 filing fee within 30 days in order that we might issue your license as set forth above. If you do not concur with these findings or have any questions, please contact us within the 30-day period.

Sincerely,

JAN GROVER
JIM JOHNSON
Water Rights Supervisor

JG:j
Enclosure

RECEIVED

JUL 07 1988

State of Idaho
DEPARTMENT OF WATER RESOURCES
FIELD REPORT

65-7143

Permit No.

CONTACT WITH PERMIT HOLDER

	DATE	INITIALS	REMARKS
☒ Appointment letter mailed:	10/28/80	h/h	no appt. made
☐ Telephone call made: (List Telephone No. used)			
☐ Appointment scheduled for: (Date, time, location)	4/8/81	JKV	appt. 9 AM

EXAMINATION

Date 4/8/81 Accompanied by James Bekow Total Q measured 75
If source is surface water, estimate total flow of source Capacity
Methods of measurement anemometer Meets Permit requirements?

Measurement calculations:
 6" steel pipeline - measurement $5.6 \times 335 \text{ GPM} \times .002278 = .75$
 $V = 25 \times 1.2 \text{ AF} = 30 \text{ AF}$ * Allow .23 AS per domestic Table 655
 $.23 \times 1.9835 \times 365 = 16.5$
 $V = 25 \text{ units} \times 1.2 = 30.0$ ✓

WELL/DIVERSION* NO.	HP	MOTOR MAKE	MOTOR SERIAL NO.	PUMP MAKE	PUMP SERIAL NO.	MEASURING DEVICE TYPE	CONDITION OF MEAS. DEV.	REMARKS
8	25					Probe #	meter #	
						191134	45806	

System Description 8" casing - 115' deep - 2500 gal storage tank - signed to 25 homes. 1 8" well also can be used as a back up well. another (25 HP motor)

**Code with map on reverse side. Disregard code if only one.*

$$\frac{25 \text{ HP} (.8) (8.8) / 15' + 30 (2.3)}{184} = \frac{176}{184} = .95 \text{ cfs}$$

RECOMMENDED AMOUNTS

USE	Q (cfs)	V (afa)	FROM	TO
Domestic	~~.75~~ [*] .23 ✓	~~30~~ ✓	1/1	12/31
Total	~~.75~~ [*] .23 ✓	~~30~~ ✓	1/1	12/31

Remarks Bonnie Laura Subdivision **MICROFILMED**

MICROFILMED

~~JUL 07 1988~~

* Note! .75 cfs is the amount put on the license instead of .23 cfs because the criteria used to determine domestic use presently was not in effect when permit was used. Also water may be used for lawns which current domestic table used join 5/28/81 does not include.

See my memo dated 6/4/81 DKT

[illegible]

(Include distance from pump to measuring device, if applicable.)

Point(s) of diversion: NW SE Sec 1 T6N R2W

Place(s) of Use

[illegible]

Recommended Amendments:

- ☒ Change P.D. as reflected above
☐ Change P.U. as reflected above

- ☐ Add P.D. as reflected above
- ☐ Add P.U. as reflected above

- ☐ None
- ☐ Other

JUL 07 1988

Examiner's Signature

*Checked by

Approved by

Date

ate

Date _____



State of Idaho
DEPARTMENT OF WATER RESOURCES
WESTERN REGION, 92 South Cole Road, Boise, Idaho 83709

JOHN V. EVANS
Governor

(Office at the corner of
Franklin and Cole Roads)

C. STEPHEN ALLRED
Director

(208) 384-2190

October 28, 1980

Bonnie Laura Subdivision
c/o Charles L. Rekow
1029 Lilac Lane
Emmett, Idaho 83617

RE: Permit No. 65-7143

Dear Mr. Rekow:

We acknowledge receipt of your statement submitted as proof of beneficial use for the above referenced permit.

Before a license can be issued, a field examination must be made by a representative of this Department.

☐ A field examination of your system has been scheduled for

_____.
If this time and date is not convenient for you, please contact this office as soon as possible.

☐ A field examiner will contact you to arrange to examine your system.

If you have any questions regarding the field examination, please contact this office.

Sincerely,

Kay Walker
Secretary

DEPARTMENT OF WATER RESOURCES

The Idaho Department of Water Resources will consider this card as a statement that the permit holder(s) has completed development to the extent shown below of Permit No. 65-7143

Name(s) of Permit Holder: Bonne Terra Sub Charles Hekow

Post Office Address: 1029 Lilac Lane Emmet, Idaho 83617

Installed 14 Nipple As. Instructed Tel. No. 365-2274

Source of Water.

Extent of Use:

☒ Domestic

25

(number of households)

☐ Stockwater

(number and type of stock)

☐ Irrigation

(acres)

☐ Other

Measuring Device: Required?

☒ Yes ☐ No

Installed? ☒ Yes ☐ No

Access Port. Required?

☒ Yes ☐ No

Installed? ☒ Yes ☐ No

The above information is a true statement of the extent to which the above numbered permit has been developed.

06/1980
Date

Charles Hekow
Signature of Permit Holder

Bonnie Laura Sub
Charles F. Kew
1029 Lilac Lane
Boise, Idaho 83617

Department of Water Resources

OCT 6 1980


RECEIVED



IDAHO DEPARTMENT OF WATER RESOURCES
STATEHOUSE
BOISE, IDAHO 83720



STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Statehouse
Idaho 83720

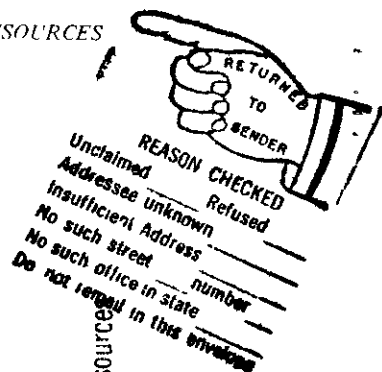



RECEIVED

SEP 2 1980

Department of Water Resources

Bonnie Laura Subdivision
c/o Charles L. Rekow, Pres.
Rt. 2, Box 266-6
Emmett, ID 83617

1029 Silver Lane
Emmett 83617

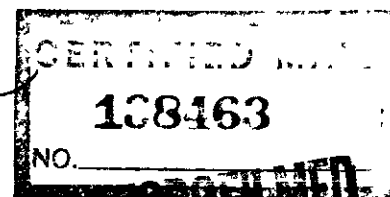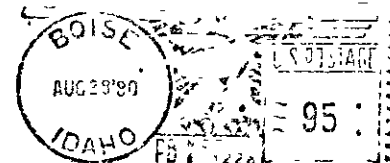

NO. 108463

138463

August 31, 1980

Bonnie Laura Subdivison
c/o Charles L. Rekow, Pres.
Rt. 2, Box 286-6
Emmett, ID 83617

Gentlemen:

One of the conditions of approval of your water permit No. 65-7143 was that evidence of the extent of development must be submitted to this office on or before November 1, 1980. (See last page of your permit). Enclosed is a post card which may be used to submit the required proof of beneficial use.

If you have not fully completed your project, and you have not previously received an extension of time, you may request an extension of time provided the delay is for reasonable cause as indicated in Section 42-204, Idaho Code, amended. If you have been prevented from proceeding by a governmental agency or by litigation, more than one extension of time can be granted. A request for extension of time form is enclosed for your convenience. Please note that a fee of \$15.00 must be submitted with this form.

Either the beneficial use post card or a request for an extension of time must be received by this department on or before the above mentioned date, otherwise the permit will lapse and be of no further force or effect within sixty days.

Sincerely,

RITA FLECK
Sr. Secretary

Enclosures

MICROFILMED



State of Idaho
DEPARTMENT OF WATER RESOURCES
STATE OFFICE, 450 W. State Street, Boise, Idaho

JOHN V. EVANS
Governor

C. STEPHEN ALLRED
Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 334-4440

May 16, 1980

Dear Wateruser:

The enclosed Order changes the measuring device condition of approval on your water right permit.

The changed condition is less restrictive and provides you the option to install an access port or have your system measured and certified by a professional engineer. Instructions for access port installation are also enclosed.

If you have questions regarding this matter, please contact the Regional Office nearest to you.

Sincerely,

David R. Tutthill Jr.

DAVID R. TUTHILL JR., P.E.
Supervisor, Water Allocations Section

DRT:jg

Enclosures

Northern Region Office
Rt. #5 Box 203, Government Way
Coeur d'Alene, Idaho 83814

Eastern Region Office
1515 Lincoln Road
Idaho Falls, Idaho 83401

Southern Region Office
1041 Blue Lake Boulevard North
Twin Falls, Idaho 83301

Western Region Office
92 South Cole Road
Boise, Idaho 83705

MICROFILMED

November 5, 1975

Re: Permit No. 65-7143

Bonnie Laura Subdivision
Route 2, Box 266-6
Emmett, Idaho 83617

Gentlemen:

Enclosed is a copy of the assignment assignment the above referenced permit to you. The assignment has been recorded and the Department's records have been changed.

Also enclosed is a copy of the approved application for amendment and a copy of the approved application for extension of time. The time within which to submit proof of beneficial use of water has been extended to November 1, 1980. The permit has also been reinstated and the priority has been advanced to June 26, 1970.

Sincerely,

D. Darlene Reich
Water Rights Supervisor

DDR:JFR

Enclosures

October 30, 1975

Re: Permit No. 65-7143

Frank D. Callender
Cascade,
Idaho 83611

Dear Mr. Callender:

Pursuant to our telephone conversation yesterday, enclosed is an assignment of permit form.

If you have any further questions concerning this matter, please contact us.

Sincerely,

D. DARLENE REICH
Water Rights Supervisor

DDR:rb

Enc.

RECEIVED
OCT 31 1975
WATER RIGHTS DIVISION

PS Form 3811, Nov. 1973

RETURN RECEIPT, REGISTERED, INSURED AND CERTIFIED MAIL

- SENDER. Complete items 1 and 2.
Add your address in the "RETURN TO" space on reverse.

1. The following service is requested (check one).

- ☐ Show to whom and date delivered..... 15¢
☐ Show to whom, date, & address of delivery.. 35¢
☐ DELIVER ONLY TO ADDRESSEE and
show to whom and date delivered..... 65¢
☐ DELIVER ONLY TO ADDRESSEE and
show to whom, date, and address of
delivery 85¢

2. ARTICLE ADDRESSED TO

3 ARTICLE DESCRIPTION:

REGISTERED NO. CERTIFIED NO. INSURED NO.

37219

(Always obtain signature of addressee or agent)

I have received the article described above.
SIGNATURE4. Frank J. [Signature]
DATE OF DELIVERY
SEP 4 1975

5. ADDRESS (Complete only if requested)

6. UNABLE TO DELIVER BECAUSE:

UNITED STATES POSTAL SERVICE
OFFICIAL BUSINESS

SENDER INSTRUCTIONS

Print your name, address, and ZIP Code in the space below.

- Complete items 1 and 2 on reverse side.
- Moistened gummed ends and attach to back of article

PENALTY FOR PRIVATE
USE TO AVOID PAYMENT
OF POSTAGE, \$300



**RETURN
TO**

DEPARTMENT OF WATER RESOURCES
STATE HOUSE
BOISE, IDAHO 83720

September 2, 1975

CERTIFIED MAIL

27219

Re: Permit No. 65-7143

Frank D. Callender
Cascade,
Idaho 83611

Dear Mr. Callender:

One of the conditions of approval of your water Permit No. 65-7143 (see last page of your approved permit) was that evidence of the extent of development be submitted as proof of application of water to beneficial use to this office on or before November 1, 1975. Enclosed is an affidavit form which must be used to submit the required proof of beneficial use.

If you have not fully completed your project, and you have not previously received an extension of time, you may request an extension of time provided the delay is for reasonable cause as indicated in Section 42-204, Idaho Code, amended. If you have been prevented from proceeding by a governmental agency or by litigation, more than one extension of time can be granted.

Either the beneficial use affidavit or a request for an extension of time must be received by this Department on or before the above mentioned date, otherwise the permit will lapse and be of no further force or effect.



R. KEITH HIGGINSON
Director

RKH:jg
Enc: Proof affidavit

RECEIVED
SEP 11 1975
IDH

November 17, 1970

Re: Permit No. 65-7143

Mr. Frank D. Callender
Cascade,
Idaho 83611

Dear Mr. Callender:

Enclosed is a copy of your approved Application for Permit No. 65-7143. We direct your attention to the conditions of approval as listed on the fourth page.

Be sure to note that a special condition requiring you to install and maintain a measuring device at your point of diversion has been placed upon your permit. We are enclosing a letter describing different types of measuring devices accepted by this office.

Very truly yours,

C. Stephen Allred
Deputy Director

CSA:kh

Enclosures: Copy of permit
2 informational letters
Receipt No. 4808 for \$20

65 7143

July 1, 1970

Re: Application for Permit No. 65-7143 - Frank D. Callender

The Emmett Messenger-Index
120 North Washington Avenue
Emmett, Idaho 83617

Gentlemen:

Enclosed you will find a legal notice which we wish to have published once a week for two consecutive weekly issues of your newspaper. We have inserted the publication dates allowing ample time for you to submit us a galley proof for review before publication.

After sending us a galley proof, proceed with the publication on the dates we have inserted assuming the notice is correct. If we have any corrections, we will notify you before the first publication date. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department of Reclamation along with the publication bill. In order to receive payment, the following certification must appear on the bill:

I hereby certify that the foregoing account is just and correct, that the amount claimed is legally due, after allowing all just credits, and that no part of the same has been paid.

(Signature of the claimant)

Very truly yours,

Donald W. McEldowney
Appropriation Supervisor

DWM:kh
Enclosure

65 7143

*Bill submitted
7-22-70
dr*

NOTICE OF APPLICATION FOR PERMIT
TO APPROPRIATE THE PUBLIC WATERS OF THE STATE OF IDAHO

Notice is hereby given that Frank D. Callender, Cascade, Idaho,

has on June 22, 1970,

submitted Application No. 65-7143 to appropriate the public waters of
a ground water source.

~~XXXXXXXXXXXX~~

The application proposes a maximum diversion and appropriation of 0.88
cubic feet per second ~~XXXXXX~~ of water to be diverted by a well and pump
within the SE $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 1.

T. 6 N., R. 2 W., B.M., Gem County

and is to be used within the NW $\frac{1}{4}$ SW $\frac{1}{4}$ Sec. 6, T. 6 N., R. 1 W., B.M. and NE $\frac{1}{4}$ SE $\frac{1}{4}$,
SE $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 1, T. 6 N., R. 2 W., B.M., for the domestic use of 44 families from Jan. 1
to Dec. 31.

Any permit issued pursuant to this application will be subject to ALL PRIOR
WATER RIGHTS and subject to the CONTROL OF A STATE WATERMASTER. Any protest
against this application must be filed with the Idaho Department of ~~XXXXXXXXXX~~ **Water Administration**
or before July 27, 1970.

R. KEITH HIGGINSON

Director

~~XXXXXXXXXXXXXXXXXXXX~~

Published in the The Emmett Messenger-Index, Emmett, Idaho

on July 9th and July 16th, 1970.

65 7143

June 2, 1970

C
O
P
Y
Re: Application for Permit - Frank D. Callender

Mr. Ernest L. Beckman
4821 Wedge St.
Boise, Idaho 83704

Dear Mr. Beckman:

We are returning the application for permit and filing fee you submitted in behalf of Mr. Callender. Before we can process this application, we will require additional information as follows:

- Item 4: Enter the amount of water to be appropriated, preferably in cubic feet per second. Please be advised that the maximum the Department can allow is 0.02 c.f.s. per single family dwelling.
- Item 5: Enter the total amount of water to be appropriated. For 44 families we would recommend 0.88 c.f.s.; the filing fee for this amount would be \$20.00.
- Item 9b: List the owner of the land at the place of use.
- Item 11: Complete a map of the proposed project.

Page 2
Mr. Ernest L. Beckman
June 2, 1970

Also, if you are going to sign the application for Mr. Callender, we will require that Mr. Callender complete the enclosed Power of Attorney form giving you the authorization to sign the application for him.

If we may be of any assistance in this matter, please do not hesitate to contact us.

Very truly yours,

Dorian T. Clay
Appropriation Examiner

DTC:DR

Enc: Application w/check
Power of Attorney form

C
O
P
Y

DEPARTMENT OF WATER ADMINISTRATION

STAFF ANALYSIS

Application No.	65-7143	Name	Frank D. Callender
Source	~~stond~~ ground water		
Point of Diversion	SE ¹ / ₄ SE ¹ / ₄ Sec. 1, T. 6N, R. 2W, B.M., Gem		
Quantity	0.88	Use	domestic
		Period	Jan. 1 - Dec. 31
Quantity		Use	
		Period	
Quantity		Use	
		Period	
Well Size	8	Diameter	8
		Proposed Depth	160
Use	44 families		
Date Forwarded	7-6-70	Date Returned	7-13-70
		Received by	<i>[Signature]</i>

COMMENTS: WATER TABLE IS STABLE IN THE AREA
(W.B. # 11). MANY SMALL DOMESTIC WELLS IN
the area. SHALLOW (20-30 ft) with water
table at 5-10 ft below land surface. Drawdowns
10-15 ft. Sediment aquifers.

RECOMMENDED:

Applied: Qty.	0.88	Use	domestic	Period	1-1 to 12-31	AF/A	—	AF	690
Qty.		Use		Period		AF/A		AF	
Qty.		Use		Period		AF/A		AF	
Maximum: Qty.	0.88	Use	domestic	Period	1-1 to 12-31	AF/A	—	AF	690
Qty.		Use		Period		AF/A		AF	
Qty.		Use		Period		AF/A		AF	

ACTION: Approved X Denied

Conditions of approval or reason for denial: Well spacing of
500 ft should be made to avoid well
interference or upper water should be cased
out of the deeper new well.

INVESTIGATION By Norman C Young Title WRI II
 Date July 10, 1970

65 7143