

Permit No: 75-7052

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
MAY 05 2005
Page 1
DEPARTMENT OF
WATER RESOURCES

A. GENERAL INFORMATION

Permit No: 75-7052

Exam Date: 9/27/1995

1. Current Owner: WILLIAMS LAKE RECREATIONAL WATER & SEWER DIST
PO BOX 82
SALMON ID 83467
(208)756-6124

2. Accompanied by:

Phone No:

Address:

Relationship to Permit Holder:

3. **SOURCE**

TRIBUTARY

WILLIAMS LAKE

B. OVERLAP REVIEW

1. Other water rights with the same place of use:
2. Other water rights with the same point of diversion:

C. DIVERSION AND DELIVERY SYSTEM

1. LOCATION OF POINT(S) OF DIVERSION:

WILLIAMS LAKE
LEMHI County

SE NW SW (L-2)

Sec. 34, Twp 20N, Rge 21E, B.M.

Method of Determination:

ON SITE USGS MAP

2.

PLACE OF USE: DOMESTIC

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
19N	21E	3			X	X													
20N	21E	34								X									

See attached Exam for
POU

Method of Determination:

3. ☒ Delivery System Diagram Attached (required). Indicate all major components and distances between components. Indicate weir size/pipe as applicable.
- ☒ Map Attached Showing Location(s) of point(s) of diversion and place(s) of use (required). Scale must be 1:24,000 or greater.
- ☐ Aerial Photo Attached (required for irrigation of 10+ acres).
- ☐ Photo of Diversion and System Attached

4.

<u>Well or Diversion ID No.*</u>	<u>Motor Make</u>	<u>Hp</u>	<u>Motor Serial No.</u>	<u>Pump Make</u>	<u>Pump Serial No. or Discharge Size</u>
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

<u>Measurement Equipment</u>	<u>Type</u>	<u>Make</u>	<u>Model No.</u>	<u>Serial No.</u>	<u>Size</u>	<u>Calib. Date</u>
_____	_____	_____	_____	_____	_____	_____
_____	_____	_____	_____	_____	_____	_____

2. Measurements:

E. FLOW CALCULATIONS

_____ Additional Computation Sheets Attached

Measured Method:

2 (5hp) Pumps in Parallel 70% eff 90 psi

$$Q = \frac{(10hp)(8.814)eff}{(90 \times 2.308)} = 0.297 cfs - 0.30 cfs$$

F. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation season}) \times 1.9835 =$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$$

2. Volume Calculations for Other Uses:

$$V_{OL} = 0.30 \times 1.9835 \times 365 = 217 \text{ ata}$$

G. NARRATIVE/REMARKS/COMMENTS

Have conditions of permit approval been met? ☒ Yes ☐ No

H. RECOMMENDATIONS

1. Recommended Amounts

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	1/01 to 12/31	0.500 CFS 0.30	
<u>Totals:</u>		0.500 CFS 0.30	

2. Recommended Amendments

☒ Change P.D. as reflected above ☐ Add P.D. as reflected above ☐ None

☒ Change P.U. as reflected above ☐ Add P.U. as reflected above ☒ Other

change nature of use

I. AUTHENTICATION

Field Examiner's Name *Kent C. Miller* Date *4/12/2005*

Reviewer _____ Date _____

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED

MAY 05 2005

DEPARTMENT OF
WATER RESOURCES

A. GENERAL INFORMATION

Permit No. 75-07052

1. Owner: WILLIAMS LAKE RECREATIONAL WATER & SEWER DIST. Phone No. 376-3369

Current Address: P.O. BOX 82, SALMON, IDAHO 83467

2. Accompanied by: HAROLD G. SISCO EXAM DATE: 9/27/95

Address: SAME AS ABOVE Phone No. (208) 756-3460

Relationship to Permit Holder: CHAIRMAN OF WATER DISTRICT

3. Source: WILLIAMS LAKE tributary to SALMON RIVER

B. OVERLAP REVIEW

1. Other water rights with the same place of use: 75-07589, 75-07590

2. Other water rights with the same point of diversion: DONE

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:


Ident No.	Gov't Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
	2	SE	NW	SW	34	20N	21E	LEMMI	U.S.G.S. TOPO MAP

2. Place(s) of Use: Used within the Boundary of Williams Lake Recreational Water & Sewer District
Indicate Method of Determination ON SITE INSPECTION

TWP	RGE	SEC	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
20N	21E	34							D	D	D	D	D	D					
19N	21E	3					D	D		D									
19N	21E	3		X			X	X											
				L-2			L-3	L-4											
20N	21E	33																X	
																		L-4	
20N	21E	34							X	X	X	X	X	X			X		
									L-1		L-2	L-2	L-4	L-3					

75-7052

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

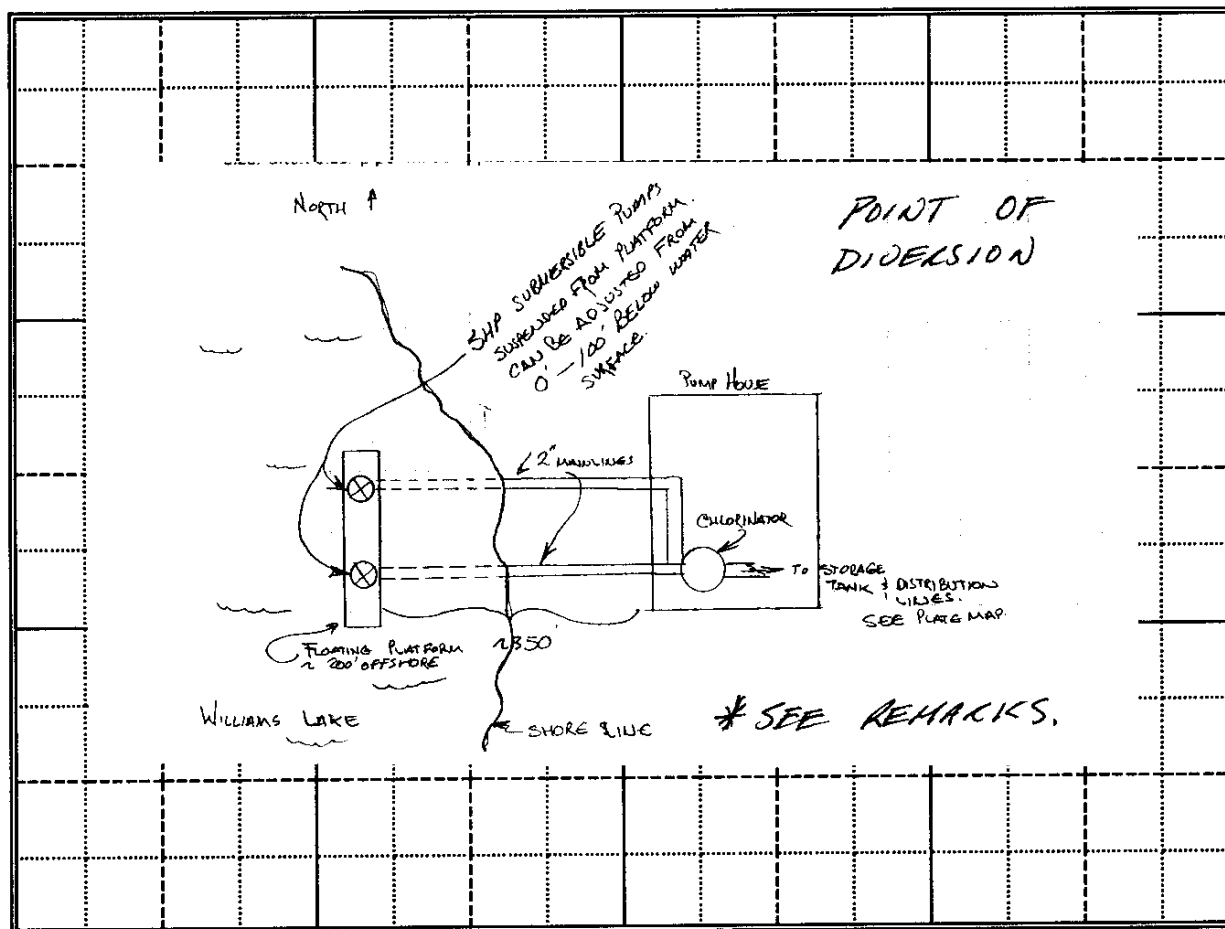

Scale: 1" = _____

____ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

____ Aerial Photo Attached (required for irrigation of 10+ acres)

____ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
#1	FRANKLIN	5	SUBMERSIBLE	MEYERS	2"
#2	FRANKLIN	5	SUBMERSIBLE	MEYERS	2"

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: NO MEASUREMENTS TAKEN DUE TO SYSTEM DESIGN
USE THEORETICAL Pump Calculations $Q = 0.30 \text{ cfs}$

75-7052

E. NARRATIVE/REMARKS/COMMENTS


TWO SHP SUBMERSIBLE PUMPS ARE SUSPENDED 60' DOWN INTO WILLIAMS LAKE FROM A STATIONARY FLOATING PLATFORM APPROXIMATELY 200' FROM SHORE. WATER IS PUMPED TO SHORE TO A BUILDING WHERE WATER IS CHLORINATED. WATER THEN TRAVELS VIA A 4" LINE TO A ^{9,400}~~10,000~~ GALLON STORAGE TANK LOCATED APPROXIMATELY 250' UP SLOPE AND 3/4 MILE AWAY; BOOSTER PUMPS LIFT WATER UP TO STORAGE TANK. WATER THEN GRAVITY FEEDS ~~MOST OF~~ MULTIPLE DOMESTIC SYSTEM. 4" MAIN LINES DISTRIBUTE WATER AT APPROXIMATELY 150 PSI TO HOMES.

58 HOMES ARE CURRENTLY ON THE SYSTEM, MOST ARE SUMMER USE ONLY.

PRESSURE MEASURED @ 90 PSI

#3 CONT.

LAYOUT INSIDE CHLORINATOR BUILDING.

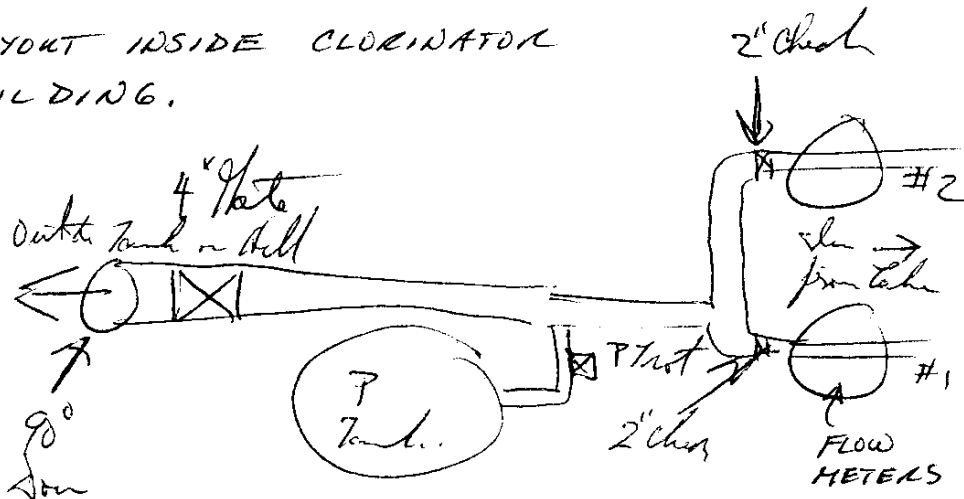

#1 FLOWMETER (ROCKWELL 36,954,580 GALLONS #2 HERSEY 3,110,840 GALLONS

Have conditions of permit approval been met? ☒ yes ☐ no

75-7052

F. FLOW CALCULATIONS

✓ Additional Computation Sheets Attached

Measured Method:

Q FROM DOMESTIC USE CHART = 0.37 cfs FOR 66 HOMES

$$Q_{THEORETICAL} = \frac{(10 \text{ hp})(8.814)(.70)}{(90 \times 2.308)} = 0.297 \text{ cfs} = 0.30 \text{ cfs}$$

NOTE: 2 1/2 hp pumps

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

 $V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = \underline{\hspace{2cm}}$
 $V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = \underline{\hspace{2cm}}$
 $V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = \underline{\hspace{2cm}}$

2. Volume Calculations for Other Uses:

~~1.2 AFA x 66 = 79.2 AFA~~

$$0.30 \times 1.9835 \times 365 = 217 \text{ afa}$$

Since majority of homes are summer homes use irrigation period of 214 days annual use.

$$0.30 \times 1.9835 \times 214 = 127.3 \text{ afa}$$

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
DOMESTIC	1/1	12/31	0.37	79.2
Municipal	1/1	12/31	0.30	217.0 afa 127.3
Totals:			0.37 cfs 0.30 cfs	79.2 AFA 217.0 afa 127.3 afa

2. Recommended Amendments

☒ Change P.D. as reflected above

☐ Add P.D. as reflected above

☐ None

☒ Change P.U. as reflected above

☒ Add P.U. as reflected above

☒ Other

Change nature of use
Name change

I. AUTHENTICATION

Field Examiner's Name

KEITH C WILSON

Date

4/12/2005

DON SIMPKINS

12/12/96

Reviewer

Date

SEAL

75-7052

MEMORANDUM

Date: April 15, 2005
To: Water Right File 75-7052
From: kwilson
Re: Field Report Narrative

09/27/1995 Exam:

Two 5 hp submersible pumps are suspended 60 ft down into Williams Lake from a stationary floating platform approximately 200 ft from shore. Water is pumped to shore to a building where water is chlorinated. Water then travels via a 4-inch line to a 9400-gallon storage tank located approximately 250 ft up slope and 3/4 miles away; Booster pumps lift water up to storage tank. Water then gravity feeds multiple domestic system. 4-inch mainlines distribute water at approximately 150 psi to homes. Fifty-eight (58) homes are currently on the system, most are summer use only.
#1 Flow meter (Rockwell 36,954,580 gallons), #2 Flow meter (Hersey 3,110,840 gallons)

04/15/2005 Research:

Document A includes a cover letter dated August 25, 1994, from Milton A. Slavin, and a signed Voluntary Consent Order prepared by Department of Health and Welfare, Division of Environmental Quality, in which the district name is indicated as being the Williams Lake Recreational Water & Sewer District.

Williams Lake Recreational Water and Sewer District established as a recreational water and sewer district by decree dated April 19, 1994, by Judge James C. Herndon. (See Document B)

Milton A. Slavin, Slavin Law Office, Chartered, 116 N Center Street, Salmon, ID 83467 [(208)756-2030] is currently the attorney for Williams Lake Recreational Water and Sewer District. Mr. Slavin informed this examiner that the order (Document B) is sufficient documentation that authorizes changing the name of the district to the Williams Lake Recreational Water and Sewer District.

According to Richard Borst, district president, and Milton Slavin, attorney, the Williams Lake Recreational Water and Sewer District is NOT associated with Williams Lake Property Owners Association.

Williams Lake Recreational Water and Sewer District qualifies as a municipal provider and has requested that the nature of use under the right be changed from domestic to municipal.

Planning study conducted by Forsgren Associates Inc. lists the recorded pressure of 90 psi at the junction where the water from Williams Lake enters the system.

The 9400-gallon storage tank located within the SENW Sec 3, T19N, R21E, and is on the BLM. Williams Lake Recreational Water and Sewer District has a permit from BLM for the Storage tank.

For information purposes, as of 12/02/2004, there are 66 homes serviced by the Williams Lake Recreational Water and Sewer District.

Since a majority of the homes serviced by the Williams Lake Recreational Water and Sewer District are summer residents recommend that the volume calculation, for municipal use, use 214 days (i.e. irrigation season).

75-7052

THEORETICAL PUMP FLOW CALCULATIONS

$$Q_{cfs} = [(Hp) (8.814) (Eff.)] \div [Lift + (psi \times 2.308)]$$

Hp = Horsepower = 5 (2 Pumps)

Eff. = Efficiency = 70% (Usually 70.0%)

Lift = Static Water Level + Draw down

Static Water Level = _____ ft.

Assumed Draw down = _____ ft.

Lift = _____ ft.

OR

Measured Dynamic Water Level = _____ ft.

Psi = Operating Pressure = 90* psi

$$Q_{cfs} = [\frac{10}{HP} \times 8.814 \times \frac{0.70}{EFF}] \div [\frac{\text{LIFT}}{\text{LIFT}} + (\frac{90}{PSI} \times 2.308)]$$


$$= [88.8] \div [207.7] = 0.297$$

$$Q_{cfs} = \underline{0.30} \text{ cfs}$$


* FROM PLANNING STUDY BY FORSGREN ASSOCIATES INC. IN August
2004

75-7052

Permit Number

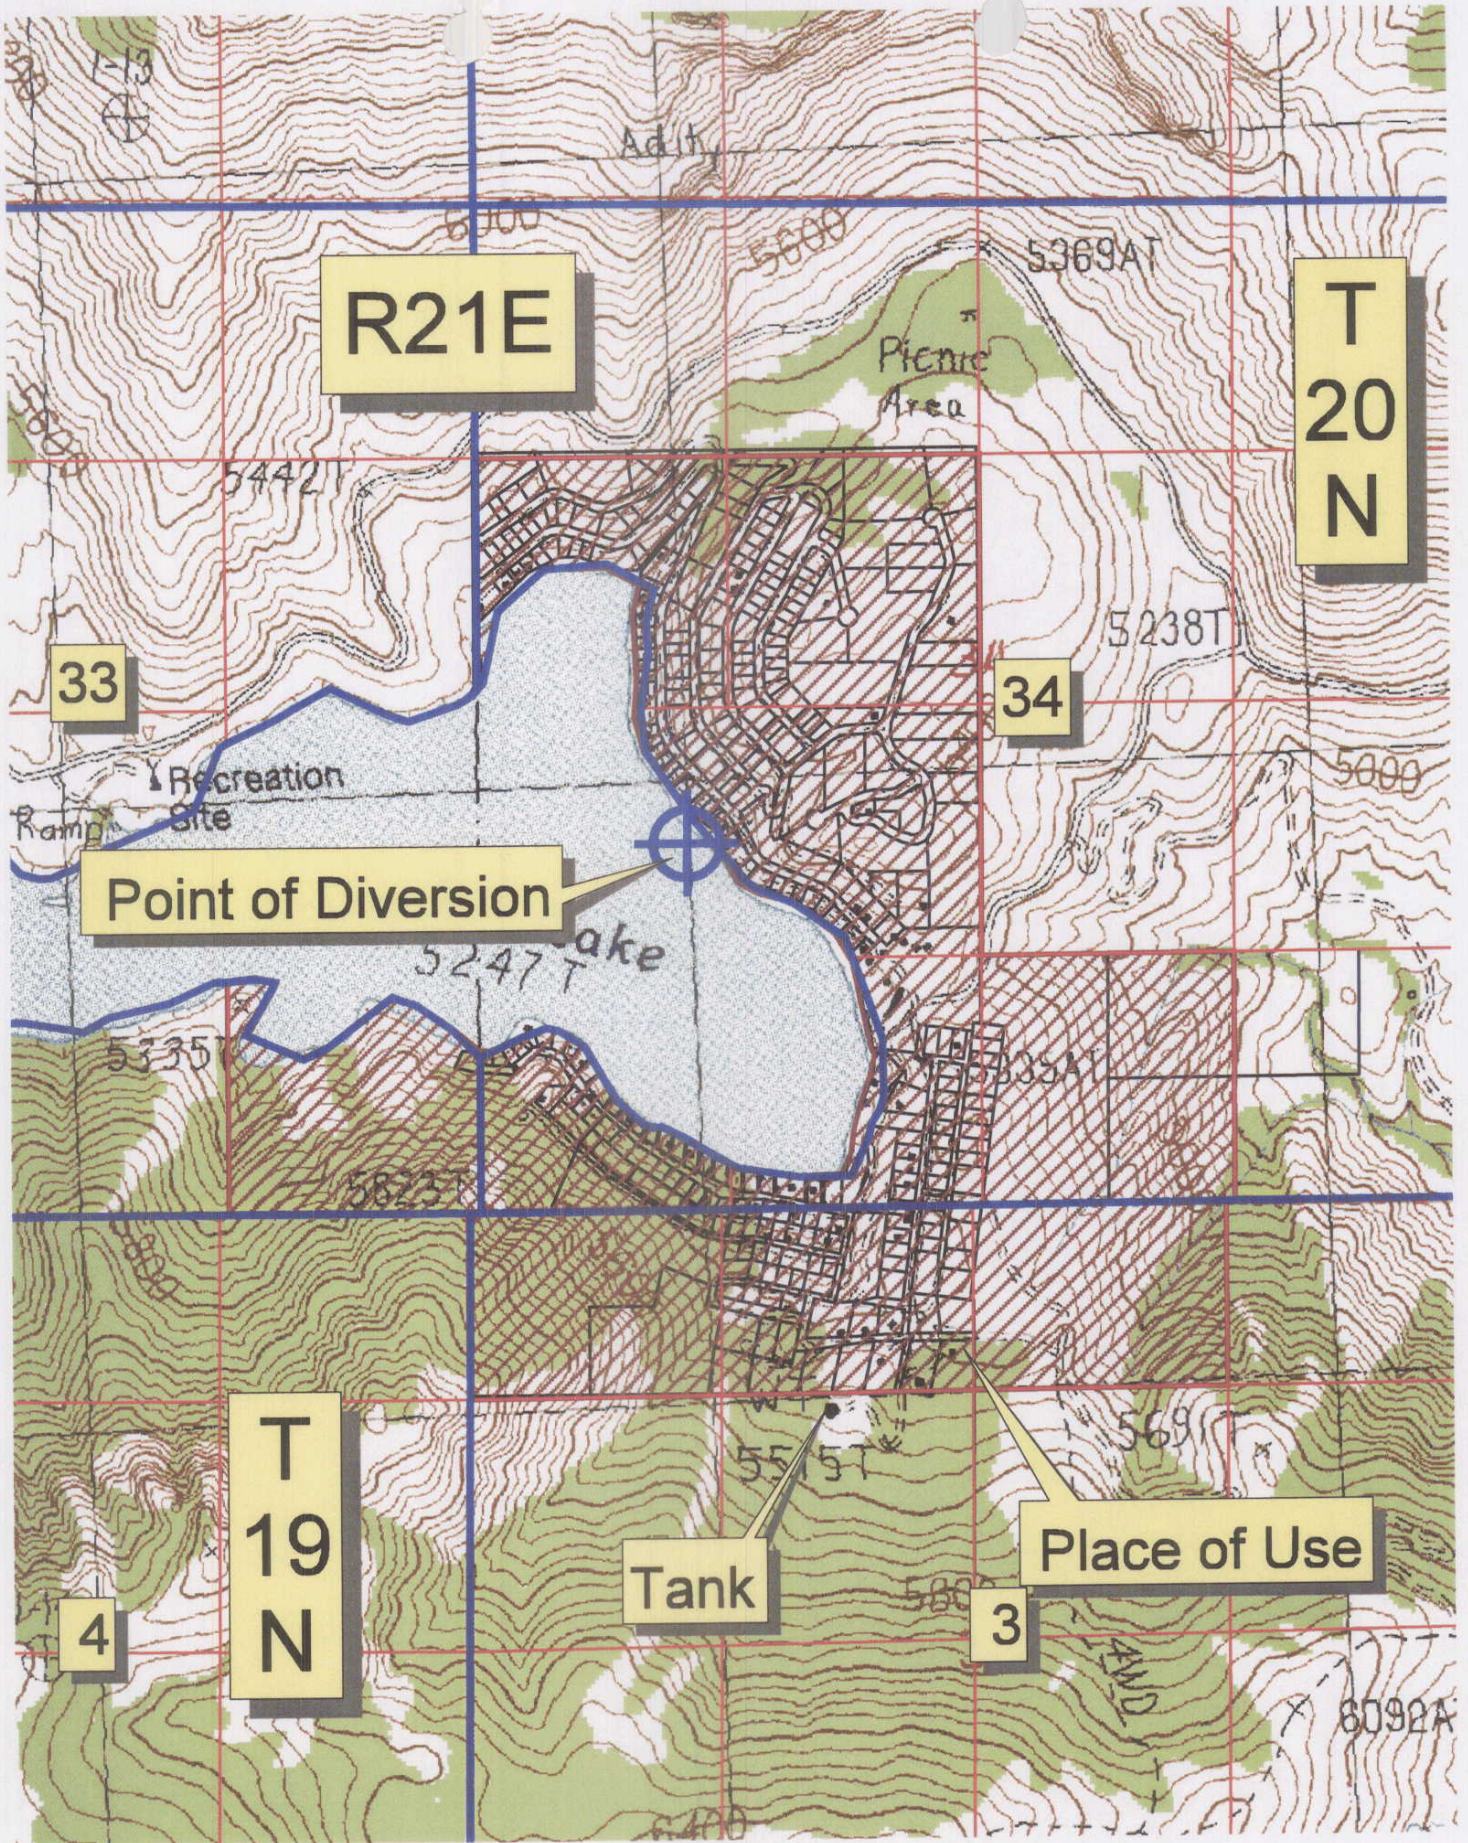

75-7052

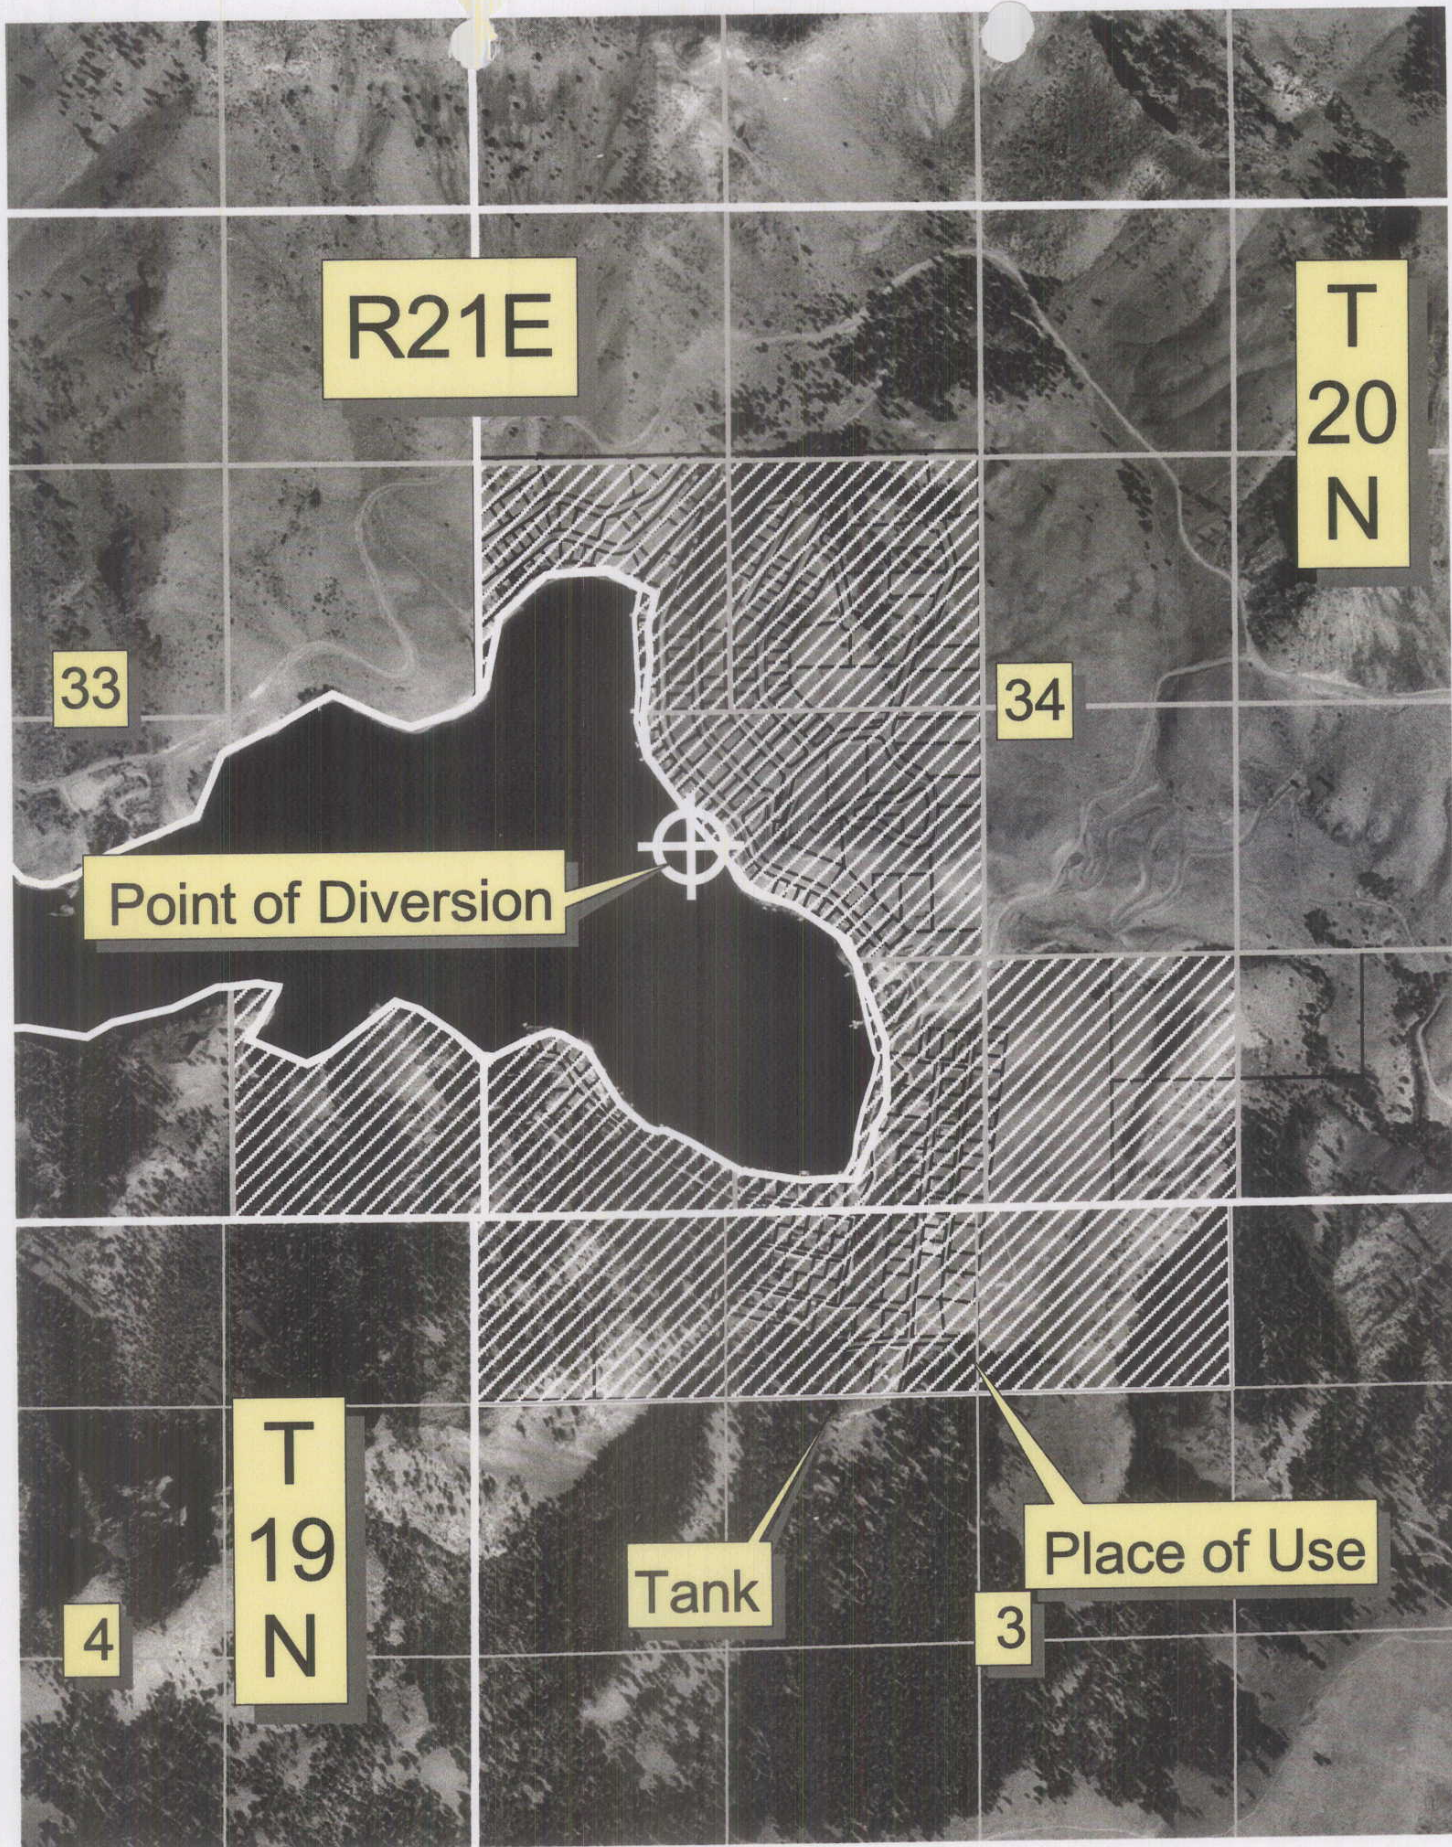

75-7052

T20N, R21E

END →

← END

BURIED
PIPELINES

← END

CLORINE
BUILDING

← BOOSTER PUMP

IN LAKE
POINT OF
DIVERSION

← END

END ↓

PUMP
HOUSE

END →

ENDS

33 34

4 3


BURIED ↑
PIPELINES

END ↑

STORAGE ↑
TANK
10,000 GALS.

↑
N

75-07052

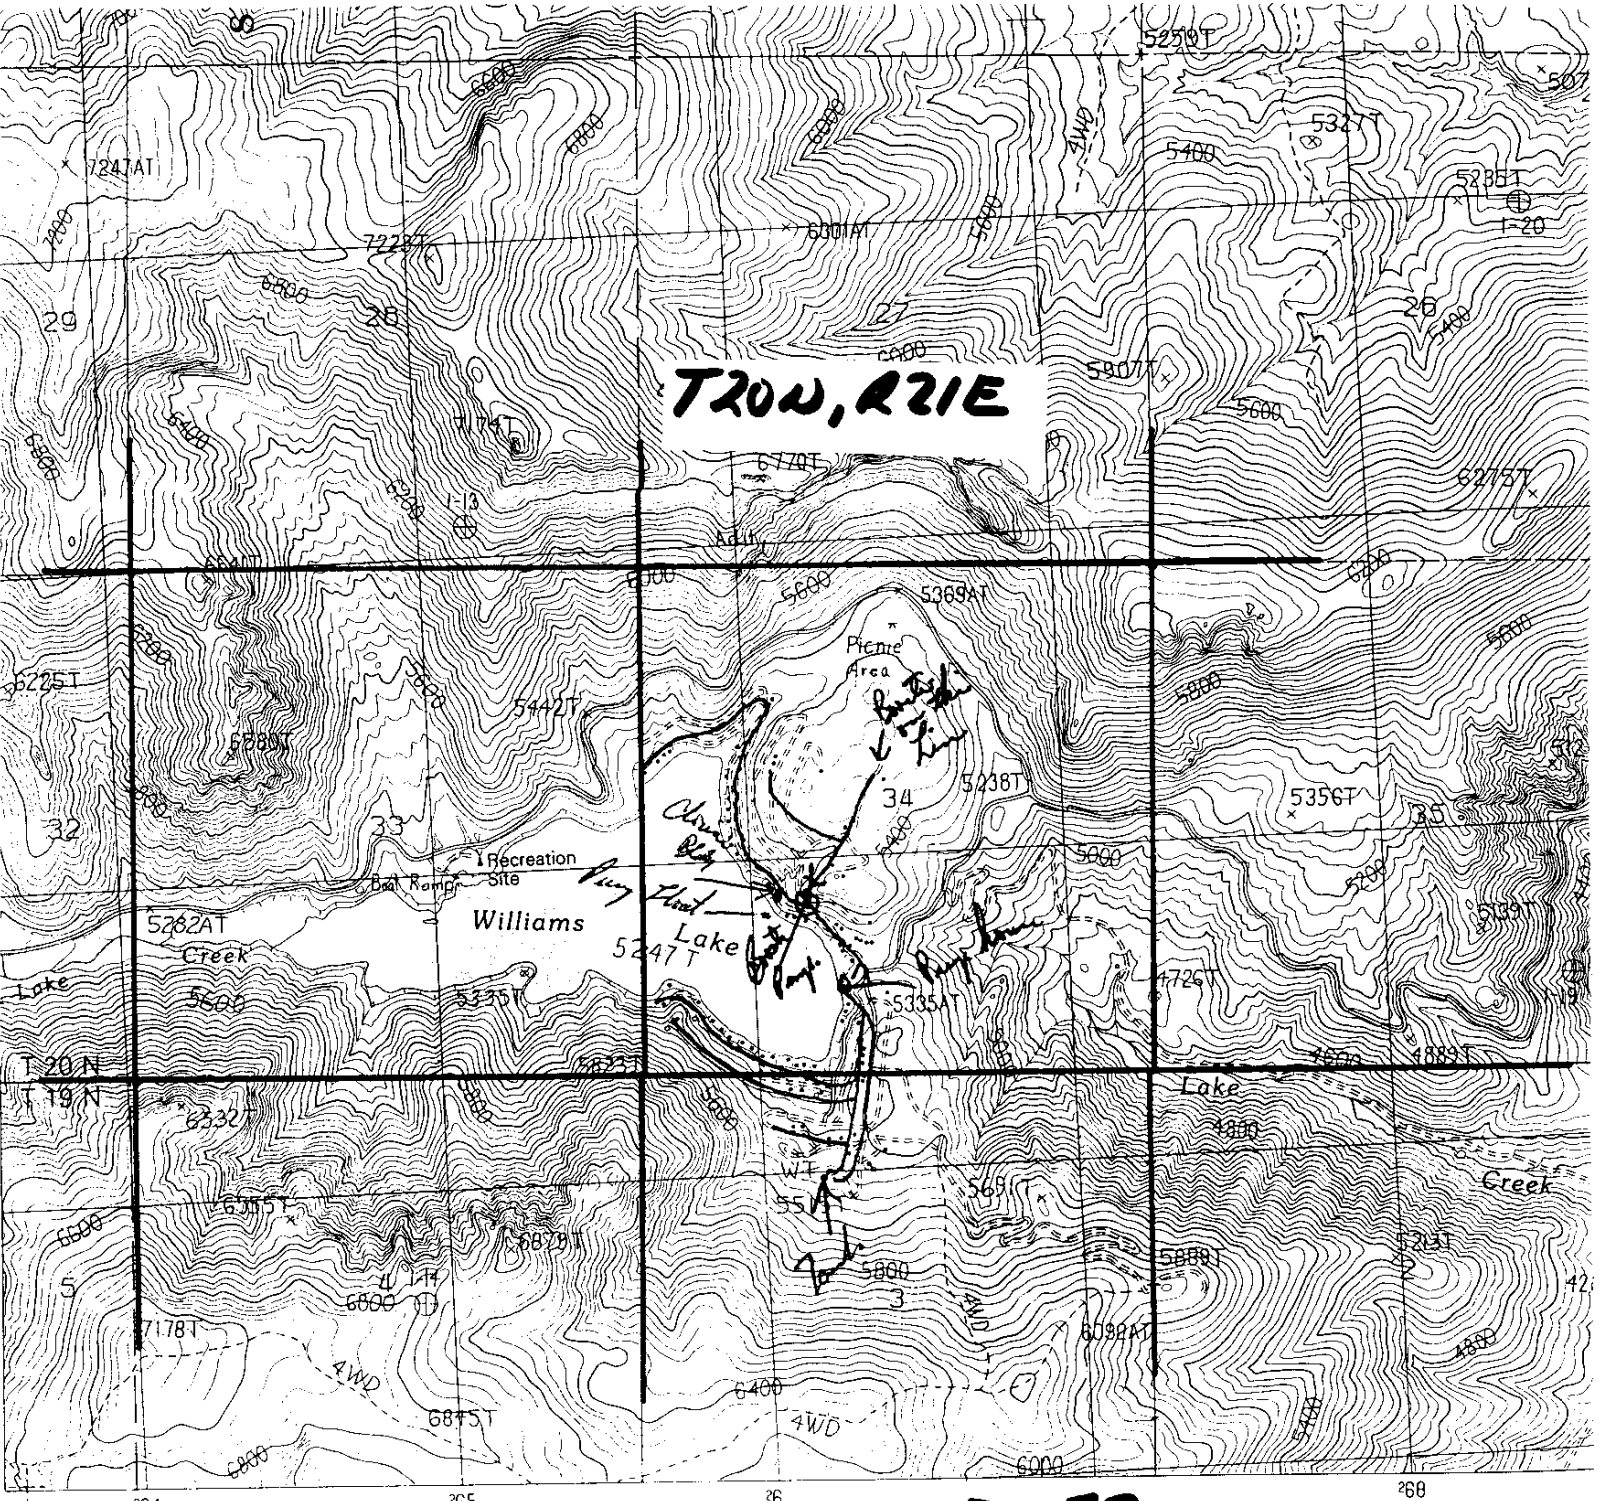


PRODUCED BY THE UNITED STATES GEOLOGICAL SURVEY
BY ... USGS, NOS/NOAA
FROM AERIAL PHOTOGRAPHS TAKEN ... 1985

75-07052

SCALE 1:2



12

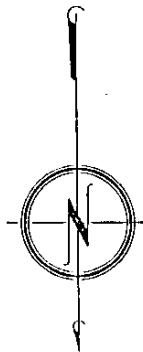

Williams Lake

WILLIAMS LAKE SUBDIVISION No. 2

of
Lots 1, 2, 3 and 522 NW¹/₄, Sec. 34
T. 20 N., R. 21 E., Boise Meridian
Lemhi Co., Idaho

SURVEYORS CERTIFICATE:
I, John C. Carr, Registered Land Surveyor in the State of Idaho hereby certify that the survey of WILLIAM LARUE SUBDIVISION has been eliminated, that that was made by me and under my supervision, that the survey was correctly made and is correctly represented on this plat and that all corners are correctly monumented.



APPROVED BY THE LAMBI COUNTY BOARD OF COMMISSIONERS
in regular meeting, at Sedona, Arizona, this 14th day of September 1943


Paul Johnson
Chairman

River for many of the reports of
 this 18th of March 1963. The river was very low at
 in South of the river. Reports of low water
 at South of the river.

By Order of the County Board
 of Duane County, Oregon

25070-51

Section 34 T. 20 N. R. 21 E. S. 34
Section 3 T. 19 N. R. 21 E. S. 34

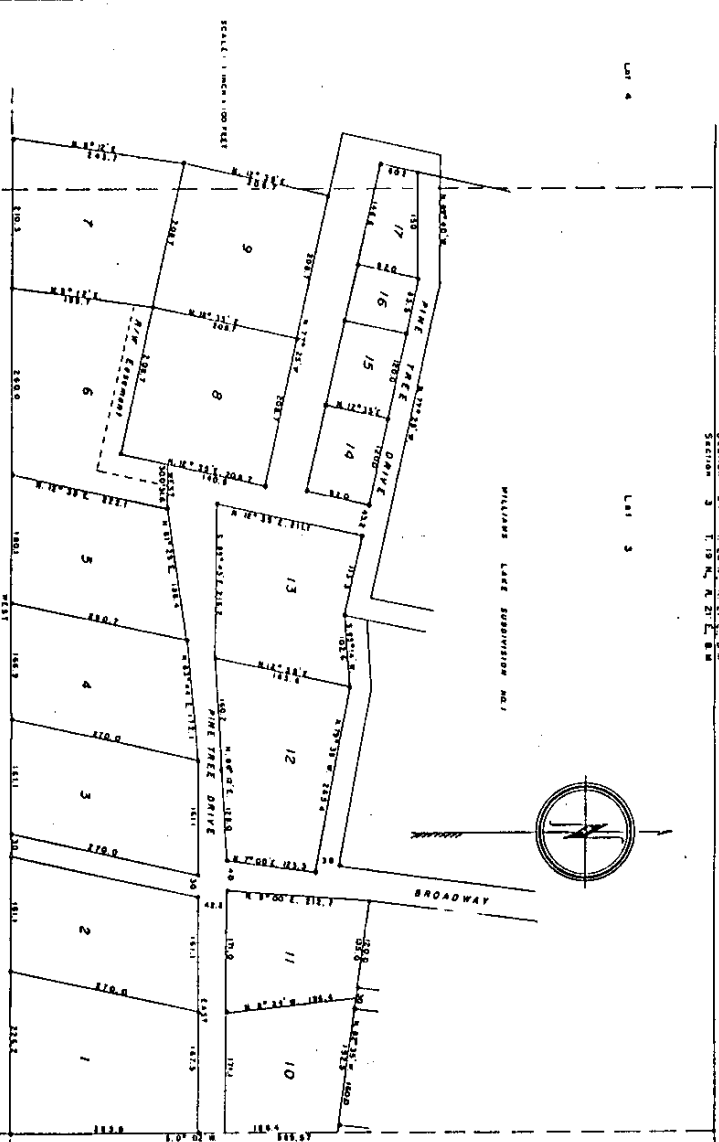

WILLIAMS LAKE SUBDIVISION No. 3


Lots 3 and 4, Sec. 3, T. 19 N., R. 21 E. B.M.
Lemhi Co., Idaho

DEDICATION CERTIFICATE.
BEFORE ME, the undersigned authority, on this _____ day of _____, 19____, personally appeared _____, known to me to be the President of the _____, a corporation organized under the laws of the State of Idaho, and the _____, its secretary and treasurer, and they declared that they executed the foregoing instrument for the purposes and consideration therein expressed, and that the same should be recorded for the purpose of dedicating to the public use the land therein described, and that they were duly authorized to execute the same.

On this 6th day of September, 1951, before me, _____, a Notary Public in and for the State of Idaho, personally appeared _____, known to me to be the President of the _____, a corporation organized under the laws of the State of Idaho, and the _____, its secretary and treasurer, and they declared that they executed the foregoing instrument for the purposes and consideration therein expressed, and that the same should be recorded for the purpose of dedicating to the public use the land therein described, and that they were duly authorized to execute the same.



SURVEYOR'S CERTIFICATE.
I, _____, Registered Land Surveyor in the State of Idaho, hereby certify that the survey of the WILLIAMS LAKE SUBDIVISION No. 3, as delineated on this plat, was made by me and under my supervision, that the survey was correctly made, and that the same is properly represented on this map, and that all corners are properly monumented.



APPROVED BY The Lemhi County Board of Commissioners, at a regular meeting, held on _____ day of _____, 19____, at _____, Idaho.

By _____, Clerk
By _____, Secretary

75-07052

State of Iowa, ss. SURVEYOR CERTIFICATE
County of Linn, ss. I, the Surveyor, do hereby certify that the above described land is the property of the State of Iowa, and is subject to the right of the State of Iowa to take the same for public use, and that the same is not subject to any other claim or interest.



Attest my hand and seal of office this 1st day of June, 1904.

Surveyor General

State of Iowa, ss. APPROVAL CERTIFICATE
County of Linn, ss. I, the County Clerk, do hereby certify that the above described land is the property of the State of Iowa, and is subject to the right of the State of Iowa to take the same for public use, and that the same is not subject to any other claim or interest.


Attest my hand and seal of office this 1st day of June, 1904.

County Clerk

WILLIAMS LAKE SUBDIVISION

SW 1/4 Sec 34, T. 20N, R. 21E
Lots 2, 3, 4, Sec 3, T. 19N, R. 21E.

Linn County, Iowa

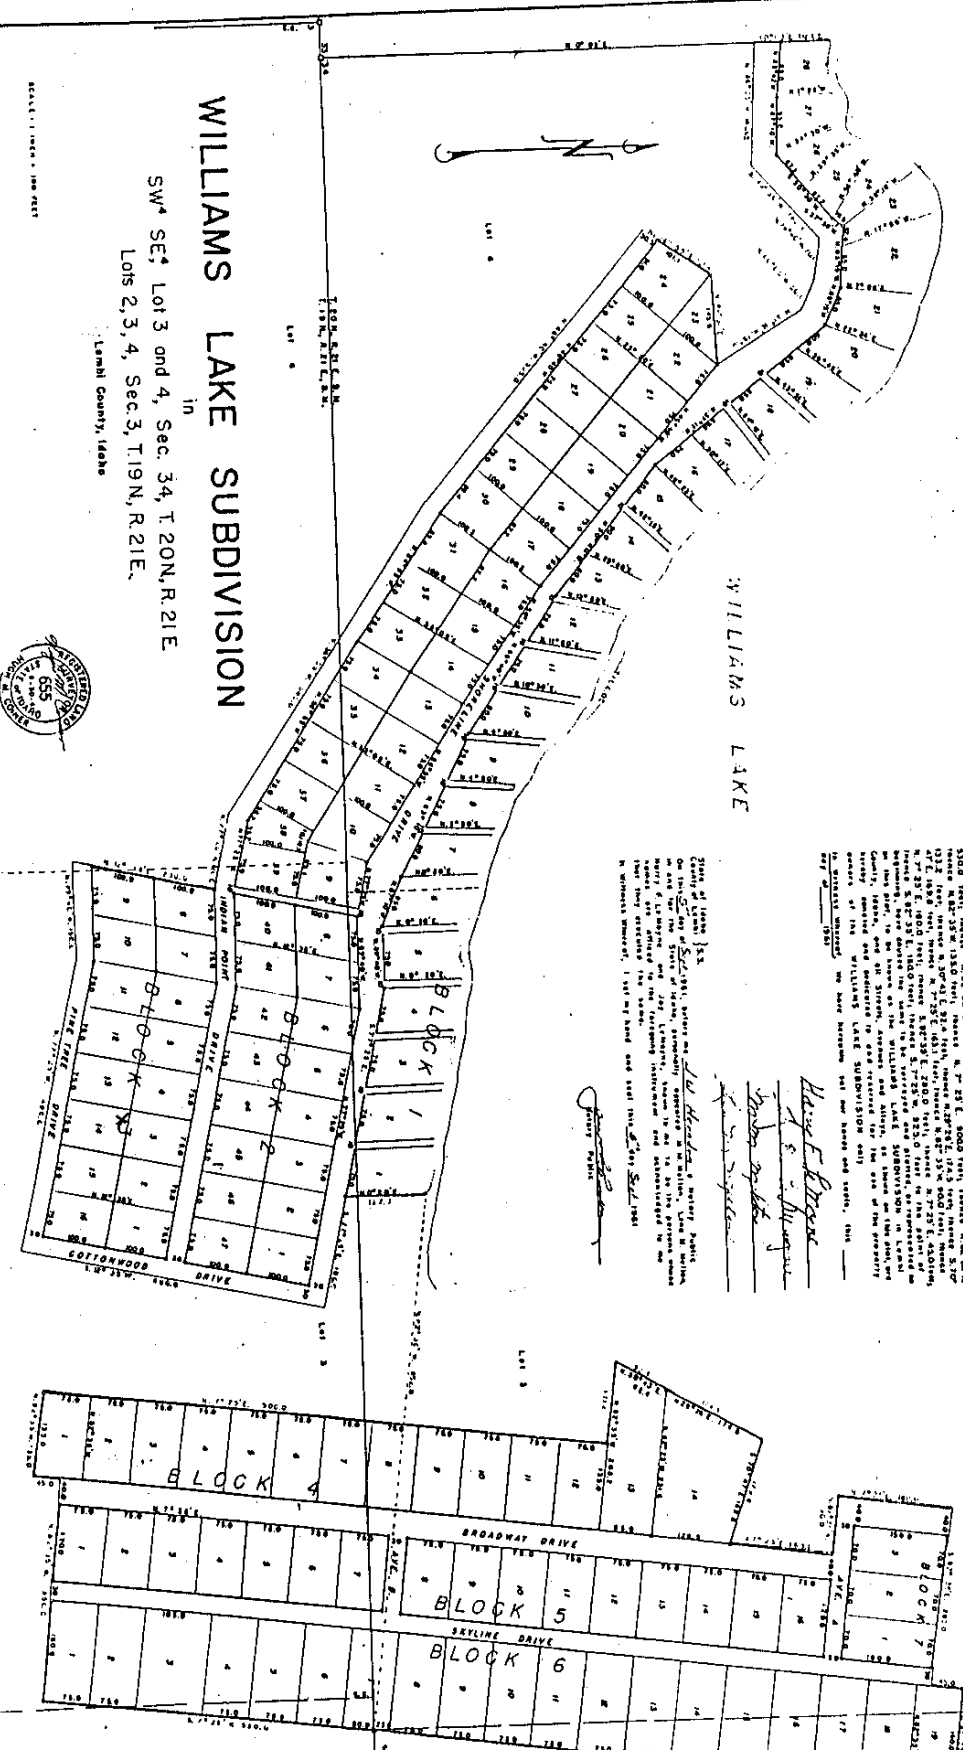

State of Iowa, ss. APPROVAL CERTIFICATE
County of Linn, ss. I, the County Clerk, do hereby certify that the above described land is the property of the State of Iowa, and is subject to the right of the State of Iowa to take the same for public use, and that the same is not subject to any other claim or interest.

Attest my hand and seal of office this 1st day of June, 1904.

County Clerk

State of Iowa, ss. APPROVAL CERTIFICATE
County of Linn, ss. I, the County Clerk, do hereby certify that the above described land is the property of the State of Iowa, and is subject to the right of the State of Iowa to take the same for public use, and that the same is not subject to any other claim or interest.

Attest my hand and seal of office this 1st day of June, 1904.

County Clerk

State of Iowa, ss. APPROVAL CERTIFICATE
County of Linn, ss. I, the County Clerk, do hereby certify that the above described land is the property of the State of Iowa, and is subject to the right of the State of Iowa to take the same for public use, and that the same is not subject to any other claim or interest.

Attest my hand and seal of office this 1st day of June, 1904.

County Clerk

*Please copy and
send original to
Sweener @ CO
Copy to our files*
MILTON A. (JOCK) SLAVIN *BD*

ATTORNEY AT LAW

1016 MAIN ST., P.O. BOX 1103, SALMON, IDAHO 83467

208/756-2030

Blaine -
RECEIVED

AUG 29 1994

DIVISION OF
ENVIRONMENTAL QUALITY
EIRO

August 25, 1994


George Spinner
Regional Administrator
Idaho Division of Environmental Quality
224 S. Arthur
Pocatello, ID. 83204

Dear George:

Enclosed please find the Voluntary Consent Order prepared by your office and signed by the Directors of the Williams Lake Recreational Water and Sewer District.

Please return an executed copy to our office for our files. If there is anything further that needs to be done feel free to contact me at your earliest convenience.

Very truly yours,

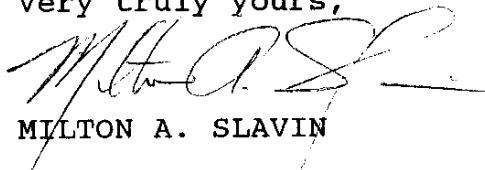

MILTON A. SLAVIN

MAS/st

enclosure

RECEIVED

SEP 9 1994

Div. of Environmental Quality
Community Programs

RECEIVED

NOV 09 1994

DIVISION OF
ENVIRONMENTAL QUALITY
EIRO

Document A
pg 1 of 4


75-7052

IDAHO DEPARTMENT OF HEALTH AND WELFARE

Voluntary Consent Order

1. Pursuant to Idaho Code § 39-108 (Idaho Environmental Protection and Health Act), the Idaho Department of Health and Welfare (Department) enters into this Voluntary Consent Order with Williams Lake Recreational Water and Sewer District.
2. Williams Lake Recreational Water and Sewer District is the owner of the Williams Lake Recreational Water and Sewer public water system, located in Lemhi County, Idaho, identification number 7300061.
3. Williams Lake Recreational Water and Sewer District agrees to the terms and conditions of this Voluntary Consent Order without the issuance of a Notice of Violation or the holding of a compliance conference under Idaho Code § 39-108.
4. The Department has determined that Williams Lake Recreational Water and Sewer District is in violation of the surface water treatment technique requirements of the Idaho Rules For Public Drinking Water Systems, IDAPA 16.01.08.9301.300 (effective June 1, 1994).
5. Williams Lake Recreational Water and Sewer District shall perform the following actions in order to achieve compliance with IDAPA 16.01.08.9301.300 (effective June 1, 1994):
 - a. Provide initial public notification to consumers, in accordance with IDAPA 16.01.08.9301.150.02, no later than July 31, 1994, and every three (3) months thereafter until in full compliance with the treatment technique requirements of IDAPA 16.01.08.9301.300.
 - b. Perform the following interim protective measures to ensure public health protection until the system is in full compliance with IDAPA 16.01.08.9301.300: Maintain continuous chlorination of the current water supply.
 - c. Submit to the Department an engineering report in accordance with IDAPA 16.01.08.9301.551.01 which, among other things, outlines alternatives to bring the system into compliance. The engineering report shall be submitted no later than July 31, 1994.
 - d. Submit a report to the Department no later than August 31, 1994 which outlines how system improvements will be financed.
 - e. Submit plans and specifications to the Department for review and approval in accordance with IDAPA 16.01.08.9301.551.04. Plans and specifications shall be submitted no later than July 31, 1994.


75-7052

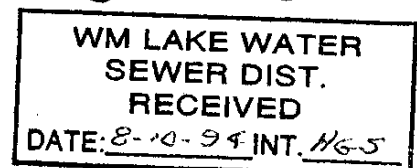

Document A
Pg 2 of 4


- f. Complete construction of the supply water system improvements in accordance with plans and specifications approved by the Department no later than December 31, 1995.
 - g. Conduct initial monitoring of the new water source for total coliform and inorganic and organic chemical contaminants listed in IDAPA 16.01.08.9301 Subsections 100.01., 100.03. and 100.04., unless analysis is waived pursuant to Subsection 100.07. Initial monitoring shall be conducted no later than July 31, 1996.
 - h. Discontinue the use of the surface water from Williams Lake as a source of potable water no later than July 31, 1996.
 - i. Complete construction of distribution system improvements in accordance with plans and specifications approved by the Department no later than December 31, 1996.
 - j. Submit as constructed plans and specifications for source water and distribution construction or modifications to the Department in accordance with IDAPA 16.01.08.9301.551.04.c. The as constructed plans and specifications shall be submitted no later than thirty (30) days after completion of the supply water system and distribution system respectively.
 - k. Achieve full compliance with IDAPA 16.01.08.9301.300 by January 31, 1997.
- 6. The Department agrees to waive civil penalties for the matters covered by this Voluntary Consent Order provided Williams Lake Recreational Water and Sewer District fully complies with the terms of this Voluntary Consent Order. Williams Lake Recreational Water and Sewer District recognizes that failure to comply with the terms of this Voluntary Consent Order may result in disapproval of the water system and district court action pursuant to Idaho Code § 39-108.
 - 7. This Voluntary Consent Order shall not in any way relieve Williams Lake Recreational Water and Sewer District from any obligation to comply with any provision of the Idaho Rules For Public Drinking Water Systems, or any applicable local, state, or federal laws.
 - 8. Upon fulfilling all requirements of this Voluntary Consent Order, Williams Lake Recreational Water and Sewer District may petition the Department in writing for termination of this Voluntary Consent Order. This Voluntary Consent Order shall remain in full force and effect and shall bind Williams Lake Recreational Water and Sewer District, its successors, and assigns until the Williams Lake Recreational Water and Sewer District has fulfilled all requirements of this Voluntary Consent Order and the Department acknowledges in writing that this Voluntary Consent Order is terminated.

9. Each undersigned representative to this Voluntary Consent Order certifies that he or she is fully authorized to enter the terms and conditions of this Voluntary Consent Order and to execute and legally bind such party to this document.
10. The effective date of this Voluntary Consent Order shall be the date of signature by the Regional Administrator of the Idaho Division of Environmental Quality.



Date: 9/6/94

George Spinner, Regional Administrator
Idaho Division of Environmental Quality




Date: Aug 17, 1994

Harold G. Sisco, Chairman
Williams Lake Recreational Water and Sewer District




Date: Aug 18, 1994

Mae Mulkey, Board Member
Williams Lake Recreational Water and Sewer District

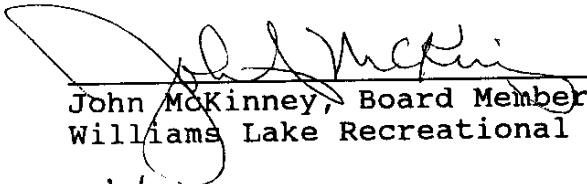


Date: August 23, 1994

John McKinney, Board Member
Williams Lake Recreational Water and Sewer District



Date: August 24, 1994

Kay McAtee, Board Member
Williams Lake Recreational Water and Sewer District

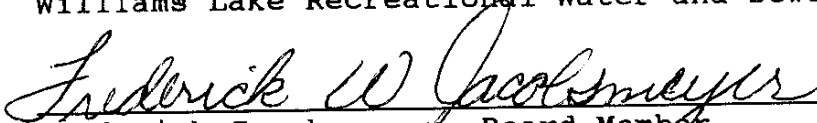

Date: 8/22/94

Frederick Jacobsmeyer, Board Member
Williams Lake Recreational Water and Sewer District

STATE OF IDAHO
COUNTY OF LEMHI

ALBERTA WIEDENRICK, CLERK OF THE DISTRICT COURT OF THE SEVENTH JUDICIAL DISTRICT OF THE STATE OF IDAHO, IN AND FOR THE COUNTY OF LEMHI, DO HEREBY CERTIFY THAT THE FOLLOWING IS A TRUE AND CORRECT COPY OF THE ORIGINAL FILED IN THIS OFFICE.

LEMHI COUNTY DISTRICT COURT
FILED 4/10

Milton A. Slavin
Attorney at Law
P.O. Box 1103
1016 Main Street
Salmon, Idaho 83467
Telephone: 208-756-2030

AM. APR 19 1994

Terrence J. Morton

ALBERTA WIEDENRICK, CLERK
DEPUTY
Terrence J. Morton

IN THE DISTRICT COURT OF THE SEVENTH JUDICIAL DISTRICT OF
THE STATE OF IDAHO, IN AND FOR THE COUNTY OF LEMHI

In The Matter Of:

Case No. 5145

WILLIAMS LAKE WATER AND
SEWER DISTRICT

FINDINGS OF FACT, CONCLUSIONS OF LAW,
ORDER AND DECREE CHANGING STATUS TO
A RECREATIONAL WATER & SEWER DISTRICT

A Petition having been filed by the Williams Lake Water and Sewer District to change the status from a regular water and sewer district to a recreational water and sewer district in conformance with the provisions of Idaho Code, §42-3202C.

FINDINGS OF FACT

After review of the Petition, the Court made the following findings:

I

That the Petition for change of status was filed with the Court on March 10, 1994;

II

That the Order For Hearing was executed by the Court on March 15, 1994;

Findings of Fact, Conclusions of Law, Order and Decree

Page 1

Document B
Pg 1 of 3

75-7052

III

That the Notice of Hearing on the Petition for Change of Status was published in the Recorder-Herald on March 24, 1994, in accordance with Idaho Code §42-3206 and an Affidavit Of Publication has been filed herein;

IV

That a hearing having been held on the 19th day of April, 1994 and no objection to the change of status having been given, and several witnesses having testified in favor of the change of status for the purpose of obtaining qualified voters in order to vote in any elections held within the district;

CONCLUSIONS OF LAW

I

That the Hearing for the change of status was held in accordance with the Statutes and the Constitution of the State of Idaho;

II

That there being no objections thereto.

NOW, THEREFORE, IT IS HEREBY ORDERED, ADJUDGED AND DECREED:

That the status of Williams Lake Water and Sewer District is hereby changed to that of a recreational district in accordance with the Idaho Code, §42-3202C, and shall comprise all of the lands described as follows:

All platted parts and parcels of land as follows:

Findings of Fact, Conclusions of Law, Order and Decree

Page 2

Document B
Pg 2 of 3

75-7052

Williams Lake Subdivision - Book of Plats, page 47;
 Williams Lake Subdivision No. 2, Book 2 of Plats, page 10;
 Williams Lake Subdivision No. 3, Book 2 of Plats, page 18;
 Williams Lake Subdivision No. 4, Book 2 of Plats, page 33.

Also, all unplatted parts and parcels of Lot 4 and of the W $\frac{1}{2}$ SW $\frac{1}{4}$ SE $\frac{1}{4}$ of Section 34, Township 20 North, Range 21 East Boise Meridian and all unplatted parts and parcels of Lots 2, 3, 4, and S $\frac{1}{2}$ NE $\frac{1}{4}$ of Section 3, Township 19 North, Range 21 East Boise Meridian.

IT IS FURTHER ORDERED, ADJUDGED AND DECREED, That the following persons be and they are hereby declared to be the elected and confirmed Directors of said water and sewer district to serve for terms as follows:

Fred Jacobsmeyer	Term ends July 31, 1994;
Kay McAtee	Term ends July 31, 1994;
Mae Mulkey	Term ends July 31, 1996;
Harold Sisco	Term ends July 31, 1998;
John McKinney	Term ends July 31, 1998.

DATED: April 19, 1994.

ORIGINAL SIGNED BY
 JAMES C. HERNDON

JAMES C. HERNDON
 District Judge

Document B
 Pg 2 of 3

75-7052

DOMESTIC

WILLIAMS LAKE WATER + SEWER

10/6



THE NEXT
8 PHOTOS
SHOW PLACE
OF USE
VIEW IS
FROM LEFT
TO RIGHT.
NW 34



—+—
NW SW +
NE SW SEC
34
SHOWN
POINT OF
DIVERSION

PERMIT
NKMBA

75-07052

DOMESTIC

WILLIAMS LAKE WATER & SEWER

2 of 6

SE SW 534



SE SW 534 +
NE NW 53



PERMIT
NUMBER

75-07052

DOMESTIC


WILLIAMS LAKE WATER + SEWER

3 of 6

SE SW 534
DUPLICATE



27 9'95

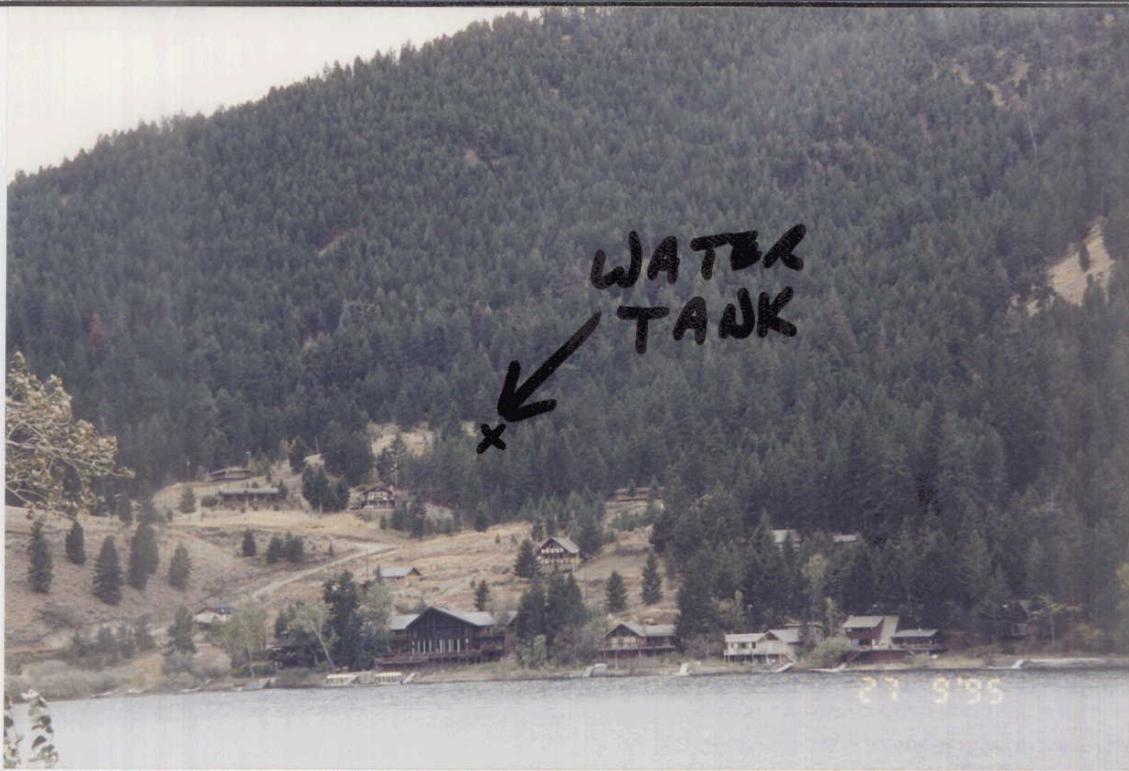

WATER
TANK
x

NEWS 3
T19 N R 21 E
SHOWN
PLACE WHERE
STORAGE TANK
IS LOCATED

PERMIT
NUMBER

75-07052

DOMESTIC

WILLIAMS LAKE WATER + SEWER

40/6



VIEW OF
FLOATING
PLATFORM
WHERE ②
SUBMERSIBLE
PUMPS ARE
SUSPENDED
60' DOWN

DUPLICATE
VIEW



SWSW 534

PERMIT
NUMBER

75-07052

DOMESTIC

WILLIAMS LAKE WATER + SEWER

5/6

VIEW OF
POINT OF
DIVERSION
BELOW
STATIONARY
FLOAT.




PERMIT
NUMBER

75-07052

DOMESTIC

WILLIAMS LAKE WATER & SEWER

6/6

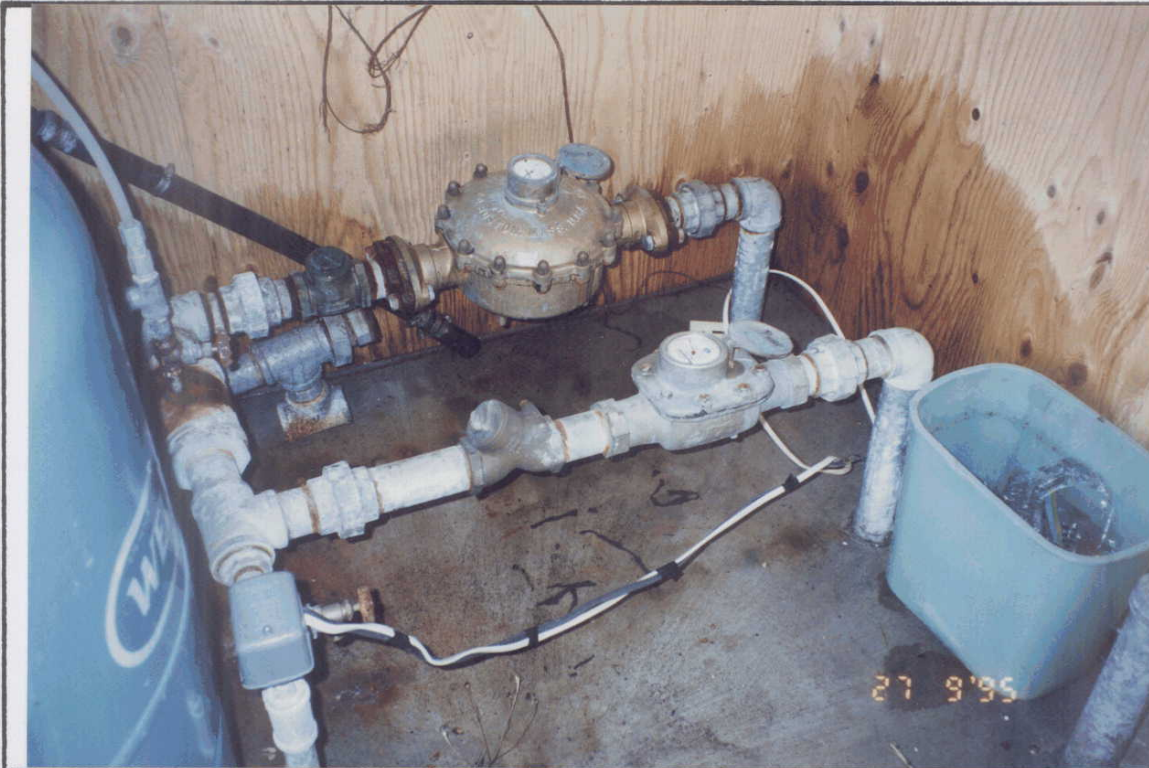

VIEW INSIDE
CHLORINATOR
ROOM.


SHOWS
FLOW METERS



CHLORINATOR

PERMIT
NUMBER


75-07052

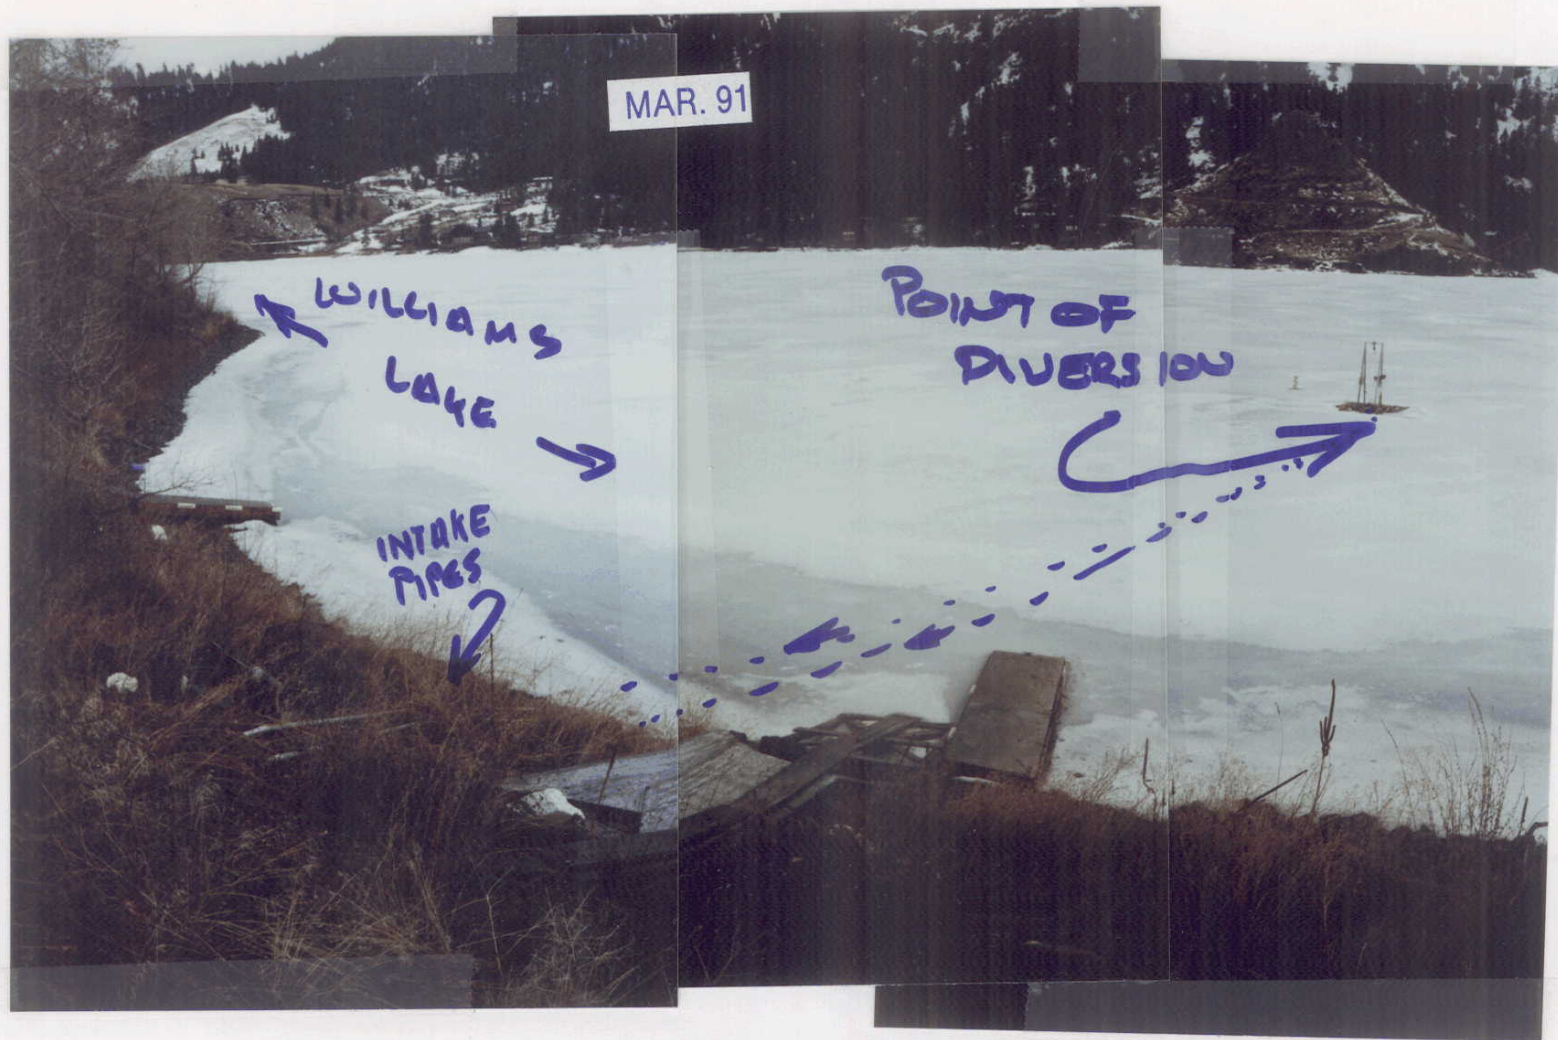


75-07052 - POINT OF DIVERSION

3/4/91 ESV

75-07052

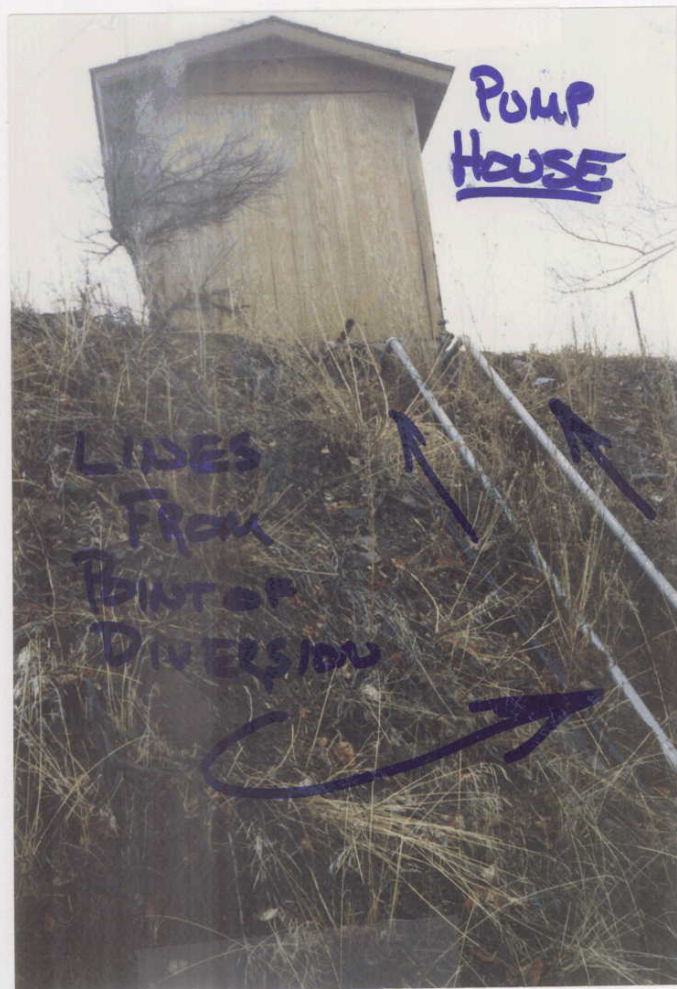

MAR. 91

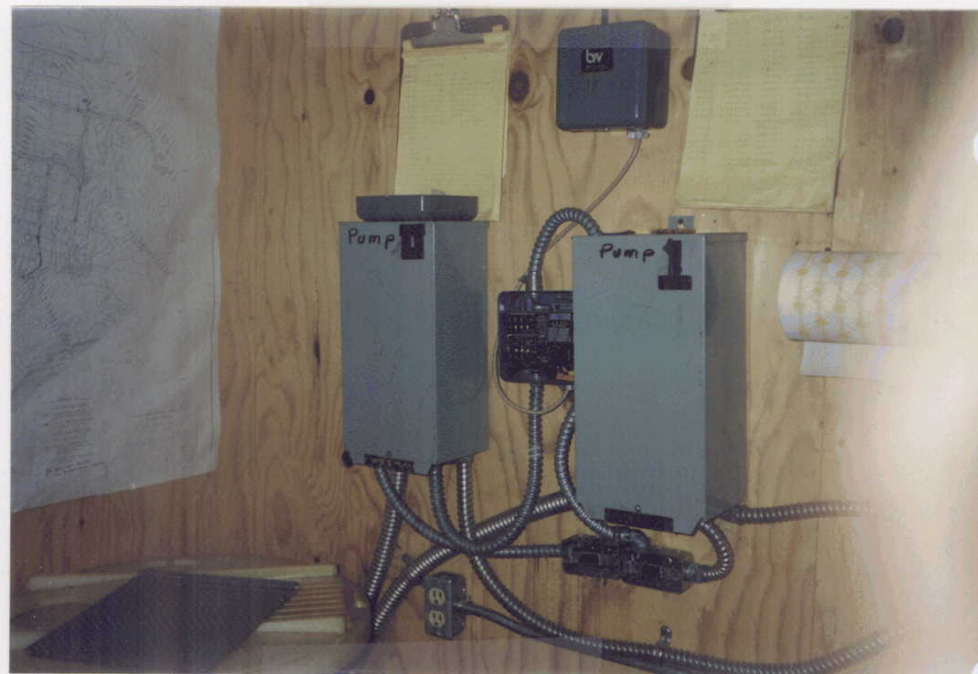

CONTROL BOXES FOR
SUBMERSIBLE
PUMPS.

75-07052

3/4/91 ESI

75-07052