


T. 66706 & 63-12459
REVIEW MEMO ATTACHMENT

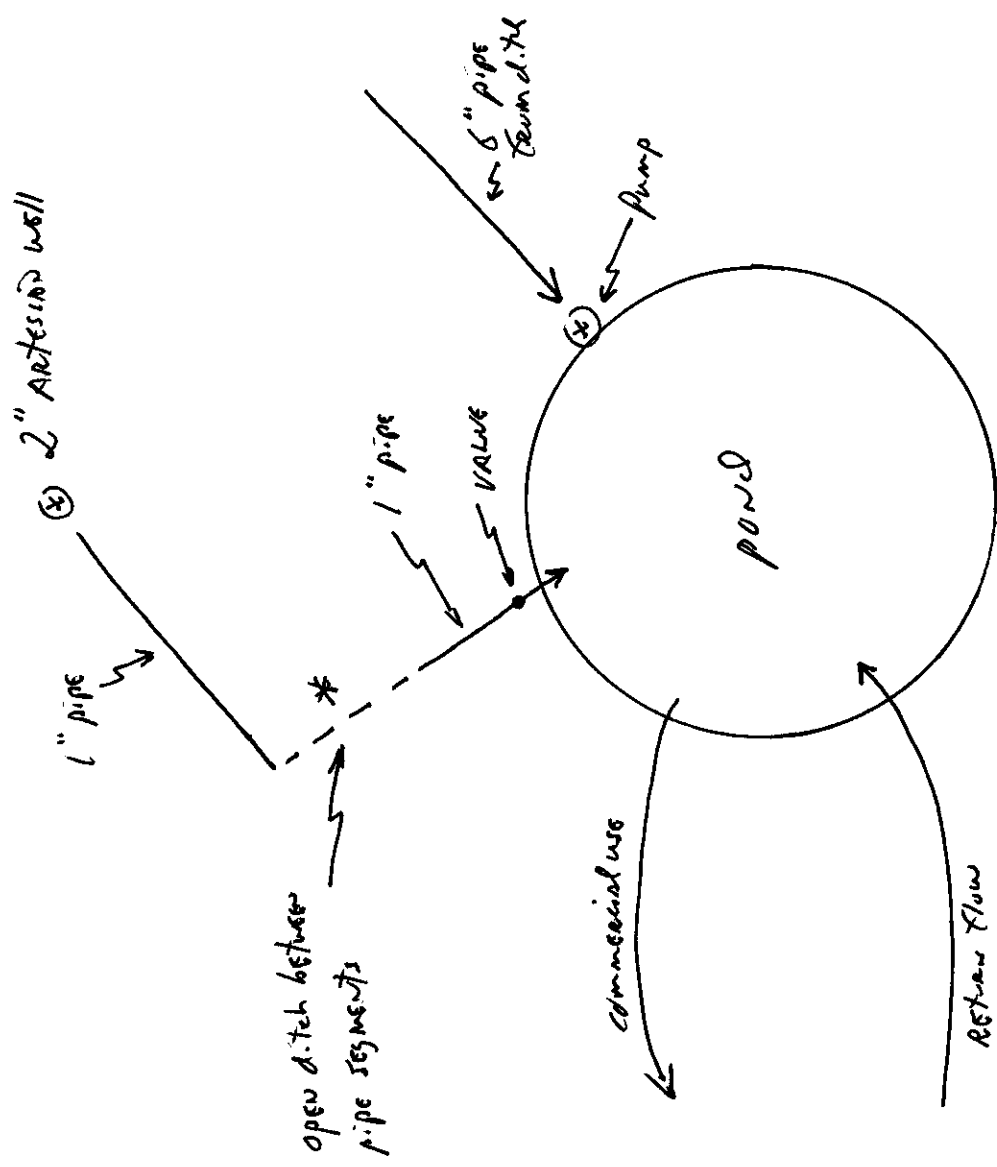

NURSERY AREA

- greenhouses
- open air containers
- drip systems
- low pressure sprinklers
- in previous water for
Return flow for
Reuse

- Shallow ground water - fill pond
- Artesian well - maintain pond
(.04 cfs / 2500 gpd limit)
- can run ditch shares to pond if
needed

* estimated 10-15 gpm @ ditch
 8/19/97

- R 12/14/04