

[illegible]

20

21

22

VABM - 3412

REGISTRATION

3307
DEC 08 1992

GOODING & CO
TWIN FALLS CO

Well -
3356


NIAGARA

SPRINGS

36-08661

36-8661

13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

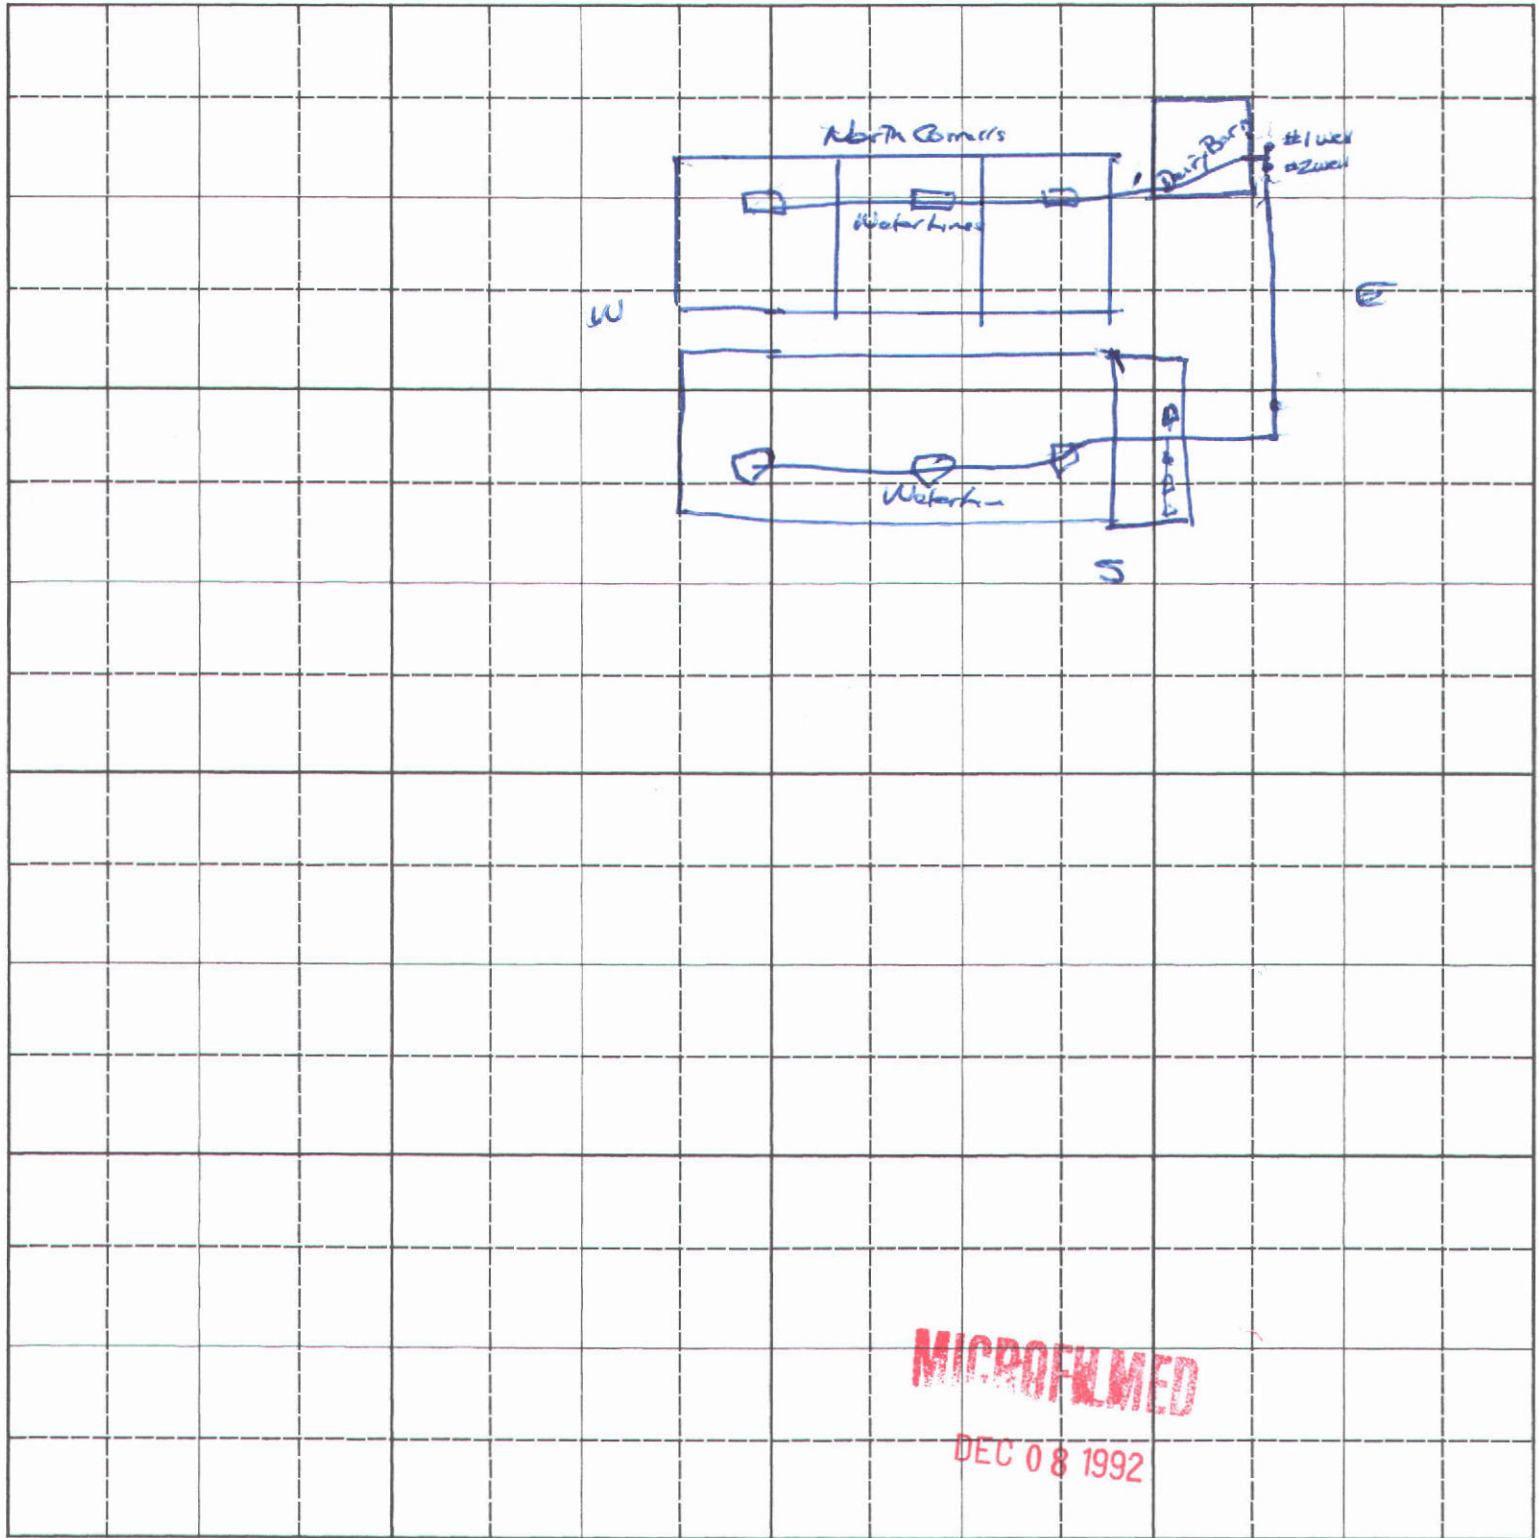

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

[Signature]
(Applicant)

AFFIDAVIT of PUBLICATION

RECEIVED

State of Idaho }
County of Gooding } ss.

SEP 14 1992

Department of Water Resources
Southern Region Office

Patty Nance, being first duly sworn, deposes and says that she is the printer (publisher) of the Gooding County Leader, a newspaper published every week in Gooding, County of Gooding, State of Idaho; that said newspaper has been continuously and uninterruptedly published for a period of seventy-eight consecutive weeks prior to the first publication of the annexed notice, and is a newspaper qualified to publish legal notices as provided by act of the 1919 session of the legislature of the State of Idaho, known as House Bill 145; that the annexed advertisement was published once each week for

2 consecutive issues in said newspaper proper and not in a supplement; that the date of the first publication of said advertisement was on the 2 day of Sept., 1992, and the date of the last publication was on the 9 day of Sept., 1992.

Patty Nance
Subscribed and sworn to before me this 9th day of September, 1992.
(SEAL)

Norma DeVoe
NOTARY PUBLIC

GOODING COUNTY LEADER

Gooding, Idaho

COST OF PUBLICATION

Number of Picas per Line _____

Number of Lines in Notice _____

Number of Insertions _____

Lines tabular at _____ 6¢/Pica
345 Lines straight at 17.25 5¢/Pica
345 Subsequent lines at 13.80 4¢/Pica
TOTAL COST 31.05

COPY OF NOTICE

(Paste Here)

Water Rt. #36-08661
TITLE OF NOTICE

PLAINTIFF ATTORNEY

DEFENDANT

PLAINTIFF

BILL TO

I DWR

NOTICE OF APPLICATION FOR TRUST WATER RIGHT

36-08661

STOUDER, WILLIAM C

3507 S 2000 E

WENDELL, ID 83355

Source: GROUNDWATER

Diversion Pt: NENENE Sec 33 T
08S R 15E in GOODING County.

Use: STOCKWATER (.260
CFS)

COMMERCIAL (.260 CFS)

Total Diversion: (.260 CFS)

Date Filed: 5/21/1992

In: GOODING County

T08S R15E S33 NENE

The permit(s) will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code and/or the new public interest criteria of Sec. 42-203C, Idaho Code. Protests must be filed with the Director, Dept. of Water Resources, 222 Shoshone Street East, Twin Falls, ID 83301 on or before SEPTEMBER 21, 1992.

S/R Keith Higginson, Director
inv.# 13534

Publish: 9-2/9-9

GCL

MICROFILMED


DEC 08 1992

№ 5456


#13534

South

3507 S 2000 E.
Stouder Holdings Wendell, ID 83355

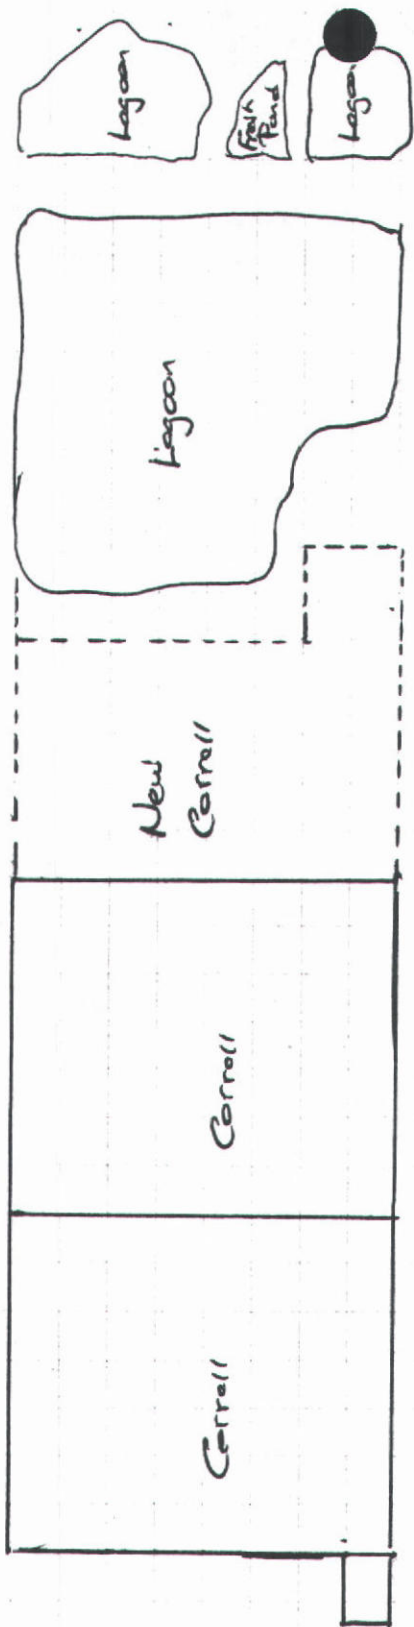


West

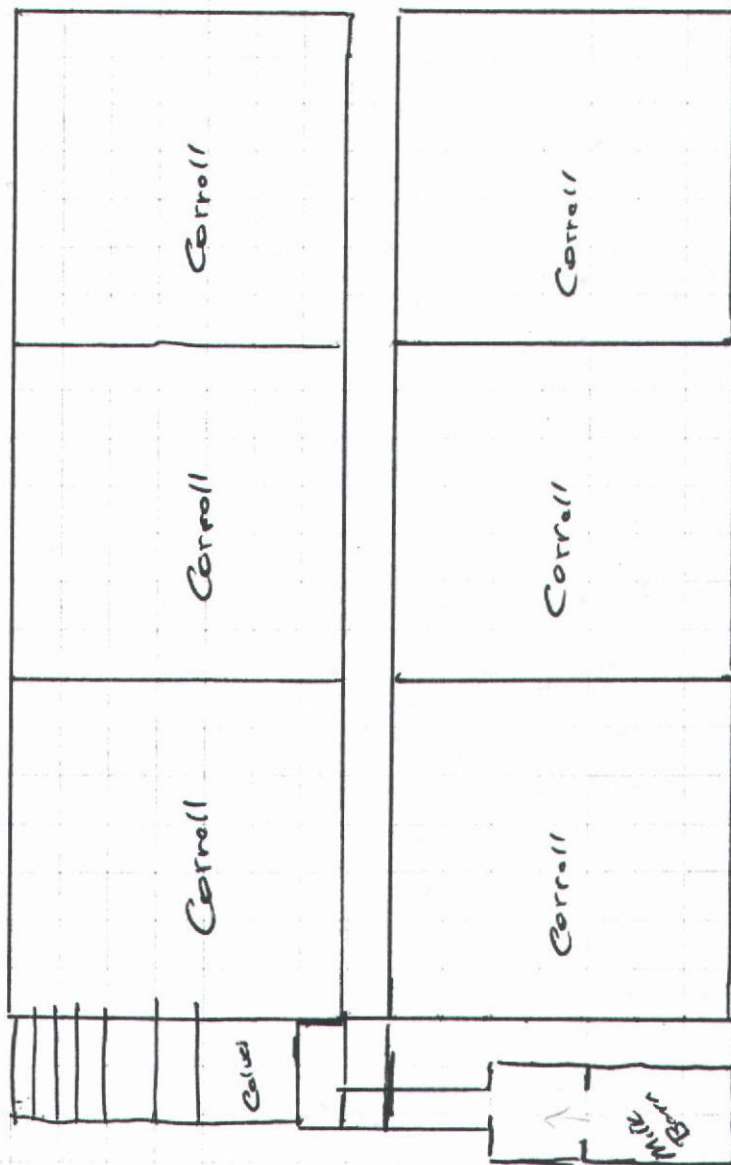

Bob Barta

MICROFILMED

APR 23 2002

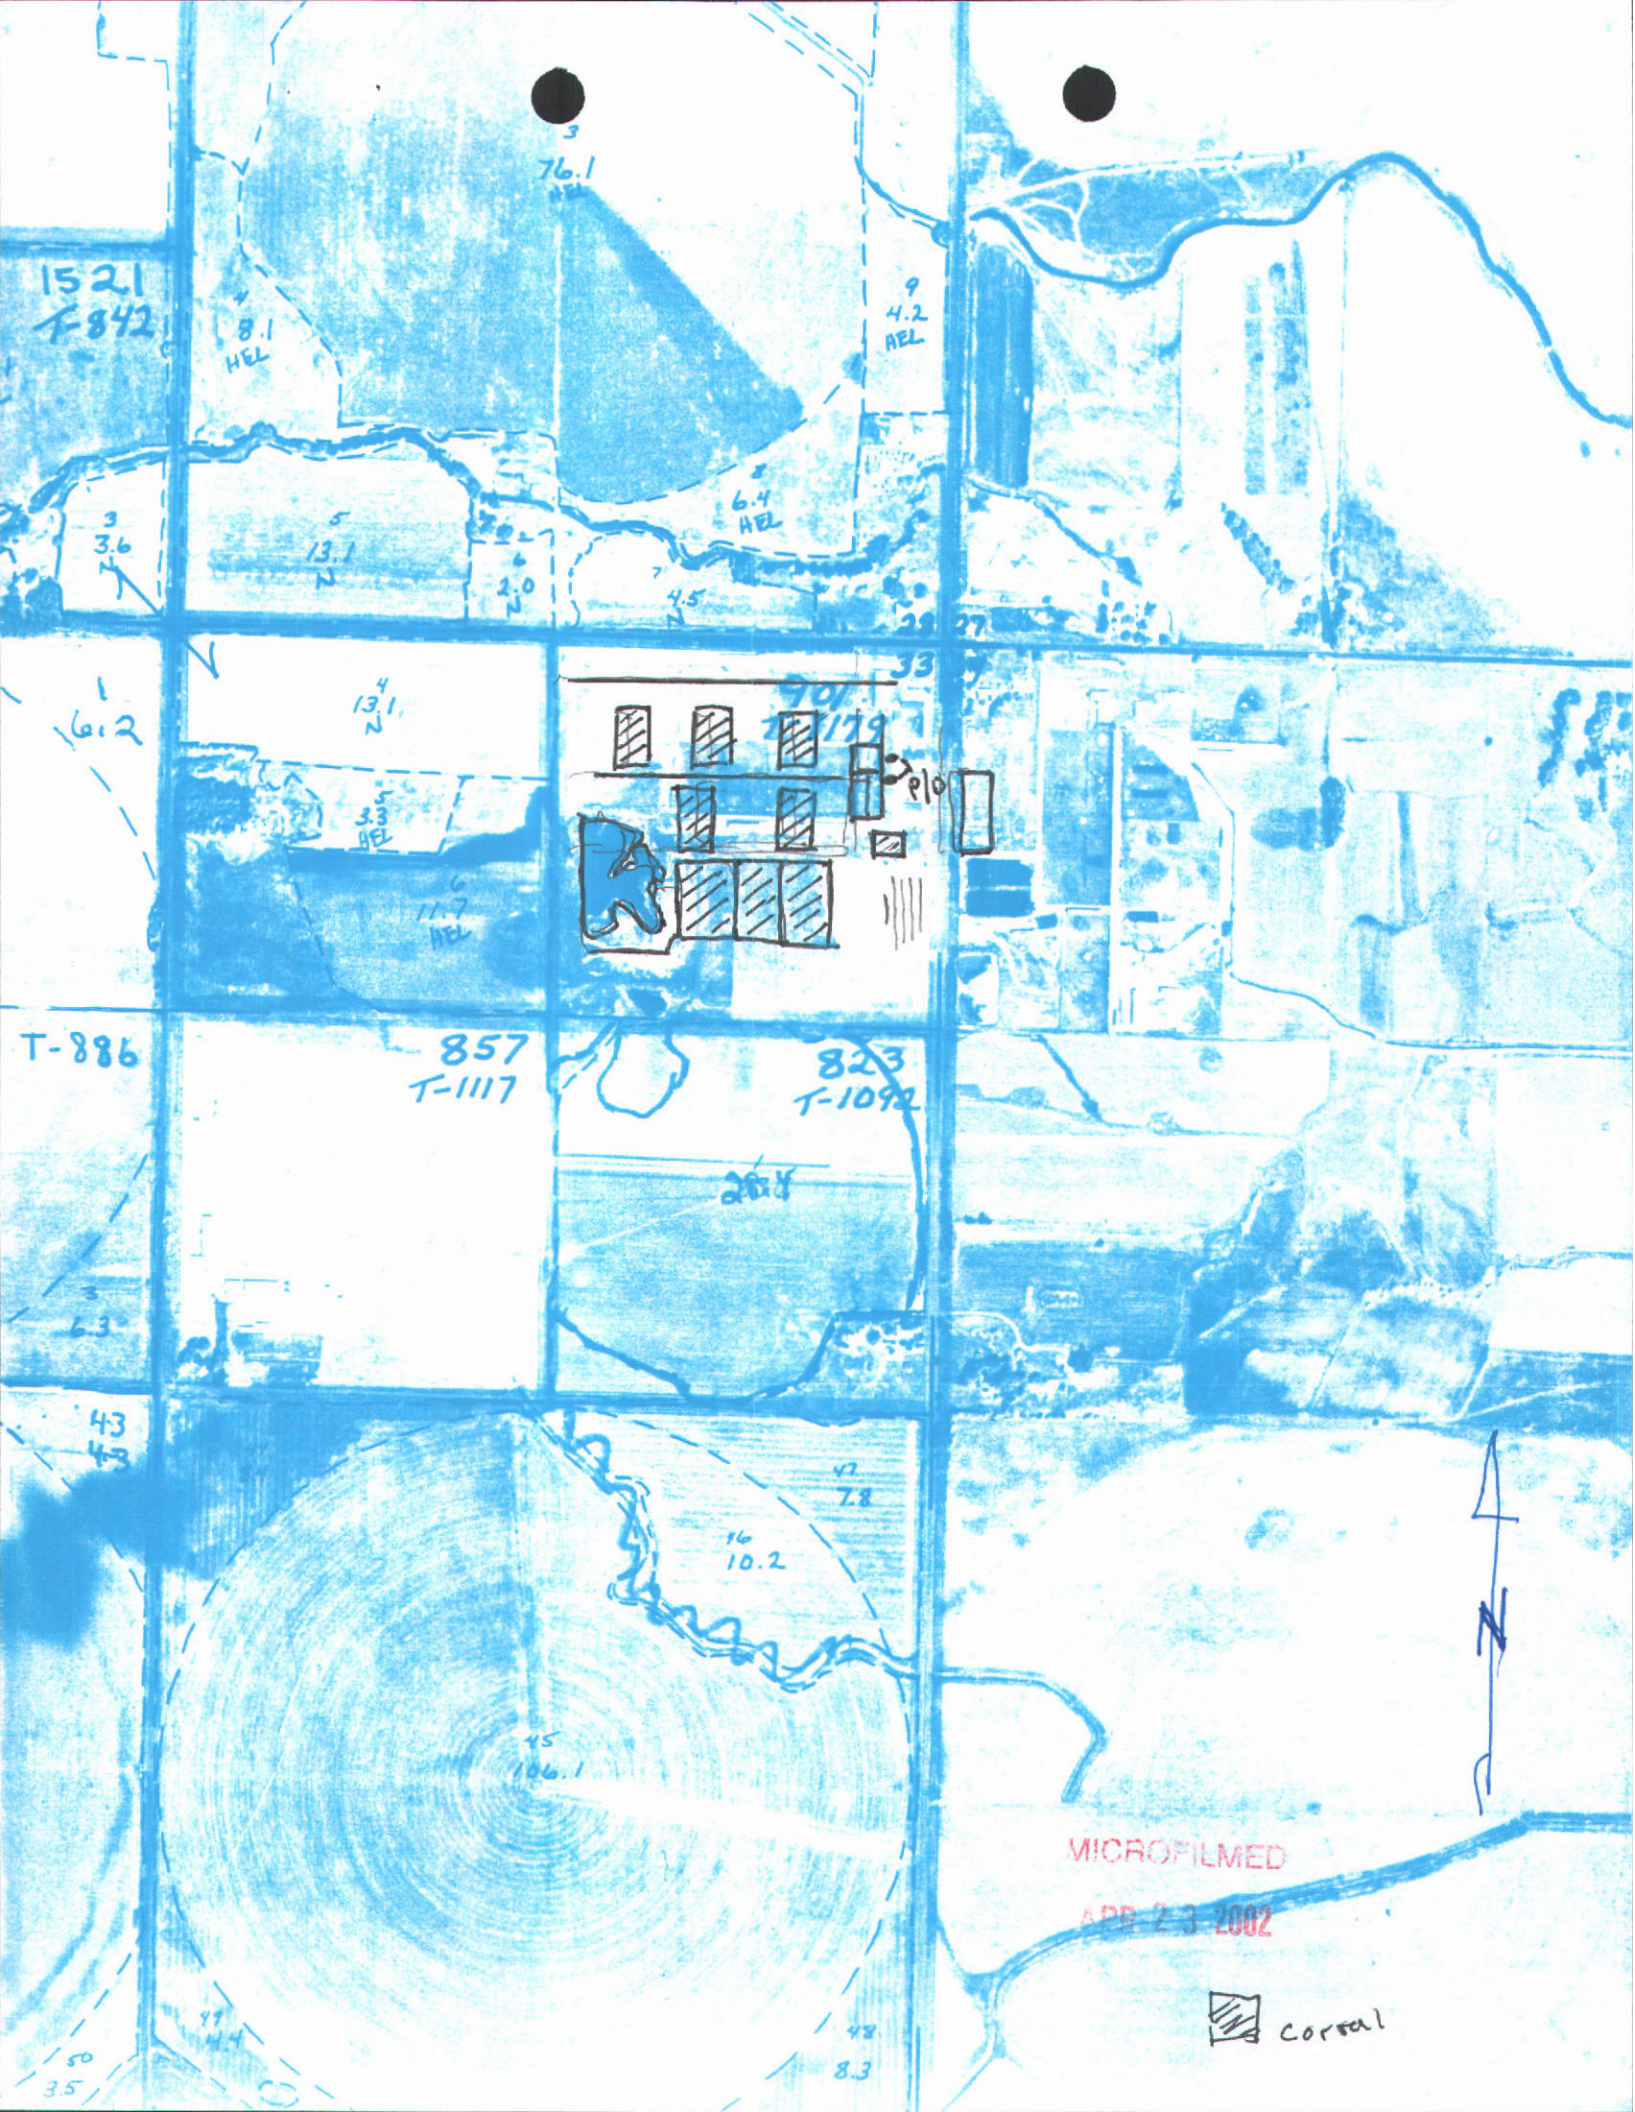

1521
F842

8.1
REL

76.1
REL

4.2
REL

6.4
REL

13.1
N

2.0
N

3.6
N

13.1
N

3.3
REL

11.7
REL

T-886

857
T-1117

823
T-1092

20.8

10.2

106.1

MICROFILMED

APR 23 2002

 Coral

well #1



well #2



MICROFILMED

APR 23 2002

Showing
Installed
measuring
device



Diverging
works to
comm &
stockwater



APR 23 2002

showing 25 HP
Booster pump
& connection to
storage vault



STORAGE
VAULT



MICROFILMED
APR 23 2002

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCESUSE TYPEWRITER OR
BALLPOINT PEN

WELL DRILLER'S REPORT

State law requires that this report be filed with the Director, Department of Water Resources
within 30 days after the completion or abandonment of the well.

1. WELL OWNER

Name William Stander
Address RT 1 Wendell
Owner's Permit No. (well #1)

7. WATER LEVEL

Static water level 98' feet below land surface.
Flowing? ☐ Yes ☒ No G.P.M. flow _____
Artesian closed-in pressure _____ p.s.i.
Controlled by: ☐ Valve ☐ Cap ☐ Plug
Temperature _____ °F. Quality _____
Describe artesian or temperature zones below.

2. NATURE OF WORK

- ☒
- New well
- ☐
- Deepened
- ☐
- Replacement
-
- ☐
- Abandoned (describe abandonment procedure: such as materials, plug depths, etc. in lithologic log)

8. WELL TEST DATA Not Tested☐ Pump ☐ Bailer ☐ Air ☐ Other _____

Discharge G.P.M. _____ Pumping Level _____ Hours Pumped _____

3. PROPOSED USE

- ☒
- Domestic
- ☐
- Irrigation
- ☐
- Test
- ☐
- Municipal
-
- ☐
- Industrial
- ☒
- Stock
- ☐
- Waste Disposal or Injection
-
- ☒
- Other
- Dairy
- (specify type)

4. METHOD DRILLED

- ☒
- Rotary
- ☒
- Air
- ☐
- Hydraulic
- ☐
- Reverse rotary
-
- ☐
- Cable
- ☐
- Dug
- ☐
- Other _____

5. WELL CONSTRUCTION

Casing schedule: ☒ Steel ☐ Concrete ☐ Other _____

Thickness	Diameter	From	To
<u>0.25</u> inches	<u>5 1/2"</u>	<u>7</u> feet	<u>19</u> feet
_____ inches	_____ inches	_____ feet	_____ feet
_____ inches	_____ inches	_____ feet	_____ feet
_____ inches	_____ inches	_____ feet	_____ feet

Was casing drive shoe used? ☐ Yes ☒ No
Was a packer or seal used? ☐ Yes ☒ No
Perforated? ☐ Yes ☒ NoHow perforated? ☐ Factory ☐ Knife ☐ TorchSize of perforation _____ inches by _____ inches
Number _____ From _____ To _____
_____ perforations _____ feet _____ feet
_____ perforations _____ feet _____ feet
_____ perforations _____ feet _____ feetWell screen installed? ☐ Yes ☒ No
Manufacturer's name _____

Type _____ Model No. _____

Diameter _____ Slot size _____ Set from _____ feet to _____ feet

Diameter _____ Slot size _____ Set from _____ feet to _____ feet

Gravel packed? ☐ Yes ☐ No ☐ Size of gravel _____

Placed from _____ feet to _____ feet

Surface seal depth 55 Material used in seal: ☐ Cement grout☐ Bentonite ☒ Pudding clay ☒ CuttingSealing procedure used: ☐ Slurry pit ☐ Temp. surface casing☒ Overbore to seal depthMethod of joining casing: ☐ Threaded ☐ Welded ☐ Solvent Weld☐ Cemented between strataDescribe access port See Standard Well Cap5' gravel top soil moved in zone with hole

6. LOCATION OF WELL

Sketch map location must agree with written location.



Subdivision Name _____

Lot No. _____ Block No. _____

County CandorNE 1/4 NE 1/4 Sec. 33 T. 8 N. R. 15 E. 1/4

10.

Work started 12/26 Finished 12/27, 8311. DRILLERS CERTIFICATION 00I/We certify that all minimum well construction standards were
complied with at the time the rig was removed.Firm Name Eaton's Firm No. 26Address Wendell Date 8-24-83Signed by (Firm Official) James Eaton

and

(Operator) _____

Amended

WATER RIGHT NO. 36-08661

Maximum Diversion Rate: 0.26 CFS
Maximum Diversion Volume: 58.1 AF

And

NORTHWEST FARM CREDIT SERVICES ACA
1363 FILLMORE
PO BOX 5059

TWIN FALLS ID 833035059 have complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated May 21, 1992; and have submitted Proof of Beneficial Use on November 4, 1993. An examination indicates that the works have a diversion capacity of 0.32 cfs of water from:

GROUND WATER

and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL DIVERSION VOLUME</u>
STOCKWATER	01/01 to 12/31	0.26 CFS	58.1 AF
COMMERCIAL	01/01 to 12/31	0.26 CFS	58.1 AF

GROUND WATER NE¼NE¼ Sec. 33, Twp 8S, Rge 15E, B.M. GOODING County

PLACE OF USE: STOCKWATER

[illegible]

PLACE OF USE: COMMERCIAL

[illegible]

State of Idaho
Department of Water Resources
Water Right License

WATER RIGHT NO. 36-08661

CONDITIONS OF APPROVAL

1. The place of commercial use authorized by this approval includes land upon which wastewater may be applied for irrigation purposes to satisfy water quality requirements. Water diverted under this approval shall not be used for irrigation unless the water is first used in the dairy as authorized by this water right.
2. Commercial use is for a dairy.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. The water right confirmed by this license is subject to all prior water rights and shall be used in accordance with Idaho law and applicable rules of the Department of Water Resources.

Signed and sealed this 22nd day of March, 2002.

Acting for


Acting for **KARL J. DREHER**
Director

State of Idaho
Department of Water Resources
Water Right License

WATER RIGHT NO. 36-08661

Priority: May 21, 1992

Maximum Diversion Rate: 0.26 CFS
Maximum Diversion Volume: 42.6 AF

It is hereby certified that WILLIAM C STOUER
3507 S 2000 E
WENDELL ID 83355

And

NORTHWEST FARM CREDIT SERVICES ACA
1363 FILLMORE
PO BOX 5059
TWIN FALLS ID 833035059

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated May 21, 1992; and has submitted Proof of Beneficial Use on November 04, 1993. An examination indicates that the works have a diversion capacity of 0.32 cfs of water from:

SOURCE

GROUND WATER

and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL DIVERSION VOLUME</u>
STOCKWATER	01/01 to 12/31	0.26 CFS	42.6 AF
COMMERCIAL	01/01 to 12/31	0.26 CFS	42.6 AF

LOCATION OF POINT(S) OF DIVERSION:

GROUND WATER	NE 1/4 NE 1/4	Sec. 33, Twp 08S, Rge 15E, B.M.	GOODING County
GROUND WATER	NE 1/4 NE 1/4	Sec. 33, Twp 08S, Rge 15E, B.M.	GOODING County

PLACE OF USE: STOCKWATER

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
08S	15E	33	X																

PLACE OF USE: COMMERCIAL

Twp	Rge	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
08S	15E	33	X																

CONDITIONS OF APPROVAL

1. The place of commercial use authorized by this approval includes land upon which wastewater may be applied for irrigation purposes to satisfy water quality requirements. Water diverted under this approval shall not be used for irrigation unless the water is first used in the dairy as authorized by this water right.

State of Idaho
Department of Water Resources
Water Right License

WATER RIGHT NO. 36-08661

CONDITIONS OF APPROVAL

2. Commercial use is for a dairy.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. The water right confirmed by this license is subject to all prior water rights and shall be used in accordance with Idaho law and applicable rules of the Department of Water Resources.

Signed and sealed this 14th day of MARCH, 2002.

Acting for


KARL J. DREHER
Director

WATER RIGHT SUMMARY

ACTION	RIGHT NO.	NAME	AMOUNT CFS
~~Original Application~~	~~36-08661~~	~~William C Stouder~~	~~0.26~~
Full Assignment	36-08661	William C Stouder & Northwest Farm Credit Services, ACA	0.26

RECORDED
APR 13 1995

RECEIVED

MAR 09 1995

Department of Water Resources
Southern RegionState of Idaho
DEPARTMENT OF WATER RESOURCES

ASSIGNMENT OF PERMIT

To change the ownership of a permit

OFFICE USE ONLY

Amt. of Fee \$25.00

Date 3-9-95

Receipt No. 5017847

Receipt by MTS

I, WILLIAM C. STODER, hereby assign to WILLIAM C. STODER and NORTHWEST FARM CREDIT SERVICES, ACA
(Permit Holder)
 of 3485 S 2000 E, Wendell ID 83355
(Full Address)


All my right, title, and interest in and to Permit No. 36-08661
 to appropriate the public waters of the State of Idaho.

OR (for partial assignments)

The following described portion of my right, title, and interest in and to
 Permit No. _____ to appropriate the public waters of the State of Idaho.

Describe portion of the permit assigned listing the number of acres in each 40 acre subdivision,
 point of diversion location, and the amount of water in cubic feet per second.

Made this 7 day of March, 19 95.


 Permit Holder(s)

State of Idaho)
 County of GOODING)
 ss


RECEIVED

MAR 10 1995

Department of Water Resources

On this 7th day of MARCH, 1995, personally appeared before me
 the signer of the above instrument, duly acknowledged to me that he/she/they executed the same.

SEAL


 Notary Public


 Signature

My commission expires: 12/8/2000

database updated 3/28/95 cz

RECEIVED

NOV 04 1993

Department of Water Resources

OFFICE USE ONLY

Amt. of Fee \$ 100.00

Date 11-5-93

Receipt No. CO28946

Receipt by JW

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 36-08661 Telephone No. 208-536-6592

2. Name(s) of Permit Holder(s): William C. Stander

3. Mailing Address: 3507 S. 2000 E. Wendell, ID 83355

4. Source of Water: Groundwater

If GROUNDWATER, Well Driller's Name: Eaton Drilling, Wendell Date Drilled: 6-13-83

OPTIONAL:

Pump horsepower: 2-5HP Pressure (psi): 40 Dynamic pumping level (ft.): 100 ft.

5. Extent of Use (as authorized by the permit):

Domestic 1 (No. of households) Stockwater Dairy Cattle - 600 Adults (No. and type of stock)

Irrigation 0 (No. of acres) Other plus young stock

6. Total rate and/or volume for which proof is submitted 0.26 cfs OR 0.5 acre/feet (each well 70 GPM)

7. Refer to the approval conditions on your permit and respond accordingly:

Measuring device: Required? Yes No Installed? Yes No

Flow Measurement Port: Required? Yes No Installed? Yes No OR Not required as per conversation with Agent - Jim Stettin

8. Fee Enclosed: \$ 100 (See License Fee Schedule on back of Instruction Sheet)

9. Person to contact to accompany the Department representative during field examination of the water system.

Bruce Stander 208-536-2086 or 208-536-6592
Name Telephone No.

3507 S. 2000 E. Wendell, ID 83355
Address

10. The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

MICROFILMED

DEC 01 1993

11-2-93
Date

[Signature]
Signature (and title, if on behalf of a company or organization)

State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 36-08661

Proposed Priority: May 21, 1992 Maximum Diversion Rate: 0.26 CFS
This is to certify, that WILLIAM C STODER

3507 S 2000 E
WENDELL ID 83355

has applied for a permit to appropriate water from: GROUNDWATER
and a permit is APPROVED for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
STOCKWATER	01/01 to 12/31	0.26 CFS
COMMERCIAL	01/01 to 12/31	0.26 CFS
	Totals	0.26 CFS

LOCATION OF POINT(S) OF DIVERSION: NENENE, Sec. 33, Township 08S, Range 15E
GOODING County

PLACE OF USE: STOCKWATER
TWN RGE SEC

08S 15E 33 NENE

PLACE OF USE: COMMERCIAL, same as STOCKWATER use

CONDITIONS/REMARKS:

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before December 1, 1993.
2. Subject to all prior water rights.
3. A flow measurement port or other device as specified by the Department shall be installed by the right holder to provide for the installation of measuring equipment and the determination of the rate of diversion by the Department.
4. Two points of diversion are located within NENENE, S33, T08S, R15E.
5. Commercial use is for a dairy.
6. Stockwater use is for 1040 dairy cattle.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the signature of the Director, affixed at Boise, this

16th day of November, 1992

[Signature]
for R. Keith Higginson, Director

MICROFILMED

DEC 08 1992

RECEIVED
Form 208
6/86

Ident. No. 36-08661

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

Department of Water Resources
Southern Region Office

To appropriate the public waters of the State of Idaho

1. Name of applicant William C. Stouder Phone (208) 536-2086

Post office address 3507 S. 2000 E., Wendell, ID 83355

2. Source of water supply ground water which is a tributary of N/A

3. Location of point of diversion is 2 points NE $\frac{1}{4}$ of NE $\frac{1}{4}$ of NE $\frac{1}{4}$, Govt. Lot _____

Sec. 33 Township 08S Range 15E B.M. Gooding County; additional

points of diversion if any: _____

4. Water will be used for the following purposes:

Amount .260 for Commercial purposes from 1/1 to 12/31 (both dates inclusive)
(cfs or acre-feet per annum)

Amount 0.26 for Stockwater purposes from 1/1 to 12/31 (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated is (a) .260 and/or (b) N/A
cubic feet per second acre feet per annum

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc. 2 HP pumps, 2 130' wells

b. Height of storage dam _____ feet; active reservoir capacity _____ acre-feet; total
reservoir capacity _____ acre-feet; period of year when water will be diverted to storage:
_____ to _____ inclusive.

c. ~~Proposed~~ well diameter is 6 5/8" inches; ~~proposed~~ depth of well is 130 feet.

d. Is ground water with a temperature of greater than 90°F being sought? No

7. Time required for the completion of the works and application of the water to the proposed beneficial use is

1 year years (minimum 1 year).

DEC 08 1992

8. Description of proposed uses (if irrigation only, go to item 9):

- Hydropower; show total feet of head and proposed capacity in KW. _____
- Stockwatering; list number and kind of livestock. 470 dairy cattle, 570 dry stock
- Municipal; show name of municipality. _____
- Domestic; show number of households. _____
- Other; describe fully. 380/Day/1/450/Day/Stock 470/1 Commercial use in dairy

9. Description of place of use:

- If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- If water is used for other purposes, place a symbol of the use (example: *D* for *Domestic*) in the corresponding place of use below. See instructions for standard symbols.

TWP	RANGE	SEC.	NE¼				NW¼				SW¼				SE¼				TOTALS
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	
08S	15E	33	S C																

S = Stockwater, C = Commercial Use

Total number of acres to be irrigated N/A

10. Describe any other water rights used for the same purposes as described above. _____

.060 for domestic use to 2 homes

11. a. Who owns the property at the point of diversion? William C. Stouder

b. Who owns the land to be irrigated or place of use? William C. Stouder

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing. N/A

12. Remarks: These wells have been in use for 9 years under mistaken belief that the proper application had been made. Well drillers reports for each well is attached.

MICROFILMED

DEC 08 1992

36-740

20 21 22

VABM 3412

23 24 25

33 34 35 36 37 38

DEC 08 1992

GOODING CO WYOMING CO

Well 3356

36-08661

20

21

22

VABM

3412

DEC 08 1992

Well -
3.356


GOODWIN & CO
BURLINGTON CO

NAGAR

36-08661


36-8661

13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

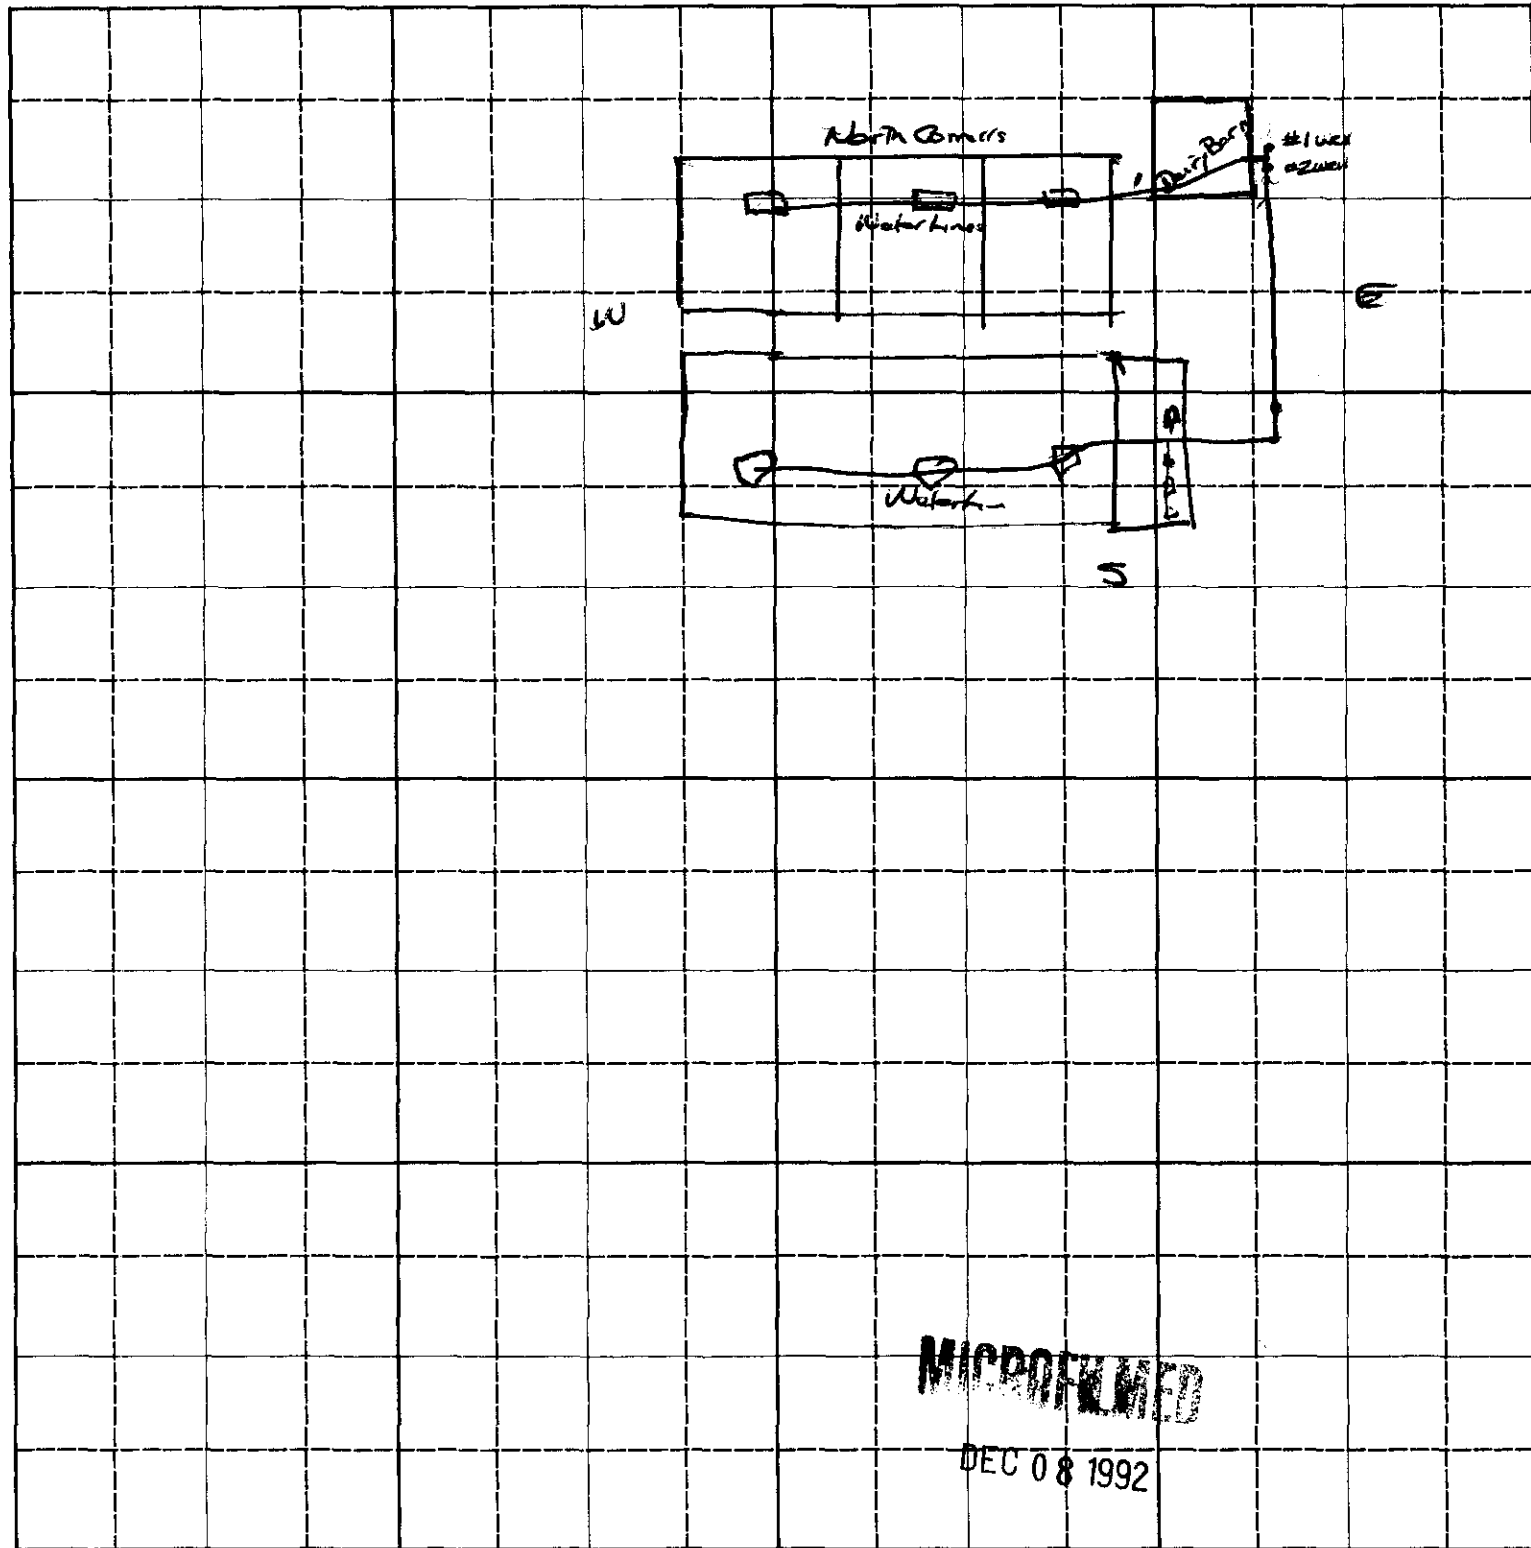

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.



(Applicant)

Received by RF Date 5-21-92 Time 10:30 Preliminary check by ~~MTS~~ J
Fee \$ 45.00 Received by MTS # 5014504 Date 5-21-92
Publication prepared by MB Date 8-17-92 Published in Leading Co. Leader
Publication approved MBaldwin Date 9/23/92

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. _____, and said application is hereby _____.

1. Approval of said application is subject to the following limitations and conditions:

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
- b. Proof of construction of works and application of water to beneficial use shall be submitted on or before _____, 19 ____.
- c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.
- d. The water right acquired under this permit if for hydropower purposes shall be junior and subordinate to all rights to the use of water, other than hydropower, within the State of Idaho that are initiated later in time than the priority of this permit and shall not give rise to any right or claim against any future rights to the use of water, other than hydropower, within the State of Idaho initiated later in time than the priority of this permit.
- e. Other:

MICROFILMED

DEC 08 1992

AFFIDAVIT of PUBLICATION

RECEIVED

State of Idaho }
County of Gooding } ss.

SEP 14 1992

Department of Water Resources
Southern Region Office

Patty Nance, being first duly sworn, deposes and says that she is the printer (publisher) of the Gooding County Leader, a newspaper published every week in Gooding, County of Gooding, State of Idaho; that said newspaper has been continuously and uninterruptedly published for a period of seventy-eight consecutive weeks prior to the first publication of the annexed notice, and is a newspaper qualified to publish legal notices as provided by act of the 1919 session of the legislature of the State of Idaho, known as House Bill 145; that the annexed advertisement was published once each week for

2 consecutive issues in said newspaper proper and not in a supplement; that the date of the first publication of said advertisement was on the 3 day of Sept., 1992, and the date of the last publication was on the 9 day of Sept., 1992.

Subscribed and sworn to before me this 9th day of September, 1992.
(SEAL)

Norma DeVoe
NOTARY PUBLIC

GOODING COUNTY LEADER
Gooding, Idaho

COST OF PUBLICATION

Number of Picas per Line _____
Number of Lines in Notice _____
Number of Insertions _____

Lines tabular at _____ 6¢/Pica
345 Lines straight at 17.25 5¢/Pica
345 Subsequent lines at 13.80 4¢/Pica
TOTAL COST 31.05

COPY OF NOTICE

(Paste Here)

Water Rf. #36-08661
TITLE OF NOTICE

PLAINTIFF ATTORNEY

DEFENDANT

PLAINTIFF

BILL TO

IDWR

STANDARD BILLING
3600 E. 200 N.
WILSON, IDAHO
SOUTH SOUTHWEST CORNER
Intersection of Highway 33 & T
OSS RISE 333 GOODING County.
Use: STOCKWATER (.260
CFS)
COMMERCIAL (.260 CFS)
Total Diversion: (.260 CFS)
Date Filed: 5/21/1992
In: GOODING County
TOSS RISE 333 NINE

The permit(s) will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code under the new public interest criteria of Sec. 42-203C, Idaho Code. Protests must be filed with the Director, Dept. of Water Resources, 227 Shoshone Street East, Twin Falls, ID 83301 on or before SEPTEMBER 21, 1992.
S/R. Kafa Higgins, Director
IDWR 1992
Public Notice

DEC 08 1992

No 5456

#13534



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Boise, ID 83706 - P.O. Box 83720, Boise, ID 83720-0098
Phone: (208) 327-7900 Fax: (208) 327-7866 Web Site: www.idwr.state.id.us

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

March 22, 2002

WILLIAM C STOUDER
3507 S 2000 E
WENDELL ID 83355

RE: Water Right License 36-8661

Dear Mr. Stouder:

The Department of Water Resources (IDWR) has issued the enclosed amended Water Right License for Water Right 36-8661. The amended license is issued pursuant to Rule 730.02.c of IDWR's Rules of Procedure (IDAPA 37.01.01), which authorizes IDWR to review a preliminary order on its own motion. The amended license is an **amended preliminary order** issued by the Department pursuant to §67-5243, *Idaho Code*. It supersedes the Water Right License issued on March 14, 2002. **The preliminary order can and will become a final order without further action of the Department unless a party petitions for reconsideration or files an exception and/or brief as further described in the enclosed information sheet.**

If you have questions, please contact me at (208) 327-7946.

Sincerely,

Shelley W. Keen
Water Rights Supervisor

Enclosure

Cc: Northwest Farm Credit Services ACA

MICROFILMED
APR 23 2002


CERTIFICATE OF SERVICE

I hereby certify that on **March 25, 2002**, I mailed a true and correct copy, certified, postage prepaid, of the foregoing **AMENDED PRELIMINARY ORDER** to the person(s) listed below:

RE: Water Right License 36-8661

**WILLIAM C STOUDE
3507 S 2000 E
WENDELL ID 83355**

**NORTHWEST FARM CREDIT SERVICES ACA
PO BOX 5059
TWIN FALLS ID 83303-5059**

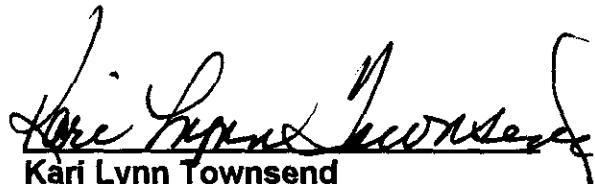
**Kari Lynn Townsend
Secretary**

**MICROFILMED
APR 23 2002**

**EXPLANATORY INFORMATION
TO ACCOMPANY A
PRELIMINARY ORDER**

The accompanying order or approved document is a "Preliminary Order" issued by the department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department of Water Resources (department) unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the department or the Idaho Water Resource Board (Board) is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01303 (Rules of Procedure 302 and 303).

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

MEMORANDUM

DATE: March 22, 2002

TO: Water Right File 36-8661

FROM: Shelley W. Keen ^{SLK}

RE: Adjustment to the annual volume

A few days ago Bill Stouder called to discuss the annual volume limit listed on the license issued March 14, 2002, for water right 36-8661. He felt the volume was too low. Because Mr. Stouder's permit listed 1040 dairy cattle, which can be interpreted to mean 1040 "milking" cattle, the volume was re-calculated to reflect his herd of 750 milking cattle. It also reflects the part of his replacement herd that would be equivalent in watering needs to 290 milking cattle. Based on these calculations, the correct annual volume limit is 58.1 af.

FILE NUMBER 38-8681
REVIEWER SRC
DATE March 18, 2002

DAIRIES: WATER USE WORKSHEET

THEORETICAL FLOW ESTIMATION WORKSHEET

REQUIRED DAIRY DATA

NUMBER OF MILKING CATTLE 1040
NUMBER OF DRY CATTLE
NUMBER OF REPLACEMENT CATTLE: 0-2 MONTHS
3-4 MONTHS
5-8 MONTHS
9-12 MONTHS
13-15 MONTHS
16-24 MONTHS
ENTER 1 FOR MANUAL COW WASHING, 2 FOR AUTOMATIC COW WASHING,
OR 3 IF SPRINKLERS ARE USED TO FLUSH HOLDING PEN AND WASH COWS 3
IF SPRINKLERS ARE USED: NUMBER OF SPRINKLERS IN HOLDING PEN 100
NOZZLE DISCHARGE (USE 5.0 GPM IF UNKNOWN) 5.00
TOTAL OPERATION TIME OF SPRINKLERS (MIN/DAY) 20
NUMBER OF MILKINGS PER DAY 2
AVG. LBS. OF MILK PRODUCED PER DAY PER ANIMAL (IDAHO AVG IS 70 LBS.) 70
ARE THERE SEPARATE PUMPS FOR COMMERCIAL AND STOCKWATER USES? N
IF SO: HOW MANY HOURS PER DAY DOES THE STOCKWATER PUMP RUN?
HOW MANY HOURS PER DAY DOES THE COMMERCIAL PUMP RUN?
IF ONLY ONE PUMP, HOW MANY TOTAL HOURS PER DAY DOES IT RUN? 12.0
IS A PLATE COOLER USED? Y
IS PLATE COOLER WATER LATER RECYCLED FOR OTHER USES? (IF NO PLATE
COOLER, LEAVE BLANK) N
ARE CORRAL MISTERS USED IN HOLDING PEN? Y
IF USING CORRAL MISTERS: NUMBER OF MISTERS (IF UNKNOWN,
ASSUME 1 MISTER FOR EVERY 5 COWS) 150
NOZZLE DISCHARGE (USE 5 GPM IF UNKNOWN) 5.00
SPRAY INTERVAL (EX - 2 MIN ON EVERY 5 MIN = 2/5) 2/5
OPERATION TIME OF MISTERS (HRS/DAY) 10
DAYS PER YEAR MISTERS ARE USED 45
ENTER A TOTAL VOLUME IN GPD FOR MISCELLANEOUS WATER USES NOT
INDIVIDUALLY CALCULATED BELOW (EX - RESTROOMS, WASHING MACHINES) 0

CALCULATIONS

DIVERSION RATE (CFS):

STOCKWATER
MILKING CATTLE (BASED ON MILK PRODUCTION) ****
DRY CATTLE @17.0 GPDMD ****
REPLACEMENT CATTLE ****
TOTAL 0.17

COMMERCIAL
TOTAL 0.17

TOTAL DIVERSION RATE 0.17

DIVERSION VOLUME (AFA):

STOCKWATER
MILKING CATTLE 33.5
DRY CATTLE 0.0
REPLACEMENT CATTLE 0.0
TOTAL 33.5

COMMERCIAL
WASHING OF BULK TANK AND RELATED EQUIPMENT 0.4
BACKFLUSH 1.2
PARLOR/MILKHOUSE/HOLDING PEN CLEANUP 2.0
CATTLE WASHING BASED UPON METHOD OF WASHING 11.2
PLATE COOLER 9.3
CORRAL MISTERS 0.4
MISCELLANEOUS USES 0.0
TOTAL 24.6

TOTAL DIVERSION VOLUME 58.1

CONSUMPTIVE USE VOLUME (AFA)(assuming 100% consumptive):

STOCKWATER 33.5
COMMERCIAL 24.6
TOTAL CONSUMPTIVE USE 58.1

REQUIRED PUMP INFORMATION

	PUMP 1	PUMP 2	PUMP 3	PUMP 4	PUMP 5
PUMP HORSEPOWER (HP)	5.00	5.00	0.00	0.00	0.00
PUMP EFFICIENCY (%)	70	70	70	70	70
LIFT (FT)	100	100	0	0	0
DISCHARGE PRESSURE (PSI)	40	40	0	0	0
FRICTION LOSSES (FT)			0.0	0.0	0.0
HOURS PER DAY PUMP OPERATES	12.0	12.0	0.0	0.0	0.0

CALCULATIONS

THEORETICAL FLOW RATE (CFS) *	0.16	0.16	0.00	0.00	0.00
DIVERSION VOLUME (AFA) **	57.9	57.9	0.0	0.0	0.0

* IF PUMP EFFICIENCY IS UNKNOWN, 70% MAY BE ASSUMED.

** DIVERSION VOLUME IS THE ABSOLUTE MAXIMUM VOLUME BASED ON THE
THEORETICAL FLOW RATE ASSUMING PUMP RUNS EVERY DAY OF THE YEAR.

536-6592 Home office
Bill Stouder
cell 280-1601

MICROFILMED
APR 23 2002



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Boise, ID 83706 - P.O. Box 83720, Boise, ID 83720-0098
Phone: (208) 327-7900 Fax: (208) 327-7866 Web Site: www.idwr.state.id.us

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

March 15, 2002

WILLIAM C STOUDE
3507 S 2000 E
WENDELL ID 83355

NORTHWEST FARM CREDIT SERVICES FLCA
PO BOX 5059
TWIN FALLS ID 83303-5059

RE: License No. 36-8661 - Issuance of License

Dear Water Right Holder(s):

The Department of Water Resources has issued the enclosed Water Right License confirming that a water right has been established in accordance with your permit. Please be sure to thoroughly review the conditions of approval and remarks listed on your license.

The license is a PRELIMINARY ORDER issued by the Department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action by the Department unless a party petitions for reconsideration or files an exception and/or brief within fourteen (14) days of the service date as described in the enclosed information sheet.

Please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Failure to report these changes could result in a \$100 late filing fee. Contact any office of the Department or visit the Department's homepage on the Internet to obtain the proper forms and instructions.

If you have any questions, please contact me at 208-327-7946.

Sincerely,

Shelley W. Keen
Water Rights Supervisor

SWK:klt

Enclosure(s)

MICROFILMED

APR 23 2002


CERTIFICATE OF SERVICE

I hereby certify that on March 15, 2002 I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER(Approved License) to the person(s) listed below:

RE: WATER RIGHT NO. 36-8661

**WILLIAM C STOUDER
3507 S 2000 E
WENDELL ID 83355**

**NORTHWEST FARM CREDIT SERVICES ACA
PO BOX 5059
TWIN FALLS ID 83303-5059**

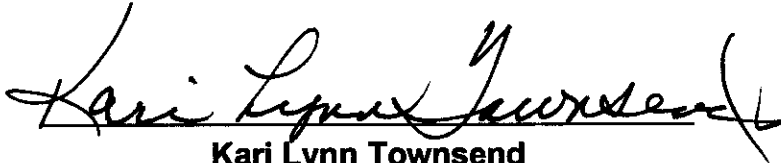
**Kari Lynn Townsend
Secretary**

MICROFILMED

APR 23 2002

**EXPLANATORY INFORMATION
TO ACCOMPANY A
PRELIMINARY ORDER**

The accompanying order or approved document is a "Preliminary Order" issued by the department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department of Water Resources (department) unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the department or the Idaho Water Resource Board (Board) is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01303 (Rules of Procedure 302 and 303).

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

MICROFILMED
APR 23 2002

Stouder Holsteins
3507 S. 2000 E.
WENDELL, ID 8335

RECEIVED

MAR 13 2002

Department of Water Resources

March 8, 2002

Dept. of Water Resource
Attn. Ms. Sharla Curtis
1301 North Orchard St.
Boise, ID 83706

Dear Ms. Curtis:

RE: Permit No. 36-8661

Waste water from our lagoon irrigates two forty acres parcels. Their legal descriptions are: Township 8 South; Range 15, East Boise Meridian, Gooding County, Section 33; NW $\frac{1}{4}$ NE $\frac{1}{4}$ and NE $\frac{1}{4}$ NE $\frac{1}{4}$.

I hope this information helps you and I anticipate the licensing of this permit in the near future.

Thank you very much.

Sincerely,



William C. Stouder, DVM
Partner, Stouder Holsteins

MICROFILMED

APR 23 2002

MEMORANDUM

To: File 36-8661

From: Sharla

Date 3/6/2002

Re: Stockwater Use, Misc Info

Stockwater use is for 470 dairy cattle and 570 dry cattle as listed in the application for permit. The permit listed 1040 dairy cattle; the reviewer erroneously added the dairy and dry cattle together and simply called them all dairy cattle.

The license is limited to the original application figures and the volume has been calculated accordingly. This figure closely matches the volume measured by the water measurement district in 1996 when the two wells shared the same meter. The measurements started to rise the following year and from the time that separate meters were installed in the two wells, the figures far exceed the volume to be licensed and the reason for this is undoubtedly the increase in the number of cattle beyond what the water user has covered by his water right.

MICROFILMED
APR 23 2002

FILE NUMBER 36-8861
REVIEWER SRC
DATE March 8, 2002

DAIRIES: WATER USE WORKSHEET

THEORETICAL FLOW ESTIMATION WORKSHEET

REQUIRED DAIRY DATA

NUMBER OF MILKING CATTLE 470
NUMBER OF DRY CATTLE 570
NUMBER OF REPLACEMENT CATTLE: 0-2 MONTHS
3-4 MONTHS
5-8 MONTHS
9-12 MONTHS
13-15 MONTHS
16-24 MONTHS
ENTER 1 FOR MANUAL COW WASHING, 2 FOR AUTOMATIC COW WASHING,
OR 3 IF SPRINKLERS ARE USED TO FLUSH HOLDING PEN AND WASH COWS 3
IF SPRINKLERS ARE USED: NUMBER OF SPRINKLERS IN HOLDING PEN 100
NOZZLE DISCHARGE (USE 5.0 GPM IF UNKNOWN) 5.00
TOTAL OPERATION TIME OF SPRINKLERS (MIN/DAY) 20
NUMBER OF MILKINGS PER DAY 2
AVG. LBS. OF MILK PRODUCED PER DAY PER ANIMAL (IDAHO AVG IS 70 LBS.) 70
ARE THERE SEPARATE PUMPS FOR COMMERCIAL AND STOCKWATER USES? N
IF SO: HOW MANY HOURS PER DAY DOES THE STOCKWATER PUMP RUN?
HOW MANY HOURS PER DAY DOES THE COMMERCIAL PUMP RUN?
IF ONLY ONE PUMP, HOW MANY TOTAL HOURS PER DAY DOES IT RUN? 12.0
IS A PLATE COOLER USED? Y
IS PLATE COOLER WATER LATER RECYCLED FOR OTHER USES? (IF NO PLATE
COOLER, LEAVE BLANK) N
ARE CORRAL MISTERS USED IN HOLDING PEN? Y
IF USING CORRAL MISTERS: NUMBER OF MISTERS (IF UNKNOWN,
ASSUME 1 MISTER FOR EVERY 5 COWS) 150
NOZZLE DISCHARGE (USE 5 GPM IF UNKNOWN) 5.00
SPRAY INTERVAL (EX - 2 MIN ON EVERY 5 MIN = 2/5) 2/5
OPERATION TIME OF MISTERS (HRS/DAY) 10
DAYS PER YEAR MISTERS ARE USED 45
ENTER A TOTAL VOLUME IN GPD FOR MISCELLANEOUS WATER USES NOT
INDIVIDUALLY CALCULATED BELOW (EX - RESTROOMS, WASHING MACHINES) 0

CALCULATIONS

DIVERSION RATE (CF8):

STOCKWATER
MILKING CATTLE (BASED ON MILK PRODUCTION) ****
DRY CATTLE @17.0 GPD/HD ****
REPLACEMENT CATTLE ****
TOTAL 8.13
COMMERCIAL
TOTAL 0.13
TOTAL DIVERSION RATE 0.13

DIVERSION VOLUME (AFA):

STOCKWATER
MILKING CATTLE 15.2
DRY CATTLE 8.8
REPLACEMENT CATTLE 0.0
TOTAL 23.8
COMMERCIAL
WASHING OF BULK TANK AND RELATED EQUIPMENT 0.4
BACKFLUSH 0.5
PARLOR/MILKHOUSE/HOLDING PEN CLEANUP 2.0
CATTLE WASHING BASED UPON METHOD OF WASHING 11.2
PLATE COOLER 4.2
CORRAL MISTERS 0.4
MISCELLANEOUS USES 0.0
TOTAL 18.8
TOTAL DIVERSION VOLUME 42.6

CONSUMPTIVE USE VOLUME (AFA)(assuming 100% consumptive):

STOCKWATER 23.8
COMMERCIAL 18.8
TOTAL CONSUMPTIVE USE 42.6

REQUIRED PUMP INFORMATION

	PUMP 1	PUMP 2	PUMP 3	PUMP 4	PUMP 5
PUMP HORSEPOWER (HP)	5.00	5.00	0.00	0.00	0.00
PUMP EFFICIENCY (%)	70	70	70	70	70
LIFT (FT)	100	100	0	0	0
DISCHARGE PRESSURE (PSI)	40	40	0	0	0
FRICTION LOSSES (FT)			0.0	0.0	0.0
HOURS PER DAY PUMP OPERATES	12.0	12.0	0.0	0.0	0.0

CALCULATIONS

THEORETICAL FLOW RATE (CFS) *	0.16	0.16	0.00	0.00	0.00
DIVERSION VOLUME (AFA) **	57.9	57.9	0.0	0.0	0.0

* IF PUMP EFFICIENCY IS UNKNOWN, 70% MAY BE ASSUMED.

** DIVERSION VOLUME IS THE ABSOLUTE MAXIMUM VOLUME BASED ON THE
THEORETICAL FLOW RATE ASSUMING PUMP RUNS EVERY DAY OF THE YEAR.

Use 26 as permitted

MICROFILMED
APR 23 2002

LICENSE REVIEW CHECKLIST

Reviewed by Sharla Curtis on

Permit No. 36-8661

BU Fee Pd \$ 100.00

Name/Address: ☒ OK ☐ CHANGE

Govt Lots ☐ n/a ☐ plat copy attached

AREA OF CONCERN: No/Yes ESPA Moratorium ☐ GWMA TRUST/NON-TRUST

GROUNDWATER: (✓Flow Chart)

Supp irr (irr = only use) - 065-104
Supp irr (+ other uses) - 100-105
≤ 0.24 cfs/5 acres - No MD
> 0.24 cfs/5 acres - 01M (if on permit)

LOCATION:

Trust ☒ - R55(consumptive uses)
Non-Trust ☐ - 048

SURFACE WATER: (✓Flow Chart)

In/Above MSF - WB9
WD - R04 (WD#)
≤ 0.20 cfs/others - R02- 01P or No MD
> 0.20 cfs - R43

SPRINGS/SINK, INACTIVE WD & REST OF STATE

≤ 0.24 cfs/5 acres - No MD
> 0.24 cfs/5 acres - 01M or No MD

RIVER BASINS: (SW special considerations)

SNAKE R (01) - W22, N/A
(02,03) - WB9 if above Weiser
Payette R (65) - 047(Payette Lake)
Salmon R (70's) - 029 (fish screens)
Weiser R (67) - 086-087

USES:

STORAGE - 18A-R02-01P-18B-NA
IRR ≤ 5 ac - R66/R67/R68/R69 (0.03 cfs/ac)
> 5 ac - R62/R63/R64/R65 (0.02 cfs/ac)
STOCKWATER - R37 (BLM/USFS) NA
MINING - 106
FISH PROP - 029(70's only)-042-106
HEAT/COOL - R07(injection well)
FIRE PROT. - 077

C/dairy

USES:

POWER - R22-R23 (+uses)-025-106-W42-W43-027
MUNICIPAL
Restricted area - 022,075
Irr., GW supp to SW - 102
DOMESTIC
Surface water - WB5 (Big Wood or Boise above Star Bridge)
27A (Payette R)
>1 in restricted area - 070-071-075(no parks/common areas, etc)
Irr use listed separate - WB5
Lawn/garden included - W01

ADVANCE PRIORITY? ☐ Yes ☒ No

MISC CONDITIONS/REMARKS:

Multiple pd's per ¼/4 - W32
Subd lot desc (pd) - W59
Subd lot desc (pu) - W60
Use definitions - W02 example - *C/tire shop*
Non-consumptive - 027
Water Quality - 106-R07
Mitigation - 121 (if on permit)
PPU acre limit - W27

*470
750 dairy
5/10/10
200 dry
1247
570*

OVERLAP ANALYSIS/RATES/VOLUMES:

PD overlap rights - W35-W36 Right #
PU overlap rights - WB7-W31(<1 ac)
GW replaced SW - 050

Permit Rate .26 cfs Fee Limit cfs
Measured cfs Theoretical .32 cfs

Use	Rate	Volume
Stock	.16 cfs	13.0 af
Comm.	.16 cfs	21.6 af
	cfs	af
TOTALS	<u>.32</u> cfs	<u>34.6</u> af

CHECK NEW IRR SEASON MAP ☐

OTHER CONDITIONS/REMARKS/COMMENTS

SRBA Claim Filed ☐ Yes ☒ No

If no, is a claim required: ☐ Yes ☒ No

AMENDMENTS REQUIRED ☐ Yes ☒ No

WMD

POD Data

08S 15E 33 NENENE

Legal Description	GPS Site ID	Diversion Name	Meas Option	POD
08S 15E 33 NENENE	A0002869	SOUTH WELL		401884
Latitude 042:41:43.117		Longitude -114:41:39.047	GPS File R121822A	
Comments HAS ITS OWN METER 2/11/99		Flowmeter (8)		

Flowmeter Data

Year	Date	Calibration Factor	Max CFS	Adj Max CFS	Acre-Ft	Adj Acre-Ft	Acre-Ft Qualif	Valid	Prefrd
2000	11/30/2000	0.94			53.12	49.93	MR	☐	☐
Comments									
1999	12/18/1997	0.96	0.16	0.15	41.26	39.61	MR	☐	☐
Comments IDWR audit 1-5-00 read 200940 @54 gpm. (GPM 2-3-00)									
1998	12/18/1997	0.96	0.16	0	65.8	63.2	MR	☐	☐
Comments NOW HAS ITS OWN METER, NO SHARING WITH THE NORTH WELL 2/11/99									

Flowmeter Calibration

Calibration Date: 11/30/2000 Calibration Factor: 0.94

401884

Installed Meter	Standard Meter	Other well(s):
Meter Type: IMPELLER	Pipe Material: STEEL	
Manufacturer: GRAINLAND AQUAMASTER	Outside Diameter: 2.4	Other meter(s): ☐
Model: 400B	Wall Thickness: 0.144	Comments:
Serial Number: 17114	Upstream Straight: 3	I went out and ran the field exam on this but it came out to be high, so I am planning on returning to make some adjustments and finish the exam.. (CRK-12-1-2000) Done 12-14-00
Rate Units: GPM	Downstream Straight: 1	
Rate Multiplier: 1	Meter Type: SONIC	
Volume Units: AF	Measured Flow Units: GPM	
Volume Multiplier: 0.001	Measured Flow: 42.7	
Location: FAIR	Confidence: FAIR	
Indicated Flow: 45.6		

Changed: 7/17/2001

Calibration Date: 12/18/1997 Calibration Factor: 0.96

401884

Installed Meter	Standard Meter	Other well(s):
Meter Type: IMPELLER	Pipe Material:	
Manufacturer: GRAINLAND AQUAMASTER	Outside Diameter:	Other meter(s): ☐
Model: 400B	Wall Thickness:	Comments:
Serial Number: 17114	Upstream Straight:	
Rate Units: GPM	Downstream Straight:	
Rate Multiplier: 1	Meter Type:	
Volume Units: AF	Measured Flow Units:	
Volume Multiplier: 0.001	Measured Flow:	
Location: FAIR	Confidence:	
Indicated Flow:		

Changed:

Legal Description	GPS Site ID	Diversion Name	Meas Option	POD
-------------------	-------------	----------------	----------------	-----

Site Visits

Site Visit Date	Site Examiner	Reason	Change Date:
12/18/1997	DNELSON	Inventory	

Notes:

WMD

POD Data

08S 15E 33 NENENE

Legal Description	GPS Site ID	Diversion Name	Meas Option	POD
08S 15E 33 NENENE	A0002866	NORTH WELL		400547
Latitude 042:41:43.598 Longitude -114:41:38.693 GPS File R121821A Flowmeter (8)				
Comments SHARE FLOW METER - READINGS REPORTED ON THIS WELL DAN 4-2-98. REPORTED BY OWNER THERE ARE TWO(2) SEPARATE METERS NOW. (gpm 1-31-00).				

Flowmeter Data

Year	Date	Calibration Factor	Max CFS	Adj Max CFS	Acre-Ft	Adj Acre-Ft	Acre-Ft Qualif	Valid	Prefrd
2000	11/30/2000	0.96			72.88	69.96	MR	☐	☐
	Comments						1 well		
1999	12/31/1999	0.96	0.13	0.12	68.79	66.04	MR	☐	☐
	Comments	meter needs calibration. (gpm 1-31-00) IDWR audit 1-5-00 read 209551x100 (GPM 2-3-)							
1998	12/18/1997	0.96	0.1	0	19.9	19.1	MR	☐	☐
	Comments	INSTALLED A METER ON BOTH WELLS ABW 2/11/99							
1997	12/18/1997	0.96	0.25	0.24	89.3	85.7	MR	☐	☐
	Comments	METER READINGS LOOK ACCEPTABLE							
1996	12/18/1997	0.96	0	0	64.3	64.3	MR	☐	☐
	Comments	single meter 2 wells							
1995	12/18/1997	0.96	0	0	539.1	539.1	FE	☐	☐
	Comments								

Flowmeter Calibration

Calibration Date: 11/30/2000 Calibration Factor: 0.96

400547

Installed Meter	Standard Meter	Other well(s):
Meter Type: IMPELLER	Pipe Material: STEEL	
Manufacturer: MASTERMETER	Outside Diameter: 2.4	Other meter(s): ☐
Model: MM6T-01	Wall Thickness: 0.133	Comments:
Serial Number:	Upstream Straight: 3	This well now has its own meter.
Rate Units: GPM	Downstream Straight: 0	
Rate Multiplier: 1	Meter Type: SONIC	
Volume Units: GAL	Measured Flow Units: GPM	
Volume Multiplier: 100	Measured Flow: 45.5	
Location: FAIR	Confidence: GOOD	
Indicated Flow: 47.34		

Changed: 1/18/2001

Calibration Date: 12/31/1999 Calibration Factor: 0.96

400547

Legal Description	GPS Site ID	Diversion Name	Meas Option	POD
Installed Meter Meter Type: IMPELLER Manufacturer: MASTERMETER Model: MM6T-01 Serial Number: Rate Units: GPM Rate Multiplier: 1 Volume Units: GAL Volume Multiplier: 100 Location: FAIR Indicated Flow: 		Standard Meter Pipe Material: Outside Diameter: Wall Thickness: Upstream Straight: Downstream Straight: Meter Type: Measured Flow Units: Measured Flow: Confidence: 		Other well(s): Other meter(s): Comments: meter not calibrated!!! These are the units and multiplier received from the 1999 report. (gpm,1-31-00) This has been calibrated look on the second record under this section. (crk,12/1/00) Changed: 12/1/2000

Site Visits

Site Visit Date	Site Examiner	Reason	Change Date:
11/30/2000	CKNOWLES	Flowmeter Calibration	12/1/2000
Notes: This well previously was metered by an aquamaster which took care of both wells. They have changed that and installed a master meter for the north well. This checked out fairly well and looks like it is doing the job.			
12/18/1997	DNELSON	Flowmeter Calibration	
Notes: THIS SYSTEM HAD 2 WELLS AND ONE METER BUT IN SEPT 1998, MR i STOUARD INSTALLED A METER ON BOTH WELLS SO EACH CAN BE MEASURED i INDEPENDTLY. ARNIE 2/11/99			

in 30 days after the completion or abandonment of the well.

5 S. 42 West 1/4 Sec. 32 T. 8 N. R. 15 E. M.

1. WELL OWNER
Name William S. Kunkle
Address NT, Woodville, IL
Owner's Permit No. (well #2)

2. NATURE OF WORK
☒ New well ☐ Deepened ☐ Replacement
☐ Abandoned (describe abandonment procedures such as materials, plug depths, etc. in lithologic log)

3. PROPOSED USE
☒ Domestic ☐ Irrigation ☐ Test ☐ Municipal
☐ Industrial ☐ Stock ☐ Waste Disposal or Injection
☒ Other Dairy (specify type)

4. METHOD DRILLED
☒ Rotary ☒ Air ☐ Hydraulic ☐ Reverse rotary
☐ Cable ☐ Dug ☐ Other

5. WELL CONSTRUCTION
Casing schedule: ☐ Steel ☐ Concrete ☐ Other
Thickness 1/2 inches 6 1/2 inches + 7 feet 14 feet
Diameter 6 1/2 inches 6 1/2 inches 6 1/2 inches 6 1/2 inches
From 0 feet 14 feet
To 14 feet 14 feet
Was casing drive shoe used? ☐ Yes ☒ No
Was a packer or seal used? ☐ Yes ☒ No
Perforated? ☐ Yes ☒ No
How perforated? ☐ Factory ☐ Knife ☐ Torch
Size of perforation _____ inches by _____ inches
Number _____ From _____ To _____
_____ perforations _____ feet _____ feet
_____ perforations _____ feet _____ feet
_____ perforations _____ feet _____ feet
Well screen installed? ☐ Yes ☒ No
Manufacturer's name _____
Type _____ Model No. _____
Diameter _____ Slot size _____ Set from _____ feet to _____ feet
Diameter _____ Slot size _____ Set from _____ feet to _____ feet
Gravel packed? ☐ Yes ☐ No ☐ Size of gravel _____
Placed from _____ feet to _____ feet
Surface seal depth 14 Material used in seal: ☐ Cement grout
☐ Bentonite ☒ Pudding clay ☒ Surface
Sealing procedure used: ☐ Slurry pit ☐ Temp. surface casing
☒ Overbore to seal depth
Method of joining casing: ☐ Threaded ☐ Welded ☐ Solvent
Weld
☐ Cemented between strata
Describe access port Sanitary well cap
5' Top Soil to be placed in after drilling

6. LOCATION OF WELL
Sketch map location must agree with written location.
N
W 33 E
S
County Carroll
Subdivision Name _____
Lot No. _____ Block No. _____
NE 1/4 NE 1/4 Sec. 32 T. 8 N. R. 15 E. M.

7. WATER LEVEL
Static water level 78 feet below land surface.
Flowing? ☐ Yes ☒ No G.P.M. flow _____
Artesian closed-in pressure _____ p.s.i.
Controlled by: ☐ Valve ☐ Cap ☐ Plug
Temperature _____ °F. Quality _____
Describe artesian or temperature zones below.

8. WELL TEST DATA
☐ Pump ☐ Bailor ☐ Air ☐ Other
NOT TESTED
Discharge G.P.M. _____ Pumping Level _____ Hours Pumped _____

9. LITHOLOGIC LOG
Bore Diam. Depth Material Water Yes No
0 6 Top Soil ✓
6 15 Gravel & sand ✓
15 19 Red clay ✓
19 23 " " ✓
23 47 Gravel & sand (lost cuttings) ✓
47 130 ? ✓

10. Work started May 22, 83 finished May 22, 83

11. DRILLERS CERTIFICATION
I/We certify that all minimum well construction standards were complied with at the time the rig was removed.
Firm Name Eaton's Firm No. 26
Address Woodville Date 8-24-87
Signed by (Firm Official) James Eaton
and
(Operator) " "

55 SE Wendell

within 30 days after the completion or abandonment of the well.

1. WELL OWNER
Name William Stover
Address RT 1 Wendell
Owner's Permit No. (well # 1)

2. NATURE OF WORK
☒ New well ☐ Deepened ☐ Replacement
☐ Abandoned (describe abandonment procedures such as materials, plug depths, etc. in lithologic log)

3. PROPOSED USE
☒ Domestic ☐ Irrigation ☐ Test ☐ Municipal
☐ Industrial ☒ Stock ☐ Waste Disposal or Injection
☒ Other Dairy (specify type)

4. METHOD DRILLED
☒ Rotary ☐ Air ☐ Hydraulic ☐ Reverse rotary
☐ Cable ☐ Dug ☐ Other

5. WELL CONSTRUCTION
Casing schedule: ☒ Steel ☐ Concrete ☐ Other
Thickness 0.15 inches Diameter 5.5 inches + 1 feet To 19 feet
Inches inches feet feet
Inches inches feet feet
Inches inches feet feet
Inches inches feet feet
Was casing drive shoe used? ☐ Yes ☒ No
Was a packer or seal used? ☐ Yes ☒ No
Perforated? ☐ Yes ☒ No
How perforated? ☐ Factory ☐ Knife ☐ Torch
Size of perforation _____ inches by _____ inches
Number _____ From _____ To _____
_____ perforations _____ feet _____ feet
_____ perforations _____ feet _____ feet
_____ perforations _____ feet _____ feet
Well screen installed? ☐ Yes ☒ No
Manufacturer's name _____
Type _____ Model No. _____
Diameter _____ Slot size _____ Set from _____ feet to _____ feet
Diameter _____ Slot size _____ Set from _____ feet to _____ feet
Gravel packed? ☐ Yes ☐ No ☐ Size of gravel _____
Placed from _____ feet to _____ feet
Surface seal depth 15 Material used in seal: ☐ Cement grout
☐ Bentonite ☒ Pudding clay ☒ Cutting
Sealing procedure used: ☐ Slurry pit ☐ Temp. surface casing
☒ Overbore to seal depth
Method of joining casing: ☐ Threaded ☐ Welded ☐ Solvent
Weld
☐ Cemented between strata
Describe access port Sanitary well cap
5' ~~gravel~~ Top Soil moved in after well drilled

6. LOCATION OF WELL
Sketch map location must agree with written location.
N
W 33 E
S
County Gord. Co.
NW 1/4 NE 1/4 Sec. 33, T. 8 N, R. 15 E.

7. WATER LEVEL
Static water level 88 feet below land surface.
Flowing? ☐ Yes ☒ No G.P.M. flow _____
Artesian closed-in pressure _____ p.s.i.
Controlled by: ☐ Valve ☐ Cap ☐ Plug
Temperature _____ OF. Quality _____
Describe artesian or temperature zones below.

8. WELL TEST DATA Not Tested
☐ Pump ☐ Bailor ☐ Air ☐ Other

Discharge G.P.M.	Pumping Level	Hours Pumped

9. LITHOLOGIC LOG
Bore Diam. Depth From To Material Water Yes No
8 0 6 Top Soil ☒
8 6 15 Red Lign ☒
8 15 23 Red Lign ☒
6 23 57 Red Lign ☒
6 57 64 Red ☒
6 64 115 Red ☒
6 115 130 Red ☒

MICROFILMED
APR 23 2002

10. Work started May 26 finished May 27, 83

11. DRILLERS CERTIFICATION DR
I/We certify that all minimum well construction standards were
compiled with at the time the rig was removed.
Firm Name Estor's Firm No. 26
Address Wendell Date 8-24-83
Signed by (Firm Official) James Estor
and
(Operator) " "

USE ADDITIONAL SHEETS IF NECESSARY -- FORWARD THE WHITE COPY TO THE DEPARTMENT



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Boise, ID 83706 - P.O. Box 83720, Boise, ID 83720-0098
Phone: (208) 327-7900 Fax: (208) 327-7866 Web Site: www.idwr.state.id.us

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

February 22, 2002

WILLIAM C STOUDER
3507 S 2000 E
WENDELL ID 83355

RE: Permit No. 36-8661

Dear Mr. Stouder:

Permit 36-08661 is currently being reviewed for licensing. Since you received your permit, the Department has taken a position that it is necessary to clarify the place of use for land application of waste from dairies as part of the water right. We would like to give you the opportunity to include the description of the place of use for this waste water on your water right license. Please submit information, by 40-acre tract descriptions, that describes where the waste water is used and the ownership of the lands that this water is applied.

Enclosed, for your convenience, is a copy of a topographical map that you can use to identify these lands. Please mark on the map where your waste water is being applied. If land application is found to be in tracts not included on your permit, we will request that you amend your permit before licensing to include this information on the license. If the waste water is not land applied, please advise us by telephone, e-mail (scurtis@idwr.state.id.us) or a letter.

Please submit the requested information within the next 14 days so we can proceed with licensing your permit. If you have any questions, please feel free to contact me at (208) 327-5452.

Sincerely,

Sharla Curtis
Sr. Water Resource Agent

Enclosures

MICROFILMED

APR 23 2002

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
MAR 12 1996
Department of Water Resources

A. GENERAL INFORMATION

Permit No. 36-08661

1. Owner: William C Stouder Phone #: (208) 536-2086

Current Address: 3507 S. 2000 e. Wendell ID 83355

2. Accompanied by: Bill Stouder EXAM DATE : 02-14-1996

Address: Same Phone No.: Same

Relationship to Permit Holder: Owner

3. Source: Groundwater tributary to None

B. OVERLAP REVIEW

1. Other water rights with the same place of use: None

2. Other water rights with the same point of diversion: None

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident No.	Gov't Lot	¼	¼	¼	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
#1		ne	ne	ne	33	08s	15e	Gooding	USGS Aerial Photo W/ASCS Slide
#2		ne	ne	ne	33	08s	15e	Gooding	USGS Aerial Photo W/ASCS Slide

2. Place(s) of Use:

Indicate Method of Determination

TWP	RGE	SEC	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
08s	15e	33	S																
08s	15e	33	C																

MICROFILMED
APR 23 2000

E. NARRATIVE/REMARKS/COMMENTS

This system consists of two inter-connected wells drilled 130 ft deep with a dynamic pumping level of 78 ft.

Water is diverted to 4 65 gallon pressure tanks via two 5 hp Mitsubishi pumps, and also into a large concrete storage vault.

Water is then diverted to the corral system and regulated by level sensing switches. Water used to cool milk, and flush milk pipes, is returned to the concrete storage vault and comingled with raw water until needed for udder washing, and barn cleaning. This is accomplished by using a 25 hp booster pump.

This system originally furnished water for household use also, but has since been disconnected and a new domestic well drilled for home use only.


This image shows a single sheet of white paper with horizontal blue or grey ruling lines. The lines are evenly spaced and run across the width of the page. There are no margins, text, or other markings on the paper.

Have conditions of permit approval been met? X yes ___ no

MICROFILMED

APR 23 2000

3. **Delivery System Diagram:** Include all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. **SEE ATTACHED AERIAL PHOTO**

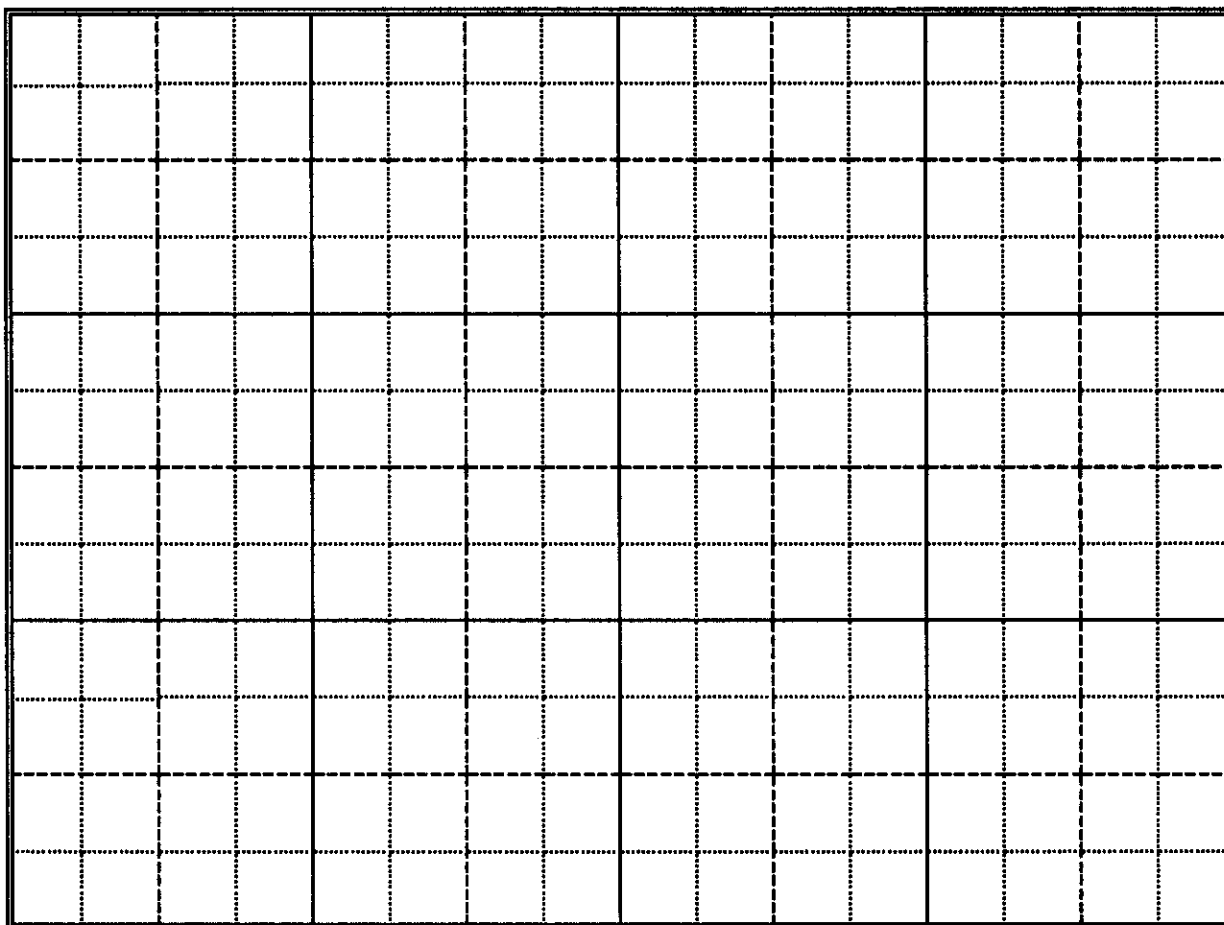

Scale: 1" = Not to Scale

☐ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

☒ Aerial Photo Attached (required for irrigation of 10+ acres)

☐ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
Well #1	General Electric	5	MJ 4003-70	mitsubishi	MI C35 UL
Well #2	General Electric	5	MJ 4004-70	mitsubishi	MI C35 UL

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
TOTALIZING DIGITAL	UNK	AQUA	M35	UNK	UNK	UNK

2. Measurements: Observation

MICROFILMED

APR 23 2002

F. FLOW CALCULATIONS

____ Additional Computation Sheets Attached

Measured Method:

See Attached Dairy Worksheet

$$\frac{8.8 \times 10 \times .70}{78 + (40 \times 2.31)} = 0.36 \text{ cfs}$$

G. VOLUME CALCULATIONS**1. Volume Calculations for Irrigation:**

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = \underline{\hspace{2cm}}$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = \underline{\hspace{2cm}}$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = \underline{\hspace{2cm}}$$

2. Volume Calculations for Other Uses:**Stockwater**

$$750 \times 35 \text{ gpd} \times 365 = 9581250 / 325900 = 29.4 \text{ afa}$$

$$1247 \times 12 \text{ gpd} \times 365 = 5461860 / 325900 = 16.8 \text{ afa}$$

Commercial

28.1 afa

H. RECOMMENDATIONS**1. Recommended Amounts: Based on Fee Schedules and system capacities.**

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
<u>Stockwater</u>	<u>01-01</u>	<u>12-31</u>	<u>0.26 cfs</u>	<u>50.0 afa</u>
<u>Commercial</u>	<u>01-01</u>	<u>12-31</u>	<u>0.26 cfs</u>	<u>28.1 afa</u>
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
Totals:			<u>0.26 cfs</u>	<u>78.1 afa</u>

2. Recommended Amendments

___ Change P.D. as reflected above ___ Add P.D. as reflected above X None
___ Change P.U. as reflected above ___ Add P.U. as reflected above ___ Other

I. AUTHENTICATIONField Examiner's Name DR. L. J. ... Date 03-10-96Reviewer Adm Date 3/11/96MICROFILMED
SEAL

APR 23 2002

FILE # OF NAME ----- 36-08661
 REVIEWER ----- drt
 DATE ----- 05-Mar-96

IDAHO DEPARTMENT OF WATER RESOURCES
 DAIRIES: WATER USE WORKSHEET

REQUIRED DAIRY DATA

NUMBER OF MILKING CATTLE ----- 750
 NUMBER OF NONMILKING CATTLE ----- 1267
 IF LAGOON IS AEROBIC, ENTER ITS SURFACE AREA IN ACRES;
 IF ANAEROBIC, ENTER ZERO ----- 0.0
 EVAPOTRANSPIRATION FACTOR FOR AREA (AC-FT/AC-YR) ----- 0
 ENTER 1 FOR MANUAL COW WASHING, 2 FOR AUTOMATIC, OR 3 IF
 SPRINKLERS ARE USED TO FLUSH HOLDING PEN AND WASH COWS -
 NUMBER OF MILKINGS PER DAY ----- 2

CALCULATIONS

DIVERSION RATE FOR STOCKWATER (CFS): ****

MILKING CATTLE 235 GPD/HD ----- 0.59
 MILKING CATTLE (NUMBER OF CATTLE ROUNDED UP) * --- 0.52
 NONMILKING CATTLE 212 GPD/HD ----- 0.28
 NONMILKING CATTLE (NUMBER OF CATTLE ROUNDED UP) * --- 0.29
 TOTAL (BASED UPON ROUNDED NUMBERS) ----- 0.81

DIVERSION VOLUME (AFA):

STOCKWATER
 MILKING CATTLE 235 GPD/HD ----- 29.4
 MILKING CATTLE (NUMBER OF CATTLE ROUNDED UP) * --- 32.0
 NONMILKING CATTLE 212 GPD/HD ----- 16.8
 NONMILKING CATTLE (NUMBER OF CATTLE ROUNDED UP) * --- 18.0
 TOTAL (BASED UPON ROUNDED NUMBERS) ----- 50.0

COMMERCIAL
 WASHING OF BULK TANK AND RELATED EQUIPMENT ----- 0.4
 PARLOR FLOOR AND MILKHOUSE FLOOR ----- 0.1
 CATTLE WASHING BASED UPON METHOD OF WASHING ----- 27.6
 TOTAL ----- 28.1

TOTAL DIVERSION VOLUME ----- 78.1

CONSUMPTIVE USE VOLUME (AFA):

STOCKWATER
 MILKING ----- 4.6
 NONMILKING ----- 0.0
 TOTAL ----- 4.6
 COMMERCIAL ----- 0.0
 TOTAL CONSUMPTIVE USE ----- 4.6

THEORETICAL FLOW ESTIMATION

REQUIRED PUMP INFORMATION

	PUMP 1	PUMP 2	PUMP 3
PUMP HORSEPOWER (HP) -----	5.00	5.00	
LIFT (FT) -----	78	78	
DISCHARGE PRESSURE (PSI) -----	40	40	
FRICTION LOSSES (FT) -----	0.0	0.0	

CALCULATIONS

	0.18	0.18	0.00
THEORETICAL FLOW RATE (CFS) ** -----			
DIVERSION VOLUME (AFA) *** -----	130.9	130.9	0.0


* NUMBER OF CATTLE ROUNDED UP TO AGREE WITH EXISTING TABLES.
 ** PUMP EFFICIENCY WAS ASSUMED TO BE 70%.
 *** DIVERSION VOLUME IS THE ABSOLUTE MAXIMUM VOLUME BASED ON
 THE THEORETICAL FLOW RATE ASSUMING PUMP RUNS CONTINUOUSLY
 EVERY DAY OF THE YEAR.
 **** BASED ON 2 HOUR DIVERSION TO MEET VOLUME

Dev.: MStirling
 Mod.: ADH & KKC
 Mod.: 8/5/94 DRJ


MICROFILMED
 APR 23 2002

South

3507 S 2000 E.
Stouder Holdings Wendee, ID 83355

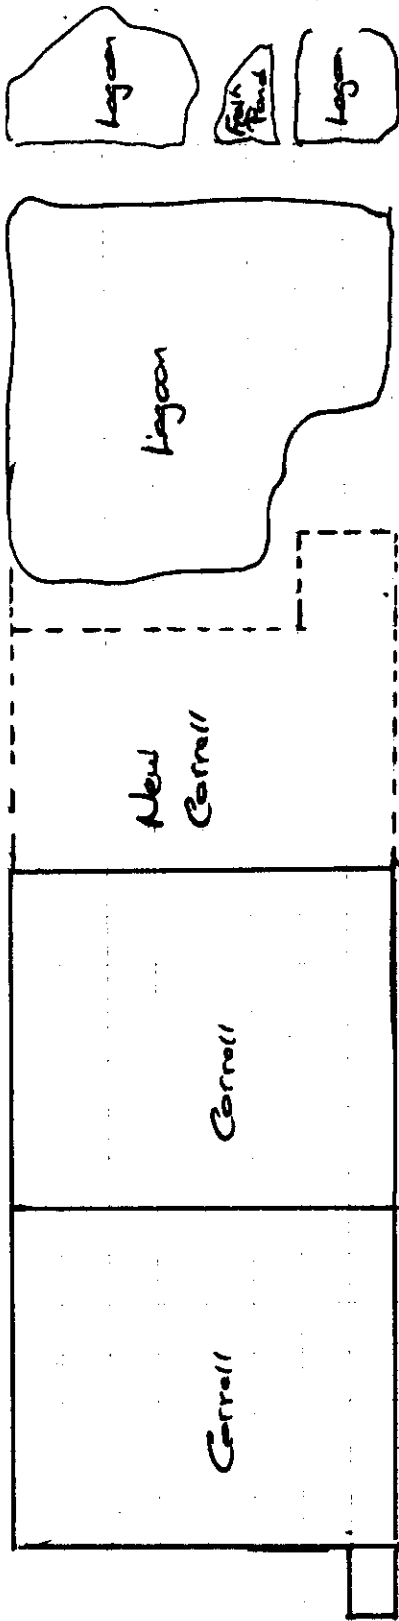

West

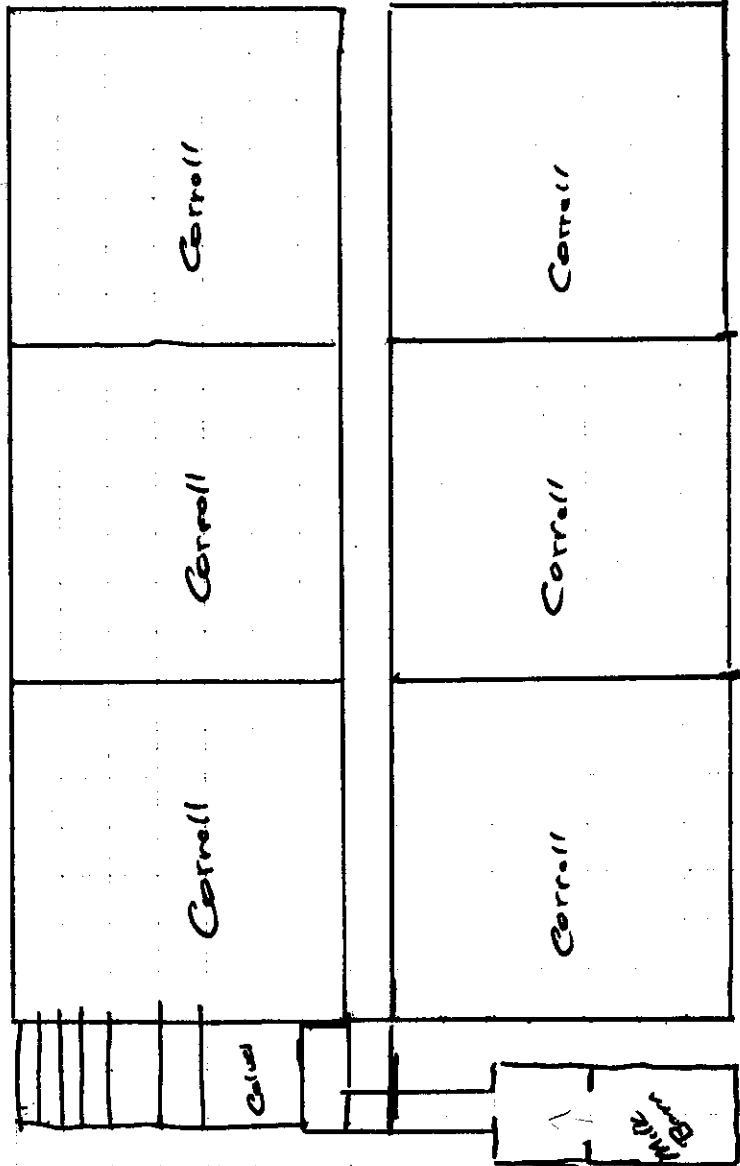

Bob Barta

MICROFILMED

Bob

23 2002



well #1



well #2




MICROFILM


2 3 2002



showing 25 HP
Booster pump
& connection to
storage vault

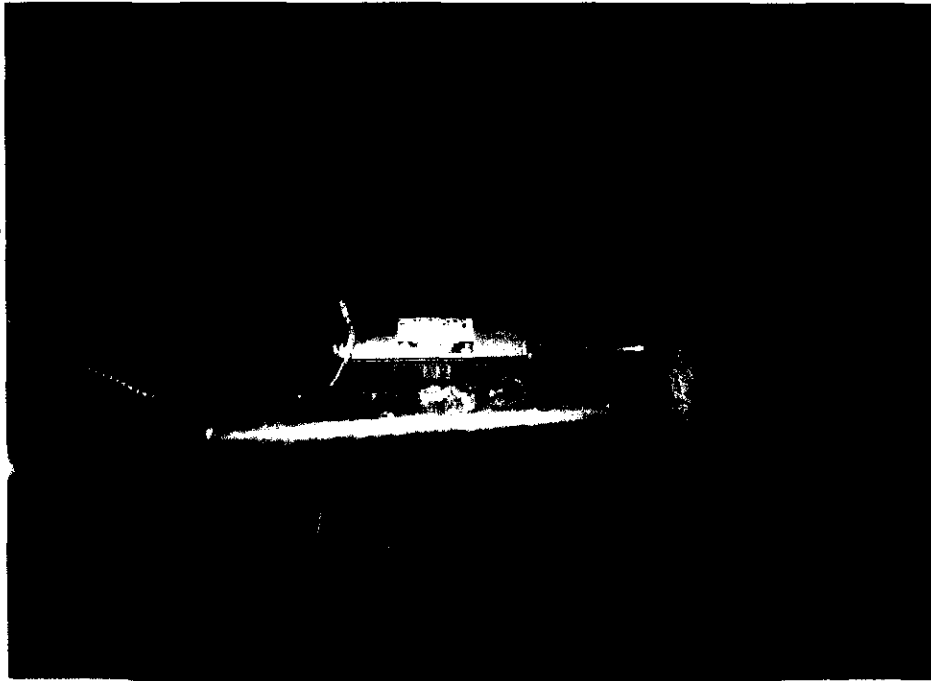

STORAGE
VAULT

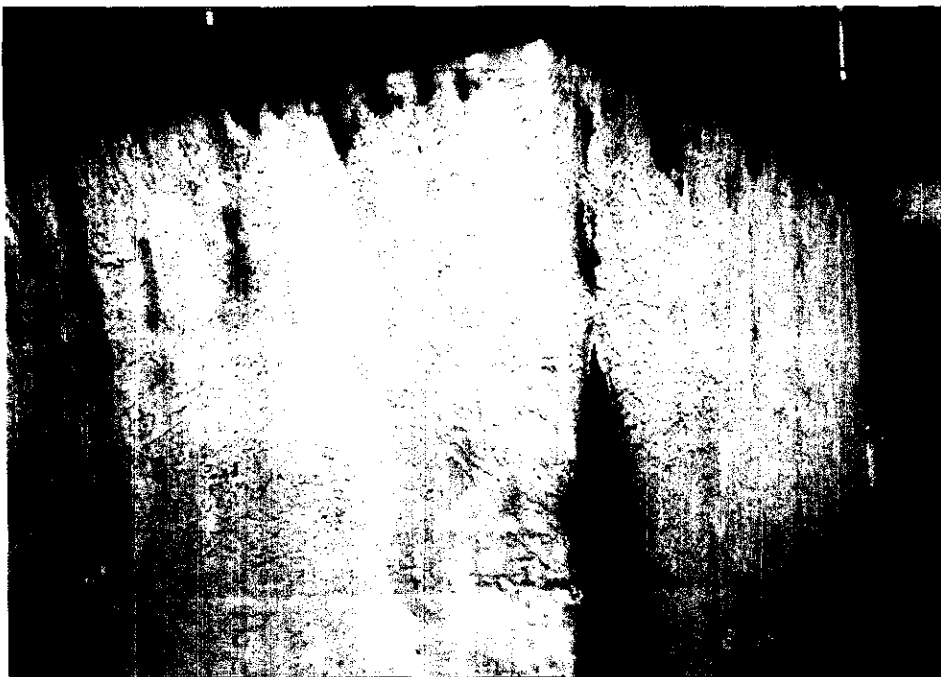

MICHAEL

APR 23 2002



State of Idaho
DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. Box 83720, Boise, Idaho 83720-0098
Phone: (208) 327-7900 FAX: (208) 327-7866

PHILIP E. BATT
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

March 29, 1995

Northwest Farm Credit Services, ACA
P O Box 288
Twin Falls ID 83303-0288

RE: Permit No. 36-08661

Dear Sirs,

This letter is to confirm that the assignment of ownership on the above referenced water right is satisfactory. We have modified our computer records to reflect this change in ownership.

If you have any questions regarding this matter, please feel free to contact us.

Sincerely,

A handwritten signature in black ink, appearing to read 'Jim Johnson', with a horizontal line extending to the right.

JIM JOHNSON, Manager
Water Right Permits Section

JJ:rl

c: William C Stouder

APR 13 1995



Farm Credit Services

RECEIVED

129 Eastland Drive
P.O. Box 288
Twin Falls, Idaho 83303-0288
208/733-2577

March 8, 1995

RECEIVED

MAR 10 1995

Department of Water Resources
Southern Region
Department of Water Resources
222 Shoshone Street East
Twin Falls ID 83301

Department of Water Resources
Southern Region

RE: Water Permit 36-08661
William C. Stouder

RECEIVED
MAR 10 1995

Department of Water Resources

Gentlemen:

This letter will serve as notice to the Department of Water Resources that Northwest Farm Credit Services, ACA, has a security interest in the above Permit and a real estate mortgage has been filed on property where the wells are located. Enclosed is an Assignment from William C. Stouder to William C. Stouder and Northwest Farm Credit Services, ACA.

We request copies of all notices and correspondence mailed to William C. Stouder regarding the above-described permit number be sent to our office address.

Please acknowledge below and return this letter to our office. We appreciate your cooperation in this matter.

Sincerely,

Carolyn Hoover

Carolyn Hoover
Customer Service Representative

ACKNOWLEDGED this 9th day of March, 1995.

DEPARTMENT OF WATER RESOURCES

By

Mel Schulte
SR. Water Rights Agent

RECEIVED

MAR 09 1995

Department of Water Resources
Southern Region

RECEIVED

APR 13 1995

November 19, 1993

WILLIAM C STOUDE
3507 S 2000 E
WENDELL ID 83355

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 36-08661

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water.

If you have questions concerning this matter, please feel free to contact the SOUTHERN Regional Office in Twin Falls at (208)736-3033.

Sincerely,

JULIE L. YARBROUGH
Senior Secretary

c: IDWR - Region

MICROFILMED

DEC 01 1993

ANALYSIS SHEET
FOR
PROOF OF BENEFICIAL USE

Permit No. 36-8661 Reviewed by VH Date 11-15

GENERAL CONSIDERATIONS

TYPES OF USE

yes Name same as permit?
yes Address same as permit?
yes Proof timely received? Correct Uses? _____
If not, complete calculation below.

SOURCE OF WATER

_____ Surface water source
✓ Ground water source
NO Drilling permit required? Wells drilled in 1983
_____ Copy in the file? Drilling Permit No. _____
_____ Amount paid for permit _____ Correct?
yes Well log in the file? (2)

LICENSE EXAMINATION FEE

yes Required?
180 Amount Submitted
yes Correct?

MEASURING DEVICE

NO Required?
_____ Installed?
_____ Waiver requested?

PRIORITY CALCULATION

Date proof received _____
Date proof due _____ - _____
No. of days late _____ = _____
Priority Date _____ + _____
New Priority Date _____

DEFICIENCIES OR ACTION ITEMS

- Proof acceptable.

DATA ENTRY
New Address _____

N/A

Proof Made 11-04-93

September 30, 1993

WILLIAM C STOUDE
3507 S 2000 E
WENDELL ID 83355

PROOF DUE NOTICE

RE: PERMIT NO. 36-08661

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before December 1, 1993. (See last page of your approved permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a complete field examination report prepared by a certified water right examiner may be used to submit the required proof.


If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.

Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.

SINCERELY,

Karen L. Gustafson
Secretary/Records Manager

Enclosures

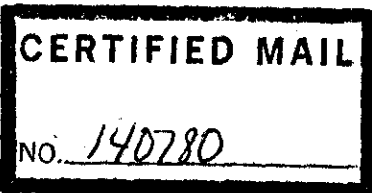

MICROFILMED

DEC 01 1993



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

November 16, 1992

WILLIAM C STOUDE
3507 S 2000 E
WENDELL ID 83355

PERMIT APPROVAL NOTICE

RE: PERMIT NO. 36-08661

Dear Permit Holder:

Enclosed is a copy of your approved application for permit. We direct your attention to the conditions of approval on the final page.

Enclosed is a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit. Also enclosed is a form entitled "Proof of Beneficial Use". If your project is already completed you should complete and submit this form immediately.

Be sure to note the special condition requiring you to install a measuring device. Enclosed, for your reference, is a list of measuring device options.

Sincerely,

A handwritten signature in cursive script that reads "Brenda L. Miller".

BRENDA L. MILLER
Water Resource Agent

BLM:cz

Enclosures

MICROFILMED

DEC 08 1992

APPLICATION FOR PERMIT REVIEW

Application #: 36-8661 Date: 11-9-92 Reviewer: Brenda Miller

SYSTEM COMPLETED:

No - 26A-P17
 Complete in 1 year - P16
 Yes
 Proof not submitted - P16
 Proof submitted - N/A

GROUNDWATER:

GT. 0.2 cfs <flo-ch> - 01G-P03, 01C-P03 (existing well)
 - NMR <fl ch>, A of C SNAKE River Basin
 LT. 0.2 cfs - No measurement required <flow chart>

Drilling Permit:

Approved w/permit - P99
 Not included - 046-46A-46B-P23 (after 7/1/87) (N/A) prior to 1987

SURFACE WATER: not in w/d - 01C-P03 (=GT.2 w/pump), NMR <flow chart>

LOCATION:

Water Districts - WD No. _____
 Surface water - R04, R04-01H-P01(LT.2 w/pump)
 R04-01J-P08(GT.2), NMR <flow chart>
 Groundwater - P05
 Irrigation Districts - 023
 Canal Co. Areas - 023
 Drainage Districts - 024
 Boise Front (63) - 058 (Groundwater)
 Swan Falls Flag - C (1, Blank or Other)
 Trust - 051-052-053-P74(Consumptive Uses)
 Non Trust <1> - 048-049

RIVER BASINS:

(Surface Water) Water District Control Condition &....
 Boise (63) - 05A & 11E
 Payette (65) - 047-P04, 059-P71
 Snake (01, 02 & 03) - 11A-P04(01), 061-P07(02/03 No W.D.Cond.)

USE:

Fish Propagation - 06A, 09E-P10 & 010 (WQ/Choose One),
 042(req.), 002-P06(MD), 07A(Spec.),
 044(Policy 5G)
 Power - Use Power Review
 Mining - 06A, 010, or 09E-P10 & 054(req.)
 Storage - 18A-for multiple measuring devices(In WD),
 18B-P09(Size)
 Rec/Wildlf/Aes - 027(Non-Consumptive)
 Domestic - 021 (Boise River - upstream from L Peak)
 (restricted areas) 27A (Payette River & main tributaries)

OWNERSHIP:

Non land owner - 004

PROTESTED:

Agreement - 020

Beneficial Use Due Date: - 12-01-1993

Other Conditions/Remarks: -

Pre 1987 DEVELOPMENT

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR PERMIT ANALYSIS SHEET Stouder, William

INITIAL REVIEW BY J.P. Stanton DATE 5-27, 1992
APPLICATION NO. 36-08661

REQUIRED INFORMATION

- ☒ Name (If applicant is a corporation or partnership, names must be provided for the director, officers, & other partners.)
☒ Address
☒ Source (see USGS quad for names of water sources)
☒ Point of diversion (10 Acres for spring, lot & block descriptions for subdivisions, local name, flow &/or volume.)
☒ County
☒ Quantity (flow &/or volume)
☒ Period of use
☒ Nature of proposed use (include description of use)
☒ Description of diverting works.
☒ Time required for beneficial use of water.
☒ Place of use or acres irrigated.
☒ Map
☒ Signature (If applicant is corp., partnership, or municipality, title of signator is required)
☒ Fee
☒ Yes ☐ No* In form to receipt
- ++++PROPOSED PRIORITY DATE
5-27 1992

ADDITIONAL INFORMATION

- ☐ Overlapping place of use(Describe source & relationship to present application on the back.
☐ Overlapping point of diversion.
☐ Yes ☒ No Field check required
Field check by _____
☐ Yes ☐ No Field report attached
☐ Yes ☒ No Critical Ground water area
☐ Yes ☒ No Groundwater management area
☐ Yes ☒ No Send Dam safety information
☐ Yes ☒ No Send power requirement letter
☐ Yes ☒ No Send fish farm requirement letter
☐ Yes ☒ No Power residency affidavit.
☐ Yes ☒ No Power efficiency form
☒ Yes ☐ No Within trustwater boundary(If yes, attach trustwater supplementary analysis sheet.
☐ Yes ☒ No Diversion greater than 5 cfs or 500 acre ft. (If yes, attach large diversion supplementary analysis sheet.
See reverse side for additional information.

* REQUEST THE FOLLOWING ADDITIONAL INFORMATION FROM THE APPLICANT: _____

RECEIVED
SEP 29 1992

PROCESSING ✓ Yes No
 Yes ✓ No
✓ Yes No

In form for Advertising
No Statewide Advertising
Fee amount, receipt date & No. recorded on app.

SEND COPIES TO: _____ Idaho Dept of Health & Welfare _____ USDI BLM
 _____ Idaho Dept of Fish & Game _____ USFS
 _____ Idaho Dept of Lands _____ Water Dist.
 _____ Adjudication Bureau Unit _____ Other _____

FINAL REGIONAL PROCESSING REVIEW

☒ Yes ☐ No Affidavit of publication received.
☒ Yes ☐ No Application published correctly. If not, record action taken.

✓ Yes ☐ No Publication dates and paper, recorded on App.
 Yes ☒ No Protests received
 Final date for Protest 9/21/92
 Yes ☒ No Protests, dates, resolution of protest, recorded on app.
 Yes ☒ No Recommendations attached
 Yes ☒ No Measuring device required
 Yes ☒ No Access port required
 Yes ☒ No Will water be delivered by watermaster? If yes, what dist. _____
 Yes ☒ No Special conditions of approval or cover letter below. _____

See below for additional information

Date of priority recommended 5/21, 1992
By Larry Ottalano Date 9/24, 1992

STATE OFFICE REVIEW

See below for additional information By
Date , 19

ADDITIONAL INFORMATION:

LOCAL PUBLIC INTEREST

Comments recieved from:

_____ City	_____ Idaho Fish & Game	_____ Irrigation Dist.
_____ County	_____ Idaho Health & welfare	_____ Canal Company
_____ Reservations	_____ Div. of Enviromental Quality	_____ Other _____

PROJECT IMPACTS/IMPLICATIONS REPORT

COMMENTS:

_____ DATE _____, 19____

NOTICE OF APPLICATION FOR TRUST WATER RIGHT

36-08661

STOUDER, WILLIAM C
3507 S 2000 E
WENDELL, ID 83355

Source: GROUNDWATER

Diversion Pt: NENENE Sec. 33 T 08S R 15E in GOODING County.

Use: STOCKWATER (.260 CFS)
COMMERCIAL (.260 CFS)
Total Diversion: (.260 CFS)

Date Filed: 5/21/1992

In: GOODING County
T08S R15E S33 NENE

The permit(s) will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code and/or the new public interest criteria of Sec. 42-203C, Idaho Code. Protests must be filed with the Director, Dept. of Water Resources, 222 Shoshone Street East, Twin Falls, ID 83301 on or before SEPTEMBER 21, 1992.

R. Keith Higginson, Director

Published: 9/ 2/1992 & 9/ 9/1992

MICROFILMED

DEC 08 1992

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Southern Region
222 Shoshone Street East
Twin Falls, ID 83301
(208) 736-3033

AUGUST 17, 1992

GOODING COUNTY LEADER
PO BOX 56
GOODING, ID 83330

Gentlemen:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before SEPTEMBER 21, 1992.

Yours truly,

Mary Baldwin
Secretary/Office Coordinator

Enclosure

MICROFILMED

DEC 08 1992



State of Idaho

DEPARTMENT OF WATER RESOURCES

Southern Region, 222 Shoshone St. East, Twin Falls, Idaho 83301 (208) 736-3033

CECIL D. ANDRUS
Governor

17-Aug-1992

R. KEITH HIGGINSON
Director

J DEE MAY ESQUIRE
PO BOX 1846
TWIN FALLS ID 83301

Re: Application for Permit No. 36-08661 (William C. Stouder)

Dear Mr. May:

The Department of Water Resources acknowledges receipt of the water right application for permit filed in behalf of William C. Stouder. The application has been assigned the above referenced identification number. Please refer to this number in all further correspondence.

This office will be advertising the application in the Gooding County Leader on 9/2 & 9/9/92. A period of ten days following the second publication will be allowed for the submittal of protests.

If the application is protested you will be sent a copy of the protest. The protest must be resolved before the application is approved or denied. If the protest is not resolved voluntarily, this Department will conduct a conference and/or hearing on the matter.

If the application is not protested, it will be forwarded to our State Office in about five weeks. State office personnel will conduct a complete review prior to final processing of the application and will notify you of the outcome of this review. When a permit is issued, you will be sent a copy. A typical processing time for an unprotested application is about eight weeks.

Please feel free to contact this office if you have any questions regarding this procedure.

Very truly yours,

James E. Stanton
Sr. Water Resource Agent

JS:MB

cc: William C. Stouder

MICROFILMED

DEC 08 1992

MAY & MAY LAW OFFICES
P. O. BOX 1846 516 2ND STREET EAST
TWIN FALLS, IDAHO 83303-1846

JAY D. SUDWEEKS
J. DEE MAY
MARK D. STUBBS
THOMAS D. KERSHAW, JR
BART D. BROWNING

TELEPHONE
(208)733-7180

TELEFAX
(208)733-7967

July 2, 1992

RECEIVED

JUL 06 1992

Idaho Department of Water Resources
Attention: Loren Holmes
220 Shoshone East
Twin Falls, ID

Department of Water Resources
Southern Region Office

RE: Stouder v. Idaho Dept. of Water Resources
File No. 16858

Dear Mr. Holmes:

I received a call from Mr. Robert Worstell who indicated that the application for water rights made by Mr. Stouder had been sent to you for processing. I have enclosed copies of the last two letters I sent to Mr. Worstell along with a copy of the application.

I asked Mr. Worstell and will renew that request to you that I need to know what the status of the application is and how the moratorium which has been placed by the department on drilling wells effects this particular application. As you can see from the application, there has been an historical use for almost ten years, so we are not talking about drilling a new well.

Could you please let me know the status of the case and how the moratorium effects the application so I can report to my client.

Thank you very much.

Very truly yours,

MAY & MAY LAW OFFICES


J. DEE MAY

JDM:mab

cc: William Stouder
3507 S. 2000 E.
Wendell, ID 83355

MICROFILMED

DEC 08 1992

MAY & MAY LAW OFFICES
P. O. BOX 1846 516 2ND STREET EAST
TWIN FALLS, IDAHO 83303-1846

RECEIVED

JAY D. SUDWEEKS
J. DEE MAY
MARK D. STUBBS
THOMAS D. KERSHAW, JR
BART D. BROWNING

JUN 22 1992

TELEPHONE
(208)733-7180

Department of Water Resources
Southern Region Office
TELEFAX
(208)733-7967

June 19, 1992

Idaho Department of Water Resources
Attention: Robert Worstell
220 Shoshone East
Twin Falls, ID

RE: Stouder v. Idaho Dept. of Water Resources
File No. 16858

Dear Mr. Worstell:

I sent over Mr. Stouder's application on May 20, 1992. Could you please let me know what the status of that application is as well as letting me know the answer to the other question I asked in my May 20th letter, that being whether the moratorium on well drilling effects these particular wells.

Please let me hear from you as soon as possible.

Very truly yours,

MAY & MAY LAW OFFICES


J. DEE MAY

JDM:mab

cc: William Stouder
3507 S. 2000 E.
Wendell, ID 83355

RECEIVED

DEC 08 1992

MAY & MAY LAW OFFICES
P. O. BOX 1846 516 2ND STREET EAST
TWIN FALLS, IDAHO 83303-1846

JAY D. SUDWEEKS
J. DEE MAY
MARK D. STUBBS
THOMAS D. KERSHAW, JR
BART D. BROWNING

TELEPHONE
(208)733-7180

TELEFAX
(208)733-7967

May 20, 1992

RECEIVED

MAY 21 1992

Idaho Department of Water Resources
Attention: Robert Worstell
220 Shoshone East
Twin Falls, ID

Department of Water Resources
Southern Region Office

Dear Mr. Worstell:

I have enclosed the Application for Permit with the appropriate filing fee for William Stouder on the wells furnishing water to his dairy and which we discussed in your office a few weeks ago. Could you please proceed with the Application and let me know its status.

In addition, I am concerned with the moratorium which has just been placed on well drilling as to how that effects these particular wells, since they were in existence prior to the moratorium coming down.

If you could please let me know on the moratorium, I would appreciate it.

Thank you for all of your help and, if you could please keep me posted as to the progress and status of this Application, I would appreciate it.

Very truly yours,

MAY & MAY LAW OFFICES



J. DEE MAY

JDM:mab

Enclosures

cc: William Stouder
3507 S. 2000 E.
Wendell, ID 83355

MICROFILMED

DEC 08 1992

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORT

USE TYPEWRITER OR
BALLPOINT PEN

State law requires that this report be filed with the Director, Department of Water Resources, within 30 days after the completion of the well.

515 SE 1st St

1. WELL OWNER
Name *William J. Smith*
Address *515 SE 1st St*
Owner's Permit No. *(well 1)*

2. NATURE OF WORK
☒ New well ☐ Deepened ☐ Replacement
☐ Abandoned (describe abandonment procedure, seal materials, plug depths, etc. in lithologic log)

3. PROPOSED USE
☒ Domestic ☐ Irrigation ☐ Farm ☐ Municipal
☐ Industrial ☐ Stock ☐ Waste Disposal ☐ Other *Drinking*

4. METHOD DRILLED
☒ Rotary ☐ Auger ☐ Hydraulic ☐ Reverse
☐ Cable ☐ Other

5. WELL CONSTRUCTION
Casing schedule: ☒ Steel ☐ Concrete ☐ Other
Thickness *3/8"* Diameter *4"* *10'* feet *20'* feet
Inches *3/8"* Inches *4"* Feet *10'* Feet *20'* Feet
Inches *3/8"* Inches *4"* Feet *10'* Feet *20'* Feet
Inches *3/8"* Inches *4"* Feet *10'* Feet *20'* Feet
Was casing drive shoe used? ☐ Yes ☒ No
Was a packer or seal used? ☐ Yes ☒ No
Perforated? ☐ Yes ☒ No
How perforated? ☐ Factory ☐ Knife ☐ Torch
Size of perforation _____ inches by _____ inches
Number _____ From _____ feet _____ feet
_____ perforations _____ feet _____ feet
_____ perforations _____ feet _____ feet
Well screen installed? ☐ Yes ☒ No
Manufacturer's name _____
Type _____ Model No. _____
Diameter _____ Slot size _____ Set from _____ feet to _____ feet
Diameter _____ Slot size _____ Set from _____ feet to _____ feet
Gravel packed? ☐ Yes ☒ No ☐ Size of gravel _____
Placed from _____ feet to _____ feet
Surface seal depth *25'* Material used in seal _____
☐ Bentonite ☒ Fuddling clay ☐ Cement
Sealing procedure used: ☐ Murrey plug ☐ Trench surface seal
Method of joining casing: ☐ Threaded ☐ Welded ☐ Seamed
☐ Cemented between struts
Describe access port _____
5" pipe top seal installed in 10' well

6. LOCATION OF WELL
Sketch map location must agree with written location.
N
W 23 E
S
County *Cadiz*
Subdivision Name _____
Lot No. _____ Block No. _____
NE & NE 1/4 Sec. 33, T. 8, R. 15 E.

7. DRILLERS CERTIFICATION
I/We certify that all minimum well construction standards were complied with at the time the rig was removed.
Firm Name *Lyton's* Firm No. *26*
Address *Lyndon* Date *8-24-83*
Signed by (Firm Official) *Lyndon*
and
(Operator) " "


USE ADDITIONAL SHEETS IF NECESSARY - FORWARD THE WHITE COPY TO THE DEPARTMENT

36-08661

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORTUSE TYPEWRITER OR
BALLPOINT PEN

State law requires that this report be filed with the Director, Department of Water Resources

S.S. 36-08661 (thin 30 days after the completion or abandonment of the well. All But which 383

1. WELL OWNER Name <u>William Stender</u> Address <u>RT 1, 11111 IL</u> Owner's Permit No. <u>(will #2)</u>		7. WATER LEVEL Static water level <u>78</u> feet below land surface. Flowing? ☐ Yes ☒ No G.P.M. flow _____ Artesian closed-in pressure _____ p.s.i. Controlled by: ☐ Valve ☐ Cap ☐ Plug Temperature _____ of. Quality _____ Describe artesian or temperature zones below																																															
2. NATURE OF WORK ☒ New well ☐ Deepened ☐ Replacement ☐ Abandoned (describe abandonment procedures such as materials, plug depths, etc. in lithologic log)		8. WELL TEST DATA ☐ Pump ☐ Bailor ☐ Air ☐ Other _____ <u>NOT TESTED</u> Discharge G.P.M. _____ Pumping Level _____ Hours Pumped _____																																															
3. PROPOSED USE ☒ Domestic ☐ Irrigation ☐ Test ☐ Municipal ☐ Industrial ☐ Stock ☐ Waste Disposal or Injection <u>Other ONLY</u> (specify type)		9. LITHOLOGIC LOG <table border="1"><thead><tr><th rowspan="2">Bore Diam.</th><th colspan="2">Depth</th><th rowspan="2">Material</th><th colspan="2">Water</th></tr><tr><th>From</th><th>To</th><th>Yes</th><th>No</th></tr></thead><tbody><tr><td>0</td><td>0</td><td>6</td><td>Top Soil</td><td></td><td>✓</td></tr><tr><td>6</td><td>6</td><td>15</td><td>Clay Layer</td><td></td><td>✓</td></tr><tr><td>15</td><td>15</td><td>19</td><td>Red Clay</td><td></td><td>✓</td></tr><tr><td>19</td><td>19</td><td>23</td><td>"</td><td></td><td>✓</td></tr><tr><td>23</td><td>23</td><td>47</td><td>Hard Lign (Last Cuttings)</td><td></td><td>✓</td></tr><tr><td>47</td><td>47</td><td>100</td><td>?</td><td></td><td>✓</td></tr></tbody></table>		Bore Diam.	Depth		Material	Water		From	To	Yes	No	0	0	6	Top Soil		✓	6	6	15	Clay Layer		✓	15	15	19	Red Clay		✓	19	19	23	"		✓	23	23	47	Hard Lign (Last Cuttings)		✓	47	47	100	?		✓
Bore Diam.	Depth		Material		Water																																												
	From	To		Yes	No																																												
0	0	6	Top Soil		✓																																												
6	6	15	Clay Layer		✓																																												
15	15	19	Red Clay		✓																																												
19	19	23	"		✓																																												
23	23	47	Hard Lign (Last Cuttings)		✓																																												
47	47	100	?		✓																																												
4. METHOD DRILLED ☒ Rotary ☐ Air ☐ Hydraulic ☐ Reverse rotary ☐ Cable ☐ Dig ☐ Other _____																																																	
5. WELL CONSTRUCTION Casing schedule: ☐ Steel ☐ Concrete ☐ Other _____ Thickness _____ Diameter _____ From _____ To _____ Inches _____ inches _____ feet _____ feet Inches _____ inches _____ feet _____ feet Inches _____ inches _____ feet _____ feet Was casing drive shoe used? ☐ Yes ☒ No Was a packer or seal used? ☐ Yes ☒ No Perforated? ☐ Yes ☒ No How perforated? ☐ Factory ☐ Knife ☐ Torch Size of perforation _____ inches by _____ inches Number _____ From _____ To _____ perforations _____ feet _____ feet perforations _____ feet _____ feet perforations _____ feet _____ feet Well screen installed? ☐ Yes ☒ No Manufacturer's name _____ Type _____ Model No. _____ Diameter _____ Slot size _____ Set from _____ feet to _____ feet Diameter _____ Slot size _____ Set from _____ feet to _____ feet Gravel packed? ☐ Yes ☒ No ☐ Size of gravel _____ Placed from _____ feet to _____ feet Surface seal depth <u>1.7</u> Material used in seal: ☐ Cement grout ☐ Bentonite ☒ Pudding clay ☒ Sealing Sealing procedure used: ☐ Slurry pit ☐ Temp. surface casing ☒ Overbore to seal depth Method of joining casing: ☐ Threaded ☐ Welded ☐ Solvent ☒ Cemented between struts Describe access port: <u>5" Top Soil to be placed 2' after drilling</u>																																																	
6. LOCATION OF WELL Sketch map location must agree with written location.  Subdivision Name _____ Lot No. _____ Block No. _____ County <u>Candor</u> <u>NE 1/4 Sec. 32, T. 6 N. R. 12 E. 10</u>		10. DRILLERS CERTIFICATION I/We certify that all minimum well construction standards were complied with at the time the rig was removed. Firm Name <u>Estor's</u> Firm No. <u>26</u> Address <u>11111 IL</u> Date <u>7-24-87</u> Signed by (Firm Official) <u>James Estor</u> and _____ (Operator) _____																																															

USE ADDITIONAL SHEETS IF NECESSARY — FORWARD THE WHITE COPY TO THE DEPARTMENT

DEC 08 1992

36-08661

CHECKLIST FOR APPLICATION ACKNOWLEDGEMENT LETTER

Please check each specialized paragraph to INCLUDE

Notual Advertising
per LPH
8-13-92

Re: Application for Permit No. >

Dear >:

The Department of Water Resources acknowledges receipt of your water right application for permit. The application has been assigned the above referenced identification number. Please refer to this number in all further correspondence.

>1) Please be advised that your application is subject to a moratorium on processing new applications which has been imposed due to drought conditions and may be held in this office without further processing until the Moratorium is lifted. At this time we are unable to give a date for further review of this application.

>2) However, your application may be exempt from the moratorium if it meets one of the following criteria:

-Drought relief-to replace existing surface water supply for a limited time.

-Application represents existing development which occurred prior to November 19, 1987.

Permits granted for drought relief purposes will be limited to the extent of the existing valid surface water rights and will be issued for one (1) irrigation season.

Please complete and return the enclosed questionnaire regarding the proposed project to aid in reviewing your application.

>3) From the information contained in your file, it is not possible to determine whether any of these exemptions apply. If you wish to proceed with your application at this time you must provide additional information about the proposed project. The attached questionnaire is intended to aid in reviewing your application.

>4) We acknowledge receipt of the Snake River Moratorium Questionnaire which you have submitted regarding the above referenced application. It will be reviewed to determine if your application qualifies for a moratorium exemption.

If you have any questions or if this office can be of further assistance, please feel free to contact us.

UNRECORDED

DEC 08 1992

36-8661