




PERMIT 36-8630 INIT KKC
T. R. S. Q/Q
P/D 95 16E 3 NE/NW/NE
SCALE BB-22
PHOTO ID. 1976

Sennicksen
VABM 3741
Butte

ALL INFORMATION
MAY 18 1992

36-08630

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

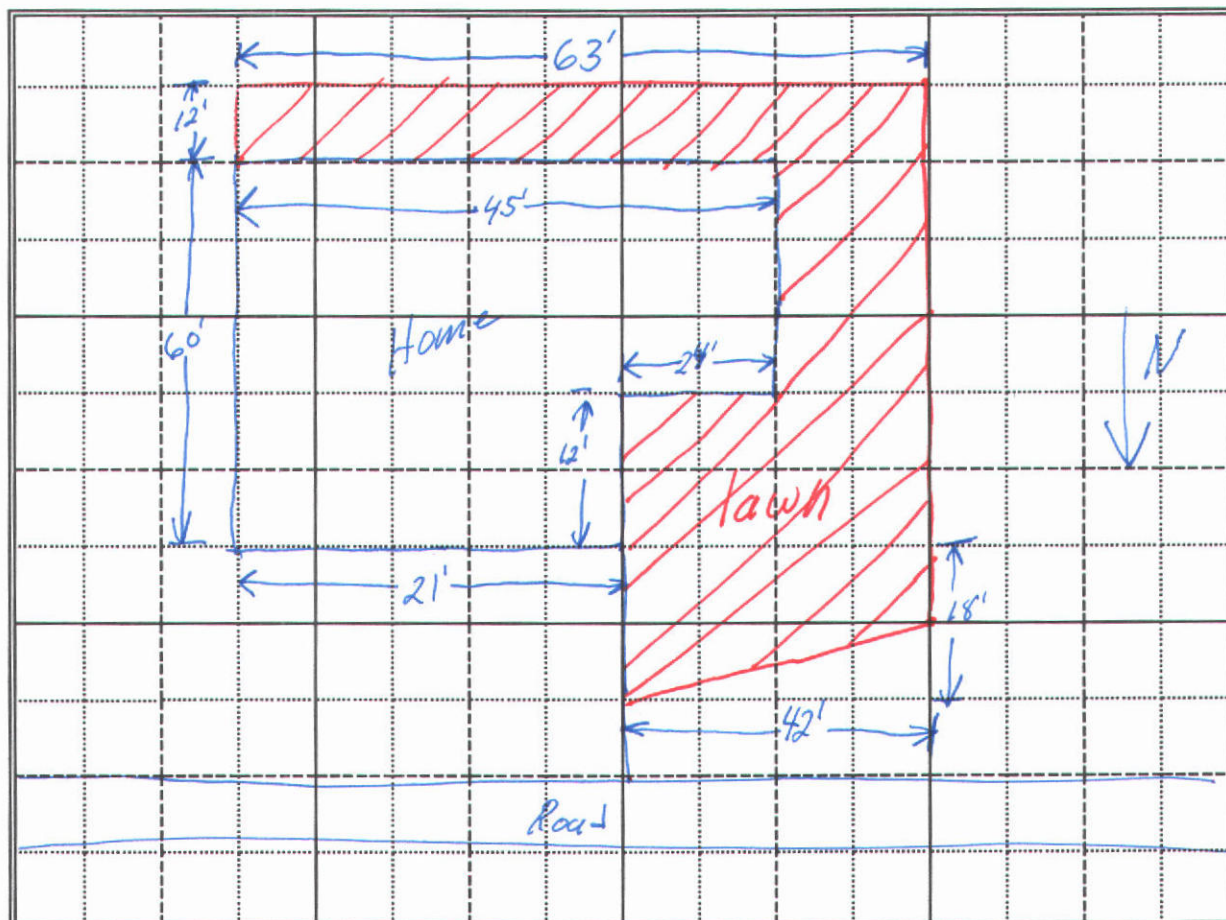

Scale: 1" = 40 scale

☒ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

☐ Aerial Photo Attached (required for irrigation of 10+ acres)

☒ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
	Sta-Rite	1.5	C79Y	Sta-Rite	

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements:

MURRAY KFD


NOV 07 1994

PERMIT 36-08630 INIT ALL
T. R. S. Q/Q
P/D 45 16E 3 NWNE
SCALE _____
PHOTO ID. _____



NOV 07 1994

Ship No. 9 South, Range No. 16 East, of the Boise Mer

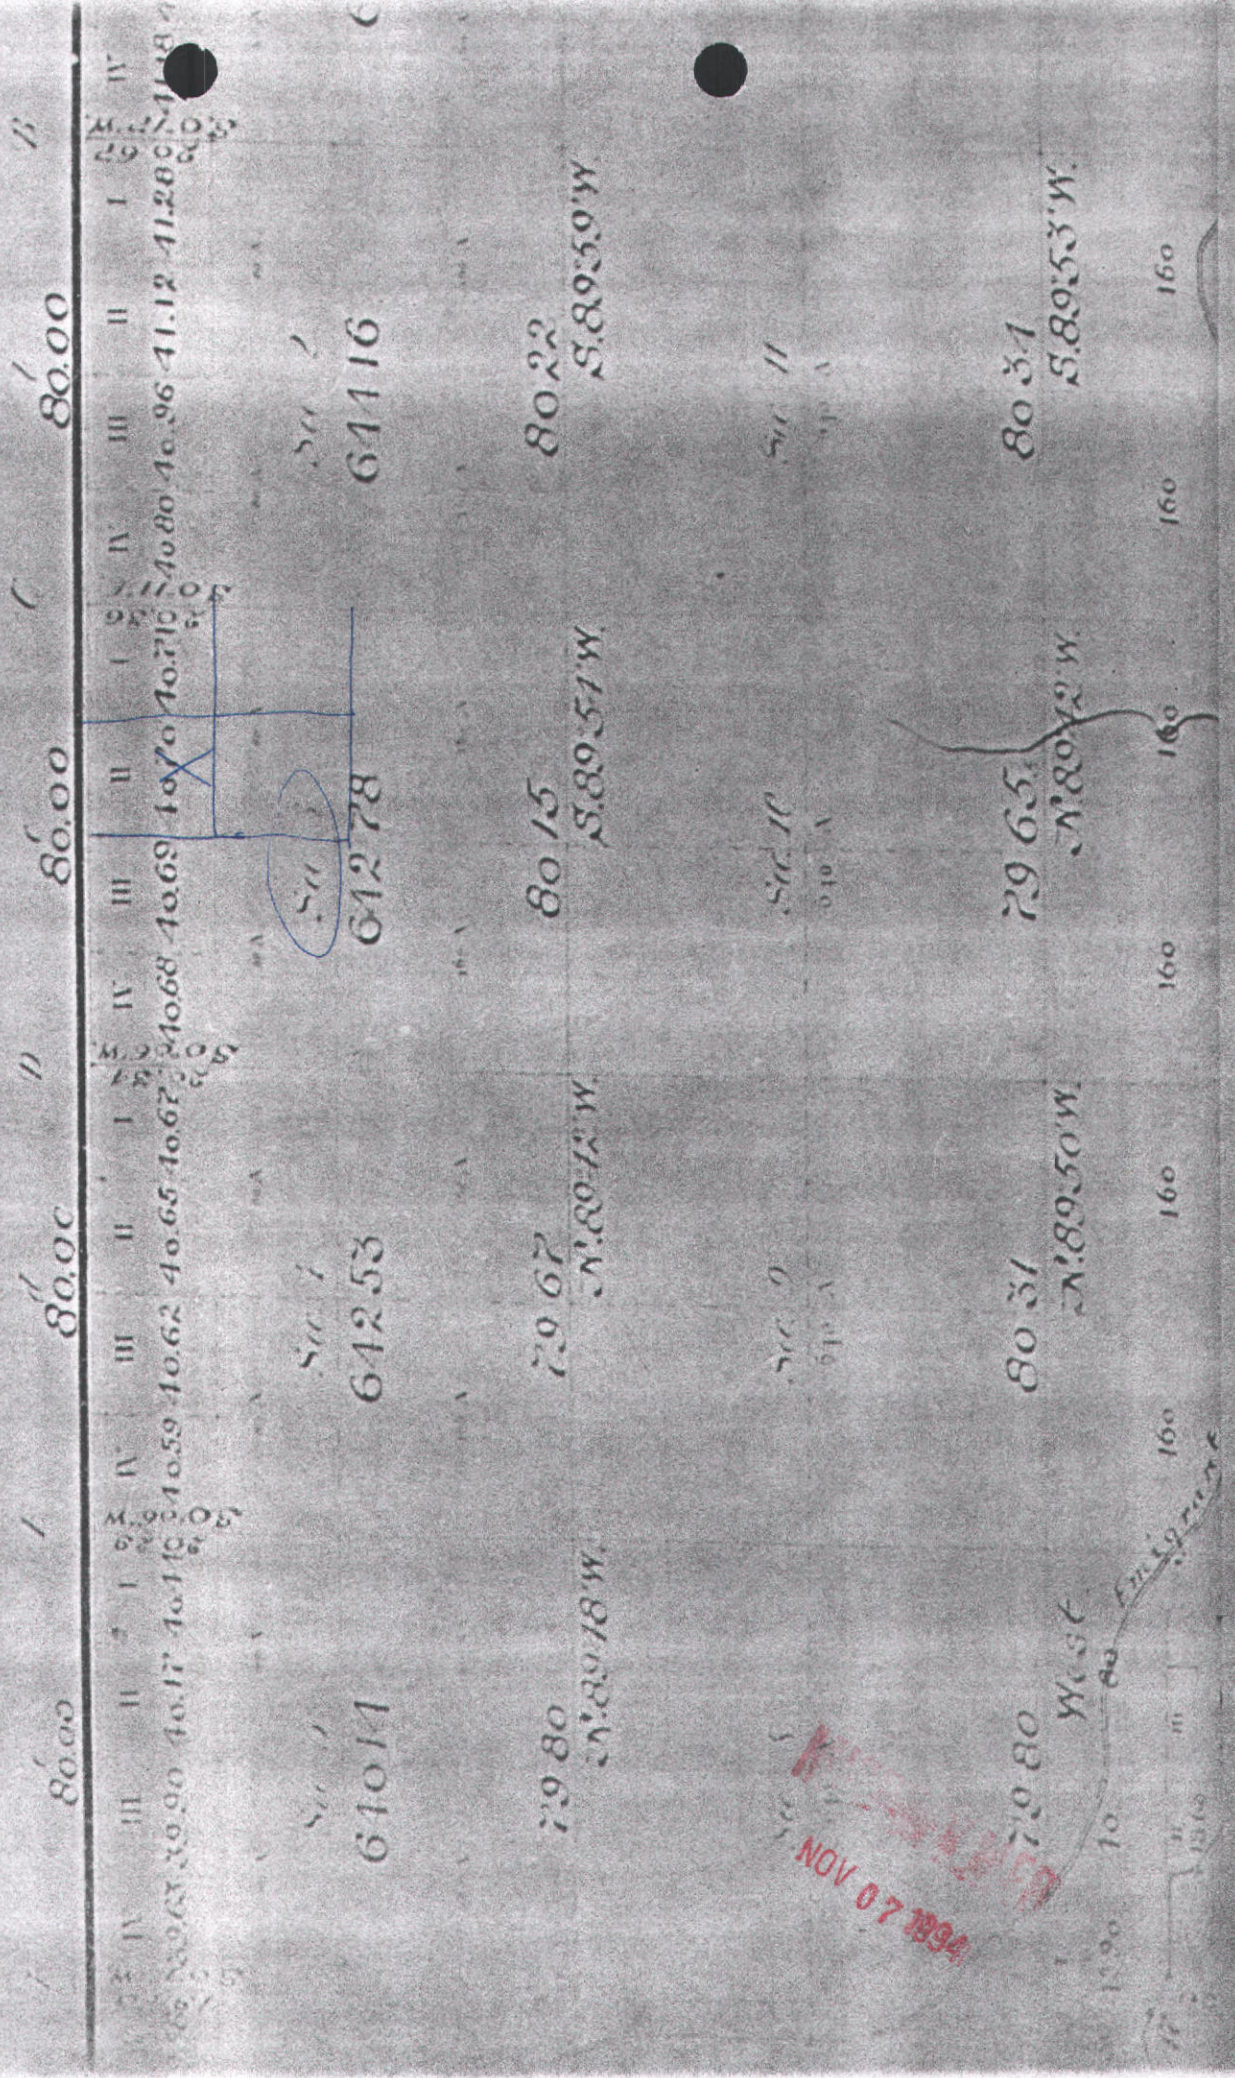

36-08630



#1

P/D
and
P/u

P/D



#2

P/u

NOV 07 1994

AFFIDAVIT of PUBLICATION

RECEIVED

State of Idaho }
County of Jerome } ss.

JAN 24 1992

Department of Water Resources
Southern Region Office

Patty Nance, being first duly sworn, deposes and says that she is the printer (publisher) of the Jerome North Side News, a newspaper published every week in Jerome, County of Jerome, State of Idaho; that said newspaper has been continuously and uninterruptedly published for a period of seventy-eight consecutive weeks prior to the first publication of the annexed notice, and is a newspaper qualified to publish legal notices as provided by act of the 1919 session of the legislature of the State of Idaho, known as House Bill 145; that the annexed advertisement was published once each week for

2 consecutive issues in said newspaper proper and not in a supplement; that the date of the first publication of said advertisement was on the 15th day of January, 1992, and the date of the last publication was on the 22nd day of January, 1992.

Subscribed and sworn to before me this 23rd day of January, 1992
(SEAL)

Norma DeVoe
NOTARY PUBLIC

NORTH SIDE NEWS
Jerome, Idaho

COST OF PUBLICATION

Number of Picas per Line _____
Number of Lines in Notice _____
Number of Insertions 24

Lines tabular at _____ 6¢/Pica
325 Lines straight at 110.25 5¢/Pica
Subsequent lines at 13.00 4¢/Pica
TOTAL COST 29.25

COPY OF NOTICE

(Paste Here)

Not. of App. Water rights
TITLE OF NOTICE
#36-08630

PLAINTIFF ATTORNEY

DEFENDANT

PLAINTIFF

J.D.W.R.
BILL TO

NOTICE OF APPLICATION FOR
WATER RIGHT
The Following application(s) have been filed to appropriate the public waters of the State of Idaho:
36-08630
SCANTLIN, ORVILLE
227 W 300 S
JEROME, ID 83338
Source: GROUNDWATER
Diversion Pt: NENWNE Sec 3 T 09S R 16E in JEROME County.
Use: DOMESTIC (.040 CFS)
Total Diversion (.040 CFS)
Date Filed: 11/7/1991
In: JEROME County
T09S R16E S03 NWNE
The permit(s) will be subject to all prior water rights. Protests must be filed with the Director, Dept. of Water Resources, Southern Region, 222 Shoshone Street East, Twin Falls, ID 83301 on or before FEBRUARY 3, 1992.
-s-R. Keith Higginson, Director
PUB: 1/15, 22 N11715

(Idaho Code, Rev. Statutes 1984)

7-8 pt. per line tabular.....6¢/Pica
7-8 pt. per line straight.....5¢/Pica
7-8 pt. per line successive insertions.....4¢/Pica

MICROFILMED
MAY 18 1992

No 5303
11715

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 36-08630

Priority: November 7, 1991

Maximum Diversion Rate:

0.04 CFS

Maximum Diversion Volume:

1.2 AF

This is to certify, that ORVILLE SCANTLIN

227 W 300 S

JEROME ID 83338

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated November 7, 1991; and has submitted Proof of Beneficial Use on April 7, 1993. An examination indicates that the works have a diversion capacity of .040 cfs of water from a GROUNDWATER source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	0.04 CFS	1.2 AF

LOCATION OF POINT(S) OF DIVERSION: Lot 2(NWNE), Sec. 3, Township 09S, Range 16E
JEROME County

PLACE OF USE: DOMESTIC


TWN RGE SEC

09S 16E 3 Lot 2(NWNE)

CONDITIONS/REMARKS:

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. Domestic use is for 1 home.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code, Witness the seal and signature of the Director, affixed at Boise, this 28TH day of OCTOBER, 1994.

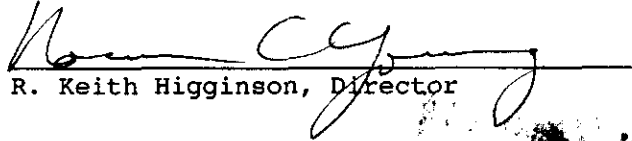Acting for  R. Keith Higginson, Director

NOV 07 1994

RECEIVED

APR - 8 1993

Department of Water Resources

OFFICE USE ONLY

Amt. of Fee \$ - 0 -

Date 4-7-93

Receipt No.

Receipt by KAC

RECEIVED

APR 07 1993

Department of Water Resources
Southern Region Office

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 36-08630 Telephone No. 208-324-3028

2. Name(s) of Permit Holder(s): Orville L. Scantlin

3. Mailing Address: 227 W 300 So Jerome, ID 83338

4. Source of Water: Groundwater

If GROUNDWATER, Well Driller's Name: Eaton Date Drilled: 1979

OPTIONAL:

Pump horsepower: 1 1/2 Pressure (psi): 40 Dynamic pumping level (ft.): 210

5. Extent of Use (as authorized by the permit):

Domestic 21 (No. of households) Stockwater NA (No. and type of stock)

Irrigation None (No. of acres) Other _____

6. Total rate and/or volume for which proof is submitted .04 cfs OR _____ acre/feet

7. Refer to the approval conditions on your permit and respond accordingly:

Measuring device: Required? Yes NO Installed? Yes No

OR

Flow Measurement Port: Required? Yes NO Installed? Yes No

8. Fee Enclosed: \$ NA (See License Fee Schedule on back of Instruction Sheet)

9. Person to contact to accompany the Department representative during field examination of the water system.

Name L. Ray Scantlin Telephone No. 208-324-3028

Address 227 W 300 So Jerome ID

10. The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

Date 4/7/93 Signature (and title, if on behalf of a company or organization) [Signature]

APR 09 1993

State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 36-08630

Proposed Priority: November 7, 1991 Maximum Diversion Rate: 0.04 CFS

This is to certify, that **ORVILLE SCANTLIN**
227 W 300 S
JEROME ID 83338

has applied for a permit to appropriate water from: **GROUNDWATER**
and a permit is **APPROVED** for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
-----------------------	----------------------	--------------------------

DOMESTIC	01/01 to 12/31	0.04 CFS
----------	----------------	----------

LOCATION OF POINT(S) OF DIVERSION: NWNE , Sec. 3, Township 09S, Range 16E
JEROME County

PLACE OF USE: DOMESTIC
TWN RGE SEC

09S 16E 3 NWNE

CONDITIONS/REMARKS:

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before **May 3, 1993**.
2. Subject to all prior water rights.
3. Permit holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
4. Domestic use is for 1 home.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this

7th day of April, 1992

R. Keith Higginson
for R. Keith Higginson, Director

MICROFILMED
MAY 18 1992

RECEIVED

NOV 07 1991

Form 202
6/85

Ident. No. 36-08630

STATE OF IDAHO Department of Water Resources
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

1. Name of applicant Orville SCANTLIN Phone 324-3028

Post office address 227W 300 50 Jerome ID

2. Source of water supply WELL which is a tributary of _____

3. Location of point of diversion is NE ¼ of NW ¼ of NE ¼, Govt. Lot _____

Sec. 3 Township 9S Range 16E B.M. JEROME County; additional

points of diversion if any: NONE

4. Water will be used for the following purposes:

Amount .04 for Domestic purposes from 1-1 to 12-31 (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated is (a) .04 and/or (b) _____
cubic feet per second acre feet per annum

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc. 8" WELL APPROX 225' DEEP
WITH A SUBMERSIBLE PUMP TIED INTO A PRESSURE TANK
SYSTEM PUMP IS A 1.5 HP.

b. Height of storage dam N/A feet; active reservoir capacity _____ acre-feet; total
reservoir capacity _____ acre-feet; period of year when water will be diverted to storage:
_____ to _____ inclusive.

c. ~~Proposed~~ well diameter is 8" inches; ~~proposed~~ depth of well is 225' feet.

d. Is ground water with a temperature of greater than 90°F being sought? No

7. Time required for the completion of the works and application of the water to the proposed beneficial use is

1 years (minimum 1 year)

RECORDED
MAY 18 1992

8. Description of proposed uses (if irrigation only, go to item 9):

- a. Hydropower; show total feet of head and proposed capacity in KW. _____
- b. Stockwatering; list number and kind of livestock. _____
- c. Municipal; show name of municipality. _____
- d. Domestic; show number of households. 1 HOME WITH YARD
- e. Other; describe fully. _____

9. Description of place of use:

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RANGE	SEC.	NE¼				NW¼				SW¼				SE¼				TOTALS
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	
9S	16E	3		D															

Total number of acres to be irrigated _____

10. Describe any other water rights used for the same purposes as described above. CANAL CO. WATER FOR IRRIGATION

11. a. Who owns the property at the point of diversion? APPLICANT


b. Who owns the land to be irrigated or place of use? SAME

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing. _____

12. Remarks: _____

MICROFILMED

MAY 18 1992

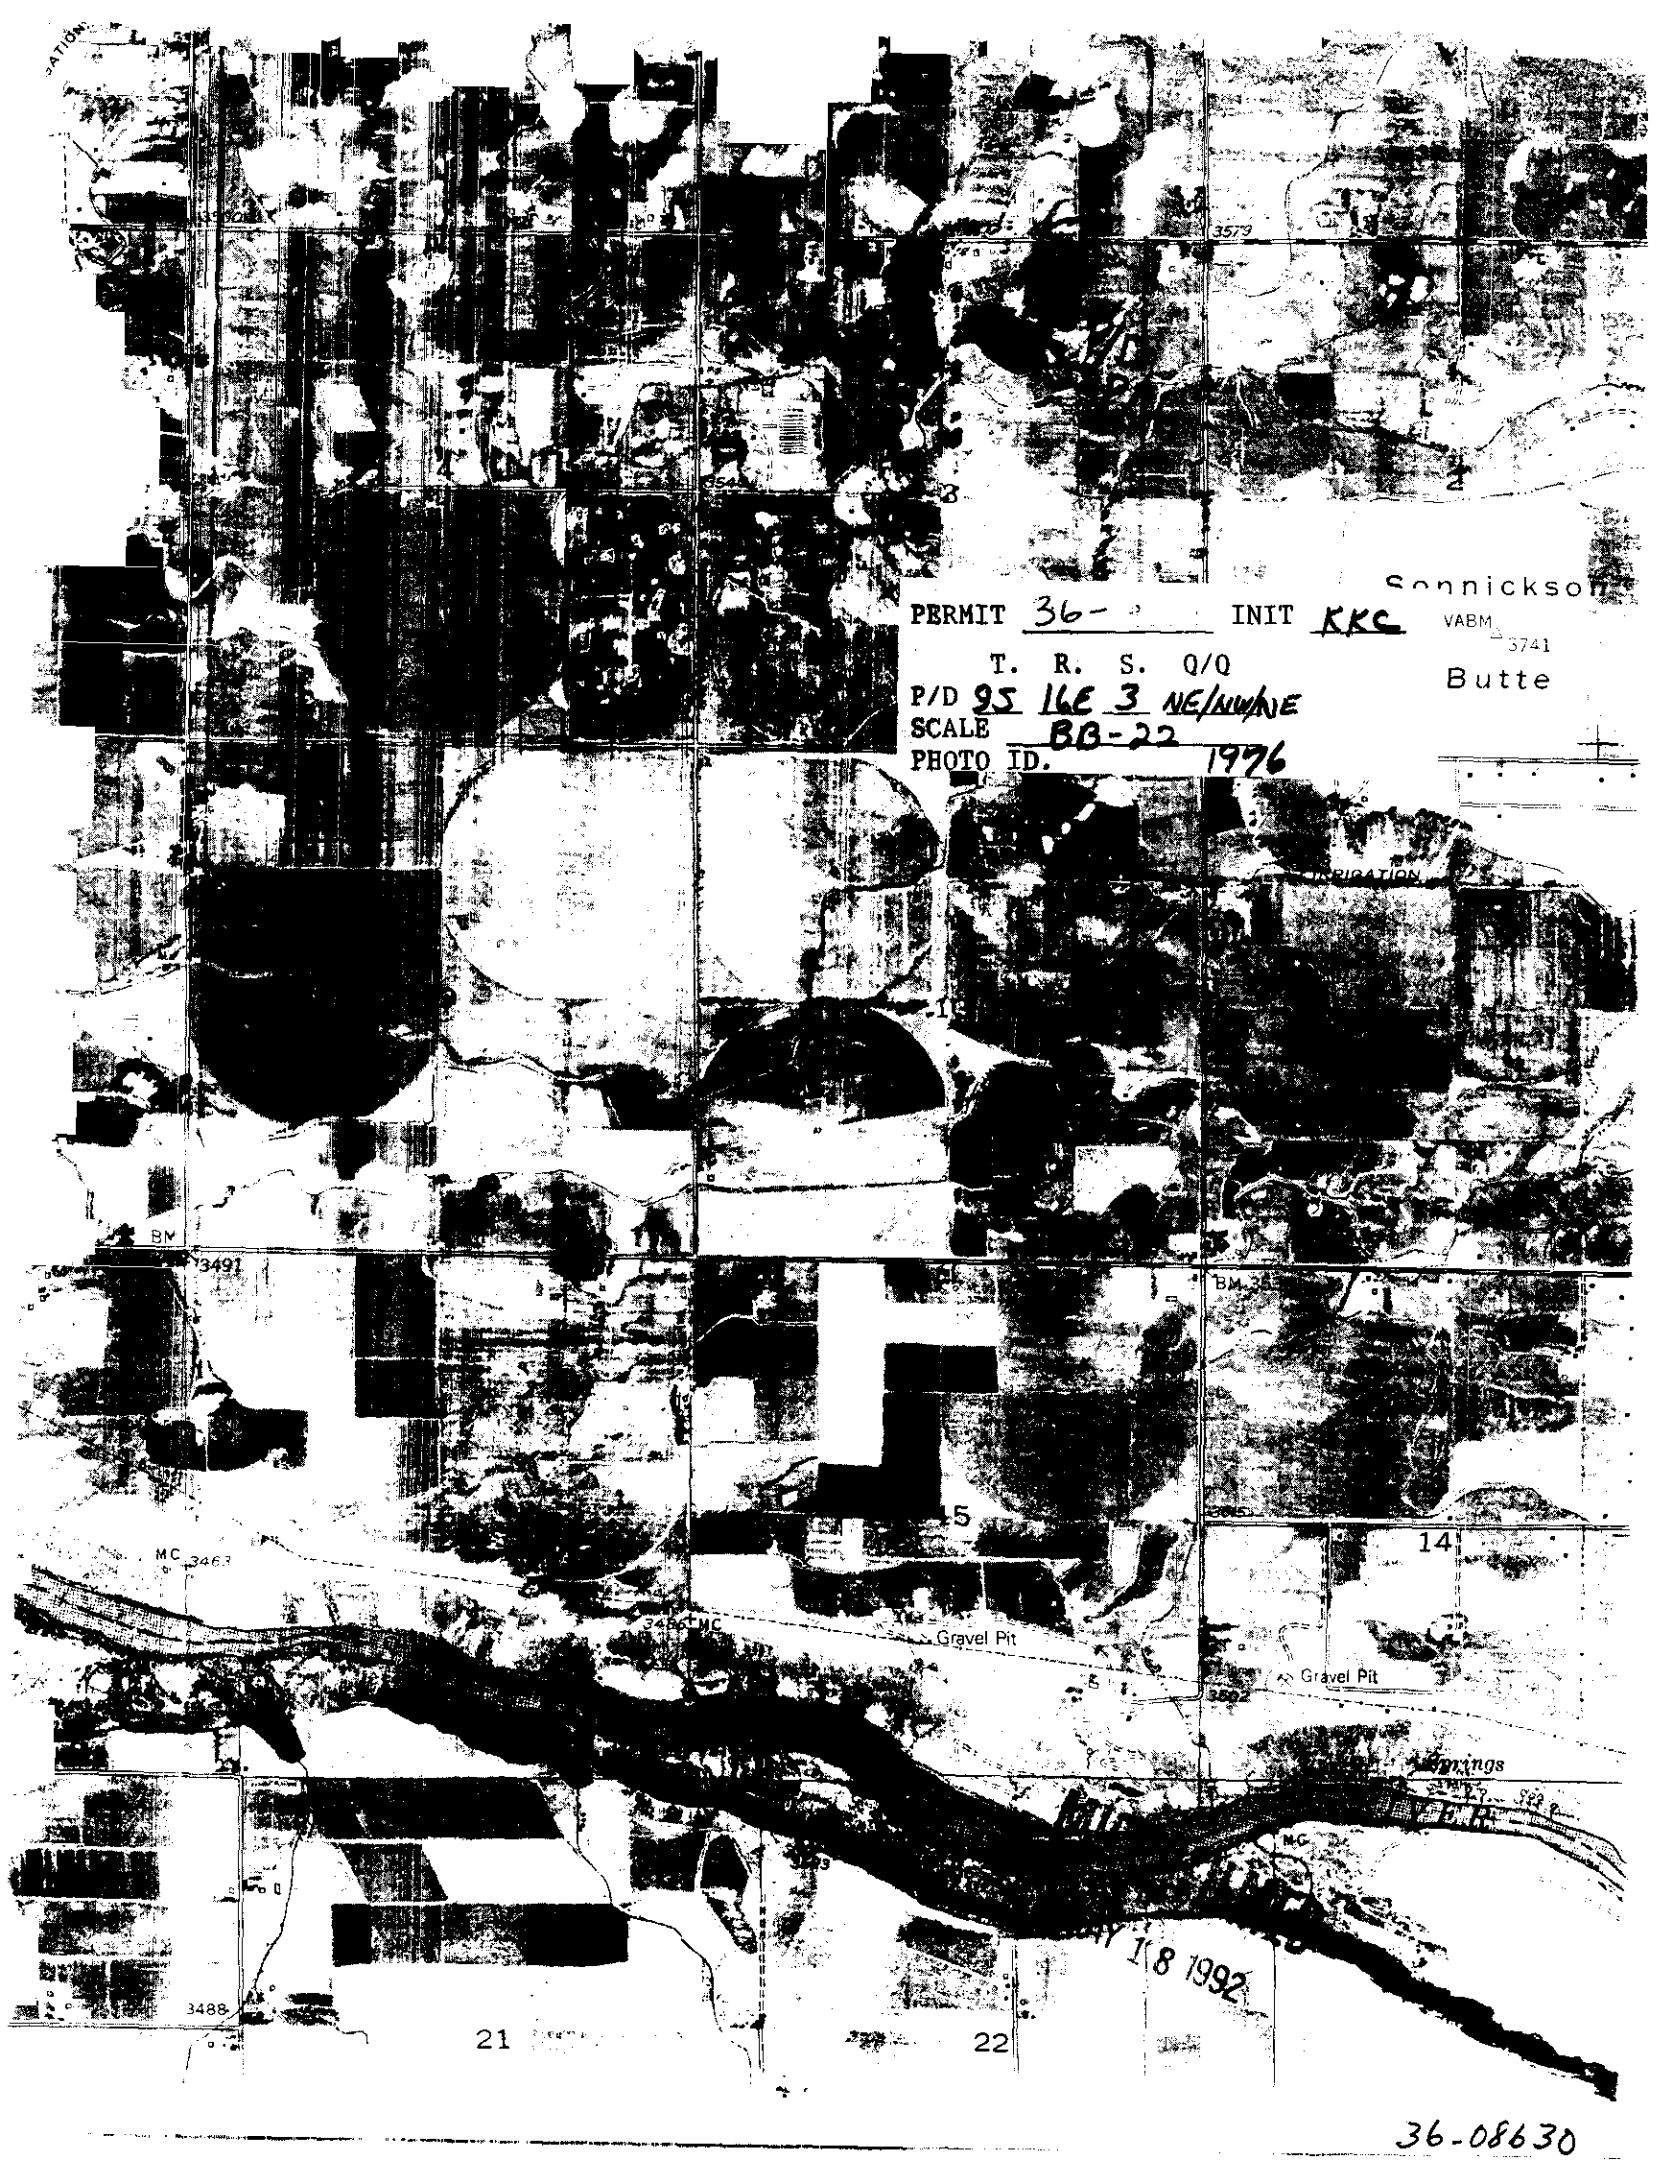

PERMIT 36- INIT KKC
T. R. S. Q/O
P/D 95 16E 3 NE/44NE
SCALE BB-22
PHOTO ID. 1976

Sonnicksen

VABM 5741

Butte

14

5

Gravel Pit

Gravel Pit

Spring


18 1992

21

22

36-08630

13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

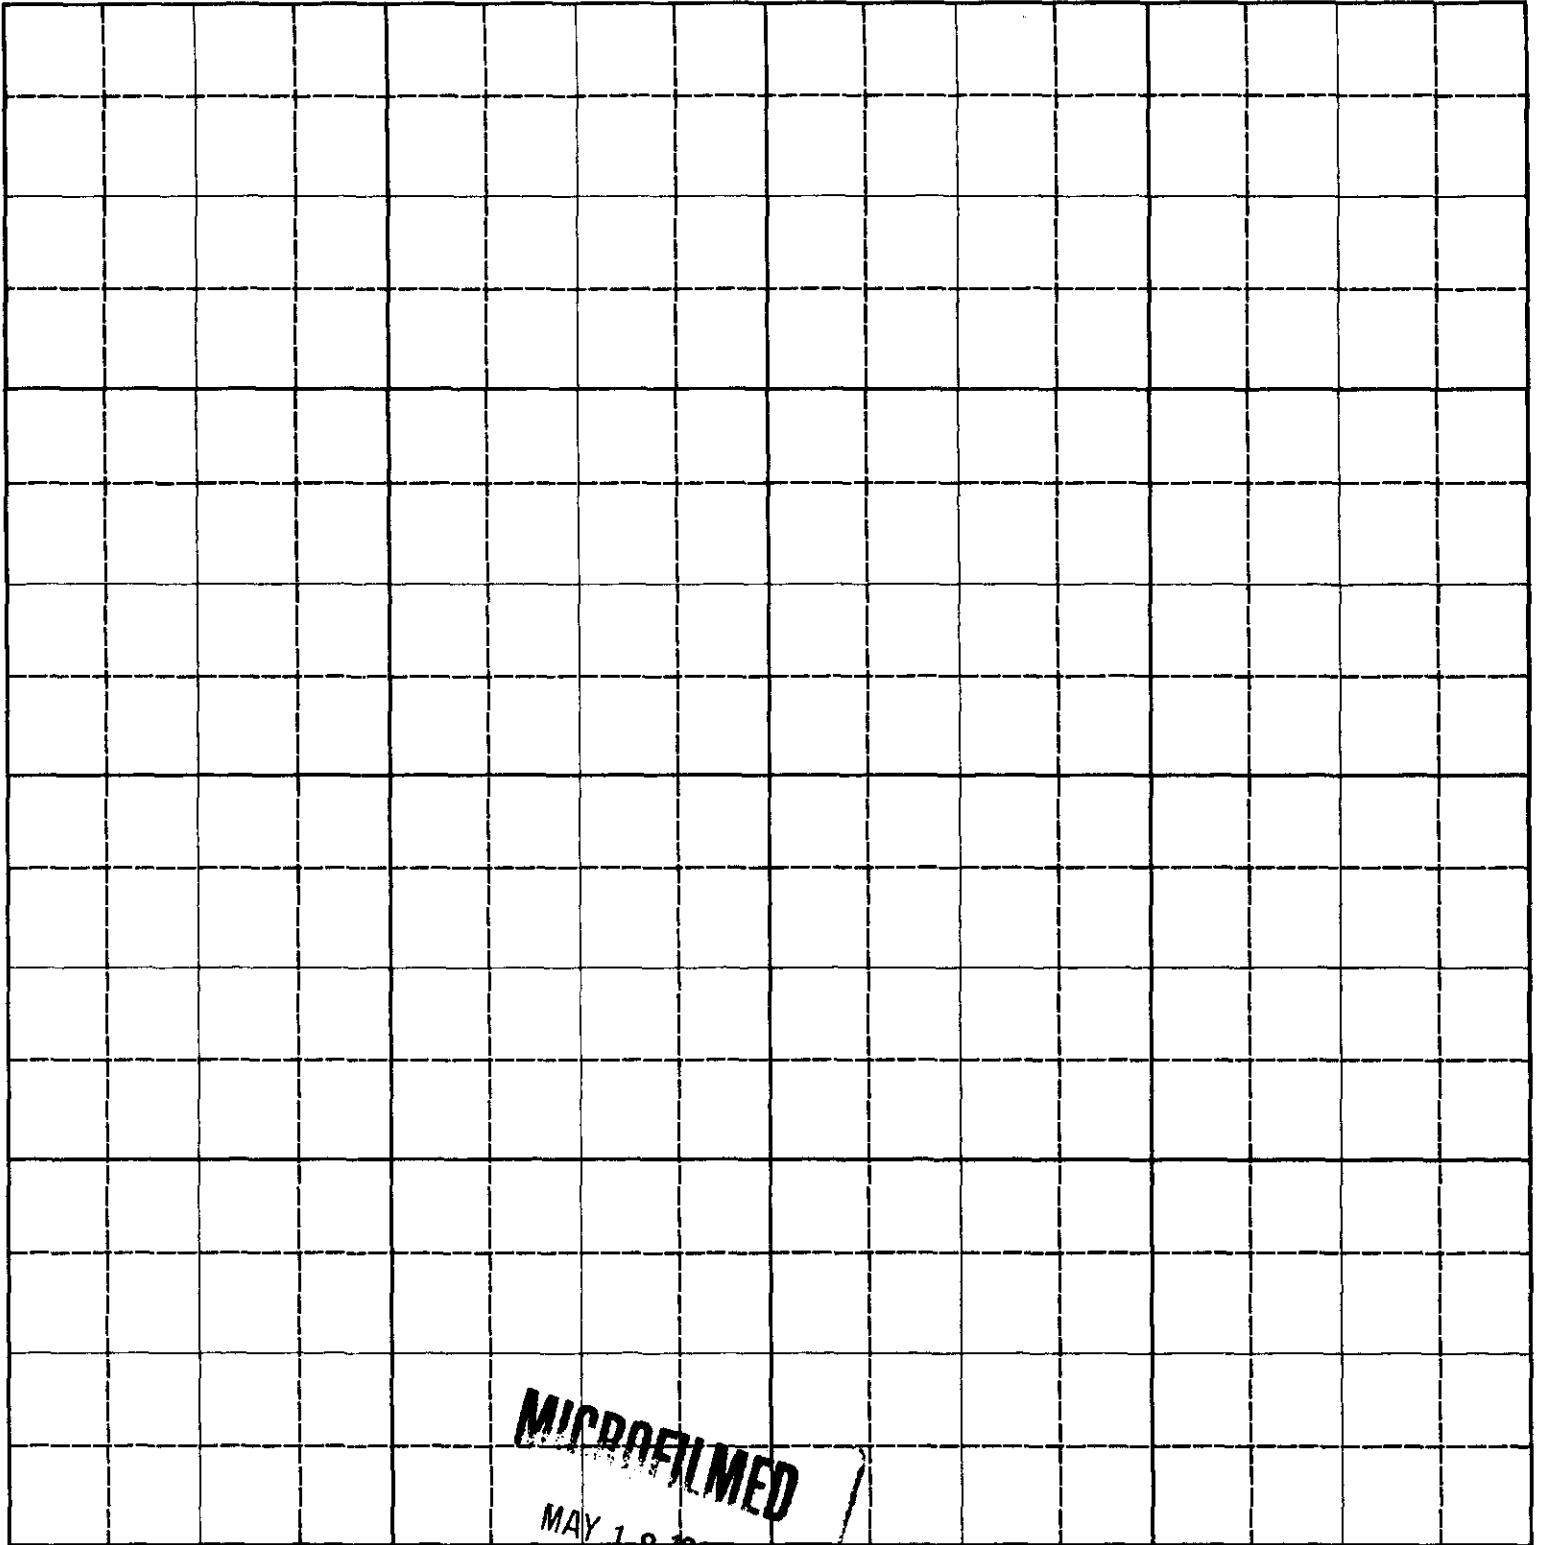

MICROFILMED
MAY 18 1992

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Orville J. Pennington
(Applicant)

Received by KKC Date 11-7-91 Time 1:15 Preliminary check by A.D.
Fee \$ 30.00 Receipted by KKC # 5013868 Date 11-7-91
Publication prepared by MB Date 1/8/92 Published in North Side News
Publication approved MBaldwin Date 2-4-92

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. _____, and said application is hereby _____.

1. Approval of said application is subject to the following limitations and conditions:

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
- b. Proof of construction of works and application of water to beneficial use shall be submitted on or before _____, 19____.
- c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.
- d. The water right acquired under this permit if for hydropower purposes shall be junior and subordinate to all rights to the use of water, other than hydropower, within the State of Idaho that are initiated later in time than the priority of this permit and shall not give rise to any right or claim against any future rights to the use of water, other than hydropower, within the State of Idaho initiated later in time than the priority of this permit.
- e. Other:

MICROFILMED

MAY 18 1992



State of Idaho
DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000
Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

November 2, 1994

ORVILLE SCANTLIN
227 W 300 S
JEROME ID 83338

RE: WATER RIGHT NO. 36-08630

Dear Water Right Holder(s):

Enclosed is a copy of the Water Right License issued on the above referenced permit. If you have any questions, please contact me within 10 days of receipt of this license.

Sincerely,

Shelley W. Keen
Water Rights Supervisor

SK:dc

Enclosure

RECEIVED
NOV 07 1994

LICENSE REVIEW CHECKLIST

PERMIT NO. 36-08630 DATE 10-18-94



NAME	Yes ☐	No ☒	Or Address Change?
PRIORITY DATE	☐	☒	Advance? ☐ Advanced to: _____ Order to reinstate needed? _____ Incorrect fee for rate recommended? <u>N/A</u>
SOURCE	☐	☒	Changes or just clarification of originally intended source? _____ Notice of Intent to Void necessary? _____
POINT OF DIV	☐	☒	Amendment needed? <u>Add Gov Lot 2</u> Overlaps? _____
PLACE OF USE	☐	☒	Amendment needed? <u>Add Gov Lot 2</u> Overlaps? _____
DIV RATE	☐	☒	Permit/fee limits: <u>.04 CFS</u> Meas Q = _____ Theo Q = <u>.04</u> Recommend: <u>.04</u> _____ Combined rates exceed capacity _____
ANNUAL VOLUME	☐	☒	Season of use: _____ Calculations: <u>Standard domestic @ 1.2</u> Flow limit: _____ cfs x _____ x 1.9835 = _____ Combined volumes exceed capacity/allowable _____
USES	☐	☒	Change in Nature of Use or additional uses? _____ Amendment necessary? _____
REMARKS	☐	☒	Multiple p/d(s) in 1/4 1/4? _____ Other _____
CONDITIONS	☐	☒	Measuring/Locking Devices _____ Watermaster control - District _____ Irrigation Overlap _____ Water Quality _____ Other _____ Heat/Cool/ Fish verified _____

COMMENTS: _____

RECOMMENDED	CFS	VOL	SRBA Claim Filed	NO-NA
<u>Domestic</u>	<u>.04</u>	<u>1.2</u>	Adjustment Memo Needed	<u>NO</u>
_____	_____	_____	LICENSE	☒
_____	_____	_____	1ST AMENDMENT LETTER	_____
_____	_____	_____	FINAL AMENDMENT LETTER	_____



STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED

SEP 21 1994

Department of Water Resources

A. GENERAL INFORMATION

Permit No. 36-08630

1. Owner: Orville Scantlin Phone No. 324-3028

Current Address: 227 W. 300 S. Jerome, ID 83338

2. Accompanied by: Mrs. Scantlin EXAM DATE: 6-10-94

Address: Same as above Phone No. Same as above

Relationship to Permit Holder: Wife

3. Source: Ground water tributary to None

B. OVERLAP REVIEW

1. Other water rights with the same place of use: None

2. Other water rights with the same point of diversion: None

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident No.	Gov't Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
	2		NW	NE	3	9S	16E	Jerome	USGS Photo Quad map


2. Place(s) of Use:

Indicate Method of Determination

TWP	RGE	SEC	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
9S	16E	3		D															
				42															

NOV 07 1994

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe I.D. as applicable.

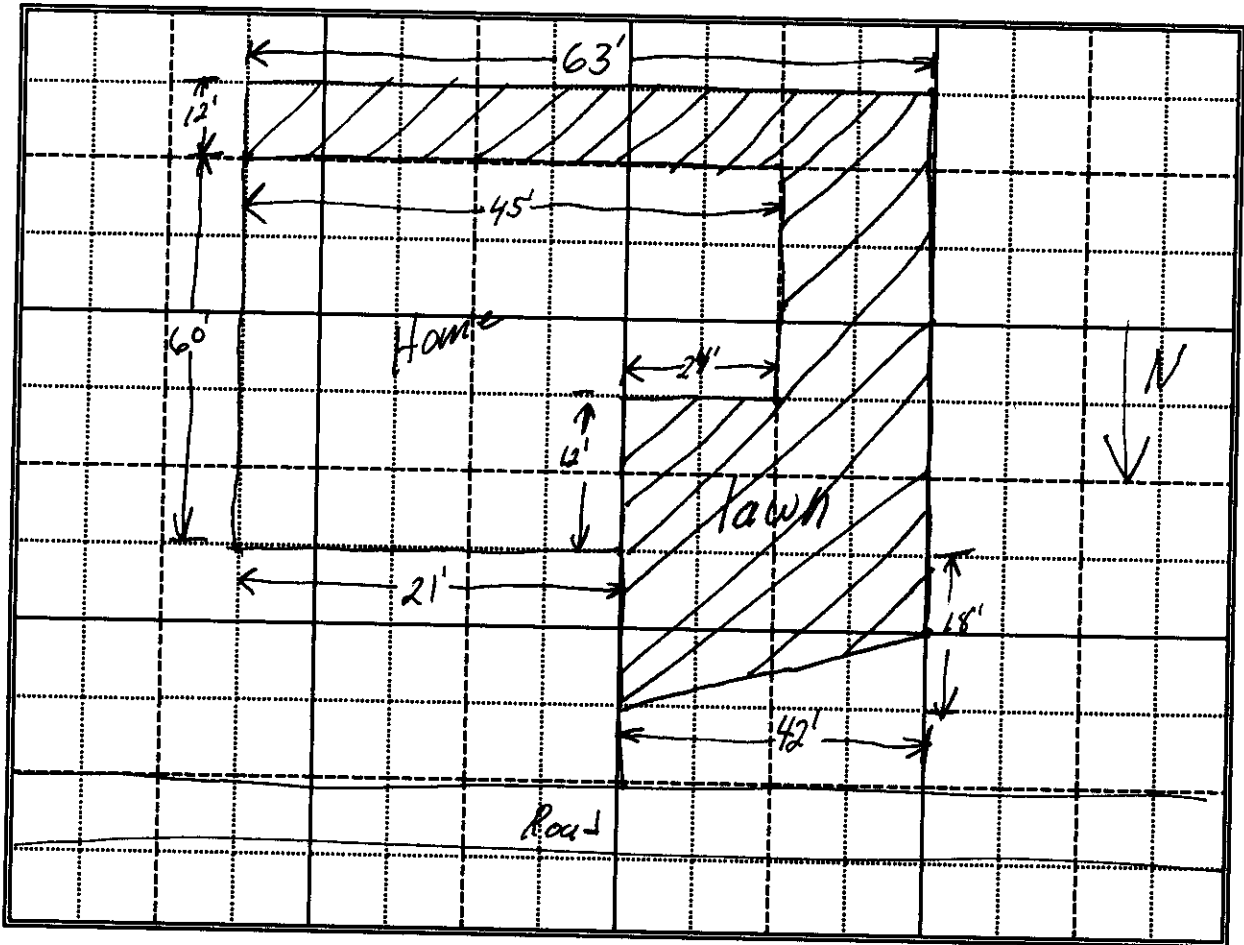

Scale: 1" = 100' Scale

☒ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

☐ Aerial Photo Attached (required for irrigation of 10+ acres)

☒ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
	Sta-Rite	1.5	C79Y	Sta-Rite	

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements:

NOV 07 1994

E. NARRATIVE/REMARKS/COMMENTS

No overlaps were found to exist.

See Narrative Attachment

Have conditions of permit approval been met? ☒ yes ☐ no

APPROVED
NOV 07 1994

Additional Computation Sheets Attached

Measured Method:

$$Q = \frac{1.5(8.814)(.70)}{120 + 40(2.308)} = .04 \text{ cfs}$$

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = 07(4.0) = 28$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = 04(2.15) / 1.9835 = 17.06$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = 17.06$$

$$V = \text{Smaller of } V_{LR} \text{ and } V_{DR} = \underline{2.8}$$

2. Volume Calculations for Other Uses:

~~Stock: $5(12) = 60$ gpd~~
~~people: $4(60) = 240$ gpd~~
 ~~300 gpd or $.34$ ac-ft~~
~~annum~~

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
<u>Domestic</u>	<u>1-1</u>	<u>12-31</u>	<u>.04</u>	<u>1.2</u>
<u> </u>	<u> </u>	<u> </u>	<u> </u>	<u> </u>
<u> </u>	<u> </u>	<u> </u>	<u> </u>	<u> </u>
<u> </u>	<u> </u>	<u> </u>	<u> </u>	<u> </u>
<u> </u>	<u> </u>	<u> </u>	<u> </u>	<u> </u>
Totals:			<u>.04</u>	<u>1.2</u>

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

I. AUTHENTICATION

Field Examiner's Name Alan Hansen Date 6-13-94

Reviewer _____ Date _____

SEAL

SECRET

NOV 07 1994

36-08630

Narrative Attachment

The point of diversion (well) is located to the west of the home and lawn. The lawn is irrigated with hoses and sprinklers. 2 horses and sometimes some calves are kept in the pasture and watered by the domestic well. A theoretical calculation was used to determine flow and it was found that the system is capable of pumping the permitted amount of .04 CFS.

NOV 07 1994

GROUNDWATER MEASUREMENT REQUIREMENT ANALYSIS

FILE: 36-08630

DATE: 6-13-94

BY: Alan Hanstey

THEORETICAL RATE OF FLOW: $Q = \frac{(8.8) \times (\text{H.P.}) \times (\text{EFF.})}{\text{TDH}}$

Q = CFS

H.P. = Total Brake Horsepower of pumping plant (including booster)

EFF. = Pumping plant efficiency (ASSUME 70% OR 0.70)

TDH = total dynamic head = [(LIFT) + (PSI X 2.31)]

LIFT = depth to water in FEET from land surface to pumping water level

PSI = pumping pressure measured in psi near pump
(if open discharge assume zero [0])

$$Q = \frac{(8.8) \times (\dots 1.5 \dots) \times (0.70)}{[(\dots 120 \dots) + (\dots 40 \dots \times 2.31)]} = \underline{.04 \text{ cfs}}$$

LIFT FROM:

measurement ()

owner ()

area estimate ()

well logs (X)

Booster (Y) (X)

PSI FROM:

measurement ()

owner ()

estimate (X)

owner gage ()

NOTES ON PUMP:

Motor Make, Serial or ID

Sta-Rite, C79Y

Pump Make, Serial or ID, rating

Sta-Rite

REMARKS

ANNUAL VOLUME ANALYSIS Sec Back

$$\text{POTENTIAL Acre Feet/Acre/Annum} = \frac{(\text{DAYS IN SEASON}) \times (1.98) \times (Q)}{(\text{RECOMMENDED ACRES IRRIGATED})}$$

(season)	(days)	
3/15 - 11/15	246	(.....) X (1.98) X (.....)
4/1 - 11/1	215	POTENTIAL =
4/15 - 10/15	184	
3/1 - 12/1	276	(.....)

POTENTIAL =

REQUIRED Acre Feet/Acre/Annum =

(AF/Ann/Ac irrigation requirement from chart for area)

NOTE that this is NOT Consumptive use

IF POTENTIAL IS GREATER THAN REQUIRED THEN NO MEASUREMENT NECESSARY ()

IF POTENTIAL IS LESS THAN REQUIRED THEN MEASUREMENT IS NECESSARY ()

NOV 07 1994

4 people in residence

$$4(60) + 2(12) + 3(12) = 300 \text{ gpd} = 109,500 \text{ gal/yr}$$

$$= .34 \frac{\text{acre-ft}}{\text{annum}}$$

NOV 07 1994

PERMIT 36-08636 INIT

T. R. S. Q/Q

P/D 45 16E 3 NWNE

SCALE

PHOTO ID.

Sonnicks

VAR

3741

Butte

5

14

Gravel Pit

Gravel Pit

Marinas

BM 35

NOV 07 1994

Rock

2

22

36-08630



#1

P/D
and
P/u



#2

P/u

NOV 07 1994

April 9, 1993

ORVILLE SCANTLIN
227 W 300 S
JEROME ID 83338

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 36-08630

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water.

If you have questions concerning this matter, please feel free to contact the SOUTHERN Regional Office in Twin Falls at (208)736-3033.

Sincerely,

Karen L. Gustafson
Secretary/Records Manager

c: IDWR - Region

MICROFILMED

APR 09 1993

February 28, 1993

ORVILLE SCANTLIN
227 W 300 S
JEROME ID 83338

PROOF DUE NOTICE

RE: PERMIT NO. 36-08630

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before May 1, 1993. (See last page of your approved permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a complete field examination report prepared by a certified water right examiner may be used to submit the required proof.


If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.

Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.

SINCERELY,

Karen L. Gustafson
Secretary/Records Manager

Enclosures

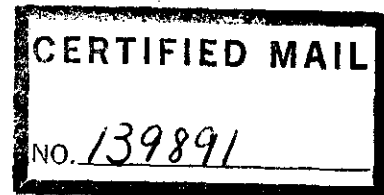

RECEIVED

APR 09 1993

April 9, 1993

ORVILLE SCANTLIN
227 W 300 S
JEROME ID 83338

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 36-08630

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water.

If you have questions concerning this matter, please feel free to contact the SOUTHERN Regional Office in Twin Falls at (208)736-3033.

Sincerely,

Karen L. Gustafson
Secretary/Records Manager

c: IDWR - Region

MICROFILMED

APR 09 1993



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

April 9, 1992

ORVILLE SCANTLIN
227 W 300 S
JEROME ID 83338

PERMIT APPROVAL NOTICE

RE: PERMIT NO. 36-08630

Dear Permit Holder:

Enclosed is a copy of your approved application for permit. We direct your attention to the conditions of approval on the final page.

Enclosed is a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit. Also enclosed is a form entitled "Proof of Beneficial Use". If your project is already completed you should complete and submit this form immediately.

Section 42-235, Idaho Code, requires that a "drilling permit" must be obtained from the department for all wells constructed after July 1, 1987. A drilling permit is a separate permit that must be issued in addition to your permit to appropriate water. Commencement of well construction or diversion of water under your permit to appropriate water is prohibited unless a drilling permit is obtained.

Sincerely,

PAMELA SKAGGS
Technical Records Specialist

PS:clh

Enclosures

MICROFILMED

MAY 18 1992

AFFIDAVIT of PUBLICATION

RECEIVED

State of Idaho }
County of Jerome } ss.

JAN 24 1992

Department of Water Resources
Southern Region Office

Patty Nance, being first duly sworn, deposes and says that she is the printer (publisher) of the Jerome North Side News, a newspaper published every week in Jerome, County of Jerome, State of Idaho; that said newspaper has been continuously and uninterruptedly published for a period of seventy-eight consecutive weeks prior to the first publication of the annexed notice, and is a newspaper qualified to publish legal notices as provided by act of the 1919 session of the legislature of the State of Idaho, known as House Bill 145; that the annexed advertisement was published once each week for

2 consecutive issues in said newspaper proper and not in a supplement; that the date of the first publication of said advertisement was on the 15th day of January, 1992, and the date of the last publication was on the 22nd day of January, 1992.

Subscribed and sworn to before me this 23rd day of January, 1992
(SEAL)

Norma De Voe
NOTARY PUBLIC

NORTH SIDE NEWS
Jerome, Idaho

COST OF PUBLICATION

Number of Picas per Line _____
Number of Lines in Notice _____
Number of Insertions 24

Lines tabular at _____ 6¢/Pica
325 Lines straight at 10.25 5¢/Pica
Subsequent lines at 13.00 4¢/Pica
TOTAL COST 29.25

COPY OF NOTICE

(Paste Here)

Not. of App. Water Rights
TITLE OF NOTICE
#36-08630

PLAINTIFF ATTORNEY

DEFENDANT

PLAINTIFF

S.D.W.R.
BILL TO

The Following application has been filed to appropriate the waters of the State of Idaho:

SCANTLIN, ORVILLE
227 W 300 S
JEROME, ID 83338

Source: GROUNDWATER
Diversion From: NEVADIAN Sec. 3 T10S2
106th JEROME County

Use: DOMESTIC (640 CFS)
Total Diversion: (640 CFS)

Date Filed: 11/7/1991
In: JEROME County

THIS NOTICE IS TO BE FILED WITH THE DIRECTOR, DEPT. OF WATER RESOURCES, SOUTHERN REGION, 227 SHOSHONE STREET, JEROME, ID 83301, ON OR BEFORE FEBRUARY 1, 1992.

The permit(s) will be used for _____ or water rights. Protests must be filed with the Director, Dept. of Water Resources, Southern Region, 227 Shoshone Street, Jerome, Idaho 83301, on or before FEBRUARY 1, 1992.

J.R. Reid, Manager, District
PUB: 1/15/92

(Idaho Code, Rev. Statutes 1984)

7-8 pt. per line tabular.....6¢/Pica
7-8 pt. per line straight.....5¢/Pica
7-8 pt. per line successive
insertions.....4¢/Pica

MAILED
MAY 18 1992

No 5303
11715

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

36-08630

SCANTLIN, ORVILLE
227 W 300 S
JEROME, ID 83338

Source: GROUNDWATER

Diversion Pt: NENWNE Sec 3 T 09S R 16E in JEROME County.

Use: DOMESTIC (.040 CFS)
Total Diversion: (.040 CFS)

Date Filed: 11/ 7/1991

In: JEROME County
T09S R16E S03 NWNE

The permit(s) will be subject to all prior water rights. Protests must be filed with the Director, Dept. of Water Resources, Southern Region, 222 Shoshone Street East, Twin Falls, ID 83301 on or before FEBRUARY 3, 1992.

R. JOHNSON, Director

Published: 1/15/1992 & 1/22/1992

MICROFILMED
MAY 18 1992

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Southern Region
222 Shoshone Street East
Twin Falls, ID 83301
(208)736-3033

JANUARY 8, 1992

NORTH SIDE NEWS
PO BOX 468
JEROME, ID 83338

Gentlemen:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before FEBRUARY 3, 1992.

Yours truly,

Mary Baldwin
Secretary/Office Coordinator

Enclosure

REPROFILMED

JAN 18 1992



State of Idaho

DEPARTMENT OF WATER RESOURCES

Southern Region, 222 Shoshone St. East, Twin Falls, Idaho 83301 (208) 736-3033

08-Jan-1992

CECIL D. ANDRUS
Governor

R. KEITH HIGGINSON
Director

ORVILLE SCANTLIN
227 W 300 S
JEROME ID 83338

Re: Application for Permit No. 36-08630

Dear Mr. Scantlin:

The Department of Water Resources acknowledges receipt of your water right application for permit. The application has been assigned the above referenced identification number. Please refer to this number in all further correspondence.

This office will be advertising the application in the North Side News on 1/15 & 1/22/92. A period of ten days following the second publication will be allowed for the submittal of protests.

If the application is protested you will be sent a copy of the protest. The protest must be resolved before the application is approved or denied. If the protest is not resolved voluntarily, this Department will conduct a conference and/or hearing on the matter.

If the application is not protested, it will be forwarded to our State Office in about five weeks. State office personnel will conduct a complete review prior to final processing of the application and will notify you of the outcome of this review. When a permit is issued, you will be sent a copy. A typical processing time for an unprotested application is about eight weeks.

Please feel free to contact this office if you have any questions regarding this procedure.

Very truly yours,

Gary Funderburg
Sr. Water Resource Agent

GF:MB

RECEIVED

MAY 18 1992