



79-07207

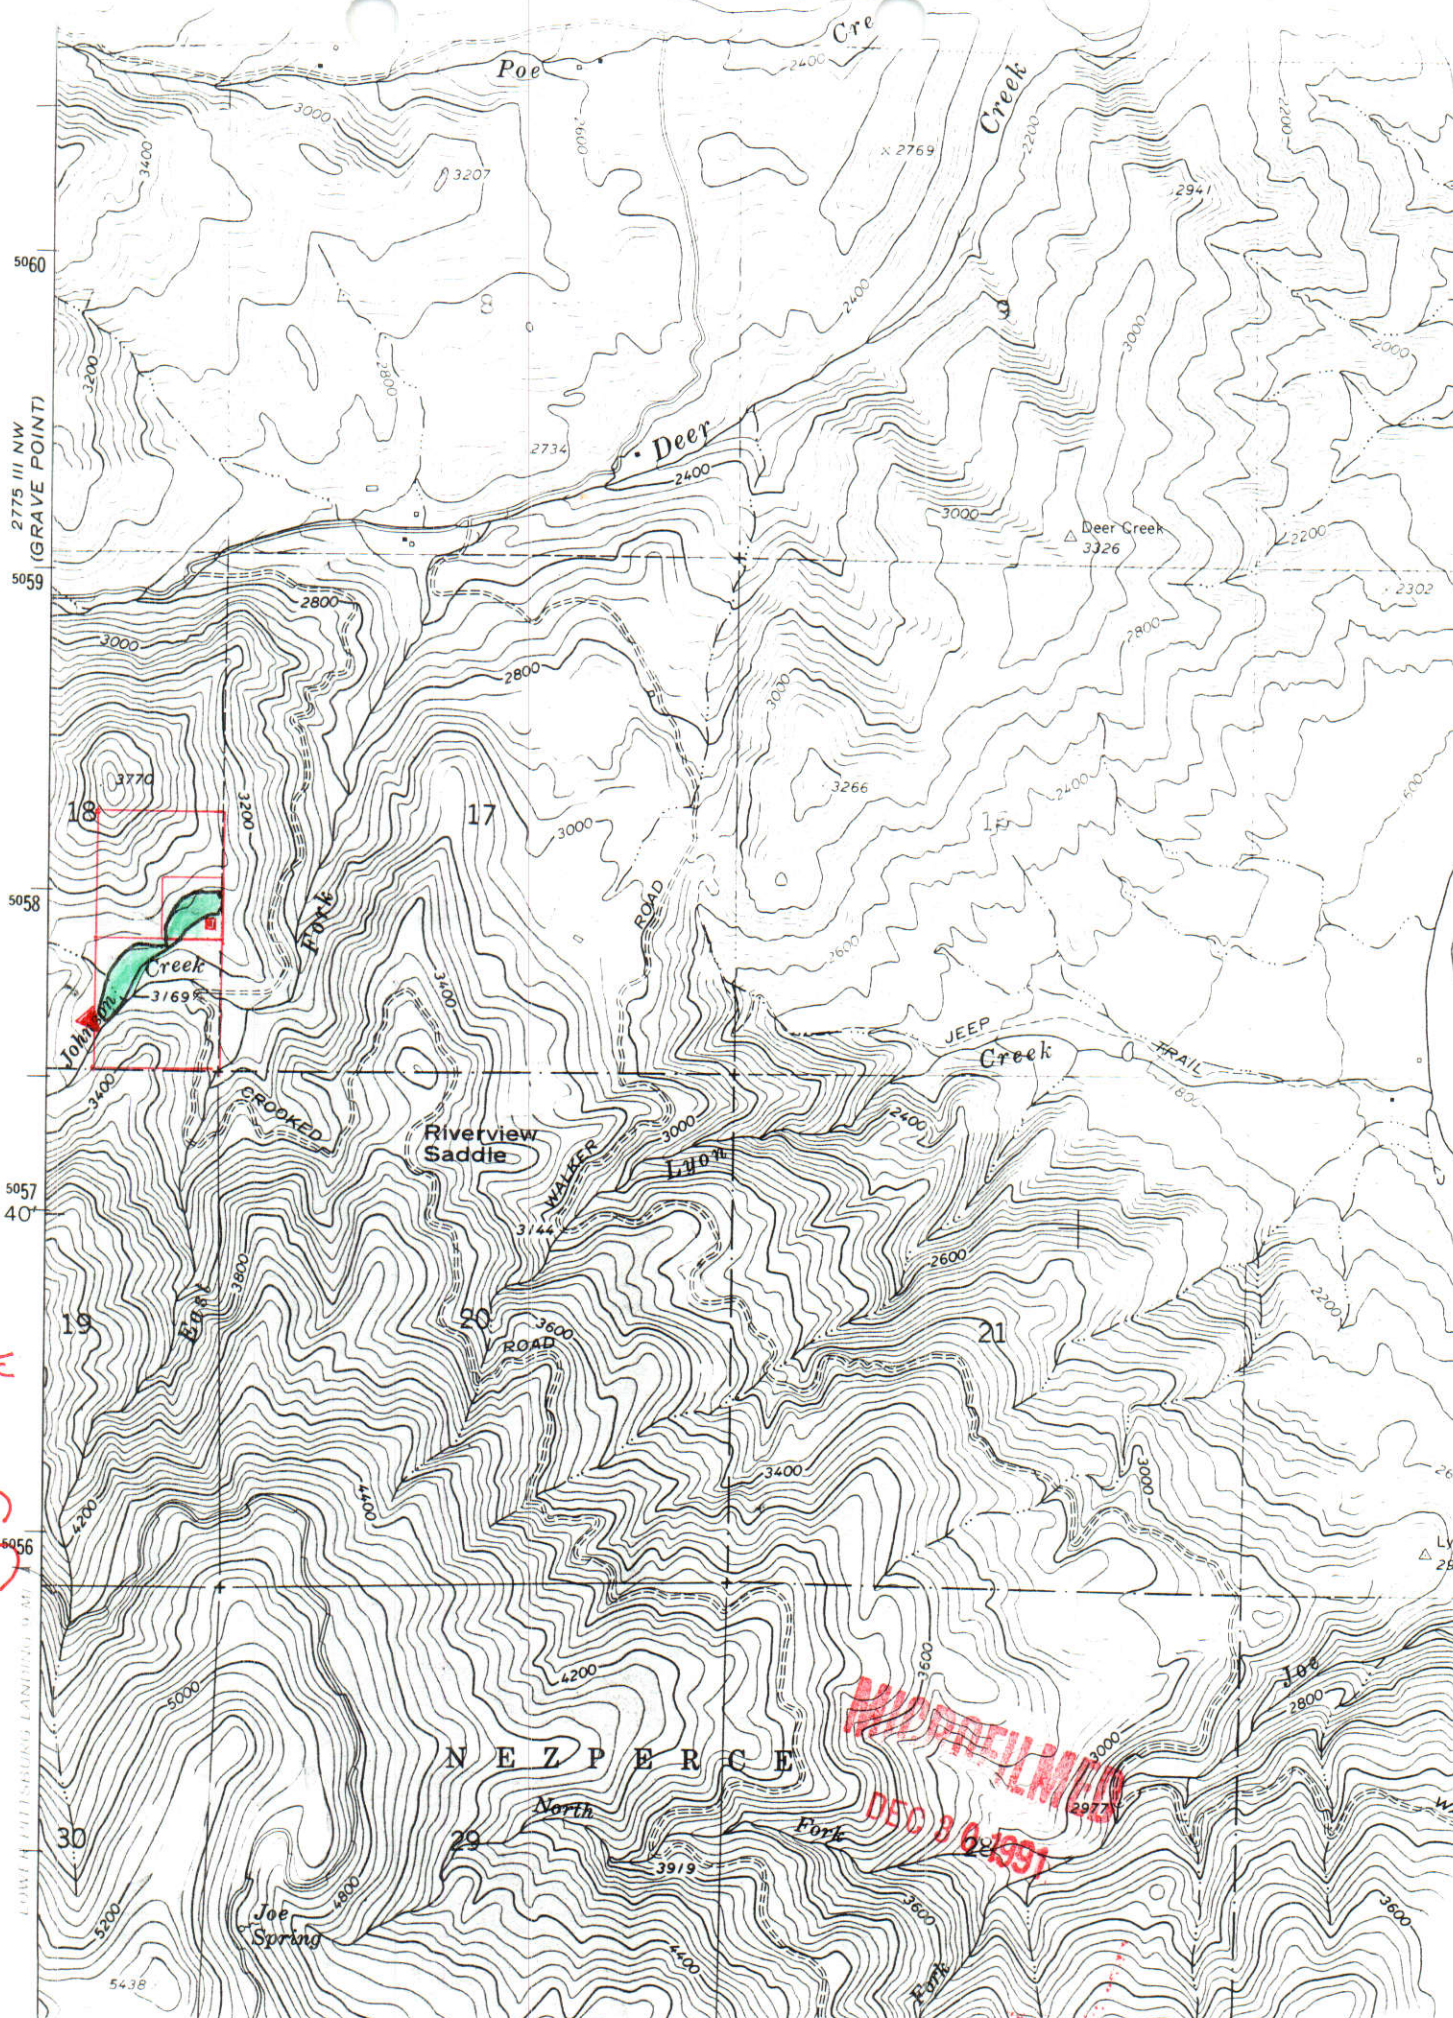

T27N
R1E
S18
P/D
SWSESE
P/W
SESE(7)
NESE(3)

UNRECORDED
DEC 8 6 1991

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

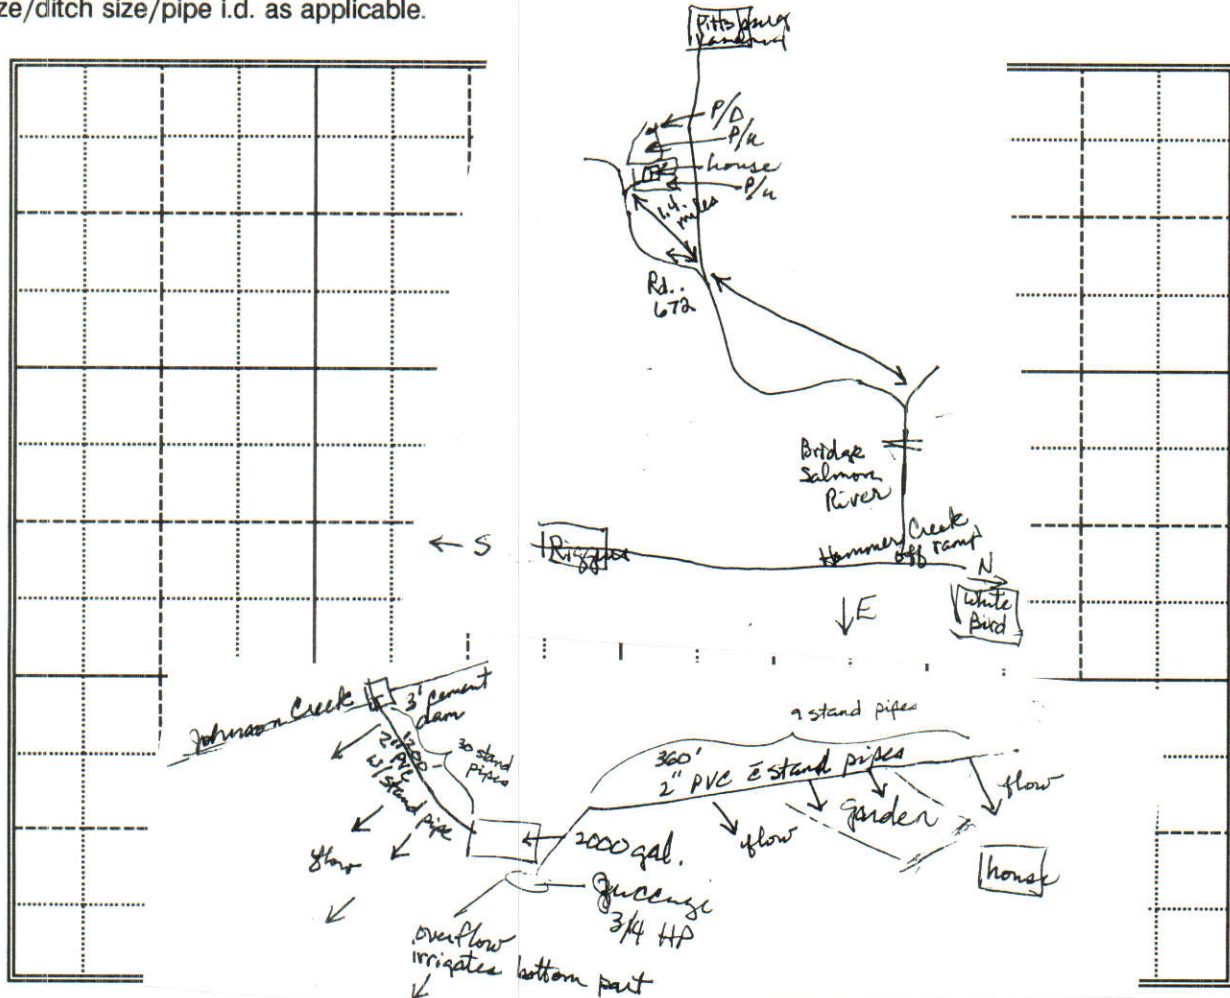

Scale: 1" = _____

☒ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

☒ Aerial Photo Attached*
(required for irrigation of 10+ acres)

☒ Photo of Diversion and System Attached

* per ASIS office, this map is not to scale

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
		3/4	~~510D194238~~	Grucci model# IRM 2-S/A	SWD194238 2"

*Code to correspond with No. on map and aerial photo


D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: _____

NOV 15 1995

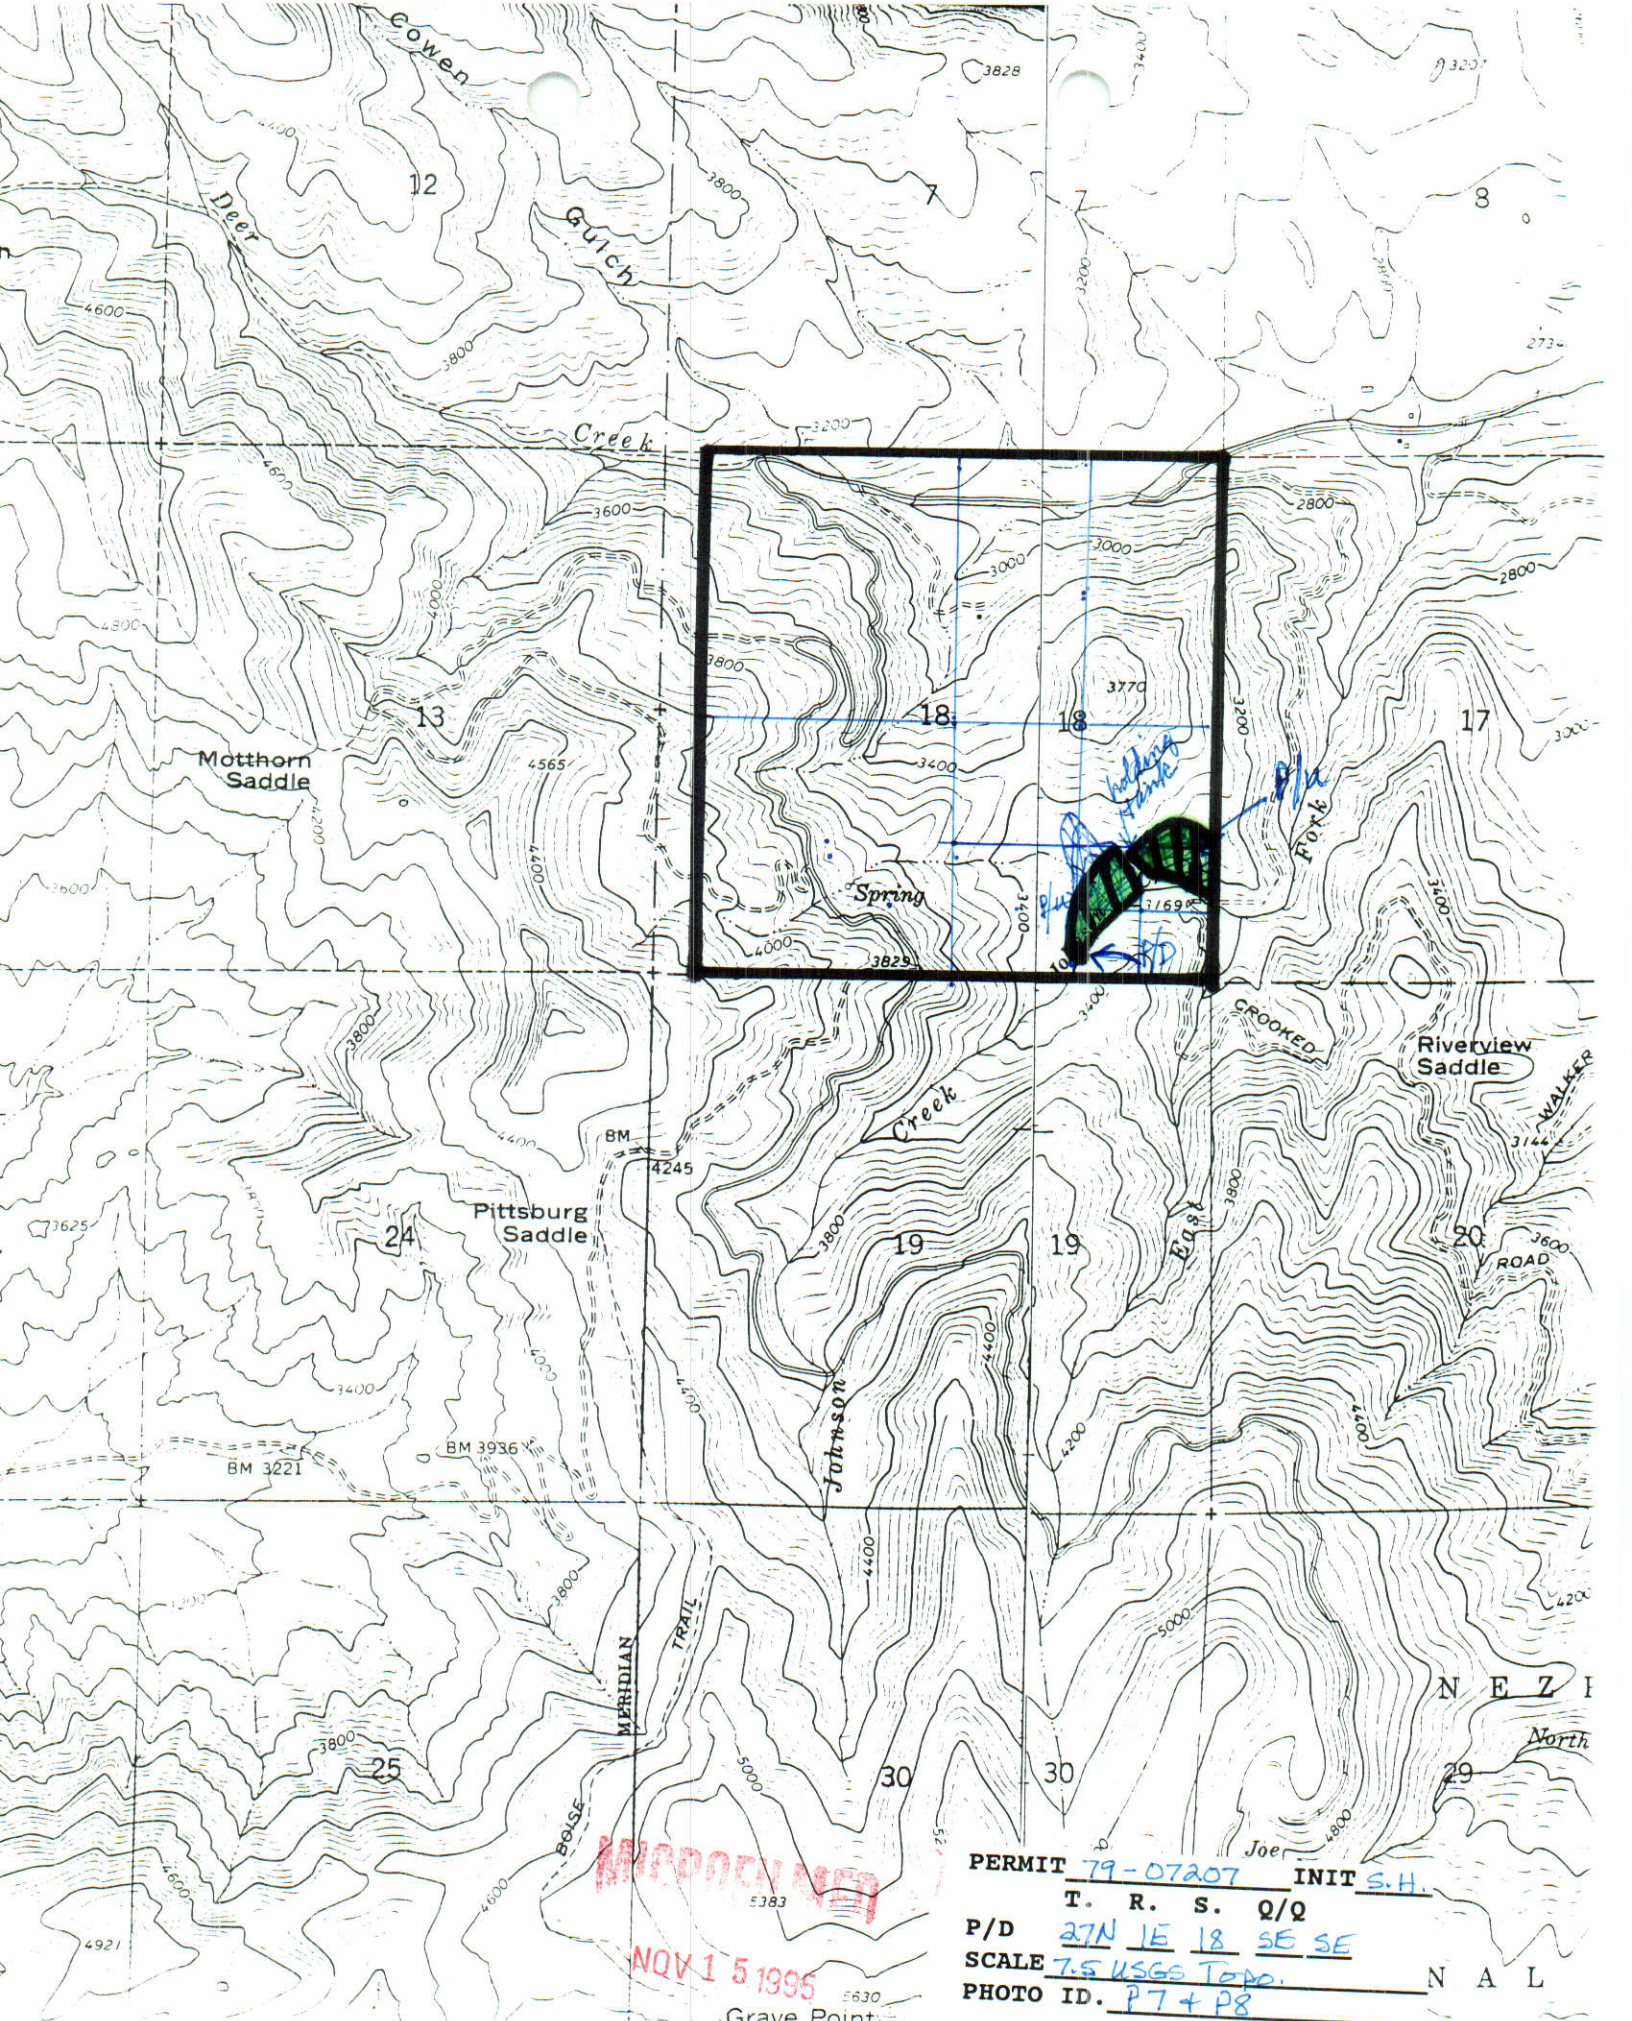

NOV 15 1995

Grave Point

PERMIT 79-07207 INIT S.H.
T. R. S. Q/Q
P/D 27N 1E 18 SE SE
SCALE 7.5 USGS Topo.
PHOTO ID. P7 + P8

FRANKLIN


hidden tank

91

Permit No. 79-07207
P/D: T27N R1E S18 SESE
ASGS Aerial Map

NOV 15 1995
*Map not to
scale per
USGS

S.H.

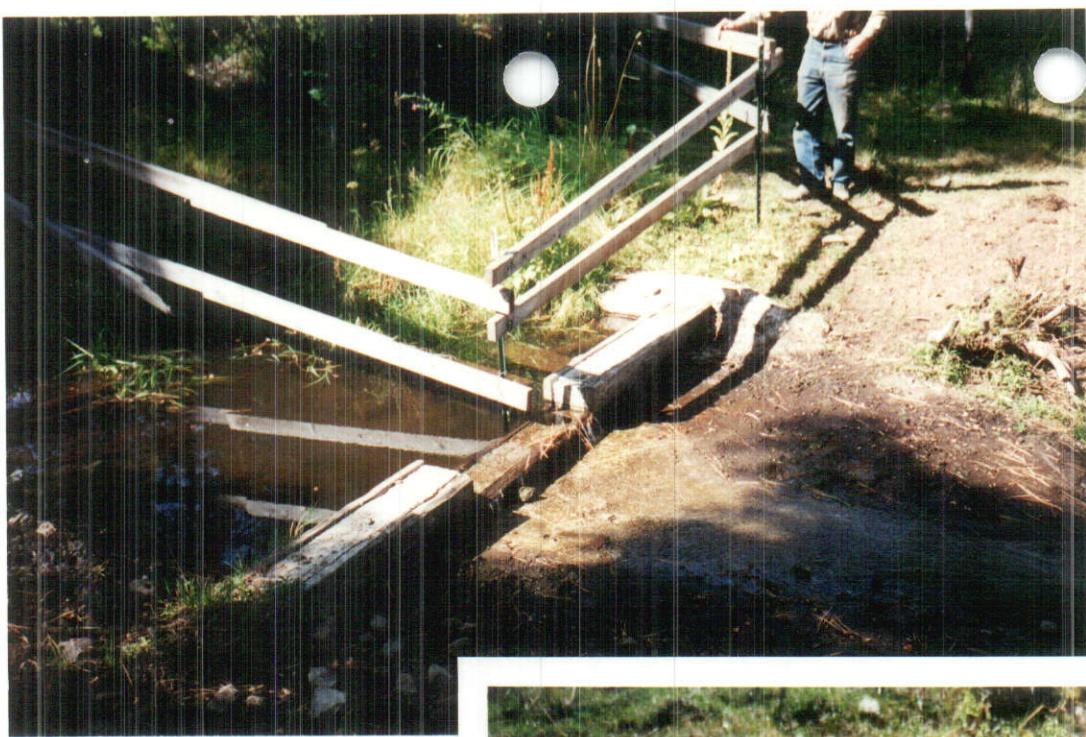

79-07207
9/22/95 S.H.

P/D:
Johnson Creek - 3'
cement dammed
area w/ overflow
continuing down
Johnson Creek.
A 2" PVC pipe
diverting to 30
40' sections w/ 1 stand pipe
each.

P/U:
1 stand pipe per
40' section of
2" PVC; 1 stand
pipe opened at
a time to flow
irrigate (gravity
flow)



P/U: pasture

2000' gallon holding tank

NOV 15 1995

2" PVC line, every
40' a stand pipe
to flood irrigate




79-07207
9/22/95 S.H.

2000' gallon
holding tank

Jacuzzi 40-60psi
3/4 HP, mod. # 1RM2-5/A
serial #
SWD194238

Jacuzzi 3/4 HP
mod. # 1RM2-5/A
serial # SWD194238
40-60psi

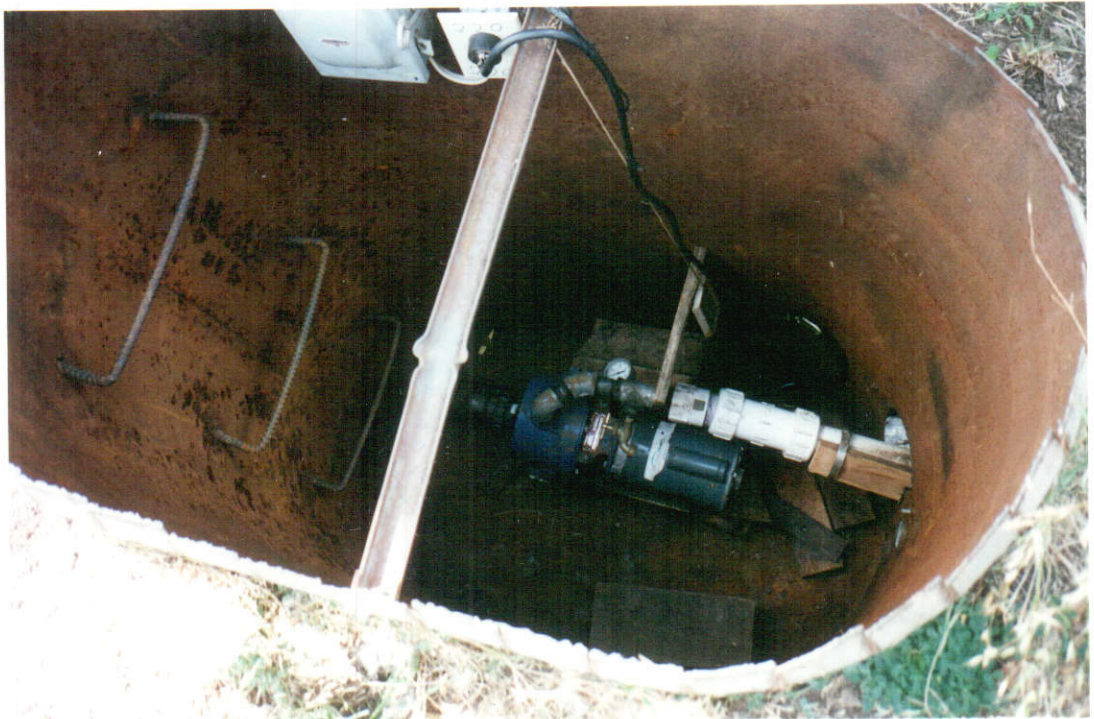

P/u:
40' 2" PVC w/ 9
stand pipe +
hoses to flood
irrigate + drip
system in garden

NOV 15 1995

State of Idaho
Department of Water Resources

AMENDED

WATER RIGHT LICENSE

AMENDED

WATER RIGHT NO. 79-07207

Priority: September 17, 1991

Maximum Diversion Rate:

0.20 CFS

Maximum Diversion Volume:

40.0 AF

This is to certify, that FRANKLIN TAYLOR

HC 04 BOX 103

WHITE BIRD ID 83545

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated September 16, 1991; and has submitted Proof of Beneficial Use on December 2, 1992. An examination indicates that the works have a diversion capacity of 0.200 cfs of water from:

JOHNSON CREEK

tributary to DEER CREEK, EAST FORK

source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
IRRIGATION	03/01 to 11/30	0.20 CFS	40.0 AF

LOCATION OF POINT(S) OF DIVERSION:

SESE, Sec. 18, Township 27N, Range 01E
IDAHO County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
27N	01E	18	NESE 3	SESE 7		10

Total number of acres irrigated: 10

CONDITIONS OF APPROVAL AND REMARKS

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount that can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. This right when combined with all other rights shall provide no more than .02 cfs per acre nor more than 4.0 afa per acre for irrigation of the lands above.

RECORDED

DEC 11 1992

State of Idaho
Department of Water Resources

AMENDED

WATER RIGHT LICENSE

AMENDED

WATER RIGHT NO. 79-07207

This license is issued pursuant to the provisions of Section 42-219, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this 22ND
day of OCTOBER, 1997.


Acting for KARL J. DREHER, Director

DEC 11 1997

DEC 11 1997

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 79-07207

Priority: September 17, 1991

Maximum Diversion Rate:

0.11 CFS

Maximum Diversion Volume:

40.0 AF

This is to certify, that FRANKLIN TAYLOR
HC 04 BOX 103

WHITE BIRD ID 83545 has complied with the terms and conditions
of the permit, issued pursuant to Application for Permit dated September 16, 1991; and
has submitted Proof of Beneficial Use on December 2, 1992. An examination indicates
that the works have a diversion capacity of 0.110 cfs of water from:

JOHNSON CREEK

tributary to DEER CREEK, EAST FORK

source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
IRRIGATION	03/01 to 11/30	0.11 CFS	40.0 AF

LOCATION OF POINT(S) OF DIVERSION:

SESE , Sec. 18, Township 27N, Range 01E
IDAHO County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
27N	01E	18	NESE 3	SESE 7		10

Total number of acres irrigated: 10

CONDITIONS OF APPROVAL AND REMARKS

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount that can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. This right when combined with all other rights shall provide no more than .02 cfs per acre nor more than 4.0 afa per acre for the lands above.

NOV 15 1995


State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 79-07207

This license is issued pursuant to the provisions of Section 42-219, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this 8TH
day of NOVEMBER, 1995.


Acting for KARL J. DREHER, Director

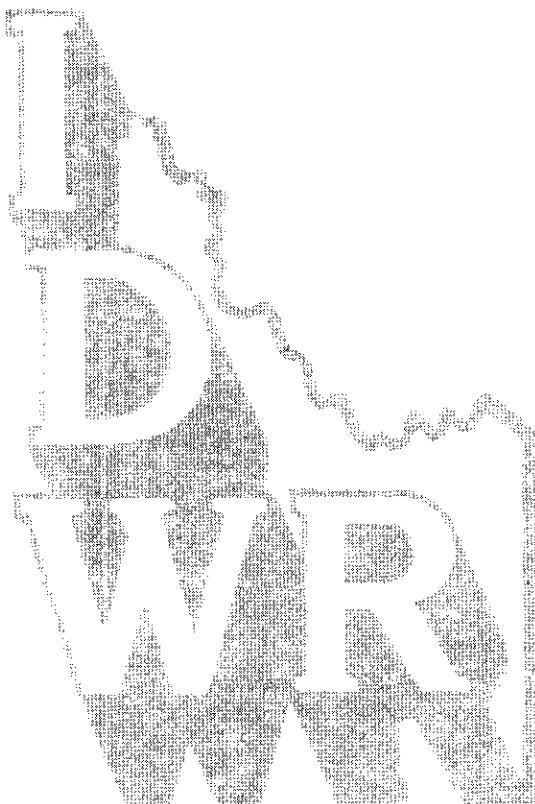

NOV 15 1995

BEFORE THE DEPARTMENT OF WATER RESOURCES
OF THE STATE OF IDAHO

IN THE MATTER OF PERMIT NO. 79-07207)
IN THE NAME OF FRANKLIN TAYLOR) ORDER OF
REINSTATEMENT)

WHEREAS, the Department issued the above-captioned permit with the condition that proof of construction of works and application of water to beneficial use (proof of beneficial use) be submitted on or before December 1, 1992; and,

WHEREAS, the Department notified the permit holder by certified mail that proof was due and instructed the permit holder of the steps to be taken to submit the proof of beneficial use; and,


WHEREAS, the Department notified the permit holder that the permit had lapsed for failure to submit the proof of beneficial use; and,

WHEREAS, Section 42-218a of the Idaho Code provides that a permit may be reinstated upon a showing of reasonable cause within sixty days of the date of the notice of lapsing; and,

WHEREAS, the permit holder has provided a reasonable showing why the permit should be reinstated by submitting proof of beneficial use on December 2, 1992;

IT IS, THEREFORE, HEREBY ORDERED that Permit No. 79-07207 be REINSTATED with an advance in priority to September 17, 1991.

Dated this 3rd day of December, 1992.

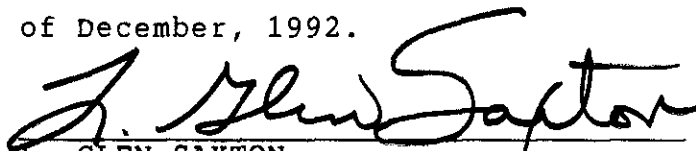
L. GLEN SAXTON
Chief, Water Allocation Bureau

MICROFILMED

DEC 10 1992

STATE OF IDAHO

DEPARTMENT OF WATER RESOURCES

RECEIVED

DEC 2 1992

Department of Water Resources

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources will consider this form as a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 79-07207 Telephone No. 208-839-2259

2. Name(s) of Permit Holder(s): Franklin W Taylor

3. Post Office Address: H.C. 04 Box 103 White Bird, Id. 83554

4. Source of Water: Small Creek Johnson Creek

a. If ground water, well driller's name: _____ Date drilled: _____

b. Pump horsepower: 1 Pressure (psi): 25 Dynamic pumping level (ft.): 25

5. Extent of Use:

Domestic _____ (No. of households) Irrigation 10 (No. of acres)

Stockwater 25 stock (No. and type of stock) Other _____
NA 12/2/92 Klg

6. Total rate and/or volume for which proof is submitted 0.01 12/2/92 Klg 500 gals/hr acre/feet

7. Refer to the approval conditions on your permit and respond accordingly:

Measuring device: Required? Yes ☒ No Installed? Yes ☐ No

OR

Flow Measurement Port: Required? Yes ☒ No Installed? Yes ☐ No

8. Fee Enclosed: \$ 50.00 (See License Examination Fee Schedule)

9. Person to contact to accompany the Department representative during the field examination:

Franklin W Taylor 208-839-2259
Name Telephone No.

H.C. 04 Box 103 White Bird, Id. 83554
Address

10. The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

Nov 23-1992
Date

Franklin W Taylor
Signature (and title if on behalf of a company or organization)

RECEIVED

DEC 10 1992

State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 79-07207

Proposed Priority: September 16, 1991 Maximum Diversion Rate: 0.20 CFS

This is to certify, that **FRANKLIN TAYLOR**
HC 04 BOX 103
WHITE BIRD ID 83545

has applied for a permit to appropriate water from:

JOHNSON CREEK

tributary of **DEER CREEK, EAST FORK**

and a permit is **APPROVED** for development of water as follows:

BENEFICIAL USE

PERIOD OF USE

RATE OF DIVERSION

IRRIGATION

03/15 to 11/15

0.20 CFS

LOCATION OF POINT(S) OF DIVERSION:

SWSESE Sec. 18, Township 27N, Range 01E
IDAHO County

PLACE OF USE: IRRIGATION

TWN RGE SEC

ACRES

ACRES

ACRES

TOTAL

27N 01E 18

NESE 3

SESE 7

10

Total number of acres irrigated:

10

CONDITIONS/REMARKS:

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before **December 1, 1992**.
2. Subject to all prior water rights.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this

2nd day of December, 1991.

R. Keith Higginson
for R. Keith Higginson, Director

MICROFILMED

DEC 30 1991

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

1. Name: FRANKLIN TAYLOR 208-839-2259
Address: HC 04 BOX 103
WHITEBIRD ID 83545
2. Source: JOHNSON CREEK Trib. to: DEER CREEK, EAST FORK
3. Location of Point of Diversion: SWSESE Sec. 18, Township 27N, Range 01E
IDAHO County
4. Water will be used for the following purposes:

Purpose	From	To	CFS	(or)	AF
IRRIGATION	03/15	11/15	0.200		
5. Total quantity to be appropriated is:
0.200 CFS (and/or) AF
6. Proposed diverting works:
 - a. Description of ditches, flumes, pumps, headgates, etc.
GRAVITY FLOWS & SPRINKLERS W/PUMP, PIPELINE FROM CREEK
 - b. Height of storage dam feet; active reservoir capacity
acre-feet; total reservoir capacity acre-feet; period of
year when water will be diverted to storage: to inclusive.
 - c. Proposed well diameter is inches; proposed depth of well is
feet.
 - d. Is groundwater with a temperature greater than 90F being sought? NO
7. Time required for the completion of the works and application of
the water to the proposed beneficial use is 1 years.
8. Description of proposed uses:
PIPELINE, GRAVITY FLOWS, PUMP, SPRINKLERS.
9. Place of Use: IRRIGATION

TWN	RGE	SEC	ACRES	ACRES	ACRES	TOTAL
27N	01E	18	NESE 3	SESE 7		10
Total number of acres irrigated:						10
10. Describe any other water rights used for the same purposes.
A79-10027

DEC 30 1991

11. a. Who owns the property at the point of diversion?
APPLICANT
b. Who owns the land to be irrigated or place of use?
APPLICANT
c. If the property is owned by a person other than the applicant,
describe the arrangement enabling the applicant to make this filing.

12. Remarks: ~~Source known locally as East Fork of Johnson Creek~~
DELETED PER CONVO. WITH APPLICANT 9-17-91 (Rdh)

13. Map of proposed point of diversion and place of use attached? ☒

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Franklin W. Taylor
Applicant

Received by Rdh Date 9/16/91 Time 10:56 Preliminary check by GU

Fee \$ 30.00 Receipted by Rdh # W013674 Date 9/16/91


Publication prepared by GG Date 10-9-91 Published in Idaho County Free Press

Publication approved AT Date 11-7-91
10/17 & 10/24/91

MICROFILMED

DEC 30 1991

79-07207

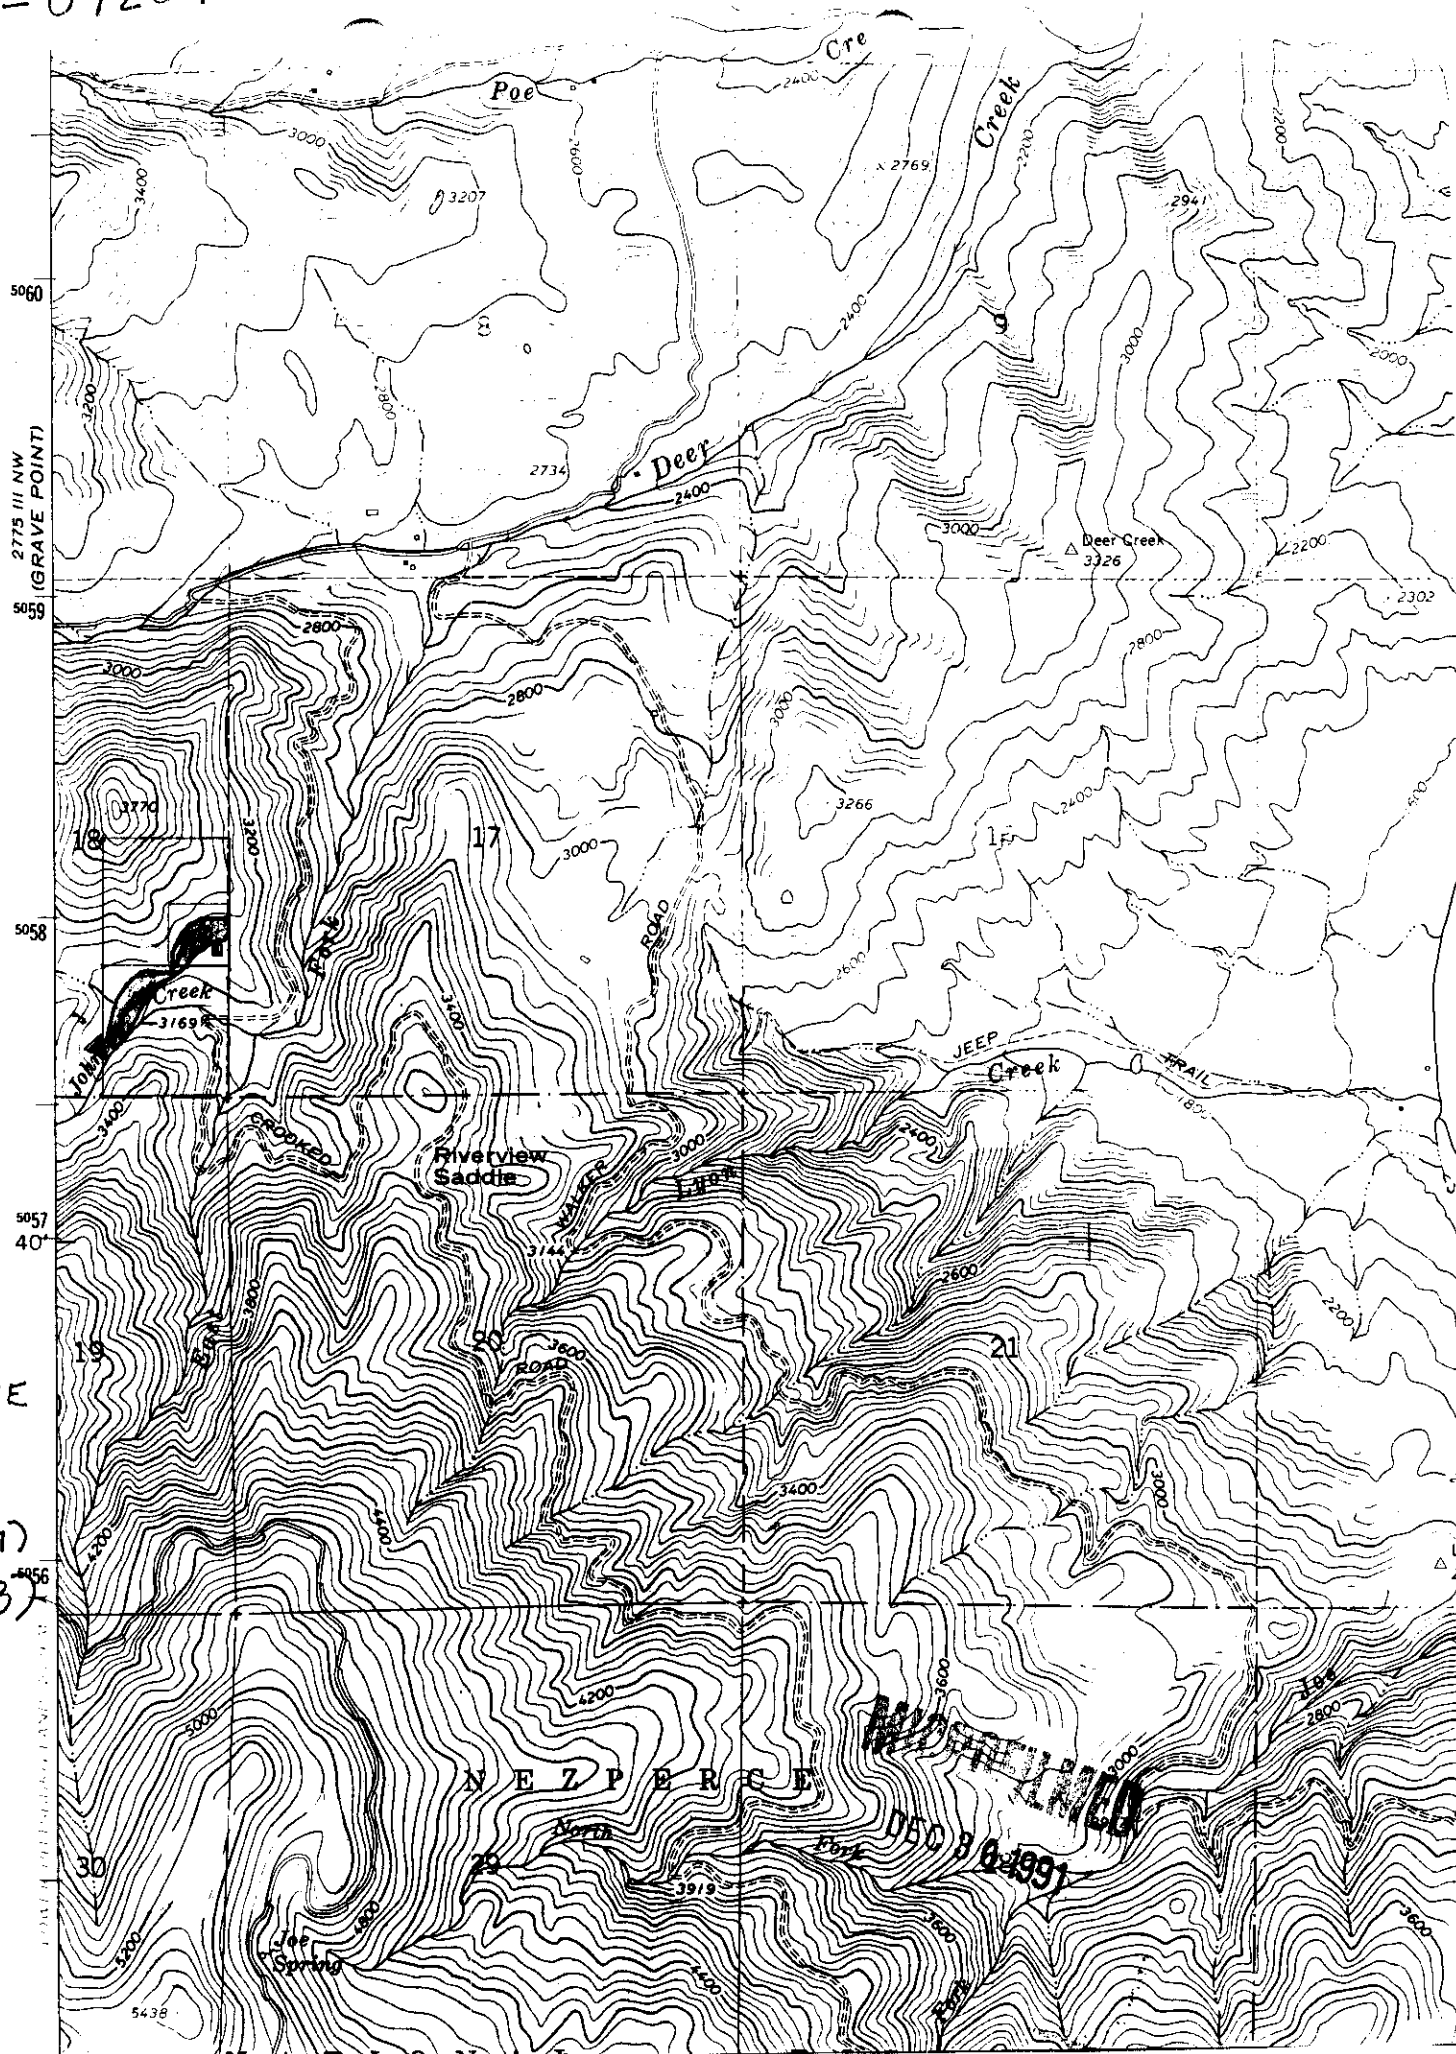

T27N
R1E
S18
P/D
SWSESE
P/W
SESE(7)
NESE(3)

RECEIVED
OCT 8 1991



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. BOX 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

October 23, 1997

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

FRANKLIN TAYLOR
HC 04 BOX 103
WHITE BIRD ID 83545

RE: WATER RIGHT NO. 79-07207

Dear Water Right Holder(s):

The Department of Water Resources (the Department) has issued the enclosed license confirming that a water right has been established in accordance with the permit referenced above. The license is a preliminary order issued by the Department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department unless a party petitions for reconsideration or files an exception and/or brief as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the Department within fourteen (14) days of the service date of this order. The Department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See section 67-5243(3), Idaho Code.

EXCEPTIONS AND BRIEFS

Within twenty-one (21) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding. Otherwise, this preliminary order will become a final order of the Department.

If any party appeals or takes exceptions to this preliminary order, opposing parties shall have twenty-one (21) days to respond to any party's appeal. Written briefs in support of or taking exceptions to the preliminary order shall be filed with the Department. The Department retains the right to review the preliminary order on its own motion.

MACRO-FILMED

DEC 11 1997

ORAL ARGUMENT

If the Department grants a petition to review the preliminary order, the Department shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Department will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Department orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Department in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with Rules of Procedure 302 and 303.

FINAL ORDER

The Department will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Department may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The Department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.


APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

Sincerely,

A handwritten signature in cursive script that reads "Shelley W. Keen".

Shelley W. Keen
Water Rights Supervisor

SK:klt


Enclosure

CERTIFICATE OF MAILING

I hereby certify that on the 23rd day of October, 1997, I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER (Approved License) to the person(s) listed below:

Water Right No. 79-07207

FRANKLIN TAYLOR
HC 04 BOX 103
WHITE BIRD ID 83545

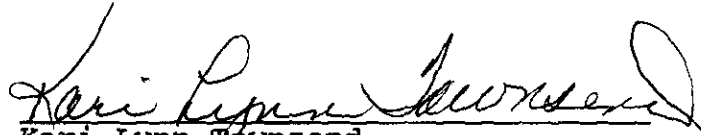
Kari Lynn Townsend
Secretary

RECORDED

DEC 11 1997

MEMORANDUM

TO: File 79-07207

FROM: Sharla

DATE: October 8, 1997

RE: Amended License

The right holder disputed the rate of diversion based on an error in the inside diameter of pipe. A second inspection was made by the examiner and she confirmed the inside diameter to be 2 1/8", rather than 2". An amended license to correct the rate has been prepared.

ALL INFORMATION CONTAINED
HEREIN IS UNCLASSIFIED
DATE 11 1997 BY 1043

Recommended Amendment to License

STATE OF IDAHO DEPARTMENT OF WATER RESOURCES BENEFICIAL USE FIELD REPORT

RECEIVED
MAY 11 1996

Department of Water Resources

A. GENERAL INFORMATION

Permit No. 79-07207

1. Owner: Franklin Taylor Phone No. (208) 839-2255

Current Address: HC 04 Box 103 White Bird, Id 83545

2. Accompanied by: Franklin Taylor EXAM DATE: 9/22/95 *re-examined 4/24/96*

Address: HC 04 Box 103 White Bird, Id 83545 Phone No. (208) 839-2255

Relationship to Permit Holder: self

3. Source: Johnson Creek tributary to Deer Creek, East Fork

B. OVERLAP REVIEW

1. Other water rights with the same place of use: none

2. Other water rights with the same point of diversion: none

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident No.	Gov't Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
		SW	SE	SE	18	27N	1E	Idaho	USGS Topo. & exam

2. Place(s) of Use:

Indicate Method of Determination USGS Topo. & exam

TWP	RGE	SEC	NE				NW				SW				SE				Totals			
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE				
27N	1E	18																3			7	10.0

10/10/95

REC 11 1995

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

Scale: 1" = _____

☒ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

☒ Aerial Photo Attached (required for irrigation of 10+ acres)

☒ Photo of Diversion and System Attached
* see previous form filed

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
		3/4	~~4000~~	Jacuzzi	SWD194238
				Model #	2 1/8"
				IRM2-5/A	

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: _____

 DEC 11 1987

E. NARRATIVE/REMARKS/COMMENTS

- Same comments as on previous form filed.
- On Jan. 12, 1996, we received a letter from Mr. Franklin disputing the pipe dimensions. He stated the inside diameter should read $2\frac{1}{8}$ ". Upon doing the exam, he had stated the pipe was 2", ^{also in a letter dated Oct. 26, 1995} & the riser caps measured 2", but upon request of Dave Tutthill, I re-examined the pipe without the risers, & found the inside diameter of the buried PVC pipe to be $2\frac{1}{8}$ ". I recommend amendment of the licensed amount of Diversion Capacity to be changed from .11 cfs, to read the corrected amount of .20 cfs. All other information remains the same.

Have conditions of permit approval been met? ☒ yes ☐ no

DEC 11 1997

F. FLOW CALCULATIONS

☒ Additional Computation Sheets Attached

Measured Method:

10 acres x .02 cfs = .20 cfs (Max. Allowable)
Corrected Pipe Flow Capacity w/ 2 1/8" inside diameter = .20 cfs
 Computation Spreadsheet (see attachment) .20 cfs
Original Permitted amount = .20 cfs

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = 10 \times 4.0 = 40.0$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = .20 \times 246 \times 1.9835 = 97.6$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = 40.0$$

2. Volume Calculations for Other Uses:

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
Irrigation	3/15	11/15	.20	40.0
Totals:			.20	40.0

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☐ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☒ Other

I. AUTHENTICATION

Field Examiner's Name Janet Hemerway Date 5/18/96

Reviewer _____ Date _____

SEAL

RECEIVED
DEC 1 1997

Pipeflow Computation Spreadsheet (DRT 12/31/1992)

Data Entered By: Sandy Hemenway
05/18/96
Project: Flow Computation for Permit No. 79-07207
Franklin Taylor
Given: See Data Table

Compute head losses with the Williams and Hazen Formula:

$$f = 0.2083 * (100 / \text{roughness})^{1.85} * ((\text{cfs} * 448.8)^{1.852} / \text{ID}^4.8655 * \text{Length} / 100)$$

To Find: Compute Rate of Flow

Data Table

Total Head: 100.00 feet
 Pressure Req'd: 0.00 psi
 Available Head: 100.00 feet
 Pipe Roughness: 150.00 Note: pvc = 150, smooth and straight pipe = 140
 aluminum - joint length 20' = 125, joint length
 30' = 130, joint length 40' = 132, joint length
 50' = 134, new riveted steel = 100
 old riveted steel = 100, old cast iron = 95,
 old pipes in poor condition = 60 to 80

Inside Diameter in Inches	Equivalent Length in Feet	Unit Head Loss	Total Head Loss from Pipe Friction
2.18	1200.00	100.28	
13.50	0.00	0.00	
11.50	0.00	0.00	
9.50	0.00	0.00	100.28

Rate of Flow: 0.190 CFS = .20 cfs

RECORDED
DEC 11 1997



State of Idaho

DEPARTMENT OF WATER RESOURCES

Western Region, 2735 Airport Way, Boise, Idaho 83705-5082 - (208) 334-2190

FAX (208) 334-2348

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

RECEIVED

FEB 06 1996

February 1, 1996

Mr. Franklin W. Taylor
HC04 Box 103
Whitebird, ID 83545

Department of Water Resources

RE: Beneficial Use Field Examination for Water Right Permit No.
79-07207

Dear Mr. Taylor:

I am in receipt of your letter dated January 10, 1996, in which you indicated that the inside diameter of the plastic pipe that you purchased is 2 1/8 inches. I have determined that at this point the best option is for us to take another look at your system during the coming summer. By copy of this letter I am requesting that Sandy make contact with you and visit your location. We will attempt to use another means of measurement to double-check your flow rate to ensure that you are given full credit for the flow that your system will produce.

Sincerely,

David R. Tuthill, Jr., P. E.
Manager, Western Region Office

cc: Sandy Hemenway
State Office File for Water Right No. 79-07207

DEC 11 1997

79-02207

RECEIVED

JAN 12 1996

WATER RESOURCES
WESTERN REGION

White Bird, Id.

Jan. 9 - 1996

Davis R Tuttle of R.
Dept of Water Resources
Western Region

I received your letter Jan 2-96
The inside measurement of my pipe
is $2\frac{1}{8}$ in.

We are talking of a small Creek
I have to accept what ever it runs.
That is beside the point.

I dont like having the descrip-
tion of old junk pipe on my
permit. I cant imagin her ever
pulling it on there.

The 1200 ft of pipe covered the
whole system. I would like very
much to have it taken off.

Sincerely

Franklin M Taylor
HC04 Box 103

DEC 11 1997

White Bird Id 83554



State of Idaho

DEPARTMENT OF WATER RESOURCES

Western Region, 2735 Airport Way, Boise, Idaho 83705-5082 - (208) 334-2190

FAX (208) 334-2348

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

January 2, 1996

RECEIVED

JAN 05 1996

Department of Water Resources

Mr. Franklin W. Taylor
HC04 Box 103
Whitebird, ID 83545

RE: Beneficial Use Field Examination for Water Right Permit No.
79-07207

Dear Mr. Taylor:

I am in receipt of your letter dated December 28, 1995, in which you further described your concerns about the field report prepared by Ms. Sandy Hemenway. By your description, I think I see the basis of your concern.

The sheet that you copied and returned entitled Pipeflow Computation Spreadsheet is a computer worksheet that contains general information for solving pipeflow problems. You have noted that your system does not contain any old pipe. This is what Sandy's report reflects. The spreadsheet says "Pipe Roughness: 150.00", and then it has a note describing that the roughness for PVC is 150, for smooth and straight pipe is 140, and so on. The note is used as a guide on the form so that the person preparing the spreadsheet will know what figure to place in this location on the spreadsheet. As Sandy has filled out the worksheet, you were credited for 1200 feet of brand new PVC with roughness coefficient of 150.

Down where the form states inside diameter and length, note that she shows 1200 feet with inside diameter of 1.75 inches, and no pipe of other lengths. The reason that she showed 1.75 inches is that this is a typical inside pipe diameter for 2 inch pvc pipe. If you could please measure the inside diameter of your pipe, and let me know what it is, we will re-run this computation and see if the re-run changes the amount of water allowed. I'll await your response.

Sincerely,

David R. Tuthill, Jr., P. E.
Manager, Western Region Office

cc: State Office File for Water Right No. 79-07207

DEC 11 1995



State of Idaho

DEPARTMENT OF WATER RESOURCES

Western Region, 2735 Airport Way, Boise, Idaho 83705-5082 - (208) 334-2190

FAX (208) 334-2348

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

December 22, 1995

Mr. Franklin W. Taylor
HC04 Box 103
Whitebird, ID 83545

RECEIVED

DEC 27 1995

Department of Water Resources

RE: Beneficial Use Field Examination for Water Right Permit No.
79-07207

Dear Mr. Taylor:

I am in receipt of your letter dated October 26, 1995, in which you expressed a concern about the recommendations of our field examiner Sandy Hemenway relative to the examination of the water system described in the above-referenced permit. In response to your letter I have reviewed the field examination, a copy of which is enclosed.

It appears that there might have been a misunderstanding regarding the significance of the printout document that Ms. Hemenway sent to you. This document, entitled "Pipeflow Computation Spreadsheet", was used to compute the amount of flow that will be carried by a 2" pvc pipe with length of 1200 feet under an elevation drop of 100 feet. The computation results in a flow of 0.11 cubic feet per second, which is equivalent to 5.5 miners inches, or 49 gallons per minute. This is an extremely high flow for a 2" pipe, so it appears that your system has been given the benefit of the doubt in the amount of water that it will divert from Johnson Creek.

Please review the field exam that Ms. Hemenway prepared for your system, and if you have a remaining concern, please feel free to contact me.

Sincerely,

David R. Tuthill, Jr., P. E.
Manager, Western Region Office

cc: State Office File for Water Right No. 79-07207

DEC 11 1995



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

November 8, 1995

FRANKLIN TAYLOR
HC 04 BOX 103
WHITE BIRD ID 83545

RE: WATER RIGHT NO. 79-07207

Dear Water Right Holder(s):

Enclosed is a copy of the Water Right License issued on the above referenced permit. If you have any questions, please contact me within 10 days of receipt of this license.

Sincerely,

Shelley W. Keen
Water Rights Supervisor

SK:rl

Enclosure

RECEIVED

NOV 15 1995

LICENSE REVIEW CHECKLIST

PERMIT NO. 79-07207 DATE 11-7-95



NAME	Change	OK	Or Address Change?
PRIORITY DATE	☒	☒	Advance? <u>YES</u> Advanced to: <u>9-17-91</u> Order to reinstate needed? <u>DONE</u> Incorrect fee for rate recommended? <u>NO</u>
SOURCE	☐	☒	Changes or just clarification of originally intended source? _____ Notice of Intent to Void necessary? _____
POINT OF DIV	☐	☒	Amendment needed? _____ Overlaps? _____
PLACE OF USE	☐	☒	Amendment needed? _____ Overlaps? _____
DIV RATE	☐	☒	Permit/fee limits: <u>.20 CFS</u> Meas Q = _____ Theo Q = <u>.11</u> Recommend: <u>.11</u> <u>10 x .02 = .20 Reduce to CAPACITY</u> Combined rates exceed capacity _____
ANNUAL VOLUME	☐	☒	Volume Limit: _____ <u>NEW</u> Season: <u>E/4.0 (3-1 to 11-30)</u> Calculations: _____ <u>10 x 4 = 40</u> Flow limit: _____ cfs x _____ x 1.9835 = _____ Combined volumes exceed capacity/allowable _____
USES	☐	☒	Change in Nature of Use or additional uses? _____ Amendment necessary? _____
ADDITIONAL INFO	Supplemental Groundwater _____ PPU Scenario _____ Irr/Dom Combination _____ Shared G/W System _____		
NEW REMARKS	☐	☐	Multiple p/d(s) in ¼ ¼? _____ Other _____
NEW CONDITIONS	☐	☐	Watermaster control - District _____ Measuring/Locking Devices _____ <u>R3/</u> Irrigation Overlap _____ Other _____ Water Quality _____ Heat/Cool/Fish verified _____

COMMENTS: Reduce rate to capacity:

RECOMMENDATION	CFS	VOLUME	SRBA Claim Filed	<u>NO</u>
<u>Investigation</u>	<u>.11</u>	<u>40</u>	Adjustment Memo Needed	<u>NO</u>
_____	_____	_____	LICENSE	<u>✓</u>
_____	_____	_____	1ST AMEND LETTER _____	
_____	_____	_____	2ND AMEND LETTER _____	

RECEIVED

OCT 30 1995

WATER RESOURCES
WESTERN REGION

White Bird, Id

October 26, 1995

Dave Tuttle

Dept. of water resources.

Regional Manager

2735 Airport Way

Boise Id.

Sir

In september 16-1991 I came to Boise to get permit to appropriate Water No. 79-07207

I put a dam in a small creek on our property and bought 105 joints of 2" A B pipe to bring water. I brought the water gravity flow as far as I could. put in a cement tank (2000) galon.

Then put in a pump to bring it up to the house.

Sandy Hemmerway came here to examine the system Sept. 22-1995. I took her up to the dam, brought her down the system all the way to the house. I ask her for a copy of her report, which she did.

There is nothing right in all of her report.

I will include a copy of her report.

Hoping you will correct all of it

Sincerely Franklin W. Taylor

(over)

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
OCT 17 1995

Department of Water Resources

A. GENERAL INFORMATION

Permit No. 79-07207

1. Owner: Franklin Taylor Phone No. (208) 839-2259

Current Address: HC 04 Box 103 White Bird, Id. 83545

2. Accompanied by: Franklin Taylor EXAM DATE: 9/22/95

Address: HC 04 Box 103 White Bird, Id. 83545 Phone No. (208) 839-2259

Relationship to Permit Holder: _____

3. Source: Johnson Creek tributary to Deer Creek, East Fork

B. OVERLAP REVIEW

1. Other water rights with the same place of use: none

2. Other water rights with the same point of diversion: none

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident No.	Gov't Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
		SW	SE	SE	18	27N	1E	Idaho	USGS Topo. & exam


2. Place(s) of Use:

Indicate Method of Determination USGS Topo. & exam

TWP	RGE	SEC	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
27N	1E	18													3			7	10.0 acres

NOV 1 1995

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe I.D. as applicable.

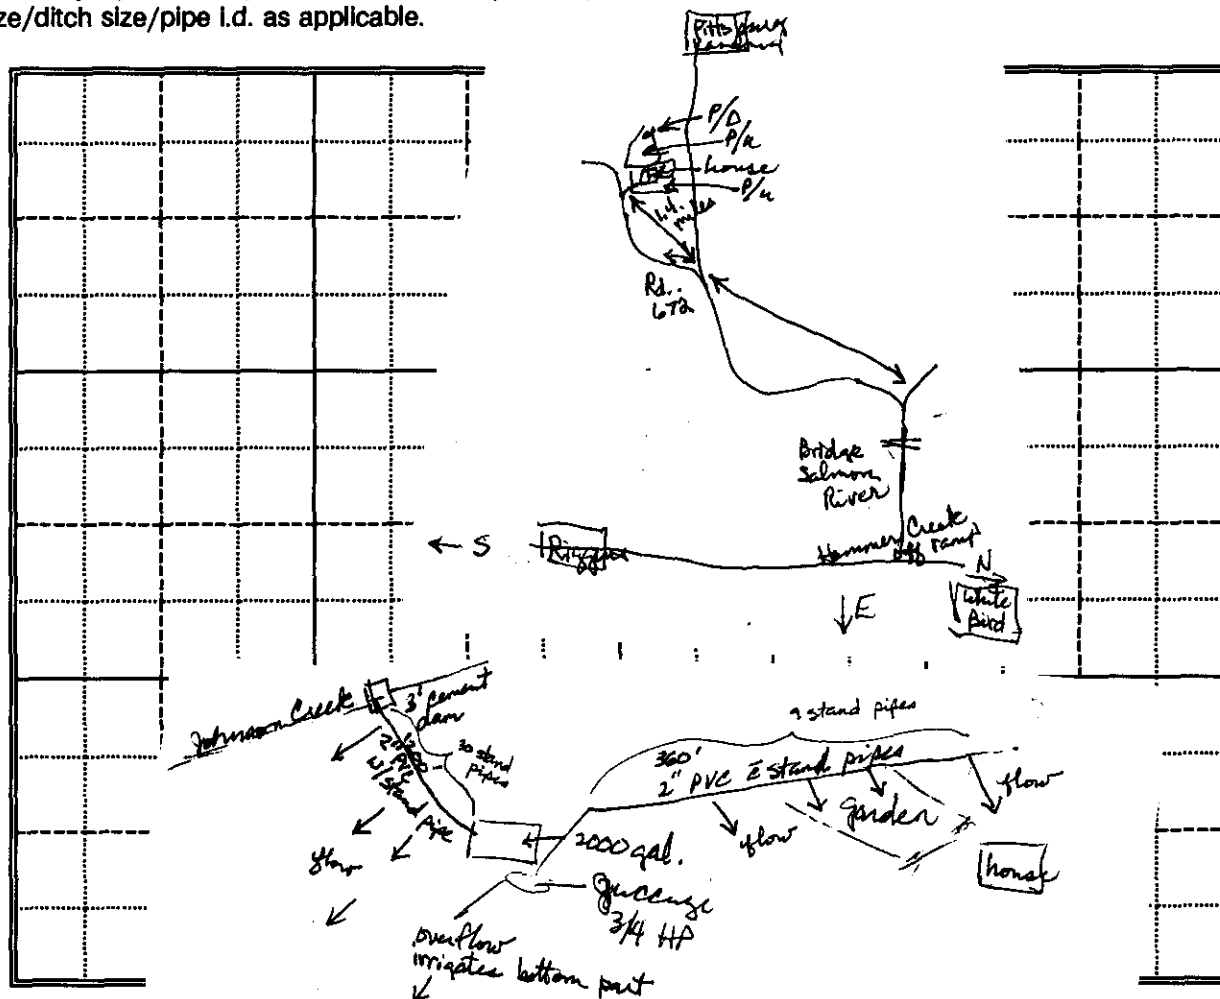

Scale: 1" =

☒ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

☒ Aerial Photo Attached* (required for irrigation of 10+ acres)

☒ Photo of Diversion and System Attached

* per ASIS office, this map is not to scale

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
		3/4	~~SWD194238~~	Opuszi	SWD194238
				model#	2"
				IRM 2-S/A	

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements:

NOV 15 1995

E. NARRATIVE/REMARKS/COMMENTS

- Other WR # 79-04052 (^{source:} Deer Creek) & 79-04422 (^{source:} White Bird).
- No grit. Lots were found.
- A79-10027 is groundwater/Domestic D/I.
- Use is irrigation of 10 acres ^{pasture + garden} & Stockwater for 25 cattle (same water different use) ^{other} uses is for fire protection.
- No other water source available for irrigation of pastures, domestic well could be used for garden & yard only.
- The system consists of a 3' cement dam in Johnson Creek (overflow thru a weir continues to flow down Johnson Creek). A 2" PVC pipe buried 3' deep diverts across the north-west end of the property with every 40' a stand pipe (30 ^{stand pipes} total for this section of property), & then a 2000 gallon holding tank w/ a 3/4 HP Orange Pump at the end of this. This is pumped thru 2" PVC w/ every 40' a stand pipe (9 stand pipes for this section of property). The flow is gravity-flow going north to southeast. Only one stand pipe is opened @ a time to get maximum flow in that area that the applicant feels needs watering.
- Recommend allowing 11 cfs since that is the max. capacity of a 2" diameter pipe, the Pipeflow Computation Spreadsheet was 11 cfs, & no physical measurement could be taken since the cap of the stand pipe when removed left the end of the pipe almost flush with the ground making it

Have conditions of permit approval been met? ☒ yes

☐ no

impossible to enclose the pipe to collect a sample of water to measure
NOV 15 1995

F. FLOW CALCULATIONS

☒ Additional Computation Sheets Attached

Measured Method:

$$10 \text{ acres} \times .02 \text{ cfs} = .20 \text{ cfs}$$

$$\text{Pipe Flow Capacity of 2" diameter pipe} = .11 \text{ cfs}$$

$$\text{Pipe Flow Computation Spreadsheet (see attachment)} = .11 \text{ cfs}$$

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = 10 \times 4.0 = 40.0$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = .11 \times 246 \times 1.9835 = 536.73 = 536.7$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = 40.0$$

2. Volume Calculations for Other Uses:

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
* Irrigation	3/15	11/15	.11	40.0
Totals:			.11	40.0

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

I. AUTHENTICATION

Field Examiner's Name Andy Hernandez Date 10/13/95

Reviewer _____ Date _____

SEAL

* Season of use corrected. BC

NOV 13 1995

- ① Permit: Irrigation 3/15 - 11/15 .20 cfs
- ② B/U fee: \$50⁰⁰ 12/2/92 pd. 0 - 0.20 cfs
- ③ Max. Allowable:

$$10 \text{ acres} \times .02 \text{ cfs} = .20 \text{ cfs}$$

- ④ Measurement:

Pipe Flow Capacity for 2" diameter pipe

$$Q = 5\pi R^2 = \boxed{.11 \text{ cfs}}$$

$$\frac{2''}{12} \div 2 = R$$

$$\pi = 3.1416$$

Pipeflow Computation Spreadsheet (see attachment) - $\boxed{.11 \text{ cfs}}$

APPROVED

7-735

Pipeflow Computation Spreadsheet (DRT 12/31/1992)

Data Entered By: Sandy Hemenway
10/13/95
Project: Flow Computation for Permit No. 79-07207
Franklin Taylor
Given: See Data Table

Compute head losses with the Williams and Hazen Formula:
 $f = 0.2083 * (100 / \text{roughness})^{1.85} * ((\text{cfs} * 448.8)^{1.85} / \text{ID}^4 * 8.655 * \text{Length} / 100)$

To Find: Compute Rate of Flow

Data Table

Total Head:	100.00 feet	elevation drop or slope	} this shows the capacity of the creek + piping, not the holding tank
Pressure Req'd:	0.00 psi		
Available Head:	100.00 feet		
Pipe Roughness:	150.00	Note: pvc = 150, smooth and straight pipe = 140 aluminum - joint length 20' = 125, joint length 30' = 130, joint length 40' = 132, joint length 50' = 134, new riveted steel = 100 old riveted steel = 100, old cast iron = 95, old pipes in poor condition = 60 to 80	


Inside Diameter in Inches	Equivalent Length in Feet	Unit Head Loss	Total Head Loss from Pipe Friction
1.75	1200.00	100.84	
13.50	0.00	0.00	
11.50	0.00	0.00	
9.50	0.00	0.00	100.84

Rate of Flow: 0.107 CFS = .11 cfs

Solution is obtained by entering an estimated rate of flow and adjusting until Total Head Loss approximates Available Head.

* From the chart for Pipe Flow Capacity for a 2" diameter pipe, it shows maximum capacity of .11 cfs, so you are getting the maximum capacity for the size pipe you are using.

NOV 15 1995

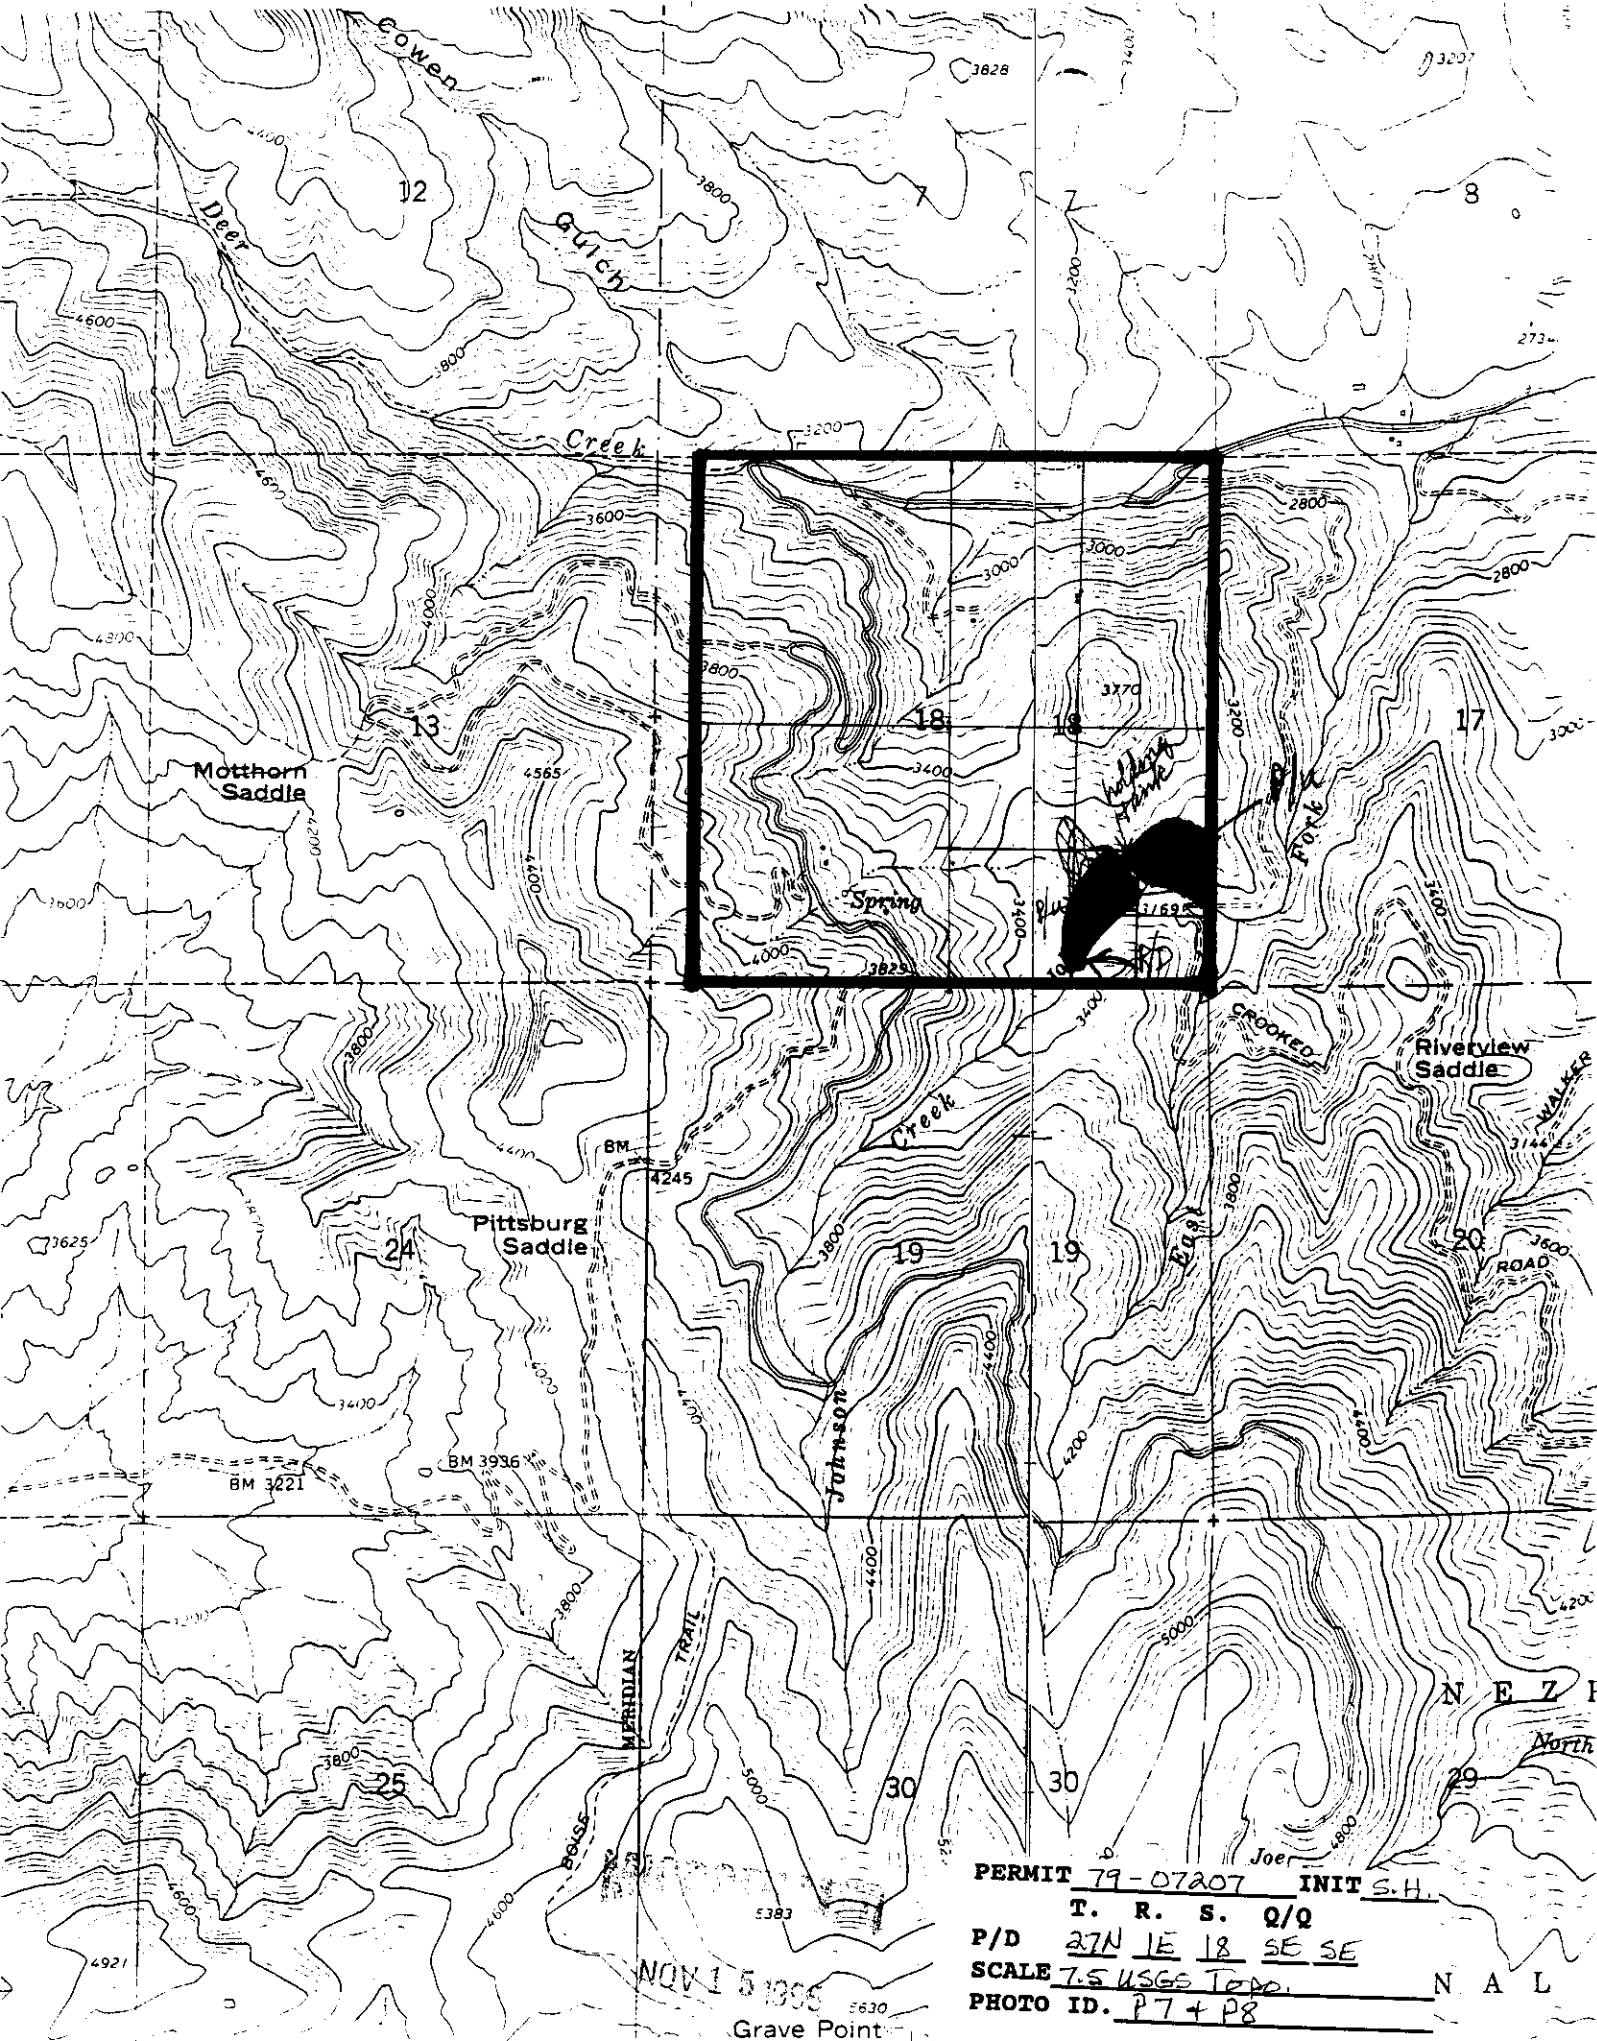

PERMIT 79-07207 INIT S.H.

T. R. S. Q/Q

P/D 27N 1E 18 SE SE

SCALE 7.5 USGS TOPO.

PHOTO ID. P7 + P8

NOV 15 1965


Grave Point

FRANKLIN

Willow
creek

Permit No. 79-07307
P/D: T27N R1E S18 SESE
USGS Aerial Map

NOV 5 1994
Scale per
USGS S.H.

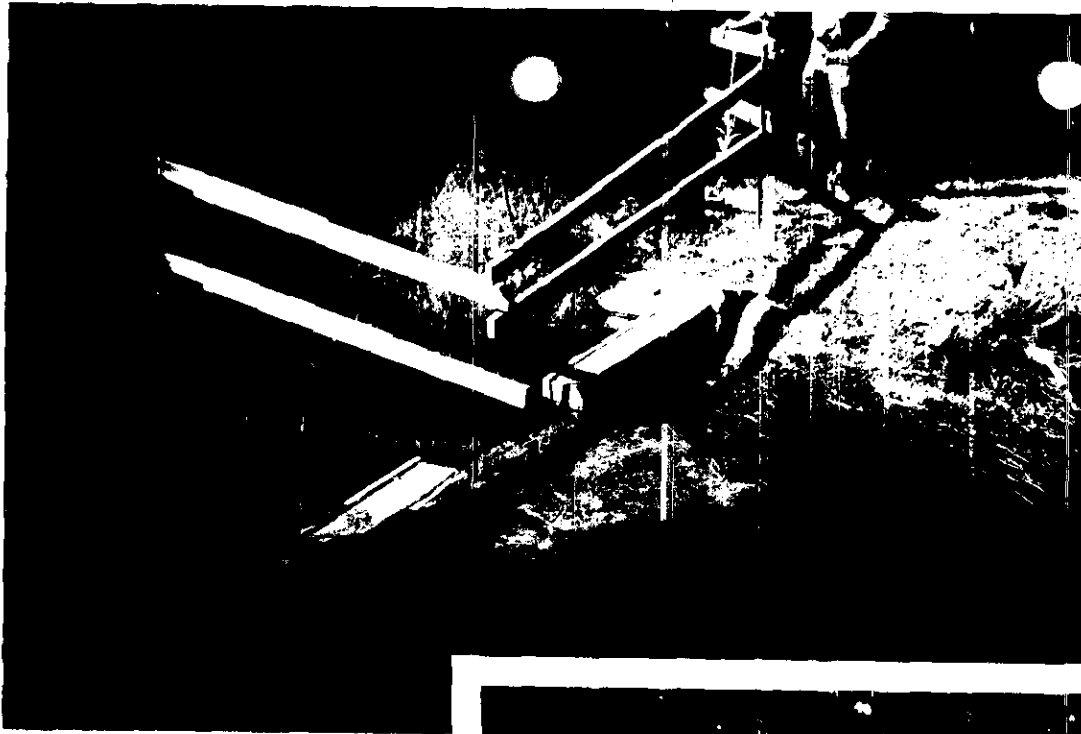

79-07207
9/22/95 S.H.

P/D:

Johnson Creek - 3'
cement dammed
area w/ overflow
continuing down
Johnson Creek.

A 2" PVC pipe
diverting to 30
40' sections w/ 1 stand pipe
each.

P/u:

1 stand pipe per
40' section of
2" PVC; 1 stand
pipe opened at
a time to flow
irrigate (gravity
flow)




P/u: pasture

2000 gallon holding tank

NOV 15 1995

2" PVC line, every
40' a stand pipe
to flood irrigate

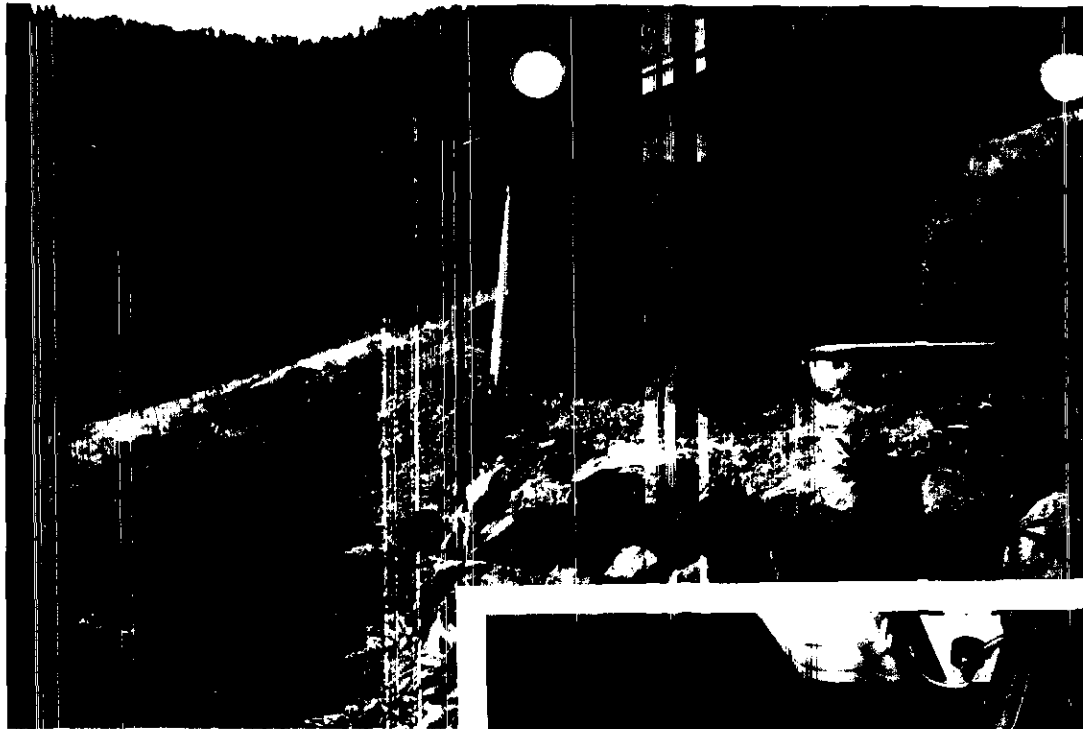



79-07207

9/22/95 S.H.

2000' gallon
holding tank

Jacuzzi 40-60 psi
3/4 HP, mod. # 1RM2-S/A
serial #
SWD 194238

Jacuzzi 3/4 HP
mod. # 1RM2-S/A
serial # SWD 194238
40-60 psi

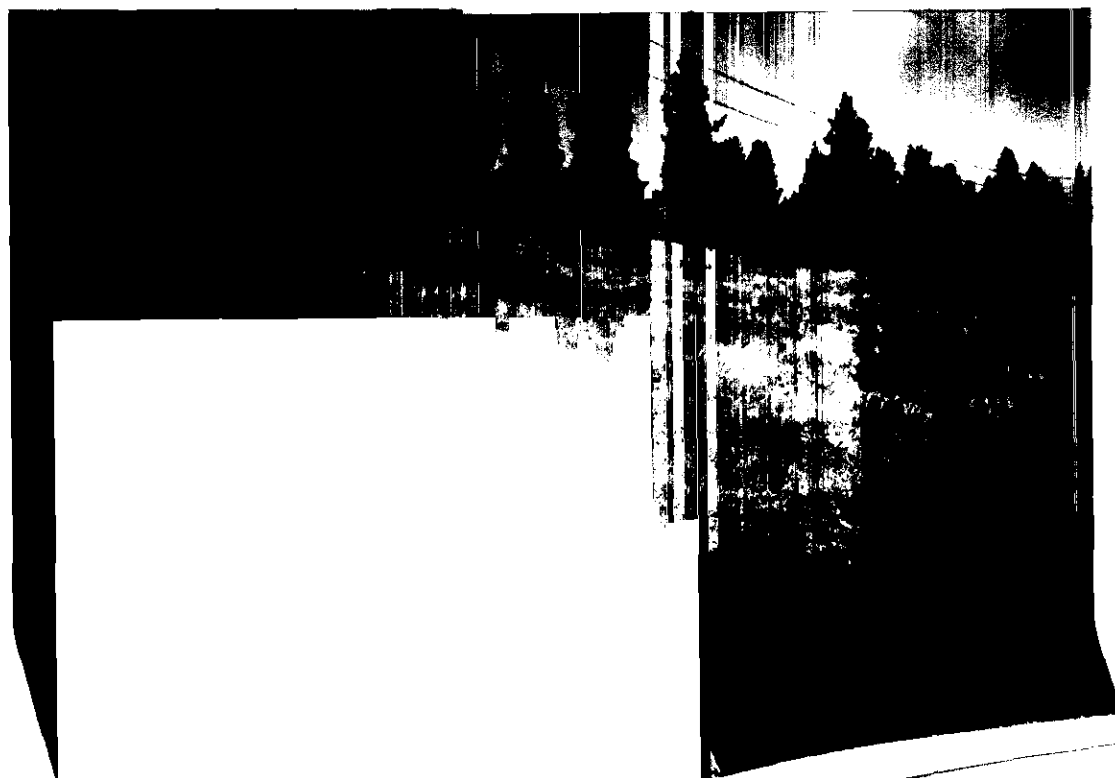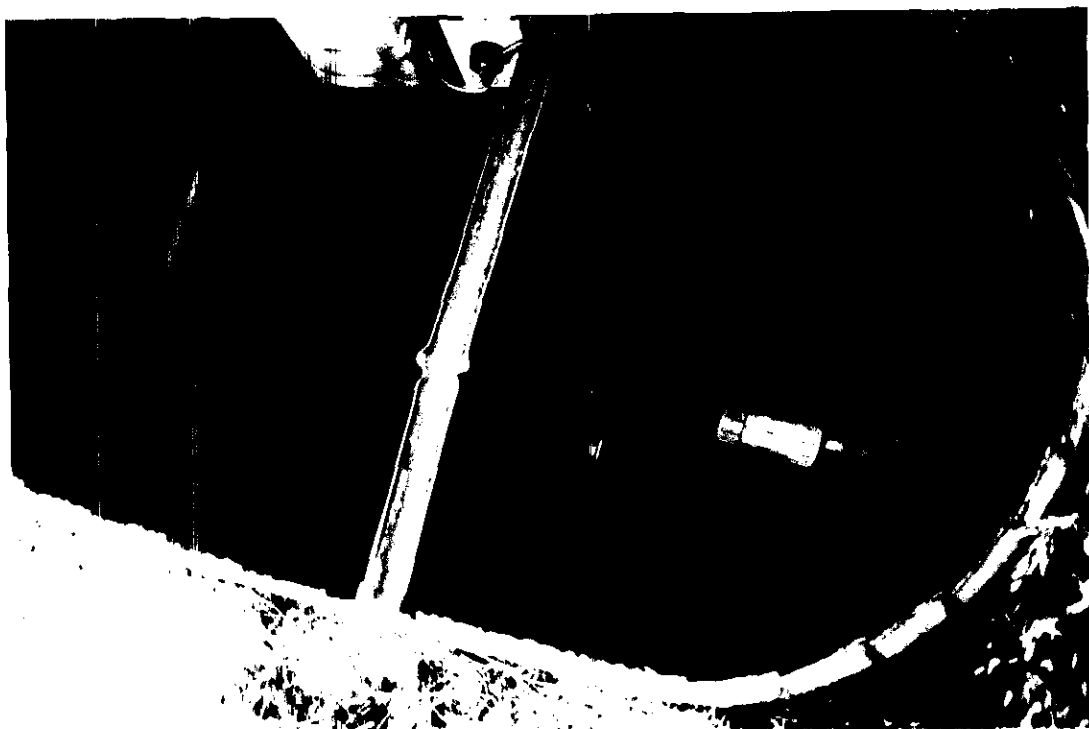

P/u:
40' 2" PVC w/ 9
stand pipe +
hoses to flood
irrigate + drip
system in garden

NOV 15 1995

December 4, 1992

FRANKLIN TAYLOR
HC 04 BOX 103
WHITE BIRD ID 83545

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 79-07207

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. Enclosed is an order advancing the priority of the permit since the proof was received after the proof due date. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water.

If you have questions concerning this matter, please feel free to contact the WESTERN Regional Office in Boise at (208)334-2190.

Sincerely,

Karen L. Gustafson
Secretary/Records Manager

c: IDWR - Region

Enclosure

RECEIVED

DEC 10 1992

ANALYSIS SHEET
FOR
PROOF OF BENEFICIAL USE

Permit No. 79-07207

Reviewed by Klg

Date 12/2/92

GENERAL CONSIDERATIONS

yes Name same as permit?
yes Address same as permit?
no Proof timely received?
If not, complete calculation below.

TYPES OF USE

irrigate -10
Correct Uses? OK

SOURCE OF WATER

✓ Surface water source
Ground water source

NA Drilling permit required?

/ Copy in the file? Drilling Permit No. _____

/ Amount paid for permit _____ Correct?

/ Well log in the file?

LICENSE EXAMINATION FEE

yes Required?
50 Amount Submitted
yes Correct?

MEASURING DEVICE

NA Required?
/ Installed?
/ Waiver requested?

PRIORITY CALCULATION

Date proof received 12/2/92 336
Date proof due 12/1/92 - 335
No. of days late = 1
Priority Date 9/16/91 + 259
New Priority Date 9/17/91 260

DEFICIENCIES OR ACTION ITEMS

Klg

proof acceptable

needs an order

DATA ENTRY

New Address _____

Proof Made 12/2/92 Klg
12/4/92

September 30, 1992

FRANKLIN TAYLOR
HC 04 BOX 103
WHITE BIRD ID 83545

PROOF DUE NOTICE

RE: PERMIT NO. 79-07207

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before December 1, 1992. (See last page of your approved permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a complete field examination report prepared by a certified water right examiner may be used to submit the required proof.


If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.

Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.

SINCERELY,

Karen L. Gustafson
Secretary/Records Manager

Enclosures

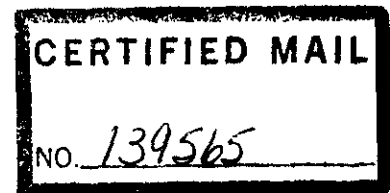

MINNEMED

DEC 10 1992



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

December 5, 1991

FRANKLIN TAYLOR
HC 04 BOX 103
WHITE BIRD ID 83545

PERMIT APPROVAL NOTICE

RE: PERMIT NO. 79-07207

Dear Permit Holder:

Enclosed is a copy of your approved application for permit. We direct your attention to the conditions of approval on the final page.

Enclosed is a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit. Also enclosed is a form entitled "Proof of Beneficial Use". If your project is already completed you should complete and submit this form immediately.

Sincerely,

PAMELA SKAGGS
Technical Records Specialist

PS:blm

Enclosures

RECEIVED
DEC 30 1991

AFFIDAVIT OF PUBLICATION

NOTICE OF APPLICATION FOR WATER RIGHT

The following application(s) have been
filed to appropriate the public waters of
the State of Idaho:

78-07322

RUARK, ROBERT A
P.O. BOX 283
RIGGINS, ID 83549
Source: LITTLE SALMON RIVER
Tributary: SALMON RIVER
Diversion Pt: SESESE Sec 21 T 24N R
01E
Use: IRRIGATION (.020 CFS)
Total Diversion: (.020 CFS)
Date Filed: 9/4/1991
In: T24N R01E S21 SESE
1.0 ACRES TOTAL

78-07323

BOGGAN, DOUGLAS
BOGGAN, SHARON
P.O. BOX 1178
RIGGINS, ID 83549
Source: LITTLE SALMON RIVER
Tributary: SALMON RIVER
Diversion Pt: SWNWNE Sec. 28 T 24N R
01E
SENESE Sec. 28 T 24N R 01E
Use: IRRIGATION (.220 CFS)
STOCKWATER (.070 CFS)
Total Diversion: (.290 CFS)
Date Filed: 10/4/1991
In T24N R01E S28 NENW SENW
11.0 ACRES TOTAL

79-07207

TAYLOR, FRANKLIN
HC 04 BOX 103
WHITE BIRD, ID 83545
Source: JOHNSON CREEK Tributary:
DEER CREEK, EAST FORK
Diversion Pt: SWSESE Sec 18 T 27N R
01E
Use: IRRIGATION (.200 CFS)
Total Diversion: (.200 CFS)
Date Filed: 9/16/1991
In: T27N R01E S18 NESE SESE
10.0 ACRES TOTAL

79-07208

CITY OF WHITE BIRD
P.O. BOX 36
WHITE BIRD, ID 83554
Source: GROUNDWATER
Diversion Pt: NWNESW Sec 14 T 28N R
01E
Use: MUNICIPAL (.140 CFS)
Total Diversion: (.140 CFS)
Date Filed: 9/16/1991
Place of Use within city limits of White
Bird.

The permit(s) will be subject to all prior
water rights. Protests must be filed with
the Director, Dept. of Water Resources,
Western Region, 2735 Airport Way,
Boise, Idaho 83705 on or before
NOVEMBER 4, 1991.

R. KEITH HIGGINSON, Director
Published 10/16/1991 & 10/23/1991

016-23

STATE OF IDAHO

County of Idaho - ss.

..... Marietta Hanson being
first duly sworn, says she is the.....Bookkeeper..... of the
IDAHO COUNTY FREE PRESS, a weekly newspaper published
and issued weekly at Grangeville, Idaho county, State of Idaho,
and is of general circulation in said county and state, that the
said notice, of which the one hereto attached is a true copy, was
published in said paper for two..... weeks, being published
.....two.....times, the first publication being on the
.....16th.....day of October....., 19.....91.,
and the last publication on the.....23rd.....day of
.....October....., 19.....91.; that the said notice was
published in the newspaper proper and not a supplement; that
said newspaper has been continuously and uninterruptedly
published in said county during a period of seventy-eight
consecutive weeks prior to the publication of said notice or
advertisement.

Marietta Hanson

STATE OF IDAHO }

COUNTY OF }

On this.....23rd.....day of.....October.....in the year
of.....1991....., before me, a Notary Public, personally
appeared.....Marietta Hanson....., known or
identified to me to be the person whose name subscribed to the
within instrument, and being by me first duly sworn, declared
that the statements therein are true, and acknowledged to me
that he executed the same.

Notary Public for Idaho

Residing at.....Grangeville, Idaho

My commission expires:.....9-10-92.....

DEC 30 1991

79-07207

TAYLOR, FRANKLIN
HC 04 BOX 103
WHITE BIRD, ID 83545

Source: JOHNSON CREEK

Tributary: DEER CREEK, EAST FORK

Diversion Pt: SWSESE Sec 18 T 27N R 01E

Use: IRRIGATION (.200 CFS)

Total Diversion: (.200 CFS)

Date Filed: 9/16/ 1991

In: T27N R01E S18 NESE SESE

10.0 ACRES TOTAL

MICROFILMED

DEC 30 1991