


13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

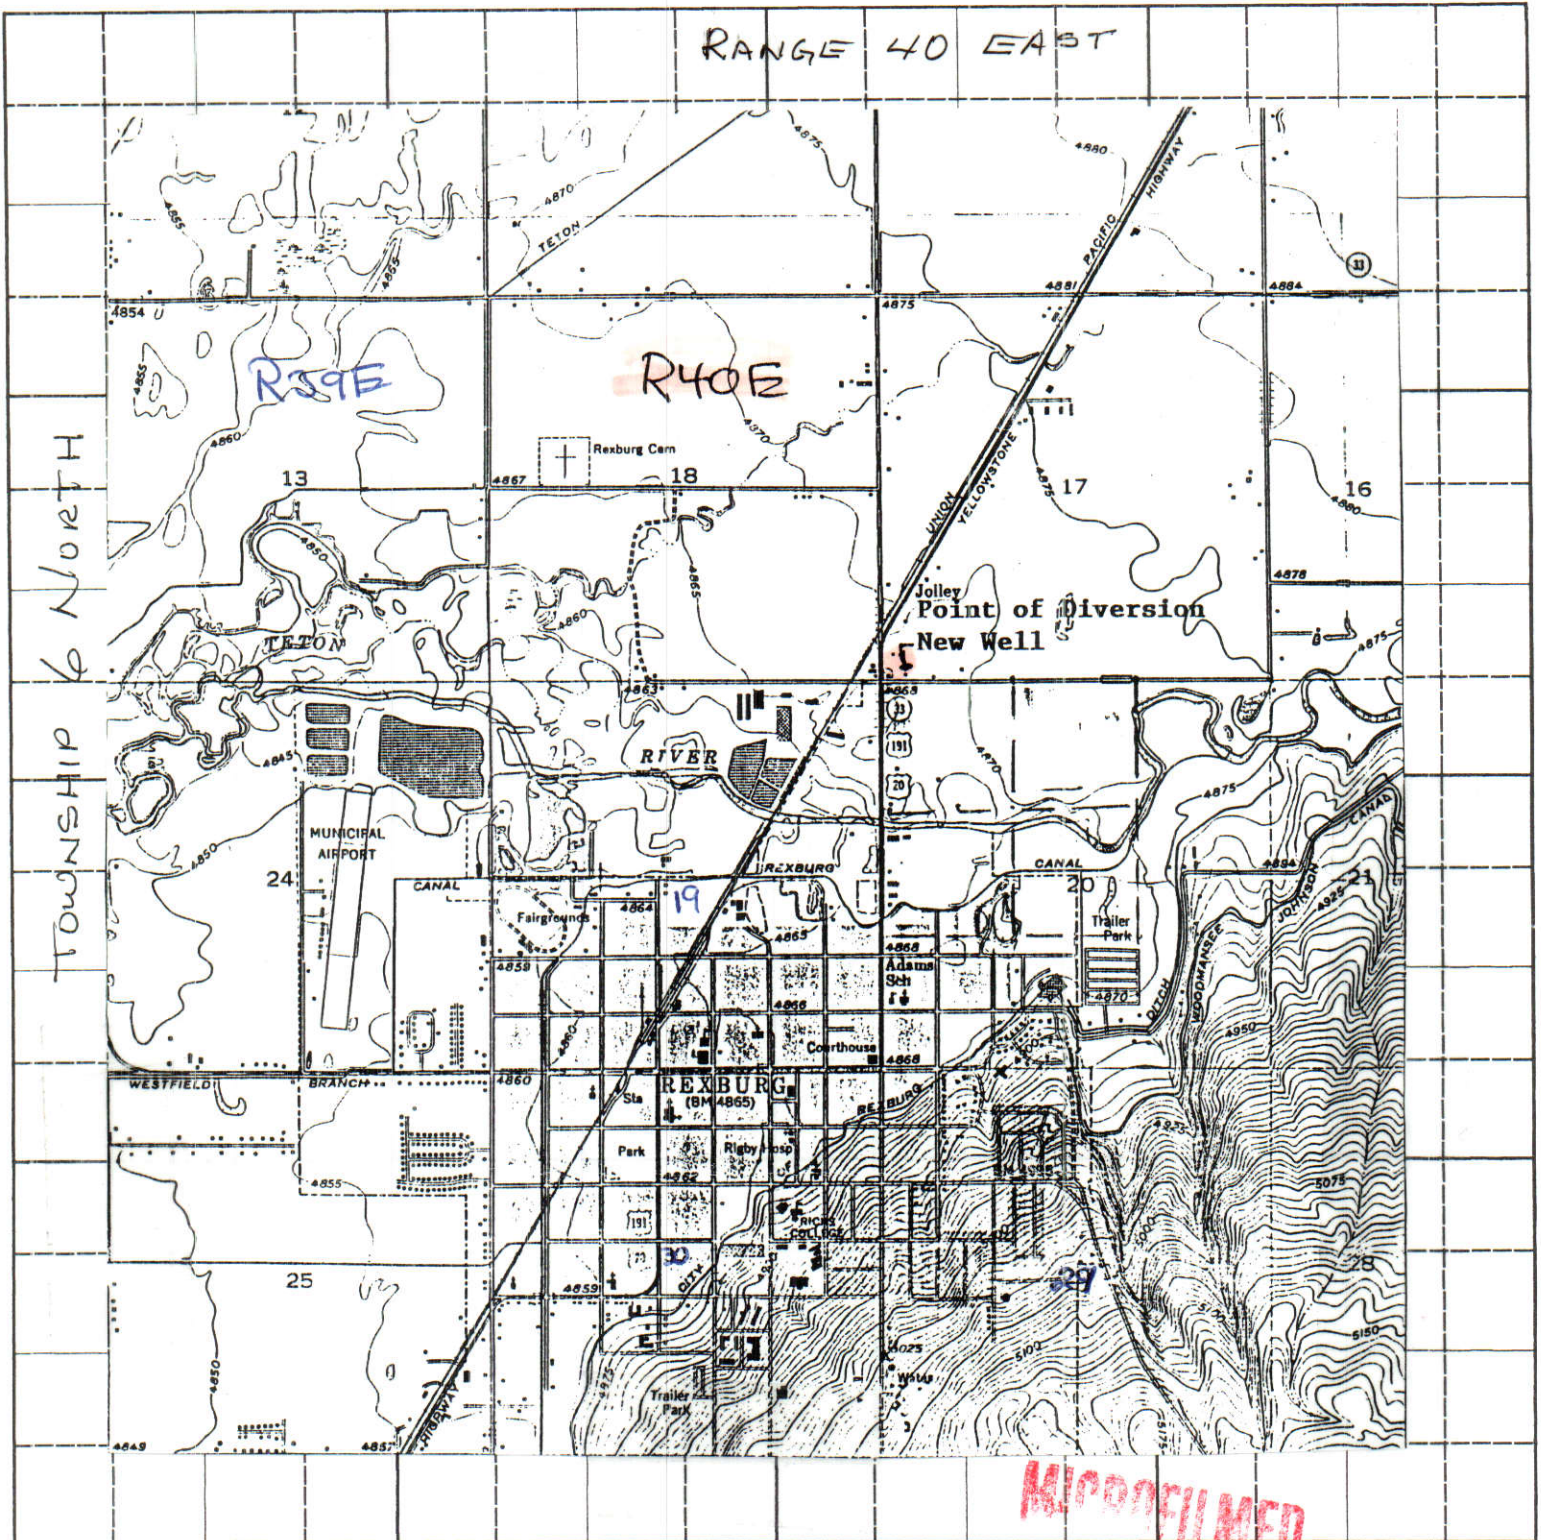

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Nile L. Boyle
(Applicant)

(Mayor)

APR 07 1993

THE STANDARD-JOURNAL
Rexburg, Idaho
AFFIDAVIT OF PUBLICATION

STATE OF IDAHO
County of Madison

I, TERRY WEATHERSTON being
first duly sworn, depose and say, that I
am the printer of THE STANDARD-JOURNAL,
a semi-weekly newspaper printed and
published semi-weekly at Rexburg,
Madison County, Idaho; and I do solemnly
swear that the

NOTICE OF APPLICATION a copy
of which notice appears attached hereto,
was published in the regular and entire
issue of said newspaper, and not in any
supplement issue thereof for

TWO consecutive issues, the
first publication having been made on
JANUARY 7, 1993 and the last
publication having been made on
JANUARY 14, 1993.

Further, that said newspaper is one
of general circulation in said county;
that it is a legal newspaper, conforming
to legal specifications under the Idaho
Statutes; that it has at least two
hundred bona fide subscribers living
within the county of publication; and
that it has been continuously and
uninterruptedly published in said county
during a period of seventy eight
consecutive weeks prior to the first
publication of the said notice.

Terry Weatherston

STATE OF IDAHO)
COUNTY OF MADISON)

On this 15TH day of JANUARY in
the year of 1993, before me, a Notary
Public, personally appeared Terry
Weatherston, known or identified to me
to be the person whose name subscribed
to the within instrument, and being by
me first duly sworn, declared that the
statements therein are true, and
acknowledged to me that he executed the
same.

George B. [Signature]
Notary Public for Idaho

Residing at Rexburg, Idaho
My commission expires: June 8, 1993.

NOTICE OF APPLICATION
FOR WATER RIGHT

The Following application(s) have been
filed to appropriate the public waters of
the State of Idaho:

22-07754

CITY OF REXBURG

PO BOX 245

REXBURG, ID 83440

Source: GROUNDWATER

Diversion Pt: SWSW Sec 17 T 06N R
40E in MADISON County.

Use: DOMESTIC (3.300 CFS) Total

Diversion: (3.300 CFS)

Date Filed: 12/17/1992


Place of use: Within city limits of
Rexburg

The permit(s) will be subject to all prior
water rights. Protests must be filed with
the Director, Dept. of Water Resources,
Eastern Region, 150 Shoup Avenue,
Suite 15, Idaho Falls, Idaho 83402 on or
before JANUARY 25, 1993.

R. KEITH HIGGINSON
Director

Publ. Jan. 7 and 14, 1993J.

RECEIVED
APR 07 1993

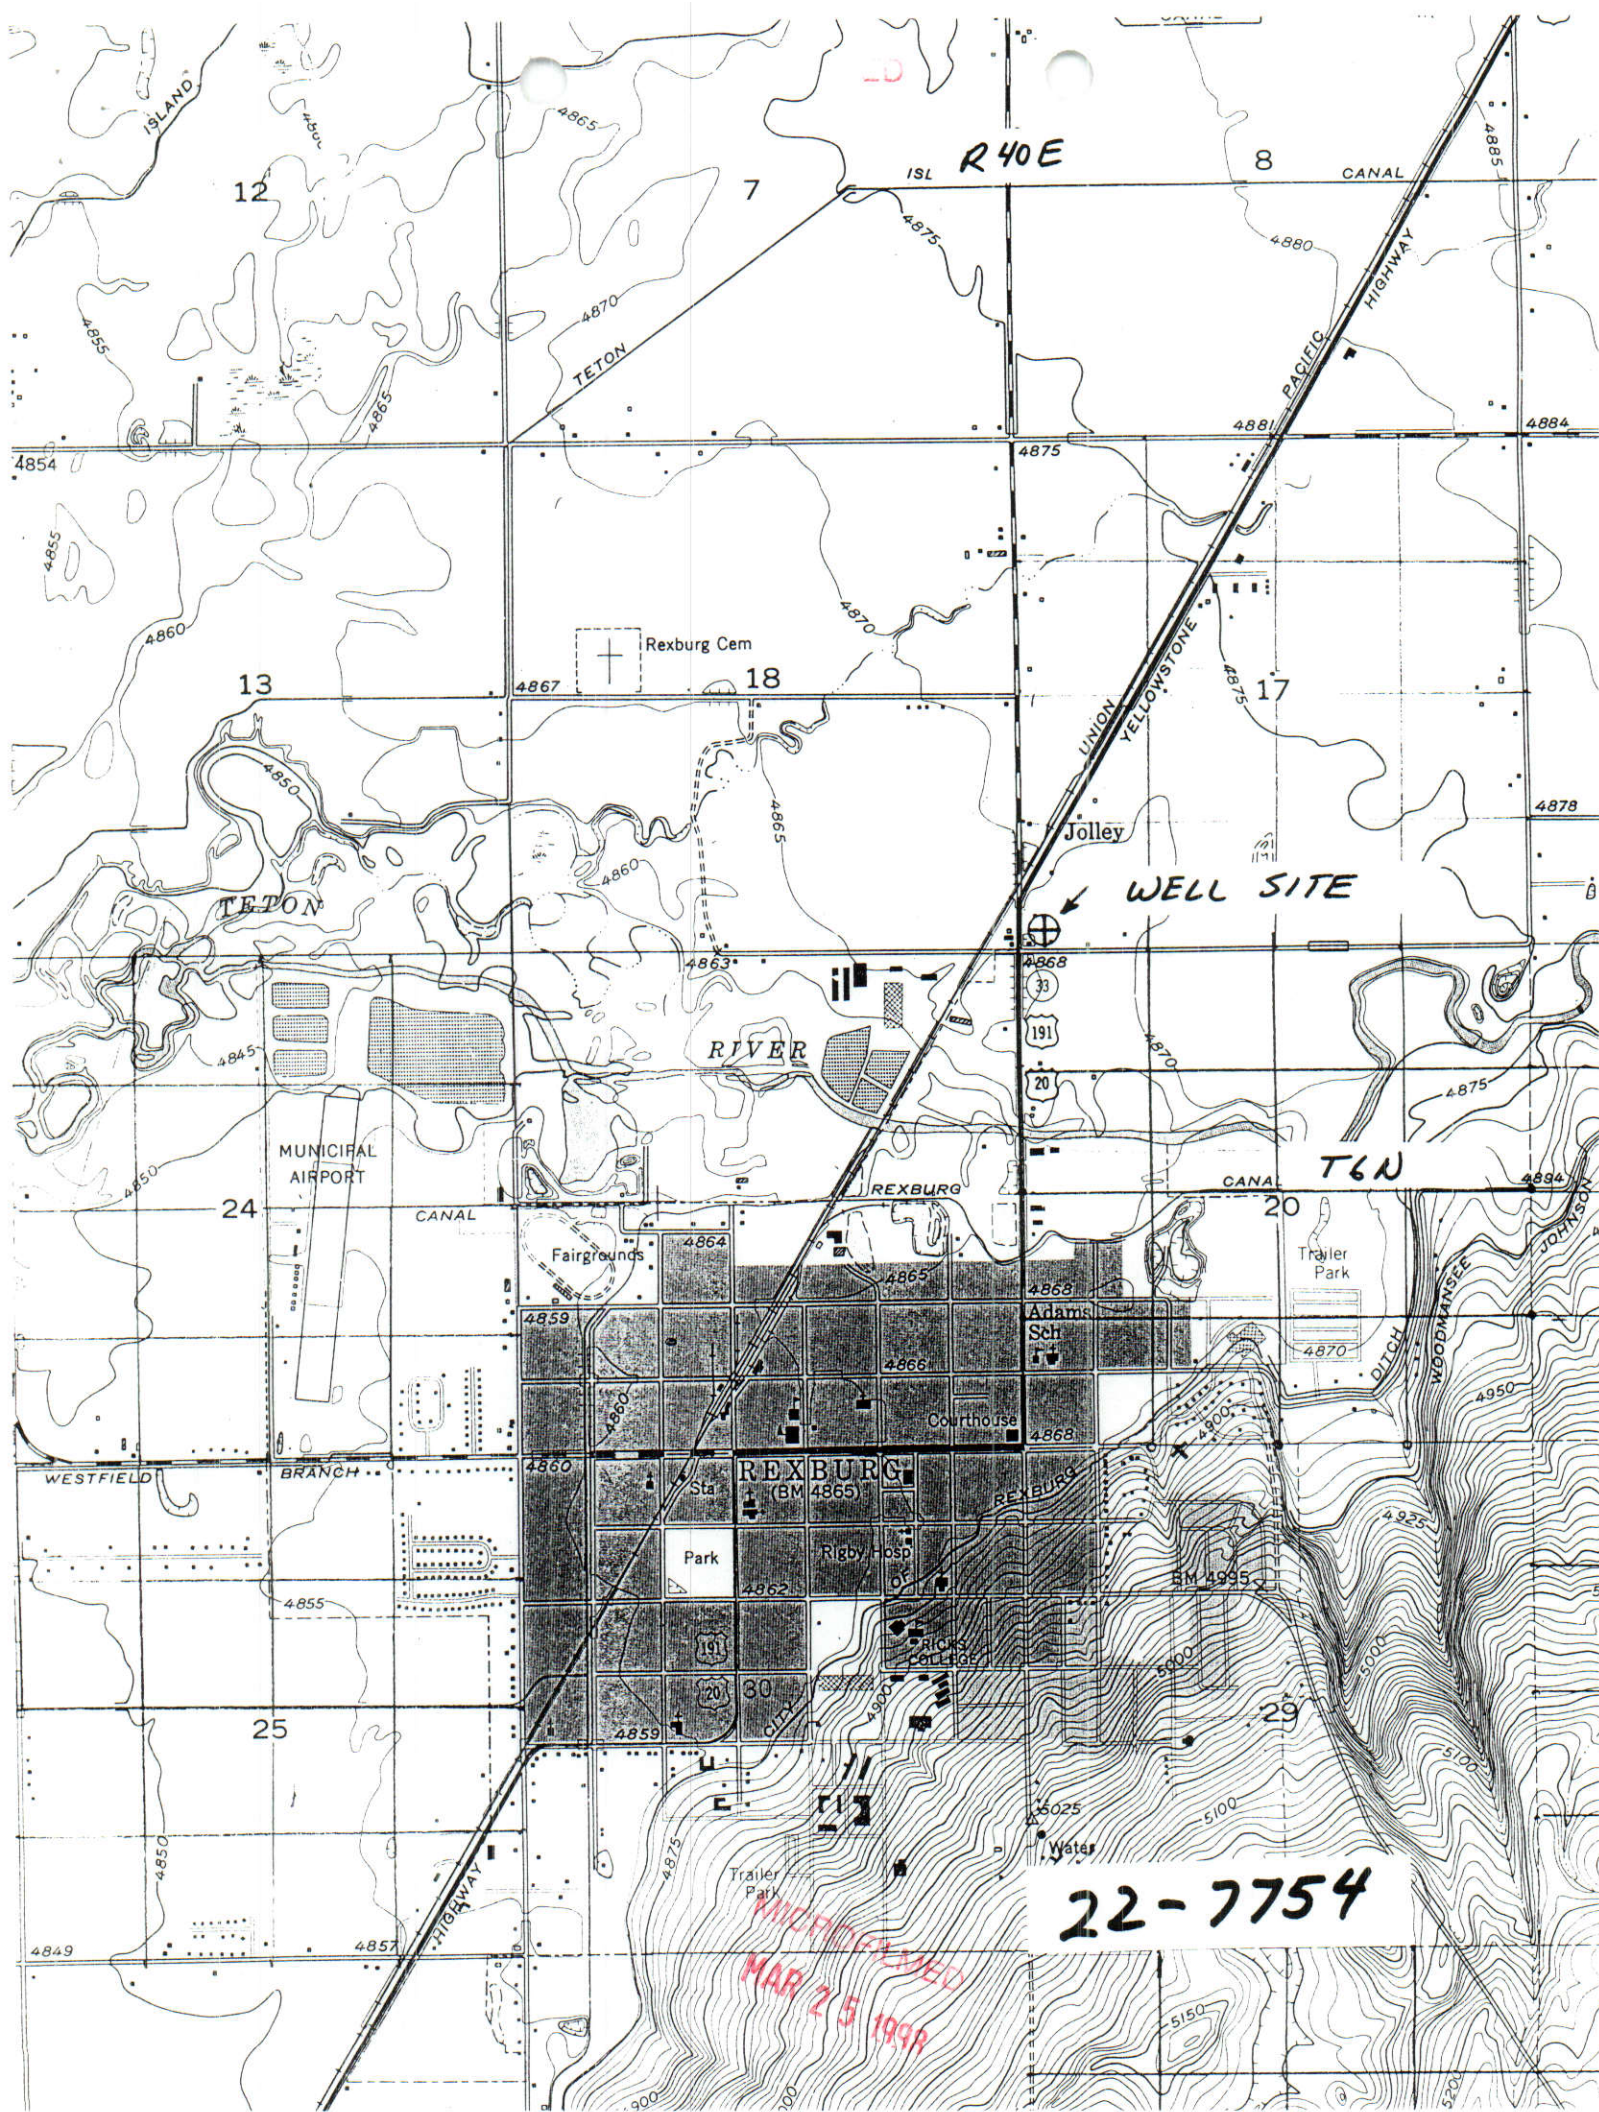

22-7754

UNCLASSIFIED
MAR 25 1998

22-7754

CITY OF KEXBURG
WELL HOUSE - CONTROL ROOM



150 HP PUMP / VALVING / CONTROLS



MICROFILMED
MAR 25 1998

22-07754

North Well

22-7754


HP

Range 260'

Depth Well 285'

Lat $43^{\circ} 50' 28''$
Long $111^{\circ} 46' 37''$

Accounted
De Lynn Edstrom
Water Superintendent

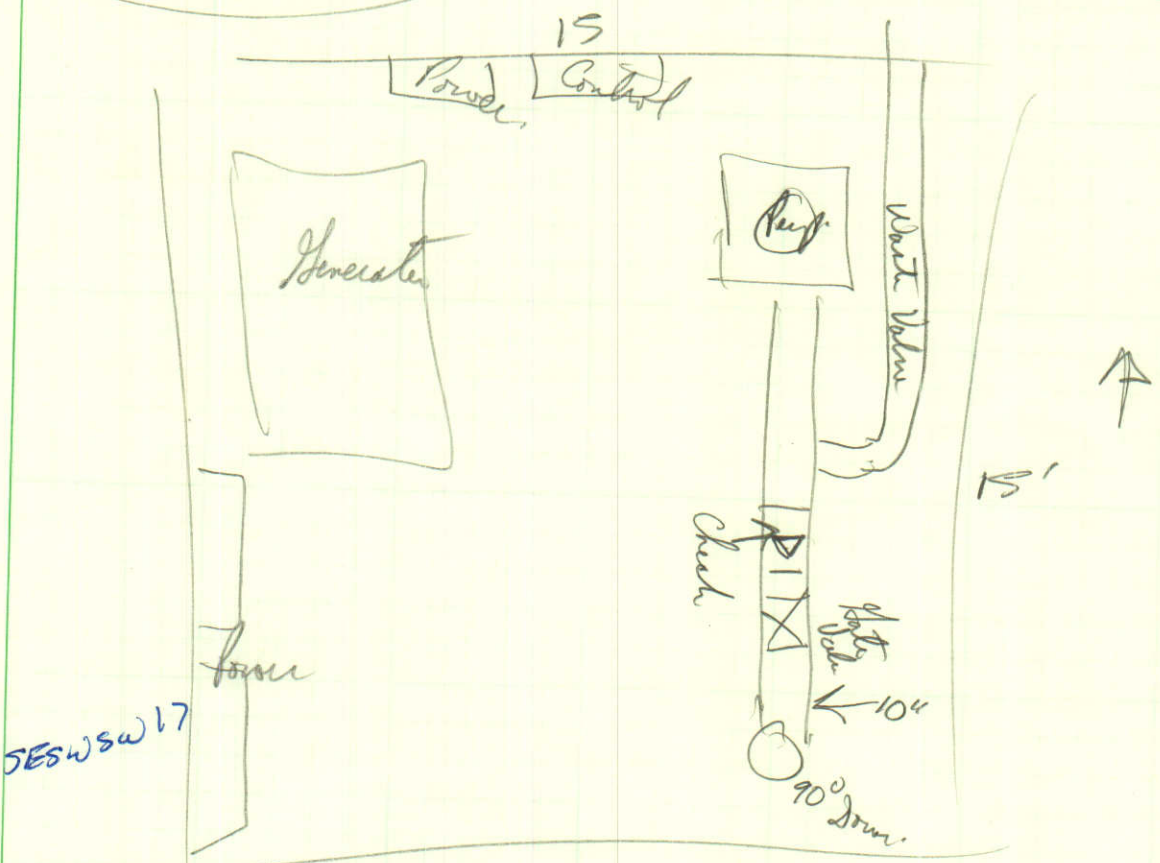

SESW 17

Water Level 139'

80# PSI Normal
Current 111 PSI

US Motor

HP 150 6350 / V08V 203 R096 R-3

2/93
Well Drilled 1992?
High Plains 7/92

Sensor - Act - Pak
Flow Meter - Gallons 42118 X1000
1000D-AC1-39560C

MICROFILMED

MAR 25 1998

National Brand
13,782 500 SHEETS, FULLER 5 SQUARE
42,381 100 SHEETS, EYE EASE 5 SQUARE
42,382 100 SHEETS, EYE EASE 5 SQUARE
42,383 100 SHEETS, EYE EASE 5 SQUARE
42,384 100 SHEETS, EYE EASE 5 SQUARE
42,385 100 SHEETS, EYE EASE 5 SQUARE
42,386 200 RECYCLED WHITE 5 SQUARE
Made in U.S.A.

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 22-07754

Priority: December 17, 1992

Maximum Diversion Rate:

2.77 CFS

This is to certify, that CITY OF REXBURG
PO BOX 280
REXBURG ID 83440

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated December 17, 1992; and has submitted Proof of Beneficial Use on March 16, 1993. An examination indicates that the works have a diversion capacity of 2.770 cfs of water from a **GROUNDWATER** source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
MUNICIPAL	01/01 to 12/31	2.77 CFS	

LOCATION OF POINT(S) OF DIVERSION:

SWSW , Sec. 17, Township 06N, Range 40E
MADISON County

PLACE OF USE: See Remarks

CONDITIONS OF APPROVAL AND REMARKS

1. This water right is appurtenant to the described place of use.
2. This right is subject to all prior water rights and may be forfeited by five years of non-use.
3. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
4. Irrigation of large projects such as parks, golf courses, or sports activities fields is not authorized under this right.
5. Place of use is within the city limits of Rexburg.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. Witness the seal and signature of the Director, affixed at Boise, this 19TH day of MARCH, 1998.

Acting for

KARL J. DREHER, Director

MICROFILMED

MAR 25 1998

RECEIVED

MAR 19 1993

Department of Water Resources

RECEIVED

MAR 19 1993

OFFICE USE ONLY

Am't. of Fee \$ 175.00
Date 3-16-93
Receipt No. E018358
Receipt by RC

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 22-07754 Telephone No. (208) 359-3020
2. Name(s) of Permit Holder(s): CITY OF REXBURG
3. Mailing Address: P.O. BOX 280, REXBURG, IDAHO 83440
4. Source of Water: GROUND WATER

If **GROUNDWATER**, Well Driller's Name: HIGH PLAINS DRILLING Date Drilled: JULY 1992

OPTIONAL:

Pump horsepower: 150 Pressure (psi): 80 Dynamic pumping level (ft.): 135

5. Extent of Use (as authorized by the permit):

Domestic ~~3000~~ (No. of households) Stockwater _____ (No. and type of stock)

Irrigation _____ (No. of acres) Other municipal

6. Total rate and/or volume for which proof is submitted 3.3 cfs OR _____ acre/feet

7. Refer to the approval conditions on your permit and respond accordingly:

Measuring device: Required? ☒ Yes ☐ No Installed? ☒ Yes ☐ No

OR

Flow Measurement Port: Required? ☐ Yes ☒ No Installed? ☐ Yes ☐ No

8. Fee Enclosed: \$ 175 (See License Fee Schedule on back of Instruction Sheet)

9. Person to contact to accompany the Department representative during field examination of the water system.

DeLYNN EDSTROM (208) 359-3034
Name Telephone No.

P.O. BOX 280, 12 NORTH CENTER, REXBURG, IDAHO 83440
Address

10. The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

APR 07 1993

3-10-93
Date

Nile L. Boyle
Signature (and title, if on behalf of a company or organization)

MAYOR/CITY OF REXBURG

State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 22-07754

Proposed Priority: December 17, 1992 Maximum Diversion Rate: 3.30 CFS
This is to certify, that CITY OF REXBURG

PO BOX 245

REXBURG ID 83440

has applied for a permit to appropriate water from: GROUNDWATER
and a permit is APPROVED for development of water as follows:

BENEFICIAL USE

PERIOD OF USE

RATE OF DIVERSION

MUNICIPAL

01/01 to 12/31

3.30 CFS

LOCATION OF POINT(S) OF DIVERSION:

SWSW , Sec. 17, Township 06N, Range 40E
MADISON County


PLACE OF USE: See Remarks

CONDITIONS/REMARKS:

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before March 1, 1994.
2. Subject to all prior water rights.
3. A flow measurement port or other device as specified by the Department shall be installed by the right holder to provide for the installation of measuring equipment and the determination of the rate of diversion by the Department.
4. The issuance of this right in no way grants any right-of-way or easement across the land of another.
5. Irrigation of large projects such as parks, golf courses, or sports activities fields is not authorized under this permit.
6. Place of use is within the city limits of Rexburg.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the signature of the Director, affixed at Boise, this

16th day of February, 1993

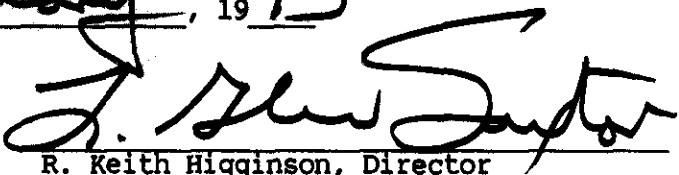for 
R. Keith Higginson, Director

RECORDED

APR 07 1993

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

1. Name of applicant City of Rexburg Phone 359-3020

Post office address P.O. Box 245 Rexburg, ID 83440

2. Source of water supply Groundwater which is a tributary of N/A

3. Location of point of diversion is SW $\frac{1}{4}$ of SW $\frac{1}{4}$ of Govt. Lot

Sec. 17 Township 06N Range 40E B.M. Madison County; additional

points of diversion if any: N/A

4. Water will be used for the following purposes:

Amount 3.30 cfs for Municipal purposes from 01/01 to 12/31 (both dates inclusive)
(cfs or acre-feet per annum)

Amount for purposes from to (both dates inclusive)
(cfs or acre-feet per annum)

Amount for purposes from to (both dates inclusive)
(cfs or acre-feet per annum)

Amount for purposes from to (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated is (a) 3.30 cfs and/or (b)
cubic feet per second acre feet per annum

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc. Existing 12" well, pump and piping
system developed under Permit No. 22-07741

b. Height of storage dam N/A feet; active reservoir capacity acre-feet; total
reservoir capacity acre-feet; period of year when water will be diverted to storage:
 to inclusive.

c. Proposed well diameter is existing inches; proposed depth of well is existing feet.

d. Is ground water with a temperature of greater than 90°F being sought? No

7. Time required for the completion of the works and application of the water to the proposed beneficial use is

existing / 1 years (minimum 1 year).

RECEIVED

APR 27 1993

8. Description of proposed uses (if irrigation only, go to item 9):

- a. Hydropower; show total feet of head and proposed capacity in KW. _____
- b. Stockwatering; list number and kind of livestock. _____
- c. Municipal; show name of municipality. _____
- d. Domestic; show number of households. Approximately 3800 - City of Rexburg
- e. Other; describe fully. Numerous public and commercial users.

9. Description of place of use:

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

City of Rexburg

TWP	RANGE	SEC.	NE¼				NW¼				SW¼				SE¼				TOTALS
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	
6N	40	19✓									D	D	D	D	D	D	D	D	
6N	40	30✓	D	D	D	D	D	D	D	D	D	D	D	D	D	D	D	D	
6N	~~40~~ 39½	24													D			D	
6N	40	20✓						D	D		D	D	D	D		D	D		
6N	~~40~~ 39½	25	D			D									D			D	
6N	40	29✓					D	D	D	D	D	D	D	D					

Total number of acres to be irrigated _____


10. Describe any other water rights used for the same purposes as described above. The City of Rexburg has five (5) other active domestic wells.

11. a. Who owns the property at the point of diversion? City of Rexburg
- b. Who owns the land to be irrigated or place of use? N/A
- c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing. N/A

12. Remarks: The existing well was permitted as a fire protection diversion by Permit No. 22-07741 on September 23, 1992.

APR 07 1993

13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

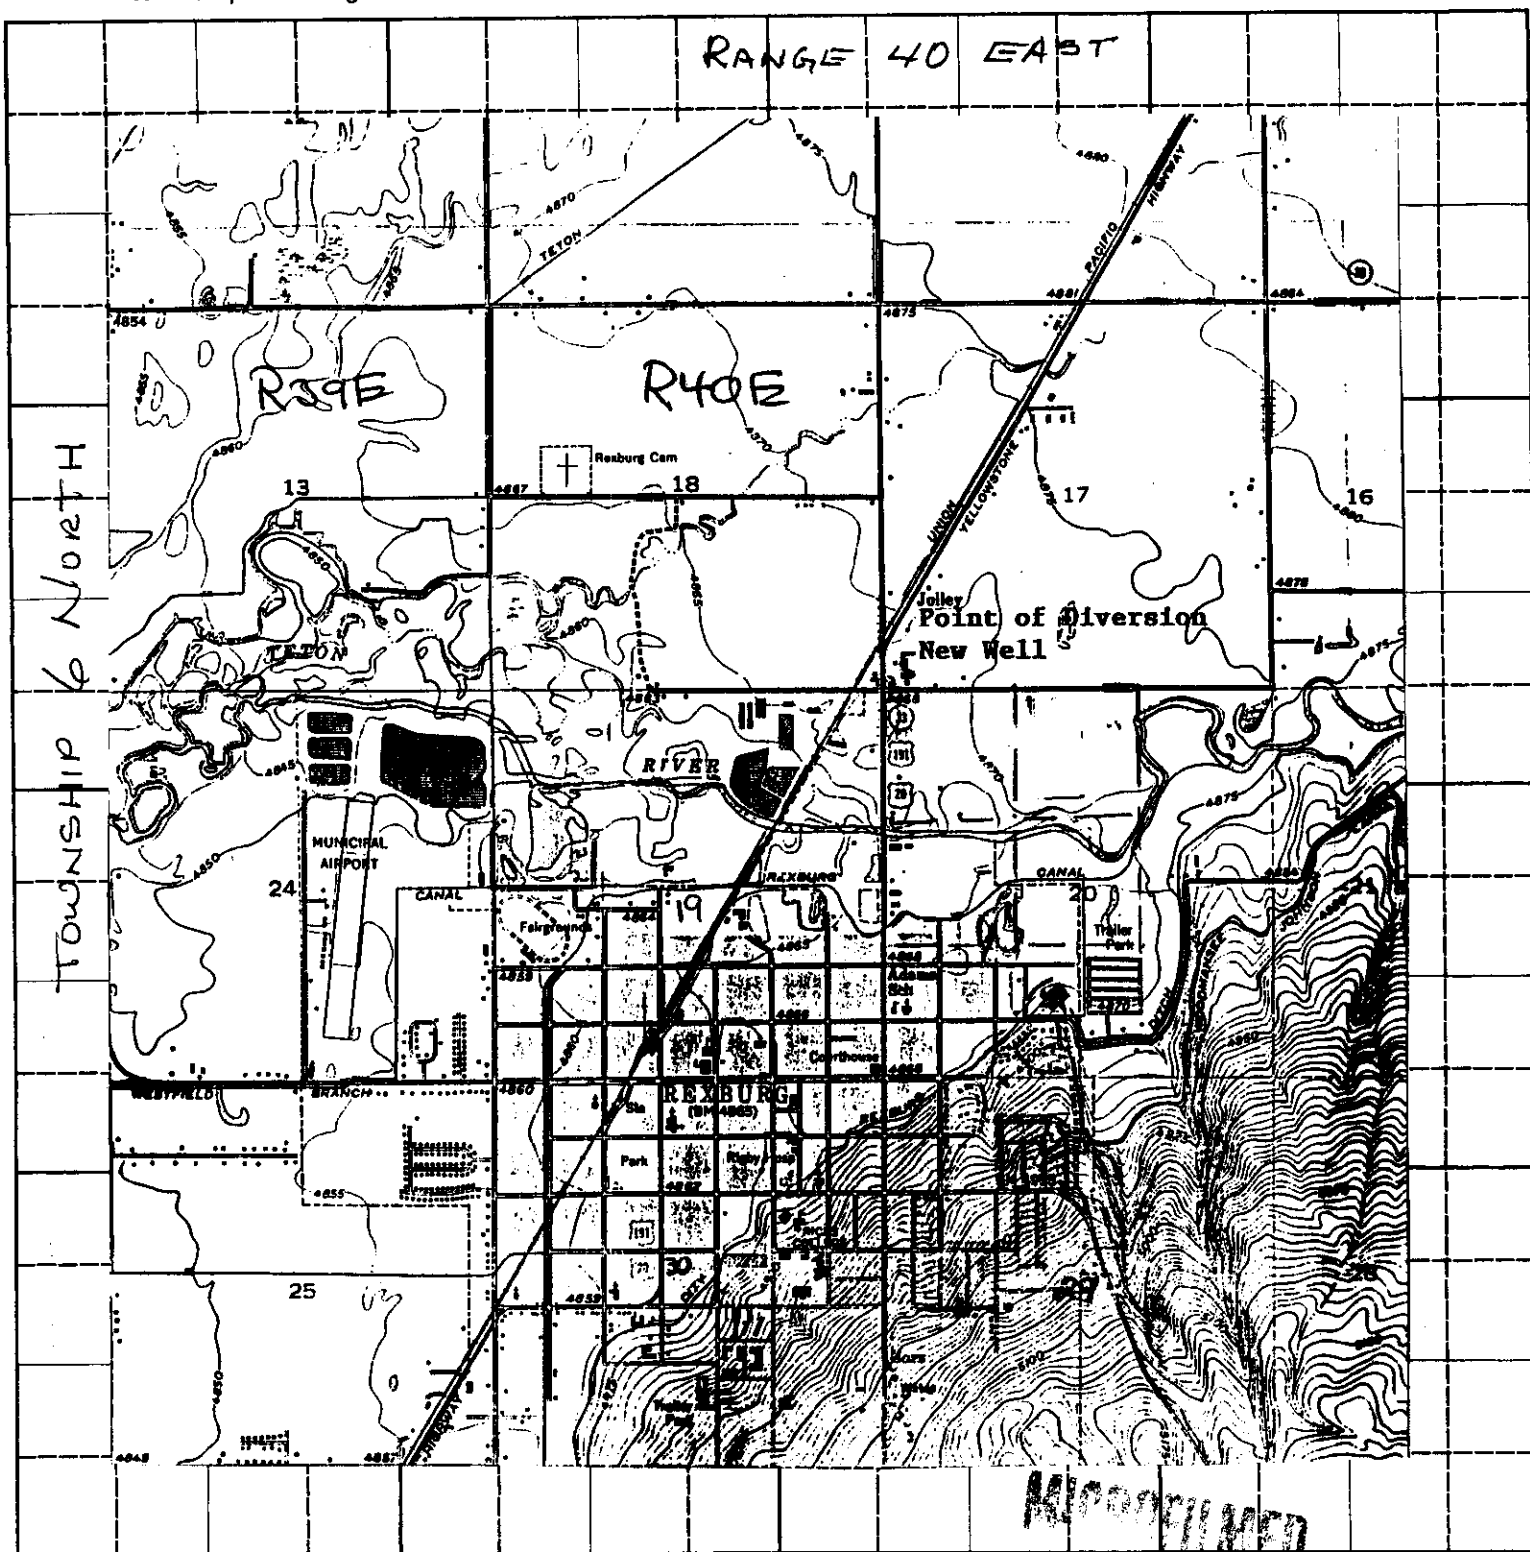

Scale: 2 inches equal 1 mile.

APR 07 1993

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Nile L. Boyle

(Applicant)

(Mayor)

Received by WM Date 12/17/92 Time 1:00 p.m. CK # 1629 12/17/92 WM
Preliminary check by _____
Fee \$ 105-~~85~~ Received by HCT # E018125 Date 12-17-92
Publication prepared by RB Date 1-7-93 Published in Lexburg Standard
Publication approved RB Date 2-2-93

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. _____, and said application is hereby _____.

1. Approval of said application is subject to the following limitations and conditions:

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
- b. Proof of construction of works and application of water to beneficial use shall be submitted on or before _____, 19 ____.
- c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.
- d. The water right acquired under this permit if for hydropower purposes shall be junior and subordinate to all rights to the use of water, other than hydropower, within the State of Idaho that are initiated later in time than the priority of this permit and shall not give rise to any right or claim against any future rights to the use of water, other than hydropower, within the State of Idaho initiated later in time than the priority of this permit.
- e. Other:

APR 07 1993

THE STANDARD JOURNAL
Rexburg, Idaho
AFFIDAVIT OF PUBLICATION


STATE OF IDAHO
County of Madison

I, TERRY WEATHERSTON being
first duly sworn, depose and say, that I
am the printer of THE STANDARD JOURNAL,
a semi-weekly newspaper printed and
published semi-weekly at Rexburg,
Madison County, Idaho; and I do solemnly
swear that the

NOTICE OF APPLICATION a copy
of which notice appears attached hereto,
was published in the regular and entire
issue of said newspaper, and not in any
supplement issue thereof for

TWO consecutive issues, the
first publication having been made on
JANUARY 7, 1993 and the last
publication having been made on
JANUARY 14, 1993.

Further, that said newspaper is one
of general circulation in said county;
that it is a legal newspaper, conforming
to legal specifications under the Idaho
Statutes; that it has at least two
hundred bona fide subscribers living
within the county of publication; and
that it has been continuously and
uninterruptedly published in said county
during a period of seventy eight
consecutive weeks prior to the first
publication of the said notice.

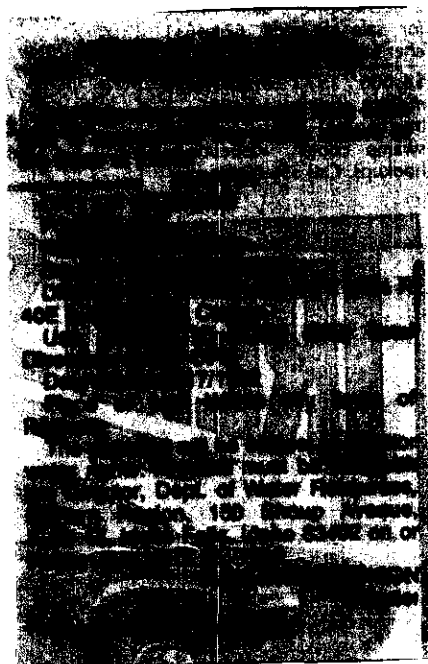

Terry Weatherston

STATE OF IDAHO)
COUNTY OF MADISON)

On this 15TH day of JANUARY in
the year of 1993, before me, a Notary
Public, personally appeared Terry
Weatherston, known or identified to me
to be the person whose name subscribed
to the within instrument, and being by
me first duly sworn, declared that the
statements therein are true, and
acknowledged to me that he executed the
same.

George H. [Signature]

Notary Public for Idaho

Residing at Rexburg, Idaho
My commission expires: June 8, 1993.

APR 07 1993



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. Box 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

March 23, 1998

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

CITY OF REXBURG
PO BOX 280
REXBURG ID 83440

RE: WATER RIGHT NO. 22-07754

Dear Water Right Holder(s):

The Department of Water Resources (the Department) has issued the enclosed license confirming that a water right has been established in accordance with the permit referenced above. The license is a preliminary order issued by the Department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department unless a party petitions for reconsideration or files an exception and/or brief as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the Department within fourteen (14) days of the service date of this order. The Department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See section 67-5243(3), Idaho Code.

EXCEPTIONS AND BRIEFS

Within twenty-one (21) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding. Otherwise, this preliminary order will become a final order of the Department.

If any party appeals or takes exceptions to this preliminary order, opposing parties shall have twenty-one (21) days to respond to any party's appeal. Written briefs in support of or taking exceptions to the preliminary order shall be filed with the Department. The Department retains the right to review the preliminary order on its own motion.

MICROFILMED

MAR 25 1998

ORAL ARGUMENT

If the Department grants a petition to review the preliminary order, the Department shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Department will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Department orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Department in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with Rules of Procedure 302 and 303.

FINAL ORDER

The Department will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Department may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The Department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28, days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

If you have any questions, please call me at 208-327-7946.

Sincerely,

A handwritten signature in cursive script that reads "Shelley W. Keen".

Shelley W. Keen
Water Rights Supervisor

SK:klt

Enclosure


MICROFILMED
MAR 25 1968

CERTIFICATE OF MAILING

I hereby certify that on the 23rd day of March, 1998, I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER (Approved License) to the person(s) listed below:

Water Right No. 22-07754

CITY OF REXBURG
PO BOX 280
REXBURG ID 83440

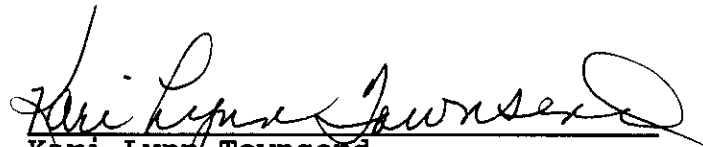
Kari Lynn Townsend
Secretary

RECEIVED
MAR 25 1998

LICENSE REVIEW CHECKLIST

PERMIT NO. 22-07754

DATE 7/19/96

REVIEWER: S H A R L A

NAME	Change <u>—</u>	OK <u>✓</u>	Address Change <u>NO</u>
SOURCE	Change <u>—</u>	OK <u>✓</u>	Is change/clarification of originally intended source? <u>—</u> If not, prepare Notice of Intent to Void <u>—</u>
POINT OF DIV	Change <u>—</u>	OK <u>✓</u>	Amendment required <u>NO</u>
PLACE OF USE	Change <u>—</u>	OK <u>✓</u>	Amendment required <u>NO</u>

Does map agree with written description? ✓ yes — no

OVERLAPS — P/D — P/U

RATE OF DIV

Permitted Rate	<u>3.30</u> cfs
Fee limit	<u>4.0</u> cfs <u>\$175⁰⁰</u>
Measured	<u>—</u> cfs
Theoretical	<u>2.77</u> cfs <u>2111 psi = 2.28</u>
Recommended Total Div Rate <u>2.77</u> cfs	

ANNUAL VOLUME/ NATURE OF USES

<u>—</u>	<u>✓</u>	<u>Municipal</u>	Volume Calculation
<u>—</u>	<u>—</u>	<u>—</u>	<u>NO VOLUME</u> af
<u>—</u>	<u>—</u>	<u>—</u>	<u>USED</u> af
<u>—</u>	<u>—</u>	<u>—</u>	<u>—</u> af
<u>—</u>	<u>—</u>	<u>—</u>	<u>—</u> af
SUBTOTAL			<u>—</u> af

Flow rate — cfs X N/A days X 1.9835 = — af

Total volume recommended — af
(SUBTOTAL or Flow Rate, whichever is less)

REMARKS

N/city limits of Berburg.
W21 - carryover

CONDITIONS

— Watermaster Control WD# —
— GW Measurement/Measuring Device
— Overlap
— Use-specific conditions

Advancement of Priority Date Required — yes ✓ no

SRBA Claim Filed N/A
Adjustment Memo —

1st Amend Letter N/A
2nd Amend Letter —

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
APR 1993
F. J. [illegible]

A. GENERAL INFORMATION

Permit No. 22-7754

1. Owner: CITY OF REXBURG Phone No. (208) 359-3034
P.O.
Current Address: BOX 280, REXBURG, IDAHO 83440 359-3020

2. Accompanied by: DELYNN EDSTROM EXAM DATE: 3/7/95

Address: SAHE Phone No. 359-3020

Relationship to Permit Holder: WATER SUPERINTENDENT

3. Source: GROUND WATER tributary to N/A

B. OVERLAP REVIEW

1. Other water rights with the same place of use: (Applic.) 22--07617, (Licenw) 22-07386, See attached Sheet
2. Other water rights with the same point of diversion: NONE

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident. No.	Gov't Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
		SW	SW	SW	17	6N	40E	MADISON	U.S.G.S. TOPO MAP


2. Place(s) of Use: MUNICIPAL

Indicate Method of Determination ON SITE INSP.

TWP	RGE	SEC	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
			MUNICIPAL																

MICROFILMED
MAR 25 1998

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe I.D. as applicable. *SEE ATTACHED PHOTO'S*

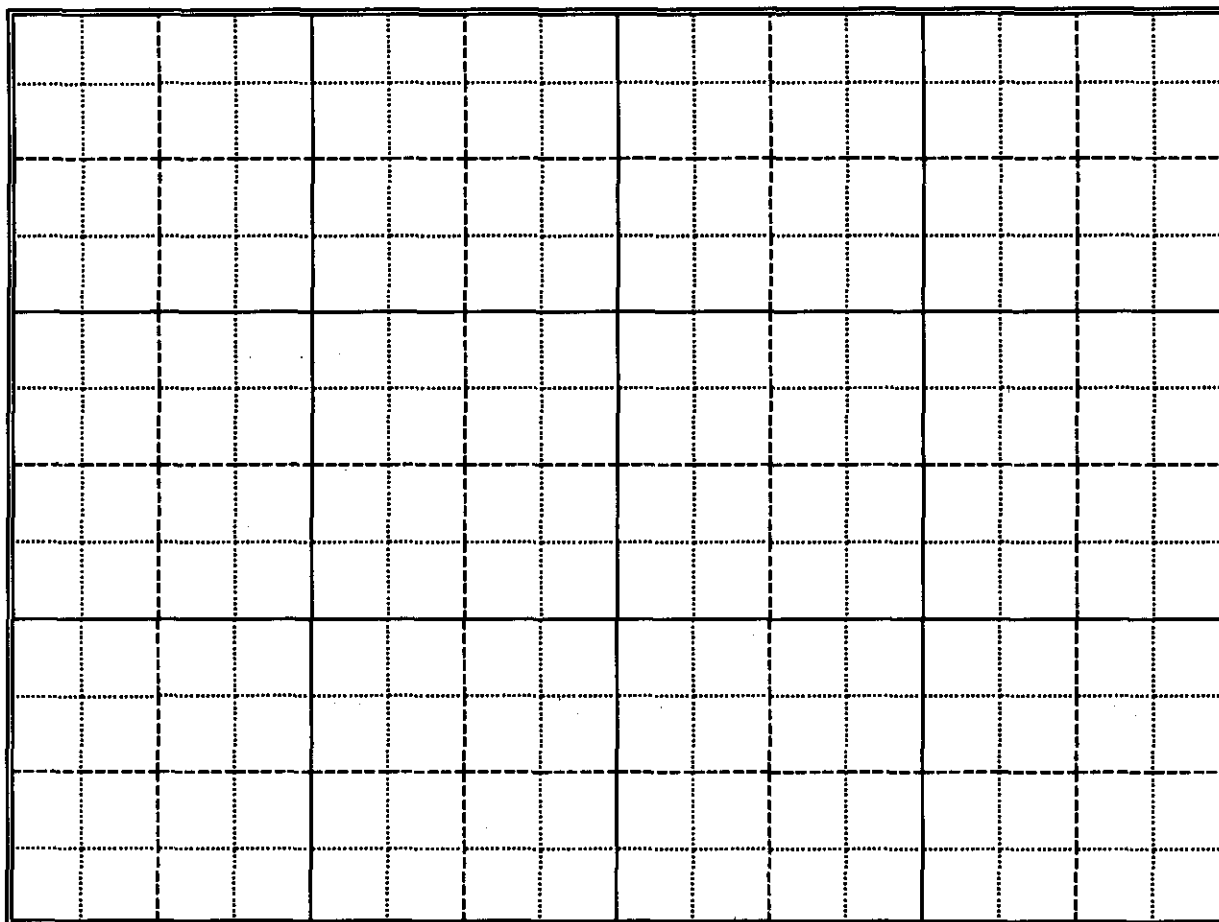

Scale: 1" = _____

____ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

____ Aerial Photo Attached (required for irrigation of 10+ acres)

____ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
NORTH WELL	U.S. MOTOR	150			10"

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: *SENSUS-ACT-PAK FLOW METER 042118 X 1000*
1000-ACI-39560C

MAR 25 1968

E. NARRATIVE/REMARKS/COMMENTS

SEE ATTACHMENT

Have conditions of permit approval been met? ☒ yes ☐ no

MICROFILMED
MAR 25 1998

F. FLOW CALCULATIONS

____ Additional Computation Sheets Attached

Measured Method:

$$Q = \frac{(150 \text{ HP} \times 8.814 \times .70 \text{ EFF})}{139' \text{ STAT} + 10' \text{ DRAW} + (2.308 \times 80 \text{ PSI})} = \frac{925.47}{333.64} = 2.77 \text{ CFS}$$

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = \underline{\hspace{2cm}}$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = \underline{\hspace{2cm}}$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = \underline{\hspace{2cm}}$$

2. Volume Calculations for Other Uses:

H. RECOMMENDATIONS

1. Recommended Amounts


Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
<u>MUNICIPAL</u>	<u>1/1</u>	<u>12/31</u>	<u>2.77</u>	<u> </u>
<u> </u>	<u> </u>	<u> </u>	<u> </u>	<u> </u>
<u> </u>	<u> </u>	<u> </u>	<u> </u>	<u> </u>
<u> </u>	<u> </u>	<u> </u>	<u> </u>	<u> </u>
<u> </u>	<u> </u>	<u> </u>	<u> </u>	<u> </u>
Totals:			<u>2.77 CFS</u>	<u> </u>

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☐ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

I. AUTHENTICATIONField Examiner's Name SIMPKINS Date 3/22/95Reviewer [Signature] Date 4-5-96

SEAL

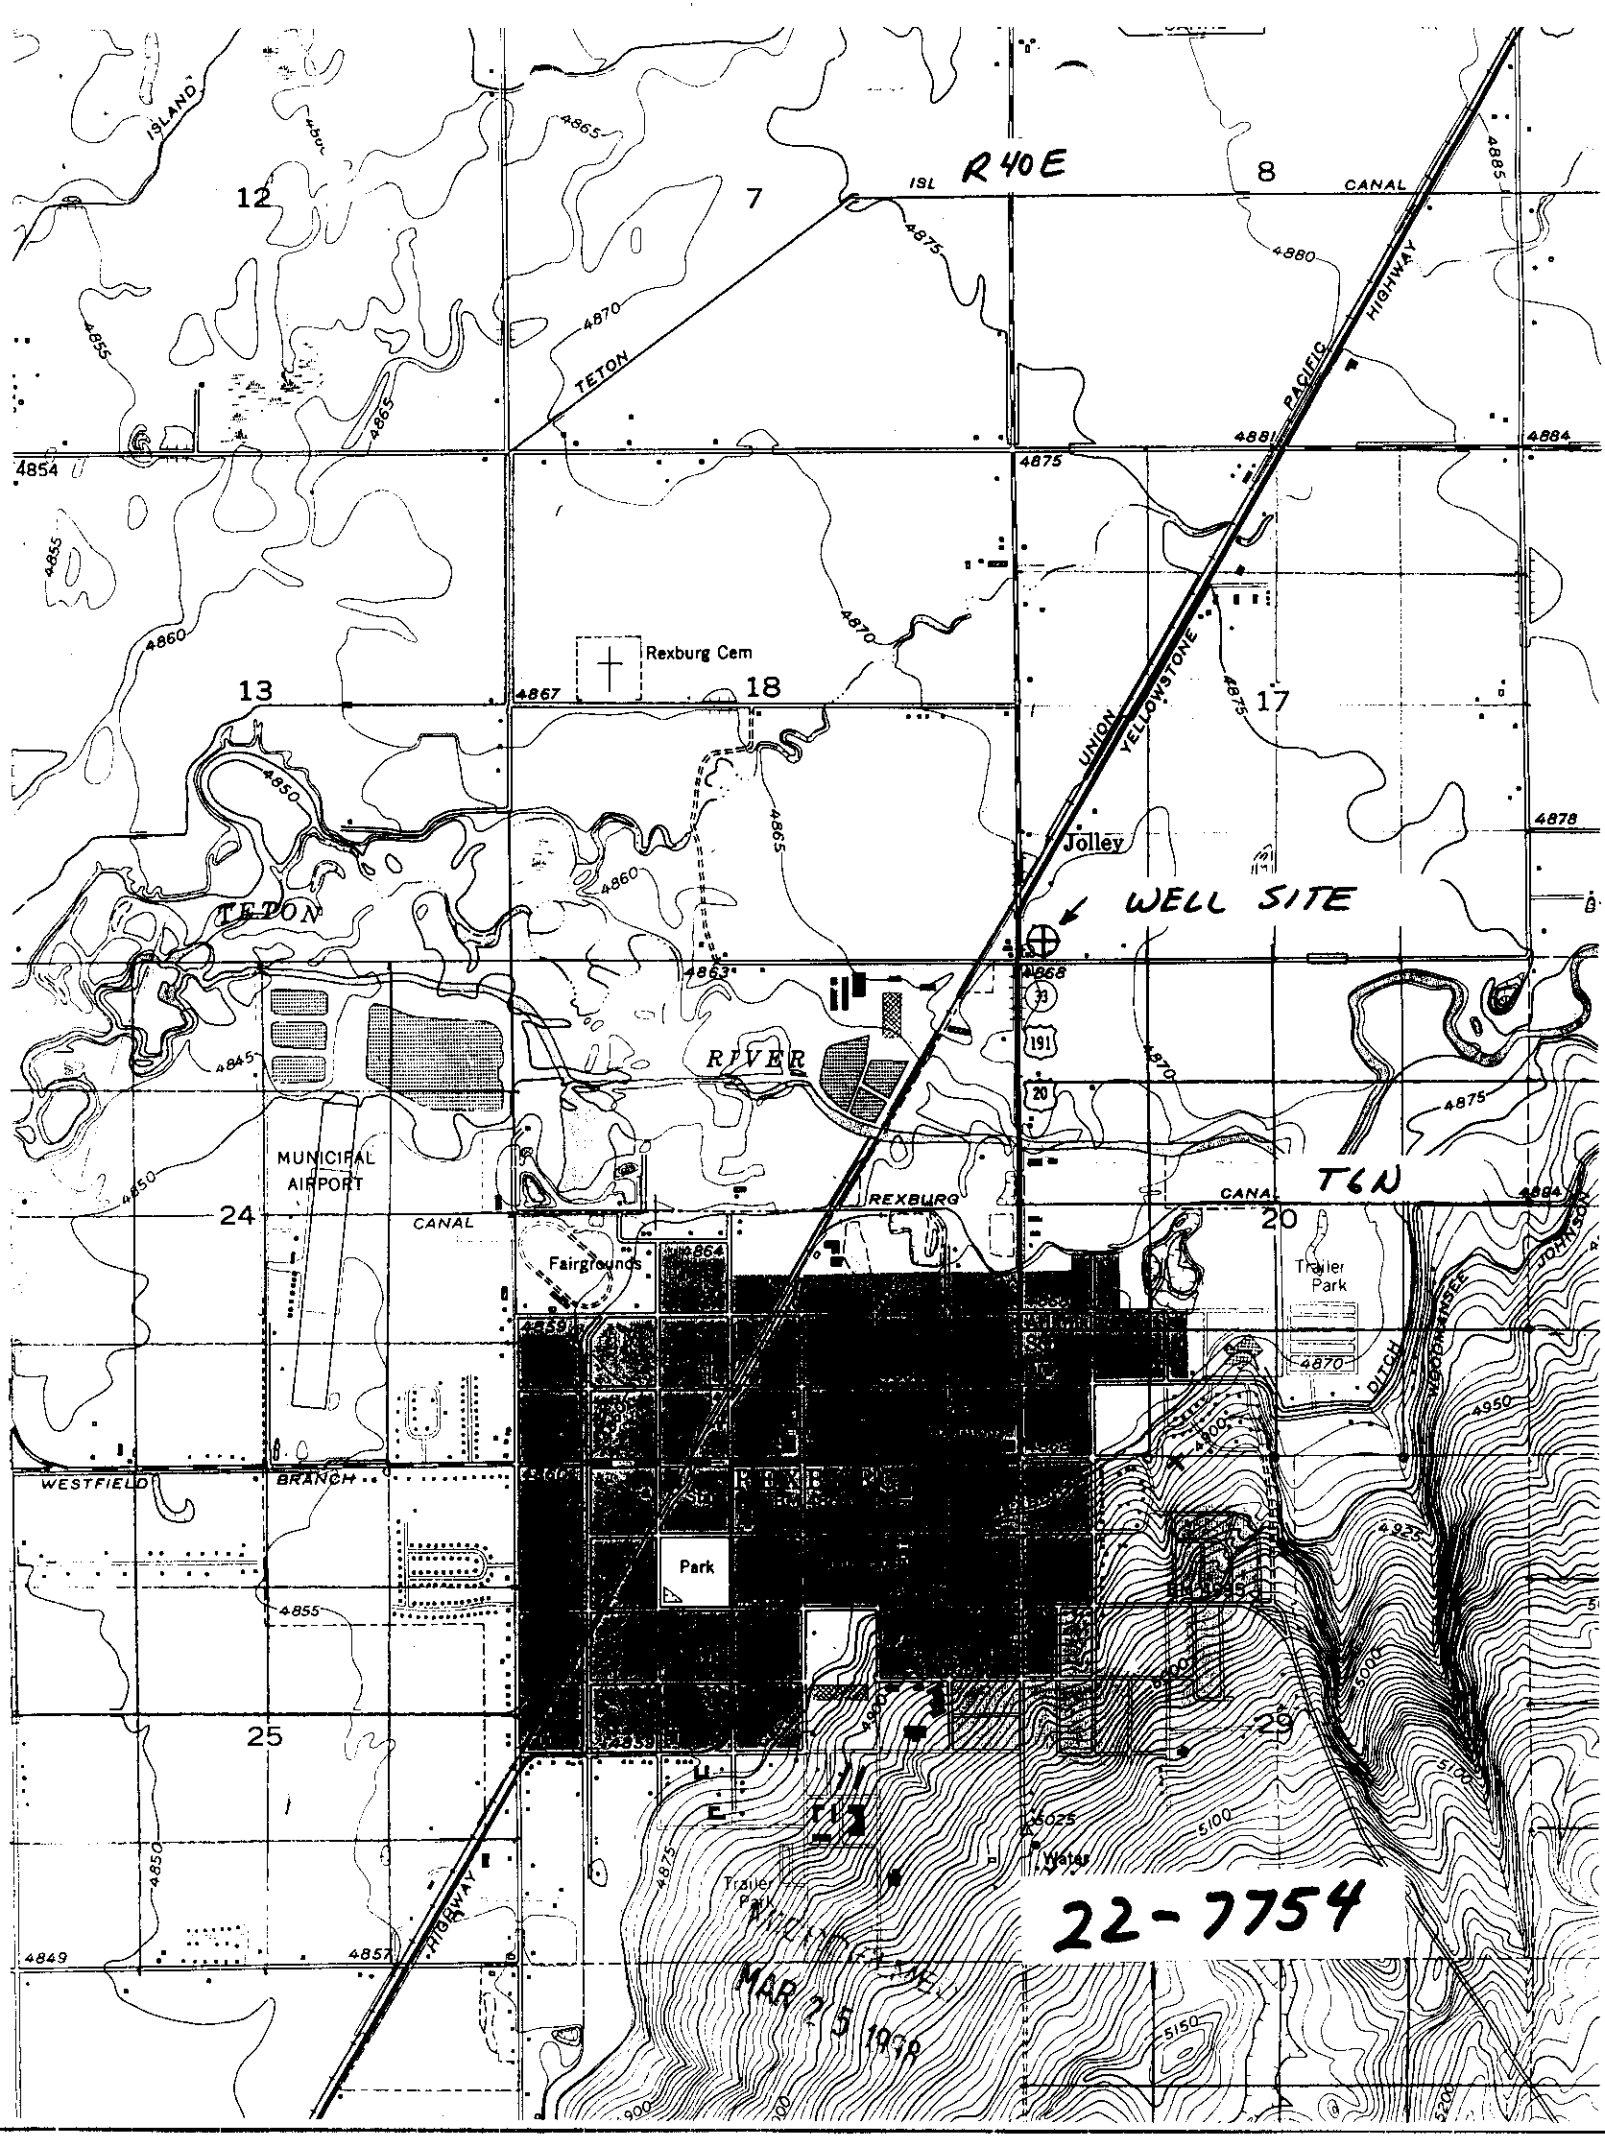

ON 3/7/95 A FIELD EXAM WAS CONDUCTED FOR PERMIT # 22-7754. THE IS A MUNICIPAL WELL AND PUMP USED TO PROVIDE ADDITIONAL WATER TO THE CITY WATER SUPPLY.

THE NORTH WELL HAS A 150 HP PUMP WHICH SUPPLIES WATER ON SYSTEM DEMAND INTO A MAIN LINE INCORPORATED INTO THE CITY WATER SUPPLY SYSTEM. THE PUMP BOWLS SET AT 167 FEET, IN A 285 FEET DEEP WELL. A WATER LEVEL INDICATOR IN THE CONTROL BUILDING INDICATED THE CURRENT WATER LEVEL TO BE AT 139 FEET. THE SYSTEM PRESSURE CURRENTLY HAD A READING OF 111 PSI, BUT THE SUPERINTENDENT SAID THE NORMAL SYSTEM OPERATING PRESSURE WAS 80 PSI. A FLOW METER READING WAS ABLE TO BE OBTAINED BUT I WAS NOT ABLE TO FIND OUT WHEN THE NORTH WELL WAS FIRST RUN (42,118,000 gallons have flowed to date).

A SONIC METER READING WAS ATTEMPTED BUT THE SONIC EQUIPMENT WAS NOT ABLE TO BE MOUNTED ON THE SPACES AVAILABLE (SPACE LIMITATIONS).

ENCLOSURE
MAR 25 1998

22-7754

CITY OF LEXBURG

WELL HOUSE - CONTROL ROOM



150 HP PUMP / VALVING / CONTROLS



MAR 25 1978

22-07754


22-7759



Depth of well 285'

Lat $43^{\circ} 50' 28''$
Long $111^{\circ} 46' 37''$

De Lynn Edstrom
Water Superintendent

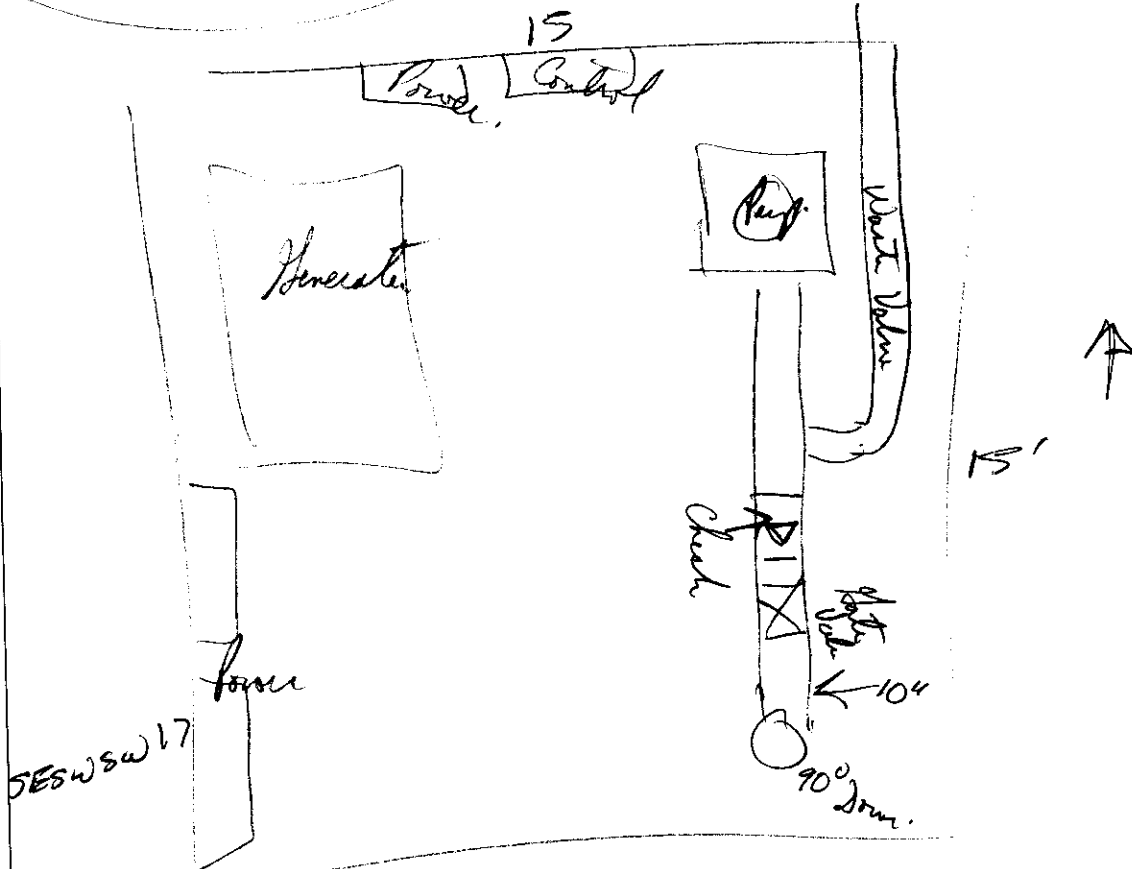

Water Level 139'

80# PSI Normal
Current 111 PSI

US Motor

HP ISO 6350 / V08V 203 R096R-3

Sensu - Act - Path.

Flow Meter - Galbano 42118 x 1000
1000D-ACI-39560C

Well Drilled $\frac{2/93}{1992}$?
High Plains $\frac{7/92}{1992}$

53.3 Kevan

$$Q = \frac{150(8.814)(.70)}{139.1(80 \times 2.308)} = \frac{925.47}{323.64} = 2.859$$

INTERMEDIATE
17 12 78

April 2, 1993

CITY OF REXBURG
PO BOX 280
REXBURG ID 83440

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 22-07754

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water.

If you have questions concerning this matter, please feel free to contact the EASTERN Regional Office in Idaho Falls at (208)525-7161.

Sincerely,

Karen L. Gustafson
Secretary/Records Manager

c: IDWR - Region

RECEIVED

APR 07 1993

ANALYSIS SHEET
FOR
PROOF OF BENEFICIAL USE

Permit No. 22-07754 Reviewed by Klg Date 3/19/93

GENERAL CONSIDERATIONS

TYPES OF USE

yes Name same as permit? municipal
yes Address same as permit?
yes Proof timely received? Correct Uses? yes
If not, complete calculation below.

SOURCE OF WATER

 Surface water source
✓ Ground water source
yes Drilling permit required?
data copy yes Copy in the file? Drilling Permit No. 22-92-E-009500
200 Amount paid for permit yes Correct?
yes Well log in the file?

LICENSE EXAMINATION FEE

MEASURING DEVICE

yes Required?
175 Amount Submitted
yes Correct?
yes Required?
yes Installed?
NA Waiver requested?

PRIORITY CALCULATION

Date proof received NA
Date proof due -
No. of days late =
Priority Date +
New Priority Date

DEFICIENCIES OR ACTION ITEMS

proof acceptable

DATA ENTRY

New Address PO Box 280 3/31/93 Klg

Proof Made 3/19/93
4/2/93 Klg

PERMIT NUMBER	OWNER CODE	NAME & ADDRESS	TWP	RGE	SEC	TRACT	LOT	COUNTY
22-92-E-0095-000	0	CITY OF REXBURG 12 N CENTER PO BOX 245 REXBURG, ID 83440 (208) 359-3020	06N	40E	17	SW SW		MADISON

Subdivision Location and Description:

Subdivision Name:

Well Site Address: 1000 N HWY 33

City, State: REXBURG, ID

Geographic Location:

Accuracy Code:

Lat: : : N

Long: : : W

Lot(s):

Block(s):

Proposed Use of Well: Other

Proposed Casing Diameter: 16 In.

Proposed Depth: 250 Ft.

Well Use Comments: FIRE PROTECTION

Driller License No: 0299

Firm Name: HIGH PLAINS DRILLING INC

Official: MARCUS FRANSEN

Permit Status: Permit

Verbal Issue Date:

Date Received: 06/08/1992

Date Approved: 06/05/1992

Proposed Start Date: 06/15/1992

Extension Date:

Extension Expiration:

Receipt No.

E017459

Receipt Date

06/05/1992

Fee

\$ 200.00

Permit Remarks:

WELL DRILLER'S LOG REPORT

Drilling Permit No: 22-92-E-0095-000

Water Right No: 22-07741

Injection Permit No:

Nature of Work: NEW WELL

Construction Method: ROTARY & CABLE

Number of Monitor Wells:

Casing Diameter: 12 In.

Static Water Level: 30 Ft.

Actual Start Date: 07/01/1992

Depth of Casing: 211 Ft.

Temperature: 49 F.

Well Finish Date: 07/30/1992

Total Depth: 296 Ft.

Production Rate: 1400.00 GPM

Log Received Date: 03/25/1993

Screen Installed? No

Certification Date: 08/23/1992

Field Inspection Date:

Inspector:

Well Log Remarks: .375 - 16 INCHES FROM 2 TO 125 FEET
 .375 - 14 INCHES FROM 2 TO 146 FEET
 .375 - 12 INCHES FROM 146 TO 211 FEET

APR 07 1993

MICROFILMED

**USE TYPEWRITER OR
BALLPOINT PEN**

MAR 29 1993

WELL DRILLER'S REPORT

State law requires that this report be filed with the Director, Department of Water Resources, within 30 days after the completion or abandonment of the well.

[illegible]



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

March 19, 1993

High Plains Drilling
Marcus Frandsen
PO Box 756
Rexburg, ID 83440

Re: Permit No. 22-07754 - City of Rexburg
Drilling Permit No. 22-92-E-0095-000
Drilling Date: July, 1992
Proposed Location: 06N, 40E, Section 17, SW $\frac{1}{4}$ SW $\frac{1}{4}$

In the department's review of the proof of beneficial use submitted in connection with the above referenced permit, the department was not able to locate a well log which should have been submitted 30 days after completion of the construction of this well.

While it is possible that you have submitted the log, we have been unable to locate it. Please supply me with another copy. Please address any correspondence directly to me. Your response should be received within 20 days of the date of this mailing.

This information is needed before the department can proceed further with the examination of the permit holders system and the eventual issuance of a license of water right.

If you have any questions or if I can be of any further assistance, please feel free to contact me.

Sincerely,

Karen L. Gustafson
Secretary/Records Manager

C: Permit Holder

RECEIVED

APR 07 1993



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

February 17, 1993

CITY OF REXBURG
PO BOX 245
REXBURG ID 83440

PERMIT APPROVAL NOTICE

RE: PERMIT NO. 22-07754

Dear Permit Holder:

Enclosed is a copy of your approved application for permit. We direct your attention to the conditions of approval on the final page.

Enclosed is a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit. Also enclosed is a form entitled "Proof of Beneficial Use". If your project is already completed you should complete and submit this form immediately.

Be sure to note the special condition requiring you to install a measuring device. Enclosed, for your reference, is a list of measuring device options.

Sincerely,

A handwritten signature in cursive script that reads "Brenda L. Miller".

BRENDA L. MILLER
Water Resource Agent

BLM:cz

Enclosures

RECEIVED

APR 07 1993

APPLICATION FOR PERMIT REVIEW

BLM

Application #: 22-7754 Date: 2-12-93 Reviewer: Brenda Miller

SYSTEM COMPLETED:

- No - 26A-P17
- Complete in 1 year - P16
- Yes
- Proof not submitted - P16
- Proof submitted - N/A

AREA OF CONCERN?

YES
SNAKE RIVER BASIN

GROUNDWATER:

- GT. 0.2 cfs <flo-ch> - ~~01C-P03~~ 01C-P03 (existing well)
- No measurement required <flow chart>
- LT. 0.2 cfs - No measurement required <flow chart>

Drilling Permit:

- (Approved) w/permit - P99 Permit No. 22-92-E-0095
- Not included - 046-46A-46B-P23 (after 7/1/87), N/A

SURFACE WATER: not in w/d - 01C-P03 (=GT.2 w/pump), NMR <flow chart>

LOCATION:

- Water Districts - WD No. 01
- Surface water - R04, R04-01H-P01(LT.2 w/pump)
- Groundwater EXISTING - R04-01J-P08(GT.2), NMR <flow chart>
- P05
- Irrigation Districts - 023
- Canal Co. Areas - 023
- Drainage Districts - 024
- Boise Front (63) - 058 (Groundwater)
- Swan Falls Flag - C (1, Blank or Other)
- Trust - 051-052-053-P74(Consumptive Uses)
- Non Trust <1> - 048-049

RIVER BASINS:

- (Surface Water) Water District Control Condition &....
- Boise (63) - 05A & 11E
- Payette (65) - 047-P04, 059-P71
- Snake (01, 02 & 03) - 11A-P04(01), 061-P07(02/03 No W.D.Cond.)

USE:

- Fish Propagation - 06A, 09E-P10 & 010 (WQ/Choose One), 042(req.), 002-P06(MD), 07A(Spec.), 044(Policy 5G)
- Power - Use Power Review
- Mining - 06A, 010, or 09E-P10 & 054(req.)
- Storage - 18A-for multiple measuring devices(In WD), 18B-P09(Size)
- Rec/Wildlf/Aes - 027(Non-Consumptive)
- Domestic - 021 (Boise River - upstream from L Peak)
- (restricted areas) 27A (Payette River & main tributaries)

OWNERSHIP:

- Non land owner - 004

PROTESTED:

- Agreement - 020

Beneficial Use Due Date - 03-01-1994

Other Conditions/Remarks: - W21

Form No. 202a
/87STATE OF IDAHO
DEPARTMENT OF WATER RESOURCESAdvertiser

APPLICATION FOR PERMIT ANALYSIS SHEET

INITIAL REVIEW BY HWS DATE 12-21-92 APPLICATION NUMBER 22 7754City of Rexburg
REQUIRED INFORMATION

- ☒ Name (If applicant is a corporation or partnership, names must be provided for the director, officers, & other partners.)
- ☒ Address
- ☒ Source (See USGS Quad for names of water sources)
- ☒ Point of Diversion (10 acres for spring, lot & block descriptions for subdivisions, local name, flow and/or volume)
- ☒ County
- ☒ Quantity (flow and/or volume)
- ☒ Period of Use
- ☒ Nature of proposed use (Include description of use.)
- ☒ Description of diverting works
- ☒ Time required for beneficial use of water
- ☒ Place of use or acres irrigated
- ☒ Map
- ☒ Signature (If applicant is corp. partnership, or municipality, title of signator is required)
- ☒ Fee
- ☒ Yes ☐ No* In form to receipt

ADDITIONAL INFORMATION

- ☒ Overlapping place of use (Describe source & relationship to present application on the back.)
- ☐ Overlapping point of diversion
- ☐ Yes ☐ No Field check required
- ☐ Yes ☐ No Field check by _____
- ☐ Yes ☐ No Field report attached
- ☐ Yes ☐ No Critical groundwater area
- ☐ Yes ☐ No Groundwater management area
- ☐ Yes ☐ No Send dam safety information
- ☐ Yes ☐ No Send power requirement letter
- ☐ Yes ☐ No Send fish farm requirement letter
- ☐ Yes ☐ No Power residency affidavit
- ☐ Yes ☐ No Power efficiency form
- ☐ Yes ☐ No Within trustwater boundary (If yes, attach trust water supplementary analysis sheet.)
- ☐ Yes ☐ No Diversion greater than 5 cfs or 500 acre ft. (If yes, attach large diversion supplementary analysis sheet.)
- ☐ See reverse side for additional information

RECEIVED
FEB 9 1993

Department of Water Resources

*REQUEST THE FOLLOWING ADDITIONAL INFORMATION FROM THE APPLICANT _____

Date Requested _____

29-Dec-1992

CITY OF REXBURG
PO BOX 245
REXBURG ID 83440

RE: Application No. 22-07754

Dear Water Right Applicant:

The Department of Water Resources acknowledges receipt of your water right permit. This office is currently in the process of advertising the application in the Rexburg Standard Journal on 1-07 & 14-93. The advertisement will be published for two consecutive weeks, and a period of ten days following the second publication will be allowed for the submittal of protests.

If the application is protested, you will be sent a copy of the protest. The protest must be resolved before the application is approved or denied. If the protest is not resolved voluntarily, this Department will conduct a conference and/or hearing on the matter.

If the application is not protested, it will be forwarded to our State Office in about five weeks. State Office Personnel will conduct a complete review prior to final processing of the application and will notify you of the outcome of this review. When a permit is issued, you will be sent a copy. A typical processing time for an unprotested application is about eight weeks.

Please feel free to contact this office if you have any questions regarding this procedure.

Sincerely,


Harold W. Jones *rb*
Water Right Supervisor

HWJ:rb

MICROFILMED

APR 07 1993

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Eastern Region
150 Shoup Ave., Suite 15

Idaho Falls, Idaho 83402
(208) 525-7161

DECEMBER 22, 1992

THE REXBURG STANDARD-JOURNAL
P.O. BOX 10
REXBURG, ID 83440

Gentlemen:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before JANUARY 25, 1993.

Yours truly,

Rita Bodell
Secretary

Encl.

RECEIVED

DEC 27 1993

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

RECEIVED

APR 07 1993

22-07754

CITY OF REXBURG
PO BOX 245
REXBURG, ID 83440

Source: GROUNDWATER

Diversion Pt: SWSW Sec 17 T 06N R 40E in MADISON County.

Use: DOMESTIC (3.300 CFS)
Total Diversion: (3.300 CFS)

Date Filed: 12/17/1992

00

MICROFILMED

APR 07 1993

The permit(s) will be subject to all prior water rights. Protests must be filed with the Director, Dept. of Water Resources, Eastern Region, 150 Shoup Avenue, Suite 15, Idaho Falls, Idaho 83402 on or before JANUARY 25, 1993.

R. KEITH HIGGINSON, Director

Published: 1/ 7/1993 & 1/14/1993

RECEIVED

APR 07 1993



City of Rexburg

STATE OF IDAHO

NILE L. BOYLE
MAYOR
ROSE BAGLEY, CLERK
RICHARD HORNER, TREASURER

RECEIVED

12 NORTH CENTER ST. PHONE (208) 359-3020
REXBURG, IDAHO 83440

December 15, 1992

DEC 17 1992

91-221

Department of Water Resources
Eastern District Office

State of Idaho
Department of Water Resources
150 Shoup
Idaho Falls, ID 83402

RE: Water Right Application

Dear Sirs:

Accompanying this letter is an application for converting a fire protection water right on an existing well to a regular water right for consumptive use by the City of Rexburg. Also included is a check for \$105 for the required fees.

The well has been drilled and is in full operation. It has become necessary for the City of Rexburg to provide water to the north area of the City on a more continuous basis. For this reason, we are asking that the well be considered for a permanent water right for year-round consumptive use.

If you have any questions or need further information, please contact myself or our Engineer, John Millar at Forsgren Associates, 356-9201, at any time.

Sincerely,

CITY OF REXBURG

Nile Boyle
Mayor, City of Rexburg

JWM/jh

DEC 17 1992

