


- MAR 30 1989



x Darrell King
(Applicant)
Title - Water Master

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

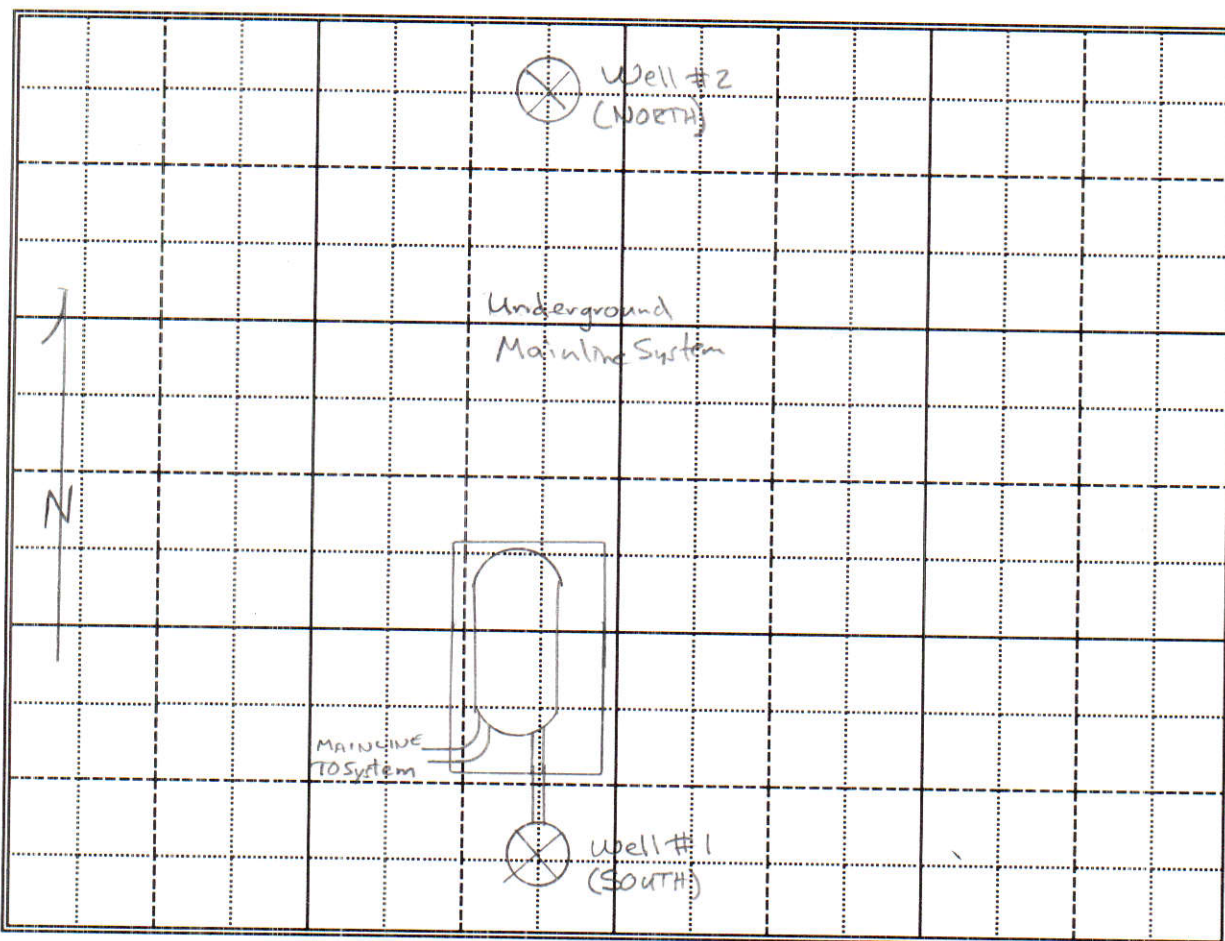

Scale: 1" = _____

____ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

____ Aerial Photo Attached (required for irrigation of 10+ acres)

____ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
#2 (NORTH)	UNKNOWN	20	UNKNOWN	?	
#1 (SOUTH)	UNKNOWN	25	UNKNOWN	?	

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
Pressure Gage		Rainbird			0-160	
Totalizing Meter		McCrometer			Gallons	

2. Measurements: PSI 50-62 psi 4.50" mainline 0.214" thickness
2.559" spacing (Could only measure Well #1 South Well)

MICROFILMED

JUN 08 1998

21

RIGBY

SOUTH

4885

4894

4879

R39E

POINTS OF DIVERSION

28

4890

PLACE OF USE

CANAL

BUNGALOW
CANAL

4894

4878

4887

4885


(ABANDONED)


RUDY

25-07454

MICROFILMED
JUN 08 1998

33

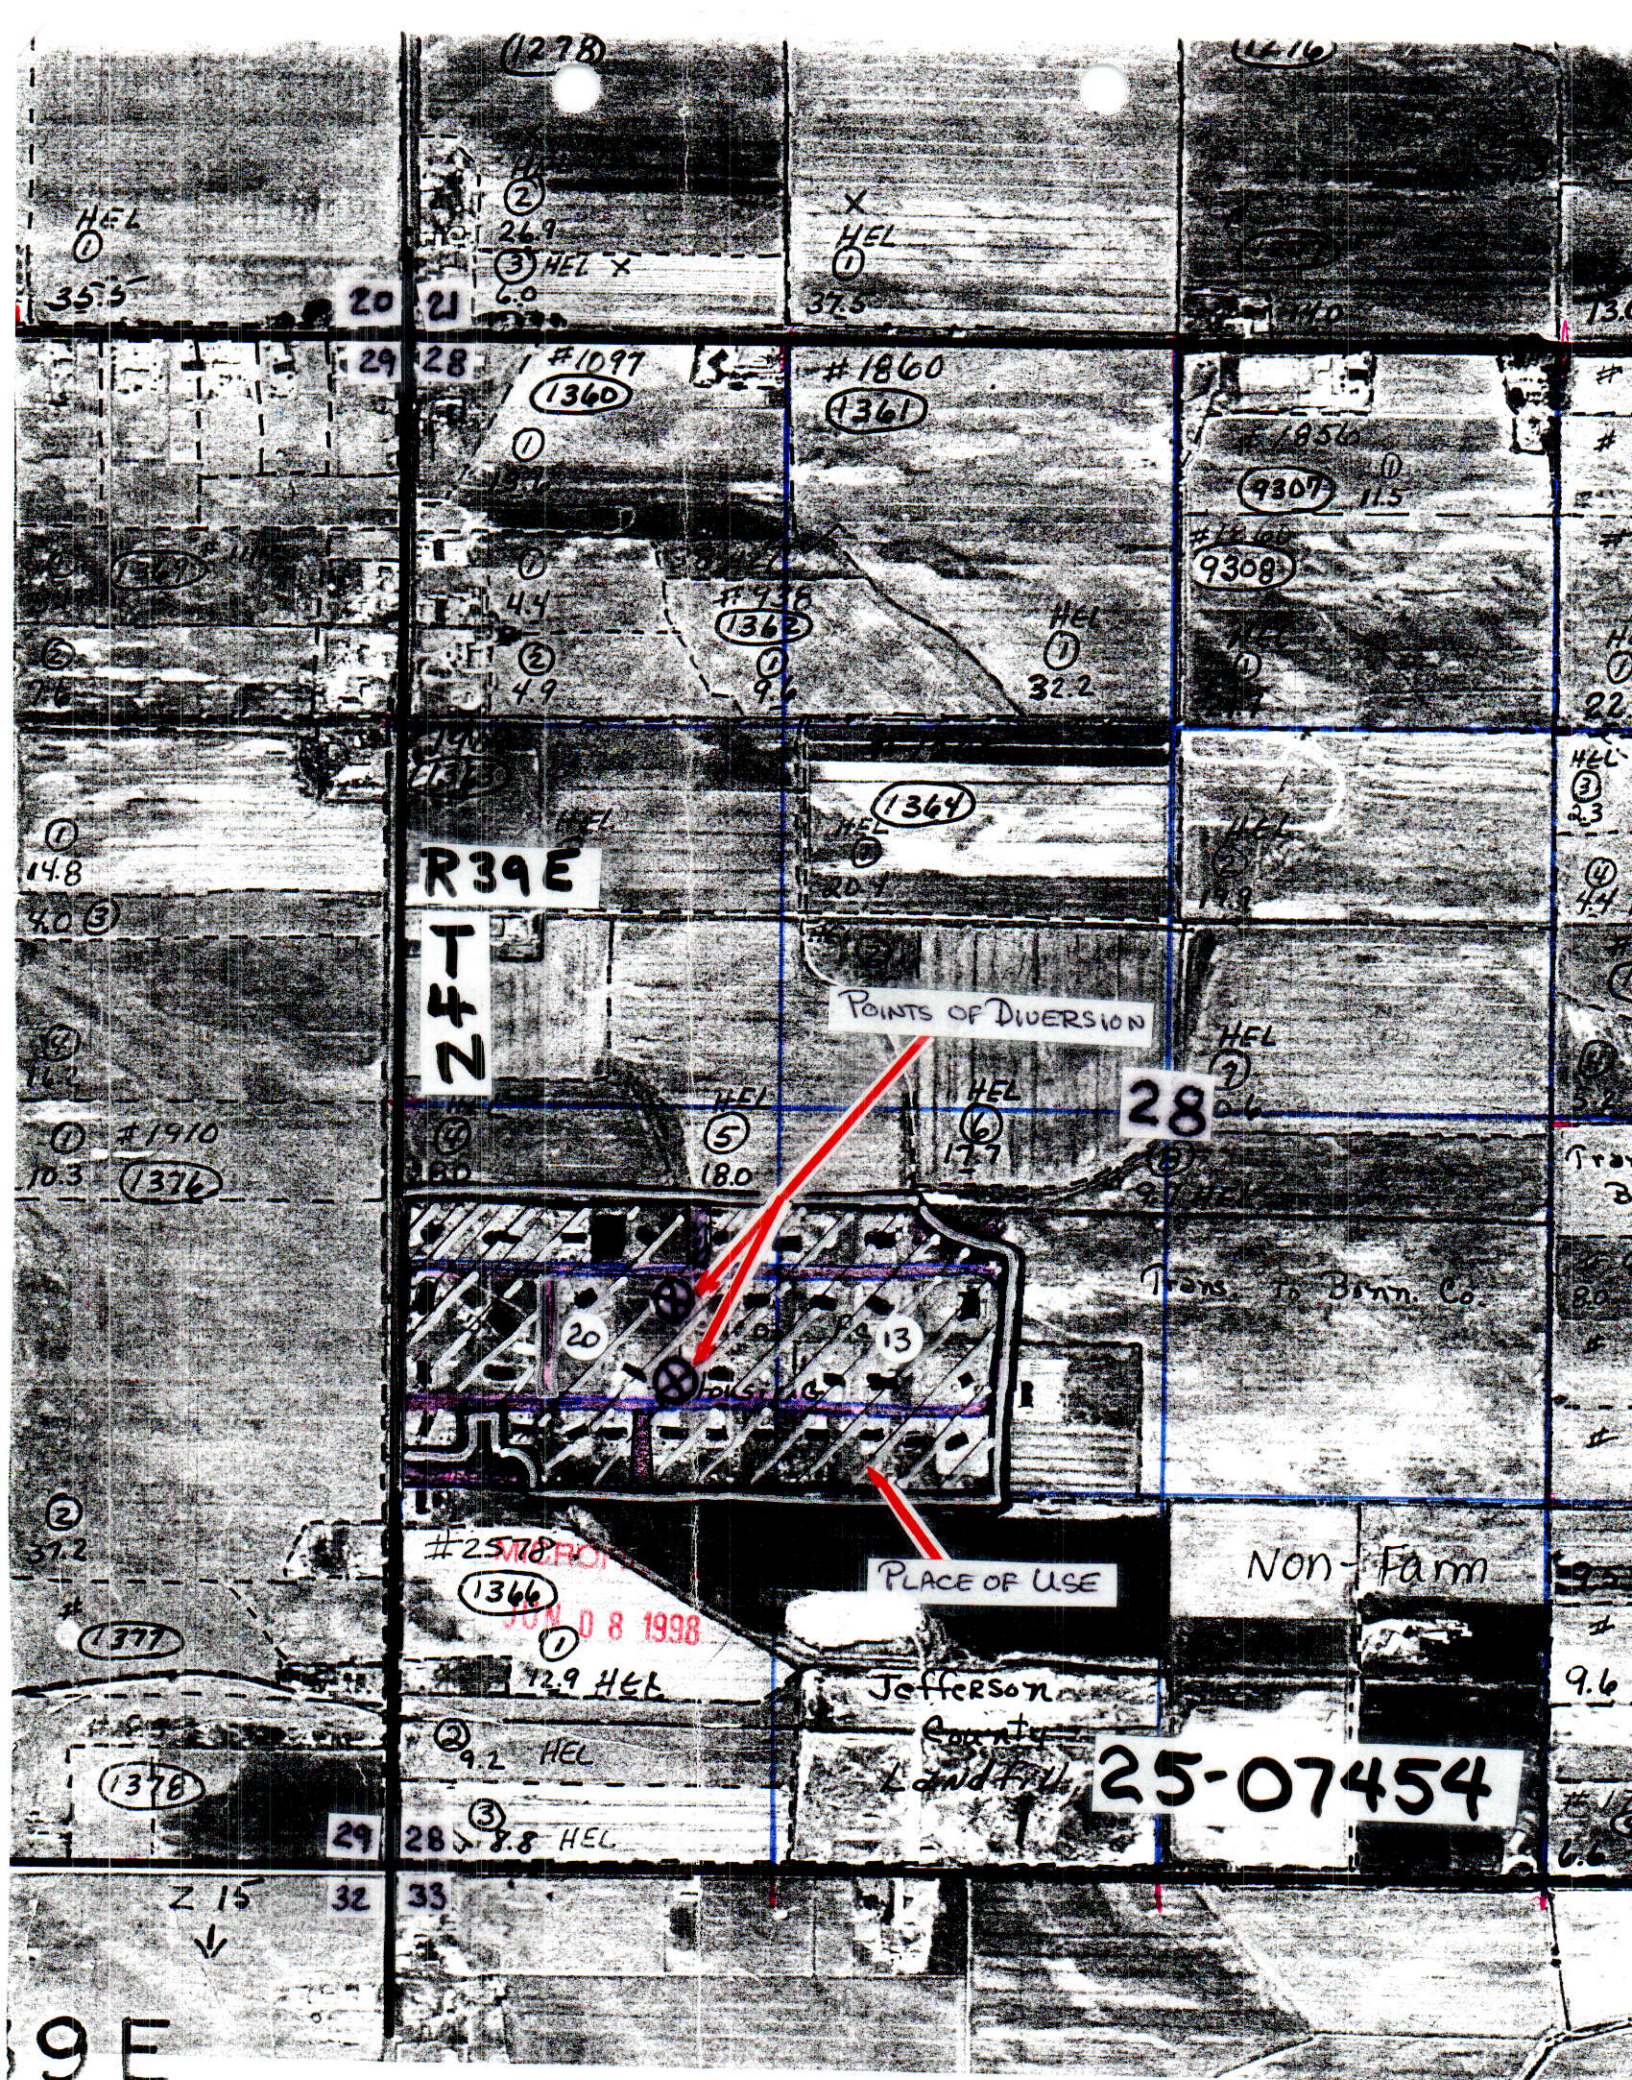



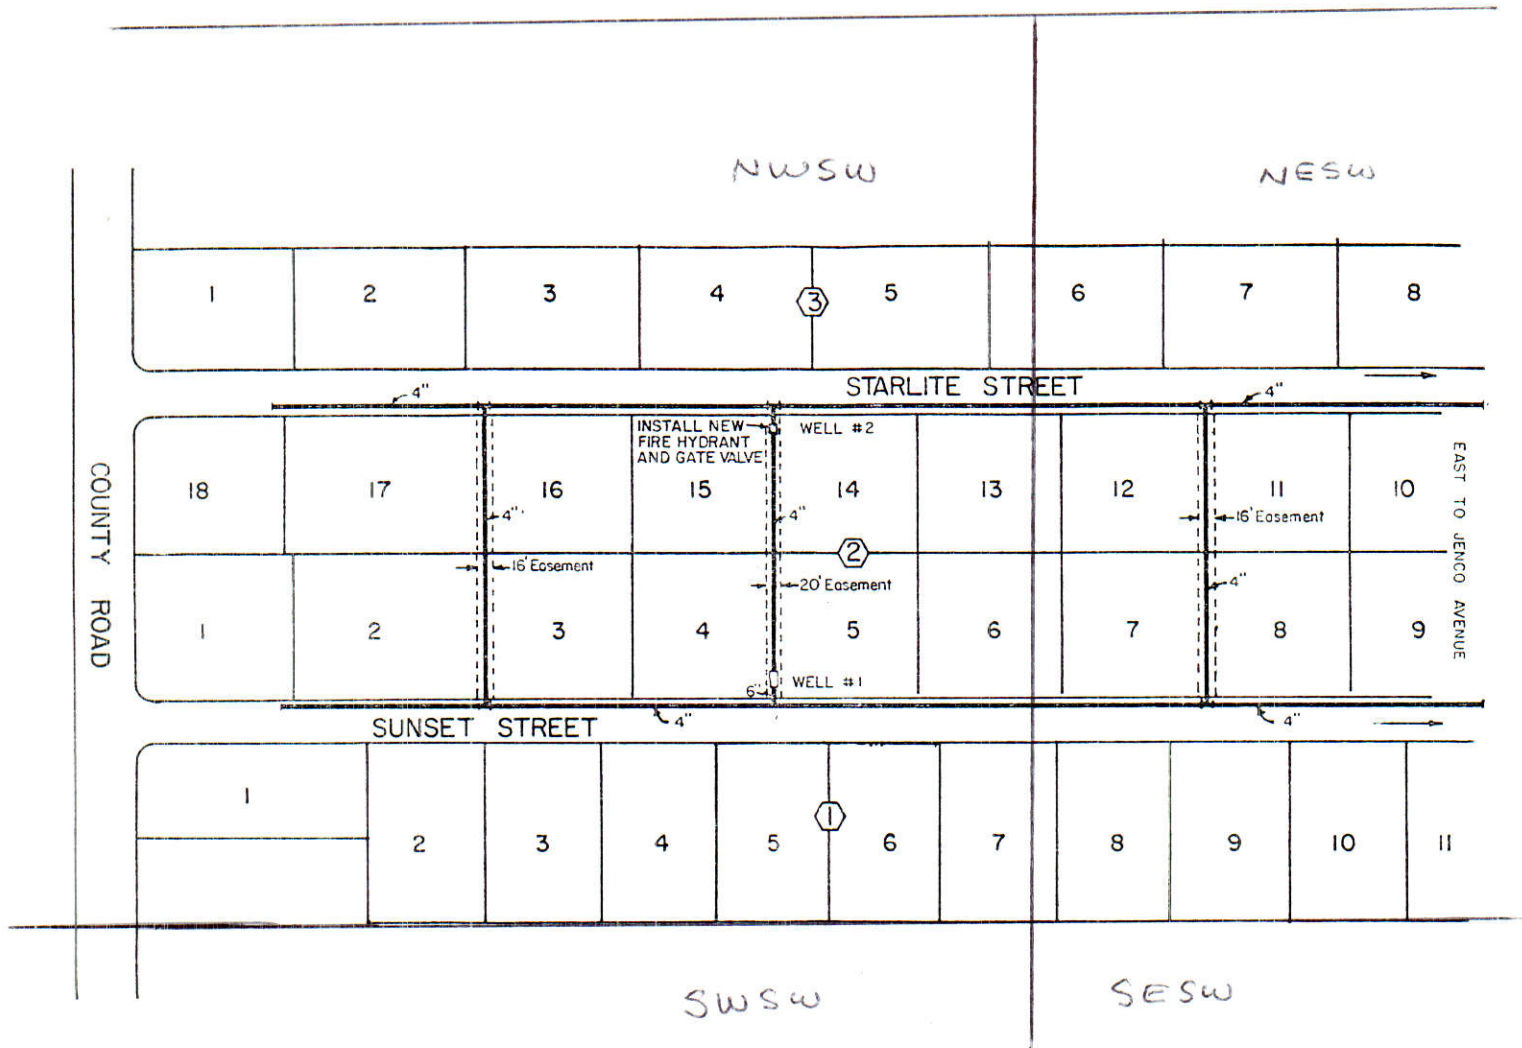


PROFESSIONAL
R. Harper
81

DRAWN JCH	DESIGNED CC	THOMPSON ENGINEERING, INC. CONSULTING ENGINEERS RIGBY — IDAHO — REXBURG	WELL LOC
CHECKED LIT	APPROVAL LIT		
DATE 9-24-81	SCALE NA		JENCO ACRES S
REVISION	DATE		DIVISION NO

MICROFILMED
JUN 08 1998

25-07454

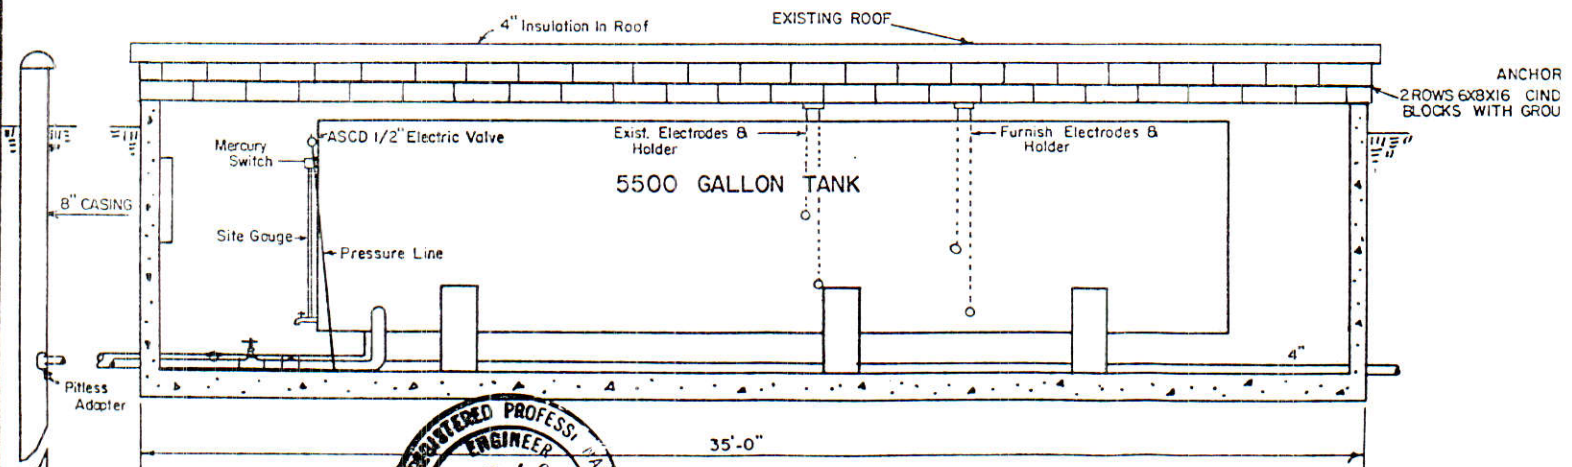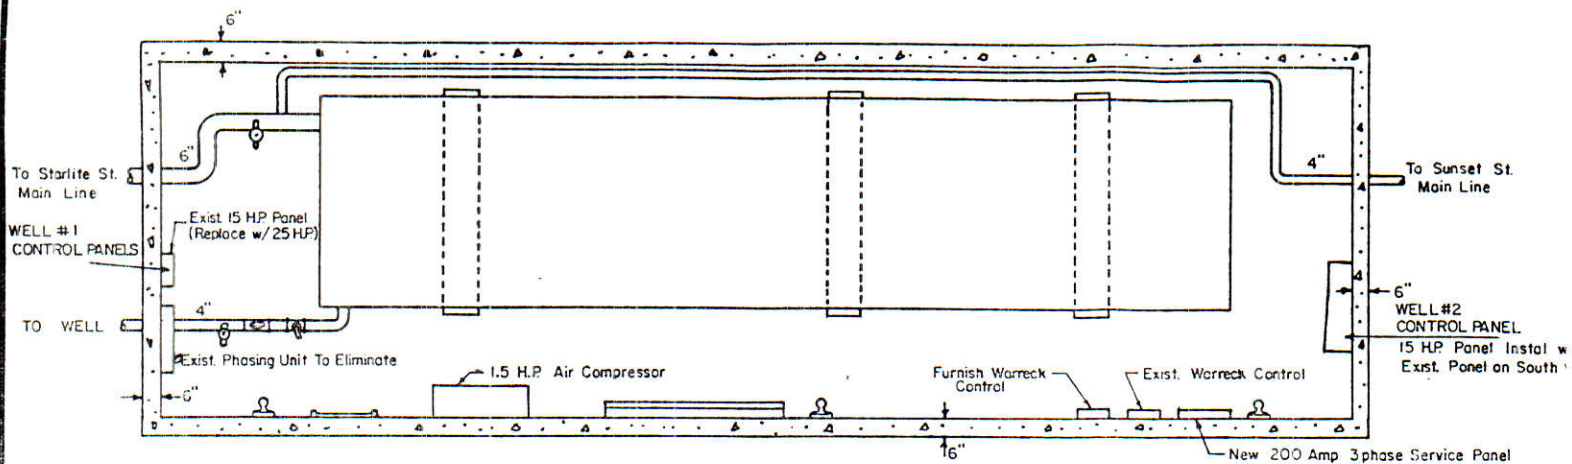

DRAWN	JCH	DESIGNED	CC
CHECKED	LIT	APPROVAL	LIT
DATE	9-24-81	SCALE	1" = 4'
REVISION		DATE	

THOMPSON ENGINEERING, I
CONSULTING ENGINEER

RIGBY -- IDAHO -- REXBURG




WELL #1
Page 1 of 2

MICROFILMED
JUN 08 1998

25-07454

NOTES

1. EXISTING 15 H.P. SUBMERSIBLE PUMP SHALL BE REMOVED FROM WELL #1 AND PLACED IN WELL #2.
2. EXISTING AIR COMPRESSOR SHALL BE REPLACED WITH 1.5 H.P. 208 VOLT 3 PHASE SYSTEM
3. PRESSURE SYSTEM SHALL BE CHANGED TO OPERATE IN THE RANGE OF 60-80 P.S.I.
4. WIRING FROM WELL #2 TO VAULT INSTALLED UNDER PREVIOUS CONTRACT.

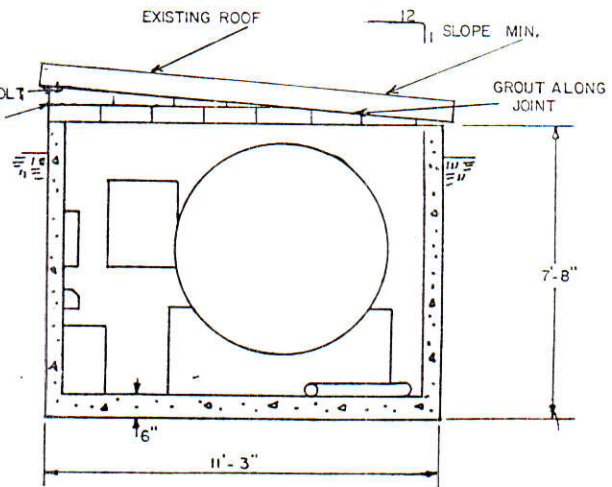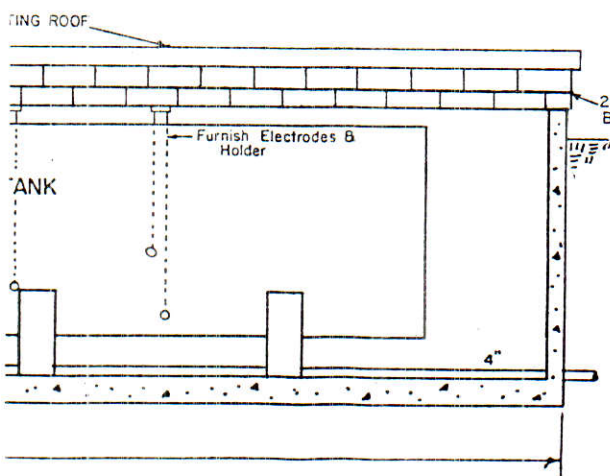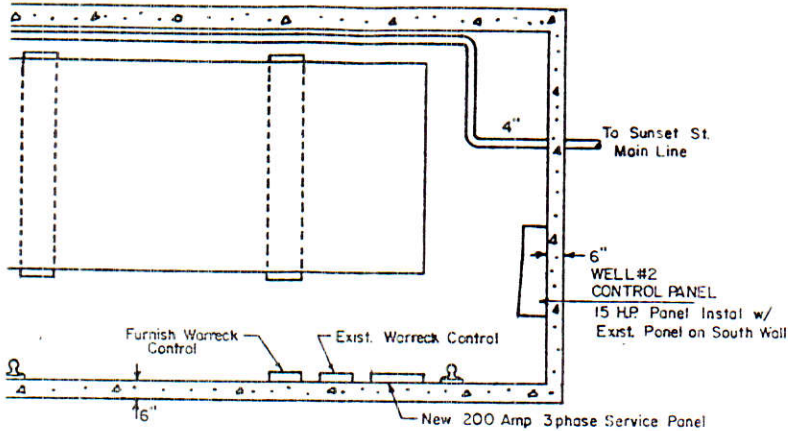

DRAWN	JCH	DESIGNED	CC
CHECKED	LIT	APPROVAL	LIT
DATE	9-24-81	SCALE	1" = 4'

THOMPSON ENGINEERING, INC.
CONSULTING ENGINEERS

WELL NO. 1

PROJECT NO.

81-043



JIFNCO ACRES SUBDIVISION

SHEET NO.


well #1
Page 2 of 2

MICROFILMED
JUN 08 1998

25-07454

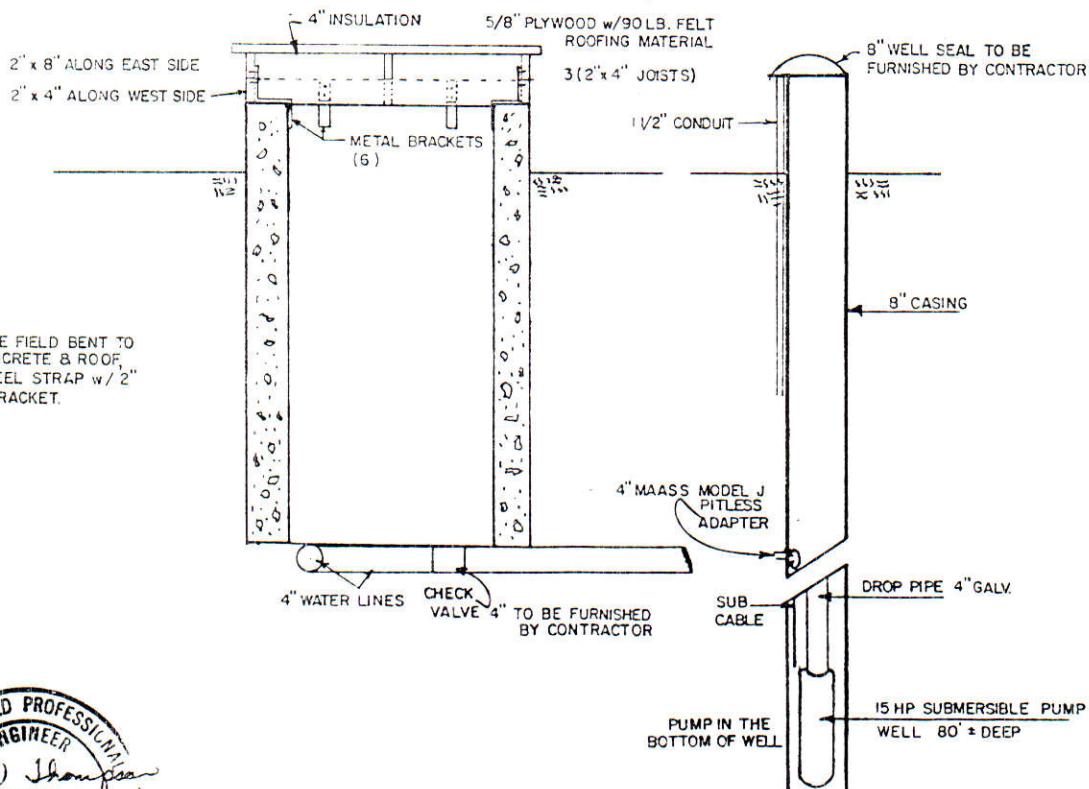

NOTE:
BRACKETS WILL BE FIELD BENT TO
MATCH EXIST. CONCRETE & ROOF.
3/16" x 1" x 12" STEEL STRAP w/ 2"
1/4" BOLTS PER BRACKET.




DRAWN	MK	DESIGNED	CC	THOMPSON ENGINEERING, INC
CHECKED		APPROVAL		

WELL # 2
Page 1 of 2

MICROFILMED
JUN 08 1998

25-07454

N

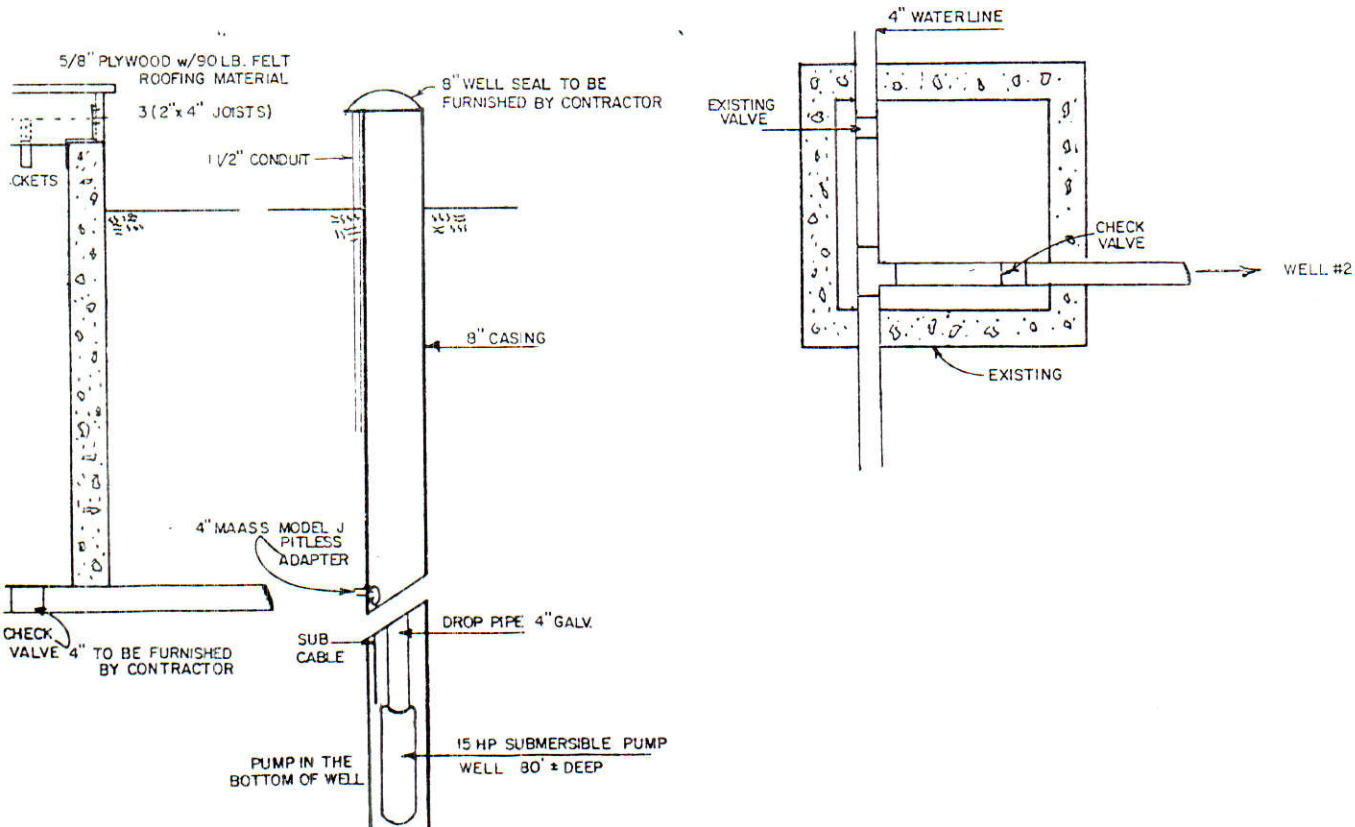


DRAWN MK	DESIGNED CC	THOMPSON ENGINEERING, INC.	WELL NO.2	PROJECT NO 81-043
----------	-------------	----------------------------	-----------	----------------------

Page 2 of 2

MICROFILMED
JUN 08 1998

25-07454

Points of
Diversion



Well #1 (South)

JUN 08 1998



Well #2 (North)

25-07454

Control panel
Pressure tank
Water storage..
tank



25-07454

RECEIVED
JUN 08 1998

25-07454

JENCO ACRES WATER BOARD ASSOC.
4134 E. 140 N.
RIGBY, ID 83442

Source: GROUNDWATER

Diversion Pt: NWSW Sec 28 T 04N R 39E

Use: DOMESTIC (.250 CFS)
IRRIGATION (.250 CFS)

Date Filed: 11/14/1988

In: T04N R39E S28 NESW NESW NWSW NWSW

37.0 ACRES TOTAL

25-07454
JENCO ACRES WATER BOARD ASSOC.
4134 E. 140 N.
RIGBY, ID 83442
Source: GROUNDWATER
Diversion Pt: NWSW Sec 28 T 04N R 39E
Use: DOMESTIC (.250 CFS)
IRRIGATION (.250 CFS)
Date Filed: 11/14/1988
In: T04N R39E S28 NESW NESW
NWSW 37.0 ACRES TOTAL

RECEIVED

MAR 30 1989

State of Idaho
Department of Water Resources
Water Right License

WATER RIGHT NO. 25-07454

Priority: November 14, 1988

Maximum Diversion Rate:

0.50 CFS

Maximum Diversion Volume:

153.6 AF

This is to certify, that JENCO ACRES WATER BOARD ASSN

4111 E 140 N

RIGBY ID 83442

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated November 14, 1988; and has submitted Proof of Beneficial Use on March 30, 1990. An examination indicates that the works have a diversion capacity of 1.170 cfs of water from a GROUNDWATER source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
IRRIGATION	04/15 to 10/15	0.25 CFS	132.0 AF
DOMESTIC	01/01 to 12/31	0.25 CFS	21.6 AF
	Totals	0.50 CFS	153.6 AF

LOCATION OF POINT(S) OF DIVERSION:

NWSW , Sec. 28, Township 04N, Range 39E
JEFFERSON County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
04N	39E	28	NESW 13	NWSW 20		33

Total number of acres irrigated: 33

PLACE OF USE:

DOMESTIC, same as IRRIGATION use

CONDITIONS OF APPROVAL AND REMARKS

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount that can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license shall be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. Irrigation use under this right is authorized only in connection with a domestic use.

MICROFILMED

JUN 08 1998

State of Idaho
Department of Water Resources


Water Right License

WATER RIGHT NO. 25-07454

CONDITIONS OF APPROVAL AND REMARKS

6. This right when combined with all other rights shall provide no more than 0.02 cfs per acre nor more than 4.0 afa per acre at the field headgate for irrigation of the lands above.
7. The right holder shall use the full allotment of appurtenant surface water rights in conjunction with groundwater diverted under this right.
8. This right shall not be used for irrigation purposes if the surface water right(s) appurtenant to the place of use is sold, transferred, leased or used on any other place of use.
9. Two points of diversion are located within the NWSW, S28, T4N, R39E.
10. Domestic use is for 36 homes and does not include lawn, garden, landscape, or other types of irrigation.
11. Place of use is located within Lots 1-11, Blk. 1; Lots 1-18, Blk. 2; and Lots 1-8, Blk. 3; Jenco Acres Subdivision.
12. Points of diversion are located within Lots 5 and 14, Blk. 2, Jenco Acres Subdivision.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. Witness the seal and signature of the Director, affixed at Boise, this 15TH day of MAY, 1998.

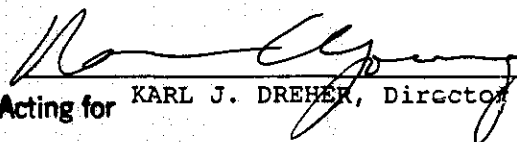
Acting for KARL J. DREHER, Director

MICROFILMED

JUN 08 1998

RECEIVED

MAR 30 1990

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
PROOF OF BENEFICIAL USE

Department of Water Resources
Eastern District Office

The Idaho Department of Water Resources will consider this form as a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

Permit No. 25-07454 Telephone No. 745-71dd

Name(s) of Permit Holder(s): Tenco Acres Water Association

Post Office Address: 4124 E 13d N. Rigby, ID 83442

Source of Water: Well Water & Wells

If ground water, well driller's name: Andrews ID Falls Date drilled: 1976

Extent of Use:
Domestic 36 (No. of households) Irrigation _____ (No. of acres)
Stockwater _____ (No. and type of stock) Other _____

Total rate and/or volume for which proof is submitted 0.50 cfs _____ acre/feet

Show date water was first diverted and beneficially used under this permit: 1977

One of the following may be a condition of approval of your permit:

Measuring device: Required? Yes ☒ No Installed? ☒ Yes No

OR

Flow Measurement Port: Required? Yes ☒ No Installed? Yes ☒ No

Fee Enclosed: \$ 100.00 (See License Examination Fee Schedule)

Person to contact to accompany the Department representative during the field examination:

Rod Furniss 745-71dd
Name Telephone No.
4124 E 13d N Rigby ID 83442
Address

The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

JUN 27 1990

3-30-90
Date

Danny K. Blumhauer Board Member
Signature (and title if on behalf of a company or organization)

BEFORE THE DEPARTMENT OF WATER RESOURCES
OF THE
STATE OF IDAHO

IN THE MATTER OF PERMIT NO. 25-7454 IN THE)
NAME OF JENCO ACRES WATER BOARD ASSOC.) ORDER OF REINSTATEMENT
_____)

WHEREAS, the Department has issued the above-captioned permit with the condition that proof of construction of works and application of water to beneficial use be submitted on or before April 1, 1990; and,

WHEREAS, Sec. 42-218a, Idaho Code provides that the Department notify a permit holder sixty days prior to the proof due date; and,

WHEREAS, the Department sent notice to the permit holder by certified mail that proof was due with instructions as to the steps to be taken to make said proof; and,

WHEREAS, the proof of beneficial use form and fee were timely received on March 30, 1990 by our Eastern Region of the Department of Water Resources; and,

WHEREAS, on April 18, 1990, the department sent the notice of lapsing for failure of the permit holder to submit proof of beneficial use; and,

WHEREAS, Sec. 42-218a of the Idaho Code provides that a permit may be reinstated upon a showing of reasonable cause within sixty days of the date of the notice of lapsing; and,

WHEREAS, the permit holder has provided a reasonable showing why the permit should be reinstated by submitting a timely proof of beneficial use;

IT IS, THEREFORE, HEREBY ORDERED that Permit No. 25-7454 be REINSTATED with no advance in priority.

Dated this 11th day of June, 1990.


L. GLEN SAXTON
Chief, Water Allocation Bureau

MICROFILMED

JUN 27 1990

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

APPROVED

1. Name of applicant Jenco Acres Water Board Assoc. Phone 745-8563
Post office address C/O David R. King 4130⁴ E 140 N, Rigby, ID 83442
2. Source of water supply Groundwater which is a tributary of _____
3. Location of point of diversion is _____ $\frac{1}{4}$ of NW $\frac{1}{4}$ of SW $\frac{1}{4}$, Govt. Lot _____
Sec. 28 Township 4N Range 39E B.M. Jefferson County; additional
points of diversion if any: _____
4. Water will be used for the following purposes:
Amount 0.25cfs for Domestic purposes from 1/1 to 12/31 (both dates inclusive)
(cfs or acre-feet per annum)
Amount 0.25cfs for Irrigation purposes from 4/1 to 11/1 (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
5. Total quantity to be appropriated is (a) 0.50 and/or (b) _____
cubic feet per second acre feet per annum
6. Proposed diverting works:
 - a. Description of ditches, flumes, pumps, headgates, etc. _____
Two wells and pumps to 37 lots with 30 homes. Each lot approx 1 acre in size.
 - b. Height of storage dam _____ feet; active reservoir capacity _____ acre-feet; total
reservoir capacity _____ acre-feet; period of year when water will be diverted to storage:
_____ to _____ inclusive.
 - c. Proposed well diameter is 8" bore wells inches; proposed depth of well is 80' ± 1, 25' ± 2 feet.
 - d. Is ground water with a temperature of greater than 90°F being sought? NO
7. Time required for the completion of the works and application of the water to the proposed beneficial use is
1 years (minimum 1 year). Wells completed in 1982.

MICROFILMED

MAR 30 1989

8. Description of proposed uses (if irrigation only, go to item 9):

a. Hydropower; show total feet of head and proposed capacity in KW. _____

b. Stockwatering; list number and kind of livestock. _____

c. Municipal; show name of municipality. _____

d. Domestic; show number of households. 30 homes, 37 lots

e. Other; describe fully. _____

9. Description of place of use:

a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.

b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RANGE	SEC.	NE¼				NW¼				SW¼				SE¼				TOTALS
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	
4N	39E	28									14	23							37
											D	D							

Total number of acres to be irrigated 37

10. Describe any other water rights used for the same purposes as described above. _____

Some canal share use form Rudy canal

11. a. Who owns the property at the point of diversion? Applicant

b. Who owns the land to be irrigated or place of use? Applicant

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing. _____

12. Remarks: Ned Leavitt - President
David King - Water Coordinator
Bill Childs - Board member
Danny Budnerson - Board member

Cindy Bunderson - Secretary
Michelle King - Treasurer
Linda Walker - Board member

NOT RECORDED

T4N R39E Sec. 28

NWSW NESW

COUNTY ROAD

STARLITE STREET

SUNSET STREET

EAST TO JENCO AVENUE

INSTALL NEW FIRE HYDRANT AND GATE VALVE

WELL #2

WELL #1

16' Easement

20' Easement

4"

1 2 3 4 5 6 7 8

18 17 16 15 14 13 12 11 10

1 2 3 4 5 6 7 8 9

1 2 3 4 5 6 7 8 9 10 11

MAR 30 1989

x Donnell King
(Applicant)
Title - Water Master

Proposed Priority 11/14/88

Received by AW Date 11-14-88 Time 4:05 Preliminary check by AWJ

Fee \$ 4500 Receipted by AW # E004064 Date 11-15-88
11-30-88 12-7-88

Publication prepared by RB Date 11-21-88 Published in Telleran Star

Publication approved AW Date 12-21-88

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. 25-7454, and said application is hereby APPROVED.

1. Approval of said application is subject to the following limitations and conditions:

a. SUBJECT TO ALL PRIOR WATER RIGHTS.

b. Proof of construction of works and application of water to beneficial use shall be submitted on or before April 1, 19 90.

c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.

d. The water right acquired under this permit if for hydropower purposes shall be junior and subordinate to all rights to the use of water, other than hydropower, within the State of Idaho that are initiated later in time than the priority of this permit and shall not give rise to any right or claim against any future rights to the use of water, other than hydropower, within the State of Idaho initiated later in time than the priority of this permit.

e. Other: Permit holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
Irrigation use under this permit is authorized only in connection with a domestic use.

Witness my hand this 3rd day of March, 1989.

J. Glen Saylor
Chief, Water Allocation Bureau

MICROFILMED

MAR 30 1989

THE JEFFERSON STAR
RIGBY, IDAHO

AFFIDAVIT OF
PUBLICATION

STATE OF IDAHO)

) ss

County of Jefferson)

I, Crystal Foster

of the Jefferson Star, published
weekly at Rigby, Jefferson County,
Idaho, do solemnly swear that the

Notice of Application

a copy of which notice appears at-
tached hereto, was published in the
regular and entire issue of said
newspaper, and not in any supple-

ment issue thereof for Two (2)
consecutive issues, the first publica-

having been made on 11/30/88
and the last publication having been
made on 12/7/88

Further, that said newspaper is one
of general circulation in said coun-
ty; that it is a legal newspaper, con-
forming to legal specifications
under the Idaho Statutes; that it has
as least two hundred bona fide
subscribers living within the county
of publication; and that it has been
continuously and uninterruptedly
published in said county during a
period of seventy-eight consecutive
weeks prior to the first publication
of the said notice.

On this 9th day of Dec

in the year of 1988, before
me, a Notary Public, personally ap-

peared Crystal Foster,
known or identified to me to be the
person whose name subscribed to
the within instrument, and being by
me first duly sworn, declared that
the statements therein are true, and
acknowledged to me that he ex-
ecuted the same.

Loane Feather
Notary Public for Idaho

Residing at Shelly

My commission expires: 1-27-91

NOTICE OF APPLICATION FOR
WATER RIGHTS

The following applications have been filed
to appropriate the public waters of the State
of Idaho.

25-07451

CHALLENGER PALLET AND SUPPLY
HEGSTED, GLORIA

IDAHO FALLS, ID 83401

Source: GROUNDWATER

Diversion Pt: NWSWSW Sec 36 T 04N R 37E

Use: COMMERCIAL (040 CFS)

Date Filed: 11/01/1988

In: T04N R37E S36

SWSW

25-07453

HUNTING, AUDREY

674 N. 3500 E.

MENAN, ID 83434

Source: GROUNDWATER

Diversion Pt: SWNWNW Sec 33 T 05N R 38E

Use: IRRIGATION (030 CFS)

Date Filed: 10/28/1988

In: T05N R38E S33

NWNW

1.0 ACRES TOTAL

25-07454

JENCO ACRES WATER BOARD ASSOC.

4134 E. 140 N.

RIGBY, ID 83442

Source: GROUNDWATER

Diversion Pt: NWSW Sec 28 T 04N R 39E

Use: DOMESTIC (250 CFS)

IRRIGATION (250 CFS)

Date Filed: 11/14/1988

In: T04N R39E S28

NESW NESW

NWSW

NWSW

37.0 ACRES TOTAL

25-07455

SLOAN, PAUL A.

SLOAN, SHERRY

445 N. YELLOWSTONE HWY

RIGBY, ID 83442

Source: GROUNDWATER

Diversion Pt: NESWSW Sec 8 T 04N R 39E

Use: DOMESTIC (040 CFS)

IRRIGATION (050 CFS)

Date Filed: 10/21/1988

In: T04N R39E S08

SWSW

1.5 ACRES TOTAL

25-07456

JEFFERSON HILLS GOLF & RECREATION

P.O. BOX 215

RIGBY, ID 83442

Source: GROUNDWATER

Diversion Pt: NENE Sec 8 T 04N R 39E

Use: COMMERCIAL (040 CFS)

Date Filed: 11/09/1988

In: T04N R39E S08

NENE

25-07457

BURGESS SUBDIVISION WATER ASSOC.

INC.

c/o BRUCE JOHNSON

4180 E. 300 N.

RIGBY, ID 83442

Source: GROUNDWATER

Diversion Pt: NWNENE Sec 21 T 04N R 39E

Use: DOMESTIC (110 CFS)

Date Filed: 10/27/1988

In: T04N R39E S21

NENE NENE

The permits will be subject to all prior
water rights. Protests may be submitted bas-
ed on the criteria of Sec. 42-203A, Idaho
Code and/or the new public interest criteria
of Sec. 42-203C, Idaho Code. Protest must
be filed with the Director, Dept. of Water
Resources, 150 Shoup Ave., Suite 15, Idaho
Falls, Idaho 83402 on or before DECEMBER
19, 1988.

R. Keith Higginson, Director

Published in the Jefferson Star, Rigby,

Idaho, November 30, and December 7, 1988.

RECEIVED

DEC 13 1988

Department of Water Resources
Eastern District Office



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. Box 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

May 18, 1998

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

JENCO ACRES WATER BOARD ASSN
4111 E 140 N
RIGBY ID 83442

RE: WATER RIGHT NO. 25-07454

Dear Water Right Holder(s):

The Department of Water Resources (the Department) has issued the enclosed license confirming that a water right has been established in accordance with the permit referenced above. The license is a preliminary order issued by the Department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department unless a party petitions for reconsideration or files an exception and/or brief as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the Department within fourteen (14) days of the service date of this order. The Department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See section 67-5243(3), Idaho Code.

EXCEPTIONS AND BRIEFS

Within twenty-one (21) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding. Otherwise, this preliminary order will become a final order of the Department.

If any party appeals or takes exceptions to this preliminary order, opposing parties shall have twenty-one (21) days to respond to any party's appeal. Written briefs in support of or taking exceptions to the preliminary order shall be filed with the Department. The Department retains the right to review the preliminary order on its own motion.

MICROFILMED

JUN 18 1998

ORAL ARGUMENT

If the Department grants a petition to review the preliminary order, the Department shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Department will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Department orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Department in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with Rules of Procedure 302 and 303.

FINAL ORDER

The Department will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Department may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The Department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

MICROFILMED

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

If you have any questions, please call me at 208-327-7946.

Sincerely,

A handwritten signature in black ink, appearing to read "Shelley W. Keen". The signature is fluid and cursive, with the first name being the most prominent.

Shelley W. Keen
Water Rights Supervisor

SK:klt

Enclosure

NOV 10 1993


NOV 10 1993

CERTIFICATE OF MAILING

I hereby certify that on the 18th day of May, 1998, I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER (Approved License) to the person(s) listed below:

Water Right No. 25-07454

JENCO ACRES WATER BOARD ASSN
4111 E 140 N
RIGBY ID 83442

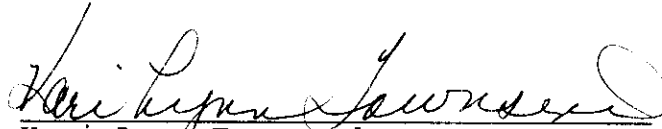
Kari Lynn Townsend
Secretary

WCTD-11MEL

MAY 18 1998

MEMORANDUM

TO: File 25-07454

FROM: Sharla

DATE: April 30, 1998

RE: Licensing Recommendation Adjustments

The adjustments to licensing recommendations for Permit No. 25-07454 are as follows:

H. RECOMMENDATIONS

Irrigation	4/15 - 10/15	0.25 cfs	132.0 afa
Domestic	1/1 - 12/31	0.25 cfs	21.6 afa
	TOTALS	0.50 cfs	153.6 afa

Although the examiner did not complete all items on the field report form, sufficient information exists to construct a license.

On May 7, 1998 I spoke with Mr. Hess concerning the use of surface water. He stated that surface water is used when available, along with the groundwater.

Examiner: Keith Wilson
Exam Date: June 14, 1995

RECEIVED
JUN 18 1998

LICENSE REVIEW CHECKLIST

PERMIT NO. 25-07454 DATE 1/30/98

REVIEWER: SHARLA

NAME Change/OK
 Address OK
 SOURCE OK Does change clarify orig. intended source? If no, Void permit
 POINT OF DIV OK Change (Para P39 - gov P40/P47) _ Add (P45/P42)

W32 (multiple in 1/4)
 W36 (overlap)
 W59 (subd. desc) lots 5 & 14

Overlaps: Right(s): _____
 File reviewed _____ Profile reports printed _____

PLACE OF USE OK _ Change (P41 - gov P43/P47) _ Add (P41/P42)

W60 (subd. desc) lots 1-8, 1-11, 1-18, & Genco Acres Subd.
 W27 (ppu acre limit)

Overlaps: Right(s): _____
 File reviewed _____ Profile reports printed _____

RATE OF DIV
 Permitted Rate 0.50 cfs
 Fee limit 1.00 cfs \$100⁰⁰
 Measured 0.37 cfs (#1 only)
 Theoretical 1.17 cfs

Recommended Total Div Rate _____ cfs

WATER USES OK - pick up 6 homes in lieu of 4 ag-in.
Dom. .25 cfs 33x4 = 132.0 af - overlap (R58-R61, R62-R65, R66-R69)
Dom. .25 cfs 36x1.6 = 57.6 af - supp. gw (WB7/065/079)
 _____ cfs 31.6 af - overlap spec. combined rts (W35)
 _____ cfs _____ af - <1acre (W31)
 _____ cfs _____ af - Domestic (W01/WB5/070/071/075)
 _____ cfs _____ af - Power (W42 or W43/025/027/R22 or R23)
 _____ cfs _____ af - Fish (042) Fire (077) Wtr Quality (081/R07)

TOTALS .50 cfs 153.6 af
 Flow rate .50 cfs X 365 days X 1.98 = 361.4 af

REMARKS _____

ADD'L CONDITIONS _____ Watermaster Control WD# _____
 _____ GW Measurement/Measuring Device
041 Others Trust (052/R55 - remove 051) Non-trust (048/049)

Advance Priority _____ yes ✓ no SRBA Claim N/A Adjust Memo blanks
 Amend letters _____

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED

OCT 01 1997

Department of Water Resources

A. GENERAL INFORMATION

Permit No. 25-07454

1. Owner: Jenco Acres Water Board Association Phone No. 745-6390

Current Address: 4111E 140N Rigby Id 83442

2. Accompanied by: Bruce Hess EXAM DATE: 14 June 95

Address: 4111E 140N Rigby Id 83442 Phone No. 745-6390

Relationship to Permit Holder: President of Association

3. Source: GROUNDWATER tributary to _____

B. OVERLAP REVIEW

1. Other water rights with the same place of use: _____

2. Other water rights with the same point of diversion: _____

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident No.	Gov't Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
#1 & 2			NW	SW	28	4N	39E	Jefferson	ONSITE / UGS QUITS / ASSESSOR Plot

2. Place(s) of Use:


Indicate Method of Determination ONSITE FSA Aerial

TWP	RGE	SEC	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
4N	39E	28									13	20							33

MICROFILMED

OCT 6 8 1998

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

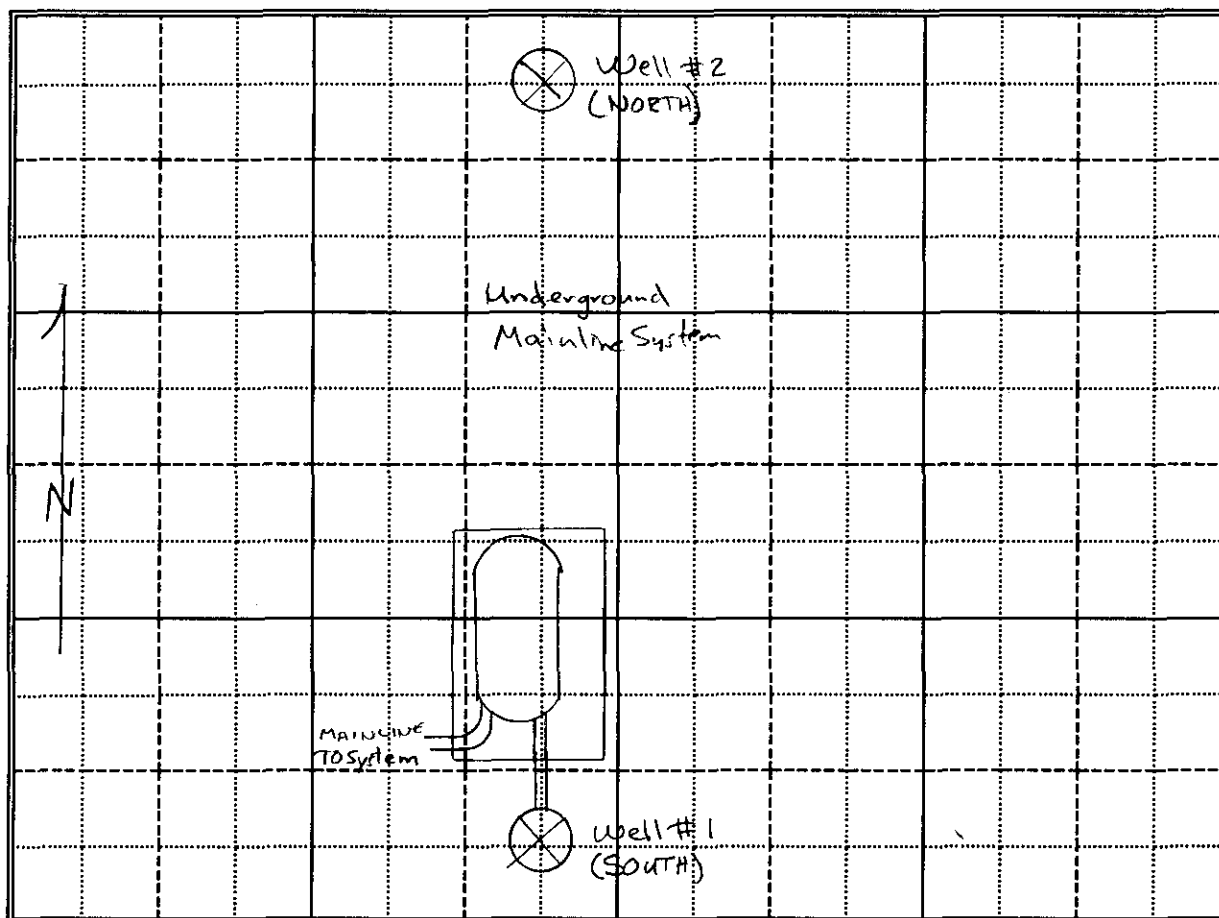

Scale: 1" = _____

____ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

____ Aerial Photo Attached (required for irrigation of 10+ acres)

____ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
#2 (NORTH)	UNKNOWN	20	UNKNOWN	?	
#1 (SOUTH)	UNKNOWN	25	UNKNOWN	?	

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
Pressure Gage		Rainbird			0-160	
Totalizing Meter		McCrometer			Gallons	

2. Measurements: PSI 50-62 psi. 4.50" mainline 0.214" thickness
2.559" spacing (Could only measure Well #1 South Well)

FILED 1998

E. NARRATIVE/REMARKS/COMMENTS

Two wells with underground distribution system to pressure tank to 36 homes for Domestic use and Irrigation. Measurements taken appear to be only a partial flow into the pressure tank. At the time of the exam irrigation was going on along with single domestic use. Recommend using theoretical calculations to determine flow.

Note: PERMIT FOR ONLY 30 homes (36 homes are on System)

Place of use AKA

Lots 1 - 11 Block 1

Lots 1 - 18 Block 2

Lots 1 - 8 Block 3 Jenco Acres Subdivision

Tompson Engineering CONFIRMED HP

Have conditions of permit approval been met? ☒ yes ☐ no

MICROFILMED

JUN 08 1986

F. FLOW CALCULATIONS

_____ Additional Computation Sheets Attached

Measured Method:

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

 $V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$ _____ $V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 =$ _____ $V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$ _____

2. Volume Calculations for Other Uses:

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
Totals:			_____	_____

2. Recommended Amendments

___ Change P.D. as reflected above ___ Add P.D. as reflected above ___ None
___ Change P.U. as reflected above ___ Add P.U. as reflected above ___ Other

I. AUTHENTICATIONField Examiner's Name KEITH C WILSON Date 15 June 95

Reviewer _____ Date _____

SEAL

RECORDED & INDEXED
JUN 16 1995

PRINTER USE
 ? YES
 MODE SELECT
 INPUT
 OUTER DIAMETER
 4.5000 IN
 PIPE MATERIAL
 ? PVC
 WALL THICKNESS
 0.2142 IN
 INNER LINING
 ? NO LING.
 KIND OF FLUID
 ? ANOTHER
 SOUND VELOCITY
 1440 M/S
 SENSOR MOUNTING
 ? U
 TYPE OF SENSOR
 ? SMALL
 DATA CHANGE
 ? NO
 DIALING
 2.0000 IN
 CTRL JOSE
 CLEAR
 06-14 11:30:00 *R
 + 1.600E 26PM
 DIAG MODE
 ? AUT READ
 READ MODE
 ? ZERO OFF
 06-14 11:35:00 *R
 + 1.633E 26PM
 MODE SELECT
 ? 10-CHECK
 06-14 11:36:00 *R
 + 1.633E 26PM
 06-14 11:31:00 *R
 + 1.240E 26PM
 06-14 11:31:00 *R
 + 1.633E 26PM
 06-14 11:32:00 *R
 + 1.607E 26PM

Well #1

$$Q = 166.7 \text{ gpm} = 0.37 \text{ cfs}$$

06-14 11:36:00
 + 1.633E 26PM

25-7454

Flow MEASUREMENT
TAPE
well #1

25-07454

THEORETICAL PUMP FLOW CALCULATIONS

Formula: $Q_{cfs} = [(Hp)(8.814)(Eff)] \div [Lift + (psi \times 2.308)]$

SYSTEM: WELL #1 (SOUTH WELL)

Hp = Horsepower = 25
Eff = Efficiency = _____ (Usually 70%)
Lift: (Static Level + Assumed Draw down)
Static Water Level = 82 ft.
Assumed Draw down = + 40 ft.
Lift = 122

OR

Measured Dynamic Water Level = _____ ft.

psi = Operating Pressure = 50 psi

$$Q_{cfs} = \left[\frac{25}{Hp} \times 8.814 \times \frac{0.7}{eff} \right] \div \left[\frac{122}{Lift} + \left(\frac{50}{psi} \times 2.308 \right) \right]$$

$$Q_{cfs} = \left[\frac{154.245}{1} \right] \div \left[\frac{237.40}{1} \right]$$

$Q_{cfs} = \underline{0.65} \text{ cfs SYSTEM } \underline{\text{Well \#1 (South well)}}$

SYSTEM: WELL #2 (NORTH WELL)

Hp = Horsepower = 20
Eff = Efficiency = _____ (Usually 70%)
Lift: (Static Level + Assumed Draw down)
Static Water Level = 82 ft.
Assumed Draw down = + 40 ft.
Lift = 122

OR

Measured Dynamic Water Level = _____ ft.

psi = Operating Pressure = 50 psi

$$Q_{cfs} = \left[\frac{20}{Hp} \times 8.814 \times \frac{0.7}{eff} \right] \div \left[\frac{122}{Lift} + \left(\frac{50}{psi} \times 2.308 \right) \right]$$

$$Q_{cfs} = \left[\frac{123.396}{1} \right] \div \left[\frac{237.40}{1} \right]$$

$Q_{cfs} = \underline{0.52} \text{ cfs SYSTEM } \underline{\text{Well \#2 (North well)}}$

PERMIT NO. 25-7454

21

RIGBY

SOUTH

4885

4894

4879

R39E

POINTS OF DIVERSION

28

4890

PLACE OF USE

CANAL

BUNGALOW
CANAL

4878

4894

Pit


(ABANDONED)

RUDY

25-07454

33

4900

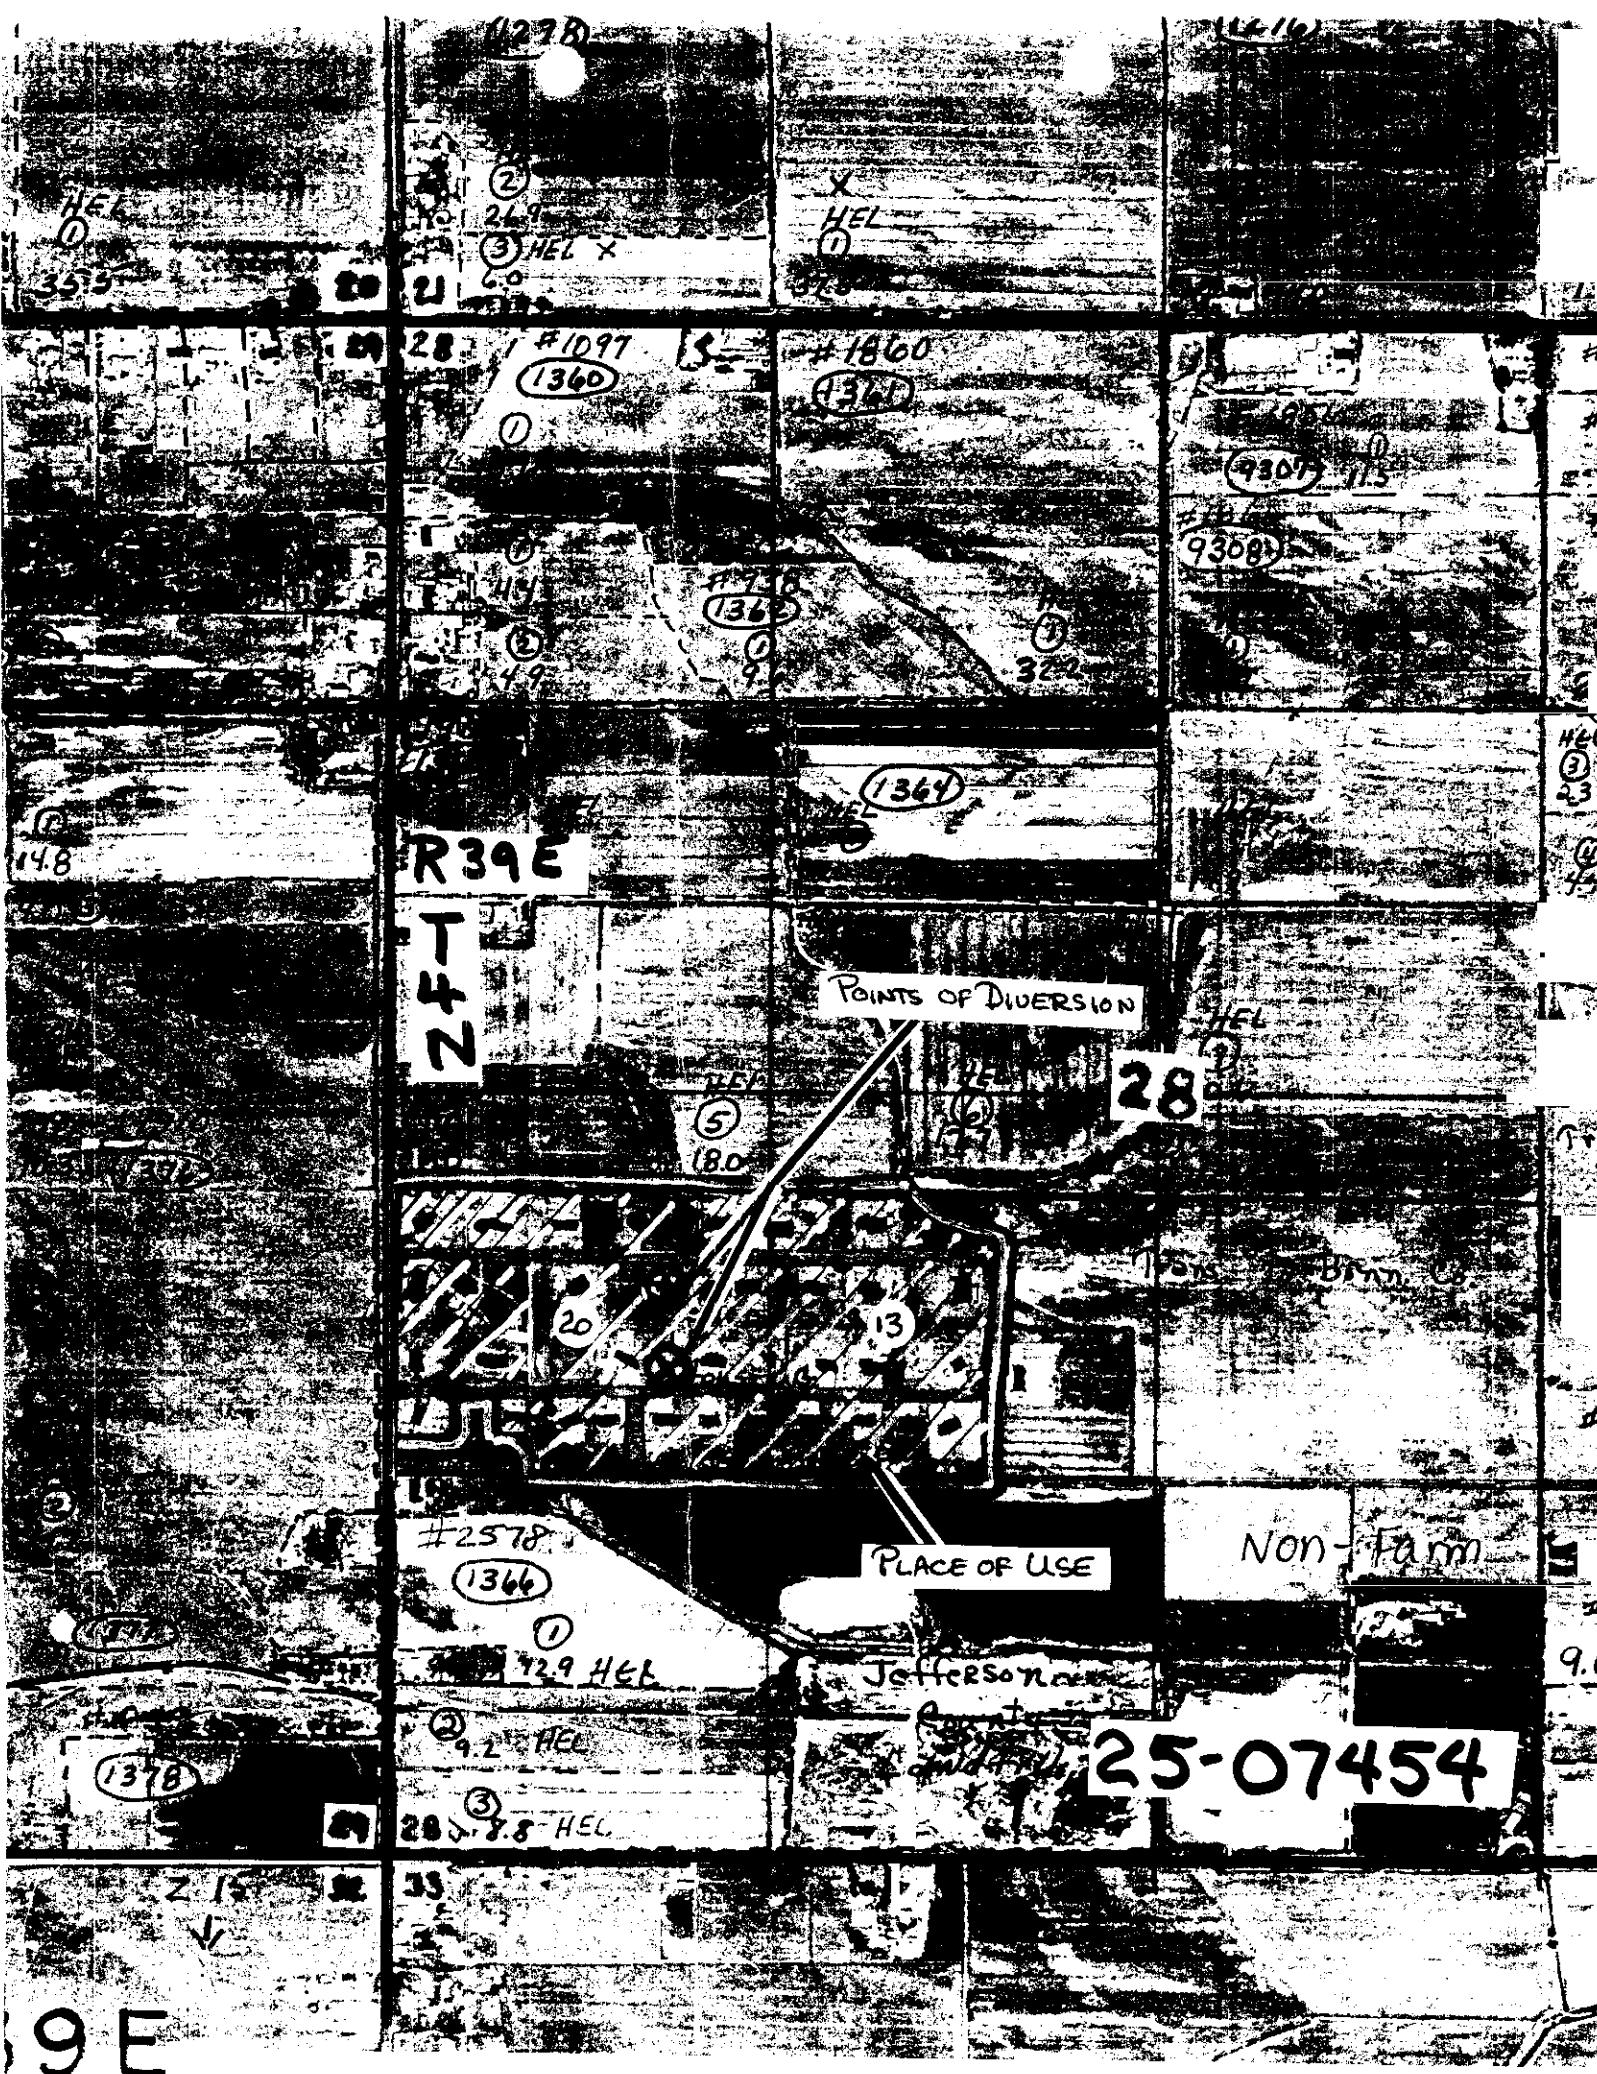

1278

1416

2

26.9
3 HEL X
6.0

X
HEL
1

28 #1097
1360

#1860
1361

9307 11.5

9308

#1718
1362

32.2

1364

R39E

T4N

POINTS OF DIVERSION

28

5
18.0

#2578
1366

PLACE OF USE

Non-Farm

Jefferson

25-07454


22.9 HEL

9.2 HEL

28 8.8 HEL

1378

9 E

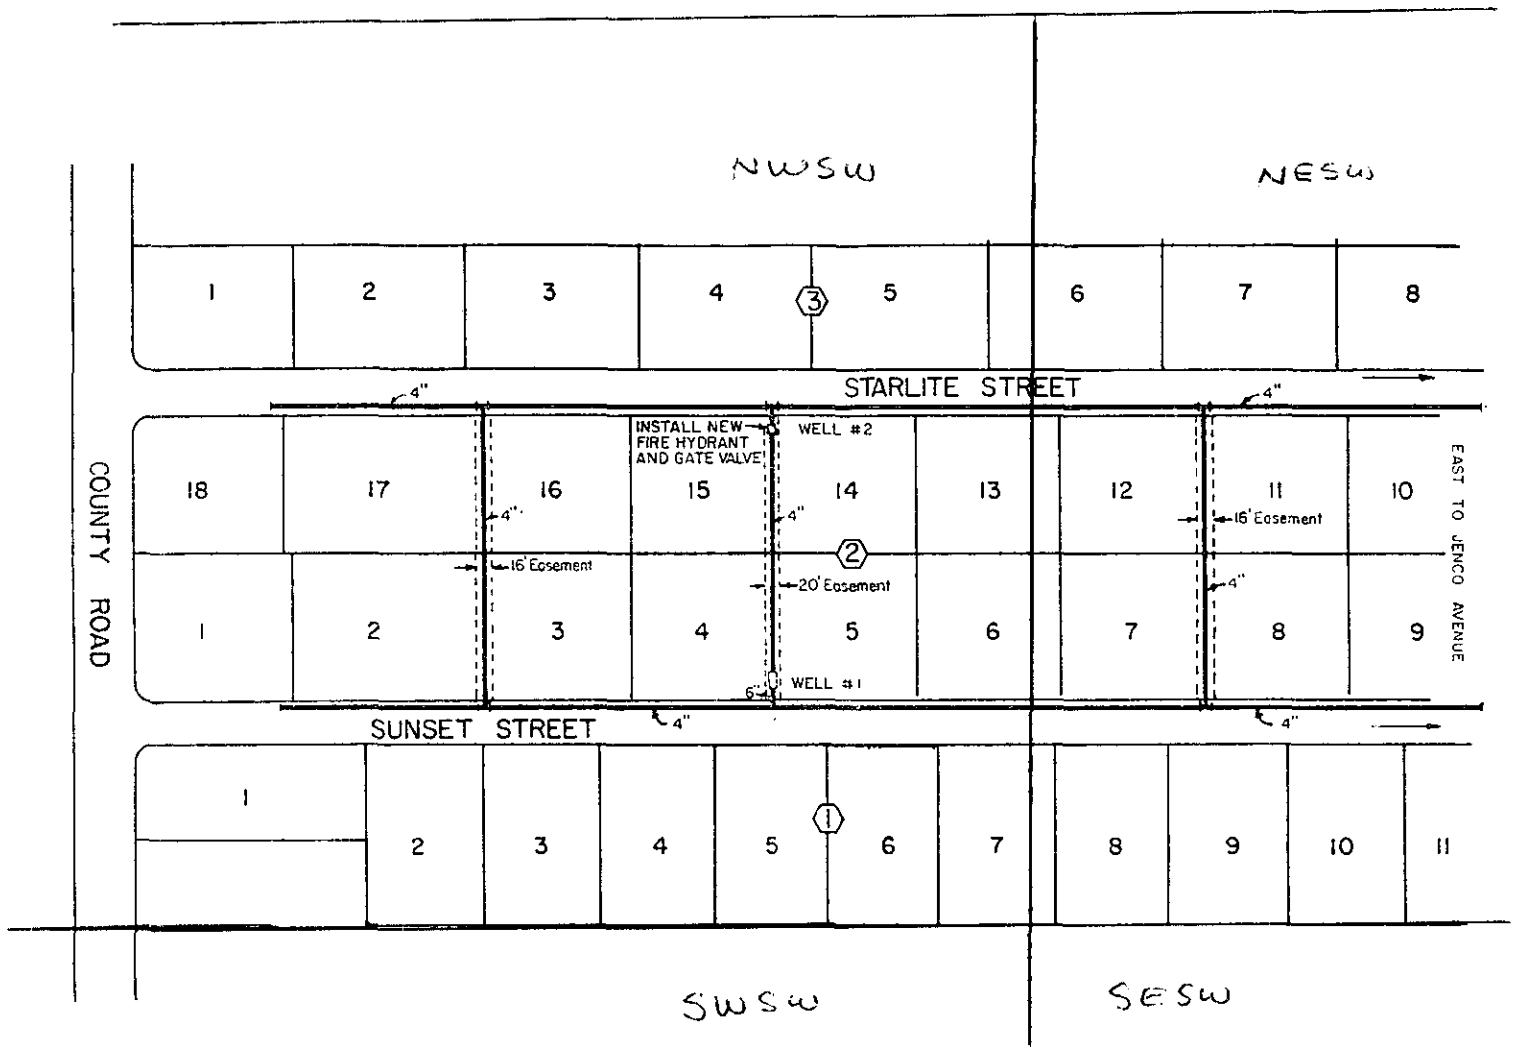

PROFESSIONAL
R. Thompson
81

DRAWN	JCH	DESIGNED	CC
CHECKED	LIT	APPROVAL	LIT
DATE	9-24-81	SCALE	NA
REVISION		DATE	

THOMPSON ENGINEERING, INC.
CONSULTING ENGINEERS



RIGBY — IDAHO — REXBURG

WELL LOC

JENCO ACRES S
DIVISION NO

IDAHO
JUN 10 1982


25-07454

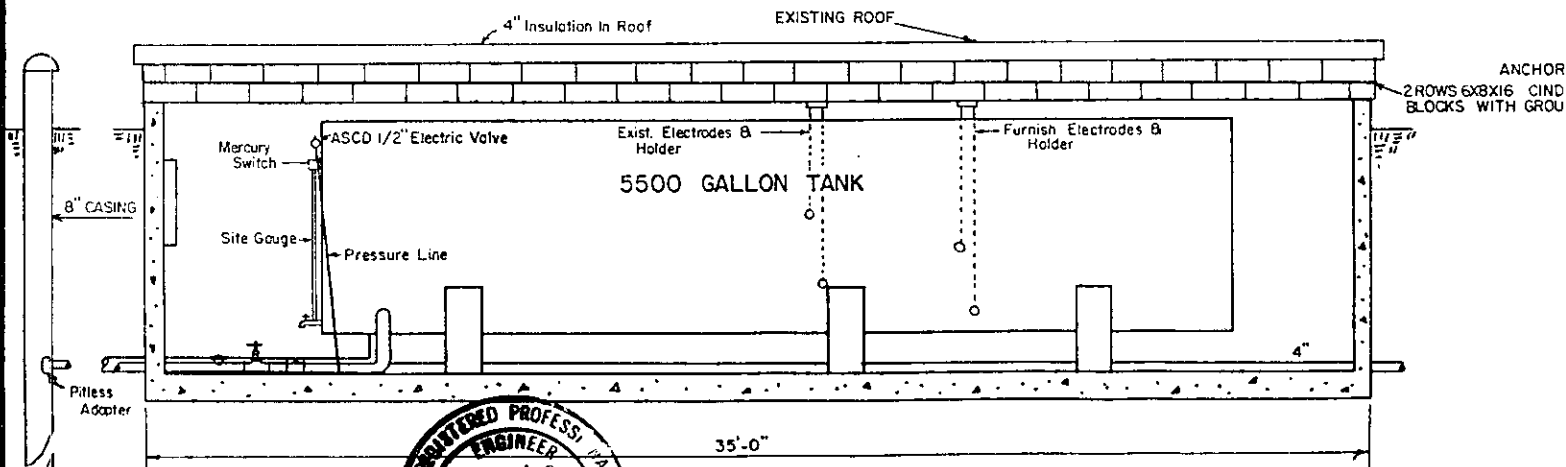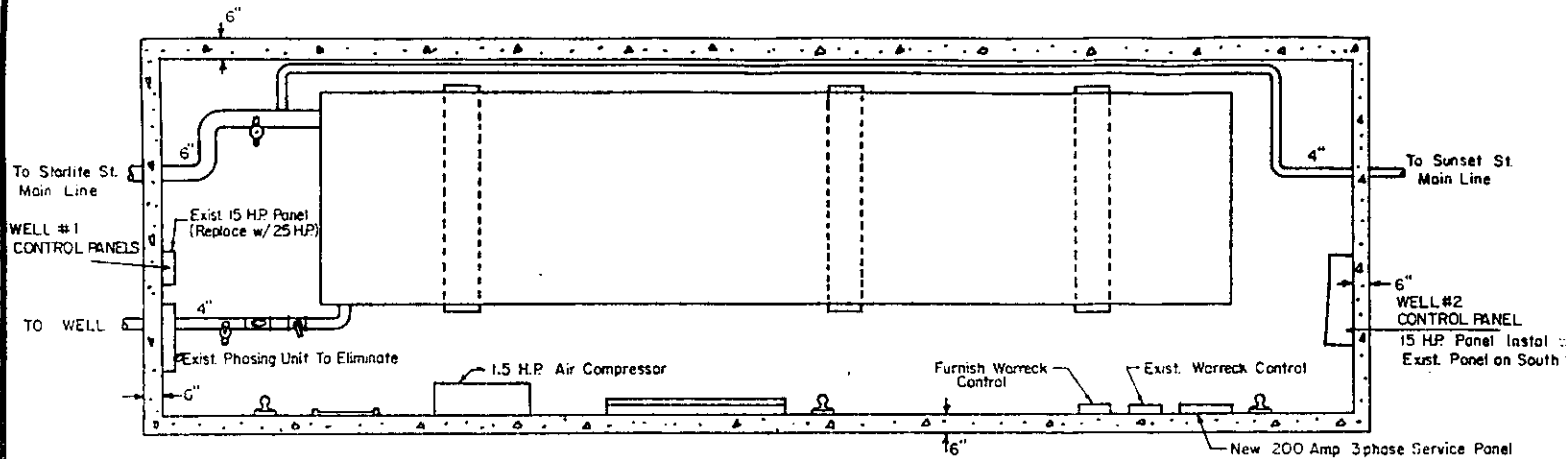

Drop Pipe 4" Galv.
Pump In The Bottom Of Well
Sub Cable

25 HP Submersible Pump

Well 90' ± DEEP



DRAWN	JCH	DESIGNED	CC
CHECKED	LIT	APPROVAL	LIT
DATE	9-24-81	SCALE	1" = 4'
REVISION		DATE	




THOMPSON ENGINEERING, I
CONSULTING ENGINEER
RIGBY — IDAHO — REXBURG

WELL #1
Page 1 of 2

25-07454

NOTES

1. EXISTING 15 H.P. SUBMERSIBLE PUMP SHALL BE REMOVED FROM WELL #1 AND PLACED IN WELL #2.
2. EXISTING AIR COMPRESSOR SHALL BE REPLACED WITH 1.5 H.P. 208 VOLT 3 PHASE SYSTEM
3. PRESSURE SYSTEM SHALL BE CHANGED TO OPERATE IN THE RANGE OF 60-80 P.S.I.
4. WIRING FROM WELL #2 TO VAULT INSTALLED UNDER PREVIOUS CONTRACT.

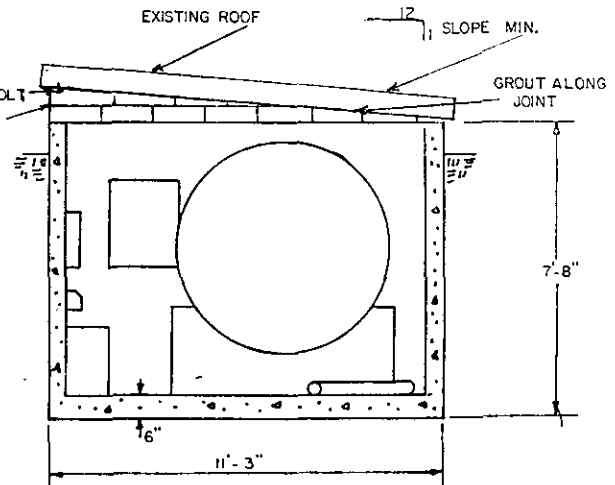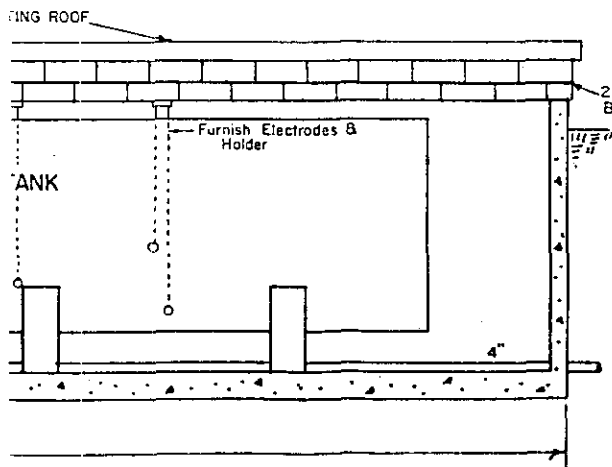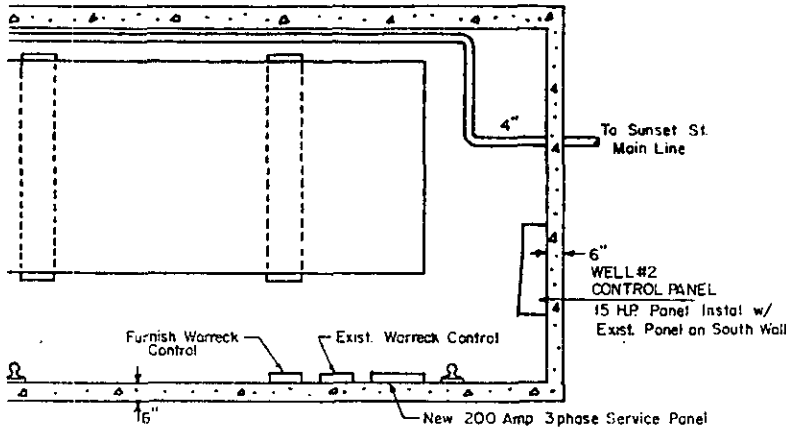

DRAWN JCH	DESIGNED CC
CHECKED LIT	APPROVAL LIT
DATE 9-24-81	SCALE 1"=4'

THOMPSON ENGINEERING, INC.
CONSULTING ENGINEERS



WELL NO. 1

JFNCO ACRES SUBDIVISION


PROJECT NO.
81-043
SHEET NO.

well #1
Page 2 of 2

25-07454

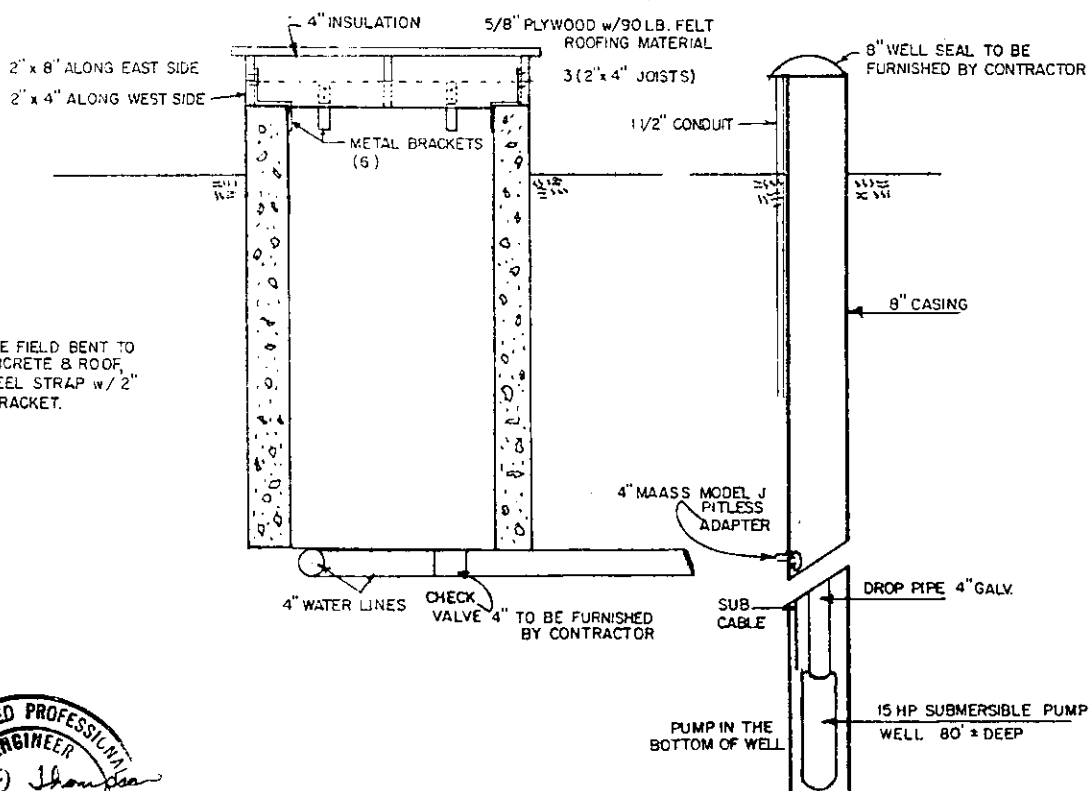

NOTE:
BRACKETS WILL BE FIELD BENT TO
MATCH EXIST. CONCRETE & ROOF.
3/16" x 1" x 12" STEEL STRAP w/ 2"
1/4" BOLTS PER BRACKET.





DRAWN MK	DESIGNED CC	THOMPSON ENGINEERING, INC.
CHECKED	APPROVAL	

WELL # 2
Page 1 of 2

25-07454

N

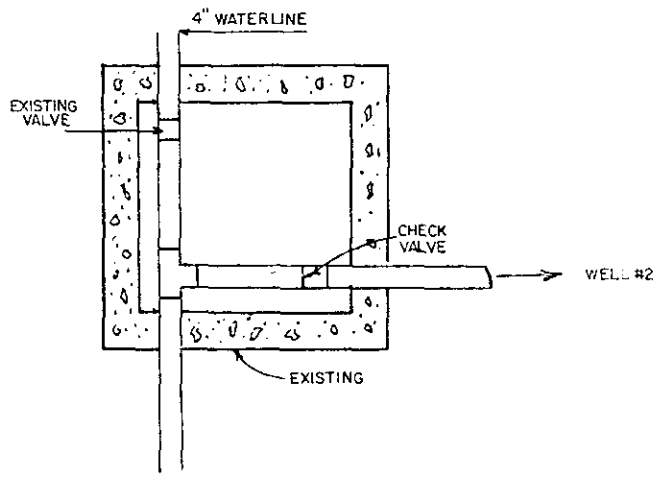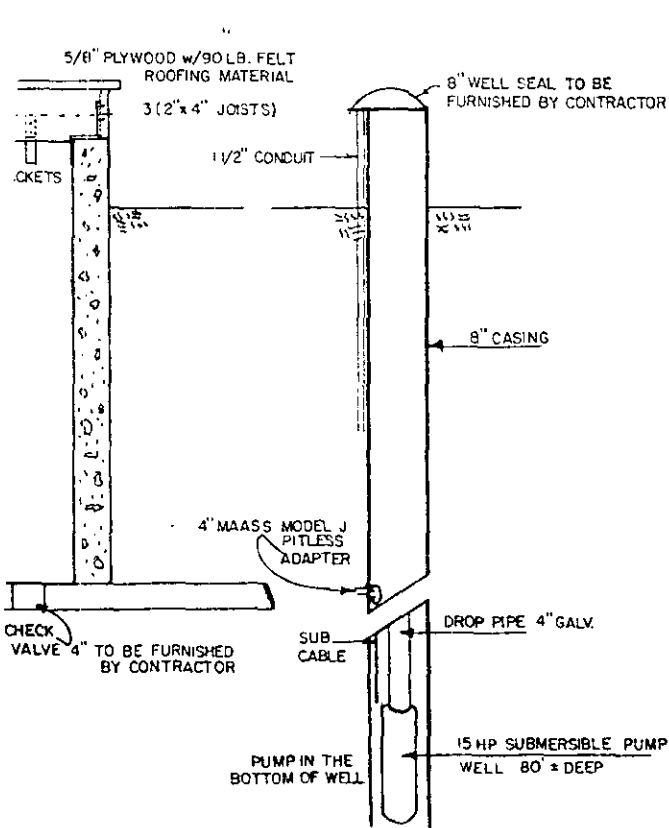


DRAWN MK	DESIGNED CC	THOMPSON ENGINEERING, INC.	WELL NO.2	PROJECT NO. 81-043
----------	-------------	----------------------------	-----------	-----------------------

Page 2 of 2

25-07454

Points of
Diversion



Well #1 (SOUTH)

4/15/66 1002



Well #2 (NORTH)

25-07454

Control panel
Pressure tank
Water storage..
tank



25-07454

100 00 1900

June 19, 1990

JENCO ACRES WATER BOARD ASSN.
C/O DAVID R. KING
4134 E. 140 N.
RIGBY, ID 83442

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 25-07454

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. Enclosed is an order advancing the priority of the permit since the proof was received after the proof due date. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water.

If you have questions concerning this matter, please feel free to contact the EASTERN Regional Office in Idaho Falls at (208)525-7161.

Sincerely,

Rita Fleck
Secretary/Records Manager

c: IDWR - Region

Enclosure

RECORDED

JUN 27 1990

1/88

PROOF OF BENEFICIAL USE

ANALYSIS SHEET

Permit No. 25-7454

Date: 5-31-90

General Considerations:

☒ Name same as permit
☒ Signature the same as permit holder
☒ Address change If yes, prepare a data entry
☒ Proof received timely
☒ Reinstated

Source of Water:

☐ Surface water
☒ Groundwater
1. well log in file 1976
2. drilling permit
NA A. amount of drilling fee paid for proposed uses

Extent of Use and Rate of Diversion:

☒ Rate of diversion appropriate for uses
☒ Is rate or volume and fee appropriate?
☒ Has permit holder indicated when water was first put to a beneficial use?

Measuring Device:

☒ Is a measuring device or access port required?
☒ Has one been installed?
☒ Waiver or modification of measuring device requested

Remarks:

Proof acceptable

Priority Calculation:

Date proof received

Date proof due

No. of days late

Priority date

NEW PRIORITY DATE

NA	
	-
	=
	+
	=

SEND FILES TO DATA ENTRY AND THEN TO MICROFILM

WARNING

CANCELLED OR LAPSED

This permit has been officially CANCELLED or LAPSED.

Ninety days following the date of official action this file will be DESTROYED.

April 16, 1990

JENCO ACRES WATER BOARD ASSN.
C/O DAVID R. KING
4134 E. 140 N.
RIGBY, ID 83442

LAPSE NOTICE

RE: PERMIT NO. 25-07454

Dear Permit Holder:

You are hereby notified that under the provisions of Section 42-218A, Idaho Code, the above referenced permit has lapsed and is of no further force nor effect. The department provided the proper forms to you in our proof due notice dated January 31, 1990. No further construction or additional development is authorized under this permit unless it is reinstated.

The permit can only be reinstated if you submit an acceptable proof of beneficial use or an acceptable request for extension of time to the department within sixty (60) days of the mailing of this lapse notice. An acceptable proof of beneficial use submittal must include the examination fee or a completed field examination report. A request for extension of time must be accompanied by a fifteen dollar (\$15) fee.

Enclosed again for your use are a proof of beneficial use form and a request for extension of time form. Please note that only one extension of time can be granted unless the project has not been completed because of lack of a necessary approval by a government agency or by litigation which may bring title to the water in question.

L. GLEN SAXTON
Chief, Water Allocation Bureau

Enclosures

LGS:RF

CERTIFICATION OF MAILING

I hereby certify that on _____
a copy/an original of this document was
deposited in the United States mail,
postage prepaid addressed to the
individual(s) named above.

RECEIVED

JUN 27 1990


STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Statehouse
Boise, Idaho 83720

RECEIVED
FEB 27 1990

Department of Water Resources

MICROFILMED

JUN 27 1990

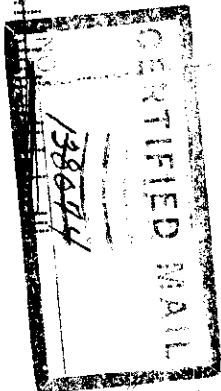

2-16-90
2-17-90

207-554

138074
January 31, 1990

JENCO ACRES WATER BOARD ASSN.
C/O DAVID R. KING
4134 E. 140 N.
RIGBY, ID 83442

PROOF DUE NOTICE

RE: PERMIT NO. 25-07454

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before April 1, 1990. (See last page of your approved permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a complete field examination report prepared by a certified water right examiner may be used to submit the required proof.

If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.

Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.

SINCERELY,

Rita Fleck
Secretary/Records Manager

Enclosures

RECEIVED

JUN 27 1990

S T A T E O F I D A H O
D E P A R T M E N T O F W A T E R R E S O U R C E S

Statehouse
Boise, Idaho 83720
(208) 334-7900
March 15, 1989

JENCO ACRES WATER BOARD ASSOC.
4134 E. 140 N.
RIGBY, ID 83442

P E R M I T A P P R O V A L N O T I C E

RE: PERMIT NO. 25-07454

Dear Permit Holder:

Enclosed is a copy of your approved application for permit. We direct your attention to the conditions of approval on the final page.

Section 42-235, Idaho Code, requires that a "drilling permit" must be obtained from the department for all wells constructed after July 1, 1987. A drilling permit is a separate permit that must be issued in addition to your permit to appropriate water. Commencement of well construction or diversion of water under your permit to appropriate water is prohibited unless a drilling permit is obtained.

You should be aware that the groundwater you propose to divert is located within a drainage basin where surface waters are regulated during the months of low flow. It is possible that diversion of groundwater may have an adverse impact on these surface water flows. Information available to us at this time does not warrant refusing to issue permits in your area, but we do caution that diversions of groundwater are not allowed to deplete flows available for surface water users with earlier priority dates. Siting your well as far from surface sources as possible and casing out upper water producing zones may reduce the potential of interference.

We have enclosed a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit. Also

MICROFILMED

MAR 30 1989

enclosed for your convenience is a form entitled "Proof of Beneficial Use" that must be submitted to the Department when your project is completed.

Sincerely,

GARY SPACKMAN, Supervisor
Water Right Permits Section

GS: SC
Enclosures

Form No. 202a
4/87STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

HWJ

APPLICATION FOR PERMIT ANALYSIS SHEET

INITIAL REVIEW BY HWJ DATE 11-15-88 APPLICATION NUMBER 217714
Jenco 684REQUIRED INFORMATION

- ☒ Name (If applicant is a corporation or partnership, names must be provided for the director, officers, & other partners.)
- ☒ Address
- ☒ Source (See USGS Quad for names of water sources)
- ☒ Point of Diversion (10 acres for spring, lot & block descriptions for subdivisions, local name, flow and/or volume)
- ☒ County
- ☒ Quantity (flow and/or volume)
- ☒ Period of Use
- ☒ Nature of proposed use (Include description of use.)
- ☒ Description of diverting works
- ☒ Time required for beneficial use of water
- ☒ Place of use or acres irrigated
- ☒ Map
- ☒ Signature (If applicant is corp. partnership, or municipality, title of signator is required)
- ☒ Fee
- ☒ Yes ☐ No* In form to receipt

ADDITIONAL INFORMATION

- ☐ Overlapping place of use (Describe source & relationship to present application on the back.)
- ☒ Overlapping point of diversion
- ☐ Yes ☒ No Field check required
- Field check by _____
- ☐ Yes ☒ No Field report attached
- ☐ Yes ☒ No Critical groundwater area
- ☐ Yes ☒ No Groundwater management area
- ☐ Yes ☒ No Send dam safety information
- ☐ Yes ☒ No Send power requirement letter
- ☐ Yes ☒ No Send fish farm requirement letter
- ☐ Yes ☒ No Power residency affidavit
- ☐ Yes ☒ No Power efficiency form
- ☒ Yes ☐ No Within trustwater boundary (If yes, attach trust water supplementary analysis sheet.)
- ☐ Yes ☒ No Diversion greater than 5 cfs or 500 acre ft. (If yes, attach large diversion supplementary analysis sheet.)
- ☐ See reverse side for additional information

*REQUEST THE FOLLOWING ADDITIONAL INFORMATION FROM THE APPLICANT

Date Requested

RECEIVED
JAN 16 1989

Department of Water Resources

PROCESSING

☒ Yes ☒ No I. form for advertising
☒ Yes ☒ No Statewide advertising
☒ Yes ☐ No Fee amount, receipt date & No. recorded on application

SEND COPIES TO

☐ Idaho Dept. of Health & Welfare ☐ U.S. BLM
☐ Idaho Dept. of Fish & Game ☐ U.S. Forest Service
☐ Idaho Dept. of Lands ☐ Water District
☐ Adjudication Bureau Unit ☐ Other _____

FINAL REGIONAL PROCESSING REVIEW

☒ Yes ☐ No Affidavit of publication received
☒ Yes ☐ No Application published correctly. If not, record action taken.

☒ Yes ☐ No Publication dates & paper, recorded on application
☐ Yes ☒ No Protests received
Final date for protest 12-19-88
☐ Yes ☐ No Protests, dates, resolution of protest, recorded on application
☐ Yes ☒ No Recommendations attached
☐ Yes ☒ No Measuring device required
☐ Yes ☒ No Access port required
☒ Yes ☐ No Will water be delivered by watermaster? If yes, what Dist. 01
☒ Yes ☐ No Special conditions of approval or cover letter below.

P05

☐ See below for additional information

Date of priority recommended 11-14-1988
By HW Date 1-10-89

STATE OFFICE REVIEW

P23, P05, P16 46 41 ~~48~~

☐ See below for additional information

By FW Date 2/27/89

ADDITIONAL INFORMATION

condition: <41>

app. in trust water area-

November 22, 1988

Jenco Acres Water Board Assoc.
4134 E. 140 N.
Rigby, ID 83442

RE: Application for Permit No. 25-07454

Dear Water Right Applicant:

The Department of Water Resources acknowledges receipt of your water right application for permit. The application has been assigned identification No. 25-07454. Please refer to this number in all further correspondence.

This office is currently in the process of advertising the application in the THE JEFFERSON STAR. The advertisement will be published for two consecutive weeks, and a period of ten days following the second publication will be allowed for the submittal of protests.

If the application is protested, you will be sent a copy of the protest. The protest must be resolved before the application is approved or denied. If the protest is not resolved voluntarily, this Department will conduct a conference and/or hearing on the matter.

If the application is not protested, it will be forwarded to our state office in about five weeks. State office personnel will conduct a complete review prior to final processing of the application and will notify you of the outcome of this review. When a permit is issued, you will be sent a copy. A typical processing time for an unprotested application is about eight weeks.

Please feel free to contact this office if you have any questions regarding this procedure.

Sincerely,

HAROLD W. JONES
Water Rights Supervisor

HWJ/rb

Harold W. Jones

MAR 30 1989

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Eastern Region
150 Shoup Ave., Suite 15

Idaho Falls, Idaho 83402
(208) 525-7161

NOVEMBER 21, 1988

THE JEFFERSON STAR
P.O. BOX 37
RIGBY, ID 83442

Gentlemen:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before DECEMBER 19, 1988.

Yours truly,

Rita Bodell
Secretary

Encl.

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

1. [Illegible]

2. [Illegible]

25-07454

JENCO ACRES WATER BOARD ASSOC.
4134 E. 140 N.
RIGBY, ID 83442

Source: GROUNDWATER

Diversion Pt: NWSW Sec 28 T 04N R 39E

Use: DOMESTIC (.250 CFS)
IRRIGATION (.250 CFS)

Date Filed: 11/14/1988

In: T04N R39E S28 NESW NESW NWSW NWSW

37.0 ACRES TOTAL

25-07454
JENCO ACRES WATER BOARD ASSOC.
4134 E. 140 N.
RIGBY, ID 83442
Source: GROUNDWATER
Diversion Pt: NWSW Sec 28 T 04N R 39E
Use: DOMESTIC (.250 CFS)
IRRIGATION (.250 CFS)
Date Filed: 11/14/1988
In: T04N R39E S28 NESW NESW
NWSW NWSW
37.0 ACRES TOTAL

The permit(s) will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code and/or the new public interest criteria of Sec. 42-203C, Idaho Code. Protests must be filed with the Director, Dept. of Water Resources, 150 Shoup Ave., Suite 15, Idaho Falls, Idaho 83402 on or before DECEMBER 19, 1988.

R. Keith Higginson, Director

Published 11/30/1988 & 12/07/1988

NOT RECORDED

NOV 30 1988

Enclosed check for
filing fee of enclosed
papers - we weren't
sure who to make it
out to - Please advise
us of this - Thank you.

David King



NOV 14 1983

Department of Water Resources
Eastern District Office

MICROFILMED

Nov 30 1983

