


11. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

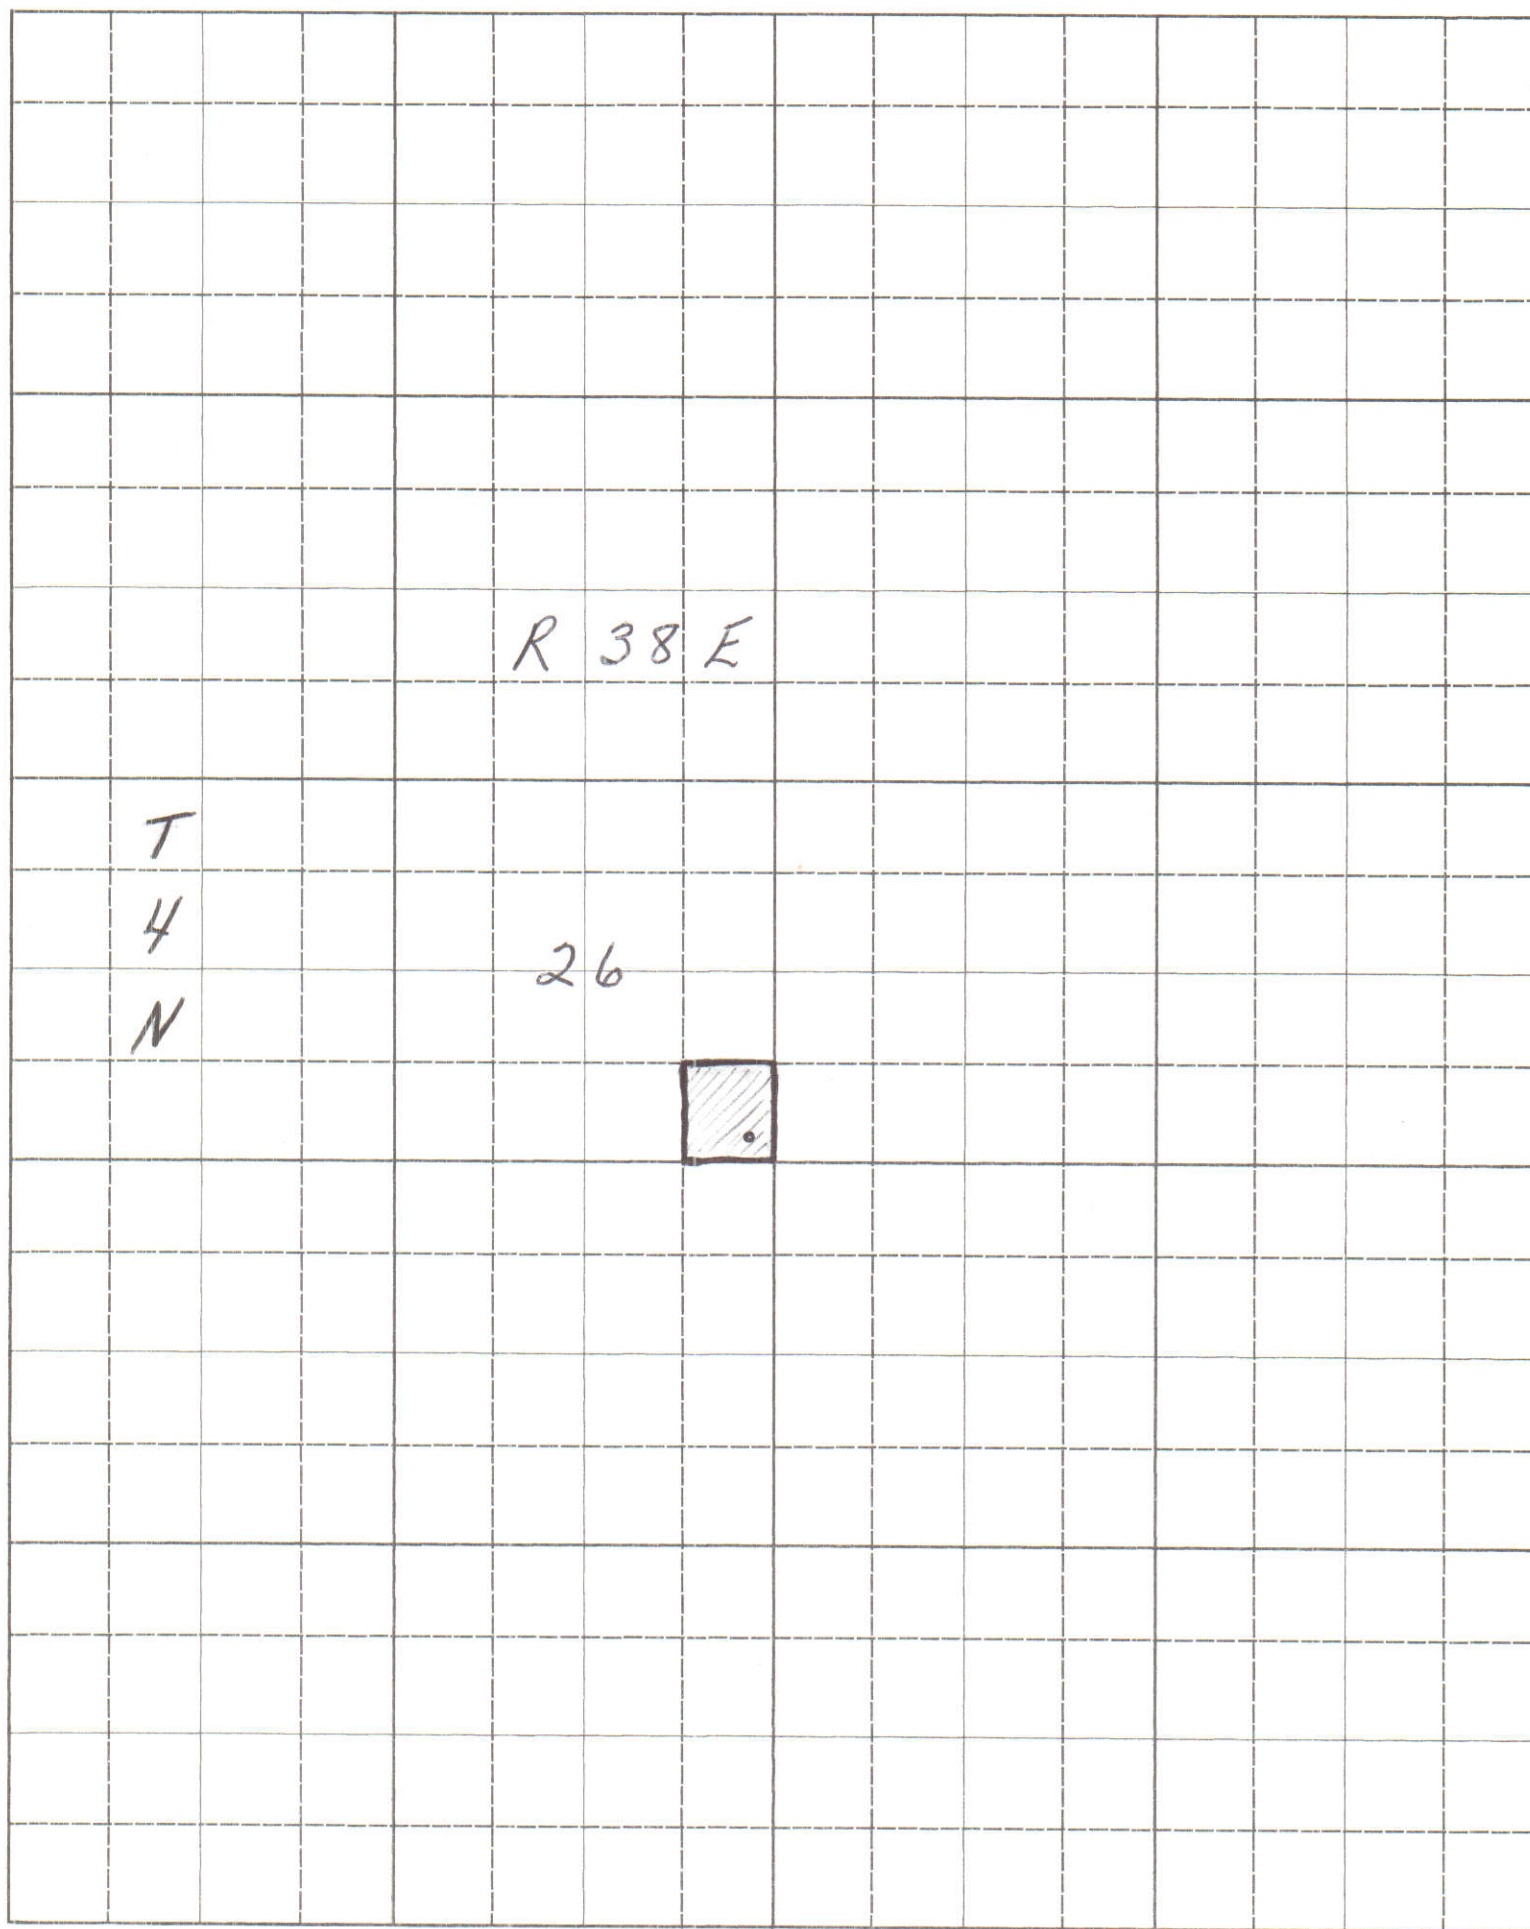

Scale: 2 inches equal 1 mile.


BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

*David H. Frank*  
\* David H. Frank  
(Applicant) President


LOCATION DRAWING  
BENTON ENGINEERING  
550 Linden Drive  
IDAHO FALLS, IDAHO 83401  
Phone 522-8033

JOB PARKWOOD ACRES WATER CORPORATION  
SHEET NO. 1 OF 2  
CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_  
CHECKED BY DEB DATE 12-5-83  
SCALE 1" = 30'

25-7175

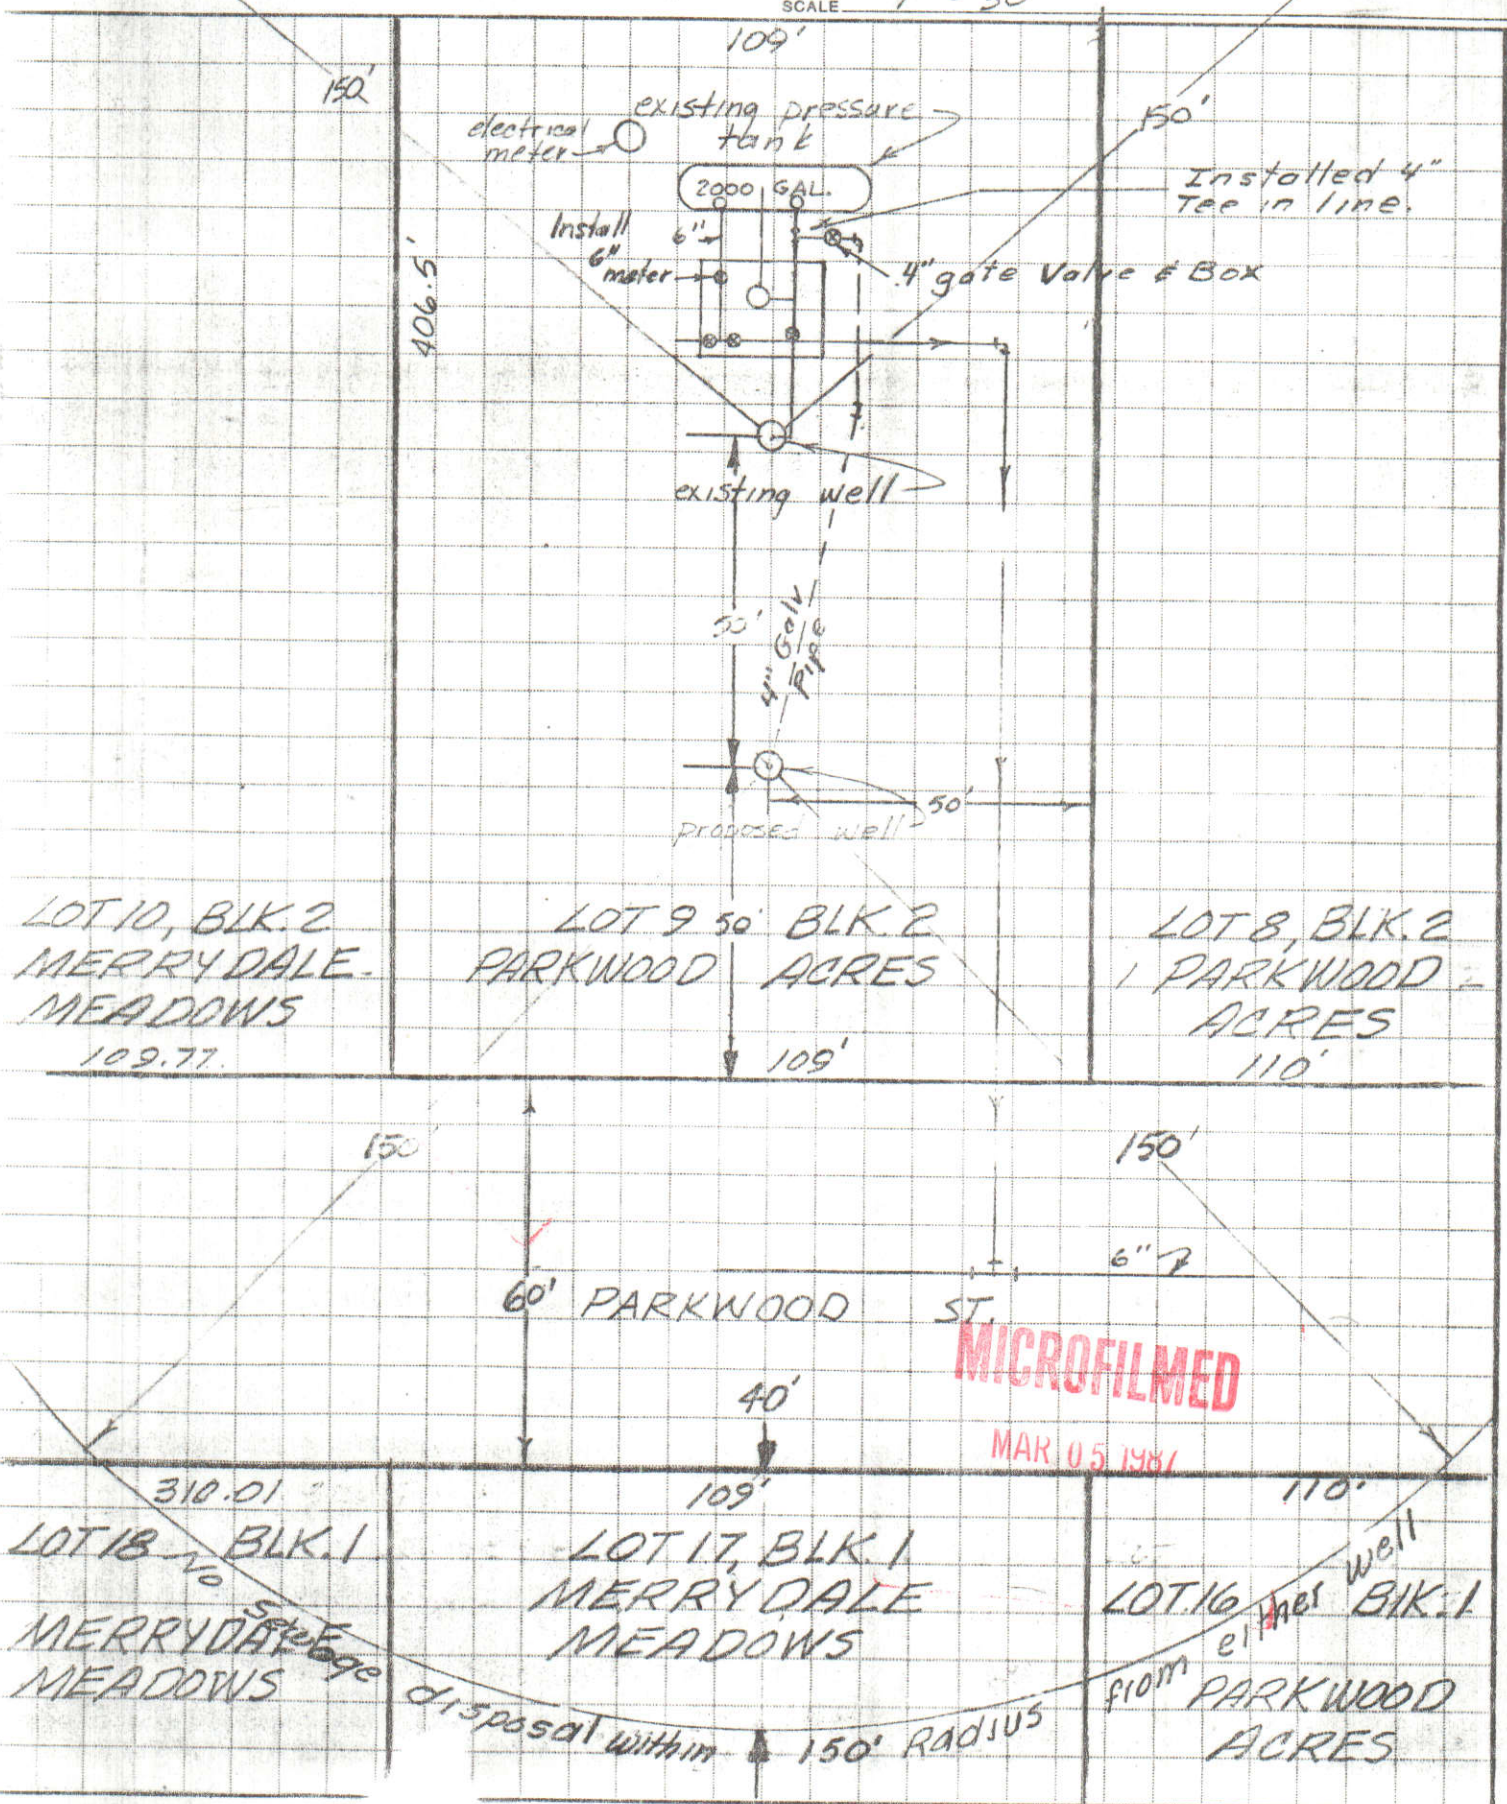



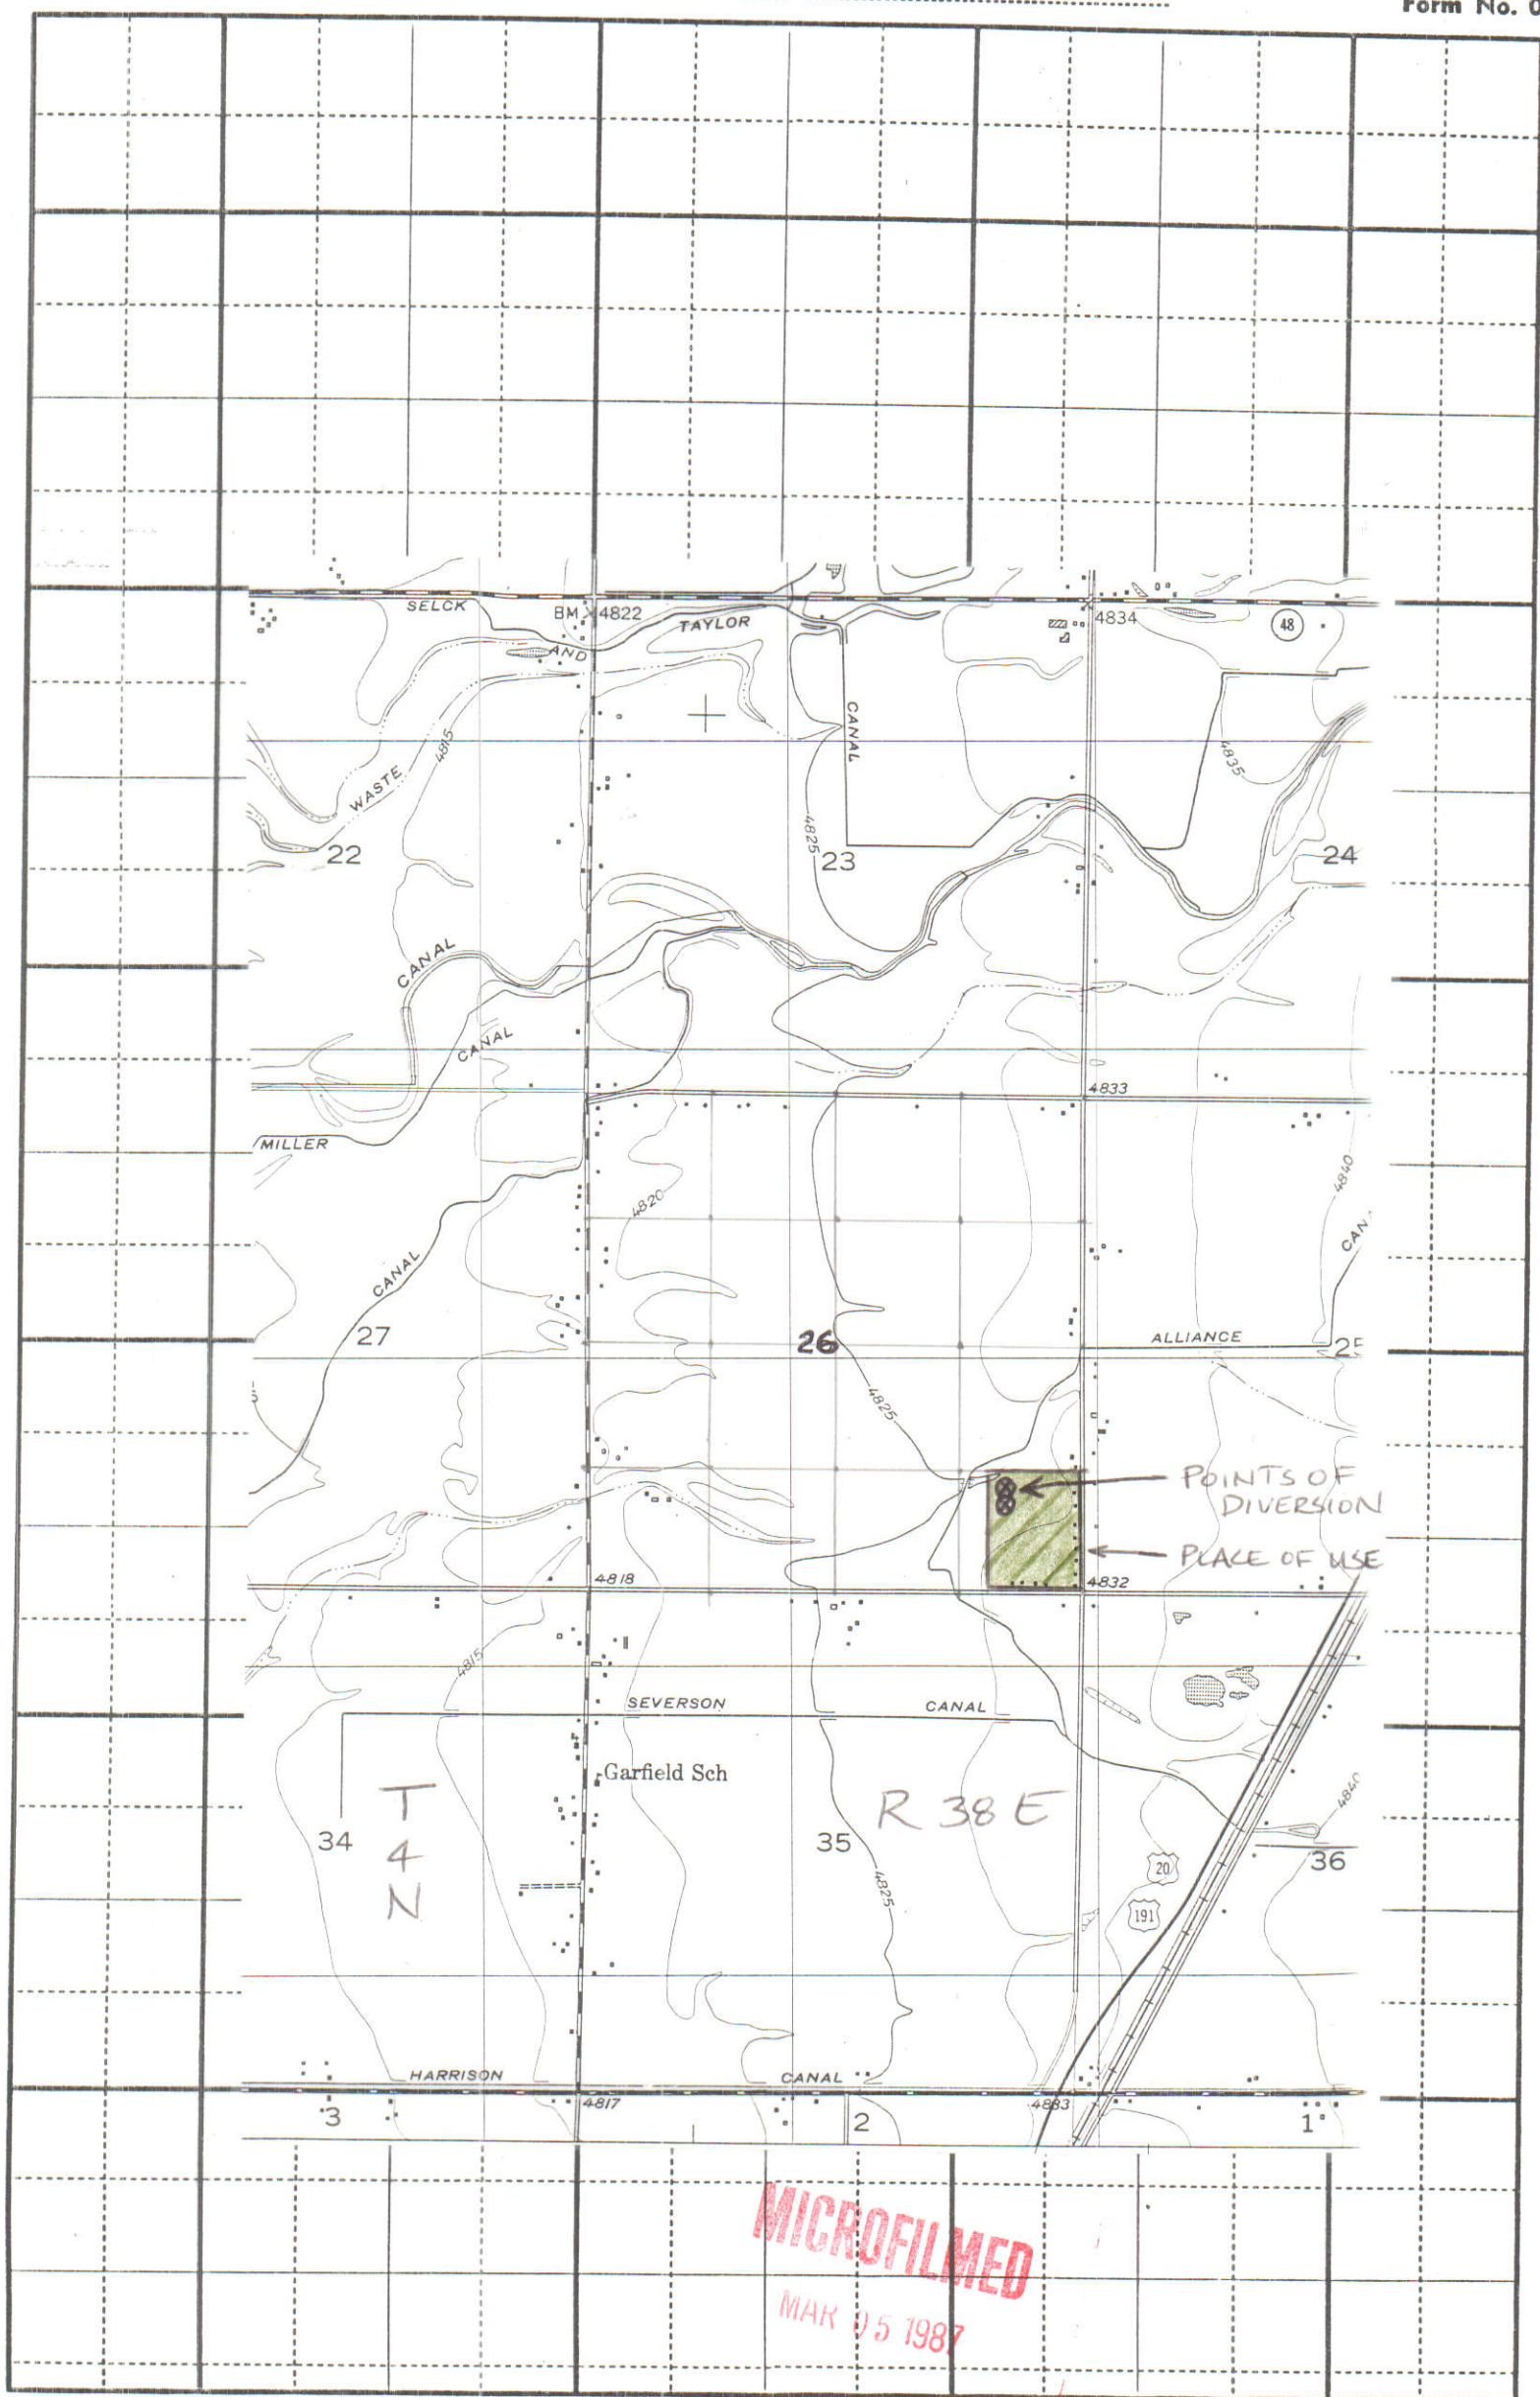

State of Idaho  
Department of Water Resources

**WATER RIGHT LICENSE**  
WATER RIGHT NO. 25-7175

Priority: July 3, 1979 Amount: .50 CFS 28.8 AF

This is to certify, that PARKWOOD ACRES WATER CO. INC.

C/O SANDY STACEY  
140 PARKWOOD DR.  
RIGBY, ID 83442

has complied with the terms and conditions of the permit issued pursuant to Application for Permit dated July 3, 1979, and has submitted proof to the Department of Water Resources on June 25, 1984, that water has been applied to a beneficial use; an examination by the Department indicates that the works have a diversion capacity of 1.71 cfs of water from a GROUNDWATER source and that a water right has been established as follows:

| <u>BENEFICIAL USE</u> | <u>PERIOD OF USE</u> | <u>RATE OF DIVERSION</u> | <u>VOLUME</u> |
|-----------------------|----------------------|--------------------------|---------------|
| Domestic              | 01/01 to 12/31       | .50 cfs                  | 28.8 af       |

LOCATION OF POINT OF DIVERSION(S): SESE , Sec. 26, Township 4N, Range 38E  
Jefferson County

PLACE OF USE: Domestic

TWN RGE SEC

4N 38E 26 SESE

CONDITIONS/REMARKS:

1. The right to the use of the water hereby confirmed is limited to the amount which can actually be beneficially used and is restricted and appurtenant to the lands or place of use and to the purpose herein described, as provided by the laws of Idaho.
2. This right is subject to all prior water rights and may be forfeited by five years of non-use.
3. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
4. This right when combined with all other rights shall provide no more than .02 cfs per acre nor more than 3.5 afa per acre for the lands above.
5. Use of water under this right is for 24 homes within the Parkwood Acres Subdivision No. 1.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. Witness the seal and signature of the Director, affixed at Boise, this 27<sup>th</sup> day of January, 1987.

MicroFILMED

for the

Director

*Norman C. Young*

MAR 05 1987

**STATE OF IDAHO**  
**DEPARTMENT OF WATER RESOURCES**  
**APPLICATION FOR PERMIT**  
**To appropriate the public waters of the State of Idaho**

**APPROVED**

1. Name of applicant Parkwood Acres Water Company, Inc. Phone 745-7103

Post office address c/o Sandy Stacey, 140 Parkwood Drive, Rigby, ID 83442

2. Source of water supply Ground water (well) which is a tributary of \_\_\_\_\_

3. Location of point of diversion is SE  $\frac{1}{4}$  of SE  $\frac{1}{4}$  of Section 26 Township 4 N

Range 38 E B.M. Jefferson County, additional points of diversion if any: \_\_\_\_\_

4. Water will be used for the following purposes:

Amount 0.5 for domestic purposes from Jan. 1 to Dec. 31 (both dates inclusive)  
(cfs or acre-feet per annum)

Amount \_\_\_\_\_ for \_\_\_\_\_ purposes from \_\_\_\_\_ to \_\_\_\_\_ (both dates inclusive)  
(cfs or acre-feet per annum)

Amount \_\_\_\_\_ for \_\_\_\_\_ purposes from \_\_\_\_\_ to \_\_\_\_\_ (both dates inclusive)  
(cfs or acre-feet per annum)

Amount \_\_\_\_\_ for \_\_\_\_\_ purposes from \_\_\_\_\_ to \_\_\_\_\_ (both dates inclusive)  
(cfs or acre-feet per annum)

5. Total quantity to be appropriated:

a. 0.5 cubic feet per second and/or b. \_\_\_\_\_ acre-feet per annum.

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc. 8" well with submersible pump and  
buried main line

b. Height of storage dam \_\_\_\_\_ feet, active reservoir capacity \_\_\_\_\_ acre-feet; total reservoir  
capacity \_\_\_\_\_ acre-feet, materials used in storage dam: \_\_\_\_\_

Period of year when water will be diverted to storage \_\_\_\_\_ to \_\_\_\_\_ inclusive.  
(Month/Day) (Month/Day)

c. Proposed well diameter is 8 inches; proposed depth of well is 200 feet.

7. Time required for the completion of the works and application of the water to the proposed beneficial  
use is 5 years (minimum 1 year — maximum 5 years).

8. Description of proposed uses:

a. If water is not for irrigation:

(1) Give the place of use of water: SE  $\frac{1}{4}$  of SE  $\frac{1}{4}$  of Section 26 Township 4 N

Range 38 E B.M.

(2) Amount of power to be generated: \_\_\_\_\_ horsepower under \_\_\_\_\_ feet of head.

(3) List number of each kind of livestock to be watered \_\_\_\_\_


(4) Name of municipality to be served Parkwood Acres Subdivision I, or number of families to be  
supplied with domestic water 24.

(5) If water is to be used for other purposes describe: \_\_\_\_\_

**MICROFILMED**



11. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

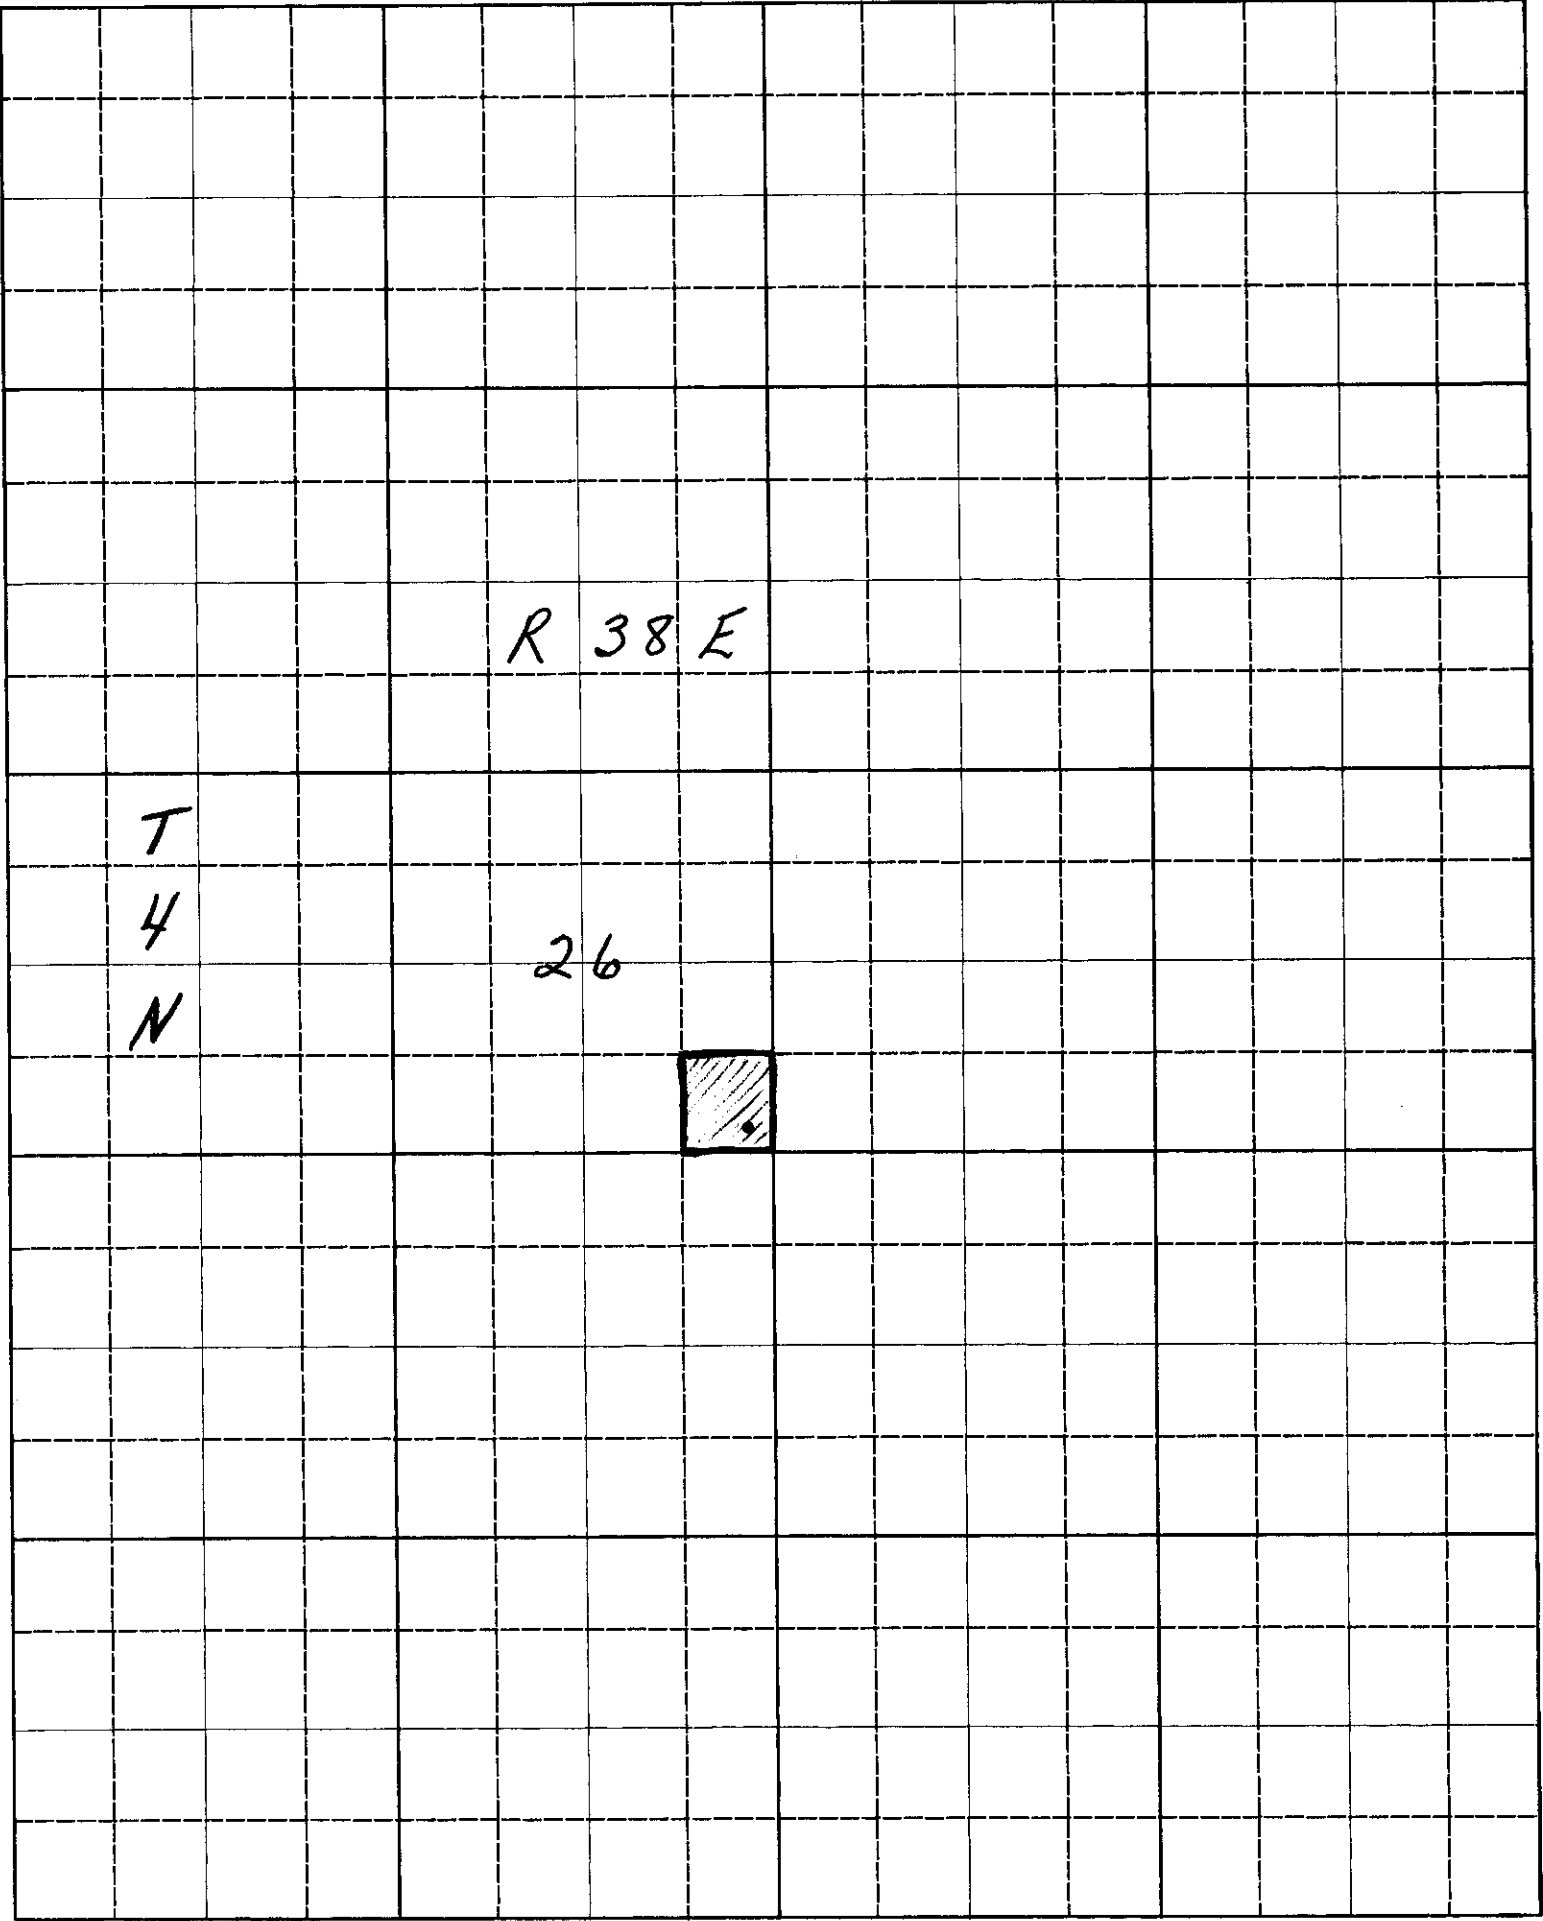

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

*David H. French*  
\* *David H. French*  
(Applicant) President

Proposed Priority 7/3/79  
Received by dh Date 7-3-79 Time 1:30 pm  
Preliminary check by S.M. Fee \$ 35.00  
Receipted by dh Date 7-3-79 #11983  
Publication prepared by dh Date 7-13-79  
Published in Rigby Star  
Publication dates July 18 & 25, 1979  
Publication approved JO Date 8/21/79  
Protests filed by: \_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_  
Copies of protests forwarded by \_\_\_\_\_  
Hearing held by \_\_\_\_\_ Date \_\_\_\_\_  
Recommended for approval denial by EMC JS

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. 25-7175 , and said application is hereby approved .

- 1. Approval of said application is subject to the following limitations and conditions:
  - a. SUBJECT TO ALL PRIOR WATER RIGHTS.
  - b. Proof of construction of works and application of water to beneficial use shall be submitted on or before August 1 , 19 84 .
  - c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.
  - d. Other: (1) The issuance of this permit in no way grants any right-of-way or easement across the land of another.

Witness my hand this 30<sup>th</sup> day of August , 19 79.

L. Glen Saxton  
Chief, Operations Bureau

**NOTICE OF APPLICATION  
FOR WATER RIGHT**

NOTICE IS HEREBY GIVEN that the following applications have been submitted for permit to appropriate the public waters of the State of Idaho:

01-7032

Hal D. and/or Merlyn Clark,  
Route 4, Box 279, Rigby, Id. 83442.  
Source: Snake River, South Fork  
tributary to Columbia River.  
Date filed: 7-3-1979.  
Amount 2.20 CFS.  
Diversion Point: NENW Sec. 29 T  
04N R 40E, Jefferson Co.  
Use: Irrigation (2.20 CFS) from  
4-1 to 11-1.  
Place of Use: SWNE, SWNW,  
SENE, Sec. 28 T 04N R 39E for 110  
acres.  
Diversion Means: Headworks of  
Rudy Canal.

25-7175

Parkwood Acres Water Company,  
Inc., c/o Sandy Stacey, 140  
Parkwood Drive, Rigby, Id. 83442.  
Source: Groundwater.  
Date Filed: 7-3-1979.  
Amount: 0.50 CFS  
Diversion Point: SESE Sec. 26 T  
04N R 38E, Jefferson Co.  
Use: Domestic (0.50 CFS) from  
1-01 to 12-31.  
Place of Use: SESE, Sec. 26 T 04N  
R 38E.  
Diversion Means: Well, pump  
and pipeline.

25-7176

Jefferson County, Box 275, Rigby,  
Id. 83442.  
Source: Groundwater.  
Date Filed: 6-27-1979.  
Amount: 0.04 CFS.  
Diversion Point: NENE, Sec. 07 T  
04N R 39E, Jefferson Co.  
Use: Domestic (0.04 CFS) from  
1-01 to 12-31.  
Place of Use: NENE Sec. 07 T 04N  
R 39E.  
Diversion Means: Well and  
pump.

31-7319

Rene and/or Lella Shurtliff,  
Hamer, Id. 83425.  
Source: Groundwater.  
Date Filed: 6-28-1979.  
Amount: 4.00 CFS.  
Diversion Point: SESE, SWSE,  
Sec. 22 T 07N R 36E, Jefferson Co.  
Use: Irrigation (4.00 CFS) from  
04-01 to 11-01.  
Place of Use: NESW, SESW,  
NESE, NWSE, SWSE, SESE, Sec.  
22 T 07N R 36E for 181 acres.  
Diversion Means: Well, pump  
and open ditches.

31-7320

Earl Hunter, P.O. Box 310, Ririe,  
Id. 83443.  
Source: Groundwater.  
Date Filed: 7-5-1979.  
Amount: 6.40 CFS.  
Diversion Point: NWSE Sec. 18 T  
07N R 34E, Jefferson Co.  
Use: Irrigation (6.40 CFS) from  
04-01 to 11-01.  
Place of Use: NENE, NWNE,  
SWNE, SENE, NESW, NWSW,  
SWSW, SESW, Sec. 18 T 07N R 34E  
for 320 acres.  
Diversion Means: Well, pump  
and sprinkler system.  
If issued, the permits will be  
subject to all prior water rights.  
Protests against the granting of any  
permit must be filed with the  
Director of the Idaho Department of  
Water Resources, 1515 Lincoln  
Road, Idaho Falls, Idaho 83401 on or  
before August 6, 1979.  
/s/ C. Stephen Allred  
Director

Published July 18 and 25, 1979.

**Affidavit of Publication**

THE RIGBY STAR

**RECEIVED**

AUG 14 1979

Department of Water Resources  
Eastern District Office

STATE OF IDAHO,

County of Jefferson

ss

I, Karl Hanosky, do solemnly swear that I am the  
Publisher of THE RIGBY STAR, a weekly  
newspaper as defined by Idaho Codes Annotated Section 58-106 as  
amended, and that said newspaper is a weekly newspaper, printed and  
published at Rigby, Jefferson County, Idaho, having a general circulation in  
said county, and that said newspaper has been printed and published as a  
weekly newspaper, in said county for more than 78 consecutive weeks prior  
to the first publication of the attached notice.

And affiant further says that at the times herein mentioned said  
publication as per clipping attached, was published in said newspaper in the  
regular and entire issue thereof, and not in any supplement issue thereof,  
for 2 consecutive issues thereof; first publication having been made on the

Eighteenth day of July, 1979

and the last publication on the

Twenty-Fifth day of July, 1979

And affiant further says that at the times herein mentioned said  
newspaper was made up of at least four pages of at least five columns each  
printed from type matter of at least seventeen and three-fourths inches  
depth; and that there are at least two hundred bonafide subscribers in  
Jefferson County.

Karl S. Hanosky  
Publisher

Subscribed in my presence and sworn to before me this Twenty-Fifth  
day of July, 1979.  
[SEAL]

Evelyn M. Flapen  
Notary Public for the State of Idaho  
Residence and P. O. Address, Rigby, Idaho.

My commission expires Life, 19    

Publication Fee: \$ 39.54

80

**MICROFILMED**

STATE OF IDAHO  
DEPARTMENT OF WATER RESOURCES  
**WELL DRILLER'S REPORT**

USE TYPEWRITER OR

RECEIVED

ES JUL 31 1984

State law requires that this report be filed with the Director, Department of Water Resources within 30 days after the completion or abandonment of the well.

[illegible]

STATE OF IDAHO  
DEPARTMENT OF WATER RESOURCES  
COMMENCEMENT OF WORKS

Permit No. 25 7175

Name(s) of Permit Holder(s): Parkwood Acres Water Company, Inc.

Post Office Address: c/o 140 Parkwood, Rigby, ID 83442

Tel. No. 208-745-7103

☒ I hereby certify that construction of diversion works for the above referenced permit began on 7-21-75 and I understand that I must  
(date)  
continue to develop the water system with due diligence to maintain a valid permit.

☐ I hereby certify that construction of diverting works on the above referenced project has not yet begun due to the following reason beyond my control\*:  
\_\_\_\_\_

\*Note: A financing difficulty is  
not an acceptable reason.

6-3-83  
Date

Sandy Stacey, Secretary  
Signature of Permit Holder

Parkwood Acres  
Water Company, Inc.  
c/o 140 Parkwood  
Rigby, ID 83442



**MICROFILMED**

JUN 16 1988



IDAHO DEPARTMENT OF WATER RESOURCES  
STATEHOUSE  
BOISE, IDAHO 83720



State of Idaho

## DEPARTMENT OF WATER RESOURCES

STATE OFFICE, 450 W. State Street, Boise, Idaho

CECIL D. ANDRUS

~~JOHN V. EVANS~~

Governor

A. KENNETH DUNN

Director

Mailing address:  
Statehouse  
Boise, Idaho 83720  
(208) 334-4440

February 3, 1987

RE: Permit No. 25-7175

Parkwood Acres Water Co. Inc.  
c/o Sandy Stacey  
140 Parkwood Dr.  
Rigby, ID 83442

Dear Permit Holder(s):

Enclosed herewith is a copy of the Water Right License issued on the above referenced permit.

Sincerely,

JIM JOHNSON  
Water Rights Supervisor


JJ:sc

Enclosure

MICROFILMED  
MAR 03 1987

**Total Acres** \_\_\_\_\_

10. Other water rights on these lands 01-0353/0249
11. Other water right diverted from same p.d. N/A
12. **Diversion and Delivery System Diagram:** Indicate all major components and distances between components. Indicate ditch size/pipe i.d. as applicable. Indicate on systems with measurement port the distance between the port and the nearest component/pipe bend/restriction both upstream and downstream, and the inside pipe diameter at the measurement port. On multiple diversion systems indicate how diversion systems are connected.

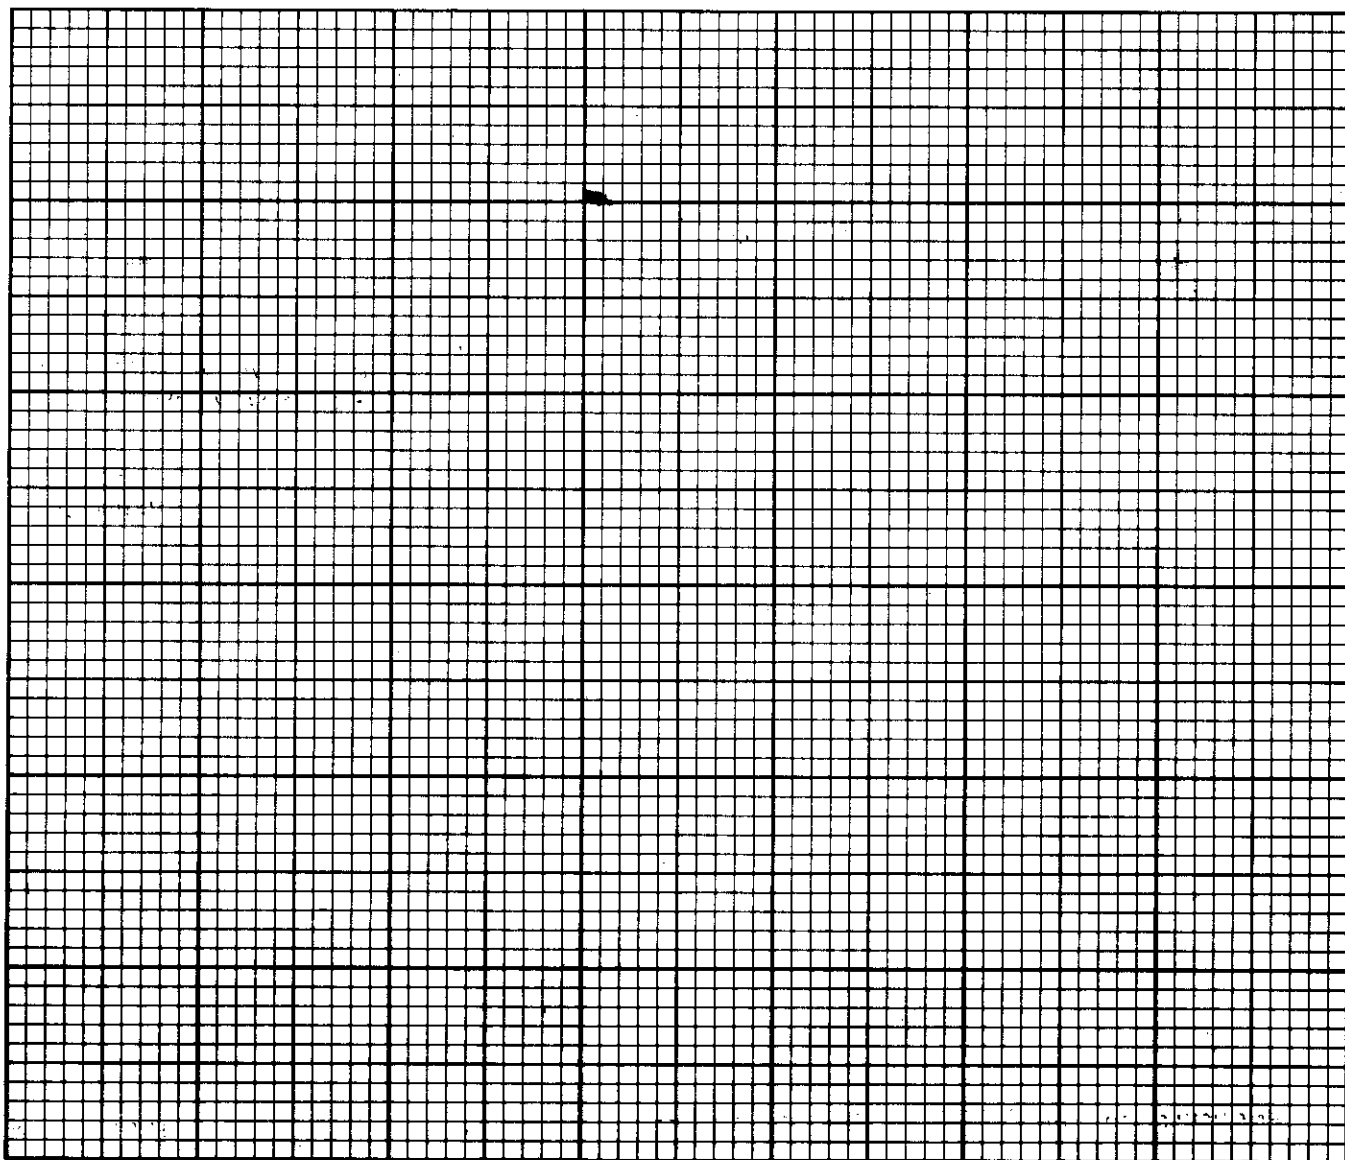

13. ☐ Photo of Diversion & System Attached

☒ Aerial Photo of Place of Use Attached  
or Map of Irrigated Acreage Attached

14. Remarks \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_  
 \_\_\_\_\_

15. Recommended Amendments

- ☐ Change P.D. as reflected above  
☐ Change P.U. as reflected above

- ☐ Add P.D. as reflected above  
☐ Add P.U. as reflected above

- ☒ None  
☐ Other

16. Examiner's/Consultant's Signature Keith C. Wilson Date 6 Sept 1984

Consultant's License Number \_\_\_\_\_

IDWR Director's Authorization to Conduct

Beneficial Use Examination \_\_\_\_\_

Date **MICROFILMED**  
 MAR 05 1987

CONSULTANT SEAL

STATE OF IDAHO  
DEPARTMENT OF WATER RESOURCES  
LICENSING REPORT

RECEIVED

APR 1 1986

25-7175

Permit No.

Department of Water Resources

1. Measurement Calculations

a) Field Measurement Calculations (Include theoretical capacities and system capacity)

Theoretical

$$Q = \frac{hp (8.814) E}{H + (2.308 \times P)} \quad \text{where}$$

E = efficiency of pump + motor  
H = head from pumping water surface to ground elevation  
P = pumping pressure

$$hp = 15$$

$$E = 0.855$$

$$H = 40'$$

$$P = 40 \text{ psi}$$

$$Q = \frac{15 (8.814) (0.855)}{13.232 \times 40 + (2.308 \times 40)} = 0.854 \text{ cfs for } 1 \frac{1}{2}$$

$$Q_{\text{TOTAL}} = 1.71 \text{ cfs } \checkmark$$

Permit gives 0.5 cfs for 24 homes - For domestic use, however, department restricts instantaneous flow to 0.22 cfs. The lots in this subdivision are one acre lots, and it is the opinion of the examiner that the additional flow was approved in the permit to irrigate the larger acreage even though included under domestic. Recommend 0.5 cfs

b) Volume Calculations for Irrigation:

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 =$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$$

c) Volume Calculations for Other Uses:

1.2 afa per home

$$(1.2)(24) = 28.8 \text{ afa}$$

2. Overlap Review

a) Other water rights with same place of use: 01-0353/0249 (Included because of possible irrigation of lots)

b) Other water rights with same point of diversion: N/A

c) Analysis:

R 30

MICROFILMED

MAR 05 1987

## RECOMMENDED AMOUNTS

| Permit No. | Priority | Amount | App. Date | Date Proof Submitted | System Capacity |
|------------|----------|--------|-----------|----------------------|-----------------|
| 25-7175    |          |        |           |                      | 1.71            |

4. Permit Holder: \_\_\_\_\_

**Address:** \_\_\_\_\_

5. Source: Groundwater tributary to \_\_\_\_\_

| 6. Beneficial Use | Period of Use |       | Rate of Diversion | Annual Volume |
|-------------------|---------------|-------|-------------------|---------------|
|                   | From          | To    | Q (cfs)           | V (afa)       |
| DOMESTIC          | 1/1           | 12/31 | 0.5 cfs           | 28.8 afa      |

|                     |         |          |
|---------------------|---------|----------|
| Allowable Maximums: | 0.5 cfs | 28.8 afa |
|---------------------|---------|----------|

7. Point(s) of Diversion: *Lot 9 Block 2 Parkwood ACRES Subdivision*

[illegible]

8. Place(s) of Use Parkwood Acres Subdivision

[illegible]

9. Recommended Conditions/Remarks: Permit allows 0.5 cfs for 24 homes. For domestic use, however, department restricts instantaneous flow to 0.22 cfs. The lots in this subdivision are one acre lots and it is the opinion of the examiner that the additional flow was approved in the permit to irrigate the larger acreage even though included under domestic. Recommend licensing for 0.5 cfs.

## 0. Recommended Amendments

☐ Change P.D. as reflected above    ☐ Add P.D. as reflected above    ☒ None

☐ Change P.U. as reflected above    ☐ Add P.U. as reflected above    ☐ Other \_\_\_\_\_

1. Examiner's Signature Keith Carlson

Date 26 Mar, 1986

Checked in Regional Office by Gary S. [Signature]

Date 3-31-86

Approved in State Office by Jim **DECLINED**


Date 1-9-87

MAR 05 1981

LOCATION DRAWING  
**BENTON ENGINEERING**  
 550 Linden Drive  
 IDAHO FALLS, IDAHO 83401  
 Phone 522-8033

**PARKWOOD ACRES WATER CORPORATION**  
 JOB 1 OF 2  
 SHEET NO. \_\_\_\_\_ DATE \_\_\_\_\_  
 CALCULATED BY \_\_\_\_\_ DATE \_\_\_\_\_  
 CHECKED BY DEL DATE 12-5-83  
 SCALE 1" = 30'

25-7175

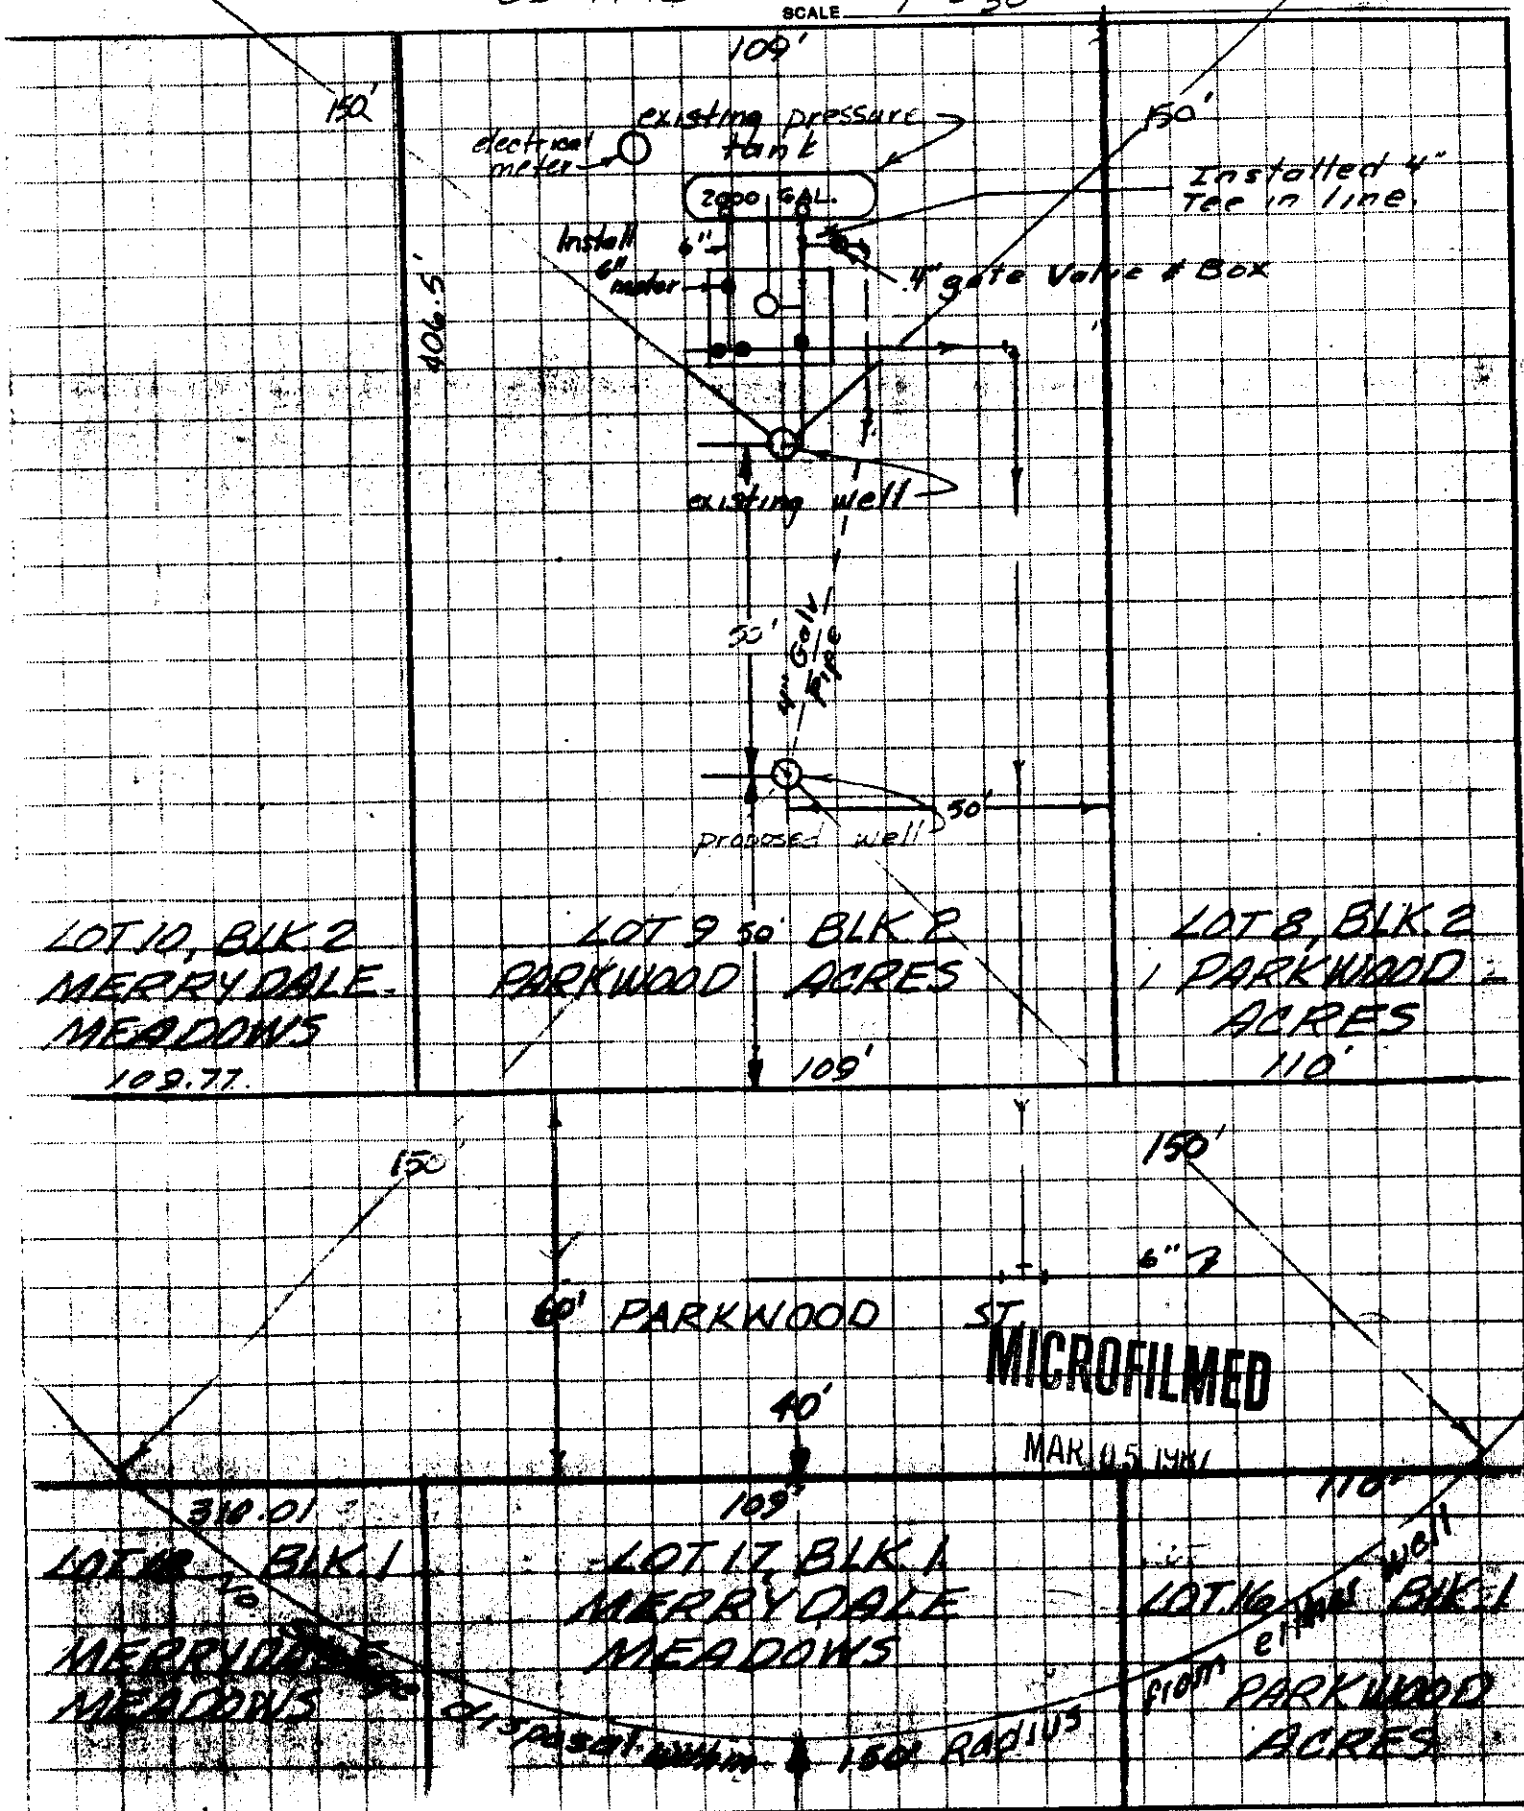

3 Phase 60 cycles  
230, 460, 575 Volts  
40°C. Ambient - C. Rise MP-1


HOLLOSHAFT & SOLIDSHAFT MOTORS  
TYPICAL OPERATING CHARACTERISTICS

| HP    | RPM        |              | EFFICIENCY   |             |             | % POWER FACTOR |             |             | CURRENT<br>IN AMPERES<br>460 VOLTS |                    |
|-------|------------|--------------|--------------|-------------|-------------|----------------|-------------|-------------|------------------------------------|--------------------|
|       | NO<br>LOAD | FULL<br>LOAD | FULL<br>LOAD | 3/4<br>LOAD | 1/2<br>LOAD | FULL<br>LOAD   | 3/4<br>LOAD | 1/2<br>LOAD | FULL<br>LOAD                       | LOCKED<br>STARTING |
| 2     | 900        | 860          | 75.0         | 74.5        | 70.0        | 68.0           | 60.0        | 47.5        | 3.9                                | 18.0               |
|       | 1800       | 1720         | 80.0         | 79.5        | 75.5        | 81.0           | 72.5        | 59.5        | 4.4                                | 32.0               |
|       | 1200       | 1155         | 78.5         | 78.0        | 75.0        | 69.0           | 61.0        | 49.0        | 5.4                                | 23.0               |
| 3     | 900        | 860          | 78.5         | 79.0        | 75.5        | 67.5           | 59.0        | 46.0        | 5.8                                | 30.5               |
|       | 3600       | 3480         | 81.0         | 82.0        | 80.5        | 86.0           | 80.5        | 69.5        | 6.9                                | 45.0               |
|       | 1800       | 1725         | 81.5         | 82.0        | 79.5        | 84.0           | 76.5        | 63.5        | 7.0                                | 47.0               |
| 5     | 1200       | 1160         | 81.0         | 81.0        | 78.0        | 71.0           | 62.5        | 50.0        | 8.5                                | 40.0               |
|       | 900        | 875          | 80.5         | 80.0        | 77.0        | 72.0           | 64.0        | 51.0        | 8.2                                | 44.0               |
|       | 3600       | 3480         | 84.0         | 85.0        | 84.0        | 88.0           | 84.0        | 75.5        | 9.8                                | 65.0               |
| 7 1/2 | 1800       | 1740         | 83.5         | 84.0        | 82.5        | 84.0           | 80.0        | 71.5        | 10.4                               | 63.5               |
|       | 1200       | 1170         | 83.0         | 83.5        | 81.0        | 80.5           | 74.0        | 61.5        | 10.5                               | 63.0               |
|       | 900        | 875          | 80.5         | 80.5        | 77.5        | 71.5           | 63.0        | 50.5        | 12.5                               | 65.0               |
| 10    | 3600       | 3500         | 83.5         | 84.0        | 83.0        | 87.0           | 84.0        | 76.5        | 13.4                               | 79.0               |
|       | 1800       | 1740         | 86.5         | 87.0        | 85.5        | 81.0           | 75.0        | 64.0        | 13.3                               | 82.0               |
|       | 1200       | 1165         | 82.5         | 82.5        | 80.0        | 78.5           | 70.0        | 57.0        | 14.0                               | 80.0               |
| 15    | 900        | 875          | 86.0         | 86.5        | 84.5        | 72.0           | 65.0        | 53.0        | 15.5                               | 81.0               |
|       | 3600       | 3485         | 85.0         | 86.5        | 86.0        | 88.5           | 87.0        | 82.0        | 19.5                               | 112.0              |
|       | 1800       | 1765         | 85.5         | 86.5        | 85.0        | 81.0           | 75.5        | 61.5        | 20.5                               | 112.0              |
| 20    | 1200       | 1160         | 87.5         | 89.0        | 89.0        | 85.0           | 82.0        | 74.5        | 19.4                               | 115.0              |
|       | 900        | 870          | 86.0         | 87.5        | 86.5        | 75.5           | 69.5        | 58.5        | 22.5                               | 116.0              |
|       | 3600       | 3515         | 85.5         | 87.0        | 87.0        | 89.0           | 87.5        | 82.5        | 25.4                               | 145.0              |
| 25    | 1800       | 1765         | 88.0         | 89.0        | 89.0        | 85.0           | 82.5        | 75.0        | 26.0                               | 145.0              |
|       | 1200       | 1160         | 88.0         | 89.5        | 89.0        | 85.0           | 81.5        | 74.0        | 25.8                               | 145.0              |
|       | 900        | 880          | 85.0         | 86.5        | 86.0        | 74.5           | 69.0        | 57.0        | 30.5                               | 140.0              |
| 30    | 3600       | 3510         | 89.0         | 90.0        | 89.0        | 88.5           | 87.0        | 81.0        | 30.4                               | 172.0              |
|       | 1800       | 1755         | 88.5         | 90.0        | 89.5        | 83.0           | 78.5        | 68.5        | 32.5                               | 180.0              |
|       | 1200       | 1180         | 85.5         | 87.0        | 86.5        | 84.0           | 79.0        | 68.0        | 33.5                               | 193.0              |
| 40    | 900        | 880          | 86.0         | 88.0        | 87.5        | 77.0           | 72.0        | 61.0        | 36.5                               | 175.0              |
|       | 3600       | 3510         | 89.5         | 90.5        | 89.5        | 87.5           | 85.0        | 78.0        | 37.0                               | 218.0              |
|       | 1800       | 1755         | 89.0         | 90.0        | 89.5        | 80.5           | 75.0        | 63.5        | 40.0                               | 217.0              |
| 50    | 1200       | 1175         | 86.5         | 88.5        | 89.5        | 86.0           | 84.0        | 78.0        | 38.5                               | 215.0              |
|       | 900        | 880          | 88.0         | 89.5        | 89.5        | 75.0           | 70.0        | 59.5        | 43.5                               | 205.0              |
|       | 3600       | 3515         | 90.0         | 91.0        | 90.0        | 86.5           | 83.0        | 75.0        | 48.5                               | 310.0              |
| 60    | 1800       | 1770         | 88.0         | 89.5        | 89.0        | 86.0           | 82.0        | 73.0        | 51.0                               | 292.5              |
|       | 1200       | 1175         | 87.5         | 89.5        | 90.0        | 84.5           | 81.0        | 72.0        | 52.0                               | 292.0              |
|       | 900        | 875          | 88.0         | 90.0        | 90.0        | 76.0           | 71.5        | 61.0        | 57.5                               | 280.0              |
| 75    | 3600       | 3540         | 88.0         | 89.5        | 89.0        | 87.0           | 84.5        | 78.0        | 63.0                               | 350.0              |
|       | 1800       | 1765         | 89.0         | 90.5        | 90.5        | 84.5           | 81.0        | 72.0        | 64.0                               | 339.5              |
|       | 1200       | 1170         | 88.0         | 90.5        | 91.0        | 85.0           | 83.0        | 76.5        | 64.0                               | 370.0              |
| 100   | 900        | 875          | 88.5         | 90.0        | 90.0        | 80.0           | 76.0        | 67.0        | 68.0                               | 325.0              |
|       | 3600       | 3540         | 89.5         | 91.0        | 91.0        | 89.0           | 89.0        | 86.0        | 72.5                               | 410.0              |
|       | 1800       | 1770         | 90.0         | 91.0        | 91.0        | 86.0           | 83.0        | 75.0        | 75.0                               | 454.5              |
| 125   | 1200       | 1175         | 88.5         | 90.0        | 89.5        | 85.5           | 82.0        | 72.5        | 76.0                               | 460.0              |
|       | 900        | 875          | 89.0         | 90.5        | 90.5        | 80.5           | 77.0        | 68.0        | 80.5                               | 410.0              |
|       | 3600       | 3535         | 90.5         | 92.0        | 92.0        | 89.0           | 89.0        | 86.0        | 90.0                               | 525.0              |
| 150   | 1800       | 1770         | 91.5         | 92.5        | 92.5        | 87.0           | 84.5        | 78.0        | 91.0                               | 594.0              |
|       | 1200       | 1175         | 89.5         | 91.0        | 91.0        | 87.5           | 85.0        | 78.5        | 92.0                               | 576.0              |
|       | 900        | 880          | 89.0         | 90.5        | 91.0        | 82.0           | 79.0        | 70.0        | 99.0                               | 520.0              |
| 200   | 3600       | 3540         | 92.5         | 93.5        | 94.0        | 88.5           | 87.5        | 83.6        | 117.0                              | 745.0              |
|       | 1800       | 1775         | 91.0         | 92.5        | 92.5        | 84.0           | 81.5        | 74.0        | 124.0                              | 685.0              |
|       | 1200       | 1170         | 91.5         | 92.5        | 93.0        | 85.5           | 84.0        | 79.0        | 125.5                              | 690.0              |
| 250   | 900        | 880          | 89.0         | 91.0        | 91.5        | 81.5           | 77.0        | 67.0        | 133.0                              | 740.0              |
|       | 3600       | 3545         | 92.5         | 93.5        | 93.5        | 90.5           | 89.5        | 86.0        | 143.0                              | 1045.0             |
|       | 1800       | 1775         | 92.0         | 93.0        | 93.5        | 86.5           | 85.0        | 80.0        | 150.0                              | 934.0              |
| 300   | 1200       | 1175         | 91.5         | 93.0        | 93.0        | 86.0           | 85.0        | 81.0        | 153.5                              | 865.0              |
|       | 900        | 875          | 89.5         | 91.1        | 91.3        | 82.5           | 78.0        | 68.0        | 158.0                              | 963.8              |
|       | 3600       | 3545         | 94.0         | 94.5        | 94.5        | 91.0           | 90.0        | 86.0        | 170.0                              | 1325.0             |
| 350   | 1800       | 1770         | 92.0         | 93.0        | 93.0        | 87.5           | 86.0        | 80.0        | 180.0                              | 1051.0             |
|       | 1200       | 1175         | 92.5         | 93.5        | 93.5        | 84.5           | 82.0        | 74.0        | 178.0                              | 1077.0             |
|       | 900        | 885          | 91.5         | 92.2        | 91.7        | 82.5           | 78.0        | 68.0        | 186.0                              | 1172.0             |
| 400   | 3600       | 3550         | 92.0         | 92.5        | 92.0        | 91.0           | 90.5        | 87.0        | 230.0                              | 1490.0             |
|       | 1800       | 1770         | 92.5         | 93.5        | 93.5        | 87.0           | 84.5        | 77.5        | 238.0                              | 1645.0             |
|       | 1200       | 1180         | 91.5         | 92.2        | 91.8        | 87.0           | 85.5        | 80.0        | 235.0                              | 1575.0             |
| 450   | 900        | 885          | 91.7         | 92.4        | 92.0        | 83.5           | 81.0        | 72.5        | 245.0                              | 1546.0             |
|       | 3600       | 3545         | 93.0         | 93.5        | 92.7        | 89.1           | 87.9        | 83.7        | 278.0                              | 1815.0             |
|       | 1800       | 1770         | 93.0         | 93.5        | 93.0        | 87.3           | 84.9        | 78.1        | 284.0                              | 1825.0             |
| 500   | 1200       | 1180         | 91.2         | 91.9        | 91.5        | 87.5           | 86.0        | 81.0        | 293.0                              | 1904.0             |
|       | 900        | 885          | 92.1         | 92.8        | 92.6        | 84.0           | 81.0        | 72.5        | 303.0                              | 1894.0             |
|       | 3600       | 1770         | 91.6         | 92.3        | 91.8        | 89.5           | 88.0        | 84.0        | 343.0                              | 2195.0             |
| 550   | 1800       | 1775         | 92.3         | 93.2        | 93.2        | 87.5           | 86.5        | 81.5        | 348.0                              | 2332.0             |
|       | 1200       | 1175         | 92.3         | 92.6        | 92.8        | 88.5           | 87.5        | 82.0        | 344.0                              | 2064.0             |
|       | 900        | 880          | 92.0         | 92.7        | 91.8        | 89.5           | 88.0        | 82.0        | 398.0                              | 2587.0             |
| 600   | 3600       | 1770         | 91.7         | 92.0        | 91.1        | 88.0           | 86.0        | 80.0        | 406.0                              | 2720.0             |
|       | 1800       | 1775         | 92.6         | 92.9        | 93.0        | 88.5           | 87.5        | 81.5        | 400.0                              | 2560.0             |
|       | 1200       | 1180         | 92.1         | 92.8        | 92.6        | 89.0           | 88.0        | 84.0        | 437.0                              | 2788.0             |
| 700   | 900        | 880          | 92.2         | 92.3        | 92.2        | 86.5           | 84.0        | 77.0        | 464.0                              | 2900.0             |
|       | 3600       | 1770         | 92.5         | 93.2        | 92.9        | 89.5           | 88.0        | 84.0        | 509.0                              | 3181.0             |
|       | 1800       | 1770         | 91.9         | 92.2        | 92.7        | 88.0           | 86.0        | 80.0        | 521.0                              | 3256.0             |
| 800   | 1200       | 1180         | 92.2         | 92.3        | 92.2        | 85.0           | 81.5        | 73.0        | 538.0                              | 3362.0             |
|       | 900        | 880          | 93.1         | 93.8        | 93.7        | 89.5           | 88.0        | 82.5        | 562.0                              | 3793.0             |
|       | 3600       | 1770         | 92.0         | 92.3        | 91.9        | 88.0           | 86.0        | 80.5        | 578.0                              | 3757.0             |
| 900   | 1800       | 1775         | 91.5         | 92.3        | 92.1        | 85.0           | 81.5        | 73.5        | 602.0                              | 3461.0             |
|       | 1200       | 1180         | 91.5         | 92.3        | 92.1        | 85.0           | 81.5        | 73.5        | 602.0                              | 3461.0             |

REFILMED

MAR 05 1981


25-7175

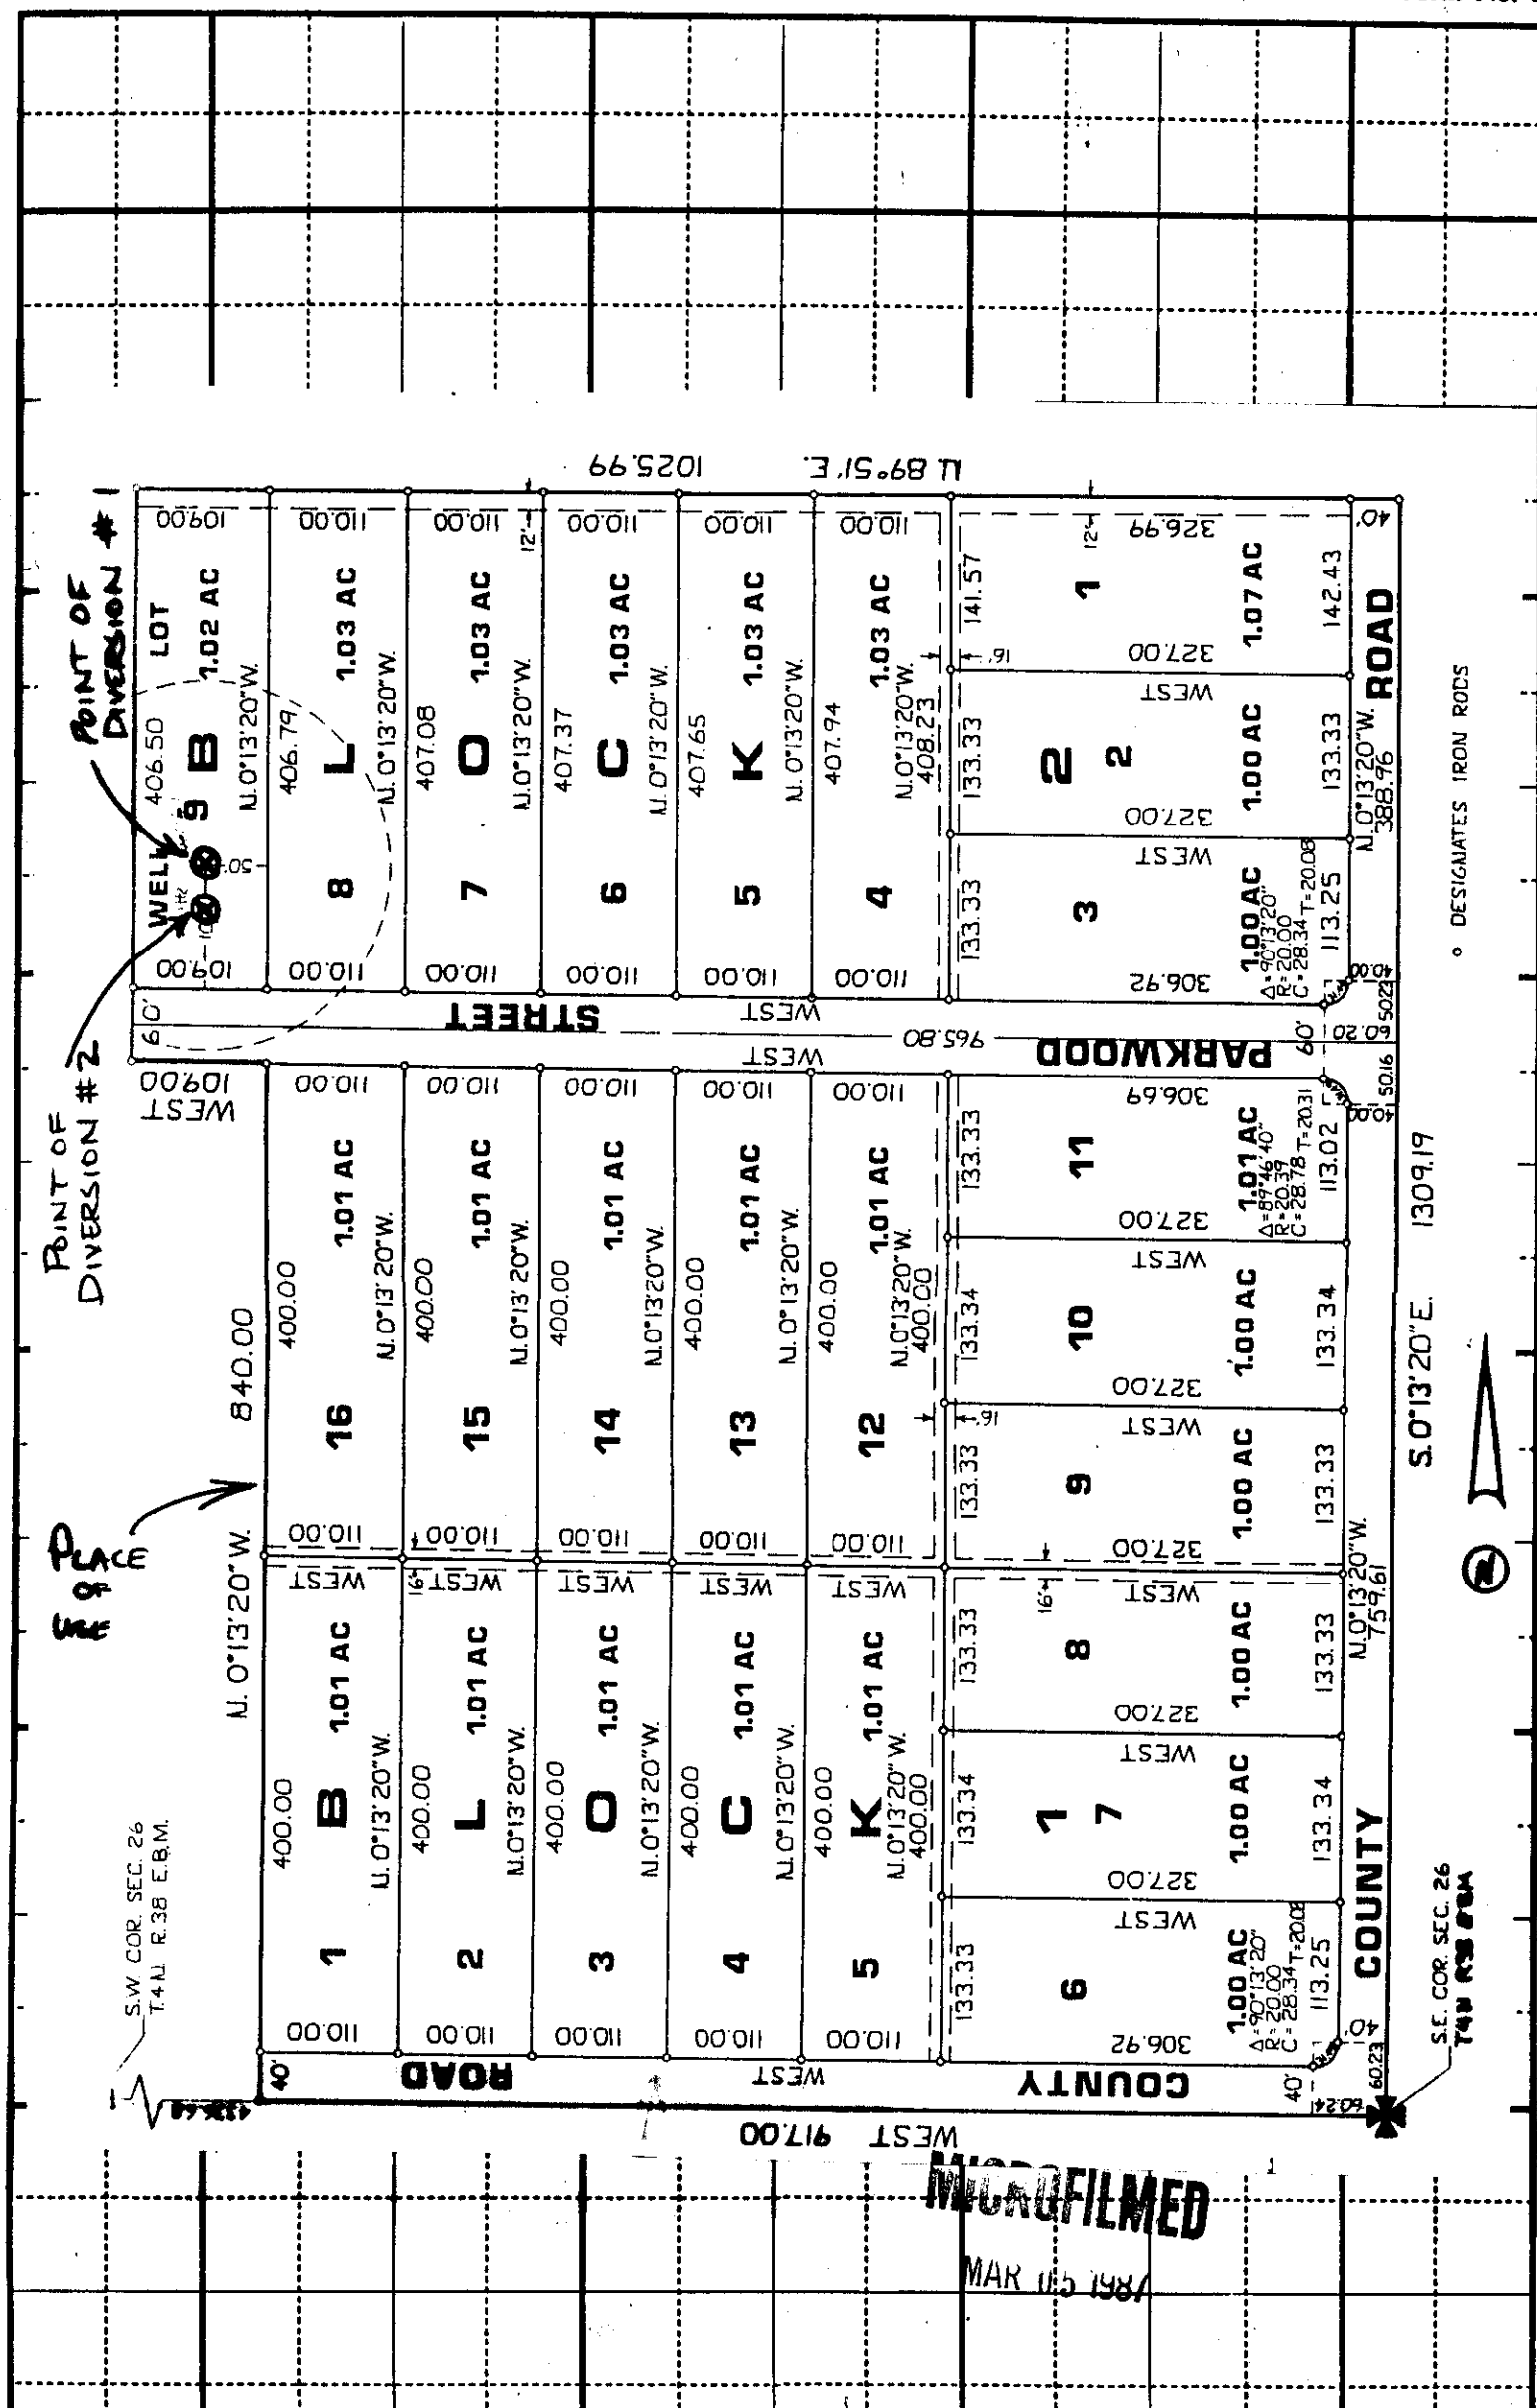

**SCALE:**

## Draw Plan In Ink.

25-7175

**Form No. 0**

25-7175

STATE OF IDAHO  
DEPARTMENT OF WATER RESOURCES  
Eastern Region

---

150 Shoup, Suite 15  
Idaho Falls, Idaho 83402  
(208) 525-7161

AUGUST 30, 1984

PARKWOOD ACRES WATER COMPANY, INC.  
C/O SANDY STACEY  
140 PARKWOOD  
RIGBY ID 83442

RE: Permit No. 25-7175

Dear Permit Holder:

We acknowledge receipt of your statement submitted as proof of beneficial use for the above referenced permit.

Before a license can be issued, a field examination must be made by a representative of this department.

A field examiner will contact you to arrange to examine your system.

If you have any questions regarding the field examination, please contact this office by phone at 525-7161 or in person in the third floor State Office Building, 150 Shoup, Idaho Falls, Idaho.

Sincerely,  
s/HAROLD W. JONES  
Sr. Resource Agent

REGISTERED

MAR 05 1987

# DEPARTMENT OF WATER RESOURCES

The Idaho Department of Water Resources will consider this card as a statement that the permit holder(s) has completed development to the extent shown below of Permit No. 25-7175.

Name(s) of Permit Holder: Parkwood Acres Water Company, Inc.

Post Office Address: % Sandy Stacey, 140 Parkwood,  
Rigby, ID 83442 Tel. No. 745-7103

Source of Water: 2 Domestic Wells

Extent of Use: ☒ Domestic 24 (number of households)  
☐ Stockwater (number and type of stock)  
☐ Irrigation (acres)  
☐ Other

Measuring Device: Required? ☐ Yes ☒ No Installed? ☒ Yes ☐ No  
Access Port: Required? ☐ Yes ☒ No Installed? ☒ Yes ☐ No



The above information is a true statement of the extent to which the above numbered permit has been developed.

6-11-84  
Date



Sandy Stacey  
Signature of Permit Holder

Parkwood Acres Water Co., Inc.  
c/o 140 Parkwood  
Rigby, ID 83442

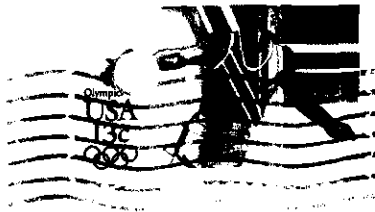


JUN 25 1984

IDAHO DEPARTMENT OF WATER RESOURCES

STATEHOUSE

Department of Water Resources  
BOISE, IDAHO 83720



S T A T E O F I D A H O  
DEPARTMENT OF WATER RESOURCES

---

STATEHOUSE  
BOISE, IDAHO 83720  
(208) 334-4440  
CERTIFIED MAIL  
138740

PARKWOOD ACRES WATER COMPANY, INC.  
C/O SANDY STACEY  
140 PARKWOOD DR.  
RIGBY, ID 83442

PROOF DUE NOTICE

MAY 31, 1984

DEAR PERMIT HOLDER:

ONE OF THE CONDITIONS OF APPROVAL OF YOUR WATER PERMIT NO. 25-7175 WAS THAT PROOF OF THE EXTENT OF YOUR BENEFICIAL USE MUST BE SUBMITTED TO THIS OFFICE ON OR BEFORE AUGUST 01, 1984. (SEE LAST PAGE OF YOUR APPROVED PERMIT OR YOUR LAST APPROVED EXTENSION REQUEST). ENCLOSED IS A POSTCARD WHICH MAY BE USED TO SUBMIT THE REQUIRED PROOF.

IF YOU HAVE NOT FULLY COMPLETED YOUR PROJECT, AND YOU OR A PREVIOUS OWNER OF THIS PERMIT HAVE NOT RECEIVED A PRIOR EXTENSION OF TIME, YOU MAY REQUEST AN EXTENSION OF TIME IF THE DELAY IS FOR REASONABLE CAUSE AS PROVIDED IN SECTION 42-204, IDAHO CODE. IF YOU HAVE BEEN PREVENTED FROM PROCEEDING BY A GOVERNMENTAL AGENCY OR BY LITIGATION, MORE THAN ONE EXTENSION OF TIME CAN BE GRANTED. AN EXTENSION OF TIME REQUEST FORM IS ENCLOSED FOR YOUR CONVENIENCE.

EITHER THE BENEFICIAL USE POSTCARD OR A REQUEST FOR AN EXTENSION OF TIME MUST BE RECEIVED BY THIS DEPARTMENT ON OR BEFORE THE ABOVE DESCRIBED PROOF DUE DATE. IF NEITHER IS RECEIVED, THE DEPARTMENT WILL SEND YOU A LAPSE NOTICE. WITHIN SIXTY (60) DAYS OF THE MAILING OF THE LAPSE NOTICE, THE PERMIT WILL NO LONGER BE OF ANY FORCE NOR EFFECT.

SINCERELY,

RITA FLECK  
SECRETARY/RECORDS MANAGER

ENCLOSURES

11/27/84

IDENT. NO. 25-7175

I D A H O   D E P A R T M E N T   O F   W A T E R   R E S O U R C E S

WATER RIGHT  
DATA ENTRY LOG

[illegible]



State of Idaho  
**DEPARTMENT OF WATER RESOURCES**  
STATE OFFICE, 373 W. Franklin Street, Boise, Idaho

JOHN V. EVANS  
Governor

C. STEPHEN ALLRED  
Director

Mailing address:  
Statehouse  
Boise, Idaho 83720  
(208) 384-2215

August 31, 1979

Parkwood Acres Water Company, Inc  
c/o Sandy Stacey  
140 Parkwood Dr.  
Rigby, Idaho 83442

Dear Sirs,

RE: Permit No. 25-7175

Enclosed is a copy of your approved Application for Permit. We direct your attention to the conditions of approval as listed on the fourth page.

Sincerely,

DAVID R. TUTHILL, JR.  
Supervisor, Water Allocations Section

DRT:lr

Enclosure

**MICROFILMED**



# STATE OF IDAHO

**RECEIVED**

JUL 27 1979

## DEPARTMENT OF HEALTH AND WELFARE

Department of Water Resources  
Eastern District Office

DIVISION OF ENVIRONMENT  
636 Pershing  
Pocatello, Idaho  
83201

26 July 1979

Parkwood Acres Water Co., Inc.  
140 Parkwood Drive  
Rigby, Idaho 83442

Re: Application #25-7175  
(Jefferson County)

Gentlemen:

We have been advised of your intent to appropriate the public waters of the State of Idaho to supply domestic water to 24 families.

Title 39-100 of the Idaho Code defines public water systems as a source of domestic water for ten or more separate premises or households; further, the statute requires that plans and specifications for public water facilities must be reviewed and approved by this Department prior to construction.

Operation and maintenance of the public water system must conform to the Idaho Regulations for Public Drinking Water, copy of which is enclosed for your information.

If you have any questions regarding the requirements, please do not hesitate to contact our office.

Yours very truly,

Robert L. Wheeler, P.E.  
Environmental Engineer

RLW/md

Enc.

CC: Ron Carlson

EQUAL OPPORTUNITY EMPLOYER

**MICROFILMED**

July 17, 1979

Henry Moran  
Public Health Engineer  
Dept. of Health & Welfare  
636 Pershing  
Pocatello, Idaho 83201

Dear Mr. Moran:

Re: Application for Permit No. 25-7175

We are enclosing a copy of an application that may be of interest to your agency. Please review the application and submit any comments you may have to our Department as soon as possible. The last date of protest is August 6, 1979 and we are required to take final action shortly thereafter.

If we may be of further assistance, please feel free to contact our eastern regional office.

Very truly yours,

RONALD D. CARLSON  
Supervisor  
Eastern Region

RDC:dh

Enclosure

S T A T E   O F   I D A H O  
DEPARTMENT OF WATER RESOURCES  
Eastern Region

---

1515 Lincoln Road  
Idaho Falls, Idaho 83401  
(208) 523-7186

JULY 13, 1979

The Risby Star  
P. O. Box 37  
Risby, Idaho 83442

Gentlemen:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. We have allowed ample time for you to submit a galley proof to this office for review before the first publication date. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billings to this office before AUGUST 6, 1979.

Yours truly,

RONALD D. CARLSON  
Supervisor  
Eastern Region

Encl.

ENCLOSURE

NOTICE OF APPLICATION FOR WATER RIGHT

Notice is hereby given that the following application(s) have been submitted for permit to appropriate the public waters of the State of Idaho:

25-2175-

PARKWOOD ACRES WATER COMPANY, INC.

% SANDY STACEY, 140 PARKWOOD DRIVE, RIGBY, ID 83442

Source: GROUNDWATER

Date Filed: 07/03/1979

Amount: 0.50 CFS

Diversion Point: SESE Sec 26 T 04N R 38E, JEFFERSON Co.

Use: DOMESTIC (0.50 CFS) from 01/01 to 12/31

Place of Use: SESE Sec 26 T 04N R 38E

Diversion Means: WELL, PUMP & PIPELINE

If issued, the permit(s) will be subject to all prior water rights. Protests against the granting of any permit must be filed with the Director of the Idaho Department of Water Resources, 1515 Lincoln Road, Idaho Falls, Idaho 83401 on or before AUGUST 6, 1979.

C. STEPHEN ALLRED

Director

Published 7/19 & 7/26/79.

**MICROFILMED**

State of Idaho  
Department of Water Resources

APPLICATION FOR PERMIT ANALYSIS SHEET

INITIAL REVIEW BY: Norris M. Duran

APPLICATION NUMBER: Parkwood Area  
Water Co., Inc.

CHECK:

- ☒ Source.  
☒ Point of diversion.  
☒ County.  
☒ Description of diverting works.  
☐ Time required for beneficial use of water.  
☒ Place of use or acres irrigated.  
☒ Map.  
☒ Signature.  
☒ Fee.  
☐ Yes ☒ No Field check required.  
☐ Yes ☒ No Critical groundwater area.  
☐ Yes ☒ No Request dam safety information. Sent by: \_\_\_\_\_ Date: \_\_\_\_\_  
☒ Yes ☐ No\* In form to receipt.

Field check by: \_\_\_\_\_

Date: \_\_\_\_\_

Comments: \_\_\_\_\_

\*REQUEST THE FOLLOWING ADDITIONAL INFORMATION FROM THE APPLICANT: \_\_\_\_\_

positions of the applicants within the association

SEND COPIES TO:

- ☒ Idaho State Health Department.  
☐ Idaho Fish and Game Department.  
☐ Idaho Department of Lands.  
☐ U.S. Bureau of Land Management.  
☐ U.S. Forest Service.  
☐ Other \_\_\_\_\_

Copies sent by: DH Date: 7-19-79

PROCESSING:

- ☐ Yes ☐ No Platted by: DMD Map No. X-43  
☐ Yes ☒ No Other rights on same place of use: (25-7064) Lapsed  
☐ Yes ☐ No\* In form for advertising.  
☐ Yes ☒ No Final date for protests: AUGUST 16, 1979  
☐ Yes ☒ No Protests received. If yes, record information on 4th page of application.

FINAL REGIONAL PROCESSING REVIEW:

- ☒ Affidavit of publication received. Date: AUGUST 14, 1979  
☐ Application published correctly. If not, record action taken: \_\_\_\_\_  
☒ Fee amount, receipt date & number, recorded on application.  
☒ Publication dates and paper, recorded on application.  
☐ Protests, dates, withdrawal, etc., recorded on application.  
☒ Recommendation & initial, recorded on application.  
☐ Yes ☒ No Measuring device required.  
☐ Yes ☒ No Access port required.  
☐ Yes ☒ No Will water be delivered by watermaster? If yes, what district? \_\_\_\_\_  
☒ 7/3/79 Date of priority recommended.  
Special conditions of approval or cover letter. \_\_\_\_\_

By: Ernest Carlson

Date: 8/24/79

STATE OFFICE REVIEW:

04,  
Short letter w/o condition

- ☐ See attached sheet for more information.

By: Jim

Date: 8/29/79

RECEIVED

AUG 27 1979

Department of Water Resources