

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
JAN 15 1991

Department of Water Resources

A. GENERAL INFORMATION


1. Owner: Riverview Subd. Water Assoc. Permit No. 63-09171
Current Address: HC 87 Box 251 Pine, ID 83647 Phone No. 658-2438
2. Accompanied by: Frank Seibert EXAM. DATE: 11/16/89
Address: as above Phone No. as above
Relationship to Permit Holder: Vice-President
3. Source: groundwater tributary to _____

B. OVERLAP REVIEW

1. Other water rights with same place of use: 63-04284, 63-07835, 63-07943, 63-05163, 63-07746, 63-03470, 63-07856 ☐ Copies Attached
2. Other water rights with same point of diversion: 63-04284, 63-07835, 63-07943 ☐ Copies Attached ☐ Copies of Field Exam's Attached

C. SYSTEM DESCRIPTION

1. **Diversion System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☐ Alternative diagram attached

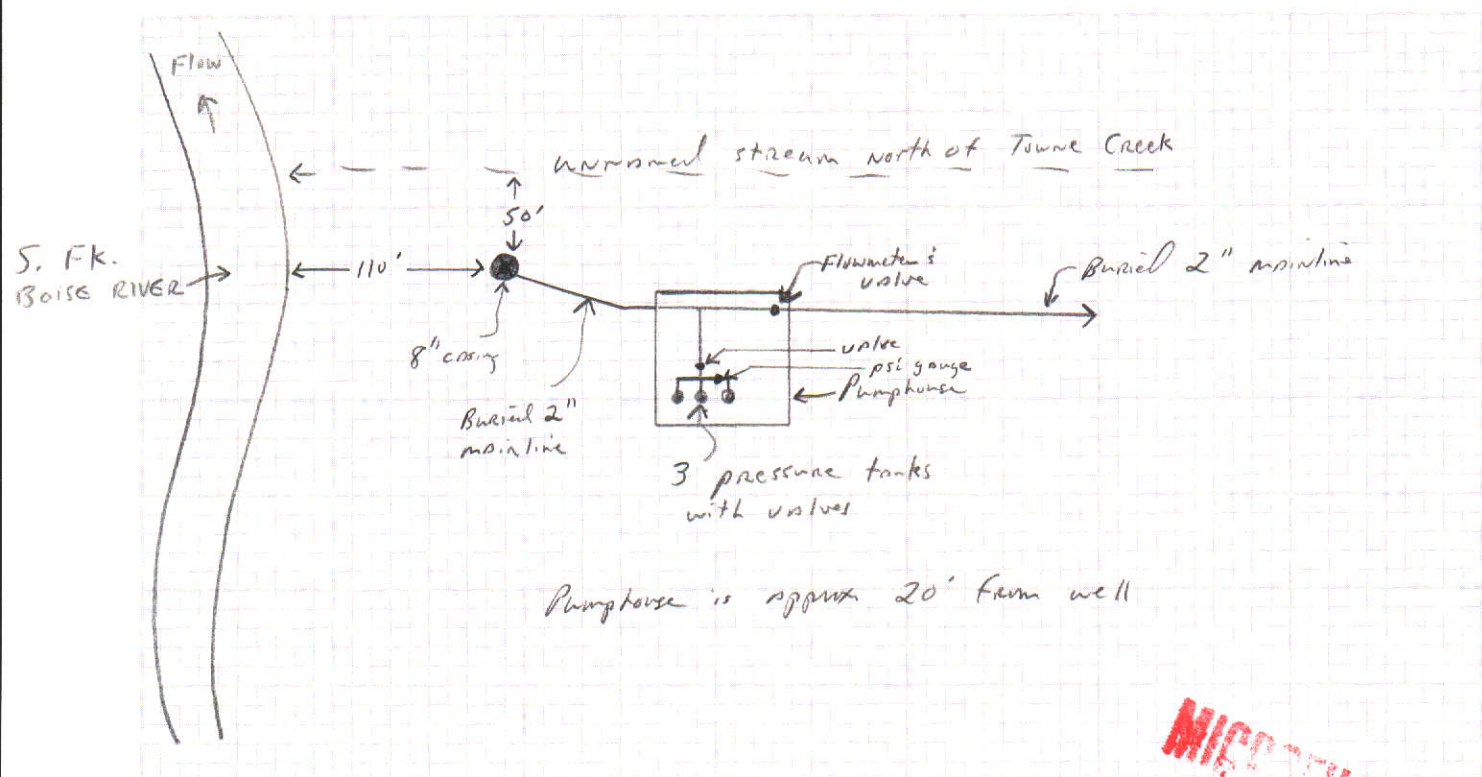

Scale: 1" = NOT TO SCALE


2. ☒ Copy of U.S.G.S. Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required). ☐ Aerial Photo Attached (required for irrigation of 10 acres or more).
☒ Photo of Diversion and System Attached (required for all but single household domestic groundwater, and stockwater).

RECEIVED
FEB 10 1992

T2N
R10E
S.18

NORTH

S.19

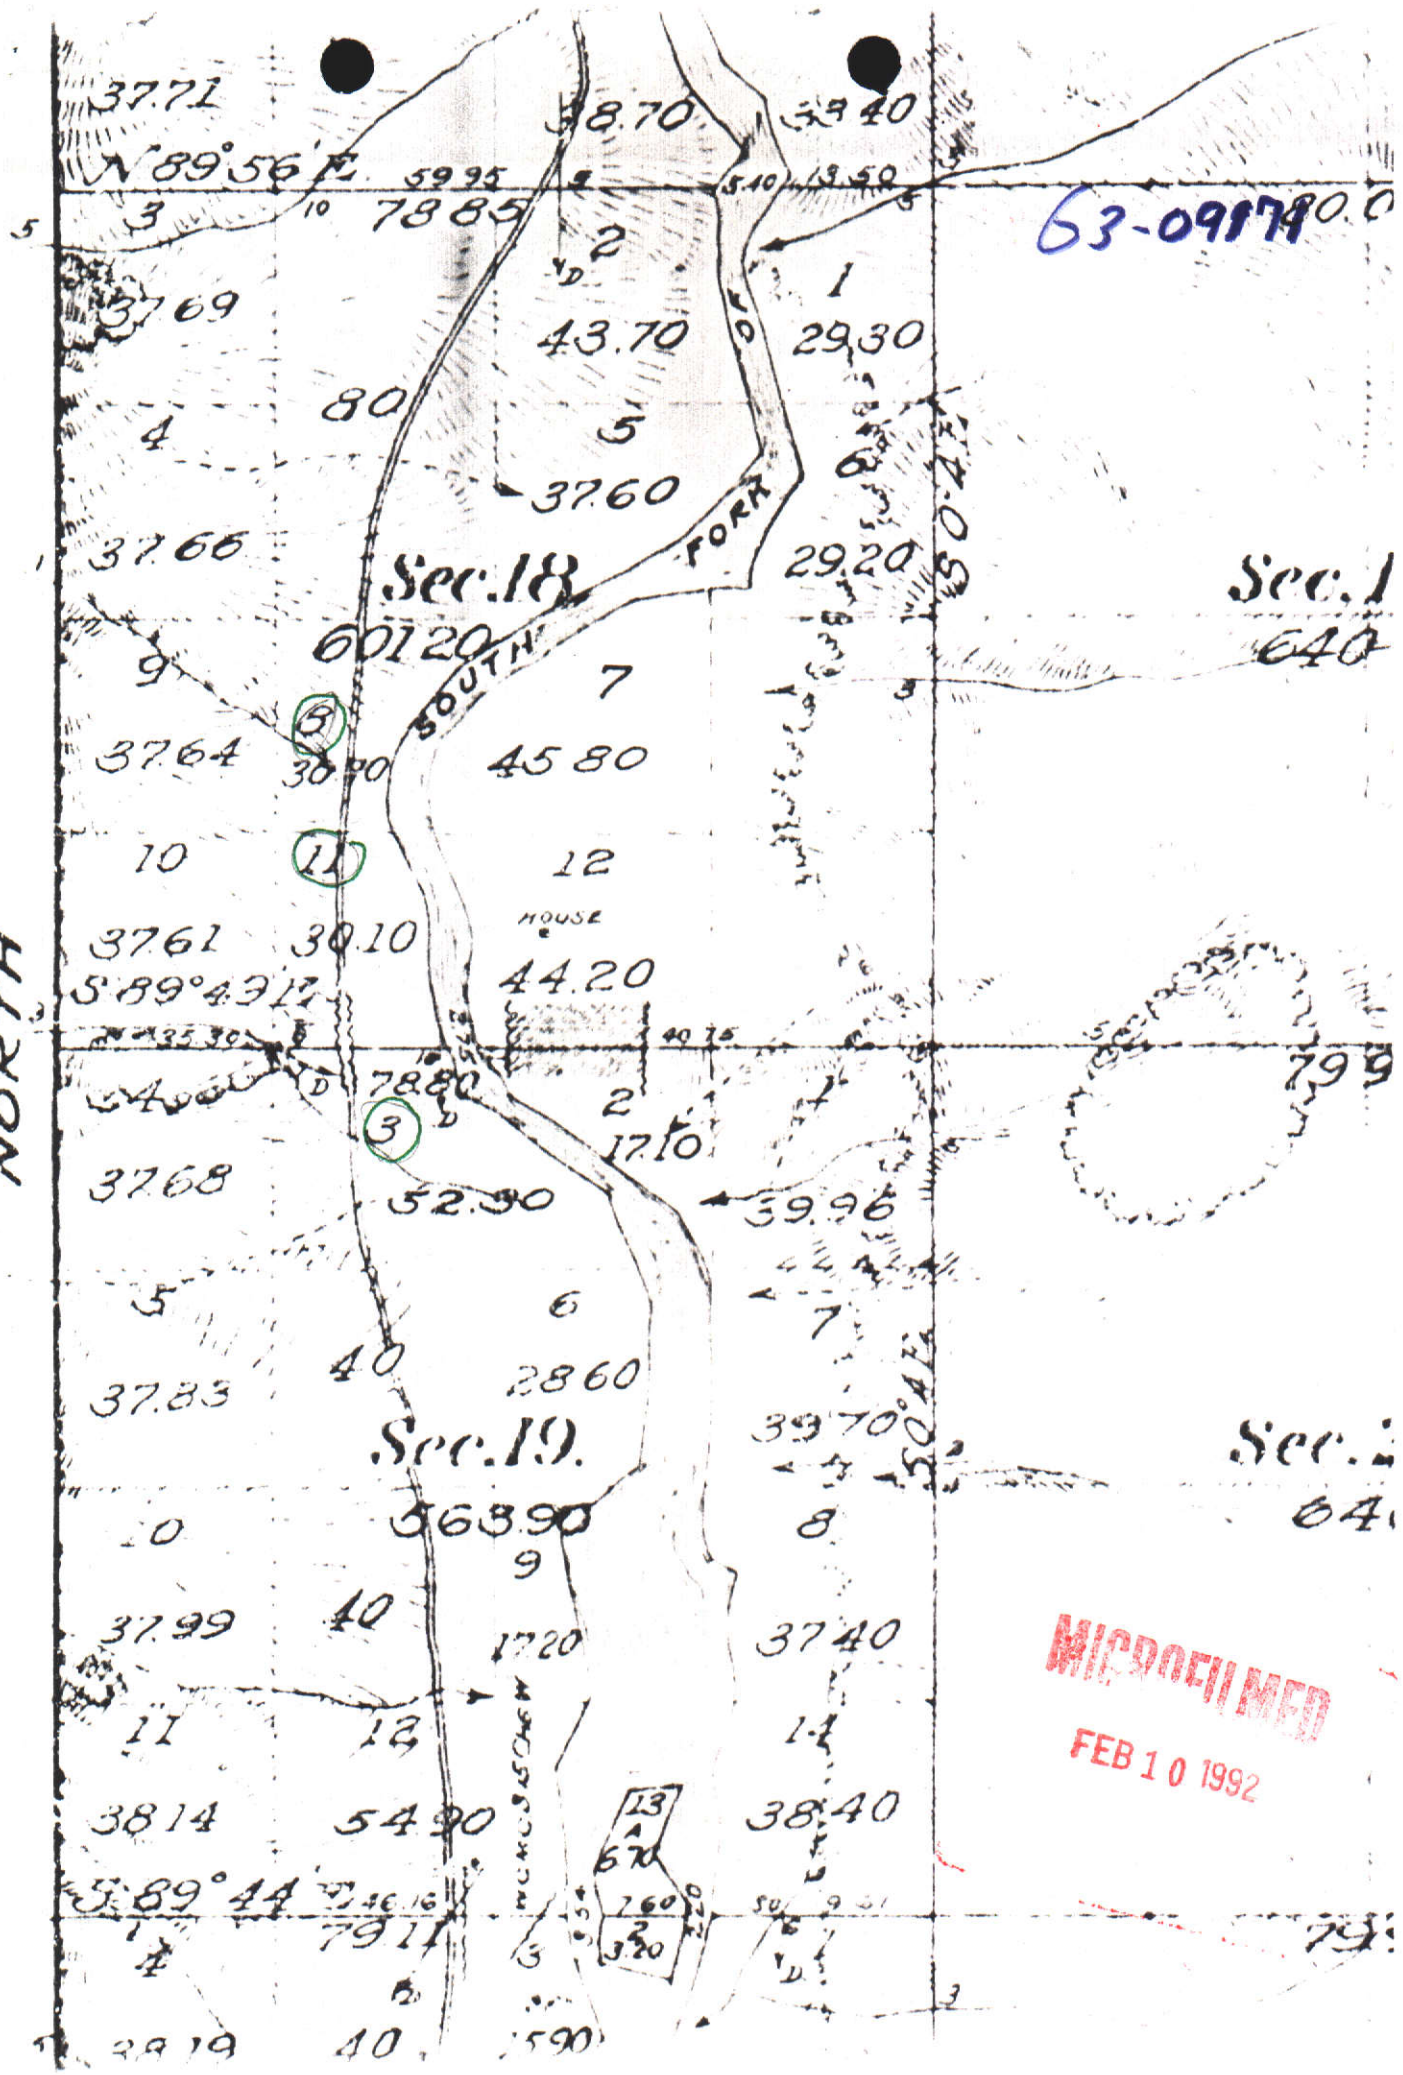

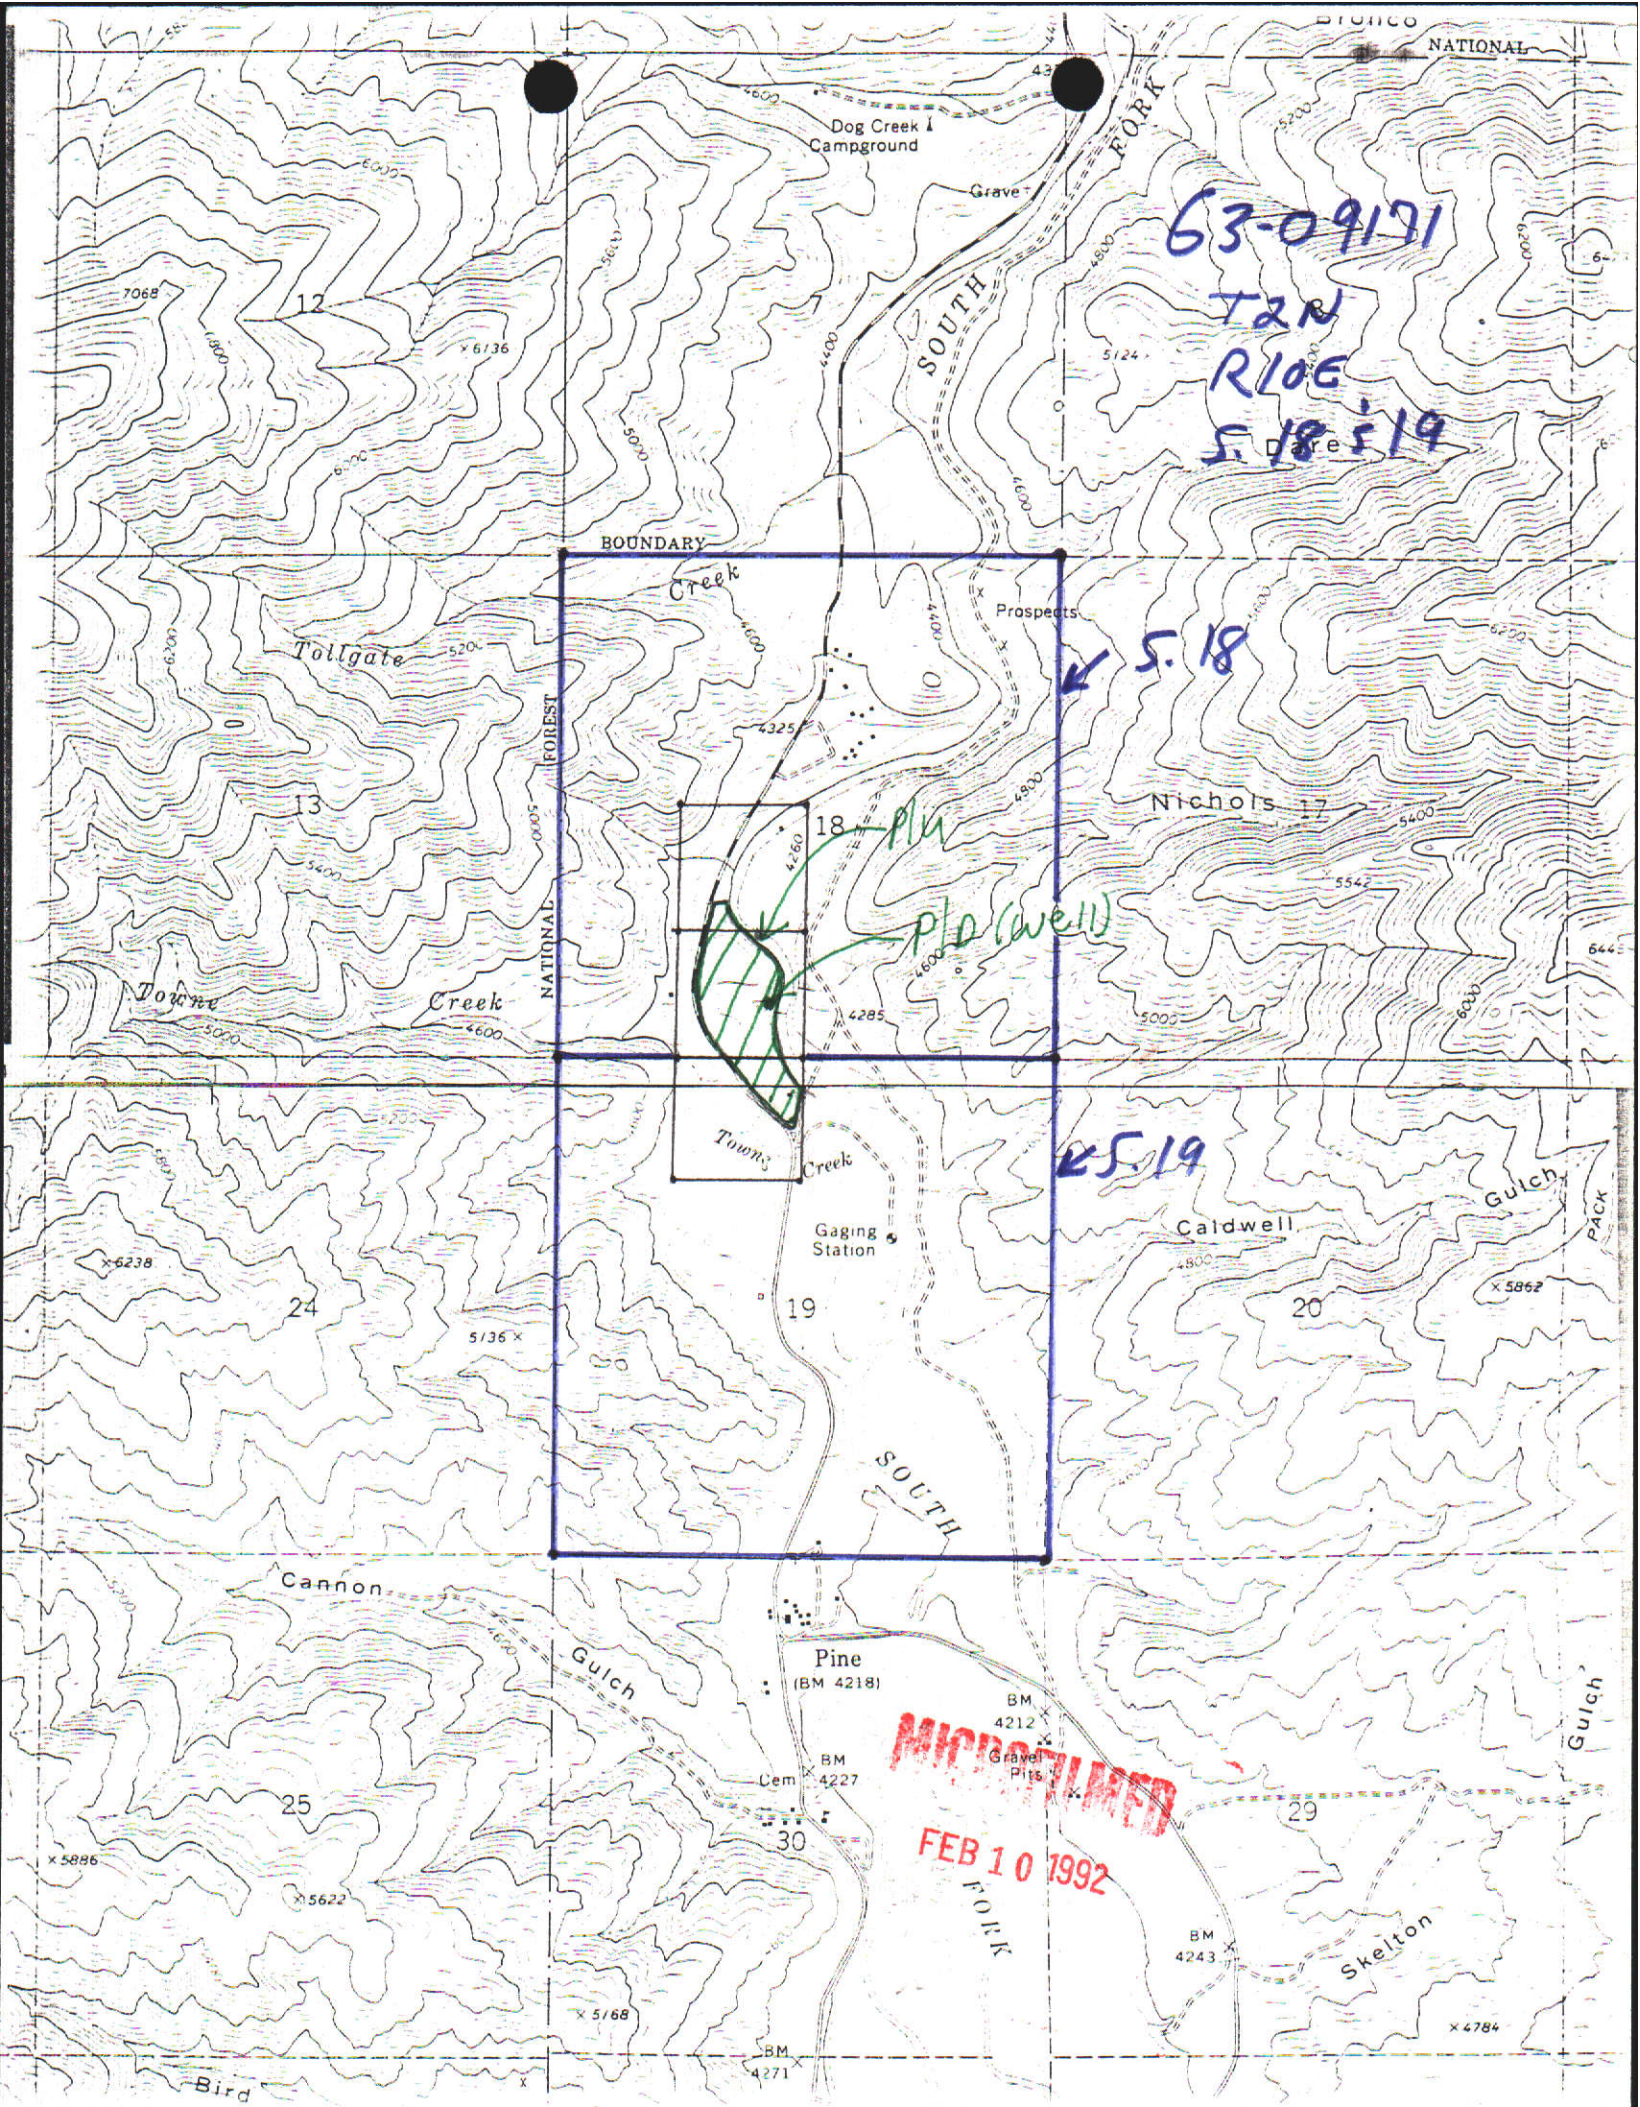


PHOTO ONE-

Point of Diversion
8" well &
pumphouse with 3
pressure tanks.

>



Place of Use
typical home's
yard shown

RECEIVED
FEB 10 1992

PHOTO TWO-



9-10-11
ad
Chambers

✓



ACCOUNT PAID TO

ADDRESS *mt Hanco*
Rat 511

NAME *Henry Knight, Jr.*
Carr, Willis
Renewal Sub. Water Pump
FIRST READING *659*

329.2
ACCOUNT NO.

REMARKS	READINGS	KWH USED	V	NET SALE	SALES TAX	ARREARS	PEN-ALTY	GROSS BILL	AMOUNT PAID	DATE PAID	BALANCE DUE
	1024 4925										
	e 0025	100		8.00		113.45					
	e 0125	100		8.00		121.45					
	e 0225	100		8.00		129.85	40	129.85			
	e 0325	100		8.00		138.25	40				
	R 1192	867		30.27		146.25			138.25	5-7-75	
	e 1292	100		8.00		382.7					8.00
	e 1343	50		8.00		8.00			382.7	6-9-75	
	e 1449	100		8.00		8.00	4.00		12.00	7-10-75	
	e 1543	100		8.00		10.00					
	R 2085	541		24.53		40.53			40.53	10-30-75	
	R 2214	131		10.48		8.00			10.48	11-18-75	
	e 2314	100		8.00		10.48			8.00	12-30-75	
	e 2414	100		8.00		8.00					

REMARKS

also get membership - bill 11/15/75 paid 11-18-75

MICROFILMED

NOV 20 1989

NOV 10 1989

RECEIVED

18
b c d
J F M A M J J A S O N D
ACCOUNT PAID TO

ADDRESS Mountain Home Idg
Box 511 126 Barber Rd
FIRST DATE 2-28-76 83647

NAME Riverview Sub Water Assoc
26 Henry Light Cemetery Causeway
FIRST READING 659
Teas

READING DATE		DUE DATE		DELINQUENT DATE		DELINQUENT RATE							
DATE READ	REMARKS	READINGS	KWH USED	V	NET SALE	SALES TAX	ARREARS	NET BILL	PEN-ALTY	GROSS BILL	AMOUNT PAID	DATE PAID	BALANCE DUE
Jan		C 2414					800						
Feb		C 2514	100		800		1600						
Mar		C 2614	100		800		800	1600					
April 9		R 5574	2860	5432			2400						
May		C 2714	100		800								
June		C 5774	100		800		800						
July 16		R 6414	640	2664			1600						
Aug		C 6669	255	1738			2624						
Sept		C 6869	260	1600			4382						
Oct		C 6769	100	800			3338						1738
Nov 17-18		R 7302	533	2433			4138						
Dec		C 7402	100	800			2443						
TOTAL							3233						

MICROFILMED

NOV 20 1989

METER RECORD				DEPOSIT DATA				SHUT OFF RECORD	
NUMBER	AMPS	DATE SET	DATE REMOVED	NUMBER	AMOUNT	DATE ISSUED	DEBIT	DATE RETIRED	DATE SHUT OFF

RECEIVED
NOV 06 1989
DEPARTMENT OF WATER RESOURCES

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 63-09171

Priority: October 6, 1989

Maximum Diversion Rate:

0.22 CFS

Maximum Diversion Volume:

72.0 AF

This is to certify, that RIVERVIEW SUBDIVISION WATER ASSN.

HC 87 BOX 251

PINE ID 83647

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated August 16, 1978; and has submitted Proof of Beneficial Use on October 6, 1989. An examination indicates that the works have a diversion capacity of .220 cfs of water from a GROUNDWATER source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	0.22 CFS	72.0 AF

LOCATION OF POINT(S) OF DIVERSION:

SESW, Sec. 18, Township 02N, Range 10E
ELMORE County

PLACE OF USE: DOMESTIC
TWN RGE SEC

02N 10E 18 Lot 8(NESW) Lot 11(SESW)
19 Lot 3(NENW)

CONDITIONS/REMARKS:

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. Domestic use is for 23 homes within Riverview Subdivision.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. Witness the seal and signature of the Director, affixed at Boise, this 30TH day of JANUARY, 1992.

Acting for

R. Keith Higginson, Director

FEB 10 1992

BEFORE THE DEPARTMENT OF WATER RESOURCES
OF THE
STATE OF IDAHO

IN THE MATTER OF PERMIT	)	
	)	
NO. 63-9171, IN THE NAME OF	)	ORDER OF REINSTATEMENT
	)	
RIVERVIEW SUBDIVISION WATER ASSN.	)	

This matter having come before the Idaho Department of Water Resources (Department) the Department finds as follows:

FINDINGS OF FACT

1. On December 18, 1978 the Director of the Department of Water Resources issued Permit No. 63-9171 with a condition of approval that proof of construction of works and application of water to beneficial use be submitted on or before January 1, 1980.
2. On October 31, 1979 the Department sent a proof due notice to the permit holders.
3. On January 7, 1980 the Department sent a lapse notice to the permit holders since neither proof of beneficial use nor a request for extension of time had been received from the permit holders.
4. On October 6, 1989 Proof of Beneficial Use was received by the Department from the permit holders.
5. Section 42-218a, Idaho Code, authorizes the Department to reinstate a lapsed permit, with the priority date advanced to the date that proof of beneficial use was received, upon submittal of evidence clearly establishing the extent of beneficial use prior to the proof due date and a showing of reasonable cause why the proof was submitted late.

MICROFILMED

NOV 20 1989

6. The permit holders submitted evidence to confirm that water has been put to beneficial use. These documents include electric service meter readings and billing statements for the groundwater well pump from 1975 thru 1978, and a 1975 invoice for a five horsepower well pump motor billed to the permit holders.

7. The permit holders have stated that they believed proof had previously been filed and were therefore unaware of any action required on their part.

CONCLUSIONS OF LAW

1. The permit holders have submitted proof of beneficial use along with supporting evidence which establishes that water was in fact beneficially used as identified on the permit.

2. The permit holders have shown sufficient cause why the proof of beneficial use was not submitted in a timely manner.

3. The permit can be reinstated with the date of priority advanced to the date proof of beneficial use was received by the Department.

ORDER

IT IS HEREBY ORDERED that Permit No. 63-9171 is reinstated.

IT IS FURTHER ORDERED that the date of priority of this permit is advanced to October 6, 1989.

Dated this 3rd day of November, 1989.


L. GLEN SAXTON
Chief, Operations Bureau

RECEIVED
OCT 10 1989

Identification No. _____
Application No. 63-9171

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR PERMIT

APPROVED

To Appropriate the Public Waters of the State of Idaho
(TYPE OR PRINT IN INK)

1. Name of applicant Riverview Subdivision Water Assoc. Phone: _____
post office address P.O. Box 511, Mountain Home, Idaho 83647
2. Source of water supply Underground which is a tributary of _____
3. a. Location of point of diversion is SE $\frac{1}{4}$ of SW $\frac{1}{4}$ of Section 18 Township 2N
Range 10E B.M. Elmore County: additional points of diversion if any: _____
- b. If water is not consumed, it will be discharged into _____ at a point in _____ $\frac{1}{4}$ of _____ $\frac{1}{4}$ of Section _____ Township _____ Range _____ B.M. _____
4. Water will be used for the following purposes:
Amount 0.75 for Domestic purpose from Jan. 1 to Dec. 31 (both dates inclusive)
Amount _____ for _____ purpose from _____ to _____ (both dates inclusive)
Amount _____ for _____ purpose from _____ to _____ (both dates inclusive)
5. Total quantity to be appropriated:
a. 0.75 cubic feet per second and/or
b. _____ acre feet per annum.
6. Proposed diverting works:
a. Description of ditches, flumes, pumps, headgates, etc. Estimated 60' deep well with 8-inch diameter perforated casing; well is equipped with a 5 horsepower submersible pump set at approximately 40 feet.
- b. Height of storage dam N/A feet, active reservoir capacity _____ acre feet; total reservoir capacity _____ acre feet, materials used in storage dam: _____
Period of year during which storage will occur _____ to _____ (Mo. Day) (Mo. Day) inclusive.
Existing Existing well diameter is 8 inches; proposed depth of well is 60 feet.
7. a. Time required for the completion of the works and application of the water to the proposed beneficial use is 0 years. Well is already constructed and being utilized to supply domestic water to Riverview Subdivision
b. Estimated construction cost is \$ 8,000
8. Description of proposed uses:
a. If water is not for irrigation:
(1) Give the place of use of water: SE $\frac{1}{4}$ of SW $\frac{1}{4}$ of Section 18 Township 2N
Range 10E B.M. and NE $\frac{1}{4}$ of NW $\frac{1}{4}$ of Section 19, T. 2N., R. 10E, B.M.
(2) Amount of power to be generated N/A hp under _____ feet of head
(3) List number of each kind of livestock to be watered N/A
(4) Number of municipality to be served _____ or number of families to be supplied with domestic water 60
(5) If water is to be used for other purposes describe None

b. If water is for irrigation, indicate acreage in each subdivision in the tabulation below

[illegible]


Total number of acres to be irrigated

c. Describe any other water rights used for the same purposes as described above. None

9. a. Who owns the property at the point of diversion Applicant
b. Who owns the land to be irrigated or place of use Property Owners within Riverview Subdivision
c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing All property owners within Riverview Subdivision are members of the Riverview Subdivision Water Association.

10. Remarks: The well for which this application pertains is already constructed and has been in service for approximately 7 years. This well was drilled by the developer of the Riverview Subdivision, Willis Carrie, in 1970, and as far as we can determine he never had a well log prepared for it nor did he apply for a water right. The property owners within the Riverview Subdivision were not satisfied with the manner in which Mr. Carrie operated the water system so they formed a water association and obtained said system from Mr. Carrie. Consequently, the Riverview Subdivision Water Association is making application herewith for a water right on the existing well.

11. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

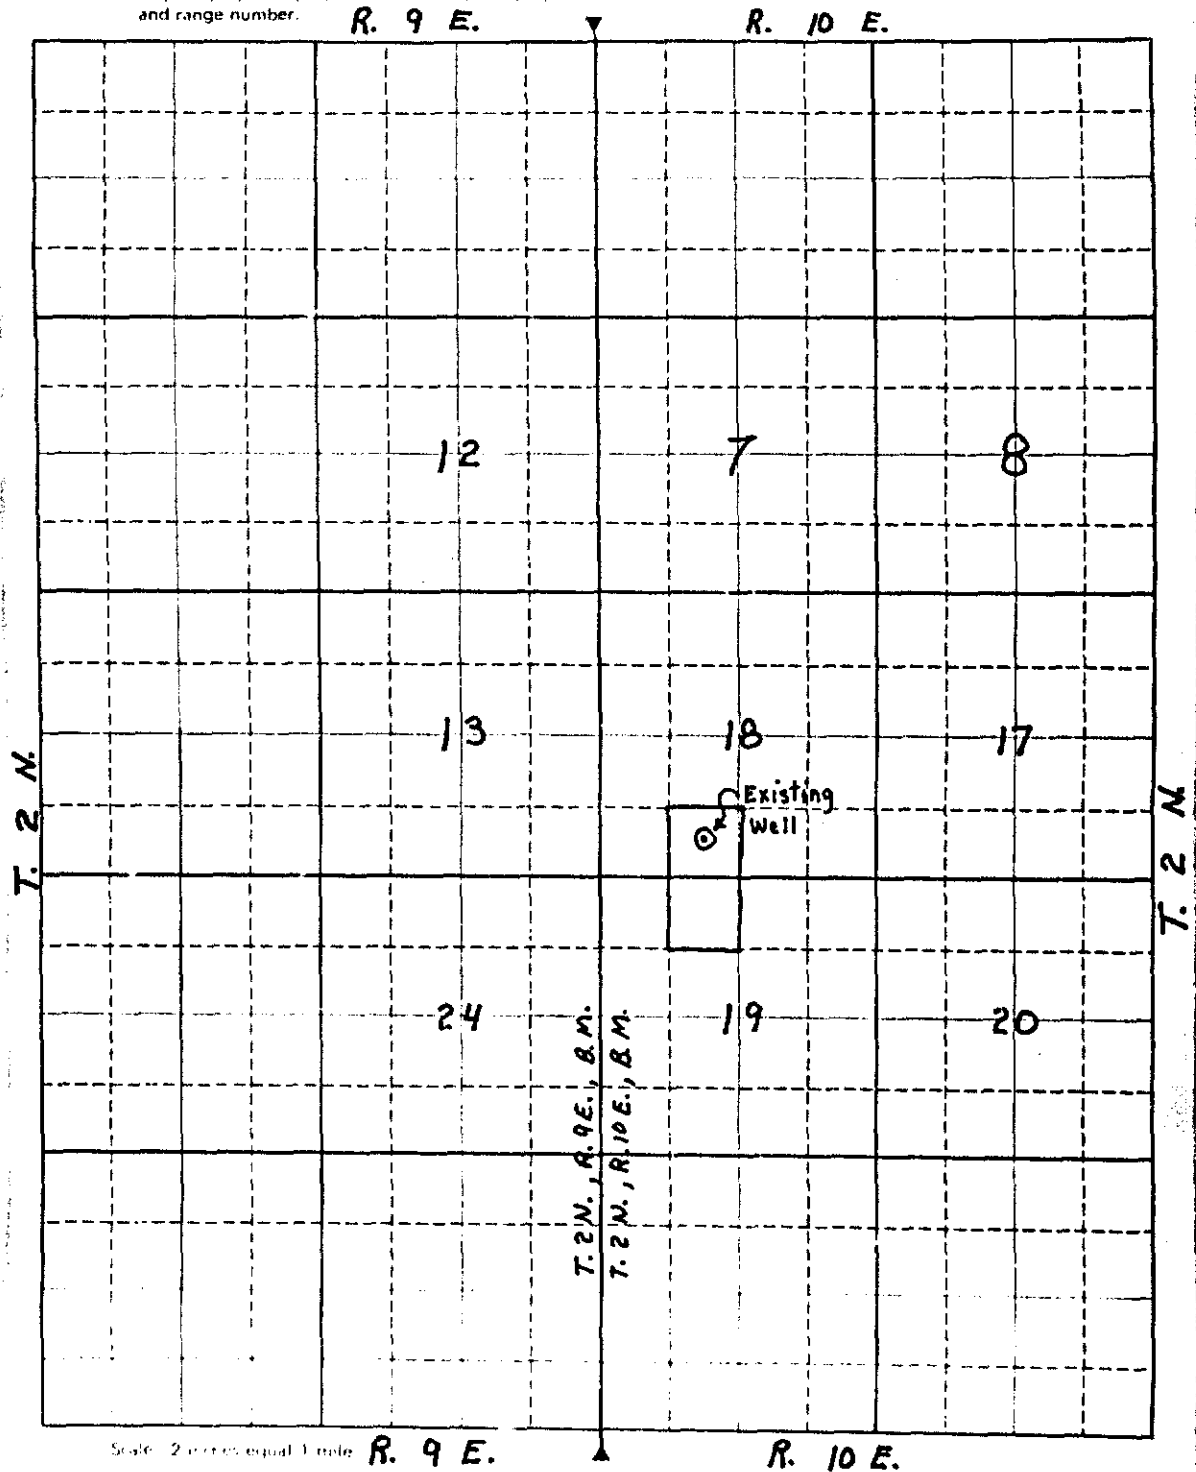

Scale: 2 inches equal 1 mile

BE IT REMEMBERED that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth

Frank N. Kamphaus
(Applicant) President

Proposed Priority 8-16-78

Received by DBS Date 7-26-78 Time 11:16 a.m.

Preliminary check by W. H. Fee \$ 35.00

Received by ST Date 8-16-78 # 12401

Publication prepared by ST Date 8-17-78

Published in Mountain Home News

Publication dates 8/24/78 8/24 9/2

Publication approved by ST Date 8-17-78

Priority reduced to Reason

Protests filed by

Copies of protests forwarded by

Hearing held by Date

Recommended for approval denial by DBS SS

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. 63-9171, and said application is hereby APPROVED.

1. Approval of said application is subject to the following limitations and conditions:

a. SUBJECT TO ALL PRIOR WATER RIGHTS.

b. Proof of construction of works and application of water to beneficial use shall be submitted on or before January 1, 19 80.

c. Other: The issuance of this permit in no way grants any right-of-way or easement across the land of another.

2. Denial of said application is for the following reasons:

Witness my hand this 18 day of December, 19 78.

L. Glen Saxton

Chief, Operations Bureau

**NOTICE OF APPLICATION
FOR WATER RIGHT**

Notice is hereby given that the following application has been submitted for permit to appropriate the public waters of the State of Idaho:

61-7372

Name: BROKEN ARROW FARMS, INC.

Address: 849 SHERMAN WAY, NAMPA, ID 83606

Source: GROUNDWATER

Date Filed: 06/24/1978

County: ELMORE

Amount: 0.04 CFS

Point of Diversion: NESW 806 T06S R06E

Use: DOMESTIC from 01/01 to 12/31

Place of Use: NESW 806 T06S R06E

Means: WELL AND PUMP

If issued, the permit will be subject to all prior water rights. Protests against the granting of any permit must be filed with the Director of the Idaho Department of Water Resources, 92 S. Cole Road, Boise, Idaho 83706 on or before Sept. 18, 1978.

C. STEPHEN ALLRED
Director

Published in the Mountain Home News on August 31, 1978 and Sept. 7, 1978.

**NOTICE OF APPLICATION
FOR WATER RIGHT**

Notice is hereby given that the following application has been submitted for permit to appropriate the public waters of the State of Idaho:

63-9171

Name: RIVERVIEW SUBDIVISION WATER ASSN.

Address: P.O. BOX 511, MOUNTAIN HOME, ID 83647

Source: GROUND WATER

Date Filed: 07/26/1978

County: ELMORE

Amount: 0.75 CFS

Point of Diversion: SESW S18 T02N R10E

Use: DOMESTIC from 01/01 to 12/31

Place of Use: SESW S18 T02N R10E NENW S19 T02N R10E

Means: WELL, PUMP & PIPE-LINE

If issued, the permit will be subject to all prior water rights. Protests against the granting of any permit must be filed with the Director of the Idaho Department of Water Resources, 92 S. Cole Road, Boise, Idaho 83706 on or before September 11, 1978.

C. STEPHEN ALLRED
Director

Published in the Mountain Home News on August 31 and Sept. 7, 1978.

**NOTICE OF APPLICATION
FOR WATER RIGHT**

Notice is hereby given that the following application has been submitted for permit to appropriate the public waters of the State of Idaho:

63-9171

Name: RIVERVIEW SUBDIVISION WATER ASSN.

Address: P.O. BOX 511, MOUNTAIN HOME, ID 83647

Source: GROUND WATER

Date Filed: 01/20/1978

County: ELMORE

Amount: 0.75 CFS

Point of Diversion: SESW 516 TOWN RISE

Use: DOMESTIC from 01/01 to 12/31

Place of Use: SESW 516 TOWN RISE

SESW 516 TOWN RISE

Means: WELL, PUMP & PIPE

Remarks: The pump will be subject to all prior water rights.

Protests against the granting of any permit must be filed with the Director of the Idaho Department of Water Resources, 92 S. Cole

Road, Boise, Idaho 83706 on or before September 11, 1978.

C. STEPHEN ALLRED

Published in the Mountain Home News on August 31 and Sept. 7, 1978.

Affidavit of Publication

County of Elmore }
STATE OF IDAHO } ss.

I, Chas. A. Water do solemnly swear that I am the foreman, or publisher of the

MOUNTAIN HOME NEWS

a weekly newspaper of general circulation, published once a week at MOUNTAIN HOME, IDAHO, that the notice attached hereto and which is a part of the proof of publication thereof, was published in said newspaper for

....2.... consecutive weeks, the first publication having been made on the ...31.... day of ...Aug....., 1978, and the last publication having been made on the 1.... day of ...Sept..... 19.78....; every Thursday issue of the paper

during the period and time of publication and that the notice was published in the newspaper proper and not in a supplement thereof.

And I further swear that the said MOUNTAIN HOME NEWS has been continuously and uninterruptedly published in said Elmore County during a period of 78 consecutive weeks prior to the first publication of the attached notice.

Subscribed and sworn to me this 7th day of September, 1978.

Deane O. Klinger
Notary Public

MEMORANDUM

TO: File 63-9171

FROM: Sharla

DATE: March 18, 1992

RE: Telecon with Bob Walker (342-5454)

On this date, Bob Walker (Gilbert's brother) called in response to my letter of 3/2. They are going to install equipment to monitor the instantaneous demand of the subdivision.

He indicated that several of the home owners had their own wells to water their lawns. They will monitor the demand for several months (through the heavy summer season) and will contact me again at the end of the period. They are satisfied with the license as it has been issued and will determine what to do next after the monitoring.



State of Idaho
DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000
Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

March 2, 1992

RE: Water Right No. 63-9171

Gilbert C. Walker
Bell-Walker Engineers Inc.
827 LaCassia Dr.
Boise, ID 83705-2254

Dear Mr. Walker:

I have received your letter regarding the above referenced water right. Your estimated maximum instantaneous demand of 71.3 gpm for 60 lots is far below the standards we recognize for determining instantaneous demand. Photos taken by our examiner indicate that lawn watering may also be taking place. If this is the case, the instantaneous demand increases. I note that the source for your determination is a publication prepared by the Dept. of Social and Health Services from the State of Washington. It may be that Washington criteria is not applicable to Idaho.


You further stated that the current pumping capacity of the system is 42 gpm (0.09 cfs). How was this figure arrived at? Our examiner estimated the pumping capacity at a higher rate. You also mentioned that "the system will be upgraded in the future as demand dictates". Changes in the delivery system required to meet growth cannot be recognized under this right. While we do not advocate duplicate water filings, sometimes this cannot be avoided and will probably be necessary in this case.

If you have supporting information that can justify amending the license for the number of lots you propose to be served, I ask that you submit it for our consideration within 15 days. If you have any questions, please give me a call.

Sincerely,

A handwritten signature in cursive script that reads 'Sharla Curtis'. The signature is written in dark ink and is positioned above the typed name.

SHARLA CURTIS
Water Resource Agent



BELL-WALKER ENGINEERS Inc.

827 LaCassia Drive
Boise, ID 83705-2254

(208) 343-3609
FAX (208) 343-3572

RECEIVED
FEB 18 1992

February 14, 1992

Ms. Sharla Curtis
Water Right Agent
Idaho Department of Water Resources
1301 North Orchard Street
Statehouse Mail
Boise, ID 83720-9000

Department of Water Resources

RIVERVIEW SUBDIVISION
PERMIT NO. 63-9171

Dear Ms. Curtis:

In response to your January 9, 1992 letter regarding the proposed license to be issued on our water right, we have evaluated system demand against the 0.22 CFS capacity.

At system buildout of 60 lots, the maximum instantaneous demand is 71.3 GPM¹ for recreational development. The current water right of 0.22 CFS equates to 98.7 GPM, or approximately 38 percent greater than the maximum expected demand at buildout. At the present time, the pumping capacity of the system is 42 GPM, capable of meeting present demand.


The pumping system will be upgraded in the future as demand dictates. Previous well pump tests indicated that the existing source of supply is more than adequate to meet the ultimate demand.

If you have further questions regarding our position, please contact me at Bell-Walker Engineers, Inc., in Boise (343-3609) or Mr. Bob Walker at General Waterworks Corporation in Boise (342-5454).

We await your reply.

Sincerely yours,

BELL-WALKER ENGINEERS, Inc.

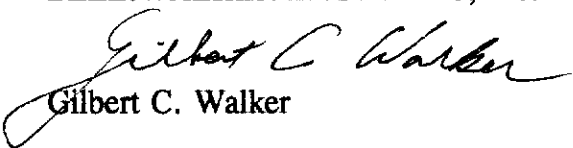
Gilbert C. Walker

c Frank Siebert
Riverview Subdivision Water Association
P.O. Box 251
Pine, ID 83647

January 31, 1992

RIVERVIEW SUBDIVISION WATER ASSN.
HC 87 BOX 251
PINE ID 83647

RE: WATER RIGHT NO. 63-09171

Dear Water Right Holder(s):

Enclosed herewith is a copy of the Water Right License issued on the above referenced permit.

Sincerely,

SHARLA CURTIS
Water Resource Agent

SC:blm

Enclosure

RECEIVED
FEB 0 1992



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

January 9, 1992

Riverview Subdivision Water Association
HC 87 Box 251
Pine, ID 83647

RE: Permit No. 63-9171

Gentlemen:

Enclosed is a draft copy of the license proposed to be issued on the above referenced water right.

Please note in remark no. 5 that domestic use is for the service of 23 homes within Riverview Subdivision. This is a reflection of the actual number of homes currently hooked to the system. While it was noted during the field examination that an additional 37 sites have stubbed lines, the 0.22 cfs capacity of the system does not warrant recognition of the additional lots at this time. In all likelihood, it will be necessary for you to upgrade your current system or to perhaps add one or more wells to provide the instantaneous demand of the additional homes as they are built and hooked to the system. When this occurs, it will be necessary for you to make a new filing for an application for permit to cover the additional homes and rate of diversion.

We ask that you review the proposed license and if you do not concur with the information, please let us know within ten (10) days.

Sincerely,

A handwritten signature in cursive script that reads 'Sharla Curtis'.

SHARLA CURTIS
Water Right Agent

SC:js

Enclosure

RECEIVED
FEB 10 1992

LICENSE REVIEW CHECKLIST

Permit No. 63-917

Name/Address change? ok ✓

Priority date Advance? yes no ✓

Memo to advance n/a
Order to reinstate needed? yes no ✓

Total cfs Limited by fee ✓

Limited by capacity ✓

Total volume Limited by flow ✓

Chart checked for AF rate/ac n/a

Capacity Actual measurement checked ✓

Theoretical checked ✓

If greater than permit, check for other rts n/a

Source Changed? yes no ✓
If so, is memo needed to clarify?

P/D Verify with map ✓ permit ✓
More than one per 44? Remember remark n/a
Check p/d overlap n/a

Uses Check irrigation period of use w/ chart n/a

P/U Verify with map ✓ permit ✓
> 5 acres irrigated, run overlap n/a

Remarks More than one p/d in 44 n/a
Description of non-irrig uses ✓
Special overlap condition n/a

Conditions -

Measuring device
W.Master control
Overlap
Water quality
Other

Dates/Misc. -

Water Dist n/a
App Rec'd ✓
Proof Rec'd ✓

CHECK FOR ADJ. CLAIM Needed according to proof filed
Filed - needs amended
Add'l fee required
Not filed
Not needed

Comments/Changes to Examiner's Recommendations: FEB 10 1992

License 10-day ✓ 30-day

Back of field report signed?
Reviewer Date Review time min.

219-S.A.
6/86

PD 2N 10E 5. 18 500V
PWS " 5. 18 500V
5. 19 NENW

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

63-09171
Permit No.

Staff Analysis Sheet
for
Beneficial Use Field Report

A. Prior to Conducting the Exam, the File Contains:

- ☒ Blank Field Report Form
- ☒ Copy of Permit
- ☒ Copies of any Amendments/Orders with conditions of approval
- ☒ Computer Data Proof Report
- ☒ Copy of U.S.G.S. Quad
- ☒ Check for Government Lots. If so, make a copy of Government Plat

*No mass device requirement
Note priority order to 10/6/89*

Check of P/D index SL 11/14/89 (Initial and date)
Overlap? ☒ yes ☐ no If yes: ☐ copy of exam(s) attached? N/A
Type of Overlap? ☐ Add acres or uses to existing system
☐ Increase rate of flow or volume
☒ Other: _____

NOTE
63-09171 is
not found in
pld & p/h
microfiche.

Check of P/U index SL 11/14/89 (Initial and date)
Overlap? ☒ yes ☐ no If yes: ☐ copy of water right(s) attached? N/A
Type of Overlap? ☐ Increase rate of flow or volume
☐ Add P/D's
☐ Increase number of acres within tracts
☒ Other: _____

Aerial Photo

Required? ☐ yes ☒ no If yes: ☐ copy attached?

Scheduling Letter sent? N/A (Initial and date)

☒ Appointment made and telephone conversation memo attached

B. After Conducting the Exam, the File Contains:

- ☒ Fully completed and signed Field Report Form
- ☒ Photographs of Point of Diversion and Place of Use
- ☒ Corrected Computer Data Proof Report with recommended license information, and date and signature of examiner.

C. Review and Processing:

Exam Completed John Lota 11/16/89 (Signature of examiner and date)
Exam Reviewed by Senior Water Resource Agent CH 12-27-90 (Initial and date)
Exam Reviewed by Manager of Regional Office Don 12/28/90 (Initial and date)
Exam Date Entered in Computer 1-14-91 st (Initial and date)
Exam sent to State Office 1-14-91 st (Initial and date)
Copy of Staff Analysis Sheet sent to Manager of Regional Office and Original
Refiled in White File _____ (Initial and date)

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
JAN 15 1991

Department of Water Resources

A. GENERAL INFORMATION


1. Owner: Riverview Subd. Water Assoc. Permit No. 63-09171
Current Address: HC 87 Box 251 Pine, ID 83647 Phone No. 653-2438
2. Accompanied by: Frank Seibert EXAM. DATE: 11/16/89
Address: as above Phone No. as above
Relationship to Permit Holder: Vice-President
3. Source: groundwater tributary to _____

B. OVERLAP REVIEW

1. Other water rights with same place of use: 63-04284, 63-07835, 63-07943, 63-05163, 63-07746, 63-03470, 63-07856 ☐ Copies Attached
2. Other water rights with same point of diversion: 63-04284, 63-07835, 63-07943 ☐ Copies Attached ☐ Copies of Field Exam's Attached N/A

C. SYSTEM DESCRIPTION

1. **Diversion System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☐ Alternative diagram attached

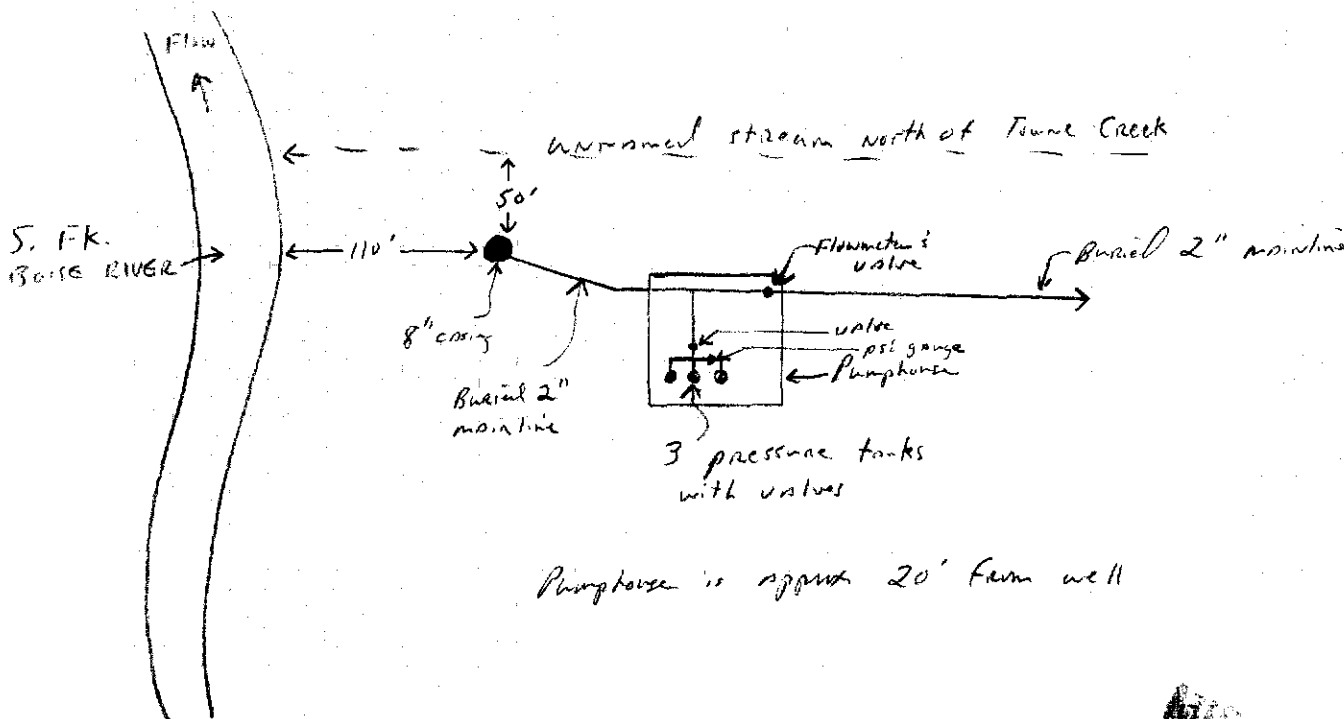

Scale: 1" = NOT TO SCALE

2. ☒ Copy of U.S.G.S. Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required). ☐ Aerial Photo Attached (required for irrigation of 10 acres or more).
☒ Photo of Diversion and System Attached (required for all but single household domestic groundwater, and stockwater).

RECEIVED
FEB 10 1992

System Description (continued)

3. Narrative: Description (As operating at time of measurement. Indicate pressure, number of sprinklers, etc.)

An 8" well estimated at 85' deep drilled around 1970 has a subm. 5 hp pump with a 2" i.d. mainline for a 2" & ~~1 1/2"~~ 1 1/2" distribution system in subdivision. 23 homes are found and an additional 37 sites have stubbed lines (total 60 sites). Intertown & external use occurs.

☐ See Remarks on page 4 for continuation

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
	UNKNOWN	5	UNKNOWN (NO TAG)	UNKNOWN Submersible	2" I.D. mainline

*Code to correspond with No. on map and aerial photo

5. Point(s) of Diversion:

Ident. No.	Gov't. Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
	11		SE	SW	18	2N	10E	Elmore	USGS 7 1/2' quad Lic. PID REC'D TO 20 BUT NOTE: WELL IN ^{SE} SESESW (110' W. of river and 50' N. of unnamed stream)

6. Place(s) of Use:

Indicate Method of Determination USGS 7 1/2' quad

Twp.	Rge.	Sec.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				Totals
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
2N	10E	18									2.8 0			2.11 0					—
		19					4.3 0												—

Do not use this space

D. FLOW MEASUREMENTS

☐ Additional Data Sheets Attached

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
McCrometer Flowmeter				77-2-269		

2. Measurements:

NO MEAS. POSSIBLE AS DIVERSION WAS NOT OCCURRING DURING EXPM.
 NORMAL PSI 55-75 (VIA PRESSURE TANK SYSTEM)

E. FLOW CALCULATIONS

☒ Additional Computation Sheets Attached

1. Measured Method: none possible

2. Alternate Method for Checking Purposes: 7
 Hp eq. when Hp = 5, eff. = 7
 psi = 2 =

$$Q = \frac{(8.8)(7)(5)}{(2.31 \times 1)} =$$

see attachment

F. PUMP EFFICIENCY DATA (Optional)

N/A

Discharge Pressure: _____ psi x 2.31 = _____ ft (1); Dynamic pumping level: _____ ft (2)

Total Head: (1) + (2) = _____ (3)

: Flow rate: _____ cfs (4)

Water HP: (3) x (4) ÷ 8.8 = _____ (5)

Meter Input KW: 3.6 x _____ KH x _____ CTR or _____ MULT x _____ PTR x _____ N/ _____ T = _____ (6)

Meter Input HP: (6) x 1.34 = _____ (7)

Panel Input KW: _____ Ave PF x _____ Ave Volts x _____ Ave Amps x .001732 = _____ (6)

Panel Input HP: (6) x 1.34 = _____ (7) Efficiency: (5)/(7) x 100 = _____ %

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation: N/A

$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$ _____

$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 =$ _____

$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$ _____

2. Volume Calculations for Other Uses:

$60 \times 1.2 = 72.0 \text{ AFA}$ (allow int. + ext. as implied by older style permit where lawn use not listed as irrigation)
 $(622)(365)(1.9835) = 159.3 \text{ AFA}$
 suggested limit by HP equation

FEB 10 1992

H. REMARKS AND OVERLAP REVIEW ANALYSIS

P/D L. 14, BL-1

P/W L. 1-38 BL. 1, L. 1-22 BL. 2, L. 1-5 BL. 3, L. 1-16 BL. 4 of Riverview Subd. (total lots = 81 but 60 sites provided for, some owners own > 1 lot).

BL. 1 & 2 in Riverview Subd. No. 1 & BL. 3 & 4 in Riverview Subd. No. 2.

Subd. plat map (3 pgs) will be kept in State office file.

Overlap -

All are other wells except 63-05163 (Towne Creek). None supply water to the subd. as a whole, although some may provide additional water to individual homes in subdivision.

NOTE - 63-09171 was not found in pld & pln overlap (9/6/89 edition).

I. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
Domestic	1/1	12/31	.22	72.0
Totals:			.22	72.0

2. Recommended Amendments

☐ Change P.D. as reflected above

☐ Add P.D. as reflected above

☐ None

☐ Change P.U. as reflected above

☒ Add P.U. as reflected above

☐ Other

J. AUTHENTICATION

Field Examiner's Name

Steve Lester


Signature

Steve Lester

Certification Date

Field Report Preparation Date

12/16/89

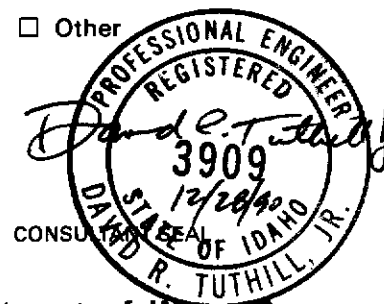



K. Licensing recommendation shall be prepared by an Idaho Department of Water Resources employee on a computer printout attached hereto.

This ground water is most likely trib. to S. Flk. Boise River if TOWNE policy, at future date, needs to identify & condition consumptive use of g.w. trib. to Boise River above Lucky Peak Dam. The external use would be subject to possible conditioning in such a development.

MICROFILMED

FEB 10 1992

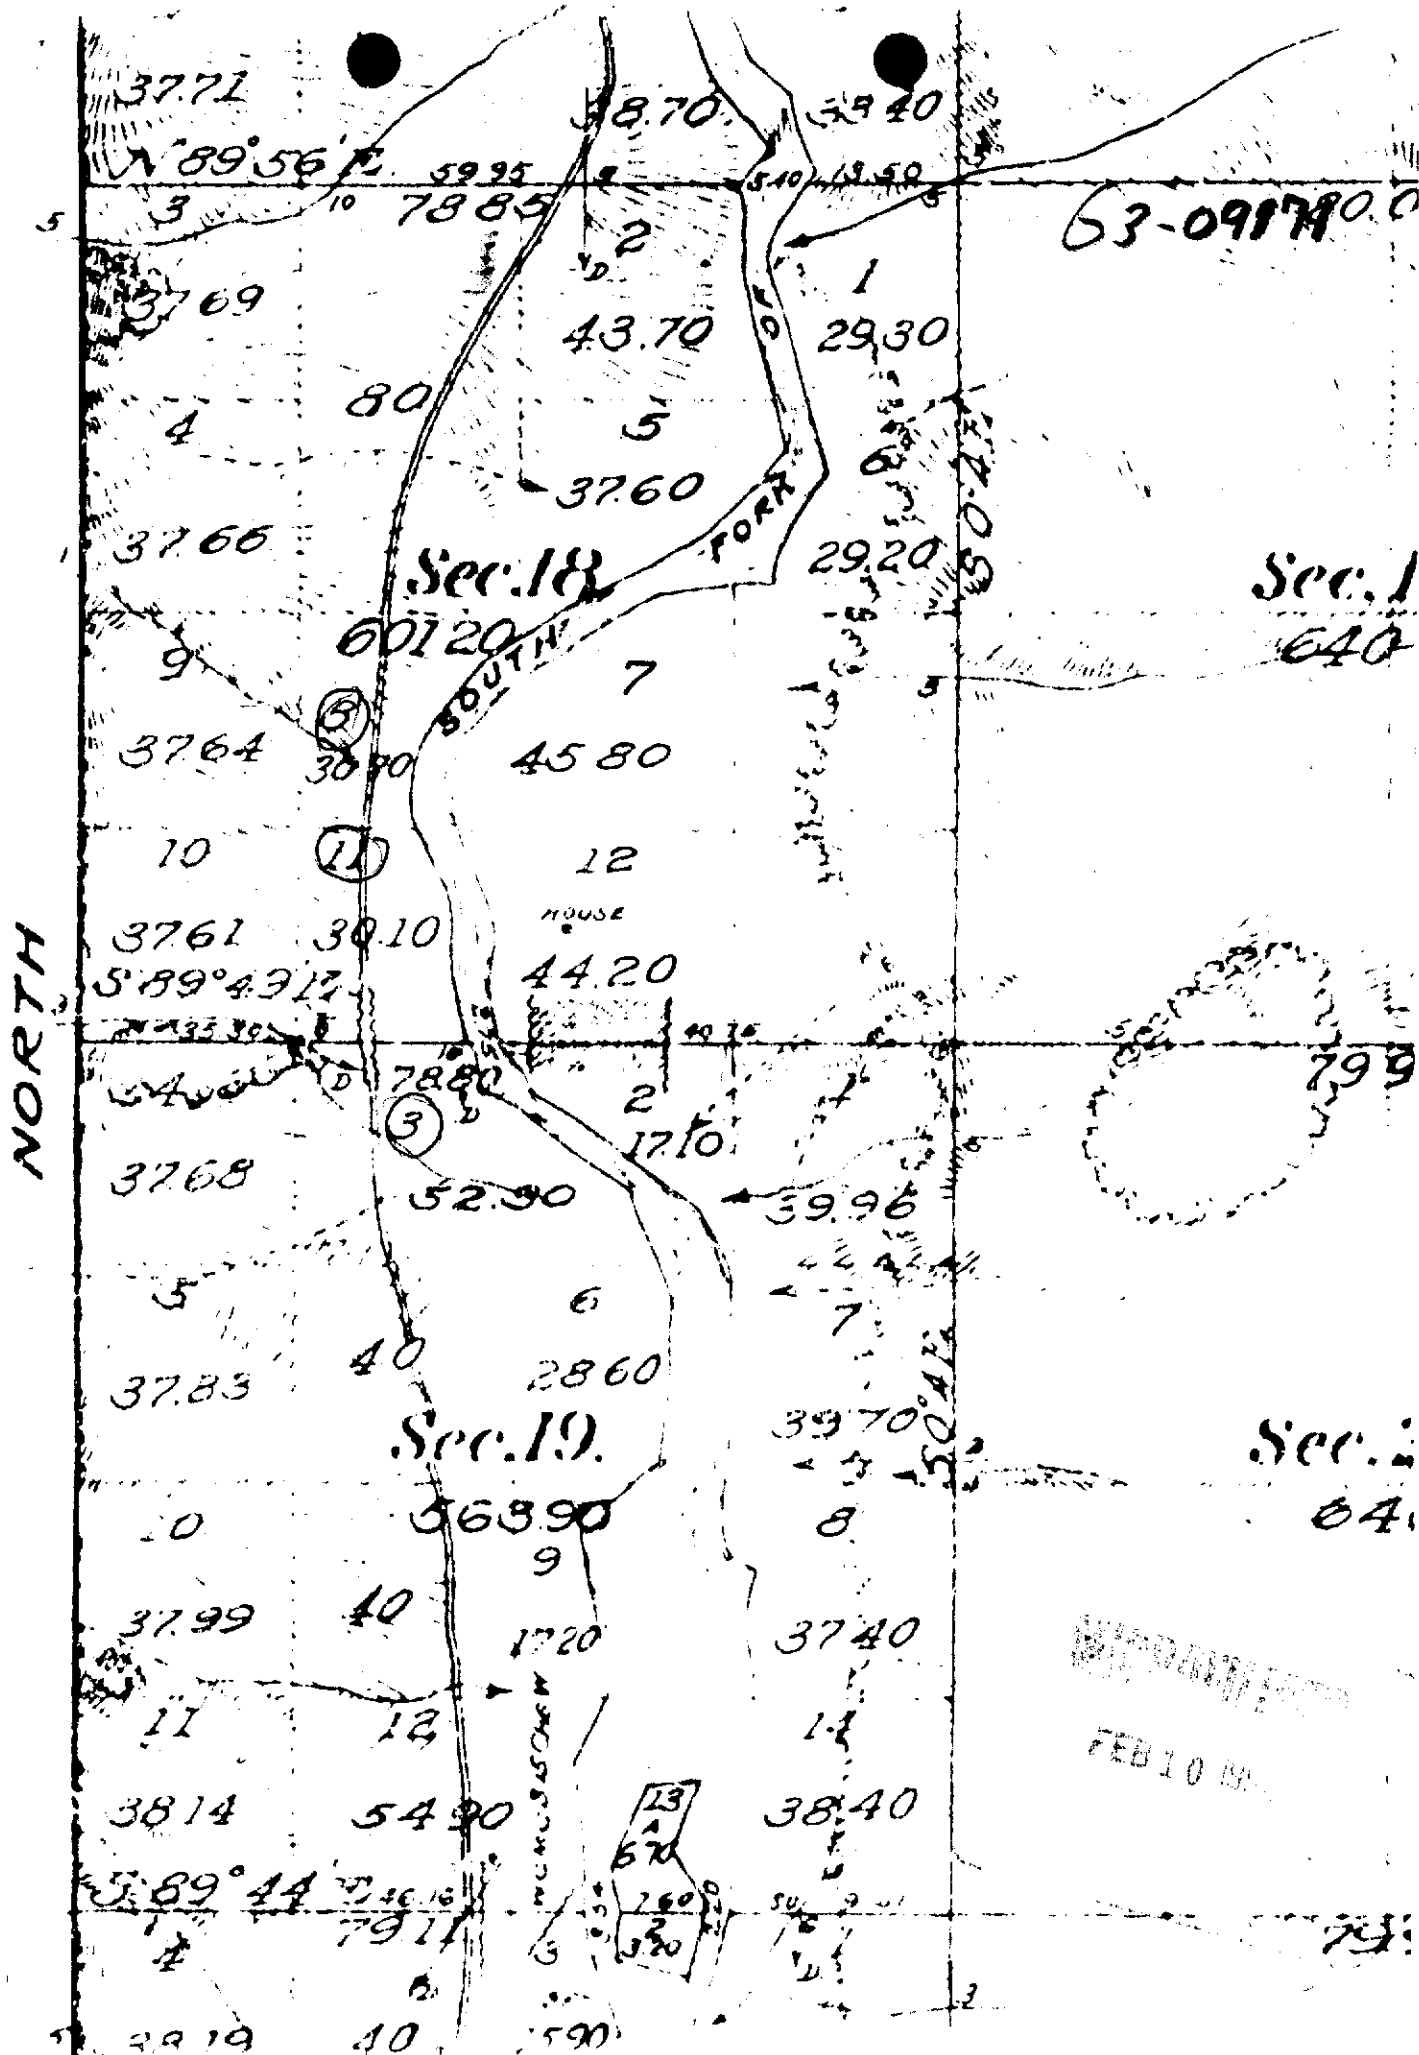

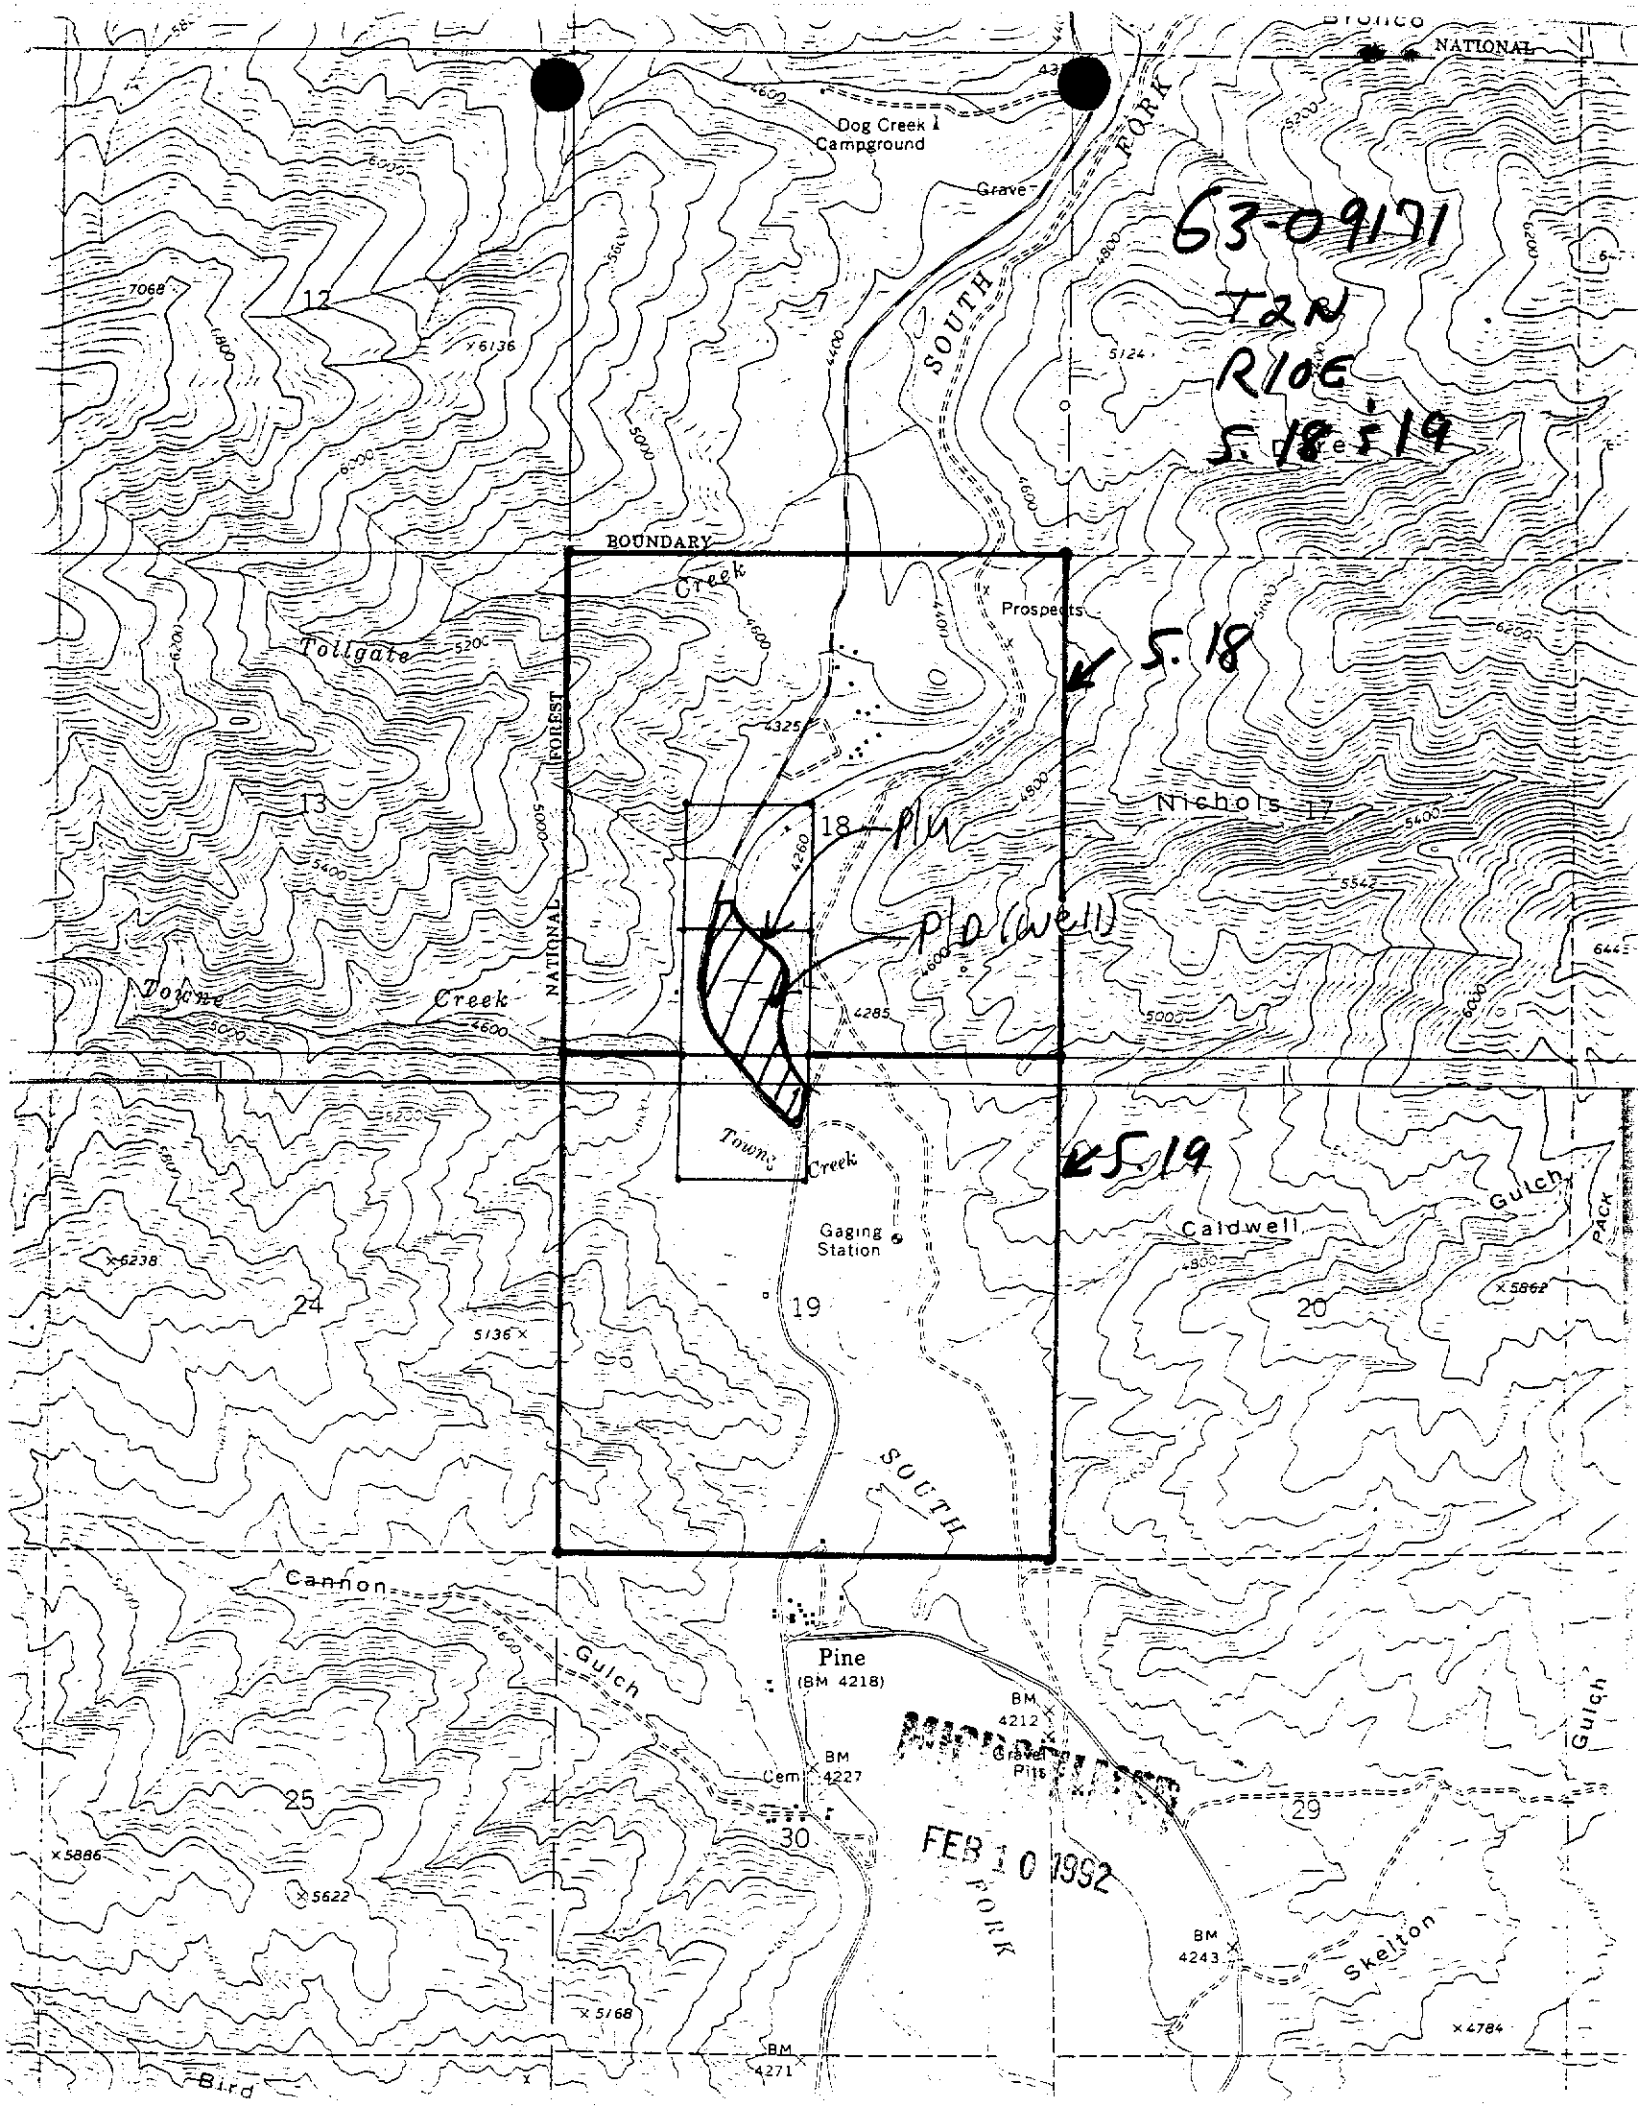

63-09171

T2N

R10E

S. 18 & 19

S. 18

25.19

FEB 10 1992

82
8/30/90① Flow Rate Calculation

HP equation where

$$HP = 5$$

$$EFF = .7 \text{ (assume)}$$

$$PSI = 40 \text{ (assume)} - \text{pressure tanks operate from 55-75 psi but assume lower psi at well head, est. about mid-way between standard domestic \& standard irrigation \& pressures of 20 \& 60.}$$

$$Z = 50 \text{ (assume)} - \text{no well log found, pump set at 70' per "Vis. Pres." into, surrounding well logs show static levels at 35'-72' with mean of 56'}$$

$$Q = \frac{(8.8)(.7)(5)}{(2.31)(40) + 50} = .22 \text{ cfs}$$

A 2" mainline for well designed system ($V = 5 \text{ ft/s}$) is expected to yield $Q = VA$

$$Q = (5)(\pi)(r^2) = (5)(3.1416)(.083^2) = .11 \text{ cfs}$$

The assumptions in HP equation are generous & do not appear to limit this right arbitrarily.

MICROFILMED

FEB 10 1992

② Volume

The permit does not specify internal v. external use. The 23 homes already present have laws. A limit of 60 units is found on permit. 81 lots occur in the subd., but some owners hold ≥ 1 lot/home or potential home. Stubbed lines are found for additional $60 - 23 = 37$ homes. Therefore, credit for 60 homes, internal & external use, can be given in licensing. Licensing of 60 units will not limit the rate to less than .22 cfs.

PHOTO ONE-

Point of Diversion

*8" well &
pumphouse with 3
pressure tanks.*

>



Place of Use

*typical home's
yard shown*

PHOTO TWO
FEB 10 1992




9

2

Reviewed Sub. #2

41
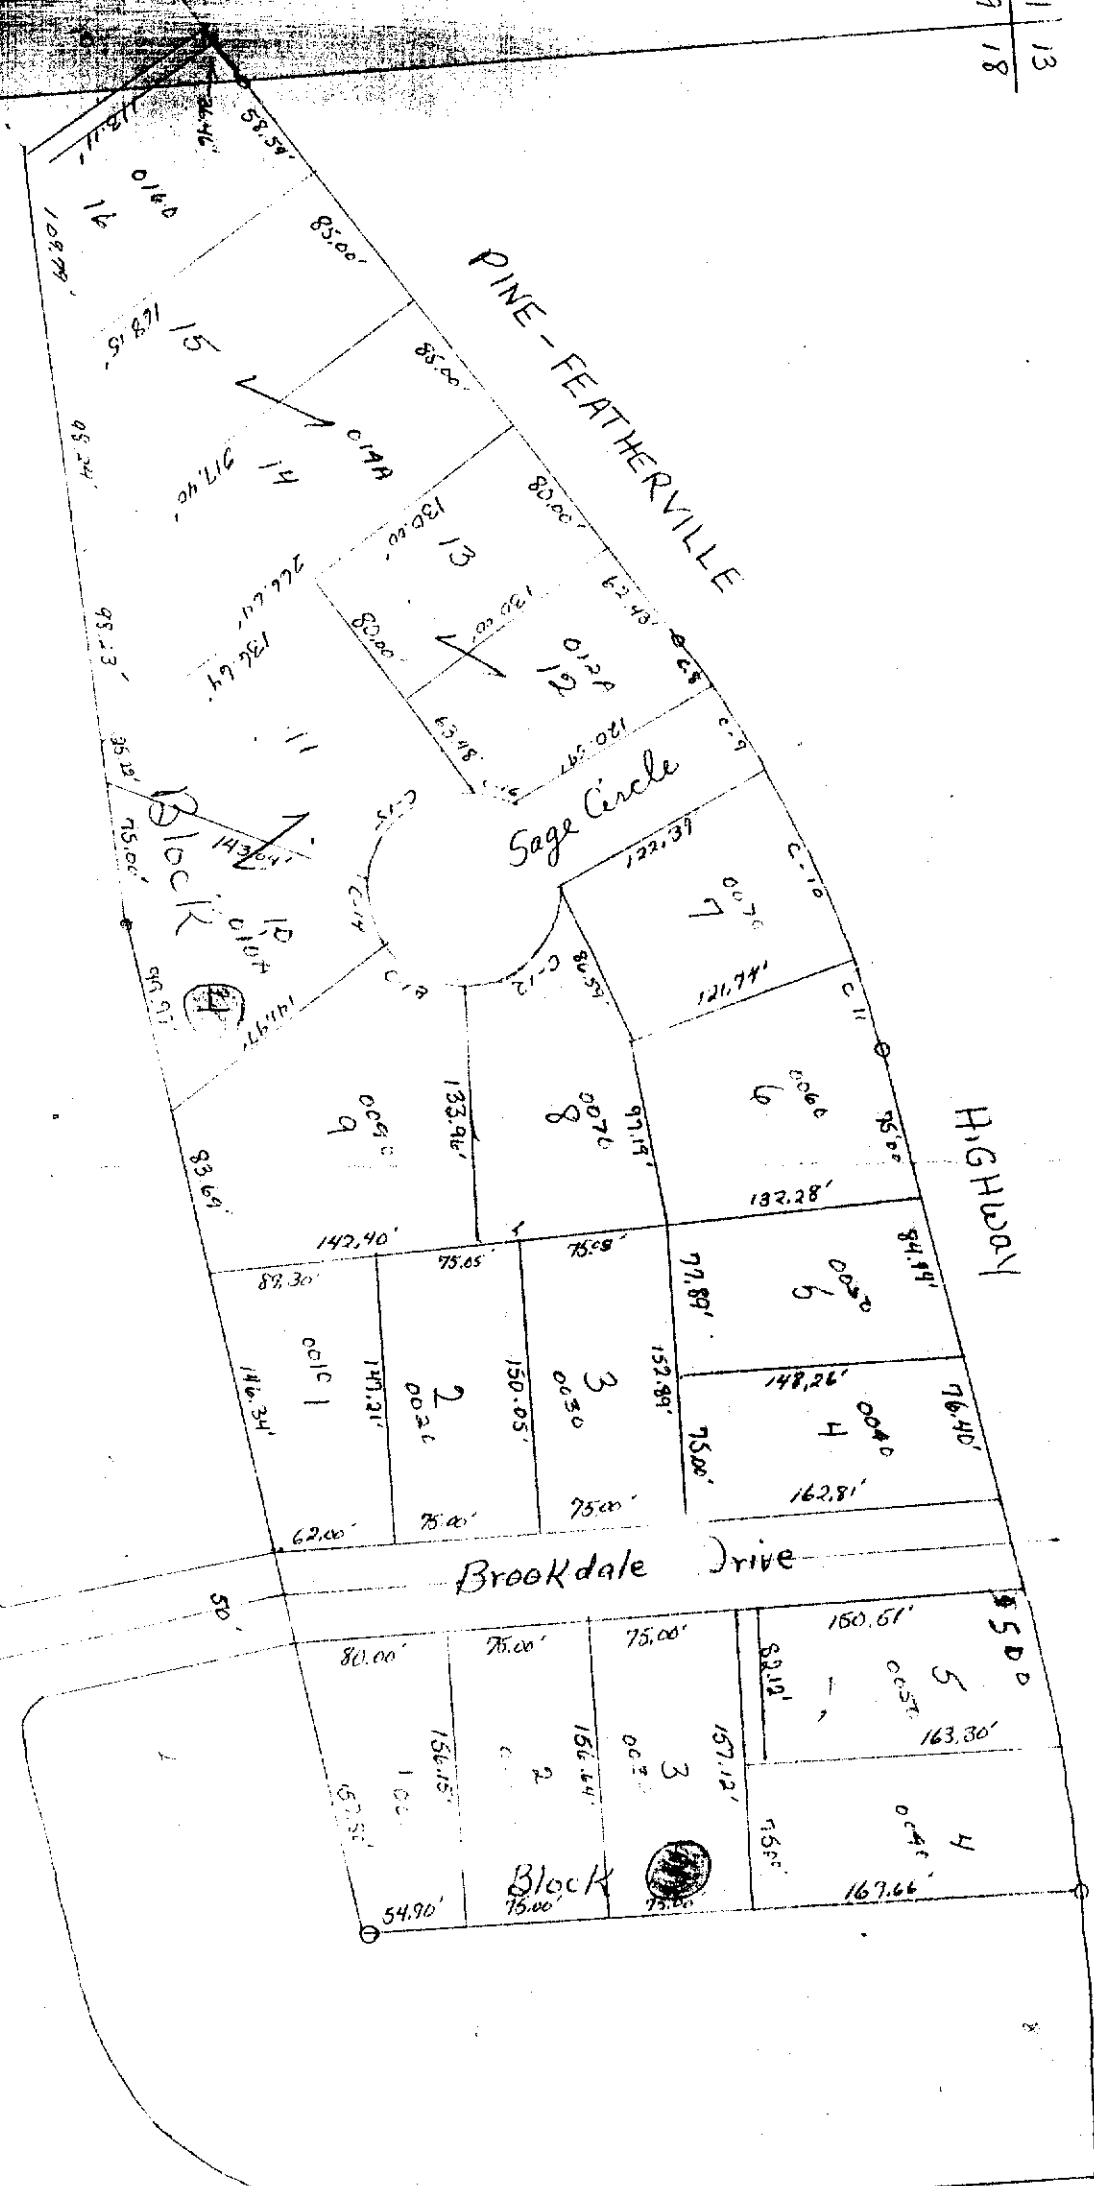
$$\begin{array}{r|l} 24 & 13 \\ 19 & 18 \end{array}$$


State of Idaho
Department of Water Resources
WELL INSTRUCTION FORM

This form should be completed by the examiner when conducting a field examination to determine the extent of beneficial use of water from a well or whenever a well is inspected for other reasons. The form should be attached to the beneficial use field report. If well construction standards do not appear to be met, a copy of this form should be forwarded to Groundwater Protection Section.

Water Right Permit No. 63-09171

1. Legal Description of Well Location: Twp. 2N, Rge. 10E
Sec. 18, Qtr./Qtr. NESESW or Lot Govt Lot 11
2. Owner Riverain Subd. Water Assoc.
Address HL 87, Box 251, City Pine, State Id. 83647
3. Approx. date of well construction 1970
Well driller UNKNOWN (no log found)
4. Casing: Diameter 8" Condition good
5. Casing length above land surface 17"
6. Well depth (ft) estimate 80' Flowing NO Temp. cold
Access port Removable cap
7. Condition of piping and valving good
8. Evidence of well seal Bolted removable cap
9. Shut in pressure or static water level unknown, est. 35-72' from surrounding well log data
10. Evidence of leakage around the casing NONE
11. Does well need repair NO
12. Comments Well at L. 14, Bl. 1 of Riverain Subd.
Pump installed by Hiddleston or mtn. Home
according to Frank Seibert, Asst. Manager

OVER

FEB 10 1992



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720 -(208) 327-7900

CECIL D. ANDRUS

GOVERNOR

R. KEITH HIGGINSON

DIRECTOR

November 9, 1989

RE: Permit No. 63-9171

Riverview Subdivision Water Assn.
HC 87 Box 251
Pine, ID 83647


Dear permit holders:

We acknowledge receipt of the statement of beneficial use and the supporting documentation for reinstating the above referenced permit. Enclosed is a copy of the Order of Reinstatement. Please note that the priority date has been advanced to October 6, 1989.

Before a license can be issued, a field examination will be made by a representative of this Department.

If you have any questions regarding this matter, please contact this office or our Western Regional Office at 344-2190.

SINCERELY,

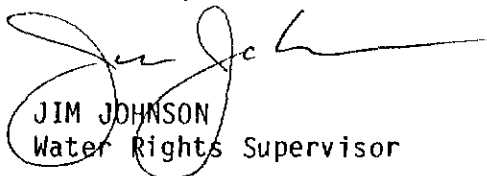
JIM JOHNSON
Water Rights Supervisor

JJ:at

Enclosure

RECEIVED

NOV 20 1989

Form 103/1
RECEIVED
OCT 06 1989

STATE OF IDAHO

DEPARTMENT OF WATER RESOURCES

For Office Use Only
Fee Received 100.00
Date 10-6-89
Receipt # C012056
Receipt by OK
Reviewed by _____
Sent to region _____

Department of Water Resources

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources will consider this form as a statement that the permit holder(s) has completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

Permit No. 63-9 9171

Name(s) of Permit Holder: RIVERVIEW SUBDIVISION WATER ASSOC.

Post Office Address: HC-87 BOX 251 PINE, IDAHO 83647

Telephone No. (208) 653-2438

Source of Water: GROUND WATER

Extent of Use:

Domestic 63 (number of households) Stockwater _____ (number and type of stock)

Irrigation _____ (acres) Other/Remark _____

Total rate and/or volume for which proof is submitted 0.75 cfs _____ acre-feet

Show the date water was first diverted and beneficially used under this permit: 1970

Measuring Device: Required? ☐ Yes ☒ No
Installed? ☐ Yes ☐ No
Fee enclosed \$ 100.00
(See License Examination Fee Schedule)

Flow Measurement Port: Required? ☐ Yes ☒ No
Installed? ☐ Yes ☐ No

Person to contact to accompany the Department representative during the field examination:

FRANK SEIBERT (208) 653-2438
(Name) (Telephone Number)

HC-87 BOX 251 PINE, IDAHO 83647
(Address)

The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

MICROFILMED

10-6-89
Date

Frank Seibert, Vice President NOV 4 1989
Signature of Permit Holder (and title, if appropriate)

On 10-6-89 The Riverview Subdivision Water
Association filed a Proof of Beneficial Use
permit #63-9171. Reason for the late
filing was that we had assumed ~~proof~~^{proof}
had been filed on at the time the well
was drilled.

Frank Seibert Vice President
Riverview Subdivision Water Assoc.

UNRECORDED

NOV 20 1989

REC-7

OCT 06 1989

Riverview Sub. Assoc.

Prairie Power Cooperative 659

Betty Walker

NAME

ACCOUNT NO.

Box 512

Glenns Ferry, Idaho 83623

FIRST READING

a b c d

Department of Water Resources

ACCOUNT PAID TO

FIRST DATE

READING DATE			DUE DATE		DELINQUENT DATE				DELINQUENT RATE				
DATE READ	REMARKS	READINGS	KWH USED	✓	NET SALE	SALES TAX	ARREARS	NET BILL	PEN-ALTY	GROSS BILL	AMOUNT PAID	DATE PAID	BALANCE DUE
BROUGHT F'RD	R	9231											
Jan	E	9331	100		8.00					8.00	8.00	1-19-78	
Feb	R	9865	534		24.35					24.35	24.35	2-23-78	
March 10	R	0119	254		17.35					17.35	17.35	3-21-78	
April 11	R	0326	257		17.42					17.42	17.42	4-19-78	
May 11	R	0613	237		16.93					16.93	16.93	5-23-78	
June 12	R	0932	319		18.98					18.98			
July 10	R	1207	275		17.88		18.98			36.86	18.98	7-5-78	17.88
Aug 10	R	1531	324		19.10					19.10	17.88	7-24-78	
Sept 10	R	1758	227		16.68		1.22			17.90		8-31-78	
TOTAL													

METER RECORD

DEPOSIT DATA

SHUT OFF RECORD

NUMBER	AMPS	DATE SET	DATE REMOVED	CHAMBER	AMOUNT	DATE ISSUED	DEBIT	BALANCE	DATE RETIRED	DATE SHUT OFF	DATE TURNED ON

Ph. 9-19-78
E 184
Chamberlain

ON M 3 L 6 E 1 3 5

Mtn. Home, Id. 83647

No. 7018

Dept.

NOV 06 1989

Date 10-21-1975

Name RIVER VIEW Subdivision WATER HSSOC.

Address P.O. Box 511 Mtn. Home

SOLD BY		CASH	C. O. D.	CHARGE	ON ACCT.	MOSE. RETD.	PAID OUT		
QUAN.		DESCRIPTION					PRICE	AMOUNT	
1	1	5 H.P. FRANKLIN motor						481.00	
	2	Milage 47 @.20						9.40	
	3								
	4								
	5								
	6								
	7								
	8								
	9	Sub Total						481.00	
	10	TAX						14.43	
	11								
	12	Labor						40.00	
	13								
	14								
	15								
	16								
	17								
	18							544.83	

Customer's
Order No.

Rec'd
By

Rediform
5H320

KEEP THIS SLIP FOR REFERENCE

19
19
MUNICIPAL
MOUNT PAID TO

ADDRESS *Mid Hance*
Box 511

NAME *Army Knight, Sec.*
Capt. W. H. Willis
Renewed Sub. Water Pump
FIRST READING *659*

ACCOUNT NO. *3297*

DATE	READINGS	KWH USED	NET SALE	SALES TAX	ARREARS	PEN. ALTY	GROSS BILL	AMOUNT PAID	DATE PAID	BALANCE DUE
12/1	9925				11845					
12/2	0025	100	800							
12/12	0125	100	800		12145					
12/22	0225	100	800		12985	10	12985			
12/32	0325	100	800		13825	10				
1/1	1192	867	3087		14625			13825	5-7-75	
1/11	1292	100	800		3827					800
1/21	1342	100	800		800			3827	6-9-75	
1/31	1542	100	800		800	400		1200	7-10-75	
2/1	2080	541	2453		1000					
2/21	2214	131	1048		4053			4053	10-30-75	
2/31	2314	100	800		1048			1048	11-18-75	
2/41	2414	100	800		800			800	12-30-75	

REMARKS

get membership - bill 11-18-75 paid 11-18-75

1061989

RECEIVED

b c d

JFIMAMJJAISOND
ACCOUNT PAID TO

Mountain Home Ida
Box 511 83647

NAME Riverview Sub Water Assoc
26 Hardy Light Community Center
Tenn

659

READING DATE

DUE DATE

DELINQUENCY DATE

DELINQUENT RATE

DATE READ	REMARKS	READINGS	KWH USED	NET SALE	SALES TAX	ARREARS	NET BILL	PEN-ALTY	GROSS BILL	AMOUNT PAID	DATE PAID	BALANCE DUE
Jan	e	2414				8.00						
Feb	e	2514	100	8.00								
Mar	e	2614	100	8.00		16.00						
Apr 9	R	2714	100	8.00		8.00	16.00			16.00	2-29-76	
May	e	5574	2860	54.92		24.00				8.00	3-9-76	
June	e	5674	100	8.00						78.22	5-7-76	
July 16	R	5774	100	8.00		8.00						
Aug	e	6474	640	26.64		16.00				8.00	7-23-76	
Sept	e	6674	255	17.38		26.84				8.00	7-7-76	
Oct	e	6869	260	16.00		43.82				26.44	9-1-76	
Nov 1-18	R	6969	100	8.00		33.38						17.38
Dec	R	7302	533	24.33		41.38						
TOTAL	e	7402	100	8.00		24.33				41.38	11-30-76	24.33
						32.33						

MICROFILMED

NOV 2 1989

MEMORANDUM RECORD				DEPOSIT DATA				SHUT OFF RECORD	
NUMBER	DATE SET	DATE REMOVED	AMOUNT	DATE ISSUED	DEBIT	BALANCE	DATE RETIRED	DATE SHUT OFF	DATE TURNED ON

OCT 6 1989

RECEIVED

WARNING

CANCELLED OR LAPSED

This permit has been officially CANCELLED or LAPSED.

Ninety days following the date of official action this file will be DESTROYED.

U A H U
RESOURCES

STAFFHOUSE
MUISE, IDAHO 83720
(208) 334-4440

IN.

JANUARY 07, 1980

DIVISIONS OF SECTION 42-218A OF
LAPSED SINCE YOU HAVE NOT
SUBJECT BY THE DATE REQUIRED
FOR THAT PURPOSE IN OUR NOTICE


YOU SUBMIT THE PROOF OF BENEFIT
OTHER REASONABLE CAUSE WHY THE
FROM THE DATE OF THIS LAPSE

RECEIVED

JAN 11 1980

Department of Water Resources

PRESORTED
FIRST-CLASS



From _____
Address _____
City _____
State _____
Zip _____
Pay to the order of _____
No. _____
Amount _____
Date _____
Signature _____

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

STATEHOUSE
BOISE, IDAHO 83720
(208) 334-4440

RIVERVIEW SUBDIVISION WATER RIGHT
P.O. BOX 511
RIVERVIEW IDAHO, ID 83447

JANUARY 07, 1980

DEAR PERMIT HOLDERS:

YOU ARE HEREBY NOTIFIED THAT UNDER THE PROVISIONS OF SECTION 42-218A OF THE IDAHO CODE, PERMIT NO. 63-9171 HAS LAPSED SINCE YOU HAVE NOT NOTIFIED US THAT YOU HAVE COMPLETED THE PROJECT BY THE DATE REQUIRED ON YOUR PERMIT. YOU WERE PROVIDED FORMS FOR THAT PURPOSE IN OUR NOTICE TO YOU DATED OCTOBER 31, 1979.

YOUR PERMIT CANNOT BE REINSTATED UNLESS YOU SUBMIT THE PROOF OF BENEFICIAL USE AFFIDAVIT, ENCLOSED, OR SHOW OTHER REASONABLE CAUSE WHY THE PERMIT SHOULD BE REINSTATED WITHIN 60 DAYS FROM THE DATE OF THIS LAPSE NOTICE.

C. STEPHEN ALLRED
DIRECTOR

ENCLOSURE

JAN 9 1980

Rita Lick

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

STATEHOUSE
BOISE, IDAHO 83720
(208) 343-2215

RIVERVIEW SUBDIVISION WATER ASSN.
P.O. BOX 511
MOUNTAIN HOME, ID 83647

101460

OCTOBER 31, 1979

DEAR PERMIT HOLDER:

ONE OF THE CONDITIONS OF APPROVAL OF YOUR WATER PERMIT NO. 63-9171 WAS THAT EVIDENCE OF THE PATENT OF DEVELOPMENT MUST BE SUBMITTED TO THIS OFFICE ON OR BEFORE JANUARY 01, 1980. (SEE LAST PAGE OF YOUR APPROVED PERMIT). ENCLOSED IS A POST CARD WHICH MAY BE USED TO SUBMIT THE REQUIRED PROOF OF BENEFICIAL USE.

IF YOU HAVE NOT FULLY COMPLETED YOUR PROJECT, AND YOU HAVE NOT PREVIOUSLY RECEIVED AN EXTENSION OF TIME, YOU MAY REQUEST AN EXTENSION OF TIME PROVIDED THE DELAY IS FOR REASONABLE CAUSE AS INDICATED IN SECTION 42-204, IDAHO CODE, AMENDED. IF YOU HAVE BEEN PREVENTED FROM PROCEEDING BY A GOVERNMENTAL AGENCY OR BY LITIGATION, MORE THAN ONE EXTENSION OF TIME CAN BE GRANTED.

EITHER THE BENEFICIAL USE POST CARD OR A REQUEST FOR AN EXTENSION OF TIME MUST BE RECEIVED BY THIS DEPARTMENT ON OR BEFORE THE ABOVE MENTIONED DATE, OTHERWISE, THE PERMIT WILL LAPSE AND BE OF NO FURTHER FORCE OR EFFECT WITHIN 60 DAYS.

SINCERELY,


RITA FLECK
SR. SECRETARY

ENC: 1

January 4, 1979

Re: Permit No. 63-9171

Jim Jenkins
Central District Health
Statehouse Mail
1455 N. Orchard
Boise, Idaho

Dear Mr. Jenkins:

Enclosed is a copy of the above referenced permit which may be of interest to your agency. Please review the permit and submit any comments you may have.

If you have questions regarding the permit, please contact this office.

Sincerely,

L. GLEN SAXTON
Chief, Operations Bureau

LGS:lr

Enclosure



State of Idaho
DEPARTMENT OF WATER RESOURCES
STATE OFFICE, 373 W. Franklin Street, Boise, Idaho

JOHN V. EVANS
Governor

C. STEPHEN ALLRED
Director

Mailing address:
Statehouse
Boise, Idaho 83726
(208) 384-2215

January 4, 1979

Re: Permit No. 63-9171

Riverview Subdivision Water Association
P.O. Box 511
Mountain Home, Idaho 83647

Gentlemen:

Your approved copy of your Application for Permit is enclosed and we direct your attention to the conditions of approval on the fourth page.

The exercise of this permit may also be affected by the court's determination of water rights in the case of Idaho Power Company v. State of Idaho, et al., Civil No. 62237, currently pending before the District Court of Ada County.

Idaho Power officials tell us that because of Case No. U-1006-124 filed before the Idaho Public Utilities Commission, Idaho Power Company is asking the District Court of Ada County to determine whether the Power Company's water rights on the Snake River are protected against subsequent upstream appropriations in the waters of the Snake River and surface and subterranean tributaries between Milner Dam and Hells Canyon.

Since the use of water under your permit may affect the flows in this reach of the Snake River, the final decision in Idaho Power Company v. State of Idaho, et al. (Ada County Civil No. 62237) may determine to what extent the exercise of your permit may be subject to the water rights of Idaho Power.

While the Ada County court is examining this question, Idaho Power Company has not filed a specific protest to your permit. However, the Department of Water Resources has been advised that the Power Company is not waiving any of its rights to contest or limit the exercise of your permit or a subsequent license or water right.

If you have any questions, please let us know.

Sincerely,

L. GLEN SAXTON
Chief, Operations Bureau

LGS:kw
Enclosure

STAFF REVIEW - STATE OFFICE

1. OK Name vs. Signature
2. W Source
3. ✓ Point of Diversion
4. ✓ Amnt. & Period of Use
5. ✓ Descrip. of Diverting Wrks.
6. 1 Time req. for Proof of B/U
7. ✓ Place of Use for other than irrig. ✓
8. N/A Place of Use for irrigation (add acres)
9. AR Property Owner at Pt. of Div. & Pl. of Use
10. ✓ Map
11. ✓ Fee & Rec't. No.

Copies Sent To:

~~NO~~ Idaho Health Department
 1 Idaho Fish & Game Dept.
 Bureau of Land Management

No U.S.F.S.
Dept. of Lands
Other

Dam Safety Information N/A (Goes to Permit Section)

Of Lands

$\frac{.75 \text{ cfs}}{60 \text{ units}} = .0125 \text{ cfs/unit}$

$= 5.6 \frac{\text{gpm}}{\text{unit}}$

Ant
Community Water System
 $2.7 \frac{\text{gpm}}{\text{unit}} \times 2 = 5.4 \text{ gpm}$

aka

Check:

Critical G.W. Area yes ☒ no

Other rights on same land N/A

~~M~~ Withdrawals of all protests received _____ yes _____ no

Conditions:

ID Power Co. Letter - Snake R. No

Meas. Dev. or Sc. Meas. No

ID Power Co. Letter - G.W. & Tribs. Yes

Totalizing meter No

Snake River Condition No

Supplemental No

Payette River Letter 10Right-of-Way Cond. Yes

Priority Date

Watermaster Cond. No

Wtr. Dist No. _____

Water Quality #16 No

Meas. Dev. Cond. for apps within
a Water Dist. D.

Water Quality #10 No

intrastate interstate

 Reviewer
 12-15-78

 Date

DEPARTMENT OF WATER RESOURCES
STAFF ANALYSIS -

Item Initial Date

Application No. 13-9171

☒ Source
☒ Point of Diversion
☒ County
☒ Quantity of Water and Period of Use
☒ Description of Diverting Works
☒ Time required for B/U of water
☒ Place of Use or Acres Irrigated
☒ Map
☒ Signature
☒ Fee

(1) Wfm 8-7-78

In form to receipt

(2) _____

Send Copies to:

_____ Idaho State Health Department
_____ Idaho Fish and Game Department
_____ Bureau of Land Management

(3) _____

_____ Request Special Use Permit from U.S.F.S.
_____ Request Easement from B.L.M.
_____ Request Information from Applicant
_____ Request Dam Safety Information

(4) Wfm 8-7-78

In form for advertising

(5) _____

Platted on Map No. _____

(6) _____

Located within Water District No. _____

(7) _____

Critical groundwater area: yes _____ no ☒

(8) _____

Groundwater levels:

_____ Declining, _____ Stable, _____ Increasing

(comment) _____

(9) _____

Other rights on the same place of use No G.W. platted

(10) _____

Comments: _____

(11) st 9-12-78

Affidavit of Publication received(date) 9/7/78

(12) _____

Final date for protests 9-11-78

Protests received: yes _____ no ☒

(13) _____

All requested information received from agencies or applicant: yes _____ no _____

(14) _____

Action recommended:

☒ Approve _____ Deny

_____ Proposed Priority

_____ Reason for Reduction _____

No Measuring device required

_____ See attached sheet for other conditions of approval

_____ No special conditions for approval

(15) District W

By Wfm Date 9-13-78

I. P. G.W. letter

RECEIVED

Department of Water Resources

If issued, the permit(s) will be subject to all prior water rights. Protests against the granting of any permit must be filed with the Director of the Idaho Department of Water Resources, 92 S. Cole Road, Boise, Idaho 83705 on or before September 11, 1978.

C. STEPHEN ALLRED

Director

Published in the Mountain Home News
on August 24, 1978 and August 31, 1978.

63-9121

Name: RIVERVIEW SUBDIVISION WATER ASSN.

Address: P.O. BOX 511, MOUNTAIN HOME, ID 83547

Source: GROUNDWATER

Date Filed: 07/26/1978

County: ELMORE

Amount: 0.75 CFS

Point of Diversion: SESW S18 T02N R10E

Use: DOMESTIC

from 01/01 to 12/31

Place of Use: SESW S18 T02N R10E NENW S19 T02N R10E

Means: WELL, PUMP & PIPELINE



John V. Evans
Governor

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
WESTERN REGION

92 South Cole Road
Boise, Idaho 83705
(208) 384-2190

August 17, 1978

Mountain Home News
P.O. Drawer 0
Mountain Home, ID 83647

RE: Application No. 63-9171 - RIVERVIEW SUBDIVISION WATER ASSOC.

Gentlemen:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. In order to receive payment, the following certification must appear on the bill:

"I hereby certify that the foregoing account is just and correct, that the amount claimed is legally due after allowing all just credits and that no part of the same has been paid."

(Signature of Claimant)

Please send the affidavit of publication and publication billing to this office before September 11, 1978.

Sincerely,

RITA FLECK
Secretary

ST/

NOTICE OF APPLICATION FOR WATER RIGHT

Notice is hereby given that the following application(s) have been submitted for permit to appropriate the public waters of the State of Idaho:



STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
WESTERN REGION

John V. Evans
Governor

92 South Cole Road
Boise, Idaho 83705
(208) 384-2190

August 21, 1978

Riverview Subdivision Water Assoc., Inc.
Box 511
Mountain Home, ID 83647

Gentlemen:

Enclosed is your Receipt No. 12401 in the amount of \$ 35.00
for application for permit which was received in
this office on 7-26-78.

Sincerely,

RITA FLECK
Secretary

RF

Enclosure