


11. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

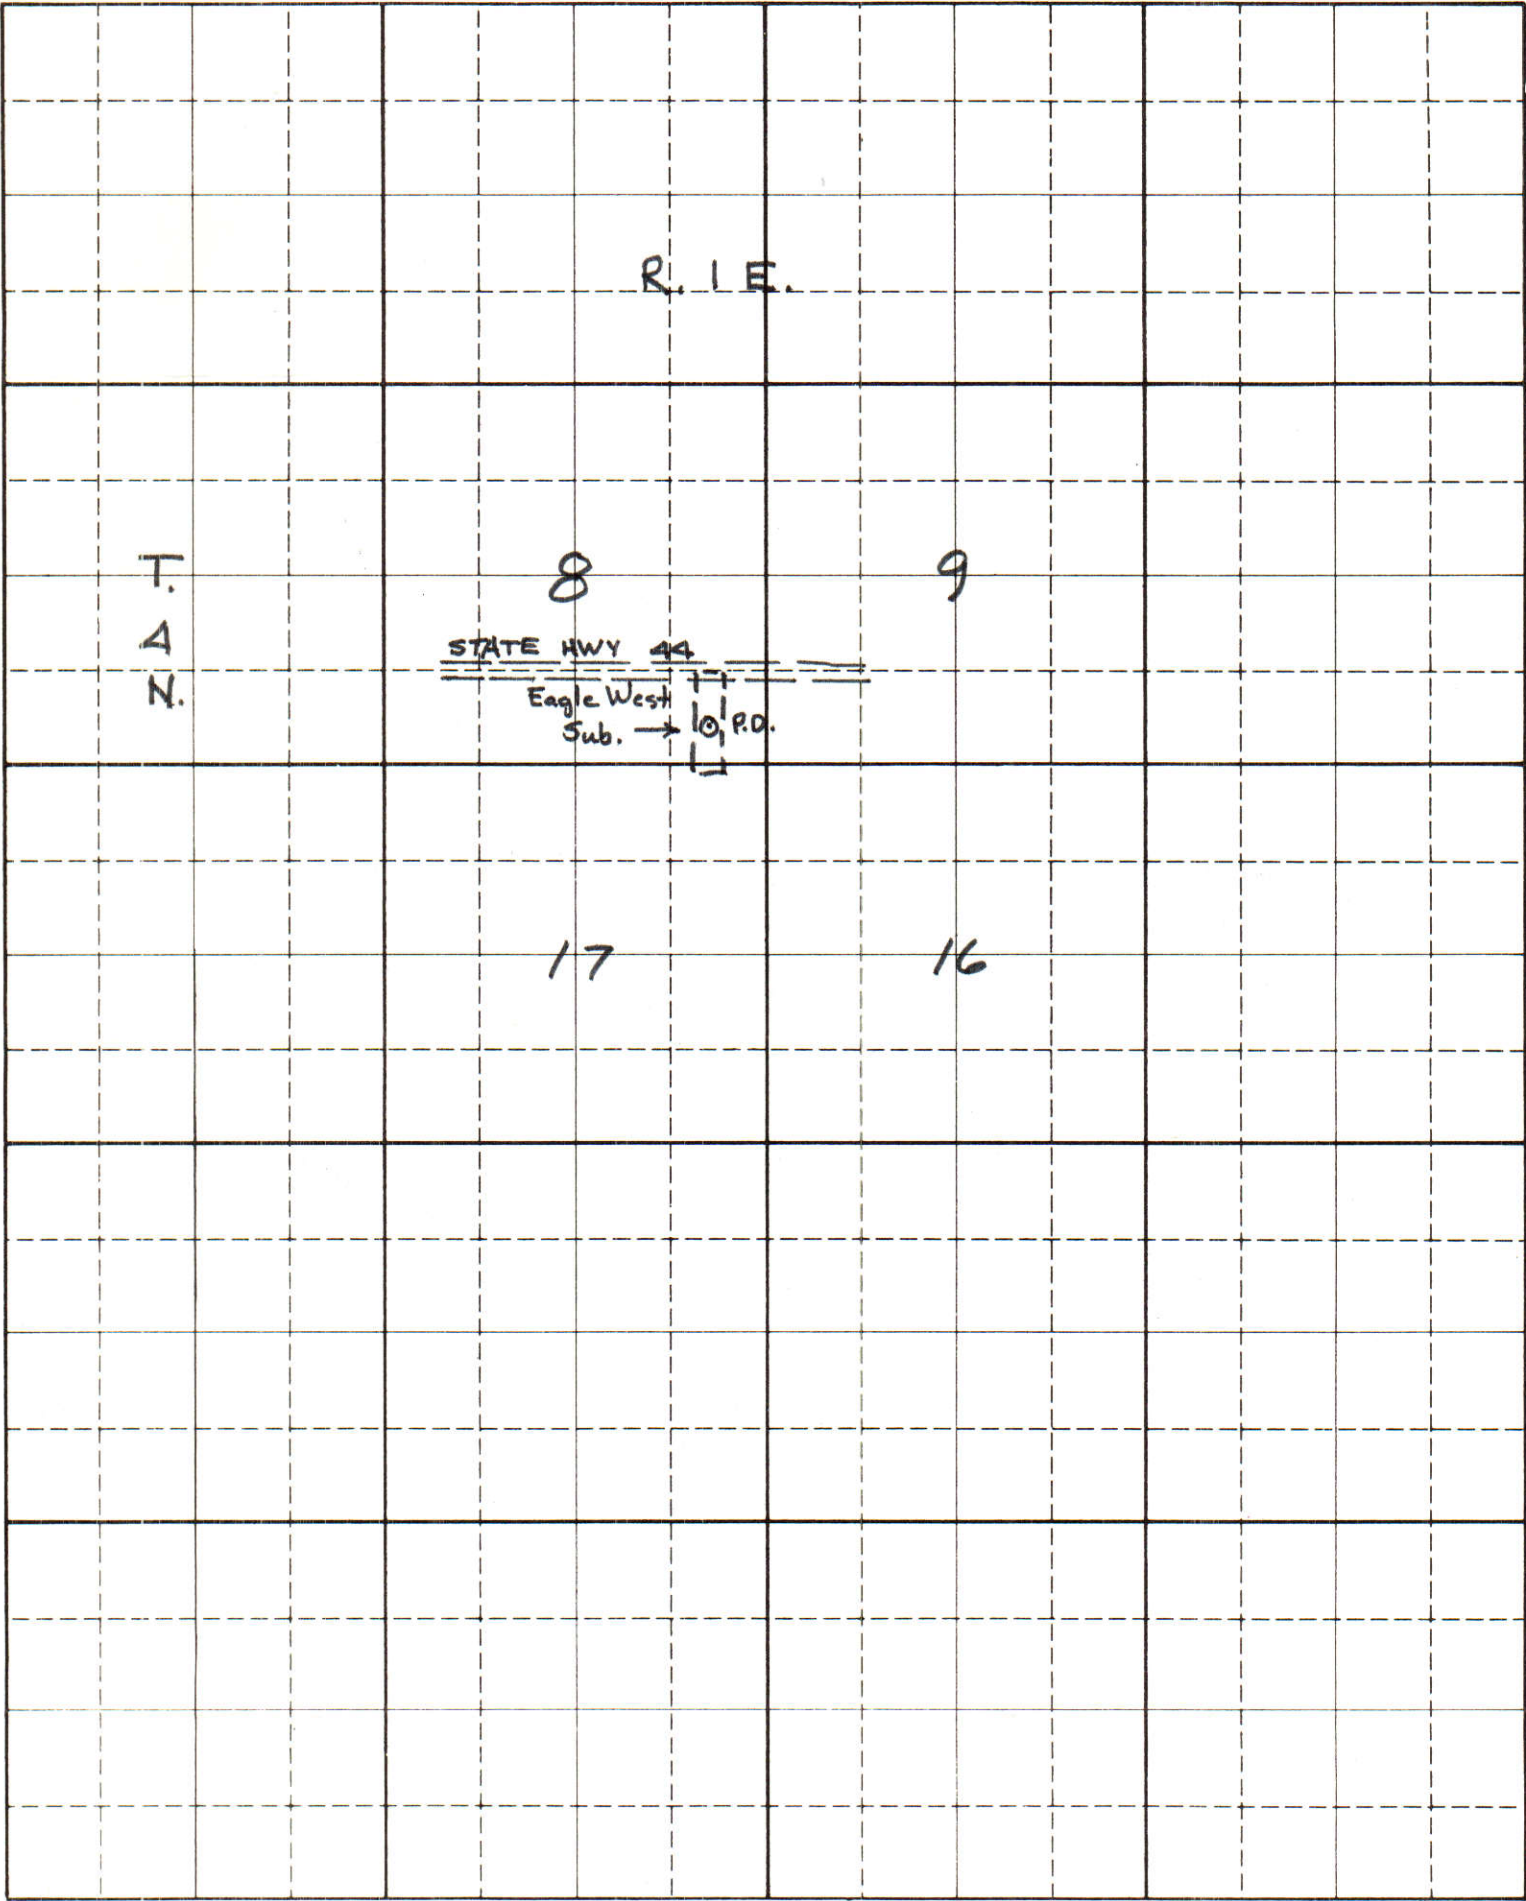

Scale: 2 inches equal 1 mile

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Larry Van Hoes Sec'y
(Applicant)

Notice is hereby given that VAN HEES BUILDERS, INC., Rt. 2, Kuna, Idaho, has on May 2, 1975, submitted Application No. 63-8124 for a permit to appropriate 1.0 cubic feet per second of water from a groundwater source by means of well, pump, and mainline within the SE $\frac{1}{4}$ SE $\frac{1}{4}$, Sec. 8, T. 4 N, R. 1 E, B.M. Ada Count to be used from Jan. 1 to Dec. 31 for domestic and fire protection purposes within the NE $\frac{1}{4}$ NE $\frac{1}{4}$, Sec. 17, SE $\frac{1}{4}$ SE $\frac{1}{4}$, Sec. 8, T. 4 N, R. 1 E, B.M.

If issued, this permit will be subject to all prior water rights. Protests against the granting of the permit must be filed with the Idaho Department of Water Resources, Statehouse, Boise, Idaho 83720, on or before June 16, 1975.

R. KEITH HIGGINSON
Director
Pub. May 29;
June 5, 1975.

931

Dorothy Eiguren, being duly sworn, deposes and says: That she is the Principal Clerk of The Idaho Statesman, a daily newspaper printed and published at Boise, Ada County, State of Idaho, and having a general circulation therein and which said newspaper has been continuously and uninterruptedly published in said County during a period of twelve consecutive months prior to the first publication of the notice, a copy of which is attached hereto; that said notice was published in the regular edition of The Idaho Statesman for

two ~~consecutive~~ insertions, beginning with the
issue of May 29, 1975, and ending with the
issue of June 5, 1975.

day of June, 1975.

Notary Public for Idaho, Residing at Boise, Idaho

MICROFILMED

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

GENERAL INFORMATION

1. Owner: Eagle West Subdivision Water Corp. Phone No. 939-8288
Current Address: 130 Harlan Pl. Eagle, Id. 83616

2. Accompanied by: Doreta Stephensen EXAM. DATE: 6/19/87
Address: Same Phone No. Same
Relationship to Permit Holder: Sec'y - Treasurer

3. Source: groundwater tributary to —

B. OVERLAP REVIEW


OVERLAP REVIEW

1. Other water rights with same place of use: 63-0261, 2406, 3055, 4465, 4727, 2553, 7008,
_____ ☐ Copies Attached

2. Other water rights with same point of diversion: 63-4465 & 4727
_____ ☐ Copies Attached ☐ Copies of Field Exam's Attached
- no copies needed -

C. SYSTEM DESCRIPTION

1. **Diversion System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☐ Alternative diagram attached

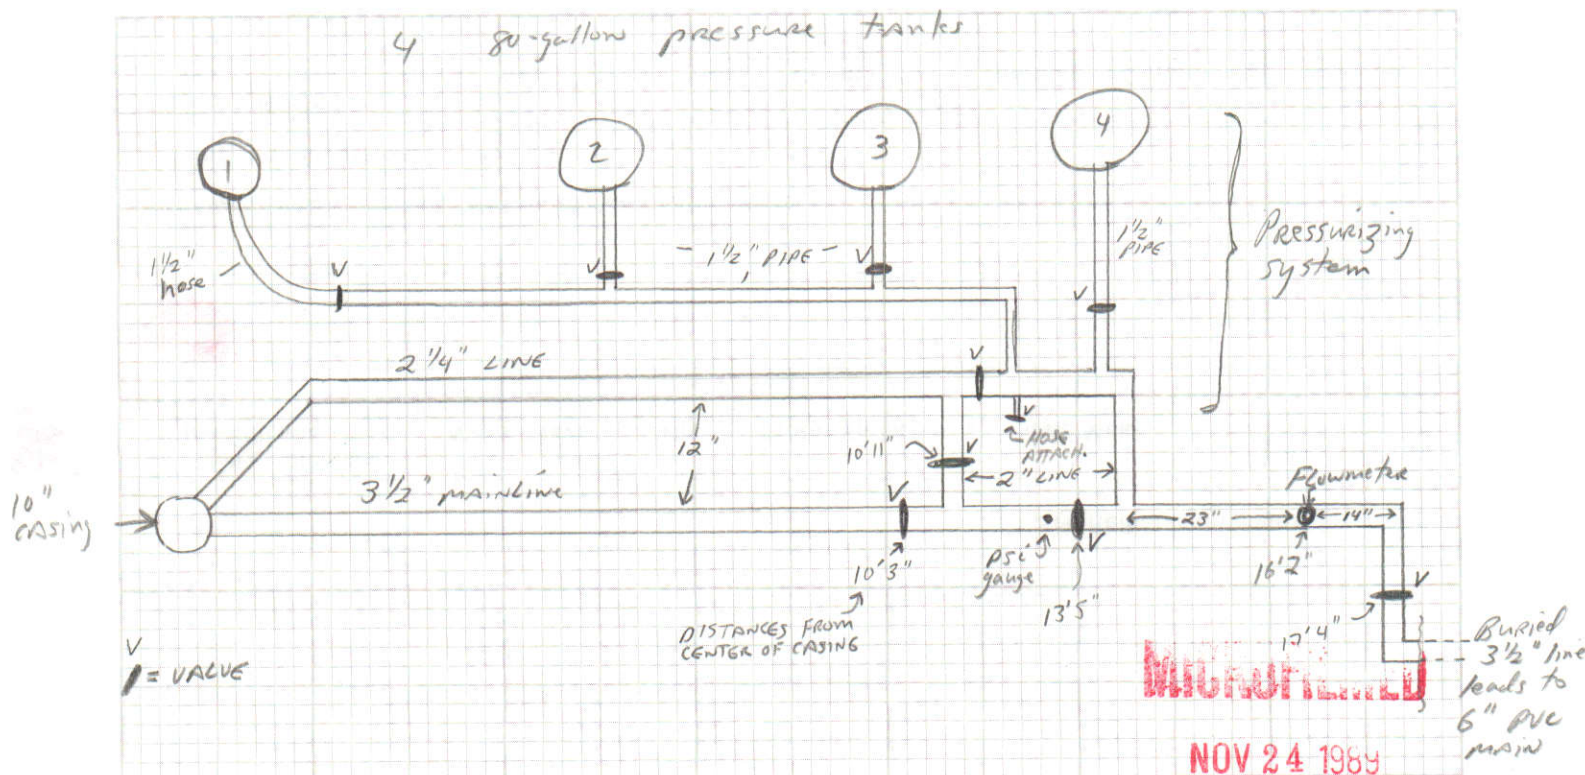


Scale: 1" = NOT TO SCALE

2. ☒ Copy of U.S.G.S. Quadrangle Attached
Showing location(s) of point(s) of diversion and
place(s) of use (required). ☐ Aerial Photo Attached;
(required for irrigation of ~~10~~ acres or more).
- ☒ Photo of Diversion and System Attached
(required for all but single household domestic groundwater, and stockwater).

63-8124

4N 1E


S. 8

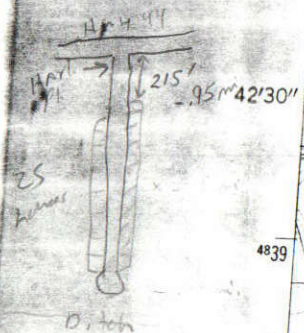

From S. end to
N. end of subdiv.
13' 0.2 m


From well to
Hwy 44 is .13 m

From Hwy 44 to
Eagle Rd is .17 m

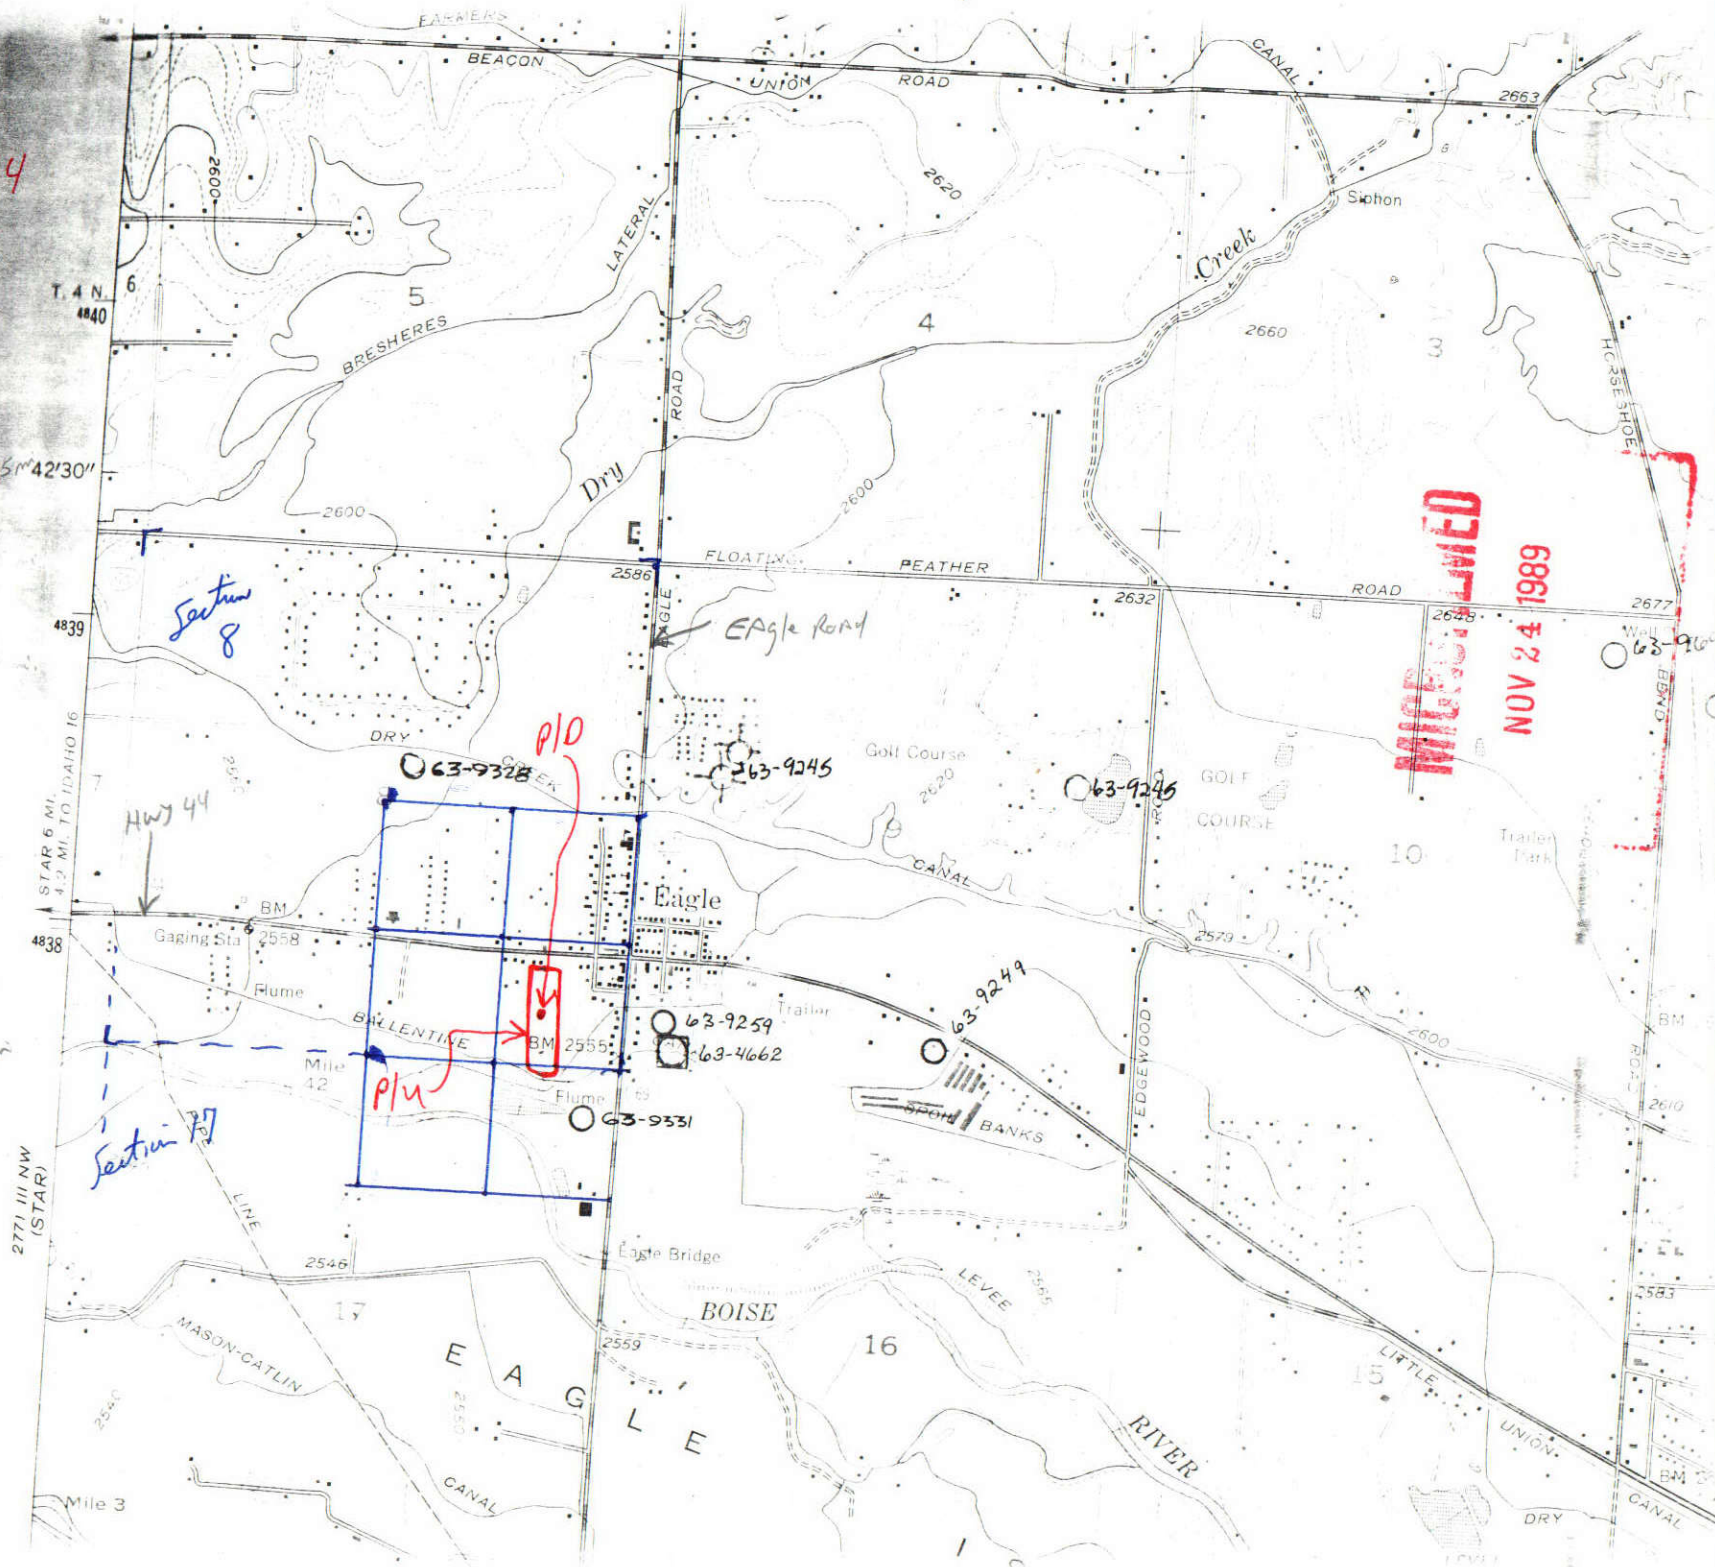

RECEIVED

NOV 24 1989

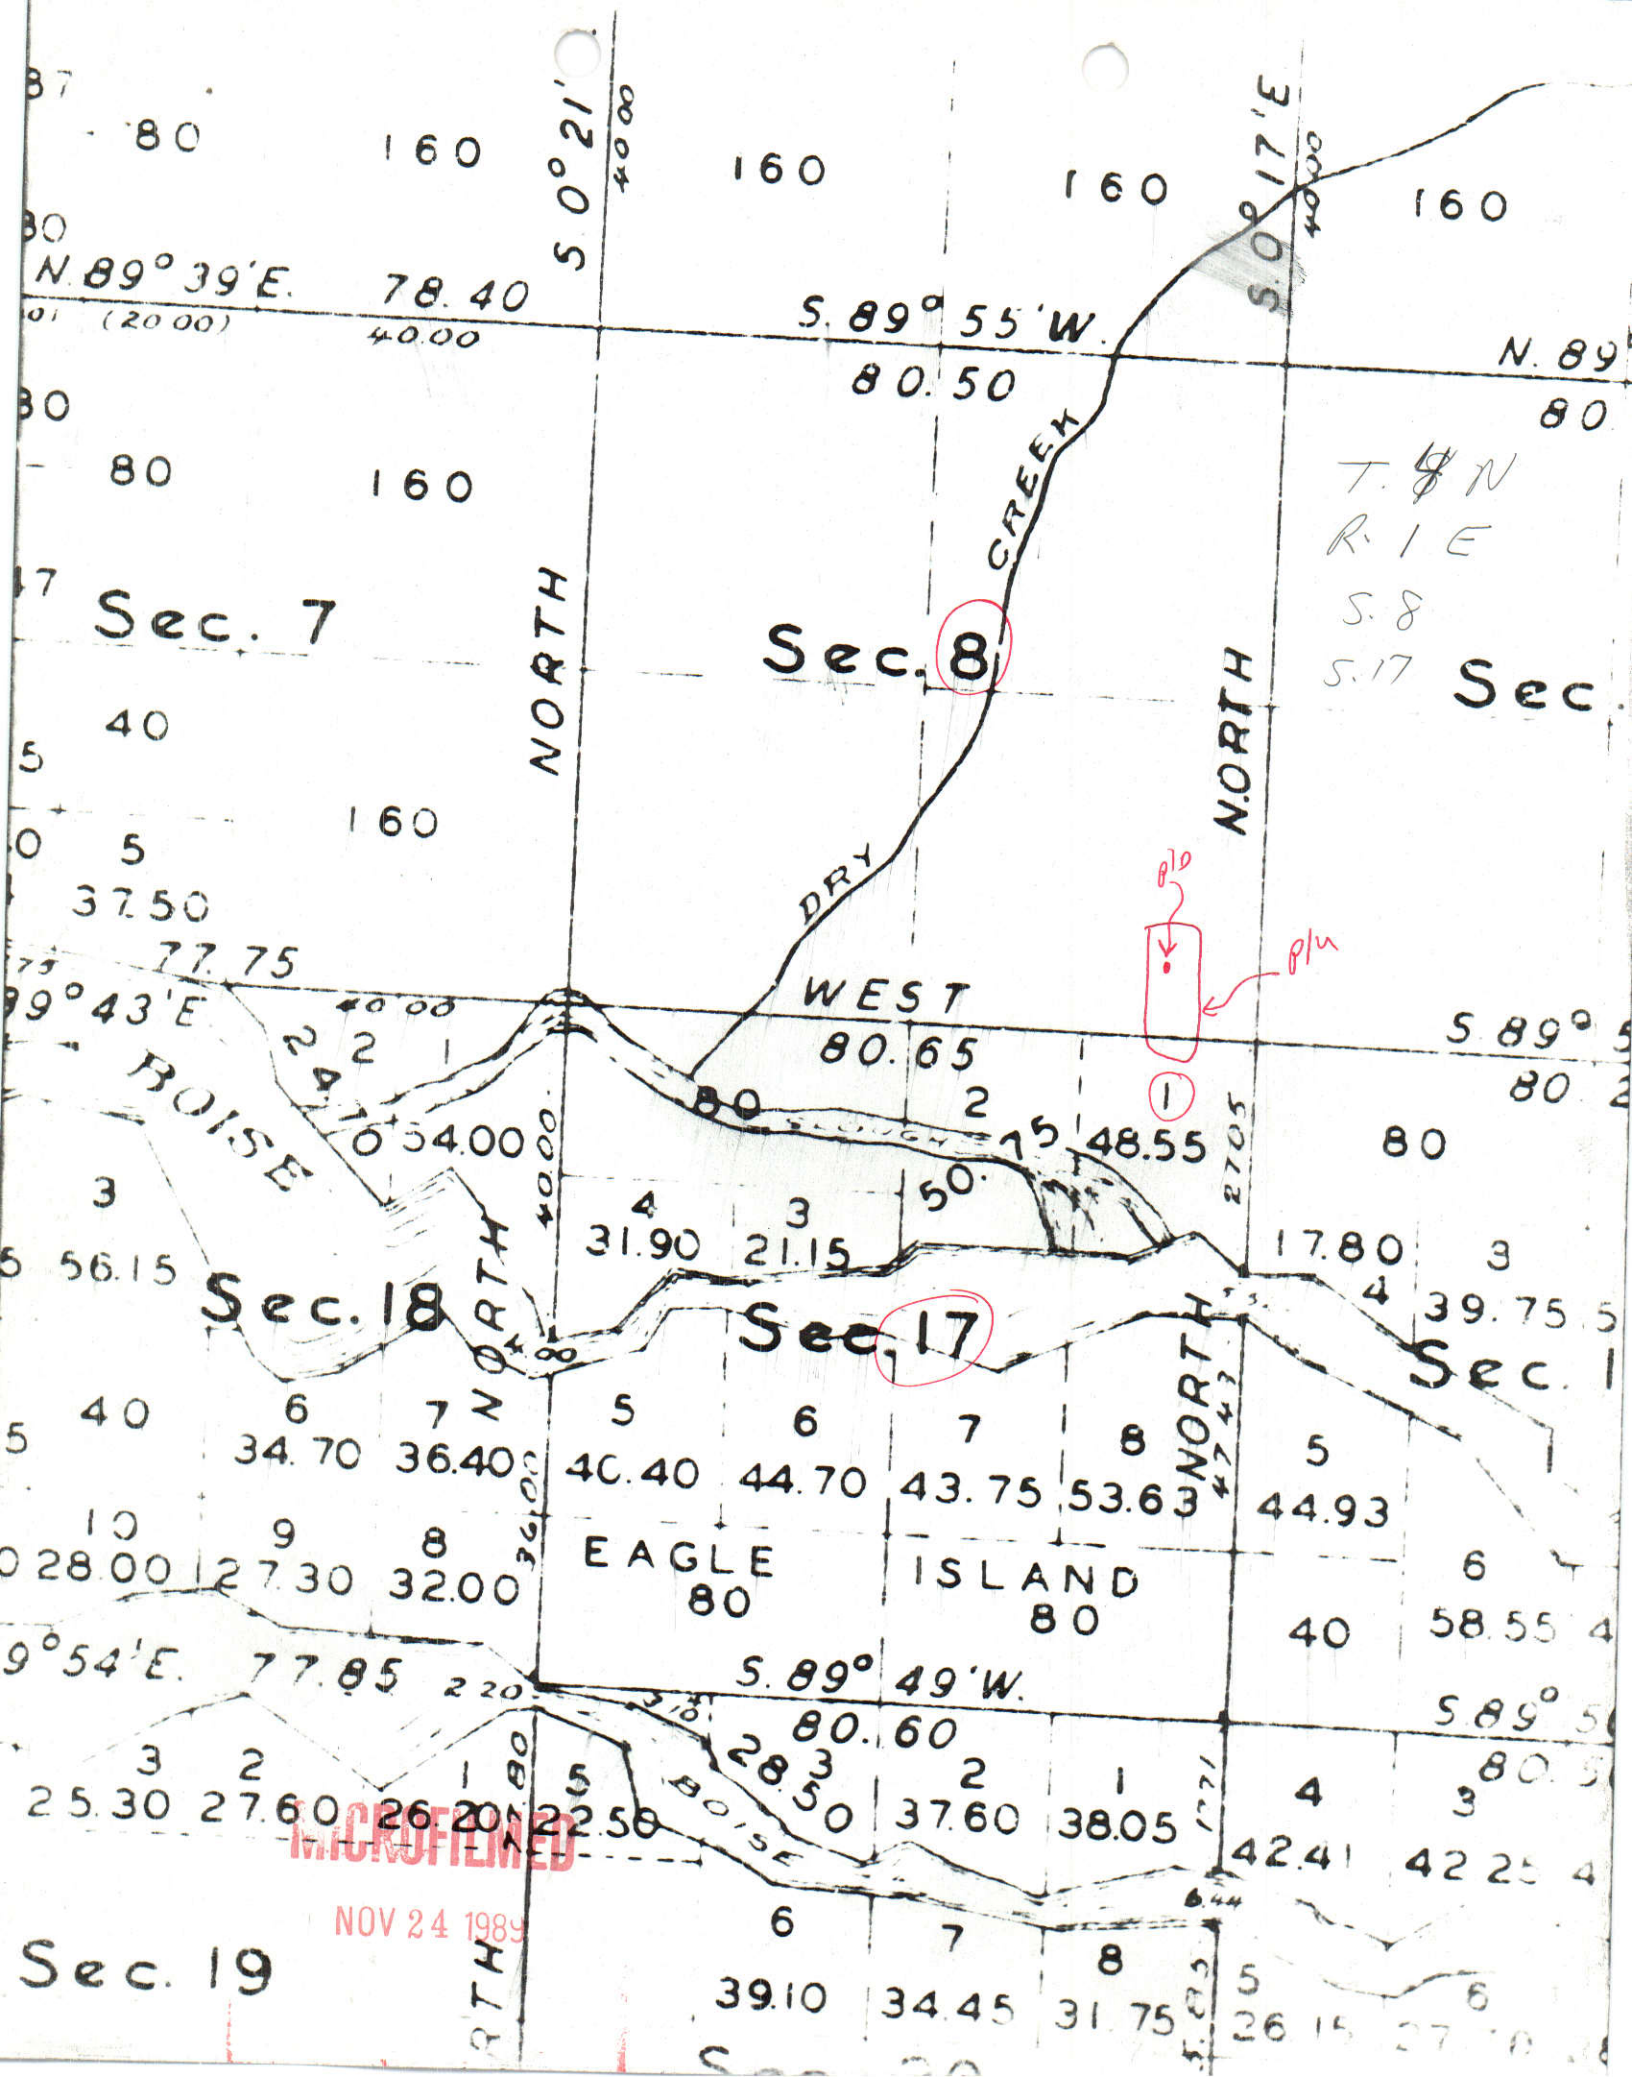


63-8124

Eagle West Subdiv.



P10- well just SW of intersection of Hwy 44 & Eagle Rd.

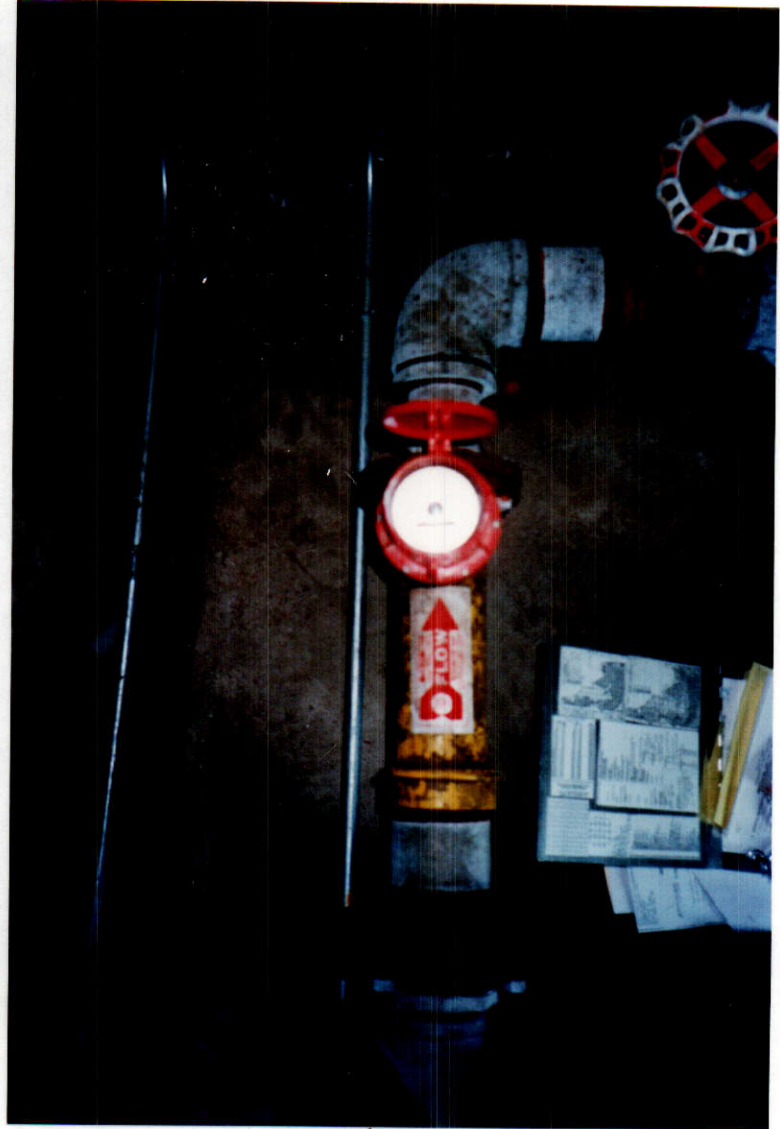

Flowmeter installed in 3 1/2" line 14" upstream from elbow.



P14


Typical view on Harlan Place road in Eagle.

NOV 24 1989

MICROFILMED

11. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.


TAN RIE

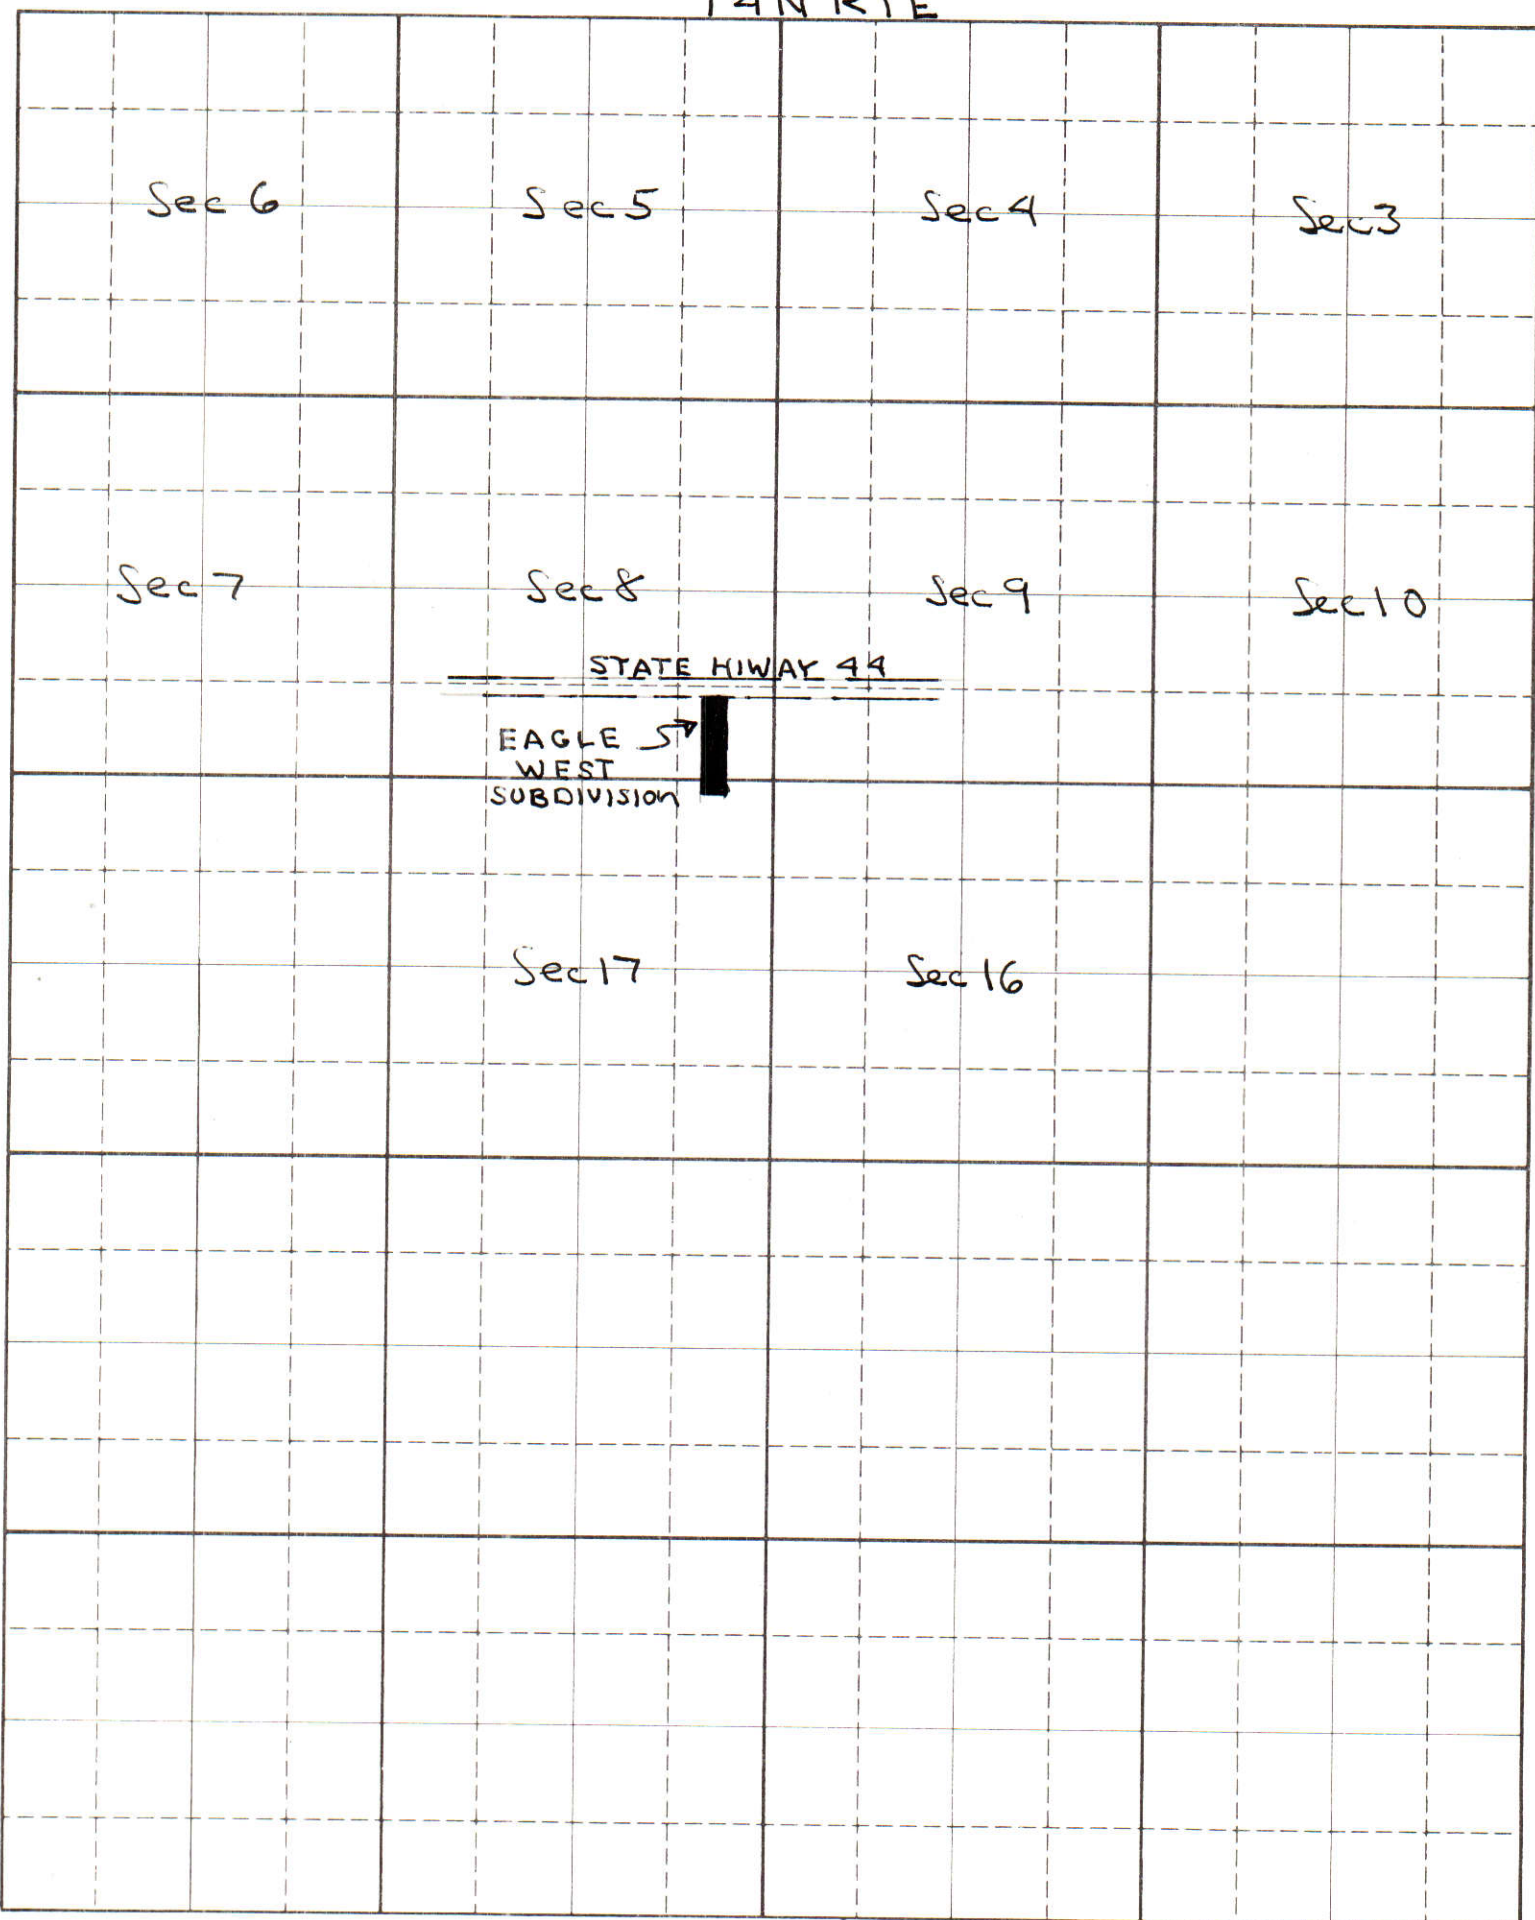

Scale: 2 inches equal 1 mile

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Larry O. Weber Sec.
(Applicant)

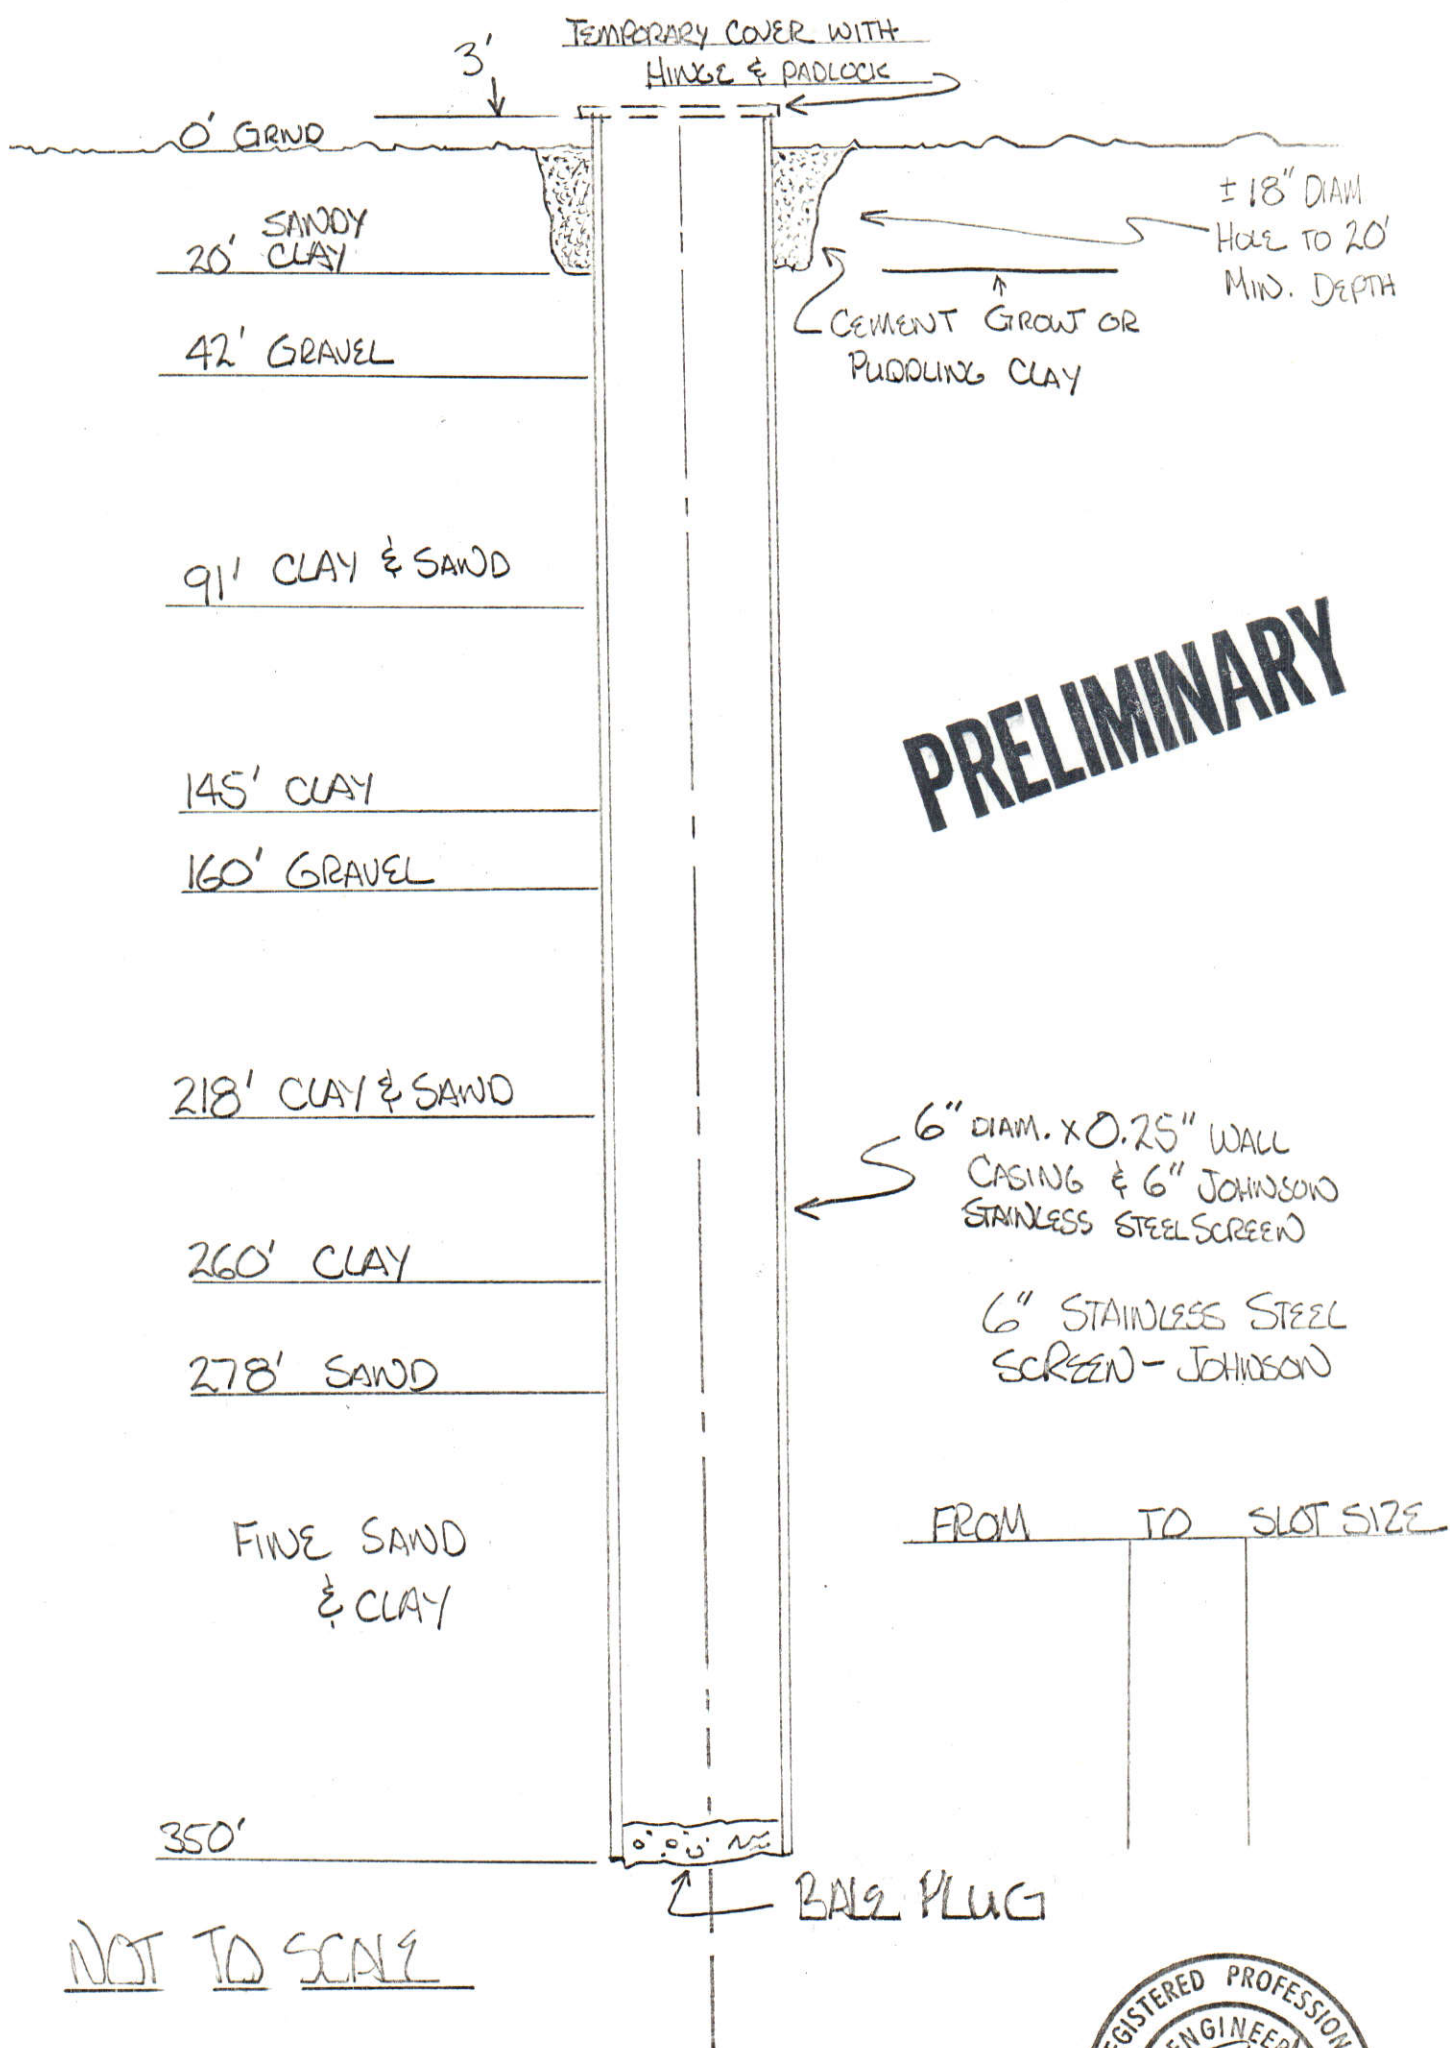

NOTE: WELL TO BE DRILLED TO A DEPTH TO PRODUCE A MINIMUM FLOW OF 325 GPM. ACTUAL DEPTH TO BE DETERMINED BY ENGINEER & DRILLER DURING CONSTRUCTION.



MICROFILMED

WELL DESIGN FOR EAGLE WEST
IN THE SE 1/4 SEC 8 & NE 1/4 SEC 17, T4N, R1E
PM. ADA CO. TRAIL

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 63-08124

Priority: May 2, 1975

Maximum Diversion Rate:

0.23 CFS

Maximum Diversion Volume:¹

30.0 AF

This is to certify, that VAN HESS BUILDERS INC.

RT. 2

KUNA, ID 83634

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated May 2, 1975; and has submitted Proof of Beneficial Use on May 1, 1980. An examination indicates that the works have a diversion capacity of .230 cfs of water from a **GROUNDWATER** source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	0.23 CFS	30.0 AF
FIRE PROTECTION	01/01 to 12/31	0.23 CFS	
	Totals	0.23 CFS	30.0 AF

LOCATION OF POINT(S) OF DIVERSION:

SESE , Sec. 8, Township 04N, Range 01E
ADA County

PLACE OF USE: DOMESTIC

TWN RGE SEC

04N 01E 8 SESE
17 LOT 1(NENE)

PLACE OF USE: FIRE PROTECTION, same as DOMESTIC use

CONDITIONS/REMARKS:

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to reflect cropping patterns or acceptable standards of water delivery efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. Domestic use is for 25 homes.

MICROFILMED

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 63-08124

This license is issued pursuant to the provisions of Section 42-219, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this 21st
day of NOVEMBER, 1987.

Acting for


R. Keith Higginson, Director

RECEIVED

NOV 24

BEFORE THE DEPARTMENT OF WATER RESOURCES
OF THE
STATE OF IDAHO

IN THE MATTER OF CHANGING THE MEASURING
DEVICE REQUIREMENT FOR PERMIT NO. **63-8124**

ORDER

WHEREAS, the above numbered permit was approved with the condition that a measuring device of a type approved by the Department be permanently installed and maintained as part of the diverting works; and,

WHEREAS, on July 1, 1978, the Department adopted a new water measurement condition which states: "An access port or other device as specified by the Department shall be installed by the permit holder to provide for the installation of measuring equipment and the determination of the rate of diversion by the Department"; and,

WHEREAS, the former condition required the permit holder to purchase and install a measuring device or hire a professional engineer to certify the rate of diversion; and,

WHEREAS, the measuring device condition effective July 1, 1978, requires less capital expenditure by the permit holder; and,

WHEREAS, to be equitable to holders of permits issued prior to July 1, 1978, the new condition should be retroactive;

NOW THEREFORE, it is hereby ordered that the condition of approval of this permit related to water measurement is hereby changed as follows: "The permit holder shall either install a measuring device or provide a certified measurement by a professional engineer or install an access port or other device as specified by the Department".

Dated this 18th day of August, 1978.


C. STEPHEN ALLRED
Director

MICROFILMED

Send a copy of all correspondence to:
David H. Roylance, P.E.
Friends Survey
619 Grove St.
Boise, ID 83702
Tel. (208) 342-5792

Identification No. _____

Application No. 63-8124

Amended

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR PERMIT

APPROVED

To Appropriate the Public Waters of the State of Idaho
(TYPE OR PRINT IN INK)

1. Name of applicant Van Hees Builders Inc. Phone: 692-1178
post office address Rt. # 2, Kuna, ID 83634
2. Source of water supply groundwater which is a tributary of _____
3. a. Location of point of diversion is SE $\frac{1}{4}$ of SE $\frac{1}{4}$ of Section 8 Township 4N
Range 1E B.M. Ada County; additional points of diversion if any: _____

b. If water is not consumed, it will be discharged into _____ at a point in _____ $\frac{1}{4}$
of _____ $\frac{1}{4}$ of Section _____ Township _____ Range _____ B.M. _____
4. Water will be used for the following purposes:
Amount 1.0 for Dom purpose from Jan 1 to Dec. 31 (both dates inclusive)
(cfs or acre-feet per annum)
Amount 1.0 for fire protection purpose from Jan 1 to Dec. 31 (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purpose from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
5. Total quantity to be appropriated:
a. 1.0 cubic feet per second and/or
b. _____ acre feet per annum.
6. Proposed diverting works:
a. Description of ditches, flumes, pumps, headgates, etc. well with pump, underground pressure pipe system, 250 gal. storage and 6" pvc water mains

b. Height of storage dam _____ feet, active reservoir capacity _____ acre feet; total reservoir capacity _____ acre feet, materials used in storage dam: _____
Period of year during which storage will occur _____ to _____ inclusive.
(Mo. Day) (Mo. Day)
c. Proposed well diameter is 6 inches; proposed depth of well is 350 feet.
7. a. Time required for the completion of the works and application of the water to the proposed beneficial use is 5 years.
b. Estimated construction cost is \$ 10,000.
8. Description of proposed uses:
a. If water is **not** for irrigation:
(1) Give the place of use of water: NE $\frac{1}{4}$ of NE $\frac{1}{4}$ of Section 8 Township 4N
Range 1E B.M. _____
(2) Amount of power to be generated: _____ hp under _____ feet of head.
(3) List number of each kind of livestock to be watered _____

(4) Name of municipality to be served Eagle West Sub., or number of families to be supplied with domestic water 27.
(5) If water is to be used for other purposes describe: fire protection

MICROFILMED

b. If water is for irrigation, indicate acreage in each subdivision in the tabulation below:

TWP.	RANGE	SEC.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				TOTALS
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	

Total number of acres to be irrigated _____

c. Describe any other water rights used for the same purposes as described above. none


9. a. Who owns the property at the point of diversion applicant

b. Who owns the land to be irrigated or place of use applicant

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing _____

10. Remarks This application is for domestic water for Eagle West Subdivision
which will have 27 homes. Fire protection will also be provided.

11. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

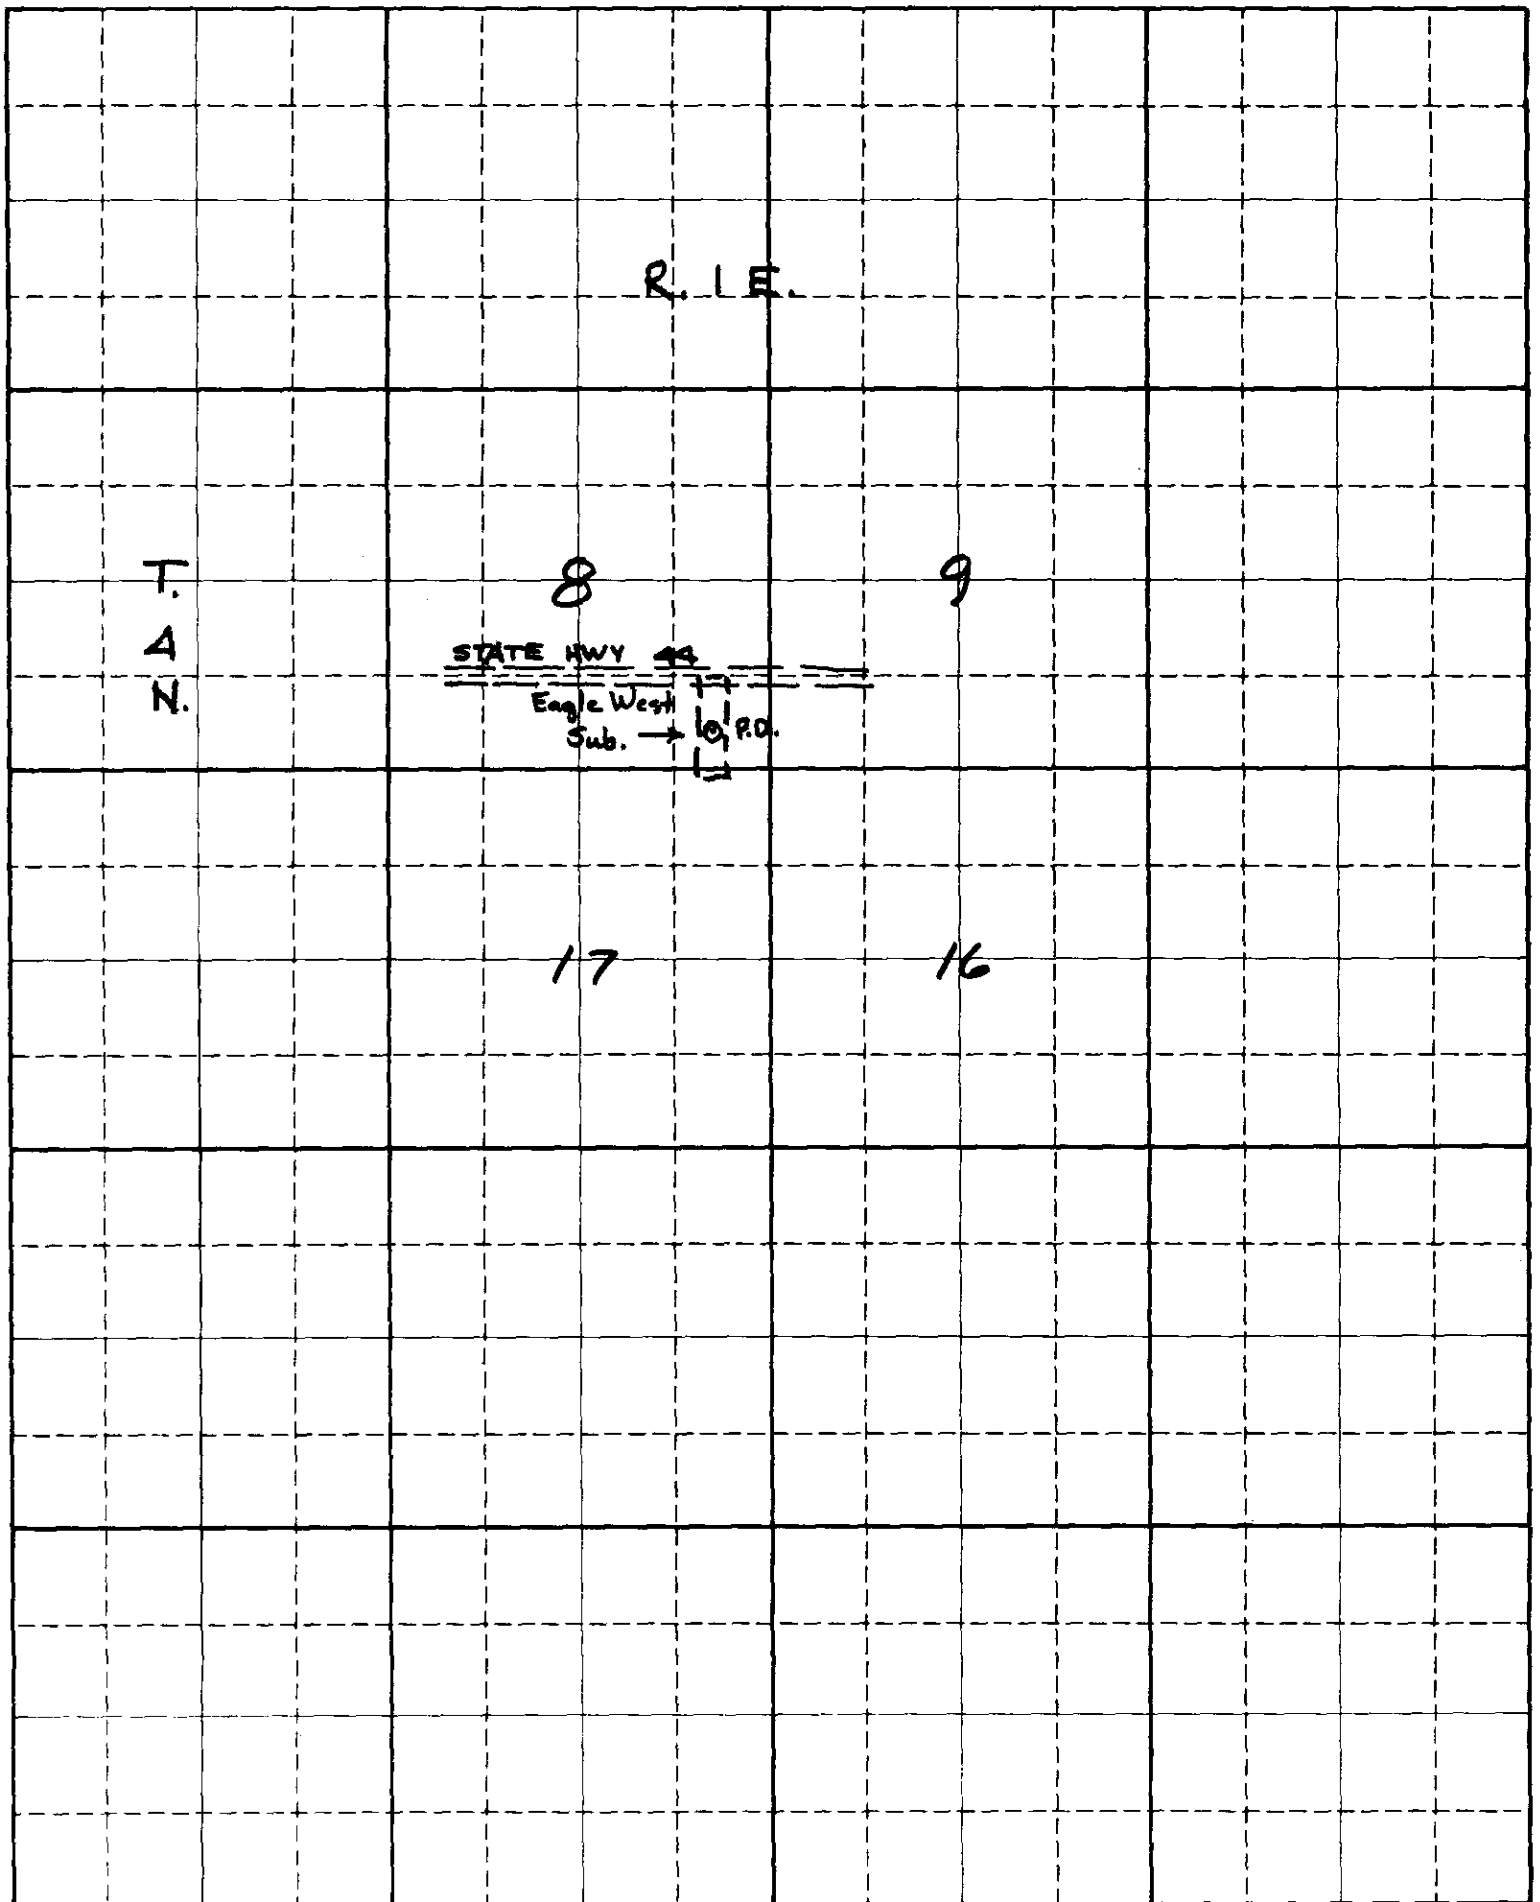

Scale: 2 inches equal 1 mile

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Sammy Van Hoesen Sec'y
(Applicant)

~~Proposed Priority~~ 5-22-1975

Received by cy Date 5/12/75 Time 9:30 A
Preliminary check by CS Fee \$ 25.00
Received by CS Date 5/12/75 # 520
Publication prepared by CS Date 5-22-75
Published in Idaho Statesman
Publication dates May 29 & June 5
Publication approved _____ Date _____
Priority reduced to _____ Reason _____

Protests filed by: _____

Copies of protests forwarded by _____
Hearing held by _____ Date _____
Recommended for approval denial by JYS

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES


This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. 63-8124, and said application is hereby APPROVED.

1. Approval of said application is subject to the following limitations and conditions:

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
- b. Proof of construction of works and application of water to beneficial use shall be submitted on or before June 1, 19 80.
- c. Other: A measuring device of a type approved by this Department shall be permanently installed and maintained as part of the diverting works.

2. Denial of said application is for the following reasons: _____

Witness my hand this 20th day of June, 19 75.

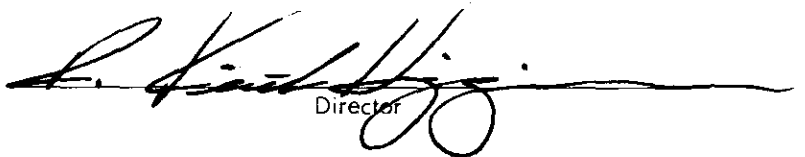
Director

STATE OF IDAHO)
COUNTY OF ADA) ss.

Dorothy Eiguren, being duly sworn, deposes and says: That she is the Principal Clerk of The Idaho Statesman, a daily newspaper printed and published at Boise, Ada County, State of Idaho, and having a general circulation therein and which said newspaper has been continuously and uninterruptedly published in said County during a period of twelve consecutive months prior to the first publication of the notice, a copy of which is attached hereto; that said notice was published in the regular edition of The Idaho Statesman for

two ~~consecutive~~ insertions, beginning with the issue of May 29, 19 75, and ending with the issue of June 5, 19 75.

Dorothy Eiguren

Subscribed and sworn to before me this 5th
day of June, 19 75.

John A. Young

Notary Public for Idaho, Residing at Boise, Idaho

John A. Young

November 22, 1989

VAN HESS BUILDERS INC.
RT. 2
KUNA, ID 83634

RE: PERMIT NO. 63-08124

Dear Permit Holder(s):

Enclosed herewith is a copy of the Water Right License issued on the above referenced permit.

Sincerely,

JIM JOHNSON
Water Rights Supervisor

JJ:sc

Enclosure

MICROFILMED

NOV 24 1989

October 26, 1989

VAN HESS BUILDERS INC.
RT. 2
KUNA, ID 83634

RE: PERMIT NO. 63-08124

Dear Permit Holder(s):

Enclosed is a draft copy of the license proposed to be issued on the above referenced water right.

This right is currently being reviewed by this office for licensing. The enclosed preliminary copy is subject to change upon further administrative review.

We ask that you review the proposed license and if you do not concur with the information, please let us know within 10 days.

Sincerely,

JIM JOHNSON
Water Rights Supervisor

JJ:sc

Enclosure

MICROFILMED

NOV 24 1989

POINT OF DIVERSION OVERLAP REVIEW

WR-NUMBER	TWP	RNG	SC	TRACT 1\4 1\4 1\4	LT	#SOURCE	#NAME
6308124	04N	01E	8	SE SE		GROUNDWATER	VAN HESS BUILDERS IN
6304465						UNNAMED DRAIN	RANDALL, JEROME W.
6304727						UNNAMED DRAIN	JACKSON, ORVILLE


MICROFILMED

NOV 24 1969

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

Staff Analysis Sheet
for
Beneficial Use Field Report

Permit No. 63-8124

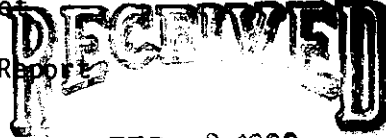

A. Prior to Conducting the Exam, the File Contains:

FFR - 3 1988

- ☒ Blank Field Report Form
- ☒ Copy of Permit
- ☒ Copies of any Amendments/Orders with conditions of approval
- ☒ Computer Data Proof Report
- ☒ Copy of U.S.G.S. Quad
- ☒ Check for Government Lots. If so, make a copy of Government Plat

Department of Water Resources

Assignment? not found -
State File 12/21/86 SL

Check of P/D index SL 12/29/86 (Initial and date)

Overlap? ☒ yes ☐ no If yes: ☐ copy of exam(s) attached? N/A
Type of Overlap? ☐ Add acres or uses to existing system
☐ Increase rate of flow or volume
☒ Other: 63-4465 & 4727 USE UNNAMED DRAIN

Check of P/U index SL 12/29/86 (Initial and date)

Overlap? ☒ yes ☐ no If yes: ☐ copy of water right(s) attached? N/A
Type of Overlap? ☐ Increase rate of flow or volume
☐ Add P/D's
☐ Increase number of acres within tracts
☒ Other: _____

Aerial Photo

Required? ☐ yes ☒ no If yes: ☐ copy attached?

Scheduling Letter sent? 6/20/86 SL (Initial and date)

☒ Appointment made and telephone conversation memo attached

B. After Conducting the Exam, the File Contains:

- ☒ Fully completed and signed Field Report Form
- ☒ Photographs of Point of Diversion and Place of Use
- ☒ Corrected Computer Data Proof Report with recommended license information, and date and signature of examiner.

C. Review and Processing:

Exam Completed Steve Lester 6/19/87 (Signature of examiner and date)
Exam Reviewed by Senior Water Resource Agent GD 1/15/88 (Initial and date)
Exam Reviewed by Manager of Regional Office Ang 11/1/88 (Initial and date)
Exam Date Entered in Computer ✓ (Initial and date)
Exam sent to State Office SL 2/2/88 (Initial and date)
Copy of Staff Analysis Sheet sent to Manager of Regional Office and Original
Refiled in White File _____ (Initial and date)

System Description (continued)

3. Narrative: Description (As operating at time of measurement. Indicate pressure, number of sprinklers, etc.)

A 10" cased well of unknown depth uses a 3 1/2" mainline and 4 pressure tanks (320 gallons total) to supply internal and external domestic water to 25 homes in the subdivision. Mainline runs 16' 2" from well before pipe is buried and leaves the pump house. Line then expands to a 6" PVC pipe. Lines to homes are probably 3/4"-1" but not known. A McCrometer flowmeter is found on mainline about 16' from casing (meter installed by Carow Pump Inc., 4/25/86). Meter unreliable, see D2, next page.

☐ See Remarks on page 4 for continuation

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
	Red Jacket Submersible	15	3HME8267	same	same; 3 1/2" pipe

*Code to correspond with No. on map and aerial photo

5. Point(s) of Diversion:

Ident. No.	Gov't. Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
			SE	SE	8	4N	1E	Ada	USGS 7 1/2' Quads

6. Place(s) of Use:

Indicate Method of Determination USGS 7 1/2' Quads

Twp.	Rge.	Sec.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				Totals
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
4N	1E	8																0	-
		17																0	-
																		0	-
																		0	-
																		0	-
																		0	-
																		0	-
																		0	-
																		0	-
																		0	-

UNRECORDED

Do not use this space

NOV 24 1989

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No. 63-8124
1. Owner: Eagle West Subdivision Water Corp. Phone No. 939-8288
Current Address: 130 Harlan Pl. Eagle, Id 83616
2. Accompanied by: Doreta Stephansen EXAM. DATE: 6/19/87
Address: Same Phone No. Same
Relationship to Permit Holder: Sec'y - Treasurer
3. Source: groundwater tributary to —

B. OVERLAP REVIEW


1. Other water rights with same place of use: 63-0261, 2406, 3055, 4465, 4727, 2553, 7008,
☐ Copies Attached
2. Other water rights with same point of diversion: 63-4465 & 4727
☐ Copies Attached ☐ Copies of Field Exam's Attached

— NO COPIES NEEDED —

C. SYSTEM DESCRIPTION

1. **Diversion System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☐ Alternative diagram attached

4 80-gallon pressure tanks

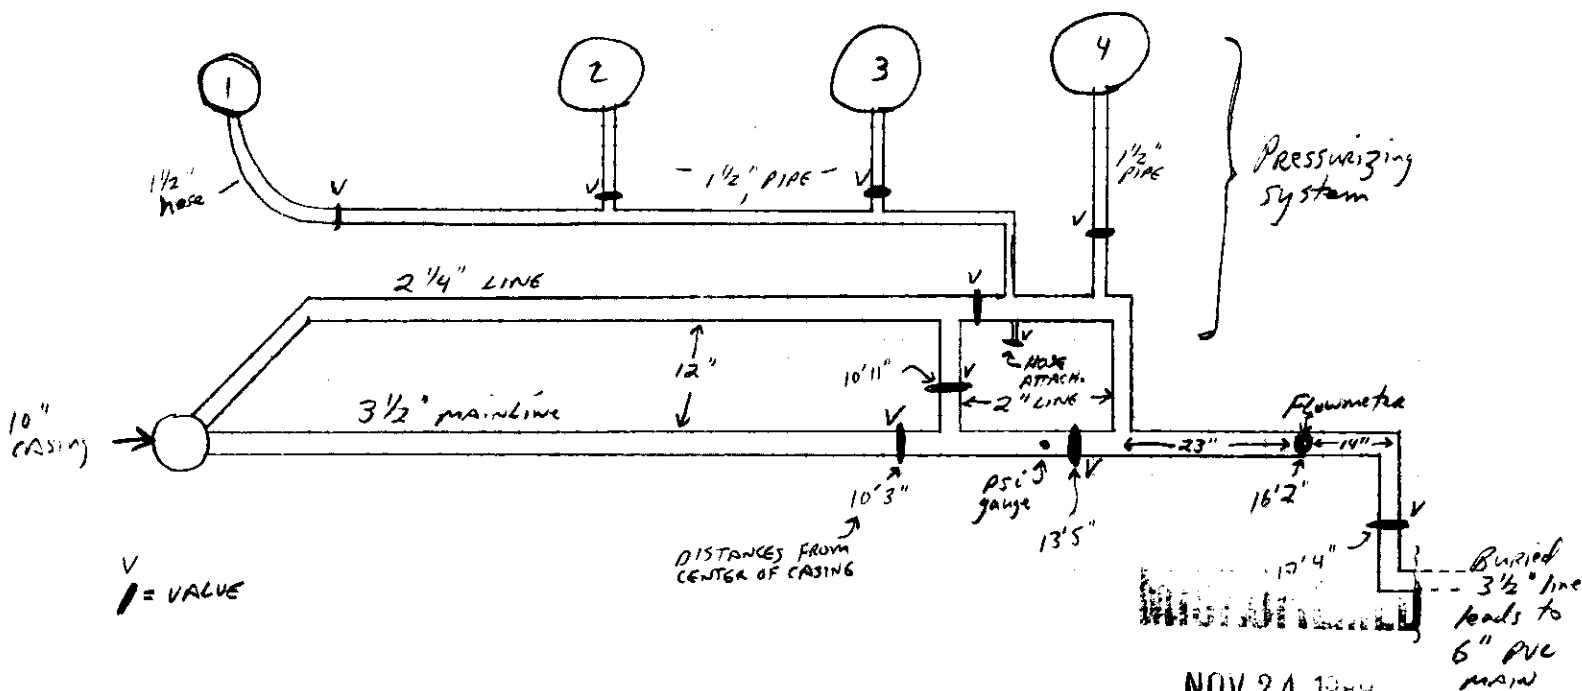

NOV 24 1988

Scale: 1" = NOT TO SCALE

2. ☒ Copy of U.S.G.S. Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required). ☐ Aerial Photo Attached (required for irrigation of 40 acres or more).
☒ Photo of Diversion and System Attached (required for all but single household domestic groundwater, and stockwater).

$$25 \times 1.2 = \underline{30.0} \text{ AFA}$$

V.

$$(.23)(365)(1.9835) = 166.5$$

USE SAME VALUE FOR NON-ADDITIVE FIRE PROTECTION USE.

Do not use this space

D. FLOW MEASUREMENTS

☐ Additional Data Sheets Attached

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
McCrometer Flowmeter				764456		

2. Measurements:

- 1) Very low flows observed during exam (flux 0-20 gpm with bursts to 40 gpm). Shut system down, waited awhile, resumed operating, and still found ~~similar~~ ^{similar} readings.
- 2) Had Mrs. Stephenson take reading on a Saturday, 6/27/87, to measure heavy use day. 9:00 a.m. 102405 gallons tally; 9:00 p.m. same reading. NO accumulated use registered during 12 hrs. on a hot ~~day~~ weekend day. Conclude meter is not reliable.

E. FLOW CALCULATIONS

☐ Additional Computation Sheets Attached

1. Measured Method: ^{-ignore flowmeter as discussed above.}
^{-From DOMESTIC USE CHART: 25 homes = .23 cfs}

2. Alternate Method for Checking Purposes:

z:
 No well log
 but many wells
 in S. 8 have static levels from 5-40 ft.

HP eq. where $\begin{cases} h_p = 15 \\ \text{eff} = .6 \text{ (plumbing)} \\ \text{psi} = 55 \\ z = 50 \text{ (assume)} \end{cases}$

$$Q = \frac{(8.8)(15)(.6)}{(2.31 \times 55) + 50} = \frac{79.2}{177.05} = .45 \text{ cfs}$$

F. PUMP EFFICIENCY DATA (Optional) - N/A - NO access into well, no reliable flow measurement

Discharge Pressure: _____ psi x 2.31 = _____ ft (1); Dynamic pumping level: _____ ft (2)

Total Head: (1) + (2) = _____ (3); Flow rate: _____ cfs (4)

Water HP: (3) x (4) ÷ 8.8 = _____ (5)

Meter Input KW: 3.6 x _____ KH x _____ CTR or _____ MULT x _____ PTR x _____ N/ _____ T = _____ (6)

Meter Input HP: (6) x 1.34 = _____ (7)

Panel Input KW: _____ Ave PF x _____ Ave Volts x _____ Ave Amps x .001732 = _____ (6)

Panel Input HP: (6) x 1.34 = _____ (7) Efficiency: (5)/(7) x 100 = _____ %

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation: N/A

$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$ _____

$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 =$ _____

$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$ _____

2. Volume Calculations for Other Uses:

25 homes, int. & ext. use:

$$25 \times 1.2 = \underline{30.0} \text{ AFA}$$

V.

$$(.23)(365)(1.9835) = 166.5$$

USE SAME VALUE FOR NON-ADDITIVE FIRE PROTECTION USE.

RECEIVED

NOV 24 1989

H. REMARKS AND OVERLAP REVIEW ANALYSIS

Rec'd removal of measuring device requirement based on NO. homes served. Even generous assumptions in hp equation show a yield well below .70 cfs.

Overlap - NO CONFLICT.

P/D - Both are surface water.

P/U - only 63-3055 and 2553 show domestic use and are for other places than G.W. Subdiv. homes.

I. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
Domestic	1/1	12/31	.23	30.0
Fire Protection	1/1	12/30	.23	~~30.0~~ N/A
Totals:			.23	30.0

2. Recommended Amendments

☐ Change P.D. as reflected above

☐ Add P.D. as reflected above

☒ None

☐ Change P.U. as reflected above

☐ Add P.U. as reflected above

☐ Other

J. AUTHENTICATION

Field Examiner's Name

Steve Lester

Signature

Steve Lester

Certification Date

Field Report Preparation Date

6/19/87

CONSULTANT SEAL

BD
1/15/88

K. Licensing recommendation shall be prepared by an Idaho Department of Water Resources employee on a computer printout attached hereto.

DOM 8/15/89

MICHAEL STUDBLEFIELD


NOV 24 1987




From S. end to
N. end of sub. is .2 m

From well to
Hwy 44 is .13 m

From Hwy 44 to
Eagle Rd is .17 m

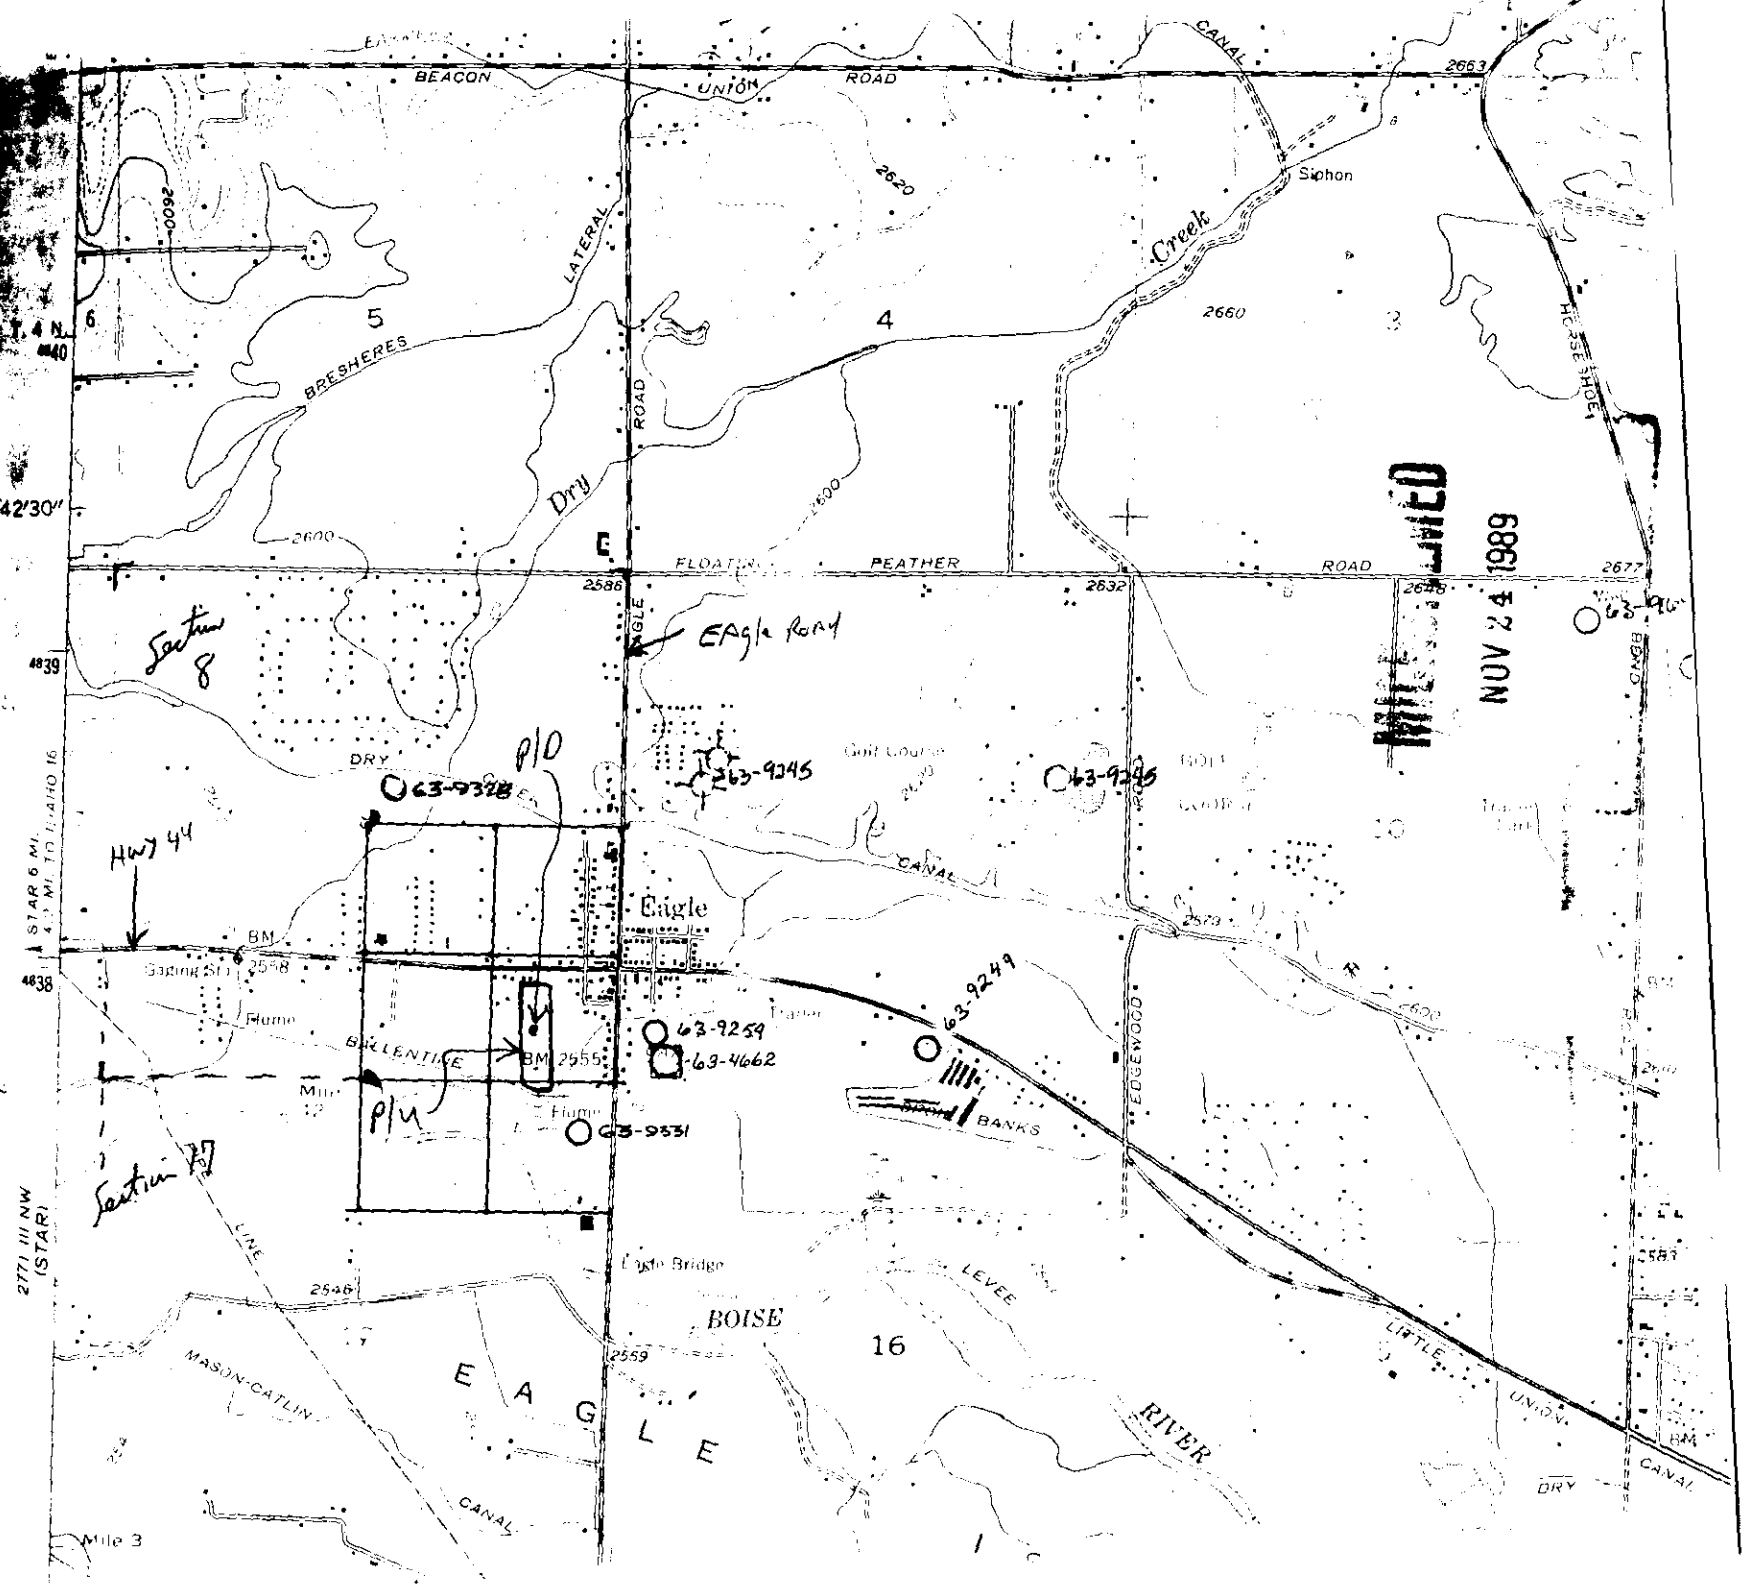

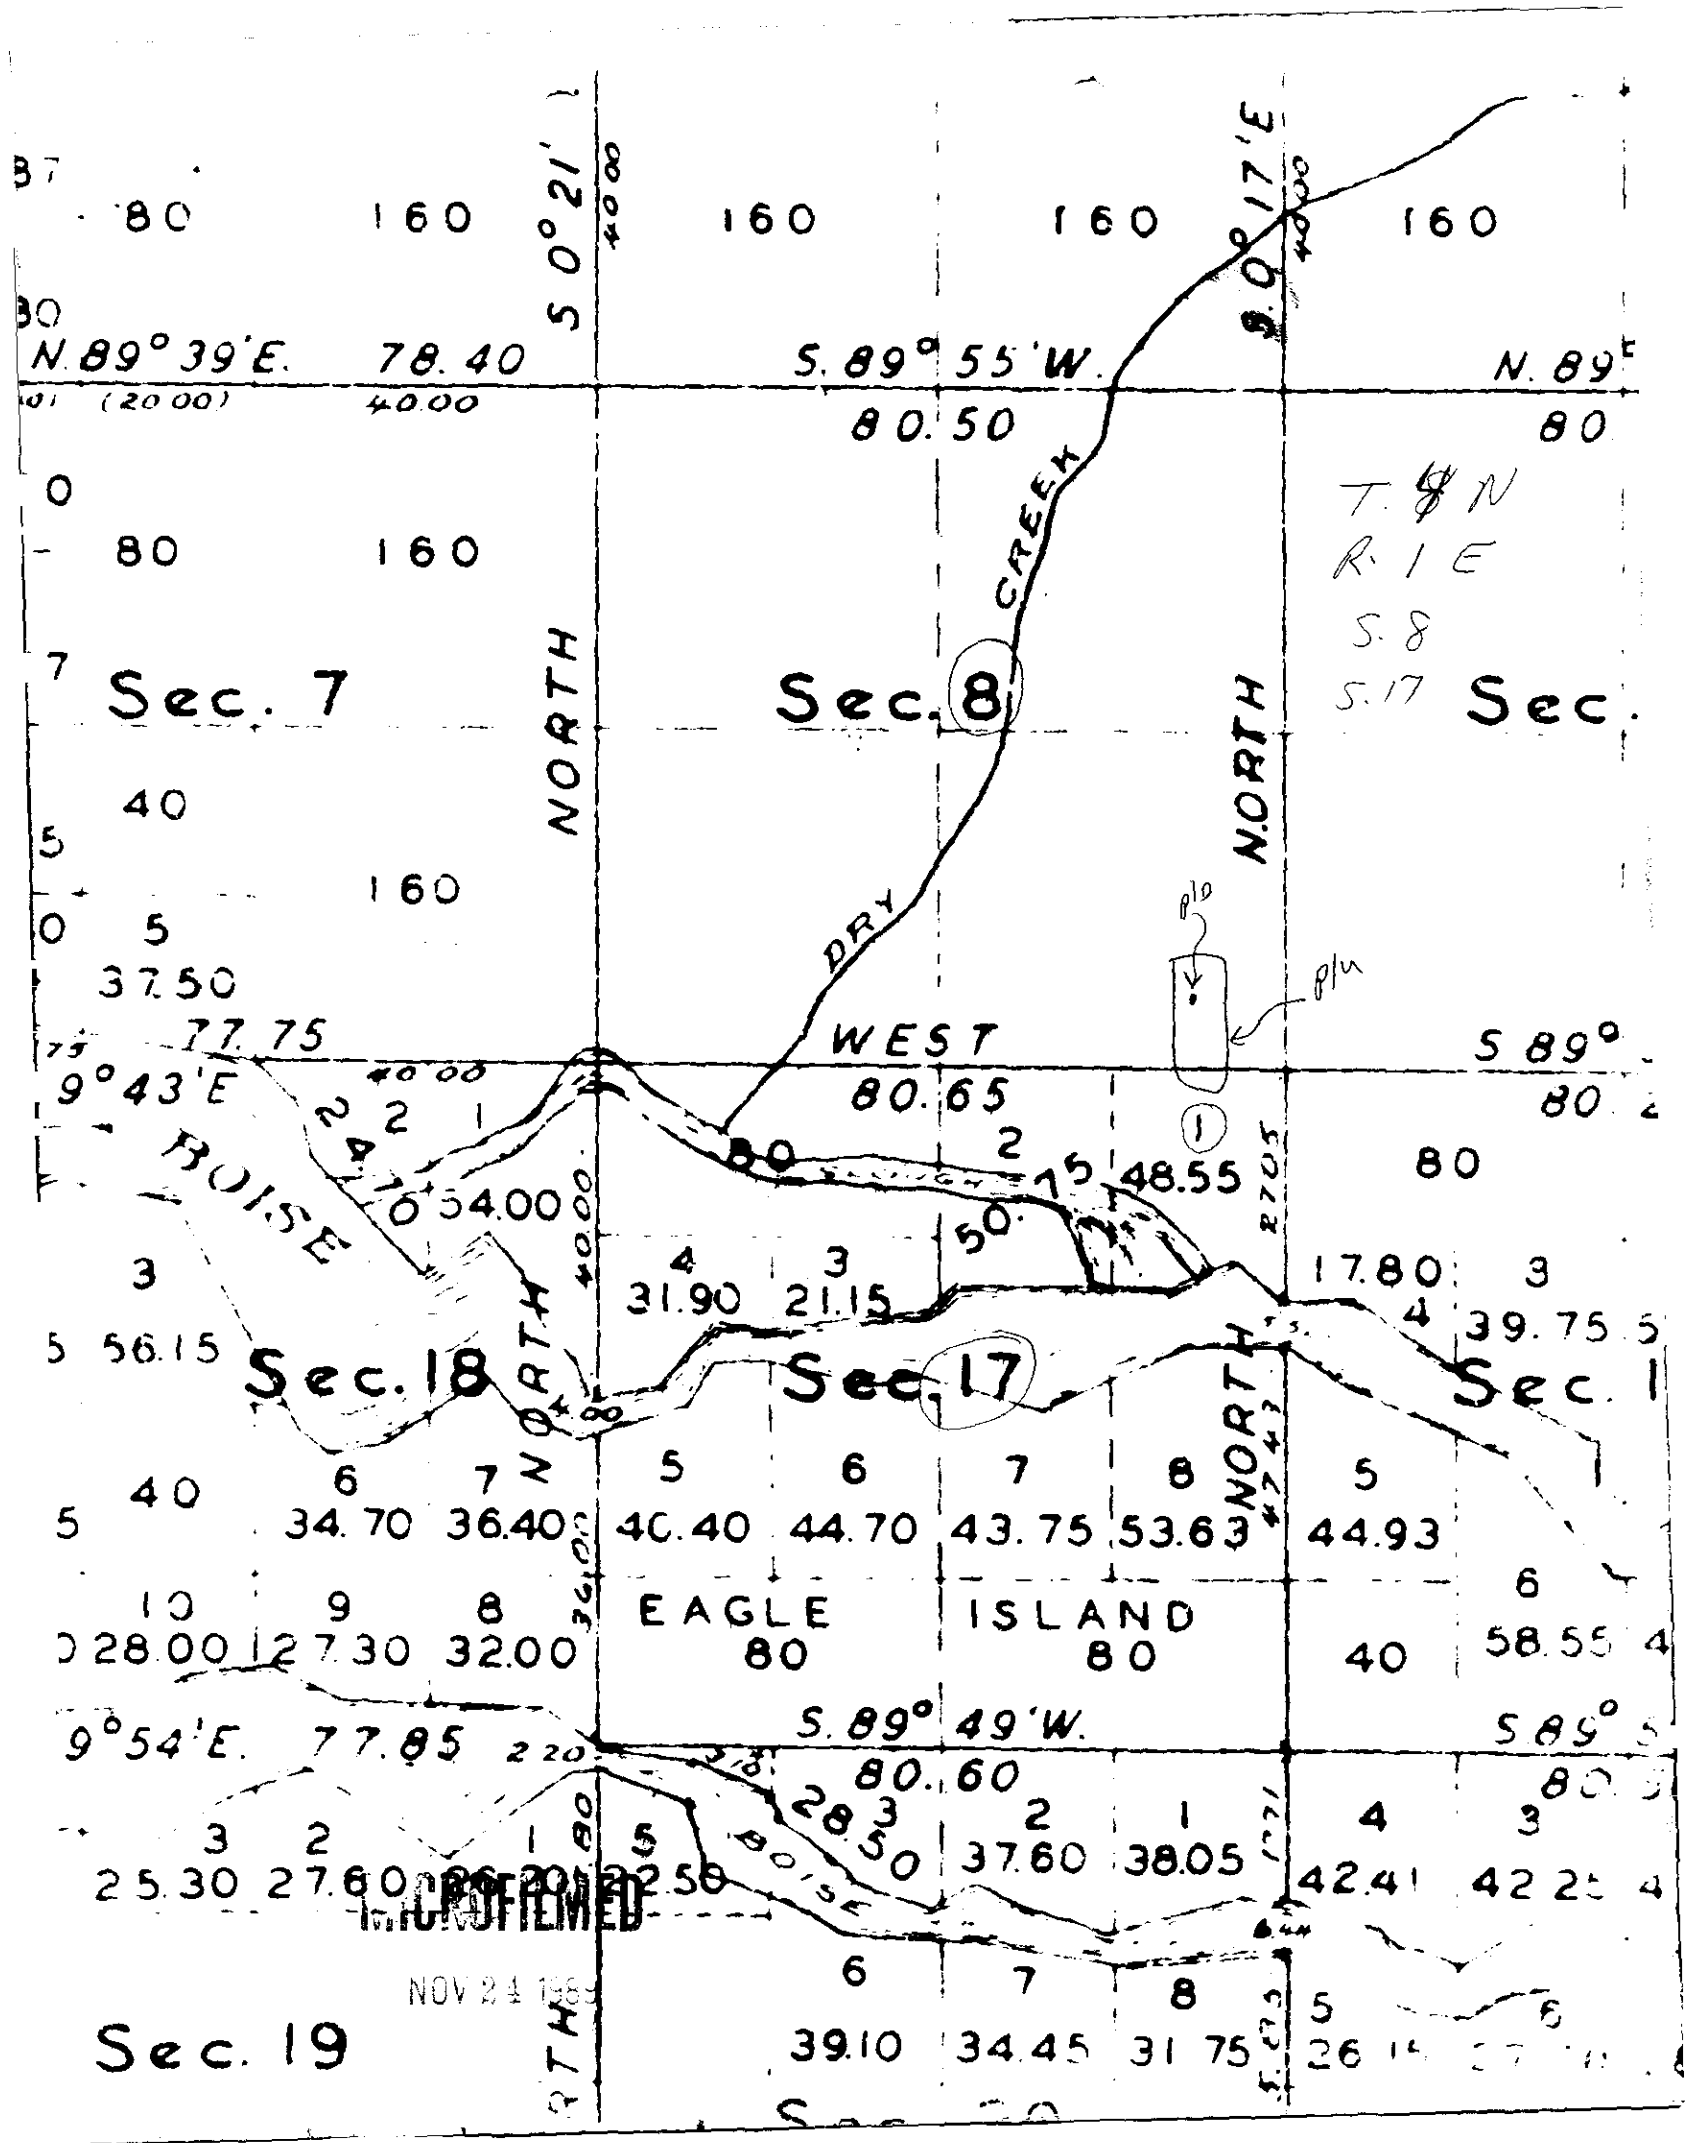

43-8124

Eagle West Subdiv.



P/O- well just SW of intersection of
Hwy 44 & Eagle Rd.



Flowmeter installed in 3 1/2" line 14" upstream
from Elbow.



P/4

Typical view on Harlan
Place road in Eagle.

NOV 24 1989

MICROFILMED

6/19/87

I request that the measuring device
Requirement be removed from Permit 63-8124 since
less than 0.7 cfs is used.

Doneta Stephenson

Witnessed by Stan Lester, Water Resource Dept

MICROFILMED

NOV 24 1989

4/8
RECEIVED

JUN 12 1986

KEYPUNCHED

For Office Use Only
Fee Received 100
Date 6/3/86
Receipt # 40332
Receipt by SP
Sent to S.O. 6/12/86

Department of Water Resources

DEPARTMENT OF WATER RESOURCES

EXAMINATION FEE INFORMATION

RECEIVED

MAY 23 1986

1. Permit No. 63-8124

ONE OF THE FOLLOWING BOXES SHOULD BE MARKED TO DESIGNATE YOUR CHOICE:

☒ I choose to have the department make the field examination of this permit; attached is the examination fee. (If this box is marked, complete items 1 thru 8.)

2. Permit Holder: Eagle West Subdivision Water Corporation

3. Post Office Address: 130 Harlan Place, Eagle, ID 83616

Telephone No. 939-8288

4. Source of Water: groundwater

5. Extent of Use:

Domestic 25 (No. of households) Stockwater _____ (No. and type of stock)

Irrigation _____ (acres) Other/Remark _____

6. Total rate &/or volume for which proof is submitted 1 cfs _____ acre-feet

7. Show the date water was first diverted and beneficially used under this permit:

5/02/75

8. Person to contact to accompany the department or examination:

Dr

field

Doneta Stephensen due 6/16
(Name)

130 Harlan Place
(Address)

- 8288
one Number)

☐ I choose to have the field examination conducted by a certified water right examiner. Attached is a statement from the certified examiner verifying that he has been retained to conduct the examination. (If this box is marked, complete items 1 thru 7.)

Date 5-22-86

Doneta Stephensen - Secretary
Signature of Permit Holder (and title, if appropriate)

RECEIVED
NOV 24 1989

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

WESTERN REGIONAL OFFICE
450 W. STATE ST.
BOISE, IDAHO 83720
(208) 334-2190
JUNE 20, 1986

VAN HESS BUILDERS INC.
RT. 2
KUNA, ID 83634

RE: PERMIT NO. 63-8124 FIELD EXAM NOTICE

DEAR PERMIT HOLDER:

WE ARE PLANNING TO CONDUCT WATER RIGHT EXAMINATIONS IN THE VICINITY OF THE ABOVE - REFERENCED PERMIT DURING THE WEEK OF JUNE 30, 1986. AN EXAMINATION IS NEEDED TO VERIFY YOUR WATER USE IN ORDER TO ISSUE A WATER RIGHT LICENSE.

ONE OF THE CONDITIONS OF APPROVAL OF YOUR WATER PERMIT WAS THAT A FLOW MEASUREMENT PORT, ALSO KNOWN AS AN ACCESS PORT, BE INSTALLED TO PROVIDE FOR THE INSTALLATION AND DETERMINATION OF THE RATE OF DIVERSION BY THE DEPARTMENT. ENCLOSED IS AN INSTRUCTION SHEET FOR INSTALLING THE FLOW MEASUREMENT PORT. THIS PORT OR AN ALTERNATE MEASURING DEVICE MUST BE INSTALLED PRIOR TO THE TIME THE EXAMINER IS SCHEDULED TO CONDUCT YOUR EXAM.

IN ORDER TO CONDUCT YOUR EXAM AS EFFICIENTLY AS POSSIBLE WE ASK THAT YOU CALL THIS OFFICE TO SCHEDULE A DAY AND TIME CONVENIENT FOR YOU.

IF THERE IS A PROBLEM WITH SCHEDULING OR CONDUCTING THE EXAMINATION AT THIS TIME, PLEASE CALL AND OTHER ARRANGEMENTS CAN BE MADE.

SINCERELY,

JAN SHURTE
SENIOR WATER RESOURCE AGENT

MICROFILMED

NOV 24 1989



State of Idaho

DEPARTMENT OF WATER RESOURCES

WESTERN REGION, 450 W. State Street, Boise, Idaho

JOHN V. EVANS
Governor

A. KENNETH DUNN
Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 334-2190

*Please
file in
63-8124*

April 29, 1986

Doneta Stephensen
130 Harlan Pl.
Eagle, ID 83616

Dear Ms. Stephensen:

Enclosed is a copy of Permit No. 63-8124 along with a copy of the letter sent to Van Hees Builders explaining the exam fee. Also enclosed is a copy of the letter I sent to Larry Van Hees concerning the assignment of this permit.

Please complete the paper-clipped form only and return it to this office with the exam fee. We will contact you this summer to schedule an exam which will complete the permit and a permanent license will be issued.

If you have any questions concerning this form or the exam, please do not hesitate to contact me.

Sincerely,

Jan Shurte

JAN SHURTE
Senior Water Resource Agent

JS:jp

Enclosures

NOV 24



State of Idaho
DEPARTMENT OF WATER RESOURCES
WESTERN REGION, 450 W. State Street, Boise, Idaho

JOHN V. EVANS
Governor

A. KENNETH DUNN
Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 334-2190

April 29, 1986

Van Hees Builders, Inc.
Attn: Larry Van Hees
Rt. 2
Kuna, ID 83634

Dear Mr. Van Hees:

After our phone call concerning Permit No. 63-8124 I spoke with Doneta Stephensen of the Eagle West Subdivision Water Corp. They are still interested in this permit and would appreciate having it assigned to them.

Therefore, please sign and notarize the enclosed assignment of permit form and return it to this office. If you have any questions concerning this permit, please do not hesitate to contact this office.

Sincerely,


JAN SHURTE

Senior Water Resource Agent

JS:jp

Enclosure

Department of Water Resources

ASSIGNMENT OF PERMIT

VAN HEES CONDS. INC.

I, LARRY VAN HEES, hereby assign to EAGLE WEST. SUP. WATER CO. INC.
of 130 HAWLAN PL., EAGLE, ID 83616
Address

CHECK ONE



All my right, title, and interest in and to Permit No. 63-8124
to appropriate the public waters of the State of Idaho.



The following described portion of my right, title, and interest in and to Permit
No. _____ to appropriate the public waters of the State of Idaho.

(Describe that portion of the permit being assigned by listing the acreage within
each 40 acre subdivision, the point of diversion and the amount of water in cubic
feet per second for direct diversion, or acre feet for storage)

Made this _____ day of _____, 19 _____.

Permit Holder

Spouse of Permit Holder

State of Idaho)
County of _____) ss.

On this _____ day of _____, 19 _____, personally
appeared before me the signer(s) of the above instrument, who duly acknowledged to me
that he (she) (they) executed the same.

seal

Notary Public residing at

RECORDED

My commission expires:

REV. 24 1939



State of Idaho

DEPARTMENT OF WATER RESOURCES

STATE OFFICE, 450 W. State Street, Boise, Idaho

JOHN V. EVANS
Governor

A. KENNETH DUNN
Director

Mailing address:
Statehouse
Boise, Idaho 83720

63-8124
VAN HESS BUILDERS INC.
RT. 2
KUNA, ID 83634

April 17, 1986

CERTIFIED MAIL

138390

EXAMINATION FEE NOTICE

Dear Permit Holder:

Department records show that proof of beneficial use has been submitted for the above-referenced permit, but that a field examination has not yet been conducted to determine the extent of beneficial use of the water for licensing purposes.

House Bill 671 (effective April 4, 1986) enacted by the 1986 Idaho Legislature requires the payment of a fee before this department can conduct the field examination needed to issue a license confirming use of water under the permit. This letter is notification that the license examination fee is due within sixty (60) days of the date of this letter. The examination fee information sheet (enclosed) must be returned with the fee.

As an alternative to submitting the fee, the department will accept a field examination report completed by a certified water right examiner from the private sector. If you choose to have the examination done by a certified water right examiner, you need not submit the license examination fee to the department, but you must within sixty (60) days of the date of this letter return to the department, the examination fee information sheet showing appropriate information together with a statement from the certified examiner to verify that you have retained a certified examiner to conduct the field examination. If you choose this alternative, a completed field examination report must be submitted within one year of the date of this letter. You cannot later change your decision to use this alternative and submit the fee needed for the department to conduct the field examination. You may change to another certified examiner.

Certified water right examiners are licensed engineers, geologists, or land surveyors certified by the department to conduct water right examinations. The procedure for certifying examiners results from the recently enacted HB 671 and is being developed at this time. A listing

MICROFILMED

NOV 24 1989

of certified water right examiners will be available from this department when examiners have been certified.

If your permitted use, in fact, has already been examined by the department and you have not asked to have the examination repeated, the fee requirement is not applicable to your permit. If you believe this is the case, please contact the department.

The license examination fee is to be based on the amount of water you indicate you have developed, as listed in item 6 on the examination fee information sheet. The amount of water on which the examination fee is based can be less than the permitted amount, if less water has been diverted and beneficially used. The licensed amount of water, however, will not exceed the amount you claim on the examination fee information sheet. The enclosed license examination fee schedule shows a listing of applicable fees.

FAILURE TO SUBMIT WITHIN THE SIXTY (60) DAY PERIOD, THE FEE OR THE STATEMENT THAT A CERTIFIED EXAMINER HAS BEEN RETAINED TO MAKE THE FIELD EXAMINATION, WILL BE CAUSE TO ADVANCE THE PRIORITY OF THE PERMIT ONE DAY FOR EACH DAY THAT THE FEE SUBMITTAL IS LATE.

FAILURE TO SUBMIT THE FEE OR THE COMPLETED FIELD EXAMINATION REPORT WITHIN A YEAR WILL BE CAUSE TO CONSIDER THE PROOF OF BENEFICIAL USE TO BE INCOMPLETE AND TO LAPSE THE PERMIT.

The attached examination fee information sheet and the fee may be submitted to the following department offices.

Northern Region

Idaho Dept. of Water Resources
4055 Government Way
Coeur d'Alene, ID 83814
Phone: 765-4639

Eastern Region

Idaho Dept. of Water Resources
150 Shoup Ave., Suite 15
Idaho Falls, ID 83401
Phone: 525-7161

Southern Region

Idaho Dept. of Water Resources
1041 Blue Lakes Blvd. North
Twin Falls, ID 83301
Phone: 734-3578

Western Region

Idaho Dept. of Water Resources
450 W. State St., (Third Floor)
Boise, ID 83720
Phone: 334-2190

Sincerely,



L. GLEN SAXTON
Chief, Operations Bureau

Enclosures

RECORDED

NOV - 1968



State of Idaho

DEPARTMENT OF WATER RESOURCES

WESTERN REGION, 92 South Cole Road, Boise, Idaho 83709

JOHN V. EVANS
Governor

(Office at the corner of
Franklin and Cole Roads)

C. STEPHEN ALLRED
Director

(208) 384-2190

June 4, 1980

Van Pees Builders, Inc.
Rt. 2
Puna, ID 83634

RE: 63-8124

Dear Gentlemen:

We acknowledge receipt of your statement submitted as proof of beneficial use for the above referenced permit.

Before a license can be issued, a field examination must be made by a representative of this Department.

☐ A field examination of your system has been scheduled for

If this time and date is not convenient for you, please contact this office as soon as possible.

☒ A field examiner will contact you to arrange to examine your system.

If you have any questions regarding the field examination, please contact this office.

Sincerely,

Kay Walker
Secretary

MICROFILMED

DEPARTMENT OF WATER RESOURCES

The Idaho Department of Water Resources will consider this card as a statement that the permit holder(s) has completed development to the extent shown below of Permit No. 63-8124.

Name(s) of Permit Holder: VAN HEES BUILDERS, INC.

Post Office Address: ROUTE #2 KUNA, ID 8363

Tel. No. 922-1110

Source of Water: WELL

Extent of Use: ☒ Domestic 28 (number of households)
☐ Stockwater _____ (number and type of stock)
☐ Irrigation _____ (acres)
☐ Other _____


Measuring Device: Required? ☐ Yes ☐ No Installed? ☐ Yes ☐ No
Access Port: Required? ☒ Yes ☐ No Installed? ☒ Yes ☐ No

The above information is a true statement of the extent to which the above numbered permit has developed.

4/30/80
Date

[Signature]
Signature of Permit Holder

MICROFILMED



RECEIVED

IDAHO DEPARTMENT OF WATER RESOURCES
STATEHOUSE
BOISE, IDAHO 83720

MAY 1 1980

Dept. of Water Resources

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

STATEHOUSE
BOISE, IDAHO 83720
(208) 334-4440

VAN HESS BUILDERS INC.
RT. 2
KUNA, ID 83634

101919

MARCH 31, 1980

DEAR PERMIT HOLDER:

ONE OF THE CONDITIONS OF APPROVAL OF YOUR WATER PERMIT NO. 63-8124 WAS THAT EVIDENCE OF THE EXTENT OF DEVELOPMENT MUST BE SUBMITTED TO THIS OFFICE ON OR BEFORE JUNE 01, 1980. (SEE LAST PAGE OF YOUR APPROVED PERMIT). ENCLOSED IS A POST CARD WHICH MAY BE USED TO SUBMIT THE REQUIRED PROOF OF BENEFICIAL USE.

IF YOU HAVE NOT FULLY COMPLETED YOUR PROJECT, AND YOU HAVE NOT PREVIOUSLY RECEIVED AN EXTENSION OF TIME, YOU MAY REQUEST AN EXTENSION OF TIME PROVIDED THE DELAY IS FOR REASONABLE CAUSE AS INDICATED IN SECTION 42-204, IDAHO CODE, AMENDED. IF YOU HAVE BEEN PREVENTED FROM PROCEEDING BY A GOVERNMENTAL AGENCY OR BY LITIGATION, MORE THAN ONE EXTENSION OF TIME CAN BE GRANTED.

EITHER THE BENEFICIAL USE POST CARD OR A REQUEST FOR AN EXTENSION OF TIME MUST BE RECEIVED BY THIS DEPARTMENT ON OR BEFORE THE ABOVE MENTIONED DATE, OTHERWISE, THE PERMIT WILL LAPSE AND BE OF NO FURTHER FORCE OR EFFECT WITHIN 60 DAYS.

SINCERELY,

RITA FLECK
SR. SECRETARY

ENC: 1

MICROFILMED



State of Idaho
DEPARTMENT OF WATER RESOURCES
STATE OFFICE, 373 W. Franklin Street, Boise, Idaho

JOHN V. EVANS
Governor

C. STEPHEN ALLRED
Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 384-2215

September 25, 1979

Dear Wateruser:

The enclosed Order changes the measuring device condition of approval on your water right permit.

The changed condition is less restrictive and provides you the option to install an access port or have your system measured and certified by a professional engineer. Instructions for access port installation are also enclosed.

If you have questions regarding this matter, please contact the Regional Office nearest to you.

Sincerely,

DAVID R. TUTHILL, JR.
Supervisor, Water Allocations Section

DRT:lr

Enclosures

Northern Region Office
Rt. #5, Box 203 Government Way
Coeur d'Alene, Idaho 83814

Eastern Region Office
1515 Lincoln Street
Idaho Falls, Idaho 83401

Southern Region Office
1041 Blue Lake Blvd. North
Twin Falls, Idaho 83301

Western Region Office
92 S. Cole Road
Boise, Idaho 83705

MICROFILMED

June 20, 1975

Re: Permit No. 63-8124

Van Hees Building, Inc.
Route 2
Kuna, ID 83634

Gentlemen:

Enclosed is a copy of your approved Application for Permit No 63-8124 . We direct your attention to the conditions of approval as listed on the fourth page.

Be sure to note that a special condition requiring you to install and maintain a measuring device at your point of diversion has been placed upon your permit. We are enclosing a letter describing different types of measuring devices accepted by this office.

Sincerely,

BOBBY D. FLEENOR
Chief, Water Rights

BDF:jfr

Enclosures

CC: David H. Roylance, P. E.
Friends Survey
619 Grove St.
Boise, ID

RECEIVED

DEPARTMENT OF WATER RESOURCES
- STAFF ANALYSIS -

Item Initial Date

Application No. 63-8124

☒ Source
☒ Point of Diversion
☒ County
☒ Quantity of Water and Period of Use ? Dom. Q
☒ Description of Diverting Works
☒ Time required for B/U of water
☒ Place of Use or Acres Irrigated
☒ Map
☒ Signature
☒ Fee

(1) _____

In form to receipt

(2) CS 5-2-75

Send Copies to:

☒ Idaho State Health Department

Idaho Fish and Game Department

Bureau of Land Management

(3) NA

Request Special Use Permit from U.S.F.S.

Request Easement from B.L.M.

Request Information from Applicant

(4) CS 5-19-75

In form for advertising

(5) _____

Platted on Map No. _____

(6) NA

Located within Water District No. _____

(7) R.W.H. 6-16-75

Critical groundwater area: yes _____ no ☒

(8) R.W.H. 6-16-75

Groundwater levels:

Declining, ☒ Stable, _____ Increasing

(comment) _____

(9) None

Other rights on the same place of use

(10) _____

Comments: _____

(11) NA

Affidavit of Publication received(date) 6-16-75

(12) R.W.H. 6-16-75

Final date for protests 6-16-75
Protests received: yes _____ no ☒

(13) R.W.H. 6-16-75

All requested information received from agencies or
applicant: yes ☒ no _____

(14) R.W.H. 6-16-75

Action recommended:

☒ Approve _____ Deny

Proposed Priority

Reason for Reduction

☒ Measuring device required

See attached sheet for other conditions of
approval

No special conditions for approval

(15) District Western

By R. Hamilton Date 6-16-75

MICROFILMED

STATE OF IDAHO

Cecil D. Andrus, governor

department of health and welfare

RECEIVED
JUN 10 1975
Department of Water Resources *James A. Bax, director*

DIVISION OF ENVIRONMENT

June 9, 1975

Mr. Kenneth H. Foit
Western District Engineer
Department of Water Resources
Statehouse
Boise, Idaho 83720

Re: Application for Permit No. 63-8124, Van Hees Builders, Inc.

Dear Mr. Foit:

We have reviewed application for permit No. 63-8124 for constructing a domestic water supply well for Eagle West Subdivision in Eagle. Our department must review and approve the engineering plans of the well and pumphouse prior to its construction.

Sincerely,

DEPARTMENT OF HEALTH AND WELFARE



H. David Sanders
Environmental Engineering Spec. II

cc: Central District Health Dept.
Van Hees Builders, Inc.
Eagle Water & Sewer District

HDS/dj

MICROFILMED

STATE OF IDAHO

Cecil D. Andrus, governor

department of health and welfare

James A. Bax, director

DIVISION OF ENVIRONMENT
May 30, 1975

Mr. Kenneth H. Foit
Western District Engineer
Department of Water Resources
Statehouse
Boise, Idaho 83720


Re: Application for Permit No. 63-8124
Van Hees Builders, Inc.

Dear Mr. Foit:

Our department must review and approve the engineering plans and specifications of the proposed domestic well and water distribution system which will serve Eagle West Subdivision.

Sincerely,

DEPARTMENT OF HEALTH AND WELFARE

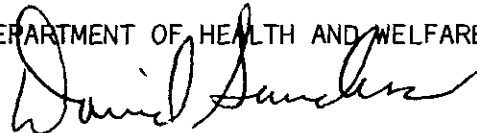

H. David Sanders
Environmental Engineering Spec. II

cc: Central District Health Dept.
Van Hees Builders, Inc.
Eagle Water & Sewer District

HDS/dj

MICROFILMED

May 23, 1975

Michael A. Smith, E.I.T.
Environmental Engineering Spec. II
Environmental Services
Department of Health & Welfare
Statehouse
Boise, ID

Re: Application for Permit No. 63-8124, Van Hees Builders Inc.

Dear Mr. Smith:

We are enclosing a copy of the above referenced application for permit which may be of interest to your agency. Please review the application and if you have any comments, please submit them to our department as soon as possible.

We normally complete the processing of an application within a six week period and we are required to take final action shortly thereafter.

If we may be of any assistance to you in the meantime, please do not hesitate to contact this department.

Sincerely,

KENNETH A. FOIT, P.E.
Western District Engineer

KHF:jg

Enclosure

MICROFILMED



STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
WESTERN DISTRICT — ANNEX 3

Cecil D. Andrus
Governor

R. Keith Higginson
Director

Statehouse
Boise, Idaho 83720
(208) 384-2190

May 23, 1975

Idaho Statesman
Box 2640
Boise, ID 83701

Re: Application for Water Permit Nos. 63-8124, Van Hees Builders, Inc.
63-8143, Barton R. Bowden

Gentlemen:

Enclosed you will find a legal notice which we wish to have published once a week for two consecutive weekly issues of your newspaper. We have inserted the publication dates allowing ample time for you to submit us a galley proof for review before publication.

After sending us a galley proof, proceed with the publication on the dates we have inserted, assuming the notice is correct. If we have any corrections, we will notify you before the first publication. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. In order to receive payment, the following certification must appear in the bill:

"I hereby certify that the foregoing account is just and correct, that the amount claimed is legally due, after allowing all just credits, and that no part of the same has been paid."

Sincerely,

(Signature of Claimant)

Bill Submitted:
OK 5/26 6-6-75

MICROFILMED

NOTICE OF APPLICATION FOR WATER PERMIT

Notice is hereby given that VAN HEES BUILDERS, INC.

Rt. 2, Kuna, ID

has on May 2, 1975 submitted Application No. 63-8124

for a permit to appropriate 1.0 cubic feet per second ~~acre feet~~ XXXXXXXXXX

~~XXXXXXXXXX~~ of water from a groundwater source

by means of well, pump, and mainline

within the SE $\frac{1}{4}$ SE $\frac{1}{4}$, Sec. 8, T. 4 N, R. 1 E, B.M. Ada County

to be used from Jan. 1 to Dec. 31

for domestic and fire protection purposes

within the NE $\frac{1}{4}$ NE $\frac{1}{4}$, Sec. 17, SE $\frac{1}{4}$ SE $\frac{1}{4}$, Sec. 8, T. 4 N, R. 1 E, B.M.

If issued, this permit will be subject to all prior water rights. Protests against the granting of the permit must be filed with the Idaho Department of Water Resources, Statehouse, Boise, Idaho, 83720, on or before June 16, 1975.

R. KEITH HIGGINSON

Director

Published in the Idaho Statesman, Boise, ID

on May 29, 1975 and June 5, 1975.

MICROFILMED



STATE OF IDAHO

DEPARTMENT OF WATER RESOURCES
WESTERN DISTRICT

STATE HOUSE BOISE, IDAHO 83720

May 19, 1975

David Sanders, E.I.T.
Environmental Engineering Spec. II
Environmental Services
Department of Health & Welfare
Statehouse
Boise, ID

Re: Application for Permit No. 63-8124 - Van Hees Builders, Inc.

Dear Mr. Sanders:

We are enclosing a copy of the above referenced application for permit which may be of interest to your agency. Please review the application and if you have any comments, please submit them to our department as soon as possible.

We normally complete the processing of an application within a six week period and we are required to take final action shortly thereafter.

If we may be of any assistance to you in the meantime, please do not hesitate to contact this department.

Sincerely,

KENNETH H. FOIT, P.E.
Western District Engineer

KHF:cla

Enclosure

MICROFILMED

May 13, 1975

Van Hees Builders Inc.
Rt. # 2
Kuna, ID 83634

Gentlemen:

Enclosed is Ammended Permit Application # 63-8124. Please review this form for correctness, sign and return to this office for processing.

The proceedure for abandoning a pørtially drilled well is as follows:

- (1) Fill in the drilled hole up to the first water confining layer from the top with the same material faken from the hole or similar material.
- (2) Seal the confining layer with bentonite or muddling clay. This will insure that no water can seep through and contaminate the water source below.
- (3) Fill the remainder of the hole with material similar to that taken out that is intermixed with clay to further seal the hole.
- (4) If no confining layer exists, the entire hole should be filled with material similar to that which was taken out that is intermixed with a sealing compound.

If you have any questiona, please feel free to contact me.

Sincerely,

M. CLAYNE BARROW
W.R. Technician II

MCB:jg
Enclosure

MICROFILMED



STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
WESTERN DISTRICT — ANNEX 3

Cecil D. Andrus
Governor

R. Keith Higginson
Director

Statehouse
Boise, Idaho 83720
(208) 384-2190

May 7, 1975

Re: Application for Permit No. 63-8124

Attn. Larry Van Hees
Van Hees Builders Inc.
Rth #2,
Kuna, ID 83634

Dear Mr. Van Hees

Enclosed is your Receipt No. _____ in the amount of \$ 5.00 for
_____ which was received in this office
on May 6, 1975.

Sincerely,

JANE GRIDLEY
Stenographer

JG:jg

Enclosure

MICROFILMED

Send copy of all correspondence to:
David H. Roylance, P. E.
Friend's Survey
619 Grove St.
Boise, Idaho 83702
Tel. (208) 342-5792

Identification No. _____
Application No. 63-8124

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

To Appropriate the Public Waters of the State of Idaho
(TYPE OR PRINT IN INK)

1. Name of applicant Van Hees Builders Inc. Phone: 692-1178
post office address Rt. # 2 Kuna, Idaho 83634
2. Source of water supply underground water which is a tributary of _____
3. a. Location of point of diversion is S E $\frac{1}{4}$ of S E $\frac{1}{4}$ of Section 8 Township 4-N
Range 1 E B.M. Ada County; additional points of diversion if any: _____

b. If water is not consumed, it will be discharged into _____ at a point in _____ $\frac{1}{4}$
of _____ $\frac{1}{4}$ of Section _____ Township _____ Range _____ B.M. _____
4. Water will be used for the following purposes:
Amount 0.02 for domestic purpose from January 1 to December 31 (both dates inclusive)
(cfs or acre-feet per annum)
Amount 0.31 for fire protect. purpose from January 1 to Dec. 31 (both dates inclusive)
(cfs or acre-feet per annum)
Amount 0.50 for irrigation purpose from April 1 to Oct. 15 (both dates inclusive)
(cfs or acre-feet per annum)
5. Total quantity to be appropriated:
a. 1.0 cubic feet per second and/or
b. _____ acre feet per annum.
6. Proposed diverting works:
a. Description of ditches, flumes, pumps, headgates, etc. underground pressure pipe system,
225 gpm. pump, 250 gallon storage and 6" PVC water mains

b. Height of storage dam _____ feet, active reservoir capacity _____ acre feet; total reservoir
capacity _____ acre feet, materials used in storage dam: _____
Period of year during which storage will occur _____ to _____ inclusive.
(Mo. Day) (Mo. Day)
c. Proposed well diameter is 6 inches; proposed depth of well is 350 + feet.
7. a. Time required for the completion of the works and application of the water to the proposed beneficial use
is 3 years.
b. Estimated construction cost is \$ 10,000.
8. Description of proposed uses:
a. If water is **not** for irrigation:
(1) Give the place of use of water: S E $\frac{1}{4}$ of S E $\frac{1}{4}$ of Section 8 Township 4-N
Range 1 E B.M.
(2) Amount of power to be generated: none hp under _____ feet of head.
(3) List number of each kind of livestock to be watered none

(4) Name of municipality to be served Eagle West Subdivision, or number of families to be
supplied with domestic water 27.
(5) If water is to be used for other purposes describe: domestic water for 27 homes and one
commercial lot, sprinkler irrigation for approximately 8 acres and fire
protection for the subdivision

MICROFILMED

b. If water is for irrigation, indicate acreage in each subdivision in the tabulation below:

TWP.	RANGE	SEC.	NE1/4				NW1/4				SW1/4				SE1/4				TOTALS
			NE1/4	NW1/4	SW1/4	SE1/4	NE1/4	NW1/4	SW1/4	SE1/4	NE1/4	NW1/4	SW1/4	SE1/4	NE1/4	NW1/4	SW1/4	SE1/4	
4 N	1 E	8																7	7
4 N	1 E	17	2																2

Total number of acres to be irrigated 9

c. Describe any other water rights used for the same purposes as described above.


9. a. Who owns the property at the point of diversion Van Hees Builders Inc.

b. Who owns the land to be irrigated or place of use Van Hees Builders Inc/

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing

10. Remarks This application is for domestic water for Eagle West Subdivision which will have 27 homes, one commercial lot, and sprinkler irrigation for the homes. Fire protection will also be provided

11. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

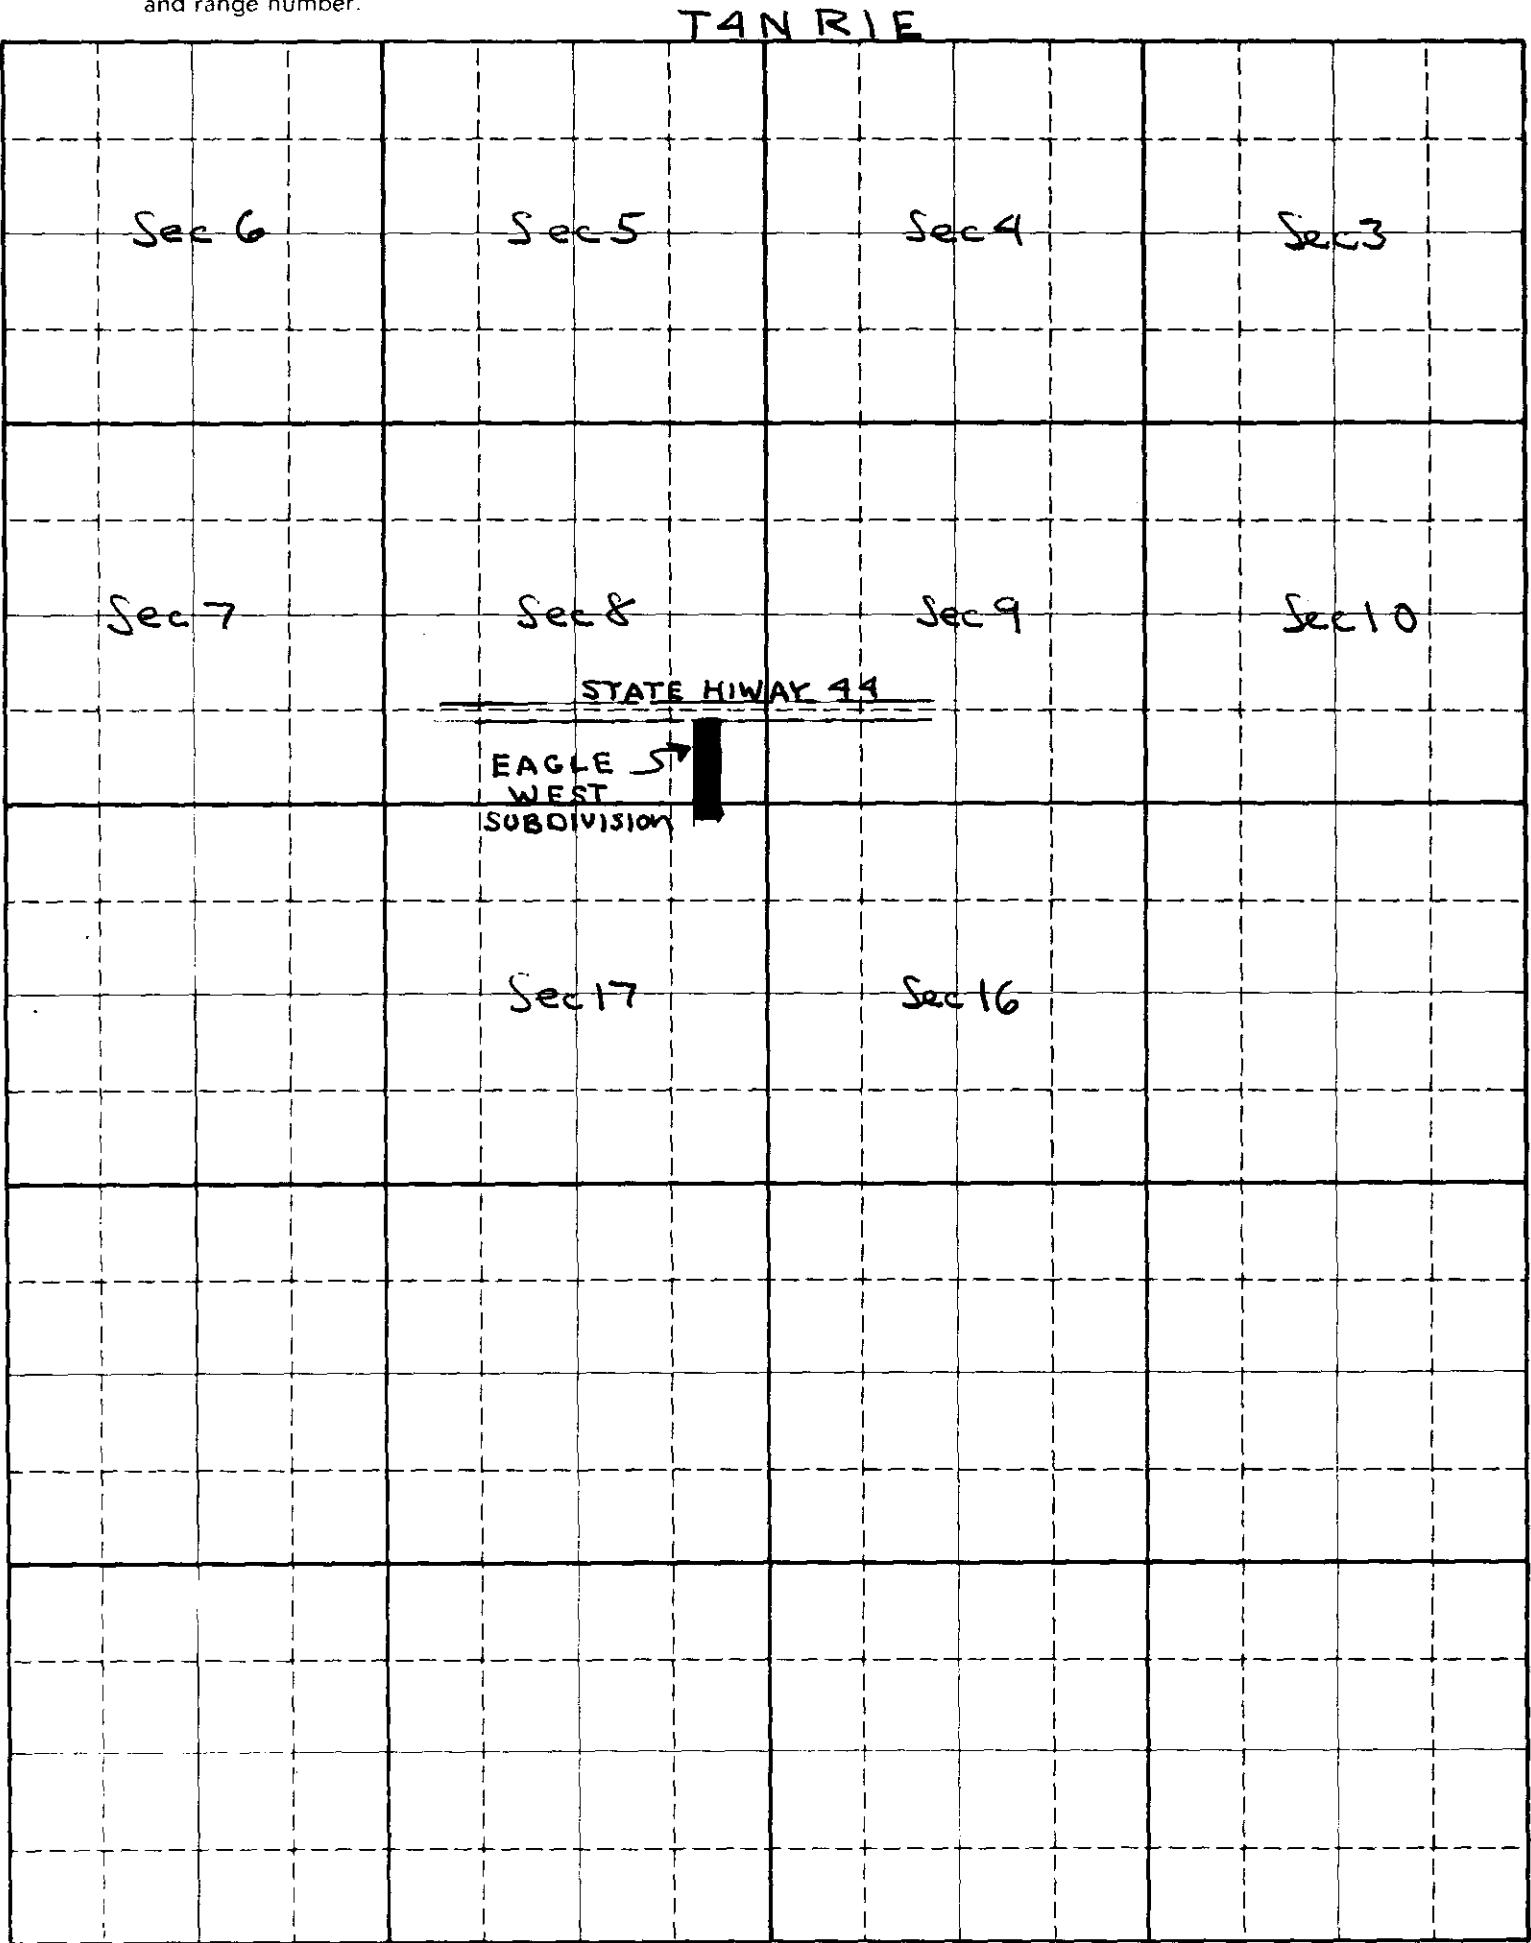

Scale: 2 inches equal 1 mile

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Larry O. Weber Sec.
(Applicant)

Received by ff Date 5/2/75 Time 9:30 A
Preliminary check by Klt Fee \$ 25.00
Received by Ca Date 5/2/75 # 520
Publication prepared by _____ Date _____
Published in _____
Publication dates _____
Publication approved _____ Date _____
Priority reduced to _____ Reason _____

Protests filed by: _____

Copies of protests forwarded by _____
Hearing held by _____ Date _____
Recommended for approval denial by _____

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. _____, and said application is hereby _____.


1. Approval of said application is subject to the following limitations and conditions:

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
- b. Proof of construction of works and application of water to beneficial use shall be submitted on or before _____, 19____.
- c. Other: _____

2. Denial of said application is for the following reasons: _____


Witness my hand this _____ day of _____ 19____.

Director

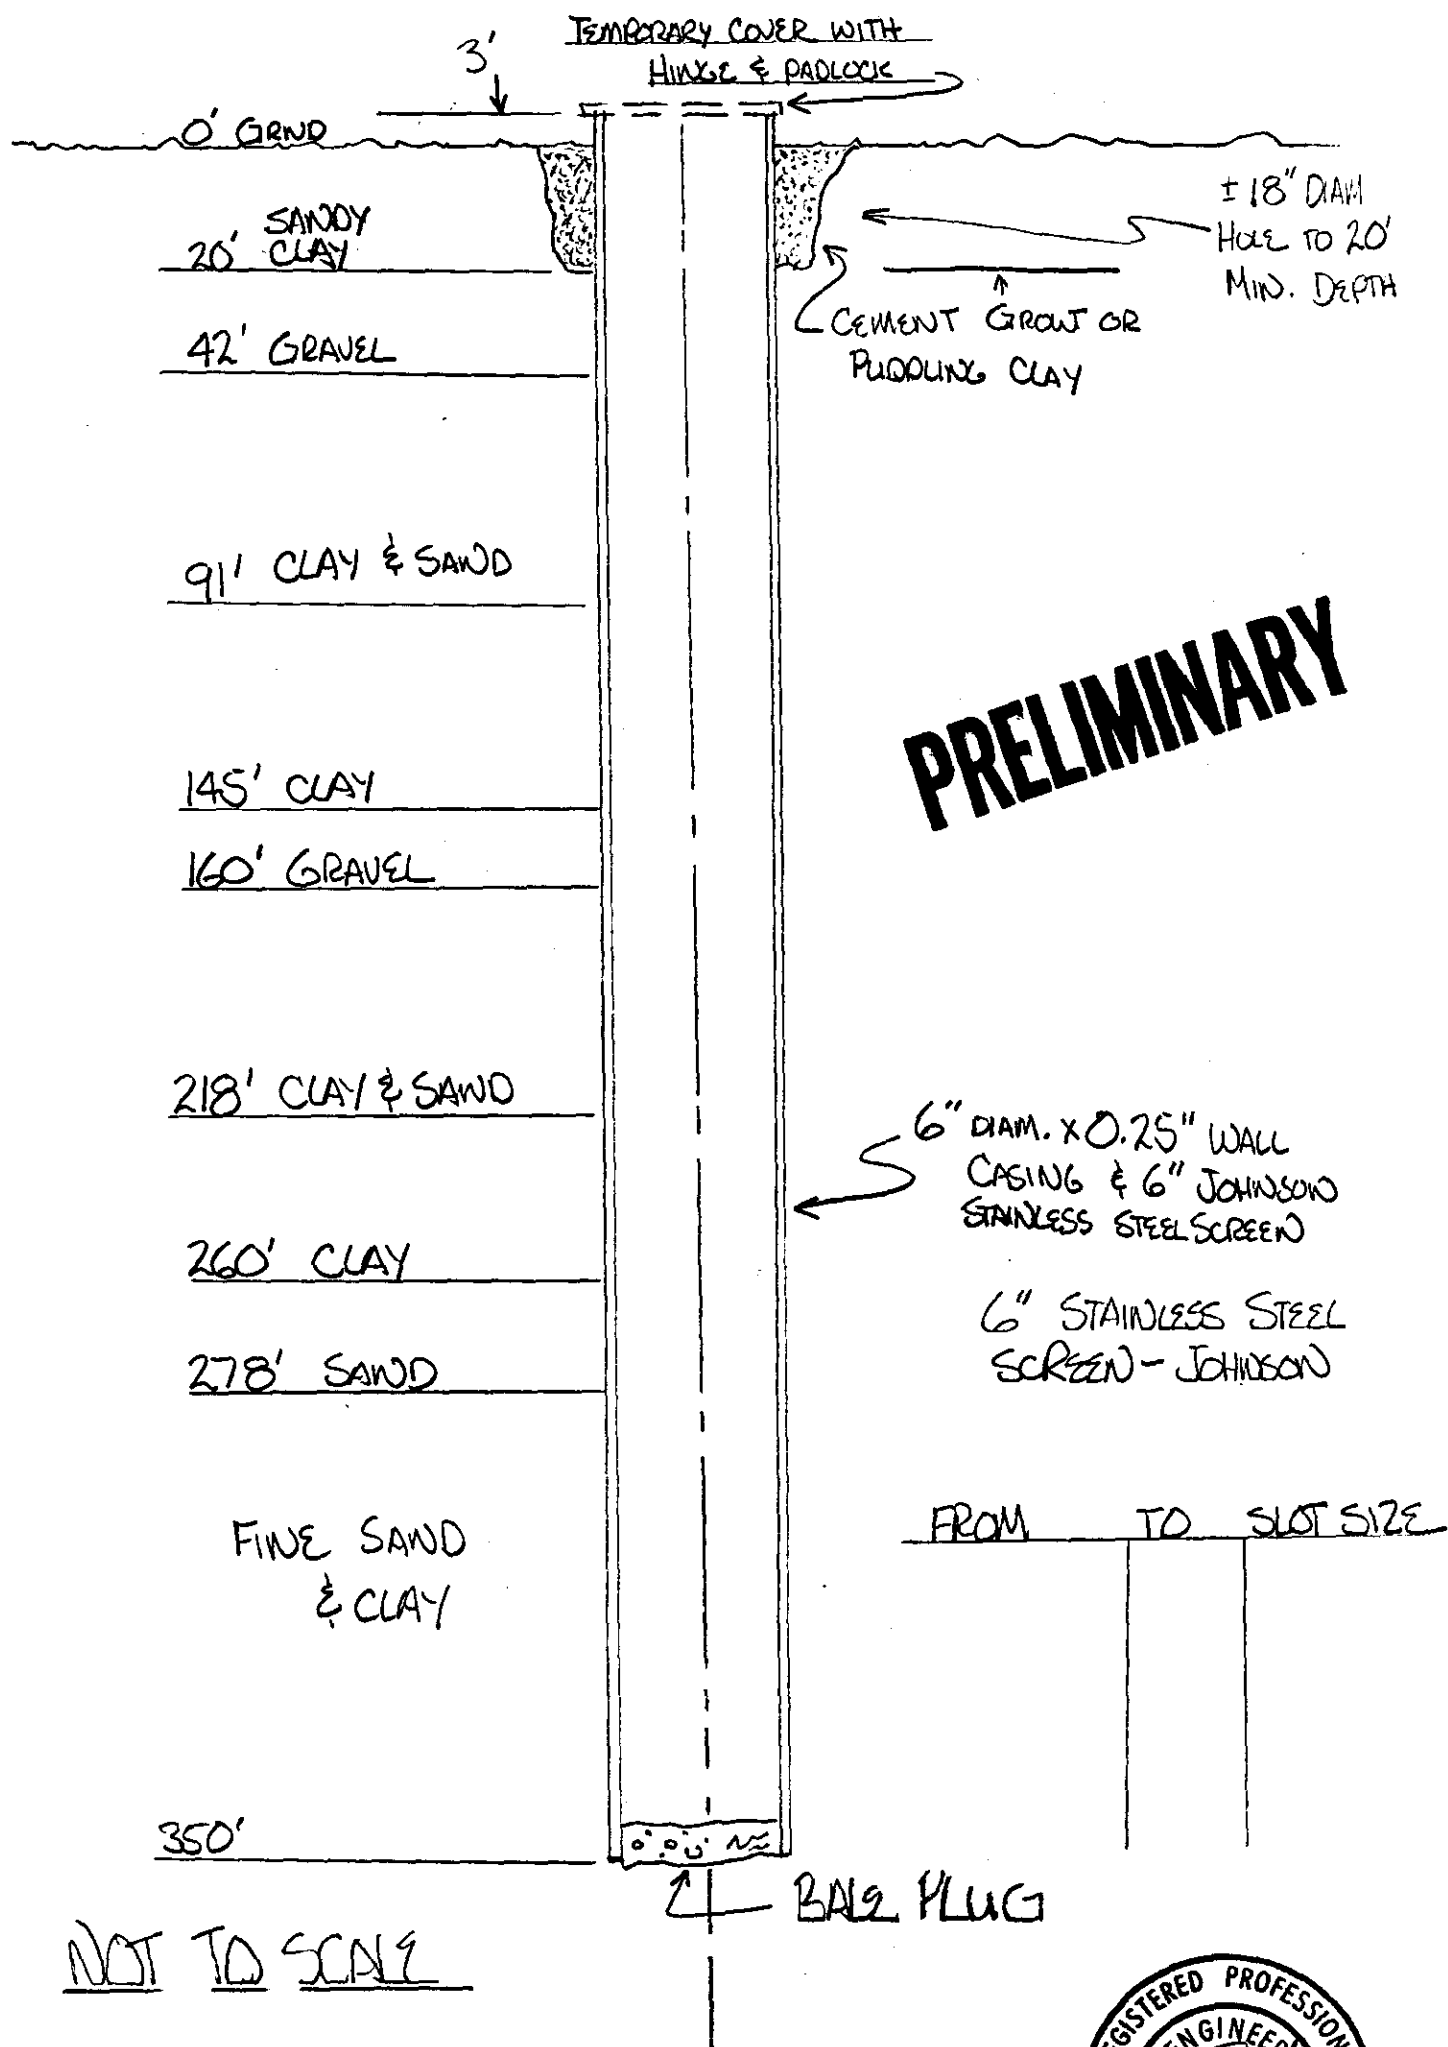

NOTE: WELL TO BE DRILLED TO A DEPTH TO PRODUCE A MINIMUM FLOW OF 325 GPM. ACTUAL DEPTH TO BE DETERMINED BY ENGINEER & DRILLER DURING CONSTRUCTION.

MICROFILMED

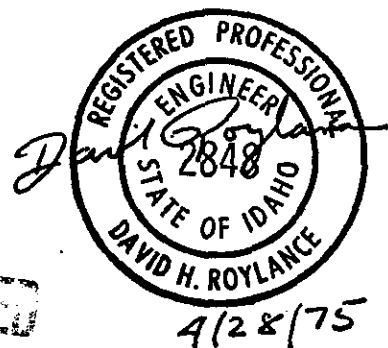

WELL DESIGN FOR EAGLE WEST
IN THE SE 1/4 SEC 8 & NE 1/4 SEC 17, T4N, R1E
PM. ADA CO. IDAHO