


11. Map of proposed project:

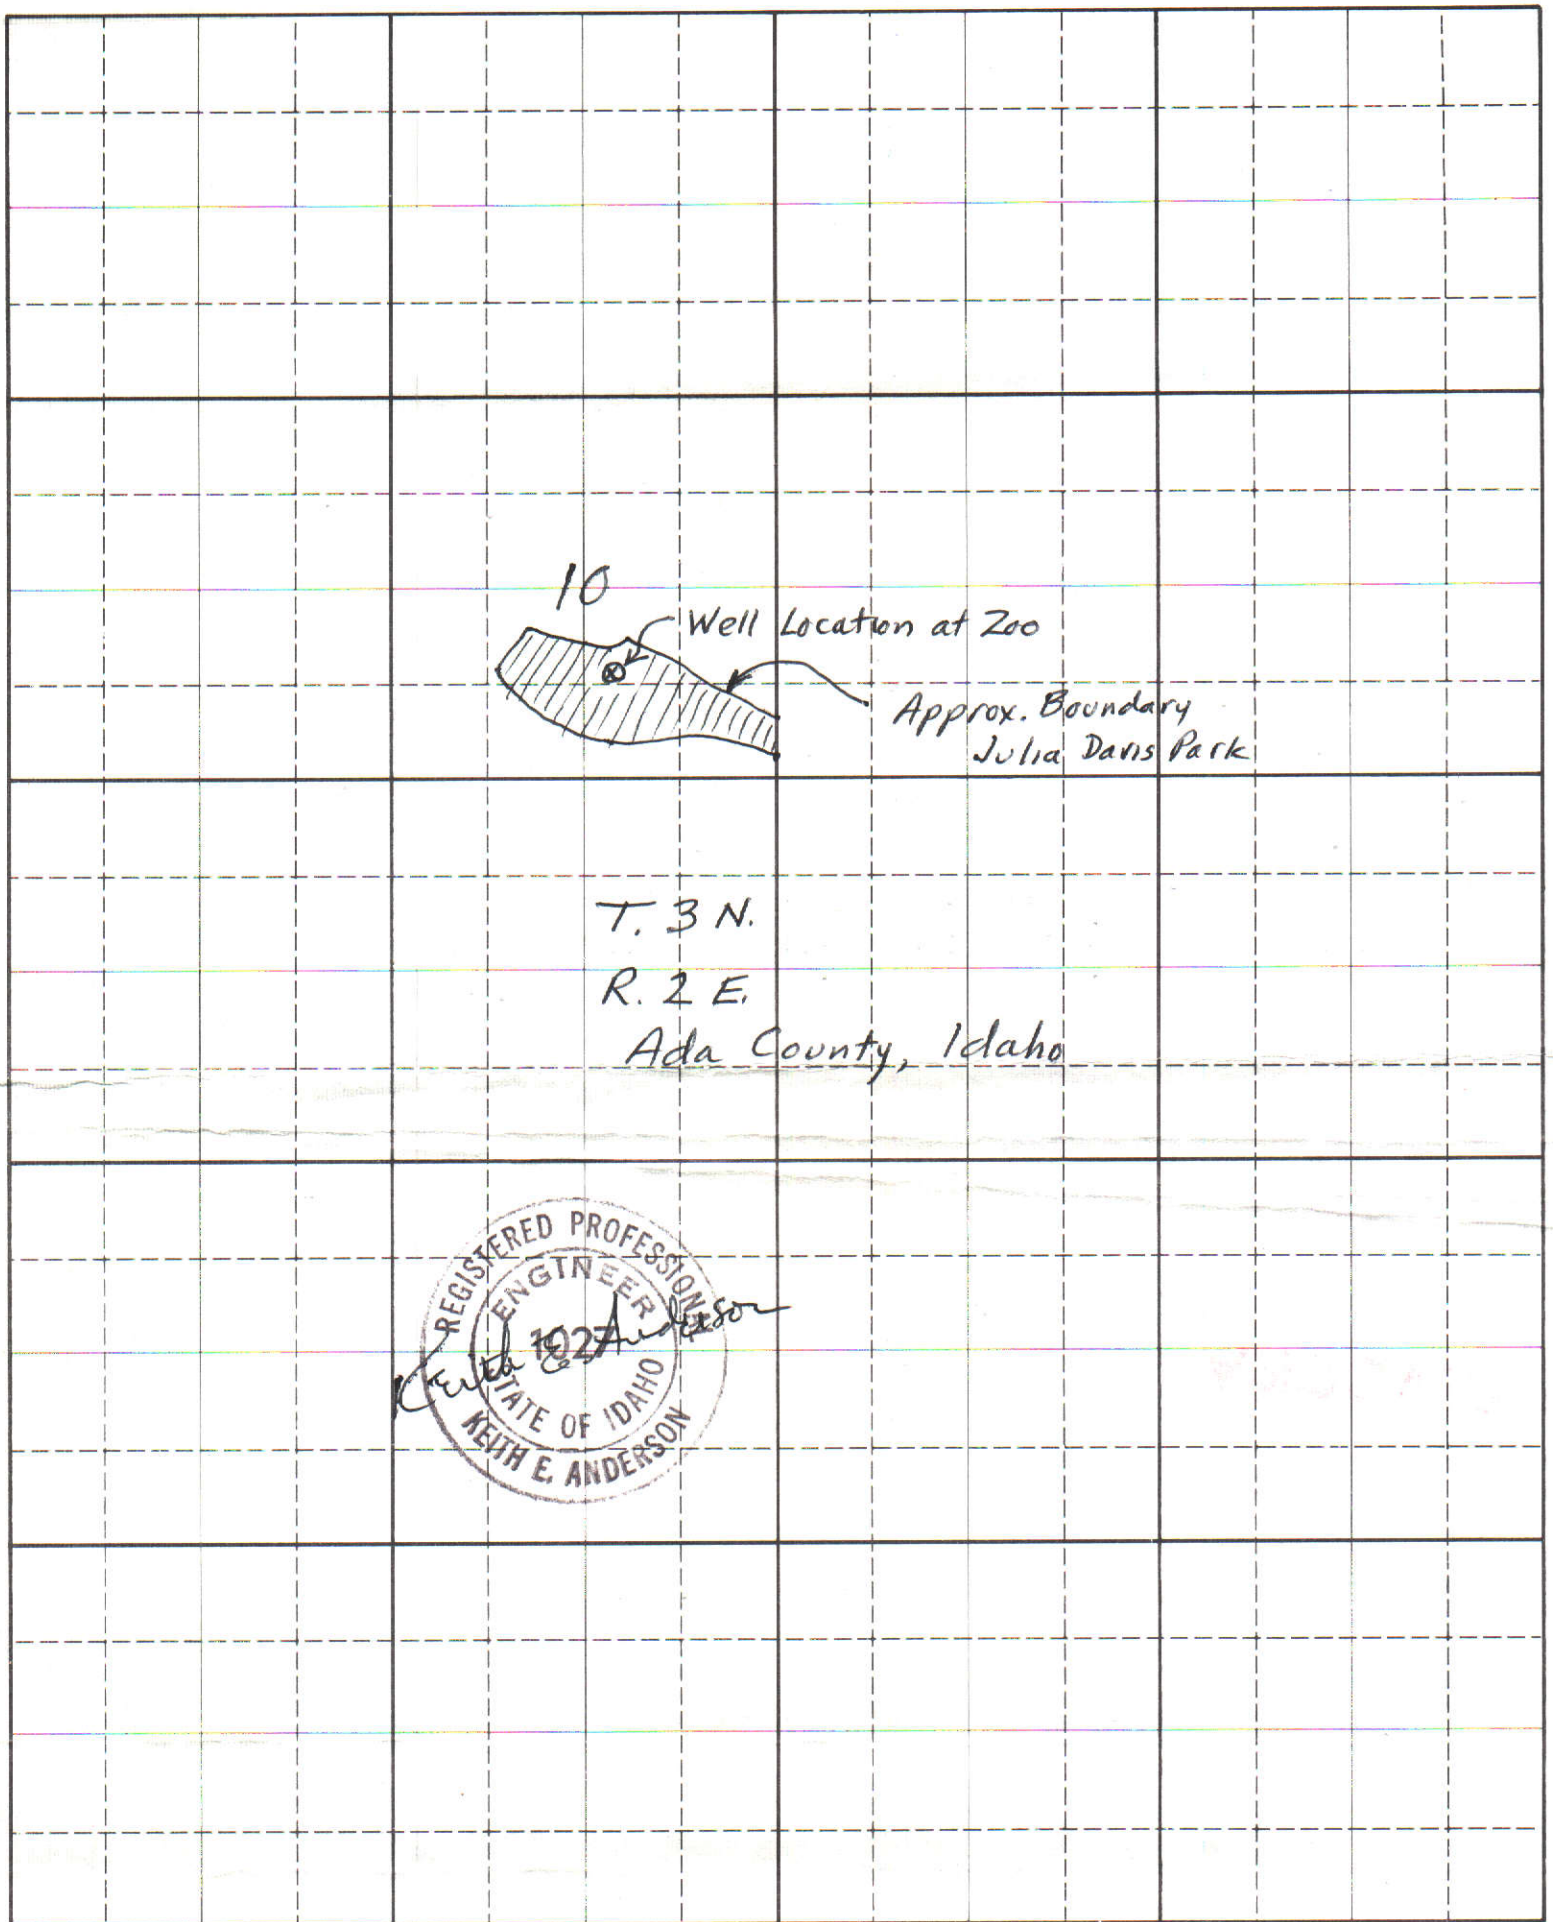

Scale: 2 inches equal 1 mile

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

City of Boise
(Applicant)
By James Amys
Mayor

STATE OF IDAHO }
COUNTY OF ADA } ss.

Iona A. Young

, being duly sworn,
deposes and says: That she is the Principal Clerk of The Idaho
Daily Statesman, a daily newspaper printed and published at
Boise, Ada County, State of Idaho, and having a general circula-
tion therein and which said newspaper has been continuously
and uninterruptedly published in said County during a period of
twelve consecutive months prior to the first publication of the
notice, a copy of which is attached hereto; that said notice was
published in the regular Monday edition of The Idaho Daily
Statesman in conformity with Sec. 60-108, Idaho Code, for

Two non/ consecutive weekly insertions


beginning with the issue of November 9, 1967,
and ending with the issue of November 16, 1967. (Thursday)

, Principal Clerk

Subscribed and sworn to before me this 6th day of

December, 1967.

[Signature]
Notary Public for Idaho, Residing at Boise, Idaho

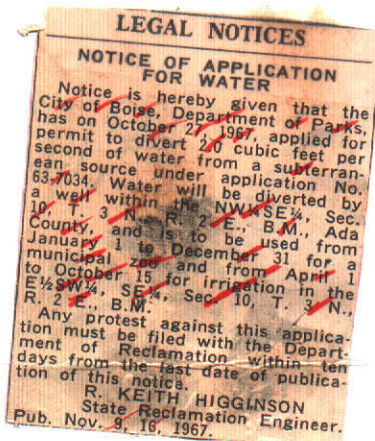

RECEIVED

Department of Reclamation

63 7034

THE STATESMAN NEWSPAPERS

BOISE, IDAHO

FOR LEGAL ADVERTISING

• State Dept. Reclamation
 • 107 State House
 • Boise, Idaho
 •

DATE	DESCRIPTION	INCHES	TOTAL INCHES	CHARGES	✓	CREDITS	BALANCE
	BALANCE STATEMENT RENDERED						
NOV 9-16 1967	WATER - Appl 63 7034 City Park Dept.	24L 2X		6.00			6.00
I hereby certify that the above account is correct and that the service was actually rendered as charged and that we have not received payment therefor. Signed STATESMAN PRINTING CO. By <u>James H. Young</u>							

TERMS: NET BY 10TH OF MONTH FOLLOWING

LAST AMOUNT IN
THIS COLUMN
IS BALANCE
DUE

63 7034

T.
3
N

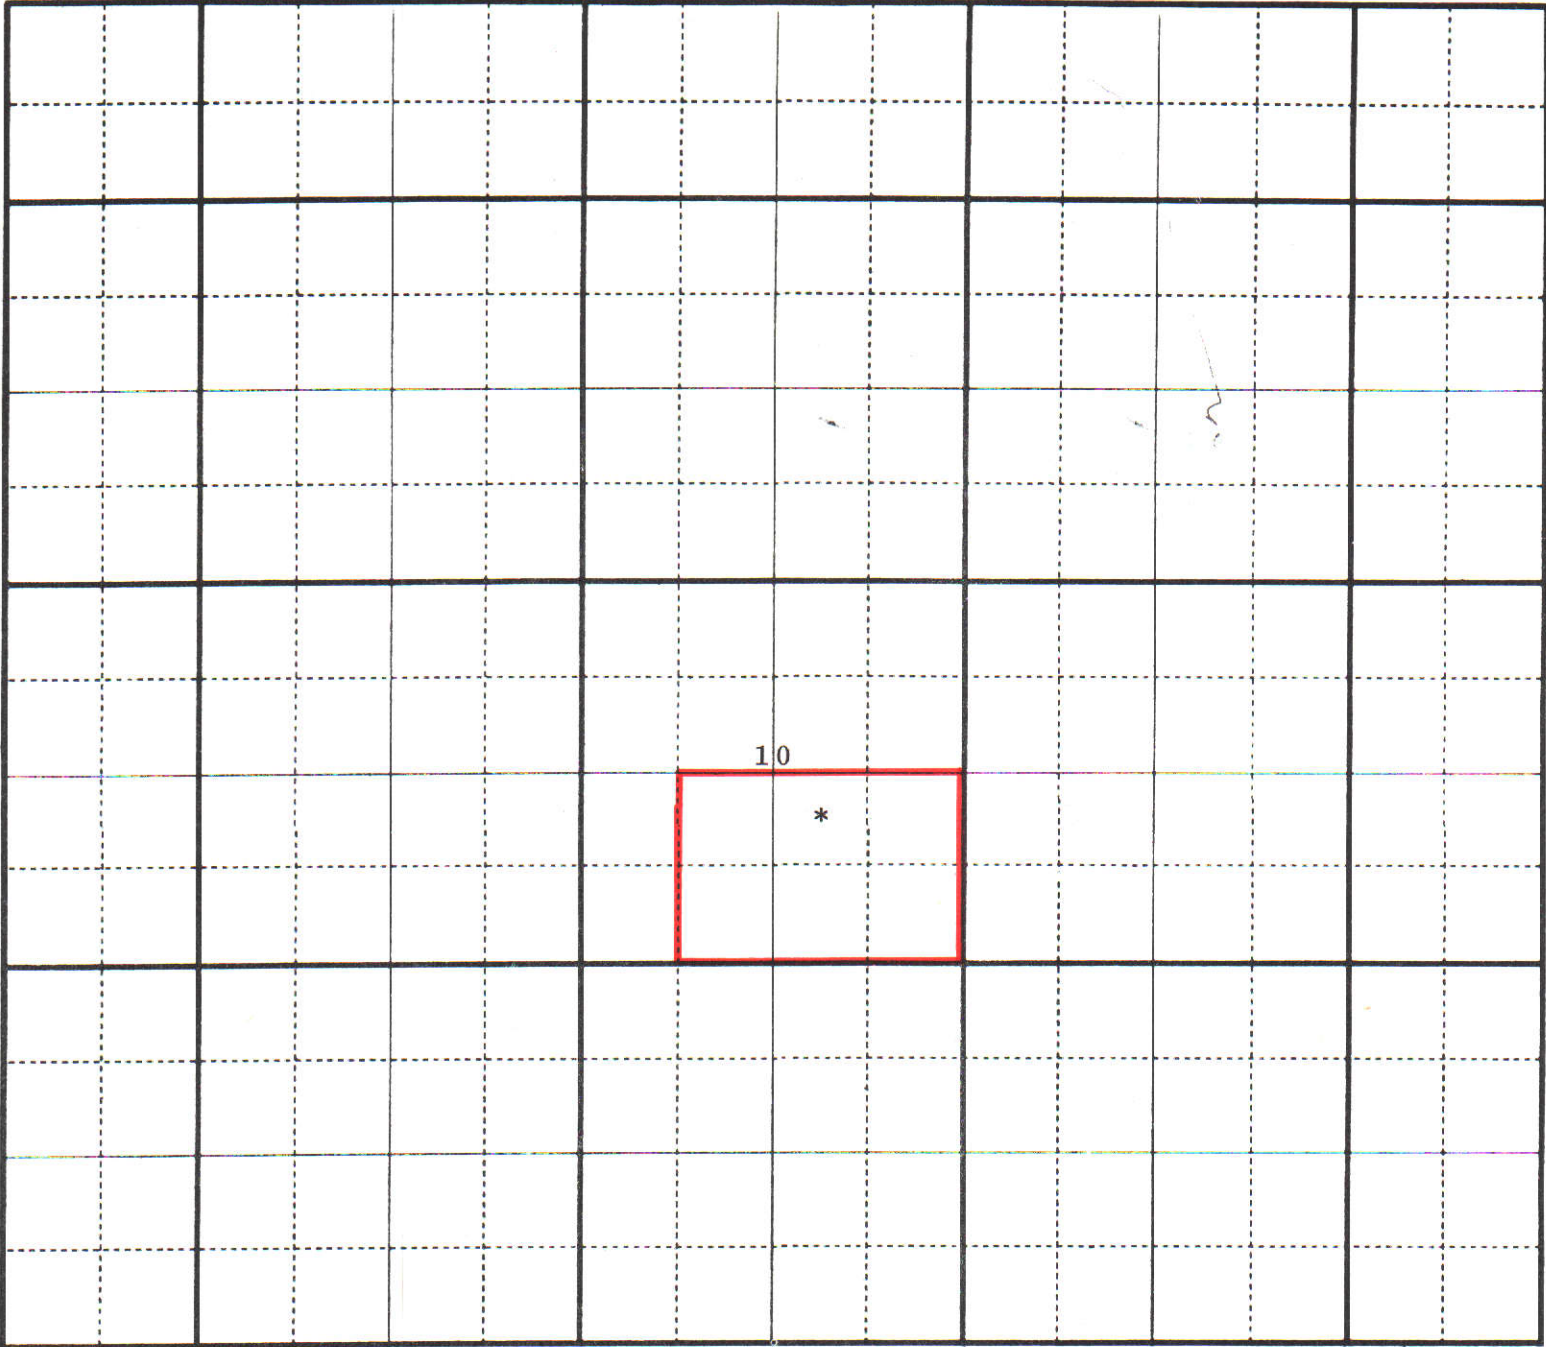


Diagram of System

Skip Gates
Ben Harris

See map

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

TRANSFER OF WATER RIGHT

TRANSFER NO. 5009
WATER RIGHT NO(S). 63-02792/63-07034/A63-30418

This is to certify that: CITY OF BOISE
PARKS & RECREATION DEPT
1104 ROYAL BLVD
BOISE ID 83706

has requested a change to the above captioned water right(s). This change in water right(s) is authorized pursuant to the provisions of Section 42-222, Idaho Code, provided the conditions listed below are met.

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL VOLUME</u>
Right No. 63-02792 :			
IRRIGATION	03/15 to 11/15	1.04 CFS	373.5 AF
Priority: 12/17/1949			
Right No. 63-07034 :			
IRRIGATION	03/15 to 11/15	1.25 CFS	373.5 AF
MUNICIPAL	01/01 to 12/31	0.34 CFS	246.0 AF
Priority: 12/13/1967			
Right No. A63-30418 :			
IRRIGATION	03/15 to 11/15	2.00 CFS	373.5 AF
Priority: 01/23/1951			
TOTAL:		*4.63 CFS	*619.5 AF

SOURCE

GROUNDWATER

LOCATION OF POINT(S) OF DIVERSION: Lot 3(NWSE), Sec. 10, Township 03N, Range 02E
Lot 11(SESE), Sec. 10, Township 03N, Range 02E
ADA County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
03N	02E	10	Lot 4(NESW) 22	Lot 4(SESW) 8	Lot 2(NESE) 1	
			Lot 3(NWSE) 6	Lot 10(SWSE) 27	Lot 11(SESE) 19	83
				Total number of acres irrigated:		83

PLACE OF USE: MUNICIPAL

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>
03N	02E	10
		Lot 3(NWSE)
		Lot 10(SWSE)

MICROFILMED
JUL 24 1989

TRANSFER NO. 5009
WATER RIGHT NO(S). 63-02792/63-07034/A63-30418

CONDITIONS OF APPROVAL AND REMARKS

1. Approval of this transfer in no way confirms the right(s) claimed.
2. Right holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
3. This right when combined with all other rights shall provide no more than 4.5 afa per acre for the lands above.
4. The change authorized by this transfer shall be accomplished within one (1) year of the date of this approval.
5. Failure to comply with the conditions of this transfer is cause for the director to issue an order to show cause why the approval of the transfer should not be rescinded.
6. Approval of this transfer does not preclude the opportunity for review of the validity of the water right(s) in the ongoing Snake River Basin Adjudication.
7. Prior to diversion of water under this approval, the right holder shall provide a means of measurement acceptable to the Department from all authorized points of diversion which will allow determination of the total rate of diversion.
- *8. The total instantaneous diversion of water from all points of diversion under Transfer No. 5009 shall not exceed 4.63 cfs, nor total combined annual volume of 619.5 af.
9. Diversion of water from the wells authorized by this water right is subject to delivery of water by the water master of State Water District No. 63, Boise River, pursuant to IDWR's conjunctive management rules.
10. Right Nos. 63-02792, 63-07034 and SRBA Claim No. A63-30418 when combined shall not exceed a total annual diversion volume of 373.5 af for the irrigation of a total of 83.0 acres.
11. Two (2) points of diversion are located within NWSE and three (3) points of diversion are located within SESE, S10, T03N, R02E.
12. Place of use is Julia Davis Park.

Dated this 12th day of June, 1997.


Chief, Water Allocation Bureau

MICROFILMED

JUN 9 1997

State of Idaho
Department of Water Administration
WATER RIGHT LICENSE

License of Water Right No. 63-7034 Priority Dec. 13, 1967 Amount 1.59 cfs

THIS IS TO CERTIFY, that the City of Boise (Park Department)
of Boise, Idaho, has complied with the terms and conditions of Permit
No. 63-7034 issued pursuant to Application for Permit dated October 27, 1967,
and has submitted proof to the Department of Water Administration on January 17, 1973,
(late proof)
that he has applied water to a beneficial use; an examination by the Department indicates that the works have a
capacity for the diversion of 1.59 cfs of water from a ground water source,
tributary to _____, and that the permit holder has applied to a beneficial use &
established a right to use water as follows:

Beneficial Use	Period of Use	Rate of Diversion	Annual Volume
Municipal Zoo from	Jan. 1 to Dec. 31	at 0.34 cfs and	246 acre feet
Irrigation from	April 1 to Oct. 15	at 1.25 cfs and	373.5 acre feet or
	from _____ to _____	at _____ cfs and	4.5 af per acre
(both dates inclusive)			

Subject, however, to the condition that no more than 1.59 cfs of water be diverted at any one time, and
that the amount of water so diverted and to which such right is entitled and confirmed is for the purpose
aforementioned and is limited to the amount which can actually be beneficially used and shall not exceed
619.5 acre feet per year, said waters to be diverted within the NW¹SE¹ of Sec. 10,
Twp. 3 N, Rge. 2 E, B. M. in the County of Ada

Description and location of place of use:

Twp.	Range	Sec.	NE ¹ / ₄				NW ¹ / ₄				SW ¹ / ₄				SE ¹ / ₄				Totals
			NE ¹ / ₄	NW ¹ / ₄	SW ¹ / ₄	SE ¹ / ₄	NE ¹ / ₄	NW ¹ / ₄	SW ¹ / ₄	SE ¹ / ₄	NE ¹ / ₄	NW ¹ / ₄	SW ¹ / ₄	SE ¹ / ₄	NE ¹ / ₄	NW ¹ / ₄	SW ¹ / ₄	SE ¹ / ₄	
3 N	2 E	10								15			10	5	13	20	20		83
		10													X (zoo)				


Total number of acres irrigated 83

A measuring device of a type approved by this Department shall be permanently
maintained as part of the diverting works.

NOTE: Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho
Code, or the applicable Idaho Law. This right may be forfeited by five years of non-use.

The right to the use of the water hereby confirmed is restricted and appurtenant to the lands or place of use
herein described, as provided by the laws of Idaho.

Witness the seal and signature of the Director, affixed at Boise, Idaho, this 5 day of
February, 19 74.

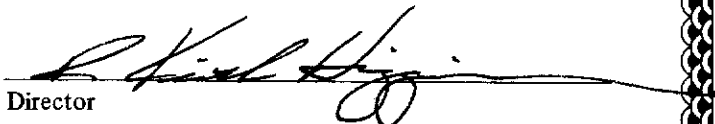
Director

63-7034

E ISSUED FOR 152 SEC. FT.
WALNDE PAGE NO. _____

Identification No. 63-7034
Application No. 42112

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
APPLICATION FOR PERMIT

APPROVED

To Appropriate the Public Waters of the State of Idaho

1. Name of applicant City of Boise (Park Department)
post office address City Hall, Boise, Idaho
2. Source of water supply Underground water which is a tributary of _____
3. a. Location of point of diversion is NW $\frac{1}{4}$ of SE $\frac{1}{4}$ of Section 10 Township 3N
Range 2E B.M. Ada County; additional points of diversion if any: _____

b. If water is not consumed, it will be discharged into Boise River at a point in NE $\frac{1}{4}$
of SW $\frac{1}{4}$ of Section 32 Township 4N Range 2E B.M.
4. Quantity to be appropriated:
a. 2.0 cubic feet per second and/or
b. _____ acre feet per annum will be stored.
5. Water will be used for the following purposes:
Municipal zoo purpose from Jan 1 to Dec. 31 (both dates inclusive)
Irrigation purpose from Apr. 1 to Oct. 15 (both dates inclusive)
_____ purpose from _____ to _____ (both dates inclusive)
6. Proposed diverting works:
a. Description of ditches, flumes, pumps, headgates, etc. _____

b. Height of storage dam _____ feet; active reservoir capacity _____ acre feet; total reservoir
capacity _____ acre feet; materials used in storage dam: _____

c. Proposed well diameter is 16 inches; proposed depth of well is 155 feet.
7. a. Time required for the completion of the works and application of the water to the proposed beneficial use
is 5 years.
b. Estimated construction cost is \$ 10,000.00.
8. Description of proposed uses:
a. If water is **not** for irrigation:
(1) Give the place of use of water: NW $\frac{1}{4}$ of SE $\frac{1}{4}$ of Section 10 Township 3N.
Range 2E B.M.
(2) Amount of power to be generated: _____ hp under _____ feet of head.
(3) List number of each kind of livestock to be watered various numbers of wildlife etc.
in the city zoo
(4) Name of municipality to be served _____, or number of families to be
supplied with domestic water: _____
(5) If water is to be used for other purposes describe: other water requirements at the
zoo.

b. If water is for irrigation, indicate acreage in each subdivision in the tabulation below:


TWP.	RANGE	SEC.	NE¼				NW¼				SW¼				SE¼				TOTALS
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	
3N	2E	10									20			10	5	15	25	20	95

Total number of acres to be irrigated 95

- c. Describe any other water rights used for the same purposes portions of Julia Davis Park
are currently irrigated from a city well, Boise Water Corporation
supply; and irrigation district surface ditch.
9. a. Who owns the property at the point of diversion City of Boise
b. Who owns the land to be irrigated or place of use City of Boise
c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing _____

10. Remarks Drilling of well was completed March 22, 1965. Through misunderstanding
between owner, architect, and various consultants no application was
filed at time of completion. Well has been in use since April 1965.
Copy of well log and well test data are submitted with this application.
A date of priority of March 22, 1965 is respectfully requested.
Well drilling contractor was Lukehart Drilling & Pump Co., Boise.
Water from the well is primarily for the zoo but piping and valves
are such as to allow part of the water, as available to be used
during the irrigation season to supplement irrigation in Julia
Davis park.

11. Map of proposed project:

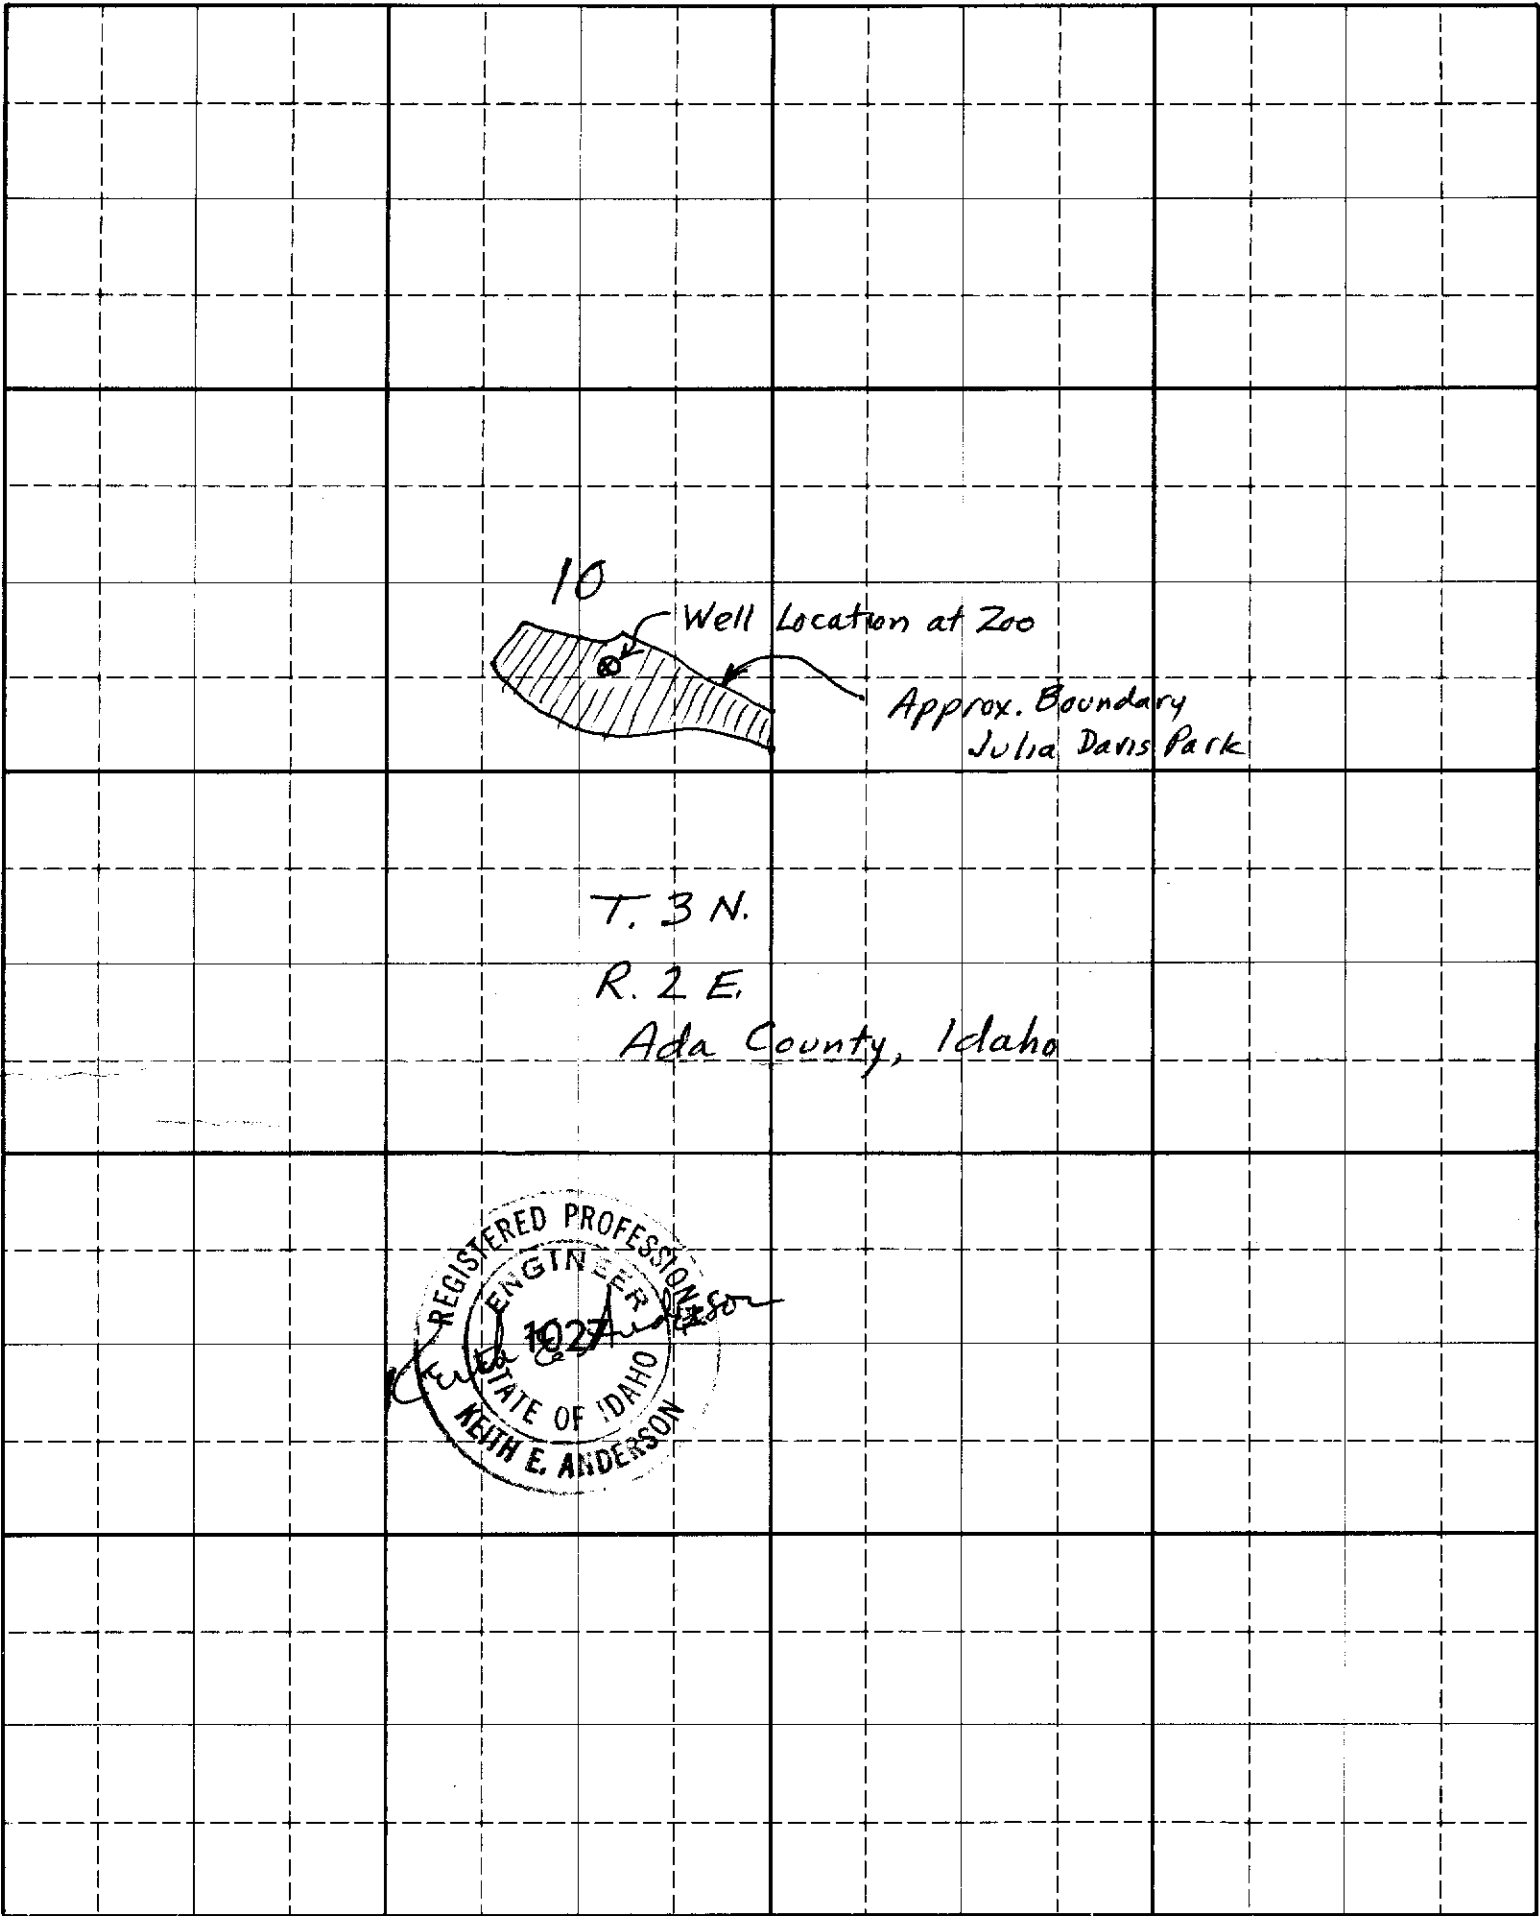

Scale: 2 inches equal 1 mile

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

City of Boise
(Applicant)
By Jeff Amys
Mayor

Received by ef Date 10-22-67 Time 8:30 am

Preliminary check by Dell Fee \$ 25.00

Received by ko Date 10-27-67

Publication prepared by KS Date 10-31-67

Published in Idaho Daily Star

Publication dates 11-9-67 & 11-16-67

Publication approved KS Date NOV 11

Priority reduced to _____ Reason _____

Protests filed by: None

Copies of protests forwarded by _____

Hearing held by _____ Date _____

Recommended for approval denial by AGAS DMK

APPROVED

ACTION OF STATE RECLAMATION ENGINEER

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. 63-7034, and said application is hereby APPROVED

1. Approval of said application is subject to the following limitations and conditions:

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
- b. Proof of construction of works and application of water to beneficial use shall be submitted on or before December 1, 1972.
- c. Other: The applicant shall permanently install a measuring device of a type approved by the department as part of the diverting works.

2. Denial of said application is for the following reasons: _____

Witness my hand this 26th day of December 19 67.

R. Keith Higgins
State Reclamation Engineer

BEFORE THE DEPARTMENT OF WATER ADMINISTRATION
OF THE
STATE OF IDAHO

IN THE MATTER OF Permit No. 63-7034)
in the name of the CITY OF BOISE)

ORDER OF REINSTATEMENT

WHEREAS, on October 27, 1967, the City of Boise filed with the Department of Water Administration (formerly the Department of Reclamation) an application for permit to appropriate 2.0 cfs of water from a ground water source within the NW $\frac{1}{4}$ SE $\frac{1}{4}$ of Sec. 10, Twp. 3 N, Rge. 2 E, B.M., Ada County, to be used for municipal and irrigation purposes; and,

WHEREAS, on December 26, 1967, the Department approved said application and issued Permit No. 63-7034 with the condition that proof of construction of works and application of water to beneficial use be submitted to the Department on or before December 1, 1972; and,

WHEREAS, on October 2, 1972, the Department notified the permit holder by certified mail that proof of beneficial use was due and instructed the permit holder as to the steps to be taken to make said proof; and,

WHEREAS, on December 8, 1972, the Department notified the permit holder that Permit No. 63-7034 had lapsed for failure to submit proof of beneficial use of water; and,


WHEREAS, on January 17, 1973, the Department received the required proof of beneficial use of water; and,

WHEREAS, Section 42-218a of the Idaho Code provides that a permit may be reinstated upon a showing of reasonable cause within 60 days from the date of the notice of lapsing; and,

WHEREAS, the permit holder has provided a reasonable showing as to why said permit should be reinstated;

IT IS, THEREFORE, HEREBY ORDERED that Permit No. 63-7034 be REINSTATED and the priority advanced to December 13, 1967.

Dated this 30 day of January, 1973.

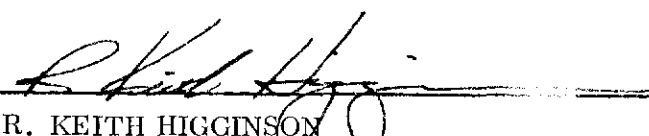

R. KEITH HIGGINSON
Director

WELL LOG AND REPORT TO THE
STATE RECLAMATION ENGINEER OF IDAHO

SUBMIT WITHIN 30 DAYS AFTER COMPLETION OF WELL: SEE IDAHO STATUTES 42-238

Permit No. Well No. 200 County AdaOwner Boise City (Park Department)Address Boise, IdahoDriller Lukehart Drilling & Pump Co.Address Boise, IdahoWell location NW 1/4 SE 1/4 Sec. 10, T. 3 N., R. 2 E.Size of drilled hole 16-inch

Locate well in section

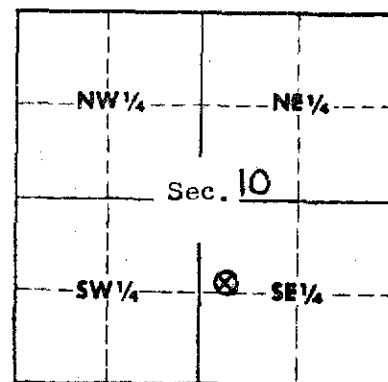Total depth of well 155 ft.Give depth to standing water from the ground 4 ft Water temp. 56 °Fahr.Test delivery was 980 g.p.m. or c.f.s. Drawdown was 43 feet. Pump? ☒ Bail? Size of pump and motor used to make test Vertical turbine, 12-inch bowlsLength of time of test 5 hours minutes.If flowing well, give flow c.f.s. or g.p.m. and of shut off pressure If flowing well, described control works

(TYPE AND SIZE OF VALVE, ETC.)

Water will be used for Irrigation & municipal Weight of casing per lineal foot 52.36 lbsThickness of casing 0.312 Casing material steel

(STEEL, CONCRETE, WOOD, ETC.)

Diameter, length and location of casing 16-inch O.D. surface to 85'8"(CASING 12" IN DIAMETER OR LESS, GIVE INSIDE DIAMETER;
CASING OVER 12" IN DIAMETER, GIVE OUTSIDE DIAMETER)

CASING RECORD

Diam. Casing	From Feet	To Feet	Length	Remarks—seals, grouting, etc.
16	0	85.7	85.7	None - Drive shoe set at 85'8"

Number and size of perforations 168 - 3/8 x 3" located 50 feet to 64 feet from ground
(casing perforated in place)Date of commencement of well Feb 15, 1965 Date of completion of well March 22, 1965

63 7034

63 7034

WELL LOG

From Feet	To Feet	Type of Material	Water-bearing Formation Ans. Yes or No	Casing Perforated Ans. Yes or No
0	49	Gravel	Yes	Yes
49	53	Gravel & sand, some brown clay	Yes	Yes
53	64	Sand & gravel	Yes	Yes
64	68	Fine sand, reddish color	Yes	No
68	75	Blue muddy sand	Yes	No
75	80	Sandy blue shale	No	
80	84	Blue shale		
84	96	Blue shale, sticky		
96	100	Blue shale,		
100	105	Sandy blue shale, some coarse sand		
105	120	Sandy blue shale, some coarse sand; caving blue muddy shale in lower part		
120	125	Blue shale		
125	129	Blue shale, sticky		
129	140	Blue shale		
140	145	Blue clay		
145	155	Clay, blue to brown; sandy gray clay in bottom	✓	✓
If more space is required use Sheet No. 2				

WELL DRILLER'S STATEMENT

This well was drilled under my supervision and the above information is complete, true and correct to the best of my knowledge and belief.

Signed _____

By _____

Keith E. Anderson
Consulting Engineer
License No. _____
WELL DRILLER'S HELPER

Dated _____

March 23, 1965

R

Q 5 57 1967

Dep.

ation

63 7034

Boise City Zoo Well - Test Data
(March 22, 1965)

<u>Time</u>	<u>Depth to Water (Ft.)</u>	<u>Discharge (GPM)</u>	<u>Remarks</u>
10:45 am	4.3	---	Static water level
12:00 noon			Pump started
12:10 pm	45.	978	
12:20	44.	950	
12:30	45.	950	Clearing, some sand and clay
12:45	44.	950	Quite clear
1:00	44.	950	
1:15	44.	950	
1:30	44.	950	Water nearly clear
1:45	47.1	985	
2:00			Pump stopped
2:00½	23.8		Recovery readings
2:01	19.3		
2:02	15.6		
2:03	13.5		
2:04	12.3		
2:06	10.7		
2:08	9.8		
2:10	9.3		
2:15	8.4		
2:20	8.0		
2:21			Pump started, some dirty color
2:25		869	Water clearing
2:30	39.8	857	
2:35			Start surging with pump to clean up
4:40	31.	634	Water clear; Temp. 56 F.
5:00	28.5	599	Last measurement

Pump: Fairbanks-Morse turbine, 12-inch bowls set at 50 feet.
 Power: Cletrac engine, gear head on pump
 Discharge: Measured with 6-inch orifice on 8-inch discharge pipe
 Water Level: Measured with electric line; measuring point was
 hole in side of 16-inch casing which was 0.5 ft.
 above ground level and 2.21 ft. below top of casing.

Observations by engineer from 10:45 - 11:15 a.m.
 1:45 - 2:35 p.m.
 4:40 - 5:00 p.m.

OCT 27 1967

63 7034

STATE OF IDAHO }
COUNTY OF ADA } ss.

Iona A. Young

, being duly sworn,
deposes and says: That she is the Principal Clerk of The Idaho
Daily Statesman, a daily newspaper printed and published at
Boise, Ada County, State of Idaho, and having a general circula-
tion therein and which said newspaper has been continuously
and uninterruptedly published in said County during a period of
twelve consecutive months prior to the first publication of the
notice, a copy of which is attached hereto; that said notice was
published in the regular Monday edition of The Idaho Daily
Statesman in conformity with Sec. 60-108, Idaho Code, for

Two non/ consecutive weekly insertions


beginning with the issue of November 9, 1967,
and ending with the issue of November 16, 1967. (Thursday)

, Principal Clerk

Subscribed and sworn to before me this 6th day of

December, 1967.

[Signature]
Notary Public for Idaho, Residing at Boise, Idaho

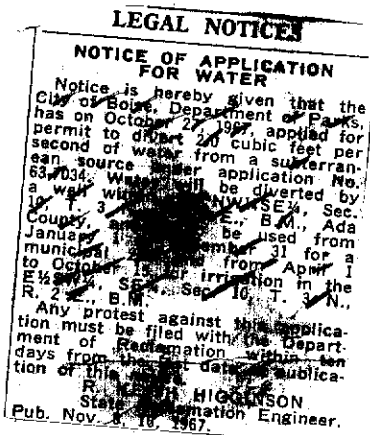

THE STATESMAN NEWSPAPERS

BOISE, IDAHO

FOR LEGAL ADVERTISING

. State Dept. Reclamation
 . 107 State House
 . Boise, Idaho
 .

DATE	DESCRIPTION	INCHES	TOTAL INCHES	CHARGES	✓	CREDITS	BALANCE
	BALANCE STATEMENT RENDERED						
NOV 9-16 1967	WATER - Appl 63 7034 City Park Dept.	24L 2X		6.00			6.00
I certify that the above account is correct and that the services were actually rendered and charged and that we have not received payment therefor. Signed STATESMAN PRINTING CO. By _____							

TERMS: NET BY 10TH OF MONTH FOLLOWING

LAST AMOUNT IN
 THIS COLUMN
 IS BALANCE
 DUE

63 7034

WELL DRILLER'S REPORT

State law requires that this report be filed with the Director, Department of Water Resources
within 30 days after the completion or abandonment of the well.

1. WELL OWNER

Name Boise City Parks
Address 1104 Royal Blvd.
Owner's Permit No. 207 63-83-C-0065-000

7. WATER LEVEL

Static water level 13 feet below land surface
Flowing? ☐ Yes ☒ No
Artesian closed-in pressure 13 p.s.i.
Controlled by: ☐ Valve ☒ Cap ☐ Plug
Temperature °F. Quantity OCT 29 1985

2. NATURE OF WORK

W.R. 63-07034

- ☒
- New well
- ☐
- Deepened
- ☐
- Replacement
-
- ☐
- Abandoned (describe method of abandoning)
-

8. WELL TEST DATA

Department of Water Resources
Western Regional Office

- ☒
- Pump
- ☐
- Bailor
- ☐
- Air
- ☐
- Other
-

Discharge G.P.M.	Pumping Level	Hours Pumped
400 GPM	150 ft	30 hrs
350 GPM	"	30 hrs
(Sand free)		

3. PROPOSED USE

- ☐
- Domestic
- ☒
- Irrigation
- ☐
- Test
- ☐
- Municipal
-
- ☐
- Industrial
- ☐
- Stock
- ☐
- Waste Disposal or Injection
-
- ☐
- Other
-
- (specify type)

4. METHOD DRILLED

- ☐
- Rotary
- ☐
- Air
- ☐
- Hydraulic
- ☐
- Reverse rotary
-
- ☒
- Cable
- ☐
- Dug
- ☐
- Other
-

5. WELL CONSTRUCTION

Casing schedule: ☒ Steel ☐ Concrete ☐ Other

Thickness	Diameter	From	To
250 inches	8 inches	1 feet	200 feet
inches	inches	feet	feet
inches	inches	feet	feet
inches	inches	feet	feet

Was casing drive shoe used? ☐ Yes ☒ NoWas a packer or seal used? ☐ Yes ☒ NoPerforated? ☐ Yes ☒ NoHow perforated? ☐ Factory ☐ Knife ☐ TorchSize of perforation inches by inches

Number	From	To
perforations	feet	feet
perforations	feet	feet
perforations	feet	feet

Well screen installed? ☒ Yes ☐ NoManufacturer's name Johnson Stainless SteelType Model No. Diameter 8 Slot size Set from feet to feetDiameter 8 Slot size Set from feet to feetGravel packed? ☐ Yes ☐ No ☐ Size of gravel Placed from feet to feetSurface seal depth 20' Material used in seal: ☐ Cement grout☐ Puddling clay ☐ Well cuttingsSealing procedure used: ☐ Slurry pit ☐ Temp. surface casing☐ Overbore to seal depthMethod of joining casing: ☐ Threaded ☐ Welded ☐ Solvent☐ Weld☐ Cemented between strataDescribe access port

9. LITHOLOGIC LOG

Hole Diam.	Depth		Material	Water	
	From	To		Yes	No
8 200'	0	3	Top Soil		✓
	3	22	Sand + Gravel		✓
	22	61	Sand + Gravel	✓	
	61	62	Red Clay		✓
	62	67	Red Sand	✓	
	67	74	Brown Sand	✓	
	74	78	Blue Shale		✓
	78	87	Gray Sand	✓	
	87	93	Sandy Blue Shale		✓
	93	94	Fine Brown Sand	✓	
	94	97	Brown Sandy Clay		✓
	97	124	Coarse Sand + Pea Gravel	✓	
	124	128	Sandy Blue Shale		✓
	128	143	Gray Sand	✓	
	143	151	Sandy Blue Shale		✓
	151	167	Sand (coarse)	✓	
	167	168	Blue Shale		✓
	168	224	Sand	✓	
224	250	Blue Shale		✓	


RECEIVED RECEIVED
MAY 14 1985 MAY 15 1985Department of Water Resources Department of Water Resources
Western Regional Office Western Regional OfficeScreens
8 in 45 ft - 50 ft - 40 ft
50 ft - 55 ft - 80 ft
55 ft - 60 ft - 30 ft
105 ft - 135 ft - 30 ft
155 ft - 165 ft - 25 ft
MICROFILME

10.

Work started 3/14/83 finished 5/16/83

6. LOCATION OF WELL

Sketch map location must agree with written location.

Subdivision Name Tourist Rest StopCapital Blvd & RiverLot No. Block No. MICROFILMEDCounty AdaNW 1/4 SW 1/4 Sec. 10, T. 3, N. 8, R. 2 E. 1/4

11. DRILLERS CERTIFICATION

00

I/We certify that all minimum well construction standards were
complied with at the time the rig was removed.Firm Name Boise Valley Pump & Drilling Firm No. 207Address Date 5/20/83Signed by (Firm Official) Ron J. Praggand
(Operator) Larry R. Fulton



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. BOX 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

June 20, 1997

PHILIP E. BATT
GOVERNOR

CITY OF BOISE
PARKS & RECREATION DEPT
1104 ROYAL BLVD
BOISE ID 83706

KARL J. DREHER
DIRECTOR

RE: Water Right No. 63-02792/63-07034/A63-30418 (Transfer No. 5009)

Dear Water Right Holder(s):

Enclosed is a copy of your approved Transfer of Water Rights for the above referenced water rights (Transfer No. 5009). Please be sure to thoroughly read the Conditions and Remarks listed on the transfer. Also, please be advised that the accompanying transfer approval should be considered and treated as a **preliminary order** of the department issued pursuant to section 67-5243, Idaho Code. Enclosed are instructions for responding to **Preliminary Orders** if you are in disagreement with the approved transfer.

As of July 1, 1996, all water right owners are required to report any change in water right ownership and any change of mailing address to the department.

If you have acquired any other water right or have changed your mailing address **PRIOR TO** July 1, 1996, you have until July 30, 1998, to record the ownership and/or address change with the department.

If you acquired other water rights or changed your mailing address **AFTER** July 1, 1996, you must notify the department within 120 days of the change.

Failure to report these changes in a timely manner could result in a \$100 late filing fee. You can contact any office of the department for more information. If you have any questions concerning your water right listed above you can contact me at (208) 327-7947.

Sincerely,

JIM JOHNSON, Manager
Water Right Permits Section

JJ:klt

Enclosures

MICROFILMED


JUN 25 1997

CERTIFICATE OF MAILING

I hereby certify that on the 20th day of June, 1997, I mailed a true and correct copy, postage prepaid, of the foregoing **TRANSFER APPROVAL** to the person(s) listed below:

WATER RIGHT NO. 63-02792/63-07034/A63-30418 (Transfer No. 5009)

CITY OF BOISE
PARKS & RECREATION DEPT
1104 ROYAL BLVD
BOISE ID 83706


Kari Lynn Townsend
Secretary

RECORDED

JUN 25 1997

MEMORANDUM

TO: FILE NOS. 63-02792, 63-07034 & A63-30418

FROM: PAM SKAGGS/STATE OFFICE

SUBJECT: TRANSFER NO. 5009

DATE: June 4, 1997



=====

Transfer No. 5009 adds points of diversion and changes the place of use under Right Nos. 63-02792, 63-07034 & A63-30418. The transfer more accurately describes the existing use and the addition of 1 new well. These groundwater rights will be diverted from 5 wells and used to irrigate Julia Davis Park.

Concerns regarding the impact of pumping from a shallow wells that appear to be directly related to the Boise River were discussed by staff, the applicant and their attorney. A condition was agreed upon to address the matter, making the rights subject to the watermaster of Water District No. 63 according to conjunctive management rules.

Season of use and diversion volume were adjusted to current standards. Other recommended conditions include drilling permit requirements, irrigation overlap, non-confirmation of claim, multiple points of diversion/measuring devices, combined right limits and standard transfer conditions.

UNRECORDED

JUN 25 1997

MEMORANDUM

TO: FILE 63-7034

FROM: PAM SKAGGS

RE: TRANSFER # 5009

DATE: 5-27-97

=====

Original Transfer Application, Form and correspondence regarding the above referenced Transfer is located within file # 63-02792.

MICROFILMED

JUN 25 1997

STATE OF IDAHO
DEPARTMENT OF WATER ADMINISTRATION
STATE OFFICE



Cecil D. Andrus
Governor

R. Keith Higginson
Director

614 State Street
Statehouse — Annex 2
Boise, Idaho 83720
(208) 384-2215

Water Rights Administration
Water Resource Investigations
Dam and Reservoir Safety
Water Well Drilling
Waste Disposal Wells
Stream Channel Protection
Geothermal Resources

February 7, 1974

Re: Permit No. 63-7034

City of Boise
Parks Department
City Hall
Boise, Idaho 83702

Gentlemen:

Enclosed herewith is a copy of the water license issued on the above referenced permit.

Sincerely,

BOBBY D. FLEENOR
Assistant Director

jfr

Enclosure

63 7034

January 22, 1974

Re: Permit No. 63-7034

City of Boise
Parks Department
City Hall
Boise, Idaho 83702

Gentlemen:

A representative of this Department has made an examination of the works covered by your Permit No. 63-7034 and has found the following:

Quantity of water diverted: 1.59 cfs

Amount of water that can be recognized as beneficially used under Idaho law: 1.59 cfs

The maximum quantity diverted shall not exceed 619.5 acre feet per year.

Beneficial use: ~~For municipal zoo purposes within the NW 1/4, Sec. 10; and for irrigation of 83 acres within the E 1/4, Sec. 10, Twp. 3 N, Rge. 2 E~~

Point of diversion: ~~NW 1/4, Sec. 10, Twp. 3 N, Rge. 2 E, B.M.~~

Priority date established: ~~December 13, 1967~~

If you do not concur with these findings, please advise us within 10 days; otherwise, a license will be issued as set forth in this letter.

Sincerely,

BOBBY D. FLEENOR
Assistant Director

jfr

63 7034

DEPARTMENT OF WATER ADMINISTRATION
FIELD REPORT

1. Name of permit holder City of Boise, Park Department
Post office address City Hall, Boise, Idaho Phone San Harris 3424621
Person to contact _____ Phone _____

2. Source of water supply: Groundwater ☒ Surface water ☐ _____
(name spring, stream, etc.)
Tributary to _____

3. Water will be used for the following purposes:

Amount 2.0 c.f.s. for Municipal Zoo
_____ AF/Annum (nature of use)

Period of Use: from Jan. 1 to Dec. 31
(mo.-day) inclusive (mo.-day)

Amount 2.0 c.f.s. for Irrigation
_____ AF/Annum (nature of use)

Period of Use: from April 1 to Oct. 15
(mo.-day) inclusive (mo.-day)

Amount _____ c.f.s. for _____
_____ AF/Annum (nature of use)

Period of Use: from _____ to _____
(mo.-day) inclusive (mo.-day)

Other uses: _____

Permit No. 63-7034
Examination for b/u

4. Total amount to be appropriated:

Max Rate of Diversion 2.0 cubic feet per second and annual volume _____ AF/Annum.

5. Location of Point(s) of Diversion:

Township 3 N N/S, Range 2 E E/W, B.M., Section 10, Subdivision NW $\frac{1}{4}$ SE $\frac{1}{4}$, Ada
County

Township _____ N/S, Range _____ E/W, B.M., Section _____, Subdivision _____ $\frac{1}{4}$ _____ $\frac{1}{4}$, _____
County

Township _____ N/S, Range _____ E/W, B.M., Section _____, Subdivision _____ $\frac{1}{4}$ _____ $\frac{1}{4}$, _____
County

Other Points of Diversions: _____

Description of diverting works: well, 2/20-hp pumps, buried pipeline system

Measuring device required: yes ☒ no ☐

83.80

6. Lands to be irrigated or place of use. City Zoo

TWP.	RANGE	SEC.	NE $\frac{1}{4}$				NW $\frac{1}{4}$				SW $\frac{1}{4}$				SE $\frac{1}{4}$				TOTALS
			NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	
3N	2E	10									15			10	5	15	30	20	95
		10														X			

63 7034 TOTAL ACREAGE

83.80

T.
3
N

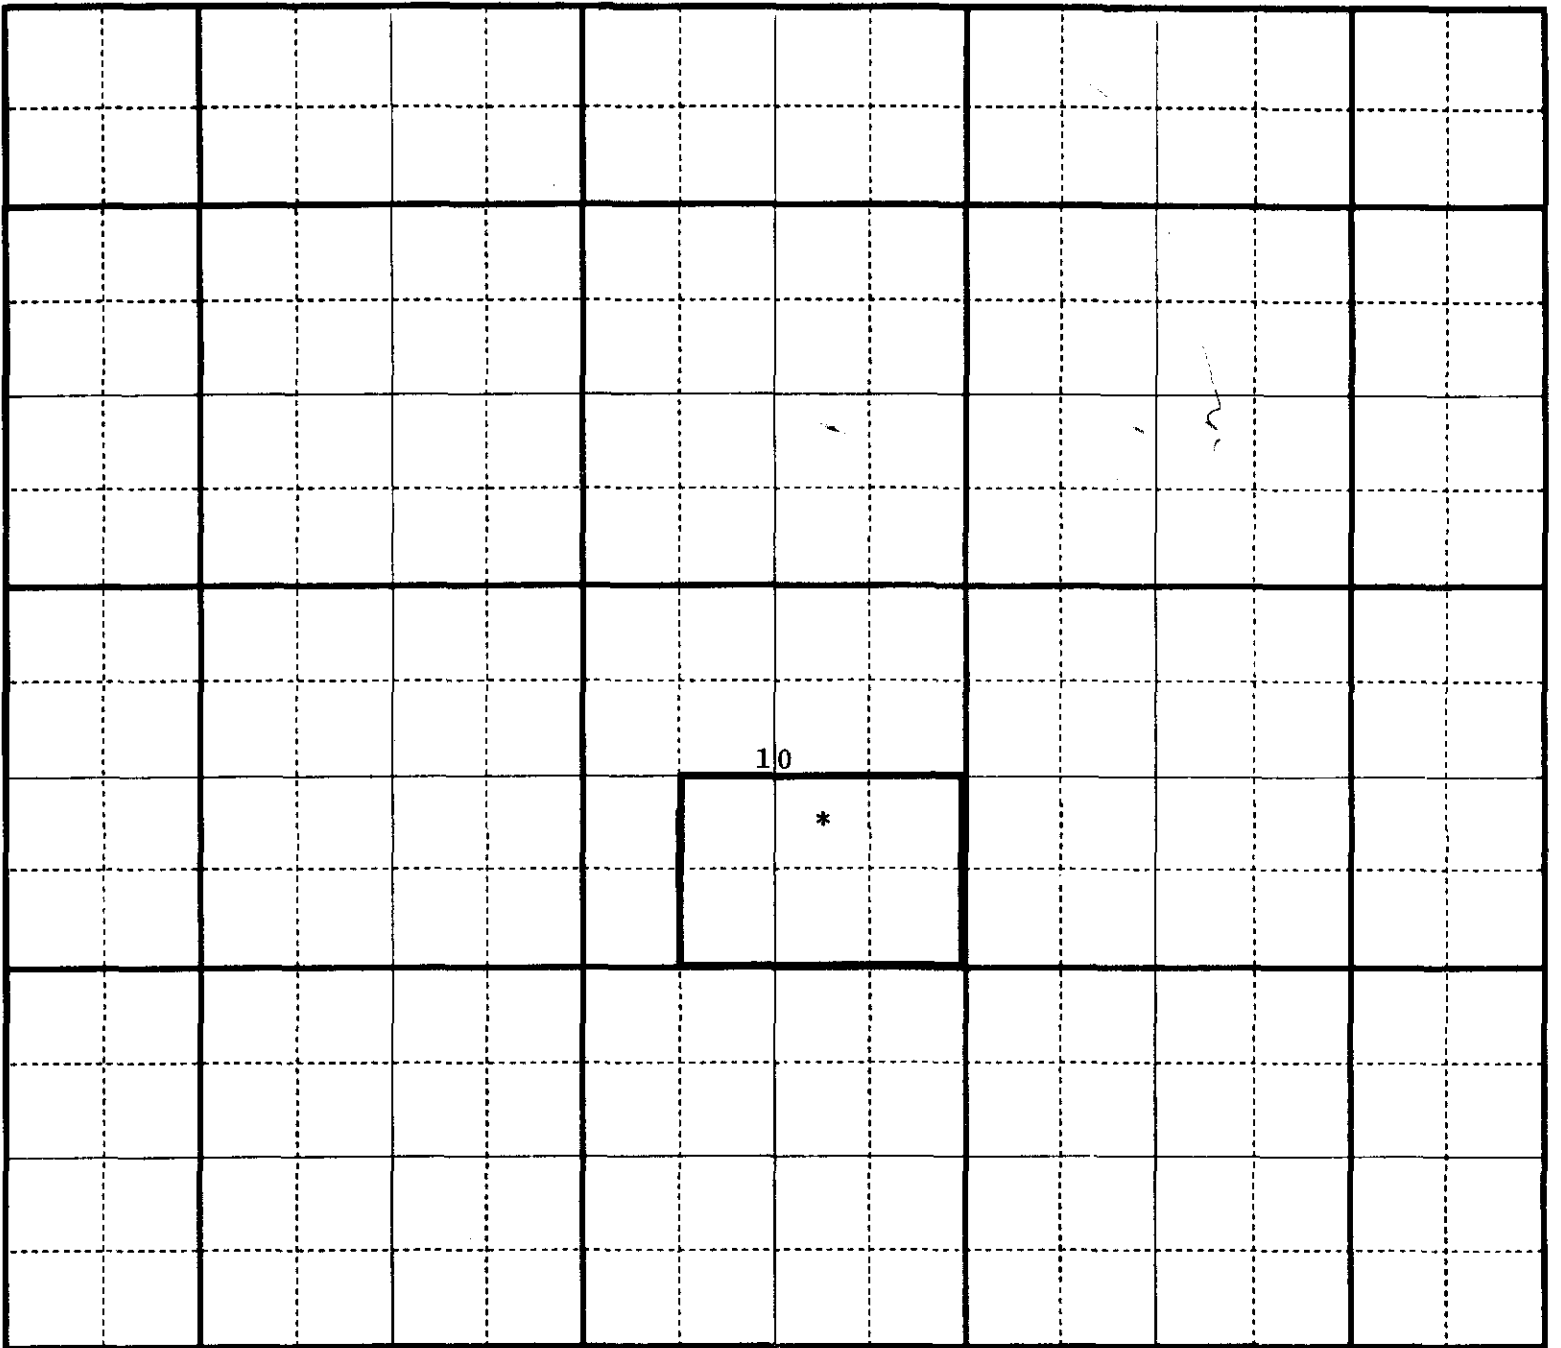


Diagram of System

Skip Gates
Ben Harris

See Map

DATE OF EXAM 18 June 1973

ACREAGE

Found

Recommended

~~Ballou~~ (Bank records)
see map & front page of exam
83.00

Irrigation Requirement 4.5 Ac Ft/Ac

USE

Irrigation Q = 1.25 c.f.s. V = 373.5 AF/Ann. from 4-1 to 12-31
Domestic Q = _____ c.f.s. V = _____ AF/Ann. from _____ to _____
Livestock Q = .34 c.f.s. V = 243.0 AF/Ann. from 1-1 to 12-31

Is water co-mingled? yes _____ no ✓

Name source: _____

twp. _____ N/S, Rge _____ E/W, B.M., Sec. _____, Sub. _____ 1/4 _____ 1/4 _____ County _____

Exchange? yes _____ no ✓

Name source exchanged with: _____

twp. _____ N/S, Rge _____ E/W, B.M., Sec. _____, Sub. _____ 1/4 _____ 1/4 _____ County _____

Point of injection: _____

twp. _____ N/S, Rge _____ E/W, B.M., Sec. _____, Sub. _____ 1/4 _____ 1/4 _____ County _____

Point of exchange: _____

twp. _____ N/S, Rge _____ E/W, B.M., Sec. _____, Sub. _____ 1/4 _____ 1/4 _____ County _____

Total Q measured 1.34 cfs @ 2.00 1.25 cfs @ 1.54 Method of measurement g.p.m.

Total Q recommended 1.59 cfs Meter No. none Type Budger Condition Good

Total V recommended 373.5 AF/Ann.
243

Recommended Amendments: 616.5 AF/Ann Total

P.D. _____

Place of Use _____

Other _____

None _____

MEASUREMENT CALCULATION:

16" x 160' deep well w/ 2 20HP pumps pumping 100 gal/min/sec
measured inline budger meter 2 1/100 = 4.6 g.p.m. = 276 gpm x 2
= 552 gpm = 1.25 cfs for irrigation

SYSTEM DESCRIPTION:

16" x 160' well 2 20 hp pumps to 4" main to underground
sprinklers etc

REMARKS:

Found system operating at 100 gal/min/sec (2)
also max usage for zoo area to 150 gpm for
page area and moats etc, accompanied by Ben Harris
during exam

Examiner's Signature

Quinn Ballou

Date 5 July 73

Checked by _____

Date _____

Approved by _____

Date _____

January 31, 1973

Re: Permit No. 63-7034

City of Boise, Park Dept.
City Hall
Boise, Idaho 83702

Gentlemen:

We acknowledge receipt of the affidavit submitted as proof of beneficial use of water for the above referenced permit. Enclosed you will find an Order of Reinstatement; please note that the priority date has been advanced.

Before a water license can be issued, a field examination must be made by a representative of this Department. We cannot tell just when this examination will be made, but our examiner will try to contact you at the time he makes the exam so that you may arrange to have someone show him the system.

Sincerely,

BOBBY D. FLEENOR
Assistant Director

BDF:DR
Enclosure

cc: Mr. Keith E. Anderson

63 7034

ANDERSON & KELLY
CONSULTANTS IN ENGINEERING AND GEOLOGY
6700 EMERALD STREET
BOISE, IDAHO 83704

January 16, 1973

Department of Water Administration
Statehouse Annex #2
Boise, Idaho

Attention: Mr. Stephen Allred
Subject: Permit No. 63-7034

Gentlemen:

Enclosed is the completed Proof of Application of Water to Beneficial Use for the subject permit. The delay in submission is due to a prolonged delay in repair and re-installation of pumps in the well. We had hoped that re-installation would have been completed prior to the deadline for proof submission, in order to have an accurate measurement of maximum discharge from both pumps. However, in order to avoid an excessive penalty and possible revocation of the permit, submission is made at this time, without measurement of both pumps discharge.

Inasmuch as the two pumps are identical, we believe the figures shown are reasonably accurate. However, if you wish, we will submit an affidavit to clarify and supplement this submission, after the re-installation is completed.


If you have any questions, please do not hesitate to contact us directly.

Sincerely,

ANDERSON & KELLY

Keith E. Anderson
Keith E. Anderson

KEA/cr
Enc.

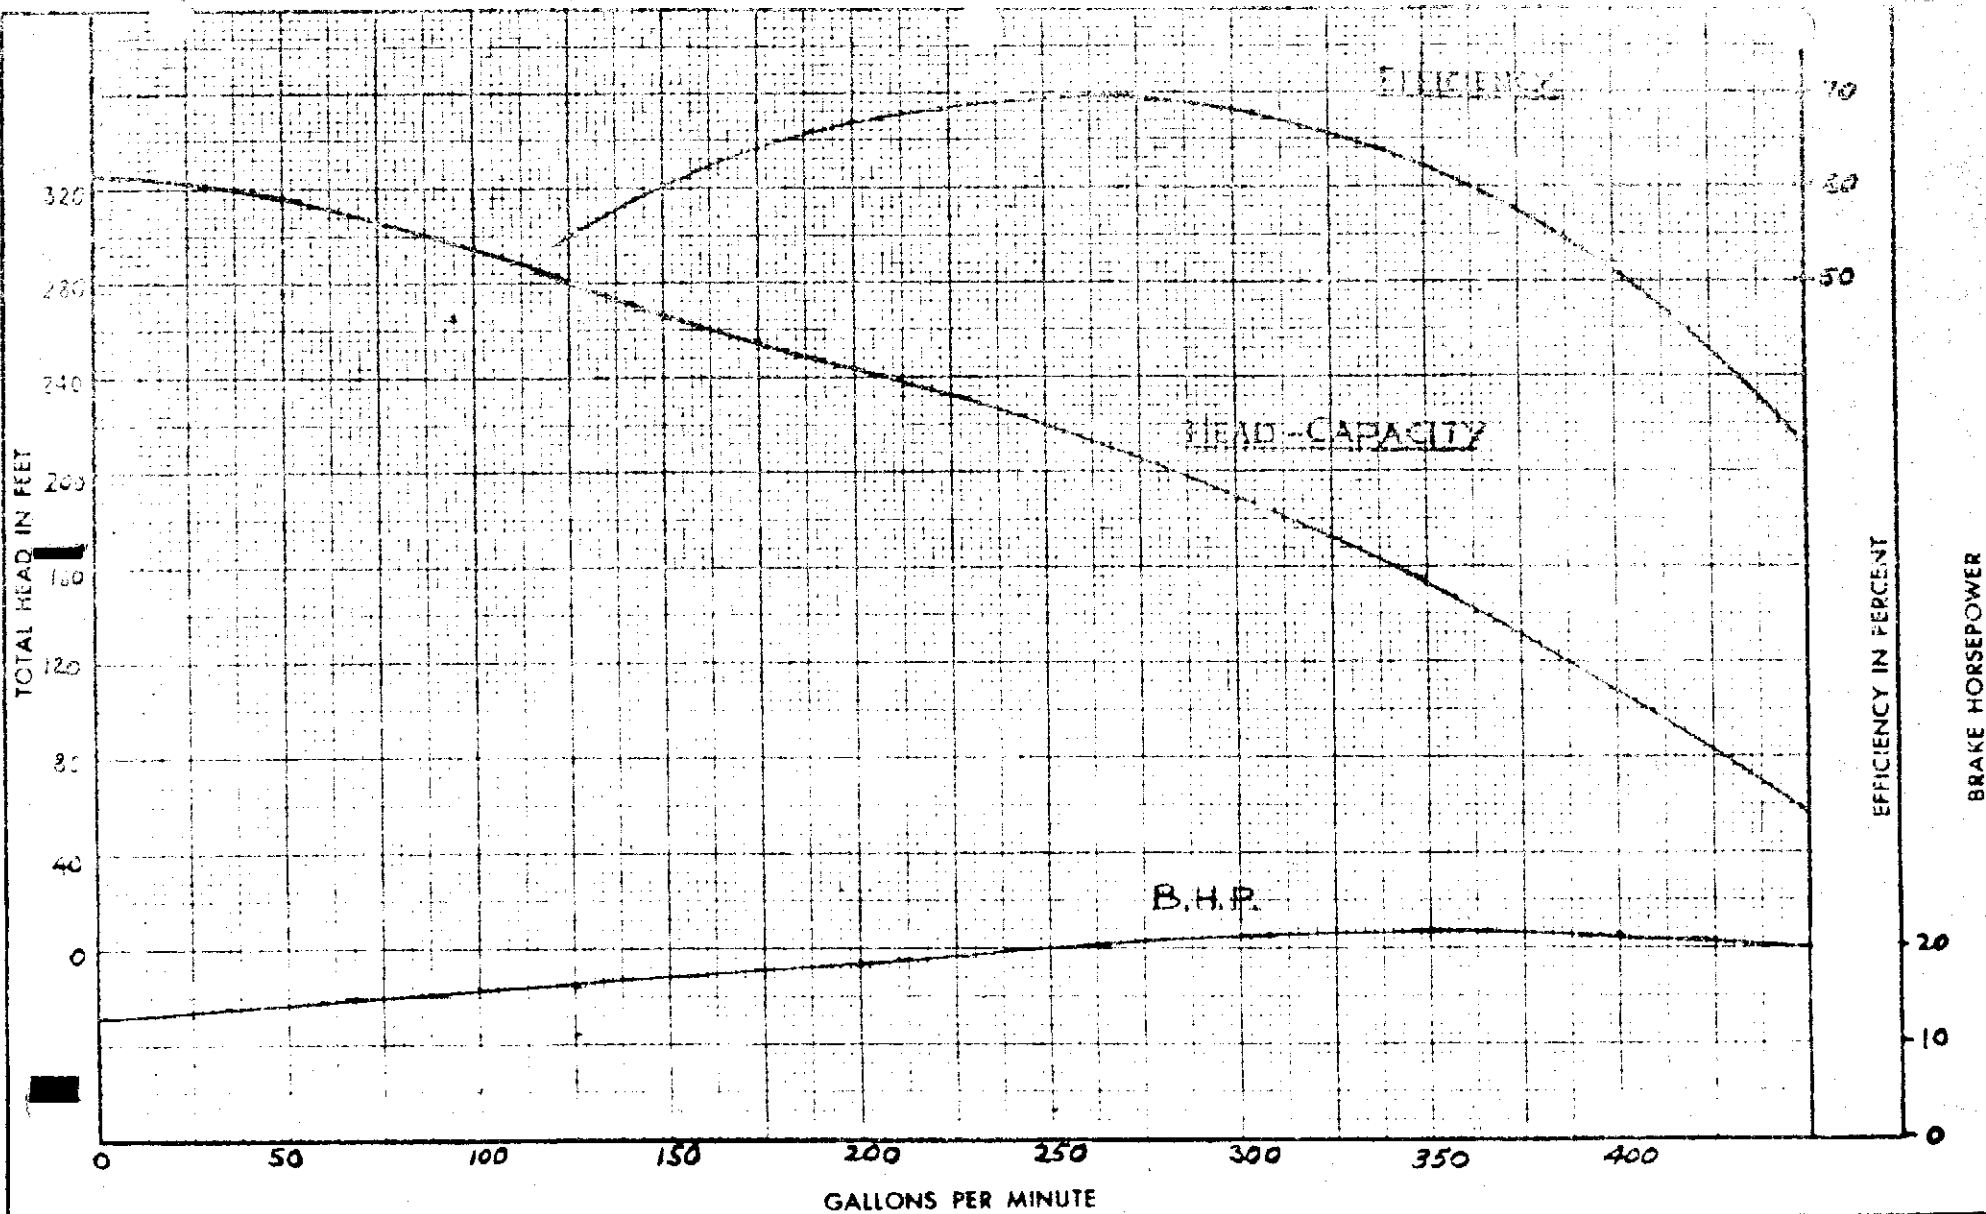

Jacuzzi
TURBINE PUMPS

Date: 10-31-60 EGP

Performance based on pumping clear, fresh water at a temperature not over 85°F., and free of gas, air or abrasives, and with bowls properly adjusted and submerged.

NUMBER OF BOWLS	CHANGE EFFICIENCY AS FOLLOWS
Change in efficiency may affect both head and horsepower	

Bowl Dia. 5 9/16 In.
Bowl No. 3473 C.I.
Impeller No. 3472 BRONZE
Eye Area 4.01 Sq. In.
Imp. Type CLOSED K=2.83

STAGE PERFORMANCE

Curve No. 6S-78
R. P. M. 3450
Bowl 20.56 X 4

Identification No. _____

Permit No. _____

RECEIVED

Date

Department of Water Administration

**STATE OF IDAHO
DEPARTMENT OF RECLAMATION**

PROOF OF APPLICATION OF WATER TO BENEFICIAL USE

1. a) Name of Permit Holder City of Boise, (Park Department)
b) Post Office Address City Hall, Boise, Idaho
2. Permit Number 63-7034
3. Date of Priority that you are prepared to establish March 22, 1965
4. a) Source from which water was appropriated groundwater
b) Location of the point of diversion: NW 1/4 SE 1/4, Section 10
Township 3N, Range 2E Boise Meridian, Other points of diversion: _____
5. a) The amount of water and use to which the water has been applied:
amount 1.4 cfs for Municipal (Zoo) purposes from Jan. 1 to Dec. 31 incl.
(cfs and/or acre feet per annum) (Month-Day) (Month-Day)
amount 1.4 cfs for Irrigation purposes from Apr. 1 to Oct. 15 incl.
(cfs and/or acre feet per annum) (Month-Day) (Month-Day)
amount _____ for _____ purposes from _____ to _____ incl.
(cfs and/or acre feet per annum) (Month-Day) (Month-Day)
b) Total amount appropriated 1.4 cfs and/or acre feet per annum
c) Describe how and by whom measurement of rate of flow or amount of storage was made and the qualifications of the person making the measurement: Pump design curves; Keith E. Anderson,
Consulting Engineer (See No. 10 Remarks)
6. If the means of diversion and conveyance are owned by someone other than the Permit Holder: N/a
a) Give the name or description of the canal, ditch or other works by which the water is conducted to the place of use: _____
b) Describe the agreement or understanding by which you take water from the works: _____
7. a) Briefly describe the works for diverting and conveying the water to the place of use, (If from a subterranean source, give the pump size, motor size, size of well casing, depth of well; if from surface water, give brief description of diversion structure and/or canal or ditch) two 20 HP submersible pumps
installed in 16-in. diameter well (total depth 155 ft.) discharging to
buried pipeline system.
b) Describe the type and size of measuring device which you have installed at your point of diversion: Badger MDIM 4-inch flowmeter installed on discharge of each pump
c) Give well drillers name and address and date the well was completed Lukehart Drilling and Pump Co., Boise, Idaho well completed March 22, 1965.

Exam typed 1-31-73 by de

63 7034

8. If for other than irrigation, describe the beneficial use to which you have applied the water and the place of use Watering of wildlife at zoo and related uses

9. Irrigation uses: Describe the lands irrigated by giving the acreages irrigated within each 40 acre subdivision:

TWP.	RANGE	SEC.	NE $\frac{1}{4}$				NW $\frac{1}{4}$				SW $\frac{1}{4}$				SE $\frac{1}{4}$				TOTALS
			NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	
3N	2E	10									20			10	5	15	25	20	95

Total number of acres irrigated 95 (see remarks)

10. Remarks: Repair and reinstallation of pumps in progress in winter 1972-73; amounts shown in No. 5 based on pump design curve attached. The two pumps are of identical design (Jacuzzi submersible turbines, 20S6x4, 315 gpm at 180 feet TDH. Water primarily for zoone use but piping and valves permit supplementing irrigation supply to Julia Davis Park


The above information is a true statement of the extent to which the above numbered permit has been developed.

Jan. 10, 1973
(Date)

[Signature]
(Signature)
B. Bowen

State of Idaho)
County of Ada) ss.

On this 17th day of January, 19 73, personally appeared before me the
signer(s) of the above instrument, who duly acknowledged to me that he (~~she~~) (~~they~~) executed the same.



Elizabeth Adelman
Notary Public residing at Bowen, Idaho

My commission expires 8-12-75

STATE OF IDAHO
DEPARTMENT OF WATER ADMINISTRATION

Cecil D. Andrus
Governor

R. Keith Higginson
Director

Statehouse — Annex 2
Boise, Idaho 83707
(208) 384-2215



Water Rights Administration
Water Resource Investigations
Dam and Reservoir Safety
Water Well Drilling
Waste Disposal Wells
Stream Channel Protection


December 8, 1972

City of Boise, Park Dept.
City Hall
Boise, Idaho 83702

Gentlemen:

You are hereby notified that under the provisions of Section 42-218a of the Idaho Code, Permit 63-7034 has lapsed.

You are further advised that the Department cannot reinstate the permit except upon a showing of reasonable cause within 60 days from the date of this notice of lapsing.

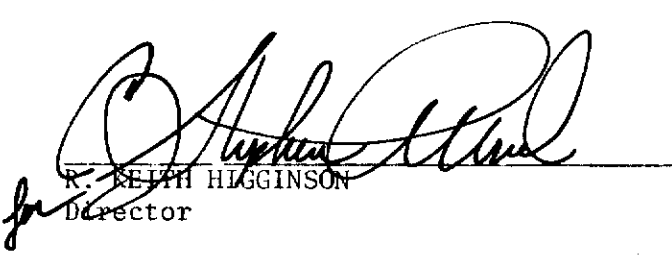
R. KEITH HIGGINSON
Director

RKH:DR

63 7034

SENDER: Be sure to follow instructions on other side

PLEASE FURNISH SERVICE(S) INDICATED BY CHECKED BLOCK(S)

(Additional charges required for these services)

☐

Show to whom, date and address
where delivered

☐

Deliver ONLY
to addressee

RECEIPT

Received the numbered article described below

REGISTERED NO.

SIGNATURE OR NAME OF ADDRESSEE *(Must always be filled in)*

CERTIFIED NO.

24024

1

SIGNATURE OF ADDRESSEE'S AGENT, IF ANY

INSURED NO.

2


DATE DELIVERED

SHOW WHERE DELIVERED *(Only if requested, and include ZIP Code)*

3

10-3-72

U.S. POSTAL SERVICE
OFFICIAL BUSINESS

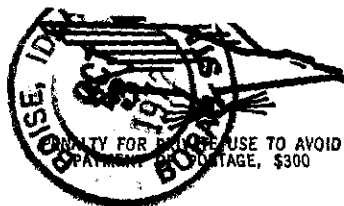

Postmark of Delivering Office

SENDER INSTRUCTIONS

Print in the space below your name, address, including ZIP Code.

- If special services are desired, check block(s) on other side.
- Moisten gummed ends and attach to back of article.

**RETURN
TO**

DEPARTMENT OF WATER ADMINISTRATION

STATEHOUSE - ANNEX #2

BOISE, IDAHO 83707

63 7024

October 2, 1972

CERTIFIED MAIL * *24024*

Re: Permit No. 63-7034

City of Boise, Park Dept.
City Hall
Boise, Idaho 83702

Gentlemen:

One of the conditions of approval of your water Permit No. 63-7034 (see last page of your approved permit) was that evidence of the extent of development be submitted as proof of application of water to beneficial use to this office on or before December 1, 1972. Enclosed is an affidavit form which must be used to submit the required proof of beneficial use.

If you have not fully completed your project, and you have not previously received an extension of time, you may request an extension of time provided the delay is for reasonable cause as indicated in Section 42-204, Idaho Code, amended. If you have been prevented from proceeding by a governmental agency or by litigation, more than one extension of time can be granted.

Either the beneficial use affidavit or a request for an extension of time must be received by this Department on or before the above mentioned date, otherwise the permit will lapse and be of no further force or effect.



R. KEITH HIGGINSON
Director

Enc: Proof affidavit
dr

63 7034

December 27, 1967

Re: Permit 63-7034

City of Boise, Park Department
City Hall
Boise, Idaho

Gentlemen:

We enclose a copy of your approved application for permit 63-7034 in which we direct your attention to the limitations and conditions as given on the fourth page under approval of the State Reclamation Engineer.

Very truly yours,

C. Stephen Allred
Assistant State Reclamation Engineer

CSA:kd

Enclosure: Copy of Application
Receipt No. 123 for \$25.00

October 31, 1967

Re: Application 63-7034

Idaho Daily Statesman
300 North 6th Street
Boise, Idaho 83701

Gentlemen:

Enclosed you will find a legal notice which we wish to have published once a week for two consecutive weekly issues of your newspaper. We have inserted the publication dates allowing ample time for you to submit us a galley proof for review before publication.

After sending us a galley proof, proceed with the publication on the dates we have inserted assuming the notice is correct. If we have any corrections, we will notify you before the first publication date. If you can not publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department of Reclamation, along with the publication bill. In order to receive payment, the following certification must appear on the bill:

I hereby certify that the foregoing account is just and correct, that the amount claimed is legally due, after allowing all just credits, and that no part of same has been paid.

(Do not sign letter)
Signature of claimant

Very truly yours,

Donald W. McEldowney
Water Rights Clerk

DW/Mks

Enclosure: legal notice

Form 3

63 7034

NOTICE OF APPLICATION FOR WATER

Notice is hereby given that the City of Boise, Department of Parks
_____ has on October 27, 1967
applied for permit to divert ~~surface~~ 2.0 cubic feet per second ~~acre/feet~~
of water from a subterranean source
under application No. 63-7034. Water will be diverted by a well
_____ within the NW 1/4 Sec. 10, T. 3 N, R. 2 E, B.M.,
Ada County
and is to be used from January 1 to December 31 for a municipal zoo and
from April 1 to October 15 for irrigation in the
1/4 E 1/2 SW 1/4, SE 1/4, Sec. 10, T. 3 N, R. 2 E, B.M.

Any protest against this application must be filed with the Department of Reclamation within ten days from the last date of publication of this notice.

R. KEITH HIGGINSON
State Reclamation Engineer

Published in the Idaho Daily Statesman, Boise, Idaho,
on November 9 and November 16.