

To Boise

Pgc. 2E

Thp. 3N

36

PD

PD

$$1.62 \text{ cfs} = 3.24 \text{ AF/DAY} \times 365 \text{ DAYS} = 1182 \text{ AF/YEAR}$$

~~ALLOW ~~25~~ cfs FOR INDUSTRIAL (COOLING OF ELECTRICAL EQUIPMENT) & FIRE PROTECTION~~

ALLOW .02 FOR DOMESTIC

TOTAL Q = ~~27~~ cfs ALLOW 2.656 cfs FOR

RECEIVED
JAN 16 1967
Department of Reclamation

PROOF OF PUBLICATION

State of Idaho, }
County of Ada } ss.

I, E. Carol Smith, being first duly sworn, depose and say, that I am over twenty-one years of age, and Chief Clerk of MERIDIAN NEWS-TIMES, a weekly newspaper of general circulation, published at Meridian, County of Ada, State of Idaho, and that the annexed notice was published in said paper once each week for 4 consecutive weeks, the first publication being on the 22nd day of December, 1966, and the last publication being on the 12th day of January, 1967.

That said notice was published in the newspaper proper and not in a supplement. That said newspaper had been continuously and uninterruptedly published in said county for a period of 78 consecutive weeks prior to the first publication of this notice, and is a newspaper within the meaning of the Idaho statutes.

E. Carol Smith
Chief Clerk

Subscribed and sworn to before me this 12th day of January, 1967.

R. J. Maack
Notary Public in and for Idaho

Residence or Postoffice Address Boise, Idaho.

NOTICE OF PROOF OF COMPLETION OF WORKS and APPLICATION OF WATER TO BENEFICIAL USE

Notice is hereby given that on the 16th day of January, 1967, at Boise, County of Ada, State of Idaho, before Gale C. Farley, Notary Public, at 1220 Idaho St., Boise, Idaho, proof will be submitted of the completion of works for the diversion of 2.676 cubic feet per second of underground water from a well, and of the application to beneficial use of said water, in accordance with the terms and conditions of Permit No. G-33213, heretofore issued by the Department of Reclamation of the State of Idaho.

1. The name and postoffice address of the person or corporation holding said permit is Idaho Power Company, Box 770, Boise, Idaho.

2. Said works of diversion will be fully completed on the date for such completion, and the amount of water which said works are capable of conveying to the place of use is 2.676 cubic feet per second.

3. The use to which said water has been applied is cooling of electrical equipment, fire protection, sprinkling, purposes and the amount applied to beneficial use is 2.676 cubic feet per second.

4. The point of diversion of said water is Well No. 4—NE¹/₄ NE¹/₄ Section 36, T3N, R2E, BM. Well No. 5—NW¹/₄ NE¹/₄ Section 36, T3N, R2E, BM.

5. The place where said water is used is NE¹/₄ NE¹/₄, Section 36, T3N, R2E, BM.

6. The date of priority which said user is prepared to establish is September 22, 1966.

R. KEITH HIGGINSON
State Reclamation Engineer.
Dec. 22, 29, 1966; Jan. 5, 12, 1967

33213 Sept 67

MERIDIAN News-Times

Ralph W. Hunter, Jean L. Hunter, Publishers

Telephone 888-4423

Meridian, Idaho 83642

Post Office Box 365

December 22, 1966

Mr. R. Keith Higginson
State Reclamation Engineer
Department of Reclamation
107 State House
Boise, Idaho 83702

RECEIVED
DEC 23 1966

Department of Reclamation

Re: Permit No. G-33213

NOTICE OF PROOF OF COMPLETION OF WORKS

and APPLICATION OF WATER TO BENE- FICIAL USE

Notice is hereby given that on the 16th day of January, 1967, at Boise, County of Ada, State of Idaho, before Gale C. Farley, Notary Public, at 1220 Idaho St., Boise, Idaho, proof will be submitted of the completion of works for the diversion of 2.676 cubic feet per second of underground water from a well, and of the application to beneficial use of said water, in accordance with the terms and conditions of Permit No. G-33213, heretofore issued by the Department of Reclamation of the State of Idaho.

1. The name and postoffice address of the person or corporation holding said permit is Idaho Power Company, Box 770, Boise, Idaho.

2. Said works of diversion will be fully completed on the date for such completion, and the amount of water which said works are capable of conveying to the place of use is 2.676 cubic feet per second.

3. The use to which said water has been applied is cooling of electrical equipment, fire protection, sprinkling, purposes and the amount applied to beneficial use is 2.676 cubic feet per second.

4. The point of diversion of said water is Well No. 4—NE $\frac{1}{4}$ NE $\frac{1}{4}$ Section 36, T3N, R2E, BM. Well No. 5—NW $\frac{1}{4}$ NE $\frac{1}{4}$ Section 36, T3N, R2E, BM.

5. The place where said water is used is NE $\frac{1}{4}$ NE $\frac{1}{4}$ Section 36, T3N, R2E, BM.

6. The date of priority which said user is prepared to establish is September 22, 1966.

R. KEITH HIGGINSON
State Reclamation Engineer.
Dec. 22, 29, 1966; Jan. 5, 12, 1967

33213

December 15, 1966

R. Keith Higginson
State Reclamation Engineer
Department of Reclamation
107 State House
Boise, Idaho 83702

RECEIVED
DEC 16 1966
Department of Reclamation

Re: Permit No. G-33213

First time published

NOTICE OF PROOF OF COMPLETION OF WORKS and APPLICATION OF WATER TO BENE- FICIAL USE

Notice is hereby given that on the 16th day of January, 1967, at Boise, County of Ada, State of Idaho, before Gale C. Farley, Notary Public, at 1220 Idaho St., Boise, Idaho, proof will be submitted of the completion of works for the diversion of 2.676 cubic feet per second of underground water from a well, and of the application to beneficial use of said water, in accordance with the terms and conditions of Permit No. G-33213, heretofore issued by the Department of Reclamation of the State of Idaho.

1. The name and postoffice address of the person or corporation holding said permit is Idaho Power Company, Box 770, Boise, Idaho.

2. Said works of diversion will be fully completed on the date for such completion, and the amount of water which said works are capable of conveying to the place of use is 2.676 cubic feet per second.

3. The use to which said water has been applied is cooling of electrical equipment, fire protection, sprinkling, purposes and the amount applied to beneficial use is 2.676 cubic feet per second.

4. The point of diversion of said water is Well No. 4 - NE 1/4 NE 1/4 Section 36, T3N, R2E, BM. Well No. 5 - NE 1/4 NE 1/4 Section 36, T3N, R2E, BM. NW 1/4

5. The place where said water is used is NE 1/4 NE 1/4, Section 36, T3N, R2E, BM.

6. The date of priority which said user is prepared to establish is September 22, 1966.

R. KEITH HIGGINSON
State Reclamation Engineer.
Dec. 15, 22, 29, 1966; Jan. 5, 1967.

WATER LICENSE

Water License No. G-33213 Priority September 22, 1966 Amount 2.676 c.f.s.

THIS IS TO CERTIFY, that IDAHO POWER COMPANY
of Boise, Idaho, made application for a permit to appropriate the public waters of
the State of Idaho, dated September 22, 1966; that Permit G-33213 was issued pursuant
to said application; that the proposed works were completed on or about May 1966,
with a storage or carrying capacity of 2.676 c.f.s., said works consisting of 2 wells,
pump, motor and storage pond; and that on January 16, 1967,
proof was made to the satisfaction of the State Reclamation Engineer, of the beneficial use of 1182
acre feet per season, with a maximum rate of diversion of 2.676 cubic feet per second of the waters
of two underground sources (2 wells), tributary of
for the purpose of cooling of electrical / equipment from January 1 to December 31;
and for domestic from January 1 to December 31; and for
from to; and that the use
of said waters has been made in accordance with the laws of Idaho, and is hereby confirmed by the State Recla-
mation Engineer and entered in the records of the Idaho Department of Reclamation: the point of diversion is
located in NE 1/4 NE 1/4, Sec. 36, T. 3 N., R. 2 E., B.M., and
other additional points NW 1/4 NE 1/4, Sec. 36, T. 3 N., R. 2 E., B.M., in the County of
Ada; and that the amount of water to which such right is
entitled and which is hereby confirmed, for the purposes aforesaid, is limited to an amount actually beneficially
used for said purposes and shall not exceed 1182 acre feet per year.

Description and location of place of use:

TWP.	RANGE	SEC.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				TOTALS
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
3 N	2 E	36	X	X															domestic use and
																			cooling of electrical equipment

Total number of acres irrigated

The right to the use of the water hereby confirmed is restricted to the lands or place of use herein described,
as provided by the laws of Idaho.

Witness the seal and signature of the State Reclamation Engineer, affixed at Boise, Idaho, this,

6th day of November, 1968

State Reclamation Engineer

63 3544

33213

(Form No. 3)

Address all communications to:

P. O.

APPLICATION FOR PERMIT

TO APPROPRIATE THE SUBTERRANEAN WATERS OF THE STATE OF IDAHO

Application No. G

Permit No. G

District No.

RECEIVED
SEP 22 1966
3:00 P.M.
Department of Reclamation

1. Name of applicant: IDAHO POWER COMPANY

Post office address Boise County Ada State Idaho

2. Quantity of water claimed: 2.676

(a) Rate of withdrawal in cubic feet per second 2.676 or Idaho Miner's
inches _____ or gallons per minute 600 on each of 2 wells

(b) Annual withdrawal in acre feet per annum 1878

3. Source of water supply: 2 wells

4. Location of point of diversion or well is in the #5-NW NE 4 of the NE 4 of Section 36,
Twp. 3N, Rge. 2E, B. M., County of Ada

5. Water is to be used for: Cooling of electrical equipment, fire protection, domestic

6. If for municipal, industrial or recreational purposes give:

(a) Point of use of water is in the NE 4 of the NE 4 of Section 36,
Twp. 3N, Rge. 2E, B. M.

(b) Waste water or sewage effluent is to be returned to Well No 5 or Well No 4

at a point in the NW 4 of the NE 4 of Section 36, Twp. 3N, Rge. 2E, B. M.
Well No 4 - 24" hole, drilled and cased. Hole is 395.5 feet deep.

7. Kind of Works: Well No 5 - 24" hole, drilled and cased. Hole is 670 feet deep.

8. Estimated cost of works: \$90,000.00

9. (a) Is reservoir to be used? No

(b) Capacity of reservoir: _____

10. The time required for the completion of such work and complete application of the water to the proposed use is
one years.

OK.

33213

18

I. (a) Date and place of incorporation: May 6, 1915 - Maine
authorized
 (b) Amount of capital stock \$ 120,000,000. (c) Amount paid in: \$ 103,176,051.

II. The financial resources of the applicant are: (a) Cash on hand: \$ _____
 (b) Treasury stock: see balance sheet attached (c) Bonds to be issued: _____
 (d) Other resources: _____

(Give irrigable acreage in each 40-acre subdivision)

[illegible]

(a) _____ (cubic feet per second, inches or gallons per minute) of the water herein applied for is to be supplemental to the existing water rights.

(b) _____ (cubic feet per second, inches or gallons per minute) is for new lands.

33213

Remarks: Water will be pumped from Well No 4 or 5, piped through electrical equipment for cooling purposes, and then discharged into Well No 5 or 4. Also, water from Wells No 4 and 5 will be used for fire protection and domestic purposes if necessary.

BE IT KNOWN That the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

IDAHO POWER COMPANY

Applicant

By *W. L. Moore*

VICE PRESIDENT

33213

DM

Approval of State Reclamation Engineer

33213

The number of this permit is G-----

Recorded in Book 116 Page 33213 Approved SEP 20 1966

This is to certify that I have examined the within application for a permit to appropriate the public waters of the State of Idaho, and hereby approve the same, subject to the following limitations and conditions:

Bond in the sum of \$----- to be filed before-----

Work to begin on or before November 30, 1966, and to continue diligently and uninterruptedly to completion, unless temporarily interrupted by circumstances over which the permit holder has no control.

One-fifth of the work above specified to be completed on or before March 30, 1967

The whole of said work to be completed and beneficial use of water appropriated in accordance herewith, to be made on or before September 30, 1967

Witness my hand this 30th day of September 30, 1966

R. Keith Higgins
State Reclamation Engineer

IN TESTIMONY WHEREOF, We ROBERT E. SMYLLIE, Governor of the State of Idaho,

and LOUIS E. CLAPP, Secretary of State of the State of Idaho, have caused this instrument to be executed in the name of the State of Idaho, and caused the Great Seal of the State of Idaho to be hereunto

affixed, this 30th day of September 30, 1966.

Countersigned:

By *Louis E. Clapp*
Secretary of State

STATE OF IDAHO

By *Robert E. Smyllie*
Governor.

No. G. 33213

PERMIT

Date of first receipt at office of State Reclamation Engineer

September 22, 1966 3:00 P.M.

Returned to applicant for correction

Corrected application received

Fees, \$ 5.50

FILING FEES FOR USE PERMIT:

For the first Sec. Ft. \$5.00

For each additional Sec. Ft. or Fraction

Thereof .25

33213

NAME OF APPLICANT IDAHO POWER COMPANY

Form No. 0

ADA COUNTY, IDAHO


T 3 N-R. 2 E., B.M. IDA.

WELL N° 5



WELL N° 4

36

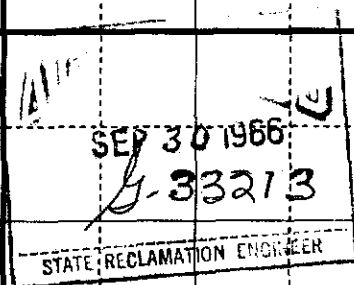

✓ 33213
K.P.
03-
3544

APPLICATION FOR PERMIT

To Appropriate the Subterranean Waters of The State of Idaho

Application No. G- 41427
Permit No. G- 33213
District No.

1. Name of Applicant: Idaho Power Company
Postoffice address: Boise County: Ada State: Idaho
2. Quantity of water claimed:
 - (a) Rate of withdrawal in cubic feet per second 2.676 or Idaho
Miners' inches 600 on each of two wells or gallons per minute
 - (b) Annual withdrawal in acre feet per annum 1878
3. Source of water supply: 2 wells
#5-NW $\frac{1}{4}$ of the NE $\frac{1}{4}$ of Section 36
4. Location of point of diversion or well is in the #4-NE $\frac{1}{4}$ of the NE $\frac{1}{4}$ of Section 36
Twp. 3 N , Rge. 2 E , B.M., County of Ada
5. Water is to be used for: cooling of electrical equipment, fire protection, domestic
6. If for municipal, industrial or recreational purposes, give:
 - (a) Point of use of water is in the NE $\frac{1}{4}$ of the NE $\frac{1}{4}$ of Section 36 , Twp. 3 N
Rge. 2 E , B.M.
 - (b) Waste water or sewage effluent is to be returned to well No 5 or Well No. 4
at a point in the NW $\frac{1}{4}$ of the NE $\frac{1}{4}$ of Section 36 , Twp. 3 N , Rge. 2 E , B.M.
Well No. 4 - 24" hole, drilled and cased. Hole is 395.5 feet deep.
7. Kind of works: Well No. 5 - 24" hole, drilled and cased. Hole is 670 feet deep.
8. Estimated cost of works: \$ 90,000.00
9. (a) Is reservoir to be used? no
(b) Capacity of reservoir:
10. The time required for the completion of such work and complete application of the water to the proposed use is
years. 1
11. If applicant is a corporation, give:
 - I. (a) Date and place of incorporation: May 6, 1915 - Maine
(b) Amount of ^{authorized} capital stock: \$ 120,000,000.00 (c) Amount paid in: \$ 103,176,051.00
(d) Names and addresses of directors: R. F. Ball, Boise, P. G. Batt, Caldwell, L. W. Brainard, Pocatello,
John H. Breckenridge, T. Falls, Albert Carlsen, Blackfoot, J. F. Emery, Boise, R. V. Hansberger, Boise, etc.
 - II. The financial resources of the applicant are (a) Cash onhand: \$ (see permit)
(b) Treasury stock: see balance sheet attached (c) Bonds to be issued:
(d) Other resources:
12. The land to be irrigated is described in the following tabulation:
13. Existing water rights and/or valid permits appurtenant to the lands to be irrigated are: none
 - (a) (cubic feet per second, inches or gallons per minute) of the water herein applied for is to be supplemental to the existing water rights.
 - (b) (cubic feet per second, inches or gallons per minute) is for new lands.

Twp.	Range	Sec.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				Totals
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
			See number 5. LICENSE ISSUED FOR <u>2.676</u> SEC. FT. LICENSE PAGE NO. <u>33213</u> -																

WATER RIGHT NUMBER 63-3544

OWNER LAST NAME - IDAHO POWER CO.

FIRST NAME - ORIG OWNER -

ADDRESS LINE 1 - P.O. BOX 70

ADDRESS LINE 2 -

ADDRESS LINE 3 -

CITY - BOISE

STATE - ID ZIP CODE - 83707

SOURCE - GROUNDWATER

TRIBUTARY OF -

STAGE - LICENSE

STATUS -

PRIORITY - 09-22-1966 COUNTY - ADA

TOTAL DIV. RATE - 2.6760 -CFS

TOTAL DIV. VOLUME - 1182.00 AFA TRFR/AMEND -

WATER DIST. -

DLE/CAREY ACT -

RIGHT BASIS -

DIVERSION POINT - NWNE 36 03N 02E LOT REDIV -

0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0

NENE 36 03N 02E LOT REDIV -

0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0 0.0

FROM - 01-01 TO - 12-31 USE - DOMESTIC

USE DIV. RATE - .0200 CFS USE DIV. VOLUME - .00 AFA

FROM - 01-01 TO - 12-31 USE - COOLING

USE DIV. RATE - 2.6560 CFS USE DIV. VOLUME - 1182.00 AFA

FROM - 01-01 TO - 12-31 USE - FIRE

PROTECTION USE DIV. RATE - 2.6560 CFS USE DIV. VOLUME - .00 AFA

USE - COOLING

PLACE OF USE - TWN 03N RNG 02E SEC 36 TRACT NENE LOT AC TRACT NWNE LOT AC
DATE - TOTAL ACRES 0

DECREE NAME -

REMARKS - FIRE PROTECTION LEFT OFF OF LIC. DUE TO OVERSIGHT ON FIELD EXAM.

NON IRRIG USE - L/ELECTRICAL EQUIP., D&F/BOISE BENCH SUBSTATION.

OTHER RIGHTS FOR SAME USE -

PROOF DUE - PERMIT/DENIED -

PROTESTED -

HEARING -

OLD NO. - 33213

PROOF MADE - FLD EXAM - COND. OF APPROVAL -

DIVERSION MEANS -

November 6, 1968

Re: Permit No. G-33213

Idaho Power Company
1220 Idaho Street
Boise, Idaho 83702

Gentlemen:

Enclosed herewith you will find your Water License
issued on the above numbered permit.

Very truly yours,

C. Stephen Allred, Assistant
State Reclamation Engineer

CSA:kh

Enclosure

33213

October 3, 1968

Re: Permit No. G-33213

Idaho Power Company
1220 Idaho Street
Boise, Idaho 83702

Gentlemen:

A representative of this department has made an examination of the works covered by your permit G-33213 and has found the following:

Quantity of water diverted: 2.676 c.f.s.

Amount of water that can be recognized as beneficially used under Idaho Law: 2.676 c.f.s.

Purpose of use: Cooling of Electrical equipment and domestic use in NW $\frac{1}{4}$ NE $\frac{1}{4}$, NE $\frac{1}{4}$ NE $\frac{1}{4}$, Sec. 36, T. 3 N., R. 2 E., B. M.

The priority date established is: September 22, 1966.

A fee totaling \$ 5.00 must be received within 30 days from the date of this letter in order that we can issue you the Certificate of Completion of Works and the License and Certificate of Water Right as described above.

Very truly yours,

C. STEPHEN ALLRED, Assistant
State Reclamation Engineer

CSA:ew

P: 1. Approved for permit G-33213 by 11/20/68 / KRP
11-20-68 KRP
33213

DON SAMUELSON
GOVERNOR



R. KEITH HIGGINSON
State Reclamation Engineer

STATE OF IDAHO

DEPARTMENT OF RECLAMATION
107 STATE HOUSE
BOISE, IDAHO 83701

October 3, 1968

Re: Permit No. G-33213

Idaho Power Company
1220 Idaho Street
Boise, Idaho 83702

Gentlemen:

A representative of this department has made an examination of the works covered by your permit G-33213 and has found the following:

Quantity of water diverted: 2.676 c.f.s.


Amount of water that can be recognized as beneficially used under Idaho Law: 2.676 c.f.s.

Purpose of use: Cooling of Electrical equipment and domestic use in NW $\frac{1}{4}$ NE $\frac{1}{4}$, NE $\frac{1}{4}$ NE $\frac{1}{4}$, Sec. 36, T. 3 N., R. 2 E., B. M.

The priority date established is: September 22, 1966.

A fee totaling \$ 5.00 must be received within 30 days from the date of this letter in order that we can issue you the Certificate of Completion of Works and the License and Certificate of Water Right as described above.

Very truly yours,

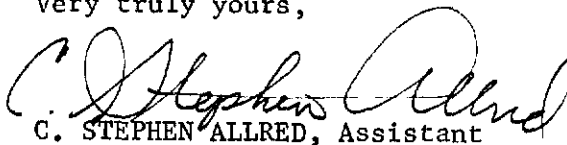
C. STEPHEN ALLRED, Assistant
State Reclamation Engineer

CSA:ew

33213

TELEPHONE MESSAGE

M. _____

a.m.

You were called at _____ p.m. Date _____

By _____

☐ Is Waiting On Line☐ Please Call _____ Ext. _____☐ Returned Your Call ☐ Will Call Again

Please Call _____

OPERATOR NO.

CITY

And Ask for M. _____

At Telephone No. _____ Ext. _____

Left this Message

(Over)

Use Your "Blue Book"

FOR FASTER LONG DISTANCE SERVICE-CALL BY AIRMAIL

May 13, 1968

Re: Permit No. G-33213

Idaho Power Company
Boise, Idaho

Gentlemen:

It appearing to the State Reclamation Engineer that the terms and conditions of Permit G-33213 to appropriate the public waters of the State of Idaho, have not been complied with as to failure to submit license fees of \$5.00

you are hereby notified that under the provisions of Section 42-311, Idaho Code, as amended, said permit is hereby held for cancellation, and you are required to show cause before the State Reclamation Engineer on or before June 24, 1968, why said permit should not be cancelled.

Permit G-33213 claims the use of 0.87 c.f.s. of water. The point of diversion was to be located NW~~1~~NE~~4~~, NE~~1~~NE~~4~~, Sec. 36, T. 3 N, R. 2 E, B.M., Ada County,

and the permit was approved September 30, 1966.

State Reclamation Engineer

Enc: Copy of fee letter

33213

March 11, 1968

Re: Permit No. G-33213

Idaho Power Company
Boise,
Idaho

Gentlemen:

A representative of this department has made an examination of the works covered by your permit G-33213 and has found the following:

Quantity of water diverted: .87 c.f.s.
Amount of water that can be recognized as beneficially used
under Idaho Law: .87 c.f.s.
Purpose of use: .85 c.f.s. for cooling
of electrical equipment and fire protection and .02
c.f.s. for domestic use in the NE 1/4, sec. 36, T.
3 N. R. 2 E, B.M.

The priority date established is: September 22, 1966


A fee totaling \$ 5.00 must be received within 30 days from the date of this letter in order that we can issue you the Certificate of Completion of Works and the License and Certificate of Water Right as described above.

Very truly yours,

Donald W. McEldowney
Appropriation Examiner

DWM:ks

3 3213

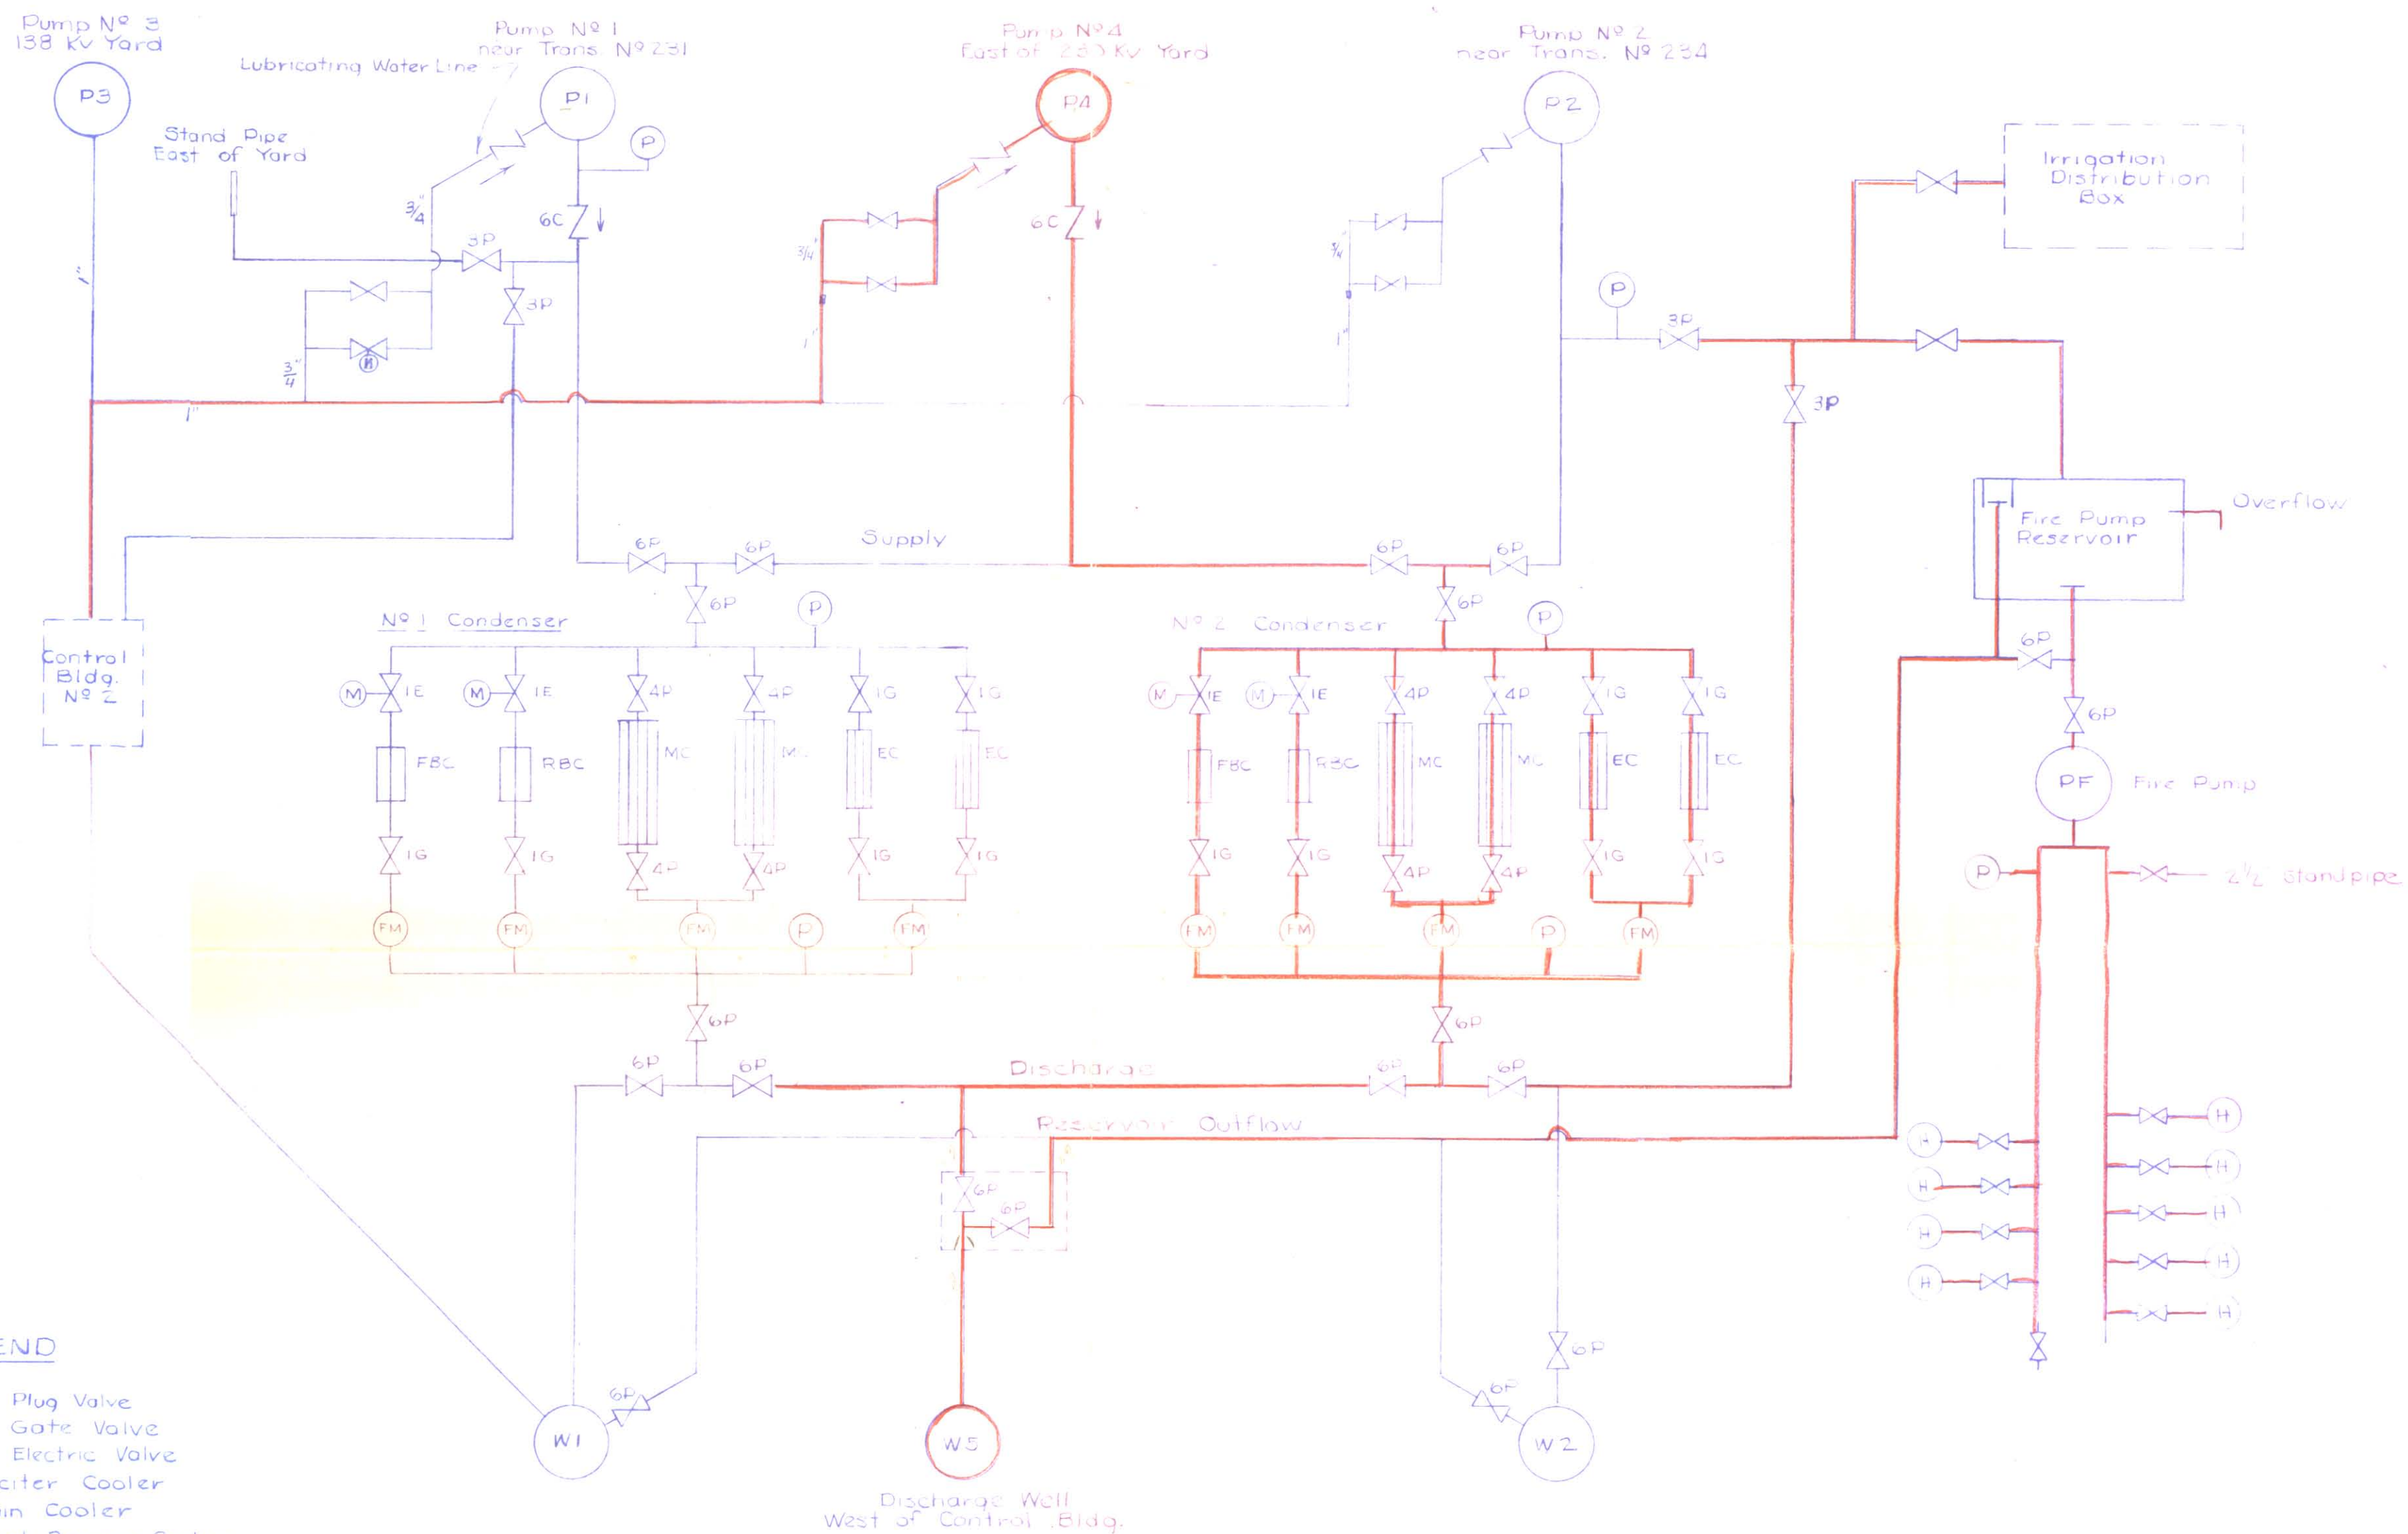

LEGEND

- 6P 6" Plug Valve
- IG 1" Gate Valve
- IE 1" Electric Valve
- EC Exciter Cooler
- MC Main Cooler
- FBC Front Bearing Cooler
- RBC Rear Bearing Cooler
- Valve
- Check Valve
- Flow Meter
- Pressure Gage
- Motor Operated Valve
- Solenoid Operated Valve
- Fire Hydrant

SCANNED
 JAN 25 2012

FEB 26 1968

32213

BOISE BENCH SUBSTATION WATER PIPING SCHEMATIC			
IDAHO POWER COMPANY		BOISE, IDAHO	
SCALE: SCHEMATIC		DATE: 8-10-68	
DR. GUN	APPROVED	21 C-33075	
TR.	SHT. 1 of 1		
REV.	CH. 108	727	727

Remeasurement

10/16/60 POWER

26 EN

ADA

WHEELS 1, 2 & 4

Main Coiler 625 gpm

Rear Bearings 9 1/2

Front 9

Exciter coiler 23

#1 UNIT COILER

MAIN COILER 615

Rear 13 1/2

Front 12

Exciter 19

659 1/2

1326 gpm

Mr. Franklin

Mr. Hamilton

26401

27211

33213

20099

33213

Form 23
2M-4-65

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
BOISE

REPORT OF EXAMINER

PERMIT NO. G-33213

REPORT ON PROOF OF Completion of Works & Beneficial Use

PD PD

3

$$1.62 \text{ c.f.s.} = 3.24 \text{ AF / DAY} \times 365 \text{ DAYS} = 1182 \text{ AF / YEAR}$$

~~ALLOW ~~2.8~~ c.f.s. FOR INDUSTRIAL (COOLING OF ELECTRICAL EQUIPMENT) & FIRE PROTECTION~~

ALLOW .02 FOR DOMESTIC

TOTAL $Q =$ ~~2.8~~ c.f.s. ALLOW 2.656 c.f.s FOR

COOLING OF ELECTRICAL EQUIPMENT + .02 FOR DOMESTIC . TOTAL = 2.676 c.f.s

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
BOISE, IDAHO
REPORT OF EXAMINER

Permit No. G-33213

This proof is for Comp: of Works & Beneficial Use In Water District No.

1. Name of applicant Idaho Power Company

2. Source of water supply: two wells

3. Location of point of diversion: Is in the NW $\frac{1}{4}$ NE $\frac{1}{4}$, NE $\frac{1}{4}$ NE $\frac{1}{4}$, of Section 36

T. 3. N. R. 2. E. County of Ada

4. Describe works as they exist, giving dimensions and capacities of same:

#5 WELL (NW NE) - DRAINAGE WELL (NOTE DIAGRAM - OPP.)
#4 WELL (NE NE) - 60 HP ELEC MOTOR # SK 6276 x C-1 B
PEERLESS VERT TURBINE # 2618962 - (NOTE DIAGRAM)
8" DISCHARGE - FOR COOLING OF 2 HYDROGEN WESTINGHOUSE
SYNCHRONOUS CONDENSERS - ALSO TO LARGE STORAGE POND - TO #5

5. Water is used for: cooling of electrical equipment, fire protection, domestic

6. State whether or not water has been turned into works of diversion: YES

7. List legal subdivisions of lands to be irrigated. If proof is for beneficial use, give exact number of acres under cultivation in each forty-acre tract. (Describe manner and place of use if other than irrigation):

Domestic NEW SEC 36 3 N 2 E

NOTE FIRE PUMP, CHRYSLER INDUSTRIAL #56511041
PEERLESS CENTRIFUGAL PUMP (# ?) 500 gpm
1770 RPM

(Submit map on attached plat, showing location and details of above description.)

8. What large stream would the water here appropriated finally reach?

Remarks:

MR. LUTHER EVANS (PE) PRESENT.

MR. GALE FARLEN PRESENT.


NOTE DIAGRAM (MARKED RED THIS PERMIT)

Q = MEASURED THROUGH 4 SEPARATE FLOW METERS.
TOTAL Q = .87 C.F.S.

This examination was made on the 26TH day of FEB, 1967

NOTE: REMEASURED IN 1968 WITH MR. FARLEN
(Signed) DR. MR. HAMILTON PRESENT


33213

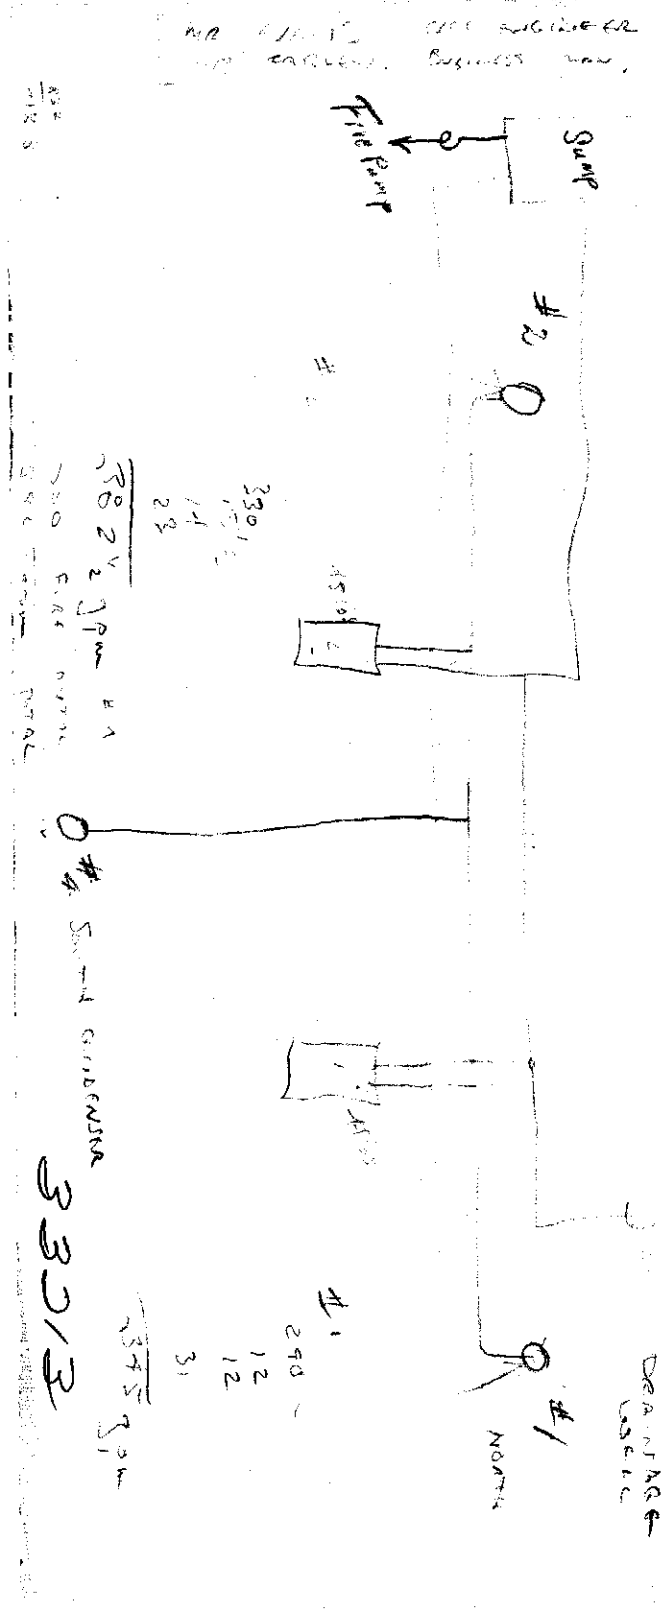

FIRE CONTROL
 PUMPS CENTRAL
 500 gpm 1250 2864 P
 200 562 11081
 CHRYSLER INDUSTRIAL
 1" OUTLET 150 lb PRESSURE

INSTRUCTIONS TO EXAMINERS

1. Always carefully note the location of the point of diversion and accurately plat same.
2. When proof is for beneficial use, carefully check up the number of acres actually irrigated in each forty and accurately plat same.
3. Make a map showing the correct location of streams and ditches, and the irrigated lands, and any adjacent permanent landmarks, such as towns, lakes, large streams and public roads.
4. If any unusual conditions are discovered, make plain statement of them under remarks.
5. Always see the holder, if possible, and go over the whole ground with him and make your report only upon actual existing facts and conditions.
6. Give general characteristics of soils, topography, and crops raised.

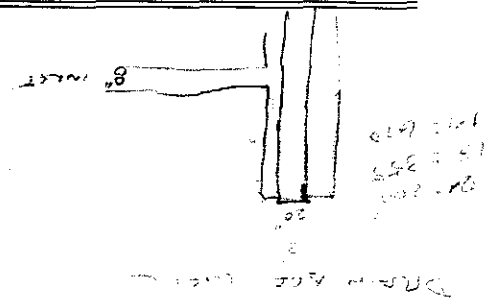

Idaho Power Company well, electric pump,
 Boise, Idaho 6" transite H₂O pipe
 M. Gale Farley 24" 395'
 Permit No. G-33213 H-303'
 Q-1.069 cfs

Examination for Completion of Works & Beneficial Use

County Ada Sec. 36 T. 3N R. 2 E

Quantity: 2.676

63-

Source: 2 wells

P.D.: NW¹/₄ NE¹/₄, Sec. 36, NE¹/₄ NE¹/₄, Sec. 36, Twp. 3 N, Rge. 2 E., B.M.
 #5 #1

Use: cooling of electrical equipment, fire protection, domestic

Extension:

Protest:

Completion of Works:

Other Rights: none

Filed: September 22, 1966, 3:00 P.M.

Due: September 30, 1967

Made: January 16, 1967

Priority: Sept. 22, 1966

3443511

#1 EAST SIDE
 60 HP FICK #546276X4C
 # EAT 506163
 DECKETS
 VERT TURBINE # 2618762

WATER LAKE 205
 WILSON HOUSE
 SHILOH
 HYDRO PUMPS

Ada

February 1, 1967

Re: Permit No. G-33213

Idaho Power Company
1220 Idaho Street
Boise, Idaho 83706

Gentlemen:

We acknowledge receipt of the depositions of holder and two witnesses, also affidavit of publication in the Meridian News-Times, all submitted in proof of completion of works and beneficial use on Permit No. G-33213.

Before final action is taken in the matter, the law requires that a field examination be made by an engineer from this department.

We cannot tell just when this examination will be made, but our field engineer will try to contact you at the time he makes the examination so that arrangements may be made to show him over the grounds.

Very truly yours,

M. Russell Bosch
Office Manager

MRB:nw

33213

RECEIVED
JAN 20 1967
Department of Reclamation

PROOF OF PUBLICATION

State of Idaho, }
County of Ada } ss.

I, E. Carol Smith, being first duly sworn, depose and say, that I am over twenty-one years of age, and Chief Clerk of MERIDIAN NEWS-TIMES, a weekly newspaper of general circulation, published at Meridian, County of Ada, State of Idaho, and that the annexed notice was published in said paper once each week for 4 consecutive weeks, the first publication being on the 22nd day of December, 1966, and the last publication being on the 12th day of January, 1967.

That said notice was published in the newspaper proper and not in a supplement. That said newspaper had been continuously and uninterruptedly published in said county for a period of 78 consecutive weeks prior to the first publication of this notice, and is a newspaper within the meaning of the Idaho statutes.

E. Carol Smith
Chief Clerk

Subscribed and sworn to before me this 12th day of January, 1967.

R. J. Maister
Notary Public in and for Idaho

Residence or Postoffice Address Boise, Idaho.

PROOF OF COMPLETION APPLICATION OF WATER TO BENEFICIAL USE

Notice is hereby given that on the 16th day of January, 1967, at Boise, County of Ada, State of Idaho, before Gale C. Farley, Notary Public, at 1220 Idaho St., Boise, Idaho, proof will be submitted of the completion of works for the diversion of 2.676 cubic feet per second of underground water from a well, and of the application to beneficial use of said water, in accordance with the terms and conditions of Permit No. G-33213, heretofore issued by the Department of Reclamation of the State of Idaho.

1. The name and postoffice address of the person or corporation holding said permit is Idaho Power Company, Box 770, Boise, Idaho.

2. Said works of diversion will be fully completed on the date for such completion, and the amount of water which said works are capable of conveying to the place of use is 2.676 cubic feet per second.

3. The use to which said water has been applied is cooling of electrical equipment, fire protection, sprinkling purposes and the amount applied to beneficial use is 2.676 cubic feet per second.

4. The point of diversion of said water is Well No. 4—NE $\frac{1}{4}$ NE $\frac{1}{4}$ Section 36, T3N, R2E, BM. Well No. 5—NW $\frac{1}{4}$ NE $\frac{1}{4}$ Section 36, T3N, R2E, BM.

5. The place where said water is used is NE $\frac{1}{4}$ NE $\frac{1}{4}$, Section 36, T3N, R2E, BM.

6. The date of priority which said user is prepared to establish is September 22, 1966.

R. KEITH HIGGINSON

Notary Public in and for Idaho
Dec. 22, 1966, Boise, Idaho

33213 Sept 67

STATE OF IDAHO
DEPARTMENT OF RECLAMATION

Boise, Idaho

Permit No. G-33213

RECEIVED
JAN 16 1967
Department of Reclamation

PROOF OF APPLICATION OF WATER TO BENEFICIAL USE

and Description of Works

DEPOSITION OF HOLDER

Ques. 1. State your name, residence occupation and postoffice address: Idaho Power
Company, 1220 Idaho Street, Boise, Idaho. Occupation-Generation & sale of electric power.

Ques. 2. If acting in behalf of corporation, state its name, principal place of business
(if foreign corporation, give name of postoffice of statutory agent), your
position with reference to same, and your authority for appearing in its behalf:

Idaho Power Company, 1220 Idaho Street, Boise, Idaho. J. F. Emery, Vice President
James E. Bruce, Secretary

Ques. 3. State number, approval date of permit, and date of priority: Permit No. G-33213,
approved September 30, 1966. Date of priority - September 22, 1966.

Ques. 4. State source of water supply: one well
Give location of point of diversion, showing subdivision, section, township and range

Well #4 - NE $\frac{1}{4}$ NE $\frac{1}{4}$, Section 36, T3N, R2E, BM

Ques. 5. Describe your works of diversion: One well with electric pump and
6" transite water pipe; state amount of water they are capable of con-
veying from point of diversion to place of use: 1,337 cfs; Give name of canal or ditch
or other works by which water is conducted to such place of use: Not applicable
; if a well, state depth of well #4-395.5'; depth and size of
casing #4-371.5', 24" perforated; depth to water #4-303.5'; if pump is used,
state discharge of pump: 1,069 cfs; tell how it was measured or determined measured
by H R McDonald carpenter's square method; if sprinkler irrigation, give number and size
of nozzles and operating pressure: Not applicable

Ques. 6. State for what purpose water is used: Cooling of electrical equipment, fire
protection, domestic
(If for irrigation, name each subdivision in which used and number of acres in
each subdivision that have actually been irrigated with said water:

Not applicable

33213

State nature of all improvements which have been made as a direct result of said use:

None

Ques. 6-a: If this is a ground water permit, give name and address of person that drilled the well: Kenneth Witt, Caldwell, Idaho

Ques. 7. If for other than irrigation purposes, show full legal description of place of use and state purpose for which water is used:

Water is used for cooling of electrical equipment, fire protection, domestic purposes. Within NE $\frac{1}{4}$ NE $\frac{1}{4}$, Section 36, T3N, R2E, BM

Ques. 8: If you are not the person or representative of the corporation to whom above mentioned permit was originally issued, please state how ownership was acquired by present holder:

Not applicable.

Quest. 9: State when and in what amount the water diverted under above mentioned permit has been first used: May, 1966; 1.069 cfs - Time used since first use:

8 months

Ques. 10. Describe all other water rights appurtenant to same place of use: _____

G-27211, 1.4 cfs; 20099, 0.11 cfs; G-28703, 0.51 cfs

(sign) _____

J. F. Emery, Vice President

I hereby certify that the foregoing testimony was read to the above subscribed, before its signing, that I believe him to be the person he represents himself to be, and that said testimony was subscribed and sworn to before me, at my office in

Boise, County of Ada

State of Idaho, on this 16th day of January, A. D. 19 67.

My commission expires: May 15, 1970

33213

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
BOISE, IDAHORECORDED
JAN 18 1967

Department of Reclamation

PERMIT NO. G-33213**Proof of Application of Water to Beneficial Use**
Deposition of Witness

The deposition of two witnesses, on this form, taken separately, required in each case.

Ques. 1. State your name, age, residence, occupation and postoffice address.

Ans. Burns Swain Hansen, 1524 Idaho St, Boise, Idaho, age 49Electrical EngineerQues. 2. Are you acquainted with Idaho Power Company, the holder of Permit No. G-33213? How long have you known him and where does he reside?Ans. 15 years. 1220 Idaho Street, Boise, IdahoQues. 3. Have you read or heard read said Permit No. G-33213, and are you familiar with its provisions and conditions?Ans. Yes

Ques. 4. State source of water supply, place of diversion, and describe works for conveying water from point of diversion to place of use.

Ans. One well. Place of diversion: #4 - NE $\frac{1}{4}$ NE $\frac{1}{4}$, Section 36, T3N, R2E, BM.Water is carried by 6" Transite water pipe.

Ques. 5. How many second feet of water do you estimate said works will safely conduct to place of use, and how much water have you seen being so conveyed?

Ans. Estimate 1.5 cfs; Witnessed 1.069 cfs

Ques. 6. State for what purpose water is used and at what place. (If for irrigation, give each subdivision in which water has been used and number of acres irrigated in each subdivision.) State whether cultivated or natural meadow land and the nature of all improvements which have been made as a direct result of said use.

Ans. Water used for domestic purposes, cooling of electrical equipment & fire protection at Boise Bench Substation located within NE $\frac{1}{4}$ NE $\frac{1}{4}$, Section 36,T3N, R2E, BM, Ada County, Idaho.

33213

Ques. 7. If for power or other purposes than irrigation, state how water has been applied and to what extent.

Ans. Water used for domestic purposes, cooling of electrical equipment and
fire protection at Boise Bench Substation located within NE $\frac{1}{4}$ NE $\frac{1}{4}$,
Section 36, T3N, R2E, BM, Ada County, Idaho

Ques. 8. If for irrigation, state character of land that has been reclaimed, and give your estimate of the amount of water required for its profitable cultivation.


Ans. Well has been completed, pump and pipe line installed and water is being
used for cooling of electrical equipment.

Ques. 9. Have you any interest in the works, water or lands above mentioned? If so, in what way and to what extent?

Ans. No


Ques. 10. State when, how, in what amount and to what extent you have witnessed the application to beneficial use of water diverted under said permit.

Ans. On December 29, 1966, I witnessed 1.069 cfs being used for cooling of
Condenser #2 at Boise Bench Substation.

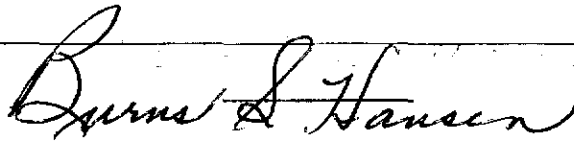

(Signed)

I hereby certify that the foregoing testimony was read to the above subscriber before its signing, that I believe him to be the person he represents himself to be, and that said testimony was subscribed and sworn to before me in Boise,
County of Ada, State of Idaho, on this 16th day of January,
A. D. 19 67.



Notary Public.

My commission expires May 15, 1970

33213

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
BOISE, IDAHO

RECEIVED
JAN 16 1967

Department of Reclamation

PERMIT NO. G-33213

Proof of Application of Water to Beneficial Use
Deposition of Witness

The deposition of two witnesses, on this form, taken separately, required in each case.

Ques. 1. State your name, age, residence, occupation and postoffice address.

Ans. William H. Tuller, Jr., 8511 Vincent St., Boise, Idaho, age 41

Civil Engineer

Ques. 2. Are you acquainted with Idaho Power Company, the holder of Permit No. G-33213? How long have you known him and where does he reside?

Ans. 35 years. 1220 Idaho Street, Boise, Idaho

Ques. 3. Have you read or heard read said Permit No. G-33213, and are you familiar with its provisions and conditions?

Ans. Yes

Ques. 4. State source of water supply, place of diversion, and describe works for conveying water from point of diversion to place of use.

Ans. One well. Place of diversion: #4 - NE $\frac{1}{4}$ NE $\frac{1}{4}$, Section 36, T3N, R2E, BM.

Water is carried by 6" Transite water pipe.

Ques. 5. How many second feet of water do you estimate said works will safely conduct to place of use, and how much water have you seen being so conveyed?

Ans. Estimate 1.5 cfs; Witnessed 1.069 cfs

Ques. 6. State for what purpose water is used and at what place. (If for irrigation, give each subdivision in which water has been used and number of acres irrigated in each subdivision.) State whether cultivated or natural meadow land and the nature of all improvements which have been made as a direct result of said use.

Ans. Water used for domestic purposes, cooling of electrical equipment & fire protection at Boise Bench Substation located within NE $\frac{1}{4}$ NE $\frac{1}{4}$, Section 36, T3N, R2E, BM, Ada County, Idaho.

33213

Ques. 7. If for power or other purposes than irrigation, state how water has been applied and to what extent.

Ans. Well has been completed, pump and pipe line installed and water is being used for cooling of electrical equipment.

Ques. 8. If for irrigation, state character of land that has been reclaimed, and give your estimate of the amount of water required for its profitable cultivation.

Ans. Not applicable.

Ques. 9. Have you any interest in the works, water or lands above mentioned? If so, in what way and to what extent?

Ans. No.

Ques. 10. State when, how, in what amount and to what extent you have witnessed the application to beneficial use of water diverted under said permit.

Ans. On January 3, 1967, I witnessed 1.069 cfs being used for cooling of Condenser #2 at Boise Bench Substation.

William H Tuller Jr.

(Signed)

I hereby certify that the foregoing testimony was read to the above subscriber before its signing, that I believe him to be the person he represents himself to be, and that said testimony was subscribed and sworn to before me in Boise, County of Ada, State of Idaho, on this 16th day of January, A. D. 19 67.

John C. Farley

Notary Public.

My commission expires May 15, 1970.

33213

SNAKE RIVER



HYDRO POWER

IDAHO POWER COMPANY

BOX 770 • BOISE, IDAHO 83701
January 16, 1967

Mr R Keith Higginson, Engineer
State Department of Reclamation
107 State House
Boise, Idaho 83701

Re: Permit No G-33213

Dear Mr Higginson:

Enclosed are depositions of two witnesses and holder together with Affidavit of Publication in connection with the above-numbered permit.

Very truly yours,

Gale C Farley
Gale C Farley
Agent

bt

Encl

33213

MERIDIAN News-Times

Ralph W. Hunter, Jean L. Hunter, Publishers

Telephone 888-4423

Meridian, Idaho 83642

Post Office Box 365

December 22, 1966

Mr. R. Keith Higginson
State Reclamation Engineer
Department of Reclamation
107 State House
Boise, Idaho 83702

RECEIVED
DEC 23 1966

DEPARTMENT OF RECLAMATION

Re: Permit No. G-33213

**and
APPLICATION OF WATER TO BENE-
FICIAL USE**

Notice is hereby given that on the 16th day of January, 1967, at Boise, County of Ada, State of Idaho, before Gale C. Farley, Notary Public, at 1220 Idaho St., Boise, Idaho, proof will be submitted of the completion of works for the diversion of 2.676 cubic feet per second of underground water from a well, and of the application to beneficial use of said water, in accordance with the terms and conditions of Permit No. G-33213, heretofore issued by the Department of Reclamation of the State of Idaho.

1. The name and postoffice address of the person or corporation holding said permit is Idaho Power Company, Box 770, Boise, Idaho.

2. Said works of diversion will be fully completed on the date for such completion, and the amount of water which said works are capable of conveying to the place of use is 2.676 cubic feet per second.

3. The use to which said water has been applied is cooling of electrical equipment, fire protection, sprinkling, purposes and the amount applied to beneficial use is 2.676 cubic feet per second.

4. The point of diversion of said water is Well No. 4—NE $\frac{1}{4}$ NE $\frac{1}{4}$ Section 36, T3N, R2E, BM. Well No. 5—NW $\frac{1}{4}$ NE $\frac{1}{4}$ Section 36, T3N, R2E, BM.

5. The place where said water is used is NE $\frac{1}{4}$ NE $\frac{1}{4}$ Section 36, T3N, R2E, BM.

6. The date of priority which said user is prepared to establish is September 22, 1966.

R. KEITH HIGGINSON

State Reclamation Engineer

Dec. 22, 1966; Jan. 1, 1967

33213

XXXXXXXXXX

December 16, 1966

Re: Permit No. G-33213

Meridian News-Times
P.O. Box 365
Meridian, Idaho 83642

Gentlemen:

The Attorney General has ruled that all legal notices required by statutes relating to Proof of Completion of Works and/or Proof of Beneficial Use for licensing public waters of the State of Idaho to individuals or organizations must have the correct legal description for the points of diversion and lands to be irrigated.

Your paper under date of December 15, 1966 received in this office December 16, 1966, in legal notice in regard to proof to be made by Idaho Power Company on January 16, 1967, shows the point of diversion for well No. 5 - ~~NE1/4~~, Section 36, T. 3 N, R. 2 E, B.M. which must be corrected to No. 5 - NW1/4, Section 36, T. 3 N, R. 2 E, B.M. and published in four successive issues.

The date for making the proof will be January 16, 1967.

Very truly yours,

R. Keith Higginson
State Reclamation Engineer

RKH:nw

cc: Applicant
Notary Public

P.S. The cost of the extra publications will be at your expense.

33213

MERIDIAN News-Times

Ralph W. Hunter, Jean L. Hunter, Publishers

Telephone 888-4423

Meridian, Idaho 83642

Post Office Box 365

December 15, 1966

R. Keith Higginson
State Reclamation Engineer
Department of Reclamation
107 State House
Boise, Idaho 83702

RECEIVED
DEC 16 1966
Department of Reclamation

Re: Permit No. G-33213

NOTICE OF PROOF OF COMPLETION OF WORKS

APPLICATION OF WATER TO BENE- FICIAL USE

Notice is hereby given that on the 16th day of January, 1967, at Boise, County of Ada, State of Idaho, before Gate C. Farley, Notary Public, at 1220 Idaho St., Boise, Idaho, proof will be submitted of the completion of works for the diversion of 2.676 cubic feet per second of underground water from a well, and of the application to beneficial use of said water, in accordance with the terms and conditions of Permit No. G-33213, heretofore issued by the Department of Reclamation of the State of Idaho.

1. The name and postoffice address of the person or corporation holding said permit is Idaho Power Company, Box 770, Boise, Idaho.

2. Said works of diversion will be fully completed on the date for such completion, and the amount of water which said works are capable of conveying to the place of use is 2.676 cubic feet per second.

3. The use to which said water has been applied is pooling of electrical equipment, fire protection, sprinkling, purposes and the amount applied to beneficial use is 2.676 cubic feet per second.

4. The point of diversion of said water is Well No. 4, NE 1/4, NE 1/4, Section 36, T3N, R2E, BM, Well No. 5, NE 1/4, NE 1/4, Section 36, T3N, R2E, BM.

5. The place where said water is used is NRL/NE 1/4, Section 36, T3N, R2E, BM.

6. The date of priority which said user is prepared to establish is September 22, 1966.

33213

NOTICE TO ACCOMPANY THIS LETTER MUST BE MADE IN DUPLICATE

(Date) December 12, 1966

(P.O.) Boise, Idaho

TO THE STATE RECLAMATION ENGINEER

Boise, Idaho

Dear Sir:

You are hereby authorized to have the attached notice published at
my expense in the Meridian News Times of
Meridian, Idaho published in the county in which the
works are situated.

IDAHO POWER COMPANY

Gale C. Farley
Gale C. Farley, Agent

(In case of canals or other works designed to divert and carry more than 50
cubic feet of water per second, the following certificate must be signed by a well known
and competent engineer.)

I hereby certify that the facts set forth in the attached notice are true.

83213

NOTICE OF PROOF OF COMPLETION OF WORKS
and
APPLICATION OF WATER TO BENEFICIAL USE

Notice is hereby given that at ~~8:00 A.M.~~, on the 16th day of January
1967, at Boise, County of Ada, State of Idaho
before Gale C. Farley, Notary Public, at (address) 1220 Idaho St.
Boise, Idaho, proof will be submitted of the completion
of works for the diversion of 2.676 cubic feet per second of underground water from a
well, and of the application to beneficial use of said water, in accordance with the
terms and conditions of Permit No. G-33213, heretofore issued by the Department of
Reclamation of the State of Idaho.

1. The name and postoffice address of the person or corporation holding said permit
is Idaho Power Company, Box 770, Boise, Idaho.

2. Said works of diversion will be fully completed on the date for such completion,
and the amount of water which said works are capable of conveying to the place of
use is 2.676 cubic feet per second.

3. The use to which said water has been applied is cooling of electrical equipment,
fire protection, sprinkling, purposes and the amount applied to beneficial use is
2.676 cubic feet per second.

4. The point of diversion of said water is Well #4-NE1/4NE1/4 Section 36, T3N, R2E, BM
Well #5-NW1/4NE1/4 Section 36, T3N, R2E, BM.

5. The place where said water is used is NE1/4NE1/4, Section 36, T3N, R2E, BM.

6. The date of priority which said user is prepared to establish is _____

September 22, 1966, 3:00 P.M.

State Reclamation Engineer

33213

December 13, 1966

Re: Permit No. G-33213

Meridian News Times
Meridian, Idaho

Gentlemen:

Enclosed you will find a legal notice which we wish to have published for four consecutive weeks prior to January 16, 1967. The expense of the publication is to be paid by Gale C. Farley, Idaho Power Company of 1220 Idaho Street, Boise, Idaho, to whom you should furnish proof of publication on or prior to the above date.

Please acknowledge receipt of this notice and furnish this office with a copy or tear sheet of the notice for checking at least one week prior to the first publication.

Very truly yours,

R.Keith Higginson
State Reclamation Engineer

RKH:nw

33213

Re: Permit No. **G-33213**

December 13, 1966

Gale C. Farley
1220 Idaho Street
Boise, Idaho

Dear Mr. Farley;

This acknowledges the Notice of Proof of Completion of Works and Application of Water to Beneficial Use under Permit No. G-33213 in the name of Idaho Power Company. Final Proof is to be made before you, as Notary on the 16th day of January, 19 67, at Boise, Idaho.

As of this date, we have mailed the Notice to the Meridian News Times, with instructions to publish it once a week for four consecutive weeks prior to the date set for final proof and then mail the Affidavit of Publication and statement of costs to you.

It is important that the enclosed depositions be executed by the permit holder and two disinterested witnesses who are familiar with the terms of the permit and the work done thereunder, at the time, on the date and before you, as Notary, as stated in the publication notice. It is very important and necessary that each question be answered in detail.

In returning the depositions to this office, be sure that all copies have been signed, that your Notary's seal has been placed on each and that all depositions, (holder and two witnesses) are being returned. Also be sure to enclose the AFFIDAVIT OF PUBLICATION.

Very truly yours,

MRE:rw

M. Russell Bosch
Office Manager

Encl.

cc: Applicant

33213

SNAKE RIVER



HYDRO POWER

IDAHO POWER COMPANY

BOX 770 • BOISE, IDAHO 83701

December 12, 1966


Mr. R. Keith Higginson, Engineer
State Department of Reclamation
107 State House
Boise, Idaho 83701

Dear Mr. Higginson:

Enclosed are your Form 36, in duplicate, and Form 11
authorizing you to have the notice published in connection with our
Permit No. G-33213.

Please send us the necessary deposition forms for the holder
and two disinterested witnesses.

Very truly yours,

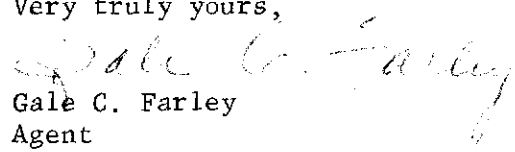
Gale C. Farley
Agent

bt

Encl

33213

October 10, 1966

Re: Permit No. G-33213

Idaho Power Company
Boise, Idaho

Gentlemen:

We enclose Permit No. G-33213 in which we direct your attention to the limitations and conditions as given on the fourth page under approval of the State Reclamation Engineer.

~~We also enclose~~ Departmental Receipt No. G-10877 which
XXXXXXXXXXXXXXXXXXXX was issued covering payment in the amount of \$ 5.50 the filing
fee of the above mentioned permit. , was given to you
at the time you were over to this office.

Very truly yours,

Enc.

M. RUSSELL BOSCH
Office Manager

MRB:ejw

permit

33213

33213

September 26, 1966

Gale C. Farley
Idaho Power Company
Box 770
Boise, Idaho

Dear Mr. Farley:

We wish to take this opportunity to thank you for the logs you recently sent us.

Since Mr. Witt has already filed the logs with us we thought you might like to have these for the permit file.

Very truly yours,

Jack A. Barnett
Assistant State Reclamation Engineer

JAB:mr

Enc. well logs 2

33213

1
SNAKE RIVER



HYDRO POWER

IDAHO POWER COMPANY

BOX 770 • BOISE, IDAHO 83701

September 23, 1966

RECEIVED
SEP 26 1966

Department of Reclamation

33213

Mr R Keith Higginson, Engineer
State Department of Reclamation
107 State House
Boise, Idaho, 83701

Dear Mr Higginson:

Enclosed are well driller's logs for our wells No 4 and 5
which I failed to include with our application filed in your office
September 22, 1966.

Very truly yours,

Gale C. Farley
Gale C Farley
Agent

bd
Encl

33213

33213

33213

IDAHO POWER COMPANY
BALANCE SHEET, JUNE 30, 1966
(Subject to Approval of Independent Auditors)

<u>Assets</u>	
ELECTRIC PLANT:	
In service (at original cost)	\$369,738,100
Less accumulated provision for property retirements (Note 1)	55,377,871
In service - Net	314,360,229
Construction work in progress	40,094,371
Electric plant - Net	354,454,600
OTHER PROPERTY AND INVESTMENTS	442,156
CURRENT ASSETS:	
Cash (including temporary investments)	5,555,529
Special deposits	451,463
Accounts receivable (less accumulated provision for uncollectible accounts, \$115,744)	5,040,187
Materials and supplies (at average cost)	2,180,965
Prepayments	498,559
Total current assets	13,726,703
DEFERRED DEBITS:	
Unamortized debt discount and expense	700,336
Extraordinary property loss (Note 2)	705,257
Preliminary survey and investigation charges	543,236
Unamortized cost of power purchased	295,772
Other	472,776
Total deferred debits	2,717,377
TOTAL	\$371,340,836

<u>Liabilities</u>	
PROPRIETARY CAPITAL:	
Common stock, \$5 par; authorized 12,000,000 shares; outstanding 6,600,000 shares	\$ 33,000,000
4% preferred stock, cumulative, \$100 par; authorized 600,000 shares; outstanding 215,000 shares	21,500,000
Premium on capital stock	48,676,051
Capital stock expense	(858,228)
Earned surplus	40,753,139
Total proprietary capital	143,070,962
LONG-TERM DEBT (Note 3)	189,259,000
CURRENT LIABILITIES:	
Notes payable	7,300,000
Accounts payable	3,570,223
Taxes accrued	4,673,608
Interest accrued (Cash in special deposits - \$450,000)	1,815,993
Other	1,494,673
Total current liabilities	18,854,497
DEFERRED CREDITS:	
Unamortized premium (less expense) on debt	206,273
Customer advances for construction	2,005,545
Other	1,981,090
Total deferred credits	4,192,908
OPERATING RESERVES	76,309
CONTRIBUTIONS IN AID OF CONSTRUCTION	600,151
ACCUMULATED DEFERRED INCOME TAXES	15,287,009
TOTAL	\$371,340,836

The accompanying Notes to Financial Statements are an integral part of this balance sheet.

() Denotes red figure.

33213

SNAKE RIVER



HYDRO POWER

IDAHO POWER COMPANY

BOX 770 • BOISE, IDAHO 83701

September 22, 1966

J. 33213

Mr R Keith Higginson, Engineer
State Department of Reclamation
107 State House
Boise, Idaho 83701

Dear Mr Higginson:

Enclosed is Application for Permit, your Form No 3,
which we wish to file for two wells located on our Boise Bench
Substation property near Boise, Idaho, together with my agent's
check for \$ 5.50 representing filing fees.

Should further information be required please let us
know.

Very truly yours,

Gale C. Farley
Gale C Farley
Agent

bd
Encls

33213

Y-33213

024

July 13, 1965

Idaho Power Company
1220 Idaho Street
Boise, Idaho

Gentlemen:

We have received logs on two wells drilled for you recently, one in the NE¹/₄ Sec. 36, T. 3 N., R. 2 E., B.M. for industrial cooling purposes, and one in the NW¹/₄ Sec. 36, T. 3 N., R. 2 E., B.M. for drainage. The test shows that the well in the NE¹/₄ Sec. 36 is capable of supplying 2,000 gallons per minute.

We note that your License No. G-27211 was issued for 1.4 c.f.s. from a well in the NE¹/₄ of said section. If you will be using more than the 1.4 c.f.s. from this well and the new one combined it will be necessary to file on the new well. Forms are enclosed.

Very truly yours,

Keith Higginson
Assistant State Reclamation Engineer

KH:mr

Enc. Form 3

C
O
P
Y

33213

INSTRUCTIONS TO DELIVERING EMPLOYEE

☐ Show to whom, date, and
address where delivered

☐ Deliver ONLY
to addressee

(Additional charges required for these services)

RECEIPT

Received the numbered article described below.

REGISTERED NO.

SIGNATURE OR NAME OF ADDRESSEE *(Must always be filled in)*

CERTIFIED NO.

20049

INSURED NO.

DATE DELIVERED

SHOW WHERE DELIVERED *(only if requested)*

POST OFFICE DEPARTMENT
OFFICIAL BUSINESS

FOR PRIVATE USE TO AVOID
PAYMENT OF POSTAGE

POSTMARK OF
DELIVERING OFFICE

MAY
14
1968

USPO

RETURN
TO

INSTRUCTIONS: Show name and address below and complete instructions on other side, where applicable. Moisten gummed ends, attach and hold firmly to back of article. Print on front of article RETURN RECEIPT REQUESTED.

NAME OF SENDER

Dept. of Reclamation

STREET AND NO. OR P.O. BOX

614 State St.

POST OFFICE, STATE, AND ZIP CODE

Boise Idaho 83706 33213

655-16-71548-10

POD Form 3811 Apr. 1967

$$J \quad \frac{2}{1728} = \frac{1}{864} \cdot \frac{1}{100}$$

9.33213
8.6

4/13/66

Luther Evans

Ext 208

Guy Leonard.

Returning to well logs
submitted by K. Witt.

Idaho Power Co.

344-2511 - ext 208

33213