


SW NE NW
No Bow lts



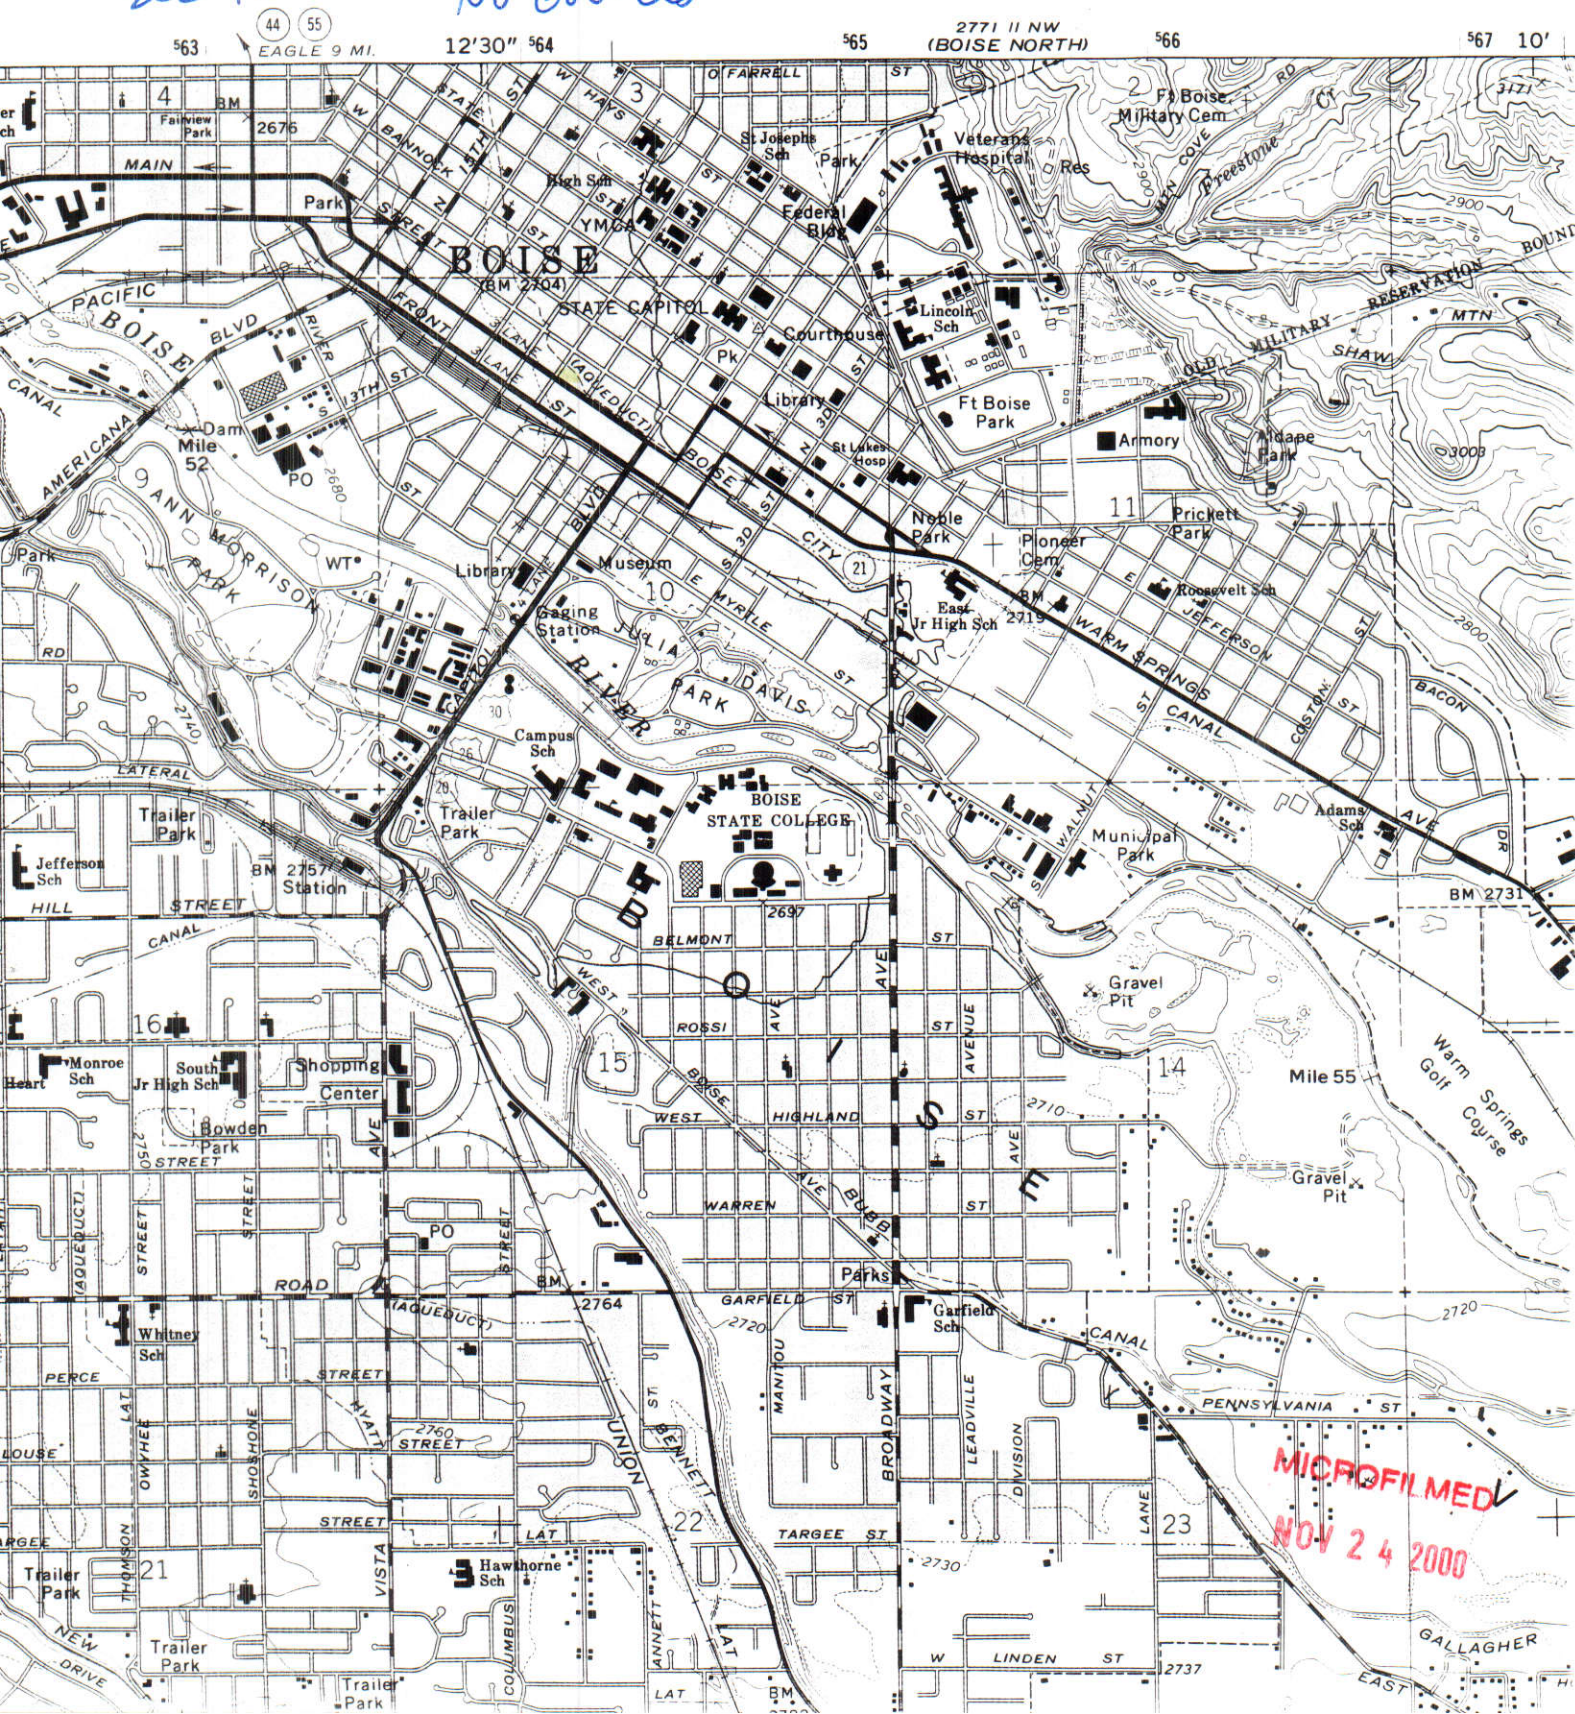

RECEIVED

NOV 20 2000

Department of Water Resources

NO SUCH NUMBER

TO

IDAHO DEPARTMENT OF WATER RESOURCES
1301 North Orchard St.
P.O. Box 83720
Boise, ID 83720-0000
(208) 327-7900

NOV 18

P63-12593
PARKLANE CO
1817 W FRANKLIN AVE ST
BOISE

ID 83702

11.20.00 Phoned for Correction - Deborah said she wanted fax correction to us to support verbal change given on the phone.

Lari Lyons

MICROFILMED

NOV 24 2000

FOR OFFICE USE ONLY
 Amt. of Fee \$: 50.00
 Receipt No. 051207
 Receipt By: 28
 Date Received: 10-22-01

STATE OF IDAHO
 DEPARTMENT OF WATER RESOURCES

RECEIVED

OCT 22 2001

PROOF OF BENEFICIAL USE

Department of Water Resources

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or be accompanied by a completed field examination report prepared by a certified water right examiner.

1. Permit No. 03-12593 Telephone No. (208) 345-3221

2. Name of Permit Holder(s): PARKLANE COMPANY

3. Mailing Address: 817 W. FRANKLIN STREET

City BOISE State ID Zip 83702

4. Source of Water: GROUNDWATER If GROUNDWATER (well), Date Drilled: mo. DEC / yr. 2000

Well Driller: ADAMSON'S PUMP & DRILLING Drilling Permit Number: D0001000

5. Use(s) (as authorized by the water right permit):

Domestic (No. of households): 53 Stockwater (No. and type of stock): _____

Irrigation (No. of acres): _____ Other: _____

6. Total rate of diversion and/or volume for which proof is submitted: .56 cfs OR _____ acre-feet

7. Measuring Device Requirement: (refer to the approval conditions on your permit and respond accordingly)

(This question is not optional. Please check either yes or no. Proofs returned not checked accordingly, will be considered incomplete)

Measuring Device: Is a measuring device required?

Yes _____ or No ☒

Has the measuring device been installed?

Yes _____ or No ☒

8. Fee Enclosed: \$ 50.00 (See Fee Schedule on back of the instructions for filing proof of beneficial use)

9. Person to contact to accompany the Department representative during field examination of the water system.

Name: JOE ANDERS Telephone Number: (208) 371-5009

Address: 817 W. FRANKLIN STREET, BOISE, ID 83702

10. The information given on this form is my true statement of the extent to which the above numbered permit has been developed and water has been diverted. I agree to relinquish any undeveloped portion of the permit to the State of Idaho.

Signature of permit holder: [Signature] Pres. Date: 10/18/01
 (include your title, if on behalf of company or organization)

MICROFILMED
 NOV 26 2001

State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 63-12593

Priority: July 28, 2000

Maximum Diversion Rate:

0.56 CFS

This is to certify, that **PARKLANE CO**

1817 W FRANKLIN AVE

BOISE ID 83702

has applied for a permit to appropriate water from: **GROUND WATER**

and a permit is **APPROVED** for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
HEATING	01/01 to 12/31	0.56 CFS
COOLING	01/01 to 12/31	0.56 CFS
	Totals	0.56 CFS

LOCATION OF POINT(S) OF DIVERSION:

SWNENW , Sec. 10, Township 03N, Range 02E
ADA County

PLACE OF USE: HEATING

TWN RGE SEC

03N 02E 10 NENW

PLACE OF USE: COOLING, same as HEATING use

CONDITIONS OF APPROVAL AND REMARKS

1. Proof of application of water to beneficial use shall be submitted on or before **November 1, 2001**.
2. Subject to all prior water rights.
3. Right holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
4. Return flow discharged to a subsurface system must be authorized by a separate injection well permit.
5. After specific notification by the department, the right holder shall install a suitable measuring device or shall enter into an agreement with the department to determine the amount of water diverted from power records and shall annually report the information to the department.
6. The point of diversion identified in this right is located within the boundaries of the Boise Front Low Temperature Geothermal Resource Groundwater Management Area. The well driller shall monitor water temperatures while drilling the well. If water with a temperature greater than 85 degrees Fahrenheit is encountered by the driller, drilling must immediately cease, and the Department must be notified. Drilling shall not resume until the Department has reviewed the drilling conditions, and established standards for construction with the driller.

MICROFILMED

NOV 24 2000

State of Idaho
Department of Water Resources

Permit To Appropriate Water


NO. 63-12593

CONDITIONS OF APPROVAL AND REMARKS

7. Use of water under this right shall be non-consumptive.
8. Water shall be diverted and reinjected through a closed loop system.
9. Water bearing zone to be appropriated is from 150 to 250 feet.
10. Heating and cooling uses are for a hotel.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the signature of the Director, affixed at Boise, this

14th day of November, 2000.

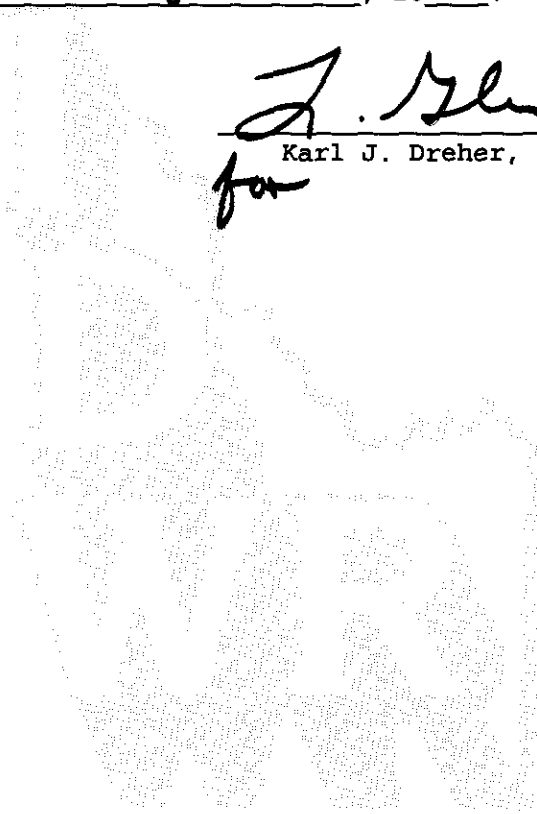
Karl J. Dreher
Karl J. Dreher, Director
for

MICROFILMED

NOV 24 2000

RECEIVED

OCT 23 2000

JUN 29 2000 Dent. No. 63-12593

FORM 202
12/99

Department of Water Resources

WATER RESOURCES WESTERN REGION

RECEIVED

RECEIVED
JUL 28 2000

ED **STATE OF IDAHO** **WATER RESOURCES**
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

**WATER RESOURCES
WESTERN REGION**

To appropriate the public waters of the State of Idaho

Department of Water Resources

1. Name of Applicant Parklane Company Phone (208) 345-3221
Mailing address 1817 West Franklin Ave. Boise, Idaho 83702
2. Source of water supply Ground Water which is a tributary of N/A
3. Location of point of diversion is Township 3N Range 2E Sec. 10 in the NW SW 1/4, ~~NW NE 1/4, NE NW 1/4~~, Govt. Lot _____, B.M., Ada County;
additional points of diversion if any: _____
4. Water will be used for the following purposes:
Amount 403.40 ^{56 cfs} for Heating/Cooling purposes from 1-1 to 12-31 (both dates inclusive)
~~(cfs or acre-feet per annum)~~
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
5. Total quantity to be appropriated is (a) 56 cubic feet per second and/or (b) 403.40 acre feet per annum
6. Proposed diverting works:
a. Describe type and size of devices used to divert water from the source Ground Water Well

b. Height of storage dam N/A feet; active reservoir capacity N/A acre-feet; total reservoir capacity N/A acre-feet
c. Proposed well diameter is 8 inches; proposed depth of well is 150-250 feet (Yield depending
d. Is ground water with a temperature of greater than 85°F being sought? No
e. If well is already drilled, when? N/A; Drilling firm N/A;
Well was drilled for (well owner) N/A; Drilling Permit No. N/A
7. Time required for completion of works and application of water to proposed beneficial use is 1 years (minimum 1 year)
8. Description of proposed uses (if irrigation only, go to item 9):
a. Hydropower; show total feet of head and proposed capacity in kW. N/A
b. Stockwatering; list number and kind of livestock. N/A
c. Municipal; show name of municipality. N/A
d. Domestic; show number of households. N/A
e. Other; describe fully. Closed loop heat pump cooling

~~JUN 22 2000~~

MICROFILMED

Department of Water Resources

NOV 24 2000

9. Description of place of use:

a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.

b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RGE	SEC	NE				NW				SW				SE				TOTALS
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
3N	2E	10		~~L~~			H/C												

Total number of acres to be irrigated 010. Describe any other water rights used for the same purposes as described above. None11. a. Who owns the property at the point of diversion? Idanha Hotelb. Who owns the land to be irrigated or place of use? N/A

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: _____

12. Remarks: Water used will be injected into the same aquifer from which it is withdrawn.

13. MAP OF PROPOSED PROJECT REQUIRED - Attach an 8½"x11" map clearly identifying the proposed point of diversion, place of use, section #, township & range. (A photocopy of a USGS 7.5 minute topographic quadrangle map is preferred.)

BE IT KNOWN that the undersigned hereby makes this application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Samuel C. Howard
Signature of Applicant (and title, if applicable)

Received by LM Date 6-23-00 Time 1:49p Preliminary check by 4
 Fee \$ 100.00 Received by LM # 10026650 Date 6-23-00
 Publication prepared by LM Date 6-23-00 Published in THE IDAHO STATESMAN
 Publication approved 4-7-00 LM Date 6-23-00 MICROFILMED

NOV 24 2000

RECEIVED

JUN 23 2000 Ident. No. 63-12593

RECEIVED

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

Department of Water Resources

To appropriate the public waters of the State of Idaho

1. Name of Applicant Parklane Company Phone (208) 345-3221
Mailing address 1817 West Franklin Ave. Boise, Idaho 83702

2. Source of water supply Ground Water which is a tributary of N/A

3. Location of point of diversion is Township 3N Range 2E Sec. 10 in the NW $\frac{1}{4}$,
NW $\frac{1}{4}$, NE $\frac{1}{4}$, Govt. Lot _____, B.M., Ada County;
additional points of diversion if any: _____

4. Water will be used for the following purposes:

Amount 403.40 for Heating/Cooling purposes from 1-1 to 12-31 (both dates inclusive)
~~(cfs or acre-feet per annum)~~
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated is (a) _____ and/or (b) 403.40
cubic feet per second acre feet per annum

6. Proposed diverting works:

a. Describe type and size of devices used to divert water from the source Ground Water Well

b. Height of storage dam N/A feet; active reservoir capacity N/A acre-feet; total
reservoir capacity N/A acre-feet

c. Proposed well diameter is 8 inches; proposed depth of well is 150-250 feet (Yield depending

d. Is ground water with a temperature of greater than 85°F being sought? No

e. If well is already drilled, when? N/A; Drilling firm N/A;
Well was drilled for (well owner) N/A; Drilling Permit No. N/A

7. Time required for completion of works and application of water to proposed beneficial use is 1 years (minimum 1 year)

8. Description of proposed uses (if irrigation only, go to item 9):

a. Hydropower; show total feet of head and proposed capacity in kW. N/A
b. Stockwatering; list number and kind of livestock. N/A
c. Municipal; show name of municipality. N/A
d. Domestic; show number of households. N/A
e. Other; describe fully. Closed loop heat pump cooling

RECEIVED

JUN 27 2000

MICROFILMED

Department of Water Resources

NOV 24 2000

9. Description of place of use:

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RGE	SEC	NE				NW				SW				SE				TOTALS
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
3N	2E	10		L															

Total number of acres to be irrigated 0

10. Describe any other water rights used for the same purposes as described above. None

11. a. Who owns the property at the point of diversion? Idanha Hotel

b. Who owns the land to be irrigated or place of use? N/A

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: _____

12. Remarks: Water used will be injected into the same aquifer from which it is withdrawn.


13. MAP OF PROPOSED PROJECT REQUIRED - Attach an 8½"x11" map clearly identifying the proposed point of diversion, place of use, section #, township & range. (A photocopy of a USGS 7.5 minute topographic quadrangle map is preferred.)

BE IT KNOWN that the undersigned hereby makes this application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Leandra G. Howell
Signature of Applicant (and title, if applicable)

Received by LM Date 6-23-00 Time 1:49p MIC preliminary check by 6
 Fee \$ 100.00 Received by LM # 102266 Date 6-23-00
 Publication prepared by LM Date 6-14-2000 Published NOV 24 2000
 Publication approved _____ THE IDAHO STATESMAN

SW NE NW
No Bow Lts

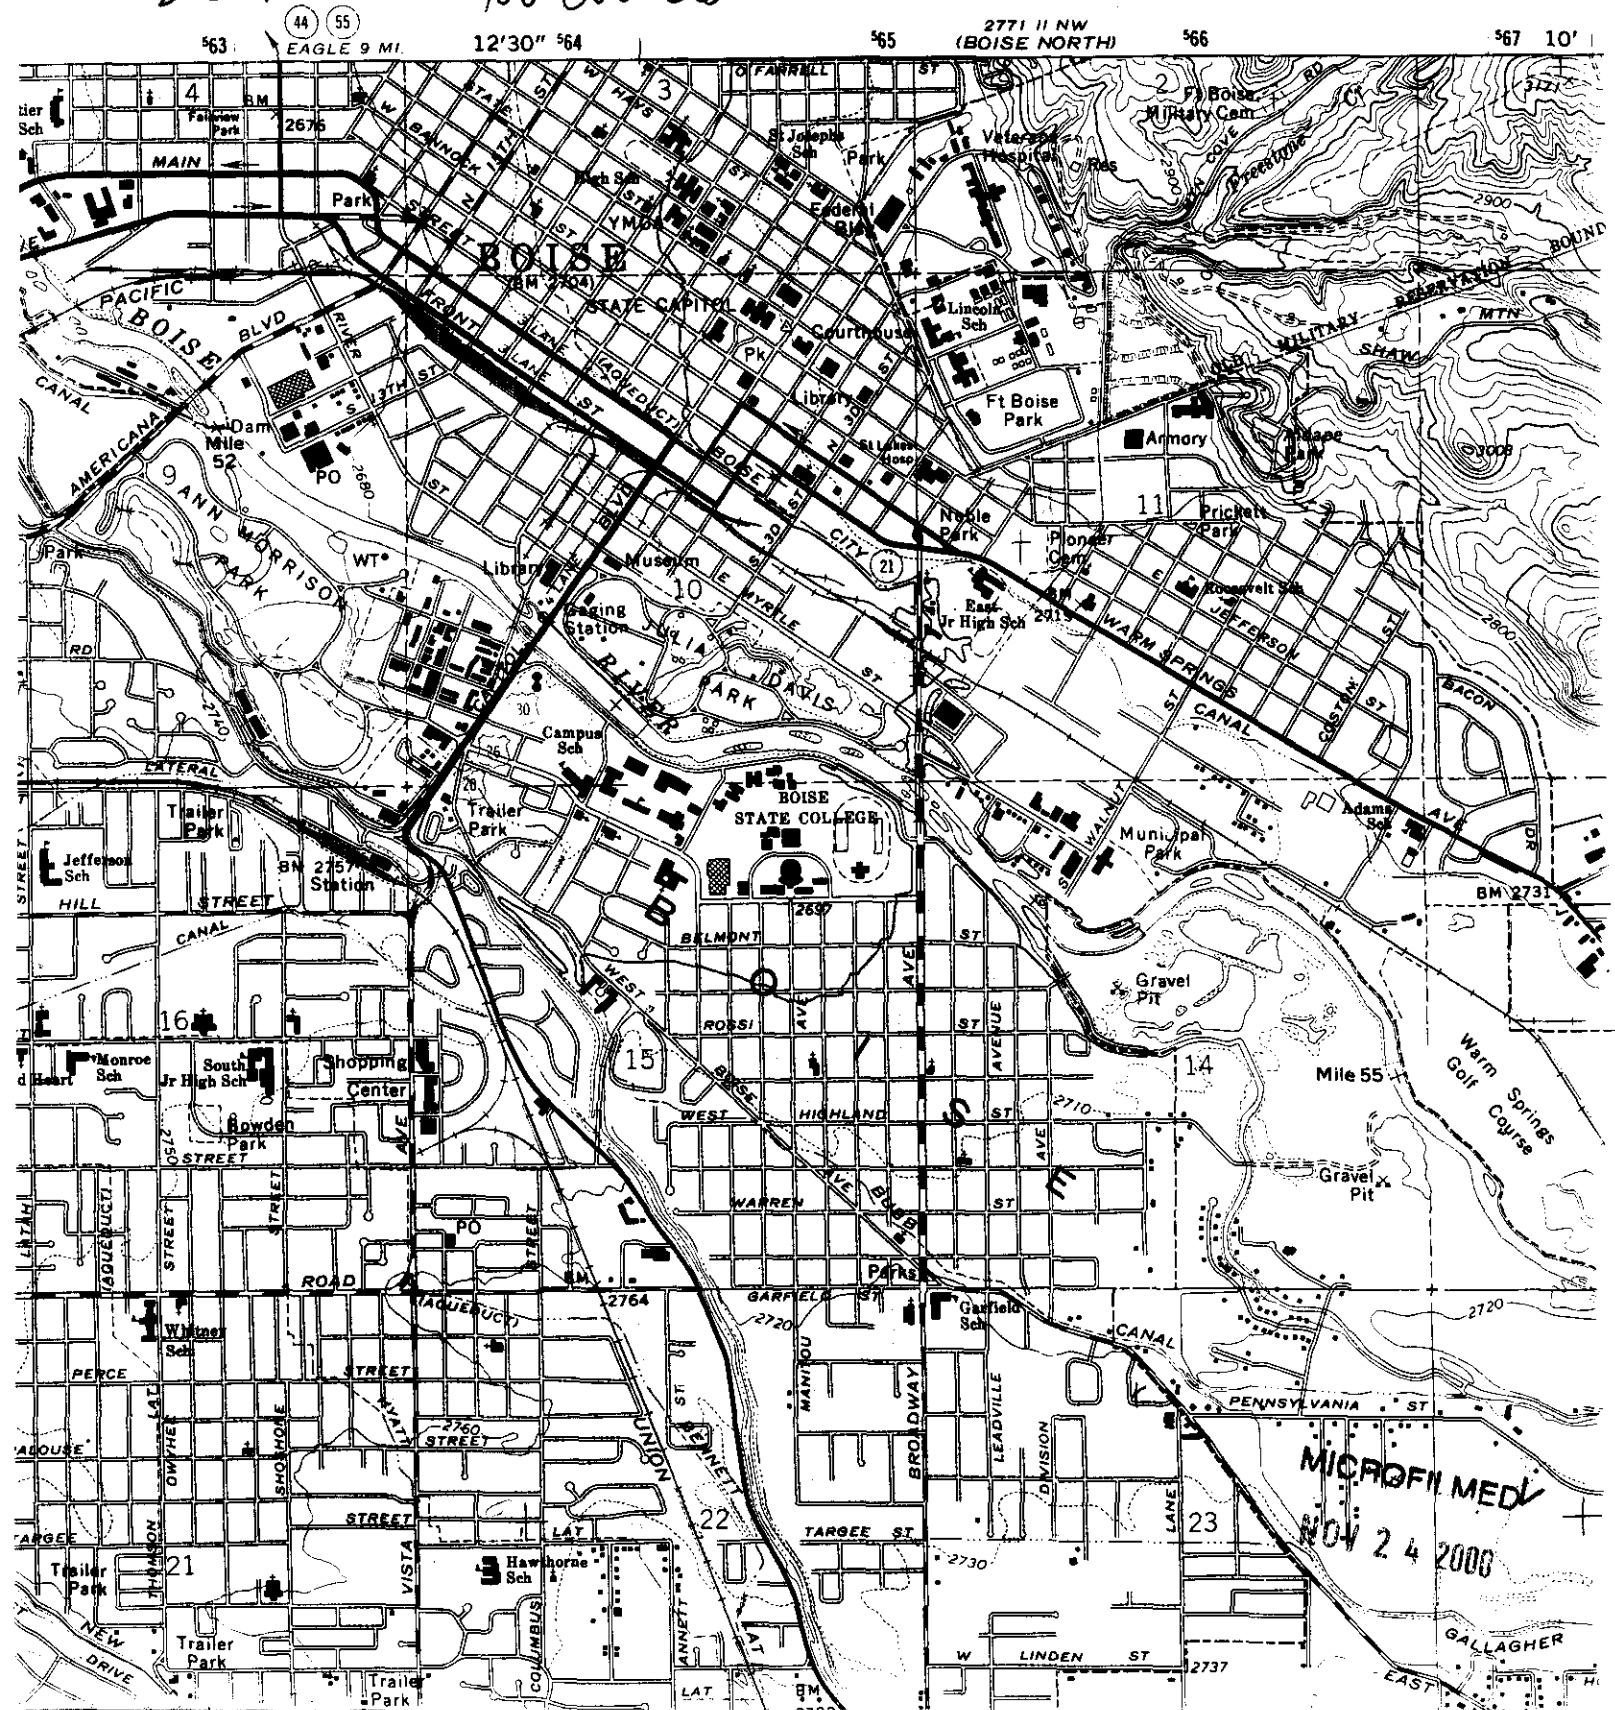

ATTACHMENT A

COOLING SYSTEM SPECIFICATIONS

MICROFILMED
NOV 24 2000

ATTACHMENT B
WELL DRILLING LOGS

MICROFILMED
NOV 24 2000

USE TYPEWRITER OR
BALL POINT PEN

State of Idaho
Department of Water Administration
WELL DRILLER'S REPORT

State law requires that this report be filed with the State Reclamation Engineer
within 30 days after completion or abandonment of the well.

6/29/73 P

1. WELL OWNER
Name President Federal Land Bank
Address 1001 West Idaho Ave
Owner's Permit No.

7. WATER LEVEL
Static water level 224 feet below land surface
Flowing? ☐ Yes ☒ No G.P.M. flow
Temperature 63 F. Quality
Artesian closed-in pressure p.s.i.
Controlled by ☐ Valve ☐ Casing ☐ Plug

2. NATURE OF WORK
☒ New well ☐ Deepened ☐ Replacement
☐ Abandoned (describe method of abandoning)

8. WELL TEST DATA
☒ Pump ☐ Bailor ☐ Other
Discharge G.P.M. 330 Draw Down 65 ft Hours Pumped 4

2. PROPOSED USE
☐ Domestic ☐ Irrigation ☐ Test
☐ Municipal ☒ Industrial ☐ Stock

9. LITHOLOGIC LOG

4. METHOD DRILLED
☒ Cable ☐ Rotary ☐ Dug ☐ Other

Depth	From	To	Description	Water
8	12	55	sand	✓
55	68	70	yellow clay	✓
70	78	80	blue clay	✓
80	85	95	blue sand	✓
95	103	123	blue clay	✓
123	130	150	blue clay	✓
150	156	160	sand & gravel	✓
160	168	189	blue clay	✓
189	228	238	blue clay	✓
238	249	253	blue clay	✓
253	289	300	blue clay	✓

5. WELL CONSTRUCTION
Diameter of hole 8 inches Total depth 300 feet
Casing schedule: ☐ Steel ☐ Concrete
Thickness 8 inches Diameter 1 1/4 feet
132 inches 8 inches 143 feet 155 feet
155 inches 6 inches 180 feet 223 feet
180 inches 6 inches 228 feet 249 feet
228 inches 6 inches 253 feet 289 feet
253 inches 6 inches 289 feet 300 feet
Was a packer or seal used? ☒ Yes ☐ No
Perforated? ☐ Yes ☒ No
How perforated? ☐ Factory ☐ Knife ☐ Torch
Size of perforation inches by inches
Number of perforations feet feet
perforations feet feet
perforations feet feet
Well screen installed? ☒ Yes ☐ No
Manufacturer's name Johnson
Type Model No.
Diameter 6 Slot size 15 Set from 165 feet to 180 feet
Diameter 6 Slot size 15 Set from 223 feet to 238 feet
Diameter 6 Slot size 15 Set from 249 feet to 289 feet
Gravel packed? ☐ Yes ☒ No Size of gravel
Placed from feet to feet
Surface seal? ☒ Yes ☐ No To what depth 40 feet
Material used in seal ☐ Cement grout ☒ Pudding clay

6. LOCATION OF WELL
Sketch map location must agree with written location
County Ada
NE 1/4 NW 1/4 Sec. 10 T. 3 N. R. 2 E
MICROFILM

Work started May 14-73 finished June 22-73
WELLER'S CERTIFICATION
This well was drilled under my supervision and this report is true to the best of my knowledge.
Carloman Well Drill 47
1309 Road - Boise
Carloman June 28-73



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Boise, ID 83706 - P.O. Box 83720, Boise, ID 83720-0098
Phone: (208) 327-7900 Fax: (208) 327-7866 Web Site: www.idwr.state.id.us

October 31, 2001

DIRK KEMPTHORNE
Governor

KARL J. DREHER
Director

PARKLANE COMPANY
817 W FRANKLIN ST
BOISE ID 83702

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 63-12593

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to contact you to schedule a field examination to determine and confirm the use being made of the water, and that it meets the permitted beneficial use.

Be advised that Section 42-248, Idaho Code, requires you or the owner of these water rights to maintain current ownership and address records on file with the department. Forms to file a change of ownership of a water right and/or a change in the address of the water right owner are available from any department office.

If you have questions, please contact the **Western** Regional Office of the department in Boise at (208) 334-2190.

Sincerely,

Deborah J. Gibson
Administrative Assistant
Water Allocation Bureau

Encl.

c: IDWR - Regional Office

MICROFILMED

NOV 26 2001

ANALYSIS SHEET FOR PROOF OF BENEFICIAL USE

Permit No.: 63-12593

Reviewed By: dgibson

Date: October 25, 2001

	<u>Yes</u>	<u>No</u>		<u>Yes</u>	<u>No</u>
Proof received timely?	X		Drilling permit required?	X	
License examination fee required?	X		Drilling permit No.:		
Appropriate fee submitted?	X		Drilling permit upgrade needed?		
Receipt No.:		W026650, C057207	Well driller's report filed?		
Additional Amount Due:			Measuring device required?		X
Name and address same as permit?		X	Measuring device installed?		X
Are the water uses correct?	X		Measure device waiver requested?		

Priority Calculation

Date proof received	10/22/2001
Date proof due	- 11/01/2001
Lapse notice sent	-
No. of days late	= 0
Holiday allowance	+
Priority date	+ 07/28/2000
New priority date	= 07/28/2000

Deficiencies of Actions Items

Check mailing address on database. ~~Forward copy to Well Construction to check on filing fee.~~
Acknowledge proof.

10/25 - To April for D.P. check. ok'd 10/26.

August 31, 2001

PARKLANE CO
817 W FRANKLIN ST
BOISE, ID 83702

PROOF DUE NOTICE

RE: PERMIT NO. 63-12593

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before November 01, 2001. (See last page of your approval permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a completed field examination report prepared by a certified water right examiner may be used to submit the required proof.

If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.


Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.


Sincerely,

Deborah J. Gibson, Administrative Assistant
Water Allocation Bureau

Enclosures

MICROFILMED
NOV 26 2001

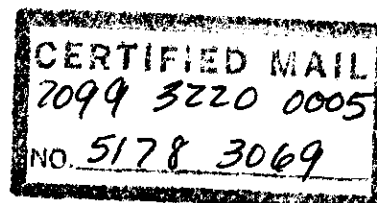

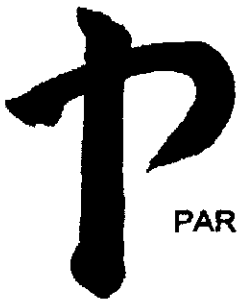

PARKLANE MANAGEMENT
COMPANY, LLC

INVESTMENT PROPERTY
DEVELOPMENT ■ MANAGEMENT

FAX COVER

To: Kari Lynn From: Deborrah Duncan
Company: IDWR Date: 11/20/00
Phone: _____ Phone: 208 345-3221 ex 21
Fax: 327-7866 Total Pages: 1
Re: Permit # 63-12593
Idanha Hotel

Comments: Please update file to show
correct address: Parklane Company
817 W. Franklin St.
Boise, ID 83702

Thank You - Deborah

P.O. BOX 2725, BOISE, IDAHO 83701
817 W. FRANKLIN, BOISE, IDAHO 83702

FAX (208) 342-1209
PHONE (208) 345-3221

MICROFILMED

NOV 24 2000

RECEIVED

NOV 20 2000

Department of Water Resources

IDAHO DEPARTMENT OF WATER RESOURCES
1301 North Orchard St.
P.O. Box 83720
Boise, ID 83720-0090
(208) 327-7900

TO

863-12390

PARKLAND CO

1817 W FRANKLIN ST

BOISE

11-20-00 Phoned for Correction - Deborah
said she wanted for correction
to us to support verbal change given
on the phone.

Deborah

MICROFILMED

NOV 24 2000



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. Box 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

DIRK KEMPTHORNE
GOVERNOR

KARL J. DREHER
DIRECTOR

November 14, 2000

PARKLANE CO
1817 W FRANKLIN AVE
BOISE ID 83702

PERMIT APPROVAL NOTICE

RE: PERMIT NO. 63-12593

Dear Permit Holder:

The Department of Water Resources (IDWR) has issued the enclosed permit authorizing you to establish a new water right. Please be sure to thoroughly review the conditions of approval and remarks listed on your permit.

The permit is a preliminary order issued by IDWR pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action by IDWR unless a party petitions for reconsideration or files an exception and/or brief as described in the enclosed information sheet.

Enclosed is a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit into a licensed water right. Also enclosed is a form entitled "Proof of Beneficial Use". If your project is already completed, you should complete and submit this form immediately.

The right to drill a well is not a part of this permit to appropriate water. Beginning in July of 1987, a statute was enacted which requires a drilling permit for new well construction and deepening of existing wells. If the well(s) proposed for use under this right were drilled or deepened after July 1, 1987, a separate drilling permit must be obtained from this Department. Please contact the Groundwater Protection Section located here at this office or our regional office nearest you.

Also, please note that water right owners are required to report any change of water right ownership and/or change of mailing address to the department within 120 days of the change. Failure to report these changes could result in a \$100 late filing fee. Contact any office of the department or visit the department's homepage on the Internet to obtain the proper reporting form.

MICROFILMED

NOV 24 2000

If you have any questions, please call me at 208-327-7946.

Sincerely,


for Shelley W. Keen
Water Rights Supervisor

SK:klt

Enclosures

MICROFILMED


NOV 24 2000

CERTIFICATE OF MAILING

I hereby certify that on the 14th day of November, 2000, I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER (Approved Permit) to the person(s) listed below:

Water Right No. 63-12593

PARKLANE CO
1817 W FRANKLIN AVE
BOISE ID 83702

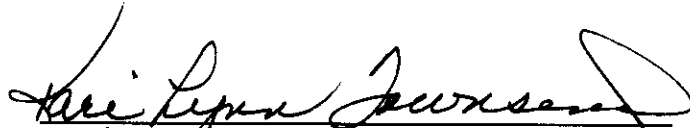
Kari Lynn Townsend
Secretary

MICROFILMED
NOV 24 2000

**EXPLANATORY INFORMATION
TO ACCOMPANY A
PRELIMINARY ORDER**

The accompanying order or approved document is a "Preliminary Order" issued by the department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department of Water Resources (department) unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the department or the Idaho Water Resource Board (Board) is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01303 (Rules of Procedure 302 and 303).

MICROFILMED

SEP 2 1988

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

MICROFILMED

**APPLICATION FOR PERMIT
STATE OFFICE ANALYSIS**
Reviewed by Sharla Curtis on 10/30/00

No. 63-12593 Name: Parklane Co Corp. Officers ☒ Ad ok ☒ Govt Lots _____

AREA OF CONCERN: No/Yes Bfront ~~Minors~~ not hot water GWMA ~~TRUST/NON-TRUST~~

GROUNDWATER: (✓Flow Chart)

DRILLING PERMIT

All wells - 046(P23)
Basin 34 - 084 (if necessary)
Irr. w/in WD - P05
WMD - North/East/West
≤ 0.24 cfs/5 acres - No MD
> 0.24 cfs/5 acres - 067

~~WMD~~

Supp irr (irr = only use) - 065-104
Supp irr (+ other uses) - 100-105
≤ 0.24 cfs/5 acres - No MD
> 0.24 cfs/5 acres - 01M

LOCATION:

Boise Front LoGeo - 058 (<85 GW)
Mitigation - 121
42-248 Area - P84
Swan Falls Flag
Trust - 051(P74) (consumptive uses)
Non-Trust - 048-049 (consumptive uses or non-cons. > 1.0 cfs)

USES:

STORAGE - 18A-01H(P01), 01P-18B(P09)-NA
IRR ≤ 5/ac - R66/R67/R68/R69 (0.03 cfs/ac)
> 5 ac - R62/R63/R64/R65 (0.02 cfs/ac)
STOCKWATER - R37 (BLM/USFS)
MINING - 054-106(P10)
FISH PROP - 029(70'S only)-007-042-106 (P10)
HEAT/COOL - R07(injection well)
~~FIRE PROT.~~ - 077

BENEFICIAL USE DUE: 11 / 01 / 2001

MISC CONDITIONS/REMARKS:

Protested - 020-W19
Development Period
≤ 1 yr - P16
> 1 yr - 26A(P17)
Ownership - 004
Non-consumptive - 027
Water Quality - 106-R07

SURFACE WATER: (✓Flow Chart)

F&G contacted - Yes/No Response _____
In/Above MSF - WB9
PLANNING REVIEW/RESPONSE _____
In-stream development - P52
WD - R04 (WD# _____)
≤ 0.20 cfs/others - 01H(P01), 01P or No MD
> 0.20 cfs - 01J(P08)

SPRINGS/SINK, INACTIVE WD & REST OF STATE

≤ 0.24 cfs/5 acres - No MD
> 0.24 cfs/5 acres - 01M or No MD

RIVER/BASINS: (SW special considerations)

Sage R (01) - W22(P04), N/A
(02,03) - 007 (w/ remark WB9 if above Weiser)
Payette R (65) - 047(P04) (Payette Lake)
Salmon R (70's) - 029 (fish screens)
Weiser R (67) - 086-087

USES:

POWER - 17H-17K (+uses)-08A-025(P18)-01N-106 (P10)
MUNICIPAL
Restricted area - 022,075
Irr., GW supp to SW - 102
DOMESTIC
Surface water - WB5 (Big Wood or Boise above Star Bridge)
27A (Payette R)
> 1 in restricted area - 070-071-075(no parks/common areas, etc)
Irr use listed separate - WB5
Moratorium approvable - W03 (2500 gpd - meets domestic definition
i.e. D/convenience store)

Multiple pd's per ¼¼ - W32
Subd lot desc (pd) - W59
Subd lot desc (pu) - W60
Use definitions - W02 example - S/50 range
Pre-1987 development - 068-074 (allow 120 days for proof due)
Single p/d intended - 076

IRRIGATION SEASON _____ (Per updated map)

IRR VOLUME/ACRE _____

OTHER CONDITIONS/REMARKS _____

COMMENTS _____

Printed 10/31/2000

Ident No. 765189

D20067
63-W-164

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
DRILLING PERMIT

Relationship: Owner/Operator
Name: PARKLANE COMPANY
Address: 1817 W FRANKLIN AVE
BOISE ID 83702

Relationship: Representative
Name: OLYMPUS ENVIRONMENTAL INC
Address: 5409 KENDALL ST
BOISE ID 83706

Proposed Well Location: Township 03N, Range 02E, Section 10, NW, NE
ADA County

Street Address of Well Site: 928 West Main St.
BOISE ID

Proposed Use of Well: Injection

Well Construction Information:

- A. New Well
- B. Proposed Surface Diameter: 8 Inches. Proposed Maximum Depth 250 Feet
- C. Anticipated Bottom Hole Temperature: 85F and less

Construction Start Date: 11/01/2000

Anticipated Well Drilling Company: ADAMSON PUMP & DRILLING (No. 457)

Applicant's Signature: _____ Date _____

Title: _____

MICROFILMED

NOV 24 2000

ACTION OF THE DEPARTMENT OF WATER RESOURCES

This permit is Approved on Tuesday, October 31, 2000.

If approved, this permit authorizes the construction or modification of a well subject to the following conditions. READ CAREFULLY!

CONDITIONS OF APPROVAL:

1. This permit does not constitute an approval of the District Health Department or the Idaho Department of Health and Welfare which may be required prior to construction of this well. The local Health Department should be contacted for septic tank/drainfield locations. Domestic wells must not be drilled closer than 100' from any drainfield and 50' from any septic tank. Public Water Supply wells must not be drilled closer than 100' from any drainfield or septic tank.
2. The well shall be constructed by a driller currently licensed in the state of Idaho who must maintain a copy of the drilling permit at the drilling site.
3. Approval of this drilling permit does not authorize trespass on the land of another party.
4. This permit does not constitute other local, county, state or federal approvals which may be required for construction of a well.
5. This drilling permit does not represent a right to divert and use the water of the State of Idaho.
6. If a bottom hole temperature of 85 Degrees F (29.44 oC) or greater is encountered, well construction shall cease and the well driller and the well owner shall contact the Department immediately.
7. Idaho Code, S 55-2201 - 55-2210 requires the applicant and/or his contractors to contact "Digline" (DigLine is a one-call center for utility notification) not less than 2 working days prior to the start of any excavation for this project. The "Dig Line " Number for your area is &DIG-LINE-NUMBER
8. Please be advised that this drilling permit should be considered and treated as a preliminary permit. If you are in disagreement with this preliminary permit you have fourteen (14) days of the service date of this permit to petition the Department for reconsideration pursuant to Section 67-5243, Idaho Code.
9. A means of monitoring well head pressures along with a pressure relief/bypass which will limit injection pressure shall be installed and maintained on the well head to prevent or reduce the chance of hydrofracturing formations.
10. The screened, perforated, filterpacked or otherwise open and commingled strata which are to be injected into, shall be of similar hydraulic head, temperature and quality. If there are notable variations encountered as the well is drilled and/or developed, the Department will be notified and supplied with supporting documentation for evaluation.
11. The Owner or Driller will notify the Department of Water Resources 24 hrs prior to covering the pitless to the well to allow for an inspection. After the 24 hrs. have passed, the excavation around the pitless and casing may be backfilled, taking particular care to enclose the pitless and casing with bentonite back to the surface.
12. Failure to construct the well in accordance with these conditions may result in the revocation of the drilling permit and constitute a violation of Idaho Law.
13. The well tag for the drilling permit/start card shall be securely and permanently attached to the well casing through welding or by the use of four closed end domed stainless steel pop rivets. The tag attachment will be done at the time of completion of the well, and prior to removing the drill rig from the drill site.
14. This drilling permit is valid for two (2) months from the approval date for the start of construction and is valid for one (1) year from the approval date for completion of the well unless an extension has been granted.
15. An injection well associated with a closed loop heat exchange well, shall have the following: A fully covered air tight 1/4" steel cap welded to the top of the casing, or an AWWA or an NSF approved water tight cap securely fastened to the top of the casing. A Pitless Adapter will be used to connect the return pipe to the well casing. If the hole is dry with no standing water, a drop pipe shall extend a minimum of 18' or 5' above the bottom of the well bore, whichever is deeper. If standing water is present in the bore, a drop pipe shall extend to 4' below the Static Water Level.
16. Injection of fluid from closed loop heat pump system shall occur either above or below the aquitard encountered at between 180 and 220'.
17. The applicant has signed and submitted an expedited drilling permit for the construction of this well prior to approval of the injection well permit, with the understanding that should the injection well permit not receive approval, no fluids may be injected into this well. In that event, production of fluids from well D1000 may require processing of an amended or new application to appropriate water before withdrawal of fluids from well D1000.

MICROFILMED

NOV 24 2000

Mark D. Hips
Signature of Authorized Dept. Representative

Dee Mayne
Title

MICROFILMED
NOV 24 2000

Printed 10/31/2000

Ident No. 765189

D20067
63-W-164

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
DRILLING PERMIT

Relationship: Owner/Operator
Name: PARKLANE COMPANY
Address: 1817 W FRANKLIN AVE
BOISE ID 83702

Relationship: Representative
Name: OLYMPUS ENVIRONMENTAL INC
Address: 5409 KENDALL ST
BOISE ID 83706

Proposed Well Location: Township 03N, Range 02E, Section 10, NW, NE
ADA County

Street Address of Well Site: 928 West Main St.
BOISE ID

Proposed Use of Well: Injection

Well Construction Information:

- A. New Well
- B. Proposed Surface Diameter: 8 Inches. Proposed Maximum Depth 250 Feet
- C. Anticipated Bottom Hole Temperature: 85F and less

Construction Start Date: 11/01/2000

Anticipated Well Drilling Company: ADAMSON PUMP & DRILLING (No. 457)

Applicant's Signature: _____ Date _____

Title: _____

MICROFILMED
NOV 24 2000

ACTION OF THE DEPARTMENT OF WATER RESOURCES

This permit is Approved on Tuesday, October 31, 2000.

If approved, this permit authorizes the construction or modification of a well subject to the following conditions. READ CAREFULLY!

CONDITIONS OF APPROVAL:

1. This permit does not constitute an approval of the District Health Department or the Idaho Department of Health and Welfare which may be required prior to construction of this well. The local Health Department should be contacted for septic tank/drainfield locations. Domestic wells must not be drilled closer than 100' from any drainfield and 50' from any septic tank. Public Water Supply wells must not be drilled closer than 100' from any drainfield or septic tank.
2. The well shall be constructed by a driller currently licensed in the state of Idaho who must maintain a copy of the drilling permit at the drilling site.
3. Approval of this drilling permit does not authorize trespass on the land of another party.
4. This permit does not constitute other local, county, state or federal approvals which may be required for construction of a well.
5. This drilling permit does not represent a right to divert and use the water of the State of Idaho.
6. If a bottom hole temperature of 85 Degrees F (29.44 oC) or greater is encountered, well construction shall cease and the well driller and the well owner shall contact the Department immediately.
7. Idaho Code, S 55-2201 - 55-2210 requires the applicant and/or his contractors to contact "Digline" (DigLine is a one-call center for utility notification) not less than 2 working days prior to the start of any excavation for this project. The "Dig Line " Number for your area is &DIG-LINE-NUMBER
8. Please be advised that this drilling permit should be considered and treated as a preliminary permit. If you are in disagreement with this preliminary permit you have fourteen (14) days of the service date of this permit to petition the Department for reconsideration pursuant to Section 67-5243, Idaho Code.
9. A means of monitoring well head pressures along with a pressure relief/bypass which will limit injection pressure shall be installed and maintained on the well head to prevent or reduce the chance of hydrofracturing formations.
10. The screened, perforated, filterpacked or otherwise open and commingled strata which are to be injected into, shall be of similar hydraulic head, temperature and quality. If there are notable variations encountered as the well is drilled and/or developed, the Department will be notified and supplied with supporting documentation for evaluation.
11. The Owner or Driller will notify the Department of Water Resources 24 hrs prior to covering the pitless to the well to allow for an inspection. After the 24 hrs. have passed, the excavation around the pitless and casing may be backfilled, taking particular care to enclose the pitless and casing with bentonite back to the surface.
12. Failure to construct the well in accordance with these conditions may result in the revocation of the drilling permit and constitute a violation of Idaho Law.
13. The well tag for the drilling permit/start card shall be securely and permanently attached to the well casing through welding or by the use of four closed end domed stainless steel pop rivets. The tag attachment will be done at the time of completion of the well, and prior to removing the drill rig from the drill site.
14. This drilling permit is valid for two (2) months from the approval date for the start of construction and is valid for one (1) year from the approval date for completion of the well unless an extension has been granted.
15. An injection well associated with a closed loop heat exchange well, shall have the following: A fully covered air tight 1/4" steel cap welded to the top of the casing, or an AWWA or an NSF approved water tight cap securely fastened to the top of the casing. A Pitless Adapter will be used to connect the return pipe to the well casing. If the hole is dry with no standing water, a drop pipe shall extend a minimum of 18' or 5' above the bottom of the well bore, whichever is deeper. If standing water is present in the bore, a drop pipe shall extend to 4' below the Static Water Level.
16. Injection of fluid from closed loop heat pump system shall occur either above or below the aquitard encountered at between 180 and 220'.
17. The applicant has signed and submitted an expedited drilling permit for the construction of this well prior to approval of the injection well permit, with the understanding that should the injection well permit not receive approval, no fluids may be injected into this well. In that event, production of fluids from well D1000 may require processing of an amended or new application to appropriate water before withdrawal of fluids from well D1000.

MICROFILMED**NOV 24 2000**

Mark S. Kip
Signature of Authorized Dept. Representative

Gene Mayne
Title

MICROFILMED
NOV 23 2000

9/99

OCT 23 2000

IDAHO DEPARTMENT OF WATER RESOURCES
APPROPRIATION APPLICATION ANALYSIS SHEET

Department of Water Resources

INITIAL REVIEW BY: lyDATE: 7/17/00APPLICATION: 63-12593REQUIRED INFORMATION

- ☒ Name: (If applicant is a corporation or partnership, names and addresses for the director, officers, and other partners must be included.)
- ☒ Address:
- ☒ Source: (See USGS Quad for names of water sources)
- ☒ Point of Diversion: (10 acres for spring, lot & block descriptions for Subdivisions, local name)
- ☒ County:
- ☒ Quantity: (flow and/or volume)
- ☒ Period of use:
- ☒ Nature of proposed use: (Include description of use)
- ☒ Description of diverting works:
- ☒ Time required for beneficial use of water:
- ☒ Place of use or acres irrigated:
- ☒ Map: (show T, R, S, QQ &/or QQQ)
- ☒ Subdivision plat: (for > 1 home in restricted area. $\geq$ 5 homes in non-restricted area)
- ☒ Signature: (If applicant is corp., partnership, or municipality, title of signatory is required)
- ☒ Correct fee paid

Gov't. Lots:

☒ P/D
☒ P/U
ADDITIONAL INFORMATION

☒ ADVERTISE REMARK(S)
(Reviewer identify which remarks)

done T FLAG CHANGED TO P FLAG

YES NO

- ☒ ☐ Overlapping place of use: (Describe source & relationship to present application on next page.)
- ☒ ☐ Overlapping point of diversion.
- ☐ ☒ Critical groundwater area:
- ☐ ☒ Groundwater management area:
- ☐ ☒ 1992 moratorium:
- ☐ ☒ Surface water source, IDFG letter needed.
- ☐ ☒ Protected river or minimum flow reach, notify water planning bureau.
- ☐ ☒ E-mail to SCA staff: (perennial stream, non-pump diversion &/or any mining).
- ☐ ☒ E-mail to Dam Safety staff: (for any storage)
- ☒ ☒ Mitigation plan: Check any that apply.
- ☐ ☐ immediate = acceptable plan required and submitted.
- ☐ ☐ future = open areas, acceptance of condition of approval is in file.
- ☐ ☒ Send power requirement letter &/or fish farm requirement letter.
- ☐ ☒ Power residency affidavit:
- ☐ ☒ Diversion greater than 5 cfs or 500 af or irrigation greater than 200 acres: (If yes, attach Large Diversion supplementary analysis sheet.)
- ☒ ☐ *REQUEST ADDITIONAL INFORMATION FROM THE APPLICANT

CFS + water bearing zone + legal

Date Requested 7/17/00Date Response Received 7/28/00

PROCESSING

APP. NO.

5-12593

YES NO

☒ ☐ In form for advertising:
☐ ☒ Statewide advertising: (> 10 cfs &/or 1000 af)
☒ ☐ Fee amount, receipt number and date recorded on application:

SEND COPIES TO: NOTE IF E-MAIL COMMENT LETTER USED.

YES NO

☐ ☒ I.D. Health & Welfare
☐ ☒ I.D. District Health
☐ ☒ I.D. Fish & Game
☐ ☒ I.D. Lands

YES NO

☐ ☒ U.S. BLM
☐ ☒ U.S. Forest Service
☐ ☒ Water Dist. # _____
☐ ☒ Water Planning Bureau
☐ ☒ Other _____

FINAL REGIONAL PROCESSING REVIEW:

YES NO

☒ ☐ Affidavit of publication received:
☒ ☐ Application published correctly: If not, record action taken.

☒ ☐ Publication dates and paper recorded on application:

☒ ☐ Final date for protest 9-5-00

☐ ☒ Protests received.

☐ ☒ Recommendations attached:

☐ ☒ Measuring device required:

☐ ☒ Water delivered by water master? District # _____

☒ ☐ Special conditions of approval or cover letter: 120, 046, Water shall be injected into the same aquifer from which it is withdrawn.
Water shall be diverted and reinjected through a closed loop system.

See below for additional information

Recommended Date or Priority 7/28/00Recommended by: Gauy SDate: 10/16/00ADDITIONAL INFORMATION:

overlaps: separate wells & lines

SD-0420-2
MODIFY RECORD

Idaho Department of Water Resources
Modify Comment

Date: 07/28/00
Time: 11:55:41

Water Right Number: 63-12593

Comment Date: 7/19/2000 User ID: LGRAVES

Subject: MORE INFO_____

Per Applicant: Propose a closed loop cooling system for the _____
Idanha Hotel located at 928 West Main Street. Water will be _____
withdrawn from the aquifer between 100 and 250' at the site _____
through a proposed pumping well. All the pumped water will then _____
be returned to the same aquifer zone through a proposed injection
well. Both wells will be installed on applicant's property or in
the Ada County Right-of-Way. Proposal is non-consumptive. _____
Per IDWR: Attachment A includes the system specs prepared by _____
applicant's engineer: Olympus Technical Services, Inc. _____
Corporate officers include only Kenneth Howell, President. _____
Original well applications were filed at the S.O. and are located
at Mark Slifka's desk waiting approval. _____

(Enter=Continue/Exit) (Gold2=Update) (Gold3=Delete) (Gold4=Prev) (Gold5=Next)

MICROFILMED

NOV 24 2000

SD-0420-2
MODIFY RECORD

Idal. Department of Water Resources
Modify Comment

Date: 07/28/00
Time: 11:55:59

Water Right Number: 63-12593

Comment Date: 7/19/2000 User ID: LGRAVES

Subject: MORE INFO

at Mark Slifka's desk waiting approval.

Contact person is Mike Backe with Olympus Technical Services,
376-5006.

(Enter=Continue/Exit) (Gold2=Update) (Gold3=Delete) (Gold4=Prev) (Gold5=Next)

MICROFILMED

NOV 24 2000

The Idaho Statesman

✓ MC
SD

RECEIVED

P.O. Box 40, Boise, Idaho 83707-0040

AUG 28 2000

LEGAL ADVERTISING PROOF OF PUBLICATION

WATER RESOURCES
WESTERN REGION

Account #	DTI#	Identification		Amount:
047628	309956	NOTICE OF APPLICATION		\$158.82
Ordered by:		P.O. #	Rate	Run Dates
			TT	AUGUST 17, 24, 2000
IDAHO DEPARTMENT OF WATER RESOURCES WEST 2735 AIRPORT WAY BOISE, IDAHO 83705			Number of Lines 49 X 2	
			Affidavit 1	Legal # 8084

JANICE HILDRETH, being duly sworn, deposes and says: That she is the Principal Clerk of *The Idaho Statesman*, a daily newspaper printed and published at Boise, Ada County, State of Idaho, and having a general circulation therein, and which said newspaper has been continuously and uninterruptedly published in said County during a period of twelve consecutive months prior to the first publication of the notice, a copy of which is attached hereto: that said notice was published in *The Idaho Statesman*, in conformity with Section 60-108, Idaho Code, as amended for: TWO

☒ consecutive weekly ☐ single
☐ consecutive daily ☐ odd skip
insertion(s)

beginning with the issue of: AUGUST 17, 2000
and ending with the issue of: AUGUST 24, 2000


Janice Hildreth

STATE OF IDAHO)
) ss
COUNTY OF ADA)

On this 24 day of AUGUST in the year of 2000
before me, a Notary Public, personally appeared before me Janice Hildreth
known or identified to me to be the person whose name subscribed to the
within instrument, and being by me first duly sworn, declared that the state-
ments therein are true, and acknowledged to me that she executed the same.

Sondra L. Brightman

Notary Public for Idaho
Residing at: Boise, Idaho
My Commission expires: 6/20/06

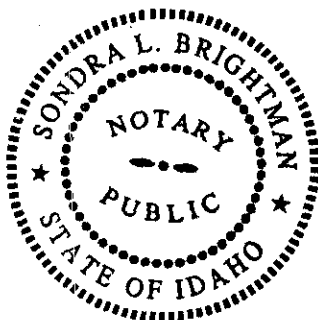

MICROFILMED

NOV 24 2000

**LEGAL NOTICE
APPLICATION FOR WATER RIGHT**

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

63-12593

PARKLAND COMPANY
1817 W. FRANKLIN AVE.
BOISE, ID 83702

Source: GROUNDWATER
Diversion Pt: SWNENW Sec 10 T 03N R 02E in ADA County.
Use: HEATING { 0.560 CFS)
COOLING { 0.560 CFS)
Total Diversion: { 0.560 CFS)
Date Filed: 7/28/2000
In: ADA County
T03N R02E S10 NENW
Water bearing zone to be appropriated is from 100 to 250 feet.

63-12595

CITY OF BOISE
PARKS & RECREATION DEPT.
1104 ROYAL BLVD.
BOISE, ID 83706

Source: GROUNDWATER
Diversion Pt: SESESE Sec 29 T 04N R 01E in ADA County
Use: IRRIGATION { 0.500 CFS)
RECREATION STORAGE { 5.00 AF)
DIVERSION TO STORAGE { 0.500 CFS)
Total Diversion: { 0.500 CFS) { 5.00 AF)
Date Filed: 6/9/2000
In: ADA County
T04N R01E S29 SESE
30.0 ACRES TOTAL

Water bearing zone to be appropriated is from 50 to 250 feet. Mitigation is proposed for consumptive use.

Permits will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code. Any protest against the approval of this application must be filed with the Director, Dept. of Water Resources, Western Region, 2735 Airport Way, Boise, Idaho 83705 together with a protest fee of \$25.00 for each application on or before SEPTEMBER 5, 2000. The protestant must also send a copy of the protest to the applicant.

KARL J. DREHER, Director

Pub. Aug. 17, 24, 2000

8084



Olympus Technical Services, Inc.

Billings, MT • Boise, ID • Havre, MT • Helena, MT

July 27, 2000

Lori Graves
Idaho Department of Water Resources
Western Region
2735 Airport Way
Boise, Idaho 83705-5082

RECEIVED

JUL 28 2000

WATER RESOURCES
WESTERN REGION

Re: **Amended Water Right Permit Application**
Idanha Hotel
Parklane Company
Boise, Idaho
Olympus Work Order No. A7050

Dear Ms. Graves:

Olympus Technical Services, Inc. (Olympus), on behalf of Parklane Company, Inc., submits the attached authorized amendments to the Application for Permit, To appropriate the public waters of the State of Idaho for the Idanha Hotel. The amendment addresses changes made to the application to reflect the correct location for the point of diversion and presents the proposed withdrawal rate in cubic feet per second. On July 20, 2000, the Idaho Department of Water Resources (IDWR) returned the amended application to Olympus requesting Parklane Company's authorization of the amendments.

Additionally, IDWR, in its July 20, 2000 correspondence, requested a response to the following question:

IDWR Inquiry. Please evaluate the effect the proposed diversion and injection of ground water will have on existing wells from the same source within a ½ mile radius, especially in regards to the variance between diversion water temperature and injection water temperature. Please explain what agreement, discussions or plan you have made with the owners of these wells.

Response. Parklane Company has applied similar systems to four projects in the general downtown Boise, Idaho area. These projects include:

- Franklin Plaza - 805 West Franklin Street;
- Union Block Building - 740 Idaho Street;
- Idaho Building - 290 North 8th Street; and
- The Alaska Center - 1020 West Main Street.

The projects at all of the above locations have been in operation for several years. In that time, Parklane Company has received no complaints from any party regarding water temperature impact to ground water from its operations. Additionally, Parklane Company has not noticed degradation in its heating and cooling operations resulting from ground water withdrawal and injection at these projects.

MICROFILMED


5409 Kendall Street • Boise, ID 83706
(208) 376-5006 • Fax (208) 376-5091 • E-mail: olympusid@rmci.net

NOV 24 2000

Please feel free to contact me should you have any questions or comments. I can be reached by telephone at (208) 376-5006 or via E-mail at mabOlyBOI@rmci.net.

Sincerely,

Olympus Technical Services, Inc.



Michael Backe, P.G.
Senior Hydrogeologist

MAB

Attachment

cc: James Campbell, Community Contracting

MICROFILMED

NOV 24 2000



State of Idaho
DEPARTMENT OF WATER RESOURCES

Western Region, 2735 Airport Way, Boise, Idaho 83705-5082 - (208) 334-2190
FAX (208) 334-2348

DIRK KEMPTHORNE
GOVERNOR

KARL J. DREHER
DIRECTOR

July 20, 2000

Parklane Co.
C/o Mike Backe
Olympus Technical Services, Inc.
5409 Kendall Street
Boise ID 83706

RE: Application for Permit No. 63-12593

Parklane Company's application for permit for heating and cooling of the Idanha Hotel was received 6/23/2000. As per our telephone conversation, please initial the changes on the enclosed amended application for permit and return to my attention. The priority date for the application will be the date the amended version is received. Once received, it will be submitted for advertising, but will be held from further processing until the following additional information is obtained as required by Idaho Code § 42-222.

Injury. Please evaluate the effect that the proposed diversion and injection of ground water will have on existing wells from the same source within a ½ mile radius, especially in regards to the variance between diversion water temperature and injection water temperature. Please explain what agreements, discussions or plans you have made with the owners of these existing wells.

The application will be advertised in the Idaho Statesman August 3rd and 10th. Last day for protest will be August 21st. If the application is not protested, this information is due after the final date of protest. If the application is protested, the information will need to be available for protest negotiations.

If you have any questions, please contact me at the above address or telephone number.

Sincerely,

A handwritten signature in cursive script, appearing to read 'Lori Graves'.

Lori Graves
Water Allocations

Encl: amended application

MICROFILMED

NOV 24 2000



Olympus Technical Services, Inc.

Billings, MT • Boise, ID • Havre, MT • Helena, MT

RECEIVED

JUN 21 2000

Department of Water Resources

June 22, 2000

To Western

Pam Skaggs
Idaho Department of Water Resources
Statehouse Mail
1301 N. Orchard Street
Boise, Idaho 83720

RECEIVED

JUN 23 2000

WATER RESOURCES
WESTERN REGION

Re: **Water Right Permit Application**
Idanha Hotel
Parklane Company
Boise, Idaho
Olympus Work Order No. A7050

Dear Ms Skaggs:

Olympus Technical Services, Inc. (Olympus), on behalf of Parklane Company, Inc., submits the attached Water Right permit application for the Idanha Hotel. The Idanha Hotel is located in Ada County, Idaho at 928 West Main Street in Boise. Parklane Company desires to obtain a non-consumptive Water Right for the operation of closed loop cooling system at the Idanha Hotel. Parklane Company proposes to withdraw water from the aquifer at the site through a pumping well. All pumped water will be returned to the aquifer through an injection well. The wells will be installed on Parklane Company property or in the Ada County Right-of-Way.

The cooling water source is from a proposed pumping well located at the Idanha Hotel. The proposed well will be between 150 and 250 feet deep and eight inches in diameter. Parklane Company desires to pump the well at a rate of 250 gallons per minute during the period January 1 through December 31 annually. Attachment A includes the cooling system specifications prepared by Parklane Company's engineer. All cooling water will be injected into the same, or adjacent, water-bearing zone of the aquifer (from which it was removed) through a 150 to 250 foot deep eight-inch diameter injection well. Examination of drilling logs (Attachment B) for wells adjacent to the Idanha Hotel indicate that the withdrawal and injection zones are in the same, or adjacent, water-bearing portion of the aquifer. Figure 1 of the permit application shows the proposed pumping and injection well locations. The completed permit application and the \$100 application fee are enclosed.

Parklane Company has also filed with the Idaho Department of Water Resources (IDWR) for Well Drilling permits and an Injection Well permit for the operation of the cooling/injection well system.

MICROFILMED

5409 Kendall Street • Boise, ID 83706
(208) 376-5006 • Fax (208) 376-5091 • E-mail: olympusid@rmci.net

JUN 24 2000

Please feel free to contact me should you have any questions or comments. I can be reached by telephone at (208) 376-5006 or via E-mail at mabOlyBOI@rmci.net.

Sincerely,

Olympus Technical Services, Inc.


Michael Backe, P.G.
Senior Hydrogeologist

MAB

Attachment

cc: John Carlson, IDWR (without attachment)
Mike Piechowski, IDWR (without attachment)
James Campbell, Community Contracting

MICROFILMED

NOV 24 2000



Olympus Technical Services, Inc.

Billings, MT • Boise, ID • Havre, MT • Helena, MT

June 22, 2000

John Carlson
Idaho Department of Water Resources
Statehouse Mail
1301 N. Orchard Street
Boise, Idaho 83720

**Re: Well Permit Applications
Idanha Hotel
Parklane Company
Boise, Idaho
Olympus Work Order No. A7050**

Dear Mr. Carlson:

Olympus Technical Services, Inc. (Olympus), on behalf of Parklane Company, Inc., submits the attached Drilling Permit applications to drill and complete two ground water wells at the Idanha Hotel. The Idanha Hotel is located in Ada County, Idaho at 928 West Main Street in Boise. Parklane Company desires to use the wells as part of a closed loop cooling system. The wells will be used to pump water to the building cooling system and return such water to the aquifer through an injection well. Figure 1 of the permit application shows the proposed well locations. The wells will be installed on Parklane Company property or in the Ada County Right-of-Way.

Parklane Company will construct the wells in accordance with guidelines established in the Idaho Department of Water Resources Well Construction Standards (January 1989). The Cooling/Injection Well Construction Logs (attached with the permit application) show the proposed well specifications. The completed Drilling Permit application and the \$200 application fee are enclosed.

Parklane Company has also filed with the Idaho Department of Water Resources (IDWR) for an Injection Well permit and a non-consumptive Water Right for the operation of the cooling/injection well system. All cooling water pumped from the aquifer will be injected into the same, or adjacent, water-bearing zone of the affected aquifer.

MICROFILMED

5409 Kendall Street • Boise, ID 83706
(208) 376-5006 • Fax (208) 376-5091 • E-mail: olympusid@rmci.net

NOV 24 2000

Please feel free to contact me should you have any questions or comments. I can be reached by telephone at (208) 376-5006 or via E-mail at mabOlyBOI@rnci.net.

Sincerely,

Olympus Technical Services, Inc.



Michael Backe, P.G.
Senior Hydrogeologist

MAB

Attachment

cc: Pam Skaggs, IDWR (without attachment)
Mike Piechowski, IDWR (without attachment)
James Campbell, Community Contracting

MICROFILMED

NOV 24 2000



Olympus Technical Services, Inc.

Billings, MT • Boise, ID • Havre, MT • Helena, MT

June 22, 2000

**Mike Piechowski
Idaho Department of Water Resources
Statehouse Mail
1301 N. Orchard Street
Boise, Idaho 83720**

**Re: Injection Well Permit Application
Idanha Hotel
Parklane Company
Boise, Idaho
Olympus Work Order No. A7050**

Dear Mr. Piechowski

Olympus Technical Services, Inc. (Olympus), on behalf of Parklane Company, Inc., submits the attached Injection Well permit application for the Idanha Hotel. The Idanha Hotel is located in Ada County, Idaho at 928 West Main Street in Boise. Parklane Company desires to inject water from a closed loop cooling system. The well will be installed on Parklane Company property or in the Ada County Right-of-Way.

The source of the cooling water (to be injected) is from a proposed pumping well located at the Idanha Hotel. All cooling water pumped from the aquifer will be injected into the same, or adjacent, water-bearing zone of the affected aquifer. Examination of drilling logs for wells adjacent to the Idanha Hotel indicate that the withdrawal and injection zones are in the same, or adjacent, water-bearing portion of the aquifer. Figure 1 of the permit application shows the proposed pumping and injection well locations.

Parklane Company will construct the well in accordance with guidelines established in the Idaho Department of Water Resources Well Construction Standards (January 1989). The Cooling/Injection Well Construction Logs (attached with the permit application) show the proposed well specifications. The completed Injection Well Permit Application and the \$75 application fee are enclosed.

Parklane Company has also filed with the Idaho Department of Water Resources (IDWR) for Well Drilling permits and a non-consumptive Water Right for the operation of the cooling/injection well system.

5409 Kendall Street • Boise, ID 83706
(208) 376-5006 • Fax (208) 376-5091 • E-mail: olympusid@rmci.net **MICROFILMED**

C:\MAB\Projects\Idanha.A7050\IDWR 6-22-00 iw.doc

NOV 24 2000

June 22, 2000

Page 2

Please feel free to contact me should you have any questions or comments. I can be reached by telephone at (208) 376-5006 or via E-mail at mabOlyBOI@rmci.net.
Sincerely,

Olympus Technical Services, Inc.



Michael Backe, P.G.
Senior Hydrogeologist

MAB

Attachment

cc: Pam Skaggs, IDWR (without attachment)
John Carlson, IDWR (without attachment)
James Campbell, Community Contracting

MICROFILMED

NOV 24 2000



State of Idaho
DEPARTMENT OF WATER RESOURCES

Western Region, 2735 Airport Way, Boise, Idaho 83705-5082 - (208) 334-2190
FAX (208) 334-2348

DIRK KEMPTHORNE
GOVERNOR

KARL J. DREHER
DIRECTOR
AUGUST 9, 2000

Legal Notices Department
THE IDAHO STATESMAN
PO BOX 40
BOISE, ID 83707

Dear Legal Dept.:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before SEPTEMBER 5, 2000.

Yours truly,

SUE TAYLOR
Secretary/Office Coordinator

Encl.

MICROFILMED

NOV 24 2000

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

MICROFILMED
NOV 24 2000

63-12593

PARKLANE COMPANY
1817 W FRANKLIN AVE
BOISE, ID 83702

Source: GROUNDWATER

Diversion Pt: SWNENW Sec 10 T 03N R 02E in ADA County.

Use: HEATING	(	0.560 CFS)
COOLING	(	0.560 CFS)
Total Diversion:	(	0.560 CFS)

Date Filed: 7/28/2000

In: ADA County
T03N R02E S10 NENW

Water bearing zone to be appropriated is from 100 to 250 feet.

MICROFILMED

NOV 24 2000

Permits will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code. Any protest against the approval of this application must be filed with the Director, Dept. of Water Resources, Western Region, 2735 Airport Way, Boise, Idaho 83705 together with a protest fee of \$25.00 for each application on or before SEPTEMBER 5, 2000. The protestant must also send a copy of the protest to the applicant.

KARL J. DREHER, Director

Published: 8/17/2000 & 8/24/2000

MICROFILMED

NOV 24 2000