


13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

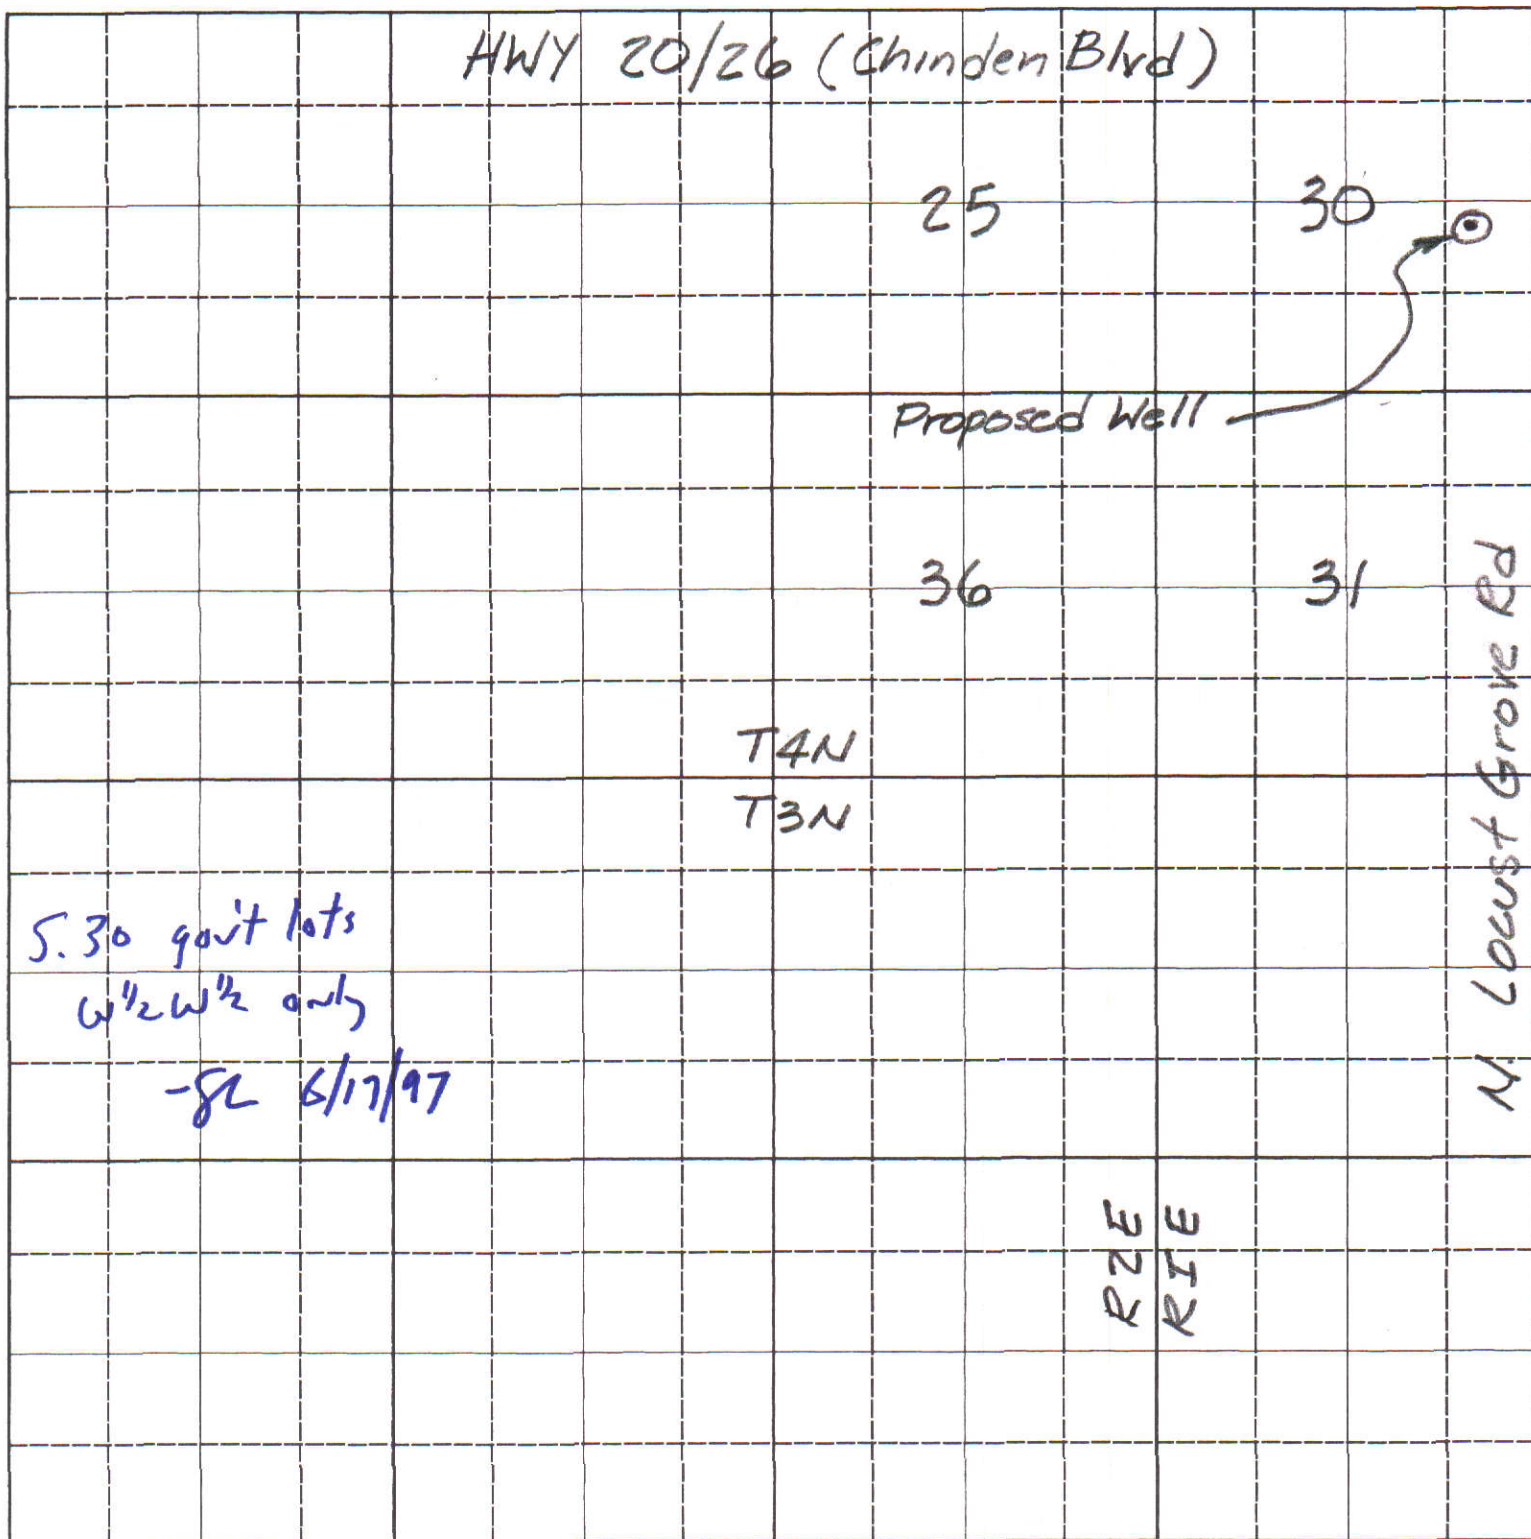


Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

X Richard L. [Signature] MICROFILMED
(Applicant)
SEP 11 1997

Well House

3. Delivery System Diagram: Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

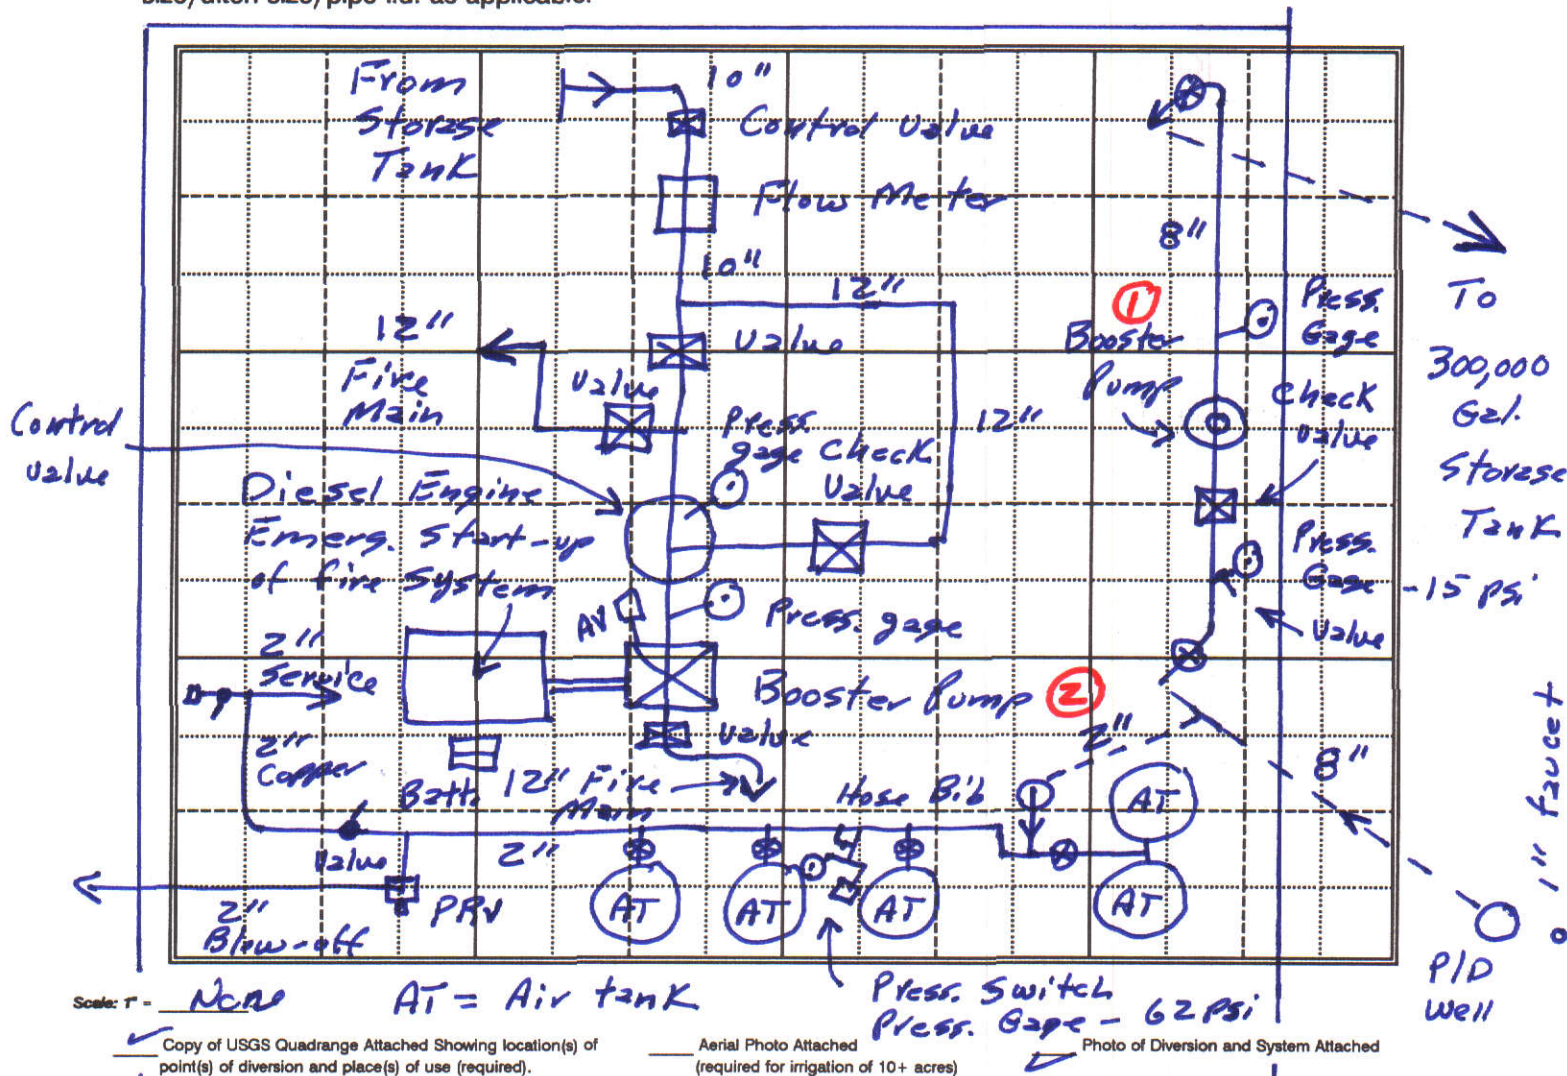

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
Well	Franklin	5 1/2		Gould	70607
Booster ①	U.S. Electr.	5	391842-932		G 158A
Booster ②	(Diesel)			Aurora	180A060

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS


1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
Flow meter		Gerand Engr.	K-2000-8	413-97F	8"	

2. Measurements: None - op. press. : 15 psi min from well pump to in-line Booster Pump

MICROFILM

AUG 23 2000

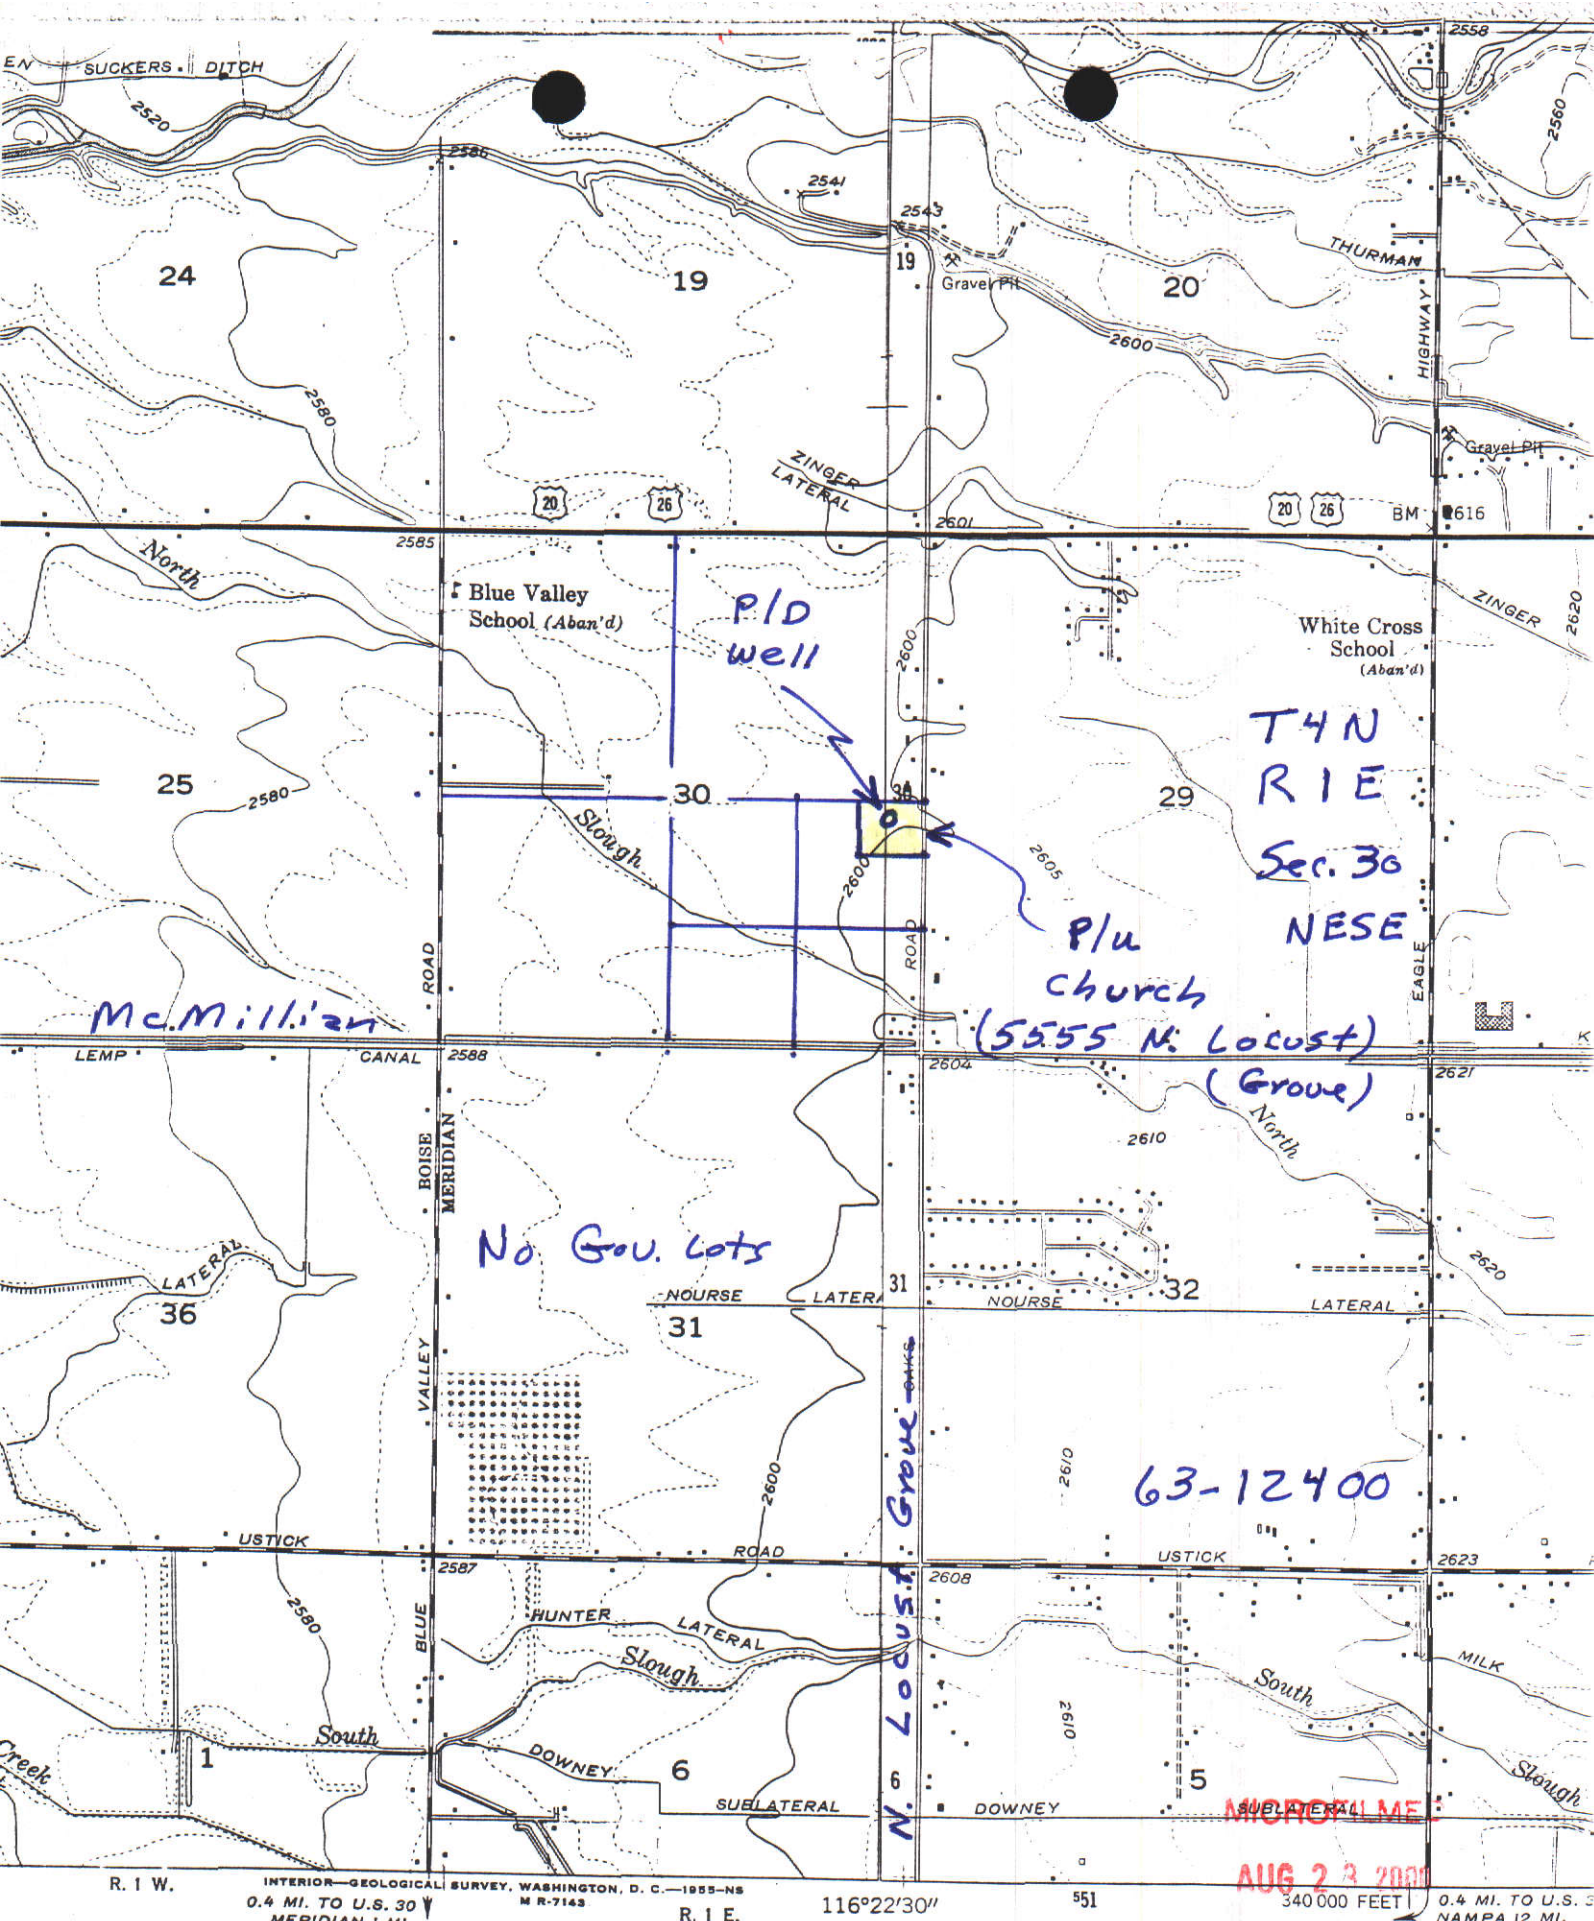


ROAD CLASSIFICATION

Heavy-duty	4 LANE 16 LANE	Light-duty
Medium-duty	4 LANE 16 LANE	Unimproved dirt

Topography from aerial photographs by multiplex methods and by plane-table surveys 1953. Aerial photographs taken 1951

Polyconic projection. 1927 North American datum

Mapped, edited, and published by the Geological Survey
Control by USGS and USC&GS

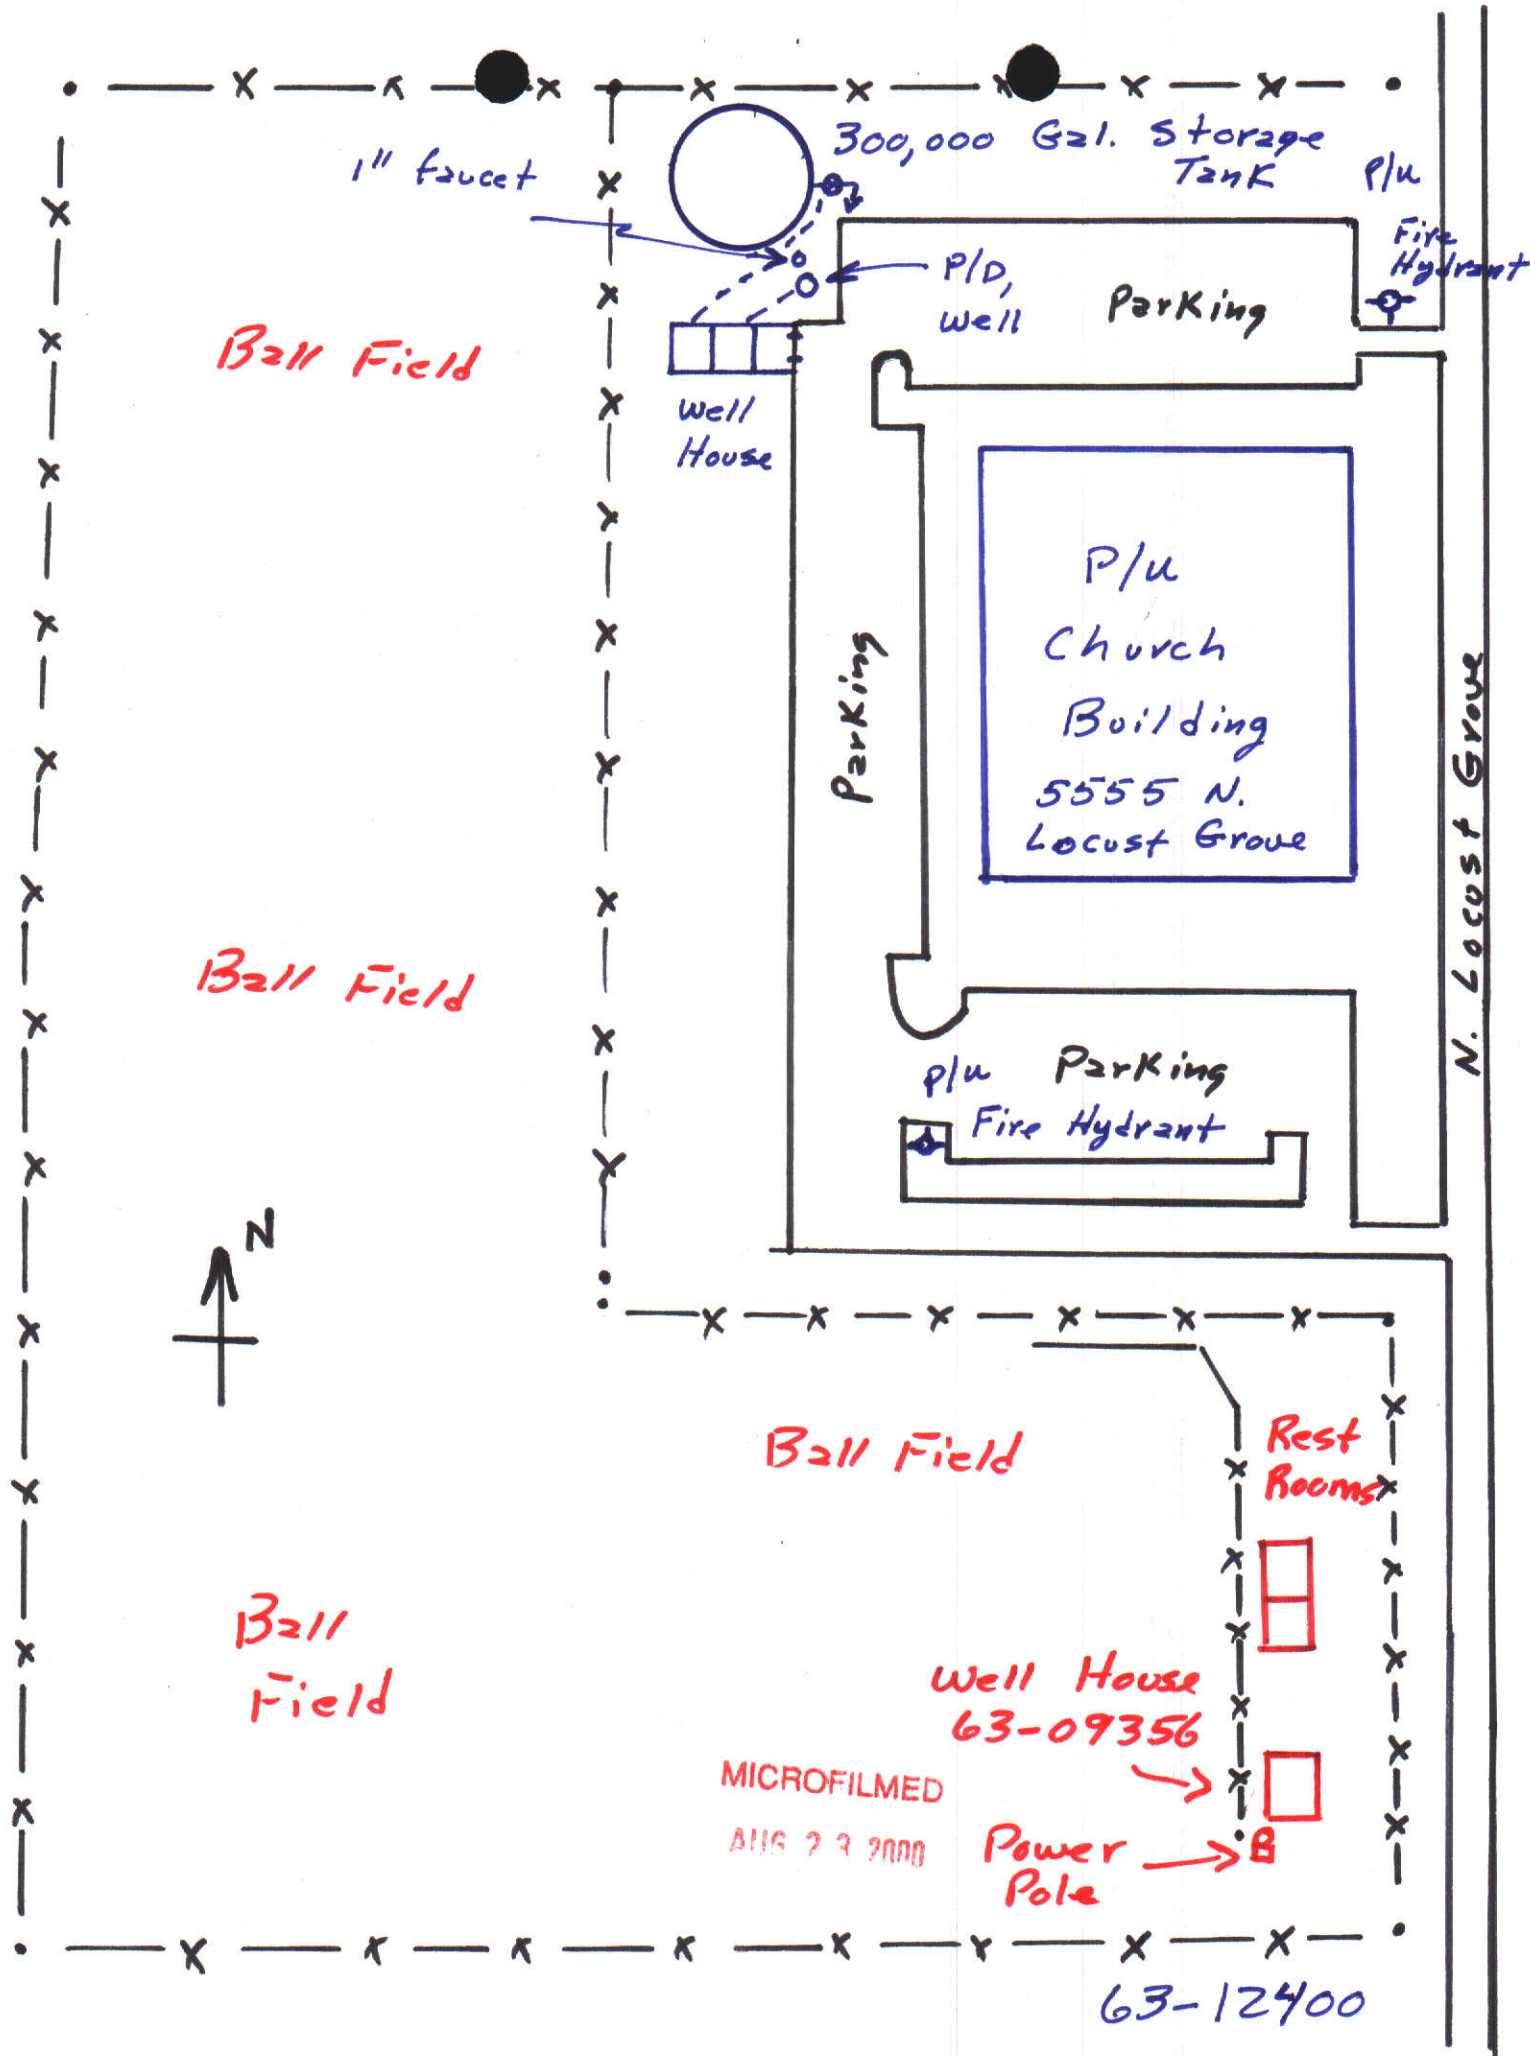

B211 Field

B211 Field



B211 Field

B211 Field

MICROFILMED

AUG 23 2000

Well House
63-09356

Power Pole

63-12400

8. POSSIBLE CONTAMINATION SOURCES:

Is there evidence of Chemigation? ☐ Yes ☒ No

If yes, is there a check-valve present? ☐ Yes ☐ No

Is there a possible source of contamination nearby? ☐ Yes ☒ No

If yes, what Type? _____

How far away from the well is this source? _____

9. REMARKS: This well is located at 5555 N.
Locust Grove.

Dan Tomich, Water Rights Examiner
Signature of Dept. Representative & Title

2-23-00
Inspection Date

PHOTOS, DRAWINGS, OTHER ATTACHMENTS:



MICROFILMED

1 of 5

P/D

Well House,
Well.

(center)

300,000
Gal.

Storage
Tank



View Looking West

P/D

Well +
1" faucet.

Well
House
+
Tank



MICROFILMED

AUG 23 2000

63-12400



2 of 5

P/D

Well
House

8" Line
(Black)
from Well
and in-
Line
Booster
Pump ①



P/D

Well
House

Air
Tanks +
2" Line
for
Church
building

MICROFILMED 63-12400

116 232000

3 of 5

P/D

Well House.

8" Line
from well
on left.

Domestic
System -
Air Tanks,
etc. in
back.



Fire System
on Right.



Fire System.

Note

Diesel
Engine
on
left.

MICROFILMED

APR 23 2000

63-12400



4 of 5

P/u

Church
Building.

Fine
Hydrent.

View
Looking
SW



P/u

Church
Building

View
Looking
NW

MICROFILMED
AUG 23 2000

63-12400

5 of 5



Well
House
at
Ball
Field
for
63-09356.

View Looking North



P/D
Another
photo
of
Well
+
Tanks

MACROFILMED

AUG 23 2000

63-12400

State of Idaho
Department of Water Resources
Water Right License

WATER RIGHT NO. 63-12400

Priority: April 22, 1997

Maximum Diversion Rate:

0.22 CFS

Maximum Diversion Volume:

5.7 AF

This is to certify, that CHURCH OF JESUS CHRIST LATTER DAY SAINTS
CORP OF THE PRESIDING BISHOP
50 E NORTH TEMPLE
SALT LAKE CITY UT 84150

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated February 6, 1997; and has submitted Proof of Beneficial Use on November 15, 1997. An examination indicates that the works have a diversion capacity of 0.630 cfs of water from a GROUNDWATER source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	0.04 CFS	5.7 AF
FIRE PROTECTION	01/01 to 12/31	0.22 CFS	
	Totals	0.22 CFS	5.7 AF

LOCATION OF POINT(S) OF DIVERSION:

NESE , Sec. 30, Township 04N, Range 01E
ADA County

PLACE OF USE: DOMESTIC

TWN RGE SEC

04N 01E 30 NESE

PLACE OF USE: FIRE PROTECTION

TWN RGE SEC

04N 01E 30 NESE


CONDITIONS OF APPROVAL AND REMARKS

1. Water shall not be diverted for fire protection use under this right except to fight or repel an existing fire.
2. Domestic use is for a church and does not include lawn, garden, landscape, or other types of irrigation.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. The water right confirmed by this license is subject to all prior water rights and shall be administered in accordance with Idaho law and applicable rules of the Department of Water Resources. Signed and sealed this 6th day of

JUNE, 2000.

MICROFILMED

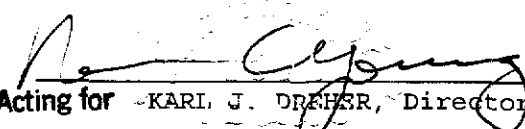Acting for  KARL J. DREHER, Director

IN THE MATTER OF PERMIT NO. 63-12400) **ORDER OF**
)
IN THE NAME OF CHURCH OF JESUS CHRIST) **REINSTATEMENT**
OF LATTER DAY SAINTS)
)

MICROFILMED
JAN 28 2002

RECEIVED

NOV 15 1999

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

#547-2547

Department of Water Resources

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or be accompanied by a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 63-12400 Telephone No. 801 240-4656
2. Name(s) of Permit Holder(s): Corporation of the Presiding Bishop of The Church of Jesus Christ of Latter-day Saints, a Utah corporation sole
3. Mailing Address: 50 E North Temple Salt Lake City, Ut 84150-6320
4. Source of Water: Groundwater If **GROUNDWATER** (well), Date Drilled: mo. 10 / yr. 97
- a. Well Driller: Adamson Pump & Drilling Drilling Permit Number: 63 - 97 - C - 0549-000
- b. **OPTIONAL:**
Pump Horsepower: 7.5 Pressure (psi): 75 Dynamic pumping level (ft): N/A Air Lifted
5. Use(s) (as authorized by the water right permit):
Domestic (No. of households): Church Stockwater (No. and type of stock): None
Irrigation (No. of acres): None Other: Fire Protection
6. Total rate of diversion and/or volume for which proof is submitted: 0.22 cfs OR acre feet
7. Measuring Device Requirement: (refer to the approval conditions on your permit and respond accordingly)
(This question is not optional. Please check either yes or no. Proofs returned not checked accordingly, will be considered incomplete)
Not Mentioned(MGP)
Measuring Device: Is a measuring device required? Yes or No X
Has the measuring device been installed? Yes or No X
Flow Measurement Port: Is a flow measurement port required? Yes or No X
Has the measurement port been installed? Yes or No X
8. Fee Enclosed: \$ 100.00 (See Fee Schedule on back of the instructions for filing proof of beneficial use)
9. Person to contact to accompany the Department representative during field examination of the water system.
Name: Richard Saxton Telephone Number: 208 433-1011
Address: 2710 Sunrise Rim Rd Suite 210 Boise, Id 83705
Fax 208 433-1016
10. The information given on this form is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the State of Idaho.

Signature of permit holder:

[Signature] AUTHORIZED AGENT
(include your title, if on behalf of company or organization)
GSC
FILMED
JAN 28 2000

Date: 11/11/99

State of Idaho
Department of Water Resources
Permit To Appropriate Water

NO. 63-12400

Proposed Priority: February 6, 1997

Maximum Diversion Rate:

0.22 CFS

This is to certify, that CHURCH OF JESUS CHRIST LATTER DAY SAINTS
CORP OF THE PRESIDING BISHOP
50 E NORTH TEMPLE
SALT LAKE CITY UT 84150

has applied for a permit to appropriate water from: GROUNDWATER

and a permit is APPROVED for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
DOMESTIC	01/01 to 12/31	0.04 CFS
FIRE PROTECTION	01/01 to 12/31	0.22 CFS
	Totals	0.22 CFS

LOCATION OF POINT(S) OF DIVERSION:

NESE , Sec. 30, Township 04N, Range 01E
ADA County

PLACE OF USE: DOMESTIC

TWN RGE SEC

04N 01E 30 NESE


PLACE OF USE: FIRE PROTECTION, same as DOMESTIC use

CONDITIONS OF APPROVAL AND REMARKS

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before September 1, 1999.
2. Subject to all prior water rights.
3. Project construction shall commence within one year from the date of permit issuance and shall proceed diligently to completion unless it can be shown to the satisfaction of the Director of the Department of Water Resources that delays were due to circumstances over which permit holder had no control.
4. Water shall not be diverted for fire protection use under this right except to fight or repel an existing fire.
5. Domestic use is for a church and does not include lawn, garden, landscape, or other types of irrigation.
6. Water bearing zone to be appropriated is 200 feet.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the signature of the Director, affixed at Boise, this

29th day of August, 1997.

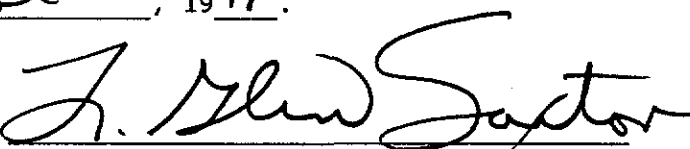
Karl J. Dreher, Director
for

Form 202
10/92Ident. No. 63-12400

RECEIVED

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

RECEIVED

FEB 07 1997

FEB 06 1997

WATER RESOURCES
WESTERN REGION

To appropriate the public waters of the State of Idaho

Department of Water Resources

1. Name of applicant CORPORATION OF THE PRESIDING BISHOP OF
THE CHURCH OF JESUS CHRIST OF LATTER DAY SAINTS Phone (208) 342-2735
 Post office address 50 EAST NORTH TEMPLE STREET, SALT LAKE CITY, UTAH 84150

2. Source of water supply GROUNDWATER which is a tributary of _____

3. Location of point of diversion is NE $\frac{1}{4}$ of NE $\frac{1}{4}$ of SE $\frac{1}{4}$, Govt. Lot _____
 Sec. 30 Township 4 N. Range 1 E. B.M. ADA County; additional
 points of diversion if any: _____

4. Water will be used for the following purposes:

Amount 0.04 CFS for DOMESTIC purposes from JAN 1 to DEC 31 (both dates inclusive)
 (cfs or acre-feet per annum)

Amount .22 for Fire protection purposes from " to " (both dates inclusive)
 (cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
 (cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
 (cfs or acre-feet per annum)

5. Total quantity to be appropriated is (a) 0.22 and/or (b) _____
 cubic feet per second acre feet per annum

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc. pump + pipeline

b. Height of storage dam N/A feet; active reservoir capacity _____ acre-feet; total
 reservoir capacity N/A acre-feet; period of year when water will be diverted to storage:
 _____ to _____ inclusive.

c. Proposed well diameter is 8 inches; proposed depth of well is 200 feet.

d. Is ground water with a temperature of greater than 85°F being sought? _____

e. If well is already drilled, when? N/A; Drilling firm _____;

Well was drilled for (well owner) _____

7. Time required for the completion of the works and application of the water to be proposed beneficial use is

2 years (minimum 1 year).

* per FAXES & telecons 2/25 - 6/17 1997 with
 Briggs Eng. (consultant). -82

iper
 tops →

8. Description of proposed uses (if irrigation only, go to item 9):

- a. Hydropower; show total feet of head and proposed capacity in KW. _____
- b. Stockwatering; list number and kind of livestock. _____
- c. Municipal; show name of municipality. _____
- d. Domestic; show number of households. church building *
- e. Other; describe fully. CULINARY WATER AND FIRE PROTECTION FOR CHURCH BUILDING.

9. Description of place of use:

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RANGE	SEC.	NE¼				NW¼				SW¼				SE¼				TOTALS
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	
4N	1E	30													*				

Total number of acres to be irrigated 0

10. Describe any other water rights used for the same purposes as described above. NONE

11. a. Who owns the property at the point of diversion? LDS CHURCH

b. Who owns the land to be irrigated or place of use? LDS CHURCH

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing. _____


12. Remarks: Water bearing zone to be appropriated is ~~about~~ 0 to 200 feet. *

COMMENTS: Internal use only. Irrigation per 63-09356 (separate system).

Fire pit does not require mitigation as shown 63-12343.

SEP 11 1997 * per Gage. Train for 6/16/97 -82

13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

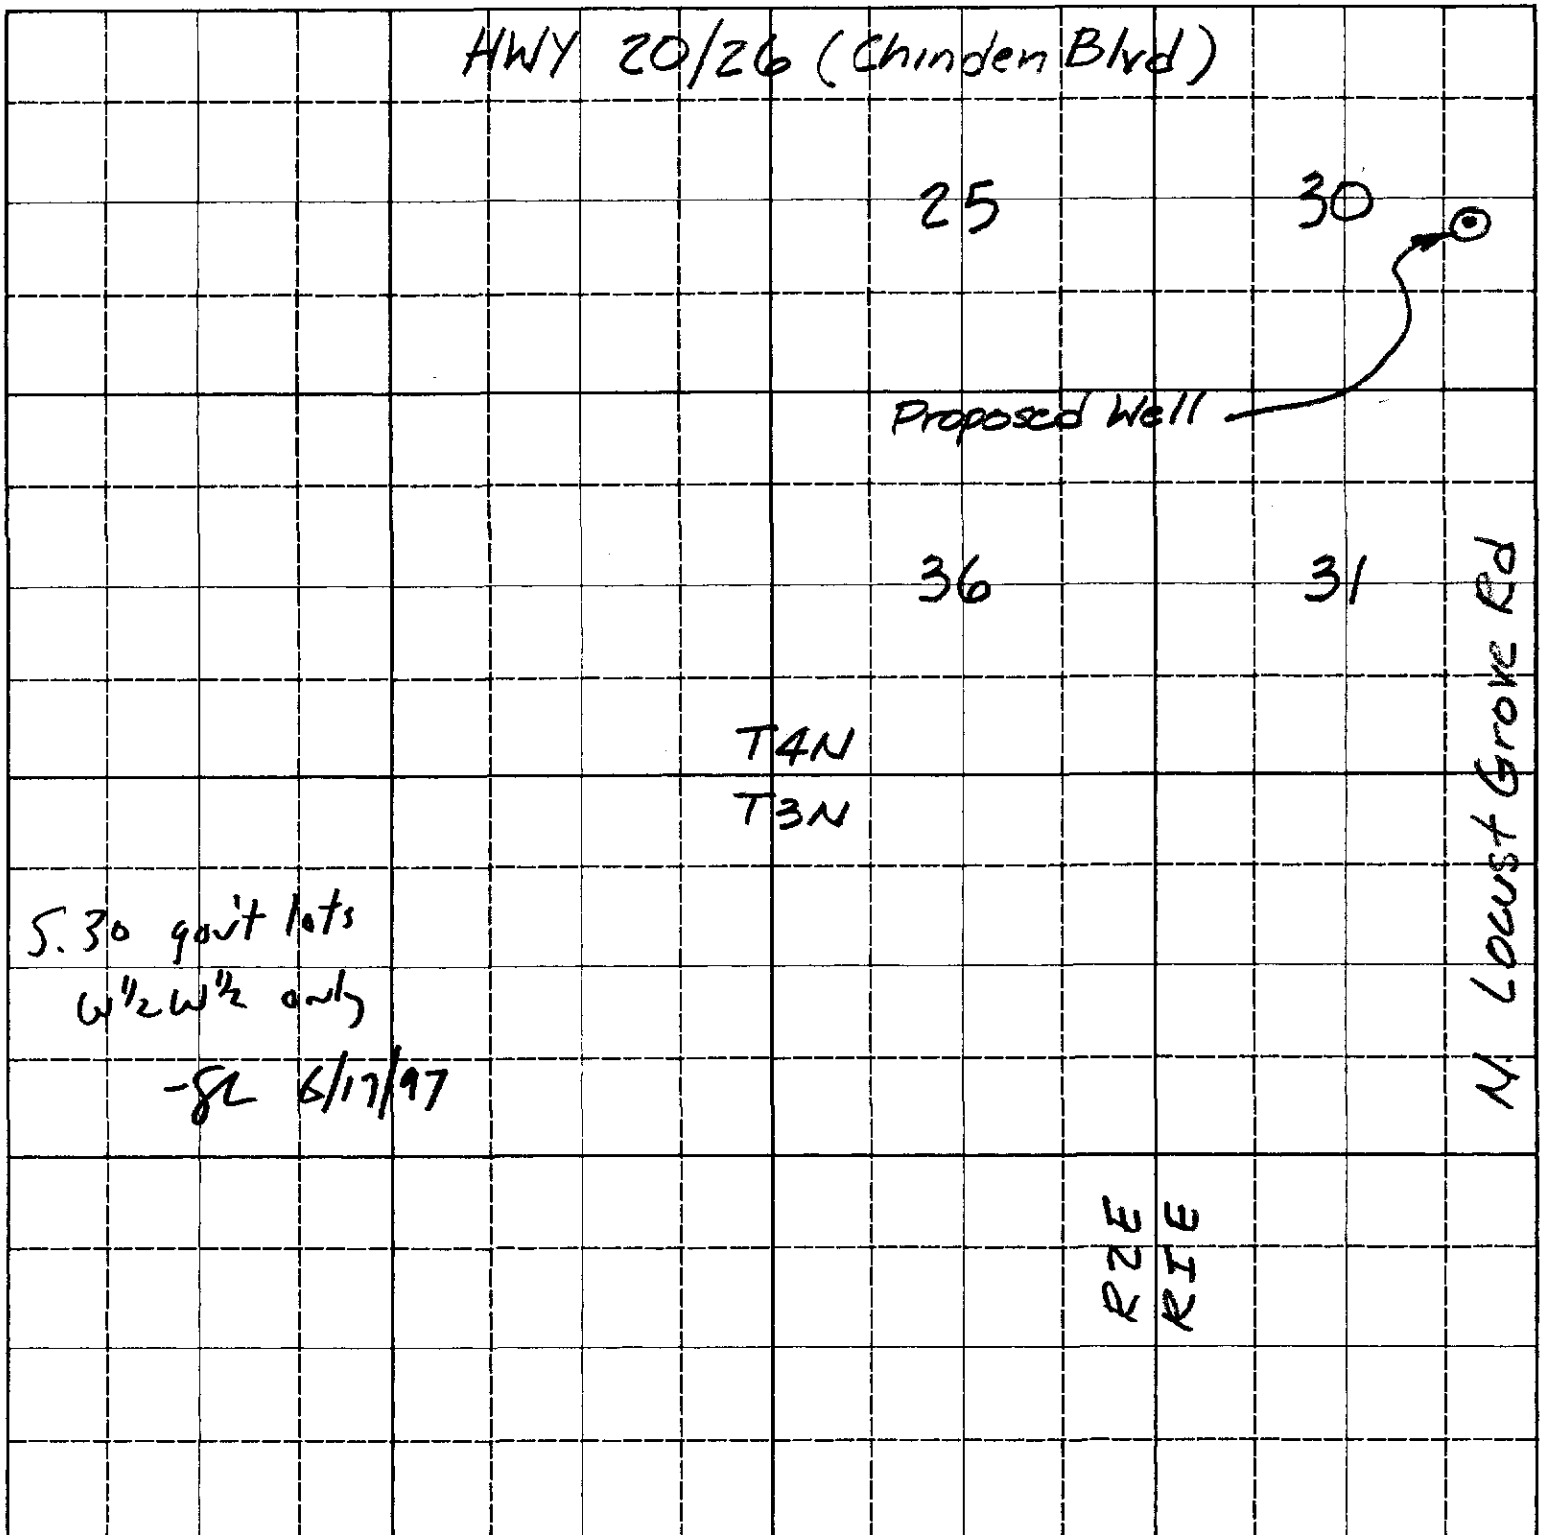

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

X Richard L. Maurer
(Applicant)

Received by H Date 2/6/97 Time 3:45 Preliminary check by SL
Fee \$ 100 Receipted by lt # 103934 Date 2/6/97
Publication prepared by AT Date 6-25-97 Published in Id. Statesman
Publication approved AT Date 7-22-97 7-3-10-97

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. _____, and said application is hereby _____.

1. Approval of said application is subject to the following limitations and conditions:

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
- b. Proof of construction of works and application of water to beneficial use shall be submitted on or before _____, 19 ____.
- c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.
- d. The water right acquired under this permit if for hydropower purposes shall be junior and subordinate to all rights to the use of water, other than hydropower, within the State of Idaho that are initiated later in time than the priority of this permit and shall not give rise to any right or claim against any future rights to the use of water, other than hydropower, within the State of Idaho initiated later in time than the priority of this permit.
- e. Other:

RECEIVED
SEP 11 1997



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. Box 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

June 8, 2000

DIRK KEMPTHORNE
GOVERNOR

KARL J. DREHER
DIRECTOR

CHURCH OF JESUS CHRIST LATTER DAY SAINTS
CORP OF THE PRESIDING BISHOP
50 E NORTH TEMPLE
SALT LAKE CITY UT 84150

RE: WATER RIGHT NO. 63-12400

Dear Water Right Holder(s):

The Department of Water Resources (the Department) has issued the enclosed license confirming that a water right has been established in accordance with the permit referenced above. The license is a preliminary order issued by the Department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department unless a party petitions for reconsideration or files an exception and/or brief as described in the enclosed information sheet.

Also, please note that water right owners are required to report any change of water right ownership and/or change of mailing address to the department within 120 days of the change. Failure to report these changes could result in a \$100 late filing fee. Contact any office of the department or visit the department's homepage on the Internet to obtain the proper reporting form.

If you have any questions, please call me at 208-327-7946.

Sincerely,

Shelley W. Keen
Water Rights Supervisor

SK:klt

Enclosure

MICROFILMED


AUG 23 2000

CERTIFICATE OF MAILING

I hereby certify that on the 8th day of June, 2000, I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER (Approved License) to the person(s) listed below:

Water Right No. 63-12400

CHURCH OF JESUS CHRIST LATTER DAY SAINTS
CORP OF THE PRESIDING BISHOP
50 E NORTH TEMPLE
SALT LAKE CITY UT 84150

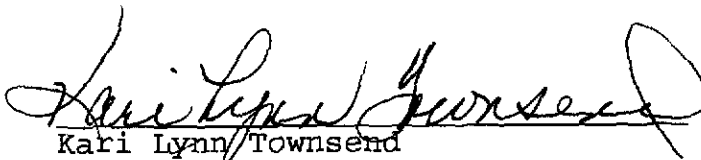
Kari Lynn Townsend
Secretary

MICROFILMED

AUG 23 2000

**EXPLANATORY INFORMATION
TO ACCOMPANY A
PRELIMINARY ORDER**

The accompanying order or approved document is a "Preliminary Order" issued by the department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department of Water Resources (department) unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the department or the Idaho Water Resource Board (Board) is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01303 (Rules of Procedure 302 and 303).

MICROFILMED

AUG 23 2006

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

MICROFILMED
AUG 23 2000

SD-0420-2
MODIFY RECORD

Idaho Department of Water Resources
Modify Comment

Date: 06/01/00
Time: 16:12:16

Water Right Number: L63-12400

Comment Date: 6/ 1/2000 User ID: SKEEN

Subject: License Review

Licensing review and data entry by S. Keen 6/1/2000. Right
63-09356 is for irrigation and domestic use in the restrooms at
the baseball field.

(Enter=Continue/Exit) (Gold2=Update) (Gold3=Delete) (Gold4=Prev) (Gold5=Next)


[illegible]

MICROFILMED

2005-2-3 2005

Well House

3. Delivery System Diagram: Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

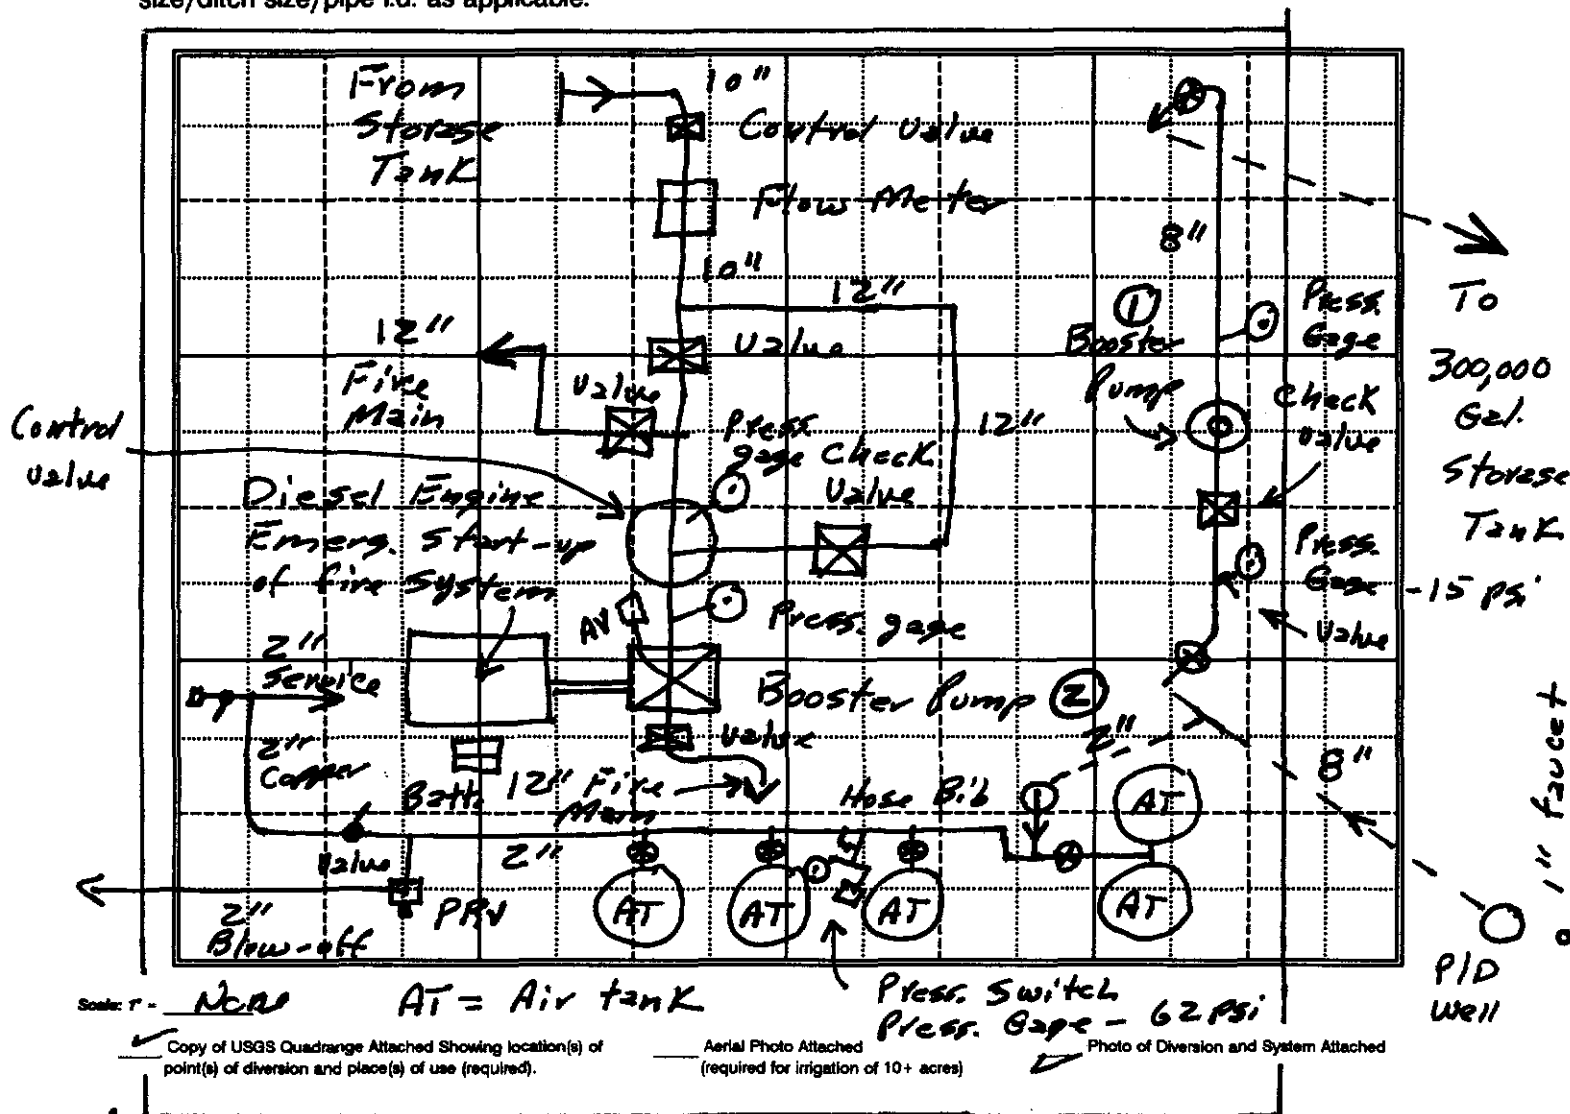

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
Well	Franklin	5 1/2		Gould	70607
Booster (1)	U.S. Electr.	5	391842-932		158A
Booster (2)	(Diesel)			Aurora	180A060

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
Flow meter		Gerard	K-2000-8	413-97F	8"	
		Engr.				

2. Measurements: None - op. press. : 15 psi min from well pump to in-line Booster Pump

MICROFILM

AUG 23 2000

5. Cond 6 - Water Bearing Zone: 200' feet.

Well screens at 167'-182'.

E. NARRATIVE/REMARKS/COMMENTS

1. This Permit is for fire protection and domestic (internal) water use at the Church building at 5555 N. Locust Grove. There are two fire hydrants; and internal use is: 5 bathrooms, 1 Kitchen, 6 fountains, and one "wet closet".

2. The well pumps water to a 300,000 gal. Storage tank. The storage tank would be used in event of a fire. The well pump operates at low pressure (15 psi), and a 5 HP in-line Booster Pump (1), pumps into the tank. From the tank, fire water would be pumped to two 12" fire mains to the 2 hydrants.

A 2" line provides water to the building. There is another Booster Pump (2) that would provide water to the fire mains in the event of a power outage. This pump receives power from an emergency Diesel engine.

3. Irrigation water to the Church grounds and adjacent ball fields is provided by a well located at the South ball field under WR 63-09356. This well also provides water to restrooms and drinking fountains at the ball fields (domestic too).

4. WR 63-03294 includes 39 AC. of irrigation from an old well for the N.E.S.E., Sec. 30. This land was

Have conditions of permit approval been met? ☒ yes ☐ no Note Cond. 6

once the old Church Welfare Farm. The Church kept 10 AC. for the new building & ball fields and sold the rest of the property. At present, water from this old well (1960's?) is not being used at the Church grounds.

63-03294
= 112 AC.
irrigation
from
another
well

Additional Computation Sheets Attached

Measured Method: None - Theoretical Cal. - 15 PSI normal div. press.

$$Q = \frac{(8.8)(5\frac{1}{2} \text{ HP})(70\%) }{19' + (15 \text{ PSI}')(\frac{34'}{14.7 \text{ PSI}'})} = 0.63 \text{ cfs} > 0.22 \text{ cfs}$$

G. VOLUME CALCULATIONS

@ 50 psi, $\phi = 0.25 \text{ cfs} > 0.22 \text{ cfs}$
(During fire)

1. Volume Calculations for Irrigation:

$$V_{LR} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$$

$$V_{DR} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 =$$

$V = \text{Smaller of } V_{LB} \text{ and } V_{DB} =$

2. Volume Calculations for Other Uses:

Internal Domestic

1) 5 Bathrooms; $\left(50 \frac{\text{Gal}}{\text{Day} \cdot \text{Person}} \right) \left(\frac{5}{1} \right) \left(\frac{20 \text{ Person}}{\text{Day}} \right) \left(\frac{365 \text{ Days}}{\text{Ann.}} \right) \left(\frac{\text{AF}}{325,850 \text{ Gal.}} \right)$

$$2) \text{ 1 Kitchen; } \left(\frac{10.681}{\text{person}} \right) \left(\frac{200 \text{ persons}}{\text{event}} \right) \left(\frac{12 \text{ events}}{\text{Ann.}} \right) \left(\frac{AF}{325,850} \right) = 5.6 \text{ AFA}$$

3) 6 fountains; $\left(\frac{10 \text{ Gal}}{\text{Day}}\right) \left(\frac{365 \text{ Days}}{\text{Ann.}}\right) \left(\frac{\text{AF}}{325,850}\right) = 0.01 \text{ AFA}$

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion	Annual Volume
	From	To	Q (cfs)	V (afa)
<u>Domestic</u>	<u>01/01</u>	<u>12/31</u>	<u>0.04</u>	<u>5.7</u>
<u>Fire Protection</u>	<u>01/01</u>	<u>12/31</u>	<u>0.22</u>	
		Totals:	<u>0.22</u>	<u>5.7</u>

2. Recommended Amendments

___ Change P.D. as reflected above ___ Add P.D. as reflected above ☒ None
 ___ Change P.U. as reflected above ___ Add P.U. as reflected above ___ Other

Note: The building is a stake, and is used every day.

I. AUTHENTICATION


Field Examiner's Name Wes Tomich Date 2-28-00

Reviewer _____ Date _____

SEAL

MICROFILMED

AUG 23 2000

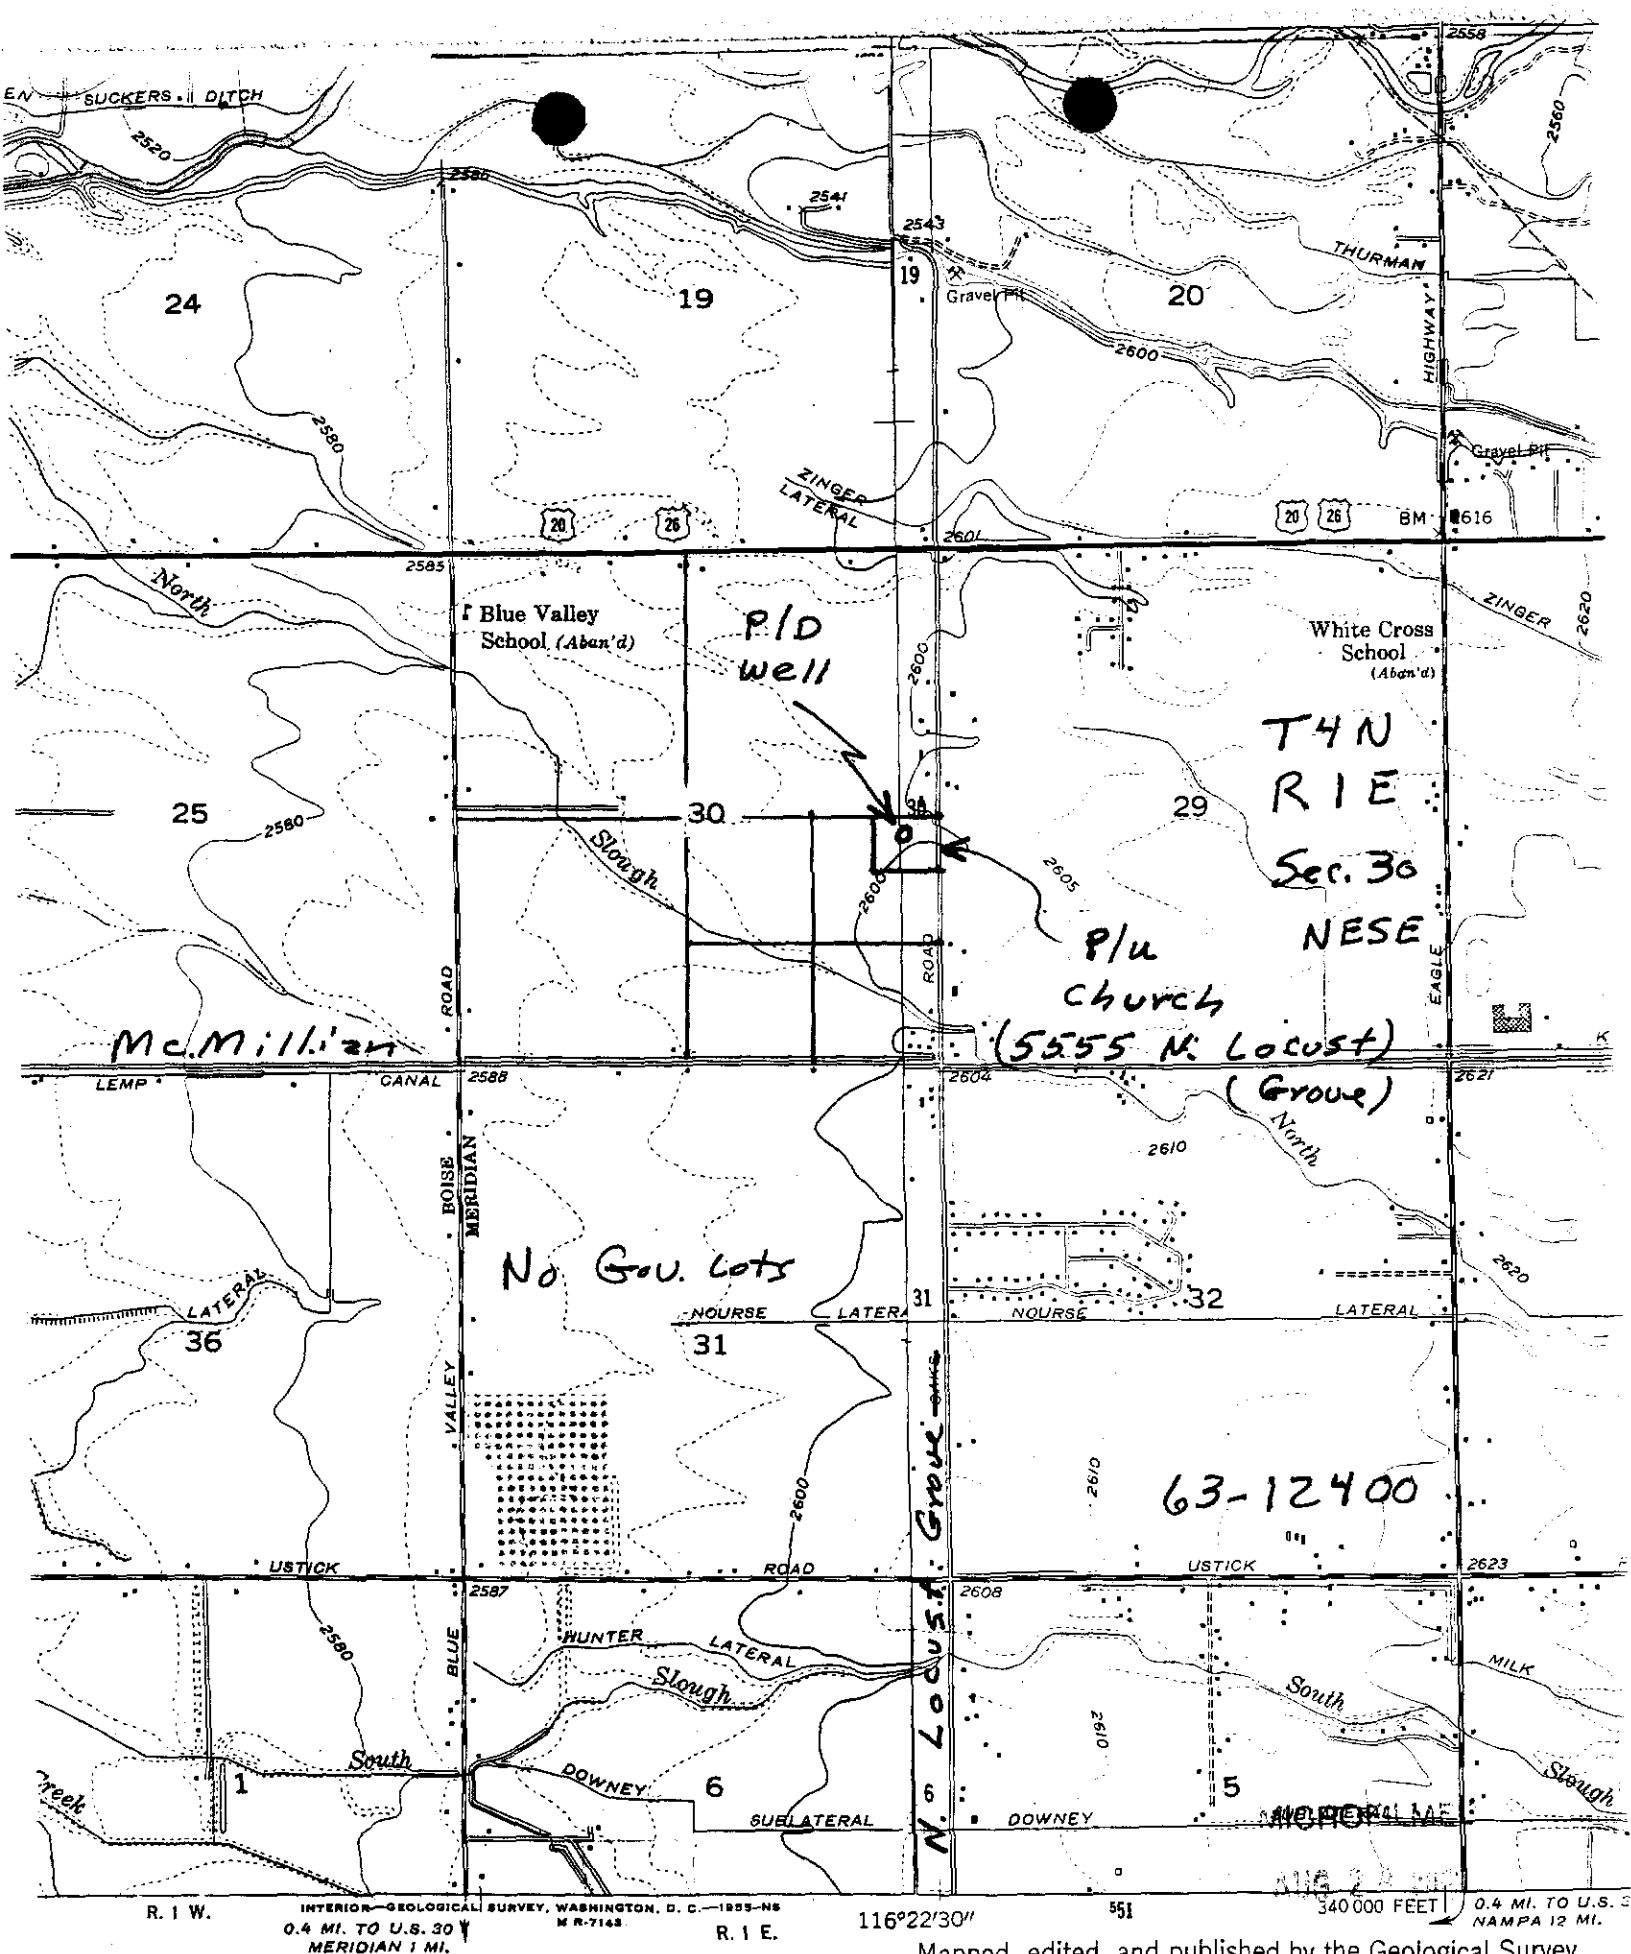


Mapped, edited, and published by the Geological Survey
Control by USGS and USC&GS

ROAD CLASSIFICATION

Heavy-duty	4 LANE 16 LANE	Light-duty	Topography from aerial photographs by multiplex methods
Medium-duty	4 LANE 16 LANE	Unimproved dirt	and by plane-table surveys 1953. Aerial photographs taken 1951

P. 1927 North American datum

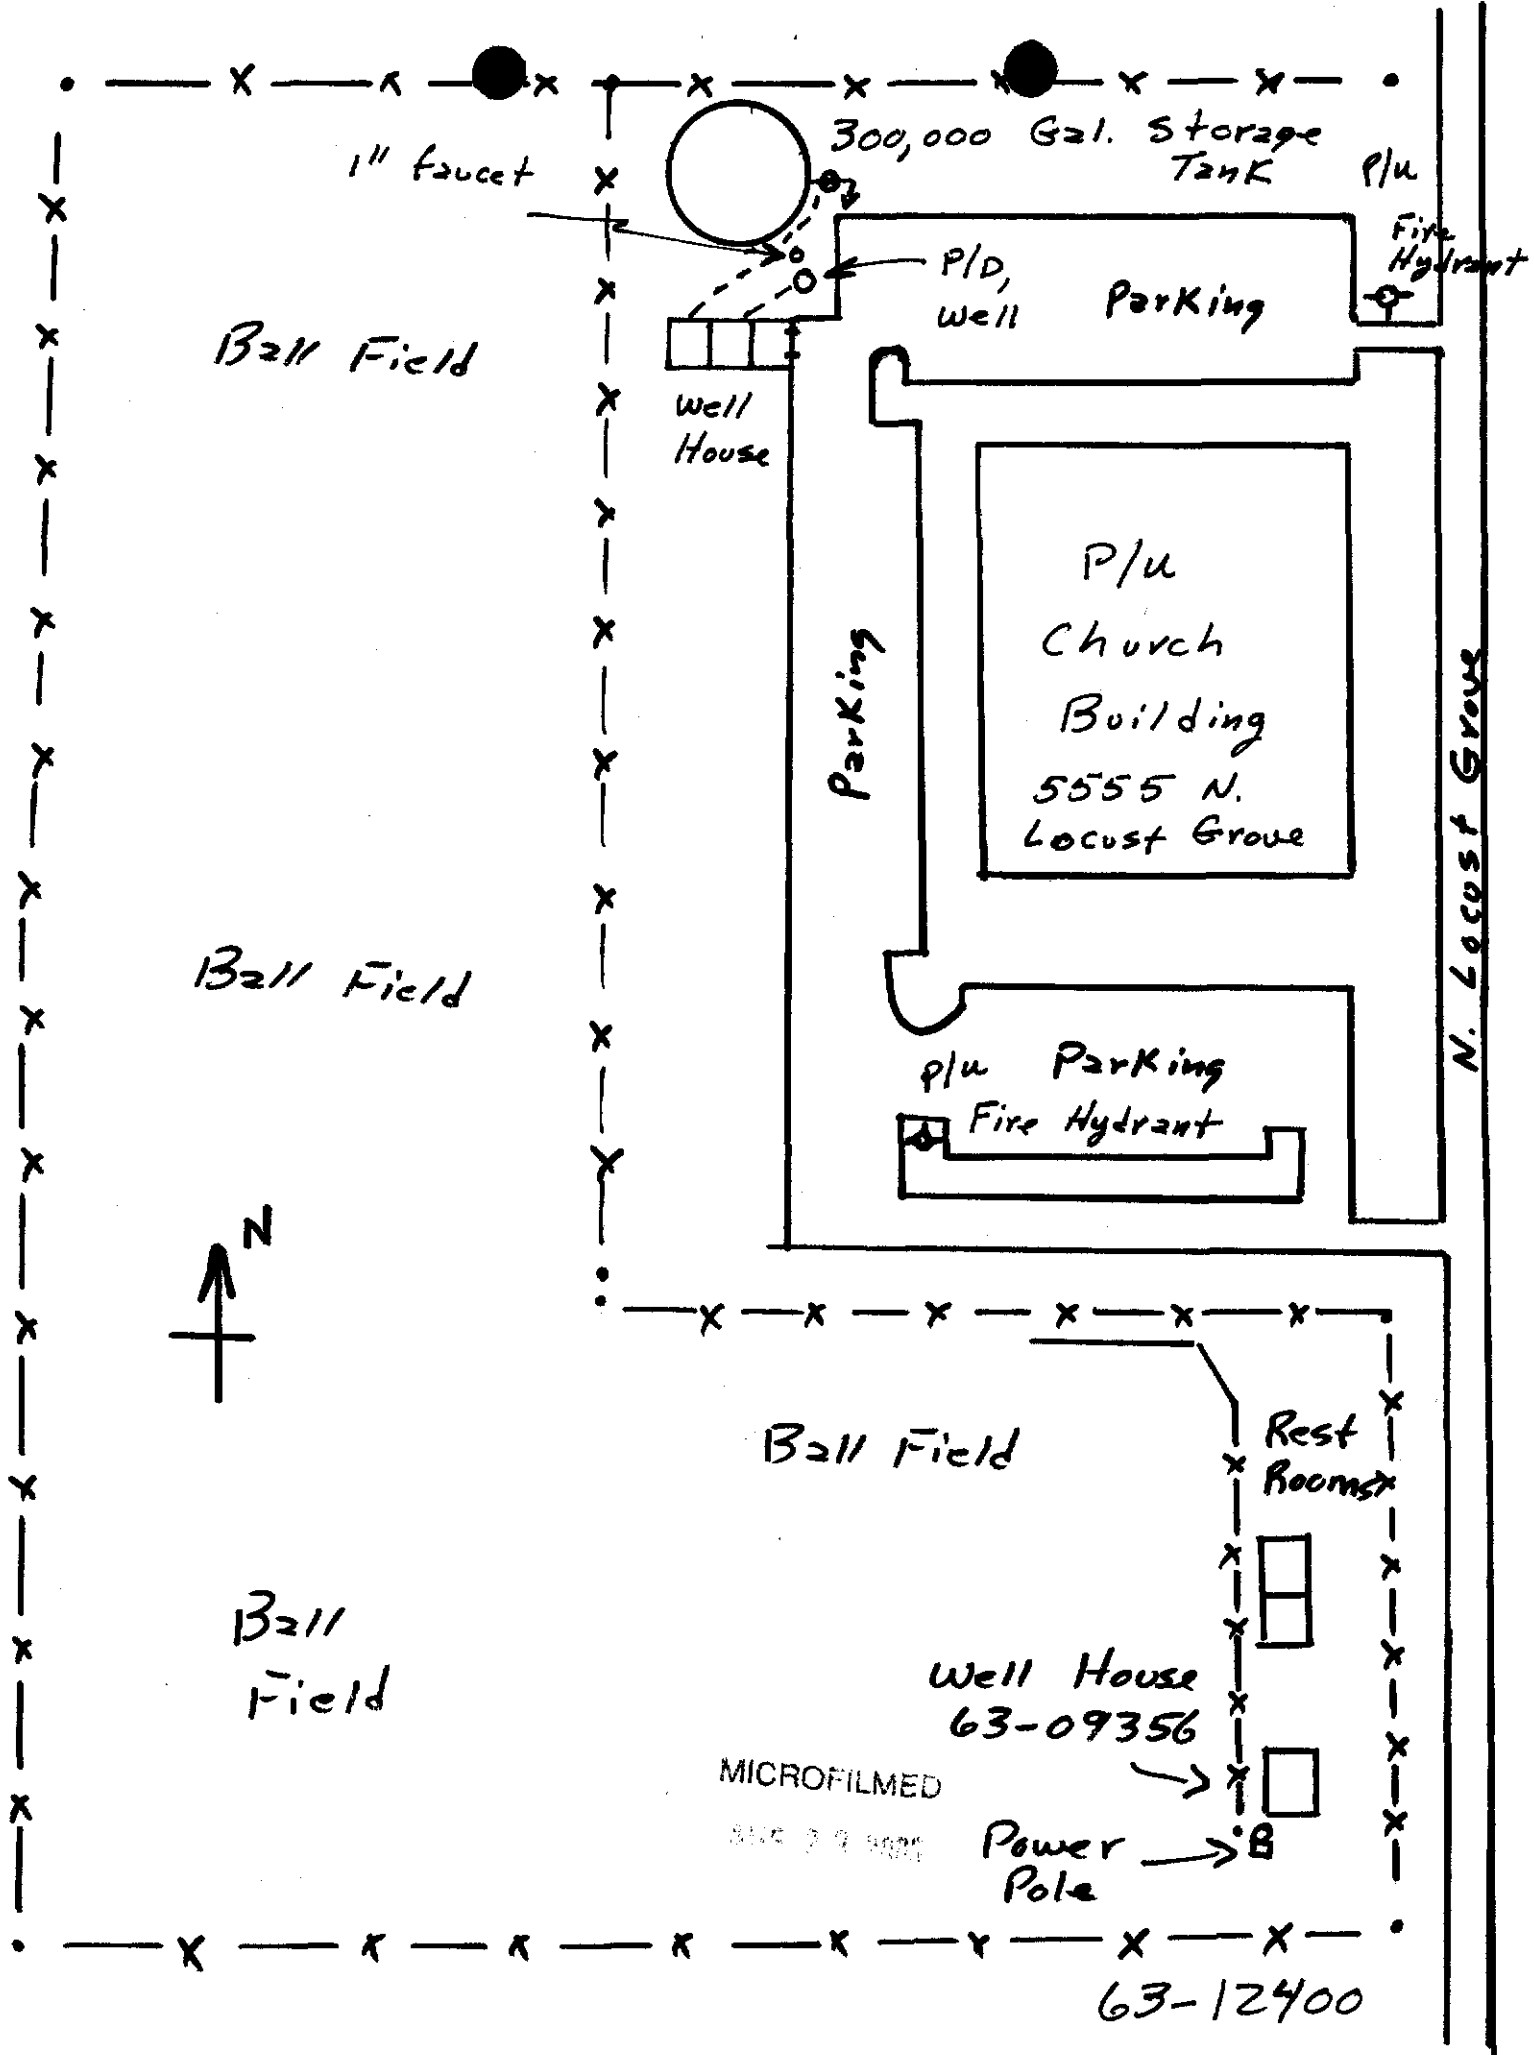

IDAHO DEPARTMENT OF WATER RESOURCES

WELL INSPECTION FORM

1. DRILLING PERMIT NO: 63-99-C-0549-000 OTHER APPLICABLE NO: 6312400
(801) 240-4656
2. OWNER: Church of Jesus Christ Latter Day Saints Phone: (208) 467-2421
Address: 50 E. Temple, Salt Lake City, UT 84150
North
3. WELL LOCATION: Twp 4N, Rge. 1E, Sec. 30, NE 1/4 SE 1/4
County Ada (Provide sketch map and photo on reverse.)
4. DRILLER: Adamsen Pump & Drilling Lic. No. 457
When Drilled? 10-7-97 to 10-10-97
5. WELL CONSTRUCTION:
Casing Diameter 8 inches Water tight cap? ☒ Yes ☐ No Access Port: ☐ Yes ☒ No
Casing $\geq$ 12 inches above ground? ☒ Yes ☐ No - Describe _____
Depth of Casing 158 ft. Method Drilled Air Rotary
Condition of Well Casing: ☒ Good ☐ Fair ☐ Poor Describe New
Control Valve? ☒ Yes ☐ No Pressure Gauge: ☒ Yes ☐ No
Condition of Piping and Valving New
Auger to a depth of _____ ft. Evidence of Annular Seal ☒ Yes ☐ No
Are there obvious construction problems that may be a source for contamination or waste of water?
☐ Yes ☒ No (Describe in Remarks and Attach Photo - On Reverse)
6. HYDROLOGIC INFORMATION:
Depth to Static Water 19 ft. Water Temperature 58 °F
Flowing Artesian ☐ Yes ☒ No Pressure: _____ (psi)
Water Sample Taken? ☐ Yes ☒ No If yes, describe purpose _____
Water Quality Measurements/Observations (Describe) _____
7. WELL USE: Church Building
☒ Domestic ☐ Irrigation ☐ Stock
☐ Test ☐ Municipal ☐ Industrial
☐ Abandoned ☐ Waste Disposal/Injection ☐ Not Used
☒ Other: Fire Protection

8. POSSIBLE CONTAMINATION SOURCES:

Is there evidence of Chemigation? ☐ Yes ☒ No

If yes, is there a check-valve present? ☐ Yes ☐ No

Is there a possible source of contamination nearby? ☐ Yes ☒ No

If yes, what Type? _____


How far away from the well is this source? _____

9. REMARKS: This well is located at 5555 N.
Locust Grove.

Dan Tomich Water Rights Examiner
Signature of Dept. Representative & Title

2-23-00
Inspection Date

PHOTOS, DRAWINGS, OTHER ATTACHMENTS:

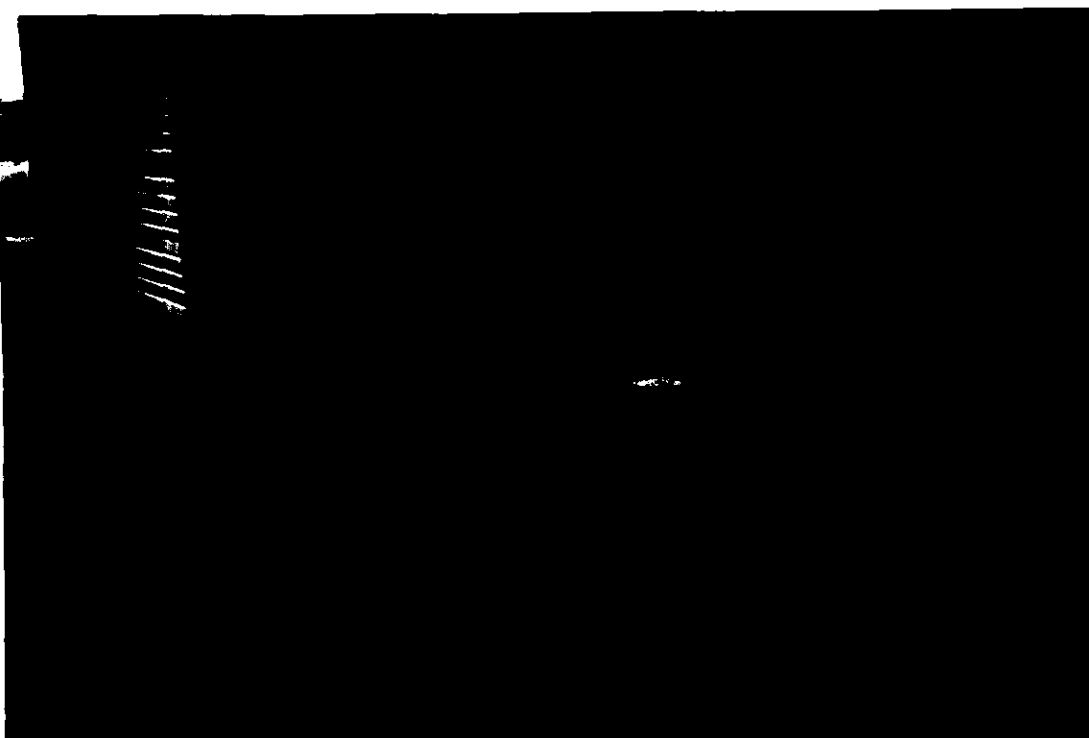

MICROFILMED

AUG 23 2000

1 of 5


P/D

Well House,
Well.

(center)

300,000
Gal.

Storage
Tank

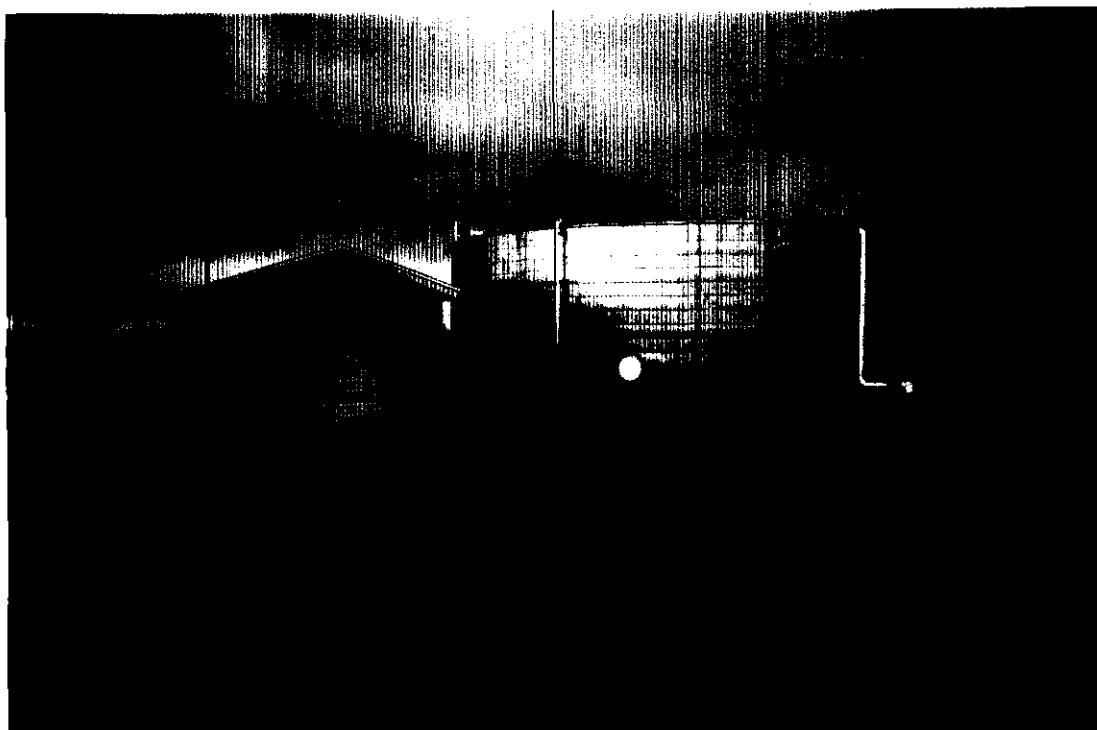


View Looking West

P/D

Well +
1" faucet.

Well
House
+
Tank

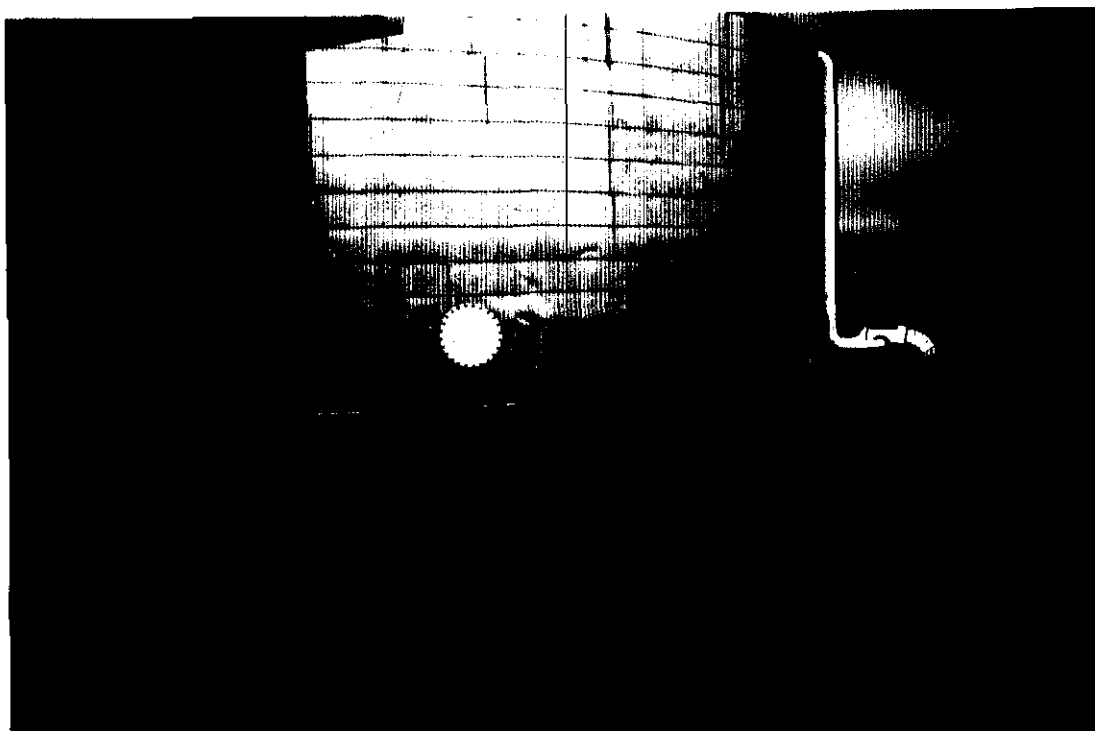

MICROFILMED

NOV 21 1980

63-12400

2 of 5

P10

Well

House

8" Line
(Black)

from Well
and in-
line

Booster
Pump ①




P10

Well

House

Air
Tanks +
2" Line
for
Church
building

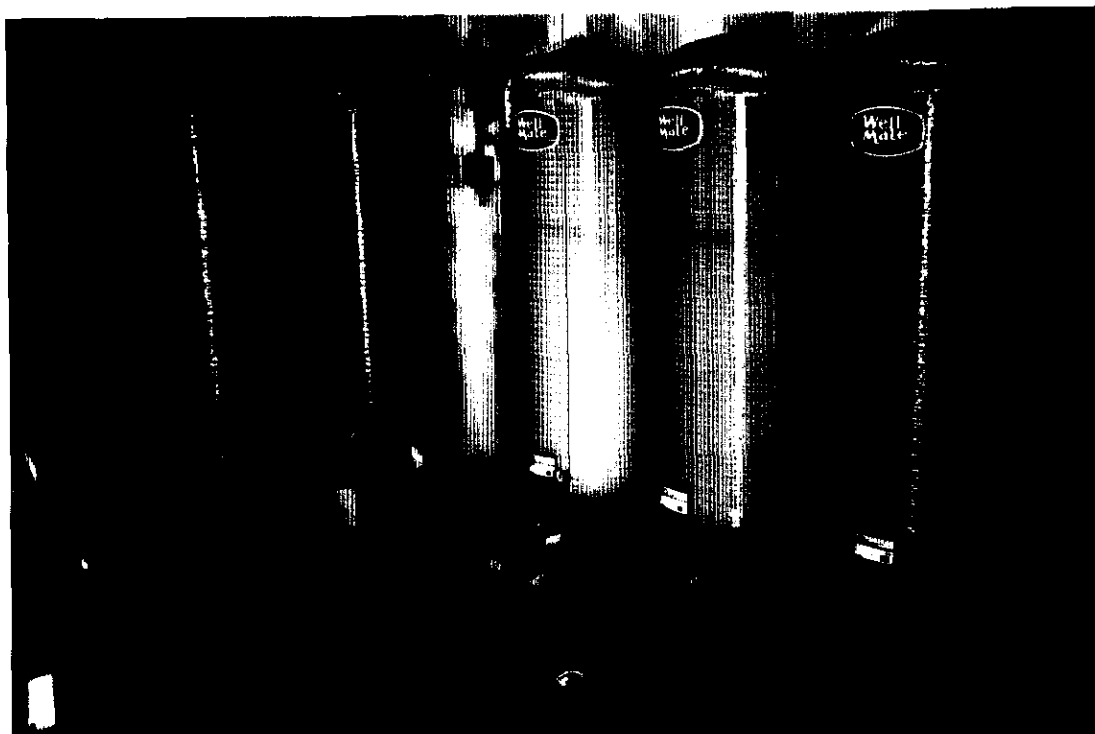

MICROFILMED 63-12400

APR 2 2000

3 of 5


P/D

Well House.

8" Line
from well
on left.

Domestic
System -
Air Tanks,
etc. in
back.

Fire System
on Right.

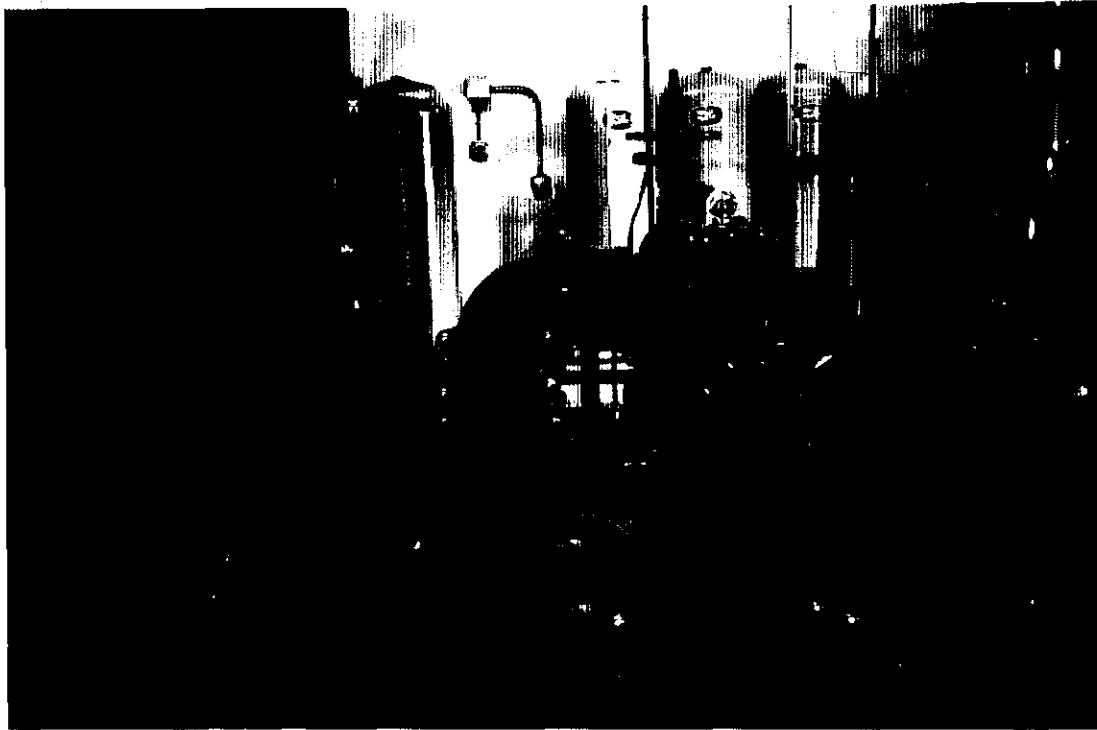

Fire System.

Note

Diesel
Engine
on
left.



REPROFILMED

SEP 23 2000

63-12400

4 of 5

P/u

Church
Building.

Fine
Hydrent.

View
Looking
SW



P/u

Church
Building

View
Looking
NW



MICROFILM

AUG 23 1980


63-12400

5 of 5



Well
House
at
Bell
Field
for
63-09356.

View Looking North

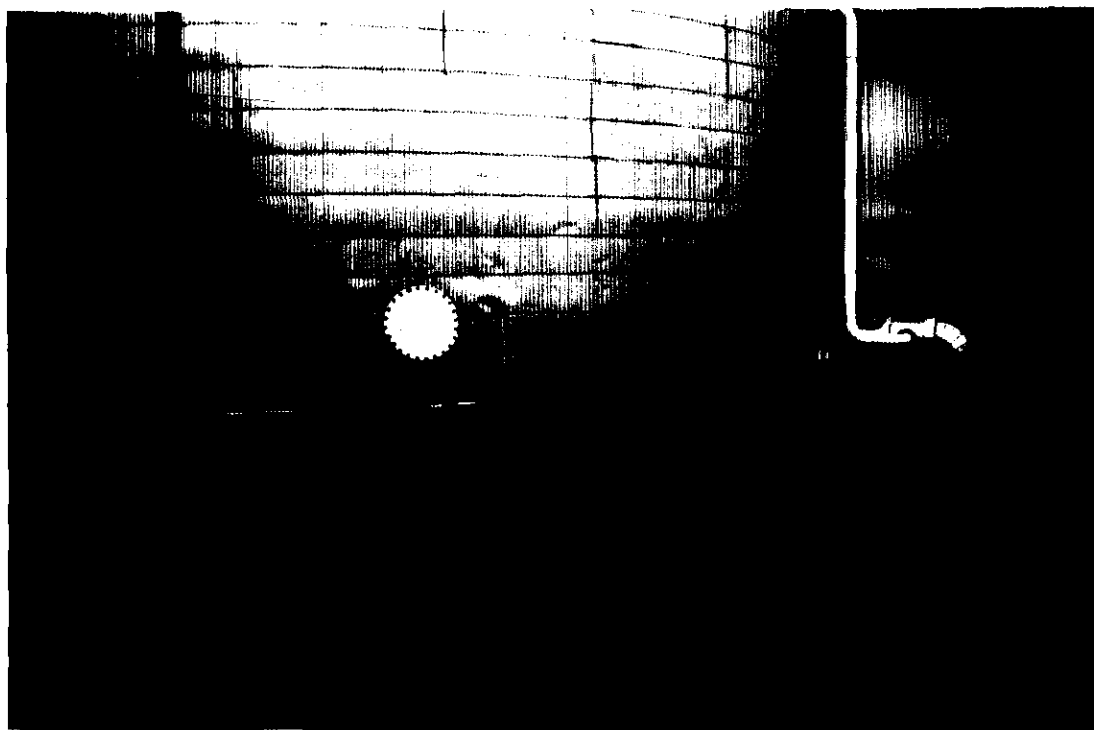

P10
Another
photo
of
well
+
Tanks

OROFILM

AUG 23 2000

63-12400

**ANALYSIS SHEET
FOR
PROOF OF BENEFICIAL USE**

Permit No. 63-12400 Reviewed by [Signature] Date 12-20-99

GENERAL CONSIDERATIONS

TYPES OF USE

yes Name same as permit?
yes Address same as permit?
NO Proof timely received? Correct Uses? yes
If not, complete calculation below.

SOURCE OF WATER

 Surface water source
✓ Ground water source
yes Drilling permit required?
yes Copy in the file? Drilling Permit No. 63-97-C-0549-000
200- Amount paid for permit yes Correct?
yes Well log in the file?

LICENSE EXAMINATION FEE

MEASURING DEVICE

yes Required?
100- Amount Submitted
yes Correct?
NO Required?
 Installed?
 Waiver requested?

PRIORITY CALCULATION

Date proof received 11-15-99 319
Date proof due 9-1-99 - 244 - 75
^{based 9-17-99} No. of days late = 75 in arrears
Priority Date 9-26-97 + 37 7 4/22/97
New Priority Date 4-22-97 112

DEFICIENCIES OR ACTION ITEMS

Reinstate + advance priority to april 22, 1997.
Proof Acceptable.

DATA ENTRY

New Address X Proof Made 11-15-99



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. Box 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

DIRK KEMPTHORNE
GOVERNOR

December 27, 1999

KARL J. DREHER
DIRECTOR

Chruch of Jesus Christ
of Latter Day Saints
50 E North Temple
Salt Lake City UT 84150-6320

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 63-12400

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit.

Enclosed is an order reinstating the permit since proof was submitted after the proof due date. Please note that the priority date has been advanced to April 22, 1997, pursuant to Section 42-218a, Idaho Code.

Please be advised that Section 42-248, Idaho Code, requires you or the owner of this water right to maintain current ownership and address records on file with the department. Forms to file a change of ownership of a water right and/or a change in the address of the water right owner are available from any department office.

The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water. If you have questions concerning the field examination, please contact the **WESTERN** Regional Office of the department in Boise at (208)334-2190.

Sincerely,

JULIE L. YARBROUGH, Administrative Assistant
Water Allocation Bureau

Enclosure

c: IDWR - Region

MICROFILMED
JAN 28 2000

WARNING

CANCELLED OR LAPSED

This permit has been officially CANCELLED or LAPSED.

Ninety days following the date of official action this file will be DESTROYED.

September 17, 1999

CHURCH OF JESUS CHRIST LATTER DAY SAINTS
CORP OF THE PRESIDING BISHOP
50 E NORTH TEMPLE
SALT LAKE CITY UT 84150

LAPSE NOTICE

RE: PERMIT NO. 63-12400

Dear Permit Holder:

You are hereby notified that under the provisions of Section 42-218A, Idaho Code, the above referenced permit has lapsed and is of no further force nor effect. The department provided the proper forms to you in our proof due notice dated June 30, 1999. No further construction or additional development is authorized under this permit unless it is reinstated.

The permit can only be reinstated if you submit an acceptable proof of beneficial use or an acceptable request for extension of time to the department within sixty (60) days of the mailing of this lapse notice. An acceptable proof of beneficial use submittal must include the examination fee or a completed field examination report. A request for extension of time must be accompanied by a fifty dollar (\$50.00) fee.

Enclosed again for your use are a proof of beneficial use form and a request for extension of time form. Please note that only one extension of time can be granted unless the project has not been completed because of lack of a necessary approval by a government agency or by litigation which may bring title to the water in question.

L. GLEN SAXTON
Chief, Water Allocation Bureau

Enclosures

MICROFILMED

JAN 28 2000

CERTIFICATION OF MAILING

I hereby certify that on 9-17-99
~~a copy~~/an original of this document was
deposited in the United States mail,
postage prepaid addressed to the
individual(s) named above.

[Signature]

June 30, 1999

CHURCH OF JESUS CHRIST LATTER DAY SAINTS
CORP OF THE PRESIDING BISHOP
50 E NORTH TEMPLE
SALT LAKE CITY UT 84150

PROOF DUE NOTICE

RE: PERMIT NO. 63-12400

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before September 1, 1999. (See last page of your approved permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a complete field examination report prepared by a certified water right examiner may be used to submit the required proof.

If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.

Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.


SINCERELY,

JULIE L. YARBROUGH
Senior Secretary

Enclosures

MICROFILMED

JAN 28 2000

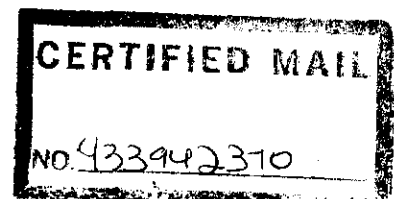

IDAHO DEPARTMENT OF WATER RESOURCES

WELL DRILLER'S REPORT

Use Typewriter or Ballpoint Pen

Office Use Only		
Inspected by _____		
Twp _____	Rge _____	Sec _____
1/4 _____ 1/4 _____ 1/4 _____		
Lat: _____	Long: _____	

1. DRILLING PERMIT NO. 63-97-C-0549-000
Other IDWR No. 63-124002. OWNER: Larry Mauer
Name Church of Jesus Christ of Latter-Day Saints
Address P.O. Box 15309
City Boise State Id Zip 83715

3. LOCATION OF WELL by legal description:

Sketch map location must agree with written location.

N		Twp. <u>4</u>		North ☒ or South ☐
W		Rge. <u>1</u>		East ☒ or West ☐
E		Sec. <u>30</u>		NE 1/4 SE 1/4 1/4
S		Gov't Lot _____		County <u>ADA</u> 10 acres 40 acres 160 acres
		Lat: _____		Long: _____
Address of Well Site <u>555 N. Locust</u>				
City <u>Meridian</u>				
Lt. _____ Blk. _____ Sub. Name _____				

(Give at least name of road + Distance to Road or Landmark)

4. USE: Fire Protection☐ Domestic ☐ Municipal ☐ Monitor ☐ Irrigation
☐ Thermal ☐ Injection ☒ Other Church Building5. TYPE OF WORK check all that apply (Replacement etc.)
☒ New Well ☐ Modify ☐ Abandonment ☐ Other _____

6. DRILL METHOD

☒ Air Rotary ☐ Cable ☐ Mud Rotary ☐ Other _____

7. SEALING PROCEDURES

SEA/FILTER PACK			AMOUNT	METHOD
Material	From	To	Sacks or Pounds	
<u>Pentonite</u>	<u>0</u>	<u>40'</u>	<u>33 Bags</u> <u>(1650#)</u>	<u>Overbore</u>

Was drive shoe used? ☒ Y ☐ N Shoe Depth(s) 158
Was drive shoe seal tested? ☐ Y ☒ N How? _____

8. CASING/LINER:

Diameter	From	To	Gauge	Material	Casing	Liner	Welded	Threaded
<u>8"</u>	<u>+2</u>	<u>158</u>	<u>.250</u>	<u>Steel</u>	☒	☐	☒	☐
					☐	☐	☐	☐
					☐	☐	☐	☐

Length of Headpipe 10' Length of Tailpipe _____

9. PERFORATIONS/SCREENS

☐ Perforations Method _____
☒ Screens Screen Type Johnson (2) Houston (1)

From	To	Slot Size	Number	Diameter	Material	Casing	Liner
<u>167</u>	<u>182</u>	<u>.025</u>		<u>5"</u>	<u>St. St.</u>	☐	☐
						☐	☐
						☐	☐

10. STATIC WATER LEVEL OR ARTESIAN PRESSURE:

19 ft. below ground Artesian pressure _____ lb. MICROFILMED
Depth flow encountered _____ ft. Describe access port or
control devices: _____

11. WELL TESTS:

☐ Pump ☐ Bailor☒ Air ☐ Flowing Artesian

Yield gal./min.	Drawdown	Pumping Level	Time
<u>300</u>			<u>1 Hr.</u>

Water Temp. 58° Bottom hole temp. _____Water Quality test or comments: Iron <1, PH 7.5Grains 7 Depth first Water Encountered 34

12. LITHOLOGIC LOG: (Describe repairs or abandonment) Water

Bore Dia.	From	To	Remarks: Lithology, Water Quality & Temperature	Y	N
<u>12</u>	<u>0</u>	<u>5</u>	<u>Top Soil</u>		
<u>12</u>	<u>5</u>	<u>10</u>	<u>Gravel + Soil</u>		
<u>12</u>	<u>10</u>	<u>18</u>	<u>Gravel + Sand</u>		
<u>12</u>	<u>18</u>	<u>31</u>	<u>Gravel + Sand</u>		
<u>12</u>	<u>31</u>	<u>34</u>	<u>Tan Clay</u>		
<u>12</u>	<u>34</u>	<u>36</u>	<u>Pea Gravel + Sand</u>	☒	
<u>12</u>	<u>36</u>	<u>40</u>	<u>Sand + Clay</u>		
<u>8</u>	<u>40</u>	<u>44</u>	<u>Clay</u>		
<u>8</u>	<u>44</u>	<u>50</u>	<u>Sand</u>		
<u>8</u>	<u>50</u>	<u>52</u>	<u>Sand</u>		
<u>8</u>	<u>52</u>	<u>57</u>	<u>Clay</u>		
<u>8</u>	<u>57</u>	<u>61</u>	<u>Sand</u>		
<u>8</u>	<u>61</u>	<u>62</u>	<u>Clay</u>		
<u>8</u>	<u>62</u>	<u>66</u>	<u>Sand</u>		
<u>8</u>	<u>66</u>	<u>77</u>	<u>Clay</u>		
<u>8</u>	<u>77</u>	<u>79</u>	<u>Sand</u>		☒
<u>8</u>	<u>79</u>	<u>81</u>	<u>Clay</u>		
<u>8</u>	<u>81</u>	<u>83</u>	<u>Sand</u>		
<u>8</u>	<u>83</u>	<u>85</u>	<u>Clay</u>		
<u>8</u>	<u>85</u>	<u>94</u>	<u>Sand</u>		
<u>8</u>	<u>94</u>	<u>95</u>	<u>Clay</u>		
<u>8</u>	<u>95</u>	<u>106</u>	<u>Sand</u>		☒
<u>8</u>	<u>106</u>	<u>108</u>	<u>Clay</u>		
<u>8</u>	<u>108</u>	<u>158</u>	<u>Sand</u>		☒
<u>158</u>	<u>162</u>	<u>Clay</u>			
<u>162</u>	<u>164</u>	<u>Sand</u>			
<u>166</u>	<u>167</u>	<u>Clay</u>			
<u>167</u>	<u>184</u>	<u>Sand</u>			

RECEIVED

OCT 28 1997

Department of Water Resources

RECEIVED

OCT 23 1997

WATER RESOURCES
WESTERN REGIONCompleted Depth 184 (Measurable)
Date: Started 10-7-97 Completed 10-10-97

13. DRILLER'S CERTIFICATION

I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

Firm Name Adamson Pump & Drilling Firm No 0457Firm Official Miriam Adamson Date 10-16-97Supervisor or Operator DAVE Adamson Date 10-16-97
(Sign once if Firm Official & Operator)



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. BOX 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

August 29, 1997

CHURCH OF JESUS CHRIST LATTER DAY SAINTS
CORP OF THE PRESIDING BISHOP
50 E NORTH TEMPLE
SALT LAKE CITY UT 84150

PERMIT APPROVAL NOTICE

RE: PERMIT NO. 63-12400

Dear Permit Holder:

The Department of Water Resources (IDWR) has issued the enclosed permit authorizing you to establish a new water right. Please be sure to thoroughly review the conditions of approval and remarks listed on your permit.

The permit is a preliminary order issued by IDWR pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action by IDWR unless a party petitions for reconsideration or files an exception and/or brief as described in the enclosed information sheet.

As a permit owner you must commence the excavation or construction of the diverting works within one year of the date the permit was issued, and you must proceed diligently until the project is completed. The date shown under condition no. 1 is the date when the project must be completed.

The Department will send you a "Proof Due Notice" approximately 60 days prior to the above referenced date requesting you to file either a Proof of Beneficial Use form or a Request for Extension of Time form.

Also enclosed is a copy of the approved drilling permit submitted in connection with this water right.

Also, please note that as of July 1, 1996, water right owners are required to report any change of water right ownership and any change of mailing address to the department. If you have acquired a water right or have changed your mailing address PRIOR TO July 1, 1996, you have until July 30, 1998, to notify the department. If you acquire a water right or change your mailing address AFTER July 1, 1996, you must notify the department within 120 days of the change.

Failure to report these changes could result in a \$100 late filing fee. Contact any office of the department to obtain the proper reporting form.

Sincerely,

A handwritten signature in cursive script, reading "Shelley W. Keen". The signature is written in dark ink and is positioned above the typed name.

Shelley W. Keen
Water Rights Supervisor

SK:klt

Enclosures


20-1-01

CERTIFICATE OF MAILING

I hereby certify that on the 29th day of August, 1997, I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER (Approved Permit) to the person(s) listed below:

Water Right No. 63-12400

CHURCH OF JESUS CHRIST LATTER DAY SAINTS
CORP OF THE PRESIDING BISHOP
50 E NORTH TEMPLE
SALT LAKE CITY UT 84150

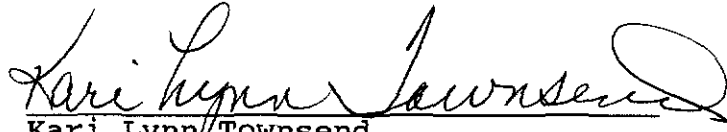
Kari Lynn Townsend
Secretary

SEP 1 1997

APPLICATION FOR PERMIT STATE OFFICE REVIEW

by *Cindy Lou*

No.: 63-12400 Name: BDS Date: 8/29/91 Ad OK? ☒ ☒ Gvmt Lts: ☒

AREA OF CONCERN:

- No/Yes: _____ Mor / _____ GWMA / Trust / Non-trust

PROTESTED:

- 020 (Protest Agreement) or *W19 (Order)

SYSTEM COMPLETED:

1 year/no proof

- P16

>1 year

- 26A-P17

GROUNDWATER: (✓ FLO-CH)

WMD (✓ MAP)

>0.24 cfs/5 acres

- _____ or No MD (in-stream stock or power)

≤ 0.24 cfs/5 acres

- No MD

WMD >0.24 cfs

- 01M (report when notified)

>5 a.

- 01M; 065-079 (if GW use SW 1st-statewide)-(cannot move SW off)

≤ 0.24 cfs/5 acres

- No MD

DRILLING PERMIT:

Existing well

- NA (pre 7/1/87; ✓ WDQ3)

Included w/permit

- Permit No. 63-97-C-0549-000 P99

No drilling permit?

- 046-46B-P23 (post 7/1/87)

irr. in WD

- P05 (new well location)

SURFACE WATER: (✓ FLO-CH) (Surface water that doesn't sink is regulated):

IN MIN. STR. FLOW (✓ MAP)

- (modify remark *WB9)

WD (✓ MAP & LISTING)

- R04 (WD # _____) 01J-P08 (MD)

Pumped >0.20 cfs

- 01H-P01 (LD & MD) or No MD (in-stream stock)

WMD (✓ MAP)

> 0.24 cfs/5 acres

- _____ or No MD (in-stream stock or power)

≤ 0.24 cfs/5 acres

- No MD

SPRINGS/SINK, INACTIVE WD & REST OF STATE

> 0.24 cfs/5 acres

- 01M or No MD (in-stream stock or power)

≤ 0.24 cfs/5 acres

- No MD

RIVER BASINS: (*Surface water):

Snake R (01)

- 11A-P04, NA

(02/03-irr)

- 007-P07 (w/ remark *WB9 if above Weiser), NA

Boise R (63)

- 05A (if WD), 11E (not 42-111 use), NA

Payette R(65)

- *W22 (regulated uses), 047-P04 (Payette Lake), NA

USE:

Domestic surface

- *WB5 (Big Wood R or Boise R ↑ Star Bridge); 27A (Payette River); NA

>1 in rest. area

- 070-071- P53

Fish Propagation

- 07A-042 (req)-09E (WQ)-P10; 044 (N of 1000 Springs)

Irr ≤ 5 acres

- 057 (0.03 cfs/acre)

> 5 acres

- 03A (0.02 cfs/acre)

Mining

- 054 (req) & 09E-P10

Muni (in restricted areas)

- 022, 075, 004 (+memo?)

Power

- 17K-08A-025-01F(P19)-028-09E(P10); 027 (if no other cons. use);

17G (FERC) or 17M (FERC); 18B-P09; >25 cfs-P18

Storage (✓ 3 compo.)

- 080; 18A (in- & out-flow MD within district), 18B-P09 (>10' dam),

LOCATION:

42-248 area

- P84 (in 20/30/40/50/60/70/80 (87) basin)

Boise Front LoGeo

- 058 (<85° GW temp only)

In-stream dev.

- P52 (stream channel alteration)

Irr Dist/Canal Co.

- 023 (Twin Falls area)

SWAN FALLS FLAG (See Code Chart)

Trust

- 051-052-053-P74 (Consumptive Uses), NA

Non-Trust (1)

- 048-049 (Consumptive Uses), NA

OWNERSHIP:

- 004 (PD/PU) _____

OTHER CONDITIONS:- 017 _____**STANDARD REMARKS:**- 0WB5 _____**BENEFICIAL USE DUE:**

- 9/1/ 1999 _____

COMMENTS:

- _____

WELL DRILLER: PLEASE COMPLETE FOR VERBALS

IDWR Employee Issuing Verbal: _____

Verbal Issued Date: _____ Time: _____

RECEIVED

FEB 06 1997

State of Idaho
Department of Water Resources

Department of Water Resources

**APPLICATION FOR DRILLING PERMIT
(FOR THE CONSTRUCTION OF A WELL)**1. Applicant (please print): CHURCH OF JESUS CHRIST OF LATTER DAY SAINTS (LARRY MAURER)2. Mailing Address: P.O. BOX 15309City & State BOISE, ID Zip Code 83715 Telephone (208) 342-2735☒ Well Owner ☐ Well Operator ☐ Contractor or Other, specify _____3. Proposed Well Location: Twp. 4N, Rge. 1E, Sec. 30, NE 1/4 SE 1/4Gov't Lot No. _____ County ADAStreet Address of Well Site 555 N. LOCUST GROVE RD, 2640 FT S. OF HWY 20-26 City MERIDIAN
Give at least name of road + Distance to Road or LandmarkLot, block and subdivision N/A

4. Proposed Use of Well:

☒ DOMESTIC: The use of water for homes, organization camps, public campgrounds, livestock (1,000 head or less) and for any other purpose in connection therewith, including irrigation of up to 1/2 acre of land, if the total use is not in excess of 13,000 gpd; or any other uses, if the total use does not exceed a diversion rate of 0.04 cfs and a diversion volume of 2500 gpd.

Domestic does not include water for multiple ownership subdivisions, mobile home parks, commercial or business establishments, unless the use does not exceed a diversion rate of 0.04 cfs and a diversion volume of 2500 gpd.

NON-DOMESTIC: ☐ Irrigation ☐ Municipal ☐ Industrial ☒ Other CHURCH BUILDING
☐ Stock ☐ Test (Over 1,000 Head) (Describe)☐ INJECTION☐ MONITORING: A well bore schematic and map is required for each blanket permit.
No. of proposed wells: _____Domestic .04 cfs
Fire Prot .22 cfs
Total .22 cfs

5. Well Construction Information:

A. ☒ New well ☐ Modify ☐ ReplaceB. Proposed Casing Diameter 8" Proposed Maximum Depth 200'C. Anticipated bottom hole temperature:
☒ 85°F or less (Cold Water Well) ☐ 85°F to 212°F (Low Temp. Geo. Well) ☐ 212°F or more (Geothermal Well)

6. Construction Start Date: _____

7. Anticipated Well Driller: _____ Driller's Lic. No. _____

NOTE: The actual well driller must be identified prior to drilling.

8. Applicant's Signature Richard L. Maurer Date 2/5/97Title Senior Real Estate Representative
(Owner, Firm Representative, Other)

* per w.r. app. - R 6/17/97

ACTION OF THE DEPARTMENT OF WATER RESOURCES

This Permit is Approved Date 8-25-97

If approved, this permit authorizes the construction or modification of a well subject to the following conditions. READ CAREFULLY

GENERAL CONDITIONS:

1. This drilling permit is valid for two (2) months from the above approval date for the start of construction and is valid for one (1) year from the approval date for completion of the well unless an extension has been granted.
2. This permit does not constitute an approval of the District Health Department or the Idaho Department of Health and Welfare which may be required before construction of this well. All wells must be drilled a minimum distance of 100 feet from a drain field. Domestic and Public Water Supply wells must be drilled a minimum of 50 feet and 100 feet respectively from a septic tank.
3. The well shall be constructed by a driller currently licensed in the State of Idaho who must maintain a copy of the drilling permit at the drilling site.
4. Approval of this drilling permit does not authorize trespass on the land of another party.
5. This permit does not constitute other local, county, state or federal approvals which may be required for construction of a well.
6. This drilling permit does not represent a right to divert and use the water of the State of Idaho.
7. If a bottom hole temperature of 85° or greater is encountered, well construction shall cease and the well driller and the well owner shall contact the Department immediately.

SPECIFIC CONDITIONS:

This well shall not be used as a public water supply without prior approval of DEQ and/or the appropriate District Health Department office.

Use from this well shall not exceed that which is authorized by water right # 63-12400 and is for internal use only.

[Signature]
Signature of Authorized Department Representative

8-25-97
Title

Receipt No. 1037954 Received by [Signature] Fee 2/6/97 Date 8-25-97

EXTENSION OF DRILLING PERMIT

Extension approved by _____ Approval Date _____
This extension expires: _____

MICROFILMED
SEP 11 1997



STATE OF IDAHO
DIVISION OF
ENVIRONMENTAL QUALITY

RECEIVED

JUL 29 1997

WATER RESOURCES
WESTERN REGION

1445 North Orchard, Boise, ID 83706-2239, (208) 373-0550

Philip E. Batt, Governor

July 28, 1997

Gary Spackman
Idaho Department of Water Resources, Western Region
2735 Airport Way
Boise, ID 83705-5082

RE: Church of Jesus Christ of Latter Day Saints
Application for Permit to Appropriate Public Waters; Identification No. 63-12400
Northeast/4 of Southeast/4 Section 30, T4N, R1E, BM / Ada County

Dear Mr. Spackman:

Thank you for the opportunity to review the referenced application. We have the following comments:

The well proposed by the applicant will be considered a source for a public water system if it serves water to 25 or more people, for 60 or more days per year. A public water system serving a church would be classified as a "non-community" (non-residential) system, and by contract between the Division of Environmental Quality (DEQ) and the Central District Health Department (CDHD), the system would be regulated by the CDHD. I have contacted Ms. Susie Simmons with the CDHD regarding this project; she plans to inspect the well site, after which she may choose to 1) review plans and specifications, 2) request that plans be reviewed by DEQ, or 3) waive review.

If the project is referred to DEQ for review, I will contact the applicant to explain the DEQ review procedure. We will require that the system be designed by a professional engineer registered in Idaho. The well site must be approved by DEQ prior to drilling, and plans for well construction, pump house, and distribution pipelines must be submitted for review and approval prior to construction.

We advise that shallow ground water in the general area is vulnerable to bacterial contamination. The well should be designed to protect the deeper aquifers.

Please call me at 373-0166 if you have questions regarding these comments.

Sincerely,

Bill Freeman
Water Quality Engineering Specialist

c: Susie Simmons, CDHD
Larry Maurer, Church of Jesus Christ of Latter Day Saints
Source File #14
Reading File



111 S. ORCHARD, SUITE 600 * BOISE, IDAHO 83705 * (208) 344-9700 FAX NO (208) 345-2950



Ada & Boise County
707 North Armstrong Place
Boise, ID 83704-0825
Tel. 327-7499

Elmore County
520 E. 8th Street North
Mountain Home, ID 83647
Tel. 587-9225

Valley County
703 North 1st Street
McCall, ID 83638
Tel. 634-7194

Environmental Health Division Sanitation Sheet

960930

Name	The Church of LDS Meridian ID. West Stake	Address	Locust Grove Rd
Date	8-14-97	Responsible Person	Kurt Reliford, Engineer

REMARKS:

This report was a consultation with the engineer of this project. Mr. Reliford reviewed the site plan and building floor plan for the project.

This facility will serve as a congregation meeting place for various wards of the Church, church services on Sunday, and Holiday Functions. Besides the Holiday Functions the majority of the gatherings are on Sunday (less than 60 days per year).

Municipal water + sewer will be provided approximately five years. The facility is designed to accommodate future connections to municipal utilities.

It has been determined that this system will not be required to submit plans and specifications for review to our Department and the Division of Environmental Quality based on the operation and the number of people at the facility.

If the facility generates (operates) more than 60 days a year and 25 or more people per day, you will be required to submit plans and specifications for review to the appropriate departments.

Note: If daycare facility is performed you will be required to submit plans + specifications for review.

X Kurt Reliford

Jessie Simmons REHS

Drilling Permit No. _____
 Water Right No. _____ (if applicable)

REQUEST FOR ISSUANCE OF DOMESTIC DRILLING PERMIT WITH CASING SIZE EXCEEDING SIX (6) INCHES

CHURCH OF JESUS CHRIST OF LATTER DAY SAINTS Applicant, requests the issuance of Drilling Permit for domestic (exempt) purposes as defined in Idaho Code Section 42-111, which authorizes construction of a well with casing size exceeding six (6) inches in diameter. The Idaho Code states, in part:

"the phrase 'domestic purposes' or 'domestic uses' means:

- A. The use of water for homes, organization camps, public campgrounds, livestock and for any other purpose in connection therewith, including irrigation of up to one-half (1/2) acre of land, if the total use is not in excess of thirteen thousand (13,000) gallons per day, or
- B. Any other uses, if the total use does not exceed a diversion rate of four onehundredths (0.04) cubic feet per second and a diversion volume of twenty-five hundred (2,500) gallons per day.

For purposes of these sections, domestic purposes or domestic uses shall not include water for multiple ownership subdivisions, mobile home parks, commercial or business establishments, unless the use meets the diversion rate and volume limitations set forth in subsection B. of this section."

The request is made to drill a 8 inch diameter well for the following reason(s):

- ☒ A larger diameter is required because of expected limited productivity of formations expected to be encountered, or difficulties in drilling that have been experienced.
- ☒ The pumping equipment available requires a larger well diameter and will be valved to prevent excessive diversion. (possibility)
- ☐ Other _____

Who owns the property at the point of diversion? CHURCH OF JESUS CHRIST OF LATTER DAY SAINTS

Who owns the land to be irrigated or place of use? CHURCH OF JESUS CHRIST OF LATTER DAY SAINTS

If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing in behalf of the well owner N/A

I acknowledge that use of this well for any other purpose than domestic use as defined under Idaho Code Section 42-111 requires approval by the Idaho Department of Water Resources and that failure to comply is a violation of Sections 42-351 and 43-352, Idaho Code.

BRIGGS ENGINEERING, INC.
 Well Owner or Authorized Agent

ENGINEERING COMPANY FOR LDS CHURCH
 Title

Hart Ralipol
 Signature

8-22-97
 Date

6/97

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPROPRIATION APPLICATION ANALYSIS SHEET

AUG 22 1997
DEPARTMENT OF WATER RESOURCES

INITIAL REVIEW BY: RL DATE: 8/17/97 APPLICATION: 85-12400

REQUIRED INFORMATION

Name: (If applicant is a corporation or partnership, names and addresses for the director, officers, and other partners must be included.)

Address:

Source: (See USGS Quad for names of water sources)

Point of Diversion: (10 acres for spring, lot & block descriptions for Subdivisions, local name)

County:

Quantity: (flow and/or volume)

Period of use:

Nature of proposed use: (Include description of use)

Description of diverting works:

Time required for beneficial use of water:

Place of use or acres irrigated:

Map: (show T, R, S, QQ &/or QQQ)

Subdivision plat: (for > 1 home in restricted area. ≥ 5 homes in non-restricted area)

Signature: (If applicant is corp., partnership, or municipality, title of signatory is required)

Fee:

Yes **No*** In form to receipt:

Gov't. Lots:

 P/D

 P/U

~~X~~ **ADVERTISE REMARK(S)**
(Reviewer identify which remarks)

ADDITIONAL INFORMATION

N/A T FLAG CHANGED TO P FLAG

YES NO

☒ Overlapping place of use: (Describe source & relationship to present application on next page.)
☒ Overlapping point of diversion.
☒ Critical groundwater area:
☒ Groundwater management area:
☒ * 1992 moratorium:
☒ Copy to SCA staff: (perennial stream, non-pump diversion &/or any mining).
☒ Copy to Dam Safety staff: (for any storage)
☒ * Mitigation plan: where ground water replaces surface water for irrigation, request additional information &/or mitigation plan to address reduced aquifer recharge
☒ Send power requirement letter:
☒ Send fish farm requirement letter:
☒ Power residency affidavit:
☒ Diversion greater than 5 cfs or 500 af or irrigation greater than 200 acres: (If yes, attach Large Diversion supplementary analysis sheet.)
☒ *REQUEST ADDITIONAL INFORMATION FROM THE APPLICANT

DATE REQUESTED

ADDITIONAL INFORMATION ON REVERSE SIDE:

* Exempt from B.S. 63 delay: Ok } .04 cts internal use only per application info.
 } .22 cts fine prot. Cms mitigation needed per
 B.S. 63 precedent
 (63-12343)

2/25/97 conv.
me

PROCESSING

APP. NO.

63-12400

YES NO

☒ ☐
☐ ☒
☒ ☐

In form for advertising:

Statewide advertising: (> 10 cfs &/or 1000 af)

Fee amount, receipt number and date recorded on application:

SEND COPIES TO:

YES NO

☒ ☐ I.D. Health & Welfare
☐ ☐ I.D. District Health
☐ ☐ I.D. Fish & Game
☐ ☐ I.D. Lands
☐ ☐ Adjudication Bureau

YES NO

☐ ☐ U.S. BLM
☐ ☐ U.S. Forest Service
☐ ☐ Water Dist. #
☒ ☐ Other DEQ - Boise Reg. off.
ATTN: Monte Marchus

FINAL REGIONAL PROCESSING REVIEW:

YES NO

☒ ☐ Affidavit of publication received:
☒ ☐ Application published correctly: If not, record action taken.☒ ☐ Publication dates and paper recorded on application:
☐ ☒ Protests received. Final date for protest 7-21-97
☐ ☒ Protest dates, resolution of protest recorded on application:
☐ ☒ Recommendations attached:
☐ ☒ Measuring device required:
☐ ☒ Measuring port required:
☐ ☒ Water delivered by water master? District #Special conditions of approval or cover letter: In building use only.Irrigation ~~use is prohibited~~ with this water right is prohibited.

See below for additional information

Recommended Date or Priority 2/6/97Recommended by: Gary Date: 8/22/97

STATE OFFICE REVIEW

See below for additional information. By _____ Date _____

ADDITIONAL INFORMATION:

NOTE - D.P. Appl. filed with w.r. appl - need i.d.driller before can issue d.p.Significant overlap = 63-09356 separate well for irrig & outdoor
facilities & chum. New well will not beintegrated with old well. New well internal only.



STATE OF IDAHO
DIVISION OF
ENVIRONMENTAL QUALITY

RECEIVED

JUL 29 1997

WATER RESOURCES
WESTERN REGION

1445 North Orchard, Boise, ID 83706-2239, (208) 373-0550

Philip E. Batt, Governor

July 28, 1997

Gary Spackman
Idaho Department of Water Resources, Western Region
2735 Airport Way
Boise, ID 83705-5082

RE: Church of Jesus Christ of Latter Day Saints
Application for Permit to Appropriate Public Waters; Identification No. 63-12400
Northeast/4 of Southeast/4 Section 30, T4N, R1E, BM / Ada County

Dear Mr. Spackman:

Thank you for the opportunity to review the referenced application. We have the following comments:

The well proposed by the applicant will be considered a source for a public water system if it serves water to 25 or more people, for 60 or more days per year. A public water system serving a church would be classified as a "non-community" (non-residential) system, and by contract between the Division of Environmental Quality (DEQ) and the Central District Health Department (CDHD), the system would be regulated by the CDHD. I have contacted Ms. Susie Simmons with the CDHD regarding this project; she plans to inspect the well site, after which she may choose to 1) review plans and specifications, 2) request that plans be reviewed by DEQ, or 3) waive review.

If the project is referred to DEQ for review, I will contact the applicant to explain the DEQ review procedure. We will require that the system be designed by a professional engineer registered in Idaho. The well site must be approved by DEQ prior to drilling, and plans for well construction, pump house, and distribution pipelines must be submitted for review and approval prior to construction.

We advise that shallow ground water in the general area is vulnerable to bacterial contamination. The well should be designed to protect the deeper aquifers.

Please call me at 373-0166 if you have questions regarding these comments.

Sincerely,

Bill Freeman
Water Quality Engineering Specialist

c: Susie Simmons, CDHD
Larry Maurer, Church of Jesus Christ of Latter Day Saints
Source File #14
Reading File



State of Idaho
DEPARTMENT OF WATER RESOURCES

Western Region, 2735 Airport Way, Boise, Idaho 83705-5082 - (208) 334-2190
FAX (208) 334-2348

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

July 18, 1997

MONTE MARCHUS
ID DEPT OF HEALTH & WELFARE
DIV OF ENV QUALITY
BOISE REGIONAL OFFICE
PO BOX 83720
BOISE ID 83706

Re: Application for Permit No. 63-12400 and Application for
Drilling Permit in the Name of the Church of Jesus Christ of
Latter Day Saints

Dear Watermaster:

Enclosed is a copy of an application for water right and an
application for drilling permit which may be of interest to your
agency.

Please review the applications and return your recommendations
within two weeks. If you have questions or need information,
feel free to contact this office.

Sincerely,


Gary Spackman

GS:st

Enclosures

RECEIVED

JUL 11 1997

WATER RESOURCES
WESTERN REGION

The Idaho Statesman

P.O. BOX 40, BOISE, IDAHO 83707-0040

LEGAL ADVERTISING INVOICE

Amount Due

\$55.44

Account Number/Trans. #		Identification	
047628		Notice of Application For Water Right	
Ordered By	P.O. Number	Rate	Run Dates
Sue Taylor		TT	July 3, 10, 1997
Sue Taylor DEPARTMENT OF WATER RESOURCES WESTERN REGION 2735 Airport Way Boise, ID 83705-5082		Estimated Inches	Real Inches
		# Affidavits	Legal Number
		1	8030

LEGAL NOTICE

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

63-12400

CHURCH OF JESUS CHRIST OF LATTER DAY STS
CORP OF THE PRESIDING BISHOP
50 E NORTH TEMPLE
SALT LAKE CITY, UT 84150

Source: GROUNDWATER
Diversion Pt: NESE Sec 30 T 04N R 01E in ADA COUNTY

Use: DOMESTIC { 0.040 CFS)
FIRE PROTECTION { 0.220 CFS)
Total Diversion: { 0.220 CFS)

Date Filed: 2/6/1997
In: ADA County
T04N R01E S30 NESE

Water bearing zone to be appropriated is 200 feet.

Permits will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code. Any protest against the approval of this application must be filed with the Director, Dept. of Water Resources, Western Region, 2735 Airport Way, Boise, Idaho 83705 together with a protest fee of \$25.00 on or before JULY 21, 1997. The protestant must also send a copy of the protest to the applicant.

KARL J. DREHER, Director

Pub. July 3 & 10, 1997

8030

JANICE HILDRETH

being duly

sworn, deposes and says: That she is the Principal Clerk of The Idaho Statesman, a daily newspaper printed and published at Boise, Ada County, State of Idaho, and having a general circulation therein and which said newspaper has been continuously and uninterruptedly published in said County during a period of twelve consecutive months prior to the first publication of the notice, a copy of which is attached hereto; that said notice was published in The Idaho Statesman in conformity with Section 60-108, Idaho Code as amended, for two

☒ consecutive weekly☐ single☐ consecutive daily☐ odd skip

insertion(s) beginning with the issue of

July 3

1997

and ending with the issue of

July 10

1997

Janice Hildreth

STATE OF IDAHO)

ss.

COUNTY OF ADA)

On this 10th day of July in the year of 1997, before me, a Notary Public, personally appeared

JANICE HILDRETH

known or identified

to me to be the person whose name subscribed to the within instrument, and being by me first duly sworn, declared that the statements therein are true, and acknowledged to me that she executed the same.

Janice Madie


Notary Public for Idaho

Residing at:

Boise, Idaho

My commission expires:

5/03

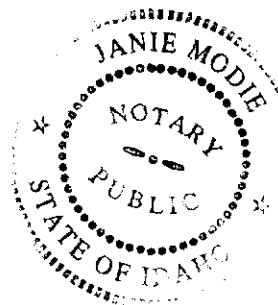

Permits will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code. Any protest against the approval of this application must be filed with the Director, Dept. of Water Resources, Western Region, 2735 Airport Way, Boise, Idaho 83705 together with a protest fee of \$25.00 on or before JULY 21, 1997. The protestant must also send a copy of the protest to the applicant.

KARL J. DREHER, Director

Published: 7/ 3/1997 & 7/10/1997



State of Idaho

DEPARTMENT OF WATER RESOURCES

Western Region, 2735 Airport Way, Boise, Idaho 83705-5082 - (208) 334-2190
FAX (208) 334-2348

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

JUNE 25, 1997

Legal Notices Department
THE IDAHO STATESMAN
PO BOX 40
BOISE, ID 83707

Dear Legal Dept.:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before JULY 21, 1997.

Yours truly,

SUE TAYLOR
Secretary/Office Coordinator

Encl.

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

CONVERSATION MEMORANDUM

DATE 8/17/97

FILE _____

NAME OF PARTY Kurt Briggs Engr. 344-9700EMPLOYEE FLRE: Processing


Applicant wants to proceed since although total
use (excluding fire pits) ≤ 2500 gpm, 18 gpm.

Acceptable: .04 cfs Domestic (channel) instand use.
.22 cfs Fire Prot
.22 cfs total

W-b zone 0-200' OK ✓

MICROFILMED

SEP 11 1997

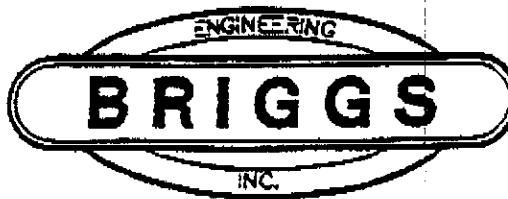

FACSIMILE TRANSMITTAL

TO STEVE LESTER FROM KURT RELFORD
COMPANY DEPT. OF WATER RESOURCES BRIGGS ENGINEERING, INC.
FAX NO. 334-2348 1111 S. ORCHARD, SUITE 600 • BOISE, ID. 83705
DATE 6-10-97 FAX NO. (208) 345-2950 TELE NO. (208) 344-9700
NO. OF PAGES SENT 1 BEI PROJECT NO. 960930
(Including Transmittal)

REFERENCE LDS - MERIDIAN STAKE (LOCUST GRAVE)

REMARKS WATER BRG. ZONE = 200 FT.

0.04 CFS IS OK, WE ADDED THE FIRE FLOW
TO 0.04 TO ARRIVE AT 0.22 CFS.

FIRE FLOW PROBABLY SHOULD NOT HAVE BEEN USED!

1250 GPM PER DAY USE @ CHURCH (MAXIMUM)

REPLY REQUESTED _____

Maybe WR N/A - opt. int

call

COPY _____



State of Idaho

DEPARTMENT OF WATER RESOURCES

Western Region, 2735 Airport Way, Boise, Idaho 83705-5082 - (208) 334-2190

FAX (208) 334-2348

April 1, 1997

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

MR DEAN BRIGGS
BRIGGS ENGINEERING INC
1111 S ORCHARD STE 600
BOISE ID 83705

RE: APPLICATION FOR PERMIT, LOCUST GROVE LDS SITE

Dear Mr. Briggs:

We discussed the above-referenced application for permit on February 25, 1997. During that conversation, it was determined that additional information was needed to process the filing. Please identify the proposed water bearing zone to be appropriated for the well that will serve this church.

Also, it should be noted that the application must be limited to .04 cfs for domestic use and .22 cfs for fire protection use (total of .22 cfs) in order to be processed within the limits of the Boise River drainage "processing moratorium".

Your reply within 30 days will be most helpful in this matter. Please let me know if you need any assistance.

Sincerely,

Steve Lester
Water Rights Supervisor

CONVERSATION MEMORANDUM

DATE 2/25/97

FILE _____

NAME OF PARTY _____

EMPLOYEE _____

RE: _____

Steve Larter

① Larry Mauer } e LOS office 342-2735
Garth Jensen }

② Dean Briggs e Briggs Eng. 345-2881

1. Domestic .04 cfs "in-house" use for
25,000 ft² church bldg. - typical church scenario
Fire not high need

2. Fire prot. .22 cfs to fill exp. tank required
per code.

3. Total = .22 cfs.

4. Water bearing zone to be appropriated will be
identified e Briggs Eng.

5. SITE = 5 ballfields irrig. with drilled water &
an existing well. (63-09356). Will replace
some of irrig. area with this new bldg. &
new well. New well will not be needed to
irrig. any landscaping etc since 63-09356
can handle it.

MICROFILMED

SEP 11 1997

WR5809NP
No. 63-09356

IDAHO DEPARTMENT OF WATER RESOURCES
WATER RIGHT PROFILE REPORT

DATE: 02/25/97
PAGE: 1

OWNER CODE	NAME & ADDRESS	PRIORITY DATE	WATER USE	USE PERIOD FROM TO	DIVERSION RATE	DIVERSION VOLUME
C	CHURCH OF JESUS CHRIST LATTER DAY SAINTS	03/07/1980	IRRIGATION	03/15 11/15	0.090 CFS	13.50 AFA
			DOMESTIC	01/01 12/31	0.040 CFS	0.60 AFA
TOTAL DIVERSION:					0.130 CFS	14.10 AFA

Water Source: GROUNDWATER

Tributary to:

Stage: LICENSE

Point(s) of Diversion Capacity: 0.300 CFS

Point(s) of Diversion: T04N R01E S30 NESE ADA County

Place of use Legal Description for: IRRIGATION

NE				NW				SW				SE													
T	R	S		NENE	NWNE	SWNE	SENE	:	NENW	NWNW	SWNW	SENW	:	NESW	NWSW	SWSW	SESW	:	NESE	NWSE	SWSE	SESE	:	SUM	
				Lt	Ac	Lt	Ac		Lt	Ac	Lt	Ac		Lt	Ac	Lt	Ac		Lt	Ac	Lt	Ac			
04N	01E	30	:					:					:					:	03					:	3.0
TOTAL ACRES																							3.0		

Place of use location for DOMESTIC is the same location as described for: IRRIGATION

Pou County: ADA

Other Water Rights Listing Overlapping Place(s) of use:
63-03294 63-05320

Conditions of Approval:

R52 - This right when combined with all other rights shall provide no
- more than .03 cfs per acre nor more than 4.5 afa per acre for the
- lands above.

Remarks: Domestic use is for outdoor restroom facilities and drinking fountain.

Dates: App. Received: 03/07/1980 Priority Date: 03/07/1980
Proof Due Date: 04/01/1985 Proof Made Date: 02/18/1983
Exam Made Date: 07/20/1983 Exam Sent to S.O.:
Licensed Date: 02/23/1990

Misc: Water District Number: Field Exam Fee:

Audit: 02/26/86 05/01/88 CONVERT 02/27/89 JOHNSON 08/10/89 CURTIS
10/04/89 CURTIS 11/09/89 CURTIS 11/17/89 CURTIS

*Reduce irrig. this
right, replace w/
new well & chanel
bldg.
Balance of irrig. will
continue.*

RECEIPT
For Monies Paid
to the
Idaho Department of Water Resources

Receipt No: C037954

Date:
Time: 2/ 6/1997
15:45:16

Received
From: LOMBARD-CONRAD ARCHITECTS

Type of Payment		Program Acct	Amount
WR CHURCH OF JESUS CHRIST, LDS	56103	229 21 1155	100.00
DP " " " " "	54116	229 21 1205	200.00
Total \$			300.00

CHECK 32417

Region: STATE

Signature: Linda Tracy

LETTER OF TRANSMITTAL

BRIGGS ENGINEERING, Inc.

1111 So. Orchard St., Suite 600 Boise, Idaho 83705

PHONE: (208) 345-2881 FAX NO: (208) 345-2950

DATE 2-6-97 ID NO. 960930

TO Dept. of Water Resources

JOB NAME LDS Meridian Stake

JOB ADDRESS _____

CITY, STATE _____

☒ WE ARE SENDING YOU

☐ SHOP DRAWINGS

☒ ENCLOSED

☐ CHANGE ORDER

☐ UNDER SEPARATE COVER VIA

☐ WE ARE RETURNING

☐ COPY OF LETTER

☐ FEDERAL EXPRESS

☐ PLANS

☐ ORIGINALS

☒ COURIER

☐ FINAL PLAT

☐ SPECIFICATIONS

☐ COMPUTER DISK

☒ OTHER Application

☒ Check

COPIES	DATED	ID NO.	DESCRIPTION
1	2-4-97	9632417	Check for Application + Drilling Permit
1			Application ~~and~~ for Permit
1			Application for Drilling Permit

THESE ARE TRANSMITTED AS CHECKED BELOW :

☐ FOR APPROVAL

☐ APPROVED AS SUBMITTED

☐ RESUBMIT _____ COPIES FOR APPROVAL

☐ FOR YOUR INFORMATION

☐ APPROVED AS NOTED

☐ SUBMIT _____ COPIES FOR DISTRIBUTION

☐ AS REQUESTED

☐ RETURNED FOR CORRECTIONS

☐ RETURN _____ CORRECTED PRINTS

☐ FOR REVIEW AND COMMENT

☐ PRICE

☐ FOR BIDS DUE _____

☐ _____

REMARKS _____

COPY TO Indochina

SIGNED Dean Briggs

16.9.97

63-12400

CHURCH OF JESUS CHRIST OF LATTER DAY STS
CORP OF THE PRESIDING BISHOP
50 E NORTH TEMPLE
SALT LAKE CITY, UT 84150

Source: GROUNDWATER

Diversion Pt: NESE Sec 30 T 04N R 01E in ADA County.

Use: DOMESTIC	(	0.040 CFS)
FIRE PROTECTION	(	0.220 CFS)
Total Diversion:	(	0.220 CFS)

Date Filed: 2/ 6/1997

In: ADA County
T04N R01E S30 NESE

Water bearing zone to be appropriated is 200 feet.