


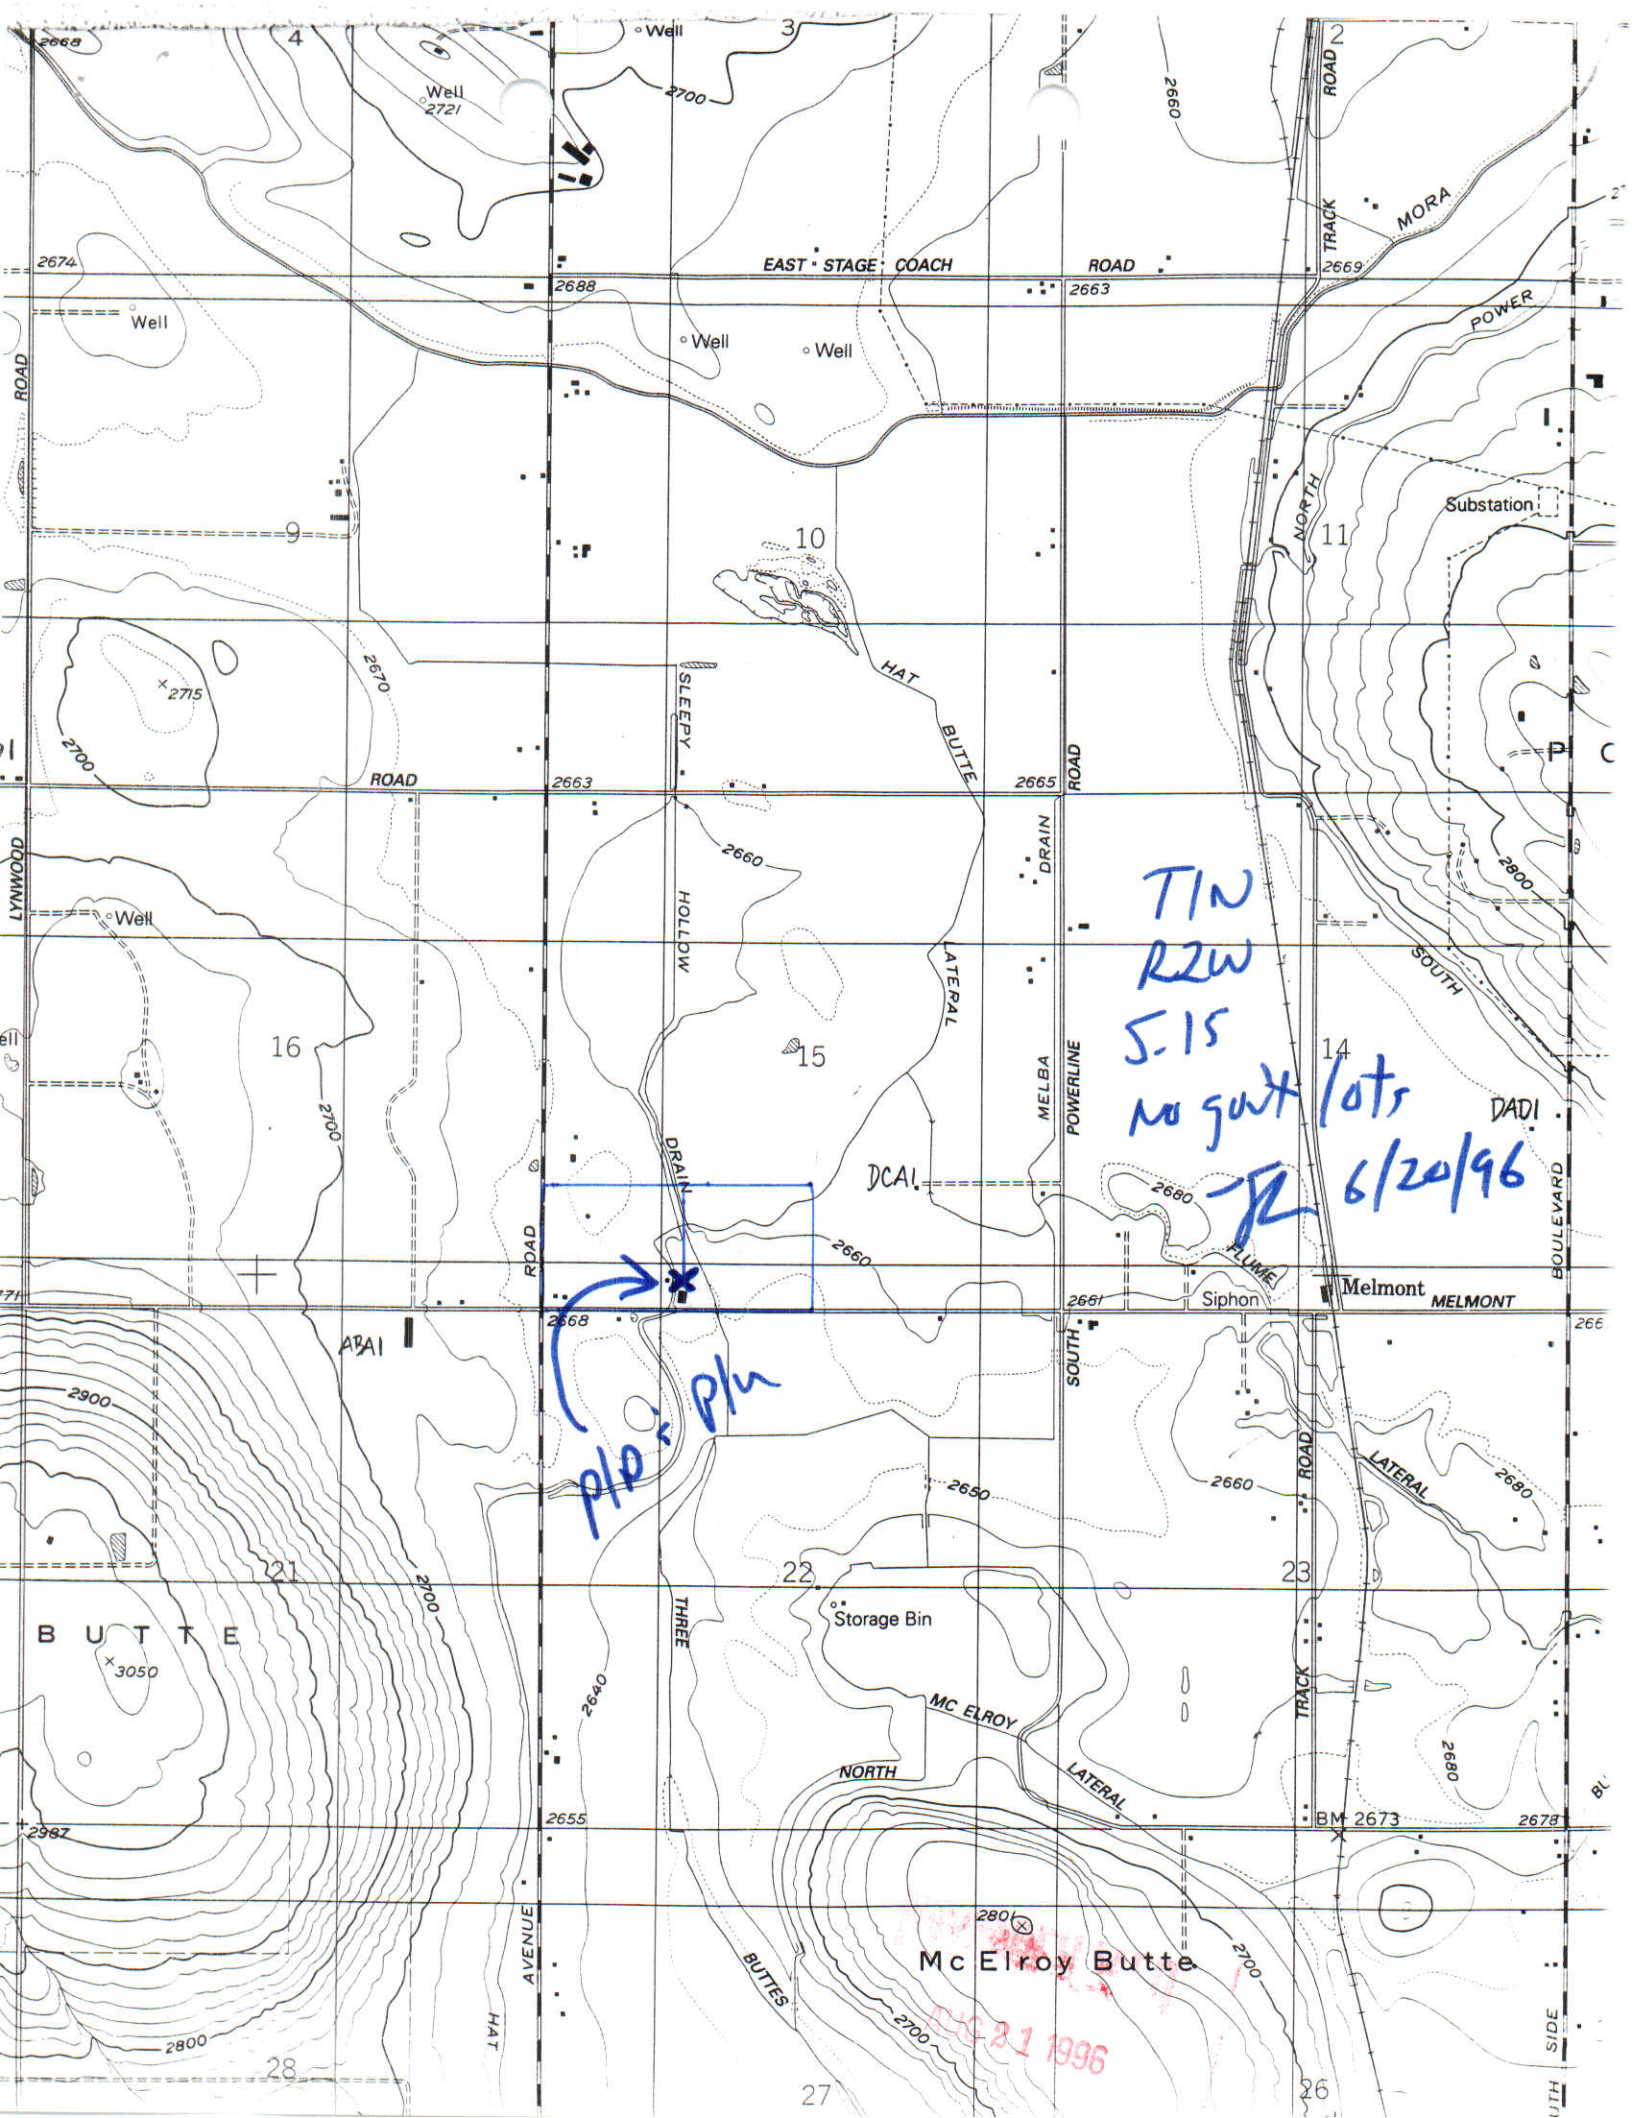


TIN
R2W
S.15
No gult lots
6/20/96

plp. plm

Mc Elroy Butte

JUL 21 1996

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

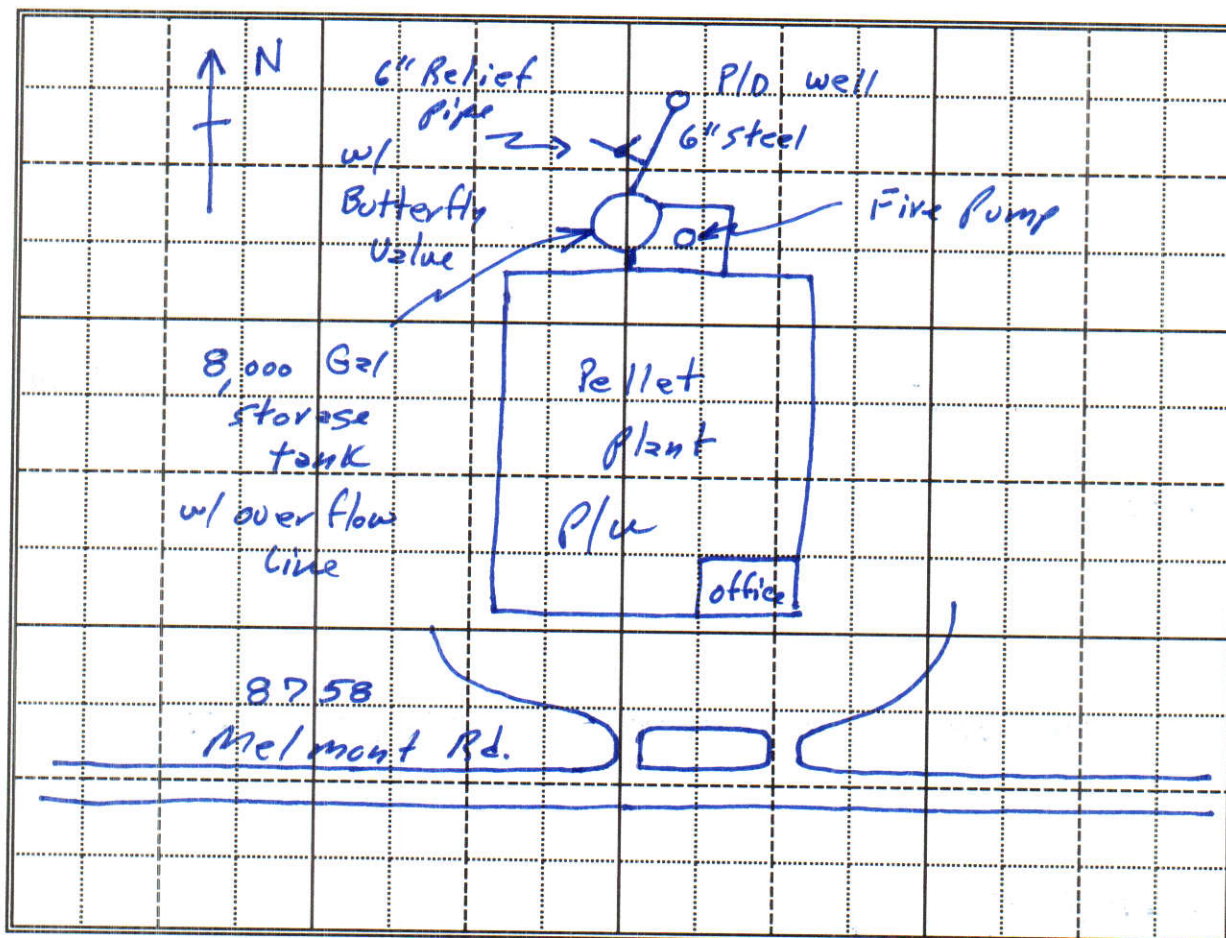

Scale: 1" = None

☒ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

☐ Aerial Photo Attached (required for irrigation of 10+ acres)

☒ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
		25		Berkeley	Model 7T-500
					2 stage


*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.


Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: None - pump off

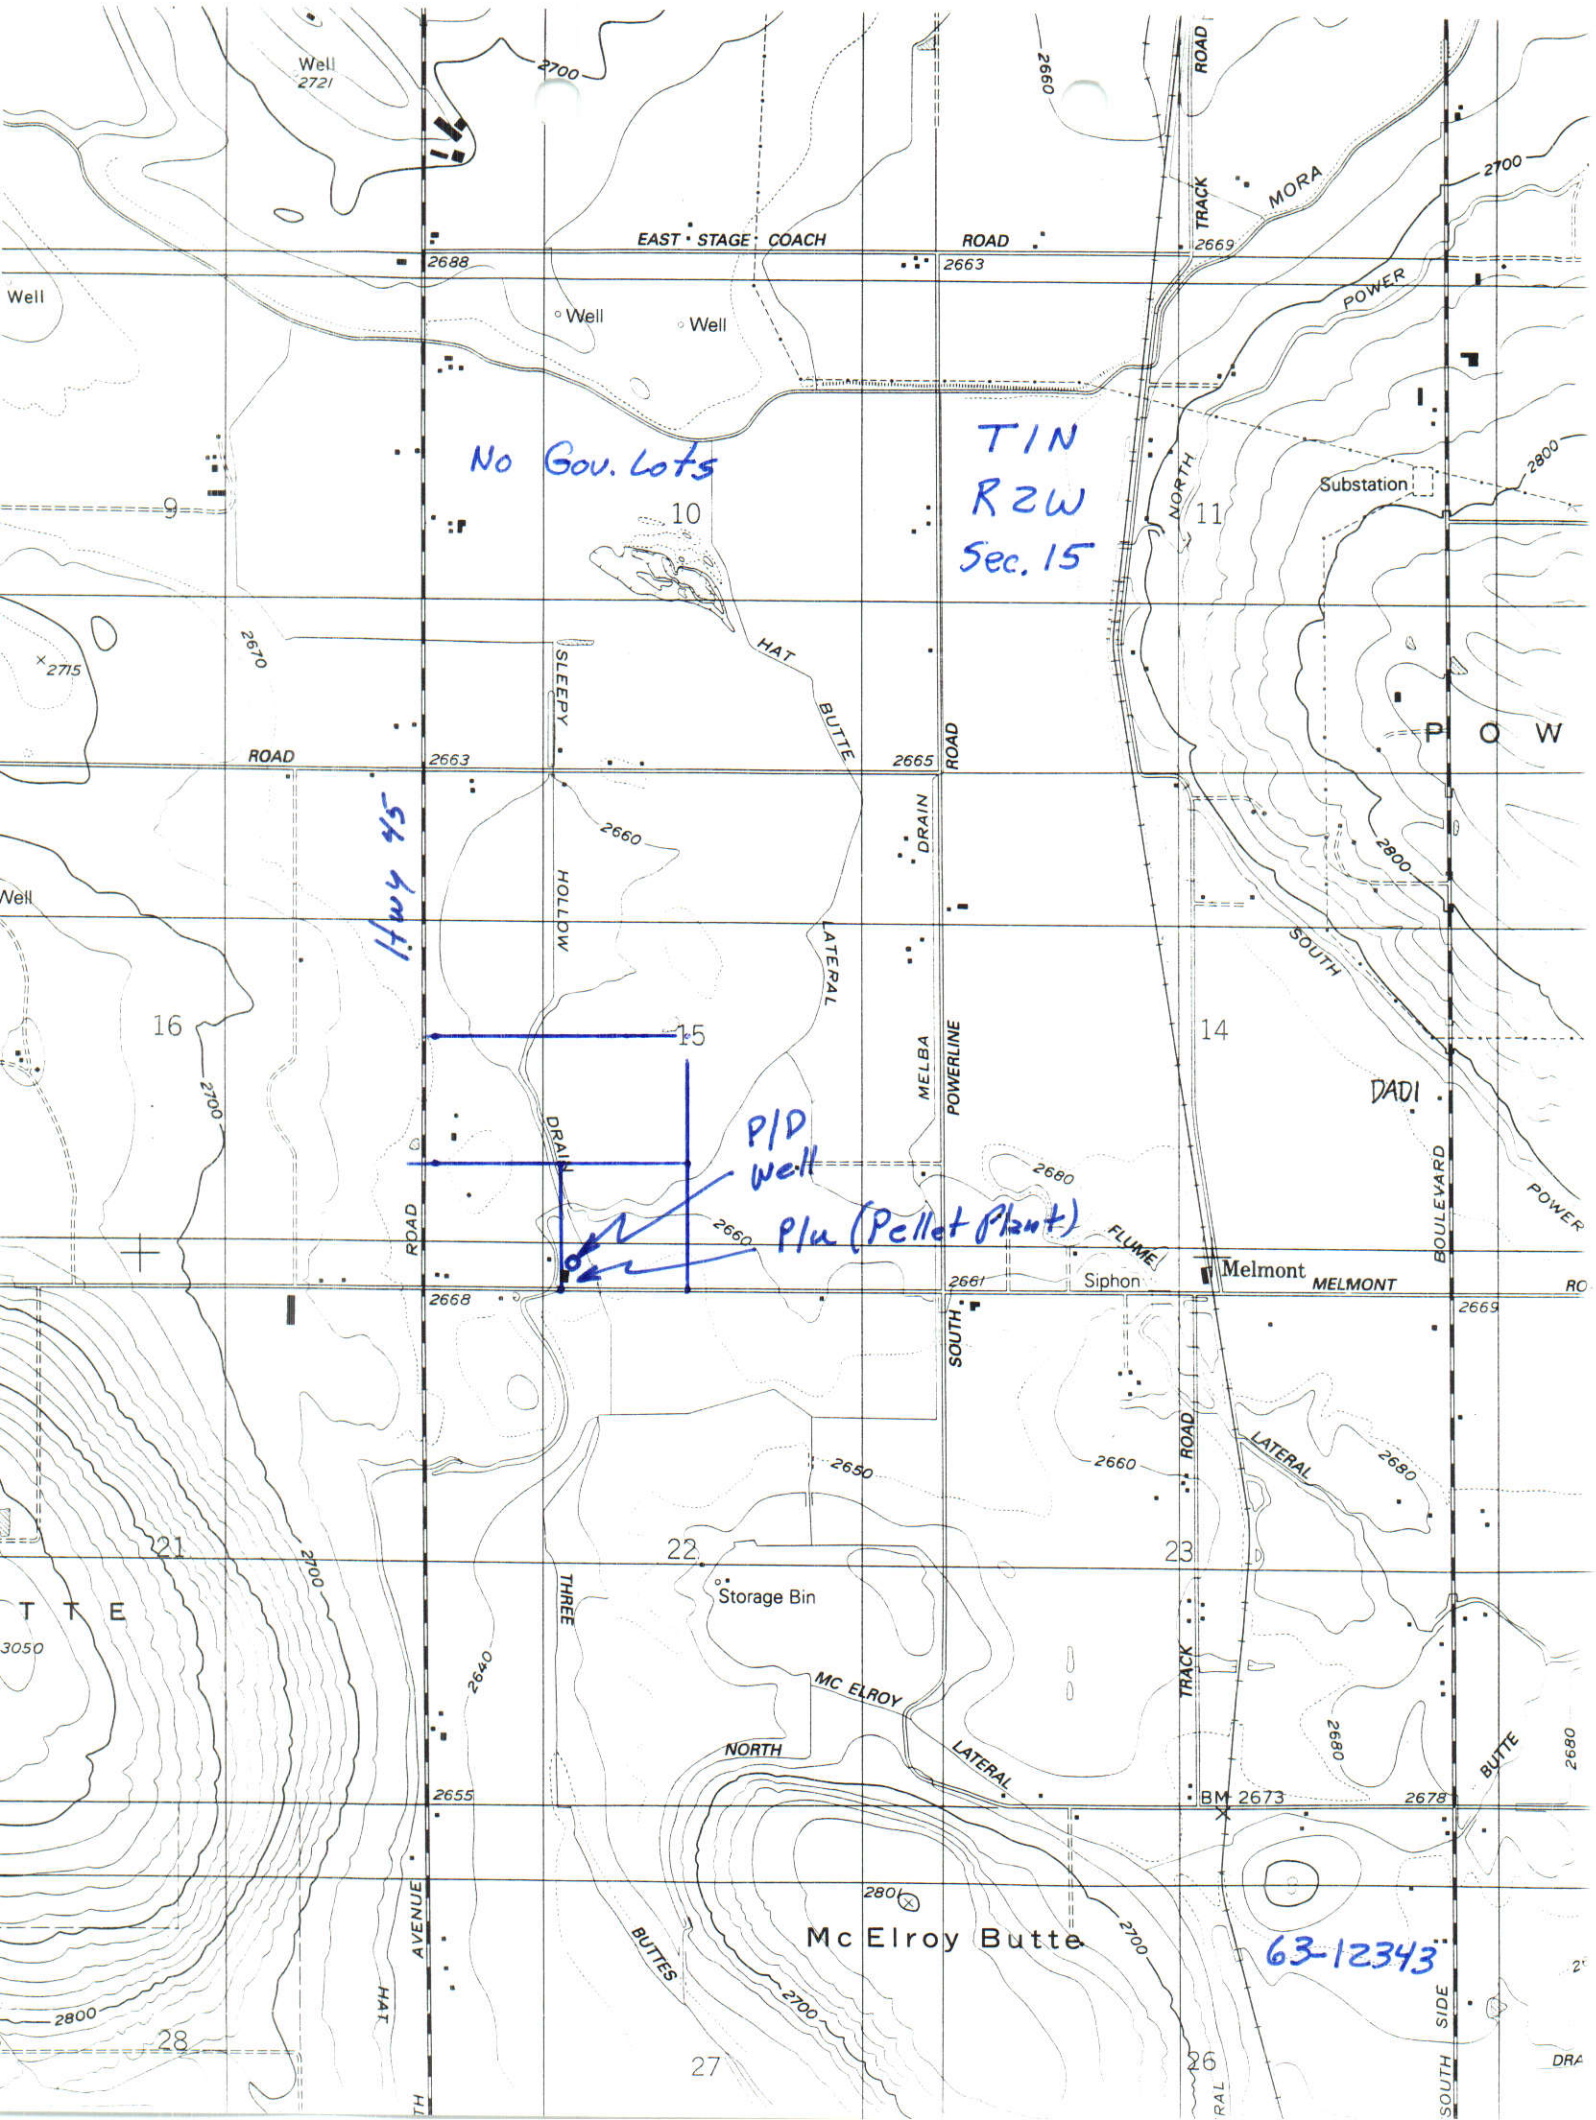

Submersible Turbine Model 7T-500

495-1209 FAX

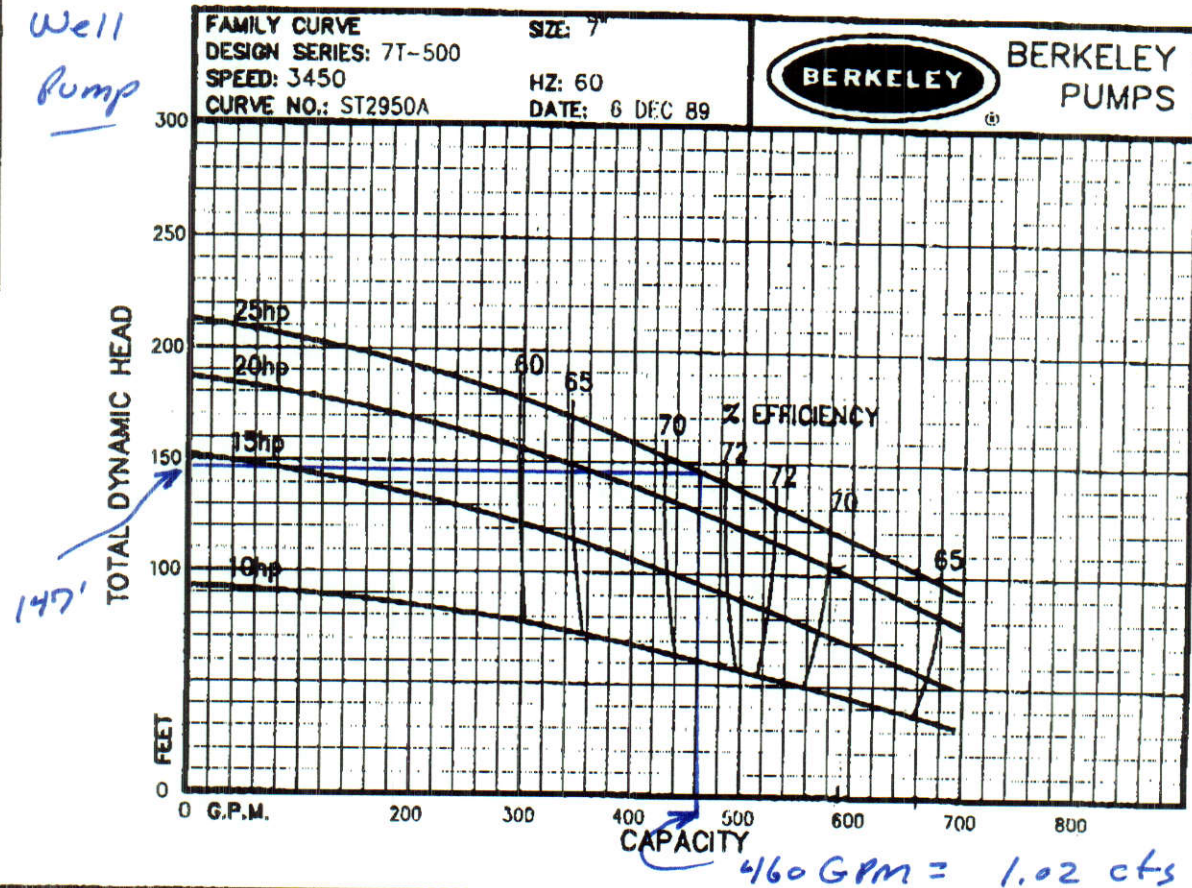Well
Pump

Specifications

25 HP motor

63-12343

LIQUID END WEIGHTS

DESCRIPTION	WEIGHT LBS.	HP RATING	MOTOR FLANGE
ONE STAGE L.E.	59.8	10-25	6"
ONE STAGE L.E.			
ONE STAGE L.E.			
EACH ADDED STAGE	28.0	ALL	ALL


CURVE No. ST2950A

IMPELLER DATA

 TYPE: ENCLOSED EYE AREA 8.19 Sq. In.
 THRUST CONSTANT K 2.84 Lbs./Ft of HEAD.

HP	IMPELLER No.	STAGES	IMPELLER Dia.
25	M08293	2	5.31" @ 20" (4.60")
20	M08291	2	5.19" @ 42" (4.25")
15	M08292	2	4.81" @ 33" (3.75")
10	M08291	1	5.19" @ 42" (4.25")

OUTLINE DIMENSIONS



- A- ONE STAGE LIQUID END LENGTH
 B- SUCTION CONNECTION LENGTH
 C- STAGE LENGTH
 D- DISCHARGE CONNECTION LENGTH
 E- BOWL DIAMETER
 F- DIAMETER ACROSS LEAD GUARD

BOWL DATA

 BOWL No. L06688 PUMP SHAFT DIA. 1"
 TYPE: THREADED DISCHARGE SIZE 6" NPT(MALE)
 5" NPT(FEMALE)

NOTE: For each additional stage add 'C'

A	B	C	D	E	F	HP RATING	MOTOR FLANGE
19.94	10.94	6.50	2.50	6.50	6.94	10-25	6"

8. POSSIBLE CONTAMINATION SOURCES:

Is there evidence of Chemigation? ☐ Yes ☒ No

If yes, is there a check-valve present? ☐ Yes ☐ No

Is there a possible source of contamination nearby? ☐ Yes ☒ No

If yes, what Type? _____

How far away from the well is this source? _____

9. REMARKS:

This well provides fire protection, only,
for the Pellet manufacturing plant.
The name has changed from Sawtooth
Pellet Co. to Sawtooth Forest Industries, Inc.

Don Conrad

Signature of Dept. Representative & Title

Water Rights Examiner

6-11-98

Inspection Date

PHOTOS, DRAWINGS, OTHER ATTACHMENTS:





1 of 3
P/u
Pellet
Plant at
8758
Melmont
Rd.

View
Looking
North.



P/D
Fire
Protection
well on
North side
of plant.

6" steel
Pipe (Green)
fills 8,000
Gal. storage
tank (Black).
63-12343



2 of 3

P/D

Well and
8,000 Gzl.
Storage
Tank.

Note
over flow
line
(white)
on Tank.


Green pipe
is filling
line



P/u

30 HP
fire
Pump
used to
pressurize
system
to 70 psi
when
fighting a
fire.

63-12343

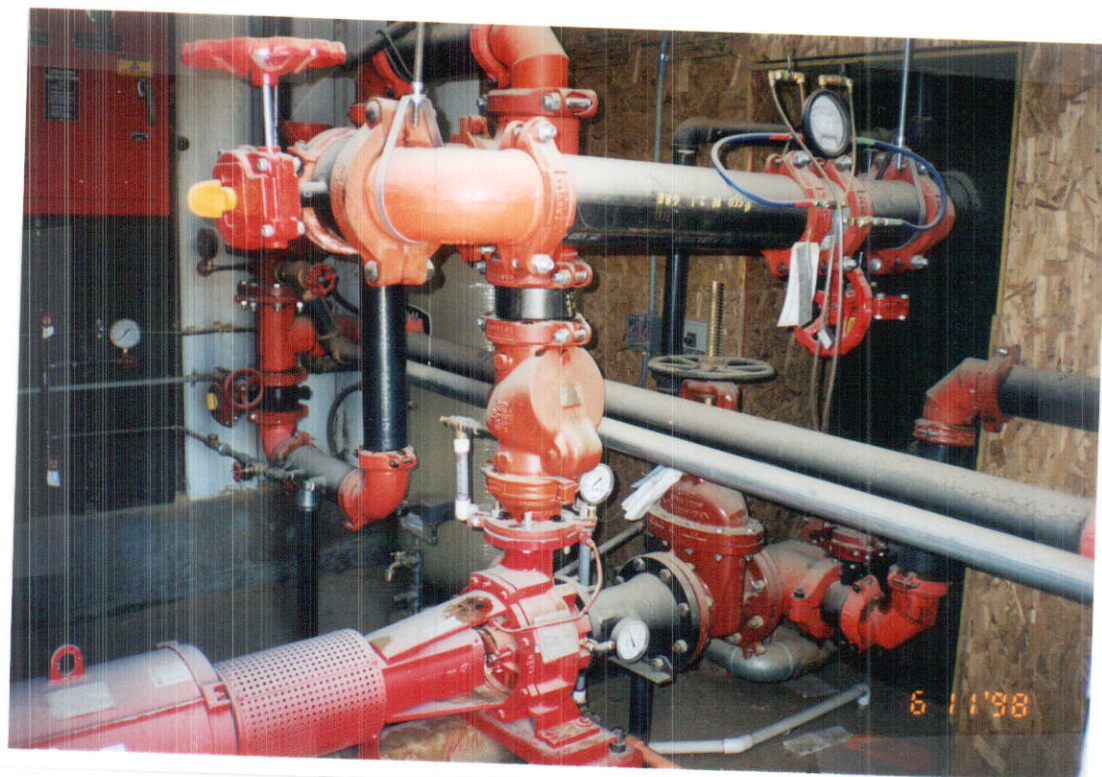

Plu

Fire pump, piping, valves, controls,
etc. on North Side of Plant.

Fire Pump (red) takes water
from 8,000 Gal. Storage tank,
(Black) and pumps to Sprinkler
system.

BEFORE THE DEPARTMENT OF WATER RESOURCES

OF THE

STATE OF IDAHO

IN THE MATTER OF PERMIT NO. 63-12343	)	ORDER OF
	)	
IN THE NAME OF SAWTOOTH PELLET CO.	)	REINSTATEMENT
	)	

WHEREAS, the Department issued the above-captioned permit with the condition that proof of construction of works and application of water to beneficial use (proof of beneficial use) be submitted to the Department on or before September 1, 1997; and,

WHEREAS, the Department notified the permit holder on June 30, 1997, by certified mail that proof of beneficial use was due and instructed the permit holder of the steps to be taken to submit the proof of beneficial use; and,


WHEREAS, the department lapsed the permit on September 8, 1997, since an acceptable proof of beneficial use or extension of time request had not been received; and,

WHEREAS, Section 42-218a, Idaho Code, provides that the Department may reinstate a permit upon a showing of reasonable cause by the permit holder within sixty days of the date of the notice of lapsing; and,

WHEREAS, the permit holder has provided a reasonable showing why the permit should be reinstated by submitting an acceptable proof of beneficial use on September 22, 1998;

IT IS, THEREFORE, HEREBY ORDERED that Permit No. 63-12343 is **REINSTATED** with an advance in priority to **July 12, 1996**.

DATED this 24th day of February, 1998.

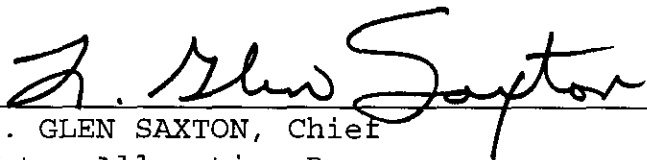

L. GLEN SAXTON, Chief
Water Allocation Bureau

RECORDED
FEB 26 1998

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

RECEIVED

SEP 22 1997

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or be accompanied by a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 63-12343 Telephone No. 208-445-1200
2. Name(s) of Permit Holder(s): Sawtooth Pellet CO.
3. Mailing Address: 8758 Melmont Rd Melba, Id 83641
4. Source of Water: well If GROUNDWATER (well), Date Drilled: mo. 8 1 yr. 96
- a. Well Driller: Adamson Pump & Drilling Drilling Permit Number: 63-96-W-0417-0000
- b. OPTIONAL:
Pump Horsepower: _____ Pressure (psi): _____ Dynamic pumping level (ft): _____

5. Use(s) (as authorized by the water right permit):

Domestic (No. of households): _____ Stockwater (No. and type of stock): _____

Irrigation (No. of acres): _____ Other: Fire Protection

6. Total rate of diversion and/or volume for which proof is submitted: 1.11 cfs OR _____ acre feet

7. Measuring Device Requirement: (refer to the approval conditions on your permit and respond accordingly)

(This question is not optional. Please check either yes or no. Proofs returned not checked accordingly, will be considered incomplete)

Measuring Device:	Is a measuring device required?	Yes _____	or	No <u>✓</u>
	Has the measuring device been installed?	Yes _____	or	No <u>✓</u>
Flow Measurement Port:	Is a flow measurement port required?	Yes _____	or	No <u>✓</u>
	Has the measurement port been installed?	Yes _____	or	No <u>✓</u>

8. Fee Enclosed: \$ 125.00 (See Fee Schedule on back of the instructions for filing proof of beneficial use)

9. Person to contact to accompany the Department representative during field examination of the water system.

Name: Clint Neider Telephone Number: 445-1200

Address: 8758 Melmont Rd Melba Id 83641

10. The information given on this form is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the State of Idaho.

Signature of permit holder: [Signature]
(include your title, if on behalf of company or organization)
General manager

Date: 9-4-97

FEB 26 1998

State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 63-12343

Proposed Priority: June 20, 1996

Maximum Diversion Rate:

1.11 CFS

This is to certify, that **SAWTOOTH PELLET CO**
8758 MELMONT RD
MELBA ID 83641

has applied for a permit to appropriate water from: **GROUNDWATER**

and a permit is **APPROVED** for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
FIRE PROTECTION	01/01 to 12/31	1.11 CFS

LOCATION OF POINT(S) OF DIVERSION:

SWSW , Sec. 15, Township 01N, Range 02W
SESW , Sec. 15, Township 01N, Range 02W
CANYON County

PLACE OF USE: FIRE PROTECTION

TWN RGE SEC

01N 02W 15

SWSW

SESW

CONDITIONS OF APPROVAL AND REMARKS


1. Proof of construction of works and application of water to beneficial use shall be submitted on or before **September 1, 1997.**
2. Subject to all prior water rights.
3. After specific notification by the department, the right holder shall install a suitable measuring device or shall enter into an agreement with the department to determine the amount of water diverted from power records and shall annually report the information to the department.
4. The issuance of this right does not grant any right-of-way or easement across the land of another.
5. Single point of diversion located on or near line between SWSW and SESW, S15, T01N, R02W.
6. Single place of use located on or near line between SWSW and SESW, S15, T01N, R02W.
7. Water shall not be diverted under this right except to fight or repel an existing fire.
8. Water bearing zone to be appropriated is 130 to 220 feet.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the signature of the Director, affixed at Boise, this

16th day of August, 1996.



AUG 21 1996

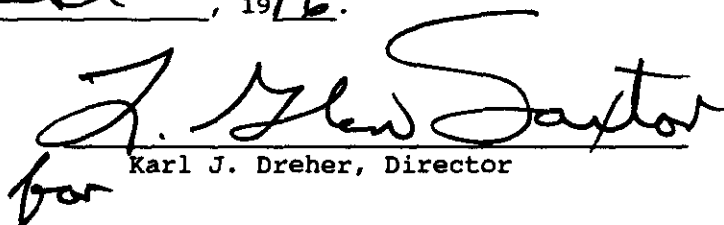
Karl J. Dreher, Director

RECEIVED
AUG 08 1996

Ident. No. 63-12343

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

Department of Water Resources

APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

1. Name: SAWTOOTH PELLET CO
Address: 8758 MELMONT RD
MELBA ID 83641
208-495-1200
2. Source: GROUNDWATER
3. Location of Point of Diversion: Trib. to:
SWSW Sec. 15, Township 01N, Range 02W
SESW Sec. 15, Township 01N, Range 02W
CANYON County
4. Water will be used for the following purposes:

Purpose	From	To	CFS	(or)	AF
FIRE PROTECTION	01/01	12/31	1.110		
5. Total quantity to be appropriated is:
1.110 CFS (and/or) AF
6. Proposed diverting works:
 - a. Description of ditches, flumes, pumps, headgates, etc.
WELL, PUMP AND PIPELINE.
 - b. Height of storage dam feet; active reservoir capacity
acre-feet; total reservoir capacity acre-feet; period of
year when water will be diverted to storage: to inclusive.
 - c. Proposed well diameter is inches; proposed depth of well is
feet.
 - d. Is groundwater with a temperature greater than 85F being sought? NO
 - e. If well is already drilled, when?
Drilling Firm
Well was drilled for
7. Time required for the completion of the works and application of
the water to the proposed beneficial use is 1 year(s).
8. Place of Use: FIRE PROTECTION

TWN RGE SEC
01N 02W 15

SWSW

SESW

AUG 21 1996

9. a. Who owns the property at the point of diversion?
APPLICANT
b. Who owns the land to be irrigated or place of use?
LEASE WITH OPTION TO BUY.
c. If the property is owned by a person other than the applicant,
describe the arrangement enabling the applicant to make this filing.
LEASE WITH OPTION TO BUY.

10. Remarks:

Water bearing zone to be appropriated is 130 to 220 feet. For
emergency fire use only.

11. Map of proposed point of diversion and place of use attached? []

BE IT KNOWN that the undersigned hereby makes application for permit to
appropriate the public waters of the State of Idaho as herein set forth.

See Original
Applicant

Received by _____ Date _____ Time _____ Preliminary check by _____

Fee \$ 320.00 Receipted by _____ #W021067 Date 6/20/1996

Publication prepared by _____ Date _____ Published in _____

Publication approved _____ Date _____

RECEIVED
AUG 21 1996

Ident. No. 63-12343

Comments: Date: 6/25/1996 User-ID: CHODGES

Subject: APPLICATION INFO

Fire protection is for warehouse sprinkler system at Sawtooth Pellet Co. as required by Canyon Co. planning and zoning. Single well on/near QQ line. Drill permit 63-96-W-0417-000 issued 6/24/96 with restrictive conditions. Company Pres = Jay Dee Karren; Sec/Mgr = Clint M. Neider.

Comments: Date: 6/25/1996 User-ID: CHODGES

Subject: PROCESS DELAY EXEMPTION

Application proposes emergency fire protection uses only, exempt from process delay. Water right required but mitigation not necessary, per NCY call to SL on 6/20/96.

APPROVED
JUL 1 1996

Ident. No. 63-12343

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT
To appropriate the public waters of the State of Idaho

1. Name of Applicant Sawtooth Pellet Co. Phone 208-495-1200
Mailing address 8758 Melmont RD MELBA, ID 83641
2. Source of water supply Groundwater which is a tributary of N/A
3. Location of point of diversion is Township 1N Range 2W Sec. 15 in the S.W 1/4, S.W 1/4, Govt. Lot _____, B.M., Canyon County; additional points of diversion if any: 1/4 SE SW 5.15 T1N R2W
4. Water will be used for the following purposes:
- 1.11 Amount 500 GPM for Fire Protection purposes from 1/1 to 12/31 (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
5. Total quantity to be appropriated is (a) 1.11 and/or (b) _____
cubic feet per second acre feet per annum
6. Proposed diverting works:
- a. Describe type and size of devices used to divert water from the source N/A WELL, pump & pipeline to 8000 g. storage tank, then pump to warehouse sprinkler system.
- b. Height of storage dam N/A feet; active reservoir capacity N/A acre-feet; total reservoir capacity N/A acre-feet
- c. Proposed well diameter is 10" inches; proposed depth of well is 220' feet
- d. Is ground water with a temperature of greater than 85°F being sought? No
- e. If well is already drilled, when? N/A; Drilling firm N/A
Well was drilled for (well owner) N/A; Drilling Permit No. N/A
7. Time required for completion of works and application of water to proposed beneficial use is 1 years (minimum 1 year)
8. Description of proposed uses (if irrigation only, go to item 9):
- a. Hydropower; show total feet of head and proposed capacity in KW. N/A
- b. Stockwatering; list number and kind of livestock. N/A
- c. Municipal; show name of municipality. N/A
- d. Domestic; show number of households. N/A
- e. Other; describe fully. N/A

AUG 21 1996

9. Description of place of use:

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RGE	SEC	N E				N W				S W				S E				TOTALS
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
1N	2W	15											✓	✓					—

Total number of acres to be irrigated N/A

10. Describe any other water rights used for the same purposes as described above. N/A

11. a. Who owns the property at the point of diversion? N/A ? Paul Wynia
- b. Who owns the land to be irrigated or place of use? N/A
- c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: lease with option to buy

12. Remarks: Fire prot. is for warehouse sprinkler system at Southcoth Pellet Co.
1 well on/ near RR line
PRES. = Jay Dec KAREN; Sec'y/Mgr. = Clint M. Neider.
Proposed water bearing zone is 130-220' (per nearby well log for
ing. well).


13. MAP OF PROPOSED PROJECT REQUIRED - Attach an 8½"x11" map clearly identifying the proposed point of diversion, place of use, section #, township & range. (A photocopy of a USGS 7.5 minute topographic quadrangle map is preferred.)

BE IT KNOWN that the undersigned hereby makes this application for permit to appropriate the public waters of the State of Idaho as herein set forth.

REVISED WITH APPLICANT
 PER 6/20/96 office visit.

[Signature] 1995
 Signature of Applicant (and title, if applicable)

Received by [Signature] Date 6/20/96 Time 12:35 Preliminary check by cje
 Fee \$ 120 Receipted by [Signature] # W021057 Date 6/20/96
 Publication prepared by [Signature] Date 6-26-96 Published in Press-trib.
 Publication approved [Signature] Date 7-24-96

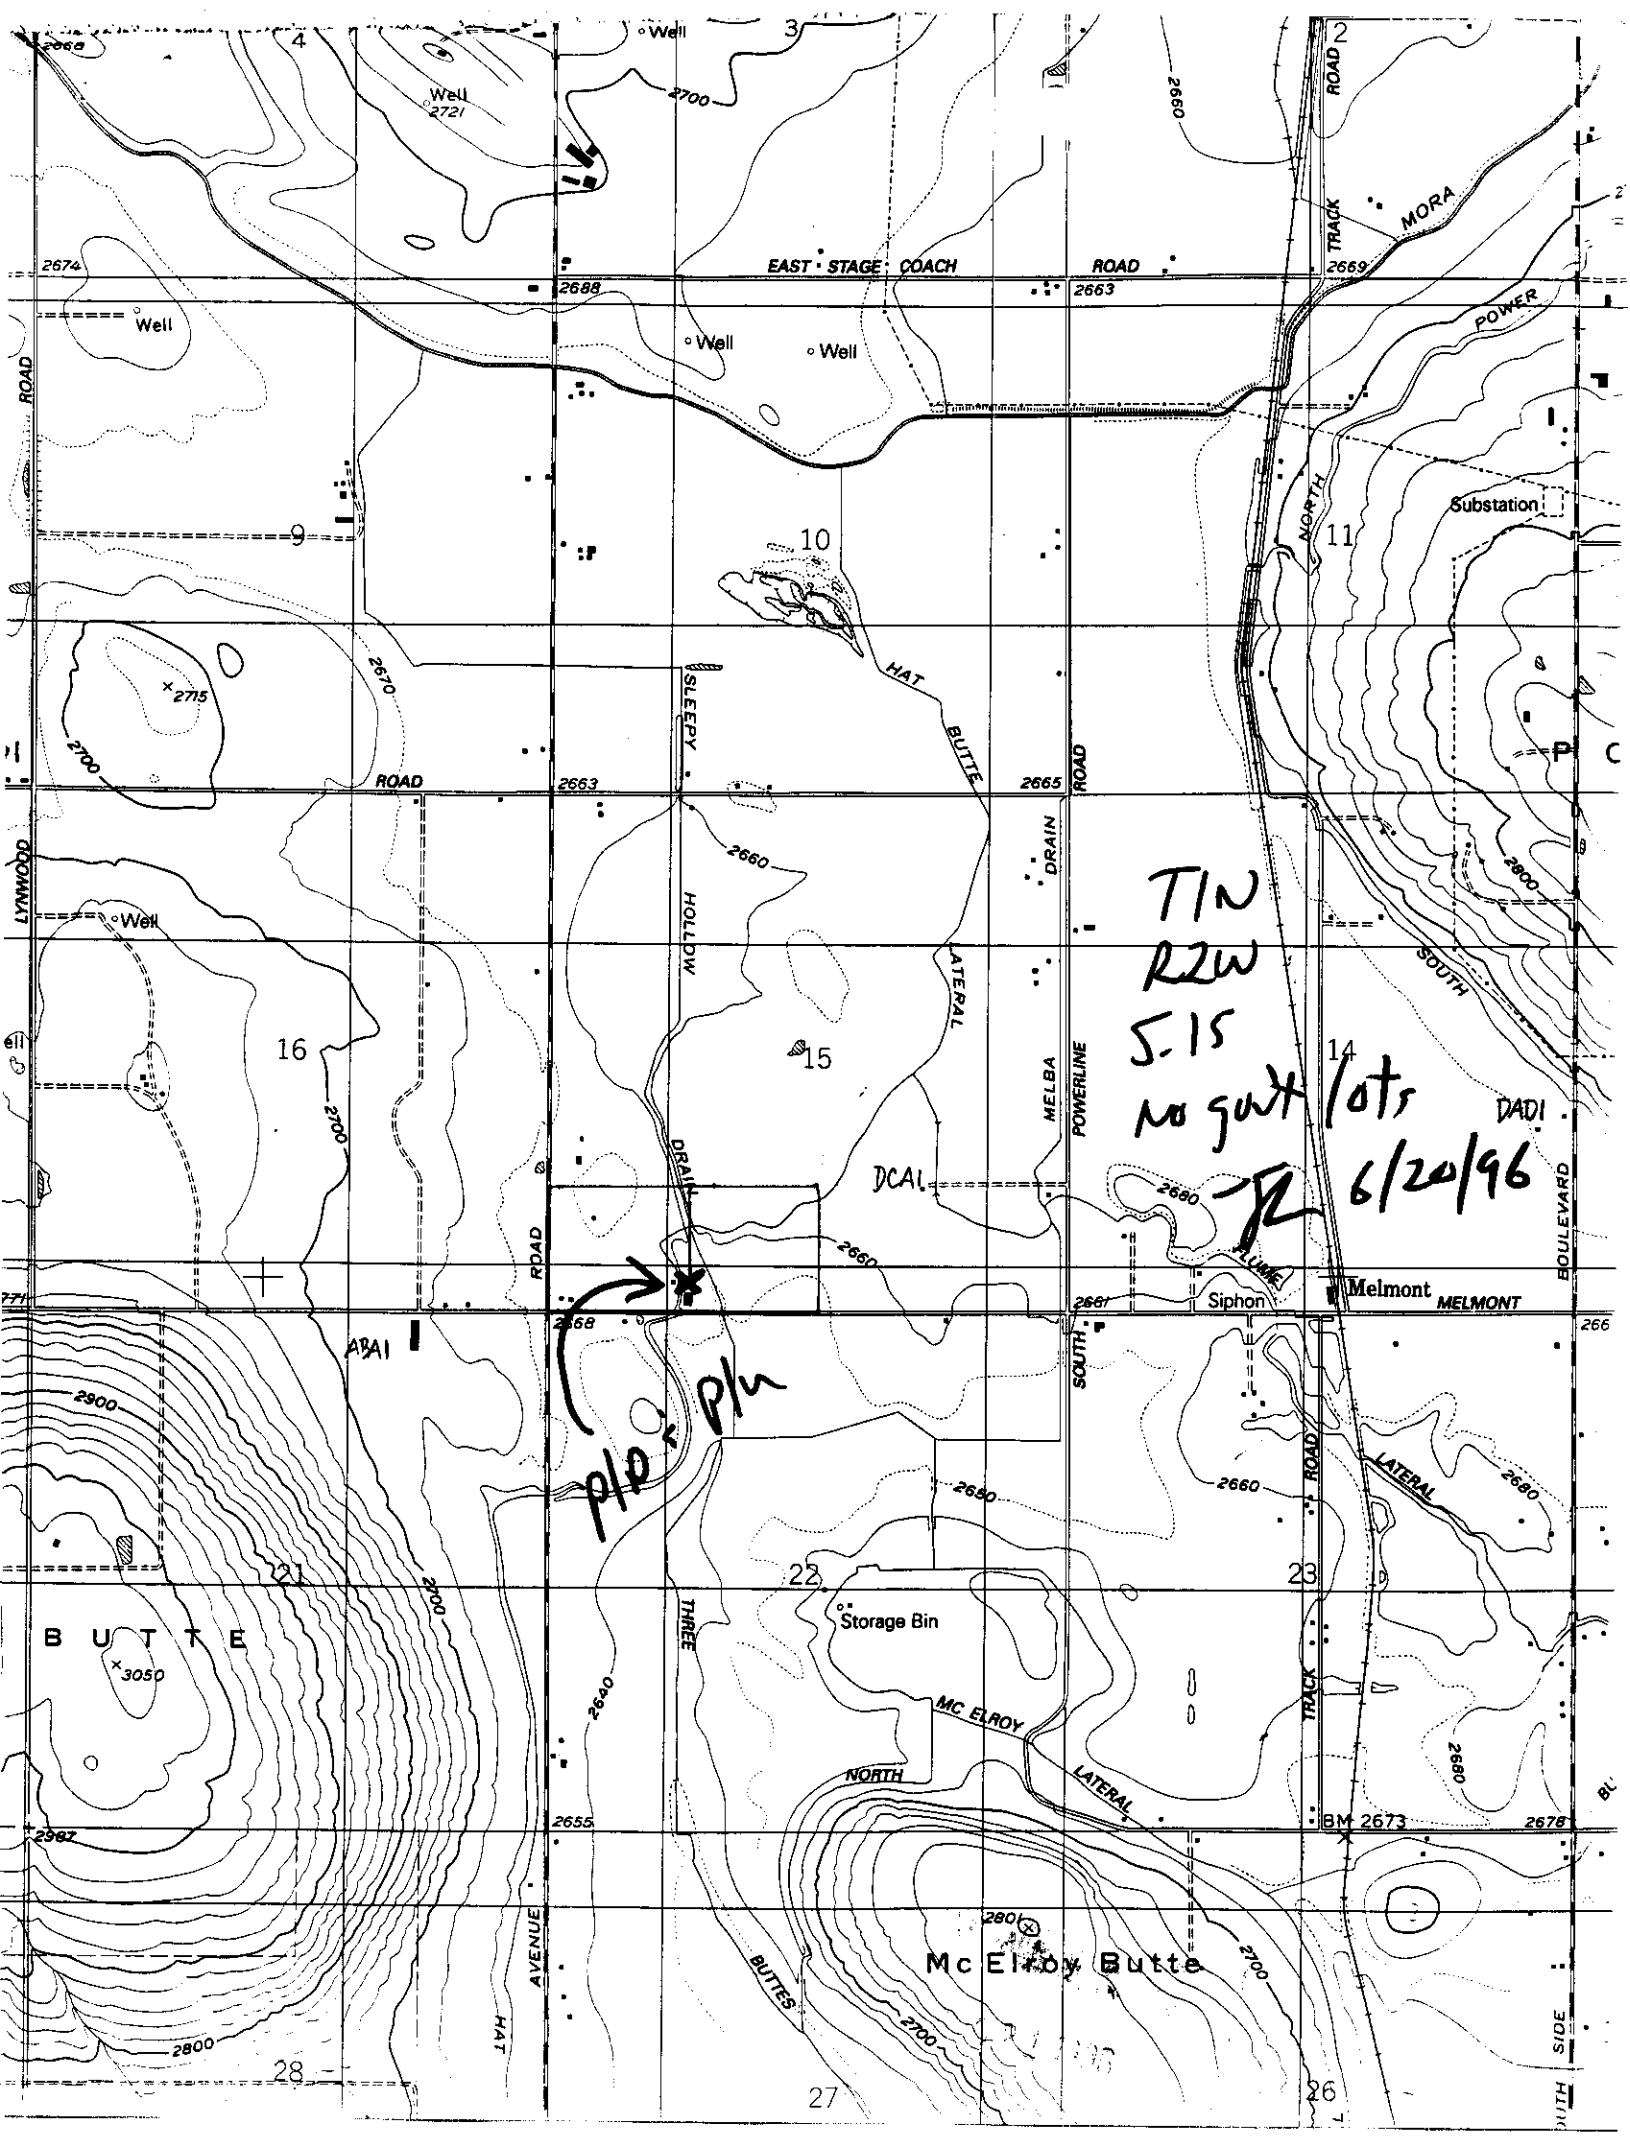

TIN
R2W
S.15
No gult lots
6/20/96
JR

P/L P/L

Drilling Permit No. 63-96-W-0417-000
 Water Right Permit No. 63-12343
 Injection Permit No. _____

WELL DRILLER: PLEASE COMPLETE FOR VERBALS

IDWR Employee Issuing Verbal: _____

Verbal Issued Date: _____ Time: _____

C

Appl. pending
 -SL 5/20/96

State of Idaho
 Department of Water Resources

APPLICATION FOR DRILLING PERMIT
 (FOR THE CONSTRUCTION OF A WELL)

1. Applicant (please print): Sawtooth Pellet Co.
2. Mailing Address: 8758 Melmont RD
 City & State IDAHO/MELMONT Zip Code 83641 Telephone 208-495-1200
☒ Well Owner ☐ Well Operator ☐ Contractor or Other, specify _____
3. Proposed Well Location: Twp. 1N, Rge. 2W, Sec. 15, S.W. 1/4 S.W. 1/4
 Gov't Lot No. _____ County CANYON OR SE SW (NEAR line)
 Street Address of Well Site 8758 Melmont RD City MELMONT
Give at least name of road + Distance to Road or Landmark
 Lot, block and subdivision _____
4. Proposed Use of Well: single well on near line in 5 1/2 SW 1/4

☐ DOMESTIC: The use of water for homes, organization camps, public campgrounds, livestock (1,000 head or less) and for any other purpose in connection therewith, including irrigation of up to 1/2 acre of land, if the total use is not in excess of 13,000 gpd; or any other uses, if the total use does not exceed a diversion rate of 0.04 cfs and a diversion volume of 2500 gpd.

Domestic does not include water for multiple ownership subdivisions, mobile home parks, commercial or business establishments, unless the use does not exceed a diversion rate of 0.04 cfs and a diversion volume of 2500 gpd.

NON-DOMESTIC: ☐ Irrigation ☐ Municipal ☐ Industrial
☐ Stock ☐ Test ☒ Other Fire Protection
 (Over 1,000 Head) (Describe) 0.11 cfs

☐ INJECTION

☐ MONITORING: A well bore schematic and map is required for each blanket permit.
 No. of proposed wells: _____

5. Well Construction Information:

- A. ☒ New well ☐ Modify ☐ Replace
- B. Proposed Casing Diameter 10" Proposed Maximum Depth 220'
- C. Anticipated bottom hole temperature:
☒ 85°F or less (Cold Water Well) ☐ 85°F to 212°F (Low Temp. Geo. Well) ☐ 212° F. or more (Geothermal Well)

6. Construction Start Date: ASAP

7. Anticipated Well Driller: CAN-ADA Well Drilling Driller's Lic. No. 304
 NOTE: The actual well driller must be identified prior to drilling.

8. Applicant's Signature [Signature] Date 6-20-96
 Title Manager

(Owner, Firm Representative, Other)

AUG 21 1996

ACTION OF THE DEPARTMENT OF WATER RESOURCES

This Permit is Approved

Date 6-24-96

If approved, this permit authorizes the construction or modification of a well subject to the following conditions. READ CAREFULLY!

GENERAL CONDITIONS:

1. This drilling permit is valid for two (2) months from the above approval date for the start of construction and is valid for one (1) year from the approval date for completion of the well unless an extension has been granted.
2. This permit does not constitute an approval of the District Health Department or the Idaho Department of Health and Welfare which may be required before construction of this well. All wells must be drilled a minimum distance of 100 feet from a drain field. Domestic and Public Water Supply wells must be drilled a minimum of 50 feet and 100 feet respectively from a septic tank.
3. The well shall be constructed by a driller currently licensed in the State of Idaho who must maintain a copy of the drilling permit at the drilling site.
4. Approval of this drilling permit does not authorize trespass on the land of another party.
5. This permit does not constitute other local, county, state or federal approvals which may be required for construction of a well.
6. This drilling permit does not represent a right to divert and use the water of the State of Idaho.
7. If a bottom hole temperature of 85° or greater is encountered, well construction shall cease and the well driller and the well owner shall contact the Department immediately.

SPECIFIC CONDITIONS:

8. Unperforated Casing Shall extend from 12" above land surface to a depth not less than 130' below land surface. Total depth of this well shall not exceed 220' without prior approval.
9. Use of water from this well is not approved pending approval of a water right application, and shall be limited for suppression of a fire. No other use from this well is authorized.

Steve Latta
Signature of Authorized Department Representative

Deputy Regional Manager
Title

Receipt No. W021067 Received by RL Fee \$200 Date 6/20/96


EXTENSION OF DRILLING PERMIT

Extension approved by _____ Approval Date _____

This extension expires: _____

AUG 21 1996

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

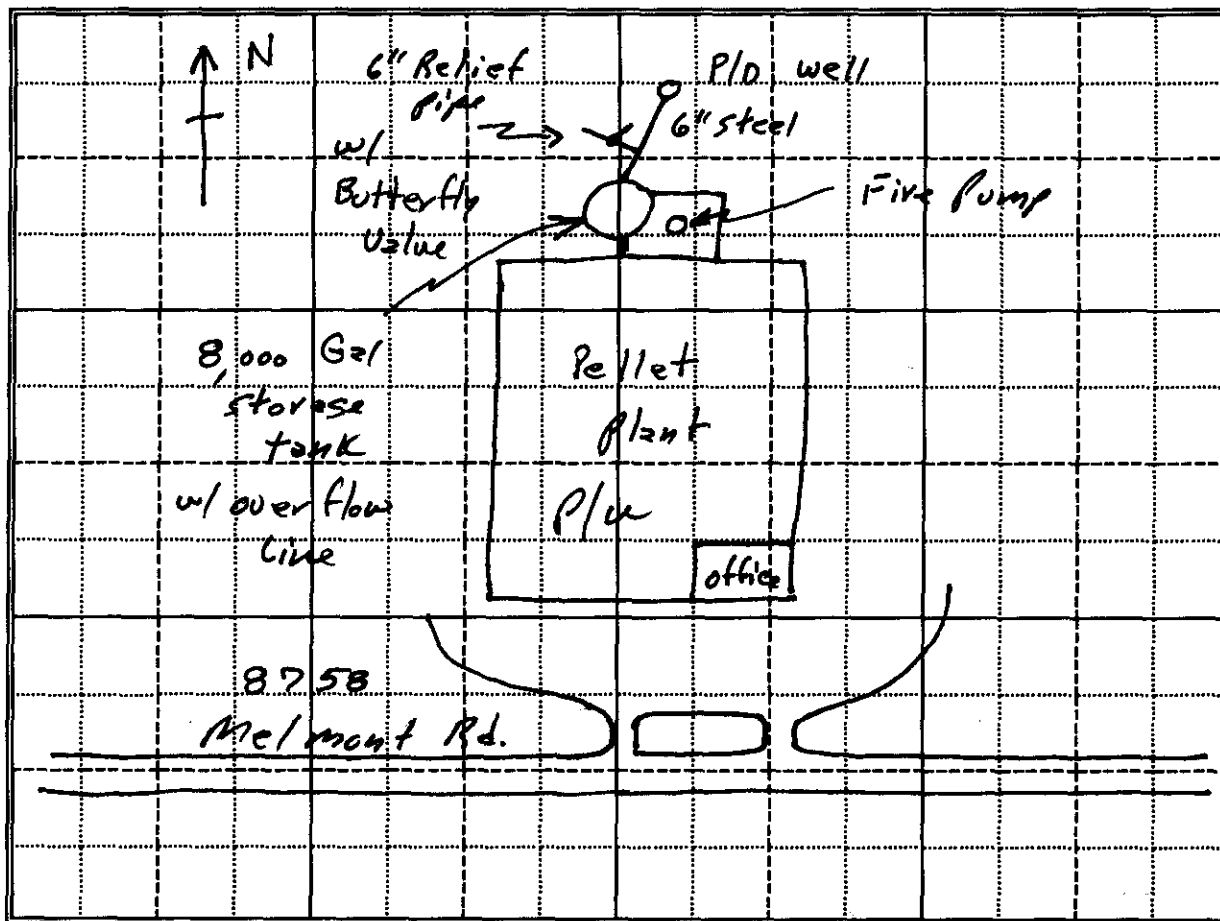

Scale: 1" = None

☒ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

☐ Aerial Photo Attached (required for irrigation of 10+ acres)

☒ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
		25		Berkeley	Model 7T-500 2 stage


*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: None - pump off

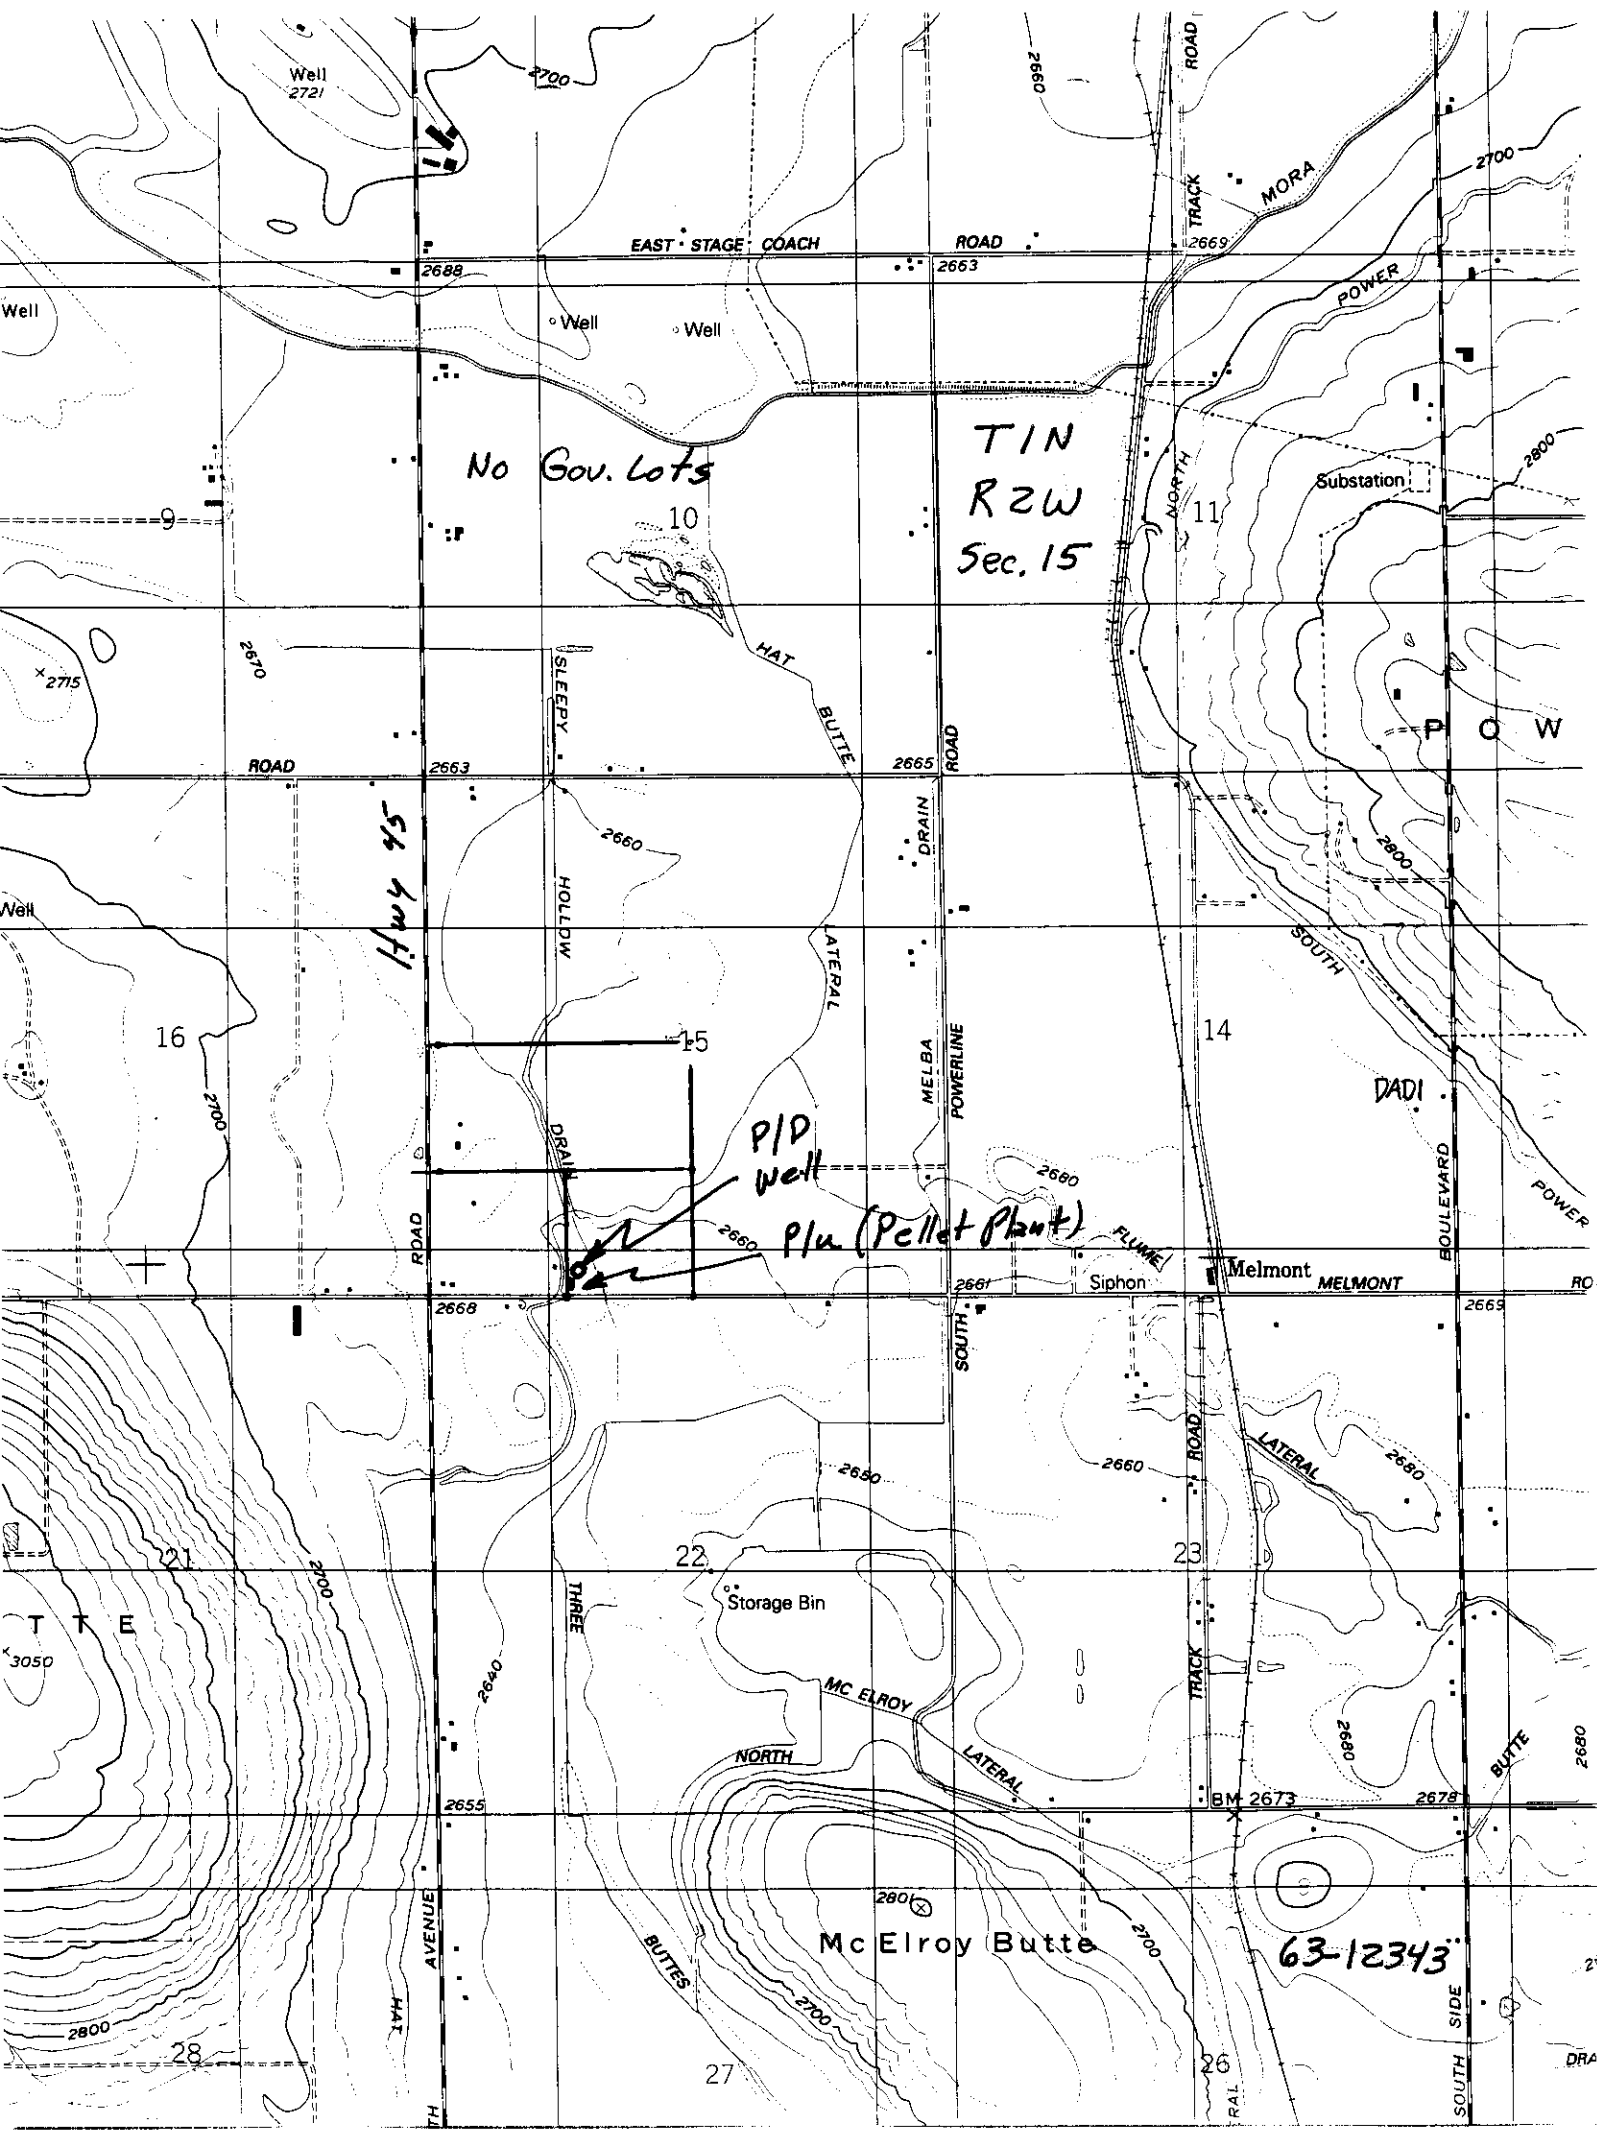

Original - S.O. file 63-12343
cc } - Requir " "
" " 63-96-W-0417-000

63-12343

CONVERSATION MEMORANDUM

DATE 8/15/46

FILE 63-96-W-0417-000

NAME OF PARTY Bill from D. Adamson Pump + Drilling 63-12343

EMPLOYEE Steve Leth

RE: REQUEST FOR CLARIFICATION & CASING REQUIREMENT

Appl. for W.R. = fire protection only.

Cond. 2: W.O. cond. Requir unperforated csg. to c 130'

IN process of drilling now.

So far - at 140' 10" hole.

4'-140' hard basalt, no water. Expect
hit water c 150' & static to rise
to c 120' per nearby well logs.

Due to drilling situation, very difficult to
place casing below 40' level where
csg. now ends. Thinks will be very
expensive to increase hole diameter & then
get csg. from 40' to 130'.

Since no water & all rock all the way
to 140', can leave as cased only to 40'?


If so, can finish drilling soon.

Per his well log same, nearby wells cased
to only c 40'.

→ I told him that looked like situation where OK
to modify requirement where cased ~~only~~ to 40',
Resume drilling.

Submersible Turbine Model 7T-500

495-1209 FAX

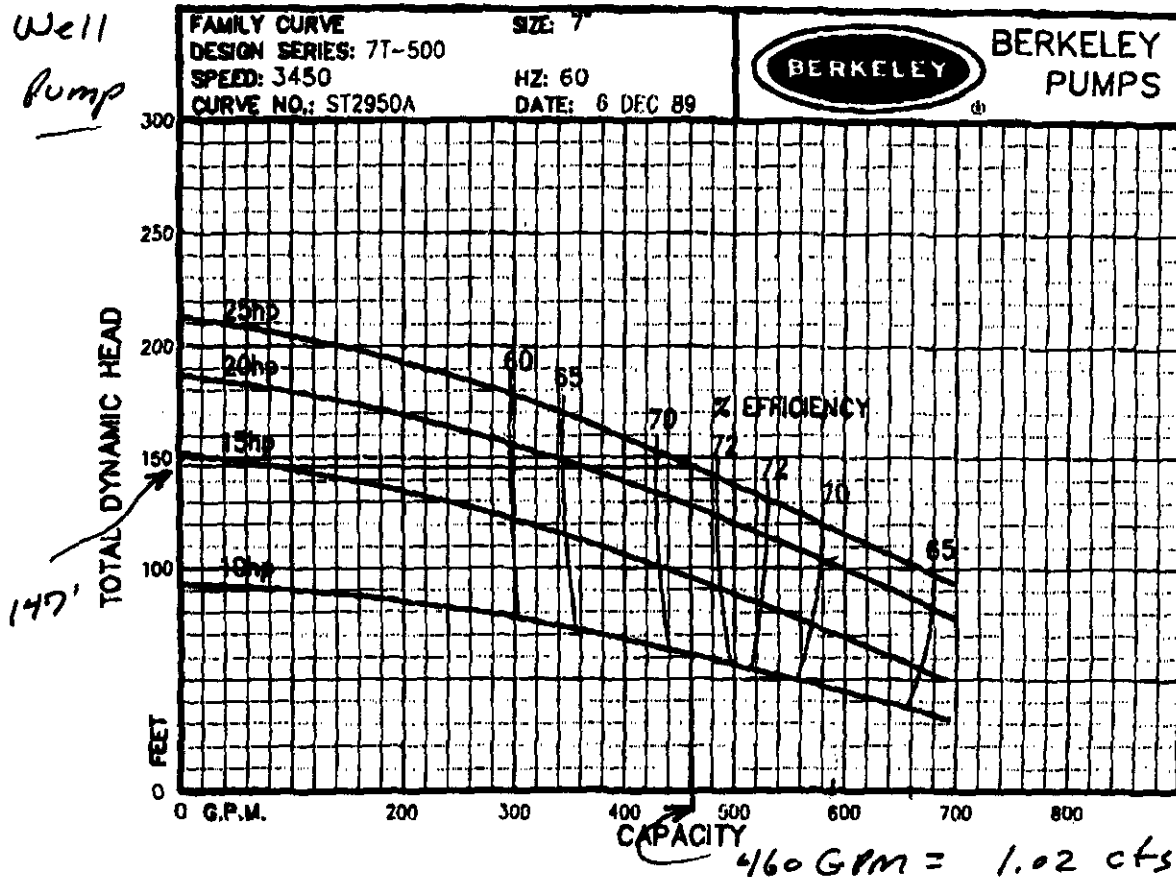Well
Pump

Specifications

25 HP Motor

63-12343

CURVE No. ST2950A

LIQUID END WEIGHTS

DESCRIPTION	WEIGHT LBS.	HP RATING	MOTOR FLANGE
ONE STAGE L.E.	59.8	10-25	6"
ONE STAGE L.E.			
ONE STAGE L.E.			
EACH ADDED STAGE	28.0	ALL	ALL

IMPELLER DATA

TYPE: ENCLOSED EYE AREA 8.19 Sq. In.
 THRUST CONSTANT K 2.84 Lbs./Ft of HEAD.

HP	IMPELLER No.	STAGES	IMPELLER Dia.
25	M08293	2	5.31" @ 20' (4.68")
20	M08291	2	5.18" @ 42' (4.25")
15	M08292	2	4.81" @ 33' (3.75")
10	M08291	1	5.18" @ 42' (4.25")

OUTLINE DIMENSIONS



- A- ONE STAGE LIQUID END LENGTH
- B- SUCTION CONNECTION LENGTH
- C- STAGE LENGTH
- D- DISCHARGE CONNECTION LENGTH
- E- BOWL DIAMETER
- F- DIAMETER ACROSS LEAD GUARD

BOWL DATA

BOWL No. L06688 PUMP SHAFT Dia. 1"
 TYPE: THREADED DISCHARGE SIZE 6" NPT(MALE)
 5" NPT(FEMALE)

NOTE: For each additional stage add 'C'

A	B	C	D	E	F	HP RATING	MOTOR FLANGE
19.94	10.94	6.50	2.50	6.50	6.94	10-25	6"

REVISED 17-06-86

AB80314

IDAHO DEPARTMENT OF WATER RESOURCES

WELL INSPECTION FORM

1. DRILLING PERMIT NO: 63-96-W-0417-0000 OTHER APPLICABLE NO: 63-12343
(Formerly Sawtooth Pellet Co.)
2. OWNER: Sawtooth Forest Industries, Inc. Phone: (208) 495-1200
Address: 8758 Melmont Rd, Melba, ID 83641
3. WELL LOCATION: Twp 1 N, Rge. 2 W, Sec. 15, SE 1/4 SW 1/4
County Canyon (Provide sketch map and photo on reverse.)
4. DRILLER: Adamson Pump & Drilling Lic. No. 0457
When Drilled? 3/14/96 to 3/16/96
5. WELL CONSTRUCTION:
- Casing Diameter 10 inches Water tight cap? ☒ Yes ☐ No Access Port: ☒ Yes ☐ No
Casing $\geq$ 12 inches above ground? ☒ Yes ☐ No - Describe _____
Depth of Casing 40 ft. Method Drilled Air Rotary
Condition of Well Casing: ☒ Good ☐ Fair ☐ Poor Describe _____
Control Valve? ☒ Yes ☐ No Pressure Gauge: ☒ Yes ☐ No
Condition of Piping and Valving Good
Auger to a depth of _____ ft. Evidence of Annular Seal ☒ Yes ☐ No
Are there obvious construction problems that may be a source for contamination or waste of water?
☐ Yes ☒ No (Describe in Remarks and Attach Photo - On Reverse)
well depth is 232'
6. HYDROLOGIC INFORMATION:
- Depth to Static Water 122 ft. Water Temperature 58 °F
Flowing Artesian ☐ Yes ☒ No Pressure: _____ (psi)
Water Sample Taken? ☐ Yes ☒ No If yes, describe purpose _____
Water Quality Measurements/Observations (Describe) _____
7. WELL USE:
- | | | |
|------------------------------------|---|-------------------------------------|
| ☐ Domestic | ☐ Irrigation | ☐ Stock |
| ☐ Test | ☐ Municipal | ☐ Industrial |
| ☐ Abandoned | ☐ Waste Disposal/Injection | ☐ Not Used |
- ☒ Other: Fire Protection

8. POSSIBLE CONTAMINATION SOURCES:

Is there evidence of Chemigation? ☐ Yes ☒ No

If yes, is there a check-valve present? ☐ Yes ☐ No

Is there a possible source of contamination nearby? ☐ Yes ☒ No

If yes, what Type? _____

How far away from the well is this source? _____


9. REMARKS:

*This well provides fire protection, only,
for the Pellet manufacturing plant.
The name has changed from Sawtooth
Pellet Co. to Sawtooth Forest Industries, Inc.*

Don Conrad Water Rights Examiner
Signature of Dept. Representative & Title

6-11-98
Inspection Date

PHOTOS, DRAWINGS, OTHER ATTACHMENTS:

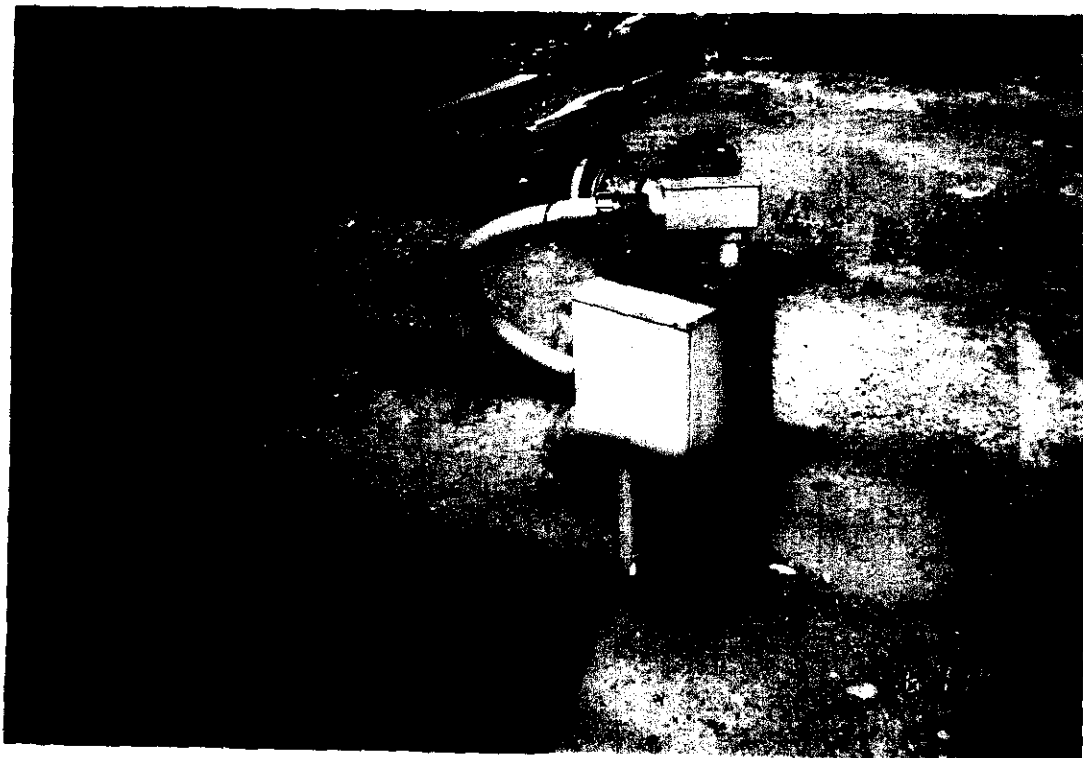



L of 3

P/u

Pellet

Plant at

8758

Melmont
Rd.

View

Looking

North.



P/D

Fire

Protection

well on

North side

of plant.

6" steel
pipe (Green)

Fills 8,000

Gal. storage
tank (Black).

63-12343



2 of 3

P/D

Well and
8,000 Gal.
Storage
Tank.

Note
over flow
line
(white)
on Tank.

Green pipe
is filling
line



P/u

30 HP
fine
pump
used to
pressurize
system
to 70 psi
when
fighting a
fire.

63-12343



Plu Fire pump, piping, valves, controls,
etc. on North Side of Plant.

Fire pump (red) takes water
from 8,000 Gal. Storage tank,
(Black) and pumps to Sprinkler
system.

old
well
in SWSW,
S. 15

8. Water for the office and bathroom is piped from an old well located about 80' west and 150' Nth of this well. The old well is owned by Paul Wynia. Clint Neider plans to file an application for a Commercial Use from this old well - No driller's report or WR found for this well.

1. This permit is for the fire protection well, only, at the Pellet plant. The well supplies water to the fire protection system which consists of a 8,000 Gal. storage tank, a 30 HP, 500 GPM fire pump, piping, valves, controls, etc, and an overhead sprinkler system in the plant. The well pumps to the tank, and the fire pump supplies the pressure needed for the sprinklers.
2. In the event of a plant fire, the 30 HP fire pump would operate the overhead sprinklers at 70 psi, taking water from the 8,000 Gal. storage tank, and the well would be pumping water to the storage tank until the fire was out and the system shut down.
3. The fire pump is an ITT A-C pump with a 30 HP U.S. Electric Motor rated at 500 GPM @ 70 psi. The model is a 2000, (series) and the size & type are 4X3X9F.
4. The system is controlled automatically by heat and smoke sensors and associated control devices.
5. There is no flow meter in the fire system.
6. Sawtooth Pellet Co. name has been changed to Sawtooth Forest Industries, Inc.
Have conditions of permit approval been met? ☒ yes ☐ no
7. For Condition 8: See Conv. memo of 8/15/96. Well was drilled to 232', but only cased to 40' due to basalt formations. This was approved for modification of Condition 8. Water zone was at about 180', and rose to 122' in well. [Cond. 8 - 130' to 220' zone] (180')

F. FLOW CALCULATIONS

Additional Computation Sheets Attached

Measured Method: None - Theoretical Cal.

Well pumps to 8,000 Gal. storage tank only (Fire Pump provides Sprinkler Pressure)

$TDH = (122' + 25') @ \text{well pump start-up.}$

$$Q_{\text{well}} = \frac{(8.8)(25 \text{ HP})(70\%) }{(122' + 25')} = 1.05 \text{ cfs}$$

$$TDH = 122' \text{ (well)} \\ + 21' \text{ (tank Ht)} \\ + 4' \text{ (Hf + Hc + Hs)} \\ \hline 122' + 25' \text{ (friction Misc. Velocity Head)} \\ = 147'$$

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 =$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$$

2. Volume Calculations for Other Uses: Fire Protection - Div. rate only.

Div. Rate (cfs):

From Pump Performance Curve, Berkeley Model 7T-500:

@ $TDH = 147'$, $Q = 460 \text{ GPM} = 1.02 \text{ cfs.}$

H. RECOMMENDATIONS

Allow 1.10 cfs

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
<u>Fire Protection</u>	<u>01/01</u>	<u>12/31</u>	<u>1.10</u>	
Totals:			<u>1.10</u>	

2. Recommended Amendments

☒ Change P.D. as reflected above ☐ Add P.D. as reflected above ☐ None
☒ Change P.U. as reflected above ☐ Add P.U. as reflected above ☒ Other

I. AUTHENTICATION

Field Examiner's Name Don Zaniel Date 11-5-98

Reviewer _____ Date _____

1) P/D + P/U are both in SE SW, not on the line with SW SW.

2) Div. rate should be 1.10 - but

SEAL
1.11 cfs
would be OK.

**ANALYSIS SHEET
FOR
PROOF OF BENEFICIAL USE**

Permit No. 63-12343 Reviewed by [Signature] Date 2-19-98

GENERAL CONSIDERATIONS

yes Name same as permit?
yes Address same as permit?
NO Proof timely received?
If not, complete calculation below.

TYPES OF USE

fire Prot.

Correct Uses? yes

SOURCE OF WATER

 Surface water source

✓ Ground water source

yes Drilling permit required?

NO Copy in the file? Drilling Permit No. 63-96-W-0417-000

200- Amount paid for permit yes Correct?

yes Well log in the file?

LICENSE EXAMINATION FEE

yes Required?

125- Amount Submitted

yes Correct?

MEASURING DEVICE

NO Required?

1 Installed?

 Waiver requested?

PRIORITY CALCULATION

Date proof received 9-22-97

Date proof due 9-1-97

No. of days late 21 = 21

Priority Date 6-20-96 + 172

New Priority Date 7-12-96 193

> 7-12-96

DEFICIENCIES OR ACTION ITEMS

Reinstate + advance priority to July 12, 1996.
Proof acceptable

DATA ENTRY

New Address X Proof Made 9-22-97



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

February 24, 1998

Sawtooth Pellet Co
8758 Melmont Rd
Melba ID 83641

PROOF ACKNOWLEDGMENT LETTER

RE: Permit No. 63-12343

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form and supporting information submitted for the above referenced permit.

Enclosed is an order reinstating the permit since proof was submitted after the proof due date. Note that the priority date has been advanced to July 12, 1996, as provided in Section 42-218a.2, Idaho Code.

Be advised that Section 42-248, Idaho Code, requires you or the owner of this water right to maintain current ownership and address records on file with the department. Forms to file a change of ownership of a water right and/or a change in the address of the water right owner are available from any department office.

The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water. If you have questions concerning the field examination, you may contact the **Western** Regional Office of the department in Boise at (208)334-2190.

Sincerely,

JULIE L. YARBROUGH

Senior Secretary, Water Allocation Bureau

Enclosure

c: IDWR - Regional Office

MICROFILMED
FEB 26 1998

I certify that file No. 63-12343

has been reviewed and is ready to be

MICROFILMED and DESTROYED.

The attached proof report is the water right as it appeared in the database prior to final status entry and deletion from the database.

Kari Super
Reviewer

12.15.97
Date

Page 1

Old (D) Number -

+ - - - - - Address - - - - - +

State- ID Zip- 83641

+ - - - Status - - - - +

+ - - - - Tributary - - - - -

```
+-----+-----+-----+-----+-----+-----+-----+-----+-----+-----+
+ - - - - Old Water Right Numbers - - - - - +
+ - - - - No Old Water Right Numbers found. - - - - - +
```

WR5808NP
(00-26)

IDAHO DEPARTMENT OF WATER RESOURCES
WATER RIGHT PROOF READING REPORT

12/09/97 13:51:09
Page 2

Water right number - 63-12343

Prefix Translation: WATER RIGHT

+ - - - - Conditions of Approval - - - - - +
01M - After specific notification by the department, the right holder
- shall install a suitable measuring device or shall enter into an
- agreement with the department to determine the amount of water
- diverted from power records and shall annually report the
- information to the department.
004 - The issuance of this right does not grant any right-of-way
- or easement across the land of another.

+ - - - - Decree Plaintiff - - - +

+ - - - - Decree Defendant - - - +

+ - Decree Date - +

00/00/0000

+ - - - - Comments - - - - - +
Date: 06/25/1996 User Id: CHODGES Subject: APPLICATION INFO
Fire protection is for warehouse sprinkler system at Sawtooth Pellet Co. as required by Canyon Co. planning and zoning.
Single well on/near QQ line. Drill permit 63-96-W-0417-000 issued 6/24/96 with restrictive conditions.
Company Pres = Jay Dee Karren; Sec/Mgr = Clint M. Neider.
Date: 09/08/1997 User Id: VAULT Subject: Lapse Notice Sent
Lapse Notice Sent

+ - - Audit Fields - 06/25/96 CHODGES 08/15/96 CZIMMERM 09/08/97 COMMENTS

+ - - - - Water Rights Dates and Flags Area - - - - - +
Proof Due Date - 09/01/1997 Field Exam Made - 00/00/0000 Field Exam Fee -
Approved/Denied - 08/16/1996 Protested Date - 00/00/0000 Swan Falls -
Proof Made Date - 00/00/0000 Hearing Date - 00/00/0000 Temporary Right - P
Exam to S.O. Date - 00/00/0000 Verified Date - 00/00/0000 DLE/Carey Act -
Order Show Cause - 00/00/0000 Receipt Number - W021067 Water District -
Licensed Date - 00/00/0000 Appl Received - 06/20/1996 Transfer/Amended -
Decree Date - 00/00/0000 Name Connector - POU Ownership Flag- N
Presumption Flag -

LOCK FILE
FEB 26 1998

September 8, 1997

SAWTOOTH PELLET CO
8758 MELMONT RD
MELBA ID 83641

LAPSE NOTICE

RE: PERMIT NO. 63-12343

Dear Permit Holder:

You are hereby notified that under the provisions of Section 42-218A, Idaho Code, the above referenced permit has lapsed and is of no further force nor effect. The department provided the proper forms to you in our proof due notice dated June 30, 1997. No further construction or additional development is authorized under this permit unless it is reinstated.

The permit can only be reinstated if you submit an acceptable proof of beneficial use or an acceptable request for extension of time to the department within sixty (60) days of the mailing of this lapse notice. An acceptable proof of beneficial use submittal must include the examination fee or a completed field examination report. A request for extension of time must be accompanied by a fifty dollar (\$50.00) fee.

Enclosed again for your use are a proof of beneficial use form and a request for extension of time form. Please note that only one extension of time can be granted unless the project has not been completed because of lack of a necessary approval by a government agency or by litigation which may bring title to the water in question.

L. GLEN SAXTON
Chief, Water Allocation Bureau

Enclosures

UNRECORDED

FEB 26 1998

CERTIFICATION OF MAILING
I hereby certify that on 9/8/97
a copy/an original of this document was
deposited in the United States mail,
postage prepaid addressed to the
individual(s) named above.

[Signature]

June 30, 1997

SAWTOOTH PELLET CO
8758 MELMONT RD
MELBA ID 83641

PROOF DUE NOTICE

RE: PERMIT NO. 63-12343

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before September 1, 1997. (See last page of your approved permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a complete field examination report prepared by a certified water right examiner may be used to submit the required proof.

If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.

Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.


SINCERELY,

JULIE L. YARBROUGH
Senior Secretary

Enclosures

RECEIVED - LIME

FEB 26 1998

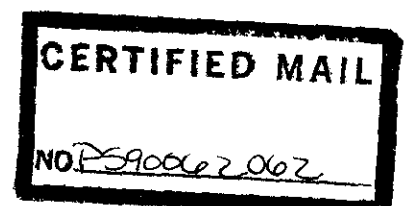

Original - S.O. file 63-12343
cc } - Requi " "
" " 63-96-W-0417-000

CONVERSATION MEMORANDUM

RECEIVED

DATE 8/15/96

SEP 11 1996

FILE 63-96-W-0417-000

NAME OF PARTY Bill from Department of Water Resources Pump + Drilling 63-12343

EMPLOYEE Steve Latta

RE: REQUEST FOR CLARIFICATION @ CASING REQUIREMENT

Appl. for W.R. = fire protection only.

W.D. cond. require unperforated csq. to c 130'

In process of drilling now.

So far - at 140' 10" hole.

4'-140' hard sand, no water. Experts
hit water c 150' & static to rise
to c 120' per nearby well logs.

Due to drilling situation, very difficult to
place casing below 40' level where
csq. now ends. Thinks will be very
expensive to increase hole diameter & then
get csq. from 40' to 130'.

Since no water & all rock all the way
to 140', can leave as cased only to 40'?

If so, can finish drilling soon.

Per his well log same, nearby wells cased
to only c 240'.

I told him that looked like situation where ok
to modify requirement where cased ~~only~~ to 40',
Resume drilling.



State of Idaho
DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000
Phone: (208) 327-7900 FAX: (208) 327-7866

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

August 16, 1996

SAWTOOTH PELLET CO
8758 MELMONT RD
MELBA ID 83641

PERMIT APPROVAL NOTICE

RE: PERMIT NO. 63-12343

Dear Permit Holder:

Enclosed is a copy of your approved application for permit. Please be sure to thoroughly review the "Conditions of Approval and Remarks" listing on the permit.

Enclosed is a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit into a licensed water right. Also enclosed is a form entitled "Proof of Beneficial Use". If your project is already completed, you should complete and submit this form immediately.

Also, please note that as of July 1, 1996, water right owners are required to report any change of water right ownership and any change of mailing address to the department. If you have acquired a water right or have changed your mailing address PRIOR TO July 1, 1996, you have until July 30, 1998, to notify the department. If you acquire a water right or change your mailing address AFTER July 1, 1996, you must notify the department within 120 days of the change.

Failure to report these changes could result in a \$100 late filing fee. Contact any office of the department to obtain the proper reporting form.

Sincerely,

Shelley W. Keen
Water Rights Supervisor

SK:ph

Enclosures

RECEIVED
AUG 21 1996

**APPLICATION FOR PERMIT
STATE OFFICE REVIEW**
by Cindy Zimmerman

No.: 63-12343 Name: Sawtooth Pallet Co Date: 8/15/96 Ad OK? ✓
Correct Fee? ✓ Receipt #: W021067 Priority: 6/20/96 ✓ Gvmt Lts: ✓

AREA OF CONCERN? 42-605 of post No/Yes BRD Mor GWMA Trust/Non-trust
- In 20/30/40/50/60/70/80 (87) basin? P84
- 020(Protest Agr) or W19(See Final/Prelim Order)

PROTESTED:**SYSTEM COMPLETED:**

Yes/proof filed - NA
1 year/no proof - P16
+1 year - 26A-P17

GROUNDWATER: <✓ FLO-CH>

+ 0.2 cfs - 01M
=/- 0.2 cfs - No MD
=/+ 5 a. - 01M, 065(if GW use SW 1st)

Drilling Permit:

Existing well - NA (pre 7/1/87)
Included w/permit - Permit No. 63-96-W-0417-000, P99
No WD permit? - 046-46B-P23 (post 7/1/87)
irr. in WD - P05 (new well)

SURFACE WATER <✓ FLO-CH> (Surface water that doesn't sink is regulated):

Water District(~~dem~~) - 005 (req) WD # <SEE MAP & LISTING>
+ 0.2 cfs - 01J(meas dev)-P08
=/- 0.2 cfs - 01H(lock dev)-P01 or No MD
~~In-WD~~ + 0.2 cfs - 01M or No MD (in-stream)
- 0.2 cfs - No MD
=/+ 5 a. irr. - 01M

RIVER BASINS (*Surface water):

SNAKE R (01) - 11A-P04, NA
(02/03-irr) - 007-P07 (w/remark WB9-† Weiser), NA
Boise R (63) - 05A (if WD), 11E (not 42-111 use), NA
Payette R (65) - 064(regulated uses), 047-P04(Payette Lake), NA

USE:

Domestic (surface) - *WB5(Boise R † Star Bridge); 27A(Payette R); NA
Fish Propagation - 07A-042(rq)-010/06A/09E(WQ)-P10;044(N 1000 Spr)
Irr <POU> =/- 5 a - 057 (0.03 cfs/A)
+ 5 a - 03A (0.02 cfs/A)
Mining - 054 (req) & 06A/010/09E-P10
Power - 08A-17K-025-027-01M-01F(P19)-09E(P10);
+25 cfs-P18; 17G(FERC) or 17M(FERE); 18B-P09
Storage(✓ 3 compo.) - 18A(multi MD in WD), 18B-P09 (+10' dam), NA

LOCATION:

Boise Front LoGeo - 058 (-85° GW temp only)
In-stream dev. - P52 (stream channel alteration)
Irr Dist/Canal Co. - 023 (Twin Falls area)
Swan Falls Flag - <SEE CODE CHART>
Trust - 051-052-053-P74 (Consumptive Uses), NA
Non-Trust <1> - 048-049 (Consumptive Uses), NA

OWNERSHIP: Non-land owner**OTHER CONDITIONS:****STANDARD REMARKS:****BENEFICIAL USE DUE:****COMMENTS:**2) WB60) W239-1-1997Cap off

5/96

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPROPRIATION APPLICATION ANALYSIS SHEET

INITIAL REVIEW BY: CJL DATE: 6/25/96 APPLICATION: 63.12343

REQUIRED INFORMATION

Name: (If applicant is a corporation or partnership, names and addresses for the director, officers, and other partners must be included.) *- See Remarks, orig. Appl.*
Address:
Source: (See USGS Quad for names of water sources)
Point of Diversion: (10 acres for spring, lot & block descriptions for Subdivisions, local name)
County:
Quantity: (flow and/or volume)
Period of use:
Nature of proposed use: (Include description of use)
Description of diverting works:
Time required for beneficial use of water:
Place of use or acres irrigated:
Map: (show T, R, S, QQ &/or QQQ)
Subdivision plat: (for > 1 home in restricted area. $\geq$ 5 homes in non-restricted area)
Signature: (If applicant is corp., partnership, or municipality, title of signatory is required)
Fee:
Yes ☐ No* In form to receipt:

RECEIVED
AUG 08 1996
Gov't. Lots:
P/D
P/U

Department of Water Resources

ADDITIONAL INFORMATION

* ADD REMARK TO
ADVERTISING! *

YES NO

☒ Overlapping place of use: (Describe source & relationship to present application on next page.)
☒ Overlapping point of diversion.
Field check required: Field check by: _____
Field report attached:
Critical groundwater area:
Groundwater management area:
1992 moratorium: *exempt for fire protection*
Copy to SCA staff: (perennial stream, non-pump diversion &/or any mining).
Copy to Dam Safety staff: (for any storage)
Mitigation plan: where ground water replaces surface water for irrigation, request additional information &/or mitigation plan to address reduced aquifer recharge
Send power requirement letter:
Send fish farm requirement letter:
Power residency affidavit:
Power efficiency form:
Diversion greater than 5 cfs or 500 af or irrigation greater than 200 acres: (If yes, attach Large Diversion supplementary analysis sheet.)
*REQUEST ADDITIONAL INFORMATION FROM THE APPLICANT

DATE REQUESTED

ADDITIONAL INFORMATION ON REVERSE SIDE:

EXPEDITED D.P. issued per Request & per Needs to meet
local requirements before can resume processing products & plants
- JR 8/16/96

YES NO

☒ In form for advertising:☒ Statewide advertising: (> 10 cfs &/or 1000 af)☒ Fee amount, receipt number and date recorded on application:SEND COPIES TO:

YES NO

☐ I.D. Health & Welfare☐ I.D. District Health☐ I.D. Fish & Game☐ I.D. Lands☐ Adjudication Bureau

YES NO

☐ U.S. BLM☐ U.S. Forest Service☐ Water Dist. # _____☐ Other _____FINAL REGIONAL PROCESSING REVIEW:

YES NO

☒ Affidavit of publication received:☒ Application published correctly: If not, record action taken.☒ Publication dates and paper recorded on application:☒ Protests received. Final date for protest 7-22-96☒ Protest dates, resolution of protest recorded on application:☒ Recommendations attached:☒ Measuring device required: - probably N/A for f.p. well - or could retain authority to add m.d. per a finding by Director?☒ Measuring port required:☒ Water delivered by water master? District # _____☒ Special conditions of approval or cover letter:

See water bearing zone remarks plus d.p. conditions & ~~then~~ this well to be developed.
how

-46 -004 -no use except for fire suppression needs. (ZONE = 130'-220')

☒ See below for additional informationRecommended Date or Priority 6/20/1996Recommended by: JLDate: 8/6/96STATE OFFICE REVIEWSee below for additional information. By _____ Date _____ADDITIONAL INFORMATION:63-10603, 10604A-B other uses from G.W.Well(s) located in W₂SWSW (not same location)

See 6/25/96 'Comments' is Appl. & waiver for B. 63 well
(re: mountain etc.) - JL

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO)
) SS.
County of Canyon)

Carolyn Spath

of Nampa, Canyon County, Idaho, being first duly sworn, deposes and says:

1. That I am a citizen of the United States of America, and at all times hereinafter mentioned was over the age of eighteen years, and not a party to the above entitled action.

2. That I am the Principal Clerk of the Idaho Press-Tribune, a daily newspaper published in the City of Nampa and Caldwell, in the County of Canyon, State of Idaho; that the said newspaper is in general circulation in the said County of Canyon, and in the vicinity of Nampa and Caldwell, and has been uninterruptedly published in said County during a period of seventy-eight consecutive weeks prior to the first publication of the notice, a copy of which is hereto attached.

3. That the notice, of which the annexed is a printed copy, was published in said newspaper

Twice

— in the regular and entire issue of said paper, and was printed in the newspaper proper, and not in a supplement.

4. That said notice was published the following dates:

July 3, 10, 1996

STATE OF IDAHO)
)
COUNTY OF CANYON)

On this 10th day of July
in the year of 1996, before me, a Notary Public, personally appeared Carolyn Spath, known or identified to me to be the person whose name subscribed to the within instrument, and being by me first duly sworn, declared that the statements therein are true, and acknowledged to me that he/she executed the same.

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

63-12343

SAWTOOTH PELLET CO
8758 MELMONT RD
MELBA, ID 83641

Source: GROUNDWATER

Diversion Pt: SWSW Sec 15 T 01 N R 02 W in CANYON County.
SESW Sec 15 T 01 N R 02 W in CANYON County.

Use: FIRE PROTECTION
(1,110 CFS)
Total Diversion:

Date Filed: 6/20/1996

In: CANYON County

T01N R02W S15 SWSW SESW

Permits will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code. Any protest against the approval of this application must be filed with the Director, Dept. of Water Resources, Western Region, 2735 Airport Way, Boise, Idaho 83705 together with a protest fee of \$25.00 on or before JULY 22, 1996. The protestant must also send a copy of the protest to the applicant.

KARL J. DREHER, Director

July 3, 10, 1996

3890

RECEIVED

JUL 22 1996

WATER RESOURCES
WESTERN REGION

AUG 21 1996

Jeanne Lee
Notary Public for Idaho
Residing at Nampa

MY COMMISSION EXPIRES
JUNE 21st, 1997

63-12343

SAWTOOTH PELLET CO
8758 MELMONT RD
MELBA, ID 83641

Source: GROUNDWATER

Diversion Pt:	SWSW	Sec 15 T 01N R 02W in CANYON County.
	SESW	Sec 15 T 01N R 02W in CANYON County.

Use: FIRE PROTECTION	(	1.110 CFS)
Total Diversion:	(	1.110 CFS)

Date Filed: 6/20/1996

In: CANYON County		
T01N R02W S15	SWSW	SESW

AUG 21 1996

CONVERSATION MEMORANDUM

DATE 6/20/96

FILE 63-12343

NAME OF PARTY Clint Weiden for Sawtooth Pellet Co.

EMPLOYEE Steve Lester

RE: _____

Water bearing zone - per ✓ of well logs.

mitigation - per emergency use only, OK.

testing - monthly tests of pump at storage tank,
not of well pump.

County P+3 requires f.p. well with 500 gpm,
2 hr. capacity.

CAN advocate + process w.r. Appl.

Drilling Permit Appl - Requests immediate approval
since business has been shut down until
county approves f.p. system. Losing \$1000's
per day in revenue.

Regin will determine if any specific cond.
of approval needed for w.d. permits.

Regin will call Earl Skinner if d.p. can be
issued right away per this method - otherwise
call applicant so he will know status.

Folksy
Needed
a.s.a.p.

✓
Completed
6/24/96
-sr