


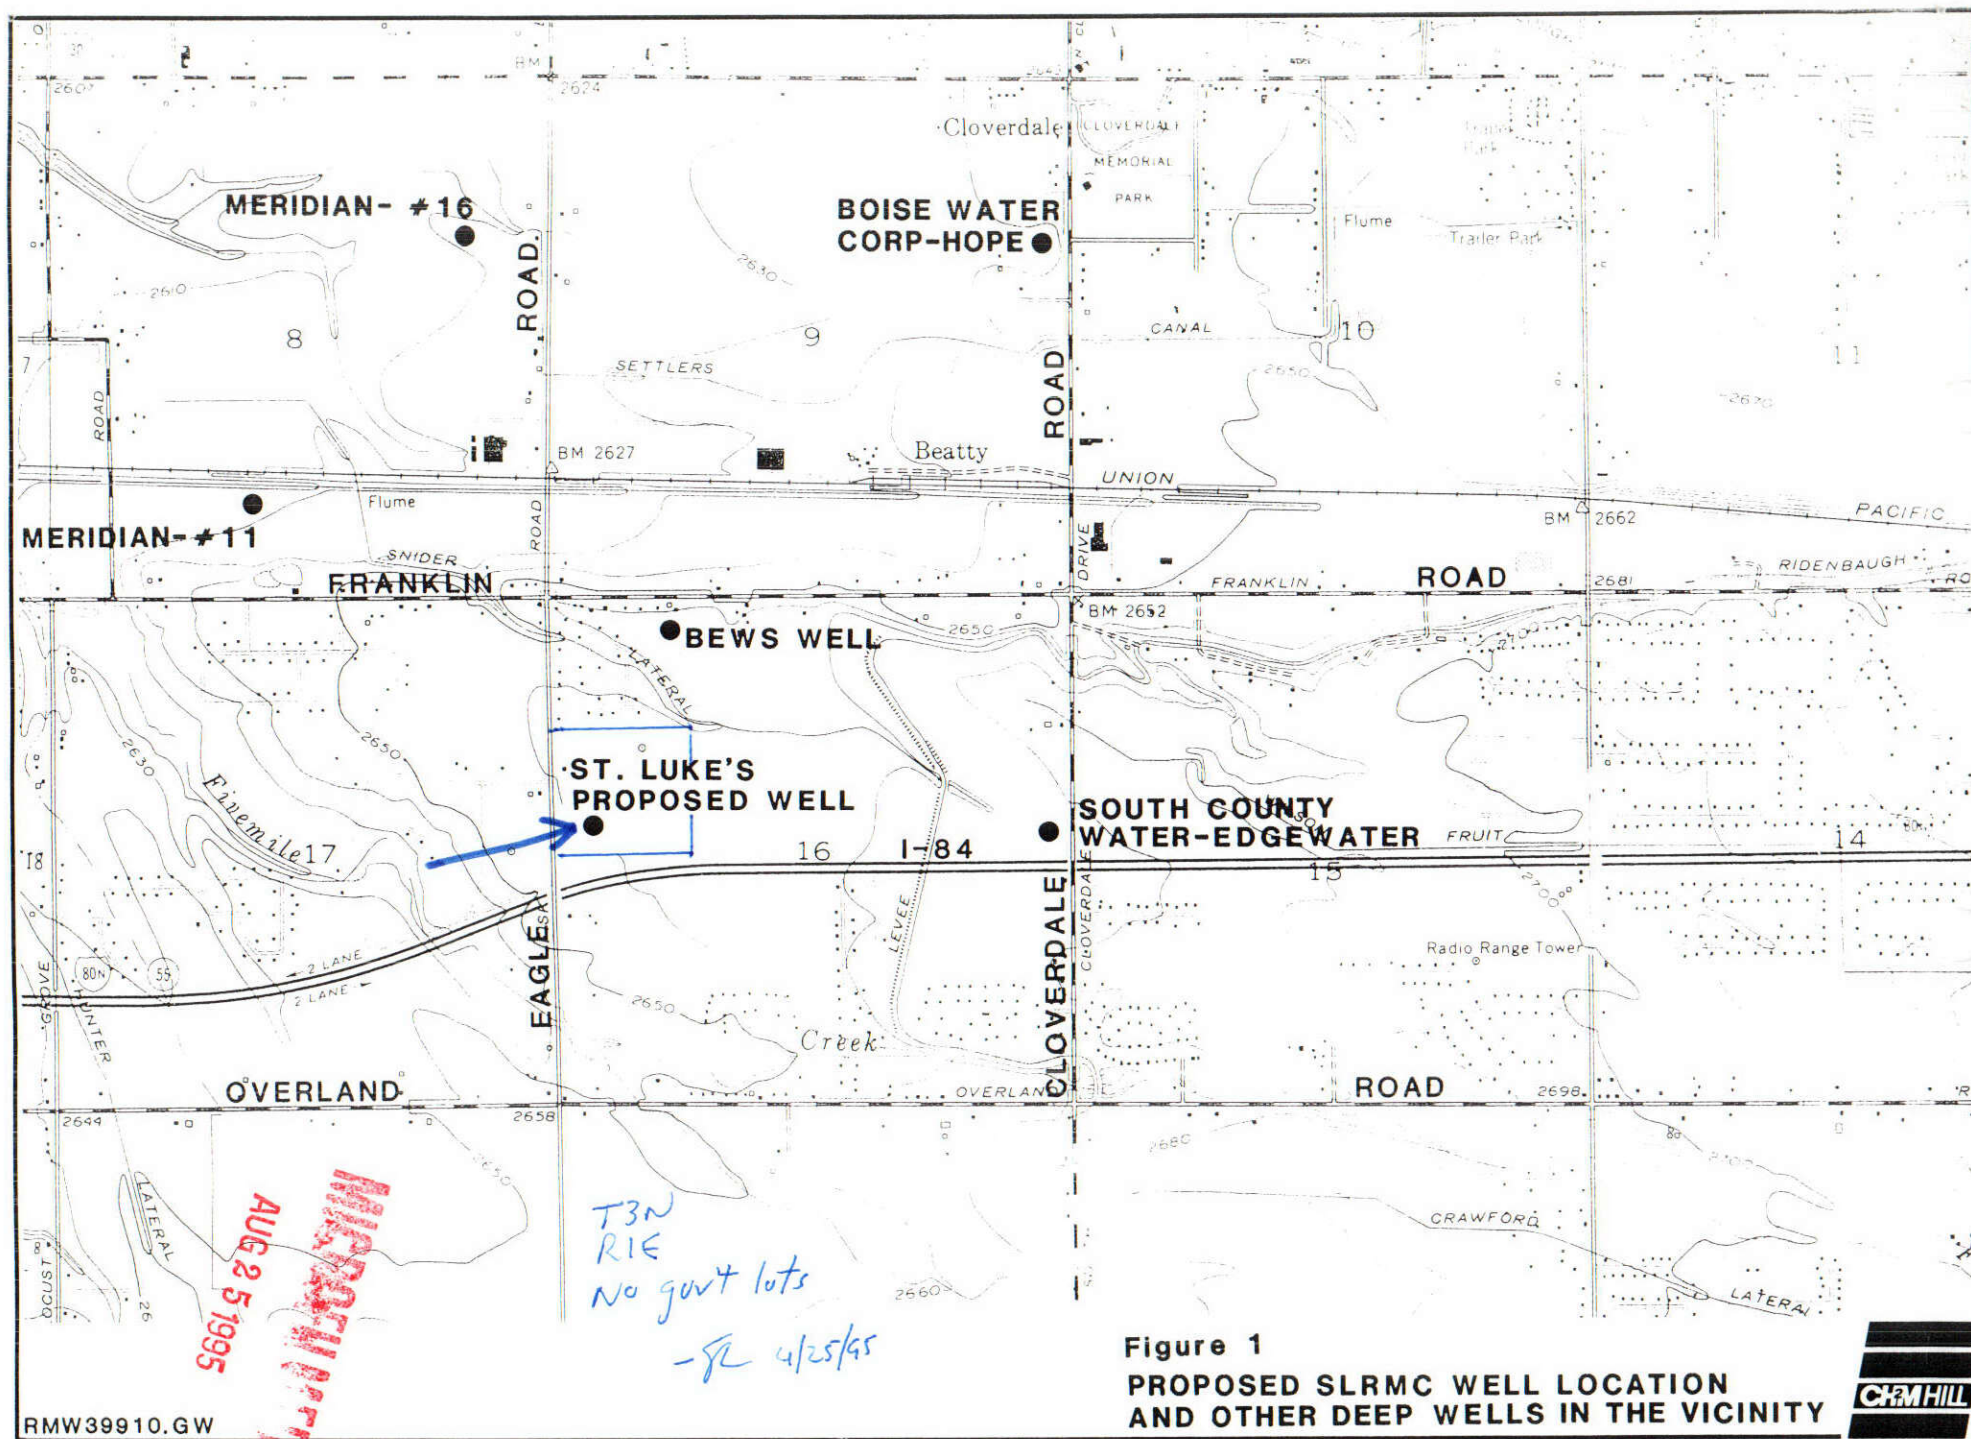


Figure 1
PROPOSED SLRMC WELL LOCATION
AND OTHER DEEP WELLS IN THE VICINITY



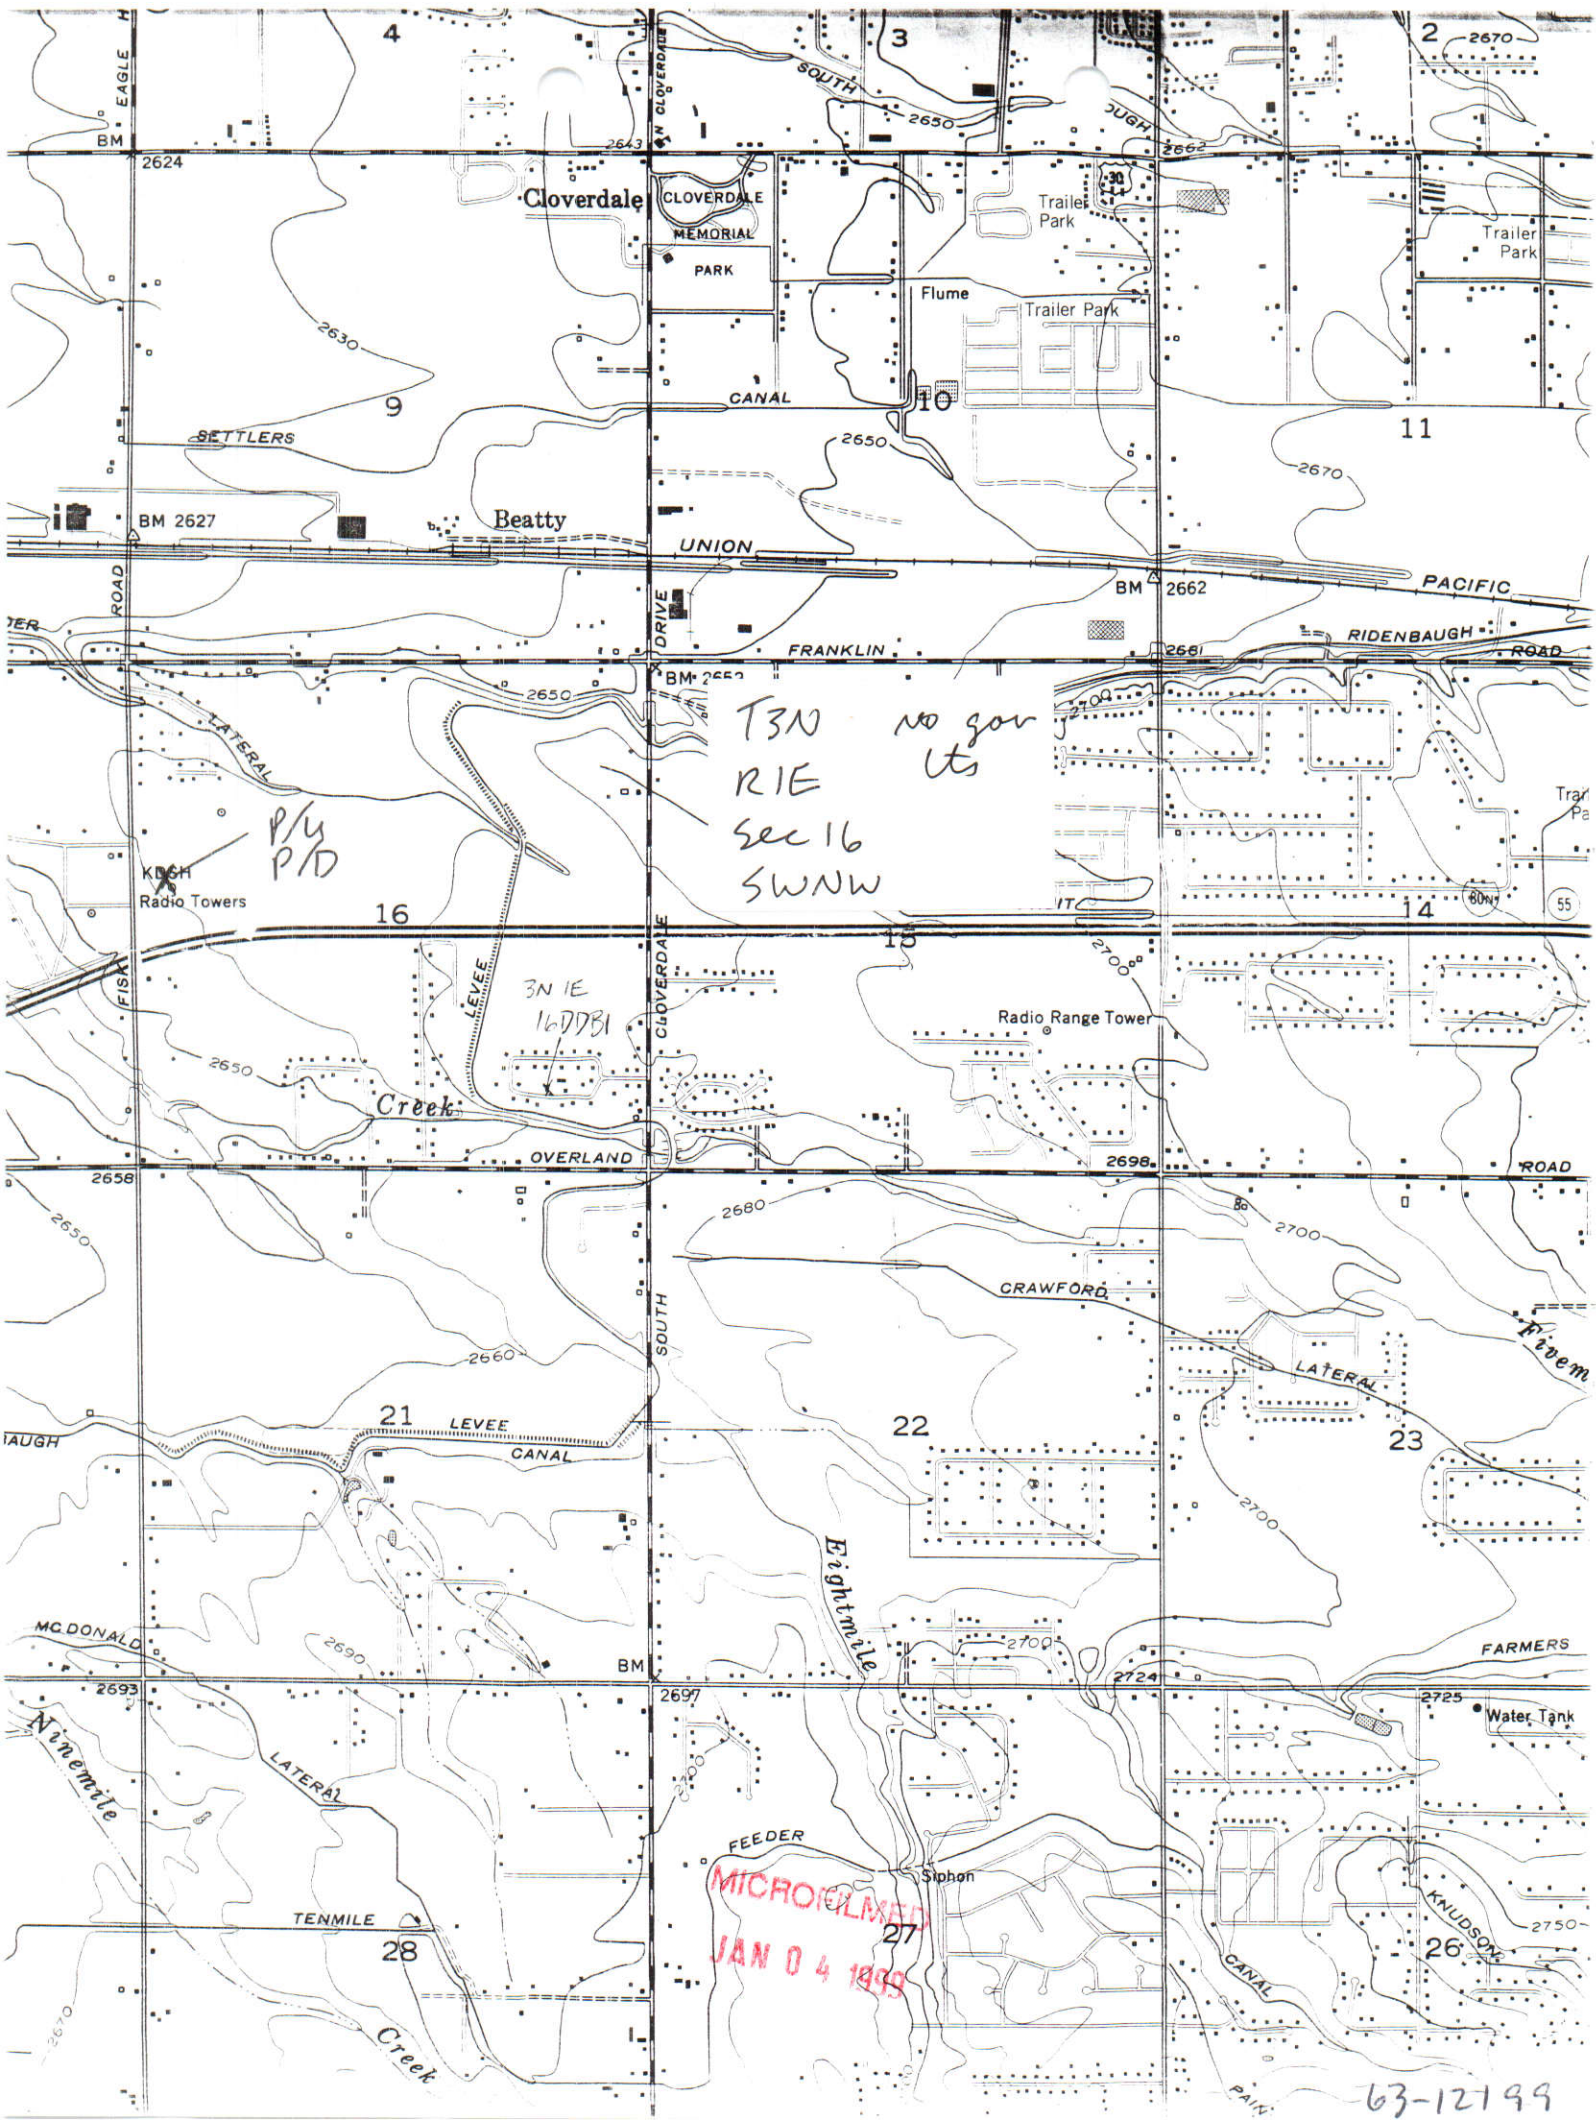

P/D

portion of
delivery
system



-P/u

MICROFILMED

JAN 04 1999

63-12199

AUG 25 1995

RECEIVED

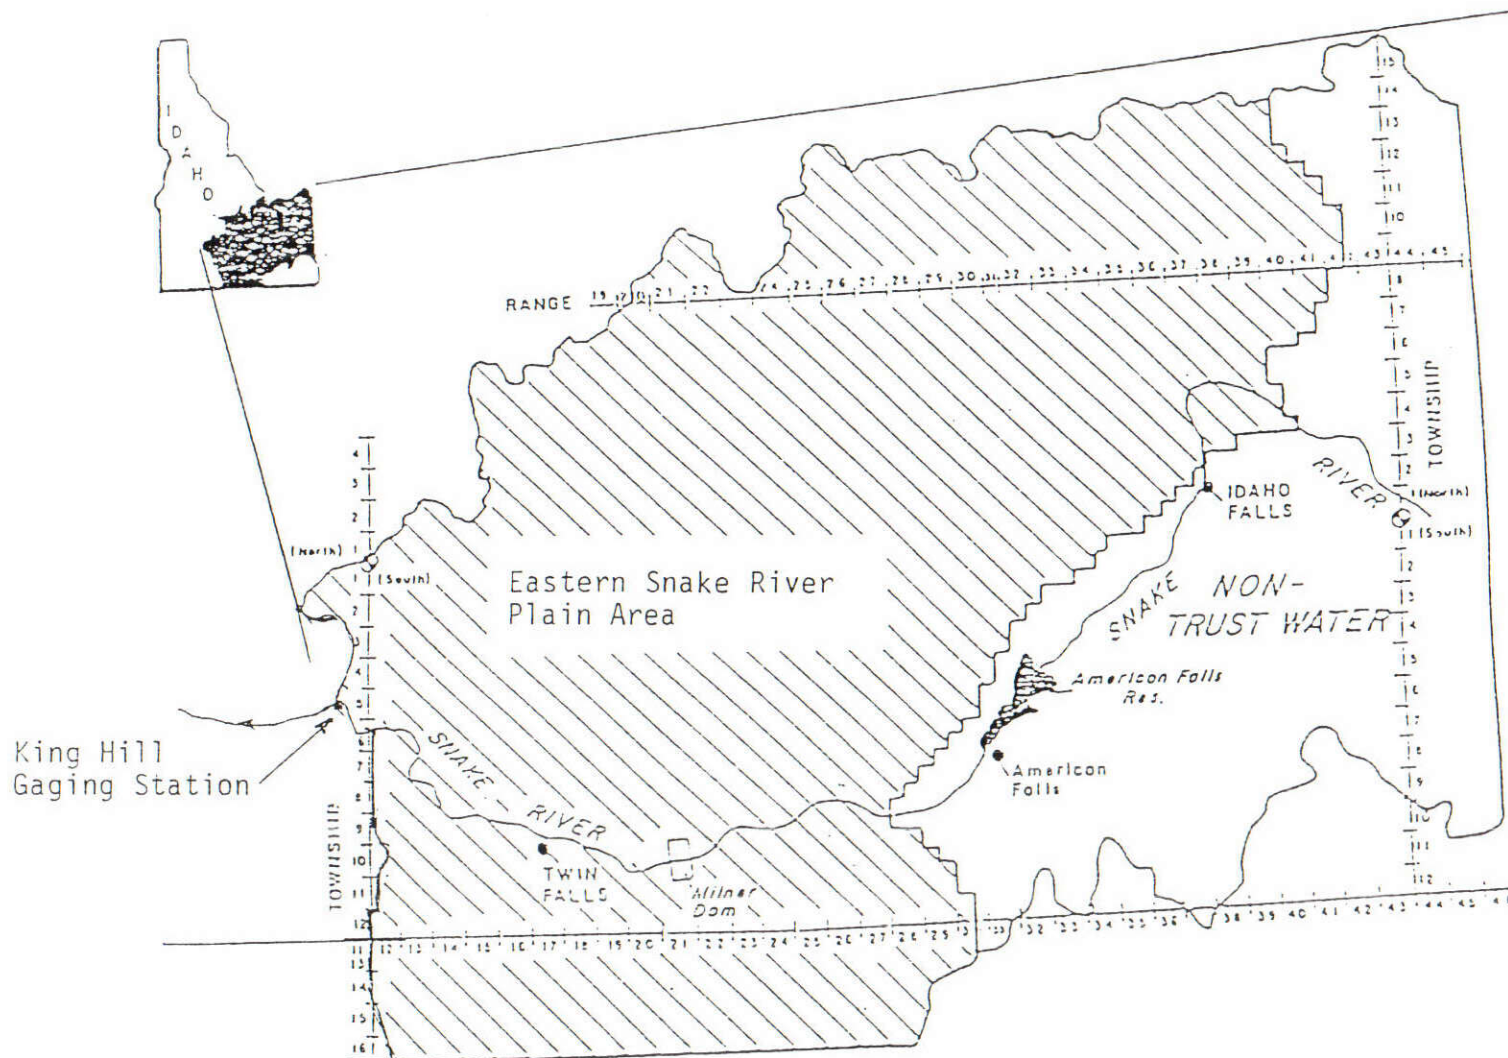


Exhibit A

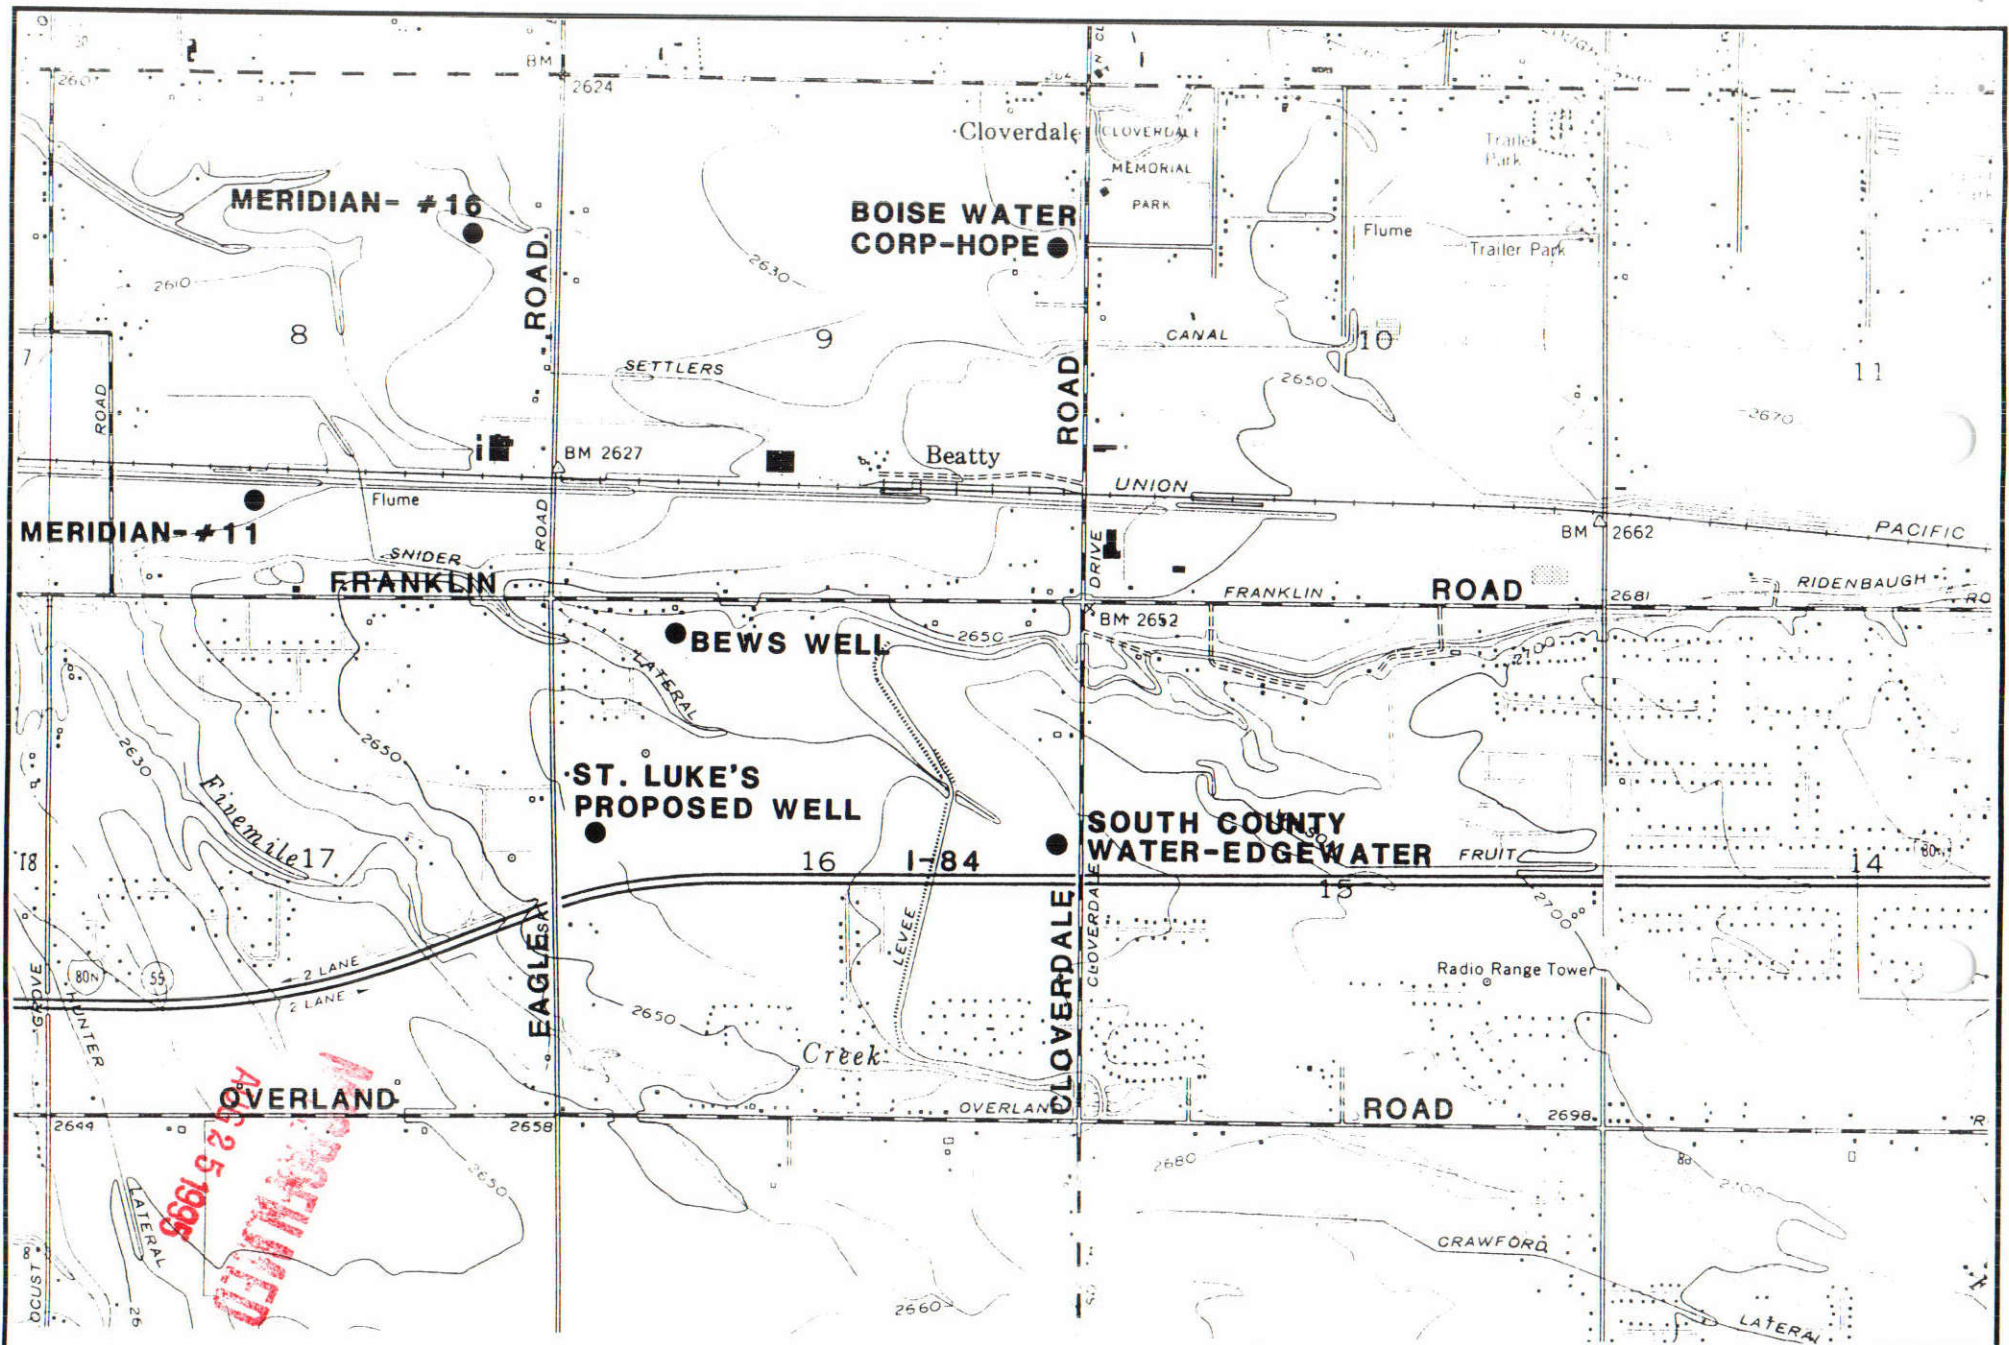


Figure 1
PROPOSED SLRMC WELL LOCATION
AND OTHER DEEP WELLS IN THE VICINITY

State of Idaho
Department of Water Resources

Water Right License
WATER RIGHT NO. 63-12199

Priority: March 22, 1995

Maximum Diversion Rate:
Maximum Diversion Volume:

0.33 CFS
5.8 AF

This is to certify, that ST LUKES REGIONAL MEDICAL CENTER

190 E BANNOCK
BOISE ID 83712

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated March 22, 1995; and has submitted Proof of Beneficial Use on July 25, 1996. An examination indicates that the works have a diversion capacity of 0.330 cfs of water from a GROUNDWATER source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	0.33 CFS	5.8 AF

LOCATION OF POINT(S) OF DIVERSION: SWNW , Sec. 16, Township 03N, Range 01E
ADA County

PLACE OF USE: DOMESTIC

TWN RGE SEC

03N 01E 16


SWNW

CONDITIONS OF APPROVAL AND REMARKS

1. After specific notification by the department, the right holder shall install a suitable measuring device or shall enter into an agreement with the department to determine the amount of water diverted from power records and shall annually report the information to the department.
2. Place of use known as St. Lukes Meridian Medical Center.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. The water right confirmed by this license is subject to all prior water rights and shall be administered in accordance with Idaho law and applicable rules of the Department of Water Resources. Signed and sealed this 8TH day of

DECEMBER, 1992.

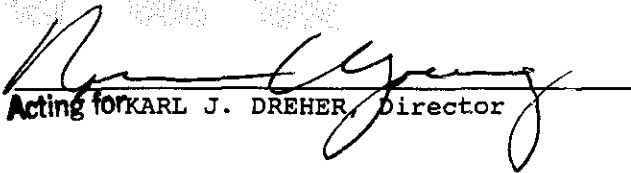
Acting for KARL J. DREHER, Director

MICROFILMED

JAN 04 1999

RECEIVED

JUL 25 1996

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

Department of Water Resources

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or be accompanied by a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 63-12199 Telephone No. 381-2255

2. Name(s) of Permit Holder(s): St. Luke's Regional Medical Center c/o Ben Strawn

3. Mailing Address: 190 East Bannock, Boise, ID 83712

4. Source of Water: Groundwater If **GROUNDWATER** (well), Date Drilled: mo. 11 / yr. 95

a. Well Driller: Hiddleston & Son, Inc. Drilling Permit Number: 63 - 95C 0418 - 000

b. **OPTIONAL:**
Pump Horsepower: 10 Pressure (psi): Dynamic pumping level (ft): 15

5. Use(s) (as authorized by the water right permit):

Domestic (No. of households): 1 CFS Stockwater (No. and type of stock):

Irrigation (No. of acres): Other: Medical Emergency Supply

6. Total rate of diversion and/or volume for which proof is submitted: 1 CFS cfs OR acre feet

7. Measuring Device Requirement: (refer to the approval conditions on your permit and respond accordingly)

(This question is not optional. Please check either yes or no. Proofs returned not checked accordingly, will be considered incomplete)

Measuring Device: Is a measuring device required? Yes or No X

Has the measuring device been installed? Yes X or No

Flow Measurement Port: Is a flow measurement port required? Yes or No X

Has the measurement port been installed? Yes or No X

8. Fee Enclosed: \$ 100.00 (See Fee Schedule on back of the instructions for filing proof of beneficial use)

9. Person to contact to accompany the Department representative during field examination of the water system.

Name: Mr. Bob Holcomb Telephone Number: 893-5071

Address: 190 E. Bannock, Boise, ID 83712

Well Site: I84 and Eagle Rd., Meridian, ID

10. The information given on this form is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the State of Idaho.

Signature of permit holder: Ben Strawn Director - Bldg. Service Date: 7/24/96
(include your title, if on behalf of company or organization)

SEP 12 1996

State of Idaho
Department of Water Resources
Permit To Appropriate Water

NO. 63-12199

Proposed Priority: March 22, 1995

Maximum Diversion Rate:

1.00 CFS

This is to certify, that **ST LUKES REGIONAL MEDICAL CENTER**
C/O BEN STRAWN
190 E BANNOCK
BOISE ID 83712

has applied for a permit to appropriate water from: **GROUNDWATER**

and a permit is **APPROVED** for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
DOMESTIC	01/01 to 12/31	1.00 CFS

LOCATION OF POINT(S) OF DIVERSION:

SWNW , Sec. 16, Township 03N, Range 01E
ADA County

PLACE OF USE: DOMESTIC

TWN RGE SEC

03N 01E 16

SWNW

CONDITIONS/REMARKS:

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before August 1, 1996.
2. Subject to all prior water rights.
3. After specific notification by the department, the right holder shall install a suitable measuring device or shall enter into an agreement with the department to determine the amount of water diverted from power records and shall annually report the information to the department.
4. Right holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
5. Construction of the well must comply with Idaho well construction standards.
6. Domestic use is for a medical center.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the signature of the Director, affixed at Boise, this

24th day of August, 1995.

Karl J. Dreher
for Karl J. Dreher, Director

RECORDED

AUG 25 1995

RECEIVED
JUL 31 1995
Department of Water Resources

Ident. No. 63-12199

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

1. Name: ST LUKES REGIONAL MEDICAL CENTER
Address: C/O BEN STRAWN
190 E BANNOCK
BOISE ID 83712
208-386-2255
2. Source: GROUNDWATER
3. Location of Point of Diversion: Trib. to: SWSWNW Sec. 16, Township 03N, Range 01E
ADA County
4. Water will be used for the following purposes:

Purpose	From	To	CFS	(or)	AF
DOMESTIC	01/01	12/31	1.000		
5. Total quantity to be appropriated is:
1.000 CFS (and/or) AF
6. Proposed diverting works:
 - a. Description of ditches, flumes, pumps, headgates, etc.
PUMP & PIPELINE WITH CONTROL VALVES & BACKFLOW DEVICE; BACKUP USE
 - b. Height of storage dam feet; active reservoir capacity
acre-feet; total reservoir capacity acre-feet; period of
year when water will be diverted to storage: to inclusive.
 - c. Proposed well diameter is 6 inches; proposed depth of well is 600
feet.
 - d. Is groundwater with a temperature greater than 85F being sought? NO
 - e. If well is already drilled, when?
Drilling Firm
Well was drilled for
7. Time required for the completion of the works and application of
the water to the proposed beneficial use is 1 year(s).
8. Place of Use: DOMESTIC

TWN RGE SEC
03N 01E 16 SWNW

RECEIVED
AUG 25 1995

9. a. Who owns the property at the point of diversion?
APPLICANT
b. Who owns the land to be irrigated or place of use?
APPLICANT
c. If the property is owned by a person other than the applicant,
describe the arrangement enabling the applicant to make this filing.

10. Remarks:

Domestic use is for a medical center.
Well is to be used as a backup source for which approval is
requested as a public interest exemption to the Snake River
(drought) Moratorium.
Primary water supply will be provided by the City of Meridian
municipal water right(s).

11. Map of proposed point of diversion and place of use attached? ☒

BE IT KNOWN that the undersigned hereby makes application for permit to
appropriate the public waters of the State of Idaho as herein set forth.

See original
Applicant

Received by VR Date 3/22/95 Time 10:40 Preliminary check by JL

Fee \$ * 150.00 Received by VR #W018769 Date 3/22/1995

Publication prepared by _____ Date _____ Published in _____

Publication approved _____ Date _____

* \$100 for 63-12199
\$50 " Temp. Approval Appl., now void, Refund to be issued per
4/25/95 memo. -JL

RECEIVED
AUG 25 1995

Comments: Date: 4/ 25/ 1995 User-ID: SLESTER

Subject:

MORATORIUM & OTHER INFORMATION

Application processed as possible drought moratorium exemption per LGS's 4-18-95 memo. The file indicates that the proposed well is for backup use only. Original application listed domestic and commercial in item 8e (hand copy of application) but use appears to fit domestic category per item 4 of application. This will include any uses within the medical center building(s).

In accordance with creditation requirements, the well will be operated (exercised) once per month and a sample collected bi-annually to ensure the well is operable at all times (this comment found in original appl. under Remarks).

Also per LGS's memo, no drilling permit to be approved until the water right is issued or about to be issued.

APPROVED
AUG 25 1995

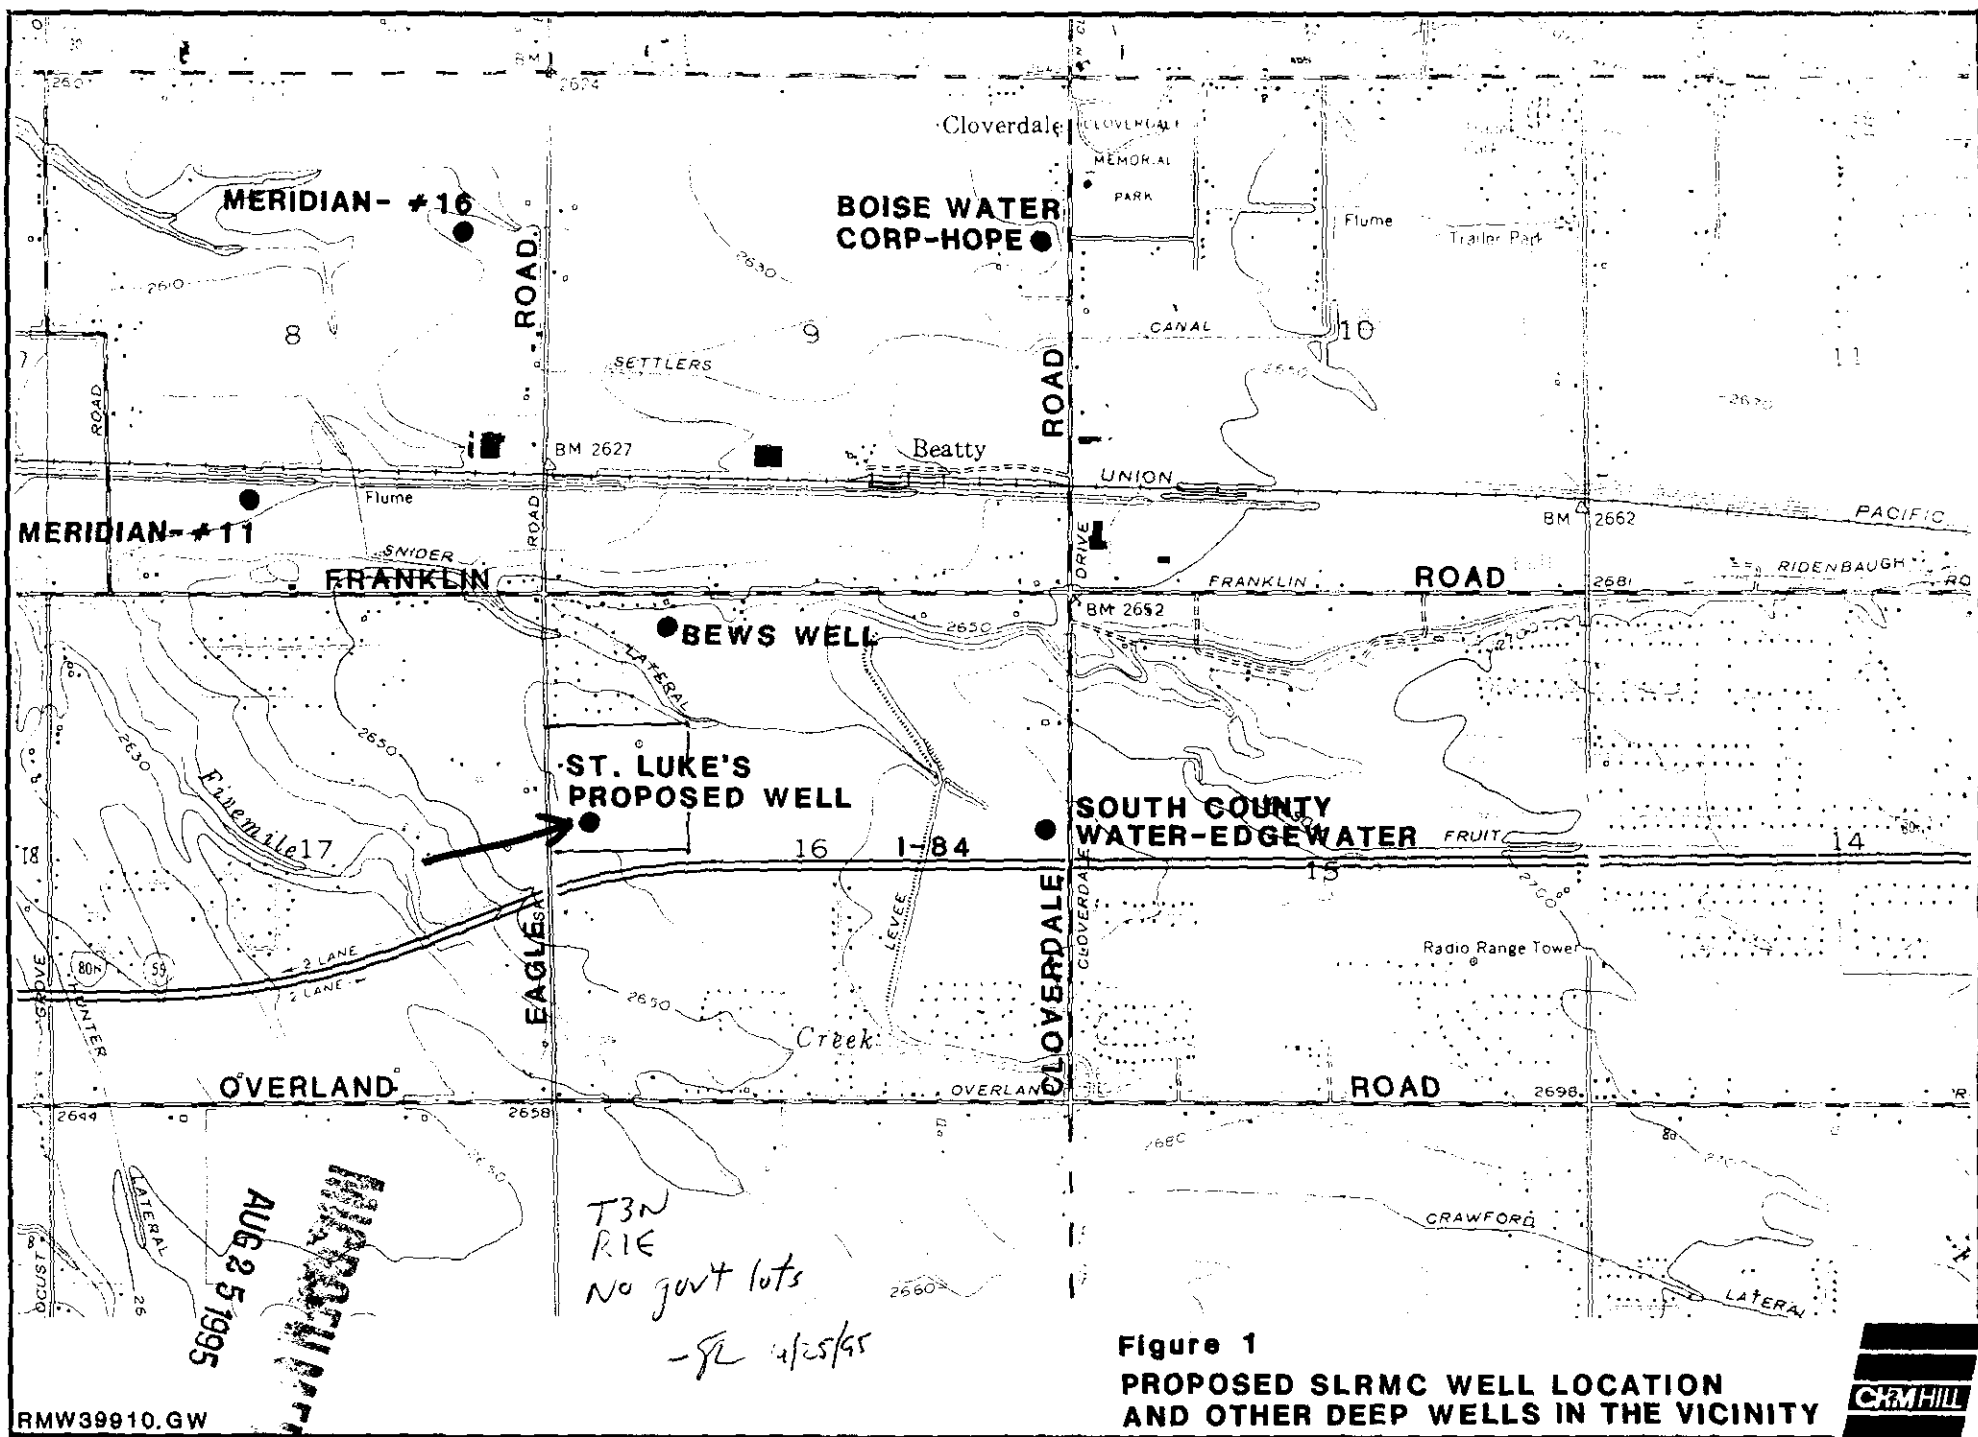


Figure 1
PROPOSED SLRMC WELL LOCATION
AND OTHER DEEP WELLS IN THE VICINITY



STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

Ident. No. 63-12199

RECEIVED

MAR 22 1995

WATER RESOURCES
WESTERN REGION

To appropriate the public waters of the State of Idaho

1. Name of applicant St. Luke's Regional Medical Center Phone (208) 386-2255
% Ben Strawn
Post office address 190 East Bannock, Boise, ID 83712

2. Source of water supply Groundwater which is a tributary of n/a

3. Location of point of diversion is SW $\frac{1}{4}$ of SW $\frac{1}{4}$ of NW $\frac{1}{4}$, Govt. Lot —
Sec. 16 Township 3 North Range 1 East B.M. Ada County; additional
points of diversion if any: n/a

4. Water will be used for the following purposes:
Emergency Domestic
Amount 1.0 cfs for potable/culinary purposes from Jan. 1 to Dec. 31 (both dates inclusive)
(cfs or acre-feet per annum)
Amount — for — purposes from — to — (both dates inclusive)
(cfs or acre-feet per annum)
Amount — for — purposes from — to — (both dates inclusive)
(cfs or acre-feet per annum)
Amount — for — purposes from — to — (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated is (a) 1.0 and/or (b) n/a
cubic feet per second acre feet per annum

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc. Pump at the wellhead; the well will be
manifold into the main supply line, but will be isolated by a control valve and a backflow prevention
device.

b. Height of storage dam n/a feet; active reservoir capacity — acre-feet; total
reservoir capacity — acre-feet; period of year when water will be diverted to storage:
— to — inclusive.

c. Proposed well diameter is 6 inches; proposed depth of well is 600 feet.

d. Is ground water with a temperature of greater than 85°F being sought? no

e. If well is already drilled, when? no; Drilling firm —

Well was drilled for (well owner) —

7. Time required for the completion of the works and application of the water to be proposed beneficial use is

January 1996 years (minimum 1 year).

* dept. standards

-SL 4/25/95

8. Description of proposed uses (if irrigation only, go to item 9):

- a. Hydropower; show total feet of head and proposed capacity in KW. n/a
- b. Stockwatering; list number and kind of livestock. n/a
- c. Municipal; show name of municipality. n/a
- d. Domestic; show number of households. n/a
- e. Other; describe fully. Domestic/Commercial. The sole purpose of this appropriation is to provide an emergency water supply to the facility when service normally supplied by the City of Meridian or disrupted because of some catastrophic event (i.e., earthquake, power outage, etc.) has been preempted. This well essentially serves as a backup supply to meet accreditation requirements. *

9. Description of place of use:

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RANGE	SEC.	NE¼				NW¼				SW¼				SE¼				TOTALS
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	
3N	1E	16							D										

Total number of acres to be irrigated _____

10. Describe any other water rights used for the same purposes as described above. n/a

11. a. Who owns the property at the point of diversion? St. Luke's Regional Medical Center

b. Who owns the land to be irrigated or place of use? St. Luke's Regional Medical Center

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing. n/a

12. COMMENTS
Remarks: In accordance with a creditation requirements, the well will be operated (exercised) once per month and a sample collected biannually to ensure the well is operable at all times. Approved


as possible drought monitoring exemption per LGS' 4/18/95 memo.

AUG 25 1995

* use = 1 -istic, see item 4

- JZ 4/25/95

13. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number. - See attached map.

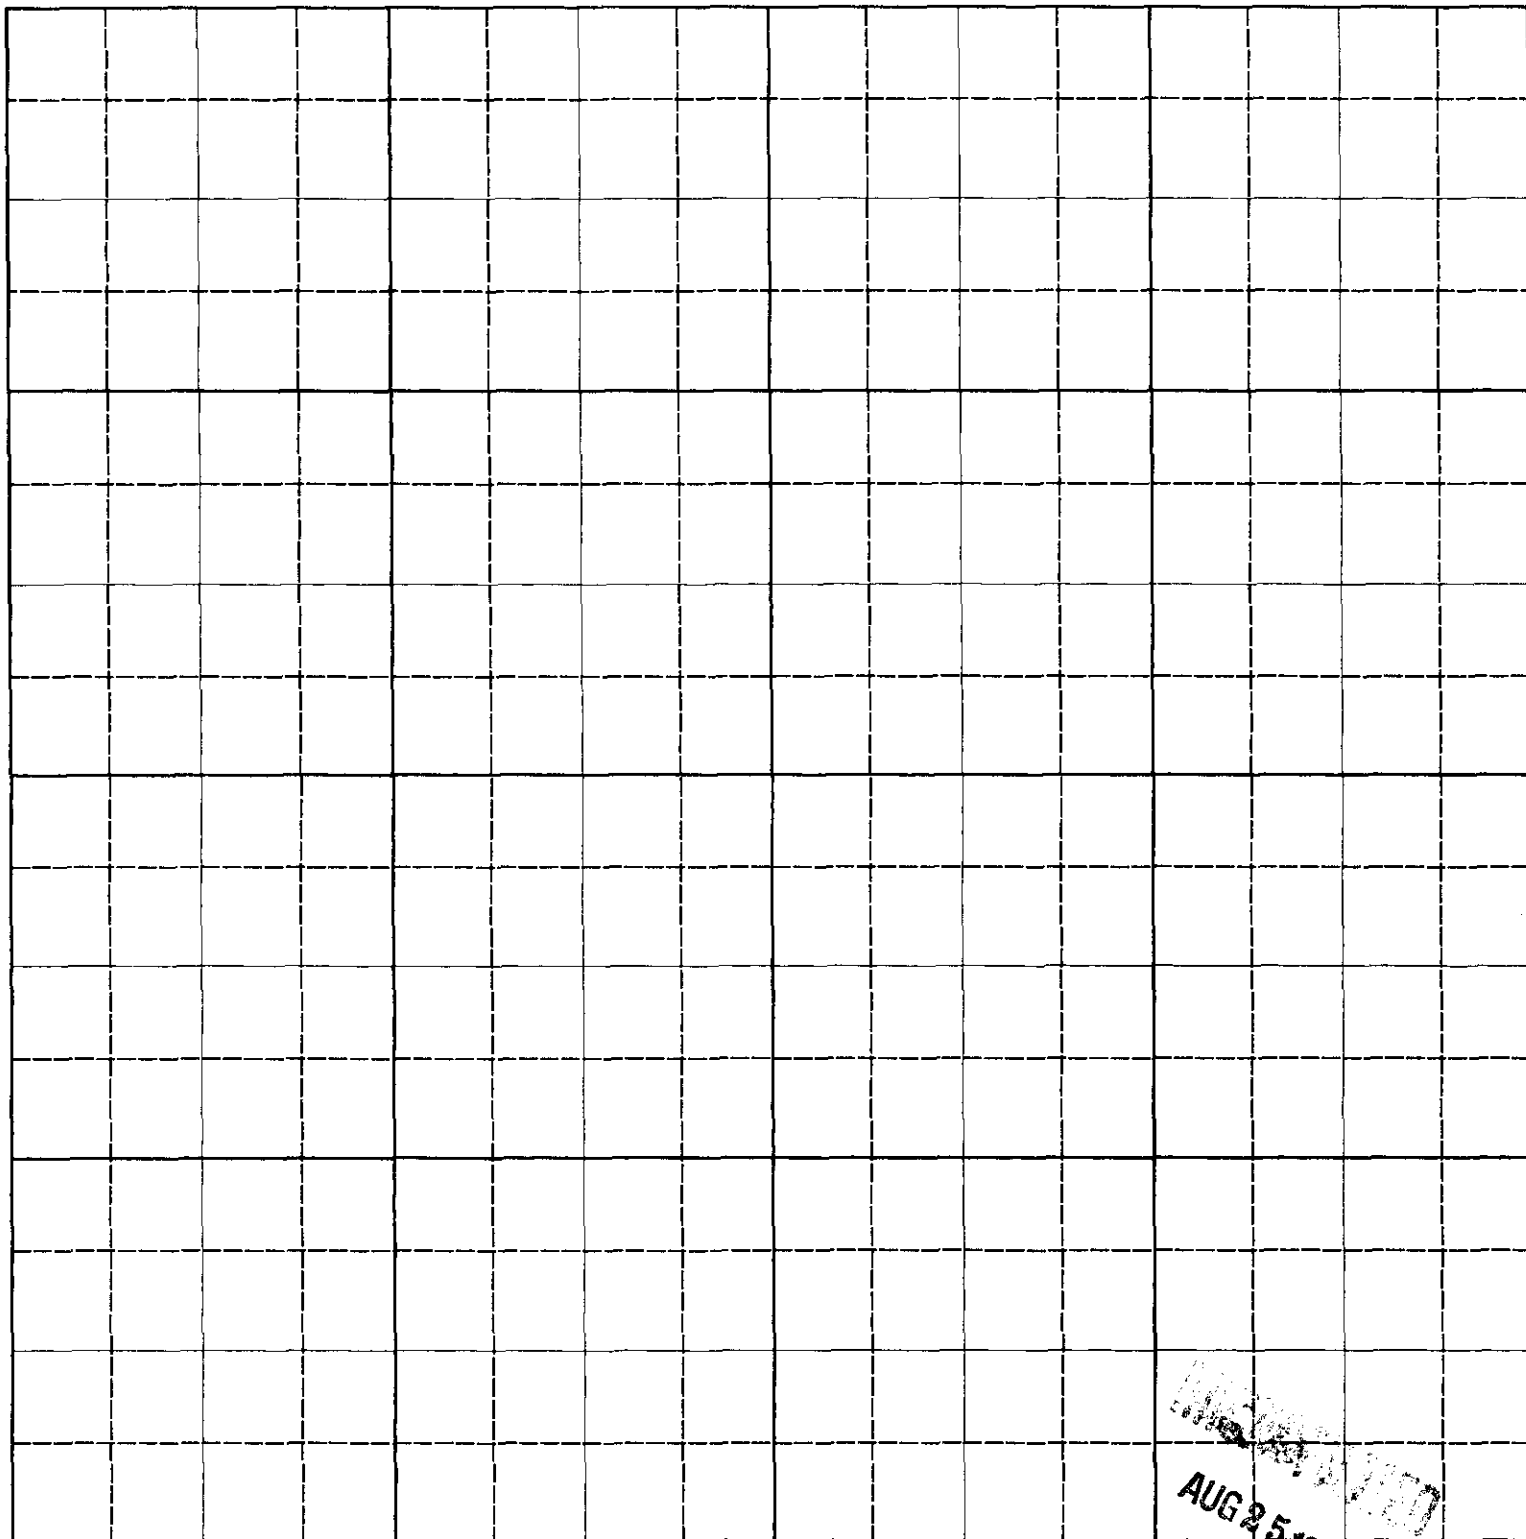

Scale: 2 inches equal 1 mile.

RECEIVED
AUG 25 1995

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

*

Sam A. Barker

(Applicant)

Received by VR Date 3-22-95 Time 10:40am Preliminary check by SL
Fee \$ 100- Receipted by VR # W018769 Date 3-22-95
Publication prepared by AT Date 4-26-95 Published in Idaho Statesman
Publication approved AT Date 5-23-95

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. _____, and said application is hereby _____.

1. Approval of said application is subject to the following limitations and conditions:

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
- b. Proof of construction of works and application of water to beneficial use shall be submitted on or before _____, 19 ____.
- c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.
- d. The water right acquired under this permit if for hydropower purposes shall be junior and subordinate to all rights to the use of water, other than hydropower, within the State of Idaho that are initiated later in time than the priority of this permit and shall not give rise to any right or claim against any future rights to the use of water, other than hydropower, within the State of Idaho initiated later in time than the priority of this permit.
- e. Other:

RECEIVED
AUG 25 1995



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. Box 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

December 9, 1998

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

ST LUKES REGIONAL MEDICAL CENTER
190 E BANNOCK
BOISE ID 83712

RE: WATER RIGHT NO. 63-12199

Dear Water Right Holder(s):

The Department of Water Resources (the Department) has issued the enclosed license confirming that a water right has been established in accordance with the permit referenced above. The license is a preliminary order issued by the Department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department unless a party petitions for reconsideration or files an exception and/or brief as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the Department within fourteen (14) days of the service date of this order. The Department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See section 67-5243(3), Idaho Code.

EXCEPTIONS AND BRIEFS

Within twenty-one (21) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding. Otherwise, this preliminary order will become a final order of the Department.

If any party appeals or takes exceptions to this preliminary order, opposing parties shall have twenty-one (21) days to respond to any party's appeal. Written briefs in support of or taking exceptions to the preliminary order shall be filed with the Department. The Department retains the right to review the preliminary order on its own motion.

MICROFILMED

JAN 04 1999

ORAL ARGUMENT

If the Department grants a petition to review the preliminary order, the Department shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Department will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Department orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Department in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with Rules of Procedure 302 and 303.

FINAL ORDER

The Department will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Department may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The Department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

MICROFILMED
JAN 04 1999

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

If you have any questions, please call me at 208-327-7946.

Sincerely,

A handwritten signature in cursive script that reads "Shelley W. Keen".

Shelley W. Keen
Water Rights Supervisor

SK:klt

Enclosure


RECEIVED
JAN 04 1993

CERTIFICATE OF MAILING

I hereby certify that on the 9th day of December, 1998, I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER (Approved License) to the person(s) listed below:

Water Right No. 63-12199

ST LUKES REGIONAL MEDICAL CENTER
190 E BANNOCK
BOISE ID 83712


Kari Lynn Townsend
Secretary

MICROFILMED
JAN 04 1999

LICENSE REVIEW CHECKLIST

PERMIT NO. 63-12199

DATE 11/30/98

REVIEWER: SHARLA

NAME OK
Address OK

SOURCE OK Does change clarify orig. intended source? If no, Void permit

POINT OF DIV OK ☐ Change (P39 /P47) ☐ Add (P45/P42) Feds - P40

W32 (multiple in 1/4/4)
W36 (overlap)
W59 (subd. desc)

Overlaps: Right(s): _____
File reviewed _____ Profile reports printed _____

PLACE OF USE OK ☐ Change (P41/P47) ☐ Add (P41/P42) Feds - P43

W60 (subd. desc)
W27 (ppu acre limit)

Overlaps: Right(s): _____
File reviewed _____ Profile reports printed _____

PD & PU amend (P37) Feds - P48

RATE OF DIV

Permitted Rate 1.00 cfs

Fee limit 1.00 cfs \$10000

Measured 1.00 cfs

Theoretical .33 cfs pump curve

Recommended Total Div Rate .33 cfs

WATER USES

Dom

OK
.33

Change (P46)

5.8 af

Irrig -

overlap (R58-R61, R62-R65, R66-R69)

supp. gw (WB7/065/079)

overlap spec. combined rts (W35)

<1acre (W31)

Domestic (W01/WB5/070/071/075)

Power (W42 or W43/025/027/R22 or R23)

Fish (042)

Fire (077)

Wtr Quality (081/R07)

TOTALS

Flow rate .33 cfs X 365 days X 1.98 = 238.5 af

REMARKS

Medical Plu aka St Lukes Meridian
Med Center.

ADD'L CONDITIONS

Watermaster Control WD# _____

DIM

GW Measurement/Measuring Device

Others

Trust (052/R55 - remove 051)

Non-trust (048/049)

Advance Priority ☐ yes ☒ no

SRBA Claim NA

Adjust Memo
Amend letters

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED

NOV 25 1998

Department of Water Resources

A. GENERAL INFORMATION

Permit No. 63-12199

1. Owner: St. Lukes Regional Medical Center Phone No. 386-2255

Current Address: 190 E Bonnock Boise ID 83712

2. Accompanied by: Bob Holcomb EXAM DATE : 9/17/98

Address: same Phone No. 893-5071

Relationship to Permit Holder: Water Works Manager

3. Source: Ground Water tributary to

B. OVERLAP REVIEW

1. Other water rights with the same place of use: Municipal

2. Other water rights with the same point of diversion:

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident No.	Govt. Lot	¼	¼	¼	Sec	Twp	Rge	County	Method of Determination/Remarks
			SW	NW	16	3N	1E	Ada	USGS Quad Map

2. Place(s) of Use:

Indicate Method of Determination USGS Quad Map

TWP	RGE	SEC	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
3N	1E	16							D										

MICROFILMED
14 NOV 4 1999

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. *see photos*

SEE ATTACHED SHEET.

Y Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

N Aerial Photo Attached (required for irrigation of 10+ acres).

Y Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
		10	Submersible		

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: Pump curve from Hiddleston Pump Co. who installed the pump.

E. NARRATIVE/REMARKS/COMMENTS

A well equipped with a 10 hp submersible pump supplies water to a hospital. The main source of water for the hospital is Meridian municipal water. The well can be used in case of emergency as a back-up well. The hospital is an out-patient care facility and is not open 24 hours/day. Their hours are 8 am to 10 pm. No other rights are used. The patient and employee numbers were supplied by Tim Hines, Manager of St. Lukes Administration (893-5000). 5 gallons per day per patient was used in the volume equation since the patients are treated on an out-patient basis.

Have conditions of permit approval been met? X yes ___ no

MICROFILMED
JAN 04 1999

F. FLOW CALCULATIONS

 / Additional Computation Sheets Attached

Measured Method:

Pump curve: 150 gpm = .33 cfs pumping capacity

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = \underline{\hspace{2cm}}$

$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = \underline{\hspace{2cm}}$

$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = \underline{\hspace{2cm}}$

2. Volume Calculations for Other Uses:

625 patients/dy X 5 gpd X 365 dys/yr/325850 = 3.5

135 employees X 15 gpd X 365 dys/yr/325850 = 2.3

2.3 + 3.5 = 5.8 afa

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion	Annual Volume
	From	To	Q (cfs)	V (afa)
<u>Domestic</u>	<u>1/1</u>	<u>12/31</u>	<u>.33</u>	<u>5.8</u>
Totals:			<u>.33</u>	<u>5.8</u>

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

I. AUTHENTICATION


Field Examiner's Name Lon Graven Date 11/23/98

Reviewer _____ Date _____

SEAL

MICROFILMED
JAN 04 1999

Submersible Turbine Model 6T-150

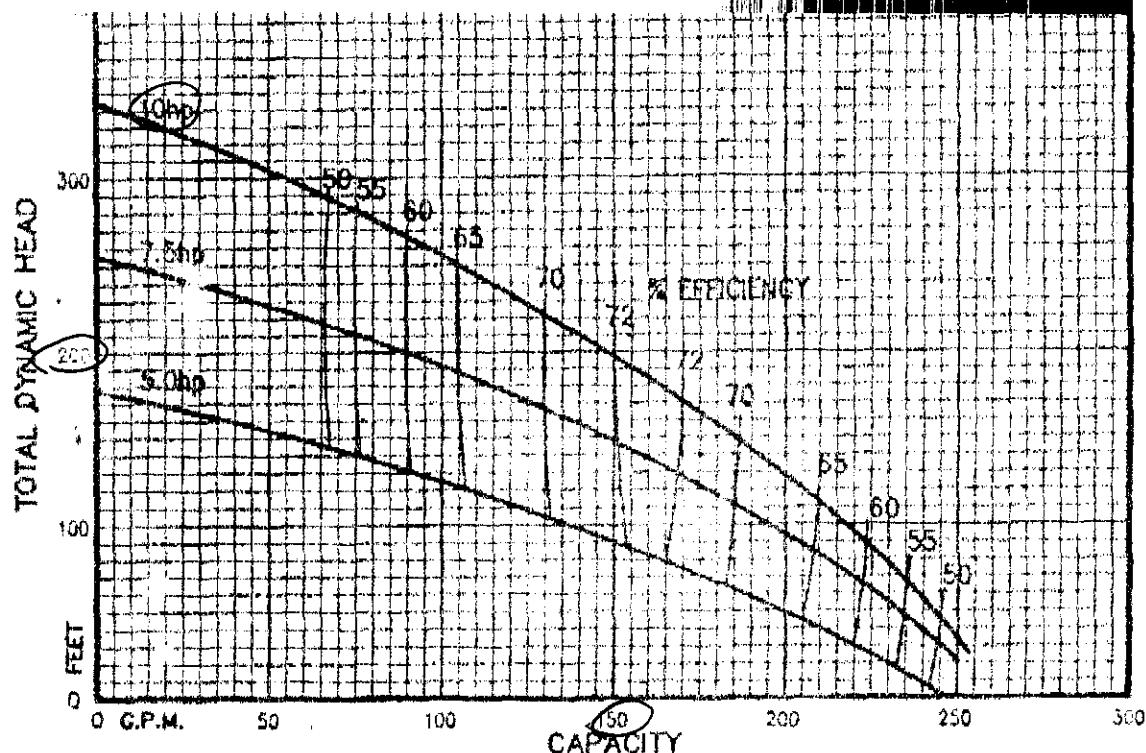

Specifications

CURVE No. SI2300A

LIQUID END WEIGHTS


DESCRIPTION	WEIGHT LBS	HP RATING	MOTOR FLANGE
ONE STAGE L.E.	55.5	5-10	6"
ONE STAGE L.E.			
ONE STAGE L.E.			
EACH ADDED STAGE	19.1	ALL	ALL

IMPELLER DATA

TYPE: ENCLOSED EYE AREA 5.76 Sq. in.
THRUST CONSTANT K 2.04 LBS./FT. OF HEAD.

HP	IMPELLER No.	STAGES	IMPELLER Dia.
10	M04236	5	4.53" Ø 42" (3.94")
7.5	S39543	4	4.14" Ø 48" (3.81")
5.0	S39542	3	4.31" Ø 45" (3.69")

OUTLINE DIMENSIONS



- A- ONE STAGE LIQUID END LENGTH
- B- SUCTION CONNECTION LENGTH
- C- STAGE LENGTH
- D- DISCHARGE CONNECTION LENGTH
- E- BOWL DIAMETER
- F- DIAMETER ACROSS LEAD GUARD

BOWL DATA

BOWL No. M04461 PUMP SHAFT Dia. 1"
TYPE: THREADED DISCHARGE SIZE 3" NPT (Female)
4" NPT (Male)

NOTE: For each additional stage add 'C'

A	B	C	D	E	F	HP RATING	MOTOR FLANGE
19.63	11.00	5.00	3.63	5.38	5.81	5-10	6"


MICROFILMED

REVISED 15 May 90

JAN 04 1999

© 1990, Berkeley Pumps

63-12199

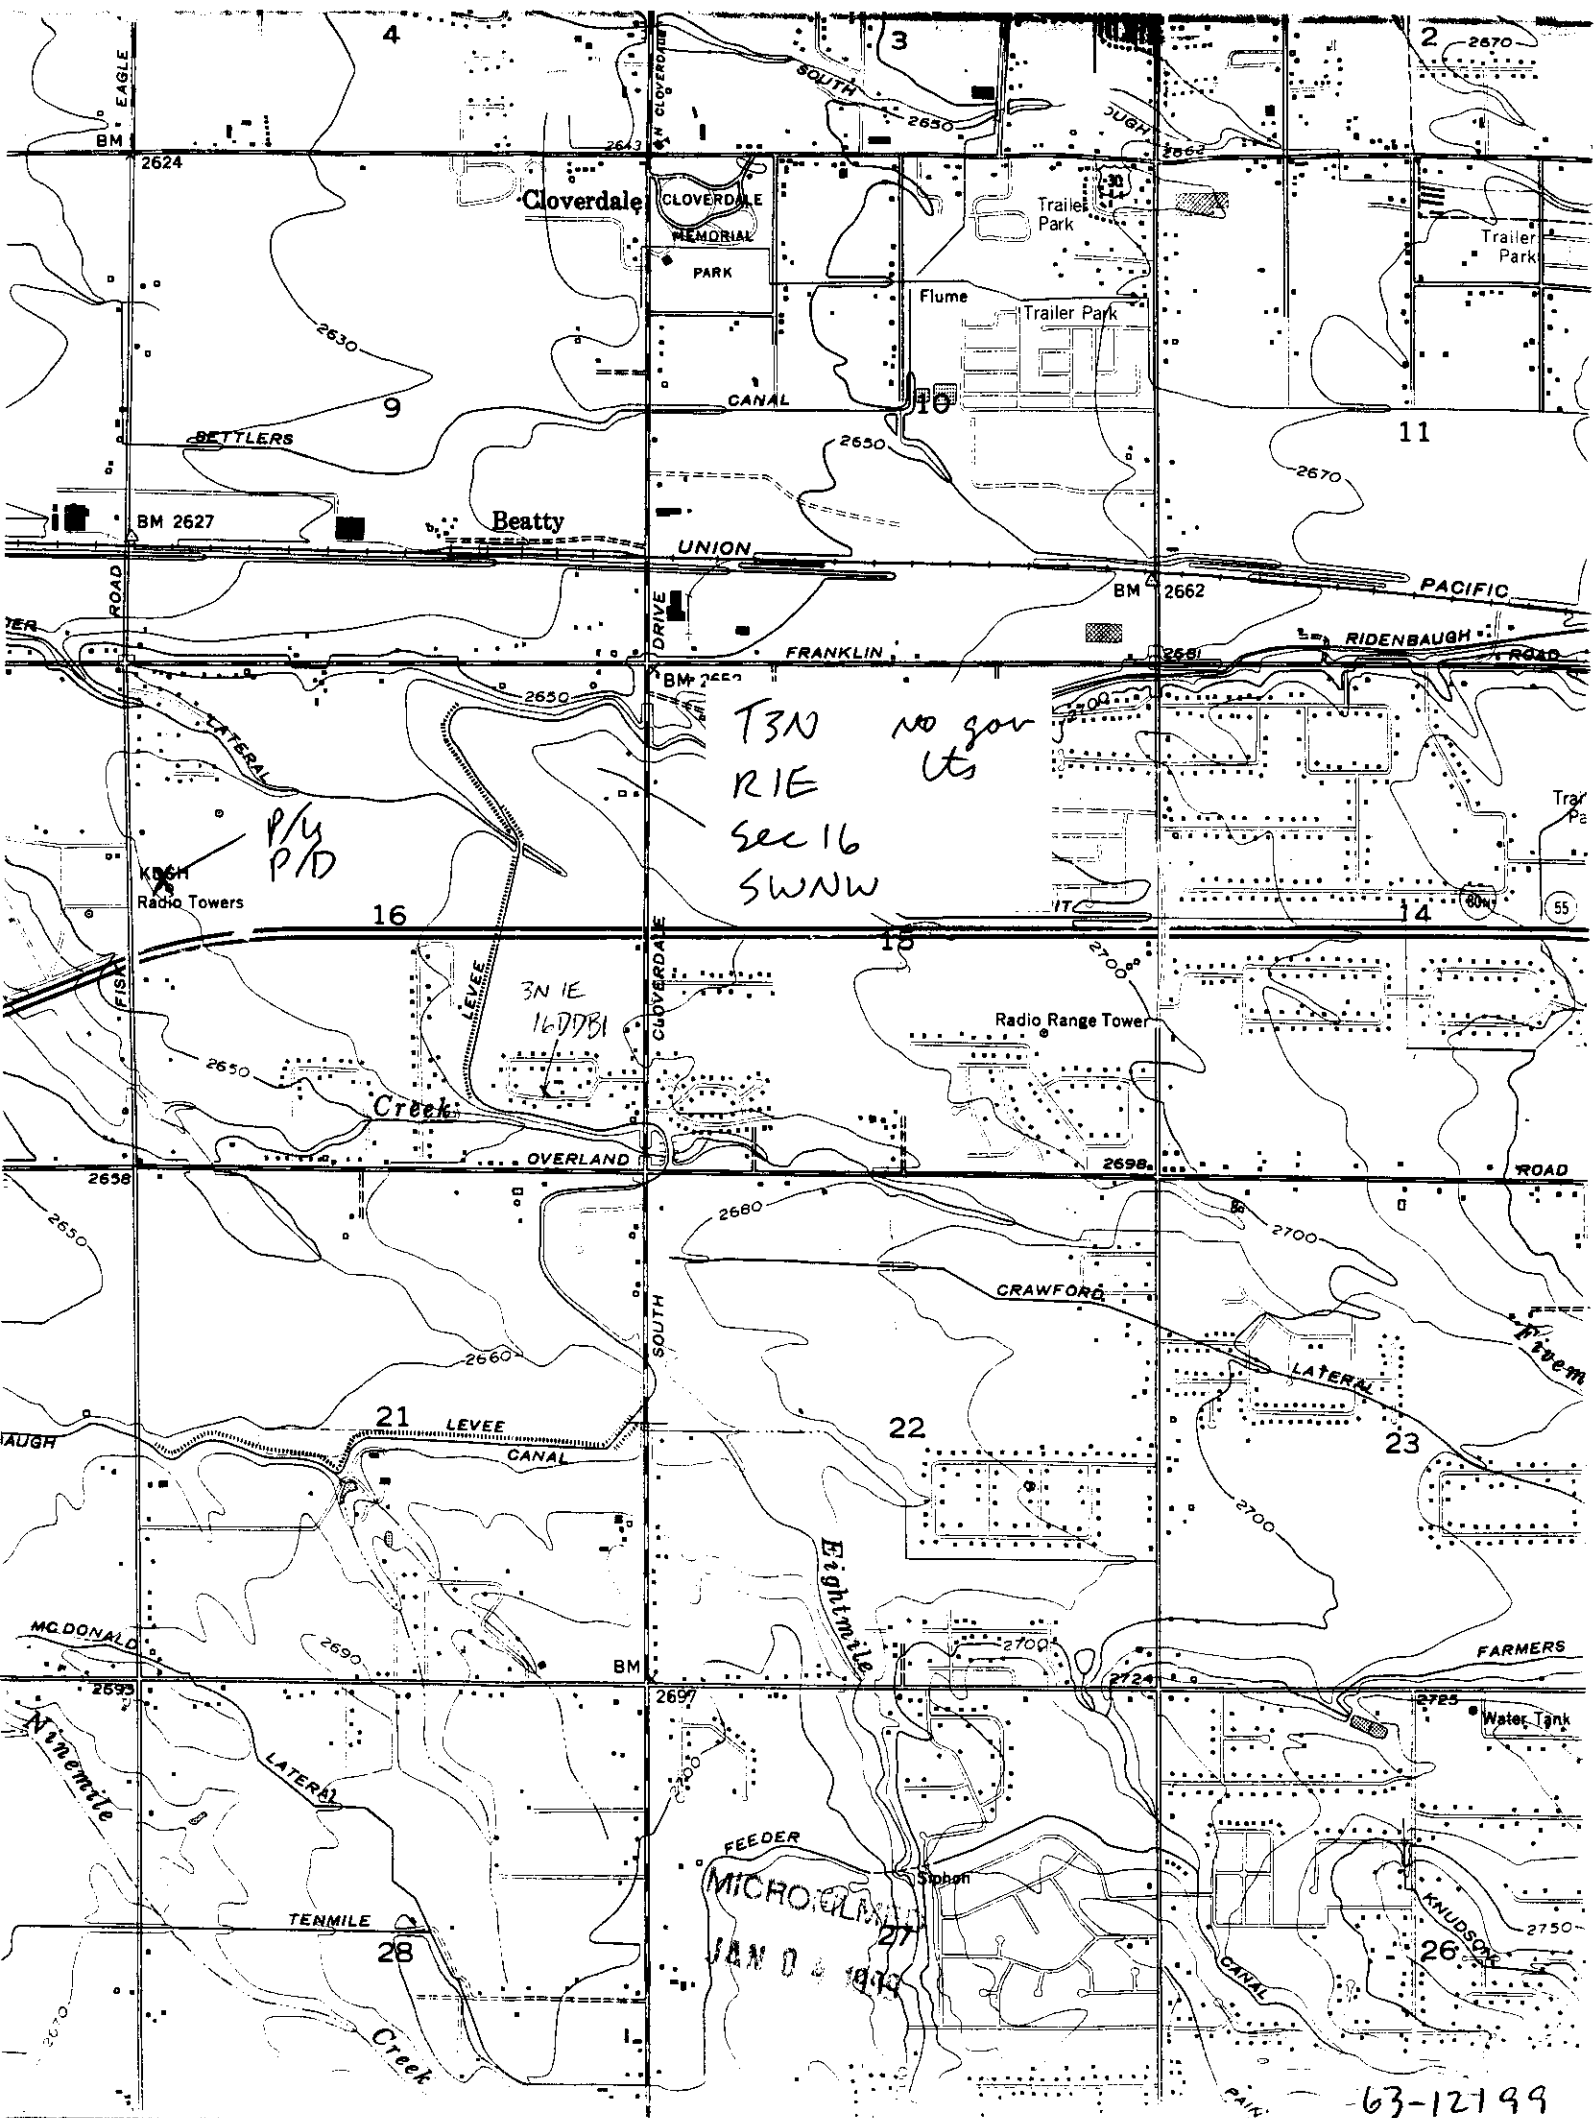

IDAHO DEPARTMENT OF WATER RESOURCES

WELL INSPECTION FORM

1. DRILLING PERMIT NO: 63-95-C-0418 OTHER APPLICABLE NO: 63-12199
2. OWNER: St. Luke Phone: 386-2255
Address: 190 E Bannock
3. WELL LOCATION: Twp 3N, Rge. 1E, Sec. 16, SW 1/4 NW 1/4
County Ada (Provide sketch map and photo on reverse.)
4. DRILLER: H. H. H. H. H. Lic. No. 35
When Drilled? 1/15/96
5. WELL CONSTRUCTION:
Casing Diameter 14-8 inches Water tight cap? ☒ Yes ☐ No Access Port: ☒ Yes ☐ No
Casing $\geq$ 12 inches above ground? ☒ Yes ☐ No - Describe _____
Depth of Casing 857 ft. Method Drilled Mud Rotary
Condition of Well Casing: ☒ Good ☐ Fair ☐ Poor Describe _____
Control Valve? ☐ Yes ☒ No Pressure Gauge: ☐ Yes ☒ No
Condition of Piping and Valving good
Auger to a depth of _____ ft. Evidence of Annular Seal ☐ Yes ☐ No
Are there obvious construction problems that may be a source for contamination or waste of water?
☐ Yes ☒ No (Describe in Remarks and Attach Photo - On Reverse)
6. HYDROLOGIC INFORMATION:
Depth to Static Water 9 ft. Water Temperature cold °F
Flowing Artesian ☐ Yes ☒ No Pressure: 50-70 (psi)
Water Sample Taken? ☐ Yes ☐ No If yes, describe purpose _____
Water Quality Measurements/Observations (Describe) _____
7. WELL USE:
☒ Domestic ☐ Irrigation ☐ Stock
☐ Test ☐ Municipal ☐ Industrial
☐ Abandoned ☐ Waste Disposal/Injection ☐ Not Used
☐ Other: _____

MICROFILMED

JAN 04 1999

8. POSSIBLE CONTAMINATION SOURCES:

Is there evidence of Chemigation? ☐ Yes ☒ No

If yes, is there a check-valve present? ☐ Yes ☒ No

Is there a possible source of contamination nearby? ☐ Yes ☒ No

If yes, what Type? _____


How far away from the well is this source? _____

9. REMARKS: back-up well to city system for
New Hospital

Ly
Signature of Dept. Representative & Title


9/17/96
Inspection Date

PHOTOS, DRAWINGS, OTHER ATTACHMENTS:

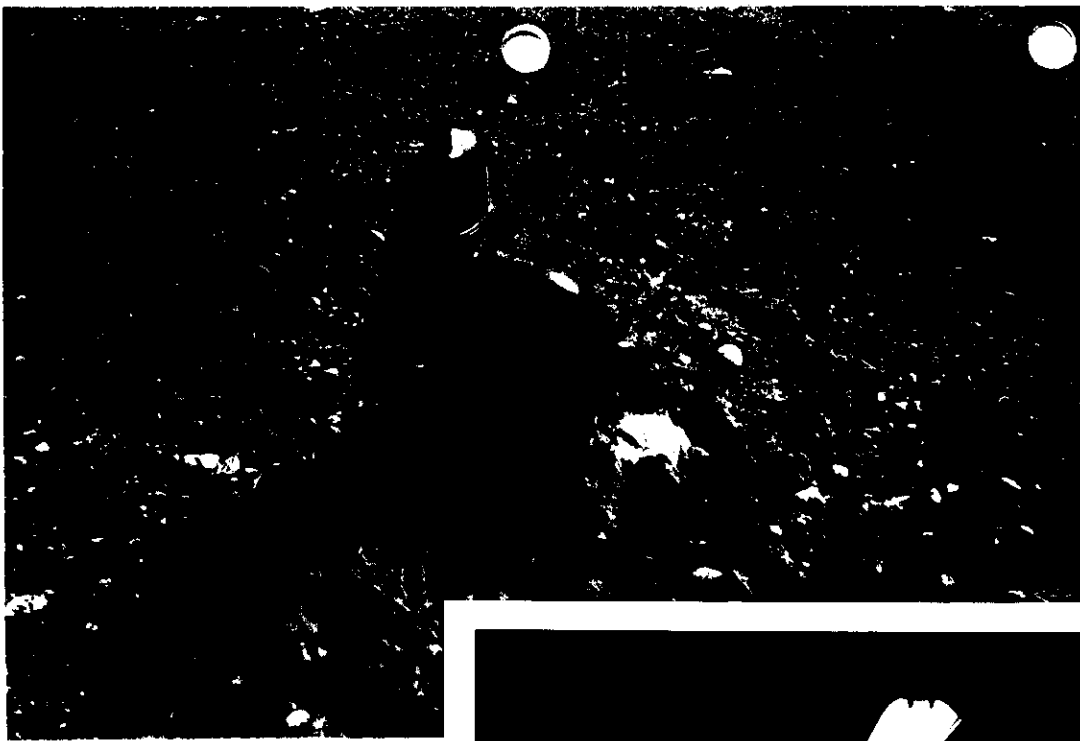

P/D

portion of
delivery
system

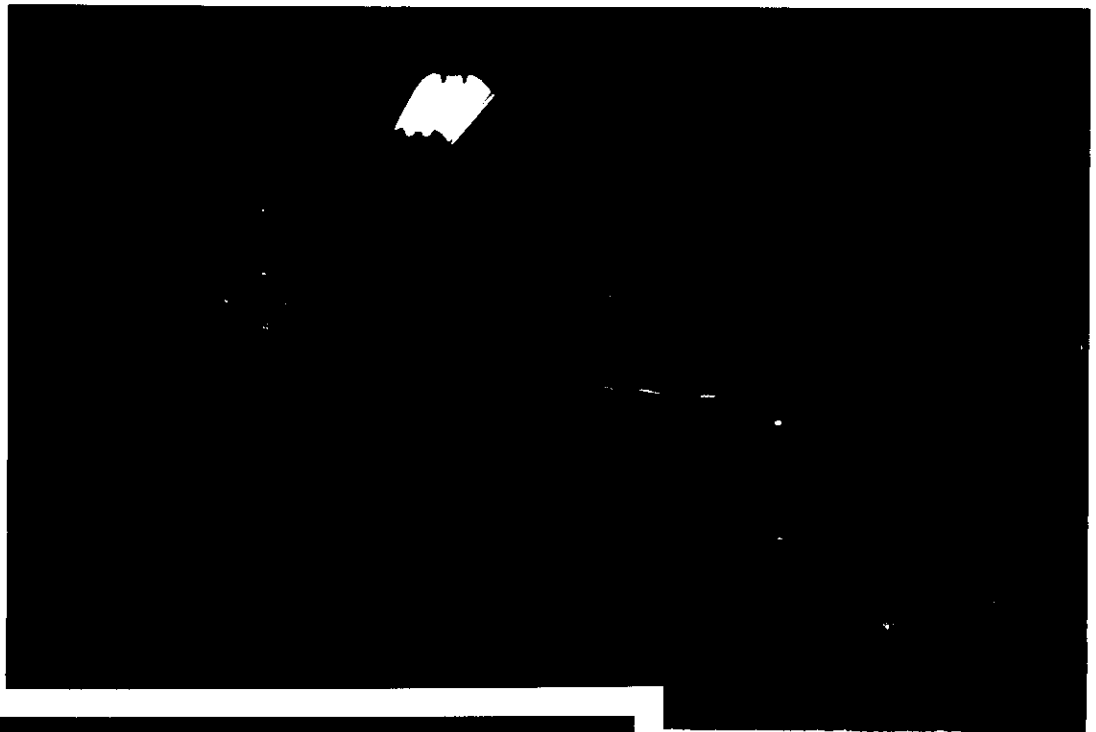

-P/U

MICROFILMED

JAN 04 1999

63-12199



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR
August 28, 1996

ST LUKES REGIONAL MEDICAL CENTER
190 E BANNOCK
BOISE ID 83712

PROOF ACKNOWLEDGEMENT LETTER

RE: PERMIT NO. 63-12199

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water.

Please be advised that Section 42-248, Idaho Code, which became effective on July 1, 1996, requires you or the owner of this water right to maintain current ownership and address records on file with the department. Please contact any office of the department for the proper form to file a change of ownership of a water right and/or a change in the address of the owner. Failure to maintain current records with the department could result in the assessment of a monetary penalty.

If you have questions concerning the field examination, contact the WESTERN Regional Office in Boise, at (208)334-2190.

Sincerely,

JULIE L. YARBROUGH
Senior Secretary

c: IDWR - Region

RECEIVED

SEP 12 1996

190 East Bannock
Boise, Idaho 83712

208-381-2222

Edwin E. Dahlberg
President

RECEIVED

JUL 25 1996

Department of Water Resources



July 24, 1996

Department of Water Resources
1301 N. Orchard Street
Statehouse Mail
Boise, ID 83720-9000

Re: Permit No. 63-12199
Proof of Beneficial Use

This Proof of Beneficial Use is submitted for the St. Luke's Meridian Medical Center at I-84 and Eagle Road, Meridian, Idaho. The medical facility will be built in multiple phases. Currently, the first phase has been constructed and is in use.

The water well installed for this project was designed for and test pumped at the total permitted withdrawal rate of 1 cfs. Current water demands under the first phase of the medical facility are being installed in the well. As additional phases of the facility are constructed, the pump size will be increased as necessary to allow diversion up to the maximum permitted amount. Therefore, St. Luke's Meridian Medical Center is hereby submitting a Proof of Beneficial Use for the full permitted amount of 1 cfs.

We appreciate the Department of Water Resources' willingness to work with St. Luke's on this project. If you have any questions about this submittal, please contact me or Mr. Chuck Feast at CH2M Hill (208) 345-5310.

Sincerely,

A handwritten signature in cursive script that reads "Ken Currier".

Ken Currier
Plant Operations Manager

SEP 12 1996

May 31, 1996

ST LUKES REGIONAL MEDICAL CENTER
C/O BEN STRAWN
190 E BANNOCK
BOISE ID 83712

PROOF DUE NOTICE

RE: PERMIT NO. 63-12199

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before August 1, 1996.

(See last page of your approved permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a complete field examination report prepared by a certified water right examiner may be used to submit the required proof.

If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.

Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.

SINCERELY,

JULIE L. YARBROUGH
Senior Secretary

Enclosures

SEP 1 2 1996

CERTIFIED MAIL

NO. 142784

WELL DRILLER'S REPORT

Use Typewriter or Ballpoint Pen

RECEIVED
FEB 21 1996

Office Use Only
Inspected by _____
Twp _____ Rge _____ Sec _____
1/4 _____ 1/4 _____ 1/4
Lat: _____ Long: _____

1. DRILLING PERMIT NO. 63 - 95 - C - 0418 - 000
Other IDWR No. 63-12199

2. OWNER:

Name ST. LUKES REGIONAL MED. CTR
Address 190 E. BANNOCK
City BOISE State ID Zip 83712

3. LOCATION OF WELL by legal description:

Sketch map location must agree with written location.

N				
S				

Twp. 3 North ☒ or South ☐
Rge. 1 East ☒ or West ☐
Sec. 16 SW 1/4 NW 1/4 1/4
Gov't Lot _____ County ADA 10 acres 40 acres 160 acres
Lat: _____ Long: _____

Address of Well Site CORNER I-84
AND EAGLE RD City MERIDIAN
(Give at least name of road + Distance to Road or Landmark)

Lt. _____ Blk. _____ Sub. Name _____

4. USE:

- ☐ Domestic ☐ Municipal ☐ Monitor ☐ Irrigation
☐ Thermal ☐ Injection ☒ Other COMMERCIAL

5. TYPE OF WORK check all that apply (Replacement etc.)

- ☒ New Well ☐ Modify ☐ Abandonment ☐ Other _____

6. DRILL METHOD

- ☐ Air Rotary ☐ Cable ☒ Mud Rotary ☐ Other _____

7. SEALING PROCEDURES

SEAL/FILTER PACK			AMOUNT		METHOD
Material	From	To	Sacks or Pounds		
CEMENT 8"	-10	770	250 sac	C	TREMMIE
CEMENT 14"	0	40	15 sac	C	" "
8-12 SAND	770	900	36 sac	"	" "

Was drive shoe used? ☐ Y ☒ N Shoe Depth(s) _____
Was drive shoe seal tested? ☐ Y ☒ N How? _____

8. CASING/LINER:

Diameter	From	To	Gauge	Material	Casing	Liner	Welded	Threaded
14"	0	40	375	STEEL	☒	☐	☒	☐
8"	2	792	250	STEEL	☒	☐	☒	☐
8"	817	857	250	STEEL	☒	☐	☒	☐

Length of Headpipe _____ Length of Tailpipe 10'

9. PERFORATIONS/SCREENS

- ☐ Perforations Method _____
☒ Screens Screen Type V-WIRE

From	To	Slot Size	Number	Diameter	Material	Casing	Liner
792	812	.030		8"	S.S.	☒	☐
857	877	.030		8"	S.S.	☒	☒

10. STATIC WATER LEVEL OR ARTESIAN PRESSURE

9 ft. below ground Artesian pressure _____ lb.
Depth flow encountered _____ ft. Description _____
control devices: _____

11. WELL TESTS:

- ☒ Pump ☐ Bailor ☐ Air ☐ Flowing Artesian

Yield gal./min.	Drawdown	Pumping Level	Time
350	10'	19	3 HRS
600	23'	32	4 HRS

Water Temp. _____ Bottom hole temp. _____

Water Quality test or comments: _____

12. LITHOLOGIC LOG: (Describe repairs or abandonment)

Bore Dia.	From	To	Remarks: Lithology, Water Quality & Temperature	Y	N
15	0	16	fill material & cobbles		
15	16	35	large cobbles & gravel		
15	35	40	tan sand & clay		
12	40	53	tan sand w/clay seams		
12	53	109	tan clay w/sand		
12	109	115	sand & gravel		
12	115	146	sandy clay		
12	146	174	sand & gravel w/clay		
12	174	190	sand & gravel		
12	190	240	brown clay sand & gravel		
12	240	248	tan clay		
12	248	264	sand coarse		
12	264	346	cemented sand w/gravel		
12	346	380	coarse sand w/layers of clay		
12	380	385	cemented sand		
12	385	395	sand & gravel		
12	395	440	blue clay		
12	440	472	medium sand		
12	472	481	blue clay		
12	481	520	blue clay w/sand seams		
12	520	560	tan sand		
12	560	579	blue clay		
12	579	670	blue clay w/sand seams		
12	670	680	blue clay & wood		
12	680	720	blue clay		
12	720	790	blue clay w/sand seams		
12	790	820	sand w/blue clay		
12	820	850	blue clay		
12	850	855	blue clay w/sand		
12	855	888	sand coarse w/sand		
12	888	902	blue clay		
12	902		sticky blue clay		

Completed Depth 887' (Measurable)
Date: Started 11/01/95 Completed 01/15/96

13. DRILLER'S CERTIFICATION

I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

Firm Name HIDDLESTON & SON, INC. Firm No. 35

Firm Official [Signature] Date 2/19/96
and _____

Supervisor or Operator _____ Date _____

(Sign once if Firm Official & Operator)

FORWARD WHITE COPY TO WATER RESOURCES



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

August 24, 1995

ST LUKES REGIONAL MEDICAL CENTER
C/O BEN STRAWN
190 E BANNOCK
BOISE ID 83712

PERMIT APPROVAL NOTICE

RE: PERMIT NO. 63-12199

Dear Permit Holder:

Enclosed is a copy of your approved application for permit. Please be sure to thoroughly review the "CONDITIONS/REMARKS:" listing on the permit.

Enclosed is a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit. Also enclosed is a form entitled "Proof of Beneficial Use". If your project is already completed you should complete and submit this form immediately.

If a well has not already been constructed you are required to obtain a "drilling permit" from the department. The right to drill a well is not a part of this permit to appropriate water.

Sincerely,

Shelley W. Keen
Water Rights Supervisor

SK:rl

Enclosures

RECORDED

AUG 25 1995

Drilling Permit 63-95-C-412000
 Water Right Per. No. 63-12199 (pending)
 Injection Permit No. _____

WELL DRILLER: PLEASE COMPLETE FOR VERBALS
 IDWR Employee Issuing Verbal: _____
 Verbal Issued Date: _____ Time: _____

RECEIVED

FEB 22 1995

State of Idaho
 Department of Water Resources

APPLICATION FOR DRILLING PERMIT
 (FOR THE CONSTRUCTION OF A WELL)

Department of Water Resources

1. Applicant (please print): St. Luke's Regional Medical Center Ben Strawn RECEIVED

2. Mailing Address: 190 East Bannock FEB 22 1995

City & State Boise, ID Zip Code 83712 Telephone (208) 386-2255 WATER RESOURCES
 WESTERN REGION

☒ Well Owner ☐ Well Operator ☐ Contractor or Other, specify _____

3. Proposed Well Location: Twp. 3 North, Rge. 1 East, Sec. 16, SW 1/4 NW 1/4

Gov't Lot No. _____ County Ada

Street Address of Well Site Intersection of Eagle Road and I-84 City Meridian
 Give at least name of road + Distance to Road or Landmark

Lot, block and subdivision Parcel 1

4. Proposed Use of Well:

☒ DOMESTIC: The use of water for homes, organization camps, public campgrounds, livestock (1,000 head or less) and for any other purpose in connection therewith, including irrigation of up to 1/2 acre of land, if the total use is not in excess of 13,000 gpd; or any other uses, if the total use does not exceed a diversion rate of 0.04 cfs and a diversion volume of 2500 gpd.

Domestic does not include water for multiple ownership subdivisions, mobile home parks, commercial or business establishments, unless the use does not exceed a diversion rate of 0.04 cfs and a diversion volume of 2500 gpd.

NON-DOMESTIC: ☐ Irrigation ☐ Municipal ☐ Industrial
☐ Stock ☐ Test ☒ Other Commercial--out patient care facility
 (Over 1,000 Head) (Describe)

☐ INJECTION

☐ MONITORING: A well bore schematic and map is required for each blanket permit.
 No. of proposed wells: _____

5. Well Construction Information:

A. ☒ New well ☐ Modify ☐ Replace

B. Proposed Casing Diameter 8 1/2 - inch Proposed Maximum Depth 600 feet

C. Anticipated bottom hole temperature:
☒ 85°F or less ☐ 85°F to 212°F ☐ 212°F or more
 (Cold Water Well) (Low Temp. Geo. Well) (Geothermal Well)

6. Construction Start Date: February 16, 1995

7. Anticipated Well Driller: Riverside, Parma, ID Driller's Lic. No. _____

NOTE: The actual well driller must be identified prior to drilling.

8. Applicant's Signature * Ben F. Strawn Date * 2/3/94

Title * Director of Bldg. Services
 (Owner, Firm Representative, Other)

VOUCHERED
 FEB 17 1995

AUG 25 1995

ACTION OF THE DEPARTMENT OF WATER RESOURCES

This Permit is Approved

Date August 28, 1995

If approved, this permit authorizes the construction or modification of a well subject to the following conditions. READ CAREFULLY!

GENERAL CONDITIONS:

1. This drilling permit is valid for two (2) months from the above approval date for the start of construction and is valid for one (1) year from the approval date for completion of the well unless an extension has been granted.
2. This permit does not constitute an approval of the District Health Department or the Idaho Department of Health and Welfare which may be required before construction of this well. All wells must be drilled a minimum distance of 100 feet from a drain field. Domestic and Public Water Supply wells must be drilled a minimum of 50 feet and 100 feet respectively from a septic tank.
3. The well shall be constructed by a driller currently licensed in the State of Idaho who must maintain a copy of the drilling permit at the drilling site.
4. Approval of this drilling permit does not authorize trespass on the land of another party.
5. This permit does not constitute other local, county, state or federal approvals which may be required for construction of a well.
6. This drilling permit does not represent a right to divert and use the water of the State of Idaho.
7. If a bottom hole temperature of 85° or greater is encountered, well construction shall cease and the well driller and the well owner shall contact the Department immediately.

SPECIFIC CONDITIONS:

RECEIVED
AUG 25 1995

David R. Tuttle
Signature of Authorized Department Representative

Mgr, Western Reg Office
Title

Receipt No C032193 Received by RT Fee 200⁰⁰ Date 2-22-95

EXTENSION OF DRILLING PERMIT

Extension approved by _____ Approval Date _____

This extension expires: _____

**APPLICATION FOR PERMIT
STATE OFFICE REVIEW
by Cindy Zimmerman**

No.: 63-12199 Name: St. Lukes Date: 7/31/95 Ad OK? ☒
Correct Fee? ☒ Receipt #: W018769 Priority: 3/22/95 ☒ Gvmt Lts:

AREA OF CONCERN? - No/Yes Mor GWMA Trust/Non-trust
PROTESTED: - 020(Protest Agr) or W19(See Final/Prelim Order)

SYSTEM COMPLETED:
Yes/proof filed - NA
1 year/no proof - P16
+1 year - 26A-P17

GROUNDWATER: <☒ FLO-CH>
+ 0.2 cfs - 01M
=/- 0.2 cfs - No MD
=/+ 5 a. (POU cmp) - 01M, 065(if GW use SW 1st)

Drilling Permit:
Existing well - NA (pre 7/1/87)
Included w/permit - Permit No. , P99
No WD permit? - 046-46B-P23 (post 7/1/87)
irr. in WD - P05 (new well)

SURFACE WATER <☒ FLO-CH> (Surface water that doesn't sink):
Water District(~~dem~~) - 005 (req) WD # <SEE MAP & LISTING>
+ 0.2 cfs - 028(may report)-01J(meas dev)-P08
=/- 0.2 cfs - 028(may report)-01H(lock dev)-P01 or No MD
=/+ 5 a. irr. - 028(may report) (POU cmp)
~~In WD~~ + 0.2 cfs - 01M or No MD (in-stream)
- 0.2 cfs - No MD
=/+ 5 a. irr. - 01M

RIVER BASINS (*Surface water):
Snake R (01) - 11A-P04, NA
(02/03) - 007-P07 (w/remark WB9), NA
Boise R (63) - 05A (if WD), 11E (not 42-111 use), NA
Payette R (65) - 064(consump. use), 047-P04(Payette Lake), NA

USE:
Domestic (surface) - 021(Boise R ↑ L Peak); 27A(Payette R); NA
Fish Propagation - 07A-042(rq)-010/06A/09E(WQ)-P10; 044(N 1000 Spr)
Irr =/- 5 acres - 057 (0.03 cfs/A) <DO POU COMPARISON>
+ 5 acres - 03A (0.02 cfs/A) <DO POU COMPARISON>
Mining - 054 (req) & 06A/010/09E-P10
Power - 08A-17K-025-027-01M-01F(P19)-09E(P10);
+25 cfs-P18; 17G(FERC) or 17M(FERC); 18B-P09
Storage(☒ 3 compo.) - 18A(multi MD in WD), 18B-P09 (+10' dam), NA

LOCATION:
Boise Front LoGeo - 058 (-85° GW temp only)
In-stream dev. - P52 (stream channel alteration)
Irr Dist/Canal Co. - 023 (Twin Falls area)
Swan Falls Flag - B <SEE CONDITION CODE CHART>
Trust - 051-052-053-P74 (Consumptive Uses), NA
Non-Trust <1> - 048-049 (Consumptive Uses), NA
OWNERSHIP: Non-land owner - 004 (PD/PU)

OTHER CONDITIONS:

STANDARD REMARKS: Down/med center bldg.

BENEFICIAL USE DUE: - 8-1-1996
COMMENTS:

RECEIVED
JUL 31 1995

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPROPRIATION APPLICATION ANALYSIS SHEET

Department of Water Resources

INITIAL REVIEW BY: FL DATE: 4/25/95 APPLICATION: 63-12199

REQUIRED INFORMATION

☒ Name: (If applicant is a corporation or partnership, names and addresses for the director, officers, and other partners must be included.)
☒ Address:
☒ Source: (See USGS Quad for names of water sources)
☒ Point of Diversion: (10 acres for spring, lot & block descriptions for Subdivisions, local name)
☒ County:
☒ Quantity: (flow and/or volume)
☒ Period of use:
☒ Nature of proposed use: (Include description of use)
☒ Description of diverting works:
☒ Time required for beneficial use of water:
☒ Place of use or acres irrigated:
☒ Map: (show T, R, S, QQ &/or QQQ)
☒ Subdivision plat: (for > 1 home in restricted area. ≥ 5 homes in non-restricted area)
☒ Signature: (If applicant is corp., partnership, or municipality, title of signatory is required)
☒ Fee:
☒ Yes ☐ No* In form to receipt:

Gov't. Lots:

N P/D
P/U

NOTE Drilling Permit Appl.
included in this file

ADDITIONAL INFORMATION

YES NO

☒ ☐ Overlapping place of use: (Describe source & relationship to present application on the back.)
☐ ☒ Overlapping point of diversion:
☐ ☐ Field check required: Field check by: _____
☐ ☐ Field report attached:
☐ ☒ Critical groundwater area:
☐ ☒ Groundwater management area:
☒ 1992 moratorium:
☐ ☒ Copy to SCA staff: (perennial stream, non-pump diversion)
☐ ☒ Copy to Dam Safety staff: (for any storage)
☐ ☒ Basin 63 mitigation plan: (where ground water replaces surface water for irrigation, request additional information &/or mitigation plan to address reduced aquifer recharge)
☐ ☒ Send power requirement letter:
☐ ☒ Send fish farm requirement letter:
☐ ☒ Power residency affidavit:
☐ ☒ Power efficiency form:
☐ ☒ Diversion greater than 5 cfs or 500 af or irrigation greater than 200 acres: (If yes, attach Large Diversion supplementary analysis sheet.)

*REQUEST ADDITIONAL INFORMATION FROM THE APPLICANT

NAMES/TITLES for MED. CTR.

DATE REQUESTED: 4/25/95 4/27/95

☒ ☐ Additional information on reverse side:

* Possible exemption (public interest)

PROCESSING

APPLICATION N

63-12199

YES NO

☒ ☐
☒ ☐
☒ ☐

In form for advertising:

Statewide advertising: (> 10 cfs &/or 1000 af)

Fee amount, receipt number and date recorded on application:

SEND COPIES TO

YES NO

☐ ☒
☐ ☒
☐ ☒
☐ ☒
☐ ☒

I.D. Health and Welfare

I.D. District Health

I.D. Fish and Game

I.D. Lands

Adjudication Bureau

YES NO

☐ ☒
☐ ☒
☐ ☒
☐ ☒

U.S. BLM

U.S. Forest Svc.

Water Dist. #

Other

FINAL REGIONAL PROCESSING REVIEW

YES NO

☒ ☐
☒ ☐

Affidavit of publication received:

Application published correctly: If not, record action taken.

Publication dates and paper recorded on application:

Protests received. Final date for protest 5-22-95

Protest dates, resolution of protest recorded on application:

Recommendations attached: Approve, DW

Measuring device required:

Measuring port required:

Water delivered by water master? District #

Special conditions of approval or cover letter:

H₂, OIF

See below for additional information

Recommended Date or Priority 3/22/1995

Recommended by: DW

Date 6/2/1995

STATE OFFICE REVIEW

See below for additional information. By Date

ADDITIONAL INFORMATION

Temp. Approval Appl. returned to St. Louis Co. Bore Stripes; 50
 Return for same being processed Roger Noble CH2M A.M. also notified
 of this & why processing w.r. application.

Overlap - Inv. Dist. H₂ in same 40; also, area served by
 mentioned municipal rights. No other wells found in 40 per
 WRGS.

RECEIVED

MAY 15 1995

WATER RESOURCES
WESTERN REGIONThe Idaho
Statesman
P.O. BOX 40, BOISE, IDAHO 83707

LEGAL ADVERTISING INVOICE

Amount Due

\$101.28

Account Number 04762800		Identification Notice of Application for Water Right	
Ordered By Sue Taylor	P.O. Number	Rate NT	Run Dates May 4 & 11, 1995
Sue Taylor IDAHO DEPARTMENT OF WATER RESOURCES Western Region 2735 Airport Way Boise, Idaho 83705-5082		Estimated Inches.	Real Inches
		± Affidavits 1	Legal Number 1940

LEGAL NOTICE

NOTICE OF APPLICATION
FOR WATER RIGHT

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

63-12195

ADDY, MIKE C
6043 BRIAN RD
BOISE, ID 83712

Source: SRING
Tributary: ROBIE CREEK
Diversión Pt: SENESW Sec 32 T04N
R04E In ADA County.

Use: STOCKWATER (0.020 CFS)
DOMESTIC (0.020 CFS)
Total Diversión: (0.040 CFS)

Date Filed: 4/13/1995
In: ADA County
T04N R04E S32 NESW

ST LUKES REGIONAL MEDICAL
CENTER
C/O BEN STRAWN
190 E BANNOCK
BOISE, ID 83712

Source: GROUNDWATER
Diversión Pt: SWSWNW Sec 16 T03N
R01E In ADA County.

Use: DOMESTIC (1.000 CFS)
Total Diversión: (1.000 CFS)

Date Filed: 3/22/1995
In: ADA County
T03N R01E S16 SWNW

Applicant seeks public interest exemption to drought moratorium for a backup well for medical center. Primary supply will be from Meridian municipal water system.

63-12202

STRAUSS, LINDA
9340 PEBBLE BROOK LN
BOISE, ID 83703

Source: UNNAMED DRAIN
Tributary: BOISE RIVER
Diversión Pt: LOT 2 (NWSE) Sec 23
T04N R01E In ADA County.

Use: AESTHETIC (0.200 CFS)
Total Diversión: (0.200 CFS)

Date Filed: 4/17/1995
In: ADA County
T04N R01E S23 Lot 2(NWSE)

Applicant seeks exemption to drought moratorium for a non-consumptive use. (waterfall)

63-12203

STATEWIDE CONSTRUCTION
4225 RIVA RIDGE DR
BOISE, ID 83709

Source: GROUNDWATER
Diversión Pt: SWSWNW Sec 15 T02N
R01E In ADA County.

Use: IRRIGATION (0.240 CFS)
DOMESTIC (0.230 CFS)
Total Diversión: (0.470 CFS)

Date Filed: 4/19/1995
In: ADA County
T02N R01E S15 SWNW NWSW
12.0 ACRES TOTAL

Permits will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code. Any protest against the approval of this application must be filed with the Director, Dept. of Water Resources, Western Region, 2735 Airport Way, Boise, Idaho 83705 together with a protest fee of \$25.00 on or before MAY 22, 1995. The protestant must also send a copy of the protest to the applicant.

R. KEITH HIGGINSON, Director
Pub. May 4 & 11, 1995 1940

LINDA PORTER

being duly sworn, deposes and says: That she is the Principal Clerk of The Idaho Statesman, a daily newspaper printed and published at Boise, Ada County, State of Idaho, and having a general circulation therein and which said newspaper has been continuously and uninterruptedly published in said County during a period of twelve consecutive months prior to the first publication of the notice, a copy of which is attached hereto; that said notice was published in The Idaho Statesman in conformity with Section 60-108, Idaho Code as amended, for TWO

☒ consecutive weekly ☐ consecutive daily ☐ single ☐ odd skip

insertion(s) beginning with the issue of MAY 4, 19 95

and ending with the issue of MAY 11, 19 95

Linda Porter

STATE OF IDAHO)

ss.

COUNTY OF ADA)

On this 11th day of MAY in the year of 1995, before me, a Notary Public, personally appeared

LINDA PORTER

known or identified to me to be the person whose name subscribed to the within instrument, and being by me first duly sworn, declared that the statements therein are true, and acknowledged to me that she executed the same.

Notary Public for Idaho

Residing at Boise, Idaho

My commission expires: 11-22-99

RECORDED

AUG 25 1995



State of Idaho

DEPARTMENT OF WATER RESOURCES

Western Region, 2735 Airport Way, Boise, Idaho 83705-5082 - (208) 334-2190
FAX (208) 334-2348

PHILIP E. BATT
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

April 27, 1995

Mr. Ben Strawn
St. Luke's Regional Medical Center
190 East Bannock
Boise, ID 83712

RE: APPLICATION FOR PERMIT NO. 63-12199

Dear Mr. Strawn:

Enclosed is the Application for Temporary Approval regarding the proposed well for the medical center in or near Meridian. It has been determined that such a route will not allow approval of a well drilling permit and use of water. However, the above-referenced Application for Permit to obtain a permanent water right (no. 63-12199) can now be processed as a probable exemption to the drought moratorium.

Should application no. 63-12199 be approved, a drilling permit can be issued to authorize construction of the well.

The Temporary Approval Application therefore serves no purpose. A \$50 refund will be issued to the fee payer, CH2M Hill, for that filing.

Meanwhile, the normal water right process will continue. Application no. 63-12199 will be advertised in the May 4 and May 11 Idaho Statesman, and the protest deadline will be May 22, 1995. To facilitate completion of application processing, please submit to this office the names and titles of officers or directors etc. for your organization.

Please contact me if you have any concerns in this regard.

Sincerely,

A handwritten signature in cursive script, appearing to read 'Steve Lester'.

Steve Lester
Water Rights Supervisor

Enclosure
cc: Roger Noble, CH2M Hill

RECEIVED
AUG 25 1995

MEMORANDUM

TO: MARY McCULLEY

FROM: STEVE LESTER *SL*

DATE: APRIL 25, 1995

RE: REFUND

CH2M Hill, acting as consultant for St. Luke's Regional Medical Center, paid \$50 on 3-22-95 for a Temporary Approval Application. This application has now been rendered unnecessary per Water Right Permit Application 63-12199.

Therefore, a \$50 refund should be issued to CH2M Hill as follows:

RECEIPT NO.	W018769	
REASON	\$50 of \$150 paid now n/a	
TO	ATTN Roger Noble CH2M Hill 700 Clearwater Ln. Boise, ID 83712	(TEL 345-5310)

cc: Application 63-12199

Ben Strawn, St. Luke's Regional Medical Center

RECEIVED
AUG 25 1995

RECEIVED

APR 19 1995

WATER RESOURCES
WESTERN REGION

MEMORANDUM

To: Dave Tuthill 
From: L. Glen Saxton 
RE: APPLICATION FOR PERMIT FILED BY ST. LUKES REGIONAL
MEDICAL CENTER
Date: April 18, 1995

I have briefly reviewed the above referenced application which you forwarded to me. The application appears to propose a back-up well to provide emergency water to the medical center when water can not be provided by the city of Meridian.

If the intended use of the well truly is for emergency back-up, it appears the department should advertise the application and consider approving it pursuant to the "furtherance of the public interest" provision in the Eastern Snake River Plain Moratorium.

I do not think the department should authorize construction of a well, however, until the department issues a water right permit or at least is prepared to issue a permit.

The department probably should refund the fee submitted in connection with the Application for Temporary Approval of a Water Appropriation since that document does not appear to be germane to the needs of the applicant.

c: Jim Johnson

INTER-DEPARTMENT MEMO — 1

FROM Dave Tuthill

DATE 4/14/95

TO Glen Saxton

SUBJECT Attached

Roger Noble requested that the Department evaluate this request as a potential exception to the Moratorium, per item 9 in the Moratorium Order.

RECORDED
AUG 25 1995

Dave

SIGNATURE

IN THE MATTER OF APPLICATIONS FOR)
PERMITS FOR THE DIVERSION AND USE)
OF SURFACE AND GROUND WATER WITHIN)
THE EASTERN SNAKE RIVER PLAIN AREA)
AND THE BOISE RIVER DRAINAGE AREA)
)

The Director of the Department of Water Resources, having responsibility for the administration of the appropriation of the water of the state of Idaho, the protection of rights to the use of water within the state, the protection of the public interest in the waters of the state, and the conservation of the water resources of the state, enters the following Findings of Fact, Conclusions of Law and Order:

1. On May 15, 1992, the Director of the department issued a moratorium order against the approval of certain new applications in the Snake River Basin upstream from the USGS gaging station at Weiser, Idaho. On January 6, 1993, the Director amended the moratorium order to eliminate the non-trust water area from the scope of the May 15, 1992 moratorium order. Conditions have since changed making further amendment of the May 15, 1992 order appropriate.

2. The Snake River Basin in Idaho has experienced six consecutive years of drought, and while the snowpack and precipitation are now near or above average across much of southern Idaho, residual effects of the drought are still evident in ground water levels, spring flows and anticipated stream flows.

3. Ground water aquifers have become stressed by the reduction in natural recharge due to changes in diversion and use of surface waters throughout the basin and by the increased volume of pumping occurring to augment scarce surface water supplies during the drought period. The lowered water levels in the

AUG 25 1995

Aug 25 1995

100-100000

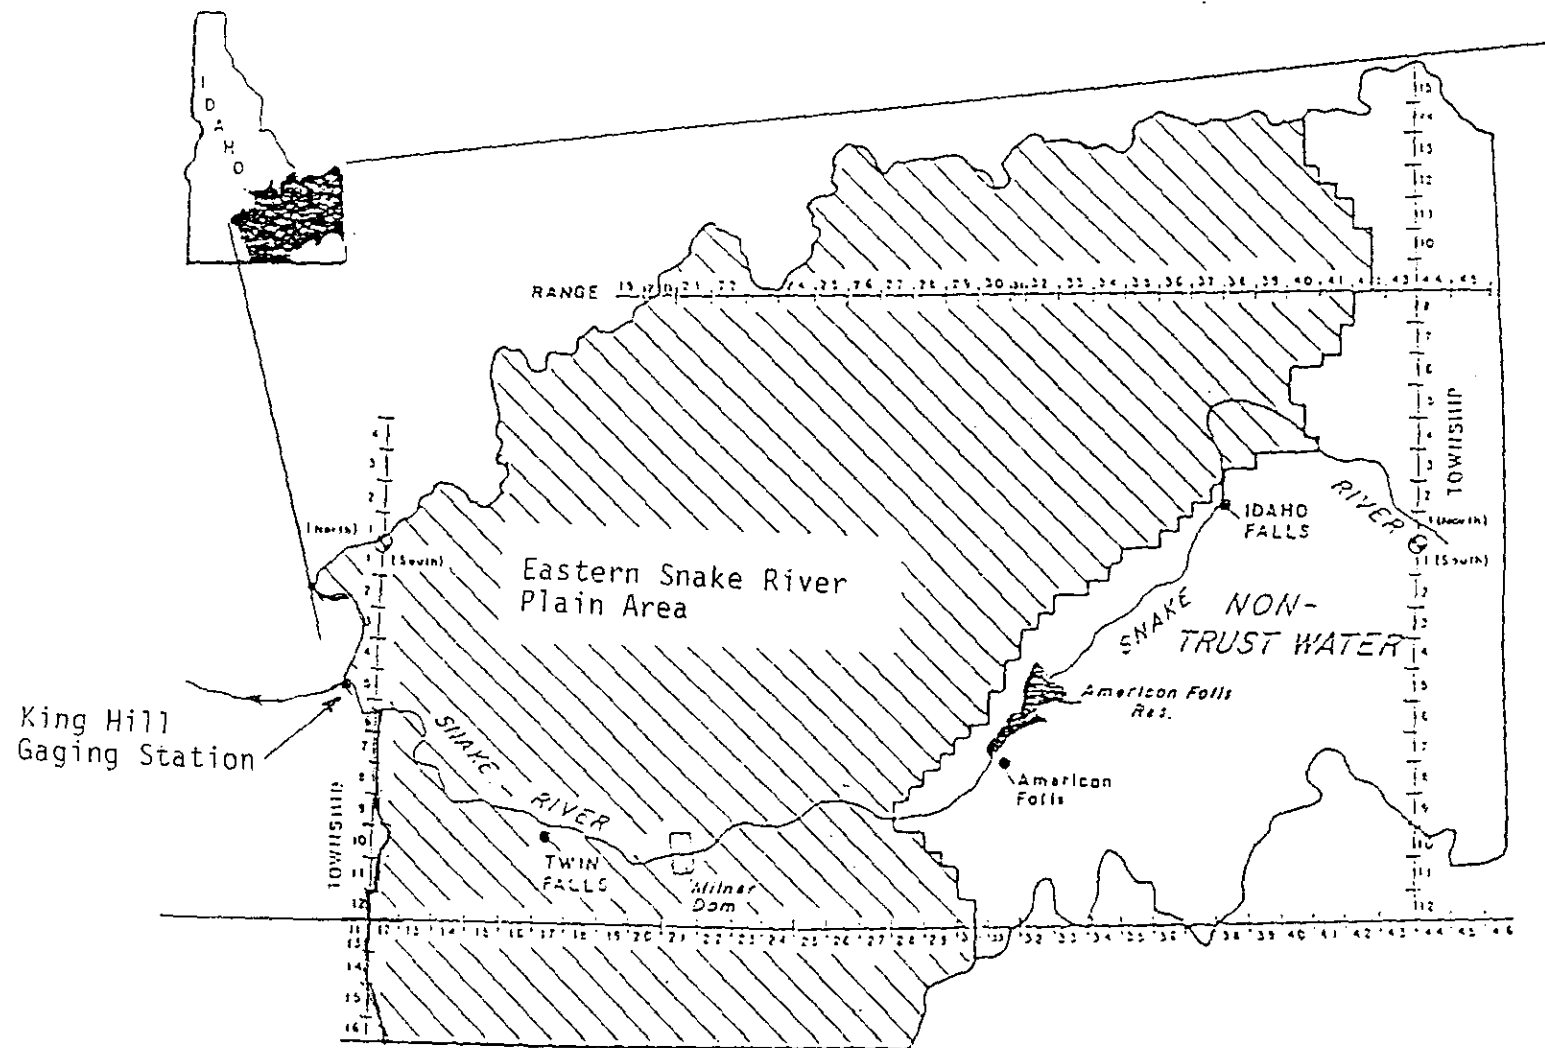


Exhibit A

aquifers across much of the Snake River Basin in southern Idaho have resulted in numerous wells, often those used for domestic and municipal water supply purposes becoming unusable. Lowered ground water levels also reduce spring and base flow discharge needed to maintain stream and river flows.

4. The need to supplement or replace inadequate surface supplies has prompted many waterusers to pursue ground water as an alternative source of supply.

5. Many wells throughout the Snake River Basin, including domestic wells in the Boise River Area, have either been replaced or drilled deeper during the duration of the drought.

6. The 1993 Idaho legislature authorized a three year study to determine the relationship between the Snake Plain Aquifer and the flow of the Snake River.

7. Even though the water supplies in the state are approaching normal for the 1993 irrigation season, ground water levels which have been declining will not fully recover in 1993.

8. The term "non-trust water area" means that area depicted as such on Exhibit "A" attached hereto and by this reference incorporated herein.

9. The term "Eastern Snake River Plain Area" means the trust water area of the Snake Plain Aquifer upstream from the USGS gaging station on the Snake River at King Hill. To further define the western boundary of this area, department designated hydrologic basin nos. 37 and 47, among other basins, are included in the area and hydrologic basin nos. 51 and 61, among other basins, are not included in the area.

10. The term "Boise River Drainage Area" means hydrologic basin no. 63 as designated in department records.

11. This Amended Moratorium Order does not pertain to the non-trust water area.

12. The Snake River Basin Moratorium Order issued by the department on May 15, 1992 and amended on January 6, 1993, includes and overlaps both the Big Lost River drainage for which the department has previously issued a moratorium order on August 7,

AUG 25 1995

1990 and the Mud Lake and Vicinity Area for which the department issued a moratorium order on December 1, 1989.

CONCLUSIONS OF LAW

1. The Director of the Department of Water Resources is responsible for administration of the appropriation and use of the water of the state of Idaho. Section 42-202, Idaho Code, reads in pertinent part:

For the purpose of regulating the use of the public waters and of establishing by direct means the priority right to such use, any person, association or corporation hereafter intending to acquire the right to the beneficial use of the waters of any natural streams, springs or seepage waters, lakes or ground water, or other public waters in the state of Idaho, shall, before commencing of the construction, enlargement or extension of the ditch, canal, well, or other distributing works, or performing any work in connection with said construction or proposed appropriation or the diversion of any waters into a natural channel, make an application to the department of water resources for a permit to make such appropriation.

2. The Director of the Department of Water Resources is responsible for supervision of water distribution in the state of Idaho. Section 42-602, Idaho Code, reads, in pertinent part,

It shall be the duty of the department of water resources to have immediate direction and control of the distribution of water from all of the streams to the canals and ditches diverting therefrom. The department must execute the laws relative to the distribution of water in accordance with rights of prior appropriation.

3. The Director of the Department of Water Resources is authorized under the provisions of Section 42-1805(7), Idaho Code, as follows:

After notice, to suspend the issuance or further action on permits or applications as necessary to protect existing vested water rights or to ensure compliance with the provisions of chapter 2, title 42, Idaho Code, or to prevent violation of the minimum flow provisions of the state water plan.

4. Rule 7,1. of the Department of Water Resources Rules and Regulations for Water Appropriation provides that a moratorium on processing of applications for permit shall be entered by issuance of an order of the Director of the Department of Water Resources.

AUG 25 1995

Notice of the order shall be by certified mail to affected applicants and permit holders and by publishing a legal notice in newspapers of general circulation in the area.

5. A moratorium on issuance of permits to divert and use surface and ground water from the Eastern Snake River Plain Area and tributary drainages and the Boise River Drainage Area should be established to protect existing water rights.

6. The department should rescind the moratorium order issued on August 7, 1990 for the Big Lost River drainage and the moratorium order issued on December 1, 1989 for the Mud Lake and Vicinity Area to remove the duplicate effect associated with this Amended Moratorium Order.

7. This amended moratorium order is not intended to affect the provisions of the moratorium order issued by the department on January 6, 1993 in the non-trust water area.

ORDER

IT IS, THEREFORE HEREBY ORDERED that prior order of the department dated May 15, 1992 and amended January 6, 1993 in connection with the Snake River Basin upstream from the USGS gaging station at Weiser, Idaho is superceded by this Amended Moratorium Order.

IT IS, FURTHER HEREBY ORDERED that a moratorium is established on the processing and approval of presently pending and new applications for permits to appropriate water from all surface and ground water sources within the Eastern Snake River Plain Area and all tributaries thereto and within the Boise River Drainage Area. The following provisions apply to the administration of the moratorium:

1. The moratorium shall be in effect on and after its entry and shall remain in effect until withdrawn or modified by order of the Director.

2. The moratorium includes applications filed on all public water sources within the Eastern Snake River Plain Area and all tributaries thereto and within the Boise River Drainage Area.

3. The moratorium applies to all applications proposing a

consumptive use of water filed after the date of the order and to all applications filed prior to the entry of the order for which approval has not been given, except as herein provided.

4. The moratorium does not affect the authorization to continue development of any existing approved application (permit).

5. The moratorium does not apply to any application for domestic purposes as such term is defined in Section 42-111, Idaho Code. For the purposes of this exception, applications for ground water permits seeking water for multiple ownership subdivisions or mobile home parks will be considered provided each unit satisfies the definition for the exception of requirement to file an application for permit as described in said section.

6. The moratorium does not apply to any application proposing a non-consumptive use of water as the term is used in Section 42-605A, Idaho Code.

7. The moratorium does not apply to applications for drilling permits to replace or deepen existing wells having valid existing water rights nor to applications for transfer of existing water rights.

8. This moratorium does not change or affect the administration of any area that has been previously designated as a critical ground water area, pursuant to Section 42-233a, Idaho Code, or a ground water management area pursuant to Section 42-233b, Idaho Code.

9. The moratorium does not prevent the Director from reviewing for approval on a case-by-case basis an application which otherwise would not be approved under terms of this moratorium if,

a) Protection and furtherance of the public interest as determined by the Director, requires consideration and approval of the application irrespective of the general drought related moratorium; or

b) The Director determines that the development and use of the water pursuant to an application will have no effect on prior surface and ground water rights because of its location, insignificant consumption of water or mitigation provided by the applicant to offset injury to other rights.

10. This moratorium does not change or supercede any of the

provisions of the moratorium order issued by the department on January 6, 1993 in the non-trust water area of the Snake River Basin and shall not be interpreted as declaring an end to the drought emergency as referenced in provision 8(b) of the moratorium order for the non-trust water area.

11. This moratorium supercedes and rescinds the Moratorium Order issued on December 1, 1989 for the Mud Lake and Vicinity Area. Pending applications for permit or applications for transfer will be treated under the terms of this amended moratorium order.

12. This moratorium supercedes and rescinds the Final Order of the department issued on August 7, 1990 which established a moratorium on the issuance of new permits within the Big Lost River drainage. Pending applications for permit or applications for transfer will be treated under terms of this amended moratorium order and may be considered for approval by the department in connection with proposed mitigation or compensation for prior water rights.

Dated this 30TH day of April, 1993.


R. KEITH HIGGINSON
Director

APPROVED

AUG 25 1995

MEMORANDUM

CHM HILL

TO: Mr. Ben Strawn, St. Luke's Regional Medical Center

COPIES: Mark A. Bowen, P.E.
File Copy

FROM: Roger A. Noble, P.G.

DATE: January 23, 1995

SUBJECT: Supplemental Information in Support of the Water Right Application for St. Luke's West Medical Center

PROJECT: RMW39910.GW

RECEIVED
MAR 22 1995
WATER RESOURCES
WESTERN REGION

Introduction

St. Luke's Regional Medical Center (SLRMC) is in the process of building a new out-patient care facility that will be located in western Ada County. Primary sewer and water supply services will be provided by the City of Meridian, Idaho. However, to meet accreditation requirements, it is necessary to have a separate backup water supply to serve in the event of an emergency when normal service would be preempted. In order to meet this requirement, SLRMC is submitting a water right permit application to drill a well for the sole purpose of appropriating groundwater when normal service is not available. SLRMC is aware that a moratorium is currently in affect and prohibits new appropriations from both surface and ground water in the Boise River Basin. However, the moratorium also allows for exclusions on a case-by-case basis if the following occurs: a) the application is in furtherance of the public interest; and b) the development and use of the water, pursuant to an application, will have no effect on prior surface and ground water rights because of its location (Idaho Department of Water Resources, 1993). This memorandum addresses the two aforementioned conditions and provides the supplemental information in support of the permit application.

Proposed Beneficial Use

The St. Luke's West Medical Center will be an out-patient care facility to provide local medical services to residents in western Ada and eastern Canyon counties. As previously stated, the well will be used in the event of an emergency if service normally provided by the City of Meridian is preempted. The well will be used to supply water to maintain direct patient care in the event of an emergency. The primary use will be for potable and culinary purposes (i.e., drinking, cooking, scrubbing, surgical, laundry, and refrigeration). The identified uses are intended to provide 24-hour medical services to the public. As such, the proposed use of the water is in the furtherance of public interest.

RECEIVED
AUG 25 1995

MEMORANDUM

Page 2

January 23, 1995

RMW39910.

Preliminary Assessment of Potential Impacts

The proposed well location is in the SW¼, SW¼, NW¼, Section 16, Township 3 North, Range 1 East of Ada County. As stated in the permit application, the proposed well depth is 500 feet. This depth was selected for the following two reasons: 1) to avoid water-quality concerns associated with elevated carbon dioxide at shallower levels; and 2) to prevent well interference concerns.

The Bews well, which is located approximately ¼-mile to the north, produces water from a depth of 420 to 471 feet. The water derived from this zone is known to contain high concentrations of dissolved carbon dioxide (Squires, 1994). As the groundwater is brought to atmospheric conditions, the carbon dioxide degasses from the water. As this occurs, carbon dioxide will accumulate in the distribution system and result in water-hammering, which is detrimental to the valves and piping. It is therefore intended to evaluate water-bearing zones below a depth of 500 feet in an attempt to avoid encountering elevated levels of carbon dioxide.

A review of Well Driller's Reports determined there are a number of shallow wells (<200 feet deep), but only five existing deep wells (200 to 600 feet) occur in the vicinity of the proposed St. Luke's well site (see attached location map). Table 1 provides a summary of well completion information regarding the five deep wells. The nearest well is the Bews well, which is less than 500 feet deep. The only well drilled exceeding a depth of 500 feet is the City of Meridian No. 16 well, which is more than 1-mile to the north.

Table 1 Well Construction Specifications			
	Well Screen Diameter (inches)	Total Depth (feet)	Deepest Perforated Interval (feet)
Meridian #11	6	207	103-199
Meridian #16	10	590	495-535, 552-562, 567-577, 580-590
Boise Water-Hope	10	444	345-444
Bews (Meridian)	10	485	420-471
South County-Edgewater	10	495	417-477

RECEIVED
AUG 25 1995

MEMORANDUM

Page 3

January 23, 1995

RMW39910.

A 6-hour constant-rate aquifer test (pumping rate 2,150 gpm) was recently conducted on the South County Water well on September 21, 1994, during which time water levels in the Bews well were monitored to discern potential affects of drawdown. The test results determined that no measurable interference could be attributed to the Bews well from pumping the South County Water well. In fact, the water level in the Bews well continued to slowly rise throughout the test (Squires, 1994). The discharge rate requested for the out-patient care facility is 450 gpm. This rate is approximately one-fifth the discharge rate used during the aquifer test. Recognizing that the proposed application is for a deeper zone, it is doubtful that a perceptible effect would be observed. It was therefore concluded that interference effects would be minimal, even under full-on pumping conditions.

Summary

As previously demonstrated, issuance of a water-right permit for the proposed well is commensurate with exclusions of the Boise River Basin Moratorium in that the proposed beneficial use is in furtherance of public interest and the appropriation will not have an effect on prior surface and ground water rights because of its location. It is therefore requested that the Director of the Idaho Department of Water Resources approve this application.

References Cited

Idaho Department of Water Resources, 1993, Amended Moratorium—Eastern Snake River Plain and Boise River Drainage.

Squires, E., 1994, Consultant's Report to the City of Meridian: Viability of the Bews Well as a Municipal Supply Well.

BOI1001382A.DOC/jc

RECEIVED
AUG 25 1995

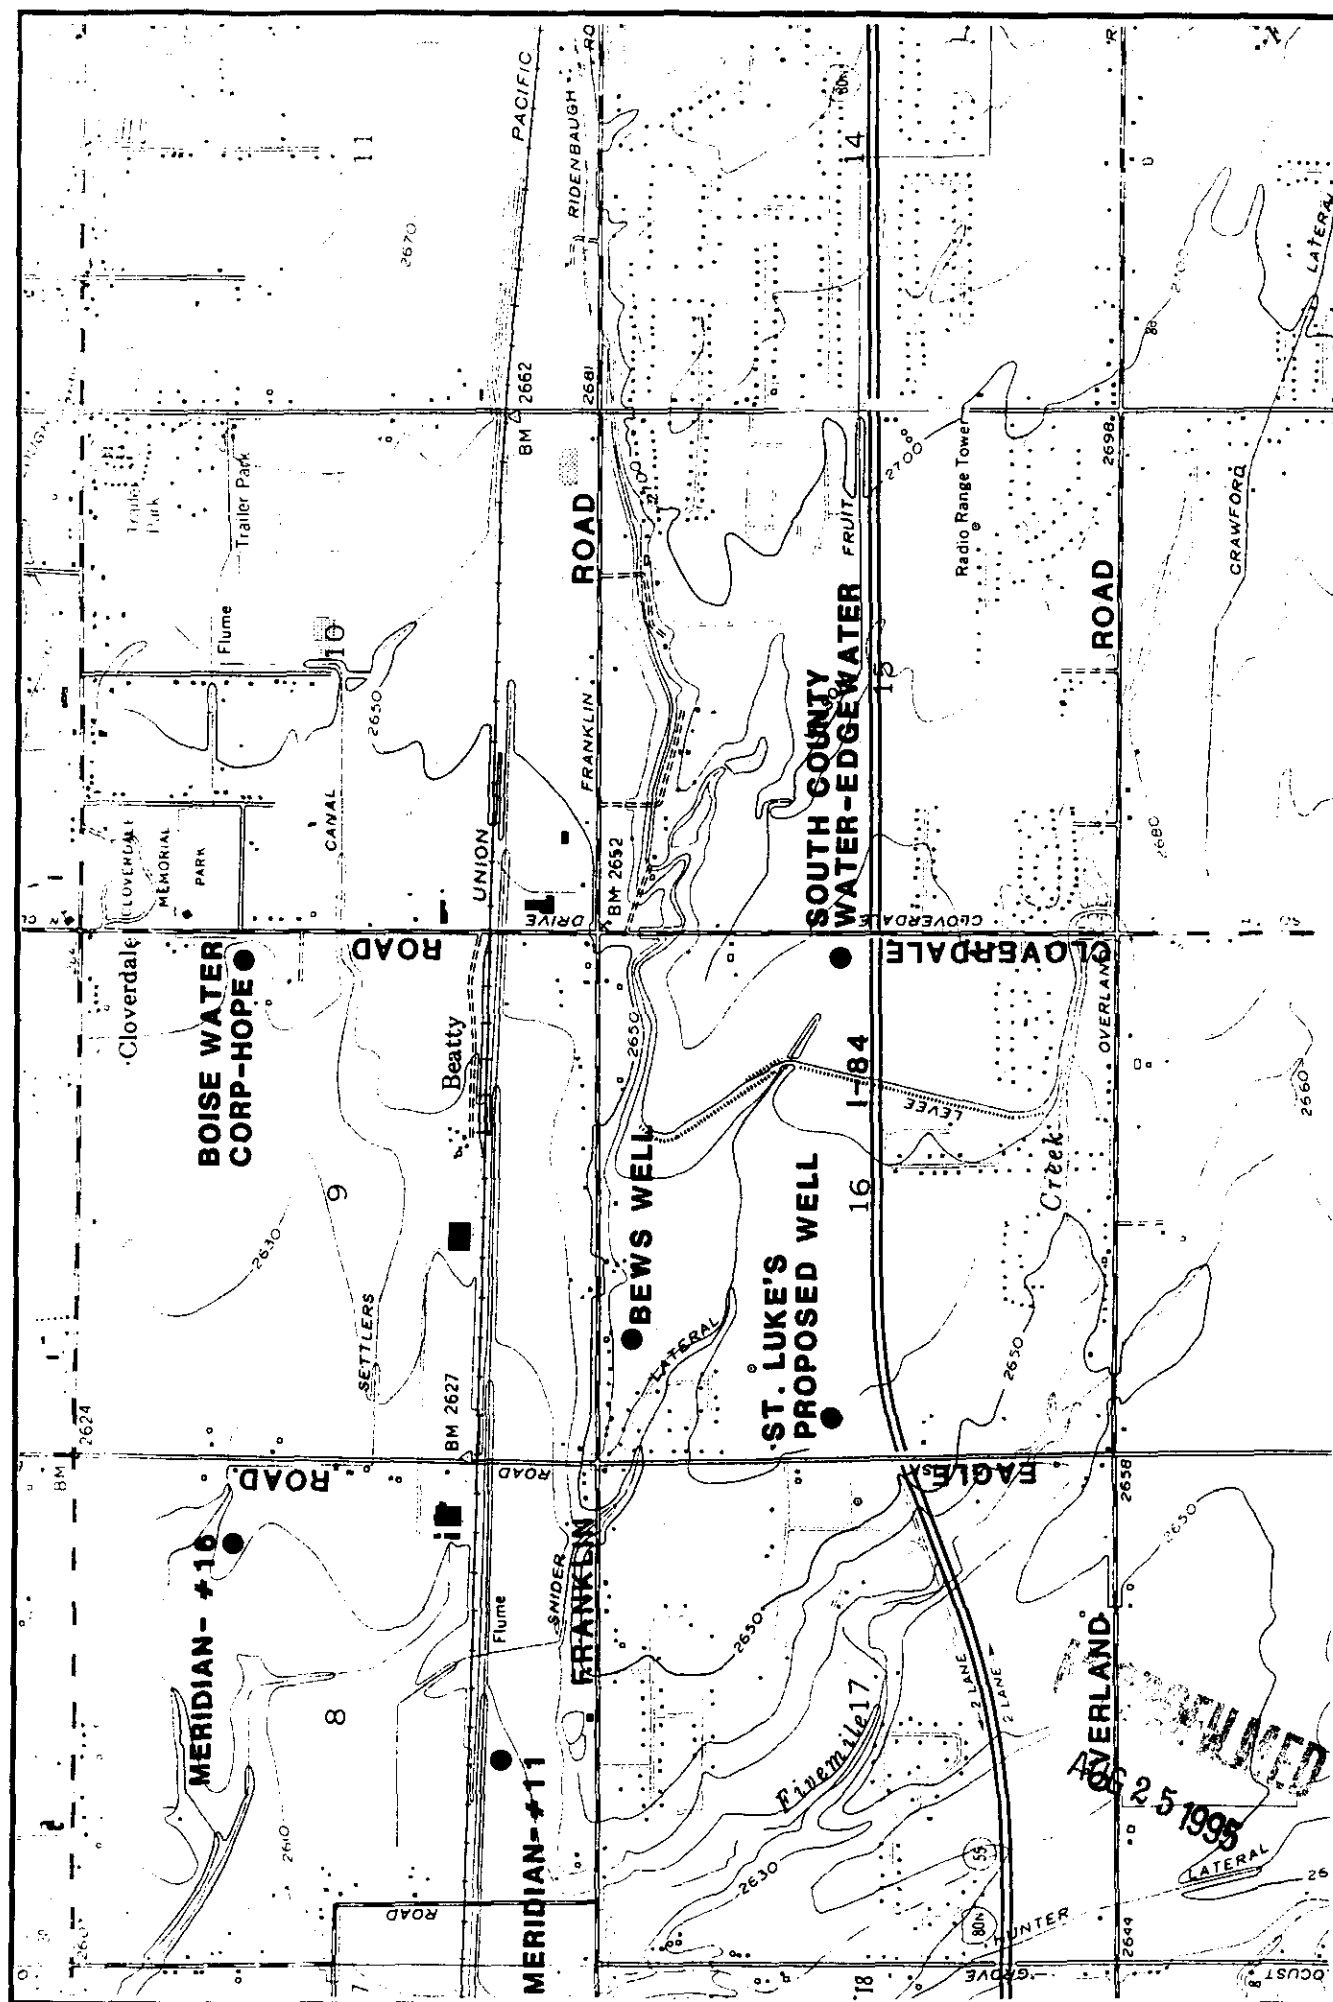


Figure 1
PROPOSED SLRMC WELL LOCATION
AND OTHER DEEP WELLS IN THE VICINITY

Drilling Permit No. _____

Water Right Permit No. _____

Injection Permit No. _____

WELL DRILLER: PLEASE COMPLETE FOR VERBALS

IDWR Employee Issuing Verbal: _____

Verbal Issued Date: _____ Time: _____

State of Idaho
Department of Water Resources**APPLICATION FOR DRILLING PERMIT
(FOR THE CONSTRUCTION OF A WELL)**1. Applicant (please print): St. Luke's Regional Medical Center Ben Strawn2. Mailing Address: 190 East BannockCity & State Boise, ID Zip Code 83712 Telephone (208) 386-2255☒ Well Owner ☐ Well Operator ☐ Contractor or Other, specify _____3. Proposed Well Location: Twp. 3 North, Rge. 1 East, Sec. 16, SW 1/4 NW 1/4Gov't Lot No. _____ County AdaStreet Address of Well Site Intersection of Eagle Road and I-84 City Meridian

Give at least name of road + Distance to Road or Landmark

Lot, block and subdivision Parcel 1

4. Proposed Use of Well:

☒ DOMESTIC: The use of water for homes, organization camps, public campgrounds, livestock (1,000 head or less) and for any other purpose in connection therewith, including irrigation of up to 1/2 acre of land, if the total use is not in excess of 13,000 gpd; or any other uses, if the total use does not exceed a diversion rate of 0.04 cfs and a diversion volume of 2500 gpd.

Domestic does not include water for multiple ownership subdivisions, mobile home parks, commercial or business establishments, unless the use does not exceed a diversion rate of 0.04 cfs and a diversion volume of 2500 gpd.

NON-DOMESTIC: ☐ Irrigation ☐ Municipal ☐ Industrial
☐ Stock ☐ Test ☒ Other Commercial--out patient care facility
(Over 1,000 Head) (Describe)☐ INJECTION☐ MONITORING: A well bore schematic and map is required for each blanket permit.

No. of proposed wells: _____

5. Well Construction Information:

A. ☒ New well ☐ Modify ☐ ReplaceB. Proposed Casing Diameter 6 - inch Proposed Maximum Depth 600 feet

C. Anticipated bottom hole temperature:

☒ 85°F or less ☐ 85°F to 212°F ☐ 212°F or more
(Cold Water Well) (Low Temp. Geo. Well) (Geothermal Well)6. Construction Start Date: February 16, 19957. Anticipated Well Driller: Riverside, Parma, ID

NOTE: The actual well driller must be identified prior to drilling.

8. Applicant's Signature Ben F. Strawn Date 2/3/95Title Director of Bldg. Services
(Owner, Firm Representative, Other)COPY
Original in
Rob's fileAUG 25 1995
RECEIVED
Driller's License

63-12199

ST LUKES REGIONAL MEDICAL CENTER
C/O BEN STRAWN
190 E BANNOCK
BOISE, ID 83712

Source: GROUNDWATER

Diversion Pt: SWSWNW Sec 16 T 03N R 01E in ADA County.

Use: DOMESTIC	(	1.000 CFS)
Total Diversion:	(	1.000 CFS)

Date Filed: 3/22/1995

In: ADA County
T03N R01E S16 SWNW

Applicant seeks public interest exemption to drought moratorium for a backup well for medical center. Primary supply will be from Meridian municipal water system.

MIDDOEN MED

AUG 25 1995