

THIS PLAT IS NOT TO SCALE



SCALE 1"=100'


NOTES

1. EASEMENT FOR UTILITIES, IMPOSITION AND GRANT
 2. EASEMENT FOR PASTURE, TRAPING
 3. FOR BOUNDARY PROTECTION BY WELL AND SEPTIC TANK OR OTHER FIELD ALLOWED WITHIN CONCRETE
 4. POSITIVE COMPANIES FIELD WITH THIS PLAT
- WITNESSES: _____
NOTARIAL NO. 154022
EXPIRATION DATE: 7/24/01

SUNNY RIDGE SUBDIVISION No. 3
CANTON COUNTY IDAHO

STATE OF IDAHO S.S.
COUNTY OF CANTON


I, Ronald M. Bishley, a Registered Professional Engineer in and for said County and State, do hereby certify that the survey of SUNNY RIDGE SUBDIVISION No. 3 in Canton County, Idaho, as described on the basis of this plat was made by me or under my direction and that this plat correctly shows the survey number, in WITNESS WHEREOF, I have hereunto set my hand and Seal this 15th day of May, A.D. 1975.



STATE OF IDAHO S.S.
COUNTY OF CANTON

On this 15th day of May, A.D. 1975 before me, _____, a Notary Public in and for said County and State, personally appeared Ronald M. Bishley, known to me to be the person whose name is subscribed to the foregoing instrument and acknowledged to me that he executed the same. IN WITNESS WHEREOF, I have hereunto set my hand and Seal this 15th day of May, A.D. 1975.

Notary Public: *Blair L. Bishley*
Residing at: *Calhoun, Idaho*
My Commission expires: *10-15-77*




I hereby certify that this instrument was filed for record at the request of Ronald M. Bishley at _____ minutes past _____ o'clock A.D. 1975.

Filed: _____
Notarial No. 154022
Expiry: _____
Deposited: _____

STATE OF TEXAS											
COUNTY OF DALLAS											
CURVE NO.	ANGLE	T	L	LC	LC BARE	CURVE NO.	ANGLE	T	L	LC	LC BARE
C-1	89°28'48"	146.00	148.30	147.39	147.39	C-18	160°00'	140.00	140.00	140.00	140.00
C-2	90°00'	100.00	100.00	100.00	100.00	C-19	110°00'	110.00	110.00	110.00	110.00
C-3	90°00'	100.00	100.00	100.00	100.00	C-20	110°00'	110.00	110.00	110.00	110.00
C-4	90°00'	100.00	100.00	100.00	100.00	C-21	110°00'	110.00	110.00	110.00	110.00
C-5	90°00'	100.00	100.00	100.00	100.00	C-22	110°00'	110.00	110.00	110.00	110.00
C-6	90°00'	100.00	100.00	100.00	100.00	C-23	110°00'	110.00	110.00	110.00	110.00
C-7	90°00'	100.00	100.00	100.00	100.00	C-24	110°00'	110.00	110.00	110.00	110.00
C-8	90°00'	100.00	100.00	100.00	100.00	C-25	110°00'	110.00	110.00	110.00	110.00
C-9	90°00'	100.00	100.00	100.00	100.00	C-26	110°00'	110.00	110.00	110.00	110.00
C-10	90°00'	100.00	100.00	100.00	100.00	C-27	110°00'	110.00	110.00	110.00	110.00
C-11	90°00'	100.00	100.00	100.00	100.00	C-28	110°00'	110.00	110.00	110.00	110.00
C-12	90°00'	100.00	100.00	100.00	100.00	C-29	110°00'	110.00	110.00	110.00	110.00
C-13	90°00'	100.00	100.00	100.00	100.00	C-30	110°00'	110.00	110.00	110.00	110.00
C-14	90°00'	100.00	100.00	100.00	100.00	C-31	110°00'	110.00	110.00	110.00	110.00
C-15	90°00'	100.00	100.00	100.00	100.00	C-32	110°00'	110.00	110.00	110.00	110.00
C-16	90°00'	100.00	100.00	100.00	100.00	C-33	110°00'	110.00	110.00	110.00	110.00
C-17	90°00'	100.00	100.00	100.00	100.00	C-34	110°00'	110.00	110.00	110.00	110.00
C-18	90°00'	100.00	100.00	100.00	100.00	C-35	110°00'	110.00	110.00	110.00	110.00
C-19	90°00'	100.00	100.00	100.00	100.00	C-36	110°00'	110.00	110.00	110.00	110.00
C-20	90°00'	100.00	100.00	100.00	100.00	C-37	110°00'	110.00	110.00	110.00	110.00
C-21	90°00'	100.00	100.00	100.00	100.00	C-38	110°00'	110.00	110.00	110.00	110.00
C-22	90°00'	100.00	100.00	100.00	100.00	C-39	110°00'	110.00	110.00	110.00	110.00
C-23	90°00'	100.00	100.00	100.00	100.00	C-40	110°00'	110.00	110.00	110.00	110.00
C-24	90°00'	100.00	100.00	100.00	100.00	C-41	110°00'	110.00	110.00	110.00	110.00
C-25	90°00'	100.00	100.00	100.00	100.00	C-42	110°00'	110.00	110.00	110.00	110.00
C-26	90°00'	100.00	100.00	100.00	100.00	C-43	110°00'	110.00	110.00	110.00	110.00
C-27	90°00'	100.00	100.00	100.00	100.00	C-44	110°00'	110.00	110.00	110.00	110.00
C-28	90°00'	100.00	100.00	100.00	100.00	C-45	110°00'	110.00	110.00	110.00	110.00
C-29	90°00'	100.00	100.00	100.00	100.00	C-46	110°00'	110.00	110.00	110.00	110.00
C-30	90°00'	100.00	100.00	100.00	100.00	C-47	110°00'	110.00	110.00	110.00	110.00
C-31	90°00'	100.00	100.00	100.00	100.00	C-48	110°00'	110.00	110.00	110.00	110.00
C-32	90°00'	100.00	100.00	100.00	100.00	C-49	110°00'	110.00	110.00	110.00	110.00
C-33	90°00'	100.00	100.00	100.00	100.00	C-50	110°00'	110.00	110.00	110.00	110.00
C-34	90°00'	100.00	100.00	100.00	100.00	C-51	110°00'	110.00	110.00	110.00	110.00
C-35	90°00'	100.00	100.00	100.00	100.00	C-52	110°00'	110.00	110.00	110.00	110.00
C-36	90°00'	100.00	100.00	100.00	100.00	C-53	110°00'	110.00	110.00	110.00	110.00
C-37	90°00'	100.00	100.00	100.00	100.00	C-54	110°00'	110.00	110.00	110.00	110.00
C-38	90°00'	100.00	100.00	100.00	100.00	C-55	110°00'	110.00	110.00	110.00	110.00
C-39	90°00'	100.00	100.00	100.00	100.00	C-56	110°00'	110.00	110.00	110.00	110.00
C-40	90°00'	100.00	100.00	100.00	100.00	C-57	110°00'	110.00	110.00	110.00	110.00
C-41	90°00'	100.00	100.00	100.00	100.00	C-58	110°00'	110.00	110.00	110.00	110.00
C-42	90°00'	100.00	100.00	100.00	100.00	C-59	110°00'	110.00	110.00	110.00	110.00
C-43	90°00'	100.00	100.00	100.00	100.00	C-60	110°00'	110.00	110.00	110.00	110.00
C-44	90°00'	100.00	100.00	100.00	100.00	C-61	110°00'	110.00	110.00	110.00	110.00
C-45	90°00'	100.00	100.00	100.00	100.00	C-62	110°00'	110.00	110.00	110.00	110.00
C-46	90°00'	100.00	100.00	100.00	100.00	C-63	110°00'	110.00	110.00	110.00	110.00
C-47	90°00'	100.00	100.00	100.00	100.00	C-64	110°00'	110.00	110.00	110.00	110.00
C-48	90°00'	100.00	100.00	100.00	100.00	C-65	110°00'	110.00	110.00	110.00	110.00
C-49	90°00'	100.00	100.00	100.00	100.00	C-66	110°00'	110.00	110.00	110.00	110.00
C-50	90°00'	100.00	100.00	100.00	100.00	C-67	110°00'	110.00	110.00	110.00	110.00
C-51	90°00'	100.00	100.00	100.00	100.00	C-68	110°00'	110.00	110.00	110.00	110.00
C-52	90°00'	100.00	100.00	100.00	100.00	C-69	110°00'	110.00	110.00	110.00	110.00
C-53	90°00'	100.00	100.00	100.00	100.00	C-70	110°00'	110.00	110.00	110.00	110.00
C-54	90°00'	100.00	100.00	100.00	100.00	C-71	110°00'	110.00	110.00	110.00	110.00
C-55	90°00'	100.00	100.00	100.00	100.00	C-72	110°00'	110.00	110.00	110.00	110.00
C-56	90°00'	100.00	100.00	100.00	100.00	C-73	110°00'	110.00	110.00	110.00	110.00
C-57	90°00'	100.00	100.00	100.00	100.00	C-74	110°00'	110.00	110.00	110.00	110.00
C-58	90°00'	100.00	100.00	100.00	100.00	C-75	110°00'	110.00	110.00	110.00	110.00
C-59	90°00'	100.00	100.00	100.00	100.00	C-76	110°00'	110.00	110.00	110.00	110.00
C-60	90°00'	100.00	100.00	100.00	100.00	C-77	110°00'	110.00	110.00	110.00	110.00
C-61	90°00'	100.00	100.00	100.00	100.00	C-78	110°00'	110.00	110.00	110.00	110.00
C-62	90°00'	100.00	100.00	100.00	100.00	C-79	110°00'	110.00	110.00	110.00	110.00
C-63	90°00'	100.00	100.00	100.00	100.00	C-80	110°00'	110.00	110.00	110.00	110.00
C-64	90°00'	100.00	100.00	100.00	100.00	C-81	110°00'	110.00	110.00	110.00	110.00
C-65	90°00'	100.00	100.00	100.00	100.00	C-82	110°00'	110.00	110.00	110.00	110.00
C-66	90°00'	100.00	100.00	100.00	100.00	C-83	110°00'	110.00	110.00	110.00	110.00
C-67	90°00'	100.00	100.00	100.00	100.00	C-84	110°00'	110.00	110.00	110.00	110.00
C-68	90°00'	100.00	100.00	100.00	100.00	C-85	110°00'	110.00	110.00	110.00	110.00
C-69	90°00'	100.00	100.00	100.00	100.00	C-86	110°00'	110.00	110.00	110.00	110.00
C-70	90°00'	100.00	100.00	100.00	100.00	C-87	110°00'	110.00	110.00	110.00	110.00
C-71	90°00'	100.00	100.00	100.00	100.00	C-88	110°00'	110.00	110.00	110.00	110.00
C-72	90°00'	100.00	100.00	100.00	100.00	C-89	110°00'	110.00	110.00	110.00	110.00
C-73	90°00'	100.00	100.00	100.00	100.00	C-90	110°00'	110.00	110.00	110.00	110.00
C-74	90°00'	100.00	100.00	100.00	100.00	C-91	110°00'	110.00	110.00	110.00	110.00
C-75	90°00'	100.00	100.00	100.00	100.00	C-92	110°00'	110.00	110.00	110.00	110.00
C-76	90°00'	100.00	100.00	100.00	100.00	C-93	110°00'	110.00	110.00	110.00	110.00
C-77	90°00'	100.00	100.00	100.00	100.00	C-94	110°00'	110.00	110.00	110.00	110.00
C-78	90°00'	100.00	100.00	100.00	100.00	C-95	110°00'	110.00	110.00	110.00	110.00
C-79	90°00'	100.00	100.00	100.00	100.00	C-96	110°00'	110.00	110.00	110.00	110.00
C-80	90°00'	100.00	100.00	100.00	100.00	C-97	110°00'	110.00	110.00	110.00	110.00
C-81	90°00'	100.00	100.00	100.00	100.00	C-98	110°00'	110.00	110.00	110.00	110.00
C-82	90°00'	100.00	100.00	100.00	100.00	C-99	110°00'	110.00	110.00	110.00	110.00
C-83	90°00'	100.00	100.00	100.00	100.00	C-100	110°00'	110.00	110.00	110.00	110.00
C-84	90°00'	100.00	100.00	100.00	100.00	C-101	110°00'	110.00	110.00	110.00	110.00
C-85	90°00'	100.00	100.00	100.00	100.00	C-102	110°00'	110.00	110.00	110.00	110.00
C-86	90°00'	100.00	100.00	100.00	100.00	C-103	110°00'	110.00	110.00	110.00	110.00
C-87	90°00'	100.00	100.00	100.00	100.00	C-104	110°00'	110.00	110.00	110.00	110.00
C-88	90°00'	100.00	100.00	100.00	100.00	C-105	110°00'	110.00	110.00	110.00	110.00
C-89	90°00'	100.00	100.00	100.00	100.00	C-106	110°00'	110.00	110.00	110.00	110.00
C-90	90°00'	100.00	100.00	100.00	100.00	C-107	110°00'	110.00	110.00	110.00	110.00
C-91	90°00'	100.00	100.00	100.00	100.00	C-108	110°00'	110.00	110.00	110.00	110.00
C-92	90°00'	100.00	100.00	100.00	100.00	C-109	110°00'	110.00	110.00	110.00	110.00
C-93	90°00'	100.00	100.00	100.00	100.00	C-110	110°00'	110.00	110.00	110.00	110.00
C-94	90°00'	100.00	100.00	100.00	100.00	C-111	110°00'	110.00	110.00	110.00	110.00
C-95	90°00'	100.00	100.00	100.00	100.00	C-112	110°00'	110.00	110.00	110.00	110.00
C											

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

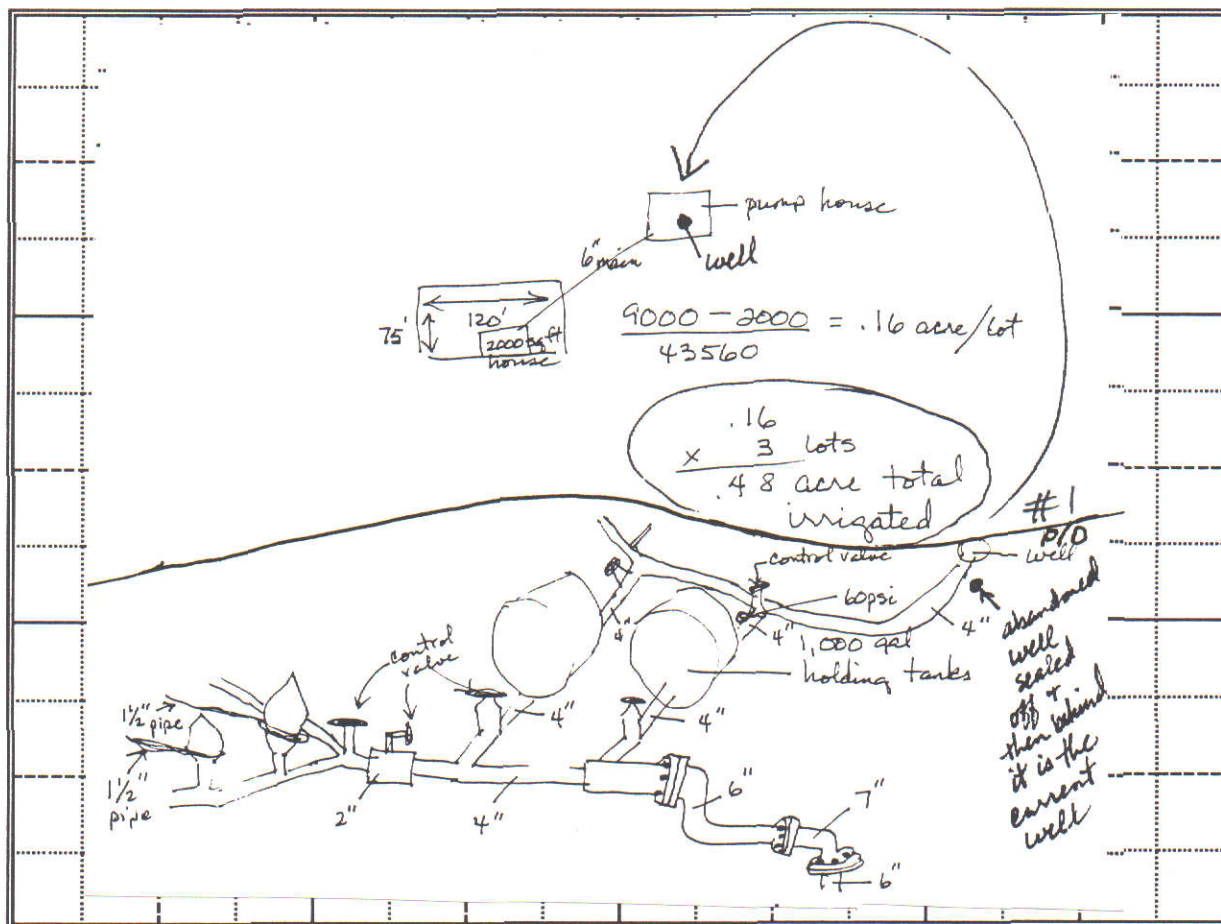

Scale: 1" = _____

☒ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

☒ Aerial Photo Attached (required for irrigation of 10+ acres)

☒ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
#1 Submers.		20			4"
#2 Submers.		15			4"

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.


Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: Average lot 9000 sq. ft - average 2000 sq. ft house = 43560

= .16 acre/lot 3 x .16 = .48 acre
+ .048 error =
.52 acre total irrigation


FEB 26 1955

63-12068
TOAN ROAD

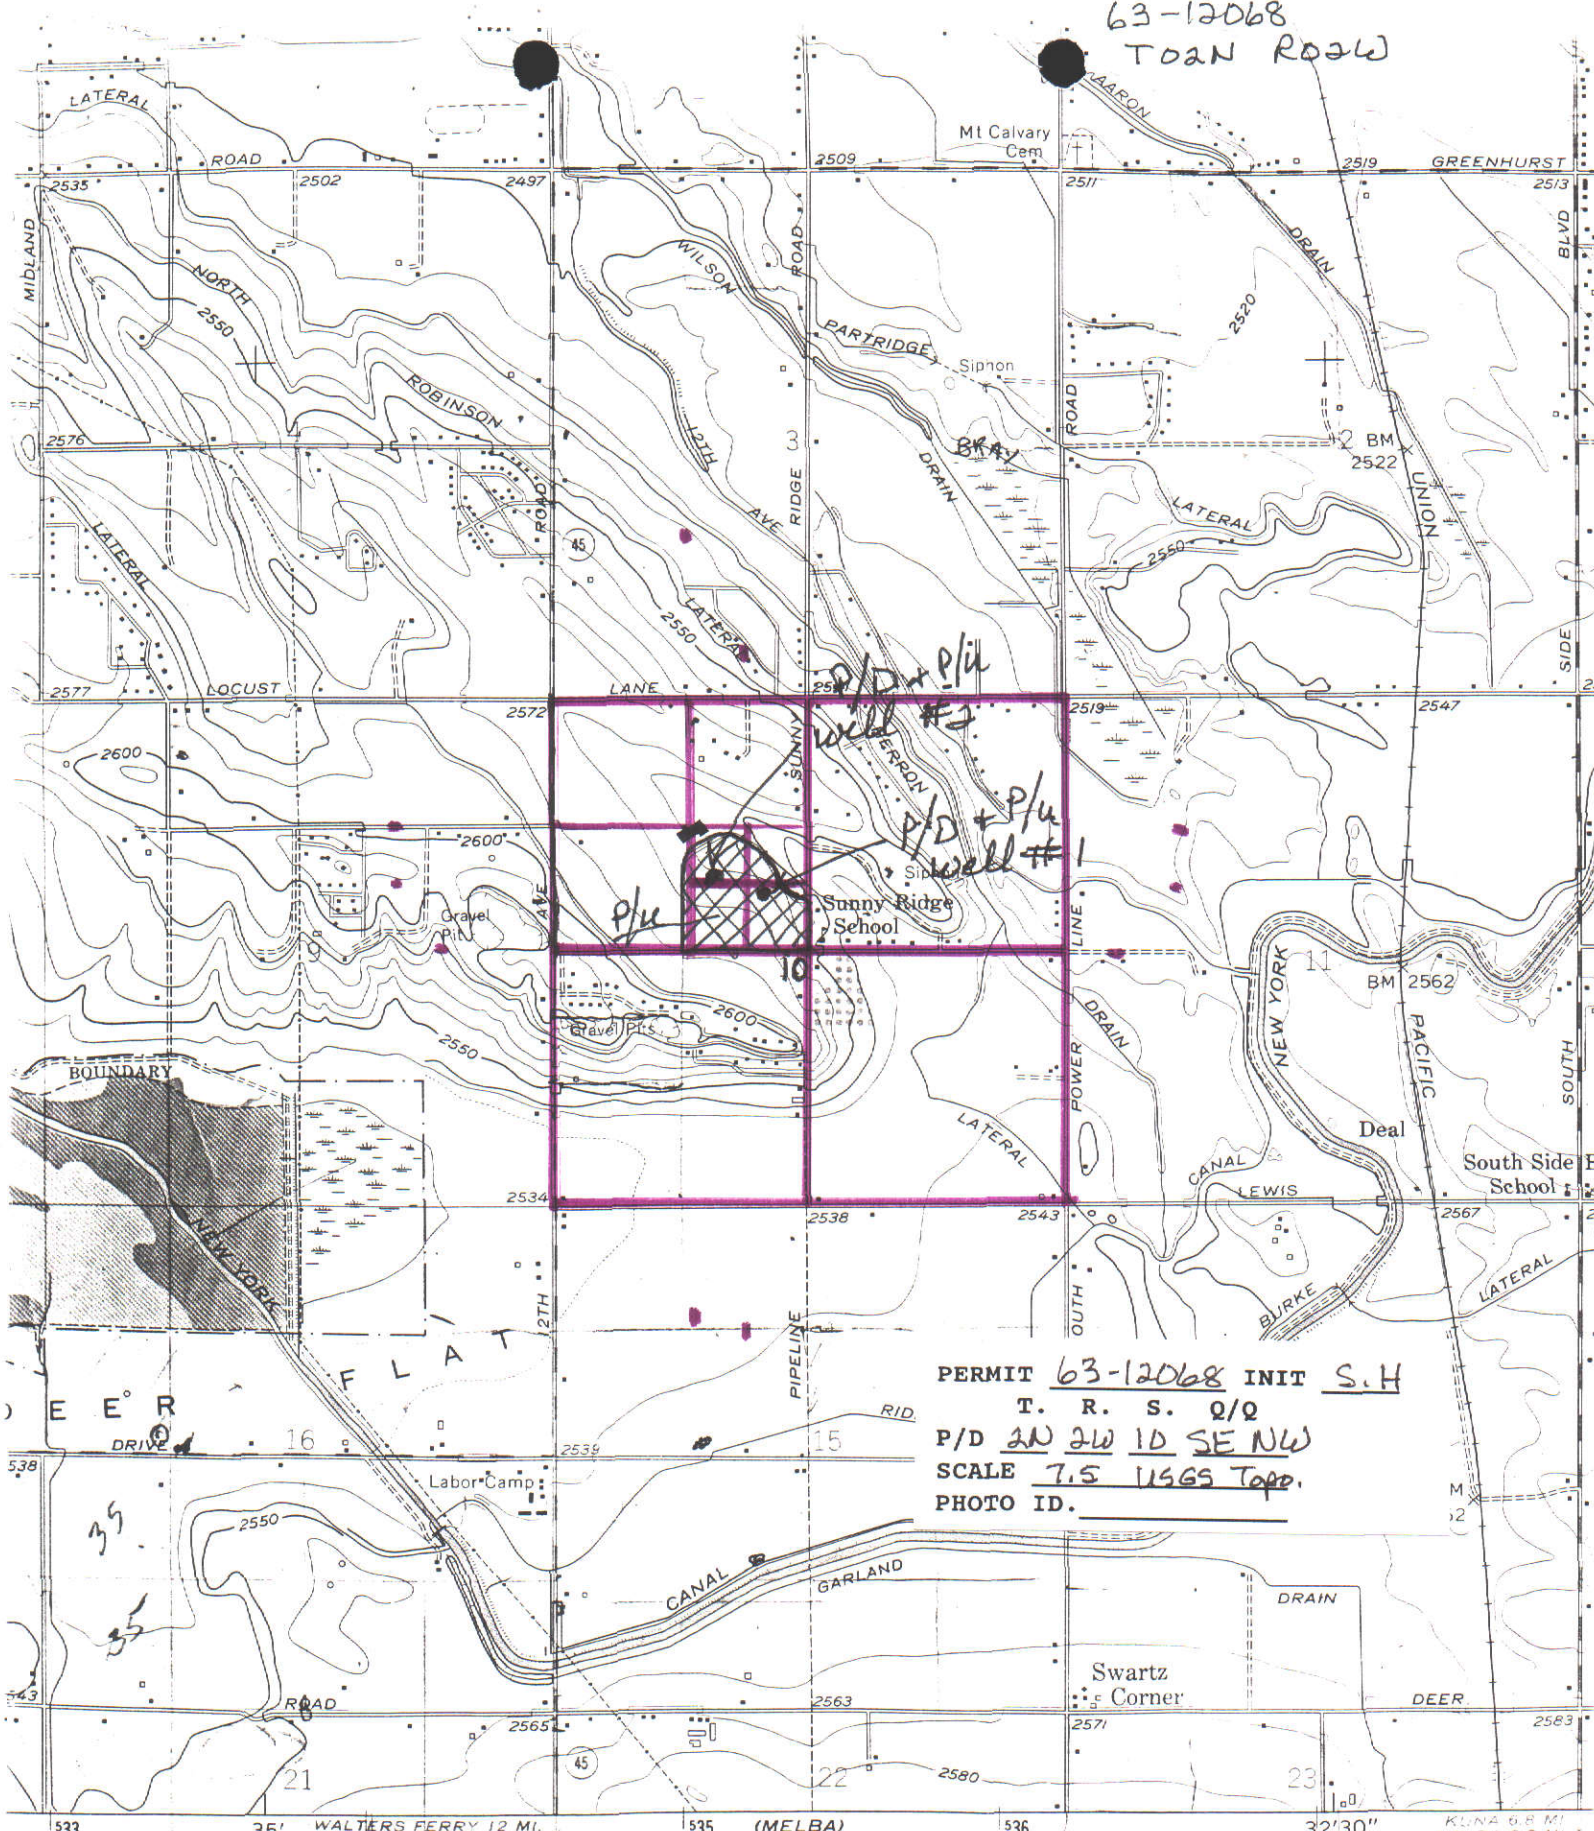

PERMIT 63-12068 INIT S.H
T. R. S. Q/Q
P/D 2N 2W 1D SE NW
SCALE 7.5 USGS Topo.
PHOTO ID.

0°18' 5 MILS
18° 329 MILS

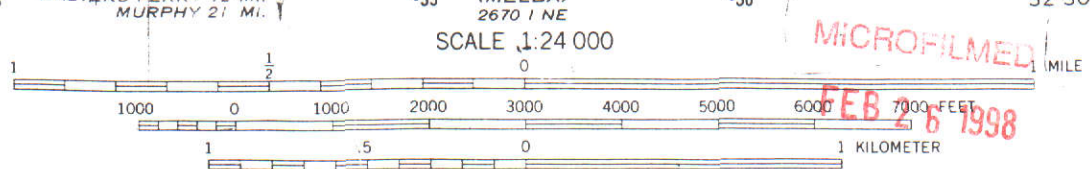

CONTOUR INTERVAL 10 FEET
DOTTED LINES REPRESENT 5-FOOT CONTOURS
DATUM IS MEAN SEA LEVEL

MICROFILMED
FEB 26 1998



63-12068
8/3/94 S.H.


(2) 1,000 gal.
holding tanks

well house (well #1)
located in Sunny
Ridge Subdivision
No. 3


MONOFILMED

FEB 26 1938

4" steel
pipe

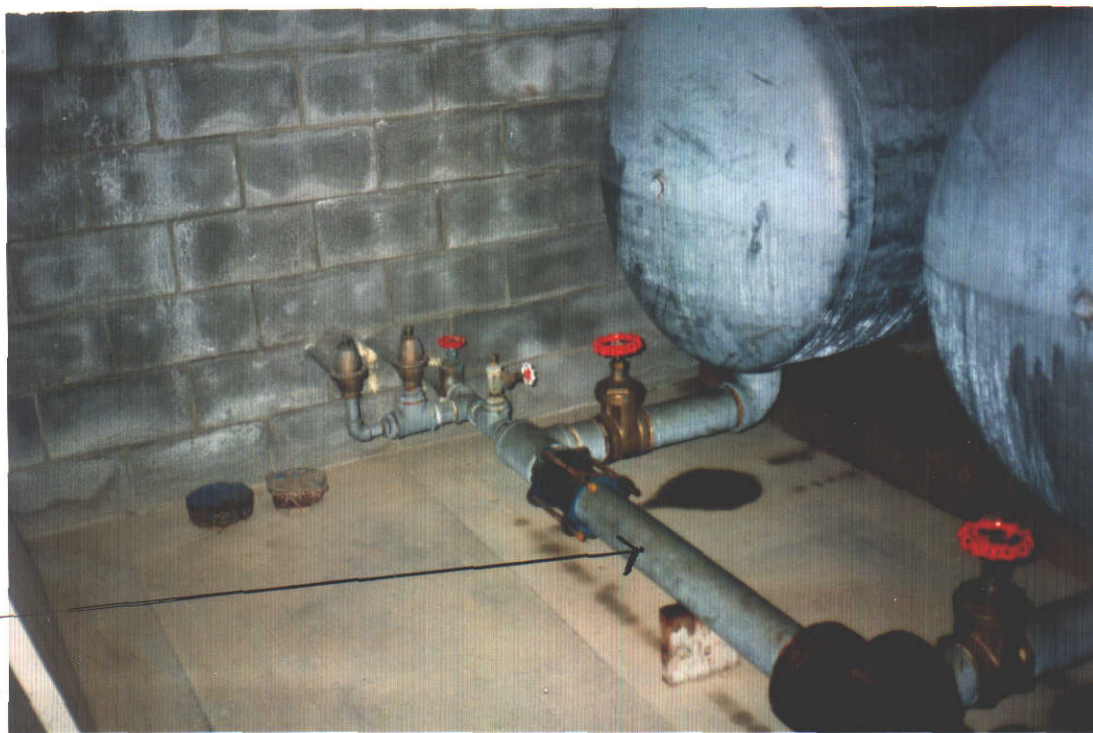

6" pipe
going to 6" main

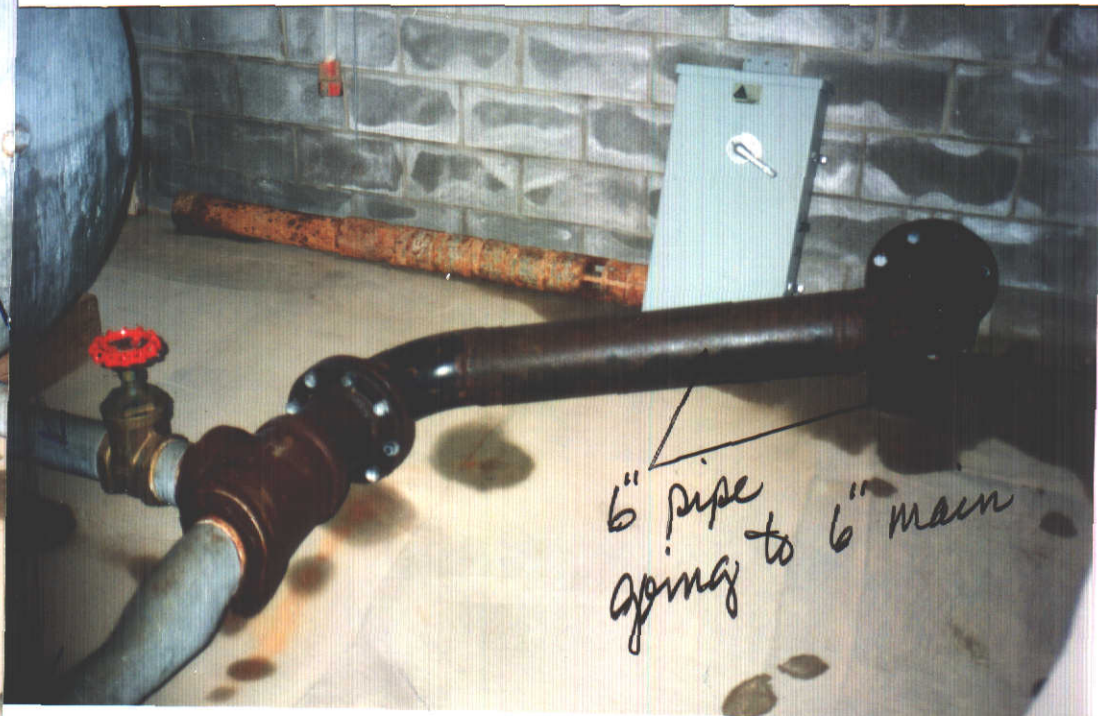

8. POSSIBLE CONTAMINATION SOURCES:

Is there evidence of Chemigation? ☐ Yes ☒ No

If yes, is there a check-valve present? ☐ Yes ☐ No

Is there a possible source of contamination nearby? ☐ Yes ☒ No

If yes, what Type? _____

How far away from the well is this source? _____


9. REMARKS:

James Hemenway WR Agent
Signature of Dept. Representative & Title

8/3/94
Inspection Date

PHOTOS, DRAWINGS, OTHER ATTACHMENTS:

on another sheet

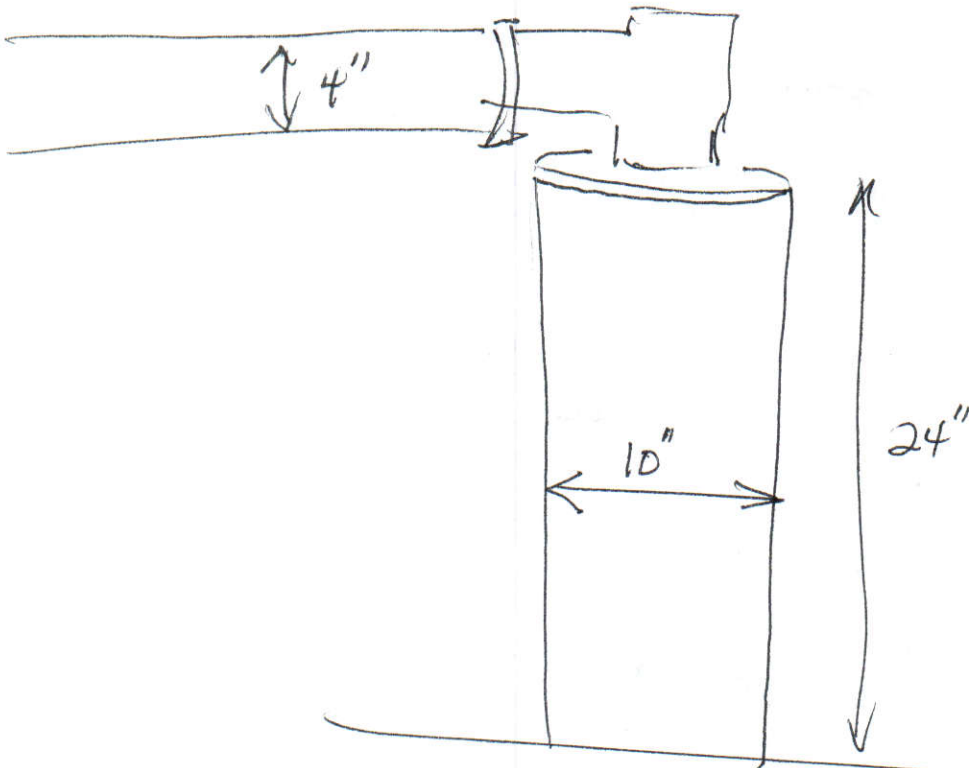

MICROFILMED
FEB 26 1998

THIS PLAT IS NOT TO SCALE



SCALE 1"=100'

NOTES

1. EASEMENT FOR UTILITY, IRRIGATION AND DRAINAGE
2. EASEMENT FOR PEDESTRIAN TRAFFIC
3. FOR SANITARY PROTECTION OF WELL NO SEPTIC TANK OR DRAIN FIELD ALLOWED WITHIN CIRCLES
4. PROTECTIVE COVENANTS FILED WITH THIS PLAT INSTRUMENT NO. 754935

SUNNY RIDGE SUBDIVISION No.3
CANYON COUNTY IDAHO

STATE OF IDAHO S.S.
COUNTY OF CANYON

I, Ronald M. Blakley, a Registered Professional Engineer in and for said County and State, do hereby certify that the survey of SUNNY RIDGE SUBDIVISION No. 3 in Canyon County, Idaho, as described on the back of this plat was made by me or under my direction and that this plat correctly shows the survey as made. IN WITNESS WHEREOF, I have hereunto set my hand and Seal this 15th day of May A.D. 1975



STATE OF IDAHO S.S.
COUNTY OF CANYON

On this 15th day of May A.D. 1975 before me, Richard T. Foster, a Notary Public in and for said County and State, personally appeared Ronald M. Blakley, known to me to be the person whose name is subscribed to the foregoing instrument and acknowledged to me that he executed the same. IN WITNESS WHEREOF, I have hereunto set my hand and Seal this 15th day of May A.D. 1975

Notary Public Richard T. Foster
Residing at Caldwell, Idaho
My Commission expires 10-15-77



I hereby certify that this instrument was filed for record at the request of Ronald M. Blakley at _____ minutes past _____ o'clock A.M. this _____ day of _____ A.D. 1975
Instrument No. 754935

Recorder _____
Deputy _____


P/D 63-08296
Existing well

2 wells tied in here

P/D #1 well
Replacement Well Drilled here


11" main

3 collations
P/U

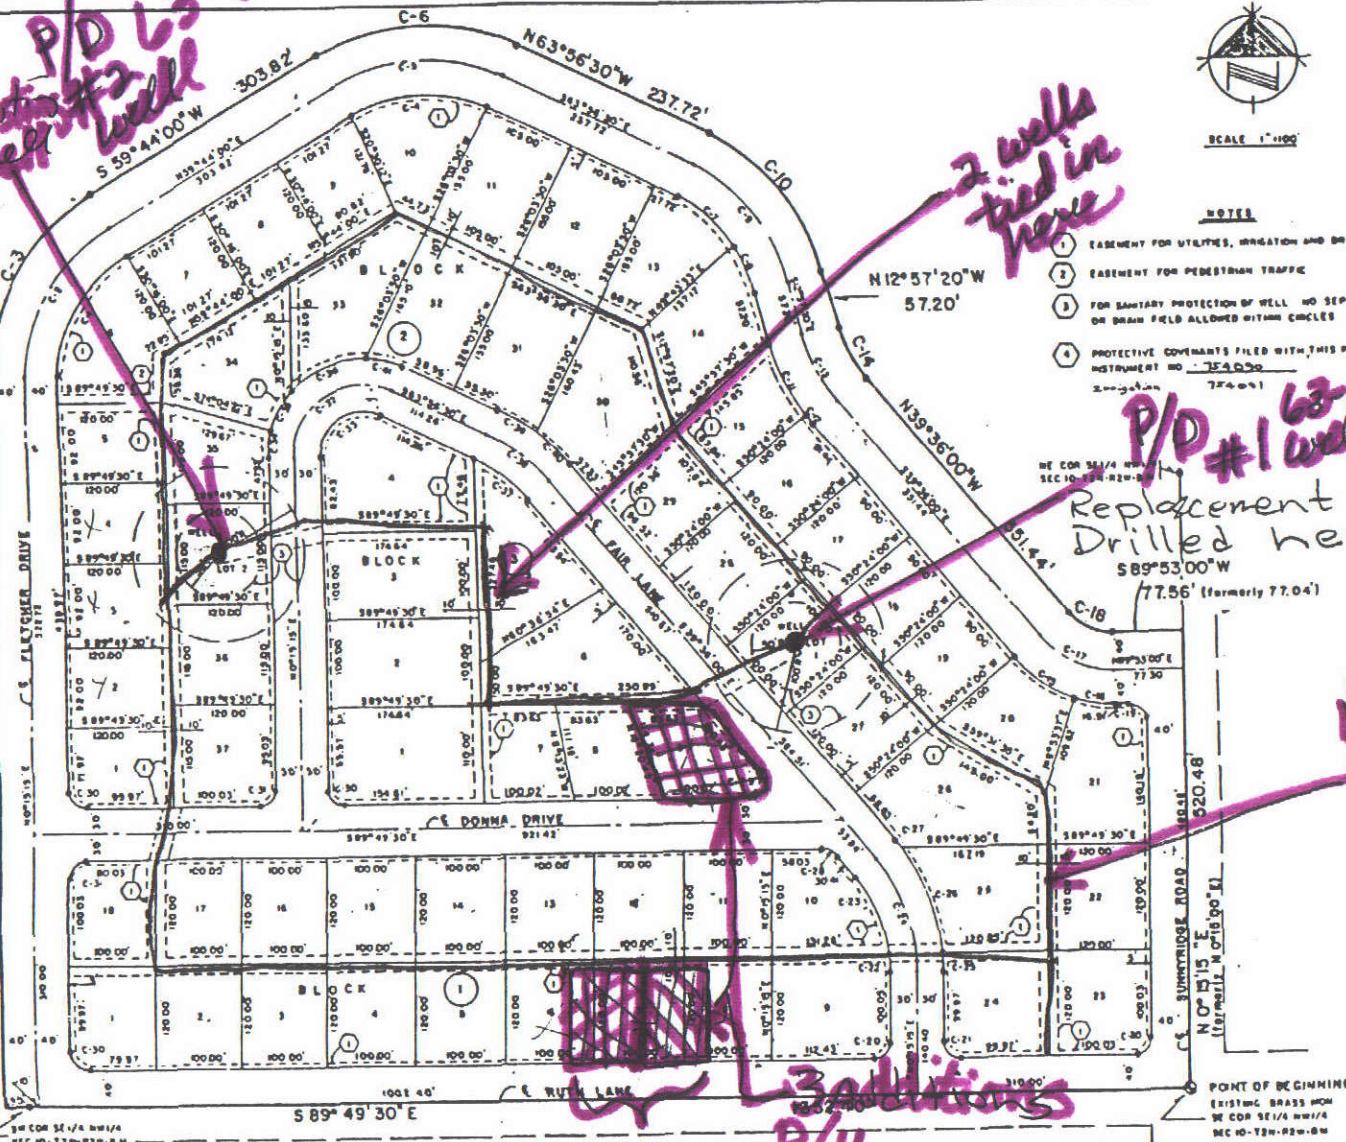


CURVE NO.	W	ANGLE	T	L	LC	LC BRG	CURVE NO.	R	ANGLE	T	L	LC	LC BRG	CURVE NO.	W	ANGLE	T	L	LC	LC BRG
C-1	100.00	89°28'40"	34.41	144.10	188.34	N12°53'30"E	C-18	180.00	30°30'33"	42.31	82.46	84.48	S20°21'12"E	C-29	200.00	129°48'50"	42.87	44.30	38.22	S20°17'19"W
C-2	100.00	89°28'40"	114.24	207.62	196.42	N12°53'30"E	C-19	180.00	89°00'37"	28.12	49.71	46.84	S00°36'42"E	C-30	200.00	90°04'45"	30.03	31.44	28.30	S44°47'06"E
C-3	240.00	89°28'40"	137.11	249.15	236.11	S12°53'30"E	C-20	180.00	80°31'00"	81.00	94.99	93.87	S84°01'30"E	C-31	200.00	89°08'18"	19.97	31.38	24.26	N48°12'52"E
C-4	100.00	89°28'40"	88.66	137.29	131.03	N12°53'30"E	C-21	70.00	90°31'00"	33.03	41.72	39.74	N44°47'15"W	C-32	80.00	118°49'18"	12.94	16.10	13.54	N58°07'23"E
C-5	200.00	89°28'40"	107.07	198.61	184.79	N12°53'30"E	C-22	70.00	90°22'00"	20.13	31.34	28.37	S48°12'45"W	C-33	100.00	113°48'15"	79.71	101.04	84.71	N58°07'22"E
C-6	240.00	89°28'40"	128.48	235.35	226.35	S12°53'30"E	C-23	200.00	89°25'30"	18.97	31.39	28.27	S48°12'45"W	C-34	110.00	117°04'10"	16.31	32.77	32.85	N44°47'20"E
C-7	180.00	33°00'27"	47.47	92.17	80.90	S14°57'16"E	C-24	200.00	90°04'30"	30.03	31.44	28.30	N44°47'15"W	C-35	110.00	26°16'23"	15.67	30.44	30.00	N30°27'37"E
C-8	180.00	17°58'45"	25.31	50.21	40.00	S21°34'42"E	C-25	170.00	89°36'30"	9.81	19.80	19.58	S1°03'10"W	C-36	110.00	47°43'02"	48.83	51.81	44.99	N67°27'47"E
C-9	200.00	80°08'10"	46.37	177.94	172.16	S30°28'55"W	C-26	170.00	37°14'40"	80.78	18.66	99.24	N23°58'40"W	C-37	170.00	24°20'30"	36.96	72.22	71.68	S57°46'15"E
C-10	240.00	80°08'10"	114.44	213.34	204.58	N10°26'55"W	C-27	200.00	38°14'40"	72.80	138.10	136.32	N19°40'30"W	C-38	200.00	24°20'30"	43.13	84.87	84.33	S61°46'15"E
C-11	240.00	24°28'02"	82.53	103.02	102.28	S25°15'21"E	C-28	230.00	47°35'30"	9.84	18.66	19.58	N23°58'40"W	C-39	230.00	12°28'38"	23.14	30.00	49.99	S57°47'17"E
C-12	240.00	2°02'36"	4.28	8.34	8.34	S30°34'41"E	C-29	230.00	37°11'33"	84.86	130.38	128.96	N20°32'44"W	C-40	230.00	1°54'32"	23.95	47.54	44.99	S49°31'56"E
C-13	200.00	2°38'40"	47.36	93.01	72.17	S24°41'40"E	C-30	230.00	2°38'40"	5.00	9.99	9.99	N38°21'31"W	C-41	110.00	2°44'40"	24.12	47.54	47.14	S78°40'50"E
C-14	240.00	24°38'40"	37.87	74.44	73.34	N23°16'48"W	C-31	200.00	50°15'30"	9.97	17.53	16.99	N44°47'45"							

63-12068
8/3/94 S.H.

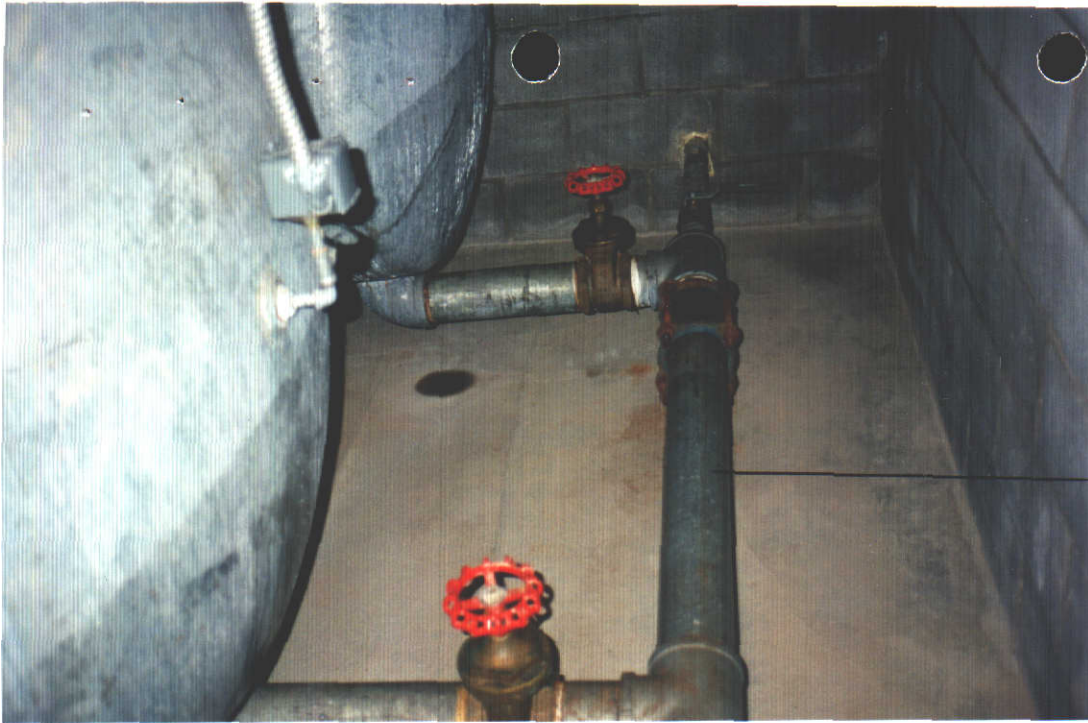

4" pipe
(steel)

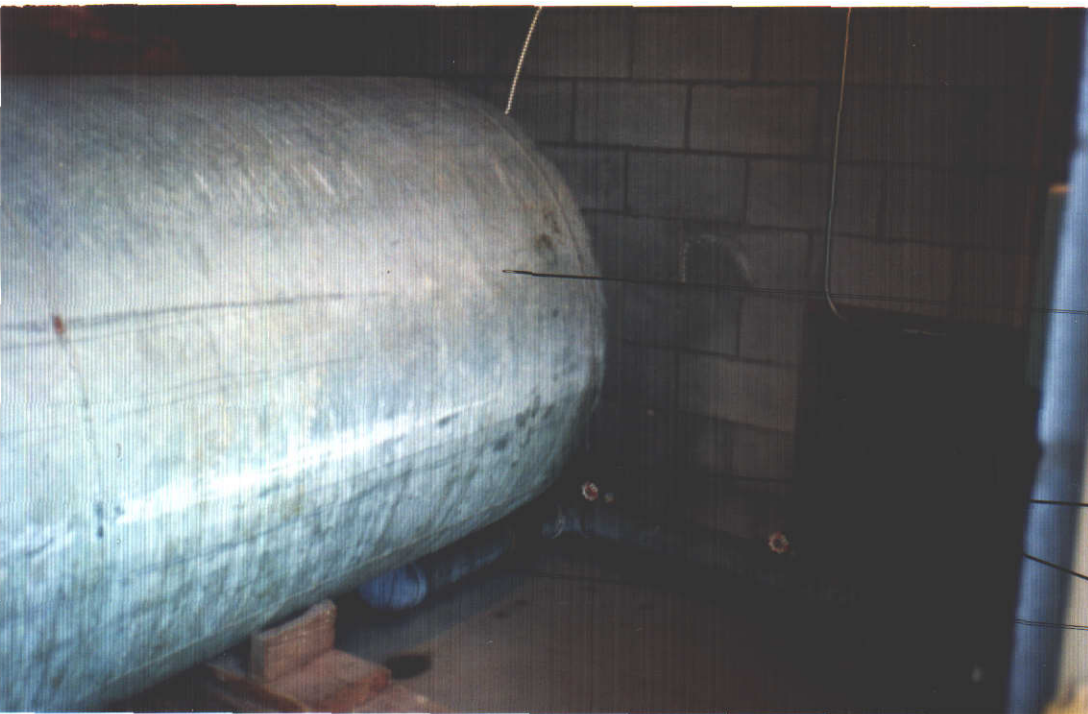

1,000 gal.
holding tanks

pressure gauge
60 psi

4" steel pipe
going from
well (back in
that crawl
space) going
to the holding
tanks

MICROFILMED
FEB 26 1998

63-12068
8/3/94 S.H.



#1 well for
#63-08296
abandoned
well, sealed
off & then
behind it
is the
current
well



#1 well
#63-12068
10" casing
20 HP
70' static
236' depth
50-74 psi

MICROFILMED
FEB 26 1998

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 63-12068

Priority: October 12, 1993

Maximum Diversion Rate:

0.08 CFS

Maximum Diversion Volume:

3.6 AF

This is to certify, that SUNNY RIDGE WATER ASSN #3

702 FAIR LN

NAMPA ID 83686

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated October 12, 1993; and has submitted Proof of Beneficial Use on March 25, 1994. An examination indicates that the works have a diversion capacity of 1.150 cfs of water from a GROUNDWATER source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	0.08 CFS	3.6 AF

LOCATION OF POINT(S) OF DIVERSION:

SENE, Sec. 10, Township 02N, Range 02W
CANYON County

PLACE OF USE: DOMESTIC

TWN RGE SEC

02N 02W 10

SENE

CONDITIONS OF APPROVAL AND REMARKS

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license shall be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. Two points of diversion are located within SENE, S10, T02N, R02W.
6. Points of diversion are located within Well Lots 1 & 2, Blk. 2, Sunny Ridge Subdivision No. 3.
7. Right 63-08296 is also diverted through the points of diversion described above.
8. Place of use is located within Sunny Ridge Subdivision No. 3.
9. Domestic use is for 3 homes.
10. The domestic use authorized under this right shall not exceed 13,000 gallons per day per dwelling in accordance with Section 42-111, Idaho Code.

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE


WATER RIGHT NO. 63-12068

CONDITIONS OF APPROVAL AND REMARKS

11. This right authorizes irrigation of up to 1/2 acre within each platted subdivision lot upon which a domestic dwelling has been constructed.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this 4th
day of FEBRUARY, 1998.

Acting for

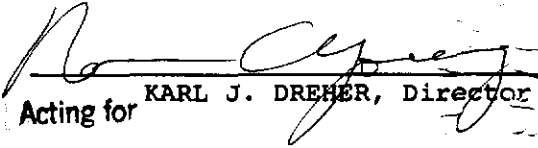
KARL J. DREHER, Director

STATE OF IDAHO

 Amt. of Fee \$ 50.00
 Date 3/25/94
 Receipt No. C039891
 Received by LLW

 DEPARTMENT OF WATER RESOURCES
PROOF OF BENEFICIAL USE
RECEIVED
MAR 25 1994
 Department of Water Resources

The Idaho Department of Water Resources will consider this form as a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

 1. Permit No. 63-12068 Telephone No. 466-8781

 2. Name(s) of Permit Holder(s): Sunny Ridge Water Corp. #3

 3. Post Office Address: 702 Fair Lane Nampa, Idaho 83686

 4. Source of Water: Ground Water

 a. If ground water, well driller's name: Dennis Phipper Date drilled: 10/21/93 to 1/28/94

 b. Pump horsepower: 20 hp Pressure (psi): _____ Dynamic pumping level (ft.): 173'

5. Extent of Use:

 Domestic 3 (No. of households) Irrigation 1 1/2 (No. of acres)

Stockwater _____ (No. and type of stock) Other _____

 6. Total rate and/or volume for which proof is submitted 0.08 cfs _____ acre/feet

7. Refer to the approval conditions on your permit and respond accordingly:

 Measuring device: Required? Yes ☒ No Installed? Yes ☒ No

OR

 Flow Measurement Port: Required? Yes ☒ No Installed? Yes ☒ No

 8. Fee Enclosed: \$ 50.00 (See License Examination Fee Schedule)

9. Person to contact to accompany the Department representative during the field examination:

Monte Schlerf 466-2463
 Name Telephone No.

702 Fair Lane Nampa, Id 83686
 Address

10. The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

3/22/94
 Date

Monte Schlerf, President
 Signature (and title if on behalf of a company or organization)

 MICROFILMED
 FEB 28 1996

State of Idaho
Department of Water Resources
Permit To Appropriate Water

NO. 63-12068

Proposed Priority: October 12, 1993 Maximum Diversion Rate: 0.08 CFS

This is to certify, that **SUNNY RIDGE WATER ASSN #3**
702 FAIR LN
NAMPA ID 83686

has applied for a permit to appropriate water from: **GROUNDWATER**

and a permit is **APPROVED** for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
-----------------------	----------------------	--------------------------

DOMESTIC	01/01 to 12/31	0.08 CFS
----------	----------------	----------

LOCATION OF POINT(S) OF DIVERSION:

SENW , Sec. 10, Township 02N, Range 02W
CANYON County

PLACE OF USE: DOMESTIC

TWN RGE SEC

02N 02W 10 SENW

CONDITIONS/REMARKS:

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before **December 1, 1994.**
2. Subject to all prior water rights.
3. Two points of diversion are located within SENW, S10, T02N, R02W. Place of use is located within Sunny Ridge Subdivision No. 3.
4. Domestic use is for 3 homes.
5. The domestic use authorized under this permit shall not exceed 13,000 gallons per day per dwelling in accordance with Section 42-111, Idaho Code.
6. This permit authorizes irrigation of up to 1/2 acre within each platted subdivision lot upon which a domestic dwelling has been constructed.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the signature of the Director, affixed at Boise, this

18 day of January, 1994.

R. Keith Higginson
R. Keith Higginson, Director

JAN 19 1994

RECEIVED

DEC 06 1993

Ident. No. 63-12068

Department of Water Resources

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

1. Name: SUNNY RIDGE WATER ASSN #3 208-466-2463
Address: 702 FAIR LANE
NAMPA ID 83686
2. Source: GROUNDWATER Trib. to:
3. Location of Point of Diversion: SENW Sec. 10, Township 02N, Range 02W
CANYON County
4. Water will be used for the following purposes:
- | Purpose | From | To | CFS | (or) | AF |
|------------|-------|-------|-------|------|----|
| IRRIGATION | 03/15 | 11/15 | 0.020 | | |
| DOMESTIC | 01/01 | 12/31 | 0.080 | | |
5. Total quantity to be appropriated is:
0.080 CFS (and/or) AF
6. Proposed diverting works:
a. Description of ditches, flumes, pumps, headgates, etc.
WELL, PUMP AND EXISTING SYSTEM
b. Height of storage dam feet; active reservoir capacity
acre-feet; total reservoir capacity acre-feet; period of
year when water will be diverted to storage: to inclusive.
c. Proposed well diameter is inches; proposed depth of well is
feet.
d. Is groundwater with a temperature greater than 85F being sought? NO
e. If well is already drilled, when?
Drilling Firm
Well was drilled for
7. Time required for the completion of the works and application of
the water to the proposed beneficial use is 1 year(s).
8. Place of Use: IRRIGATION

TWN	RGE	SEC	ACRES	ACRES	ACRES	TOTAL
02N	02W	10	SENW 1			1

Total number of acres irrigated: 1

JAN 19 1994

Place of Use: DOMESTIC, same as IRRIGATION use

9. a. Who owns the property at the point of diversion?
APPLICANT
b. Who owns the land to be irrigated or place of use?
APPLICANT
c. If the property is owned by a person other than the applicant,
describe the arrangement enabling the applicant to make this filing.

10. Remarks:

Two points of diversion in SENW, S10, T02N, R02W. Domestic
use is for in-house use for 3 houses. Property is within
Sunny Ridge subdivision no. 3.

11. Map of proposed point of diversion and place of use attached? []

BE IT KNOWN that the undersigned hereby makes application for permit to
appropriate the public waters of the State of Idaho as herein set forth.

Applicant

Received by _____ Date _____ Time _____ Preliminary check by _____

Fee \$ 419.00 Receipted by _____ #W016846 Date 10/12/1993

Publication prepared by _____ Date _____ Published in _____

Publication approved _____ Date _____

RECORDED

JAN 19 1994

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

Ident. No. 63-12068

To appropriate the public waters of the State of Idaho

466-2463

1. Name of applicant Sunny Ridge Water Assn #3 Phone 466-8781
Post office address 702 Fair Lane Nampa ID 83686

2. Source of water supply Groundwater which is a tributary of N/A

3. Location of point of diversion is — ¼ of SE ¼ of NW ¼, Govt. Lot —
Sec. 10 Township 2N Range 2W B.M. Canyon County; additional
points of diversion if any: —

4. Water will be used for the following purposes:

Amount .08 for Domestic purposes from 1-1 to 12-31 (both dates inclusive)
(cfs or acre-feet per annum)

Amount .02 for Irrig purposes from 3-15 to 11-15 (both dates inclusive)
(cfs or acre-feet per annum)

Amount — for — purposes from — to — (both dates inclusive)
(cfs or acre-feet per annum)

Amount — for — purposes from — to — (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated is (a) .08 and/or (b) —
cubic feet per second acre feet per annum

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc. 2ea 10" wells w/sub
pumps - Existing System under 63-08296

b. Height of storage dam — feet; active reservoir capacity — acre-feet; total
reservoir capacity — acre-feet; period of year when water will be diverted to storage:
— to — inclusive.

c. Proposed well diameter is 2 wells x 10" inches; proposed depth of well is 150-250 feet.

d. Is ground water with a temperature of greater than 85°F being sought? No

e. If well is already drilled, when? 7-4-93; Drilling firm Broomfield / D Phipps;

Well was drilled for (well owner) —

7. Time required for the completion of the works and application of the water to be proposed beneficial use is
1 years (minimum 1 year).

JAN 19 1994

8. Description of proposed uses (if irrigation only, go to item 9):

- a. Hydropower; show total feet of head and proposed capacity in KW. _____
- b. Stockwatering; list number and kind of livestock. _____
- c. Municipal; show name of municipality. _____
- d. Domestic; show number of households. 3 homes & Yard Irrig < 1/2 ac ea
- e. Other; describe fully. _____

9. Description of place of use:

- a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.
- b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RANGE	SEC.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				TOTALS
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
2N	2W	10				Domestic → 3/D													
						Irrig. → 1													1

Total number of acres to be irrigated 1

10. Describe any other water rights used for the same purposes as described above. 63-08296

11. a. Who owns the property at the point of diversion? Applicant
- b. Who owns the land to be irrigated or place of use? Applicant
- c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing. _____

12. Remarks: Replacement well Drilled by D. Phipps 10/93 DP # 63-93-W-1047. This application is made for additional homes serviced by water system not covered under 63-08296

Comments: Two points of diversion in SE 1/4, S10, T2N, R2W. Domestic use is for in-house use for 3 ac. Property is within Sunny Ridge Subdivision No. 1.



IDWR map per
7. Vicent's sold. plat map

SCALE 1:24,000

- 82
1-2-1973

1 MILE

THIS PLAT IS NOT TO SCALE



SCALE 1"=100'

SUNNY RIDGE SUBDIVISION No.3
CANYON COUNTY IDAHO

STATE OF IDAHO S.S.
COUNTY OF CANYON

I, Ronald M. Doherty, a Registered Professional Engineer
in and for said County and State, do hereby certify that
the survey of SUMMIT RIDGE SUBDIVISION No. 3 in Canyon
County, Idaho, as depicted on each book of this plat was made
by me or under my direction and that this plat correctly
shows the survey as made. IN WITNESS WHEREOF, I have
hereunto set my hand and Seal this 15th of
May A.D. 1979



STATE OF IDAHO S.S.
COUNTY OF CANYON

On this 15th day of May A.D. 1975 before me
Robert H. Freeman, a Notary Public in and for said
County and State, personally appeared Ronald M. Binkley,
known to me to be the person whose name is subscribed to
the foregoing instrument and acknowledged to me that
he executed the same. IN WITNESS WHEREOF, I have
hereunto set my hand and Seal this 15th day of
May A.D. 1975


History Public Robert L. LintonResiding at Caldwell, Idaho...My Commission expires 10-15-27

I hereby certify that this instrument was filed for
record at the request of Ronald M. Winkley at 2:
minutes past 11 o'clock A.M. this 22nd day
of Feb. A.D. 1978

Instrument No. 154282

Revised: _____

800017

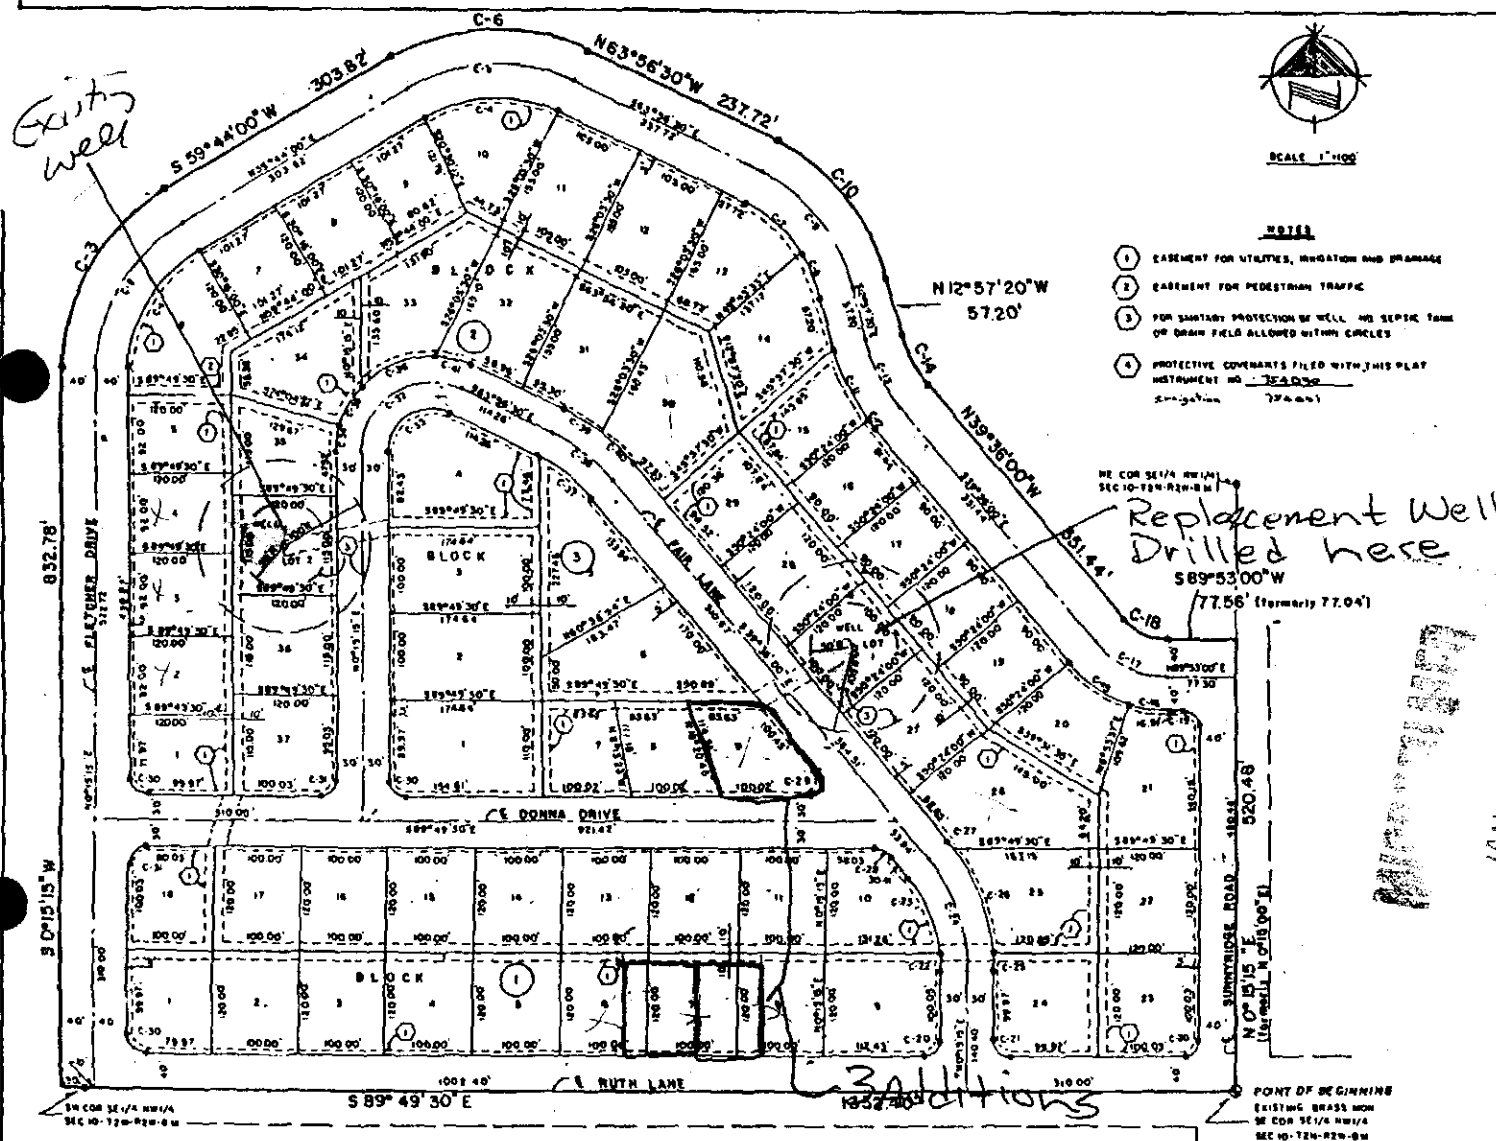

CURVE NO.	R	Δ	ANGLE	T	L	L.C.	L.C. BRS	CURVE NO.	R	Δ	ANGLE	T	L	L.C.	L.C. BRS	CURVE NO.	R	Δ	ANGLE	T	L	L.C.	L.C. BRS
C-1	160.00'	89°28'45"	94.47	148.10'	188.74'	121.97	59.33'	C-18	180.00'	90°00'23"	42.31	82.46'	96.40'	80.00	21.12'	C-19	20.00'	119°46'30"	42.87	48.30'	58.22	82.07	19.70'
C-2	2000.00'	89°28'48"	117.26	707.65'	198.42'	151.59	58.38'	C-19	180.00'	90°00'37"	21.82	49.77'	94.46'	80.00	04'45"	C-20	20.00'	90°04'45"	30.53	31.44'	38.30	54.47	07.00'
C-3	240.00'	89°28'43"	114.11	154.15'	236.11'	151.99	59.37'	C-20	110.00'	89°00'38"	63.95	93.87'	96.00	54'08"	C-21	20.00'	89°08'10"	10.93	31.26'	38.30	54.47	12.32'	
C-4	290.00'	94°19'30"	88.66	157.29'	151.03'	148.76	54.87'	C-21	70.00'	89°01'30"	33.05	61.72'	99.74'	94.84	06'48"	C-22	80.00'	118°48'18"	127.54	141.70'	135.34	158.00	07.00'
C-5	260.00'	94°19'30"	107.01	164.79'	188.79'	148.73	43.43'	C-22	20.00'	90°02'00"	20.13'	51.24'	91.74'	94.06	00'00"	C-23	100.00'	118°48'18"	127.54	141.70'	135.34	158.00	07.00'
C-6	340.00'	94°19'30"	128.46	233.53'	228.35'	147.70	53.48'	C-23	20.00'	89°00'30"	18.97'	51.39'	92.27'	94.82	12'45"	C-24	110.00'	118°48'18"	127.54	141.70'	135.34	158.00	07.00'
C-7	160.00'	33°00'47"	47.41	92.17'	90.90'	94.72	16.42'	C-24	20.00'	90°04'30"	30.03'	31.44'	28.30'	94.84	07'13"	C-25	20.00'	118°48'18"	127.54	141.70'	135.34	158.00	07.00'
C-8	160.00'	17°06'45"	25.34	30.21'	60.00'	82.15	58.42'	C-25	170.00'	89°00'30"	8.91	39.50'	94.84	07'13"	C-26	20.00'	118°48'18"	127.54	141.70'	135.34	158.00	07.00'	
C-9	240.00'	90°00'10"	90.37	177.98'	172.18'	153.87	28.53'	C-26	110.00'	89°01'40"	80.78	136.40'	92.26'	94.84	07'13"	C-27	170.00'	21°21'30"	36.46	72.27'	71.68	53.00	16.45'
C-10	340.00'	80°00'10"	114.44	213.58'	202.56'	153.87	28.53'	C-27	200.00'	33°01'40"	72.80	136.40'	136.33'	94.84	07'13"	C-28	200.00'	21°21'30"	36.46	72.27'	71.68	53.00	16.45'
C-11	240.00'	2°00'36"	92.33	93.05'	102.26'	153.51	21.41'	C-28	130.00'	49°03'30"	9.84	136.65'	94.84	07'13"	C-29	200.00'	12°21'30"	23.14	40.00'	49.99	53.00	16.45'	
	340.00'	2°00'36"	4.26	93.46'	93.46'	153.51	21.41'	C-29	130.00'	33°01'30"	94.96	136.65'	94.84	07'13"	C-30	230.00'	11°31'30"	23.14	40.00'	49.99	53.00	16.45'	
	260.00'	21°00'40"	47.38	93.41'	93.41'	153.51	21.41'	C-30	170.00'	21°00'30"	9.99	136.65'	94.84	07'13"	C-31	110.00'	11°31'30"	23.14	40.00'	49.99	53.00	16.45'	
	260.00'	21°00'40"	3.97	74.04'	73.94'	153.51	21.41'	C-31	20.00'	30°01'30"	9.97	17.33'	16.90	10.99'	C-32	110.00'	11°31'30"	23.14	40.00'	49.99	53.00	16.45'	

Attached

JAN 10 1964

Mark H. Kelly President
(Applicant)

Received by RW Date 10-12-93 Time 10:30 am Preliminary check by R
Fee \$ 30.00 Received by [Signature] # W016846 Date 10-12-93
Publication prepared by [Signature] Date 11-93 Published in Press Trib
Publication approved [Signature] Date 12-1-93

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. _____, and said application is hereby _____.

1. Approval of said application is subject to the following limitations and conditions:

a. SUBJECT TO ALL PRIOR WATER RIGHTS.

b. Proof of construction of works and application of water to beneficial use shall be submitted on or before _____, 19 ____.

c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.

d. The water right acquired under this permit if for hydropower purposes shall be junior and subordinate to all rights to the use of water, other than hydropower, within the State of Idaho that are initiated later in time than the priority of this permit and shall not give rise to any right or claim against any future rights to the use of water, other than hydropower, within the State of Idaho initiated later in time than the priority of this permit.

e. Other:

RECEIVED

JAN 19 1994

63-08296 + NEW Appl. 10/12/93

Names & Titles of Assn. Members/officers

President: Monte Schlerf

Sec/Treas: Ted Stimpson

Board Mbrs: Dan Kline
Russ Pool
Ralph Swensen

JAN 19 1994



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. BOX 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

February 5, 1998

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

SUNNY RIDGE WATER ASSN #3
702 FAIR LN
NAMPA ID 83686

RE: WATER RIGHT NO. 63-12068

Dear Water Right Holder(s):

The Department of Water Resources (the Department) has issued the enclosed license confirming that a water right has been established in accordance with the permit referenced above. The license is a preliminary order issued by the Department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department unless a party petitions for reconsideration or files an exception and/or brief as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the Department within fourteen (14) days of the service date of this order. The Department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See section 67-5243(3), Idaho Code.

EXCEPTIONS AND BRIEFS

Within twenty-one (21) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding. Otherwise, this preliminary order will become a final order of the Department.

If any party appeals or takes exceptions to this preliminary order, opposing parties shall have twenty-one (21) days to respond to any party's appeal. Written briefs in support of or taking exceptions to the preliminary order shall be filed with the Department. The Department retains the right to review the preliminary order on its own motion.

63-12068-12

FEB 26 1998

ORAL ARGUMENT

If the Department grants a petition to review the preliminary order, the Department shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Department will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Department orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Department in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with Rules of Procedure 302 and 303.

FINAL ORDER

The Department will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Department may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The Department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

If you have any questions, please call me at 208-327-7946.

Sincerely,



Shelley W. Keen
Water Rights Supervisor

SK:klt

Enclosure


RECEIVED
FEB 28 1988

CERTIFICATE OF MAILING

I hereby certify that on the **5th** day of **February, 1998**, I mailed a true and correct copy, postage prepaid, of the foregoing **PRELIMINARY ORDER (Approved License)** to the person(s) listed below:

Water Right No. 63-12068

SUNNY RIDGE WATER ASSN #3
702 FAIR LN
NAMPA ID 83686

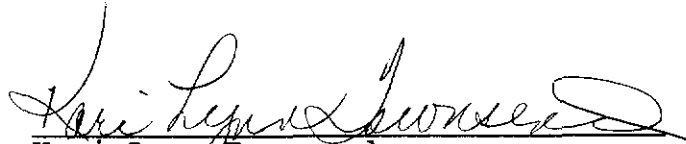
Kari Lynn Townsend
Secretary

FEB 26 1998

B/U FIELD EXAM REVIEW

by Cindy LouPermit #: 63-12068 Name: Sunny Ridge Water Assn #3 Date: 1/20/97 ✓ Lots _____

NAME	Chng	Same	Or Address Change?
SOURCE		✓	Clarify source _____ Prelim. Order to Void - Source change.
P/D		✓	Amendment Needed? Addn'l 1/4? _____ Legal <u>SESENW</u> P39 Same 1/4? _____ W32 _____ P36 Overlap(s) <u>63-8296 (same wells)</u>
P/U		✓	Amendment Needed? <u>reduce to 1/2 acre in</u> P41 Overlap(s) <u>63-8296 (same syst & subd; diff lots)</u> (Gov't use special ¶s) _____ *P/D & P/U Amend? P37
RATE		✓	Permit/proof fee limits <u>0.08</u> / <u>0.20</u> Measured Quantity = _____ cfs Theoretical Quantity = <u>1.15</u> cfs <u>allow permitted 0.08</u> (HP) $\frac{8.8 \times 0.70 \times 20}{57 + (2.31 \times 57)} = 0.65$ cfs + $\frac{8.8 \times 0.7 \times 15}{55 + (2.31 \times 51)} = 0.50 = 1.15$ Recommended capacity <u>1.15</u> cfs Recommended rate <u>0.08</u> cfs
VOLUME		✓	Season: (<u>1</u>) <u>1/1 - 12/31</u> = _____ days Calculations: <u>3 hrs x 1.2 AF/hr = 3.6 AF</u> Flow limit: _____ cfs x _____ days/yr. x 1.9835 = _____ AF Recommended volume <u>3.6</u> AF
USES		✓	Same Nature of Use? _____ P46 Amendment Needed? _____
REMARKS		✓	Multiple p/d's in same 1/4? Use W32 <u>SENW, S10, T02N, R02W</u> ① W08 1/3 ② 1/2 ac ③ W35 ④ 13000 sqd. ⑤ Pu ⑥ PD
CONDITIONS			Measuring Device (R43) or Lockable Controlling Works (R02) Watermaster Control (R04) - WD # _____ Irrigation rate/annual volume overlap GW irrigation replaces surface water (050) GW irrigation supplements surface water (065) Water Quality Other _____
PRIORITY	App Rcd	<u>10/12/93</u>	Due <u>12/1/94</u> Rcd <u>3/25/94</u> Receipt# <u>C029891</u> Fee OK? (Yes/No) <u>*50</u> Order to Reinstate Needed? Yes/No Done? _____ Advanced to: _____ Priority <u>10/12/93</u> Examined <u>8/3/94</u>

COMMENTS: 63-8296 requires SRBA claim!

USE	CFS	VOLUME
<u>Dom/3</u>	<u>0.08</u>	<u>3.6</u>
<u>/</u>	<u>/</u>	<u>/</u>
<u>/</u>	<u>/</u>	<u>/</u>
<u>TOTAL</u>	<u>0.08</u>	<u>3.6</u>

 SRBA Overlap 63-8296
 Adjustment Memo ✓
 LICENSE
 #1 AMEND: _____/P38
 #2 AMEND: (R)P42/(C)P47

MEMORANDUM

DATE: January 30, 1998
TO: File No. 63-12068
FROM: Cindy Lou Zimmerman
SUBJECT: Review of Beneficial Use Field Report

The examiner recommended domestic use for 3 homes and irrigation of 0.5 acres. The permit was issued for domestic use only. Irrigation use will not be recommended on the license.

The following adjustments¹ were made on the field report to reflect the domestic use for 3 homes with lawns that were developed under this permit:

G. Volume Calculations.

- a. Domestic, 3 homes with lawns = homes x 1.2 AF/home
= 3 x 1.2
= **3.6** AF.

H. Recommendations.

1. Recommended amounts:

Beneficial Use	Period of Use	Rate of diversion	Annual Volume
Domestic	1/1-12/31	0.08 cfs	<u>3.6</u> AF
	Totals:	0.08 cfs	<u>3.6</u> AF

Examiner: Sandy Hemingway
Examined: August 3, 1994

¹ Adjustments are **bolded and underlined**.

RECEIVED
FEB 26 1998

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

SEE FIELD #1 VENDOR
DEC 15 1994
Department of Water Resources

A. GENERAL INFORMATION

Permit No. 63-12068

1. Owner: Redd Sunny Ridge Water Assn. #3 Phone No. (208) 466-2463
Current Address: 702 Fair Ln. Nampa, Id. 83686
2. Accompanied by: Mr. Monte Schlerf EXAM DATE: 8/3/94
Address: 702 Fair Ln. Nampa, Id 83686 Phone No. (208) 466-2463
Relationship to Permit Holder: member of assn./owner
3. Source: groundwater tributary to —

B. OVERLAP REVIEW

1. Other water rights with the same place of use: 63-02388, 63-07149, 63-07600, 63-08291
2. Other water rights with the same point of diversion: 63-07600, 63-08291

C. DIVERSION AND DELIVERY SYSTEM

RECEIVED

DEC 15 1994

1. Point(s) of Diversion:

Ident No.	Gov't Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Department of Water Resources Method of Determination/Remarks
		SE	SE	NW	10	2N	2W	Canyon	USGS Topo. map & exam


2. Place(s) of Use:

USGS Topo. map +
Indicate Method of Determination exam

TWP	RGE	SEC	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
2N	2W	10								D/B									
										I									.5 acre

RECORDED
FEB 25 1995

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe I.D. as applicable.

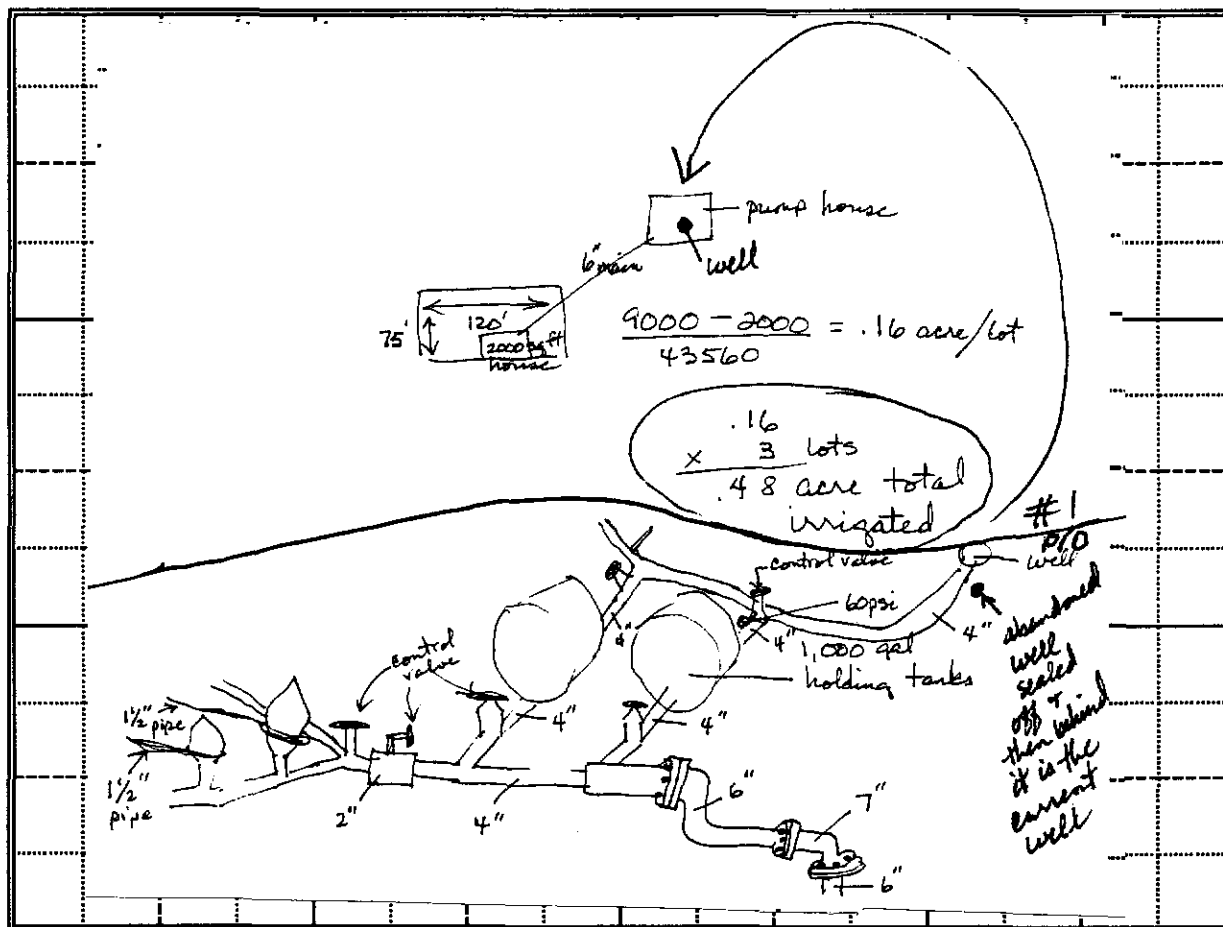

Scale: 1" = 100'

☒ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

☒ Aerial Photo Attached (required for Irrigation of 10+ acres)

☒ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
#1 Submers.		20			4"
#2 Submers.		15			4"

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: Average lot 9000 sq. ft - average 2000 sq ft house = 7000
43560

= .16 acre/lot : 3 x .16 = .48 acre
+ .048 error =
.52 acre total
FEB 26 1990

E. NARRATIVE/REMARKS/COMMENTS

- Drilling Permit # 63-93-W-1047-000 drilled by Dennis Phipps #332 1-28-94 (well #1); DR# 63-8296 drilled by Broomfield #29 3/20/74 (well #2) examined w/WR#6308296)
- P/D: (2 points) SE NW Sec. 10, T2N, R2W, Canyon County.
- Well #1 is a replacement for the original well #1 that was at the same site, only now is located 4.5'-5' away (estimating from the number of cinder blocks between the two wells in the picture).
- Overlaps for P/D #63-08296 is licensed to Sunny Ridge Water Assoc. (the original well #1 & well #2)
- ~~Overlaps for P/U are~~ The Other overlap for P/D is another source.
- Overlaps for P/U are other land &/or other uses, except for WR #63-08296 Sunny Ridge Water Assoc., which is licensed, & is for the same land ~~same #2 well~~ & original well #1 & well #2.
- WR #63-08296 license is for 62 homes of the total of 65 in the subdivision. WR#63-12068 is for the additional 3 homes & irrigation of yards to complete the subdivision.
- The Plat map shows locations for well #1 & well #2, where the systems tie together, how the 6" main runs, & where the 3 additional homes for domestic use & irrigation for yards are located.
- No govt. lots were found for this section.
- Use is for (3 homes - internal) Domestic, & irrigation of .5 acres (yards) total acreage.
- Recommend licensing as original application

Have conditions of permit approval been met? ☒ yes ☐ no

for permit stated:
Domestic & Irrigation
Use - per Steve
Lester.

63-93-W-1047-000
DEC 28 1993

✓ Additional Computation Sheets Attached

Measured Method:

ONS ☒ Additional Computation Sheets Attached
Theoretical pump efficiency calculations (see attachment)

well #1 = .66 cfs

well # 2 = .49 cfs

$$.66 \text{ cfs} + .49 \text{ cfs} = 1.15 \text{ cfs}$$

(WR#63-08296 = .89 cfs on license)

~~X~~ G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation: (see attachment)

$$V_{IR} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = 5 \times 4.5 = 2.25$$

$$V_{DR} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = 9.75$$

$$V = \text{Smaller of } V_{IR} \text{ and } V_{DR} = 2.25$$

2. Volume Calculations for Other Uses:

2. Volume Calculations for Other Uses: Domestic (internal only) $\frac{3 \times .6 \text{ Afa}}{\cancel{3 \times .6 \text{ Afa}}} = 1.8 \text{ Afa}$

~~Irrigation Exh. 12 3 hours served~~

(WR# 63-08296 = 74.4 Afa)

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
<u>Domestic</u>	<u>1/1</u>	<u>12/31</u>	<u>.08</u>	<u>1.8 *</u>
<u>Irrigation</u>	<u>3/15</u>	<u>11/15</u>	<u>.02</u>	<u>~~2.25~~ 2.3 *</u>
		Totals:	<u>.08</u>	<u>4.1 *</u>

2. Recommended Amendments

_____ Change P.D. as reflected above _____ Add P.D. as reflected above ☒ None
 _____ Change P.U. as reflected above _____ Add P.U. as reflected above _____ Other

I. AUTHENTICATION

Field Examiner's Name James J. Hennessy Date 12/8/94

Reviewer _____ Date _____

SEAL

* Adjustments made during review of this right for license approval.
See Memo for additional information. 1/30/98. 63.

FEB 26 1998

MEMORANDUM

TO: SHELLEY KEEN

FROM: STEVE LESTER

DATE: DECEMBER 13, 1994

RE: LICENSE RECOMMENDATIONS FOR PERMIT 63-12068

This memo accompanies the field exam report and addresses the beneficial uses to be licensed for this multi-domestic addition to the older and larger right covering the first 62 units in the subdivision (license 63-08296).

63-08296 was licensed under the older multi-domestic language in which internal and external uses were labeled "domestic" and up to 1.2 afa/home was allowed. The dual uses are discovered only by looking at the licensed volume value. I understand that such rights will be re-defined in the SRBA as internal domestic and external irrigation to become consistent with newer filings. License 63-08296 is such a right since proof was filed before the SRBA.

When application 63-12068 was filed, the newer standard applied in which internal and external uses were delineated as domestic and irrigation. For some reason still not clear to me, the permit was issued with only domestic use listed as a beneficial use, and irrigation of up to 1/2 acre per unit was included in the remarks.

License recommendations consistent with the permit approval would appear as follows:

Domestic (3 units) .08 cfs ?? afa

with remark @ 1/2 acre irrigation

Annual volume for external use is not clear in permit as issued but three options are seen. Is external volume treated as irrigation or as the .6 afa/unit maximum as in old method or as some other variation of the preceding?

1. Award volume based on actual irrigated acres; 1/2 acre found with 2.3 afa in Vr & Vd method; volume is 3 x .6 (internal) plus 2.3 (external) for 4.1 total.

2. Award volume based on maximum external component where each unit can have .6 afa for yard use; D/3 found so allow 3 x .6 for yard use; total volume is 3 x 1.2 (internal plus external) for 3.6 afa. This is the old style.

3. Award volume based on variation of above. Here, found 1/2 acre yard which can be treated as would in D/1 yard, allow .6 afa for yard use; total volume is 3 x .6 (internal) plus .6 (external) for 2.4 afa; I prefer this latter choice if license remains consistent with permit since 2.4 afa probably is the most realistic reflection of actual use. Also, this method mirrors the type of recommendation one would find for landscaping around offices etc.

RECORDED
FEB 26 1995

Licensing 63-12068
December 13, 1994
Page 2

The total volume to be licensed is not really clear in the permit's present configuration.

However, instead of the above options, I think we should use the standard subdivision language to avoid creating yet another type of multi-domestic use that can increase confusion in years to come when interpreting water rights. It would not be unusual for this subdivision to expand and require a third right. Assuming that we would use the standard domestic plus irrigation terms for a third right, three different types of coverage would then be used for same/similar uses in various phases of the subdivision development if the current permit was not re-defined in licensing.

At the very least, license 63-08296 will be changed in SRBA to list domestic and irrigation uses. It seems efficient to license the permit in a similar manner to promote consistency and improve future interpretations of the rights in use for the overall development. Note that the permit is precluded from SRBA re-defining (proof after 1987).


In conclusion, my approach focuses on tailoring rights to be more alike rather than increasing differences between similar rights, differences which depend on the time period in which a right is approved rather than on real variations between types of water uses. Therefore, permit 63-12068 is recommended as D/3 plus irrigation of 1/2 acre as shown in the attached exam report. Yes, it is true that my suggestion could (but doesn't necessarily) result in a somewhat larger external volume component (used Vr in exam report), but this is not an expansion of the right since external volume is not clearly determined by the manner in which the right was issued (recall three volume options).

Why should this right be different than other subdivision rights exempted in the moratorium? Aren't we now using the standard domestic and irrigation terms within and outside of the moratorium areas? If so, why are there some rights with this unusual approval language?

The outcome of licensing 63-12068 can set the tone for dealing with other moratorium exemption permits issued in an identical manner. Please let me know what you think of these ideas and what the final outcome will be for the new license. This office can use this case as a precedent for similar permits. If I recall correctly, not many were issued this way.


ENCLOSURE
FEB 26 1995

63-12068
TOAN ROAD

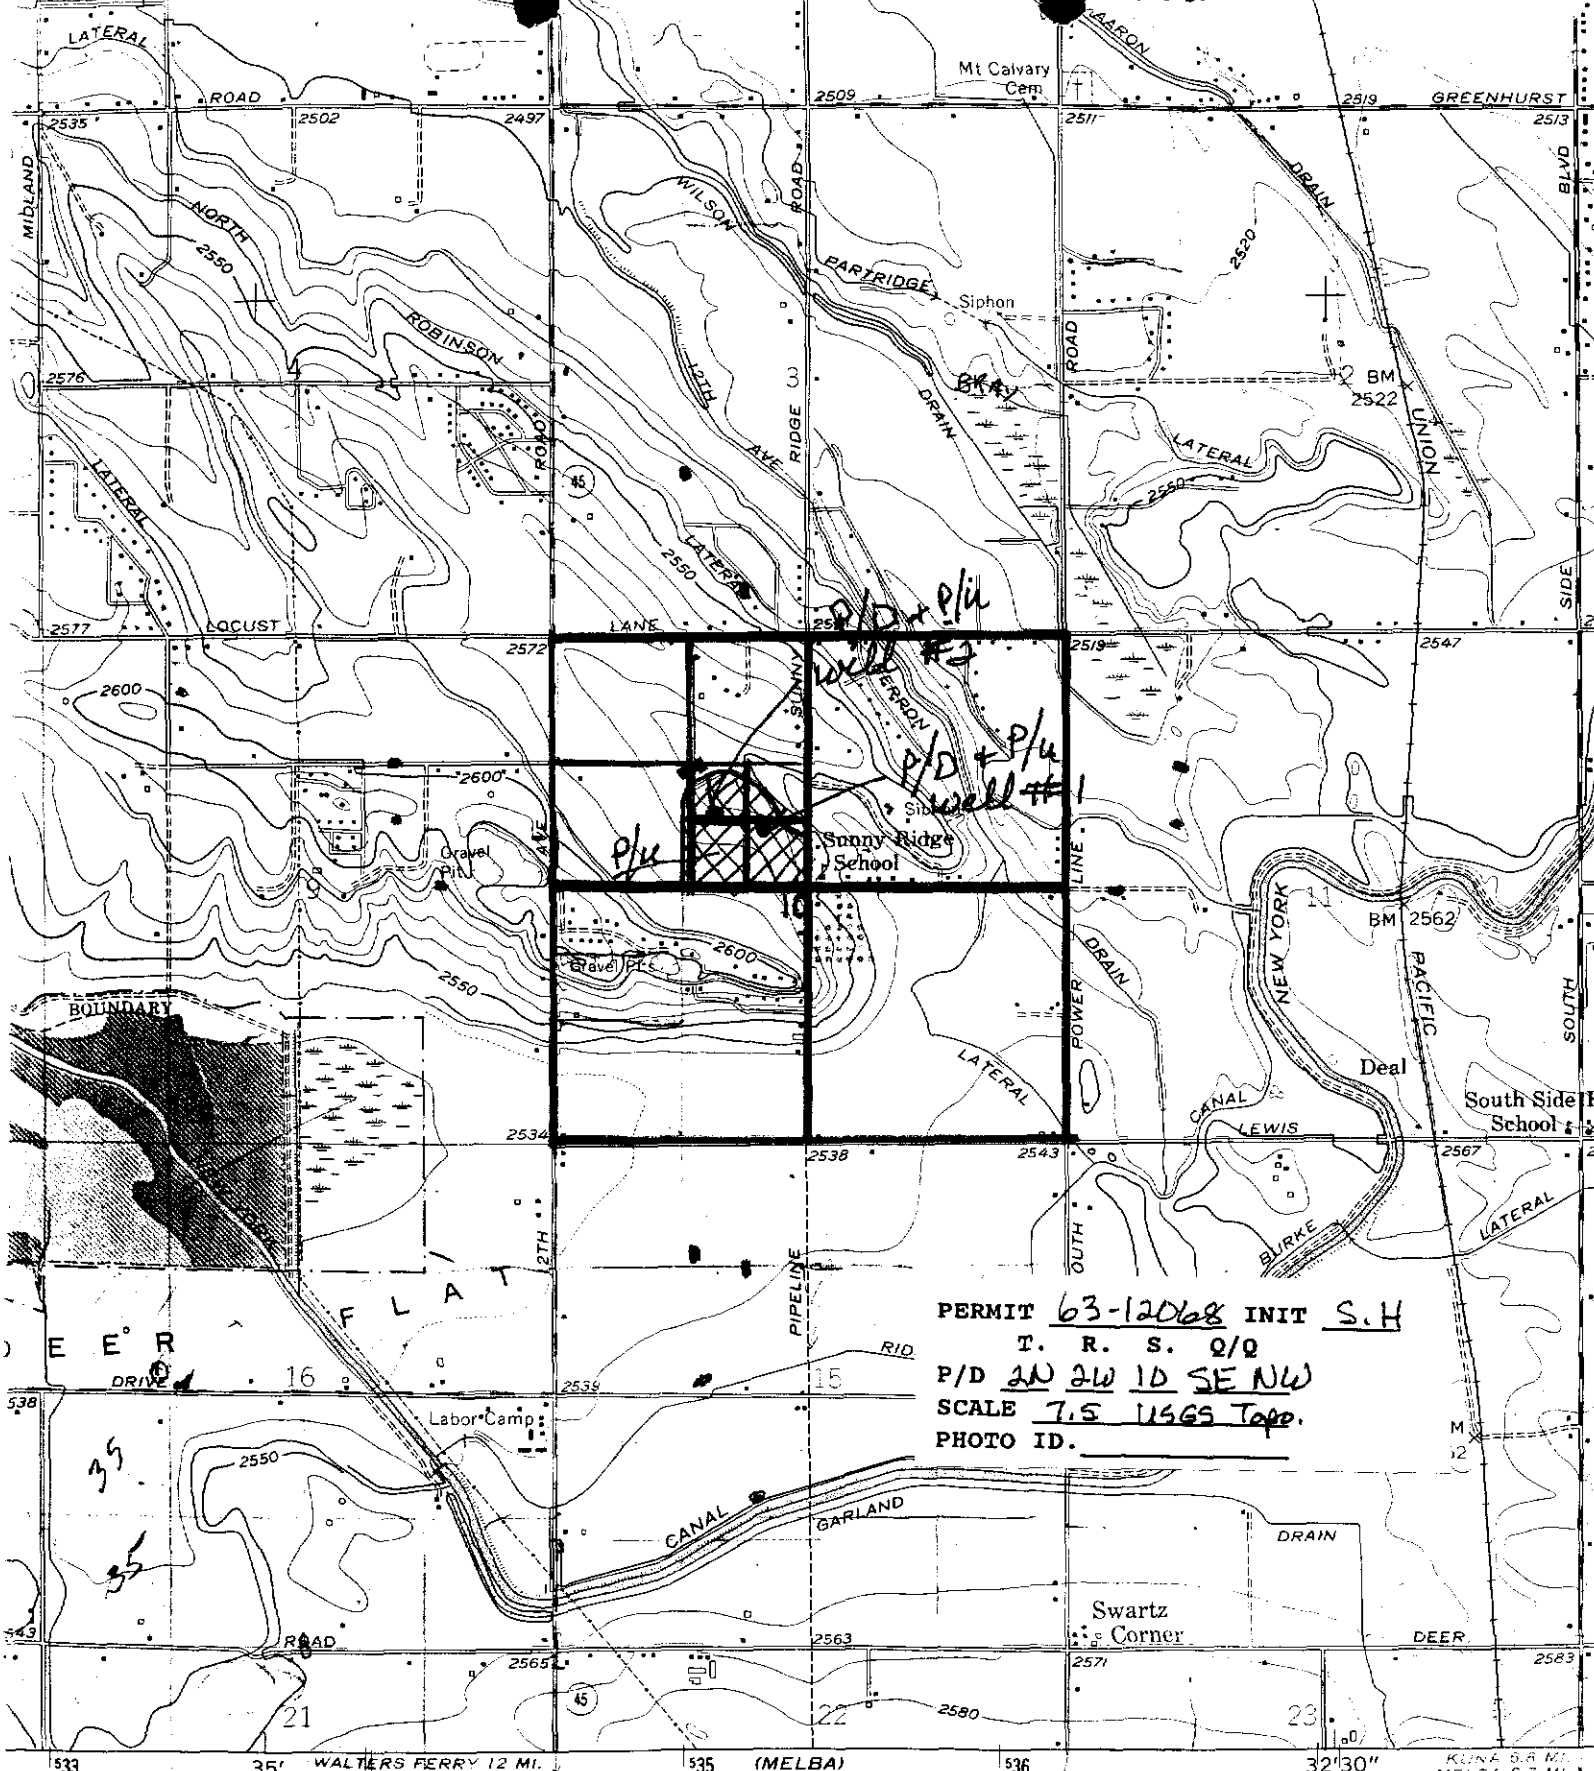


PERMIT 63-12068 INIT S.H
T. R. S. Q/Q
P/D 2N 2W 10 SE NW
SCALE 7.5 USGS Topo.
PHOTO ID.

0°18' 5 MILS
18 1/4° 329 MILS

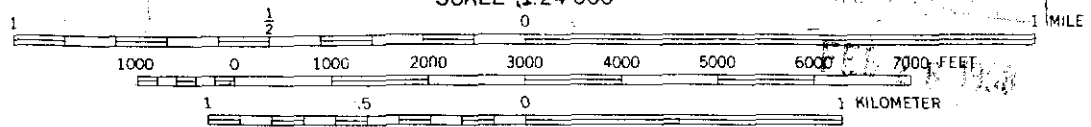

CONTOUR INTERVAL 10 FEET
DOTTED LINES REPRESENT 5-FOOT CONTOURS
DATUM IS MEAN SEA LEVEL

THIS PLAT IS NOT TO SCALE

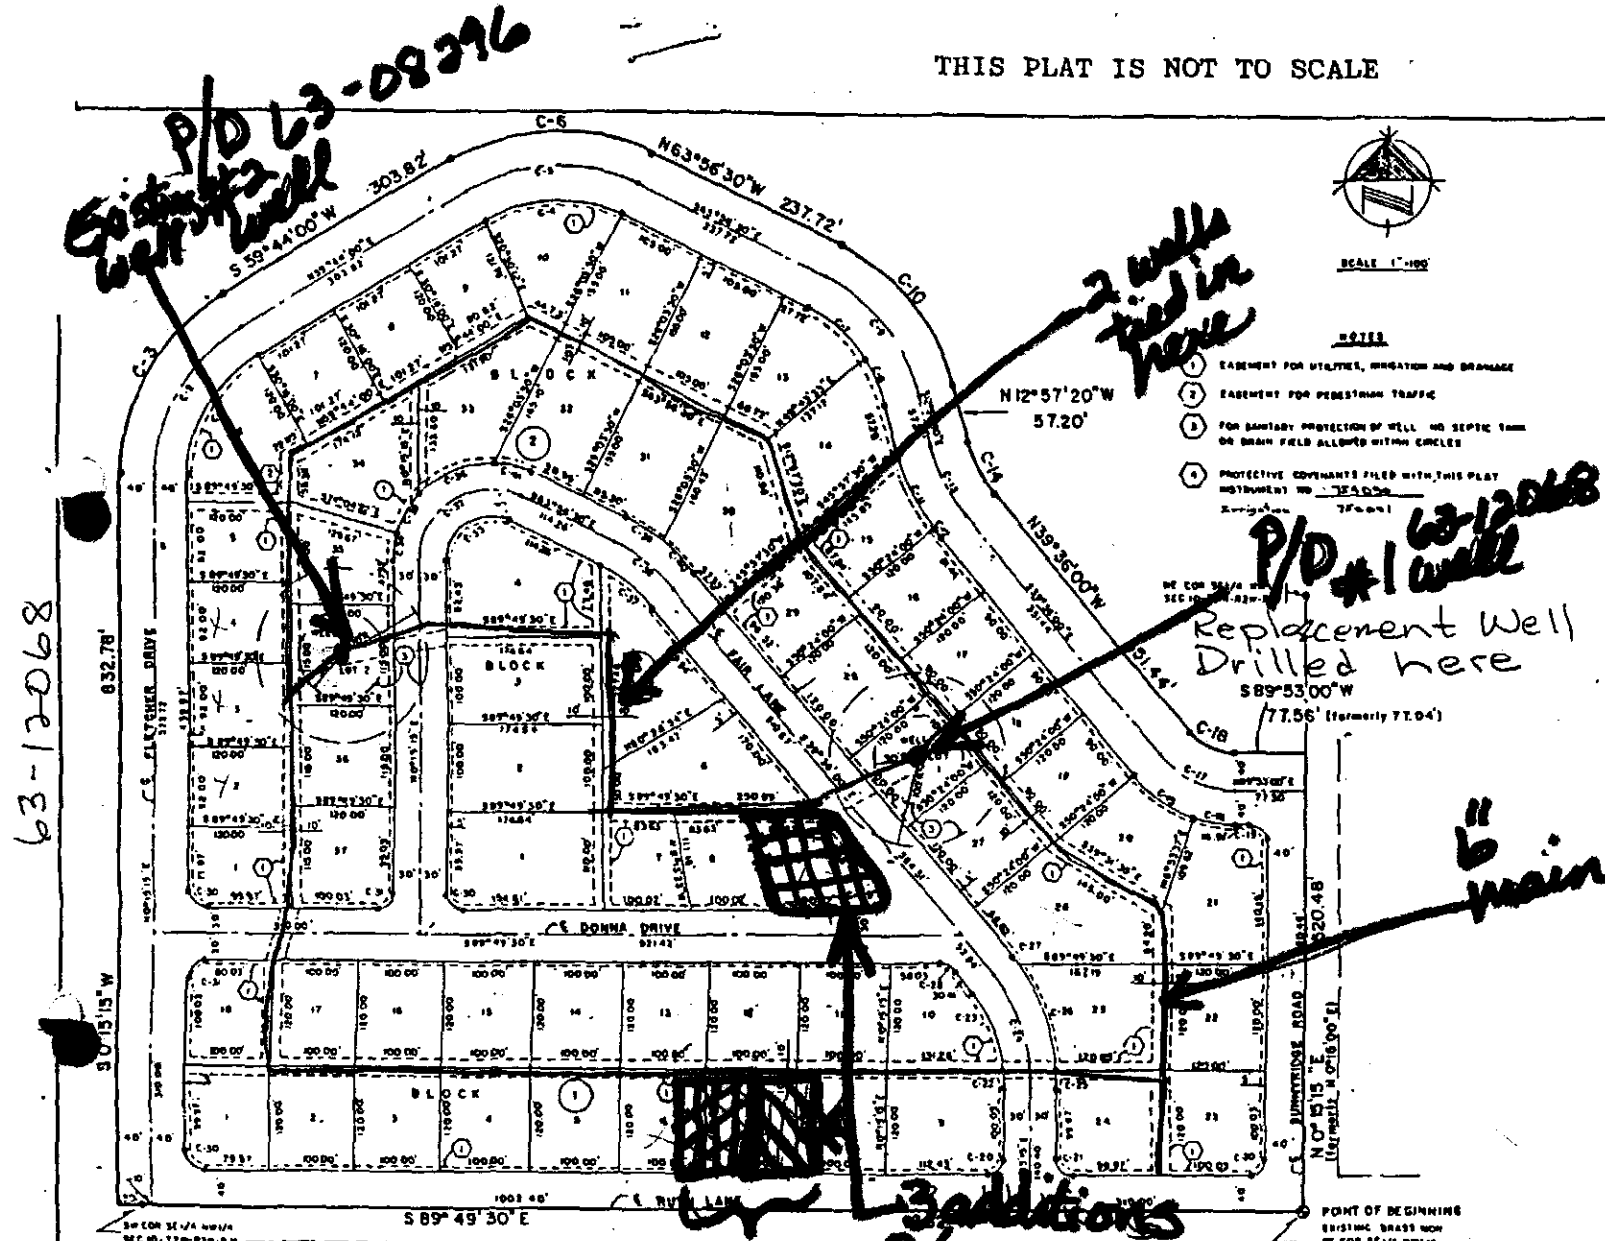

SCALE 1"=100'

NOTES

- 1 EASEMENT FOR UTILITIES, IRRIGATION AND DRAINAGE
- 2 EASEMENT FOR PEDESTRIAN TRAFFIC
- 3 FOR SANITARY PROTECTION OF WELL NO SEPTIC TANK OR DRAIN FIELD ALLOWED WITHIN CIRCLES
- 4 PROTECTIVE COVENANTS FILED WITH THIS PLAT INSTRUMENT NO. 754034

SUNNY RIDGE SUBDIVISION No.3
CANYON COUNTY IDAHO

STATE OF IDAHO S.S.
COUNTY OF CANYON

I, Ronald M. Bishley, a Registered Professional Engineer in and for said County and State, do hereby certify that the survey of SUNNY RIDGE SUBDIVISION No. 3 in Canyon County, Idaho, as described on the back of this plat was made by me or under my direction and that this plat correctly shows the survey so made. IN WITNESS WHEREOF, I have hereunto set my hand and Seal this 15th day of May A.D. 1978



STATE OF IDAHO S.S.
COUNTY OF CANYON

On this 15th day of May A.D. 1978 before me, Ronald M. Bishley, a Notary Public in and for said County and State, personally appeared Ronald M. Bishley, known to me to be the person whose name is subscribed to the foregoing instrument and acknowledged to me that he executed the same. IN WITNESS WHEREOF, I have hereunto set my hand and Seal this 15th day of May A.D. 1978

Notary Public Ronald M. Bishley

Residing at Caldwell, Idaho

My Commission expires 12-31-80



CURVE NO.	R	Δ	ANGLE	T	L	L.C.	L.C. BEG.	CURVE NO.	R	Δ	ANGLE	T	L	L.C.	L.C. BEG.
C-1	100.00	94°21'48"	94.41	164.74	164.74	164.74	164.74	C-18	100.00	3°30'33"	42.37	83.46	83.46	83.46	83.46
C-2	100.00	89°29'48"	89.49	207.62	199.42	199.42	199.42	C-19	100.00	12°28'30"	42.87	83.23	83.23	83.23	83.23
C-3	240.00	89°29'48"	137.11	249.15	236.61	236.61	236.61	C-20	200.00	30°34'43"	30.92	54.44	54.44	54.44	54.44
C-4	100.00	34°18'30"	34.31	137.23	134.02	134.02	134.02	C-21	200.00	89°56'18"	19.37	31.26	24.96	24.96	24.96
C-5	200.00	34°18'30"	107.07	194.61	184.79	184.79	184.79	C-22	80.00	118°48'18"	127.94	49.70	135.34	135.34	135.34
C-6	200.00	34°18'30"	128.68	235.05	226.32	226.32	226.32	C-23	50.00	113°48'15"	79.71	10.04	84.71	84.71	84.71
C-7	100.00	33°08'57"	47.61	92.17	90.30	90.30	90.30	C-24	100.00	17°04'10"	16.31	32.77	31.45	31.45	31.45
C-8	100.00	17°08'43"	35.37	90.31	80.00	80.00	80.00	C-25	100.00	26°16'23"	15.67	30.94	30.00	30.00	30.00
C-9	200.00	80°58'10"	80.97	177.88	172.16	172.16	172.16	C-26	100.00	47°45'08"	48.63	51.61	56.79	56.79	56.79
C-10	200.00	80°58'10"	84.44	213.24	204.38	204.38	204.38	C-27	170.00	24°20'30"	34.66	72.27	71.69	71.69	71.69
C-11	240.00	14°36'00"	42.33	403.00	402.20	402.20	402.20	C-28	100.00	24°20'30"	43.13	84.87	84.23	84.23	84.23
C-12	240.00	14°36'00"	42.81	403.00	402.20	402.20	402.20	C-29	300.00	12°28'30"	33.41	50.06	49.86	49.86	49.86
C-13	200.00	80°58'10"	47.36	92.17	90.30	90.30	90.30	C-30	230.00	17°51'32"	23.97	47.63	47.64	47.64	47.64
C-14	200.00	80°58'10"	37.87	74.41	73.76	73.76	73.76	C-31	110.00	3°04'46"	9.15	17.61	17.61	17.61	17.61

Measured Method:

63-12068

3 homes Domestic internal $.04 \times 3 = .12 \text{ cfs}$

irrigation:

$$.5 \text{ acres} \times .03 \text{ cfs} = .015 \text{ cfs} = .02 \text{ cfs}$$

① Original application domestic $.08 \text{ cfs}$ irrigation $.02 \text{ cfs}$

① permit domestic 1/1 12/31 $.08 \text{ cfs}$ (3 homes)

② B/u fee \$50.00 pd 3/25/94 0 - 0.20 cfs 0-20 Af

③ max. allowable
irrigation $\leq .5 \text{ acre @ } .03 \text{ cfs}$

Domestic $.04 \times 3 = .12 \text{ cfs}$ internal

$$④ V_{IR} = .5 \times 4.5 = 2.25 \text{ Afa}$$

$$V_{DR} = .02 \text{ cfs} \times 246 \times 1.9835 = 9.75 \text{ Afa}$$

$$V = 2.25 \text{ Afa}$$

FILED
FEB 26 1952

#1 New Well

THEORETICAL PUMP EFFICIENCY CALCULATIONS

FILE: 63-12068

DATE: 7-DEC-94

COMPLETE BY: SANDY HEMENWAY

HORSEPOWER = 20

PUMP EFFICIENCY = 70%

DYNAMIC LIFT = 55 FEET 45' static + 10'

SYSTEM PRESSURE = 57 PSI per Mr. Schlerf, system runs @ 54-60 psi

QUANTITY = 0.66 CFS

@ time of exam, it was 60 psi

FEB 2 1995

#2 Old well

THEORETICAL PUMP EFFICIENCY CALCULATIONS

FILE: 63-12068

DATE: 7-DEC-94

COMPLETE BY: SANDY HEMENWAY

HORSEPOWER = 15

PUMP EFFICIENCY = 70%

DYNAMIC LIFT = 57 FEET 47' static + 10'

SYSTEM PRESSURE = 57 PSI per Mr. Schlerf, system runs @ 54-60 psi

QUANTITY = 0.49 CFS

JUN 11 1995

FEB 26 1994

FORWARD WHITE COPY TO WATER RESOURCES

IDAHO DEPARTMENT OF WATER RESOURCES

well #1

WELL INSPECTION FORM

1. DRILLING PERMIT NO: 63-93-W-1047-⁰⁰⁰ OTHER APPLICABLE NO: WR# ~~63-08246~~ 63-12068
2. OWNER: Sunny Ridge Water Assn #3 Phone: (208) 466-2463
Address: 702 Fair Ln Nampa, Id 83686
3. WELL LOCATION: Twp 2N, Rge. 2W, Sec. 10, SE 1/4 NW 1/4
County Canyon (Provide sketch map and photo on reverse.)
4. DRILLER: Dennis Phipps Lic. No. 332
When Drilled? 1-28-94
5. WELL CONSTRUCTION:
Casing Diameter 10 inches Water tight cap? ☒ Yes ☐ No Access Port: ☒ Yes ☐ No
Casing $\geq$ 12 inches above ground? ☒ Yes ☐ No - Describe _____
Depth of Casing 236 ft. Method Drilled air rotary/cable
Condition of Well Casing: ☒ Good ☐ Fair ☐ Poor Describe _____
Control Valve? ☒ Yes ☐ No Pressure Gauge: ☒ Yes ☐ No
Condition of Piping and Valving good
Auger to a depth of — ft. Evidence of Annular Seal ☒ Yes ☐ No
Are there obvious construction problems that may be a source for contamination or waste of water?
☐ Yes ☒ No (Describe in Remarks and Attach Photo - On Reverse)
6. HYDROLOGIC INFORMATION:
Depth to Static Water 45 ft. Water Temperature cold °F
Flowing Artesian ☐ Yes ☒ No Pressure: 60 (psi)
Water Sample Taken? ☐ Yes ☒ No If yes, describe purpose _____
Water Quality Measurements/Observations (Describe) —
7. WELL USE:
☒ Domestic ☐ Irrigation ☐ Stock
☐ Test ☒ Municipal/^{multi}domestic ☐ Industrial
☐ Abandoned ☐ Waste Disposal/Injection ☐ Not Used
☐ Other: _____

SEP 7 1994

8. POSSIBLE CONTAMINATION SOURCES:

Is there evidence of Chemigation? ☐ Yes ☒ No

If yes, is there a check-valve present? ☐ Yes ☐ No

Is there a possible source of contamination nearby? ☐ Yes ☒ No

If yes, what Type? _____

How far away from the well is this source? _____


9. REMARKS:

James Hemenway WR Agent
Signature of Dept. Representative & Title

8/3/94
Inspection Date

PHOTOS, DRAWINGS, OTHER ATTACHMENTS:

on another sheet

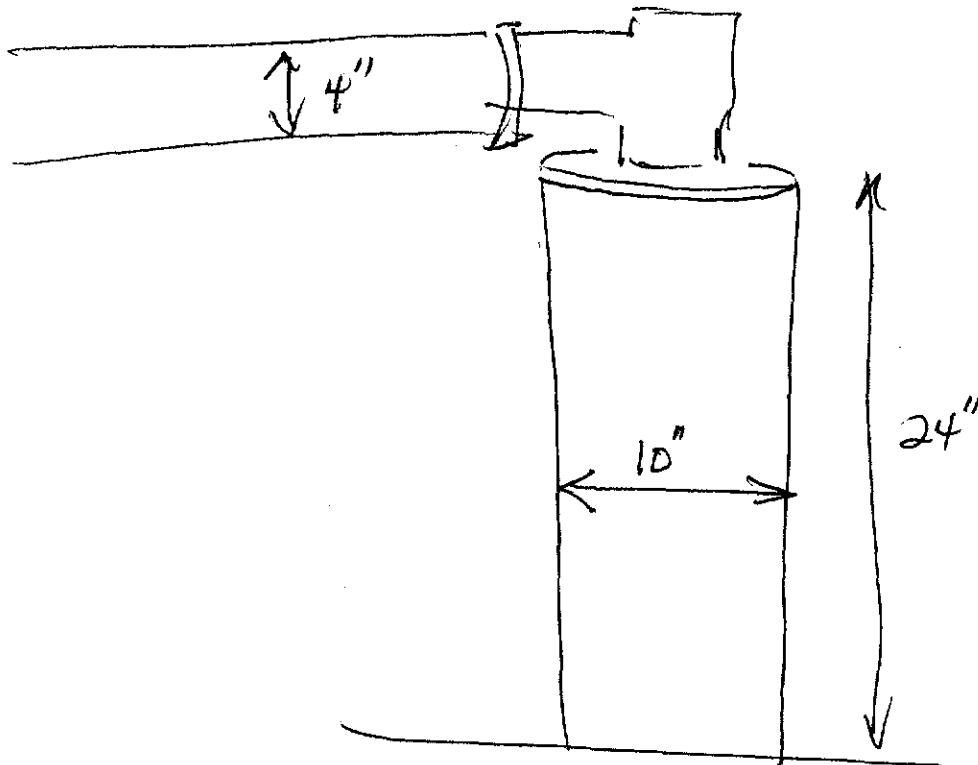

MICROFILM

FEB 26 1998

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORTWell #2
Well LogState law requires that this report be filed with the Director, Department of Water Resources
within 30 days after the completion or abandonment of the well.

1. WELL OWNER

Name Leonard J. Hatcher
Address Sunny Ridge Sub Div.
Owner's Permit No. 13-8296

7. WATER LEVEL

Static water level 47 feet below land surface.
Flowing? ☐ Yes ☐ No G.P.M. flow _____
Temperature _____ °F. Quality _____
Artesian closed-in pressure _____ p.s.i.
Controlled by: ☐ Valve ☐ Cap ☐ Plug

2. NATURE OF WORK

☒ New well ☐ Deepened ☐ Replacement☐ Abandoned (describe method of abandoning)

3. PROPOSED USE

☐ Domestic ☐ Irrigation ☐ Test ☐ Other (specify type)☒ Municipal ☐ Industrial ☐ Stock ☐ Waste Disposal
or Injection

4. METHOD DRILLED

☒ Cable ☐ Rotary ☐ Dug ☐ Other

5. WELL CONSTRUCTION

Diameter of hole 10 inches Total depth 212 feet
Casing schedule: ☐ Steel ☐ Concrete

Thickness	Diameter	From	To
<u>2.80</u> inches	<u>10</u> inches	<u>2</u> feet	<u>9.00</u> feet
_____ inches	_____ inches	_____ feet	_____ feet
_____ inches	_____ inches	_____ feet	_____ feet
_____ inches	_____ inches	_____ feet	_____ feet
_____ inches	_____ inches	_____ feet	_____ feet

Was casing drive shoe used? ☒ Yes ☐ No
Was a packer or seal used? ☒ Yes ☐ No
Perforated? ☐ Yes ☒ No
How perforated? ☐ Factory ☐ Knife ☐ Torch
Size of perforation _____ inches by _____ inches

Number	From	To
_____ perforations	_____ feet	_____ feet
_____ perforations	_____ feet	_____ feet
_____ perforations	_____ feet	_____ feet


Well screen installed? ☒ Yes ☐ No
Manufacturer's name Johnson
Type _____ Model No. _____Diameter 10 Slot size 2000 Set from 200 feet to 212 feet
Diameter _____ Slot size _____ Set from _____ feet to _____ feetGravel packed? ☐ Yes ☐ No Size of gravel _____

Placed from _____ feet to _____ feet

Surface seal depth 25 Material used in sealing ☐ Cement grout☒ Pudding clay ☐ Well cuttingsSealing procedure used ☐ Slurry pit ☐ Temporary surfacecasing ☒ Overbore to seal depth

6. LOCATION OF WELL

Sketch map location must agree with written location.



Subdivision Name _____

Lot No. _____ Block No. _____

County Blaine

SE 1/4 NW 1/4 Sec. 10 T. 2 N. R. 2 E. W.

8. WELL TEST DATA

☐ Pump ☐ Bailor ☐ Other

Discharge G.P.M.	Drawdown	Hours Pumped
<u>Not pumped</u>		

9. LITHOLOGIC LOG

Hole Diam.	Depth		Material	Water	
	From	To		Yes	No
12	0	2	Earth		
12	3	10	Hard pan		
12	10	53	Dark brownish sand		
12	53	78	Sandy clay		
10	78	87	Medium grey sand		
10	87	100	Gravelly sand		
10	100	106	Sandy clay		
10	106	122	Medium grey sand		
10	122	131	Sandy clay		
10	131	162	Medium grey sand		
10	162	187	Gravelly sand		
10	187	200	Medium grey sand		
10	200	212	Gravelly sand		

RECEIVED

JUN 6 1979

Department of Water Resources
Western Regional Office

10.

Work started Feb 25 finished Mar 30 19

11. DRILLERS CERTIFICATION

Firm Name B. B. Brumfield, Inc. Firm No. _____Address 147 Maple Ave Date June 1979

Signed by (Firm Official) _____

and

(Operator) B. B. Brumfield




2 bands
9




4" still
pipe

Well house (well #1)
located in Sunny
Ridge Subdivision
No. 3
(2) 1,000 gal.
holding tanks

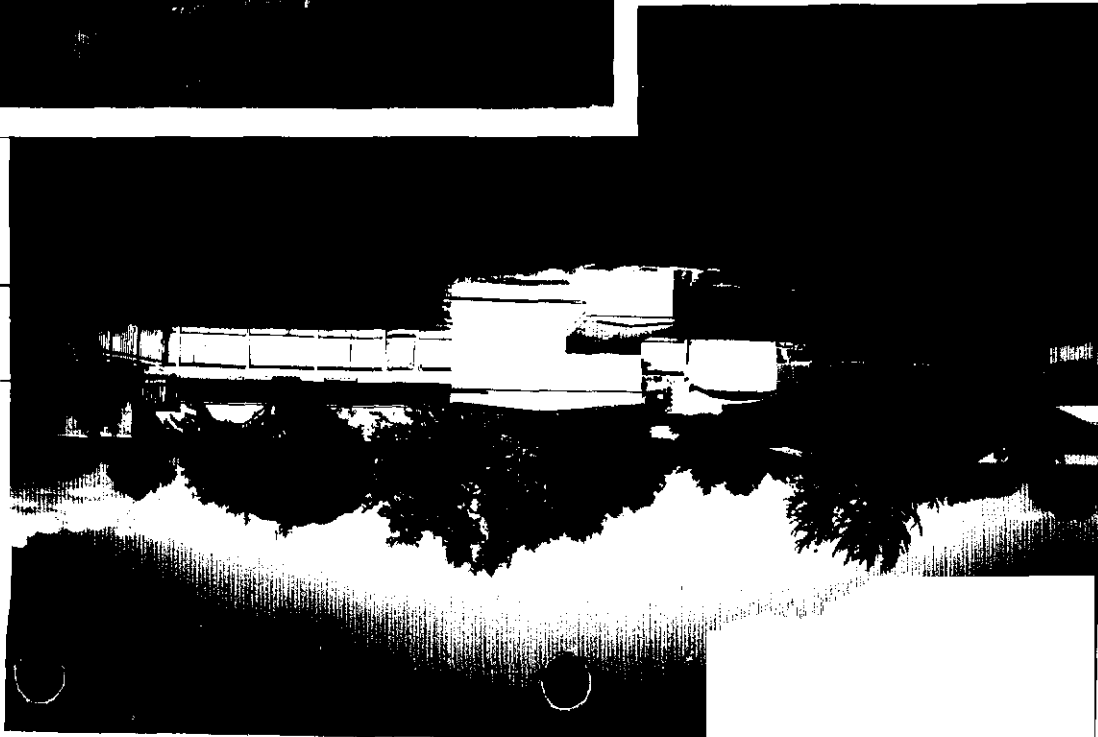


63-12068
8/3/94 S.H.

63-12068
8/3/94 S.H.

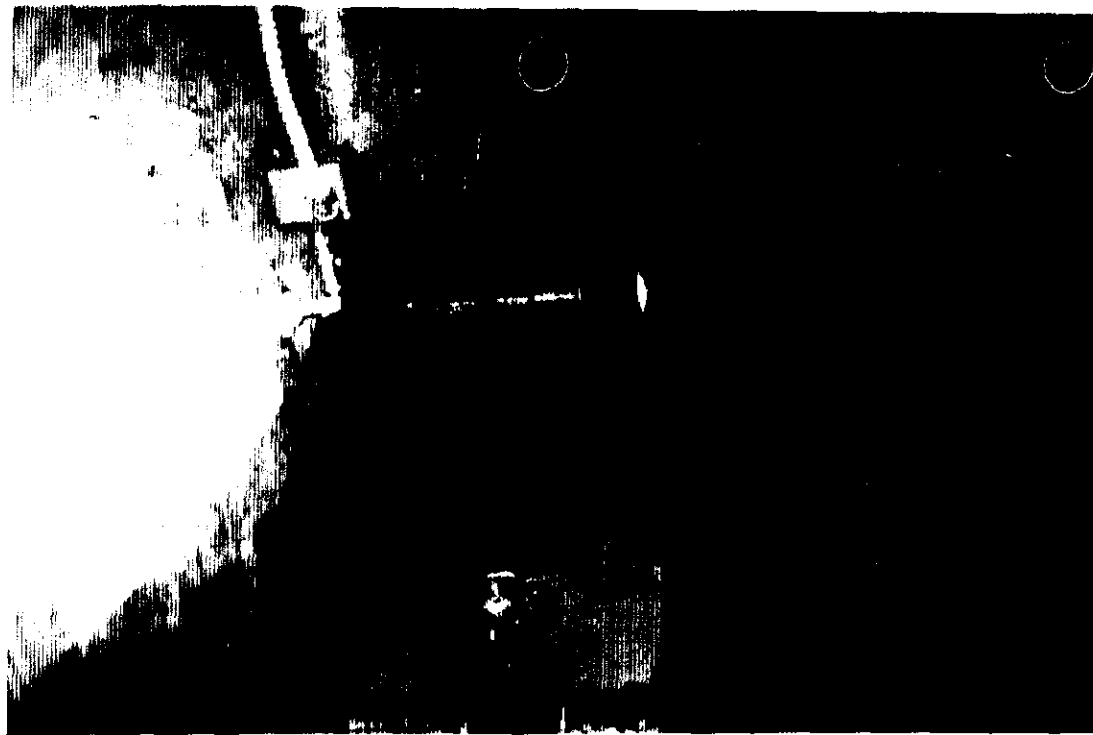

4" pipe
(steel)

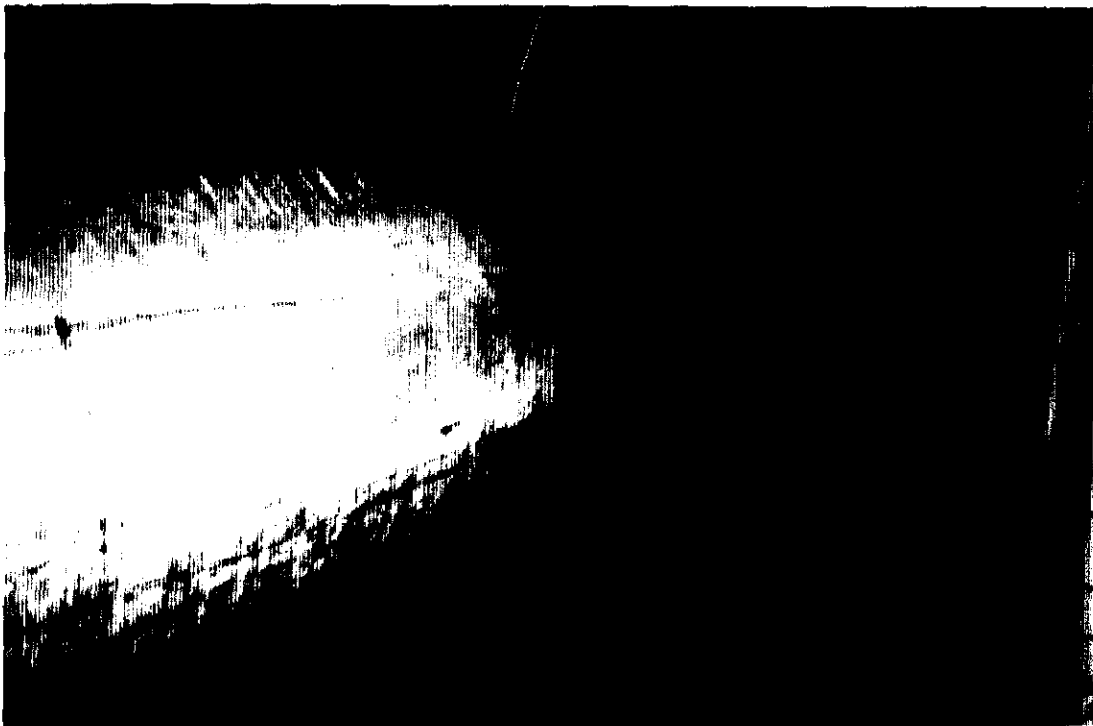


1,000 gal.
holding tanks

pressure gauge
60 psi

4" steel pipe
going from
well (back in
that crawl
space) going
to the holding
tanks

63-12068
8/3/94 S.H.

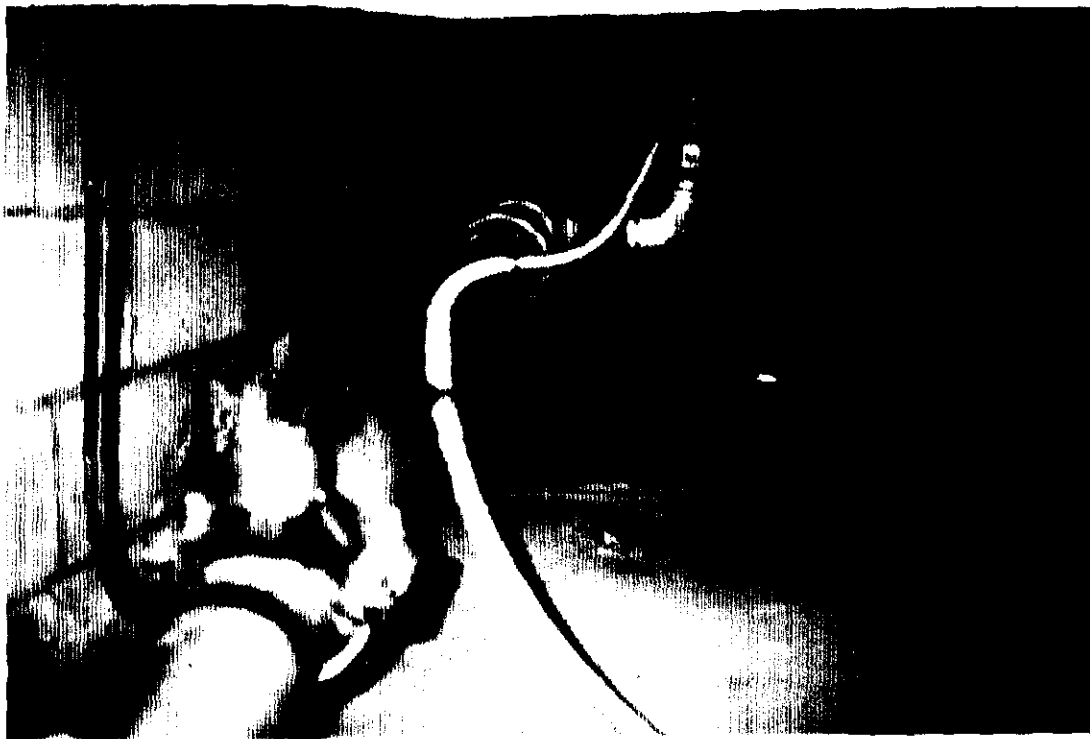

#1 well for
#63-08296
abandoned
well, sealed
off & then
behind it
is the
current
well



#1 well
#63-12068
10" casing
20 HP
70' static
236' depth
50-74 psi

April 7, 1994

SUNNY RIDGE WATER ASSN #3
702 FAIR LN
NAMPA ID 83686

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 63-12068

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water.

If you have questions concerning this matter, please feel free to contact the WESTERN Regional Office in Boise at (208)334-2190.

Sincerely,

JULIE L. YARBROUGH
Senior Secretary

c: IDWR - Region

MAILED
APR 11 1994
FBI - BOISE



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

January 19, 1994

SUNNY RIDGE WATER ASSN #3
702 FAIR LN
NAMPA ID 83686

PERMIT APPROVAL NOTICE

RE: PERMIT NO. 63-12068

Dear Permit Holder(s):

Enclosed is a copy of your approved application for permit. Please be sure to thoroughly review the "CONDITIONS/REMARKS:" listing on the permit.

Enclosed is a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit. Also enclosed is a form entitled "Proof of Beneficial Use". If your project is already completed you should complete and submit this form immediately.

Sincerely,

A handwritten signature in black ink, appearing to be 'Jim Johnson', written over the typed name and title.

JIM JOHNSON
Water Rights Supervisor

JJ:dc

Enclosure

RECEIVED
JAN 19 1994

63-12068

SUNNY RIDGE WATER ASSN #3
702 FAIR LANE
NAMPA, ID 83686

Source: GROUNDWATER

Diversion Pt: SENW Sec 10 T 02N R 02W in CANYON County.

Use: IRRIGATION (.020 CFS)
DOMESTIC (.080 CFS)
Total Diversion: (.080 CFS)

Date Filed: 10/12/1993

In: CANYON County
T02N R02W S10 SENW

1.0 ACRES TOTAL

RECEIVED

JAN 19 1994

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO)
) ss.
 County of Canyon)

Mary B. Scott

of Nampa, Canyon County, Idaho, being first duly sworn, deposes and says:

1. That I am a citizen of the United States of America, and at all times hereinafter mentioned was over the age of eighteen years, and not a party to the above entitled action.

2. That I am the Principal Clerk of the Idaho Press-Tribune, a daily, (except Saturday) newspaper published in the City of Nampa and Caldwell, in the County of Canyon, State of Idaho; that the said newspaper is in general circulation in the said County of Canyon, and in the vicinity of Nampa and Caldwell, and has been uninterruptedly published in said County during a period of seventy-eight consecutive weeks prior to the first publication of the notice, a copy of which is hereto attached.

3. That the notice, of which the annexed is a printed copy, was published in said newspaper
 Two Times

—in the regular and entire issue of said paper, and was printed in the newspaper proper, and not in a supplement.

4. That said notice was published the following dates:

November 3, 10, 1993

Mary B. Scott

STATE OF IDAHO)
)
 COUNTY OF CANYON)

On this 10th day of November in the year of 1993, before me, a Notary Public, personally appeared Mary B. Scott, known or identified to me to be the person whose name subscribed to the within instrument, and being by me first duly sworn, declared that the statements therein are true, and acknowledged to me that he/she executed the same.

Janet Scott
 Notary Public for Idaho
 Residing at Nampa

MY COMMISSION EXPIRES
 JUNE 21st, 1997

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

63-12067

CITY OF WILDER
 219 THIRD ST
 WILDER, ID 83676
 Source: GROUNDWATER
 Diversion Pt: SWSE
 Use: MUNICIPAL

Sec 15 T 04N R 05W in CANYON County.
 (1.120 CFS)
 Total Diversion: (1.120 CFS)

Date Filed: 10/26/1993
 Place of use is within the city limits of Wilder

63-12068

SUNNY RIDGE WATER ASSN #3
 702 FAIR LANE
 NAMPA, ID 83686
 Source: GROUNDWATER
 Diversion Pt: SENW
 Use: IRRIGATION
 DOMESTIC

Sec 10 T 02N R 02W in CANYON County.
 (.020 CFS)
 (.080 CFS)
 Total Diversion: (.080 CFS)

Date Filed: 10/12/1993
 In: CANYON County
 T02N R02WS10
 1.0 ACRES TOTAL
 SENW

Permits will be subject to all prior water rights. Protests may be submitted based on the criteria of Sec. 42-203A, Idaho Code. Protests must be filed with the Director, Dept. of Water Resources, Western Region, 2735 Airport Way, Boise, Idaho 83705 on or before NOVEMBER 22, 1993.

R. KEITH HIGGINSON, Director
 November 3, 10, 1993

RECEIVED

NOV 24 1993

WATER RESOURCES
 WESTERN REGION