

SE NW SW
ZG ZW
SN

MIDDLETON QUADRANGLE
IDAHO
7.5-MINUTE SERIES (ORTHOPHOTOQUAD)



STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
APR 16 1992

Department of Water Resources

A. GENERAL INFORMATION


1. Owner: Rick Hoffer Permit No. 63-11407
Current Address: 12215 Bond; Star, Idaho 83669 Phone No. 286-9249
2. Accompanied by: Rick Hoffer EXAM. DATE: 9-19-91
Address: same Phone No. same
Relationship to Permit Holder: owner
3. Source: groundwater tributary to none

B. OVERLAP REVIEW

1. Other water rights with same place of use: 63-2406, 63-4522, 63-11030
☐ Copies Attached
2. Other water rights with same point of diversion: 63-4522
☒ Copies Attached ☐ Copies of Field Exam's Attached

C. SYSTEM DESCRIPTION

1. **Diversion System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☐ Alternative diagram attached

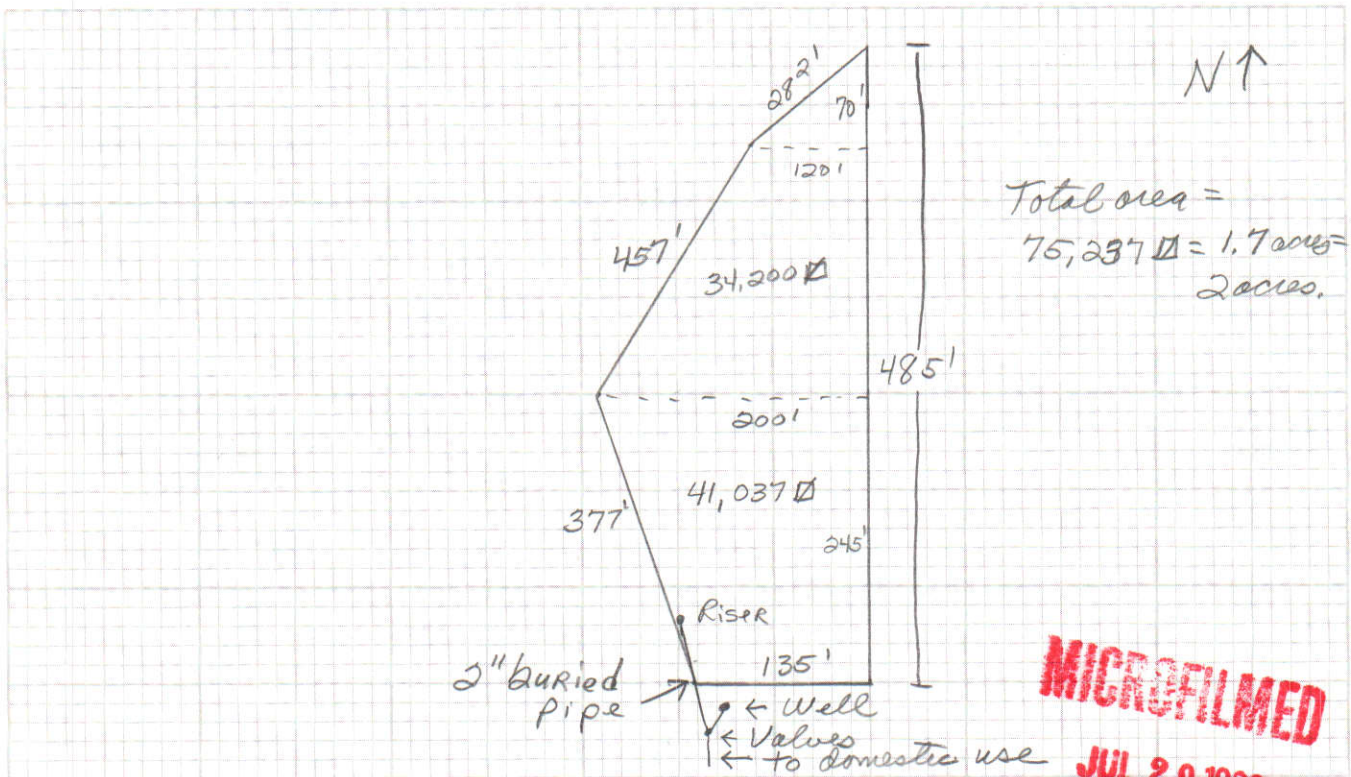

2. ☒ Copy of U.S.G.S. Quadrangle Attached
Showing location(s) of point(s) of diversion and place(s) of use (required).
☒ Photo of Diversion and System Attached
(required for all but single household domestic groundwater, and stockwater).
☐ Aerial Photo Attached
(required for irrigation of 10 acres or more).

MICROFILMED
JUL 29 1992

63-11407



#1

P/D




#2

MICROFILMED

JUL 29 1992

63-11407

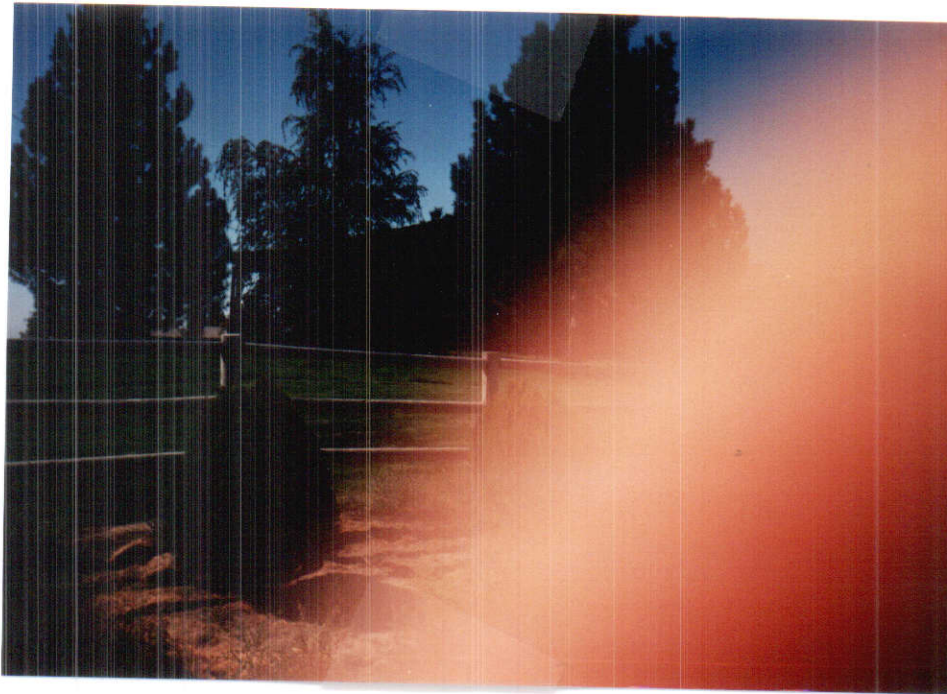

#3
P14



#4
P14

MICROFILMED
JUL 29 1992

R2W RIW

State of Idaho

DEPARTMENT OF WATER RESOURCES

PERMIT 63-11407 INIT

T. R. S. Q/Q

P/D 5N 1W 31 SE SW

SCALE

PHOTO ID.

MIDDLE

7.5-MINUTE

UNITED STATES
DEPARTMENT OF THE INTERIOR
GEOLOGICAL SURVEY

538

R. 2 W. 53

541000-E

542



WATER RIGHT SUMMARY

ACTION	RIGHT NO.	NAME	AMOUNT CFS
Original Application	63-11407	Jerome L. Arehart Deborah G. Arehart	0.19
Full Assignment	63-11407	Richard Hoffer	0.19

RECEIVED

APR 22 1991

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 63-11407

Priority: September 27, 1990

Maximum Diversion Rate:
Maximum Diversion Volume:

0.08 CFS
9.6 AF

This is to certify, that RICHARD HOFFER
12215 BAND DR
STAR ID 83669

has complied with the terms and conditions
of the permit, issued pursuant to Application for Permit dated September 27, 1990; and
has submitted Proof of Beneficial Use on February 4, 1991. An examination indicates
that the works have a diversion capacity of .080 cfs of water from a **GROUNDWATER**
source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
IRRIGATION	03/15 to 11/15	0.06 CFS	9.0 AF
DOMESTIC	01/01 to 12/31	0.04 CFS	0.6 AF
	Totals	0.08 CFS	9.6 AF

LOCATION OF POINT(S) OF DIVERSION:

SESW , Sec. 31, Township 05N, Range 01W
ADA County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
05N	01W	31	NESW 2			2
Total number of acres irrigated:						2

PLACE OF USE: DOMESTIC

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>
05N	01W	31

SESW

CONDITIONS/REMARKS:

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.

MICROFILMED

JUL 29 1992

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 63-11407

CONDITIONS/REMARKS:

5. This right when combined with all other rights shall provide no more than .03 cfs per acre nor more than 4.5 afa per acre for the lands above.
6. The total combined diversion rate under this right and 63-04522 shall not exceed 0.04 cfs.
7. Domestic use is for 1 home.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. Witness the seal and signature of the Director, affixed at Boise, this 16th day of July, 1992.

Acting for R. Keith Higginson, Director

MICROFILMED

JUL 29 1992

State of Idaho
Department of Water Resources
ASSIGNMENT OF PERMIT

RECEIVED
FEB 05 1991
Department of Water Resources

I, Jerome L. Arehart, hereby assign to Richard HOFFER
of 12215 BAND DR. STAR, Idaho. 83669
Address

All my right, title, and interest in and to Permit No. 63-11407
to appropriate the public waters of the State of Idaho.

The following described portion of my right, title, and interest in and
to Permit No. 63-11407 to appropriate the public waters of the
State of Idaho.

(Describe that portion of the permit being assigned by listing the acreage
within each 40 acre subdivision, the point of diversion and the amount of
water in cubic feet per second for direct diversion, or acre feet for storage)

Irrigation					
TWN	RGE	SEC	ACRES	ACRES	TOTAL
05N	01W	31	NESW 2.5	SESW 2.5	5
DOMESTIC					
TWN	RGE	SEC			
05N	01W	31			

Made this 26 day of January, 1991.

Jerome L. Arehart
Permit Holder

Deborah G. Arehart
Spouse of Permit Holder

State of Idaho)
County of Ada) ss

On this 4th day of February, 1991, personally
appeared before me the signer(s) of the above instrument, who duly acknowledged
to me that he (~~she~~) (~~they~~) executed the same. JEROME L. AREHART

s e a l

Beatrix H. Jones
Notary Public residing at
Bain, Idaho

My commission expires:

6-4-91

MED
APR 22 1991

State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 63-11407

Proposed Priority: September 27, 1990 Maximum Diversion Rate: 0.19 CFS

This is to certify, that **JEROME L. AREHART**
DEBORAH G. AREHART
1225 BAND
STAR, ID 83669

has applied for a permit to appropriate water from: **GROUNDWATER**
and a permit is **APPROVED** for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
IRRIGATION	03/15 to 11/15	0.15 CFS
DOMESTIC	01/01 to 12/31	0.04 CFS
	Totals	0.19 CFS

LOCATION OF POINT(S) OF DIVERSION: SESW Sec. 31, Township 05N, Range 01W
ADA County

<u>PLACE OF USE:</u>	<u>IRRIGATION</u>			
<u>TWN RGE SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
05N 01W 31	NESW 2.5	SESW 2.5		5
		Total number of acres irrigated:		5

PLACE OF USE: DOMESTIC
TWN RGE SEC
05N 01W 31 SESW

CONDITIONS/REMARKS:

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before January 1, 1992.
2. Subject to all prior water rights.
3. Permit holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
4. The rate of diversion of water for irrigation under this permit and all other water rights on the same land shall not exceed 0.03 cubic feet per second for each acre of land.
5. Domestic use is for 1 home.

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this

27th day of December, 1990.

RECEIVED

APR 22 1991

Acting for

R. Keith Higginson
R. Keith Higginson, Director

Ident. No. 63-11407

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

1. Name: JEROME L. AREHART 208-286-7397
Address: 1225 BAND
STAR, ID 83669
OR
Name: DEBORAH G. AREHART 208-286-7397
Address: 1225 BAND
STAR, ID 83669
2. Source: GROUNDWATER Trib. to:
3. Location of Point of Diversion: SESW Sec. 31, Township 05N, Range 01W
ADA County
4. Water will be used for the following purposes:

Purpose	From	To	CFS	(or)	AF
IRRIGATION	03/15	11/15	0.150		
DOMESTIC	01/01	12/31	0.040		
5. Total quantity appropriated is:
0.190 CFS (and/or) AF
6. Proposed diverting works:
 - a. Description of ditches, flumes, pumps, headgates, etc.
WELL WITH SUBMERSIBLE PUMP, SPRINKLERS, WELL DRILLED IN 1976
 - b. Height of storage dam feet; active reservoir capacity
acre-feet; total reservoir capacity acre-feet; period of
year when water will be diverted to storage: to inclusive.
 - c. Proposed well diameter is 6 inches; proposed depth of well is 415
feet.
 - d. Is groundwater with a temperature greater than 90F being sought? NO
7. Time required for the completion of the works and application of
the water to the proposed beneficial use is 1 years.
8. Description of proposed uses:
DOMESTIC USE FOR 1 HOME AND IRRIGATION OF 5 ACRES

RECEIVED

APR 22 1991

Ident. No. 63-11407
Page 2

9. Place of Use: IRRIGATION

TWN	RGE	SEC	ACRES	ACRES	ACRES	TOTAL
05N	01W	31	NESW 2.5	SESW 2.5		5

Place of Use: DOMESTIC

TWN	RGE	SEC	
05N	01W	31	SESW

Total number of acres irrigated: 5

10. Describe any other water rights used for the same purposes.
NONE

11. a. Who owns the property at the point of diversion?

APPLICANT

b. Who owns the land to be irrigated or place of use?

APPLICANT

c. If the property is owned by a person other than the applicant,
describe the arrangement enabling the applicant to make this filing.

12. Remarks:

13. Map of proposed point of diversion and place of use attached? []

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.


Applicant

Received by Ys. CJ Date 9/28/90 Time 1:25pm Preliminary check by GG

Fee \$ 30.00 Receipted by CJ # CD18456 Date 9-27-90

Publication prepared by GG Date 10/10/90 Published in ID Statesman
10/18 & 10/25/90

Publication approved st Date 11-2-90

FILMED
APR 22 1991

USE TYPEWRITER OR
BALL POINT PEN

State of Idaho
Department of Water Resources

WELL DRILLER'S REPORT

State law requires that this report be filed with the Director, Department of Water Resources within 30 days after the completion or abandonment of the well.

1. WELL OWNER Name <u>Ron Dilling</u> Address <u>Idaho, Td.</u> Owner's Permit No. _____	7. WATER LEVEL Static water level <u>158</u> feet below land surface Flowing? ☐ Yes ☒ No G.P.M. flow _____ Temperature _____ ° F. Quality _____ Artesian closed-in pressure _____ p.s.i. Controlled by ☐ Valve ☐ Cap ☐ Plug																																																																																																																												
2. NATURE OF WORK ☐ New well ☒ Deepened ☐ Replacement ☐ Abandoned (describe method of abandoning) _____	8. WELL TEST DATA ☐ Pump ☒ Bailer ☐ Other <table border="1" style="width: 100%; border-collapse: collapse;"><thead><tr><th>Discharge G.P.M.</th><th>Draw Down</th><th>Hours Pumped</th></tr></thead><tbody><tr><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td></tr></tbody></table>	Discharge G.P.M.	Draw Down	Hours Pumped																																																																																																																									
Discharge G.P.M.	Draw Down	Hours Pumped																																																																																																																											
3. PROPOSED USE ☐ Domestic ☐ Irrigation ☐ Test ☐ Other (specify type) _____ ☐ Municipal ☐ Industrial ☐ Stock ☐ Waste Disposal or Injection	9. LITHOLOGIC LOG <table border="1" style="width: 100%; border-collapse: collapse;"><thead><tr><th rowspan="2">Hole Diam.</th><th colspan="2">Depth</th><th rowspan="2">Material</th><th colspan="2">Water</th></tr><tr><th>From</th><th>To</th><th>Yes</th><th>No</th></tr></thead><tbody><tr><td>6"</td><td>0</td><td>5</td><td>Top Soil</td><td> </td><td> </td></tr><tr><td> </td><td>5</td><td>30</td><td>Sandy clay</td><td> </td><td> </td></tr><tr><td> </td><td>30</td><td>80</td><td>Clay</td><td> </td><td> </td></tr><tr><td> </td><td>80</td><td>100</td><td>Heavy Sand</td><td> </td><td> </td></tr><tr><td> </td><td>100</td><td>115</td><td>Clay</td><td> </td><td> </td></tr><tr><td> </td><td>115</td><td>130</td><td>Gravel</td><td> </td><td> </td></tr><tr><td> </td><td>130</td><td>150</td><td>Sandy clay</td><td> </td><td> </td></tr><tr><td> </td><td>150</td><td>160</td><td>Sand</td><td> </td><td> </td></tr><tr><td> </td><td>160</td><td>200</td><td>Sandy clay</td><td> </td><td> </td></tr><tr><td> </td><td>200</td><td>225</td><td>Sand</td><td> </td><td> </td></tr><tr><td> </td><td>225</td><td>250</td><td>Sandy clay</td><td> </td><td> </td></tr><tr><td> </td><td>250</td><td>275</td><td>Sand</td><td> </td><td> </td></tr><tr><td> </td><td>275</td><td>300</td><td>Sandy clay</td><td> </td><td> </td></tr><tr><td> </td><td>300</td><td>325</td><td>Sand</td><td> </td><td> </td></tr><tr><td> </td><td>325</td><td>350</td><td>Sandy clay</td><td> </td><td> </td></tr><tr><td> </td><td>350</td><td>375</td><td>Sand</td><td> </td><td> </td></tr><tr><td> </td><td>375</td><td>400</td><td>Sandy clay</td><td> </td><td> </td></tr><tr><td> </td><td>400</td><td>415</td><td>Blue shale</td><td> </td><td> </td></tr><tr><td> </td><td>415</td><td> </td><td>Sand</td><td> </td><td> </td></tr></tbody></table>	Hole Diam.	Depth		Material	Water		From	To	Yes	No	6"	0	5	Top Soil				5	30	Sandy clay				30	80	Clay				80	100	Heavy Sand				100	115	Clay				115	130	Gravel				130	150	Sandy clay				150	160	Sand				160	200	Sandy clay				200	225	Sand				225	250	Sandy clay				250	275	Sand				275	300	Sandy clay				300	325	Sand				325	350	Sandy clay				350	375	Sand				375	400	Sandy clay				400	415	Blue shale				415		Sand		
Hole Diam.	Depth		Material	Water																																																																																																																									
	From	To		Yes	No																																																																																																																								
6"	0	5	Top Soil																																																																																																																										
	5	30	Sandy clay																																																																																																																										
	30	80	Clay																																																																																																																										
	80	100	Heavy Sand																																																																																																																										
	100	115	Clay																																																																																																																										
	115	130	Gravel																																																																																																																										
	130	150	Sandy clay																																																																																																																										
	150	160	Sand																																																																																																																										
	160	200	Sandy clay																																																																																																																										
	200	225	Sand																																																																																																																										
	225	250	Sandy clay																																																																																																																										
	250	275	Sand																																																																																																																										
	275	300	Sandy clay																																																																																																																										
	300	325	Sand																																																																																																																										
	325	350	Sandy clay																																																																																																																										
	350	375	Sand																																																																																																																										
	375	400	Sandy clay																																																																																																																										
	400	415	Blue shale																																																																																																																										
	415		Sand																																																																																																																										
4. METHOD DRILLED ☐ Cable ☐ Rotary ☐ Dug ☐ Other	10. Work started <u>6/25/71</u> finished <u>10/16/71</u>																																																																																																																												
5. WELL CONSTRUCTION Diameter of hole <u>6"</u> inches Total depth <u>415</u> feet Casing schedule: ☐ Steel ☐ Concrete <table border="1" style="width: 100%; border-collapse: collapse;"><thead><tr><th>Thickness</th><th>Diameter</th><th>From</th><th>To</th></tr></thead><tbody><tr><td><u>1/8"</u></td><td><u>6"</u></td><td><u>18'</u></td><td><u>400'</u></td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td><td> </td></tr></tbody></table> Was casing drive shoe used? ☐ Yes ☐ No Was a packer or seal used? ☐ Yes ☒ No Perforated? ☐ Yes ☒ No How perforated? ☐ Factory ☐ Knife ☐ Torch Size of perforation _____ inches by _____ inches <table border="1" style="width: 100%; border-collapse: collapse;"><thead><tr><th>Number</th><th>From</th><th>To</th></tr></thead><tbody><tr><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td></tr><tr><td> </td><td> </td><td> </td></tr></tbody></table> Well screen installed? ☐ Yes ☒ No Manufacturer's name _____ Type _____ Model No. _____ Diameter _____ Slot size _____ Set from _____ feet to _____ feet Diameter _____ Slot size _____ Set from _____ feet to _____ feet Gravel packed? ☐ Yes ☒ No Size of gravel _____ Placed from _____ feet to _____ feet Surface seal depth <u>18'</u> Material used in seal ☐ Cement grout ☐ Pudding clay ☒ Well cuttings Sealing procedure used ☐ Shurry pit ☐ Temporary surface casing ☐ Overbore to seal depth	Thickness	Diameter	From	To	<u>1/8"</u>	<u>6"</u>	<u>18'</u>	<u>400'</u>																					Number	From	To																																																																																														
Thickness	Diameter	From	To																																																																																																																										
<u>1/8"</u>	<u>6"</u>	<u>18'</u>	<u>400'</u>																																																																																																																										
Number	From	To																																																																																																																											
6. LOCATION OF WELL Sketch map location must agree with written location. N W E S Subdivision Name _____ Lot No. _____ Block No. _____ County <u>Hwa.</u> <u>1/4</u> Sec. <u>10</u> T. <u>4</u> N/S. R. <u>1</u> E/W	11. DRILLERS CERTIFICATION Firm Name <u>Phyllis Well Drilling</u> Firm No. <u>155</u> Address <u>2205 Dunlap</u> Date <u>11/2/71</u> Signed by (Firm Official) <u>Dennis L. Phyllis</u> and <u>Dennis L. Phyllis</u> (Operator)																																																																																																																												

APR 22 1991

63-11407

SE NW SW
26
SW 2W

R2W RIW

MIDDLETON QUADRANGLE
IDAHO
7.5-MINUTE SERIES (ORTHOPHOTOQUAD)

36 32' 30" 38 R. 2 W. 39 300 000 FEET R. 1 W. 40 116° 30' 43° 45'



4843

4842

T5N
R1W

P.D. &
P.U.

750 000
FEET N.

T. 4 N.

T
T

FILED

2, 1991.

42' 30"

The Idaho Statesman

P.O. BOX 40, BOISE, IDAHO 83707

LEGAL ADVERTISING INVOICE

Amount Due

65.24

Account Number 47628		Identification Notice of Application for Water Right	
Ordered By Gail Garrett	P.O. Number	Rate nt	Run Dates October 18, 25, 1990
Idaho Department of Water Resources Western Region 2735 Airport Way Boise ID 83705		Estimated Inches	Real Inches
		# Affidavits 1	Legal Number 6769

NOTICE OF APPLICATION FOR WATER RIGHT

The following applications have been filed to appropriate the public waters of the State of Idaho:

63-11407
AREHART, JEROME
AREHART, DEBORAH G.
1225 BAND
STAR, ID 83669
Source: GROUNDWATER
Diversion Pt: SESW Sec 31 T 05N R 01W
Use: IRRIGATION (.150 CFS)
Use: DOMESTIC (.040 CFS)
Total Diversion: (.190 CFS)
Date Filed: 9/27/1990
In: T05N R01W S31 NESW SESW
5.0 ACRES TOTAL

63-11408
QUENZER, EUGENE
QUENZER, ARDYCE
3680 N. BLACK CAT RD.
MERIDIAN, ID 83642
Source: GROUNDWATER
Diversion Pt: NESE Sec 31 T 04N R 01E
Use: IRRIGATION (1.600 CFS)
Total Diversion: (1.600 CFS)
Date Filed: 10/1/1990
In: T04N R01E S31 NESE NWSE
80.0 ACRES TOTAL

63-11410
YELLOW FREIGHT SYSTEM INC.
10990 ROE AVE.
OVERLAND PARKS, KS 66207
Source: GROUNDWATER
Diversion Pt: SESENE Sec 8 T 03N R 01E
Use: IRRIGATION (.096 CFS)
Total Diversion: (.096 CFS)
Date Filed: 8/14/1990
In: T03N R01E S08 SENE
3.2 ACRES TOTAL

The permit(s) will be subject all prior water rights. Protests may be filed with the Director, Dept. of Water Resources, Western Region, 2735 Airport Way, Boise, Idaho 83705 on or before NOVEMBER 5, 1990.

R. Keith Higginson, Director
Pub. Oct. 18, 25, 1990 6769

Debbie Holsclaw

, being duly sworn, deposes and says: That she is the Principal Clerk of The Idaho Statesman, a daily newspaper printed and published at Boise, Ada County, State of Idaho, and having a general circulation therein and which said newspaper has been continuously and uninterruptedly published in said County during a period of twelve consecutive months prior to the first publication of the notice, a copy of which is attached hereto; that said notice was published in The Idaho Statesman in conformity with Section 60-108, Idaho Code as amended, for 2

☒ consecutive weekly ☐ consecutive daily ☐ single ☐ odd skip

insertion(s) beginning with the issue of October 18, 1990

and ending with the issue of October 25, 1990

Debbie Holsclaw

STATE OF IDAHO)

ss.

COUNTY OF ADA)

On this 25th day of October in the year of 1990, before me, a Notary Public, personally appeared Debbie Holsclaw, known or identified to me to be the person whose name subscribed to the within instrument, and being by me first duly sworn, declared that the statements therein are true, and acknowledged to me that she executed the same.

Notary Public for Idaho
Residing at Boise, Idaho

My commission expires: 12/93

APR 22 1991

July 20, 1992

RICHARD HOFFER
12215 BAND DR
STAR ID 83669

RE: WATER RIGHT NO. 63-11407

Dear Water Right Holder(s):

Enclosed herewith is a copy of the Water Right License issued on the above referenced permit.

Sincerely,

PAMELA SKAGGS
Water Resource Agent

PS:cz

Enclosure

MICROFILMED

JUL 29 1992

June 17, 1992

RICHARD HOFFER
12215 BAND DR
STAR ID 83669

RE: WATER RIGHT NO. 63-11407

Dear Water Right Holder(s):

Enclosed is a draft copy of the license proposed to be issued on the above referenced water right.

This right is currently being reviewed by this office for licensing. The enclosed preliminary copy is subject to change upon further administrative review.

We ask that you review the proposed license and if you do not concur with the information, please let us know within 10 days.

Sincerely,

PAMELA SKAGGS
Water Resource Agent

PS:cz

Enclosure

MICROFILMED
JUL 29 1992

LICENSE REVIEW CHECKLIST

Permit # 63-11407

Date 6-9-82
28

	Yes	No	
NAME	☐	☒	Address Change?
PRIORITY DATE	☐	☒	Advance? _____
	☐	☒	Memo to Advance _____
	☐	☒	Order to Reinstate Needed? _____
TOTAL CFS	☐	☒	Incorrect Fee for rate recommended? _____
	☐	☒	Disagree with Actual Measurement? _____
	☐	☒	<u>2 x .03 = .06 cfs (IRR) .04 cfs (DOM)</u>
	☒	☐	Disagree with Theoretical? <u>.11 cfs w/ estimates</u>
	☒	☐	Limited by Capacity? <u>.08 cfs (Measured)</u>
TOTAL VOLUME			Rate/ac <u>4.5</u> AFA Irr. Season <u>D</u>
			<u>3-15 to 11-15</u> Standard Irr. Season
			<u>Same Per Permit</u> Season Recommended
	☐	☒	Disagree with Examiner's Calculations? _____
	☐	☒	<u>2 x 4.5 = 9.0 afa (IRR) .6 afa (DOM)</u>
			Limited by Flow? <u>.06 x 245 x 1.9835 = 29.2 > 9.0</u>
SOURCE	☐	☒	Changes? Clarification of <u>Originally</u>
	☐	☒	<u>Intended</u> source _____
	☐	☒	Notice of Intent to Void. _____
P/D			Verify with Map
	☐	☒	Amendment Needed? <u>2 Acres/NESW per FE</u>
	☐	☒	Is Overlap Analysis a Consideration? _____
P/U			Verify with Map
	☐	☒	Amendment Needed? _____
	☐	☒	Is Overlap Analysis a Consideration? _____
USES	☐	☒	Change(s) in Nature of Use? _____
	☐	☒	Amendment Needed? _____
REMARKS	☐	☒	Multiple P/Ds in 1/4 1/4? _____
	☒	☐	Non-Irr. Uses <u>DOM/home</u>
	☒	☐	Special Overlap Condition <u>63-4522/Total Div=.08</u>
	☒	☐	Other <u>P/U</u>
CONDITIONS	☐	☒	Measuring Device
	☐	☒	W/Master Control
	<u>R52</u>	☐	Overlap
	☐	☒	Water Quality
			DATES/MISC
		☒	Water Dist.
		☒	App Rec'd
		☒	Exam Made

COMMENTS/MEMOS NEEDED: Reduced Acres & rate
Diversion rate limited by capacity .08/.10 allowable

License ☐ 10-Day ☒ 15-Day ☐ Special Correspondence _____

WR0749NP
No. L63-11407

IDAHO DEPARTMENT OF WATER RESOURCES
WATER RIGHT PROFILE REPORT
(REGIONAL)

DATE: 06/10/92
PAGE: 2

=====

Dates:	App. Received:	09/27/1990	Priority Date:	09/27/1990
	Proof Due Date:	01/01/1992	Proof Made Date:	02/04/1991
	Exam Made Date:	09/19/1991	Exam Sent to S.O.:	04/15/1992
	Licensed Date:			

Misc:	Water District Number:	Field Exam Fee: R (Received)
-------	------------------------	------------------------------

Audit:	06/10/92 SKAGGS
--------	-----------------

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
APR 16 1992

Department of Water Resources

A. GENERAL INFORMATION


1. Owner: Rick Hoffer Permit No. 03-11407
Current Address: 12215 Bond; Star, Idaho 83669 Phone No. 280-9249
2. Accompanied by: Rick Hoffer EXAM. DATE: 9-19-91
Address: same Phone No. same
Relationship to Permit Holder: owner
3. Source: groundwater tributary to none

B. OVERLAP REVIEW

1. Other water rights with same place of use: 03-2406, 03-4522, 03-11030
☐ Copies Attached
2. Other water rights with same point of diversion: 03-4522
☒ Copies Attached ☐ Copies of Field Exam's Attached

C. SYSTEM DESCRIPTION

1. **Diversion System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☐ Alternative diagram attached

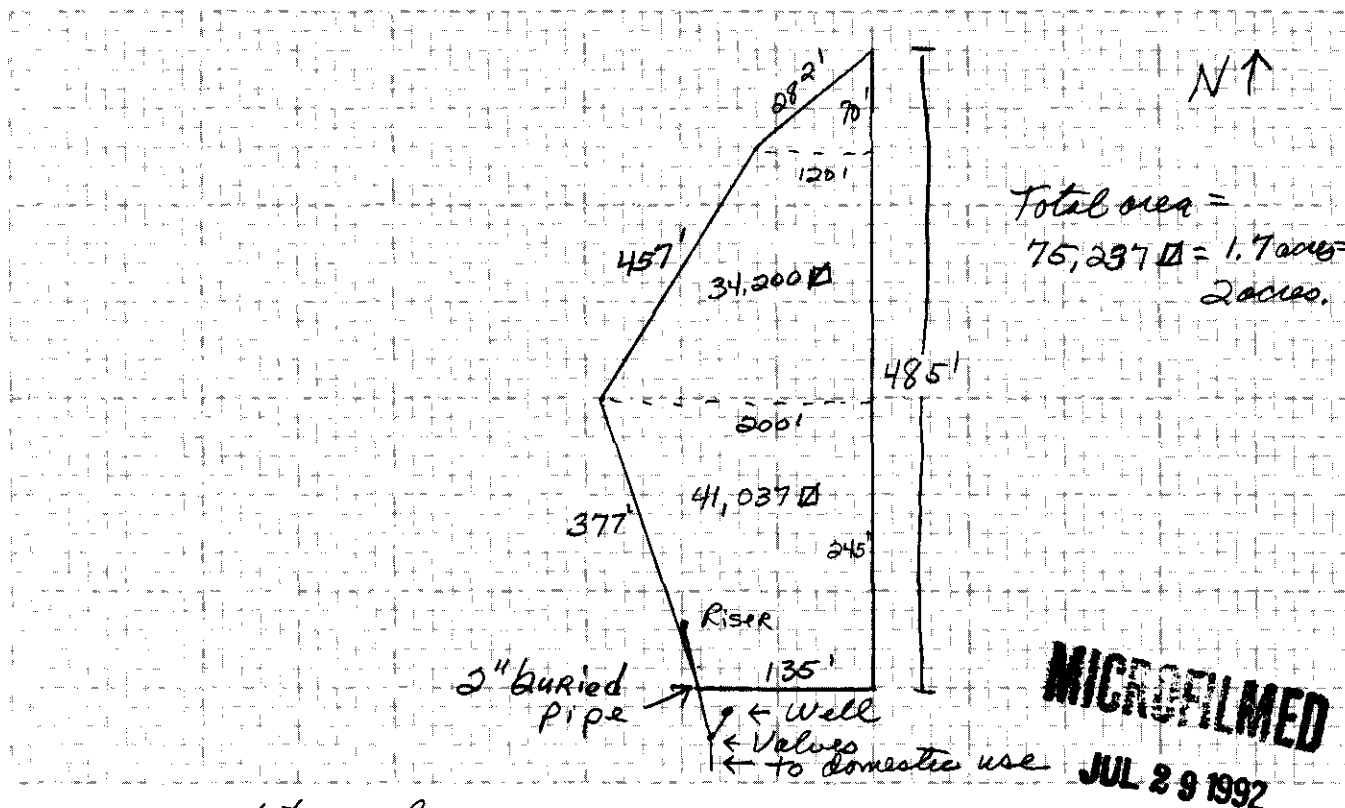

Scale: 1" = not to scale.

2. ☒ Copy of U.S.G.S. Quadrangle Attached
Showing location(s) of point(s) of diversion and
place(s) of use (required).
☒ Photo of Diversion and System Attached
(required for all but single household domestic groundwater, and stockwater.)
☐ Aerial Photo Attached
(required for irrigation of 10 acres or more).

System Description (continued)

3. Narrative: Description (As operating at time of measurement. Indicate pressure, number of sprinklers, etc.)

A well with a 6" casing and a 5 Hp submersible pump directs water to a 2" buried pipe to a valve 40' North of the well. From the Valve a 2" buried pipe delivers water to a riser about 120' Northwest. Irrigation is applied to a 2-acre field by sprinklers or flood from an open 3" handline. At the time of exam one line about 300' long was being used to irrigate a row of trees and some native grass. According to the owner the 2 acres had not been irrigated this season which was evident. This system also provides water

☒ See Remarks on page 4 for continuation

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
	Amstar	5	2821188003	Unknown	1 1/4

*Code to correspond with No. on map and aerial photo

5. Point(s) of Diversion:

Ident. No.	Gov't. Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
			SE	SW	31	5N	1W	Ada	Ortho photo quad map

6. Place(s) of Use:

Indicate Method of Determination

Twp.	Rge.	Sec.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				Totals
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
5N	1W	31									2								2 Ac.

MICROFILMED

JUL 20 1992

Do not use this space

Do not use this space

D. FLOW MEASUREMENTS

☐ Additional Data Sheets Attached

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
5-gallon bucket & stop watch						
sprinkler pressure gauge.						

2. Measurements:

A 5 gallon fill in 10 seconds was completed and pressure readings on 3 sprinklers with double nozzles of $\frac{5}{32}$ " $\frac{1}{4}$ " taken.

E. FLOW CALCULATIONS

☐ Additional Computation Sheets Attached

1. Measured Method:

$\frac{5}{32}$ " @ 20 psi = 3.26 gpm x 3 = 9.78 gpm
 $\frac{1}{4}$ " @ 22 psi = $30 \times (\frac{25}{22})^2 \times (\frac{22}{20})^5 = 8.79 \times 3 = 26.38$ gpm

$\frac{9.78 + 26.38}{36.16}$ gpm = .08 cfs

2. Alternate Method for Checking Purposes:

$\frac{5 \times 8.8 \times .7}{200 + (2.3 \times 40)} = .11$ cfs

F. PUMP EFFICIENCY DATA (Optional)

Discharge Pressure: _____ psi x 2.31 = _____ ft (1); Dynamic pumping level: _____ ft (2)

Total Head: (1) + (2) = _____ (3)

; Flow rate: _____ cfs (4)

Water HP: (3) x (4) $\div$ 8.8 = _____ (5)

Meter Input KW: 3.6 x _____ KH x _____ CTR or _____ MULT x _____ PTR x _____ N/ _____ T = _____ (6)

Meter Input HP: (6) x 1.34 = _____ (7)

Panel Input KW: _____ Ave PF x _____ Ave Volts x _____ Ave Amps x .001732 = _____ (6)

Panel Input HP: (6) x 1.34 = _____ (7) Efficiency: (5)/(7) x 100 = _____ %

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = 2 \times 4.5 = 9$ AC FT/A

$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = .06 \times 246 \times 1.9835 = 29.8$ AC FT/A

$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = 9$ cfs

2. Volume Calculations for Other Uses:

NA

MICROFILMED

JUL 29 1992

H. REMARKS AND OVERLAP REVIEW ANALYSIS

for a single domestic use under claim 63-4522. A 5 gal bucket fill in 10 seconds and sprinkler head measurements taken on 3 heads with double nozzles of $\frac{5}{32} \times \frac{1}{4}$.

The domestic component on this permit should be deleted because it is covered under claim 63-4522 and adjudication. Claim # A63-4522 The system capacity is .08 cfs per actual measurement. This right and 63-4522 combined should not exceed .08 cfs. 63-11030 is a right next door to this permit with no effect.

I. RECOMMENDATIONS

1. Recommended Amounts


Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
Irrigation	3-15	11-15	.06 cfs	9.0 cfs
Totals:			.06 cfs	9.0 cfs

2. Recommended Amendments

- ☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☐ None
☒ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

J. AUTHENTICATION

Field Examiner's Name Melvin T. Schulte
JFW 2/18/92 Signature Melvin T. Schulte
Certification Date _____
Field Report Preparation Date 1-16-92

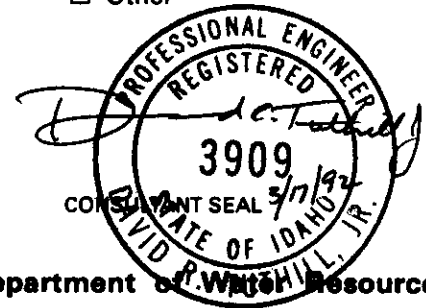

- K. Licensing recommendation shall be prepared by an Idaho Department of Water Resources employee on a computer printout attached hereto.

MICROFILMED

JUL 29 1992

IRRIGATION RIGHT FROM A GROUND WATER SOURCE

A theoretical calculation is necessary to determine if a measurement is required for irrigation from a groundwater source.

=====

1. Using the found acres (or an estimate by the permit holder) calculate the acre-foot per annum limit. This is the volume that the system must be able to theoretically produce to exclude a rate of flow measurement.
2. Next, given the pump hp and the estimated dynamic water level, calculate the theoretical rate of flow that the system can produce.
3. Using the rate found in step 2 and the days in the permitted irrigation season, calculate the theoretical AFA that the system could produce. This volume is then compared to the first AFA calculation. If the theoretical volume (step 3) is greater than the irrigation requirement volume (step 1) then no measurement is necessary. If it is less, then you must make a diversion rate measurement during the field examination.

1.
$$\frac{2}{\text{Found Acres}} * \frac{4.5}{\text{Irr. Req.}} = \frac{9}{\text{AFA}}$$
2.
$$\frac{(5) \text{HP} * 8.8 * (.7) \text{EFF}}{(200) \text{Dyn Level} + (2.3 * (40) \text{PSI})} = \frac{.11}{\text{Theor. Div. Rate}} \text{ CFS}$$
3.
$$\frac{.11}{\text{Theoretical Div. Rate}} * \frac{246}{\text{Days in season}} * 1.9835 = \frac{53.7}{\text{AFA}}$$

Note: for electrical motors
EFF = 0.70
for diesel motors
EFF = 0.60

Data Requires Verification ☐
Measurement Required ☒
Measurement Not Required ☐

Calculation data sources:

Found acres = 2 - pacing
 HP = 5 - motor plate
 Dyn Level = 200 - estimated based on well logs for area
 PSI = 40 - per gauge at pressure tank for home.

MICROFILMED
 JUL 29 1992

Department of Water Resources

WELL INSPECTION FORM

If well is associated with water right, provide WR# 63-11407

Otherwise provide legal description and a sketch map and/or address so that the well can be located easily.

1. Legal Description: TWP 5N, Rge 1W, Sec. 31, SE 1/4 SW 1/4 or Lot _____.

2. Owner: Rick Hoffer
Address 12215 Bondi St, City _____, St. Al.

3. Casing $\geq$ 12 inches above ground: Yes ☒ No _____

4. Access Port: Yes _____ No ☒ Static Water Level: 185' - 1st.
Pressure Gauge: Yes ☒ No _____ Casing Diameter: 6"
Flowing: Yes _____ No ☒ Temperature: _____

5. Are there any obvious construction problems that may be a source for contamination or waste of water: Yes _____ No ☒

If answer to Item 5 is Yes, describe in remarks and attach photo.


Remarks: _____

RECEIVED
JUL 29 1992

63-11407



#1
P/D




#2


MICROFILMED

JUL 29 1992

63-11407



#3
P14

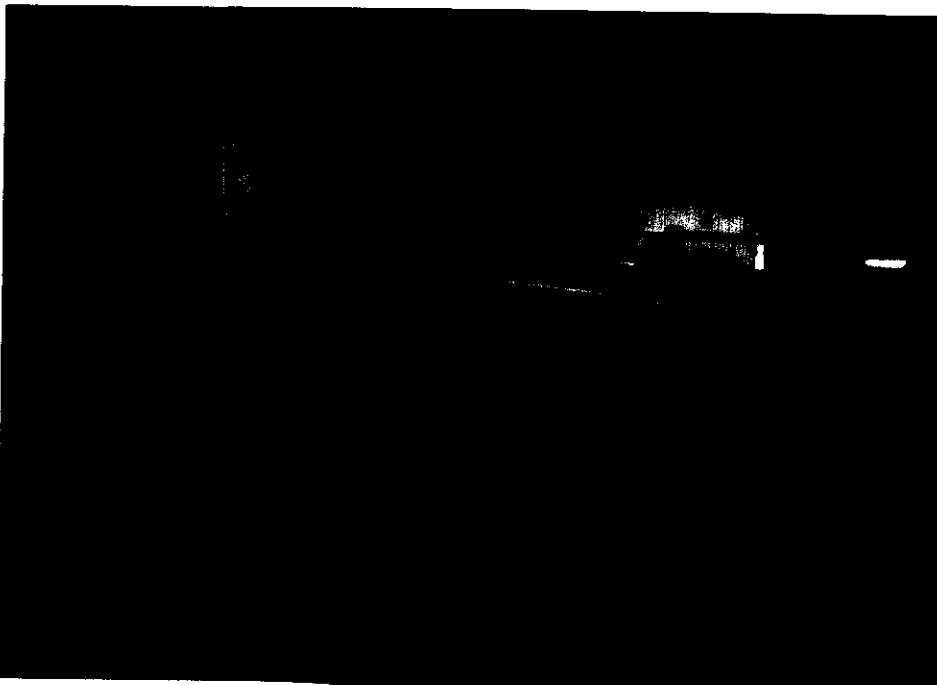

#4
P14

RECORDED
JUL 29 1963

R2W RIW

State of Idaho
DEPARTMENT OF WATER RESOURCES

PERMIT 63-11407 INIT

MIDDLE T. R. S. 0/0

P/D 5N 1W 31 SE 50

SCALE

7.5-MINUTE PHOTO ID.

UNITED STATES
DEPARTMENT OF THE INTERIOR
GEOLOGICAL SURVEY

538

R. 2 W. 50

541000mE

542

2734

2791

Gulch

30

29

MICROFILMED

JUL 29 1992

F/U

P/D

UNION

2544

2558

April 12, 1991

RICHARD HOFFER
12215 BAND DR.
STAR, ID 83669

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 63-11407

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water.

If you have questions concerning this matter, please feel free to contact the STATE Regional Office in Boise at (208)327-7900.

Sincerely,

Rita Fleck
Secretary/Records Manager

c: IDWR - Region

4ED

APR 22 1991

ANALYSIS SHEET
for
PROOF OF BENEFICIAL USE

Permit No. 63-11407

Date 4-11-91

GENERAL CONSIDERATIONS

- ☒ Name same as permit?
☒ Address same as permit? If no, indicate below.
☒ Proof timely received? If no, complete priority advancement below.

SOURCE OF WATER

- ☐ Surface water source
☒ Ground water source
NA Drill permit req'd?
1977 ☒ Copy in file? Drill permit no. _____
☒ Amt paid for drilling permit? _____ Correct?
☒ Well log in file?

LICENSE EXAMINATION FEE

- ☒ Required?
50.00 ☒ Amount submitted?
☒ Correct amount?

MEASURING DEVICE

- NO ☐ Measuring device or access port required?
☒ Installed?
☒ Waiver requested or needed?

DEFICIENCIES OR ACTION ITEMS

proof acceptable

PRIORITY CALCULATION

Date proof received	<u>NA</u>	_____
Date proof due	_____	- _____
No. of days late	_____	= _____
Priority date	_____	+ _____
NEW PRIORITY DATE	_____	= _____

LB

For Office Use Only
 Amt. of Fee \$ 50.00
 Date 2-4-91
 Receipt No. CD19510
 Received by ay

07
RECEIVED
 FEB 04 1991

STATE OF IDAHO

DEPARTMENT OF WATER RESOURCES

Department of Water Resources

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources will consider this form as a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 63-11407 HOME 286-9249
 Telephone No. 343-3663 Work

2. Name(s) of Permit Holder(s): RICK HOFFER (WARRY ABELHART)

3. Post Office Address: 12215 W. BOND STOR IDAHO

4. Source of Water: WELL GROUND WATER

a. If ground water, well driller's name: _____ Date drilled: 1977

b. Pump horsepower: 5 Pressure (psi): 50 Dynamic pumping level (ft.): _____

5. Extent of Use:

Domestic 1 (No. of households)

Irrigation 5 (No. of acres)

Stockwater _____ (No. and type of stock)

Other _____

6. Total rate and/or volume for which proof is submitted .19 cfs _____ acre/feet

7. Refer to the approval conditions on your permit and respond accordingly:

Measuring device: Required? Yes No Installed? Yes No

OR

Flow Measurement Port: Required? Yes No Installed? Yes No

8. Fee Enclosed: \$ 50.00 (See License Examination Fee Schedule)

9. Person to contact to accompany the Department representative during the field examination:

RICK HOFFER
 Name

Work 343-3663 Home 286-9249
 Telephone No.

12215 W. BOND STOR IDAHO 83669
 Address

10. The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

RECORDED

1-31-91
 Date

Rick Hoffer
 Signature (and title if on behalf of a company or organization)

APR 22 1991

\$50.00

Rick

IN THE PROCESS OF REGISTERING
THE WELL, I ENDED UP WITH A PERMIT
TO APPROPRIATE WATER. I HAVE
SENT IN THE PAPERWORK TO ASSIGN
MY WATER RIGHTS & THE PERMIT OVER
TO YOU.

I AM SENDING YOU THE FORM;
PROOF OF BENEFICIAL USE WHICH YOU
HAVE TO FILL OUT AND PRESENT TO
THE DEPT. OF WATER RESOURCES. THE
PERSON TO TALK TO THERE IS
JIM JOHNSON - 327-7947, THAT
WAY WE WILL BOTH BE WORKING
WITH THE SAME PERSON.

THEIR ADDRESS IS:

1301 NORTH ORCHARD.

Jerry Anchart

888-3162

~~888-3162~~

MAILED 20

APR 22 1991



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720 -(208) 327-7900

CECIL D. ANDRUS

GOVERNOR

R. KEITH HIGGINSON

DIRECTOR

December 31, 1990

JEROME L. AREHART
DEBORAH G. AREHART
1225 BAND
STAR, ID 83669

PERMIT APPROVAL NOTICE

RE: PERMIT NO. 63-11407

Dear Permit Holder:

Enclosed is a copy of your approved application for permit. We direct your attention to the conditions of approval on the final page.

Enclosed is a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit. Also enclosed is a form entitled "Proof of Beneficial Use". If your project is already completed you should complete and submit this form immediately.

Section 42-235, Idaho Code, requires that a "drilling permit" must be obtained from the department for all wells constructed after July 1, 1987. A drilling permit is a separate permit that must be issued in addition to your permit to appropriate water. Commencement of well construction or diversion of water under your permit to appropriate water is prohibited unless a drilling permit is obtained.

You should be aware that you are located within a drainage basin where surface water diversions are regulated by a watermaster. It is possible that diversion of groundwater under your permit may cause a reduction of surface water flow. Siting your well as far as possible from surface water channels and casing your well

MICROFILMED

APR 22 1991

so that groundwater tributary to surface water flows are not diverted will reduce the potential for the watermaster to regulate your water use.

Sincerely,

JIM JOHNSON
Water Rights Supervisor

JJ:blm

Enclosures

MICROFILMED

APR 22 1991

Application #: 63-11407
Date: 12-21-90

Existing:

Complete in 1 year - P16

Proof not submitted - P16

Groundwater:

LT. 0.7 cfs - N/A

Drilling Permit:

Approved w/permit - P99

Not included - 046-P23 (All GW, even existing wells)

Location:

Water Districts - WD No. ~~63~~

Surface water - 005, 005-01H-P01(LT.7 w/pump)
005-01J-P08(GT.7)

Groundwater - P05

Irrigation Districts - 023

Canal Co. Areas - 023

Drainage Districts - 024

Boise Front (63) - 058 (Groundwater)

Swan Falls Flag - (1 or Blank)

Trust - 051-052-053-P74 (Cons.), 041 (DCMI)

Non Trust - 048-049

River Basins:

(Surface Water)	Water District Control Condition &....
-----------------	--

Boise (63) - 11D-P72

Payette (65) - 047-P04, 059-P71

Snake (01, 02 & 03) - 11A-P04(01), 061-P07(02/03 No W.D.Cond.)

Use:

Fish Propagation - 002-P06, 06A, 007, 09E-P10, 010, 042, 044

Power - (less than 25cfs P18), 01F-P19, 08A(Req.).

- Ø17K, Ø17G-Ø17M(Choose One), 025

Mining - 06A, 006, 09E-P10, 010, 54

Storage - 18A-P09 (In W.D.), 18B-P09 (Size)

Domestic - 021(restricted areas)

Ownership:

Non land owner - 004

Protested:

Agreement - 020

Minimum Stream Flow:

Overlapping uses - 029-P20

Beneficial Use Due Date: - 01-01-1992

Other Conditions Recommended

MEMORANDUM

TO: FILE #63-11407

FROM: PAM SKAGGS

RE: DOMESTIC USE

DATE: 21-DEC-1990

=====

A memo from Carter Fritschle dated 10-9-90 suggests the domestic use applied for on this application will be covered by adjudication claim #A63-04522 if it is decreed as claimed. The size and nature of the domestic use creates no problem with it remaining part of this application at this time. During the licensing review the question of overlapping existing water rights can be reconsidered.

MICROFILMED

APR 22 1991

Form No. 202a.
3/89

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPROPRIATION APPLICATION ANALYSIS SHEET

INITIAL REVIEW BY: EE DATE: 10-3-90 APPLICATION: 63-11407

REQUIRED INFORMATION

☒ Name: (If applicant is a corporation or partnership, names and addresses for the director, officers, and other partners must be included.)
☒ Address:
☒ Source: (See USGS Quad for names of water sources)
☒ Point of Diversion: (10 acres for spring, lot & block descriptions for Subdivisions, local name)
☒ County:
☒ Quantity: (flow and/or volume)
☒ Period of use:
☒ Nature of proposed use: (Include description of use)
☒ Description of diverting works:
☒ Time required for beneficial use of water:
☒ Place of use or acres irrigated:
☒ Map:
☒ Signature: (If applicant is corp., partnership, or municipality, title of signatory is required)
☒ Fee:
☒ Yes ☐ No* In form to receipt:

Gov't. Lots:
N/A P/D
N/A P/U

ADDITIONAL INFORMATION

YES NO

☒ ☐ Overlapping place of use: (Describe source & relationship to present application on the back.)
☒ ☐ Overlapping point of diversion:
☐ ☐ Field check required: Field check by: _____
☐ ☐ Field report attached:
☐ ☒ Critical groundwater area:
☐ ☒ Groundwater management area:
☐ ☒ Diversion within interim protected river area
☐ ☒ Send dam safety information:
☐ ☒ Send power requirement letter:
☐ ☒ Send fish farm requirement letter:
☐ ☒ Power residency affidavit:
☐ ☒ Power efficiency form:
☐ ☒ Within trust water boundary: (If yes, attach Trust Water Analysis Sheet.)
☐ ☒ Diversion greater than 5 cfs or 500 af: (If yes, attach Large Diversion supplementary analysis sheet.)
☐ ☒ *REQUEST ADDITIONAL INFORMATION FROM THE APPLICANT

☒ ☐ DATE REQUESTED: _____
☒ ☐ Additional information on reverse side:

RECEIVED
NOV 08 1990

Department of Water Resources

PROCESSING

APPLICATION NO. 63-11407

YES NO

☒ ☐
☐ ☒
☐ ☒

In form for advertising:

Statewide advertising:

Fee amount, receipt number and date recorded on application:

SEND COPIES TO

YES NO

☐ ☒
☐ ☒
☐ ☒
☐ ☒

I.D. Health and Welfare

I.D. Fish and Game

I.D. Lands

Adjudication Bureau

YES NO

☐ ☒
☐ ☒
☐ ☒
☐ ☒

U.S. BLM

U.S. Forest Svc.

Water Dist. # _____

Other _____

FINAL REGIONAL PROCESSING REVIEW

YES NO

☒ ☐
☐ ☒

Affidavit of publication received:

Application published correctly: If not, record action taken.

☒ ☐
☐ ☒
☐ ☒
☐ ☒
☐ ☒
☐ ☒
☐ ☒
☒ ☐

Publication dates and paper recorded on application:

Protests received. Final date for protest November 5, 1990

Protest dates, resolution of protest recorded on application:

Recommendations attached: approve, DW

Measuring device required:

Measuring port required:

Water delivered by water master? District # _____

Special conditions of approval or cover letter: _____

The use under this water right is limited to irrigation of 5 acres. [Domestic use covered by Claim No. A63-04522 per memo from Carter Fritschle dated 10/9/90 in file], 46

☒ See below for additional information

Recommended Date or Priority 9/27/1990

Recommended by: DW Date 11/5/90

STATE OFFICE REVIEW

See below for additional information. By _____ Date _____

ADDITIONAL INFORMATION

Other water rights same legal, but do not appear to be related to this application for the irrigation use.

MEMO

TO: File 63-11407
FROM: Carter Fritschle *CF*
RE: Domestic water use
DATE: 10-9-90

Water Rt File
63-11407
RECEIVED
NOV 02 1990
Department of Water Resources
Western Regional Office

The Arehart's are selling this property, and the buyer is requiring that the water rights be filed on. Because the irrigation use started after March 25, 1963 Mr. Arehart decided to file an Application for Permit instead of an adjudication claim. The domestic use was included in the application because the cost of filing a separate claim for the domestic use (\$25.00 + \$50.00 late fee).

Mr. Arehart telephoned stating that the buyer wanted to have the domestic use claimed separately. I prepared claim A63-04522 for this purpose.

Therefore, if claim A63-04522 is decreed, the domestic use on Water Right No. 63-11407 would be a duplication and should not be recommended.

APR 22 1991

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Western Region
2735 AIRPORT WAY

Boise, Idaho 83705
(208) 334-2190

OCTOBER 10, 1990

The Idaho Statesman
P.O. Box 40
Boise, ID 83707

Dear Legal Dept.:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before NOVEMBER 5, 1990.

Yours truly,

GAIL GARRETT
Secretary

Encl.

RECEIVED
APR 22 1991

63-11407

AREHART, JEROME L.
AREHART, DEBORAH G.
1225 BAND
STAR, ID 83669

Source: GROUNDWATER

Diversion Pt: SESW Sec 31 T 05N R 01W

Use: IRRIGATION (.150 CFS)
 DOMESTIC (.040 CFS)
 Total Diversion: (.190 CFS)

Date Filed: 9/27/ 1990

In: T05N R01W S31 NESW SESW

5.0 ACRES TOTAL

MICROFILMED

APR 22 1991