


603-110742

63-11074

7.5-MINUTE SE



3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

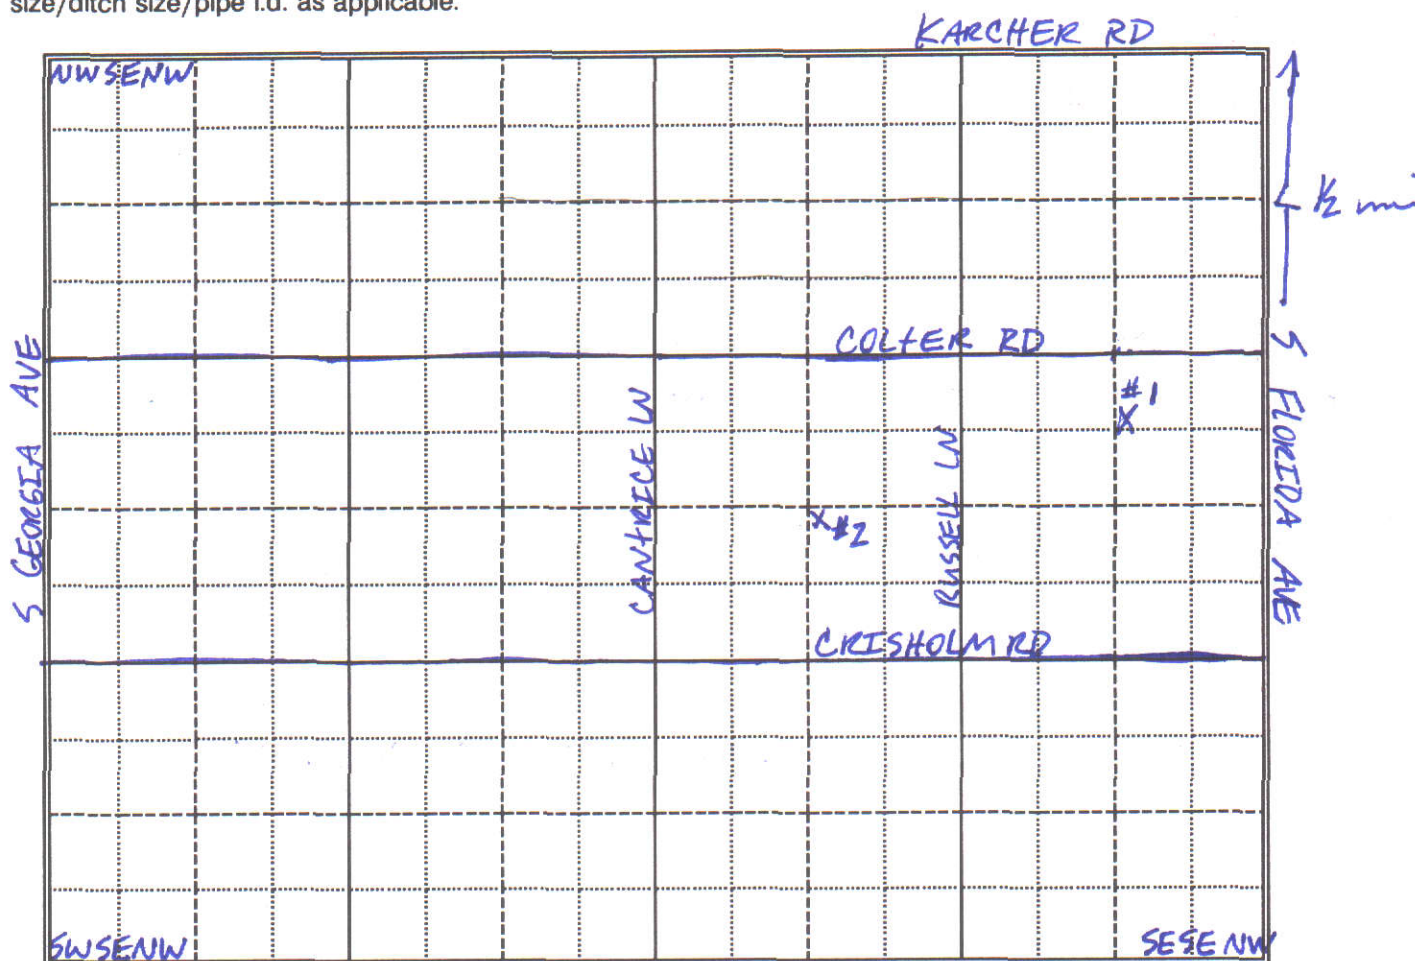

Scale: 1" =

Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

Aerial Photo Attached (required for irrigation of 10+ acres)

Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
#1	submers	15			12"
#2	"	15			10"

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS


1.


Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: Theo

MICROFILMED

JUL 23 1993

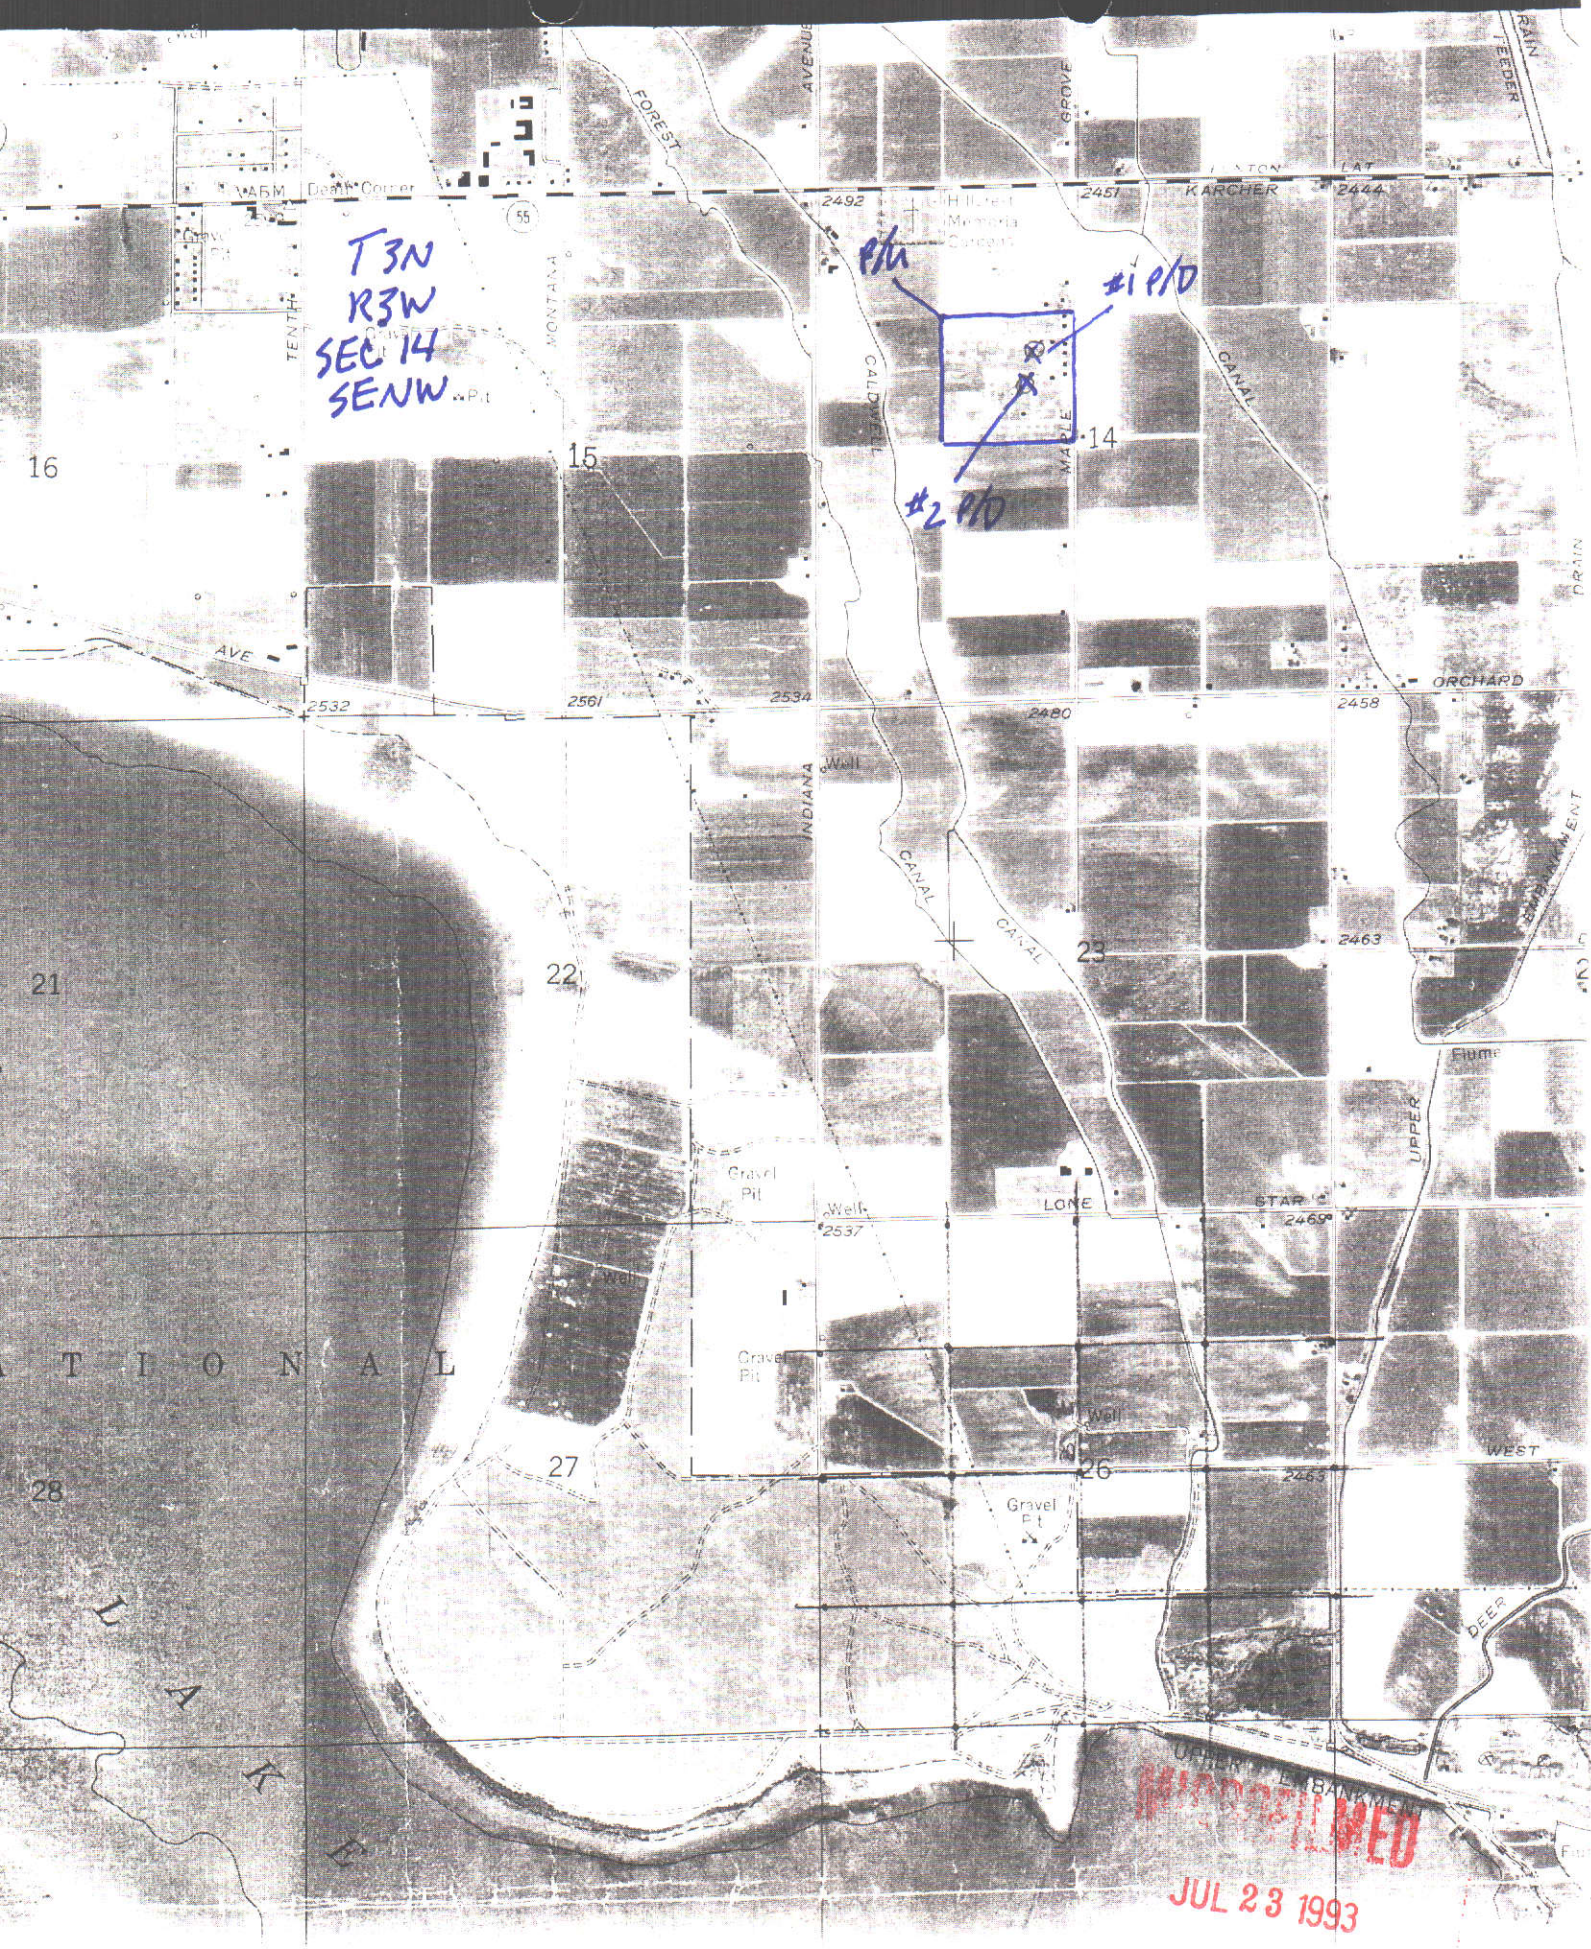

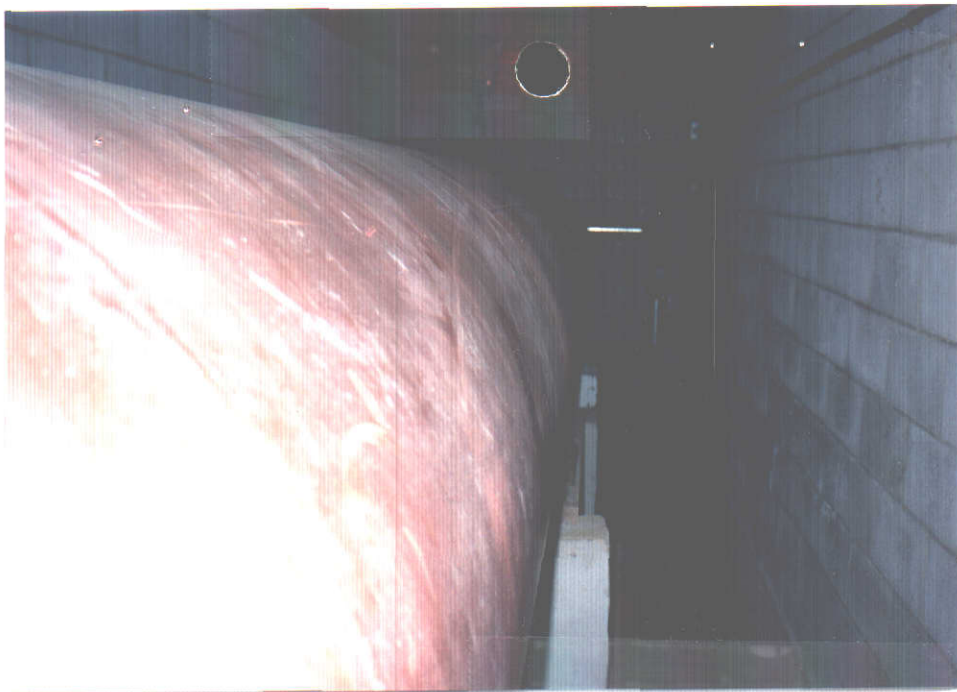

Well #1
+
tank



Well #2
+
tank



ALSO FILMED

JUL 23 1993



P/u
EXAMPLE



STUBBED IN LOT

MICROFILMED
JUL 23 1993

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 63-11074

Priority: December 6, 1989

Maximum Diversion Rate:

0.33 CFS

Maximum Diversion Volume:

42.8 AF

This is to certify, that KARCHER RANCHETTES WATER CORP
15689 CANTRICE LANE
CALDWELL ID 83605

has complied with the terms and conditions
of the permit, issued pursuant to Application for Permit dated November 29, 1989; and
has submitted Proof of Beneficial Use on January 13, 1993. An examination indicates
that the works have a diversion capacity of .960 cfs of water from a **GROUNDWATER**
source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
IRRIGATION	03/15 to 11/15	0.15 CFS	33.8 AF
DOMESTIC	01/01 to 12/31	0.18 CFS	9.0 AF
	Totals	0.33 CFS	42.8 AF

LOCATION OF POINT(S) OF DIVERSION:

SENW , Sec. 14, Township 03N, Range 03W
CANYON County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
03N	03W	14	SENW	7.5		7.5

Total number of acres irrigated: 7.5

PLACE OF USE: DOMESTIC, same as IRRIGATION use

CONDITIONS/REMARKS:

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right limited to the amount that can actually be beneficially use used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. This right when combined with all other rights shall provide no more than .02 cfs per acre nor more than 4.5 afa per acre for the lands above.

RECEIVED

JUL 23 1993

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE


WATER RIGHT NO. 63-11074

CONDITIONS/REMARKS:

6. The total combined rate of diversion under this right and Right 63-07446 shall not exceed .96 cfs.
7. The right holder shall fully use all surface water rights appurtenant to the lands identified above prior to using water under this right.
8. Two points of diversion are located within SENW, S14, T03N, R03W.
9. Domestic use is for 75 homes.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. Witness the seal and signature of the Director, affixed at Boise, this 13TH day of JULY, 1993.

Acting for

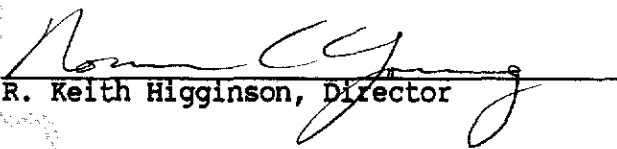
R. Keith Higginson, Director

JUL 23 1993

RECEIVED

JAN 13 1993

Department of Water Resources

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 63-11074 Telephone No. 454-8585
2. Name(s) of Permit Holder(s): KARCHER RANCHETTES WATER CORP.
3. Mailing Address: 15610 CANTRICE LANE, CALDWELL, ID 83605
4. Source of Water: 2 WELLS (2 PUMPS)

If **GROUNDWATER**, Well Driller's Name: DUFFE WELL DRILLING Date Drilled: 1/14/93 109

OPTIONAL:

Pump horsepower: 15 EACH PUMP Pressure (psi): 60 Dynamic pumping level (ft.): 60 FT.

5. Extent of Use (as authorized by the permit):

Domestic 75 (No. of households) Stockwater _____ (No. and type of stock)

Irrigation 30 LAWN/GARDENS (No. of acres) ACRES Other _____

6. Total rate and/or volume for which proof is submitted 1.00 cfs OR 499 gallons PER MINUTE acre/feet
7. Refer to the approval conditions on your permit and respond accordingly:

Measuring device: Required? Yes X No Installed? es No

Flow Measurement Port: Required? X Yes No Installed? X Yes No

8. Fee Enclosed: \$ 100.00 (See License Fee Schedule on back of Instruction Sheet)
9. Person to contact to accompany the Department representative during field examination of the water system.

RAY MULLER 454-8585
Name Telephone No.

15689 CANTRICE LANE CALDWELL, ID 83605
Address

10. The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

JAN. 11, 1993
Date

Ray Muller (FORMER PRESIDENT)
Signature (and title, if on behalf of a company or organization)

FEB 01 1993

RECEIVED
APR 2 1992

For Office Use Only
\$15 Fee Received by RF
Date 4-2-92
Receipt No. CO 23676

STATE OF IDAHO
Department of Water Resources DEPARTMENT OF WATER RESOURCES

REQUEST FOR EXTENSION OF TIME
TO PROVIDE ADDITIONAL TIME IN WHICH TO SUBMIT PROOF OF
BENEFICIAL USE FOR A WATER RIGHT PERMIT

The Idaho Department of Water Resources will consider this form as a request that the permit holder(s) be granted an additional period of time in which to complete development of water right under the provisions of Section 42-204, Idaho Code.

Permit No. 63-11074
Name(s) of Permit Holder: Karcher Ranchettes Water Corp
Mailing Address: 13711 Garrett St. Caldwell, ID 83605
Date Proof is Due 5/1/92 Telephone No. 208-454-1226

Describe what work has been completed toward the development of this water right:
(This must be filled out! If no work has been completed, show "none".)

1 well has been completed. 3rd has been denied by
DEQ. 2nd well - well drillers currently unavailable.

Costing \$ 5000.00

The permit holder(s) has been unable to complete the remainder of the work for the following reasons:

As soon as well driller is available, the 2nd well
will be completed

Permit holder(s) request an extension to May 1, 19 93.

FEE: \$15.00

(Signature)*

*If other than permit holder, Power of Attorney must be supplied.

ACTION OF THE DEPARTMENT OF WATER RESOURCES APR 13 1992

IT IS HEREBY ORDERED that the above request for extension of time be APPROVED
and the time within which to submit proof of beneficial use is extended to
May 1, 1993.

Signed this 3rd day April, 19 92

A. Glen Saxton
Chief, Water Allocation Bureau

State of Idaho
Department of Water Resources
Permit To Appropriate Water

NO. 63-11074

Proposed Priority: December 6, 1989 Maximum Diversion Rate: 1.00 CFS
This is to certify, that **KARCHER RANCHETTES WATER CORP.**
C/O JAMES FINGERLOS
13711 JARETT ST.
CALDWELL, ID 83605
has applied for a permit to appropriate water from: **GROUNDWATER**
and a permit is **APPROVED** for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
IRRIGATION	03/15 to 11/15	0.60 CFS
DOMESTIC	01/01 to 12/31	0.40 CFS
	Totals	1.00 CFS

LOCATION OF POINT(S) OF DIVERSION: SENW Sec. 14, Township 03N, Range 03W
CANYON County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
03N	03W	14	SENW	30		30
Total number of acres irrigated:						30

PLACE OF USE: DOMESTIC, same as IRRIGATION use

CONDITIONS/REMARKS:

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before **May 1, 1992**.
2. Subject to all prior water rights.
3. Permit holder shall commence the excavation or construction of diverting works within one year of the date this permit is issued and shall proceed diligently until the project is complete.
4. Permit holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
5. Prior to the diversion of water under this permit a flow measurement port or other device as specified by the Department shall be installed to provide for the installation of measuring equipment and the determination of the rate of diversion by the Department.
6. The rate of diversion of water for irrigation under this permit and all other water rights on the same land shall not exceed 0.02 cubic feet per second for each acre of land.
7. Domestic use is for 75 homes.

MICROFILMED

APR 19 1990

State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 63-11074

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this

3rd day of April, 1990.

R. Keith Higginson
for R. Keith Higginson, Director

RECORDED

APR 19 1990

Ident. No. 63-11074

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

1. Name: KARCHER RANCHETTES WATER CORP. 208-454-1226
Address: C/O JAMES FINGERLOS
13711 JARETT ST.
CALDWELL, ID 83605
2. Source: GROUNDWATER Trib. to:
3. Location of Point of Diversion: SENW Sec. 14, Township 03N, Range 03W
CANYON County
4. Water will be used for the following purposes:
- | Purpose | From | To | CFS | (or) | AF |
|------------|-------|-------|-------|------|----|
| IRRIGATION | 03/15 | 11/15 | 0.600 | | |
| DOMESTIC | 01/01 | 12/31 | 0.400 | | |
5. Total quantity to be appropriated is:
1.000 CFS (and/or) AF
6. Proposed diverting works:
- Description of ditches, flumes, pumps, headgates, etc.
3 WELLS, SUBMERSIBLE PUMPS, UNDERGROUND MAINLINES
 - Height of storage dam feet; active reservoir capacity
acre-feet; total reservoir capacity acre-feet; period of
year when water will be diverted to storage: to inclusive.
 - Proposed well diameter is inches; proposed depth of well is
feet.
 - Is groundwater with a temperature greater than 90F being sought? NO
7. Time required for the completion of the works and application of
the water to the proposed beneficial use is 2 years.
8. Description of proposed uses:
DOMESTIC WATER FOR 75 HOMES WITH LAWN IRRIGATION
9. Place of Use: IRRIGATION

TWN	RGE	SEC	ACRES	ACRES	ACRES	TOTAL
03N	03W	14	SENW 30			30
Total number of acres irrigated:						30

APR 19 1990

Ident. No. 63-11074
Page 2

Place of Use: DOMESTIC

TWN RGE SEC
03N 03W 14

SENE

Total number of acres irrigated: 30

10. Describe any other water rights used for the same purposes.
63-07446, NAMPA-MERIDIAN IRRIGATION DISTRICT

11. a. Who owns the property at the point of diversion?

APPLICANT

b. Who owns the land to be irrigated or place of use?

INDIVIDUAL LOT OWNERS

c. If the property is owned by a person other than the applicant,
describe the arrangement enabling the applicant to make this filing.
LOTS ARE WITHIN THE SERVICE AREA OF THE KARCHER RANCHETTES WATER CORP.

12. Remarks:

13. Map of proposed point of diversion and place of use attached? []

BE IT KNOWN that the undersigned hereby makes application for permit to
appropriate the public waters of the State of Idaho as herein set forth.

Ray Muller, PRESIDENT
Applicant

Received by C. Wong Date 12/7/89 Time 4:57pm Preliminary check by RW
Fee \$ 45.00 Receipted by C. Wong # CO13295 Date 12/6/89
Publication prepared by GG Date 1-10-90 Published in Press-Tribune
1/17 & 1/24/90
Publication approved SH Date 2/16/1990

MICROFILMED

APR 19 1990

KARCHER RANCHETTES WATER CORP.

Ray Muller, President
15689 Cantrice Lane
Caldwell, ID 83605

Paul Rasgorshek, Director
13675 Colter St.
Caldwell, ID 83605

Dale Klinchuch, Director
13680 Crisholm St.
Caldwell, ID 83605

Duane Wallace, Director
15669 S. Florida St.
Caldwell, ID 83605

Leonard Allen, Director
13699 Colter St.
Caldwell, ID 83605

James Fingerlos, Treasurer
13711 Jarett St.
Caldwell, ID 83605

MICROFILMED

APR 19 1990

529





State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

July 14, 1993


KARCHER RANCHETTES WATER CORP
15689 CANTRICE LANE
CALDWELL ID 83605

RE: WATER RIGHT NO. 63-11074

Dear Water Right Holder(s):

Enclosed herewith is a copy of the Water Right License issued on the above referenced permit.

Sincerely,

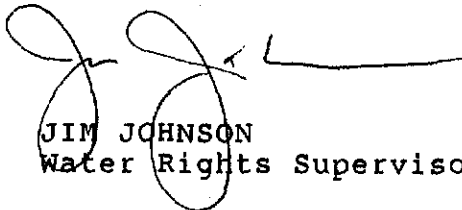

JIM JOHNSON
Water Rights Supervisor

JJ:dc

Enclosure

RECEIVED

JUL 23 1993

WR0749NP
No. L63-11074

IDAHO DEPARTMENT OF WATER RESOURCES
WATER RIGHT PROFILE REPORT
(REGIONAL)

DATE: 07/09/93
PAGE: 1

OWNER CODE	NAME & ADDRESS	PRIORITY DATE	WATER USE	USE PERIOD FROM TO	DIVERSION RATE	DIVERSION VOLUME
C	KARCHER RANCHETTES WATER CORP 15689 CANTRICE LANE CALDWELL ID 83605 (208) 454-8585	12/06/1989	IRRIGATION DOMESTIC	03-15 11-15 01-01 12-31	0.15 CFS 0.18 CFS	33.8 AFA 9.0 AFA
TOTAL DIVERSION:					0.33 CFS	42.8 AFA

Water Source: GROUNDWATER

Tributary to:

Stage: LICENSE

Point(s) of Diversion Capacity: 0.96 CFS

Point(s) of Diversion: T03N R03W S14 SE NW

Place of use Legal Description for: IRRIGATION

				NE				NW				SW				SE				
T	R	S	:	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	:	SUM	
03N	03W	14	:															:	7.5	
																			TOTAL ACRES	7.5

Place of use location for DOMESTIC is the same location as described for: IRRIGATION

Pou County: CANYON

Other Rights: 63-07446, NAMPA-MERIDIAN IRRIGATION DISTRICT

Other Water Rights with Same Point(s) of Diversion and Source:
63-07446 63-11074

Other Water Rights Listing Overlapping Place(s) of use:
63-11074

Conditions of Approval:

- R32 - This right when combined with all other rights shall provide no
- more than .02 cfs per acre nor more than 4.5 afa per acre for the
- lands above.

Remarks: The total combined rate of diversion under this right and
Right 63-07446 shall not exceed .96 cfs.
The right holder shall fully use all surface water rights
appurtenant to the lands identified above prior to using water
under this right.
Two points of diversion are located within SENW, S14, T03N,
R03W.
Domestic use is for 75 homes.

Dates: App. Received: 11/29/1989 Priority Date: 12/06/1989
Proof Due Date: 05/01/1993 Proof Made Date: 01/13/1993
Exam Made Date: 05/09/1993 Exam Sent to S.O.: 06/28/1993
Licensed Date:

Misc:	Water District Number:	Field Exam Fee:	R (Received)
Comments:	Date: 04/02/1992 Extension of Time Received	User-ID: VAULT	Subject: Extension of Time Received
	Date: 01/14/1993 Proof of Beneficial Use Rcvd	User-ID: VAULT	Subject: Proof of Beneficial Use Rcvd
Audit:	07/09/93 CHAPMAN		

LICENSE REVIEW CHECKLIST

Permit # 63-11074

Date 7-9-93

Brenda Chapman

NAME	Yes ☒ No ☐	Or Address Change?
PRIORITY DATE	☐ ☒	Advance? Memo to Advance ☐ Order to Reinstate Needed?
SOURCE	☐ ☒	Changes? Clarification of Originally Intended source Notice of Intent to Void - Source change.
P/D	☐ ☒	Amendment Needed? Is Overlap Analysis a Consideration?
P/U	☐ ☒	Amendment Needed? Is Overlap Analysis a Consideration?
TOTAL CFS	☐ ☒	Incorrect Fee for rate recommended? Disagree/Measurement <u>WELL #1 = .47 CFS</u> Pumping Theoretical $(8.8) \times (.70) \times (15HP)$ <u>WELL #2 $(50 + [2.31 \times 60psi]) = .49 CFS$</u> System Capacity <u>.96</u> Allowable Amount: <u>15 homes = .18 CFS = .33</u> <u>7.5 acres @ .02 = .15 CFS</u>
TOTAL VOLUME	☐ ☒	Rate/ac <u>4.5</u> AFA Irr. Season <u>D</u> <u>3-15 to 11-15</u> Standard Irr. Season <u>STANDARD</u> Season Recommended Disagree with Examiner's Calculations? <u>15 homes @ .6 = 9 AF</u> <u>7.5 x 4.5 = 33.8</u> Flow limit: <u>.33</u> x 365 x 1.9835 = <u>239 > 42.8</u>
USES	☐ ☒	Change(s) in Nature of Use? Amendment Needed?
REMARKS	☒ ☐	Multiple P/Ds in 1/4 1/4? <u>2 in SESW</u> Non-Irr. Uses <u>Domestic</u> <u>WB1</u> Special Overlap Condition <u>WB3</u> Other <u>(BASIN 63 SUPPLEMENTAL)</u>
CONDITIONS	☐ ☒	Measuring Devices W/Master Control <u>R32</u> Irrigation Overlap Water Quality Dates/Misc ☒ Water Dist <u>12-6-89</u> App Rec'd <u>5-9-93</u> Exam Made

COMMENTS: License 63-7446 for this subdivision is for 60 units with lawn coverage at .67 CFS. This is for the additional 15 homes + the 7.5 acres they are on.

REDUCED:
RATE and
ACRES

RECOMMENDED	CFS	VOL
Irrigation	<u>.15</u>	<u>33.8</u>
Domestic	<u>.18</u>	<u>9.0</u>
Stockwater		

LICENSE ☒
AMEND ☐

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

RECEIVED
JUN 29 1993

Department of Water Resources

A. GENERAL INFORMATION

Permit No. 63-11074

1. Owner: KARCHER RANCHETTES WATER CORP Phone No. 454-8585

Current Address: ~~13711 GARRETT ST~~ 15689 Cantrice LADE CALDWELL ⁸³⁶⁰⁵

2. Accompanied by: RAY MULLER EXAM DATE: 5/9/93

Address: SAME Phone No. 454-8585

Relationship to Permit Holder: PRES

3. Source: GROUNDWATER tributary to _____

B. OVERLAP REVIEW

1. Other water rights with the same place of use: 63-07446

2. Other water rights with the same point of diversion: 63-07446

C. DIVERSION AND DELIVERY SYSTEM

1. Point(s) of Diversion:

Ident No.	Gov't Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
			SE	NW	14	3N	3W	CANYON	(2 pt) USGS QUAD


2. Place(s) of Use:

Indicate Method of Determination

TWP	RGE	SEC	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
3N	3W	14								7.5								7.5	
										D									

JUL 29 1993

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe I.d. as applicable.

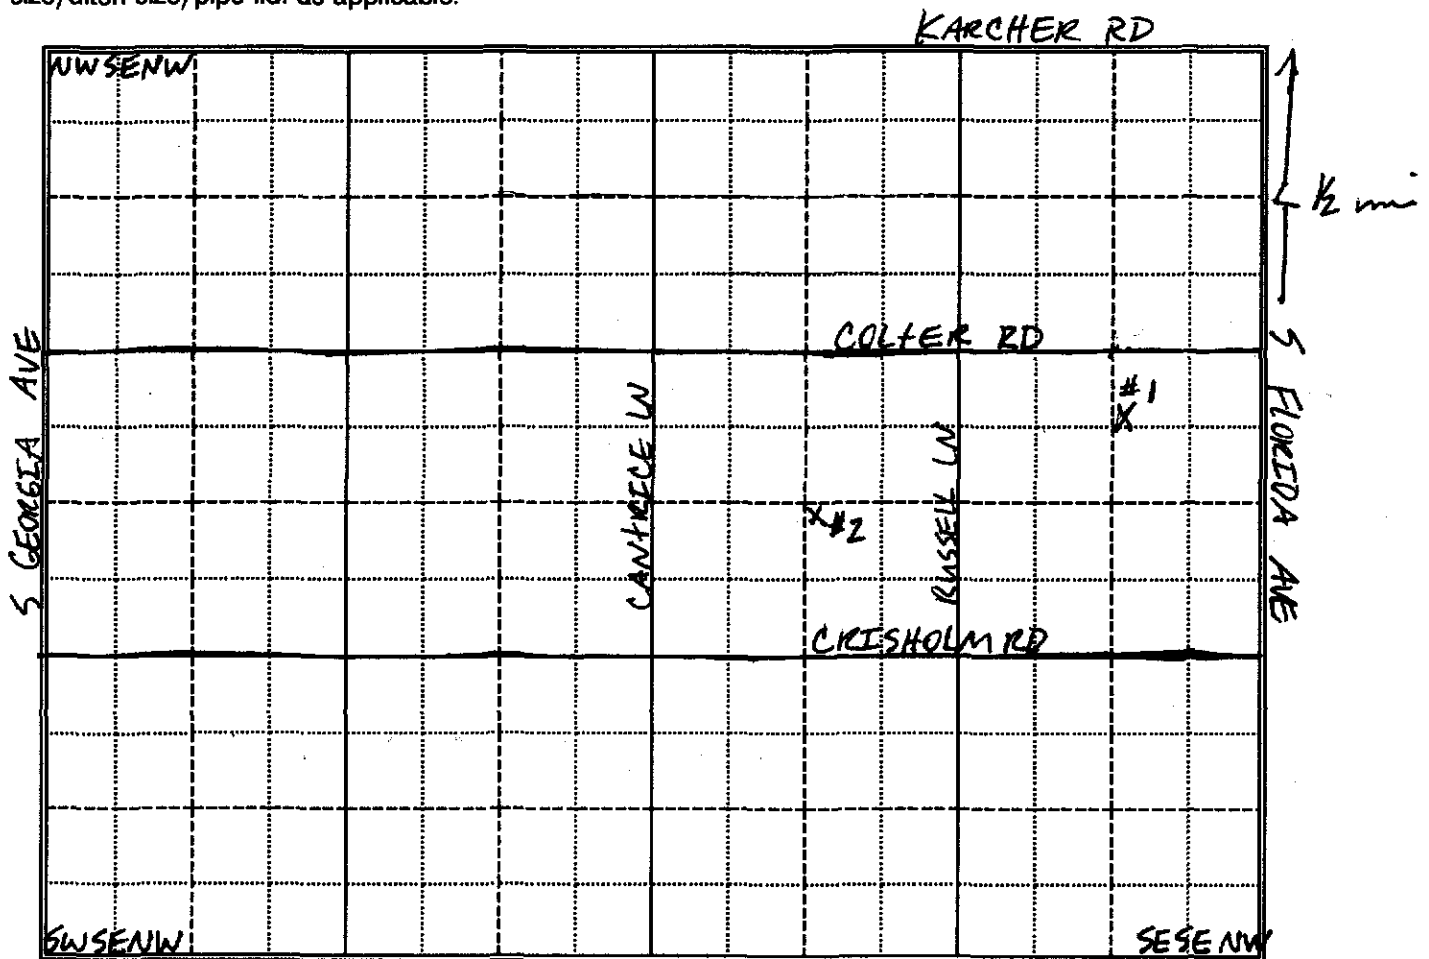

Scale: 1" = _____

Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

Aerial Photo Attached (required for irrigation of 10+ acres)

Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
#1	Submers	15			12"
#2	"	15			10"

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: Theo

RECEIVED

JUL 23 1993

E. NARRATIVE/REMARKS/COMMENTS

Two 15HP submersible wells supply water to Karcher Ranchettes Subdivision. Well #1 is equipped with a 3000 gal storage tank and well #2, a 2000 gal storage tank. Both wells are connected with 4" buried lines. Both wells also have McCrometer flow meters installed to keep track of the GPM used by the subdiv. There are a total of 75 lots within the subdiv that are currently using the wells or have been stubbed in for use in the near future (see attached plat map).

Lic 63-7446 covers internal + external use for 60 of the 75 lots. The licensed system capacity was .67 cfs. Since then the wells have been upgraded from 10HP to 15HP pumps which has increased the system capacity to .96 cfs. This permit covers the additional 15 lots internal and external use. This when combined with 63-7446 should be limited to a combined rate of .96 cfs.

Have conditions of permit approval been met? ☒ yes ☐ no

MICROFILMED

JUL 23 1993

F. FLOW CALCULATIONS

_____ Additional Computation Sheets Attached

Measured Method:

$$\#1. \frac{8.8 \times 15 \times .7}{60 + 60 \times 2.31} = .47 \text{ cfs}$$

$$\#2. \frac{8.8 \times 15 \times .7}{50 + 60 \times 2.31} = .49 \text{ cfs}$$

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = 7.5 \times 4.5 = 33.8$$

$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = .46 \times 246 \times 1.9835 = 468.4$$

$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = 33.8$$

2. Volume Calculations for Other Uses:

$$15 \times .6 = 9 \text{ AFA internal domestic use}$$

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
IRREG	3/15	11/15	.15	33.8
Dam	1/1	12/31	.18	9
Totals:			.33 cfs	42.8 AFA

2. Recommended Amendments

___ Change P.D. as reflected above ___ Add P.D. as reflected above ☒ None
___ Change P.U. as reflected above ___ Add P.U. as reflected above ___ Other


I. AUTHENTICATION

Field Examiner's Name Lon Craven Date _____

Reviewer _____ Date _____

SEAL

JUL 23 1993

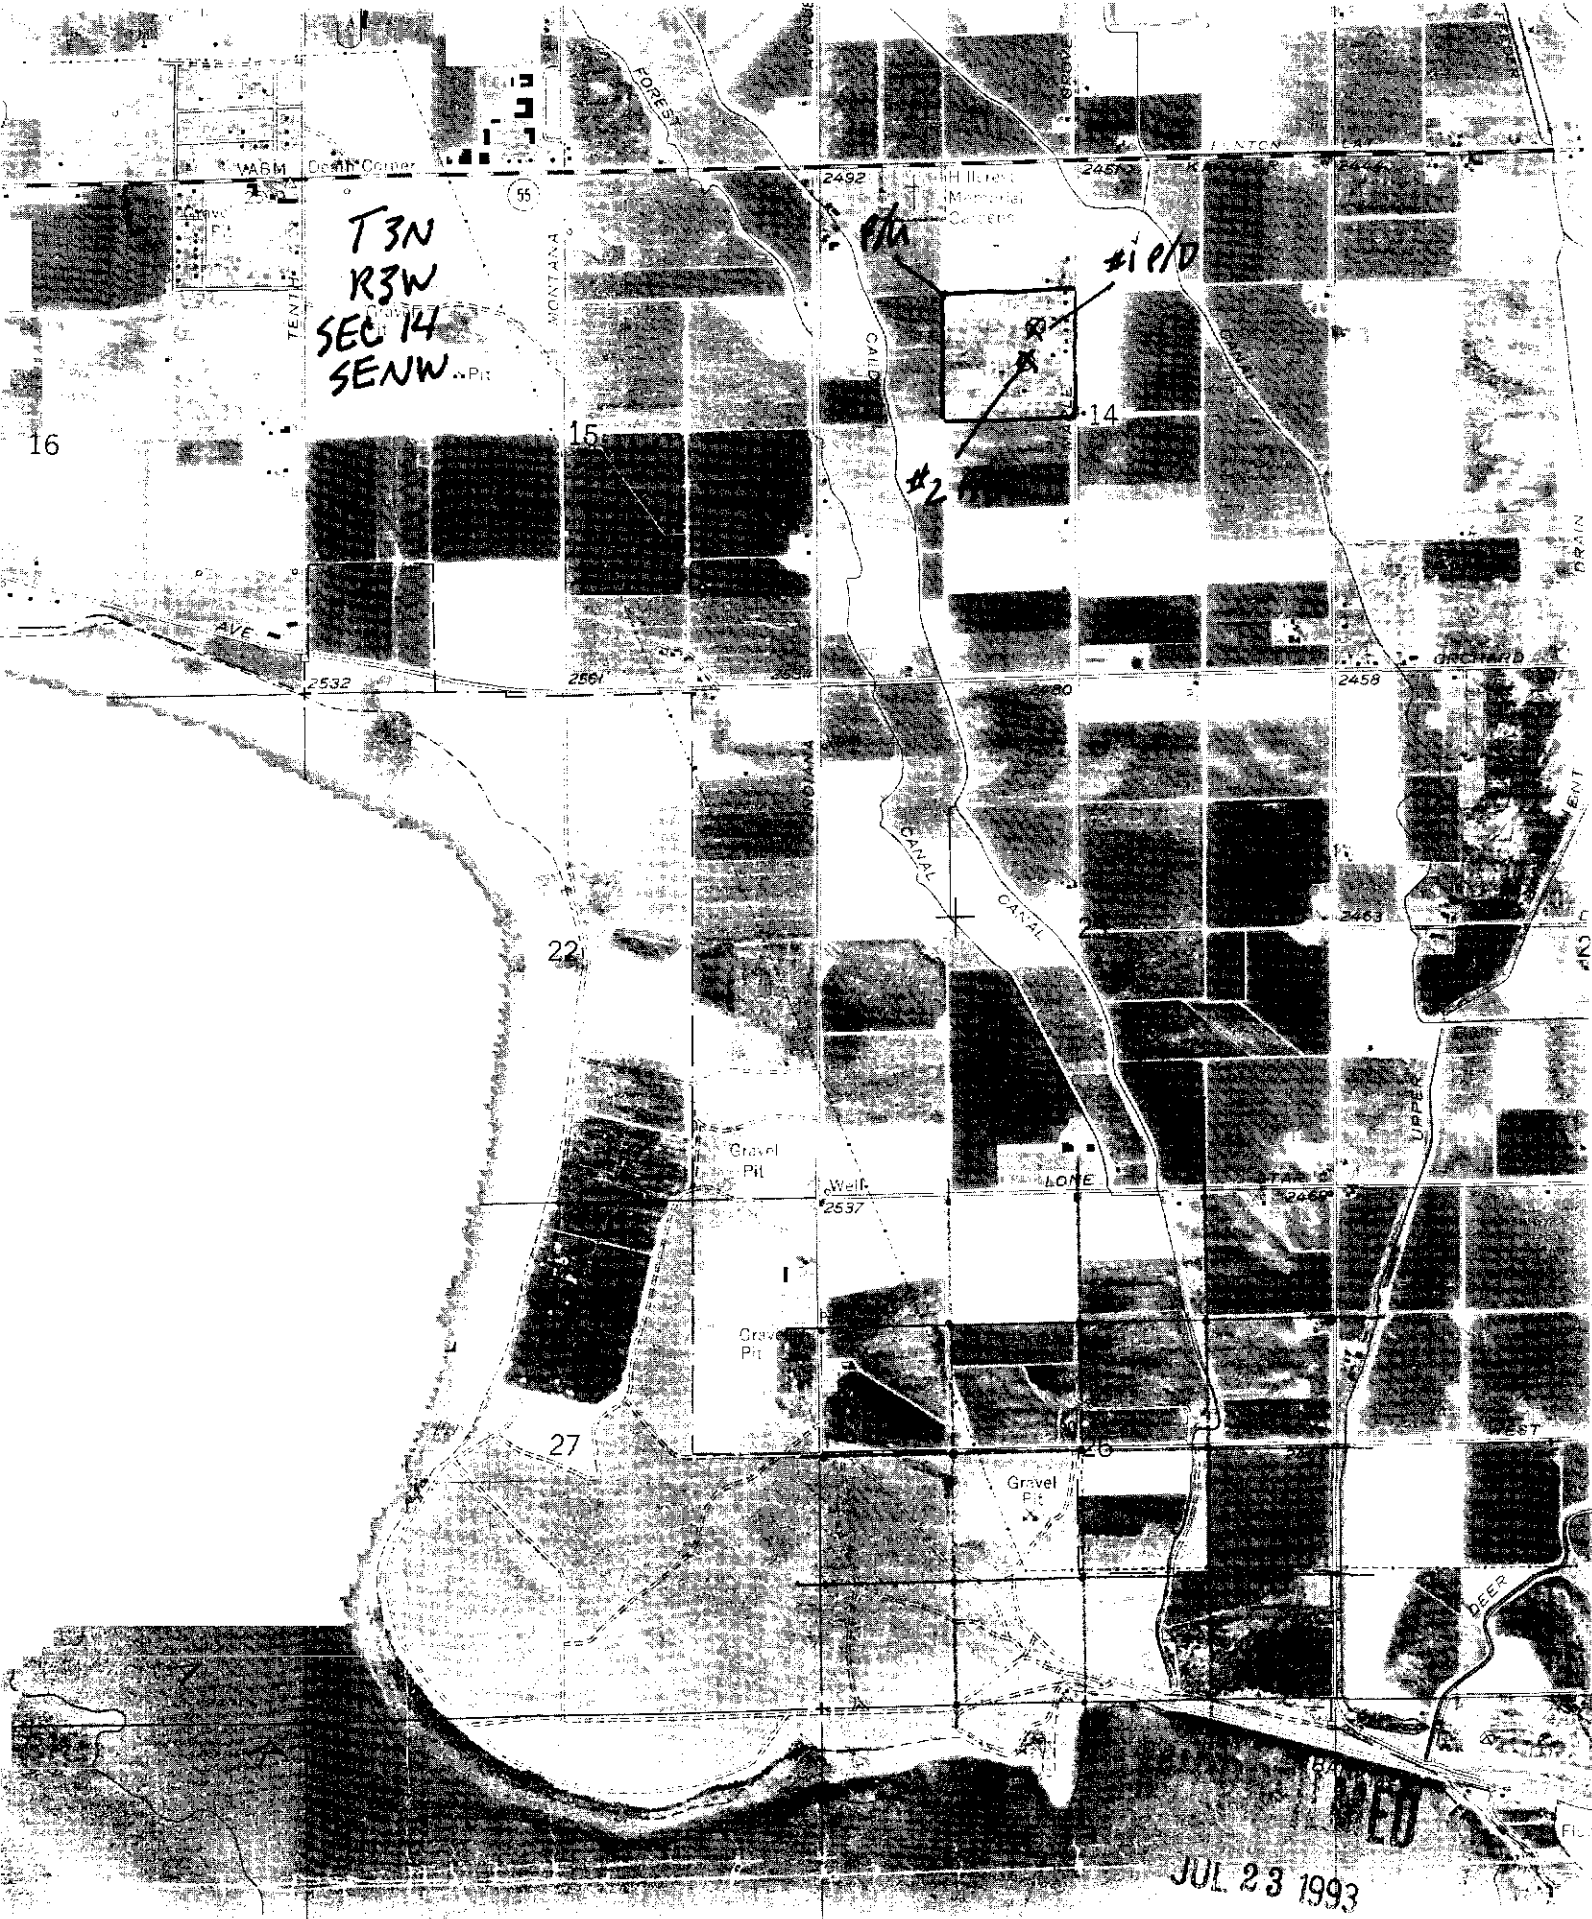

IDAHO DEPARTMENT OF WATER RESOURCES

WELL INSPECTION FORM

Drilling Permit No.: _____

Water Right No.: 63-11074
WATER CORP

Owner: KARCHER RANCHETTES Phone No.: 454-8585

Address: 13711 JARETT ST

1. Well Location: $\frac{1}{4}$, SE $\frac{1}{4}$, NW $\frac{1}{4}$, Lot , Twp 3N, Rge 3W,
Sec. 14, CANYON County (provide sketch map on reverse)

2. Driller: SOS

Is driller licensed? ☒ yes ☐ no License No.: _____

Date of Completion: 1/13/75

3. Casing size: 10" Water tight cap? ☒ yes ☐ no

Casing $\geq$ 12 inches above ground? ☐ yes ☒ no

4. Evidence of well seal? ☐ yes ☐ no

☐ visual Auger to a depth of _____

5. Access Port: ☒ yes ☐ no Static Water Level: 27'

Pressure Gauge: ☒ yes ☐ no Temperature: _____

Pressure: 60

6. Flowing Artesian? ☐ yes ☒ no

Flowing: N around annulus N through casing

7. Are there obvious construction problems that may be a source
for contamination or waste of water? ☐ yes ☒ no

Remarks: _____

g (Agent) 5/9/93 (Inspection Date)

REPRODUCTION
JUL 23 1993

State of Idaho
Department of Water Administration
WELL DRILLER'S REPORT

State law requires that this report be filed with the Director, Department of Water Administration within 30 days after the completion or abandonment of the well.

1. WELL OWNER Name <u>Don Gould</u> Address <u>Boise, Idaho</u> Owner's Permit No. <u>65-7476</u>		7. WATER LEVEL Static water level <u>22</u> feet below land surface Flowing? ☐ Yes ☒ No G.P.M. flow _____ Temperature _____ ° F. Quality _____ Arterian closed-in pressure _____ p.s.i. Controlled by ☐ Valve ☐ Cap ☐ Plug																																																
2. NATURE OF WORK ☒ New well ☐ Deepened ☐ Replacement ☐ Abandoned (describe method of abandoning) _____		8. WELL TEST DATA ☐ Pump ☐ Bailor ☒ Other Discharge G.P.M. <u>200</u> Draw Down <u>25'</u> Hours Pumped <u>1</u>																																																
3. PROPOSED USE ☒ Domestic ☐ Irrigation ☐ Test ☐ Other (specify type) _____ ☐ Municipal ☐ Industrial ☐ Stock ☐ Waste Disposal or Injection		9. LITHOLOGIC LOG <table border="1"><thead><tr><th rowspan="2">Hole Diam.</th><th colspan="2">Depth</th><th rowspan="2">Material</th><th rowspan="2">Remarks</th></tr><tr><th>From</th><th>To</th></tr></thead><tbody><tr><td>12"</td><td>0</td><td>2</td><td>Topsoil</td><td>X</td></tr><tr><td>12"</td><td>2</td><td>40</td><td>Clay + gravel</td><td>X</td></tr><tr><td>12"</td><td>40</td><td>50</td><td>Clay + gravel</td><td>X</td></tr><tr><td>10"</td><td>50</td><td>85</td><td>Heavy sand/clay</td><td>X</td></tr><tr><td>10"</td><td>85</td><td>105</td><td>Heavy brown sand</td><td>X</td></tr><tr><td>10"</td><td>105</td><td>115</td><td>Shallow brown clay</td><td>X</td></tr><tr><td>10"</td><td>115</td><td>125</td><td>Dark sticky clay</td><td>X</td></tr><tr><td>10"</td><td>125</td><td>310</td><td>Medium sand/clay</td><td>X</td></tr></tbody></table>		Hole Diam.	Depth		Material	Remarks	From	To	12"	0	2	Topsoil	X	12"	2	40	Clay + gravel	X	12"	40	50	Clay + gravel	X	10"	50	85	Heavy sand/clay	X	10"	85	105	Heavy brown sand	X	10"	105	115	Shallow brown clay	X	10"	115	125	Dark sticky clay	X	10"	125	310	Medium sand/clay	X
Hole Diam.	Depth		Material		Remarks																																													
	From	To																																																
12"	0	2	Topsoil	X																																														
12"	2	40	Clay + gravel	X																																														
12"	40	50	Clay + gravel	X																																														
10"	50	85	Heavy sand/clay	X																																														
10"	85	105	Heavy brown sand	X																																														
10"	105	115	Shallow brown clay	X																																														
10"	115	125	Dark sticky clay	X																																														
10"	125	310	Medium sand/clay	X																																														
4. METHOD DRILLED ☐ Cable ☒ Rotary ☐ Dug ☐ Other																																																		
5. WELL CONSTRUCTION Diameter of hole <u>10</u> inches Total depth <u>200</u> feet Casing schedule: ☒ Steel ☐ Concrete Thickness _____ Diameter _____ From _____ To _____ <u>250</u> inches <u>10</u> inches + <u>1</u> feet <u>151</u> feet _____ inches _____ inches _____ feet _____ feet _____ inches _____ inches _____ feet _____ feet _____ inches _____ inches _____ feet _____ feet _____ inches _____ inches _____ feet _____ feet <u>60' 8" P.U.C. line</u> from <u>140'</u> to <u>200'</u> Was a packer or seal used? ☐ Yes ☒ No Perforated? ☐ Yes ☒ No How perforated? ☐ Factory ☐ Knife ☐ Torch Size of perforation _____ inches by _____ inches Number _____ From _____ To _____ _____ perforations _____ feet _____ feet _____ perforations _____ feet _____ feet _____ perforations _____ feet _____ feet Well screen installed? ☐ Yes ☒ No Manufacturer's name _____ Type _____ Model No. _____ Diameter _____ Slot size _____ Set from _____ feet to _____ feet Diameter _____ Slot size _____ Set from _____ feet to _____ feet Gravel packed? ☐ Yes ☒ No Size of gravel _____ Placed from _____ feet to _____ feet Surface seal depth <u>80</u> Material used in seal ☐ Cement grout ☐ Pudding clay ☒ Well cuttings Sealing procedure used ☐ Shurry pit ☐ Temporary surface casing ☒ Overbore to seal depth																																																		
6. LOCATION OF WELL Sketch map location must agree with written location. <table border="1"><tr><td>N</td><td></td><td></td><td></td><td></td></tr><tr><td>W</td><td></td><td></td><td></td><td>E</td></tr><tr><td></td><td></td><td></td><td></td><td></td></tr></table> Section Name <u>Krocker</u> Lot No. <u>33</u> Block No. <u>2</u> County <u>Canyon</u> X Sec <u>14</u> T. <u>3</u> N. R. <u>3</u> W.		N					W				E						10. Work started <u>1/8/75</u> finished <u>1/13/75</u>																																	
N																																																		
W				E																																														
11. DRILLER'S CERTIFICATION Firm Name <u>D. J. Weidenbach</u> Firm No. <u>212</u> <u>2305</u> _____ Address <u>Meridian, Ida</u> Date _____ Signed by (Firm Official) <u>Frank S. ...</u> and <u>Eul ...</u> (Operator)																																																		

IDAHO DEPARTMENT OF WATER RESOURCES

WELL INSPECTION FORM

Drilling Permit No.: _____

Water Right No.: 63-11074

Owner: KARCHER RANCHETTES WATER ^{CORP} Phone No.: 454-8585

Address: 13711 JARRETT ST

1. Well Location: $\frac{1}{4}$, SE $\frac{1}{4}$, NW $\frac{1}{4}$, Lot , Twp 3N, Rge 3W,
Sec. 14, CANYON County (provide sketch map on reverse)

2. Driller: Bill Doty

Is driller licensed? ☒ yes ☐ no License No.: _____

Date of Completion: 7/3/71

3. Casing size: 12" Water tight cap? ☒ yes ☐ no

Casing $\geq$ 12 inches above ground? ☐ yes ☒ no

4. Evidence of well seal? ☐ yes ☐ no

☐ visual Auger to a depth of _____

5. Access Port: ☒ yes ☐ no Static Water Level: 25

Pressure Gauge: ☒ yes ☐ no Temperature: _____

Pressure: 60

6. Flowing Artesian? ☐ yes ☒ no

Flowing: N around annulus N through casing

7. Are there obvious construction problems that may be a source
for contamination or waste of water? ☐ yes ☒ no

Remarks: _____

kg
(Agent)

5/9/93
(Inspection Date)

RECEIVED
JUL 23 1993


USE TYPEWRITER OR
BALL POINT PEN

State of Idaho
Department of Water Administration

WELL DRILLER'S REPORT

State law requires that this report be filed with the State Reclamation Engineer
within 30 days after completion or abandonment of the well.

*Beamed
8-23-91
JL*

1. WELL OWNER Name <u>REALTY WEST AL WILLARD</u> Address <u>NAMPA IDAHO</u> Owner's Permit No. _____		7. WATER LEVEL Static water level <u>25</u> feet below land surface Flowing? ☐ Yes ☒ No G.P.M. flow _____ Temperature _____ ° F. Quality _____ Artesian closed-in pressure _____ p.s.i. Controlled by ☐ Valve ☐ Cap ☐ Plug																																																																							
2. NATURE OF WORK ☐ New Well ☐ Deepened ☐ Replacement ☐ Abandoned (describe method of abandonment) <u>PULLED UP 6" AND DRILLED IN SAME HOLE</u>		8. WELL TEST DATA ☒ Pump ☐ Bailor ☒ Other Discharge G.P.M. <u>300</u> Draw Down _____ Hours Pumped <u>6.5</u>																																																																							
3. PROPOSED USE ☐ Domestic ☐ Irrigation ☐ Test <u>SUB DIVISION</u> ☐ Municipal ☐ Industrial ☐ Stock		9. LITHOLOGIC LOG <table border="1"><thead><tr><th rowspan="2">Hole Diam</th><th colspan="2">Depth</th><th rowspan="2">Material</th><th colspan="2">Water</th></tr><tr><th>From</th><th>To</th><th>Yes</th><th>No</th></tr></thead><tbody><tr><td>12"</td><td>0</td><td>3</td><td>TOP SOIL</td><td></td><td>X</td></tr><tr><td>12"</td><td>3</td><td>15</td><td>SANDY CLAY</td><td></td><td>X</td></tr><tr><td>12"</td><td>15</td><td>19</td><td>HARD PAN</td><td></td><td>X</td></tr><tr><td>12"</td><td>19</td><td>20</td><td>HARD PAN</td><td></td><td>X</td></tr><tr><td>12"</td><td>20</td><td>81</td><td>SANDY GRAVEL</td><td>X</td><td></td></tr><tr><td>12"</td><td>81</td><td>95</td><td>CEMENTED GRAVEL</td><td></td><td>X</td></tr><tr><td>12"</td><td>95</td><td>100</td><td>GRAVELLY CLAY</td><td></td><td>X</td></tr><tr><td>8"</td><td>100</td><td>105</td><td>GRAVELLY CLAY</td><td></td><td>X</td></tr><tr><td>8"</td><td>105</td><td>145</td><td>SANDY CLAY LAYERS</td><td>X</td><td></td></tr><tr><td>8"</td><td>145</td><td></td><td>SANDY CLAY LAYERS</td><td>X</td><td></td></tr></tbody></table>		Hole Diam	Depth		Material	Water		From	To	Yes	No	12"	0	3	TOP SOIL		X	12"	3	15	SANDY CLAY		X	12"	15	19	HARD PAN		X	12"	19	20	HARD PAN		X	12"	20	81	SANDY GRAVEL	X		12"	81	95	CEMENTED GRAVEL		X	12"	95	100	GRAVELLY CLAY		X	8"	100	105	GRAVELLY CLAY		X	8"	105	145	SANDY CLAY LAYERS	X		8"	145		SANDY CLAY LAYERS	X	
Hole Diam	Depth		Material		Water																																																																				
	From	To		Yes	No																																																																				
12"	0	3	TOP SOIL		X																																																																				
12"	3	15	SANDY CLAY		X																																																																				
12"	15	19	HARD PAN		X																																																																				
12"	19	20	HARD PAN		X																																																																				
12"	20	81	SANDY GRAVEL	X																																																																					
12"	81	95	CEMENTED GRAVEL		X																																																																				
12"	95	100	GRAVELLY CLAY		X																																																																				
8"	100	105	GRAVELLY CLAY		X																																																																				
8"	105	145	SANDY CLAY LAYERS	X																																																																					
8"	145		SANDY CLAY LAYERS	X																																																																					
4. METHOD DRILLED ☒ Cable ☐ Rotary ☐ Dug ☐ Other																																																																									
5. WELL CONSTRUCTION Diameter of hole <u>12</u> inches Total depth <u>145</u> feet Casing schedule ☒ Steel ☐ Concrete Thickness Diameter From To <u>150</u> inches <u>12</u> inches <u>±2</u> feet <u>93</u> feet <u>260</u> inches <u>8</u> inches <u>±2</u> feet <u>139</u> feet inches inches feet feet inches inches feet feet inches inches feet feet inches inches feet feet Was a packer or seal used? ☐ Yes ☒ No Perforated? ☒ Yes ☐ No How perforated? ☒ Factory ☐ Knife ☐ Torch Size of perforation <u>1/8</u> inches by <u>3</u> inches Number From To <u>800</u> perforations <u>97</u> feet <u>137</u> feet perforations feet feet perforations feet feet Well screen installed? ☐ Yes ☒ No Manufacturer's name _____ Model No. _____ Type _____ Diameter Slot size Set from feet to feet Diameter Slot size Set from feet to feet Gravel packer? ☒ Yes ☐ No Size of gravel <u>50</u> Placed from <u>0</u> feet to <u>137</u> feet Surface seal? ☒ Yes ☐ No To what depth <u>19</u> feet Material used in seal ☐ Cement grout ☒ Pudding clay																																																																									
6. LOCATION OF WELL Sketch map location must agree with written location 		10 Work started <u>JUNE 8, 1971</u> finished <u>JULY 3, 1971</u>																																																																							
11 DRILLER'S CERTIFICATION This well was drilled under my supervision and this report is true to the best of my knowledge. <u>BILL DODD WELL DRILLING</u> <u>412</u> Order's or Firm's Name Number <u>ROUTE #7 CALDWELL IDAHO</u> Address <u>BILL DODD DR. 8-23-91</u> Signed By Date																																																																									

MICROFILMED
JUL 23 1993

USE ADDITIONAL SHEETS IF NECESSARY

FORWARD THE WHITE, BLUE, AND PINK COPIES TO THE DEPARTMENT

well #1
+
tank

well #2
+
tank

RECEIVED

JUL 23 1993



P/u
EXAMPLE



STUBBED IN LOT

RECEIVED
JUL 23 1993

RECEIVED

JUL 07 1993

Department of Water Resources

15689 Cantrice Lane
Caldwell, ID 83605
July 6, 1993

Water Resources Board
State House Mail
Boise, ID 83720

ATTENTION: Karen Christoferson

Re: Permit No. 63-11074


Gentlemen:

Some time ago we received a field inspection that verified that we complied with the necessary requirements for the above water permit. The inspector stated that we would receive a written statement or license showing that we are a valid owner of the water right under this permit number.

To date we have never received the document. Will you please let us know when we may expect this document? We will sincerely appreciate your help in this matter.

Sincerely,

KARCHER RANCHETTES WATER CORP.



Ray Muller, past Pres.

My telephone no. (208) 454-8585

RECEIVED

JUL 23 1993

RECEIVED

MAY 5 1993

Department of Water Resources
Western Regional Office

MAY 07 1993

Department of Water Resources

15689 Cantrice Lane
Caldwell, ID 83605
May 3, 1993

RECEIVED

MAY 07 1993

Department of Water Resources

Department of Water Resources
1301 North Orchard Street
Boise, ID 83706-2237

ATTENTION: Mr. Steve Lester


Re: Permit No. 63-11074

Gentlemen:

On February 24, 1993, we asked to have your department conduct a field examination to finalize our application and proof of beneficial use. We were advised by a telephone call from Mr. Lester that the inspection would be during the month of April for sure. To date, we have not heard any further word from you on this. We know there is an expiration date on the approval of our permit. As we do not want our permit to expire, will you please give this your immediate attention and advise me what day you will make the necessary inspection?

My telephone number is 454-8585. My residence is the return address on this letter. Urgently awaiting your reply,

Sincerely,



Ray Muller, past President
Karcher Ranchettes Water Corporation

5/6/93 called him to discuss. "Expiration date"
is N/A since proof was filed < 5/1/93.
Exam is scheduled for Monday 5/10/93.

-JL

RECEIVED

JUL 23 1993

RECEIVED

FEB 26 1993

Department of Water Resources

15689 Cantrice Lane
Caldwell, ID 83605
February 24, 1993


Karen L. Gustafson, Secy./Records Mgr.
Department of Water Resources
1301 North Orchard Street
Boise, ID 83706-2237

Re: Permit No. 63-11074

Dear Mrs. Gustafson:

Thank you for your letter of January 29, 1993, acknowledging receipt of our proof of beneficial use form. Our question at this time is when will the department conduct the field examination? In order to accommodate the field man in his examination, I assume that a telephone call will be made to me so that any information concerning the inspection can be explained. My telephone number is 454-8585. Mr residence is the return address on this letter. Awaiting your reply,

Sincerely,



Ray Muller, past Pres.
Karcher Ranchettes Water Corp.

*2/26/93- Original sent to Western with
Request for a Response.*

RECEIVED

JUL 23 1993

January 29, 1993

KARCHER RANCHETTES WATER CORP.
15610 CANTRICE LANE
CALDWELL ID 83605

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 63-11074

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water.

If you have questions concerning this matter, please feel free to contact the WESTERN Regional Office in Boise at (208)334-2190.

Sincerely,

Karen L. Gustafson
Secretary/Records Manager

c: IDWR - Region

7-10-93
FEB 1 1993

ANALYSIS SHEET
FOR
PROOF OF BENEFICIAL USE

Permit No. 63-11074 Reviewed by Klg Date 1/14/93

GENERAL CONSIDERATIONS

TYPES OF USE

yes Name same as permit?
no Address same as permit?
yes Proof timely received? Correct Uses? yes
If not, complete calculation below.

SOURCE OF WATER

 Surface water source
✓ Ground water source
NA-yes Drilling permit required?
 Copy in the file? Drilling Permit No.
 Amount paid for permit Correct?
 Well log in the file?

LICENSE EXAMINATION FEE

MEASURING DEVICE

yes Required?
100 Amount Submitted
yes Correct?
yes Required?
yes Installed?
NA Waiver requested?

PRIORITY CALCULATION

Date proof received NA
Date proof due -
No. of days late =
Priority Date +
New Priority Date

DEFICIENCIES OR ACTION ITEMS

Both wells were drilled prior to 7/1/87
per correspondence from the Permit Holder
(attached)
proof acceptable

DATA ENTRY

New Address 15610 Cantua Lane 1/30/93 Klg Proof Made 1/13/93
1/29/93 Klg

RECEIVED

JAN 25 1993

Department of Water Resources

15689 Cantrice Lane
Caldwell, ID 83605
January 21, 1993

Karen L. Gustafson, Secy./Records Mgr.
Department of Water Resources
1301 North Orchard Street
Boise, ID 83706-2237

Dear Mrs. Gustafson:

Re: Permit No. 63-11074

In reply to your letter of January 19th, I am sorry the information presented to you has led to some confusion. I will try to clarify this as follows:

We had two wells on this subdivision, drilled prior to July 1, 1987. Our 40-acre subdivision is divided into 75 lots for houses. The two wells are approximately two blocks apart with water lines connected together. Each well pump was capable of delivering approximately 125 gallons per minute using 10 H.P. submersible pumps.

In our request for beneficial use, we asked permission to double the flow of water from our two wells and to drill a third well. When we found out we were unable to drill a third well under DEQ restrictions, we filed a Request for Extension to enable us to repair one of the wells and to increase the size of the pump to 15 H.P., doubling the flow of water.

The pump on the other well was increased to 15 H.P. during 1991 to produce double the amount of water from that well.


To double the output of both wells, was our original intention at the time of applying for the Beneficial Use Permit. The drilling of a third well was also applied for, but as I previously stated, we were not allowed under DEQ to drill a third well.

I believe this information should help clear up the confusion in our application and we will look forward to hearing further from you on this.

Sincerely,

RECEIVED

FEB 01 1993


Ray Muller, past Pres.
Karcher Ranchettes Water Corp.

RECEIVED

JAN 20 1993

Department of Water Resources

15 689 Cantrice Lane
Caldwell, ID 83605
January 19, 1993

Karen L. Gustafson, Secy./Records Mgr.
Department of Water Resources
1301 North Orchard Street
Boise, Idaho 83720-9000

RECEIVED

JAN 20 1993

Department of Water Resources


Dear Mrs. Gustafson:

In Re: Permit No. 63-11074

In reply to your letter of January 14th, I have contacted Mr. Jimmy Dufoe of Dufoe Well Drilling. Mr. Dufoe has reported to me that he called you and is forwarding to you a copy of the well log for the work done on our subdivision well to increase the flow of water as requested in our beneficial use permit.

Will you please let me know what is necessary to finalize our request for this permit and verification from your department?

Sincerely,



Ray Muller, past Pres.
Karcher Ranchettes Water Corp.

RECEIVED

FEB 01 1993



State of Idaho
DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000
Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

January 19, 1993

Karcher Ranchette Water Corp
15610 Cantrice Lane
Caldwell, ID 83605

Re: Permit No. 63-11074

Dear Permit Holder:

I recently received a call from Mr. Dufoe of Dufoe Well Drilling concerning the above mentioned water right. Mr. Dufoe indicated that he only repaired a previously drilled well on January 5, 1993. However, on the proof of beneficial use you submitted, you indicate that is the date the well was drilled.

In previous correspondence to the Department dated April 2, 1992, you indicate that one well had been drilled and that you were waiting for the availability of a well driller to drill the 2nd well. You also indicated that DEQ had refused drilling of the 3rd well.

In order to complete the analysis of the proof of beneficial use, additional information is still required. The Department needs to know the ORIGINAL drilling date, and any subsequent deepening or enlargements, of BOTH wells. If the wells were drilled or deepened after July 1, 1987, you will also need to supply me with the drilling permit numbers for each well. If the wells were drilled or deepened prior to July 1, 1987, simply inform the Department by telephone or correspondence, and the Department will proceed with the analysis of the proof of beneficial use. Please note that a repair of an existing well is not considered a deepening or enlargement.

In order to meet all of the required dates, you need to submit this information on or before May 1, 1993. In the mean time, if you have any questions or if I can be of any further assistance, please feel free to contact me.

Sincerely,

A handwritten signature in cursive script that reads "Karen L. Gustafson".

Karen L. Gustafson
Secretary/Records Manager

RECEIVED
FEB 01 1993



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

CECIL D. ANDRUS
GOVERNOR

R. KEITH HIGGINSON
DIRECTOR

January 14, 1993

Karcher Ranchette Water Corp
15610 Cantrice Lane
Caldwell, ID 83605

Re: Permit No. 63-11074

Dear Permit Holder:

In the department's review of the proof of beneficial use submitted in connection with the above referenced permit, the department was not able to locate a drilling permit which should have been applied for before the opening of your well began. We have also been unable to locate a well log which should have been submitted by your well driller 30 days after completion of the construction of your well.

If you have a drilling permit or a copy of the well log, please provide this office with a copy of each. If you do not have a copy of the well log, please contact your driller and ask that he submit a copy. In your return letter, please be sure to show the above referenced permit number on any documents. Also, please address any correspondence directly to me. Your response, with both forms attached, should be received within 30 days of the date of this mailing.

This information is needed before the department can proceed further with the examination of your system and the eventual issuance of a license of water right.

If you have any questions or if I can be of any further assistance, please feel free to contact me.

Sincerely,

A handwritten signature in cursive script that reads "Karen L. Gustafson".

Karen L. Gustafson
Secretary/Records Manager

Enclosure

DEC 14 1993



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720 -(208) 327-7900

CECIL D. ANDRUS

GOVERNOR

R. KEITH HIGGINSON

DIRECTOR

April 3, 1992

Karcher Ranchettes Water Corp
13711 Jarrett Street
Caldwell, ID 83605

Re: Permit No. 63-11074

Dear Permit Holder:

Enclosed is a copy of the approved request for extension of time. The time within which to submit proof of beneficial use is extended to May 1, 1993. Please note that the department has granted this extension based on due diligence. It is important that you work diligently toward the completion of this project during the construction period allowed. The department may not be able to grant additional requests.

If you have any questions or if I can be of any further assistance, please feel free to contact this office.

Sincerely,

Karen L. Gustafson

Karen L. Gustafson
Secretary/Records Manager

Enclosure

C: IDWR-Regional Office

MICROFILMED

APR 13 1992

ANALYSIS SHEET
FOR
EXTENSION OF TIME

Permit No. 63-11074 Reviewed by Klg Date 4/2/92

BASIC INFORMATION

4/2/92 Date stamp received
yes Extension received timely
yes Fee received and receipted
yes Name and signature same as permit
no Address Change

BASIS FOR EXTENSION REQUEST

2 Has adequate work been completed to demonstrate due diligence?
Has the permit been involved in litigation?
Is supporting documentation needed to complete the file? Requested?
Is delay by a government agency?
Is supporting documentation needed to complete the file? Requested?
Is the project more than 25,000 acre feet for irrigation or 10,000 acre feet for a reservoir?

ACTION TAKEN

approve Based on due diligence
extend to 5/1/93

PRIORITY CALCULATION

Date extension received	<u>NA</u>	=	
Proof due date		=	
Number of days late		=	
Priority date		=	
New Priority Date		=	

DATA ENTRY

New Address _____
Change Proof Due Date 4/3/92 Klg

February 28, 1992

KARCHER RANCHETTES WATER CORP.
C/O JAMES FINGERLOS
13711 JARETT ST.
CALDWELL ID 83605

PROOF DUE NOTICE

RE: PERMIT NO. 63-11074

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before May 1, 1992. (See last page of your approved permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a complete field examination report prepared by a certified water right examiner may be used to submit the required proof.


If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.

Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.

SINCERELY,

Karen L. Gustafson
Secretary/Records Manager

Enclosures

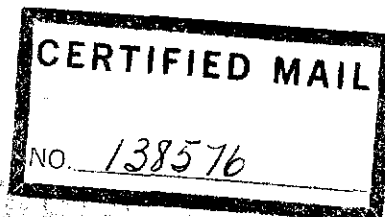

MICROFILMED

APR 13 1992

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

Statehouse
Boise, Idaho 83720
(208) 327-7900
April 3, 1990

KARCHER RANCHETTES WATER CORP.
C/O JAMES FINGERLOS
13711 JARETT ST.
CALDWELL, ID 83605

PERMIT APPROVAL NOTICE

RE: PERMIT NO. P63-11074

Dear Permit Holder:

Enclosed is a copy of your approved application for permit. We direct your attention to the conditions of approval on the final page.

You should be aware that the groundwater you propose to divert is located within a drainage basin where surface waters are regulated during the months of low flow. It is possible that diversion of groundwater may have an adverse impact on these surface water flows. Information available to us at this time does not warrant refusing to issue permits in your area, but we do caution that diversions of groundwater are not allowed to deplete flows available for surface water users with earlier priority dates. Siting your well as far from surface sources as possible and casing out upper water producing zones may reduce the potential of interference.

Section 42-235, Idaho Code, requires that a "drilling permit" must be obtained from the department for all wells constructed after July 1, 1987. A drilling permit is a separate permit that must be issued in addition to your permit to appropriate water. Commencement of well construction or diversion of water under your permit to appropriate water is prohibited unless a drilling permit is obtained.

Be sure to note the special condition requiring you to install a measuring device, or a flow measurement port to provide for the installation of measuring equipment by the department. Enclosed please find a list of measuring device options, and specifications for the installation of the flow measurement port.

MICROFILMED

APR 19 1990

Please note the requirement that as a permit holder you must commence the excavation or construction of diverting works within one year of the date the permit was issued, and you must proceed diligently until the project is completed. The enclosed blue card must be completed and returned to this office as soon as you commence construction, no later than one year from the date the permit was approved.

We have enclosed a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit into a license.

Sincerely,

GARY SPACKMAN, Supervisor
Water Right Permits Section

GS: SC
Enclosures

MICROFILMED

APR 19 1990

P/D 3N 3W S14 SE NW
P/U

Form No. 202a.
3/89

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPROPRIATION APPLICATION ANALYSIS SHEET

INITIAL REVIEW BY: RW DATE: 1-9-90 APPLICATION: 63-11074

REQUIRED INFORMATION

- ☒ Name: (If applicant is a corporation or partnership, names and addresses for the director, officers, and other partners must be included.) Attached
- ☒ Address:
- ☒ Source: (See USGS Quad for names of water sources)
- ☒ Point of Diversion: (10 acres for spring, lot & block descriptions for Subdivisions, local name)
- ☒ County:
- ☒ Quantity: (flow and/or volume)
- ☒ Period of use:
- ☒ Nature of proposed use: (Include description of use)
- ☒ Description of diverting works:
- ☒ Time required for beneficial use of water:
- ☒ Place of use or acres irrigated:
- ☒ Map:
- ☒ Signature: (If applicant is corp., partnership, or municipality, title of signatory is required)
- ☒ Fee:
- ☒ Yes ☐ No* In form to receipt:

Gov't. Lots:

N P/D

N P/U

ADDITIONAL INFORMATION

YES NO

- ☒ ☐ Overlapping place of use: (Describe source & relationship to present application on the back.)
- ☒ ☐ Overlapping point of diversion:
- ☐ ☐ Field check required: Field check by: _____
- ☐ ☐ Field report attached:
- ☐ ☐ Critical groundwater area:
- ☐ ☐ Groundwater management area:
- ☐ ☐ Send dam safety information:
- ☐ ☐ Send power requirement letter:
- ☐ ☐ Send fish farm requirement letter:
- ☐ ☐ Power residency affidavit:
- ☐ ☐ Power efficiency form:
- ☐ ☐ Within trust water boundary: (If yes, attach Trust Water Supplementary Analysis Sheet.)
- ☐ ☐ Diversion greater than 5 cfs or 500 af: (If yes, attach Large Diversion supplementary analysis sheet.)
- ☐ ☐ *REQUEST ADDITIONAL INFORMATION FROM THE APPLICANT

DATE REQUESTED: _____

☒ Additional information on reverse side:

RECORDED
MAR 12 1990

Department of Water Resources

PROCESSING

YES NO

☒ ☐ In form for advertising:
☐ ☒ Statewide advertising:
☒ ☐ Fee amount, receipt number and date recorded on application:

SEND COPIES TO

YES NO

☐ ☒ I.D. Health and Welfare
☐ ☒ I.D. Fish and Game
☐ ☒ I.D. Lands
☐ ☒ Adjudication Bureau

YES NO

☐ ☒ U.S. BLM
☐ ☒ U.S. Forest Svc.
☐ ☒ Water Dist. # _____
☐ ☒ Other _____

FINAL REGIONAL PROCESSING REVIEW

YES NO

☒ ☒ Affidavit of publication received:
☒ ☐ Application published correctly: If not, record action taken.
Paper Called Advertised on Jan. 22 & 29, 1990.
Changing the printed Date To February 8th 1990 JLS
☒ ☒ Publication dates and paper recorded on application: February 8, 1990
☐ ☒ Protests received. Final date for protest February 8, 1990
☐ ☒ Protest dates, resolution of protest recorded on application:
☐ ☒ Recommendations attached: Approve, Dm
☐ ☒ Measuring device required:
☐ ☒ Measuring port required:
☒ ☐ Water delivered by water master? District # 63-P05
☒ ☐ Special conditions of approval or cover letter:
01G, 26A (Allow 2 years)

See below for additional information
Recommended Date or Priority 12/6/1989 ✓
Recommended by: Dm Date 3/1/90

STATE OFFICE REVIEW

P05, P23, P03, P17 46 26 01G
See below for additional information. By EW Date 3-27-90

ADDITIONAL INFORMATION

63-07446 For Domestic in Name of
Karcher Ranchettes Groundwater Source

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Western Region
2735 AIRPORT WAY

Boise, Idaho 83705
(208) 334-2190

JANUARY 10, 1990

Press-Tribune
P.O. Box 9399
Nampa, ID 83652

Dear Legal Dept.:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before FEBRUARY 5, 1990.

Yours truly,

GAIL GARRETT
Secretary

Encl.

MICROFILMED

APR 19 1990

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO)
) ss.
County of Canyon)

RECEIVED
JAN 30 1990

NOTICE OF APPLICATION FOR WATER RIGHT

The Following application(s) have been filed to appropriate the public waters of the State of Idaho:

63-11074 ✓
KARCHER RANCHETTES WATER CORP.
C/O JAMES FINGERLOS
13711 JARETT ST.
CALDWELL, ID 83605
Source: GROUNDWATER
Diversión Pt:
Use: IRRIGATION
DOMESTIC

SENW

Sec 14 T 03N R 03W
(.600 CFS)
(.400 CFS)
Total Diversión: (1.000 CFS)

Date Filed: 12/06/1989
In: T03N R03W S14
30.0 ACRES TOTAL

SENW

63-11088

TOMLINSON, JULIA
TOMLINSON, FLOYD
2629 TRACK RD.
MELBA, ID 83641
Source: GROUNDWATER
Diversión Pt:
Use: IRRIGATION

NESW Sec 23 T 01N R 02W
(1.060 CFS)
(.400 CFS)
Total Diversión: (1.060 CFS)

Date Filed: 12/28/1989
In: T01N R02W S23
53.0 ACRES TOTAL
DILLON, THOMAS E.
RT. 1 BOX 310
MIDDLETON, ID 83644

SENW

63-11089

Source: WASTE WATER
Diversión Pt:
Use: IRRIGATION
IRRIGATION STORAGE
IRRIGATION FROM STORAGE
Total Diversión:

SENWSE

(.900 CFS)

Tributary: WILLOW CREEK
Sec 28 T 05N R 02W

(20.00 AF)
(20.00 AF)
(20.00 AF)

Date Filed: 12/28/1989
In: T05N R02W S28
45.0 ACRES TOTAL

SENW

NESW

NWSE

63-11093

CLIFFORD, DONNA R.
8001 BUTTE RD.
MELBA, ID 83641
Source: SPRING
Diversión Pt:
Use: IRRIGATION
STOCKWATER
RECREATION

Tributary: SNAKE RIVER
NWNENE Sec 10 T 01S R 02W
(.200 CFS)
(.020 CFS)
(.200 CFS)
Total Diversión: (.200 CFS)

Date Filed: 12/29/1989
In: T01S R02W S10
10.0 ACRES TOTAL

NENE

63-11094

LOWE, DERALD W.
RT. 1, S. ROBINSON RD.
KUND, ID 83634
Source: GROUNDWATER
Diversión Pt:
Use: IRRIGATION

NESE

Sec 31 T 02N R 01W
(1.680 CFS)
Total Diversión: (1.680 CFS)

Date Filed: 12/29/1989
In: T02N R01W S31
84.0 ACRES TOTAL

NESE

NWSE

SESE

The permit(s) will be subject to all applicable rules. Protests must be filed with the Director, Dept. of Water Resources, 1500 North Way, Boise, Idaho 83705 on or before FEBRUARY 8, 1990.

R. KEITH HIGGINSON, Director
January 22, 29, 1990

RECEIVED
JAN 20 1990

of Nampa, Canyon County, Idaho, being first duly sworn, deposes and says:

1. That I am a citizen of the United States of America, and at all times hereinafter mentioned was over the age of eighteen years, and not a party to the above entitled action.

2. That I am the Principal Clerk of the Idaho Press-Tribune, a daily, (except Saturday) newspaper published in the City of Nampa and Caldwell, in the County of Canyon, State of Idaho; that the said newspaper is in general circulation in the said County of Canyon, and in the vicinity of Nampa and Caldwell, and has been uninterruptedly published in said County during a period of seventy-eight consecutive weeks prior to the first publication of the notice, a copy of which is hereto attached.

3. That the notice, of which the annexed is a printed copy, was published in said newspaper two times —in the regular and entire issue of said paper, and was printed in the newspaper proper, and not in a supplement.

4. That said notice was published the following dates:

January 22, 29, 1990

STATE OF IDAHO)
)
COUNTY OF CANYON)

On this 29th day of January in the year of 1990, before me, a Notary Public, personally appeared Rebecca Stiehl, known or identified to me to be the person whose name subscribed to the within instrument, and being by me first duly sworn, declared that the statements therein are true, and acknowledged to me that he/she executed the same.

Janet Lusk
Notary Public for Idaho
Residing at Nampa

MY COMMISSION EXPIRES
JULY 12th, 1991

63-11074

KARCHER RANCHETTES WATER CORP.
C/O JAMES FINGERLOS
13711 JARETT ST.
CALDWELL, ID 83605

Source: GROUNDWATER

Diversion Pt: SENW Sec 14 T 03N R 03W

Use: IRRIGATION (.600 CFS)
 DOMESTIC (.400 CFS)
 Total Diversion: (1.000 CFS)

Date Filed: 12/06/1989

In: T03N R03W S14 SENW

30.0 ACRES TOTAL

RECORDED

APR 18 1990