

[illegible]

(Include distance from pump to measuring device, if applicable.)

Point(s) of diversion:

✓ JENE, S. 10, T. 3N, R. 3E.

Place(s) of Use

[illegible]☒ None☐ Other

Examiner's Signature

Checked by

Approved by

Date

Date

Date

State of Idaho
Department of Water Resources



WATER RIGHT LICENSE

License No. 63-10179 Priority 08/15/1983 Amount 0.02 CFS 0.4 AF

THIS IS TO CERTIFY, that U.S. Dept. of Interior, Bureau of Land Mgmt.

of Boise, Idaho, has complied with the terms and conditions of Permit No. 63-10179 issued pursuant to Application for Permit dated 08/15/1983, and has submitted proof to the Department of Water Resources on 08/15/1983, that he has applied water to a beneficial use; and examination by the Department indicates that the works have a capacity for the diversion of 0.02 cfs of water from a spring tributary to Warm Springs Creek, and that the permit holder has applied to a beneficial use and established a right to use water as follows:

RATE OF DIVERSION	VOLUME	BENEFICIAL USE	PERIOD OF USE
0.02 cfs	0.4 af	Stockwater	01/01 - 12/31
0.02 cfs	0.4 af	Wildlife	01/01 - 12/31

Location of point of diversion: SENE, Sec. 10, Twp 3N, Rge 3E, Ada Co.

Location of place of use:

TWP.	RGE.	SEC.	NE¼				NW¼				SW¼				SE¼				TOTALS
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	
3N	3E	10				X													

Total number of acres irrigated _____

Use of water under this license is subject to control by the watermaster of State Water District No. 63, Boise River. Also known as Wire Spring.

Subject to all prior water rights.

MICROFILMED

NOTE: Modifications to or variance from the use of water as shown on this license must be made in accordance with Section 42-222, Idaho Code, or the applicable Idaho law. This right may be forfeited by five years of non-use.

The right to the use of the water hereby confirmed is restricted and appurtenant to the lands or place of use herein described, as provided by the laws of Idaho.

Witness the seal and signature of the Director, affixed at Boise, Idaho this 25TH day of July, 1986.

Acting for the Director

Norman C Young
fw

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

RECEIVED

AUG 15 1983

APPROVED

To appropriate the public waters of the State of Idaho

Department of Water Resources

1. Name of applicant U.S. Dept. of Interior, Bureau of Land Mgmt. Phone 334-1582
Post office address 3948 Development Avenue, Boise, Idaho 83705
2. Source of water supply Unnamed spring development which is a tributary of Warm Springs Cr.
3. Location of point of diversion is SE $\frac{1}{4}$ of NE $\frac{1}{4}$ of Section 10 Township 3N
Range 3E B.M. Ada County, additional points of diversion if any: _____

4. Water will be used for the following purposes:

Amount 0.02 cfs for for stockwater purposes from 1/1 to 12/31 (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

Amount 0.02 cfs for for wildlife purposes from 1/1 to 12/31 (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated:

a. 0.02 cubic feet per second and/or b. _____ acre-feet per annum.

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc. Spring box B pipe to trough

b. Height of storage dam _____ feet, active reservoir capacity _____ acre-feet; total reservoir capacity _____ acre-feet, materials used in storage dam: _____

Period of year when water will be diverted to storage _____ to _____ inclusive.
(Month/Day) (Month/Day)

c. Proposed well diameter is _____ inches; proposed depth of well is _____ feet.

7. Time required for the completion of the works and application of the water to the proposed beneficial use is 1 years (minimum 1 year - maximum 5 years).

8. Description of proposed uses:

a. If water is not for irrigation:

(1) Give the place of use of water: SE $\frac{1}{4}$ of NE $\frac{1}{4}$ of Section 10 Township 3N
Range 3E B.M.

(2) Amount of power to be generated: _____ horsepower under _____ feet of head.

(3) List number of each kind of livestock to be watered Cattle- 25 Sheep- 25

(4) Name of municipality to be served _____, or number of families to be supplied with domestic water _____.

(5) If water is to be used for other purposes describe: Wildlife

MICROFILMED

b. If water is for irrigation, indicate acreage in each subdivision in the tabulation below:

TWP	RANGE	SEC.	NE¼				NW¼				SW¼				SE¼				TOTALS
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	

Total number of acres to be irrigated _____

c. Describe any other water rights used for the same purposes as described above. _____

9. a. Who owns the property at the point of diversion U.S. Government

b. Who owns the land to be irrigated or place of use U.S. Government

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing _____

10. Remarks The applicants include the Bureau of Land Management and permittees in:

Allotment(s): Boise FRONT (0309)

The permittees cooperating in this project include:

Id. State Fish & Game Dept.

Dallas Harris

Harold Prew

Project No.: 5425 Wire Spring

MICROFILMED

11. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

3E

10

10

3N

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Charles B Jones Acting A.M.
(Applicant)

RECEIVED

Proposed Priority 8/15/83

Received by SEC Date 8-18-83 Time 10:00
Preliminary check by LHS Fee \$ 30.00 ID-910-BP3-0003
Receipted by tg Date 12-27-83 # 33664
Publication prepared by JP Date 9/8/83
Published in Idaho Statesman
Publication dates 9/15 & 9/22/83
Publication approved JP Date 9/27/83
Protests filed by: none

Copies of protests forwarded by _____
Hearing held by _____ Date _____
Recommended for approval denial by OPS KW

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. 63-10179, and said application is hereby APPROVED.

1. Approval of said application is subject to the following limitations and conditions:

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
- b. Proof of construction of works and application of water to beneficial use shall be submitted on or before February 1, 19 85.
- c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.
- d. Other: Use of water under this permit is subject to control by the watermaster of State Water District No. 63, Boise River.

Witness my hand this 9th day of January, 1984.

L. Glen Saylor
Chief, Operations Bureau

NOTICE OF APPLICATION
FOR WATER RIGHT
The following application(s) have
been filed to appropriate the public
waters of the State of Idaho:
63-10171
GUNTER, ROBERT A. &/or DORIS N.
4540 FREEDOM DR.
MERIDIAN, ID 83642
Source: GROUNDWATER
Date Filed: 06/22/1983
Diversion Point: NWSE Sec 33 T 04N
R 01E
Use: IRRIGATION (0.03 CFS)
DOMESTIC (0.02 CFS)
In: NWSE Sec 33 T 04N R 01E FOR 1
ACRES
63-10172

SILVER SAGE
G RL SCOUT COUNCIL
8536 PEMBROOK, BOISE, ID 83704
Source: GROUNDWATER
Date Filed: 09/07/1983
Diversion Point: NWNE Sec 12 T 03N
R 01E
Use: DOMESTIC (0.04 CFS)
In: NWNE Sec 12 T 03N R 01E
63-10176

U.S. DEPT. OF INTERIOR
BUREAU OF LAND MGMT.
IDAHO STATE OFFICE
3380 AMERICANA TERRACE
BOISE, ID 83706
Source: SPRING trib. to MAYNARD
GULCH
Date Filed: 08/15/1983
Diversion Point: SWNW Sec 14 T 03N
R 03E
Use: STOCKWATER (0.02 CFS)
WILDLIFE (0.02 CFS)
In: SWNW Sec 14 T 03N R 03E
63-10177

U.S. DEPT. OF INTERIOR
BUREAU OF LAND MGMT.
IDAHO STATE OFFICE
3380 AMERICANA TERRACE
BOISE, ID 83706
Source: SPRING trib. to WARM
SPRINGS CREEK
Date Filed: 08/15/1983
Diversion Point: NWNE Sec 15 T 03N
R 03E
Use: STOCKWATER (0.02 CFS)
WILDLIFE (0.02 CFS)
In: NWNE Sec 15 T 03N R 03E
63-10178

U.S. DEPT. OF INTERIOR
BUREAU OF LAND MGMT.
IDAHO STATE OFFICE
3380 AMERICANA TERRACE
BOISE, ID 83706
Source: SPRING trib. to WARM
SPRINGS CREEK
Date Filed: 08/15/1983
Diversion Point: NWSE Sec 10 T 03N
R 03E
Use: STOCKWATER (0.02 CFS)
WILDLIFE (0.02 CFS)
In: NWSE Sec 10 T 03N R 03E
63-10179

U.S. DEPT. OF INTERIOR
BUREAU OF LAND MGMT.
IDAHO STATE OFFICE
3380 AMERICANA TERRACE
BOISE, ID 83706
Source: SPRING trib. to WARM
SPRINGS CREEK
Date Filed: 08/15/1983
Diversion Point: SENE Sec 10 T 03N
R 03E
Use: STOCKWATER (0.02 CFS)
WILDLIFE (0.02 CFS)
In: SENE Sec 10 T 03N R 03E
63-10180

U.S. DEPT. OF INTERIOR
BUREAU OF LAND MGMT.
IDAHO STATE OFFICE
3380 AMERICANA TERRACE
BOISE, ID 83706
Source: SPRING trib. to MAYNARD
GULCH
Date Filed: 08/15/1983
Diversion Point: SWNE Sec 14 T 03N
R 03E
Use: STOCKWATER (0.02 CFS)
WILDLIFE (0.02 CFS)
In: SWNE Sec 14 T 03N R 03E
The permit(s) will be subject to all
prior water rights. Protests must be
filed with the Director, Department of
Water Resources, Western Region,
Statehouse, Boise, Idaho 83720 on or
before OCTOBER 3, 1983.
A. KENNETH DUNN
Director
Pub Sept. 15, 22, 1983 3077

STATE OF IDAHO)
) ss.
COUNTY OF ADA)

Susan K. Mayer, being duly
sworn, deposes and says: That she is the Principal
Clerk of The Idaho Statesman, a daily newspaper
printed and published at Boise, Ada County, State
of Idaho, and having a general circulation therein
and which said newspaper has been continuously and
uninterruptedly published in said County during a
period of twelve consecutive months prior to the
first publication of the notice, a copy of which
is attached hereto; that said notice was published
in the regular edition of The Idaho Statesman for

two insertions, beginning with the
issue of September 15, 1983, and ending with the
issue of September 22, 1983.

Susan K. Mayer
Subscribed and sworn to before me this 22nd
day of September, 1983.

Dorothy Engman
Notary Public for Idaho, Residing at Boise, Idaho



State of Idaho
DEPARTMENT OF WATER RESOURCES
STATE OFFICE, 450 W. State Street, Boise, Idaho

JOHN V. EVANS
Governor

A. KENNETH DUNN
Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 334-4440

July 28, 1986

RE: Permit Nos. 37-8048/8164, 51-7182/7184/7187/7210/7216/7220/7230/
7235, 55-7195/7196, 55-7213 thru 55-7217, 55/7224
7237/7280/7291/7302/7333, 57-7163/7164/7321/7329/
7341/7344, 61-7453/7454, 63-9755, 63-10174 thru
63-10180, 63-10196/10199/10200/10201, 65-12673
thru 65-12680, 65-12682 thru 65-12686, 65-12689,
67-7642 thru 67-7647, 67-7653, 67-7657 thru
67-7665, 67-7670, 67-7672 thru 67-7675, 69-7078,
82-7138, 85-7403 thru 85-7407

U.S. Dept. of Interior
Bureau of Land Mgmt.
Idaho State Office
3380 Americana Terrace
Boise, ID 83706

Gentlemen:

Enclosed herewith are copies of the Water Right Licenses issued on the
above referenced permits.

Sincerely,

JIM JOHNSON
Water Rights Supervisor

JJ:sc

Enclosures

MICROFILMED

RECEIVED

MAR 18 1986

State of Idaho
DEPARTMENT OF WATER RESOURCES
WATER RIGHT BENEFICIAL USE FIELD REPORT

B.L.M.

Department of Water Resources

63-10179

KEYPUNCHED
Permit No.

CONTACT WITH PERMIT HOLDER

DATE

INITIALS

REMARKS

☐ Appointment letter mailed:☒ Telephone call made

(List Telephone No. used)

☒ Appointment scheduled for:

(Date, time, location)

4/26/84 JG

B.L.M.

4/26/84 JG

BOISE DIST. - Cascade Resource Area

EXAMINATION

Date 4/26/84 Accompanied by Gene Decker Total Q measured .02 cfs - est.

Source spring Tributary to when spgs Cr. Supp. annubar measurement sheet used?

If source is surface water, estimate total flow of source

Methods of measurement estimated Meets permit requirements?

Measurement calculations: 25 hd cattle x .0134 = 0.3 afa/year + 0.6 = 0.36 afa/year
25 hd sheep x 2 gal/day x 365 days/year ÷ 325,850 gal/acre foot = .06 afa/year
Stockwater - .02 cfs + .4 afa
Wildlife - .02 cfs + .4 afa

WELL/DIV. NO.*	HP	MOTOR MAKE	MOTOR SERIAL NO.	PUMP MAKE	PUMP SERIAL NO.	MEASURING DEVICE TYPE	CONDITION OF MEAS. DEVICE	REMARKS
			N/A					

System Description Collection till w/headbox + pipeline to place of use (trough).

*Code with map on reverse side. Disregard code if only one.

RECOMMENDED AMOUNTS

Irrigation requirement =

AFA/Acre

USE	Q (cfs)	V (afa)	FROM	TO
Stockwater - 50 hd total	.02 ✓	.4 ✓	1-1	12-31
Wildlife ✓ misc.	.02 ✓	.4 ✓	1-1	12-31
Total	.02 cfs ✓	.4 afa ✓		

Remarks

AKA Wire Spring, Project No. 5425

MICROFILMED

MICROFILMED

[illegible]

(Include distance from pump to measuring device, if applicable.)

Point(s) of diversion:

✓ JENE, S. 10, T. 3N, R. 3E.

Place(s) of Use

[illegible]☐ Other

Examiner's Signature


Checked by

Approved by _____

Date _____

Date _____

Date _____

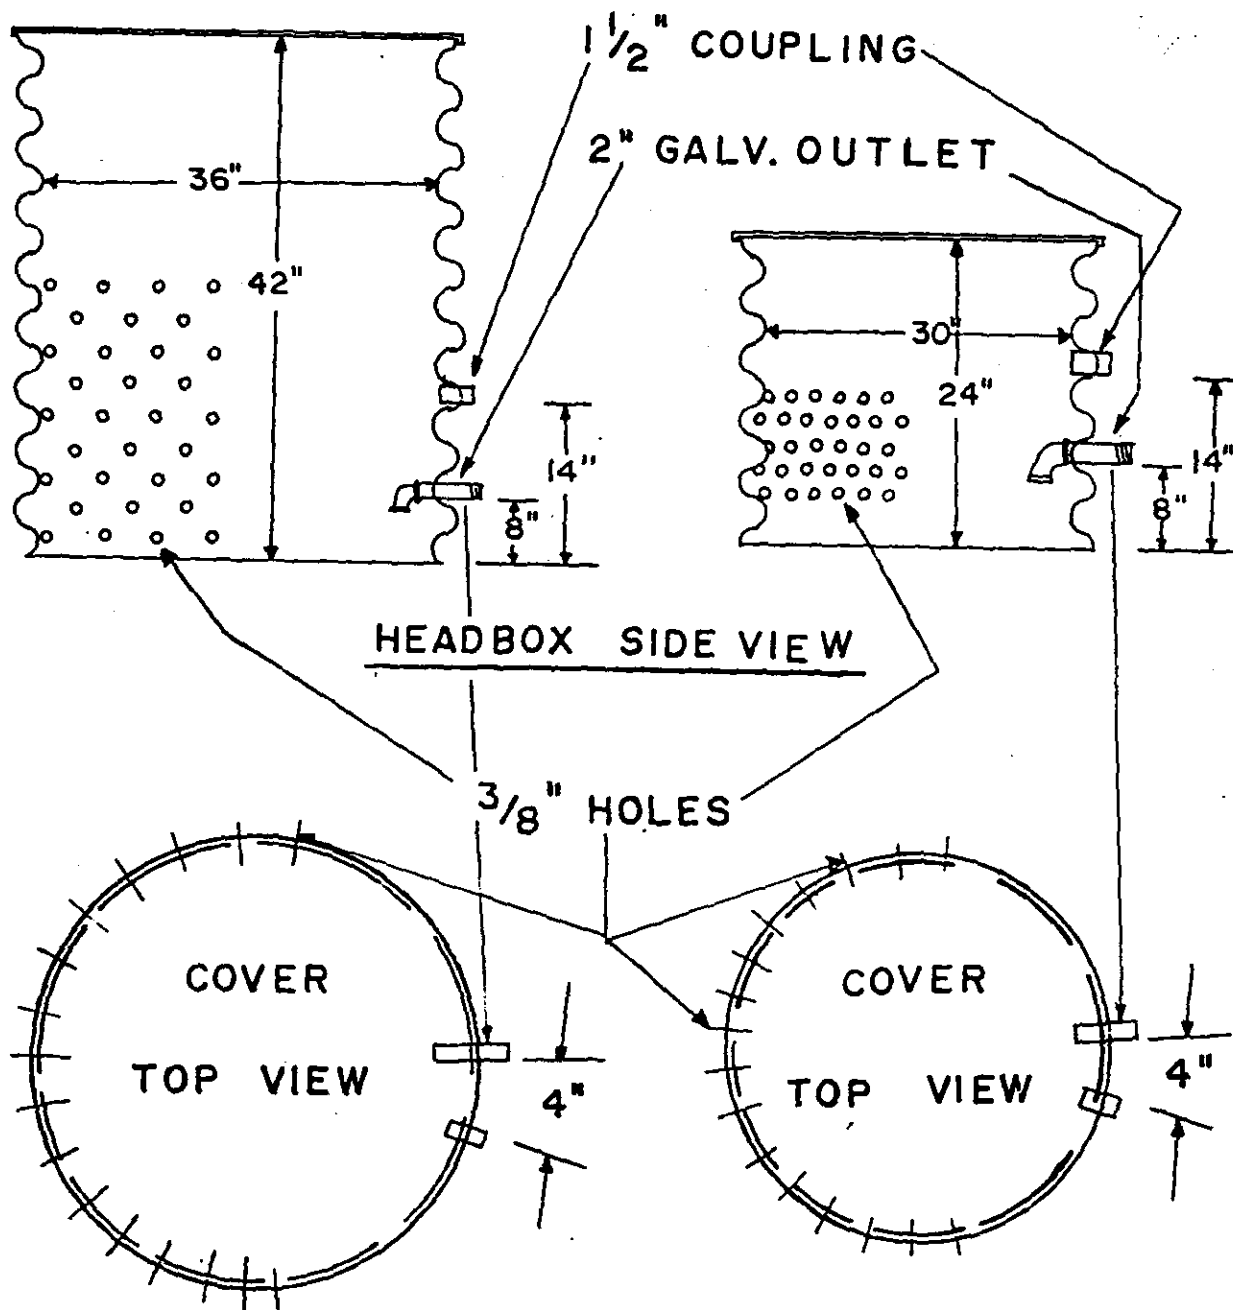

U. S. DEPARTMENT OF THE INTERIOR
BUREAU OF LAND MANAGEMENT

SPRING HEADBOX & COVER DIAGRAM

DESIGNED _____

RECOMM. _____

DRAWN _____

RECOMM. _____

CHIEF, DIV. OF ENG.

CHECKED _____

APPROVED _____

SCALE **NONE**

DATE _____

SHEET _____ OF _____

DRAWING NO. _____

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Western Region

Statehouse
Boise, Idaho 83720
(208) 334-2190

APRIL 25, 1984

BUREAU OF LAND MGMT. U.S. DEPT. OF INTERIOR
IDAHO STATE OFFICE
3380 AMERICANA TERRACE
BOISE ID 83706

RE: Permit No. 63-10179

Dear Permit Holder:

We acknowledge receipt of your statement submitted as proof of beneficial use for the above referenced permit.

Enclosed please find a copy of an order involving your permit.

Before a license can be issued, a field examination must be made by a representative of this department.

A field examiner will contact you to arrange to examine your system.

If you have any questions regarding the field examination, please contact this office by phone at 334-2190 or in person in the third floor State Towers Building, 450 West State Street, Boise.

Sincerely,
s/Judy Pense
Secretary

Enclosure

MICROFILMED



State of Idaho

DEPARTMENT OF WATER RESOURCES

STATE OFFICE, 450 W. State Street, Boise, Idaho

JOHN V. EVANS
Governor

A. KENNETH DUNN
Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 334-4440

February 10, 1984

Boise District Bureau of Land Management
3948 Development Avenue
Boise, ID 83705

Gentlemen:

Re: Permit No. See attached list

This office acknowledges receipt of the statement of beneficial use postcard submitted for this permit received on August 15, 1983.

Before a license can be issued, a field examination must be made by a representative of this department. We cannot tell just when this examination will be made, but our examiner will contact you to schedule the exam at a convenient time.

If you have any questions regarding the field examination, please contact our Western Regional office at 334-2190.

Sincerely,

RITA I. FLECK
Secretary/Records Manager

cc: Western Region

FILED

DEPARTMENT OF WATER RESOURCES

The Idaho Department of Water Resources will consider this permit as a statement that the permit holder has completed development to the extent shown below of Permit No. 63-10179

Name(s) of Permit Holder: Bureau of Land Management
Boise District Office
Post Office Address: 3948 Development Ave.
Boise, Idaho 83705 Tel. No. 334-1582

Source of Water: Unmanned spring 5425
Extent of Use: ☐ Domestic (number of households)
☒ Stockwater Cattle-25, Sheep-25 (number and type of stock)
☐ Irrigation (acres)
☒ Other Wildlife

Measuring Device: Required? ☐ Yes ☒ No Installed? ☐ Yes ☒ No
Access Port: Required? ☐ Yes ☒ No Installed? ☐ Yes ☒ No

The above information is a true statement of the extent to which the above numbered permit has been developed.

5/10/83
Date

Charles B. Jones
Signature of Permit Holder
Acting Admin

PLACE
TEN CENT
STAMP
HERE

RECEIVED

AUG 18 1983

Department of Water Resources
Western Regional Office



RECEIVED

AUG 15 1983

Department of Water Resources
Department of Water Resources

IDAHO DEPARTMENT OF WATER RESOURCES
STATEHOUSE
BOISE, IDAHO 83720



State of Idaho

DEPARTMENT OF WATER RESOURCES

STATE OFFICE, 450 W. State Street, Boise, Idaho

JOHN V. EVANS
Governor

A. KENNETH DUNN
Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 334-4440

January 11, 1984

RE: Application for Permit No's. 55-7337, 63-10174/10175/10176/
10177/10178/10179/10180/10196/10199/10200, 65-12676/12677/
12678/12679/12682, 67-7653/7656/7657/7659/7660/7661/7662/
7663/7673/7474/7475, 69-7078

U.S. Dept. of Interior
Bureau of Land Management
Idaho State Office
3380 Americana Terrace
Boise, ID 83706

Gentlemen:

Enclosed are copies of your approved Applications for Permit. We direct your attention to the conditions of approval on the fourth pages.

Sincerely,

DAVID R. TUTHILL, JR., P.E.
Supervisor, Water Allocation Section

DRT:sc

Enclosures

RECEIVED
JAN 15 1984

State of Idaho
Department of Water Resources

APPLICATION FOR PERMIT ANALYSIS SHEET

INITIAL REVIEW BY: GLS

APPLICATION NUMBER: 63-10179

CHECK:

- ☒ Source.
☒ Point of diversion.
☒ County.
☒ Quantity of water and period of use.
☒ Description of diverting works.
☒ Time required for beneficial use of water.
☒ Place of use or acres irrigated.
☒ Map.
☒ Signature.

Field check by: _____

Date: _____

Comments: _____

☒ Fee.

☐ Yes ☒ No

Field check required.

☐ Yes ☒ No

Critical groundwater area.

☐ Yes ☒ No

Request dam safety information. Sent by: _____ Date: _____

☒ Yes ☐ No*

In form to receipt.

*REQUEST THE FOLLOWING ADDITIONAL INFORMATION FROM THE APPLICANT: _____

SEND COPIES TO:

- ☐ Idaho State Health Department.
☐ Idaho Fish and Game Department.
☐ Idaho Department of Lands.
☐ U.S. Bureau of Land Management.
☐ U.S. Forest Service.
☐ Other _____

Copies sent by: _____ Date: _____

PROCESSING:

☐ Yes ☐ No

Platted by: _____ Map No. _____

☐ Yes ☒ No

Other rights on same place of use. _____

☒ Yes ☐ No*

In form for advertising.

Final date for protests: October 3, 1983

☐ Yes ☐ No

Protests received. If yes, record information on 4th page of application.

FINAL REGIONAL PROCESSING REVIEW:

☒ Affidavit of publication received. Date: 9/23/83

☐ Application published correctly. If not, record action taken: _____

☒ Fee amount, receipt date & number, recorded on application. 30⁰⁰

☒ Publication dates and paper, recorded on application. Idaho Statesman 9/15 & 9/22/83

☒ Protests, dates, withdrawal, etc., recorded on application.

☒ Recommendation & initial, recorded on application.

☐ Yes ☒ No

Measuring device required.

☐ Yes ☒ No

Access port required.

☒ Yes ☒ No

Will water be delivered by watermaster? If yes, what district? 63

☒ 8/15/83

Date of priority recommended.

Special conditions of approval or cover letter. _____

Hold for fee

By: DPS

Date: 10/3/83

STATE OFFICE REVIEW:

05/63, Boise River

☐ See attached sheet for more information.

By: cu

Date: 1/5/84

Department of Water Resources

63-10179

U.S. DEPT. OF INTERIOR

BUREAU OF LAND MGMT., IDAHO STATE OFFICE, 3380 AMERICANA TERRACE,
BOISE, ID 83706

Source: SPRING trib. to WARM SPRINGS CREEK

Date Filed: 08/15/1983

Diversion Pt: SENE Sec 10 T 03N R 03E

Use: STOCKWATER	(0.02 CFS)
WILDLIFE	(0.02 CFS)

In: SENE Sec 10 T 03N R 03E

IDENT. NO. 63-10179

WATER RIGHT
DATA ENTRY LOG

[illegible]