
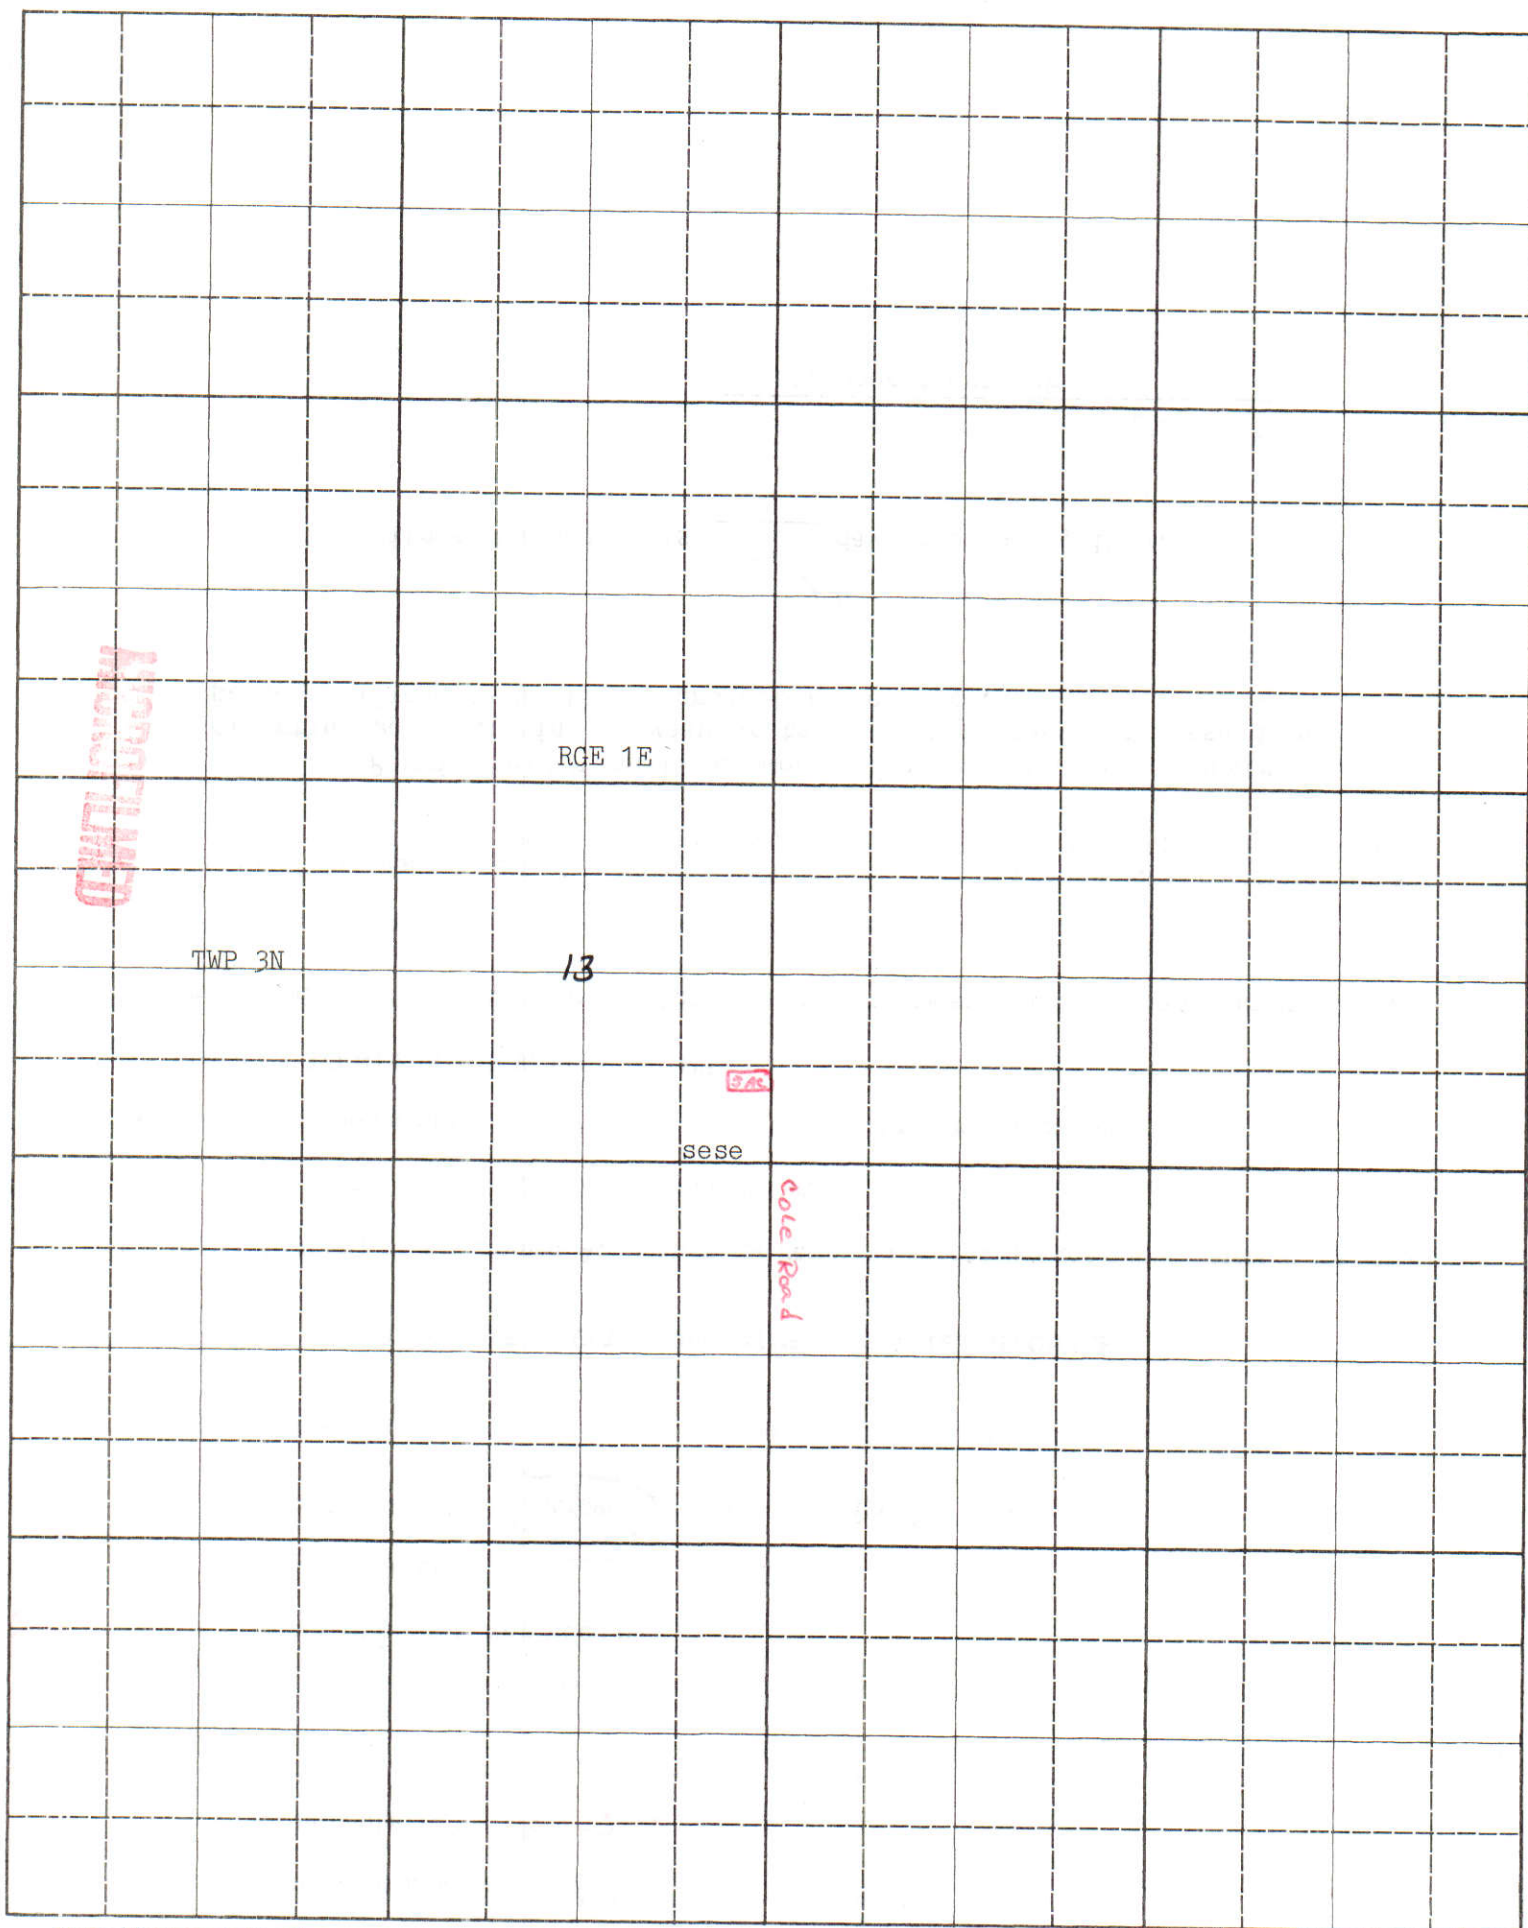


11. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

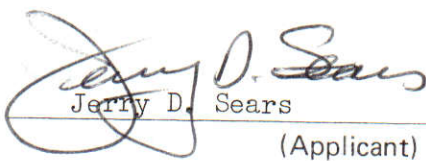

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.


Jerry D. Sears
(Applicant)

Project Representative
Temples & Special Projects - Const. Div.
Church of Jesus Christ of Latter Day Saints
Corporation of the President

5/20/2000 11:00 AM

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No. 63-10142
1. Owner: CHURCH OF JESUS CHRIST OF LATTER DAY SAINTS Phone No. 801-531-2929
Current Address: 50 E. NORTH TEMPLE ST SALT LAKE CITY, UT 84150
2. Accompanied by: BUD LLOYD ATTN: REAL ESTATE DEPT. EXAM. DATE: 11-07-88
Address: _____ Phone No. 322-4422
Relationship to Permit Holder: _____


3. Source: 2 WELLS tributary to _____
GROUND WATER (2 POINTS)

B. OVERLAP REVIEW

1. Other water rights with same place of use: DITCH CO. RIGHTS?
_____ ☐ Copies Attached
2. Other water rights with same point of diversion: NONE
_____ ☐ Copies Attached ☐ Copies of Field Exam's Attached

C. SYSTEM DESCRIPTION

1. **Diversion System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☐ Alternative diagram attached

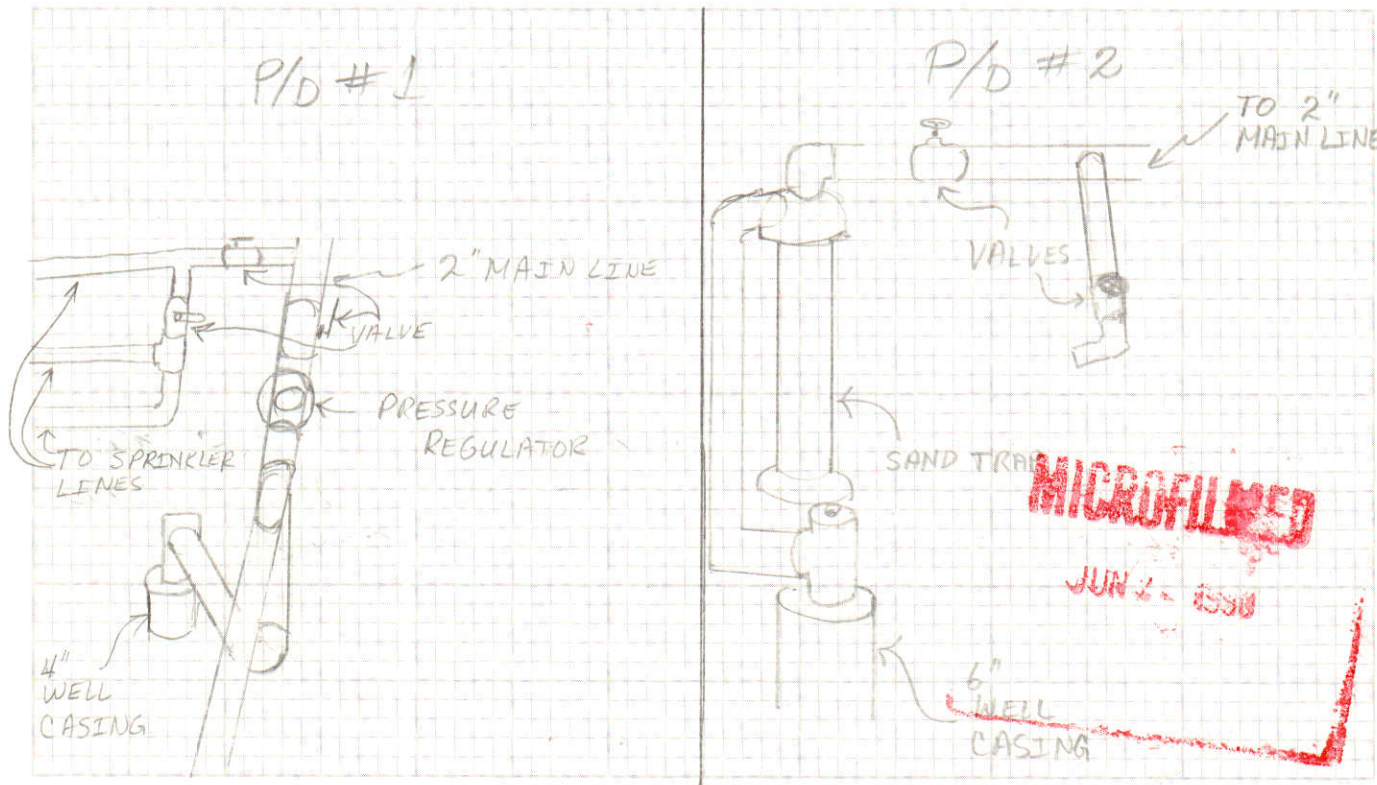


Scale: 1" = _____

2. ☐ Copy of U.S.G.S. Quadrangle Attached
Showing location(s) of point(s) of diversion and
place(s) of use (required). ☐ Aerial Photo Attached
(required for irrigation of 10 acres or more).
- ☐ Photo of Diversion and System Attached
(required for all but single household domestic groundwater, and stockwater).

IDAHO-ADA CO.
7.5 MINUTE SERIES (TOPOGRAPHIC)

2771
BOISE N.

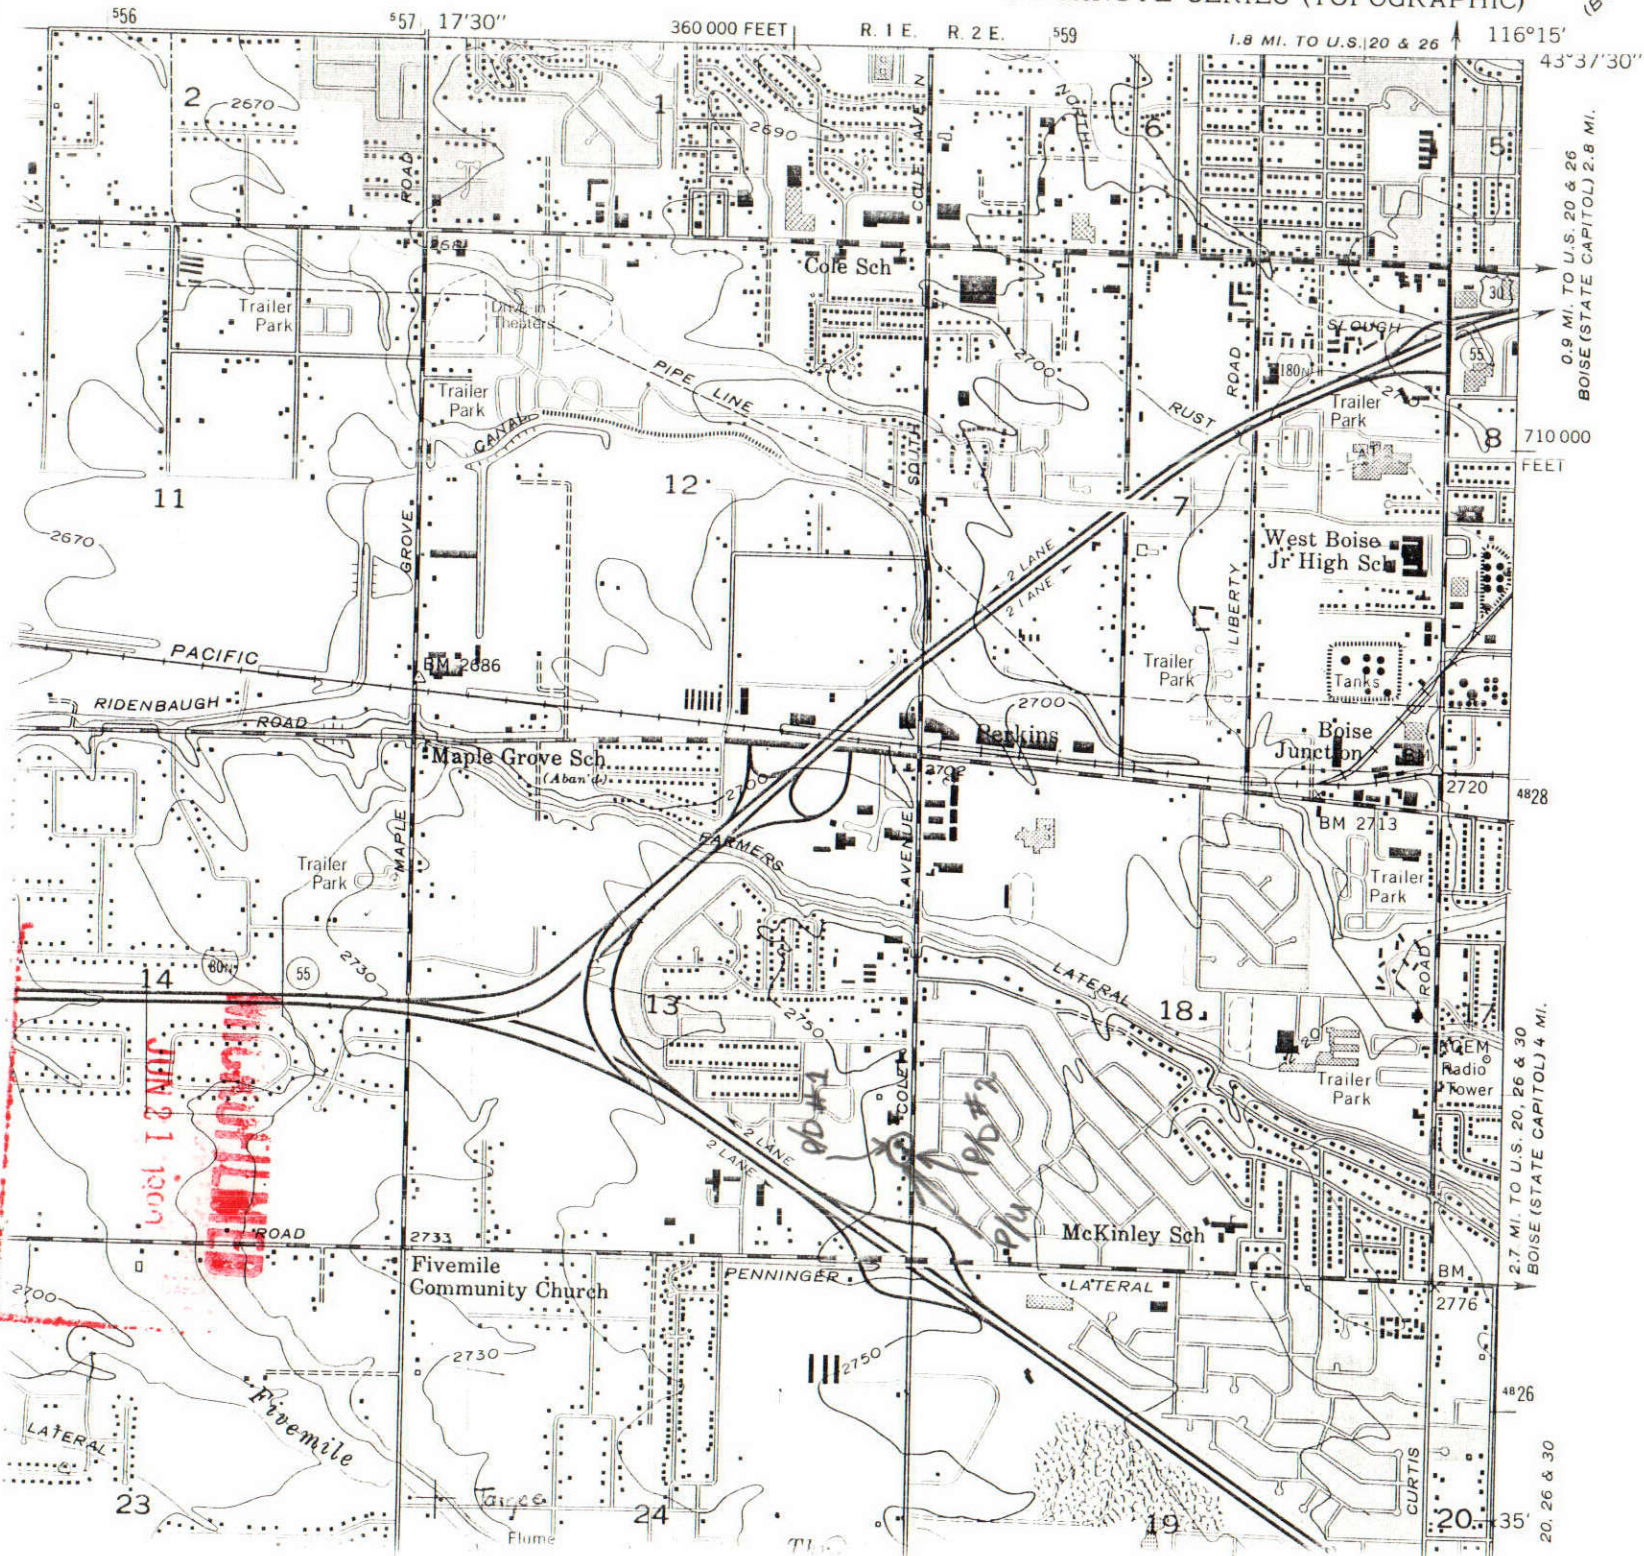

P/D # 1



P/D #2



MICROFILMED

JUN 21 1990

P/D #2

LOOKING SOUTH EAST



P/D #1

P/U


LOOKING WEST



MED

JUN 21 1990

Figure 1

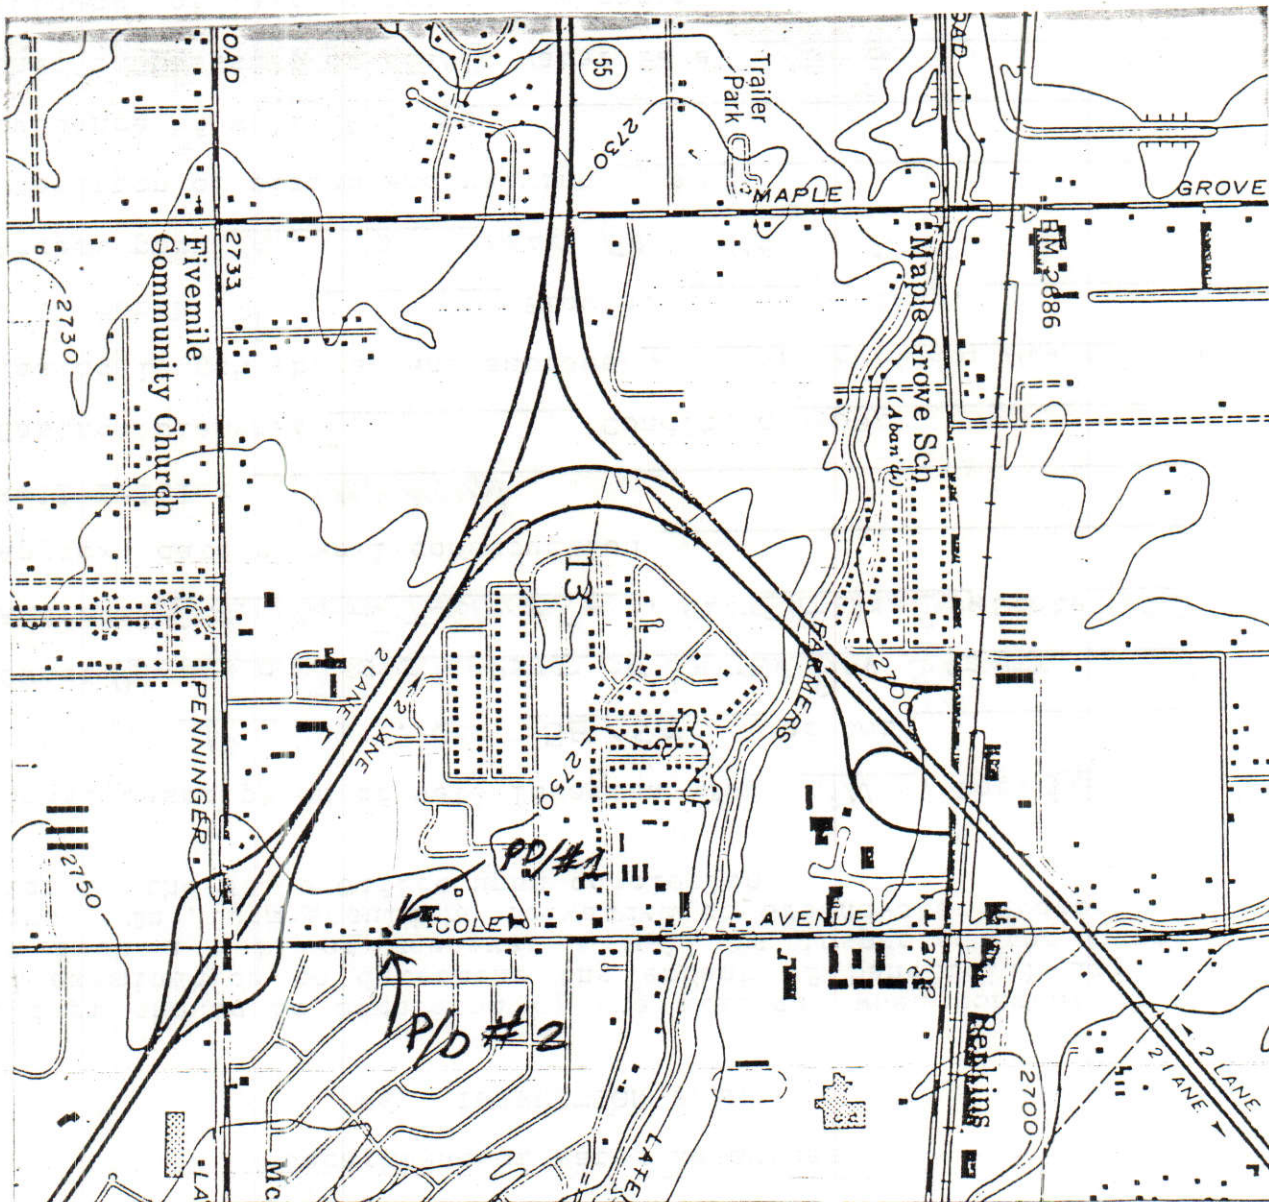

Kelly K Christensen


Date 11-07-88

RECEIVED

JUN 21 1990

SCHEMATIC

Provide a schematic diagram showing the location of the well in the quarter-quarter with respect to houses, roads, other wells or readily identifiable features.

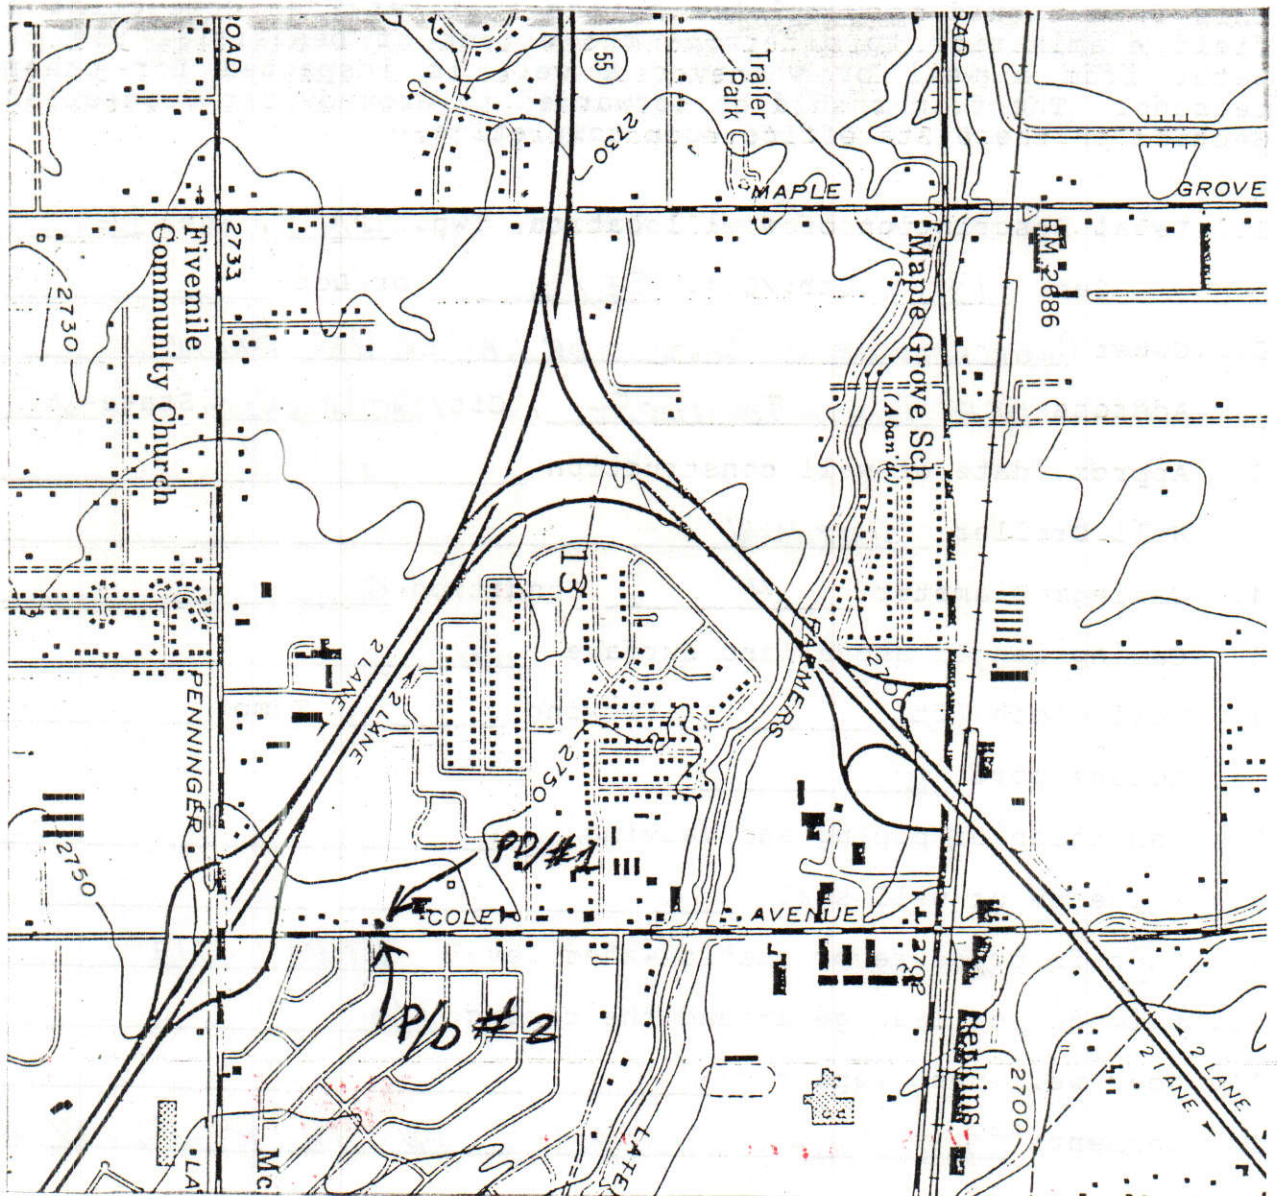

Inspected by Kelly K. Christensen

Date 11-07-88

MICROFILMED

JUN 21 1990

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE
WATER RIGHT NO. 63-10142

Priority: June 23, 1983

Maximum Diversion Rate: 0.12 CFS
Maximum Diversion Volume:¹ 5.9 AF

This is to certify, that CHURCH OF JESUS CHRIST LATTER DAY SAINTS
REAL ESTATE DEPT.
50 E. N. TEMPLE ST.
SALT LAKE CITY, UT 84150

has complied with the terms and conditions
of the permit, issued pursuant to Application for Permit dated June 23, 1983; and
has submitted Proof of Beneficial Use on August 15, 1988. An examination indicates
that the works have a diversion capacity of .140 cfs of water from a **GROUNDWATER**
source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
IRRIGATION	03/15 to 11/15	0.12 CFS	5.9 AF

LOCATION OF POINT(S) OF DIVERSION: SESE , Sec. 13, Township 03N, Range 01E
ADA County

PLACE OF USE: IRRIGATION

<u>TWN</u>	<u>RGE</u>	<u>SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
03N	01E	13	SESE	1.3		1.3

Total number of acres irrigated: 1.3

CONDITIONS/REMARKS:

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. 2 points of diversion located in SESE, S13, T3N, R1E.

MICROFILMED

JUN 21 1990

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 63-10142

This license is issued pursuant to the provisions of Section 42-219, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this 6TH
day of JUNE, 1990.

Acting for R. Keith Higginson, Director

MICROFILMED

JUN 21 1990

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

To appropriate the public waters of the State of Idaho

APPROVED

Church of Jesus Christ of Latter Day Saints

1. Name of applicant Corporation of the President Phone 801-531-2929

Post office address 50 E. North Temple St. Salt Lake City, UT 84150 ATTN: Real Estate Dept.

2. Source of water supply groundwater which is a tributary of _____

3. Location of point of diversion is SE $\frac{1}{4}$ of SE $\frac{1}{4}$ of Section 13 Township 3N

Range 1E B.M. Ada County, additional points of diversion if any: _____

2 Wells

4. Water will be used for the following purposes:

Amount .12 for Irrigation purposes from March 15 to Nov. 15 (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

Amount _____ for _____ purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)

5. Total quantity to be appropriated:

a. .12 cubic feet per second and/or b. _____ acre-feet per annum.

6. Proposed diverting works:

a. Description of ditches, flumes, pumps, headgates, etc. 4" well Pump - 8" well 5HP pump @ 45 gpm

b. Height of storage dam _____ feet, active reservoir capacity _____ acre-feet; total reservoir capacity _____ acre-feet, materials used in storage dam: _____

Period of year when water will be diverted to storage _____ to _____ inclusive.
(Month/Day) (Month/Day)

c. Proposed well diameter is 4" & 8" inches; proposed depth of well is _____ feet.

7. Time required for the completion of the works and application of the water to the proposed beneficial use is 5 years (minimum 1 year - maximum 5 years).

8. Description of proposed uses:

a. If water is **not** for irrigation:

(1) Give the place of use of water: _____ $\frac{1}{4}$ of _____ $\frac{1}{4}$ of Section _____ Township _____

Range _____ B.M. _____


(2) Amount of power to be generated: _____ horsepower under _____ feet of head.

(3) List number of each kind of livestock to be watered _____

(4) Name of municipality to be served _____, or number of families to be supplied with domestic water _____.


(5) If water is to be used for other purposes describe: _____

11. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number.

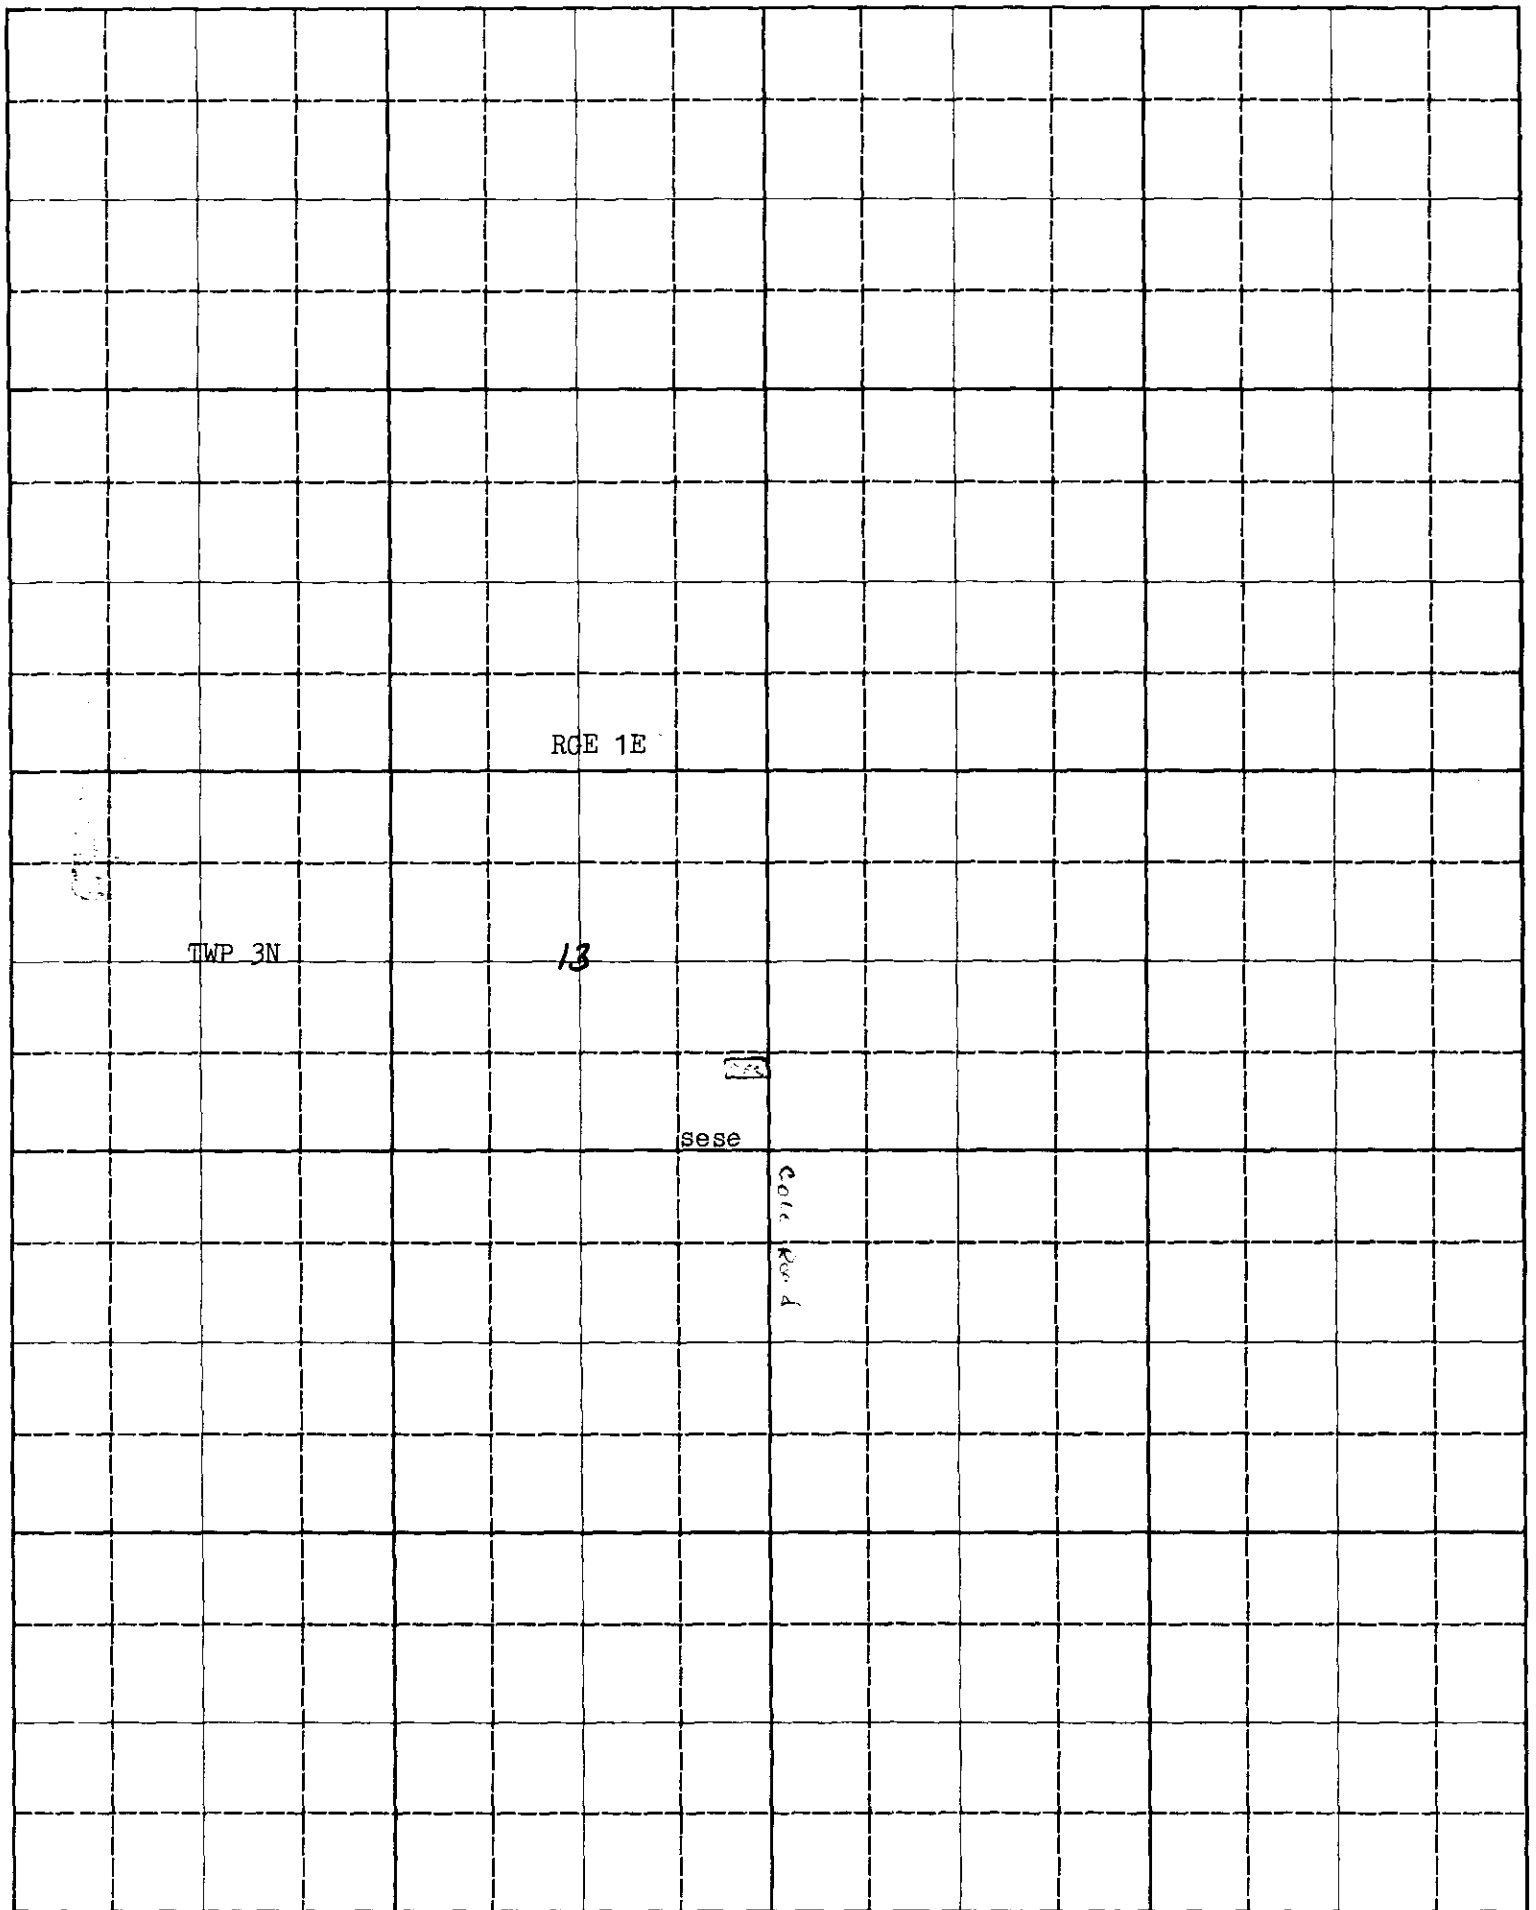

Scale: 2 inches equal 1 mile.

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

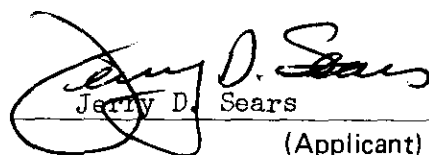
Jerry D. Sears

(Applicant)

Project Representative
Temples & Special Projects - Const. Div.
Church of Jesus Christ of Latter Day Saints
Corporation of the President

Proposed Priority 6/23/83

Received by AW Date 6/23/83 Time 10:55

Preliminary check by JS Fee \$ 30.00 - # 31147

Receipted by AW Date 6/24/83

Publication prepared by JP Date 8/18/83

Published in Statesman

Publication dates 8/25 & 9/1/83

Publication approved see Date 9/7/83

Protests filed by: none

Copies of protests forwarded by _____

Hearing held by _____ Date _____

Recommended for approval denial by DBS KW

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. 63-10142, and said application is hereby APPROVED.

1. Approval of said application is subject to the following limitations and conditions:

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
- b. Proof of construction of works and application of water to beneficial use shall be submitted on or before October 1, 19 88.
- c. The rate of diversion, if water is to be used for irrigation under this permit, when combined with all other water rights for the same land shall not exceed 0.02 cubic feet per second for each acre of land.
- d. Other: Permit holder shall commence the excavation or construction of diverting works within one year of the date this permit is issued and shall proceed diligently until the project is complete.

Witness my hand this 17th day of October, 1983.

A. Glen Saxton
Chief, Operations Bureau

**NOTICE OF APPLICATION
FOR WATER RIGHT**

The following application(s) have
been filed to appropriate the public
waters of the State of Idaho:

63-10130

WESTERN POWER SPORTS INC.
AND RELEASING
170 OVERLAND RD.
BOISE, ID 83709
Source: GROUNDWATER
Date Filed: 06/28/1983
Diversion Point: SWSE Sec 13 T 03N
R 01E
Use: DOMESTIC (0.08 CFS)
In: SWSE Sec 13 T 03N R 01E

63-10131

WILES, CURTIS G. &/or LINDA K.
120 LARRY LN.
MERIDIAN, ID 83642
Source: GROUNDWATER
Date Filed: 06/27/1983
Diversion Point: NENE Sec 28 T 04N
R 01W
Use: IRRIGATION (0.10 CFS)
DOMESTIC (0.04 CFS)
In: NENE Sec 28 T 04N R 01W FOR 5
ACRES

63-10132

THORNTON, MICHAEL J. &/or
DAYLE L.
72 E. BEACON LIGHT RD.
SAGE, ID 83616
Source: GROUNDWATER
Date Filed: 06/30/1983
Diversion Point: SWSW Sec 33 T 05N
R 01E
Use: IRRIGATION (0.32 CFS)
STOCKWATER (0.04 CFS)
DOMESTIC (0.04 CFS)
In: SWSW Sec 33 T 05N R 01E
FOR 16 ACRES

63-10140

ONAS, EVELYN M.
17 N. COLD RD., BOISE, ID 83704
Source: GROUNDWATER
Date Filed: 06/27/1983
Diversion Point: SENE Sec 12 T 03N
R 01E
Use: DOMESTIC (0.12 CFS)
In: SENE Sec 12 T 03N R 01E

63-10141

CHURCH OF JESUS CHRIST LAT-
TER-DAY SAINTS
WEST STAKE 3700 S. MAPLE
ROVE, BOISE, ID 83709
Source: GROUNDWATER
Date Filed: 06/27/1983
Diversion Point: SWNW Sec 25 T 03N
R 01E
Use: IRRIGATION (0.10 CFS)
DOMESTIC (0.07 CFS)
In: SWNW Sec 25 T 03N R 01E FOR 5
ACRES

63-10142

CHURCH OF JESUS CHRIST LAT-
TER-DAY SAINTS
CORP. OF THE PRESIDENT,
50 E. N. TEMPLE ST.,
ATTN. REAL ESTATE DEPT.,
SALT LAKE CITY, UT 84150
Source: GROUNDWATER
Date Filed: 06/23/1983
Diversion Point: SESE Sec 13 T 03N R
01E
Use: IRRIGATION (0.12 CFS)
In: SESE Sec 13 T 03N R 01E FOR 4
ACRES

The permit(s) will be subject to all
prior water rights. Protests must be
filed with the Director, Dept. of Water
Resources, Western Region, State-
house, Boise, Idaho 83720 on or before
SEPTEMBER 12, 1983.

A. KENNETH DUNN
Director

Pub. Aug 25, Sept. 1, 1983

2225

STATE OF IDAHO)

) ss.


COUNTY OF ADA)

Jill Backsen, being duly
sworn, deposes and says: That she is the Principal
Clerk of The Idaho Statesman, a daily newspaper
printed and published at Boise, Ada County, State
of Idaho, and having a general circulation therein
and which said newspaper has been continuously and
uninterruptedly published in said County during a
period of twelve consecutive months prior to the
first publication of the notice, a copy of which
is attached hereto; that said notice was published
in the regular edition of The Idaho Statesman for

two insertions, beginning with the
issue of August 25, 1983, and ending with the
issue of September 1, 1983.

Jill Backsen
Subscribed and sworn to before me this 1st
day of September, 1983.

Janice M. Gady
Notary Public for Idaho, Residing at Boise, Idaho

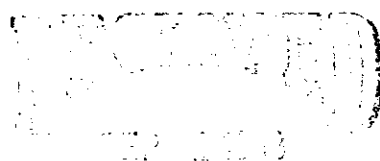

Department of Water Resources
Western Regional Office

June 8, 1990

CHURCH OF JESUS CHRIST LATTER DAY SAINTS
REAL ESTATE DEPT.
50 E. N. TEMPLE ST.
SALT LAKE CITY, UT 84150

RE: PERMIT NO. 63-10142

Dear Permit Holder(s):

Enclosed herewith is a copy of the Water Right License issued on the above referenced permit.

Sincerely,

JIM JOHNSON
Water Rights Supervisor

JJ:sc

Enclosure

MICROFILMED

JUN 21 1990

MEMORANDUM

TO: FILE

FROM: JIM JOHNSON

RE: GENERAL EVALUATION OF LAWN WATERING REQUIREMENTS

DATE: 05/15/90

=====

WATER REQUIREMENT FOR LAWNS*

1. Healthy lawns require about one inch of water per week or about 27,150 gallons/acre/week.
2. The maximum application rate that lawns can use without runoff is 0.25 inch/hour.
3. The sprinkler system should supply full supply in about 12 hours/week of operation.

EVALUATION OF DELIVERY SYSTEM

Hours of system operation:	9.5	hours
Land to be irrigated is (in acres):	1.3	acres
Gallons per week required:	35295	gallons
Rate required to supply full supply in (X) hrs/week.	61.9	gpm
	or	0.14 cfs
The rate per acre is:	0.11	cfs/acre
The application rate (inches per hour) is:	0.14	inch/hr

1. Absorption rates by soil types.

- a. Light sandy soils – 1.5" to 0.75" per hr.
- b. Medium textured soils – 0.75" to 0.50" per hr.
- c. Heavy textured soils – 0.50" to 0.20" per hr.

*Source Hydraulic Handbook, Colt Industries 1979, p.97

CONCLUSION

The rate of flow identified the field examiner will provide sufficient weekly volume with 9.5 hours of operation. The application rate for lawn watering does not exceed the absorption rate of the soil. Therefore the application rate for irrigation is acceptable.

MICROFILMED

JUN 21 1990

April 9, 1990

CHURCH OF JESUS CHRIST LATTER DAY SAINTS
REAL ESTATE DEPT.
50 E. N. TEMPLE ST.
SALT LAKE CITY, UT 84150

RE: PERMIT NO. 63-10142

Dear Permit Holder(s):

Enclosed is a draft copy of the license proposed to be issued on the above referenced water right.

This right is currently being reviewed by this office for licensing. The enclosed preliminary copy is subject to change upon further administrative review.

We ask that you review the proposed license and if you do not concur with the information, please let us know within 10 days.

Sincerely,

JIM JOHNSON
Water Rights Supervisor

JJ:sc

Enclosure

MICROFILMED

JUN 21 1990

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No. 63-10142

1. Owner: CHURCH OF JESUS CHRIST OF LATTER DAY SAINTS Phone No. 801-531-2929

Current Address: 50 E. NORTH TEMPLE ST SALT LAKE CITY, UT 84150

2. Accompanied by: BUD LLOYD ATTN: REAL ESTATE DEPT. EXAM. DATE: 11-07-88

Address: _____ Phone No. 322-4422

Relationship to Permit Holder: _____

3. Source: 2 WELLS tributary to _____
GROUND WATER (2 POINTS)

B. OVERLAP REVIEW

1. Other water rights with same place of use: DITCH CO. RIGHTS?

☐ Copies Attached



2. Other water rights with same point of diversion: NONE

☐ Copies Attached

☐ Copies of Field Exam's Attached

C. SYSTEM DESCRIPTION

1. **Diversion System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☐ Alternative diagram attached

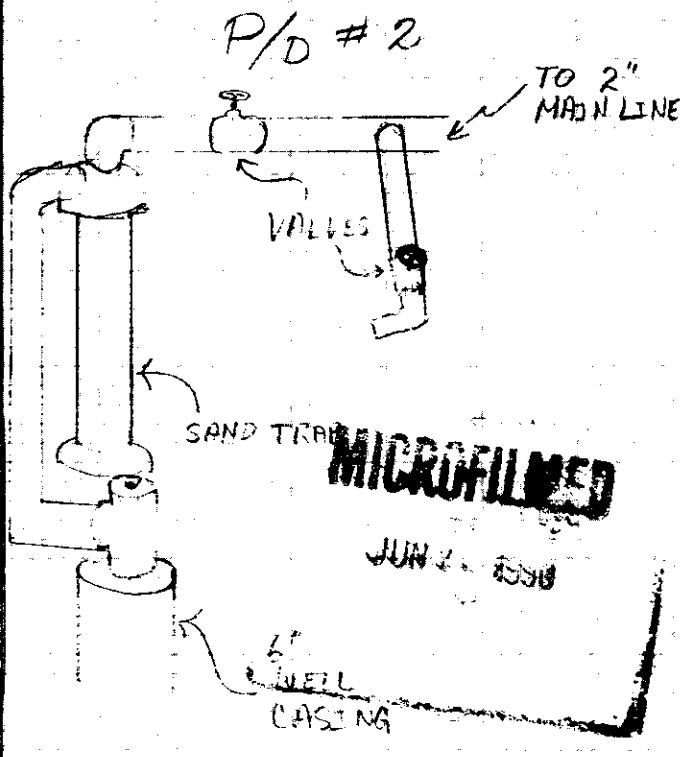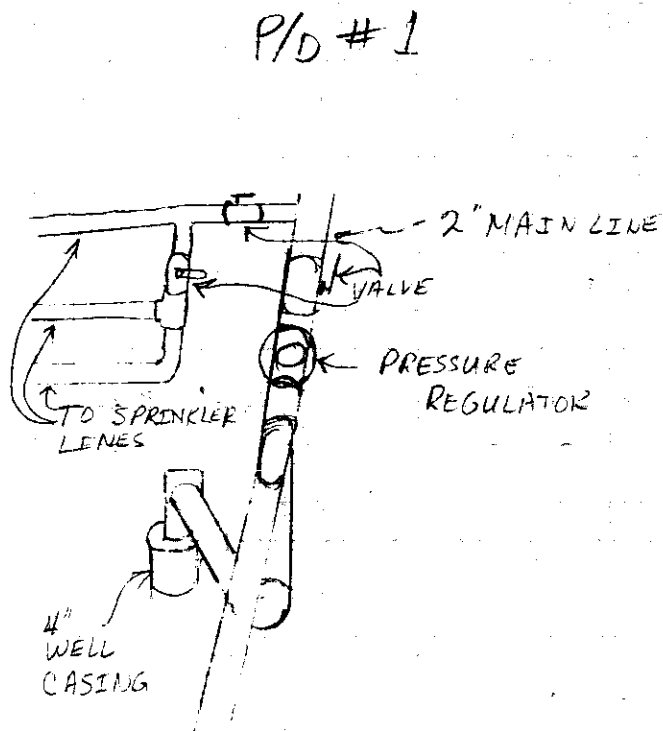

Scale: 1" = _____

2. ☐ Copy of U.S.G.S. Quadrangle Attached
Showing location(s) of point(s) of diversion and
place(s) of use (required).

☐ Photo of Diversion and System Attached

(required for all but single household domestic groundwater, and stockwater.

☐ Aerial Photo Attached
(required for irrigation of 10 acres or more).

System Description (continued)

3. Narrative: Description (As operating at time of measurement. Indicate pressure, number of sprinklers, etc.)

#1 4" WELL REGULATED WITH A PRESSURE REGULATOR SYSTEM AND A 2" LINE LEAVING WELL HOUSE UNDERGROUND (LINE IS PVC) #2 WELLS WITH A 2" DISCHARGE. TIED INTO THE SAME SYSTEM. MAIN WATER LINE FOLLOWS THE TEMPLE PERIMETER (2 1/2" DIA) THE MAIN LINE EXTENDS INTO THE NORTH PARKING LOT TO WATER GRASS ISLANDS. MAIN LINE ALSO EXTENDS INTO PARKING AREA NORTH OF TEMPLE & WEST OF

☐ See Remarks on page 4 for continuation

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
#1 (4" WELL)		3 HP		STA RITE	2"
#2 (6" WELL)		5 HP			

*Code to correspond with No. on map and aerial photo

5. Point(s) of Diversion:

Ident. No.	Gov't. Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
			SE	SE	13	3N	1E	ADA	QUAD MAP

6. Place(s) of Use:

Indicate Method of Determination QUAD MAP CHURCH RECORDS

Twp.	Rge.	Sec.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				Totals
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
3N	1E	13																1.3	

MICROFILMED

JUN 21 1990

Do not use this space

Do not use this space

D. FLOW MEASUREMENTS

☐ Additional Data Sheets Attached

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements:

INFO ON SPRENKLER HEADS FROM RAIN BIRD IRRIGATION
EQUIPMENT MANUAL 1987 EDITION.
 $54,390 \text{ SQ FT} / 43,560 = 1.25 \text{ ACRES IRRIGATED GROUND}$

E. FLOW CALCULATIONS

☐ Additional Computation Sheets Attached

1. Measured Method: $31 \text{ HEADS @ } 1.85 \text{ GPM} = 62.9 \text{ GPM} = \underline{0.14 \text{ CFS}}$
PSI (35)

2. Alternate Method for Checking Purposes: P/D #1 $\frac{3 \times 8.8 \times .8}{45 + (35 \times 2.3)} = \underline{0.17 \text{ CFS}}$ P/D #2 $\frac{5 \times 8.8 \times .8}{45 + (35 \times 2.3)} = \underline{0.28}$

F. PUMP EFFICIENCY DATA (Optional)

Discharge Pressure: _____ psi x 2.31 = _____ ft (1); Dynamic pumping level: _____ ft (2)

Total Head: (1) + (2) = _____ (3) ; Flow rate: _____ cfs (4)

Water HP: (3) x (4) ÷ 8.8 = _____ (5)

Meter Input KW: 3.6 x _____ KH x _____ CTR or _____ MULT x _____ PTR x _____ N/ _____ T = _____ (6)

Meter Input HP: (6) x 1.34 = _____ (7)

Panel Input KW: _____ Ave PF x _____ Ave Volts x _____ Ave Amps x .001732 = _____ (6)

Panel Input HP: (6) x 1.34 = _____ (7) Efficiency: (5)/(7) x 100 = _____ %

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = 1.3 \times 4.5 = 5.85$

$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = .04 \times 245 \times 1.9835 = 19.4$

$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = 5.85 \text{ AFA.}$

2. Volume Calculations for Other Uses:

JUN 11 1990

H. REMARKS AND OVERLAP REVIEW ANALYSIS

CHAPEL TO WATER ISLANDS IN LOT. LOT ISLANDS ARE 9' BY 20' - 34 TOTAL (6120 SQ FT); 4 TRIANGLE PLOTS 450 FT SQ EA (1800 SQ FT) PARKING LOT BORDERS OF (NORTH LOT) 200' BY 20' = 5600 SQ FT WEST LOT 1180.0 FT BY 7 FT = 8260 SQ FT; YARD SURROUNDING TEMPLE TOTAL SQ FT OF 38,110. GIVING TOTAL IRRIGATED GROUND OF 54,390 SQ FT. USES RAIN BIRD 15TH SERIES PRESSURE REGULATED AT 35 PSI USING 3/4" HEADS AT 1.85 GPM OR 62.9 GPM TOTAL. 63-03230 IS IN SAME Q/Q BUT FOR ANOTHER HOME. THEY THOUGHT THEY WERE INCLUDED IN DITCH COMPANY WATER BUT HAVN'T USED ANY WATER FROM THE COMPANY.

I. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
IRRIGATED	3-15	11-15	0.04	5.85
Totals:			0.04 CFS	5.85 AFA

2. Recommended Amendments

- ☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

J. AUTHENTICATION


Field Examiner's Name KELLY K. CHRISTENSEN
Signature Kelly K. Christensen
Certification Date _____
Field Report Preparation Date 12-16-88

CONSULTANT SEAL

K. Licensing recommendation shall be prepared by an Idaho Department of Water Resources employee on a computer printout attached hereto.

RECEIVED

JUN 16 1989

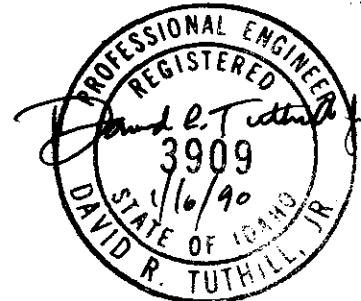

SUPPLEMENT TO CLARIFY RECOMMENDATIONS

1. RECOMMENDATIONS

1. The Permit Lists


	Acres	Rate	Homes	Rate	Category	Rate
Irrigation	<u>4</u>	<u>0.12</u>	Dom		Other	
Found at exam	<u>1.3</u>					<u>0.14</u>
Fees Paid For						<u>0.20</u> CFS Max
Legal Limit for	<u>1.3</u>	Acres	Found	* <u>0.02</u>	Cfs/Acre =	<u>0.039</u> CFS
				<u>1.03</u>		<u>≈ 0.04 CFS</u>

2. Recommended Amounts

Beneficial Use	Period of Use		Q-- Rate of	V-- Annual
	From	To	Diversion	Volume
<u>IRRIGATION</u>	<u>3-15</u>	<u>11-15</u>	<u>0.04</u>	<u>5.9</u>
	Totals		<u>0.04</u> CFS	<u>5.9</u> AFA

MICROFILMED


JUN 21 1981

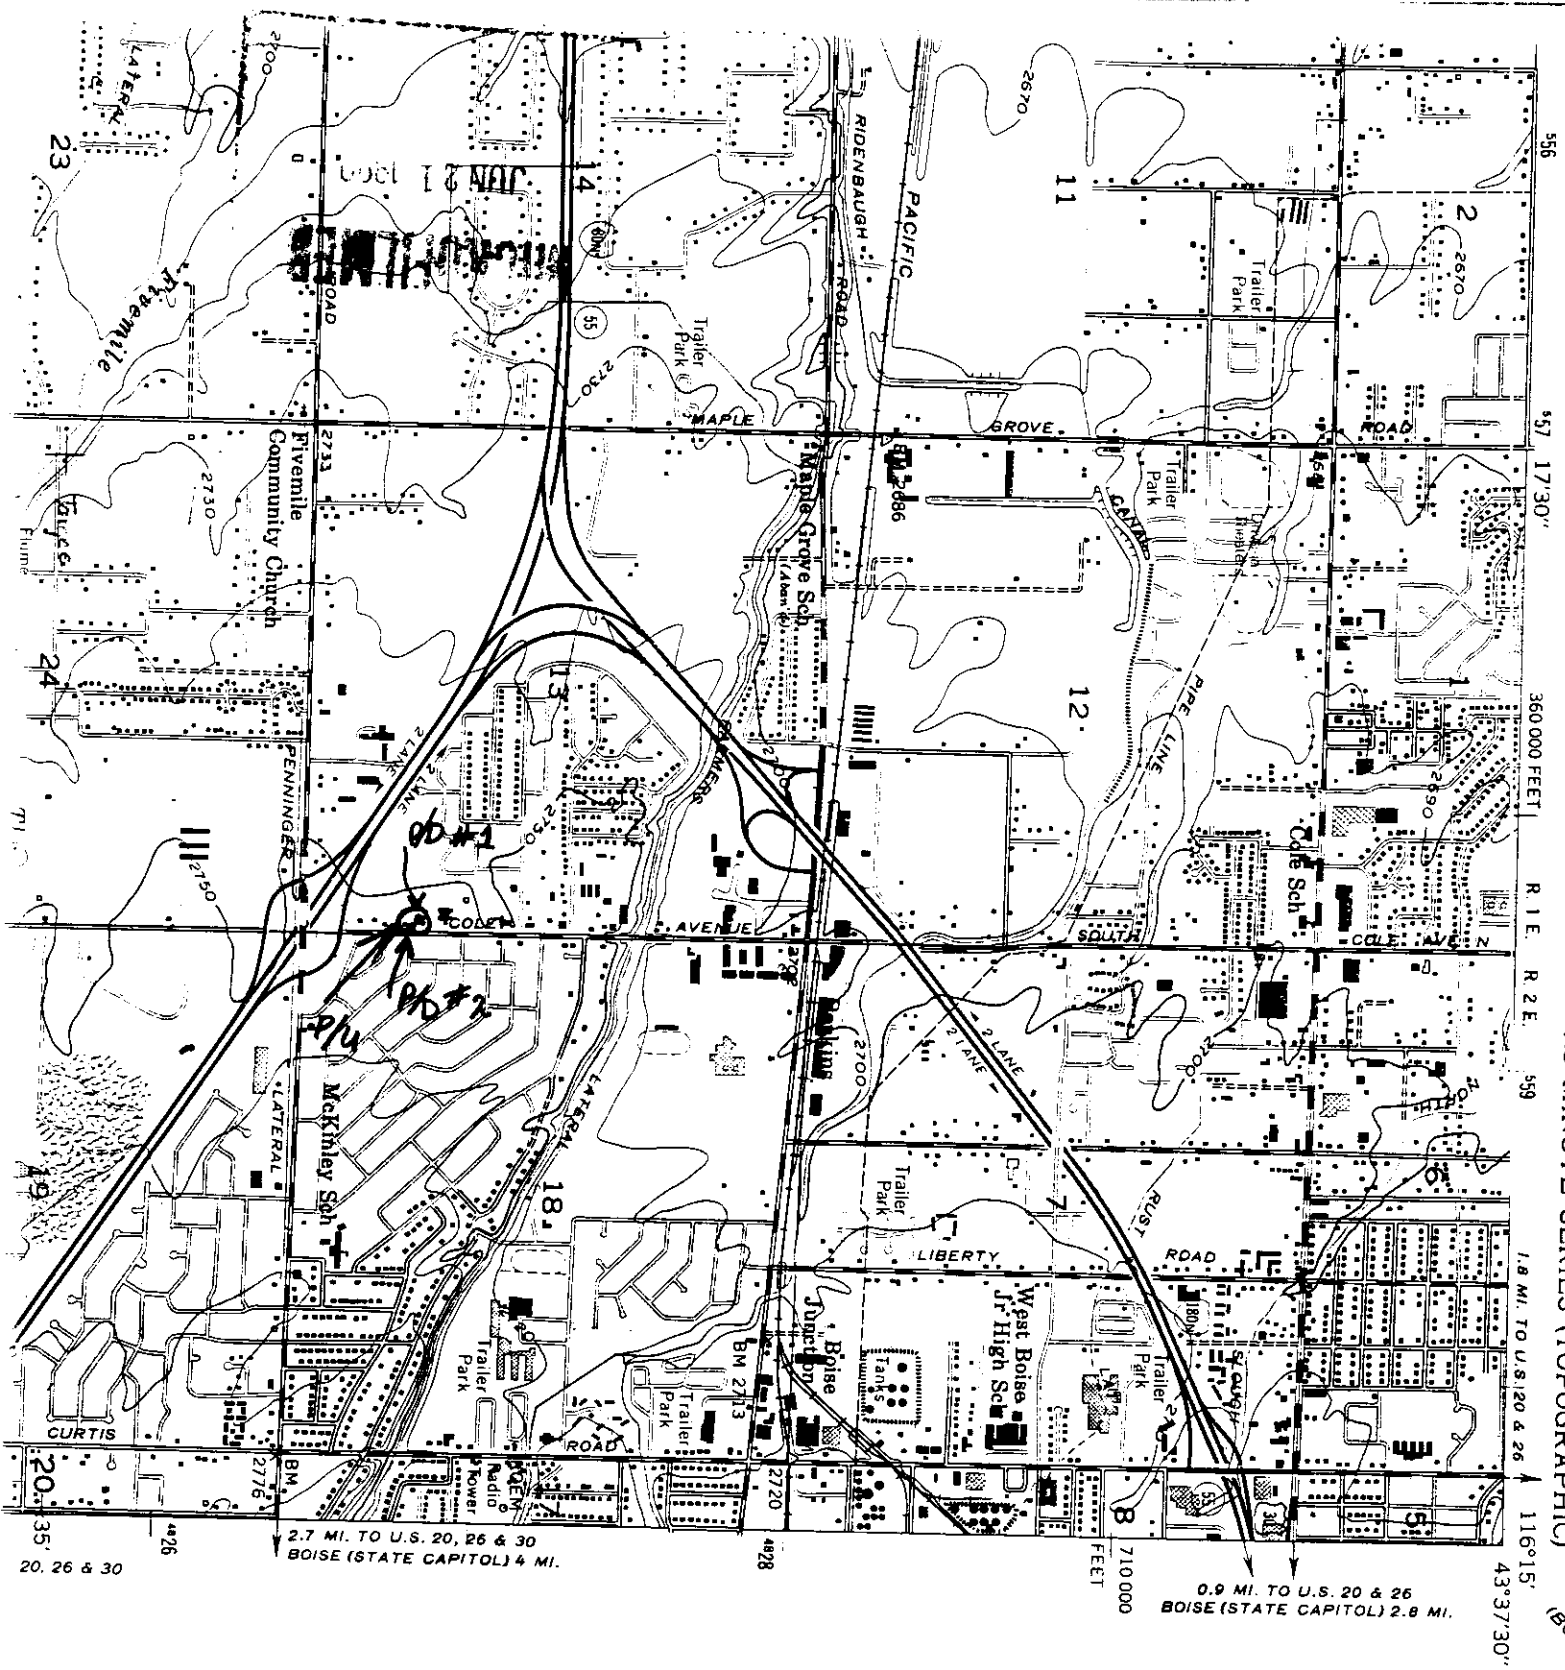

P/D # 1



P/D # 2

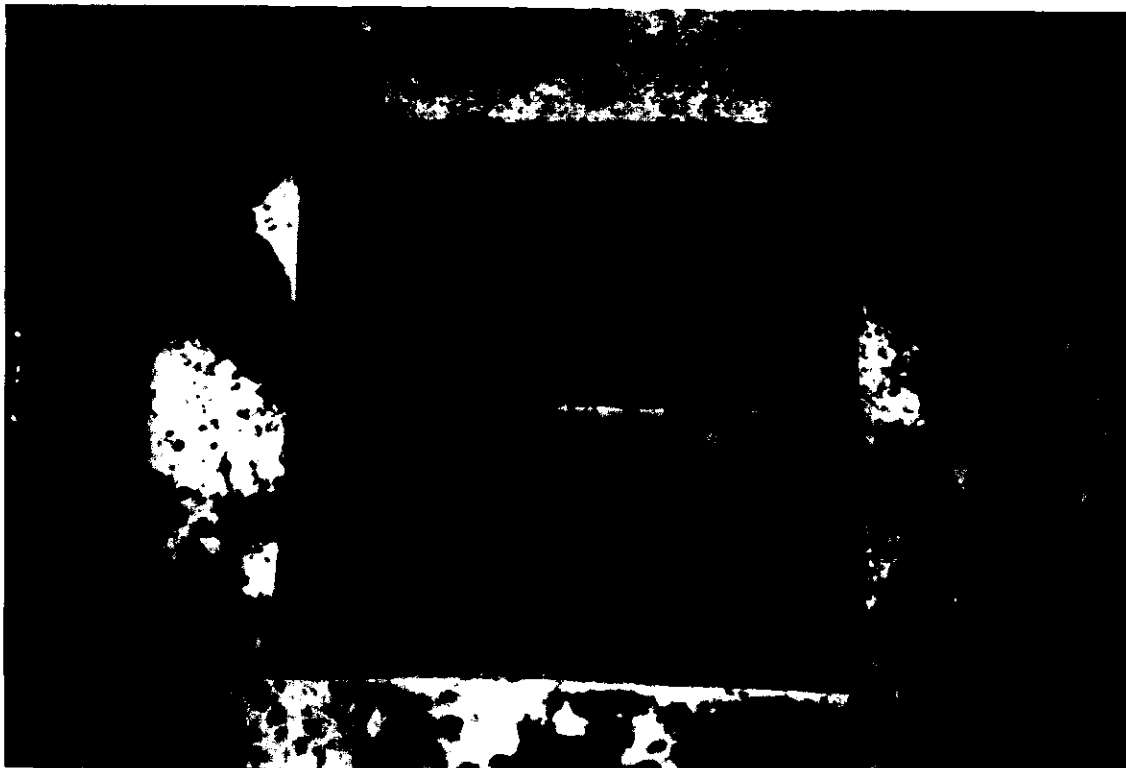

WED

JUN 21 1990

P/D #2 LOOKING SOUTH EAST



P/U

LOOKING WEST



MED

1990

State of Idaho
Department of Water Resources
WELL INSPECTION FORM

This form should be completed by the examiner when conducting a field examination to determine the extent of beneficial use of water from a well or whenever a well is inspected for other reasons. The form should be forwarded to Groundwater Protection Section in the State Office upon completion.

1. Legal Description of well location. Twp. 3N, Rge. 1E,
Sec. 13, Qtr./Qtr. SE/SE or Lot _____
2. Owner CHURCH OF JESUS CHRIST OF LATTER DAY SAINTS
Address 50E. NORTH TEMPLE ST, City SALT LAKE CITY State UT.
3. Approx. date of well construction _____
Well Driller UNKNOWN
4. Casing: Diameter 6" Condition GOOD
5. Casing length above land surface 2" ABOVE WELL HOUSE FLOOR
6. Well depth (ft) _____ Flowing NO Temp. _____
Access port YES (TOO SMALL FOR METER TIP)
7. Condition of piping and valving GOOD
8. Evidence of well seal —
9. Shut in pressure or static water level 42 EST.
10. Evidence of leakage around the casing NO
11. Does well need repair NO
12. Comments THIS WELL MARKED ON BACK AS P/D#2


(OVER)

EX-101
FILMED

JUN 21 1990

SCHEMATIC

Provide a schematic diagram showing the location of the well in the quarter-quarter with respect to houses, roads, other wells or readily identifiable features.

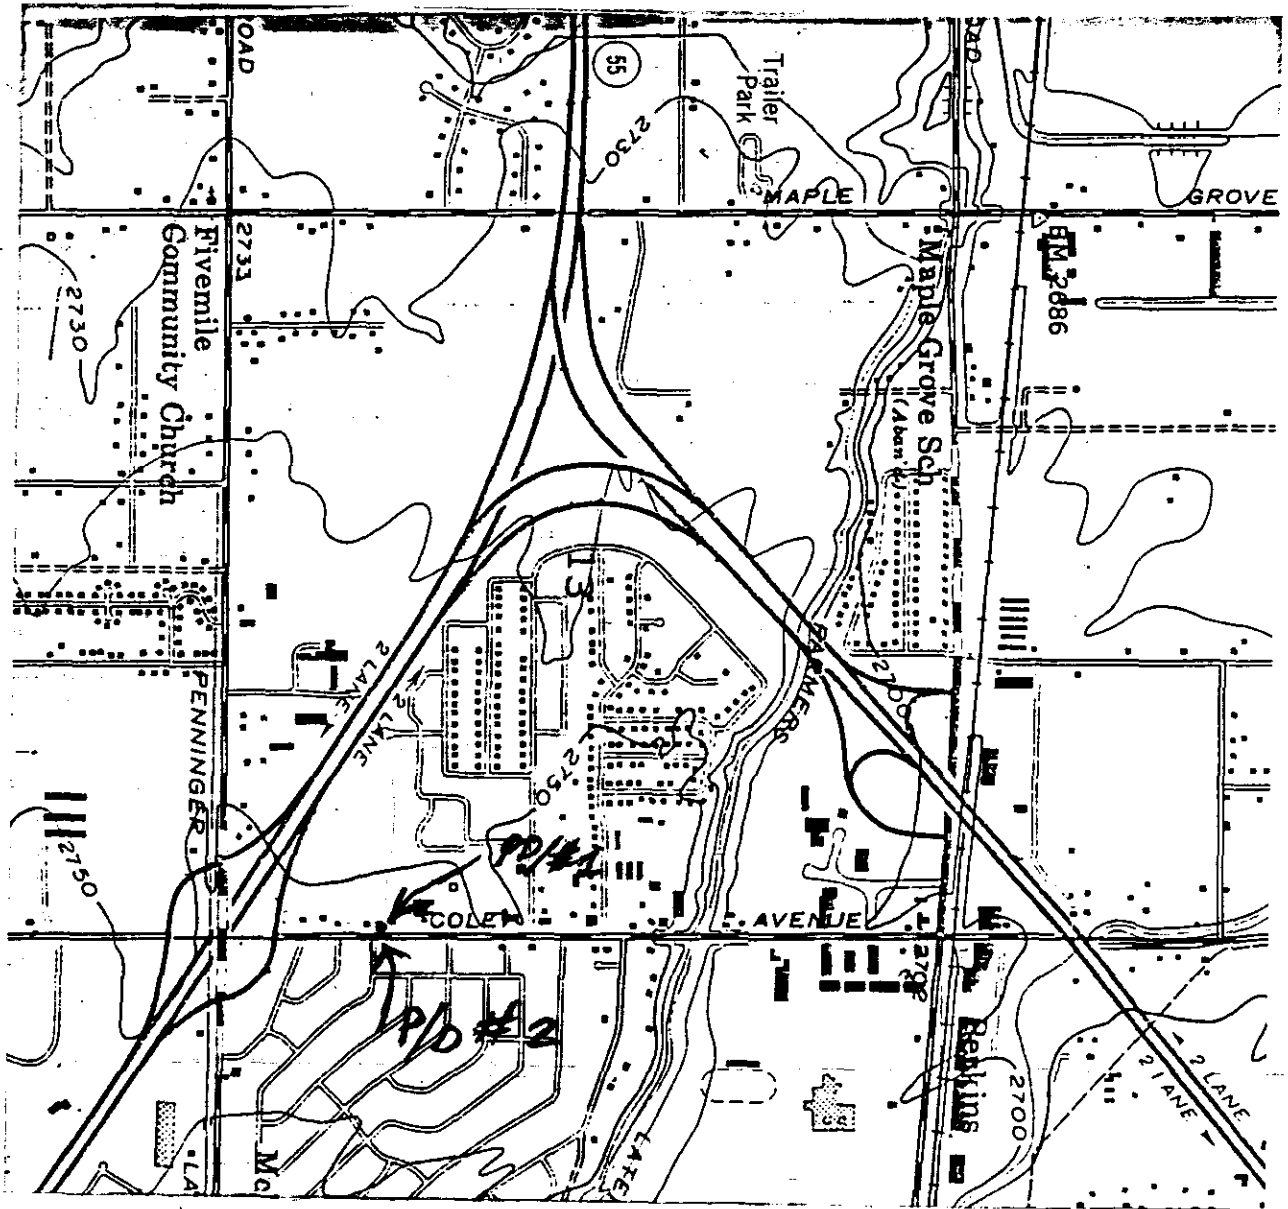

Inspected by

Kelly K. Christensen

Date

11-07-88

RECORDED

JUN 21 1990

State of Idaho

Department of Water Resources

WELL INSPECTION FORM

4" WELL

NORTH & EAST OF
TEMPLE

This form should be completed by the examiner when conducting a field examination to determine the extent of beneficial use of water from a well or whenever a well is inspected for other reasons. The form should be forwarded to Groundwater Protection Section in the State Office upon completion.

1. Legal Description of well location. Twp. 3N, Rge. 1E,
Sec. 13, Qtr./Qtr. SE/SE or Lot _____
2. Owner CHURCH OF JESUS CHRIST OF LATTER DAY SAINTS
Address 50E. NORTH TEMPLE ST., City SALT LAKE CITY State UT.
3. Approx. date of well construction 1968?
Well Driller UNKNOWN
4. Casing: Diameter 4" Condition GOOD
5. Casing length above land surface 20"
6. Well depth (ft) _____ Flowing _____ Temp. _____
Access port YES
7. Condition of piping and valving GOOD
8. Evidence of well seal _____
9. Shut in pressure or static water level APPROX 42'
10. Evidence of leakage around the casing NO
11. Does well need repair NO
12. Comments THIS WELL MARKED ON BACK AS P/D# 1


(OVER)

MICROFILMED

JUN 21 1990

SCHEMATIC

Provide a schematic diagram showing the location of the well in the quarter-quarter with respect to houses, roads, other wells or readily identifiable features.

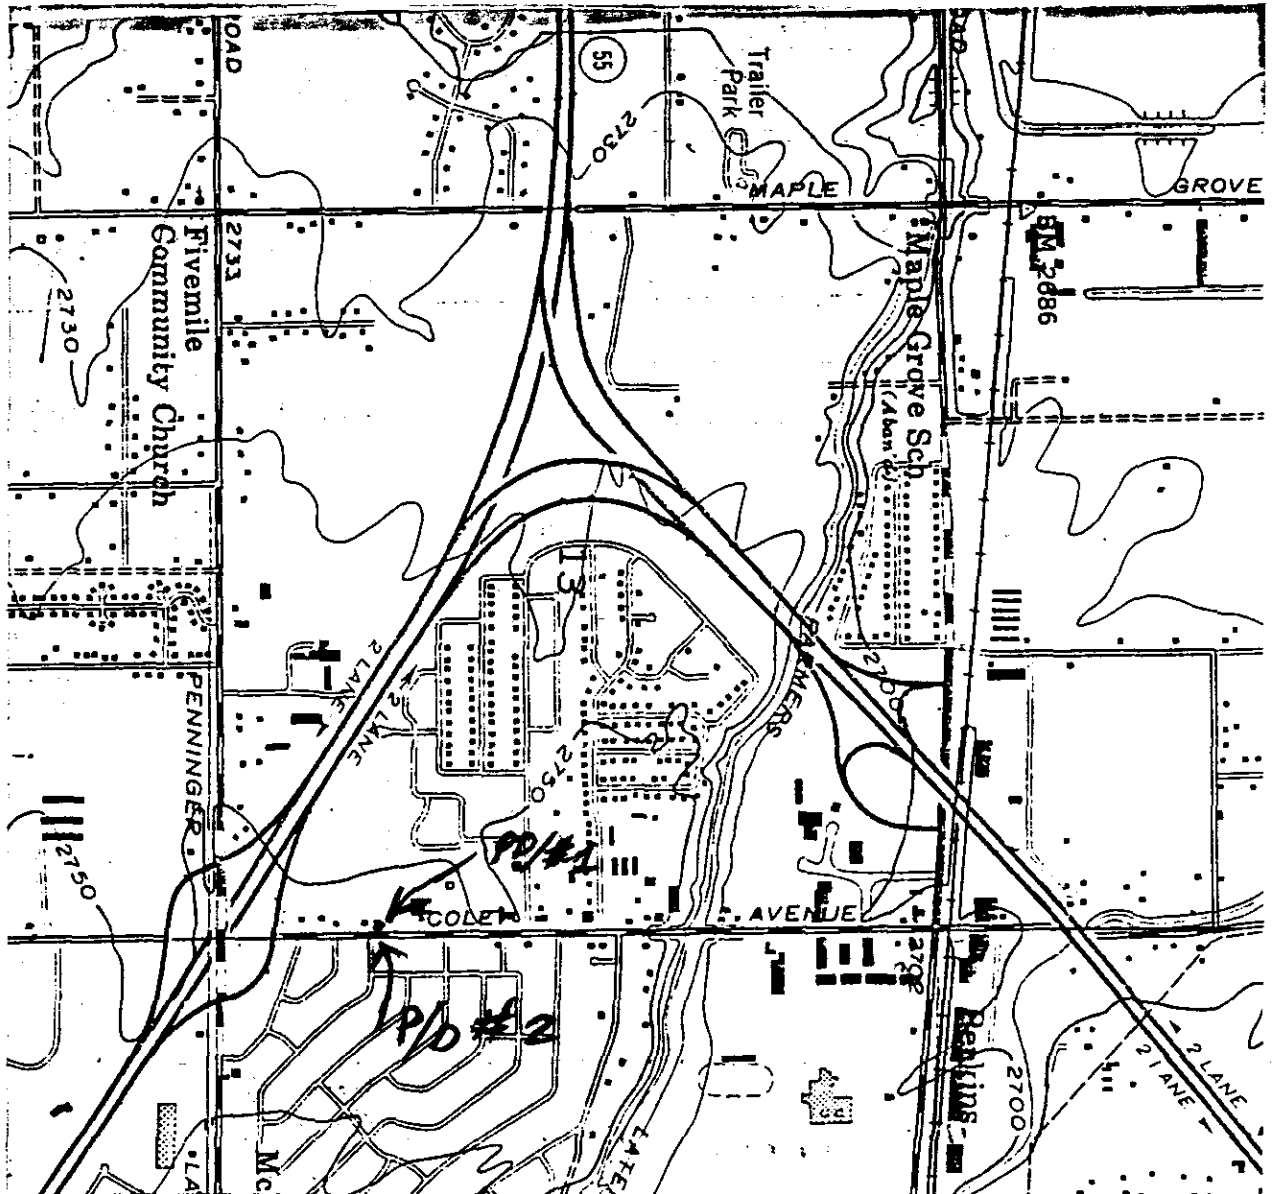

Inspected by Kelly K. Christensen Date 11-07-88

JUN 21 1990



State of Idaho
DEPARTMENT OF WATER RESOURCES
WESTERN REGION, 2735 Airport Way, Boise, Idaho 83705 • (208) 334-2190

CECIL D. ANDRUS
Governor

R. KEITH HIGGINSON
Director

November 19, 1988

63-10142
Church of Jesus Christ
50 E. N. Temple St.
Salt Lake City, UT 84150

Dear Applicants(s):

We acknowledge receipt of your statement submitted as proof as beneficial use for the above-referenced permit.

Before a license can be issued, a field examination must be made by a representative of this Department. A field examiner will contact you to arrange to examine your system.

If you have any questions regarding the field examination, please contact this office.

Sincerely,

Judy Pense
Secretary

/jp

RECORDED

JUN 21 1990

1/88

PROOF OF BENEFICIAL USE

ANALYSIS SHEET

Permit No. 63-10142

Date: 10/3/88

General Considerations:

Y Name same as permit
Y Signature the same as permit holder
N Address change _____ If yes, prepare a data entry
Y Proof received timely _____
_____ Reinstated

Source of Water:

Y Surface water
Y Groundwater
N 1. well log in file *Not found, due to reported age of well*
N/A 2. drilling permit
_____ A. amount of drilling fee paid for proposed uses

Extent of Use and Rate of Diversion:

Y Rate of diversion appropriate for uses
Y Is rate or volume and fee appropriate?
N Has permit holder indicated when water was first put to a beneficial use?

Measuring Device:

N/A Is a measuring device or access port required?
N/A Has one been installed?
N/A Waiver or modification of measuring device requested

Remarks:

Proof acceptable

N/A

Priority Calculation:

Date proof received	_____	_____
Date proof due	_____	_____
No. of days late	_____	= _____
Priority date	_____	+ _____
NEW PRIORITY DATE	_____	= _____

SEND FILES TO DATA ENTRY AND THEN TO MICROFILM

1988

For Office Use Only
Fee Received \$50.00
Date 8/16/88
Receipt # 0002241
Receipt by CP
Reviewed by JS
Sent to region

STATE OF IDAHO Department of Water Resources

DEPARTMENT OF WATER RESOURCES

PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources will consider this form as a statement that the permit holder(s) has completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

Permit No. 63-10142

Name(s) of Permit Holder: Church of Jesus Christ of Latter-day Saints Corporation of the President

Post Office Address: 50 E. North Temple St., Salt Lake City UT 84150

Attention: Real Estate Department Telephone No. 801-531-4074

Source of Water: groundwater

Extent of Use:

Domestic (number of households) Stockwater (number and type of stock)

Irrigation 4 (acres) Other/Remark

Total rate and/or volume for which proof is submitted .12 cfs acre-feet

Show the date water was first diverted and beneficially used under this permit:

Measuring Device: Required? Yes X No
Installed? Yes No Fee enclosed \$ 50.00
(See License Examination Fee Schedule)

Flow Measurement Port: Required? Yes X No
Installed? Yes No

Person to contact to accompany the Department representative during the field examination:

Bud Lloyd 208-322-4422
(Name) (Telephone Number)

Boise Temple, 1211 South Cole Road, Boise ID 83709
(Address)

The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

Corporation of the Presiding Bishop of the Church of
Jesus Christ of Latter-day Saints, a Utah Corporation sole

RECORDED

OCT 11 1988

JJK

Date Signature of Permit Holder (and title, if appropriate)
Authorized Agent:

To: File 6310142

From: Groundwater Protection

Date: 9/1/88

Drilling Permit: ☒ Not Applicable
☐ Found and in file
☐ Not Found

Well Drillers Report:

☒ Not found, due to reported age of well
probably not available
☐ Found and is in file
☐ Not found

Follow-up

☐ Request from permit holder the well
drillers report and/or the name of the
well driller.
☐ Ask permit holder when well was drilled
and notify holder of drilling permit
requirement if after July 01, 1987.

*No follow up recommended.
Logs are probably pre 1983.*

RECEIVED

OCT 11 1988

Limited Purchase Order Draft--Not to Exceed \$300.00. Utah Sales Tax Exemption No. 516

Order **Nº 5340C01069**

NOTE: Payments to noncorporations which are required to be reported on Internal Revenue Service Form 1099, must have the taxpayer's identification number such as Social Security number or Federal Identification number.

Ship to:
Church of Jesus Christ of Latter-day Saints
Real Estate Division
12th Floor Tower
60 North Main Street
Salt Lake City, Utah 84150

Questions concerning order contact:
Real Estate Division
50 East North Temple Street
Salt Lake City, Utah 84150
(801) 531-2915

Enter the number here N/A

Order Information Attach additional work order information as needed
Description of goods or services

Quantity

Unit of issue

Unit price

Extended price

FEES FOR PROOF OF BENEFICIAL USE OF WATER

\$

\$ 50.00

Authorized signature

Beth Snow

Total purchase/Check amount \$ 50.00

Accounting Information

General ledger account code

2300-1-1480-524-6504-50

BOISE ID TEMPLE 100% TEMPLES \$50.00

001 - 1988

MICROFILMED

Description (maximum 30 characters)

FEES FOR PROOF OF BENEFICIAL USE OF WATER

Original--Vendor WHITE--Finance CANARY--Purchasing BLUE, GOLDENROD--Requester

FMFI 1199 3/83 Printed in USA

THE CHURCH OF
JESUS CHRIST
OF LATTER-DAY
SAINTS

Department of Water Resources

REAL ESTATE DIVISION
Twelfth Floor
50 East North Temple Street
Salt Lake City, Utah 84150
Phone (801) 531-2929

August 10, 1988

Reference reply to:

#524-6504

Ms. Rita Fleck
State of Idaho Department of Water Resources
Statehouse
Boise ID 83720

Dear Ms. Fleck,

Attached is a signed document and a \$50.00 check for license examination fee for water permit #63-10142. The well is being used and a field examination could be made most any time by contacting Bud Lloyd at the Boise Temple, telephone #208-322-4422. Our property number is 524-6504.

Thanks for your assistance in seeing that this water right is protected.

Sincerely,



Ronald C. Johnson
Water Analyst

RCJ:ja
encs.

cc: Terry F. Roylance
M. Glade Pincock

RECEIVED

OCT 11 1988

THE CHURCH OF
JESUS CHRIST
OF LATTER-DAY
SAINTS

REAL ESTATE DIVISION
Twelfth Floor East
50 East North Temple Street
Salt Lake City, Utah 84150-0001

8861 11 100

RECEIVED

Ms. Rita Fleck
State of Idaho Dept. of Water Resources
Statehouse
Boise ID 83720

S T A T E O F I D A H
DEPARTMENT OF WATER RESOURCES

Statehouse
Boise, Idaho 83720
(208) 334-7900
Certified Mail
July 31, 1988

138196

CHURCH OF JESUS CHRIST LATTER DAY SAINTS
CORP. OF THE PRESIDENT
50 E. N. TEMPLE ST.
ATTN REAL ESTATE DEPT.
SALT LAKE CITY, UT 84150

PROOF DUE NOTICE

RE: PERMIT NO. 63-10142

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before October 1, 1988. (See last page of your approved permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a complete field examination report prepared by a certified water right examiner may be used to submit the required proof.

If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.

Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.

SINCERELY,

Rita Fleck
Secretary/Records Manager

Enclosures

MAILED

OCT 11 1988

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

STATEHOUSE
BOISE, IDAHO 83720
(208) 334-4440

CHURCH OF JESUS CHRIST LATTER DAY SAINTS
CORP. OF THE PRESIDENT
50 E. N. TEMPLE ST.
ATTN REAL ESTATE DEPT.
SALT LAKE CITY, UT 84150

OCTOBER 25, 1983

RE: PERMIT NO. 63-10142

DEAR PERMIT HOLDER:

ENCLOSED IS A COPY OF YOUR APPROVED APPLICATION FOR PERMIT. WE DIRECT YOUR ATTENTION TO THE CONDITIONS OF APPROVAL ON THE FOURTH PAGE.

PLEASE BE ADVISED THAT NUMEROUS PRIOR APPLICATIONS FOR PERMIT HAVE BEEN FILED TO APPROPRIATE WATER FROM YOUR SOURCE, TO BE USED ON DESERT LAND ENTRY AND/OR CAREY ACT LANDS. DEVELOPMENT OF THESE WATER RIGHTS IS CURRENTLY PREVENTED BY THE U.S. BUREAU OF LAND MANAGEMENT. HOWEVER, IF THE LANDS ARE RELEASED FOR DEVELOPMENT, THE ASSOCIATED WATER RIGHTS WILL RECEIVE WATER PRIOR TO YOUR WATER RIGHT ENCLOSED. THEREFORE BE SURE TO ANALYZE THE FUTURE IMPACT OF THESE RIGHTS BEFORE MAKING A MAJOR INVESTMENT IN A WATER SUPPLY SYSTEM.


THE 1982 IDAHO LEGISLATURE ADDED A REQUIREMENT THAT AS A PERMIT HOLDER YOU MUST COMMENCE THE EXCAVATION OR CONSTRUCTION OF DIVERTING WORKS WITHIN ONE YEAR OF THE DATE THE PERMIT WAS ISSUED, AND YOU MUST PROCEED DILIGENTLY UNTIL THE PROJECT IS COMPLETED. THE ENCLOSED BLUE CARD MUST BE COMPLETED AND RETURNED TO THIS OFFICE AS SOON AS YOU COMMENCE CONSTRUCTION, NO LATER THAN ONE YEAR FROM THE DATE THE PERMIT WAS APPROVED.

WE HAVE ENCLOSED INSTRUCTIONS ENTITLED "MAKING PROOF OF BENEFICIAL USE". PLEASE READ THE INSTRUCTIONS CAREFULLY SINCE YOU MUST TAKE FURTHER ACTION TO DEVELOP THIS PERMIT INTO A LICENSE.

RE: PERMIT 63-10142

PAGE 01
OCTOBER 25, 1983

SINCERELY,



DAVID R. TUTHILL, JR., P.E.
SUPERVISOR, WATER ALLOCATION SECTION

ENCLOSURE



State of Idaho
Department of Water Resources

APPLICATION FOR PERMIT ANALYSIS SHEET

INITIAL REVIEW BY: [Signature]

APPLICATION NUMBER: 63-10142

CHECK:

- ☒ Source.
☒ Point of diversion.
☒ County.
☒ Quantity of water and period of use.
☒ Description of diverting works.
☒ Time required for beneficial use of water.
☒ Place of use or acres irrigated.
☒ Map.
☒ Signature.
☒ Fee.

Field check by: _____

Date: _____

Comments: _____

- ☐ Yes ☒ No Field check required.
☐ Yes ☒ No Critical groundwater area.
☐ Yes ☒ No Request dam safety information. Sent by: _____ Date: _____
☒ Yes ☐ No* In form to receipt.

*REQUEST THE FOLLOWING ADDITIONAL INFORMATION FROM THE APPLICANT: _____

SEND COPIES TO:

- ☒ Idaho State Health Department.
☒ Idaho Fish and Game Department.
☒ Idaho Department of Lands.
☒ U.S. Bureau of Land Management.
☒ U.S. Forest Service.
☒ Other _____

Copies sent by: _____ Date: _____

PROCESSING:

- ☐ Yes ☒ No Platted by: _____ Map No. _____
☐ Yes ☒ No Other rights on same place of use. _____
☒ Yes ☐ No* In form for advertising.
Final date for protests: 9/12/83
☐ Yes ☐ No Protests received. If yes, record information on 4th page of application.

FINAL REGIONAL PROCESSING REVIEW:

- ☒ Affidavit of publication received. Date: 9/2/83
☒ Application published correctly. If not, record action taken: _____
☒ Fee amount, receipt date & number, recorded on application. 30# #31147 7/24/83
☒ Publication dates and paper, recorded on application. Statesman 8/25 & 9/1
☒ Protests, dates, withdrawal, etc., recorded on application.
☒ Recommendation & initial, recorded on application.
☐ Yes ☒ No Measuring device required.
☐ Yes ☒ No Access port required.
☐ Yes ☒ No Will water be delivered by watermaster? If yes, what district? _____
6/23/83 Date of priority recommended.
Special conditions of approval or cover letter. I.P GW letter

(26)

By: DBS

Date: 9/12/83

STATE OFFICE REVIEW:

L17, L1

26

- ☐ See attached sheet for more information.

By: LW

Date: 10/13/83

Department of Water Resources

63-10142

CHURCH OF JESUS CHRIST LATTER DAY SAINTS

CORP. OF THE PRESIDENT, 50 E. N. TEMPLE ST., ATTN REAL ESTATE DEPT.,
SPLT LAKE CITY, UT 84150

Source: GROUNDWATER

Date Filed: 06/23/1983

Diversion Pt: SESE Sec 13 T 03N R 01E

Use: IRRIGATION (0.12 CFS)

In: SESE Sec 13 T 03N R 01E FOR 4 ACRES