

[illegible]

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.


(Applicant) Mayor, City of Hollister

**NOTICE OF APPLICATION
FOR WATER PERMIT**

Notice is hereby given that City of Hollister Hollister, ID 83301 has on 7/25/77 submitted Application No. 47-7417 for a permit to appropriate 1.0 cubic feet per second of water from groundwater by means of wells, pumps, pressure tank, flowmeter & connecting pipeline within the SE $\frac{1}{4}$ NE $\frac{1}{4}$, SW $\frac{1}{4}$ NE $\frac{1}{4}$, NE $\frac{1}{4}$ SE $\frac{1}{4}$, Sec. 28, Twp. 12S, Rge. 16E., B.M., Twin Falls County to be used from Jan. 1 to Dec. 31 for city water supply within the City of Hollister.

If issued, this permit will be subject to all prior water rights. Protests against the granting of the permit must be filed with the Idaho Department of Water Resources, 1041 Blue Lakes Blvd., North, Twin Falls, Idaho, 83301 on or before September 5, 1977.

C. STEPHEN ALLRED
Director

©PUBLISH August 18 & 25, 1977

Affidavit of Publication

STATE OF IDAHO, }
COUNTY OF TWIN FALLS }

ss.

N^o 6302

I, Carolene Jennings being first duly sworn upon oath, depose and say that I am Princ. Clerk of the TIMES-NEWS, published daily, except Saturday, at Twin Falls, Idaho, and do solemnly swear that a copy of the notice of advertisement, as per clipping attached, was published in the regular and entire issue of said newspaper, and not in any supplement thereof, for two consecutive Thursdays, commencing with the issue dated August 18, 1977, and ending with the issue dated August 25, 1977.

And I do further certify that said newspaper is a consolidation, effective February 16, 1942, of the Idaho Evening Times, published theretofore daily except Sunday, and the Twin Falls News, published theretofore daily except Monday, both of which newspapers prior to consolidation had been published under said names in said city and county continuously and uninterruptedly during a period of more than twelve consecutive months, and said TIMES-NEWS, since such consolidation, has been published as a daily newspaper except Saturday, under said name in said city and county continuously and uninterruptedly.

And I further certify that pursuant to Section 60-108 Idaho Code, Thursday of each week has been designated as the day on which legal notice by law or by order of any court of competent jurisdiction within the state of Idaho, to be published weekly, will be published; and that at the head of the editorial column of said combined newspapers, and in each issue thereof, Thursday is announced as the day on which said legal notices will be published.

Subscribed and sworn to before me on this 26th day of

August, 1977.

Princ. L. Clark
Notary Public in and for the County of Twin Falls,
State of Idaho, residing at Twin Falls, Idaho

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

License of Water Right No. 47-7417 Priority July 25, 1977 Amount .40 cfs

THIS IS TO CERTIFY, that CITY OF HOLLISTER
of Hollister, Idaho, has complied with the terms and conditions of Permit
No. 47-7417 issued pursuant to Application for Permit dated July 25, 1977,
and has submitted proof to the Department of Water Resources on February 1, 1979,
that he has applied water to a beneficial use; an examination by the Department indicates that the works have a
capacity for the diversion of .40 cfs of water from a groundwater source,
tributary to _____, and that the permit holder has applied to a beneficial use and
established a right to use water as follows:

Beneficial Use	Period of Use	Rate of Diversion	Annual Volume
Municipal	from <u>January 1</u> to <u>December 31</u> at	<u>40</u> cfs and	<u>N/A</u>
	from _____ to _____ at _____ cfs and		
	from _____ to _____ at _____ cfs and		

(both dates inclusive)

Subject, however, to the condition that no more than .40 cfs of water be diverted at any one time, and
that the amount of water so diverted and to which such right is entitled and confirmed for the purpose
aforementioned and is limited to the amount which can actually be beneficially used and shall not exceed
N/A acre feet per year, said waters to be diverted within the SE $\frac{1}{4}$ NE $\frac{1}{4}$, Sec. 28, Twp. 12S,
Rge. 16E, B.M. in the County of Twin Falls

Description and location of place of use:

Twp.	Range	Sec.	NE¼				NW¼				SW¼				Totals				
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	

Total number of acres irrigated _____

NOTE: Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho Law. This right may be forfeited by five years of non-use.

The right to the use of the water hereby confirmed is restricted and appurtenant to the lands or place of use herein described, as provided by the laws of Idaho.

Witness the seal and signature of the Director, affixed at Boise, Idaho, this 16 day of
March, 19 81.

Director

MICROFILMED

BEFORE THE DEPARTMENT OF WATER RESOURCES
OF THE
STATE OF IDAHO

IN THE MATTER OF CHANGING THE MEASURING
DEVICE REQUIREMENT FOR PERMIT NO. 47-7417

ORDER

WHEREAS, the above numbered permit was approved with the condition that a measuring device of a type approved by the Department be permanently installed and maintained as part of the diverting works; and,

WHEREAS, on July 1, 1978, the Department adopted a new water measurement condition which states: "An access port or other device as specified by the Department shall be installed by the permit holder to provide for the installation of measuring equipment and the determination of the rate of diversion by the Department"; and,

WHEREAS, the former condition required the permit holder to purchase and install a measuring device or hire a professional engineer to certify the rate of diversion; and,

WHEREAS, the measuring device condition effective July 1, 1978, requires less capital expenditure by the permit holder; and,

WHEREAS, to be equitable to holders of permits issued prior to July 1, 1978, the new condition should be retroactive;

NOW THEREFORE, it is hereby ordered that the condition of approval of this permit related to water measurement is hereby changed as follows: "The permit holder shall either install a measuring device or provide a certified measurement by a professional engineer or install an access port or other device as specified by the Department".

Dated this 18th day of August, 1978.


C. STEPHEN ALLRED
Director

MICROFILMED

Identification No. _____

Application No. 47-7417

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
APPLICATION FOR PERMIT **APPROVED**

To appropriate the Public Waters of the State of Idaho
(TYPE OR PRINT IN INK)

1. Name of applicant City of Hollister
post office address Route 1, Hollister, Idaho 83301
2. Source of water supply Groundwater which is a tributary of _____
3. a. Location of point of diversion is SE $\frac{1}{4}$ of NE $\frac{1}{4}$ of Section 28 Township 12S.
Range 16E B.M. Twin Falls County; additional points of diversion if any: _____
SW $\frac{1}{4}$ of NE $\frac{1}{4}$ of Section 28, T.12S., R.16E., B.M.
NE $\frac{1}{4}$ of SE $\frac{1}{4}$ of Section 28, T.12S., R.16E., B.M.
b. If water is not consumed, it will be discharged into _____ at a point in _____ $\frac{1}{4}$
of _____ $\frac{1}{4}$ of Section _____ Township _____ Range _____ B.M. _____
4. Water will be used for the following purposes:
City Water
Amount 1.0 cfs for Supply purpose from Jan 1 to Dec 31 (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purpose from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purpose from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
5. Total quantity to be appropriated:
a. one (1.0) cubic feet per second and/or
b. _____ acre feet per annum.
6. Proposed diverting works:
a. Description of ditches, flumes, pumps, headgates, etc. Well or wells, pumps, pressure tank, flowmeter and connecting pipeline.

b. Height of storage dam _____ feet, active reservoir capacity _____ acre feet; total reservoir capacity _____ acre feet, materials used in storage dam: _____
Period of year during which storage will occur _____ to _____ inclusive.
(Mo. Day) (Mo. Day)
c. Proposed well diameter is 16 inches; proposed depth of well is 500 feet.
7. a. Time required for the completion of the works and application of the water to the proposed beneficial use is 1 $\frac{1}{2}$ years.
b. Estimated construction cost is \$ 20,000.
8. Description of proposed uses:
a. If water is **not** for irrigation: (See Remarks)*
(1) Give the place of use of water: _____ $\frac{1}{4}$ of _____ $\frac{1}{4}$ of Section _____ Township _____
Range _____ B.M. See Map.
(2) Amount of power to be generated: _____ hp under _____ feet of head.
(3) List number of each kind of livestock to be watered _____

(4) Name of municipality to be served City of Hollister, or number of families to be supplied with domestic water _____.
(5) If water is to be used for other purposes describe: General municipal use.

b. If water is for irrigation, indicate acreage in each subdivision in the tabulation below:

TWP.	RANGE	SEC.	NE¼				NW¼				SW¼				SE¼				TOTALS
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	

Total number of acres to be irrigated _____

c. Describe any other water rights used for the same purposes old wells outside of city limits -
will be abandoned when new wells are completed

9. a. Who owns the property at the point of diversion City of Hollister or See C.

b. Who owns the land to be irrigated or place of use City of Hollister


c. If the property is owned by a person other than the applicant, describe the arrangement enabling the
applicant to make this filing one proposed site owned by City. Other proposed
site to be acquired by City if needed.

10. Remarks Three (3) proposed well sites are applied for herein, however, if primary
drilling site is found to produce required quantity of water no other sites
will be drilled.

Problems with old delivery system require that new water system be built.

* S½NE¼, NW¼, N½SW¼, N½SE¼, SE¼SE¼, Sec. 28; SW¼NW¼, W½SW¼, Sec. 27;
SE½NE¼, NE½SE¼, Sec. 29, Twp. 12S, Rge. 16E., B.M.

11. Map of proposed project:

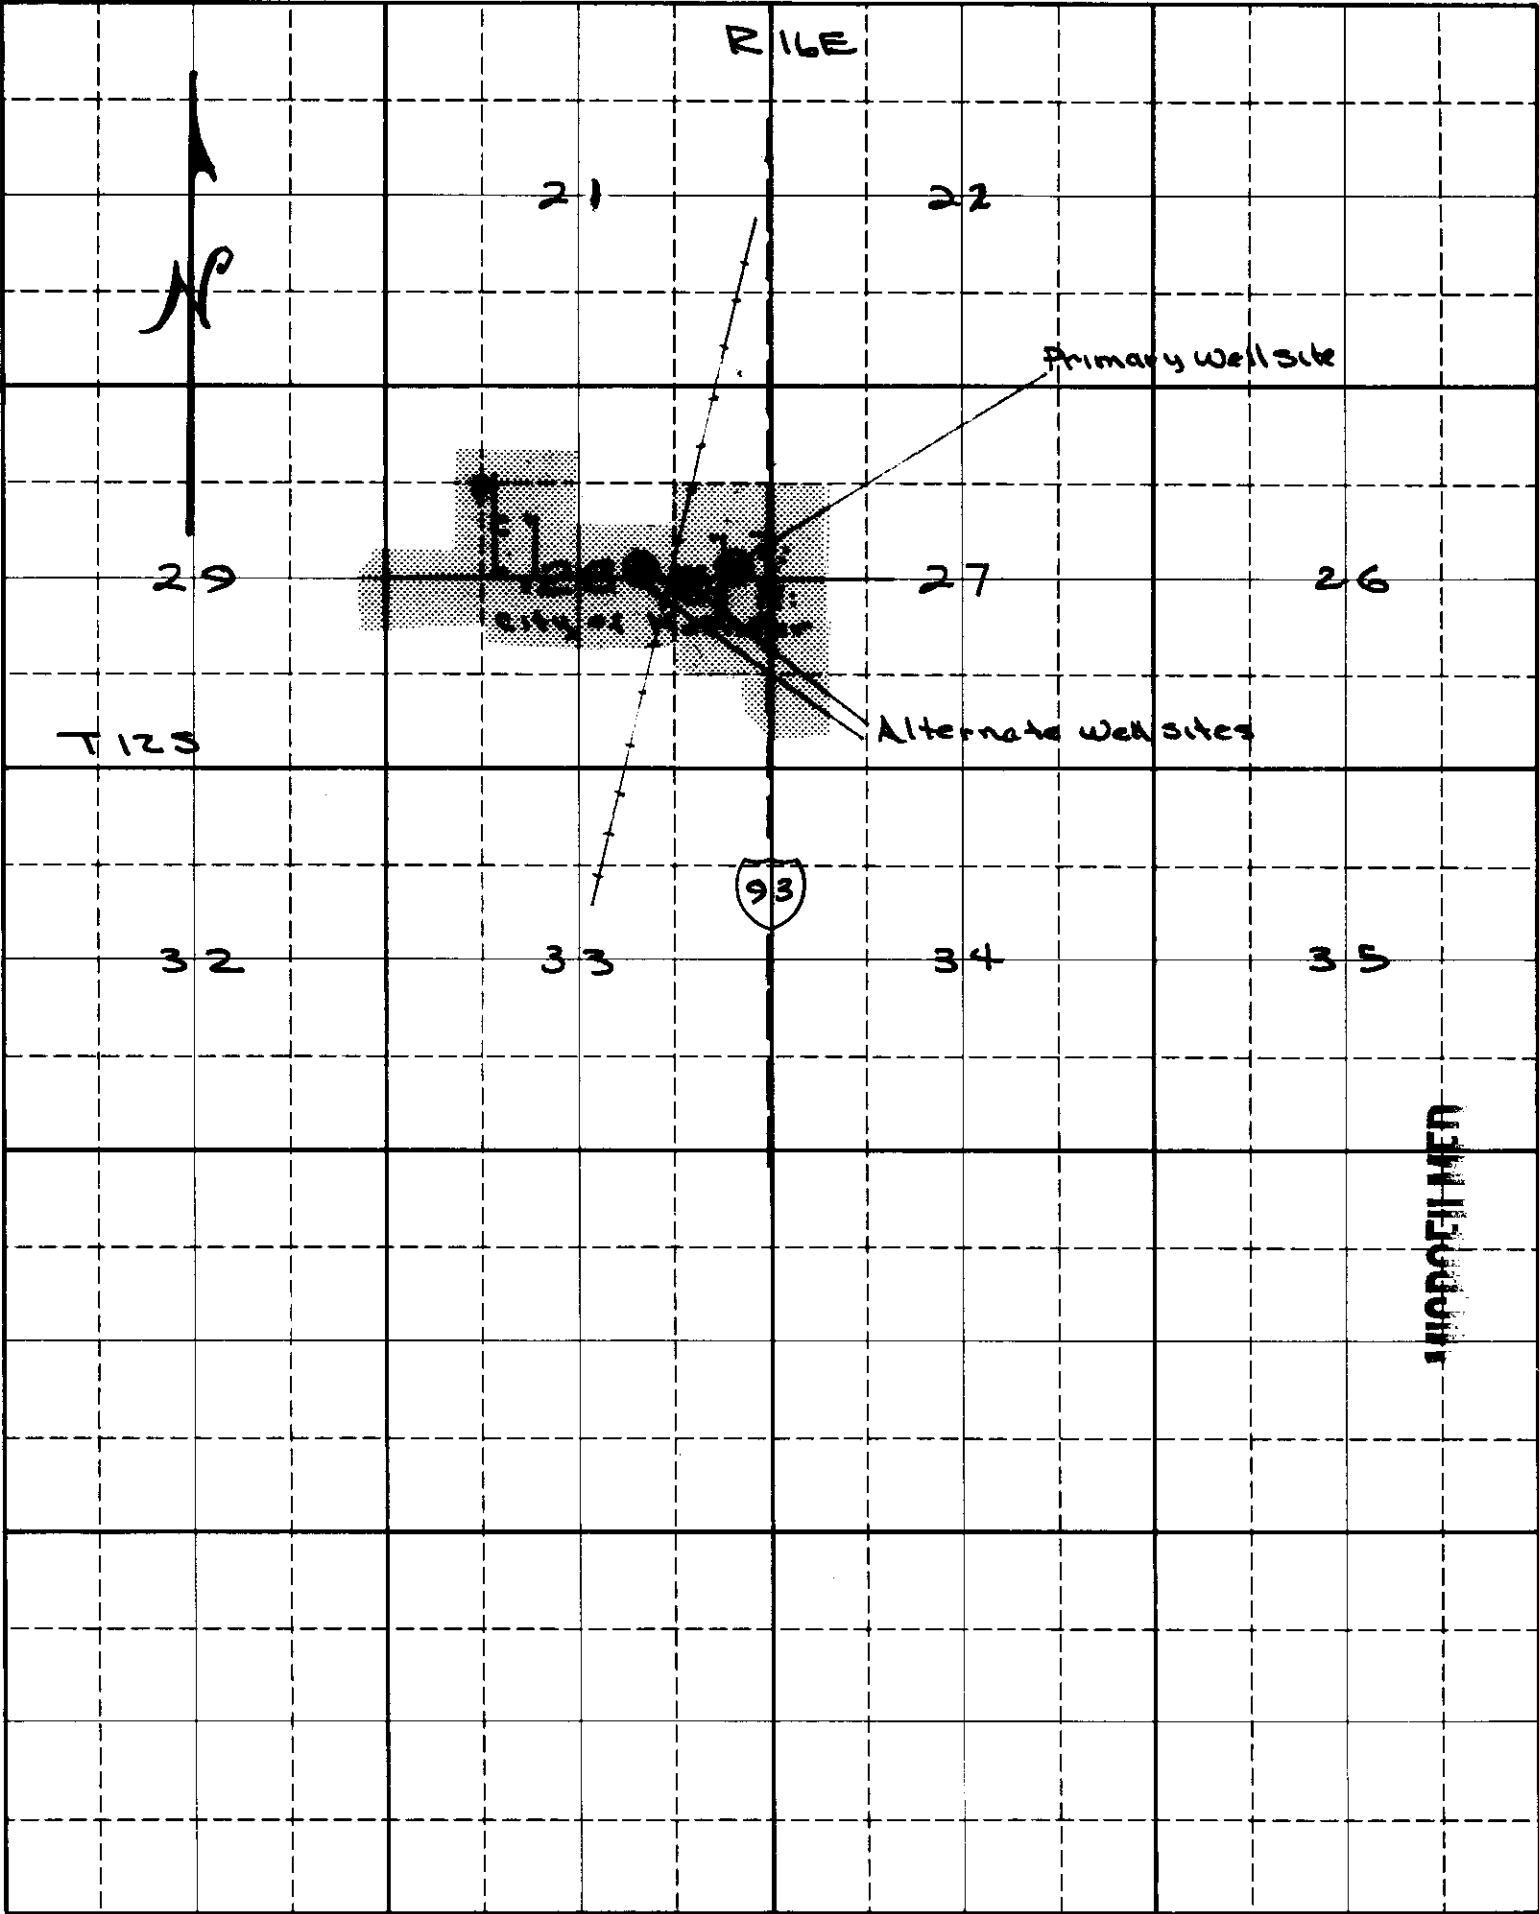

Scale: 2 inches equal 1 mile

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

Charles R. Shyland
(Applicant)
Mayor, City of Hollister

Proposed Priority 7/25/77

Received by JA Date 7-25-77 Time 12: noon
Preliminary check by ADM Fee \$ 25.00
Receipted by JA Date 7-25-77 # 8669
Publication prepared by JA Date 8/5/77
Published in Times News
Publication dates 8/8 & 8/25/77
Publication approved JA Date 8/31/77
Priority reduced to _____ Reason _____

Protests filed by: _____

Copies of protests forwarded by _____
Hearing held by _____ Date _____
Recommended for (approval) denial by mls wtk

ACTION OF STATE RECLAMATION ENGINEER

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. 47-7417, and said application is hereby APPROVED.

1. Approval of said application is subject to the following limitations and conditions:

- a. SUBJECT TO ALL PRIOR WATER RIGHTS.
 - b. Proof of construction of works and application of water to beneficial use shall be submitted on or before February 1, 19 79.
 - c. Other: For licensing purposes a scientific measurement of the diversion rate of the system as it is normally operated shall be provided by either properly installing an approved type of measuring device or by having a professional engineer certify the rate of diversion to the Department prior to submitting proof of beneficial use of water.
2. Denial of said application is for the following reasons: _____

Witness my hand this 7 day of November 19 77.


State Reclamation Engineer

**NOTICE OF APPLICATION
FOR WATER PERMIT**

Notice is hereby given that City of Hollister, Idaho, ID 83301 has on 7/25/77 submitted Application No. 77-7417 for a permit to appropriate 1.0 cubic feet per second of water from groundwater by means of wells, pumps, pressure tank, flowmeter & connecting pipeline within the SE 1/4 NE 1/4, SW 1/4 NE 1/4, Sec. 28, Twp. 12S, Rge. 16E, B.M., Twin Falls County to be used from Jan. 1 to Dec. 31 for city water supply within the City of Hollister.

If issued, this permit will be subject to all prior water rights. Protests against the granting of the permit must be filed with the Idaho Department of Water Resources, 1041 Blue Lakes Blvd., North, Twin Falls, Idaho, 83301 on or before September 5, 1977.

C. STEPHEN ALLRED
Director

PUBLISH August 18 & 25, 1977

Affidavit of Publication

STATE OF IDAHO,
COUNTY OF TWIN FALLS }

ss.

No 6302

I, Carol Anne Jennings being first duly sworn upon oath, depose and say that I am Print. Clerk of the TIMES-NEWS, published daily, except Saturday, at Twin Falls, Idaho, and do solemnly swear that a copy of the notice of advertisement, as per clipping attached, was published in the regular and entire issue of said newspaper, and not in any supplement thereof, for two consecutive Sundays, commencing with the issue dated August 12, 1977, and ending with the issue dated August 25, 1977.

And I do further certify that said newspaper is a consolidation, effective February 16, 1942, of the Idaho Evening Times, published theretofore daily except Sunday, and the Twin Falls News, published theretofore daily except Monday, both of which newspapers prior to consolidation had been published under said names in said city and county continuously and uninterruptedly during a period of more than twelve consecutive months, and said TIMES-NEWS, since such consolidation, has been published as a daily newspaper except Saturday, under said name in said city and county continuously and uninterruptedly.

And I further certify that pursuant to Section 60-108 Idaho Code, Thursday of each week has been designated as the day on which legal notice by law or by order of any court of competent jurisdiction within the state of Idaho, to be published weekly, will be published; and that at the head of the editorial column of said combined newspapers, and in each issue thereof, Thursday is announced as the day on which said legal notices will be published.

Subscribed and sworn to before me on this 26th day of August, 1977.

Carol Anne Jennings
Print. Clerk
Notary Public in and for the County of Twin Falls,
State of Idaho, residing at Twin Falls, Idaho



State of Idaho
DEPARTMENT OF WATER RESOURCES
STATE OFFICE, 450 W. State Street, Boise, Idaho

JOHN V. EVANS

Governor

C. STEPHEN ALLRED

Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 334-4440

March 17, 1981

City of Hollister
Rt. 1
Hollister, Idaho 83301

Dear Sirs,

RE: License No. 47-7417

Enclosed is a copy of the Water Right License issued on the above referenced Permit.

Please be advised that one of the conditions of your permit was that a measuring device be installed as part of your diversion works. That requirement has been waived with issuance of the enclosed license. However, in the event that water supply shortages become a problem installation of measuring devices may be required.

Sincerely,

A handwritten signature in cursive script, appearing to read "Jim Johnson".

JIM JOHNSON
Water Distribution Supervisor

JJ:mr
Enclosure

MICROFILMED



State of Idaho
DEPARTMENT OF WATER RESOURCES
STATE OFFICE, 450 W. State Street, Boise, Idaho

JOHN V. EVANS
Governor

C. STEPHEN ALLRED
Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 334-4440

March 2, 1981

City of Hollister
Rt. 1
Hollister, Idaho 83301

Dear Sirs,

A representative of this Department has made an examination of the works covered by your Permit No. **47-7417**, and has found the following:

Amount of water that can be recognized as beneficially used under Idaho law: **.40 cfs** Source: **groundwater**

The maximum quantity diverted shall not exceed **N/A** acre feet per year.

Point(s) of diversion: **SE 1/4, Sec. 28, Twp. 12S, Rge. 16E, B.M.**

Beneficial use: **Municipal use within the city limits of Hollister.**

Priority date established: **July 25, 1977**

Conditions (if any):

If you do not concur with these findings please contact us within 10 days, otherwise a water license will be issued as set forth above.

Sincerely,

JIM JOHNSON
Water Distribution Supervisor

MICROFILME

RECEIVED

Phone FEB 20 1979

Department of Water Resources
Southern District Office

3. Water will be used for the following purposes:

Period of Use: from 1-1 to 12-31
(mo.-day) inclusive (mo.-day)

Period of Use: from _____ to _____
(mo.-day) inclusive (mo.-day)

Period of Use: from _____ to _____
(mo.-day) inclusive (mo.-day)

Permit No. 47-7417
Examination for b/c

- Max Rate of Diversion 1.0 cubic feet per second and annual volume _____ AF/Annum.

- Township 12S N/S, Range 16E E/W, B.M., Section 28, Subdivision SE 1/4 NE 1/4, Swain Saline County
Permit Shaws
 Township _____ N/S, Range _____ E/W, B.M., Section _____, Subdivision SW 1/4 NE 1/4, _____ County
 Township _____ N/S, Range _____ E/W, B.M., Section _____, Subdivision NE 1/4 SE 1/4, _____ County

Other Points of Diversions: _____

Description of diverting works: 12' x 432" storage tank, pipeline distribution system

Measuring device required: yes ☒ no ☐

- [illegible]

TOTAL ACREAGE


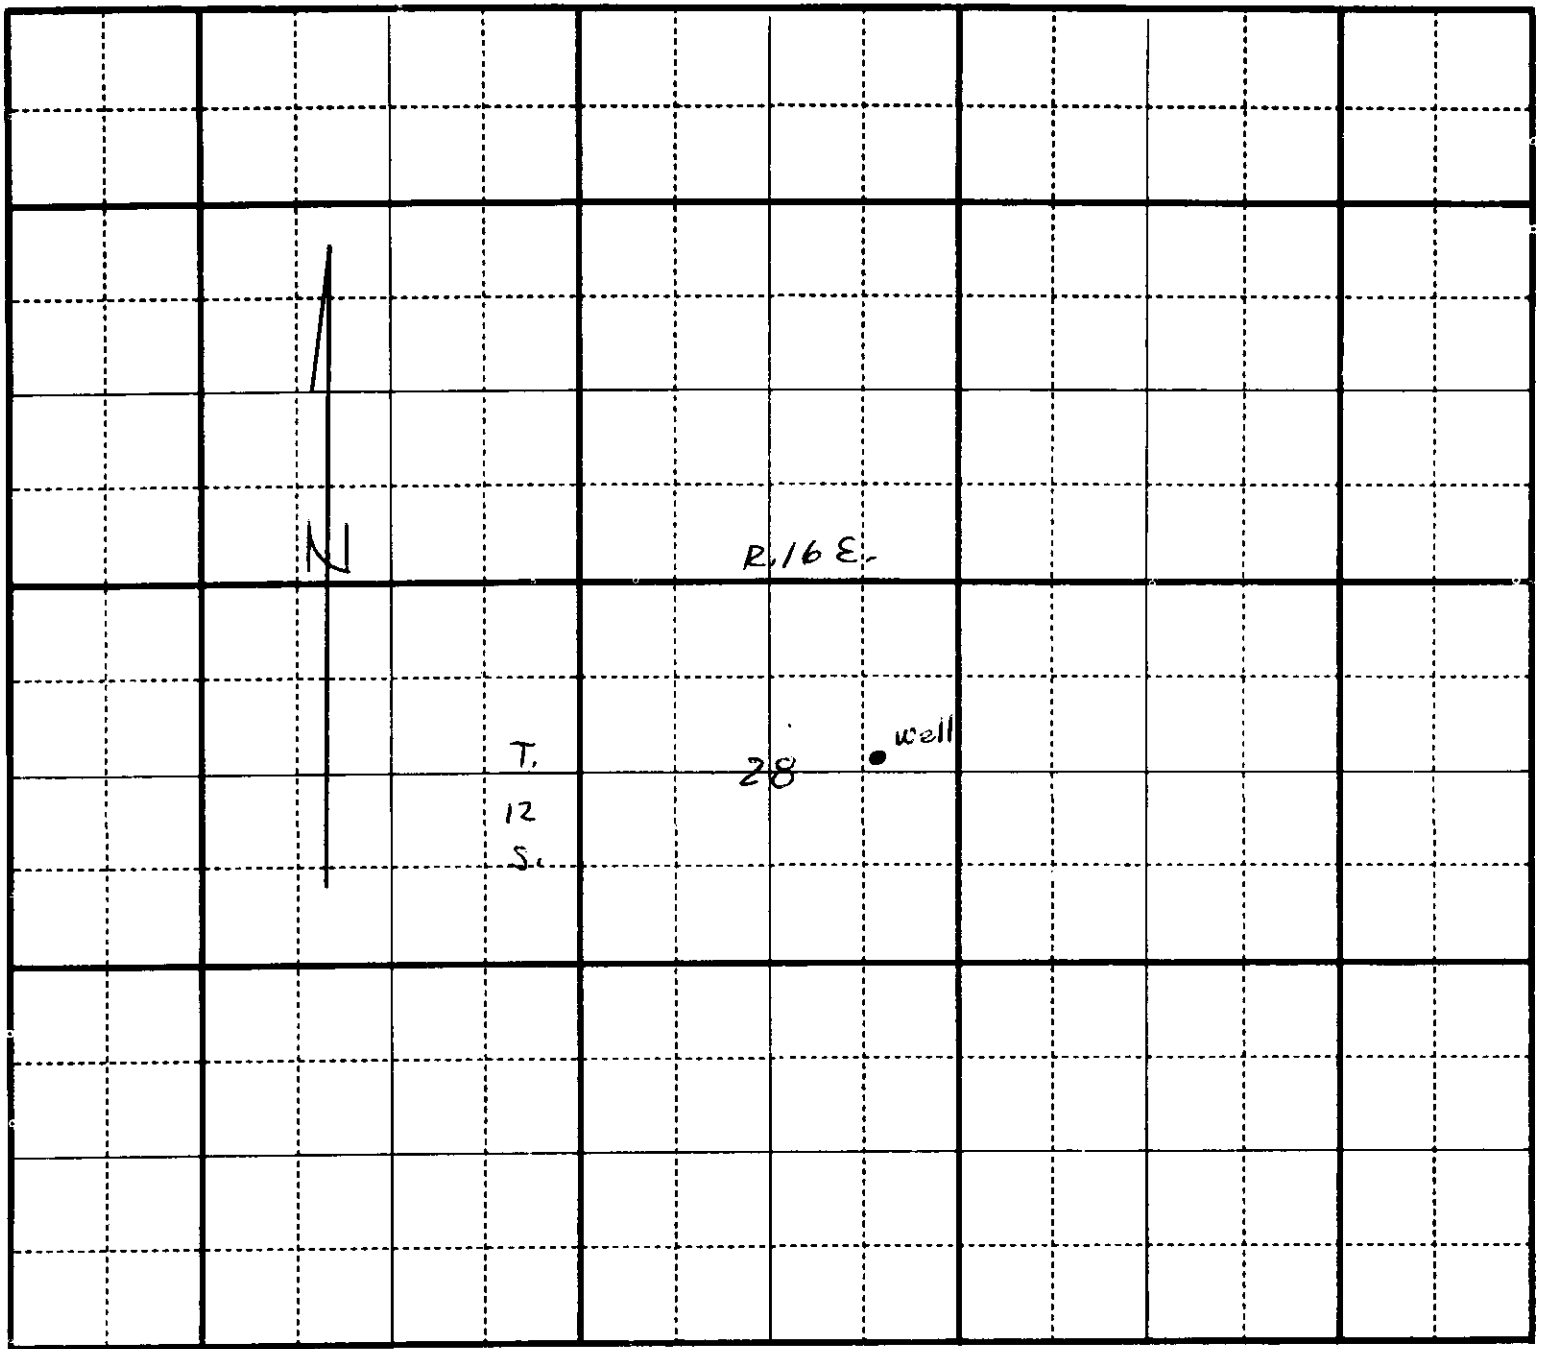


Diagram of System

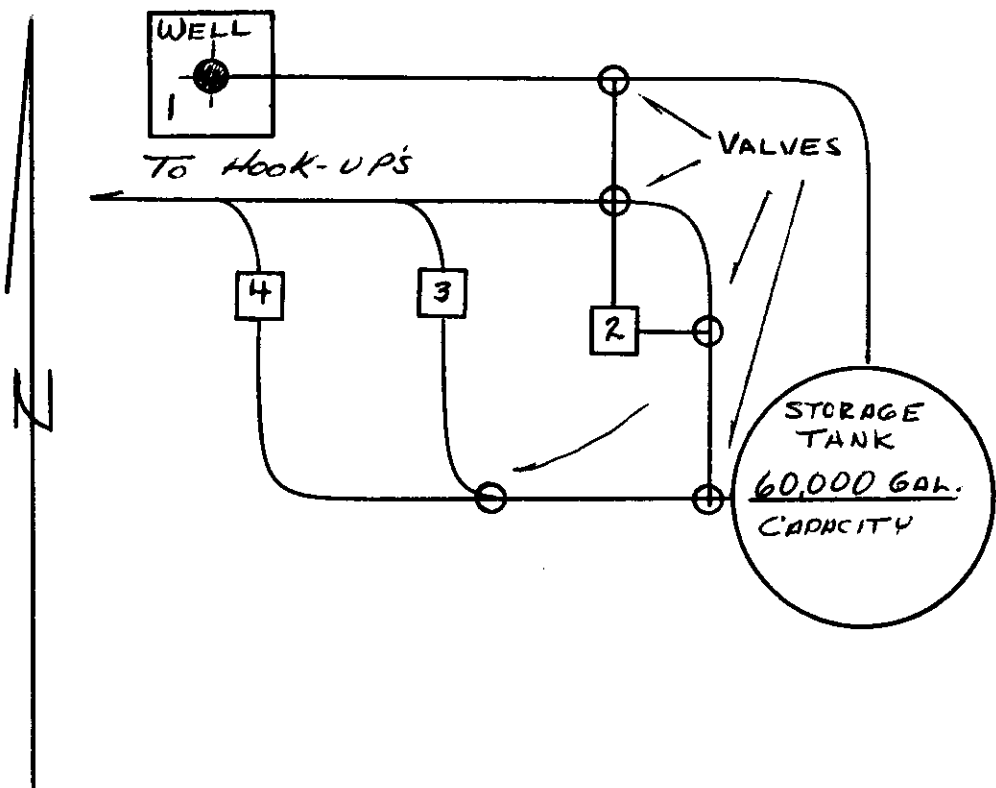

DATE OF EXAM 2.27.79

ACREAGE

Found ☒ ☐

Recommended ☒ ☐

Irrigation Requirement ✓ Ac Ft/Ac

USE

Irrigation Q=_____ c.f.s. V=_____ AF/Ann. from _____ to _____
Domestic Q=_____ c.f.s. V=_____ AF/Ann. from _____ to _____
Livestock Q=_____ c.f.s. V=_____ AF/Ann. from _____ to _____
MENDOTA 27 N/A JAN 1 Dec. 31

Is water co-mingled? yes _____ no ☒

Name source: _____
 twp. _____ N/S, Rge _____ E/W, B.M., Sec. _____, Sub. _____ 1/4 _____ 1/4 _____
 _____ County

Exchange? yes_____ no ☒

Name source exchanged with: _____
 twp. _____ N/S, Rge _____ E/W, B.M., Sec. _____, Sub. _____ 1/4 _____ 1/4 _____
 _____ County _____

Point of injection: _____
 twp. _____ N/S, Rge _____ E/W, B.M., Sec. _____, Sub. _____ 1/4 _____ 1/4 _____
 _____ County

Point of exchange: twp. _____ N/S, Rge _____ E/W, B.M., Sec. _____, Sub. _____ 1/4 _____ 1/4 _____
County _____

Total Q measured D. 401 C.F.S. Method of measurement MCCROMETER

Total Q recommended .27 CFS Meter No. 78-4-205M Type 8" Condition New

Total V recommended N/A

Recommended Amendments:

P.D. _____
Place of Use _____
Other _____
None ☒

?? called Gary F. on why he recommended that 27c's be allowed. Since this exam is 2 yrs old he could not remember. I recommend that this right be licensed for the capacity to allow for Municipal city limit changes.

MEASUREMENT CALCULATION:

MEASURED .40 CFS ALLOWED .27 CFS. 1

$$(180 \text{ gal/min}) \div (448.8 \text{ gal/min/CFS}) = \text{.40 CFS CAPACITY}$$

SYSTEM DESCRIPTION: #

SYSTEM DESCRIPTION: #

- ① G.E. MOTOR 5K6228X45A 15Hp. LAYNE PUMP #T78343
- ② MARATHON ELECTRIC 20Hp MODEL FF254TTDR7320CBWFI BOOSTER
- ③ CENTURY ELECTRIC 5Hp # 6324639-01 BOOSTER
- ④ CENTURY 6324639-02 BOOSTER

53 Hook-Ups, - 60,000 gal STORAGE TANK.

REMARKS:

Charles Shepherd (Mayor of Hollister) was present during the exam.

Examiner's Signature Paul Funderburg Date 2-27-79

Checked by James G. Gannon Date 3-1-79

Approved by [Signature] Date 2/26/1981

No Overlapping rights



State of Idaho
DEPARTMENT OF WATER RESOURCES
STATE OFFICE, 373 W. Franklin Street, Boise, Idaho

JOHN V. EVANS
Governor

C. STEPHEN ALLRED
Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 384-2215

February 13, 1979

City of Hollister
Route 1
Twin Falls, ID 83301

Gentlemen:

Re: Permit No. 47-7417

We acknowledge receipt of the affidavit submitted as proof of beneficial use for the above referenced permit.

Before a license can be issued, a field examination must be made by a representative of this Department. We cannot tell just when this examination will be made, but our examiner will try to contact you at the time he makes the examination so that you may show him the system.

If you have any questions regarding the field examination, please contact our regional office in Twin Falls.

Sincerely,

RITA FLECK
Water Rights

RECEIVED

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
**PROOF OF APPLICATION
OF WATER TO BENEFICIAL USE**

RECEIVED

FEB 1 1979

Department of Water Resources
Southern District Office

1. a) Name of permit holder City of Hollister

b) Post office address Route 1 Twin Falls, Idaho 83301

2. Permit number 47-7417

3. Date of priority that you are prepared to establish September 5, 1977

4. a) Source from which water was appropriated Ground Water

b) Location of the point of diversion: SE 1/4 NE 1/4, Section 28

Township 12 South, Range 16 East Boise Meridian. Other points of diversion:

5. a) The amount of water and use to which the water has been applied:

Amount <u>0.27 cfs</u> for <u>Municipal</u> purposes from <u>January 1</u> to <u>December</u> incl.
(cfs &/or acre-feet per annum) (month-day) (month-day)
Amount _____ for _____ purposes from _____ to _____ incl.
(cfs &/or acre-feet per annum) (month-day) (month-day)
Amount _____ for _____ purposes from _____ to _____ incl.
(cfs &/or acre-feet per annum) (month-day) (month-day)

b) Total amount appropriated 0.27 cfs and/or acre-feet per annum.

c) Describe how and by whom measurement of rate of flow or amount of storage was made and the qualifications of the person making the measurement:
The pumping capacity of the pump is 120 gpm. The time required to fill the tank, 55,000 gallon tank (60,000 nominal), was checked against flow indicator of McCrometer MainLine Meter and found in agreement by Jim Leichter, E.I.T. in Agricultural Engineering.

6. If the means of diversion and conveyance are owned by someone other than the permit holder:

a) Give the name or description of the canal, ditch or other works by which the water is conducted to the place of use:

b) Describe the agreement of understanding by which you take water from the works:

7. a) Briefly describe the works for diverting and conveying the water to the place of use, (if from a subterranean source, give the pump size, motor size, size of well casing, depth of well; if from surface water, give brief description of diversion structure and/or canal or ditch):

A 15 hp vertical turbine pump producing 120 gpm from a 12 inch diameter well, 432 ft. deep, into a 60,000 gallon (nominal) above ground redwood storage tank. The water is then taken from the tank by piping to a booster station and to a distribution system.

b) Describe the provision for making a measurement which you have at your point of diversion: (i.e., installed measuring device, access port, other)

A 4 inch micrometer water meter. McCrometer Main Line Meter Model No. CM0500

registering in gallons per minute and gallons total

MICROFILMED

Examined 2-13-79 by [signature]

c) Give well driller's name and address and the date the well was completed: Arnold Elsing Well Drilling
Box 919, Twin Falls, Idaho 83301

The pump test was preformed on February 2, 1978

8. If for other than irrigation, describe the beneficial use to which you have applied the water and the place of use:
Municipal Water Supply for the City of Hollister, Idaho

9. Irrigation uses: describe the lands irrigated by giving the acreages irrigated within each 40 acre subdivision:
N/A

T	R	SEC.	NE¼				NW¼				SW¼				SE¼				TOTAL
			NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	NE¼	NW¼	SW¼	SE¼	

10. Remarks: This Proof of Application of Water to Beneficial Use is for one well only.
Application for Permit listed three proposed sites. No other sites will be drilled
at this time.

The above information is a true statement of the extent to which the above numbered permit has been developed.
1/19/79 (Date) Charlie R. Shyler (Signature)

State of Idaho)
County of Twin Falls) ss.

On this 19th day of January, 19 79, personally appeared before me the
signer(s) of the above instrument, who duly acknowledged to me that he (she) (they) executed the same.

My commission expires Lifetime
Notary Public
Residing at Twin Falls, Idaho



State of Idaho
DEPARTMENT OF WATER RESOURCES
STATE OFFICE, 373 W. Franklin Street, Boise, Idaho

JOHN V. EVANS
Governor

C. STEPHEN ALLRED
Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 384-2215

10/10/78

Dear Wateruser:

The enclosed Order changes the measuring device condition of approval on your water right permit.

The changed condition should be less restrictive and provide more flexibility to you in the development of your water right system. The specifications related to the size and location of the access port will be available upon request from the Department, as soon as the Department's measuring equipment is obtained.

If you have questions regarding this matter, please contact this office or our regional offices.

Sincerely,

L. Glen Saxton

L. GLEN SAXTON
Chief, Operations Bureau

LGS:JG:kw

Enclosure

Microfilm



State of Idaho
DEPARTMENT OF WATER RESOURCES
STATE OFFICE, 373 W. Franklin Street, Boise, Idaho

JOHN V. EVANS
Governor

C. STEPHEN ALLRED
Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 384-2215

CERTIFIED MAIL

November 30, 1978

Re: Permit No. 47-7417

103449

City of Hollister
Route 1
Hollister, ID 83301

Gentlemen:

One of the conditions of approval of your water Permit No. 47-7417 (see last page of your approved permit) was that evidence of the extent of development be submitted as proof of application of water to beneficial use to this office on or before February 1, 1979. Enclosed is an affidavit form which must be used to submit the required proof of beneficial use.

If you have not fully completed your project, and you have not previously received an extension of time, you may request an extension of time provided the delay is for reasonable cause as indicated in Section 42-204, Idaho Code, amended. If you have been prevented from proceeding by a governmental agency or by litigation, more than one extension of time can be granted.

Either the beneficial use affidavit or a request for an extension of time must be received by this Department on or before the above mentioned date, otherwise, the permit will lapse and be of no further force or effect.


RITA FLECK
Water Rights

Encl: Proof affidavit

RECEIVED

November 2, 1977

Re: Permit No. 47-7417

City of Hollister
Route 1
Hollister, ID 83301

Gentlemen:

Enclosed is a copy of your approved Application for Permit No. 47-7417 . We direct your attention to the conditions of approval as listed on the fourth page.

Be sure to note that a special condition requiring you to either install and maintain a measuring device at your point of diversion or to provide the Department a certified measurement of the systems diversion capacity prior to submitting proof of beneficial use of water. We have enclosed a letter describing the different types of measuring devices accepted by this office.

Sincerely,

BOBBY D. FLEENOR
Chief, Operations Bureau

BDF/cah

Enclosure

INTER-DEPARTMENT MEMO — 1

FROM Sheryl - Southern

DATE September 20, 1977

TO State Office

SUBJECT Application for Permit No. 47-7417 - City of Hollister

Please include the enclosed letter in the above file.

Thanks.

SM

SIGNATURE



STATE OF IDAHO

DEPARTMENT OF HEALTH AND WELFARE

RECEIVED

SEP 16 1977

Department of Water Resources
Southern District Office

DIVISION OF ENVIRONMENT
P. O. Box 547
Twin Falls, Idaho 83301

September 14, 1977

Mr. Michael L. Steele
Dept. of Water Resources
1041 Blue Lakes Blvd. N.
Twin Falls, Idaho 83301

re: Application for Permit No. 47-7417
City of Hollister

Dear Mr. Steele:

We have reviewed and approved plans and specifications and contract documents for the proposed Hollister municipal well. As a result, we have no negative comments concerning this application.

Sincerely,

DEPARTMENT OF HEALTH & WELFARE

A handwritten signature in cursive script, reading "Ian H. von Lindern".

Ian H. von Lindern
Environmental Engineer

IHVl/jm
cc: Jerry L. Yoder, IDHW
City of Hollister
Ron Underwood, J-U-B Engineers

September 13, 1977

Idaho State Health Department
Mr. Ian Von Lindern
Box 547
Twin Falls, ID 83301

Re: Application for Permit No. 47-7417 - City of Hollister

Dear Mr. Von Lindern:

Enclosed is a copy of the above referenced application for permit which may be of interest to your agency. Please review the application and submit any comments you may have.

This office normally completes the processing of an application within a six-week period and is required to take final action shortly thereafter.

If you have questions regarding the application, please contact this office.

Sincerely,

Michael L. Steele
Southern Region Supervisor

MLS:sm

Enc.

MICROFILMED

NOTICE OF APPLICATION FOR WATER PERMIT

Notice is hereby given that City of Hollister
Hollister, ID 83301
has on 7/25/77 submitted Application No. 47-7417
for a permit to appropriate 1.0 cubic feet per second ~~acre feet per annum~~
of water from groundwater
by means of wells, pumps, pressure tank, flowmeter & connecting pipeline
within the SE1/4NE1/4, SW1/4NE1/4, NE1/4SE1/4, Sec. 28, Twp. 12S, Rge. 16E., B.M.,
Twin Falls County
to be used from Jan. 1 to Dec. 31
for city water supply
within the City of Hollister

If issued, this permit will be subject to all prior water rights. Protests against the granting of the permit must be filed with the Idaho Department of Water Resources, 1041 Blue Lakes Blvd., North, Twin Falls, Idaho, 83301 on or before September 5, 1977.

C. Stephen Allred

Director

Published in the Times News
on 8/18 and 8/25/77

August 5, 1977

Times News
P. O. Box 548
Twin Falls, ID 83301

Re: Application for Permit No. 4747417 - City of Hollister

Gentlemen:

Enclosed you will find a legal notice which we wish to have published once a week for two consecutive weekly issues of your newspaper. We have inserted the publication dates allowing ample time for you to submit us a galley proof for review before publication.

After sending us a galley proof, proceed with the publication on the dates we have inserted, assuming the notice is correct. If we have any corrections, we will notify you before the first publication. If you cannot publish the notice on the proposed dates, please contact us immediately.

In order to receive payment, an affidavit of publication must be submitted to the Department along with the publication bill.

Sincerely,

Michael L. Steele
Southern Region Supervisor

MLS:sm

Enclosure

Bill submitted: _____



J-U-B ENGINEERS, INC.

North Plaza Offices, Suite 1
800 Falls Avenue

Twin Falls, Idaho 83301

Telephone: (208) 733-2414

July 12, 1977

Department of Water Resources
1041 Blue Lakes Blvd. North
Twin Falls, Idaho 83301

Subject: Application for Permit to Appropriate
Public Waters, City of Hollister,
Twin Falls County, Idaho.

Gentlemen:

Transmitted with this letter is the Application along with a check
for the filing fee in the amount of twenty-five dollars (\$25.00).

If you have any questions please contact us at your convenience.

Yours truly,

J-U-B ENGINEERS, Inc.

R.R. Underwood, R.P.G.

RRU/et
Enc.

RECEIVED
JUL 13 1977