



DEAR SUBDIVISION SURVEY
Section 26 & 36, T.33N. R.3E. B.M.

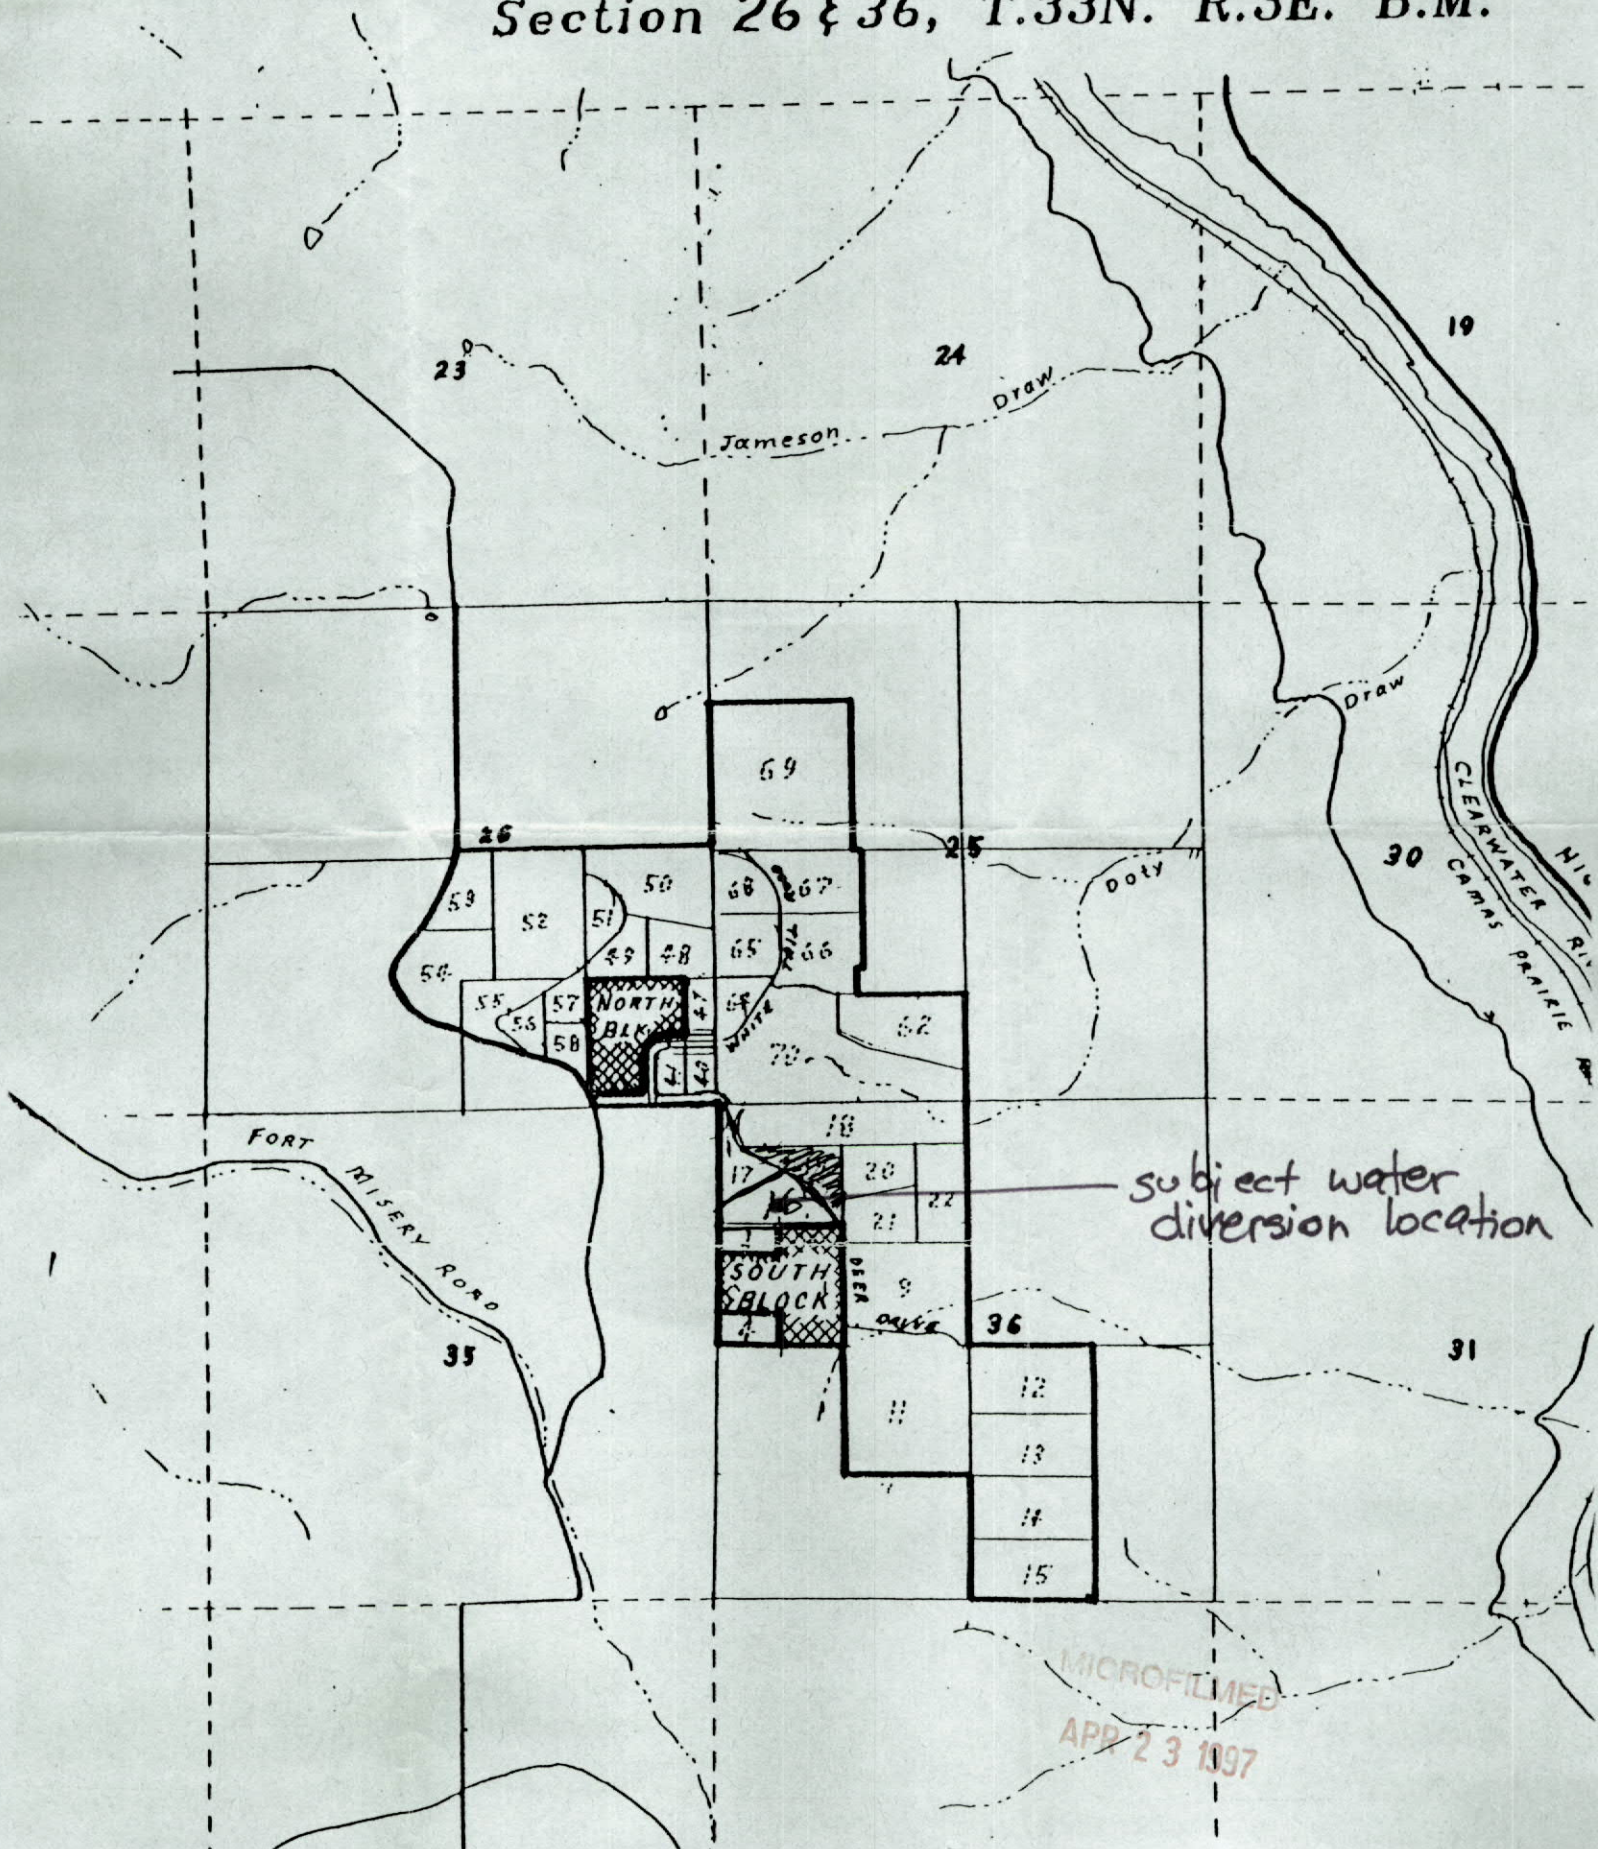

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

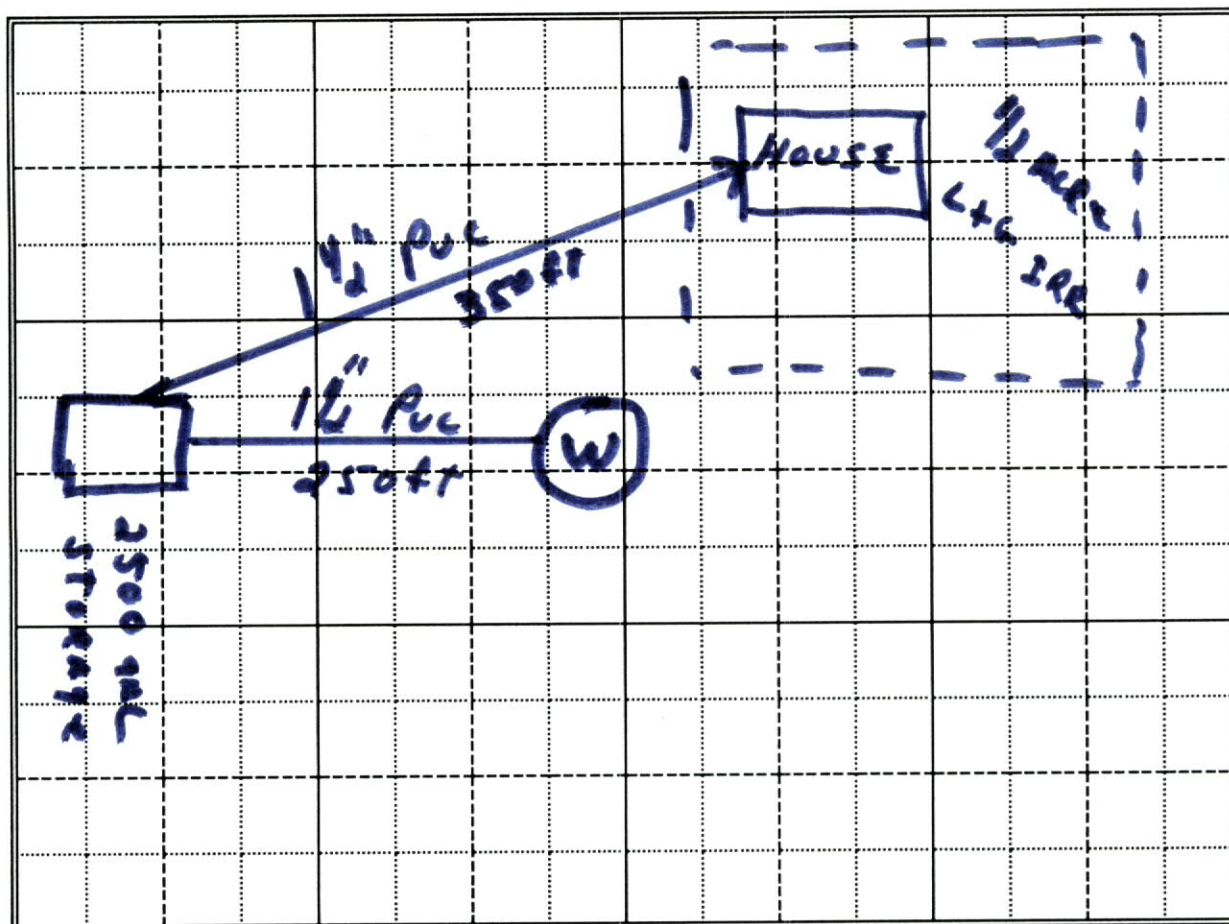

Scale: 1" = _____

____ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

____ Aerial Photo Attached (required for irrigation of 10+ acres)

____ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
	FRANKLIN	.5	2801054915	Sub	1.5"

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: _____

MICROFILMED

JUN 12 1998

E. NARRATIVE/REMARKS/COMMENTS


Pump delivers to 2 1200 gal storage cisterns. From there it is pumped to house & stock via same system.

Irrigation portion of permit is dropped. The only irrigation is 1/4 acre of lawn & garden around house. So permit should read Domestic & Stock, explained this to Mr. Sawyer & we were in agreement.



Have conditions of permit approval been met? ☒ yes ☐ no

MICROFILMED
JUN 12 1998

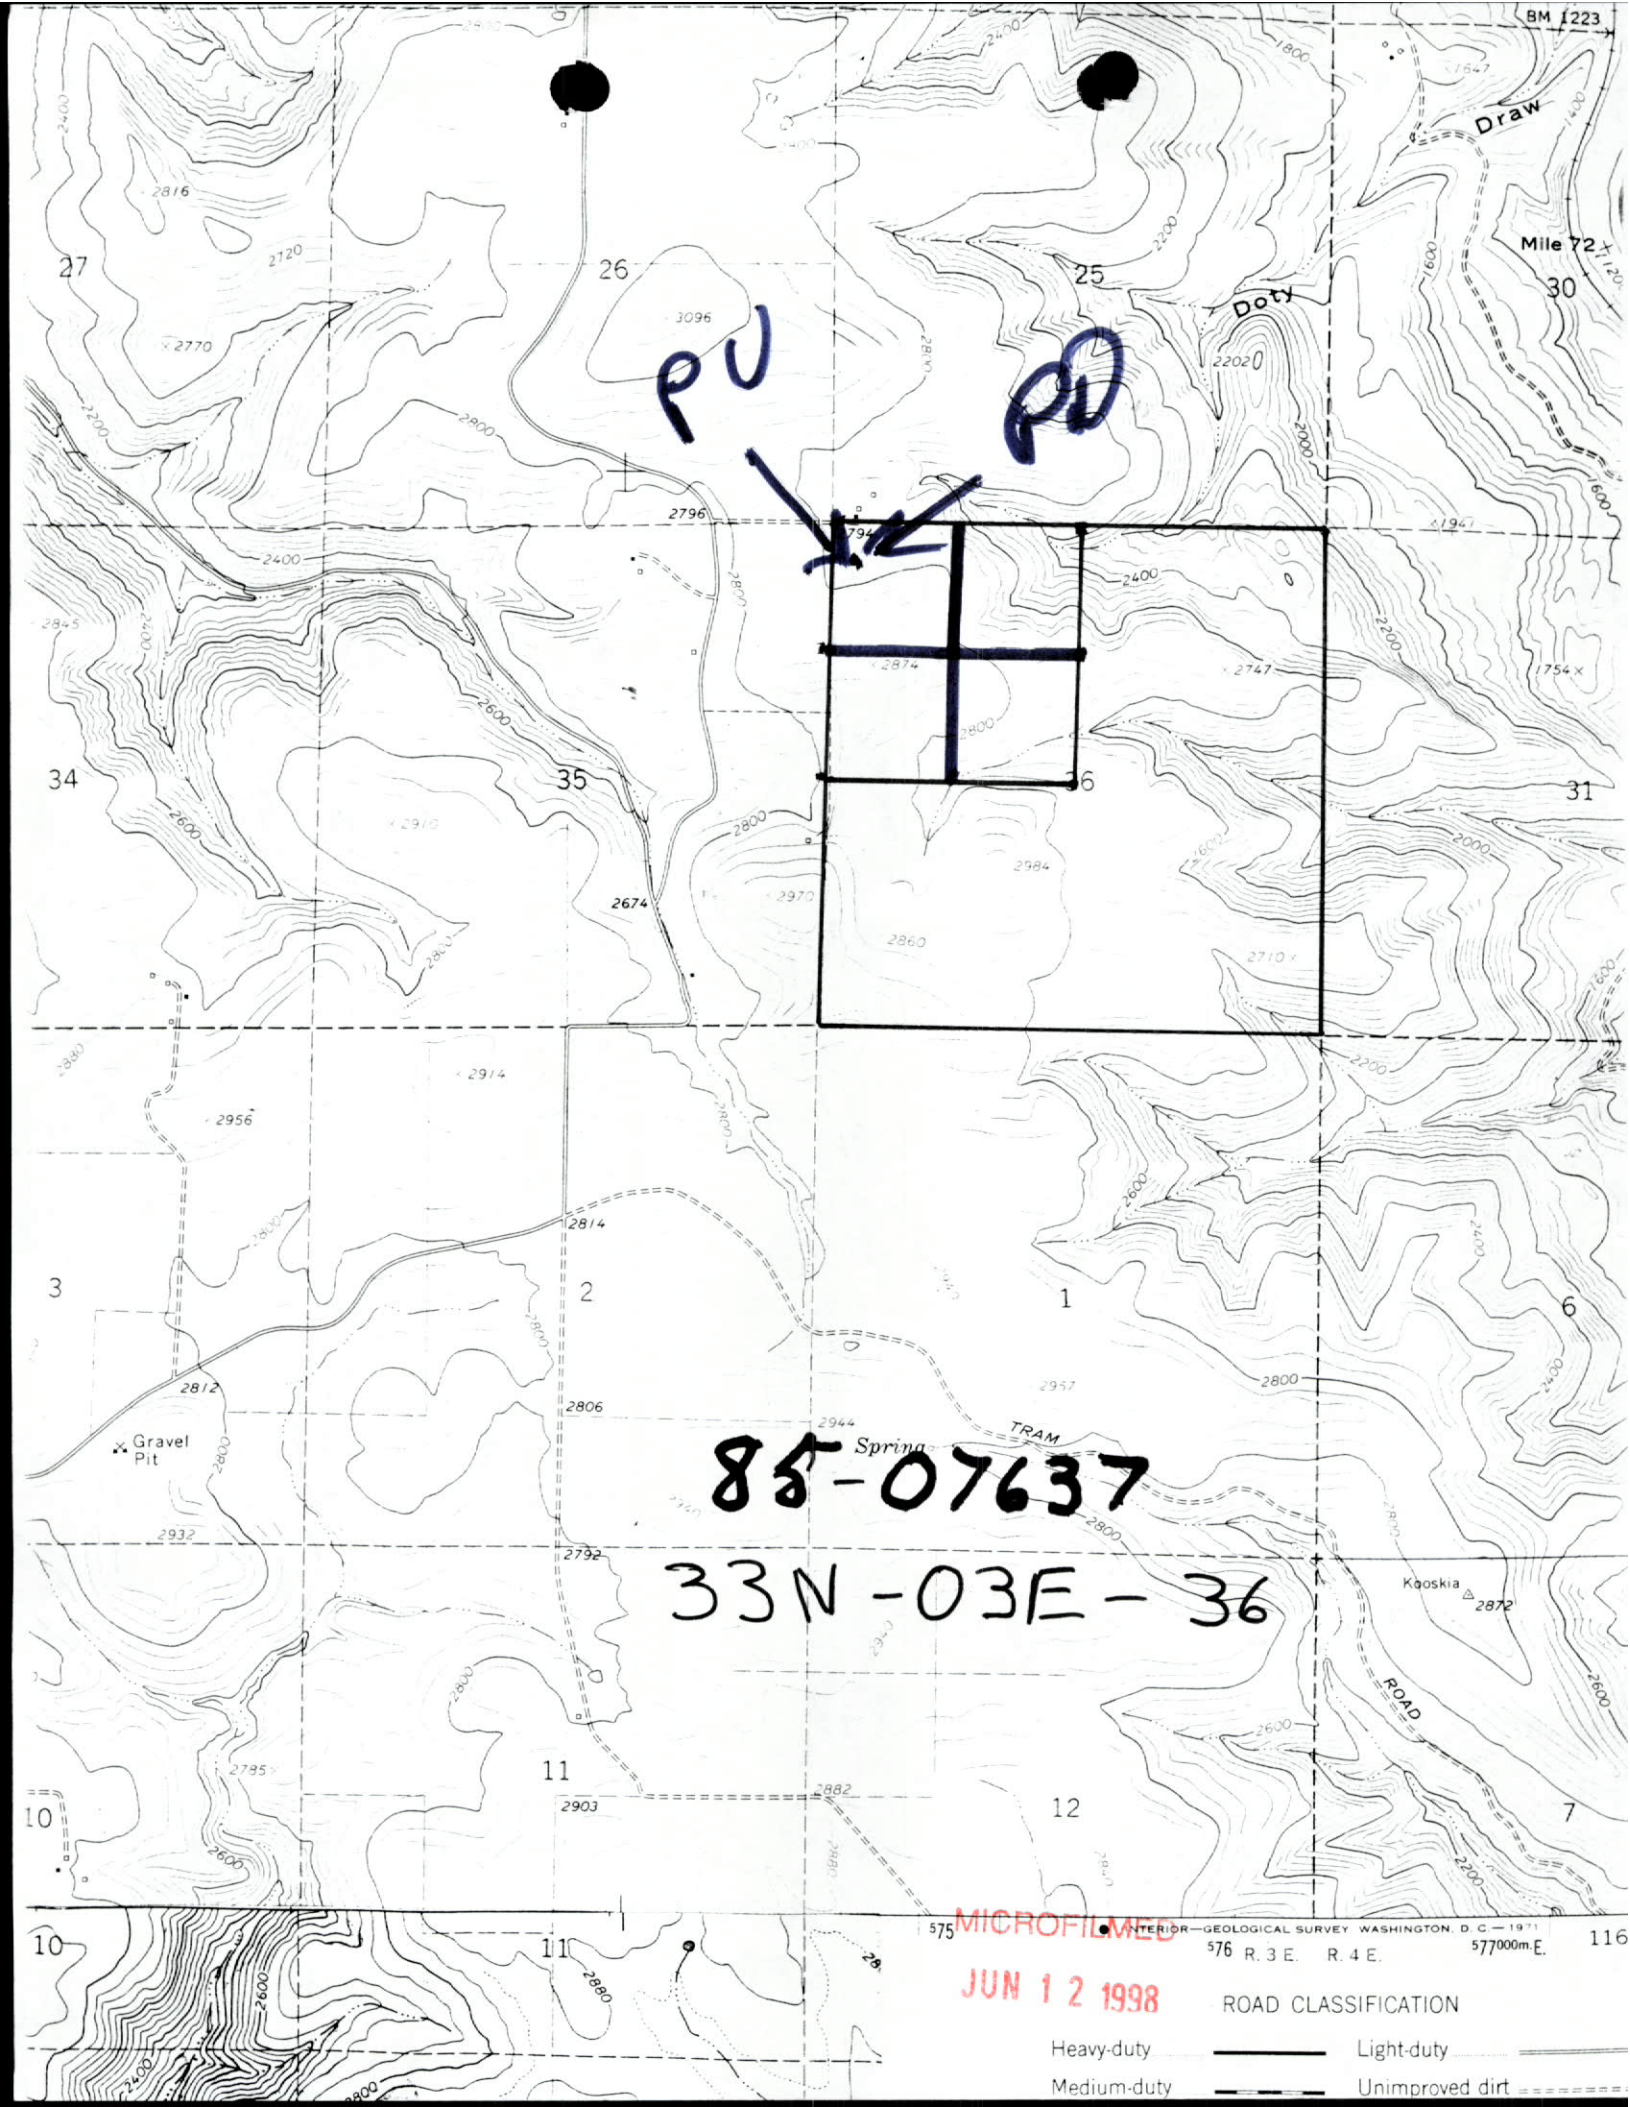

85-07637

33N-03E-36

MICROFILMED

JUN 12 1998

ROAD CLASSIFICATION

Heavy-duty	—————	Light-duty	—————
Medium-duty	—————	Unimproved dirt	—————

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO
County of Idaho - ss.

NOTICE OF APPLICATION FOR WATER RIGHT

The following application(s) have been filed
to appropriate the public waters of the State
of Idaho:

85-07637

SAWYER, STEVE
SAWYER, SUSAN
ROUTE 2 BOX 12 E
KAMIAH, ID 83536
Source: GROUNDWATER
Diversion Pt: NWNW Sec 36 T 33N R 03E
in IDAHO County.
Use: IRRIGATION (0.020 CFS)
STOCKWATER (0.010 CFS)
DOMESTIC (0.010 CFS)
Total Diversion: (0.040 CFS)
Date Filed: 1/7/1997
In: IDAHO County
T33N R03E S36 NWNW
5.0 ACRES TOTAL


For additional information concerning the
property location, call the Northern Regional
Office at (208) 769-1450.

The permit(s) will be subject to all prior
water rights. Protests must be filed with the
applicant and with the Director, Dept. of
Water Resources, Northern Region, 1910
Northwest Blvd., Suite 210, Coeur d'Alene,
Idaho 83814, together with a protest fee of
\$25.00 on or before FEBRUARY 3, 1997.

KARL J. DREHER, Director
Published: 1/15/1997 & 1/22/1997

J15-22

Andrew J. Mc Nab, being
first duly sworn, says she is the Publisher
of the IDAHO COUNTY FREE PRESS, a weekly newspaper published
and issued weekly at Grangeville, Idaho county, State of Idaho, and is
of general circulation in said county and state, that the said notice, of
which the one hereto attached is a true copy, was published in said
paper for 2 weeks, being published 2
times, the first publication being on the 15 day of
January, 19 97, and the last
publication on the 22 day of January, 19 97;
and that the said notice was published in the newspaper proper and not
a supplement; that said newspaper has been continuously and uninter-
ruptedly published in said county during a period of seventy-eight
consecutive weeks prior to the publication of said notice or advertise-
ment.

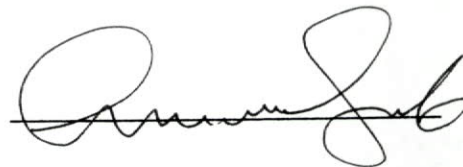

STATE OF IDAHO }

COUNTY OF }

On this 22 day of January in the year of 1997,
Before me, a Notary Public, personally appeared _____
Andrew J. Mc Nab, known or identified to me
to be the person whose name subscribed to the within instrument, and
being by me first duly sworn, declared that the statements therein are
true, and acknowledged to me that he executed the same.



Michelle Woslum
Notary Public for Idaho
Residing at Grangeville, ID
My commission expires: 01-16-200

MICROFILMED
APR 23 1997

State of Idaho
Department of Water Resources
Water Right License
WATER RIGHT NO. 85-07637

Priority: January 7, 1997

Maximum Diversion Rate:

0.02 CFS

Maximum Diversion Volume:

1.3 AF

This is to certify, that STEVE SAWYER
SUSAN SAWYER

RT 2 BOX 301

KAMIAH ID 83536

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated January 7, 1997; and has submitted Proof of Beneficial Use on February 17, 1998. An examination indicates that the works have a diversion capacity of 0.020 cfs of water from a **GROUNDWATER** source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
STOCKWATER	01/01 to 12/31	0.01 CFS	0.1 AF
DOMESTIC	01/01 to 12/31	0.02 CFS	1.2 AF
	Totals	0.02 CFS	1.3 AF

LOCATION OF POINT(S) OF DIVERSION:

NWNW , Sec. 36, Township 33N, Range 03E
IDAHO County

PLACE OF USE: STOCKWATER

TWN RGE SEC

33N 03E 36

NWNW

PLACE OF USE:

DOMESTIC, same as STOCKWATER use

CONDITIONS OF APPROVAL AND REMARKS


1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license shall be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. Point of diversion and place of use are located within Lot 16, Dear Subdivision.
6. Domestic use is for 1 home.

MICROFILMED

JUN 12 1998

State of Idaho
Department of Water Resources
Water Right License
WATER RIGHT NO. 85-07637

This license is issued pursuant to the provisions of Section 42-219, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this 7/31
day of June, 19 98.

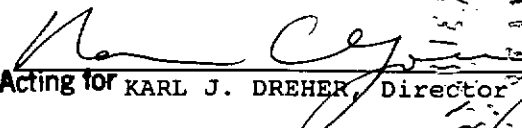
Acting for KARL J. DREHER, Director



MICROFILMED

JUN 12 1998

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

RECEIVED

FEB 17 1997

PROOF OF BENEFICIAL USE

Department of Water Resources

The Idaho Department of Water Resources considers this form a statement that the permit holder(s) has/have completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee, when necessary, or be accompanied by a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

1. Permit No. 85-07637 Telephone No. 208-935-1308

2. Name(s) of Permit Holder(s): Steve & Susan Sawyer

3. Mailing Address: Rt 2 Box 301 Kamiah ID 83536

4. Source of Water: groundwater If **GROUNDWATER** (well), Date Drilled: mo. 7 / yr. 96

a. Well Driller: Burns Well Drilling Drilling Permit Number: _____

b. **OPTIONAL:**
Pump Horsepower: 1/2 hp Pressure (psi): _____ Dynamic pumping level (ft): 150

5. Use(s) (as authorized by the water right permit):

Domestic (No. of households): 1 Stockwater (No. and type of stock): 2 horses

Irrigation (No. of acres): 5 ac Other: _____

6. Total rate of diversion and/or volume for which proof is submitted: .04 cfs OR _____ acre feet

7. Measuring Device Requirement: (refer to the approval conditions on your permit and respond accordingly)

(This question is not optional. Please check either yes or no. Proofs returned not checked accordingly, will be considered incomplete)

Measuring Device: Is a measuring device required? Yes _____ or No ✓
Has the measuring device been installed? Yes _____ or No ✓

Flow Measurement Port: Is a flow measurement port required? Yes _____ or No ✓
Has the measurement port been installed? Yes _____ or No ✓

8. Fee Enclosed: \$ N/A (See Fee Schedule on back of the instructions for filing proof of beneficial use)

9. Person to contact to accompany the Department representative during field examination of the water system.

Name: STEVE SAWYER Telephone Number: _____

Address: _____

10. The information given on this form is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the State of Idaho.

Signature of permit holder: Steve Sawyer Date: 1-20-98
(include your title, if on behalf of company or organization)

MICROFILMED

APR 28 1998

State of Idaho
Department of Water Resources
Permit To Appropriate Water
NO. 85-07637

Proposed Priority: January 7, 1997

Maximum Diversion Rate:

0.04 CFS

This is to certify, that **STEVE SAWYER**

SUSAN SAWYER

HC 2 BOX 12E

KAMIAH ID 83536

has applied for a permit to appropriate water from: **GROUNDWATER**

and a permit is **APPROVED** for development of water as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>
IRRIGATION	03/15 to 11/15	0.02 CFS
STOCKWATER	01/01 to 12/31	0.01 CFS
DOMESTIC	01/01 to 12/31	0.01 CFS
Totals		0.04 CFS

LOCATION OF POINT(S) OF DIVERSION:

NWNW , Sec. 36, Township 33N, Range 03E
IDAHO County

PLACE OF USE: IRRIGATION

<u>TWN RGE SEC</u>	<u>ACRES</u>	<u>ACRES</u>	<u>ACRES</u>	<u>TOTAL</u>
33N 03E 36	NWNW 5.0			5.0

Total number of acres irrigated: 5.0

PLACE OF USE: STOCKWATER, same as IRRIGATION use

PLACE OF USE: DOMESTIC, same as IRRIGATION use

CONDITIONS OF APPROVAL AND REMARKS

1. Proof of construction of works and application of water to beneficial use shall be submitted on or before March 1, 1998.
2. Subject to all prior water rights.
3. After specific notification by the department, the right holder shall install a suitable measuring device or shall enter into an agreement with the department to determine the amount of water diverted from power records and shall annually report the information to the department.
4. The rate of diversion of water for irrigation under this right and all other water rights on the same land shall not exceed 0.02 cubic feet per second for each acre of land.
5. Point of diversion is located within Lot 16, Dear Subdivision.
6. Place of use is located within Lot 16, Dear Subdivision.
7. Stockwater use is for 2 horses.
8. Domestic use is for 1 home and does not include lawn, garden, landscape, or other types of irrigation.

MICROFILMED

APR 23 1997


State of Idaho
Department of Water Resources

Permit To Appropriate Water

NO. 85-07637

This permit is issued pursuant to the provisions of Section 42-204, Idaho Code.
Witness the signature of the Director, affixed at Boise, this

27th day of February, 1997.

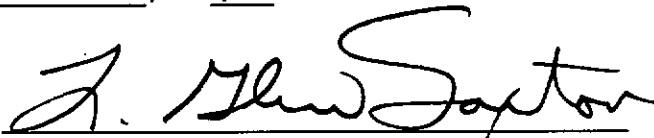
for Karl J. Dreher, Director



MICROFILMED
APR 23 1997

Ident. No. 85-7637

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR PERMIT

RECEIVED

FEB 20 1997

To appropriate the public waters of the State of Idaho

Department of Water Resources

1. Name of Applicant Steve & Susan Sawyer Phone 935-1308
Mailing address Rt 2 Box 12-E Kamiah ID 83536
2. Source of water supply groundwater which is a tributary of n/a
3. Location of point of diversion is Township 33N Range 3E Sec. 36 in the NW 1/4, NW 1/4, Govt. Lot Boise, B.M., Idaho County; additional points of diversion if any: n/a
4. Water will be used for the following purposes:

Amount <u>.01 cfs</u> for <u>domestic</u>	purposes from <u>Jan. 1</u> to <u>Dec. 31</u> (both dates inclusive)
(cfs or acre-feet per annum)	
Amount <u>.02 cfs</u> for <u>irrigation</u>	purposes from <u>Mar. 15</u> to <u>Nov. 15</u> (both dates inclusive)
(cfs or acre-feet per annum)	
Amount <u>.01 cfs</u> for <u>stockwater</u>	purposes from <u>Jan. 1</u> to <u>Dec. 31</u> (both dates inclusive)
(cfs or acre-feet per annum)	
Amount _____ for _____	purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)	
Amount _____ for _____	purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)	
Amount _____ for _____	purposes from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)	
5. Total quantity to be appropriated is (a) .04 cubic feet per second and/or (b) _____ acre feet per annum
6. Proposed diverting works:
 - a. Describe type and size of devices used to divert water from the source well - Goulds 3/4 h.p. (2)
1" pipe, 200' long, (2) concrete storage tanks (underground) - 2500 gal. total cap
 - b. Height of storage dam _____ feet; active reservoir capacity _____ acre-feet; total reservoir capacity _____ acre-feet
 - c. Proposed well diameter is 8" inches; proposed depth of well is 165 feet
 - d. Is ground water with a temperature of greater than 85°F being sought? no
 - e. If well is already drilled, when? 7/5/96; Drilling firm Burns Well - Grangeville ID
Well was drilled for (well owner) Sawyer; Drilling Permit No. 85-96-N-0039-000
7. Time required for completion of works and application of water to proposed beneficial use is 1 years (minimum 1 year)
8. Description of proposed uses (if irrigation only, go to item 9):
 - a. Hydropower; show total feet of head and proposed capacity in KW. _____
 - b. Stockwatering; list number and kind of livestock. 2 - horses
 - c. Municipal; show name of municipality. _____
 - d. Domestic; show number of households. 1 - single family dwelling
 - e. Other; describe fully. _____

MICROFILMED

APR 23 1997

9. Description of place of use:

a. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.

b. If water is used for other purposes, place a symbol of the use (example: D for Domestic) in the corresponding place of use below. See instructions for standard symbols.

TWP	RGE	SEC	N E				N W				S W				S E				TOTALS
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
33N	3E	36						D											
"	"	"						S											
"	"	"						5ac											5ac

Total number of acres to be irrigated 5 ac.

10. Describe any other water rights used for the same purposes as described above. N/A

11. a. Who owns the property at the point of diversion? Applicant - Sawyer

b. Who owns the land to be irrigated or place of use? " "

c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing: _____

12. Remarks: _____

13. MAP OF PROPOSED PROJECT REQUIRED - Attach an 8 1/2"x11" map clearly identifying the proposed point of diversion, place of use, section #, township & range. (A photocopy of a USGS 7.5 minute topographic quadrangle map is preferred.)

BE IT KNOWN that the undersigned hereby makes this application for permit to appropriate the public waters of the State of Idaho as herein set forth.

St. C. Sawyer
Signature of Applicant (and title, if applicable)

Received by [Signature] Date 1/7/97 Time 1:30 P Preliminary check by [Signature]
Fee \$ 50.00 Receipted by [Signature] # N-10893 Date 1/7/97
Publication prepared by [Signature] Date 1/15/97 Published in Idaho Free Press 1/15 + 22/97
Publication approved [Signature] Date 1/31/97

subject water
diversion location

23 1954



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. Box 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

June 11, 1998

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

STEVE SAWYER
SUSAN SAWYER
RT 2 BOX 301
KAMIAH ID 83536

RE: WATER RIGHT NO. 85-07637

Dear Water Right Holder(s):

The Department of Water Resources (the Department) has issued the enclosed license confirming that a water right has been established in accordance with the permit referenced above. The license is a preliminary order issued by the Department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action of the Department unless a party petitions for reconsideration or files an exception and/or brief as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the Department within fourteen (14) days of the service date of this order. The Department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See section 67-5243(3), Idaho Code.

EXCEPTIONS AND BRIEFS

Within twenty-one (21) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding. Otherwise, this preliminary order will become a final order of the Department.

If any party appeals or takes exceptions to this preliminary order, opposing parties shall have twenty-one (21) days to respond to any party's appeal. Written briefs in support of or taking exceptions to the preliminary order shall be filed with the Department. The Department retains the right to review the preliminary order on its own motion.

MICROFILMED
JUN 12 1998

ORAL ARGUMENT

If the Department grants a petition to review the preliminary order, the Department shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Department will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Department orders otherwise, all oral arguments will be heard in Boise, Idaho.

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Department in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with Rules of Procedure 302 and 303.

FINAL ORDER

The Department will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Department may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The Department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

If you have any questions, please call me at 208-327-7946.

Sincerely,

A handwritten signature in cursive script that reads "Shelley W. Keen".

Shelley W. Keen
Water Rights Supervisor

SK:klt

Enclosure

MICROFILMED
JUN 12 1998

CERTIFICATE OF MAILING

I hereby certify that on the 11th day of June, 1998, I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER (Approved License) to the person(s) listed below:

Water Right No. 85-07637

STEVE SAWYER
SUSAN SAWYER
RT 2 BOX 301
KAMIAH ID 83536


Kari Lynn Townsend
Secretary

MICROFILMED
JUN 12 1998

LICENSE REVIEW CHECKLIST

PERMIT NO. 85-07637 DATE 6/5/98 REVIEWER: SHARLA

NAME Change/OK
 Address OK
 SOURCE OK Does change clarify orig. intended source? If no, Void permit
 POINT OF DIV OK Change (P39 /P47) Add (P45/P42) Feds - P40

W32 (multiple in 1/4)
 W36 (overlap)
 W59 (subd. desc)

Overlaps: Right(s): _____
 File reviewed _____ Profile reports printed _____

PLACE OF USE OK Change (P41/P47) Add (P41/P42) Feds - P43

W60 (subd. desc)
 W27 (ppu acre limit)

Overlaps: Right(s): _____
 File reviewed _____ Profile reports printed _____

PD & PU amend (P37) Feds - P48

RATE OF DIV
 Permitted Rate .04 cfs
 Fee limit .04 cfs NO FEE
 Measured — cfs
 Theoretical .02 cfs

Recommended Total Div Rate .02 cfs

WATER USES	<u>OK</u>	Change (P46)		
<u>Dom</u>	<u>.02</u> cfs	<u>1.2</u> af	Irrig -	overlap (R58-R61, R62-R65, R66-R69)
<u>Stock</u>	<u>.02</u> cfs	<u>.1</u> af		supp. gw (W87/065/079)
_____	_____ cfs	_____ af		overlap spec. combined rts (W35)
_____	_____ cfs	_____ af		<1acre (W31)
_____	_____ cfs	_____ af	Domestic	(W01/WB5/070/071/075)
TOTALS	<u>.02</u> cfs	<u>1.3</u> af	Power	(W42 or W43/025/027/R22 or R23)
			Fish (042)	Fire (077) Wtr Quality (081/R07)

Flow rate .02 cfs X 365 days X 1.98 = 29.0 af


REMARKS _____

ADD'L CONDITIONS _____ Watermaster Control WD# _____
(X) GW Measurement/Measuring Device
 _____ Others Trust (052/R55 - remove 051) Non-trust (048/049)

Advance Priority yes no SRBA Claim N/A Adjust Memo _____
 Amend letters _____

JUN 12 1998

3. **Delivery System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable.

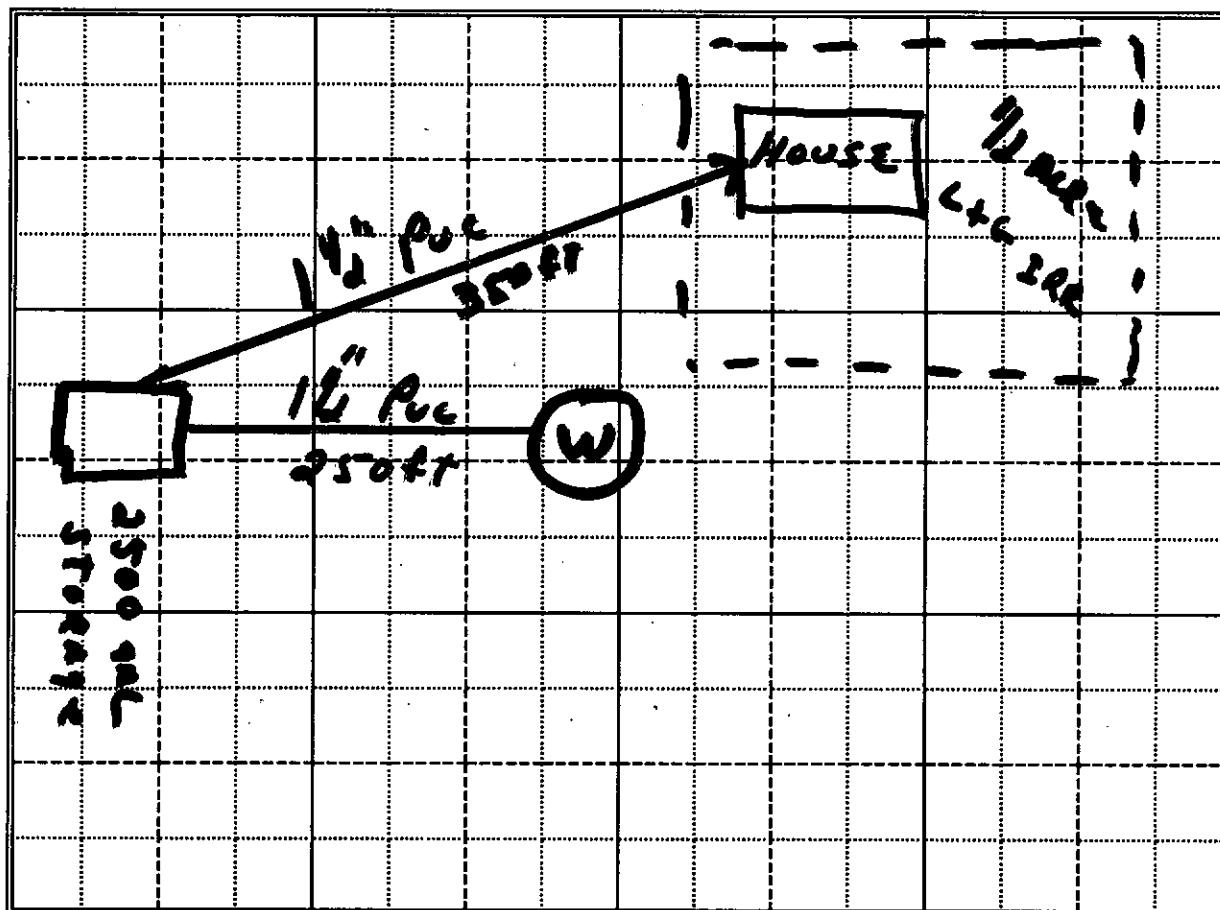

Scale: 1" = _____

____ Copy of USGS Quadrangle Attached Showing location(s) of point(s) of diversion and place(s) of use (required).

____ Aerial Photo Attached (required for irrigation of 10+ acres)

____ Photo of Diversion and System Attached

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
	FRANKLIN	.5	2801054915	Sub	1.5"

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date

2. Measurements: _____

MICROFILMED

JUN 12 1998

E. NARRATIVE/REMARKS/COMMENTS

Pump delivers to 2 1200 gal storage
cisterns. From there it is pumped to house
& stock via same system.

Irrigation portion of permit is dropped.
The only irrigation is 1/4 acre of lawn &
garden around house. So permit should
read Domestic & Stock, explained this to
Mr. Sawyer & we were in agreement.



Have conditions of permit approval been met? ☒ yes ☐ no

MICROFILMED

JUN 12 1998

F. FLOW CALCULATIONS

Additional Computation Sheets Attached

Measured Method:

$$\frac{8.8 \times .5 \times .7}{150 + (2.31 \times 20)} = \frac{3.08}{196.2} = .02 \text{ cfs}$$

theoretical

G. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

 $V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) =$ _____ $V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 =$ _____ $V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} =$ _____

2. Volume Calculations for Other Uses:

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
<i>Domestic</i>	<i>01-01</i>	<i>12-31</i>	<i>.02</i>	<i>1.2</i>
<i>Stock Water</i>	<i>01-01</i>	<i>12-31</i>	<i>.01</i>	<i>.1</i>
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
_____	_____	_____	_____	_____
Totals:			<i>.02</i>	<i>1.3</i>

2. Recommended Amendments

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☐ None
☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☐ Other

I. AUTHENTICATIONField Examiner's Name Wayne Baldwin Date 5-26-98

Reviewer _____ Date _____

SEAL

MICROFILMED

JUN 12 1998

THEORETICAL PUMP EFFICIENCY CALCULATIONS

FILE: 85-07637

DATE: 26-MAY-98

COMPLETE BY: WAYNE BALDWIN

HORSEPOWER = .5


PUMP EFFICIENCY = 70%

DYNAMIC LIFT = 150 FEET

SYSTEM PRESSURE = 20 PSI

QUANTITY = 0.02 CFS

MICROFILMED
JUN 12 1998

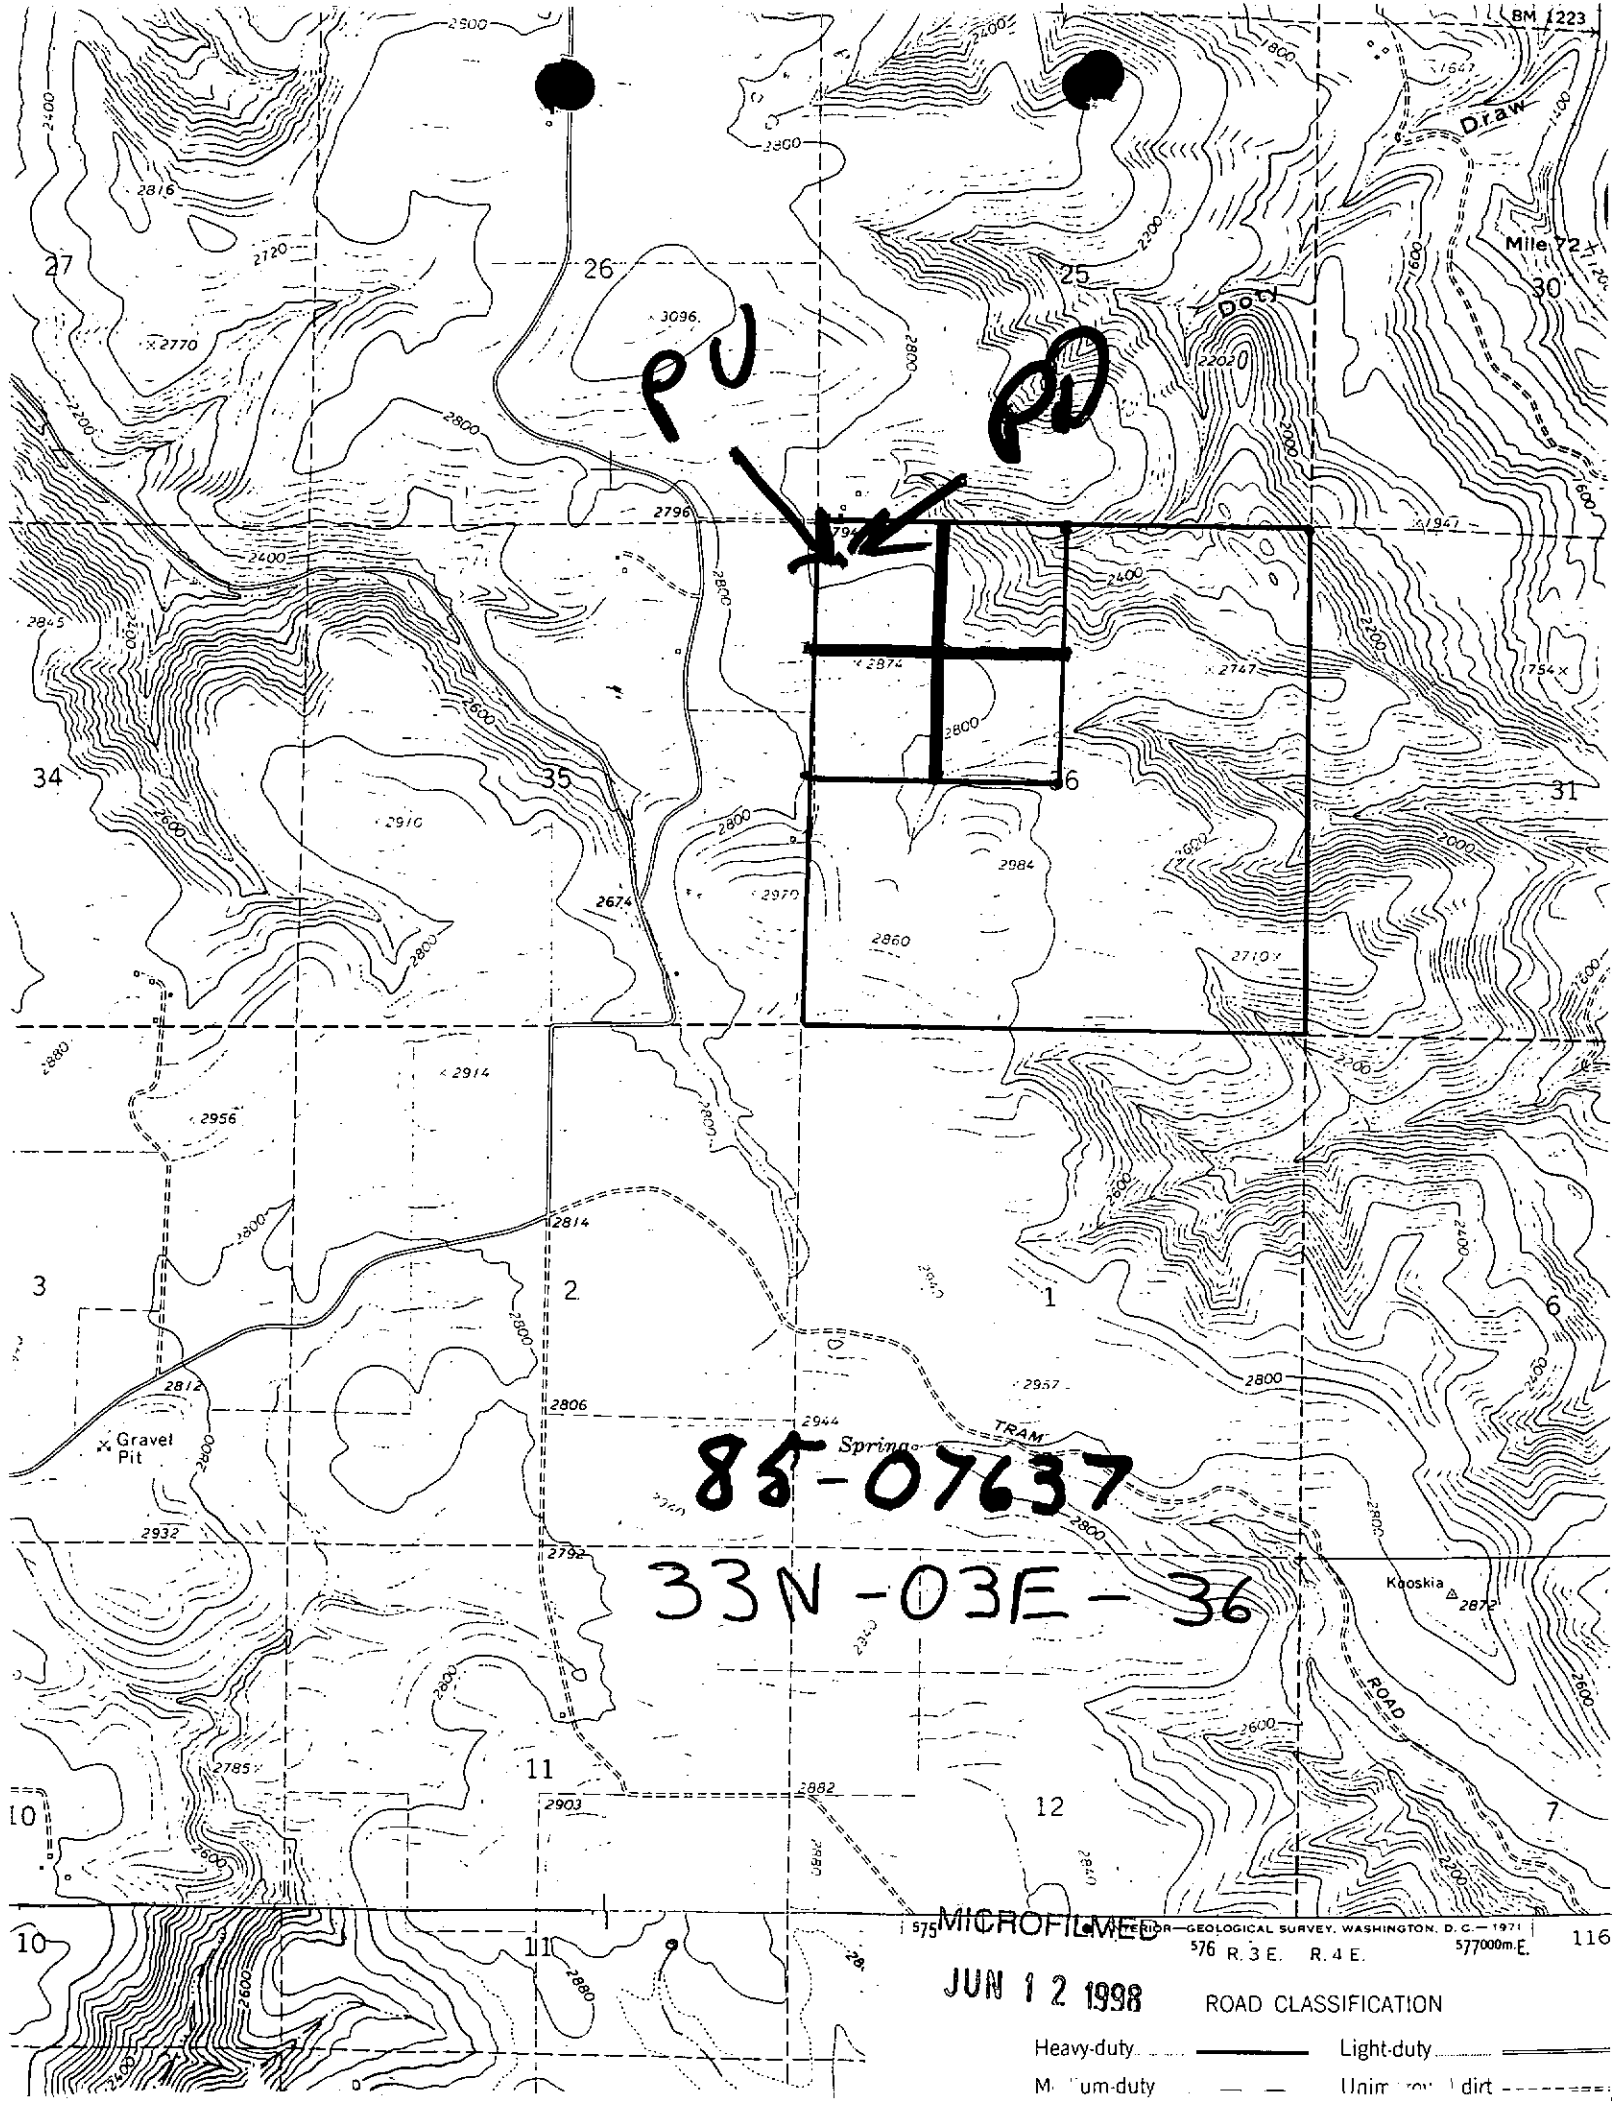

85-07637
33N-03E-36

MICROFILMED

JUN 12 1998

UNITED STATES GEOLOGICAL SURVEY, WASHINGTON, D.C. - 1971
576 R.3.E. R.4.E. 57700m.E. 116

ROAD CLASSIFICATION

Heavy-duty	—————	Light-duty	—————
Medium-duty	—————	Unimproved dirt	—————

**ANALYSIS SHEET
FOR
PROOF OF BENEFICIAL USE**

Permit No. 85-01437 Reviewed by Ag Date 3-16-98

GENERAL CONSIDERATIONS

yes Name same as permit?
NO Address same as permit?
yes Proof timely received?
If not, complete calculation below.

TYPES OF USE

dom., irr., stock

Correct Uses? yes

SOURCE OF WATER

 Surface water source

✓ Ground water source

yes Drilling permit required?

NO Copy in the file? Drilling Permit No. 85-96-N-0039-000

35 Amount paid for permit

yes Correct?

NO Well log in the file?

LICENSE EXAMINATION FEE

NO Required?
1 Amount Submitted
 Correct?

MEASURING DEVICE

NO Required?
1 Installed?
 Waiver requested?

PRIORITY CALCULATION

Date proof received	<u> </u>	<u> </u>
Date proof due	<u> </u>	<u> </u>
No. of days late	<u> </u>	<u> </u>
Priority Date	<u> </u>	<u> </u>
New Priority Date	<u> </u>	<u> </u>

DEFICIENCIES OR ACTION ITEMS

Proof acceptable

DATA ENTRY

New Address Rt. 2 Box 301 Proof Made 2-17-98



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. Box 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

March 16, 1998

STEVE AND SUSAN SAWYER
RT 2 BOX 301
KAMIAH ID 83536

PROOF ACKNOWLEDGMENT LETTER

RE: PERMIT NO. 85-07637

Dear Permit Holder:

The department acknowledges receipt of the proof of beneficial use form submitted for the above referenced permit. The next step in the process of developing a water right is for the department to conduct a field examination to determine and confirm the use being made of the water.

Be advised that Section 42-248, Idaho Code, requires you or the owner of this water right to maintain current ownership and address records on file with the department. Forms to file a change of ownership of a water right and/or a change in the address of the water right owner are available from any department office.

If you have questions concerning the field examination, please contact the department's NORTHERN Regional Office in Coeur d'Alene at (208)769-1450.

Sincerely,

JULIE L. YARBROUGH
Senior Secretary, Water Allocation Bureau

c: IDWR - Regional Office

MICROFILMED
APR 28 1998

December 31, 1997

STEVE SAWYER
SUSAN SAWYER
HC 2 BOX 12E
KAMIAH ID 83536

PROOF DUE NOTICE

RE: PERMIT NO. 85-07637

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before March 1, 1998.

(See last page of your approved permit or your last approved extension request.) Enclosed is a form which when accompanied by the license examination fee or a complete field examination report prepared by a certified water right examiner may be used to submit the required proof.

If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Section 42-204, Idaho Code. If you have been prevented from proceeding by a governmental agency or by litigation which might bring title to the water in question, more than one extension of time can be granted. An extension of time request form is enclosed for your convenience.

Either an acceptable proof of beneficial use submittal or an acceptable request for an extension of time must be received by this department on or before the above described proof due date. If neither is received, the department will send you a lapse notice. Within sixty (60) days of the mailing of the lapse notice, the permit will no longer be of any force nor effect.


SINCERELY,

JULIE L. YARBROUGH
Senior Secretary

Enclosures

MICROFILMED

APR 28 1998

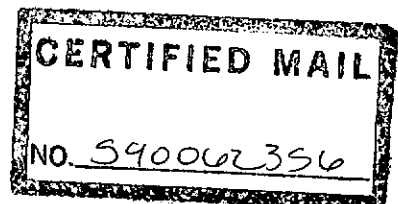



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, Statehouse Mail, Boise, Idaho 83720-9000

Phone: (208) 327-7900 FAX: (208) 327-7866

PHILIP E. BATT
GOVERNOR

KARL J. DREHER
DIRECTOR

February 28, 1997

STEVE SAWYER
SUSAN SAWYER
HC 2 BOX 12E
KAMIAH ID 83536

RE: Water Right No. 85-07637

PERMIT APPROVAL NOTICE

Dear Permit Holder:

The Department of Water Resources (IDWR) has issued the enclosed permit authorizing you to establish a new water right. Please be sure to thoroughly review the conditions of approval and remarks listed on your permit.


The permit is a preliminary order issued by IDWR pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action by IDWR unless a party petitions for reconsideration within fourteen (14) days after issuance. To learn more about preliminary orders, please refer to the enclosed information sheet.

Enclosed is a form entitled "Instructions for Proof of Beneficial Use". Please read the instructions carefully since you must take further action to develop this permit. Also enclosed is a form entitled "Proof of Beneficial Use". If your project is already completed you should complete and submit this form immediately.

Also, please note that as of July 1, 1996, water right owners are required to report any change of water right ownership and any change of mailing address to IDWR. If you acquired a water right or changed your mailing address prior to July 1, 1996, you have until July 30, 1998, to notify IDWR. If you acquire a water right or change your mailing address after July 1, 1996, you must notify IDWR within 120 days of the change. Failure to comply with these requirements could result in a \$100 late filing fee. Contact any IDWR office to obtain the proper reporting form.

If you have any questions, please contact me at 208-327-7946.

Respectfully,


Shelley Walter Keen
Water Rights Supervisor

Enclosures


MICROFILMED
APR 23 1997

CERTIFICATE OF MAILING

I certify that on the **28th** day of **February, 1997**, I mailed a true and correct copy, postage prepaid, of the foregoing **PRELIMINARY ORDER (Approved Permit)** to the person(s) listed below:

Water Right Nos. 85-07637

**STEVE SAWYER
SUSAN SAWYER
HC 2 BOX 12E
KAMIAH ID 83536**

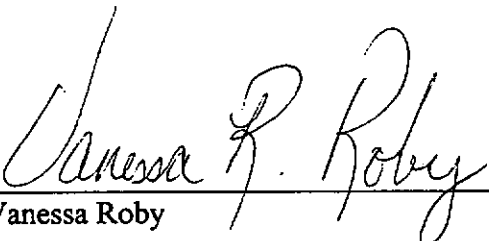

Vanessa Roby
Secretary

MICROFILMED

APR 23 1997

WR0749NP
No. P85-07637

IDAHO DEPARTMENT OF WATER RESOURCES
WATER RIGHT PROFILE REPORT

DATE: 02/26/97
PAGE: 1

OWNER CODE	NAME & ADDRESS	PRIORITY DATE	WATER USE	USE PERIOD FROM TO	DIVERSION RATE	DIVERSION VOLUME
C	STEVE SAWYER	01/07/1997	IRRIGATION	03/15 11/15	0.020 CFS	
C	SUSAN SAWYER		STOCKWATER	01/01 12/31	0.010 CFS	
	HC 2 BOX 12E		DOMESTIC	01/01 12/31	0.010 CFS	
	KAMIAH ID 83536					
	(208) 935-1308					
TOTAL DIVERSION:					0.040 CFS	

Water Source: GROUNDWATER

Tributary to:

Stage: PERMIT

Point(s) of Diversion: T33N R03E S36 NWNW IDAHO County

Place of use Legal Description for: IRRIGATION

NE				NW				SW				SE												
T	R	S		NENE	NWNE	SWNE	SENE	:	NENW	NWNW	SWNW	SENW	:	NESW	NWSW	SWSW	SESW	:	NESE	NWSE	SWSE	SESE	:	SUM
				Lt	Ac	Lt	Ac		Lt	Ac	Lt	Ac		Lt	Ac	Lt	Ac		Lt	Ac	Lt	Ac		
---	---	---	---	---	---	---	---	:	---	---	---	---	:	---	---	---	---	:	---	---	---	---	:	---
33N	03E	36	:					:		05			:					:					:	5.0
TOTAL ACRES																							5.0	

Place of use location for STOCKWATER is the same location as described for: IRRIGATION

Place of use location for DOMESTIC is the same location as described for: IRRIGATION

Pou County: IDAHO

Other Water Rights with Same Point(s) of Diversion and Source:
85-07637

Other Water Rights Listing Overlapping Place(s) of use:
85-07637

Conditions of Approval:

- (01M) - After specific notification by the department, the right holder
 - shall install a suitable measuring device or shall enter into an
 - agreement with the department to determine the amount of water
 - diverted from power records and shall annually report the
 - information to the department.
- (03A) - The rate of diversion of water for irrigation under this right
 - and all other water rights on the same land shall not exceed 0.02
 - cubic feet per second for each acre of land.

Remarks: ~~Point~~ of diversion is located within Lot 16, Dear Subdivision.
~~Place~~ of use is located within Lot 16, Dear Subdivision.
Stockwater use is for 2 horses.
Domestic use is for 1 home and does not include lawn, garden,
landscape, or other types of irrigation.

WR0749NP
No. P85-07637

IDAHO DEPARTMENT OF WATER RESOURCES
WATER RIGHT PROFILE REPORT

DATE: 02/26/97
PAGE: 2

=====
Dates: App. Received: 01/07/1997 Priority Date: 01/07/1997
Proof Due Date: 03/01/1998 Proof Made Date:
Exam Made Date: Exam Sent to S.O.:
Licensed Date:

Misc: Water District Number: Field Exam Fee:

Comments: Date: 01/08/1997 User-ID: DBALL Subject: DIVERSION DESCRIPTION
Existing well 8 inch diameter, 165 feet deep, No. 85-96-N-39.
Two 3/4 HP pumps, 1 inch pipe, 200 ft long; underground concrete
storage tanks 2500 gal total capacity.

Audit: 02/26/97 CZIMMERM

(WATER RIGHT NUMBERS THAT BEGIN WITH AN '*' ARE ADJUDICATION CLAIMS)
(QUARTER-QUARTERS WITH A '?' HAVE DIFFERENT ACREAGE AMOUNTS--CHECK THE DATA BASE RECORDS)

WR-NUMBER	SOURCE	NE				NW				SW				SE				SUM
		NE		NW		SW		SE		NE		NW		SW		SE		
		Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	Lt	Ac	
P8507637	T33N R03E S36 GROUNDWATER																	
	:							05										5
	NO MATCHES FOR THIS POU IN AJ-POU																	
8507637	GROUNDWATE :							05										5

APPLICATION FOR PERMIT
STATE OFFICE REVIEW
by Cindy Zimmerman

01/97

No.: 85-7637 Name: Sawyer Date: 2/25/97 Ad OK? / ✓ Gvmt Lts: /

AREA OF CONCERN? - No/Yes: s/c Mor / _____ GWMA / Trust / Non-trust
PROTESTED: - 020 (Protest Agreement) or *W19 (Order)

SYSTEM COMPLETED:

Yes/proof filed - NA
1 year/no proof - P16
+1 year - 26A-P17

GROUNDWATER: <✓ FLO-CH>

+ 0.24 cfs - 01M
=/- 0.24 cfs - No MD
=/+ 5 a. - 01M, 065 (if GW use SW 1st)

DRILLING PERMIT:

Existing well - NA (pre 7/1/87; ✓ WDQ3)
Included w/permit - Permit No. 85-96-N-0039-0000, P99
No WD permit? - 046-46B-P23 (post 7/1/87)
irr. in WD - P05 (new well)

SURFACE WATER <✓ FLO-CH> (Surface water that doesn't sink is regulated):

Water District (dom) - R04 (req) WD # _____ <SEE MAP & LISTING>
=/+ 0.24 cfs - 01J (meas dev)-P08
- 0.24 cfs - 01H (lock dev)-P01 or No MD
In WD =/+ 0.24 cfs - 01M or No MD (in-stream stock or power)
- 0.24 cfs - No MD
=/+ 5 a. irr. - 01M

RIVER BASINS (*Surface water):

SNAKE R (01) - 11A-P04, NA
(02/03-irr) - 007-P07 (w/ remark *WB9 if above Weiser), NA
Boise River (63) - 05A (if WD), 11E (not 42-111 use), NA
Payette River (65) - 064 (regulated uses), 047-P04 (Payette Lake), NA

USE:

Domestic (surface) - *WB5 (Boise River above Star Bridge); 27A (Payette River); NA
Fish Propagation - 07A-042 (req)-09E (WQ)-P10; 044 (North of 1000 Springs)
Irr <POU> =/- 5 a - 057 (0.03 cfs/acre)
+ 5 a - 03A (0.02 cfs/acre)
Mining - 054 (req) & 09E-P10
Power - 08A-17K-025-028-01F(P19)-09E(P10); 027 (if no other cons. use);
+25 cfs-P18; 17G (FERC) or 17M (FERC); 18B-P09
Storage (✓ 3 compo.) - 072 (req); 18A (multiple MD within district), 18B-P09 (+10' dam),

LOCATION:

42-248 area - P84 (if in 20/30/40/50/60/70/80 (87) basin)
Boise Front LoGeo - 058 (-85° GW temp only)
In-stream dev. - P52 (stream channel alteration)
Irr Dist/Canal Co. - 023 (Twin Falls area)
Swan Falls Flag - _____ <SEE CODE CHART>
Trust - 051-052-053-P74 (Consumptive Uses), NA
Non-Trust <1> - 048-049 (Consumptive Uses), NA

OWNERSHIP: Non-owner

OTHER CONDITIONS:

STANDARD REMARKS:

BENEFICIAL USE DUE:

COMMENTS:

- ① W04/24 ② WB5/1 ③ PD/LT 16 Dean Subd. ④ PU/LT 16 Dean Subd
- 3-1-1998

No. a
4/87-06/92n

DEPARTMENT OF WATER RESOURCE
APPLICATION ANALYSIS SHEET

WRI
WRA
BC

APPLICATION # 85-7637

***** INITIAL REVIEW *****

APPLICANT: SALYER BY: AS DATE: 1/7/97

ITEM REQUIRED INFORMATION

1. (X) Name and Address
2. (X) Source
3. (X) Point of Diversion & County
4. (X) Quantity
(X) Nature of Proposed Use
(X) Period of Use
5. (X) Total Quantity
6. (X) Description of diverting works
7. (X) Time required for b/u
8. (X) Proposed use
9. (X) Place of use or acres irrigated
10. (X) Other Water Rights
11. (X) Ownership
13. (X) Map
(X) Signature
(X) Fee (Amt, recpt, acknowledgment)

*** Send info sheet Y() N()

PROCESSING

Yes No PRIORITY DATE: 1/7/97

X (Include Moratorium Remark)

X Statewide Avertising: (Diversion rate greater than 10 cfs or 1,000 af).

ADVERTISE IN: IDAHO County.

LETTERS SENT REQUESTING:

- () Dam Information () Fish Information
() Power Information () Other: n/a

INFORMATION RECEIVED:

- () Dam Information () Fish Information
() Power Information () Other: n/a

ADDITIONAL INFORMATION

Yes No

- X Field check: by _____
X Field report attached
X Analysis Supp. attached(>5cfs/500af)
X Water delivered by water master?
Water District # _____

***** GROUNDWATER SECTION *****

(Yes) (No)

- X Groundwater management area
X Critical ground water area
X Well Drilling Permit required
Well Drilling Application and Fees received
Well Drilling Application approved?
Well Drilling Application Number _____

Checked by: _____ Date: 1/7/97

Remarks: CHG FOR UPGRADE FEE AFTER ADVERTISING

***** FINAL REGIONAL PROCESSING/REVIEW *****

(Yes) (No)

- Notice of pending void order issued. Final order response date: 1/7/97
Further information required from applicant
Affidavit of publication received
1/21/97 Application published correctly, If not, record action taken: _____
1/8/97 Publication dates and paper recorded on application | Sr. Agent initial AS
X Protests received. Final protest date: 2/3/97
X Measuring device required
X Measuring port required
X Special conditions: _____
X Special conditions of approval supplement and/or cover letter attached:

RECEIVED

Approval Recommended by: BRMA Date: 2E/12/97

FEB 20 1997

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO
County of Idaho - ss.

NOTICE OF APPLICATION FOR WATER RIGHT

The following application(s) have been filed
to appropriate the public waters of the State
of Idaho:

85-07637

SAWYER, STEVE
SAWYER, SUSAN
ROUTE 2 BOX 12 E
KAMIAH, ID 83536
Source: GROUNDWATER
Diversion Pt: NWNW Sec 36 T 33N R 03E
in IDAHO County.

Use: IRRIGATION (0.020 CFS)
STOCKWATER (0.010 CFS)
DOMESTIC (0.010 CFS)
Total Diversion: (0.040 CFS)

Date Filed: 1/7/1997

In: IDAHO County
T33N R03E S36 NWNW
5.0 ACRES TOTAL

For additional information concerning the
property location, call the Northern Regional
Office at (208) 769-1450.

The permit(s) will be subject to all prior
water rights. Protests must be filed with the
applicant and with the Director, Dept. of
Water Resources, Northern Region, 1910
Northwest Blvd., Suite 210, Coeur d'Alene,
Idaho 83814, together with a protest fee of
\$25.00 on or before FEBRUARY 3, 1997.

KARL J. DREHER, Director
Published: 1/15/1997 & 1/22/1997



J15-22

Andrew J. Mc Nab, being
first duly sworn, says she is the Publisher
of the IDAHO COUNTY FREE PRESS, a weekly newspaper published
and issued weekly at Grangeville, Idaho county, State of Idaho, and is
of general circulation in said county and state, that the said notice, of
which the one hereto attached is a true copy, was published in said
paper for 2 weeks, being published 2
times, the first publication being on the 15 day of
January, 19 97, and the last
publication on the 22 day of January, 19 97;
and that the said notice was published in the newspaper proper and not
a supplement; that said newspaper has been continuously and uninter-
ruptedly published in said county during a period of seventy-eight
consecutive weeks prior to the publication of said notice or advertise-
ment.



STATE OF IDAHO }
COUNTY OF }

On this 22 day of January in the year of 1997,
Before me, a Notary Public, personally appeared _____
Andrew J. Mc Nab, known or identified to me
to be the person whose name subscribed to the within instrument, and
being by me first duly sworn, declared that the statements therein are
true, and acknowledged to me that he executed the same.

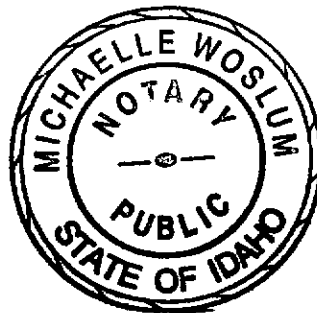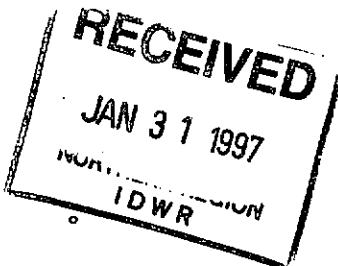

Michelle Woslum
Notary Public for Idaho
Residing at Grangeville, ID
My commission expires: 01-16-200

MICROFILMED
APR 23 1997

85-07637

SAWYER, STEVE
SAWYER, SUSAN
ROUTE 2 BOX 12 E
KAMIAH, ID 83536

Source: GROUNDWATER

Diversion Pt: NWNW Sec 36 T 33N R 03E in IDAHO County.

Use: IRRIGATION	(	0.020 CFS)
STOCKWATER	(	0.010 CFS)
DOMESTIC	(	0.010 CFS)
Total Diversion:	(	0.040 CFS)

Date Filed: 1/ 7/1997

In: IDAHO County
T33N R03E S36 NWNW

5.0 ACRES TOTAL

MICROFILMED

APR 23 1997

January 8, 1997

Steve and Susan Sawyer
Route 2 Box 12-E
Kamiah ID 83536

Re: Water Appropriation Application No. 85-07637

Dear Mr. and Mrs. Sawyer:

The Idaho Department of Water Resources hereby acknowledges receipt of the above referenced Application for Permit to appropriate the Public Waters of the State of Idaho. To assist us in providing you with prompt, accurate service, please refer to the above referenced number in all future matters concerning this water right application. Enclosed for your file is Receipt Number N010893.

Your appropriation application is currently being prepared for advertising in the local county newspaper. This advertisement will be published for two consecutive weeks followed by a waiting period of ten days to allow for the submittal of protests. Normal processing time is approximately 3 to 4 months, if the application is not protested.

If the application is not protested, it will be forwarded to Boise to be considered for approval by the Director. State office personnel will then conduct a complete review, and you will be notified by mail of the outcome. However, if the application is protested during this waiting period, you will be sent a copy of the protest and instructions to aid you in resolving the protest without a hearing. All protests must be resolved before approval of the application can be made, so if the protestant does not voluntarily withdraw the protest, this department will conduct a conference and/or hearing on the matter.

You will receive your approved Application for Permit and instructions on filing the Proof of Beneficial Use from our State office in Boise.

If your source is groundwater, a separate well drilling permit is required for all wells constructed after July 1, 1987.

A "Domestic" well drilling permit should be obtained for a rate of diversion of up to 18 gallons per minute (0.04 CFS) and a daily volume of up to 2,500 gallons per day. The cost for this permit is \$35.00. For any other use, including multiple homes, or municipal, etc., the Drilling Permit fee is \$200. It is possible to upgrade a Domestic Drilling Permit by submitting an additional \$165.00. These Permits can be obtained by your driller, also.

If you have any questions or if I can be of any assistance please feel free to contact me at this office.

Sincerely,

ALLEN BEARDSLEE
Senior Water Resources Agent

AB:db

MICROFILMED

APR 23 1997

WD0731NP
(00-0731)

IDAHO DEPARTMENT OF WATER RESOURCES
WELL DRILLING PERMIT NUMBER INDEX

DATE: 01/07/97
PAGE: 1

PERMIT NUMBER	OWNER CODE	NAME & ADDRESS	TWP	RGE	SEC	TRACT	LOT	COUNTY	ACC FLG
85-96-N-0039-000	0	STEVEN SAWYER RT 2 BOX 12E KAMIAH, ID 83536 (208) 935-1308	33N	03E	36	NW NW		IDAHO	L

Subdivision Well Site Location and Description:
Subdivision Name: DEARING
Well Site Address: 1/4 MI E OF FORT MISERY RD
City, State: KAMIAH, ID

Lot(s): 016
Block(s):

Geographic Location:
GPS Site ID:
Lat: : : N
Long: : : W
Accuracy Code:

Proposed Use of Well: Domestic
Anticipated Bottom Hole Temperature: 85F or Less

Proposed Casing Diameter: 8 In.
Proposed Depth: 300 Ft.

Well Use Comments:

Driller License No: 0103

Firm Name: BURNS WELL DRILLING
Official: GEORGE R BURNS

Permit Status: Filed

Verbal Issue Date:
Date Received: 06/18/1996
Date Approved: 06/20/1996
Proposed Start Date: 06/20/1996
Extension Date:
Extension Expiration:

Receipt No.	Receipt Date	Fee
N010306	06/18/1996	\$ 35.00
	NOT ON FILE	
	NOT ON FILE	
	NOT ON FILE	
	NOT ON FILE	

Specific Conditions:

Permit Remarks: REQUEST FOR ISSUANCE OF DOMESTIC DRILLING PERMIT WITH CASING
EXCEEDING SIX (6) INCHES SIGNED AND FILED AT REGION.

Conditions of Approval: This drilling permit is valid for two (2) months from the approval date
for the start of construction and is valid for one (1) year from the
approval date for completion of the well unless an extension has been
granted.

This permit does not constitute an approval of the District Health
Department or the Idaho Department of Health and Welfare which may be
required prior to construction of this well. The local Health Department
should be contacted for septic tank/drainfield locations. Domestic wells
must not be drilled closer than 100' from any drainfield and 50' from any
septic tank. Public Water Supply wells must not be drilled closer than
100' from any drainfield or septic tank.

The well shall be constructed by a driller currently licensed in the state
of Idaho who must maintain a copy of the drilling permit at the drilling
site.

Approval of this drilling permit does not authorize trespass on the land of
another party.

RECORDED

APR 23 1997

=====

WELL DRILLING PERMIT NUMBER INDEX: Permit No. 85-96-N-0039-000 (cont'd)

Conditions of Approval: This permit does not constitute other local, county, state or federal approvals which may be required for construction of a well.

This drilling permit does not represent a right to divert and use the water of the State of Idaho.

If the bottom hole temperature of 85 Degrees F (29.44 oC) or greater is encountered, well construction shall cease and the well driller and the well owner shall contact the Department immediately.

Idaho Code, S 55-2201 - 55-2210 requires the applicant and/or his contractors to contact "Digline" (DigLine is a one-call center for utility notification) not less than 2 working days prior to the start of any excavation for this project. The "Dig Line " Number for your area is 1- - - - .

- - - - - WELL DRILLER'S LOG REPORT - - - - -

Drilling Permit No: 85-96-N-0039-000
Log Status: Pending Data Review

Water Right No:
Injection Permit No:

Nature of Work: NEW WELL

Construction Method: ROTARY AIR

Number of Monitor Wells:

Casing Diameter: 8 In.
Depth of Casing: 78 Ft.
Total Depth: 165 Ft.
Screen Installed? No

Static Water Level: 100 Ft.
Temperature: 51 F.
Production Rate: 18.00 GPM

Actual Start Date: 07/05/1996
Well Finish Date: 07/08/1996
Log Received Date: 07/17/1996
Certification Date: 07/09/1996
Field Inspection Date:

Inspector:

Violation Flag:

Well Log Remarks: DEPTH FIRST WATER ENCOUNTERED 110'.

MICROFILMED
APR 23 1997