

State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 29-07819

Priority: September 20, 1979

Maximum Diversion Rate:

2.00 CFS

Maximum Diversion Volume:¹

63.6 AF

This is to certify, that WHITEWATER DEVELOPMENT CO.

350 N. 200 E.

REXBURG, ID 834400000

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated April 26, 1979; and has submitted Proof of Beneficial Use on May 14, 1984. An examination indicates that the works have a diversion capacity of 2.980 cfs of water from a GROUNDWATER source, and a water right has been established as follows:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	2.00 CFS	63.6 AF

LOCATION OF POINT(S) OF DIVERSION:

NENE , Sec. 26, Township 05S, Range 34E
NWSW , Sec. 25, Township 05S, Range 34E
NWNE , Sec. 26, Township 05S, Range 34E
BANNOCK County

PLACE OF USE: DOMESTIC

TWN RGE SEC

05S 34E 26

NWNE
SENW

SWNE

NENW

CONDITIONS/REMARKS:

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. Domestic use is for 53 homes.

MICROFILMED

DEC 07 1990


State of Idaho
Department of Water Resources

WATER RIGHT LICENSE

WATER RIGHT NO. 29-07819

This license is issued pursuant to the provisions of Section 42-219, Idaho Code.
Witness the seal and signature of the Director, affixed at Boise, this 27TH
day of NOVEMBER, 1970.

Acting for

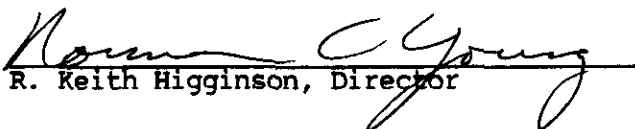
R. Keith Higginson, Director

MICROFILMED

DEC 07 1990

State of Idaho
Department of Water Resources

APPLICATION FOR AMENDMENT
(For Licensing Purposes)
WATER RIGHT NO. 29-07819

APPROVED

Date of Priority: September 20, 1979 Maximum Diversion Rate: 2.00 CFS
Maximum Diversion Volume:¹ 63.6 AF

Comes now WHITEWATER DEVELOPMENT CO.
350 N. 2ND E.
REXBURG, ID 834400000

and represents to the Director of the

Idaho Department of Water Resources:

That he is the owner and holder of Permit to Appropriate the Public Waters of the State of Idaho No. 29-07819, and requests that the permit be changed as follows:

Source: GROUNDWATER

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>RATE OF DIVERSION</u>	<u>ANNUAL VOLUME</u>
DOMESTIC	01/01 to 12/31	2.00 CFS	63.6 AF

LOCATION OF POINT(S) OF DIVERSION:

NENE	, Sec. 26, Township 05S, Range 34E
NWSW	, Sec. ~~26~~ 25, Township 05S, Range 34E
NWNE	, Sec. 26, Township 05S, Range 34E
BANNOCK County	

PLACE OF USE: DOMESTIC

TWN RGE SEC

05S 34E 26	NWNE	SWNE	NENW
	SENW		

RECEIVED
NOV 8 1990

Department of Water Resources

Permit holder asserts that no one will be injured by such change and that such change will be made at permit holder's own risk.

Signed at Rexburg, this 6th day of November, 1990

MICROFILMED

DEC 07 1990

Clayton F. Fougere
(Signature)

State of Idaho
Department of Water Resources

APPLICATION FOR AMENDMENT
(For Licensing Purposes)
WATER RIGHT NO. 29-07819

FOR DEPARTMENT USE ONLY

Preliminary check by SC Fee = \$20.00 Received by 2 Date 11/8/90 #C018819

ACTION OF THE DEPARTMENT OF WATER RESOURCES

I, R. Keith Higginson, of the Department of Water Resources hereby approve the above Application for Amendment for Permit No. 29-07819 with the following;


CONDITIONS/REMARKS:

1. The maximum diversion volume is defined as the maximum allowable volume of water that may be diverted annually from the source under this right. The use of water confirmed by this right is limited to the amount which can actually be beneficially used. The maximum diversion volume may be adjusted to more accurately describe the beneficial use or to implement accepted standards of diversion and use efficiency.
2. This water right is appurtenant to the described place of use.
3. This right is subject to all prior water rights and may be forfeited by five years of non-use.
4. Modifications to or variance from this license must be made within the limits of Section 42-222, Idaho Code, or the applicable Idaho law.
5. Domestic use is for 53 homes.

Witness my hand this 27TH day of NOVEMBER, 1990.

Acting for

R. Keith Higginson, Director

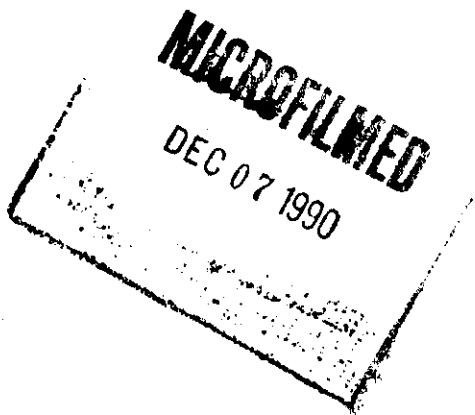

Identification No. _____
Application No. 27-7135
29-7819

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR PERMIT **APPROVED**

To Appropriate the Public Waters of the State of Idaho
(TYPE OR PRINT IN INK)

1. Name of applicant Whitewater Development Co. Phone: 356-9201
post office address 350 N. 2nd E. Rexburg, Idaho 83440
2. Source of water supply well which is a tributary of _____
3. a. Location of point of diversion is NW 1/4 of NE 1/4 of Section 26 Township 5-S
(per telecon 5-7-79 EMC)
Range 34E 36-E B.M. Bannock County; additional points of diversion if any: _____

b. If water is not consumed, it will be discharged into _____ at a point in _____ 1/4
of _____ 1/4 of Section _____ Township _____ Range _____ B.M. _____
4. Water will be used for the following purposes:
Amount 2.0 for domestic purpose from all year to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount 0.4 for commercial* purpose from all year to _____ (both dates inclusive)
(cfs or acre-feet per annum)
Amount _____ for _____ purpose from _____ to _____ (both dates inclusive)
(cfs or acre-feet per annum)
5. Total quantity to be appropriated:
a. two cubic feet per second and/or
b. _____ acre feet per annum.
6. Proposed diverting works:
a. Description of ditches, flumes, pumps, headgates, etc. pipelines

b. Height of storage dam _____ feet, active reservoir capacity _____ acre feet; total reservoir
capacity _____ acre feet, materials used in storage dam: _____
Period of year during which storage will occur _____ to _____ inclusive.
(Mo. Day) (Mo. Day)
c. Proposed well diameter is 16 inches; proposed depth of well is 500 feet.
7. a. Time required for the completion of the works and application of the water to the proposed beneficial use
is 5 years.
b. Estimated construction cost is \$ \$16,000 plus pump
8. Description of proposed uses:
a. If water is not for irrigation:

NE 1/4	SW	25
W 1/2	SW	25
	NE	26
	NW	25
	NW	26

(1) Give the place of use of water: _____ 1/4 of _____ 1/4 of Section _____ Township 5-S
Range 36-E B.M. E 1/2
34E per telecon 5-7-79 EMC

(2) Amount of power to be generated: _____ hp under _____ feet of head.

(3) List number of each kind of livestock to be watered _____

(4) Name of municipality to be served _____, or number of families to be
supplied with domestic water approx. 350

(5) If water is to be used for other purposes describe: Some greenhouse irrigation
on up to 20 acres of greenhouses

* Commercial use is for greenhouse

NOT RECORDED

b. If water is for irrigation, indicate acreage in each subdivision in the tabulation below.

TWP.	RANGE	SEC.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				TOTALS
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
5-3	36-E 34	25							4			10	6						20
	7 near FINE CLAY																		


Total number of acres to be irrigated 20

c. Describe any other water rights used for the same purposes as described above.

9. a. Who owns the property at the point of diversion Whitewater Development Co.
 b. Who owns the land to be irrigated or place of use various home owners, greenhouse user
 c. If the property is owned by a person other than the applicant, describe the arrangement enabling the applicant to make this filing Applicant is developing the area for subdivisions and for small greenhouse development by one of the limited partners

10. Remarks For irrigation purposes (greenhouse), this well may not be needed during the summer when the nearby irrigation well pump is in operation.

11. Map of proposed project: show clearly the proposed point of diversion, place of use, section number, township and range number. **T 5-S, R 36-E**

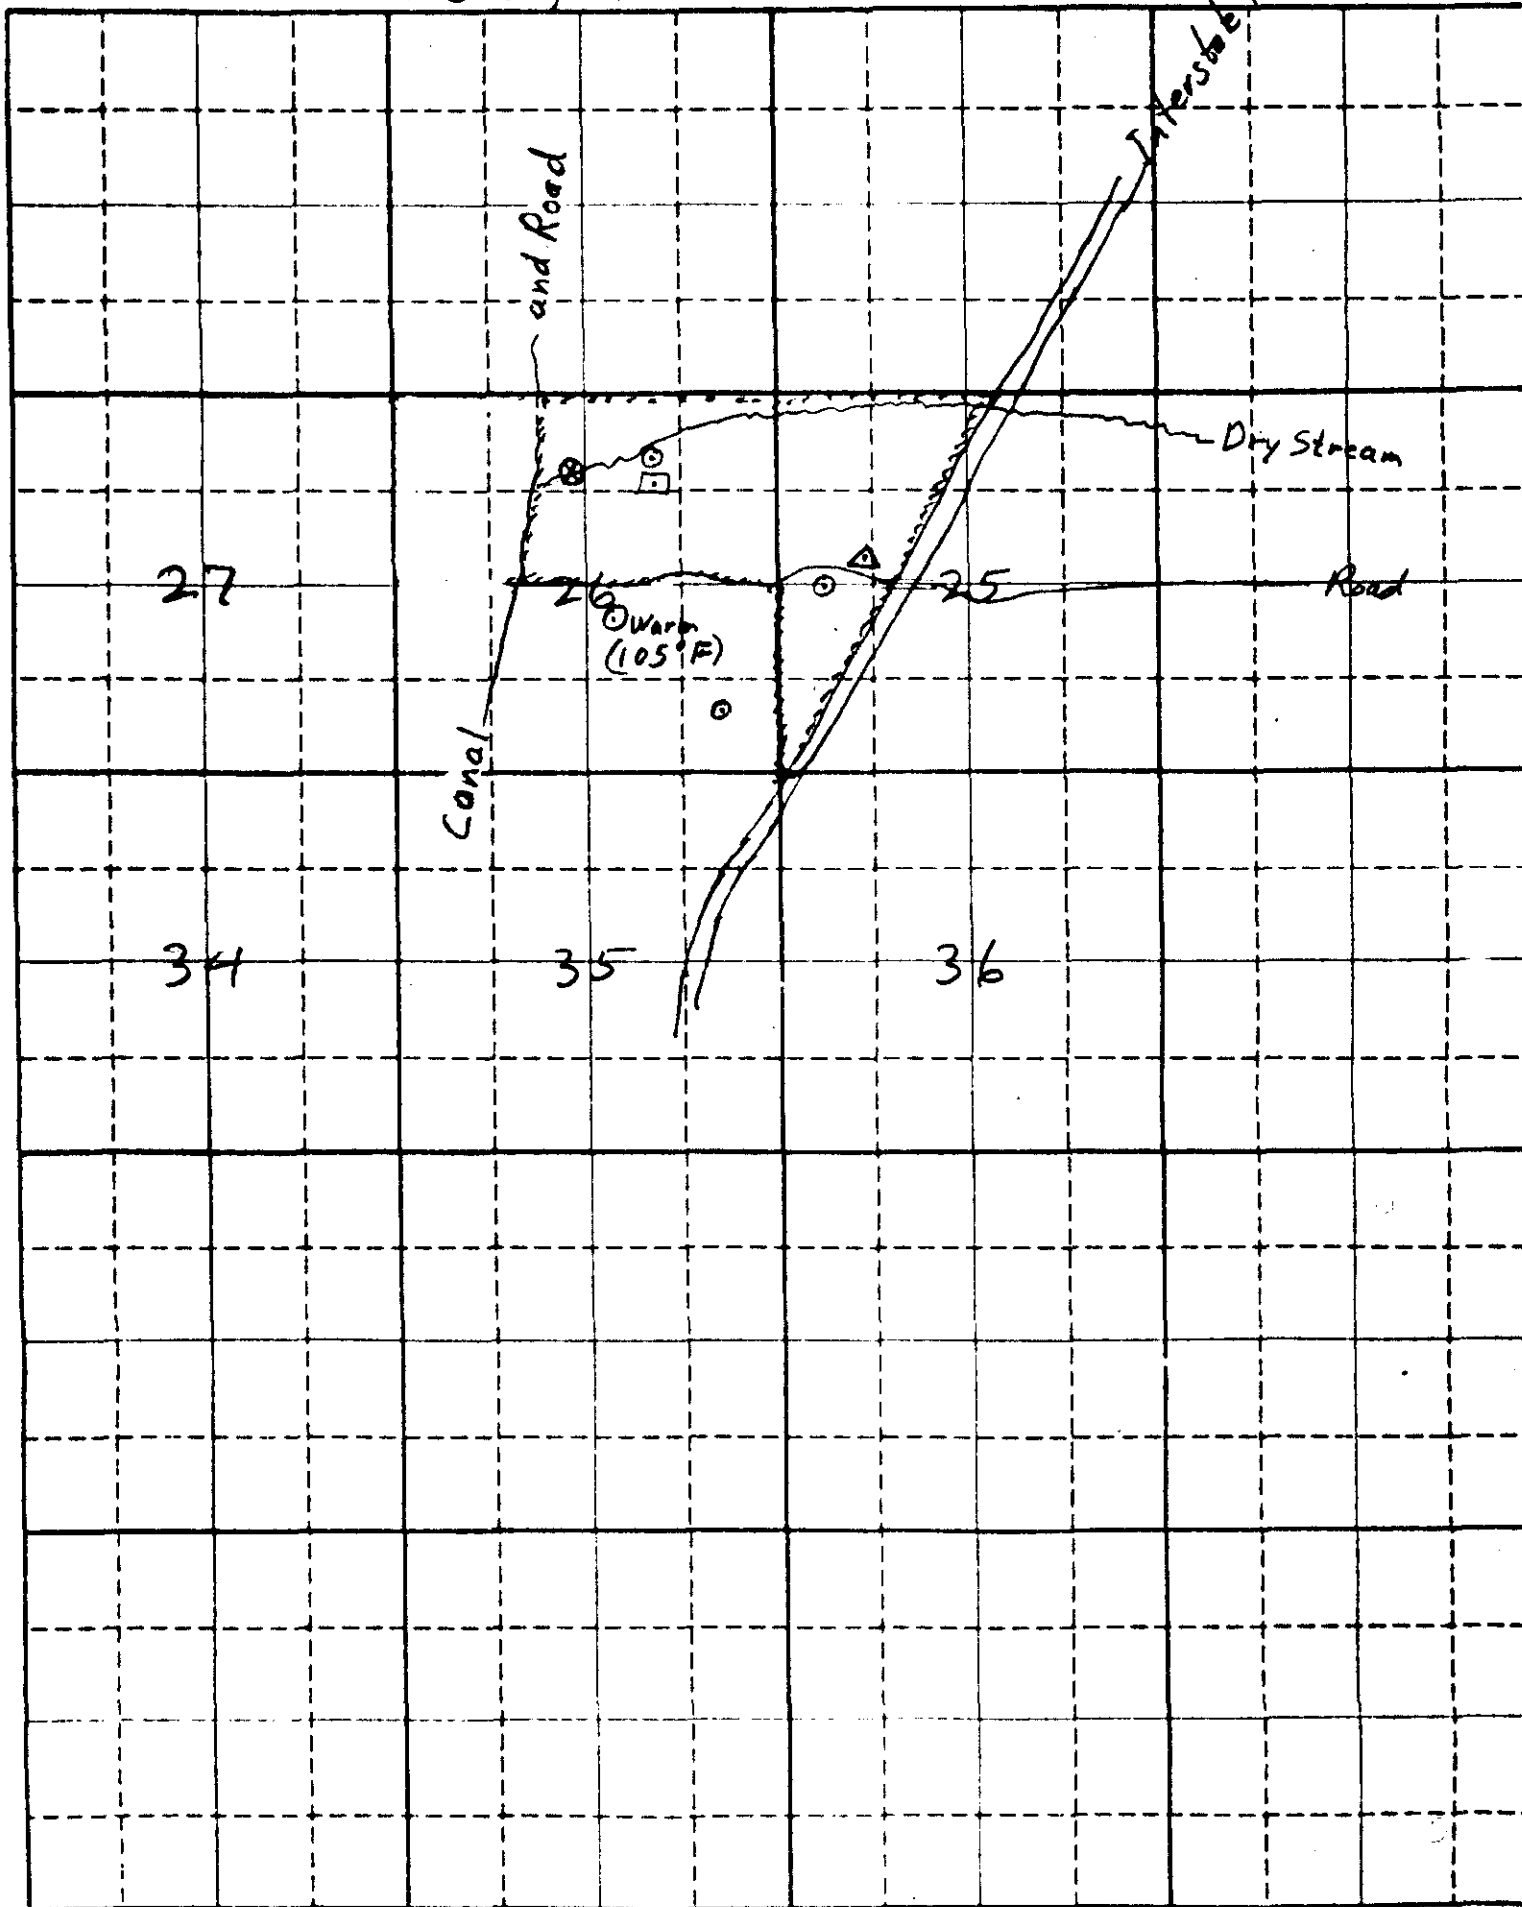

Scale: 2 inches equal 1 mile

..... Property boundary

BE IT KNOWN that the undersigned hereby makes application for permit to appropriate the public waters of the State of Idaho as herein set forth.

- ⊙ Existing Wells
- △ Planned exploratory/production geothermal well
- Planned domestic well
- ⊗ Likely discharge of cooled geothermal water

Clayton F. Ferguson
(Applicant) Manager-Partner

Proposed Priority 4-26-79

dh 5-1-79

mod

Received by DET Date 4-26-79 Time 4:30

Preliminary check by EMC Fee \$ 45.00

Received by af Date 4-26-79 # 13302

Publication prepared by dh Date 5-4-79

Published in Idaho State Journal

May 10 & 17, 1979

Publication dates _____

Publication approved Q7 Date 6/5/79

Priority reduced to _____ Reason _____

Protests filed by: _____

Copies of protests forwarded by _____

Hearing held by _____ Date _____

Recommended for approval denial by EMC SS

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Permit to appropriate the public waters of the State of Idaho No. 27-7135, and said application is hereby APPROVED.

1. Approval of said application is subject to the following limitations and conditions:

a. SUBJECT TO ALL PRIOR WATER RIGHTS.

b. Proof of construction of works and application of water to beneficial use shall be submitted on or before June 1, 19 84.

c. Other: (1) The issuance of this permit in no way grants any right-of-way or easement across the land of another. (2) An access port or other device as specified by the Department shall be installed by the permit holder to provide for the installation of measuring equipment and the determination of the rate of diversion by the Department.

Witness my hand this 13 th day of June 19 79.

A. Glen Saxton
Chief, Operations Bureau

PROOF OF PUBLICATION

STATE OF IDAHO }
County of Bannock } ss.

NOTICE OF APPLICATION FOR WATER RIGHT

Notice is hereby given that the following application(s) have been submitted for permit to appropriate the public waters of the State of Idaho:

29-7484

WALLACE, LEW
1000 SOUTH GARFIELD, AL-
HAMBRA, CA 91801
Source: GROUNDWATER
Date Filed: 04/30/1979
Amount: 0.56 CFS
Diversion Point: SWSE Sec 04 T
10S R 36E, BANNOCK Co.
Use: IRRIGATION (0.56 CFS)
from 03/15 to 11/15
Place of Use: SWSE SESE Sec
04 T 10S R 36E FOR 28 ACRES
Diversion Means: WELL, PUMP,
SPINKLER SYSTEM

29-7485

DAVIS, GWYLLIM D.
DOWNEY, ID 83234
Source: GROUNDWATER
Date Filed: 05/01/1979
Amount: 1.60 CFS
Diversion Point: NWSE Sec 13 T
11S R 36E, BANNOCK Co.
Use: IRRIGATION (1.60 CFS)
from 04/01 to 11/01
Place of Use: NESE NWSE Sec
13 T 11S R 36E FOR 80 ACRES
Diversion Means: WELL, PUMP
& SPRINKLER SYSTEM

29-7486

DAVIS, GWYLLIM D.
DOWNEY, ID 83234
Source: GROUNDWATER
Date Filed: 05/01/1979
Amount: 1.60 CFS
Diversion Point: NESE Sec 02 T
11S R 36E, BANNOCK Co.
Use: IRRIGATION
(1.60 CFS) from 04/01 to 11/01
Use: DOMESTIC
(0.04 CFS) from 01/01 to 12/31
Place of Use: NESE SESE Sec
02 T 11S R 36E FOR 80 ACRES
Diversion Means: WELL, PUMP,
SPRINKLER SYSTEM

27-7135

WHITEWATER DEVELOPMENT
COMPANY
350 NORTH 2ND EAST, REX-
BURG, ID 83440
Source: GROUNDWATER
Date Filed: 04/26/1979
Amount: 2.00 CFS
Diversion Point: NWNE Sec 26 T
05S R 34E, BANNOCK Co.
Use: DOMESTIC (2.00 CFS) from
01/01 to 12/31
COMMERCIAL (0.40 CFS) from
01/01 to 12/31
Place of Use: SWNW NWSW
SWSW Sec 25 T 05S R 34E
NENW NENW NWNW SENW
Sec 25 T 05S R 34E NENE
NWNE SWNE SENE NENW
SENE
Sec 26 T 05S R 34E
Diversion Means: WELL, PUMP
& PIPELINES

27-7136

WHITEWATER DEVELOPMENT
COMPANY
350 NORTH 2ND EAST, REX-
BURG, ID 83440
Source: GROUNDWATER
Date Filed: 04/26/1979
Amount: 4.00 CFS
Diversion Point: SWNW Sec 25 T
05S R 34E, BANNOCK Co.
Use: HEATING (4.00 CFS) from
09/01 to 05/31
Place of Use: NESW NWSW
SWSW NENW NWNW SWNW
SENE Sec 25 T 05S R 34E
NENE NWNE SWNE SENE
NENW SENW Sec 26 T 05S R
34E
Diversion Means: WELL, PUMP
& PIPELINE
If issued, the permit(s) will be
subject to all prior water rights.
Protests against the granting of
any permit must be filed with
the Director of the Idaho Depart-
ment of Water Resources, 1515
Lincoln Rd., Idaho Falls, Idaho
83401 on or before MAY 29, 1979.
C. STEPHEN ALLRED
Director
May 10, 17, 1979
No. 360

Patricia Beck

being first duly sworn on oath deposes and says: That She
was at all times herein mentioned a citizen of the United States of
America, more than 21 years of age, and the Principal Clerk of THE
IDAHO STATE JOURNAL, a daily newspaper, printed and published at
Pocatello, Bannock County, Idaho, and having a general circulation
therein.

That the document or notice, a true copy of which is attached, was
published in the said IDAHO STATE JOURNAL, on the following dates,
to-wit:

MAY 10, 1979, 19.....
MAY 17, 1979, 19.....
....., 19.....
....., 19.....
....., 19.....

That said paper has been continuously and uninterruptedly pub-
lished in said County for a period of seventy-eight weeks prior to the
publication of said notice or advertisement and is a newspaper within
the meaning of the laws of Idaho.

Patricia Beck

Subscribed and sworn to before me this 30th
day of MAY, 1979

[Signature]

Notary Public, State of Idaho
Residence: Pocatello, Idaho

RECEIVED

JUN 4 1979

Department of Water Resources
Eastern District Office

87-A

MICROFILMED

November 29, 1990

WHITewater DEVELOPMENT CO.
350 N. 200 E.
REXBURG, ID 834400000

RE: WATER RIGHT NO. 29-07819

Dear Water Right Holder(s):

Enclosed herewith is a copy of the Water Right License issued on the above referenced permit along with a copy of your approved application for amendment.

Should you have any questions regarding these documents, please feel free to contact our office.

Sincerely,

JIM JOHNSON
Water Rights Supervisor

JJ:blm

Enclosure

MICROFILMED


DEC 07 1990



**FORSGREN
ASSOCIATES/P.A.**

CENTRAL OFFICE • 350 NORTH 200 EAST
REXBURG, IDAHO 83440 / (208) 356-9201

*address
change*

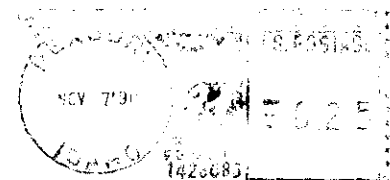

DEC 07 1990

MICROFILMED

State of Idaho
Department of Water Resources
1301 North Orchard Street
Statehouse Mail
Boise, ID 83720



November 1, 1990

WHITEWATER DEVELOPMENT CO.
350 N. 2ND E.
REXBURG, ID 834400000

RE: WATER RIGHT NO. 29-07819

Dear Water Right Holder(s):

The above referenced water right is in the process of being licensed. However, before a license can be issued, your permit must be amended to correspond with the findings of the Department's field examiner.

The enclosed application for amendment contains information that will be included on the license when it is issued. Please review carefully and if you concur, sign the amendment and return with the \$20.00 filing fee within 30 days.

Please note that the date of priority of this right has been advanced due to late submittal of the examination fee &/or exam fee information sheet.

If you do not concur with these findings or if you have any questions, please contact us within the 30-day period.

Sincerely,

JIM JOHNSON
Water Rights Supervisor

JJ:blm

Enclosure

MICROFILMED

DEC 07 1990

BENEFICIAL USE FIELD REPORT REVIEW

TO: FILE 297819

FROM: ROXANNE MC CARTHY

RE: PRIORITY ADVANCE REVIEW

DATE: 20-FEB-1990

=====

This review memo is prepared to show the process for determining what elements were involved in advancement of the priority.

	<u>DATE</u>	<u>JULIAN</u>
PERMIT		
Permit priority Date:	APRIL 26 1979	116
EXAM FEE NOTICE		
Exam Fee Notice Date:	APRIL 17 1986	107
Exam Fee/Info Sheet Received Date:	NOVEMBER 10 1986	314
Exam Fee or Info Due Date:	JUNE 16 1986	167
Days Late:		147 DAY(S)
NEW PRIORITY DATE		
Original Priority Date:	APRIL 26 1979	116
Total Days Late:		147 DAY(S)
New Priority Date:	SEPTEMBER 20 1979	263

MICROFILMED

DEC 07 1990

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No. 29-7819

1. Owner: Whitewater Development Co.

Phone No. 356-9201

Current Address: 350 N. 2nd E. Rexburg Idaho 83440

2. Accompanied by: Mike Bartlett

EXAM. DATE: 6-22-87

Address: 13516 N. Marble Pocatello, Idaho

Phone No. 237-3090

Relationship to Permit Holder: President of Whitewater committee

3. Source: ground water tributary to —

B. OVERLAP REVIEW

1. Other water rights with same place of use: N.A.

☐ Copies Attached


2. Other water rights with same point of diversion: N.A.

☐ Copies Attached

☐ Copies of Field Exam's Attached

C. SYSTEM DESCRIPTION

1. **Diversion System Diagram:** Indicate all major components and distances between components. Indicate weir size/ditch size/pipe i.d. as applicable. ☒ Alternative diagram attached

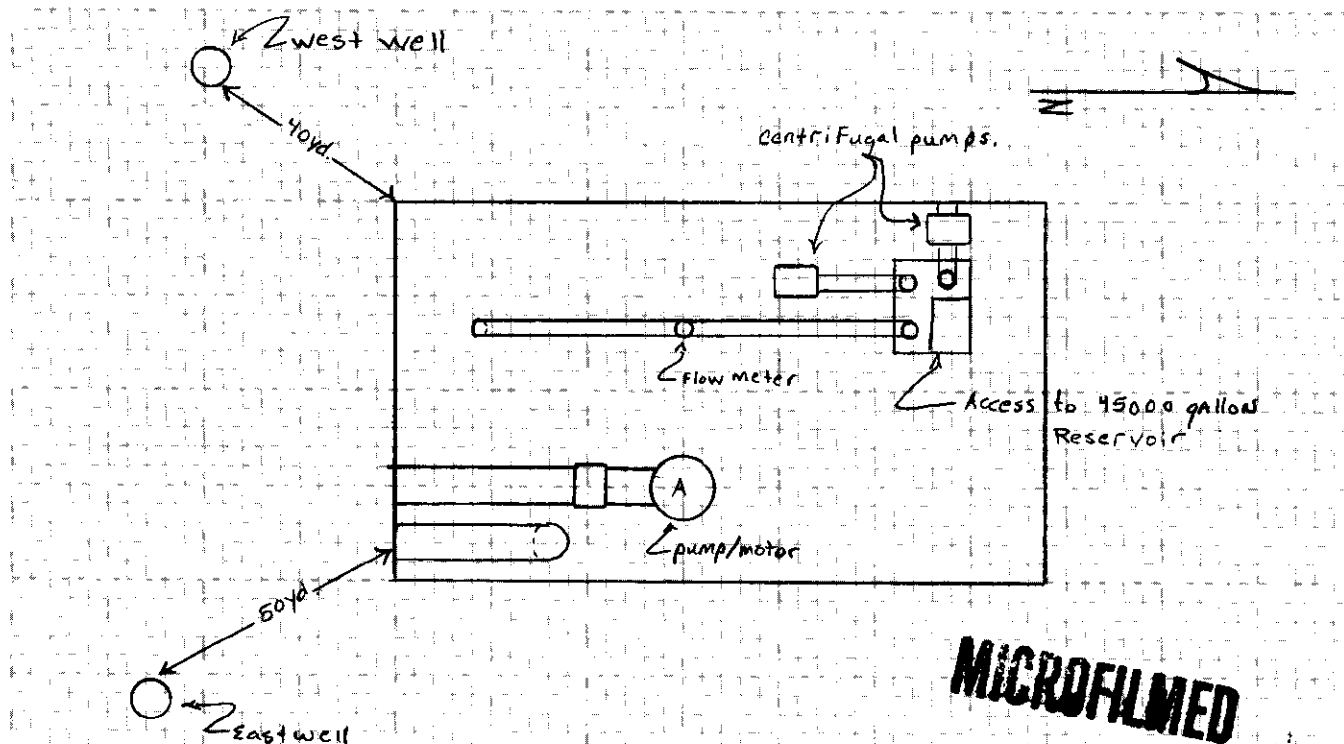

Scale: 1" = No Scale

MICROFILMED
DEC 07 1990

2. ☒ Copy of U.S.G.S. Quadrangle Attached
Showing location(s) of point(s) of diversion and
place(s) of use (required).

☒ Photo of Diversion and System Attached

(required for all but single household domestic groundwater, and stockwater.

☐ Aerial Photo Attached
(required for irrigation of 10 acres or more).

System Description (continued)

3. **Narrative:** Description (As operating at time of measurement. Indicate pressure, number of sprinklers, etc.)

3-wells supply water to 48 homes and 5 vacant lots for domestic and irrigation of yards.

The east and west well pump water into a 45,000 gallon reservoir which is located under the pump house.

The south/east well is pumped into the subdivision mainline on the south/east corner of subdivision.

The south/east well runs into 4 - 100 gallon pressure tanks and the aprox. 1/2 mile to other point where it enters subdivision.

☒ See Remarks on page 4 for continuation

4.

Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
(A)	U.S. Electric	30	P-7185-03-586	Johnston	
(West)	FRANKLIN Elect.	25	23661560 10	FRANKLIN	Submersible
(East)	FRANKLIN Elec.	30	006479	FRANKLIN	Submersible
South/east	FRANKLIN Elect.	25	2361169003	FRANKLIN	Submersible

*Code to correspond with No. on map and aerial photo

5. **Point(s) of Diversion:**

Ident. No.	Gov't. Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.	County	Method of Determination/Remarks
			NW	NE	26	5S	34E	Barnock	West well
			NE	NE	26	5S	34E	Barnock	East well
			NW	SW	25	5S	34E	Barnock	South/east well

6. **Place(s) of Use:**

Indicate Method of Determination

Twp.	Rge.	Sec.	NE 1/4				NW 1/4				SW 1/4				SE 1/4				Totals
			NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	NE 1/4	NW 1/4	SW 1/4	SE 1/4	
5S	34E	26		D	D		D			D									D

NOTE: Under the classification of Domestic include 1/2 acre of irrigation for lawns. Each lot is a 1 acre parcel. Refer to Plat map of subdivision included.

MICROFILMED

Do not use this space

DEC 17 1980

Do not use this space

D. FLOW MEASUREMENTS

☐ Additional Data Sheets Attached

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
Flow meter	—	McCrrometer	—	86-4-990	0-800 g.p.m.	
Flow meter	—	McCrrometer	—	—	0-800 g.p.m.	

2. Measurements:

I measured the Flow on the west well main line while running into reservoir, was 375-400 g.p.m.

The Flow meter in mainline running into subdivision was flowing at 200 g.p.m.

E. FLOW CALCULATIONS

☐ Additional Computation Sheets Attached

$$26.5 \text{ acres} \times 0.02 \text{ cfs} = 0.53 \text{ cfs}$$

1. Measured Method: $Q = 400 \text{ g.p.m.} \div 448.8 \text{ c.f.s.} = 0.89 \text{ c.f.s.}$ open discharge measurement into reservoir by west well.

Theoretical (west well) $Q = \frac{25(8.814)(.80)}{120 + (30 \times 2.308)} = 0.93 \text{ c.f.s.}$

2. Alternate Method for Checking Purposes: $Q = \frac{25(8.814)(.80)}{120 + (30 \times 2.308)} = 0.93 \text{ c.f.s.}$

Theoretical (East Well) $Q = \frac{(30)(8.814)(.80)}{120 + (30 \times 2.308)} = 1.12 \text{ c.f.s.}$ (South/East well) $Q = \frac{(25)(8.814)(.80)}{120 + (30 \times 2.308)} = 0.93 \text{ c.f.s.}$

F. PUMP EFFICIENCY DATA (Optional)

Total capacity of all 3 wells = 2.98 c.f.s.

Discharge Pressure: _____ psi x 2.31 = _____ ft (1); Dynamic pumping level: _____ ft (2)

Total Head: (1) + (2) = _____ (3)

; Flow rate: _____ cfs (4)

Water HP: (3) x (4) ÷ 8.8 = _____ (5)

Meter Input KW: 3.6 x _____ KH x _____ CTR or _____ MULT x _____ PTR x _____ N/ _____ T = _____ (6)

Meter Input HP: (6) x 1.34 = _____ (7)

Panel Input KW: _____ Ave PF x _____ Ave Volts x _____ Ave Amps x .001732 = _____ (8)

Panel Input HP: (6) x 1.34 = _____ (7) Efficiency: (5)/(7) x 100 = _____ %

MICROFILMED

G. VOLUME CALCULATIONS

(53 Lots with 1/2 acre each units) DEC 07 1990

1. Volume Calculations for Irrigation:

$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = (26.5)(3.5) = 92.75$

$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation Season}) \times 1.9835 = (0.93)(215)(1.9835) = 451.94$

$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = 92.75 \text{ A.F.}$

2. Volume Calculations for Other Uses: Domestic = 53 units x 0.6 cfs = 31.8 cfs J.J.

NOTE: The measurement taken from Flow meter was hooked into the west well main line only, and flowing open discharge into 45,000 gallon reservoir. I was unable to check flow of the other two wells due to lack of Flow meter installation.

H. REMARKS AND OVERLAP REVIEW ANALYSIS

Pump/motor labeled A pumps water out of the 45000 gallon Reservoir during the irrigation season to subdivision. The 2 booster/pumps are used during the winter months. Pump/motor A sets 8ft down in reservoir. Pressure reading on mainline coming out of pump A while running into subdivision was 100 psi.

Booster Identification and make:

motor make	HP.	Motor Serial No.	Pump make	Pump Serial No.
Century	20	6-324261-01	Sta-rite	2-H-790
G.I.E.	7.5	5K-184JL165C	Sta-rite	0KXE-20992H-79E

Reservoir dimensions are 18'6" x 45'; 45000 gallons.

I. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use		Rate of Diversion Q (cfs)	Annual Volume V (afa)
	From	To		
Domestic (³ 50 units)	1/1	12/31	0.93	92.75 ~~24-8~~
~~Irrigation~~	~~3-15~~	~~4-15~~	~~0.53~~	~~92.8~~ J.S.
Totals:				0.93 C.F.S. 92.75 A.F.A.
				124.6 afa

2. Recommended Amendments

☒ Change P.D. as reflected above

☐ Add P.D. as reflected above

☒ None

☒ Change P.U. as reflected above

☐ Add P.U. as reflected above

☒ Other

current nature of use

J. AUTHENTICATION

Field Examiner's Name

Signature

Certification Date

Field Report Preparation Date

Richard Lenow Jr.
Richard Lenow Jr.
23-Nov-1987


Steve McLorant


CONSULTANT SEAL

K. Licensing recommendation shall be prepared by an Idaho Department of Water Resources employee on a computer printout attached hereto.

MICROFILMED

DEC 17 1990

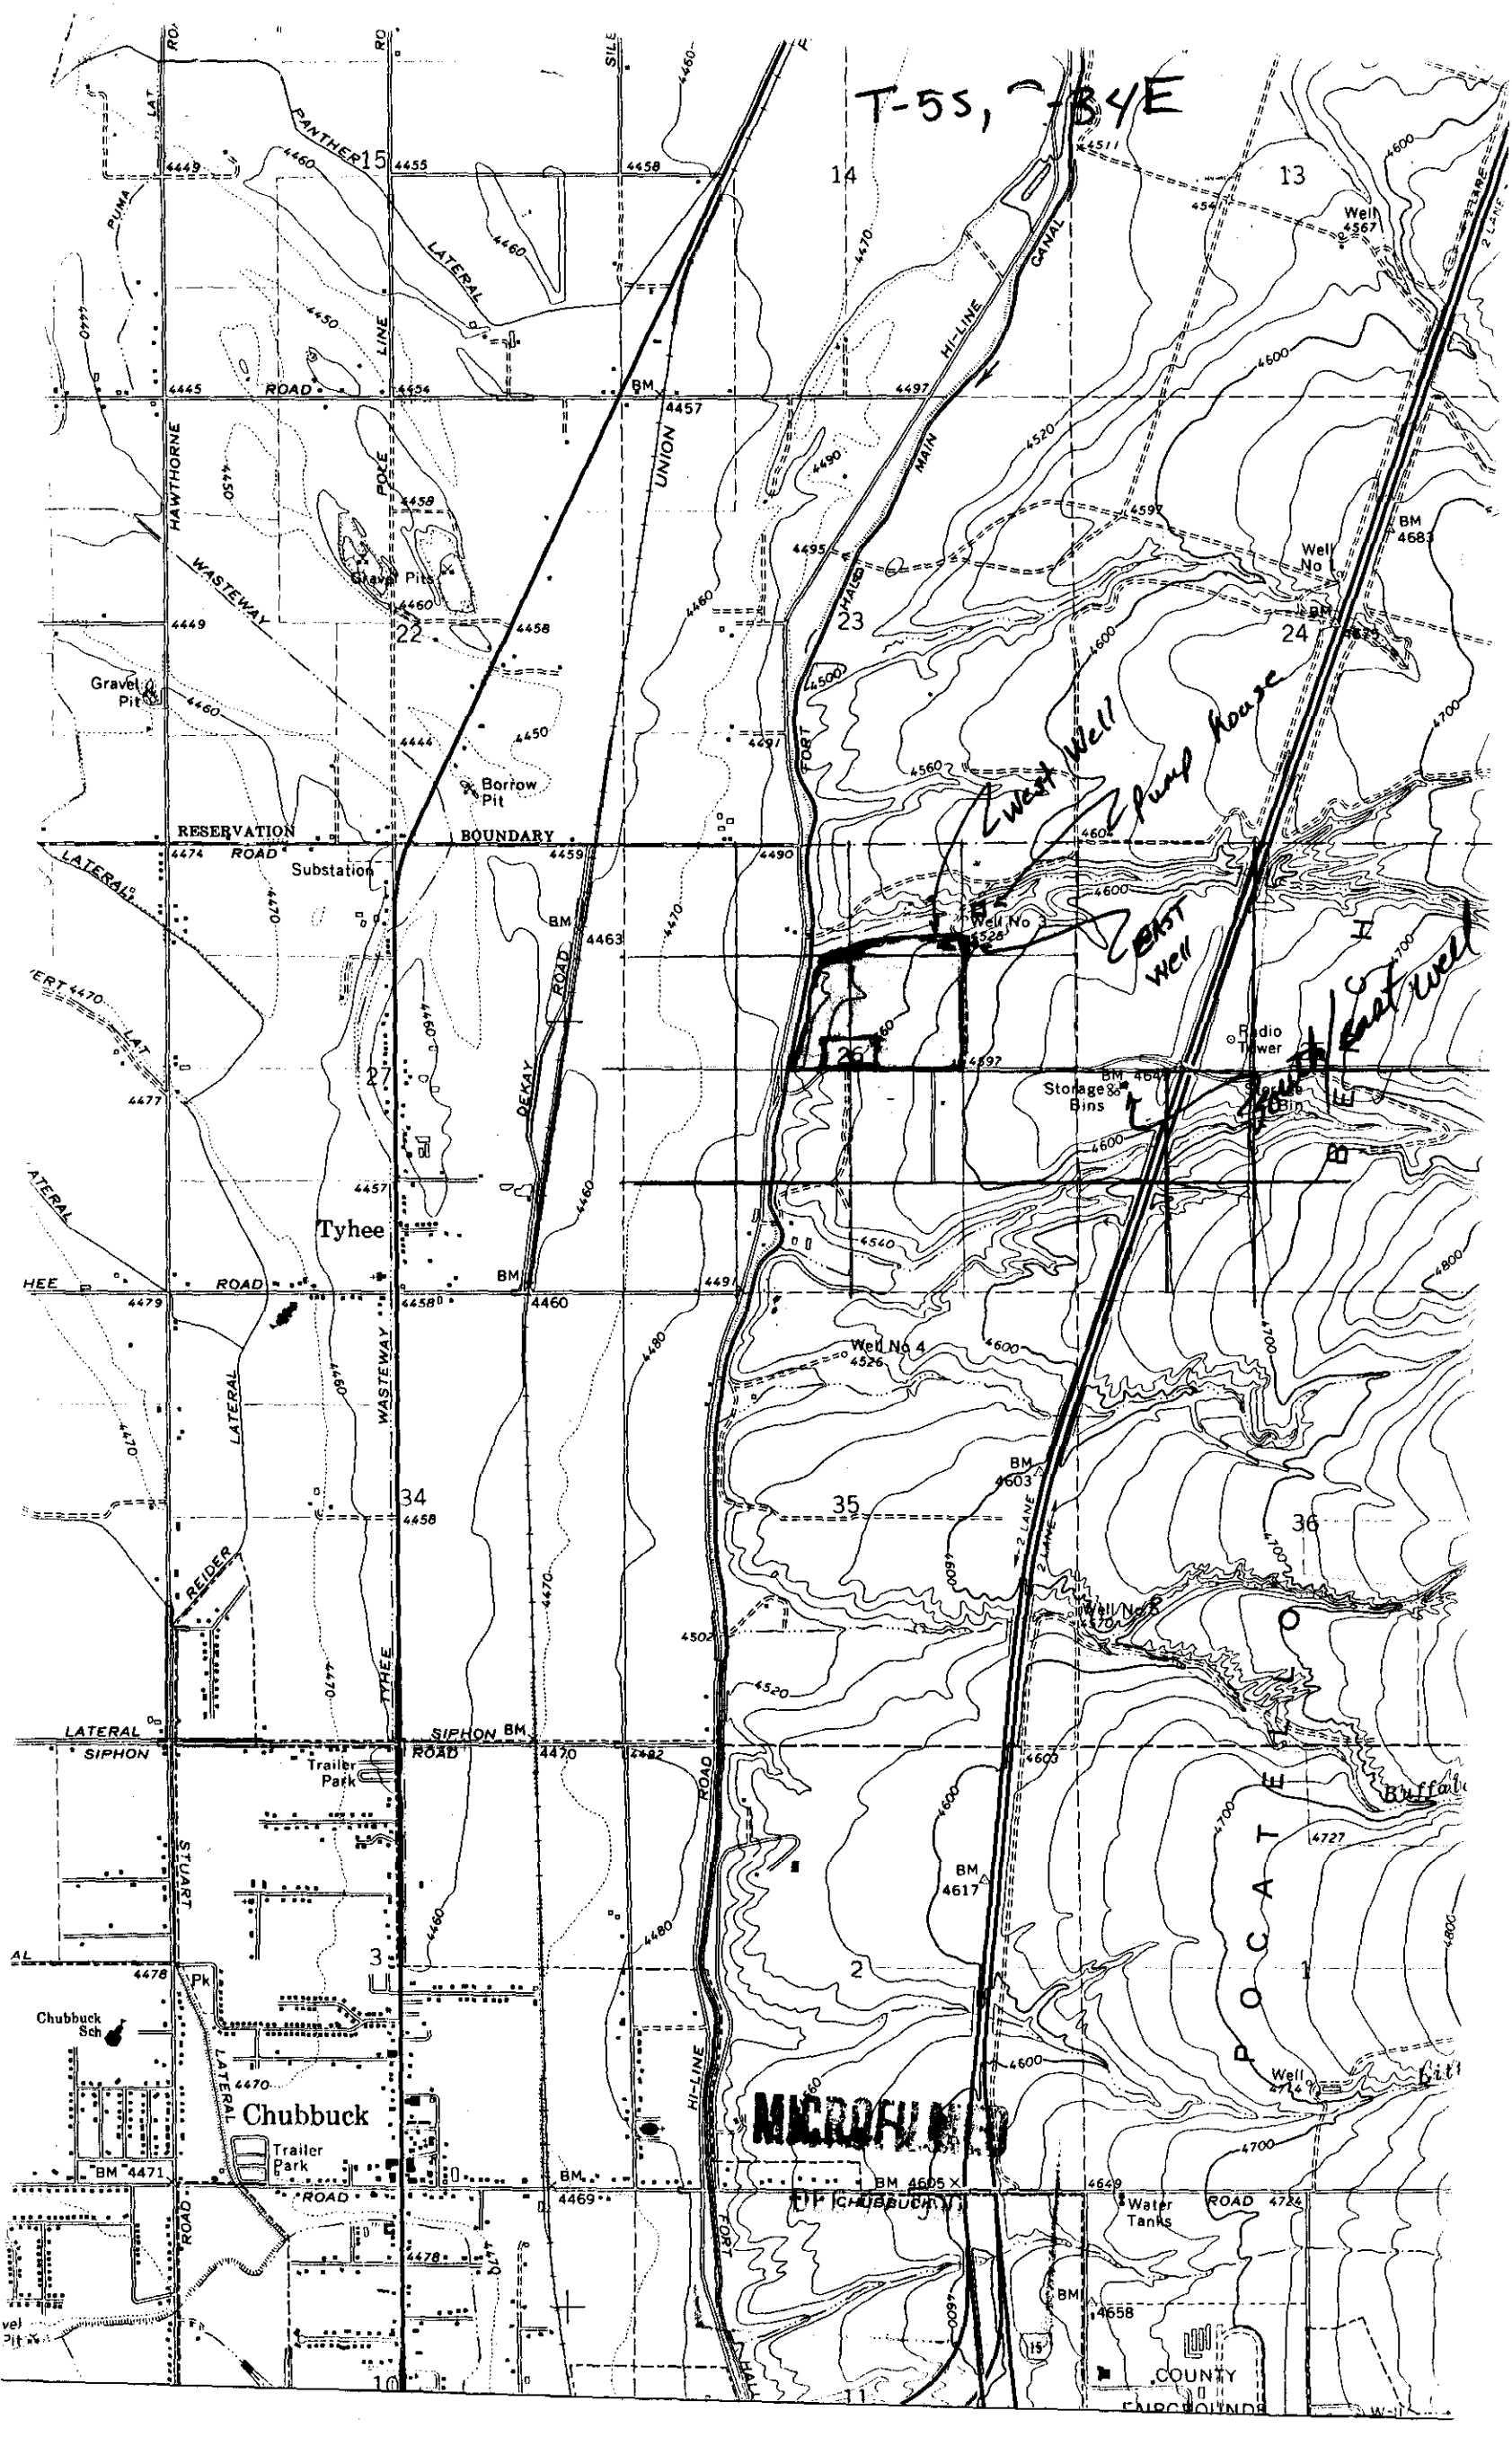

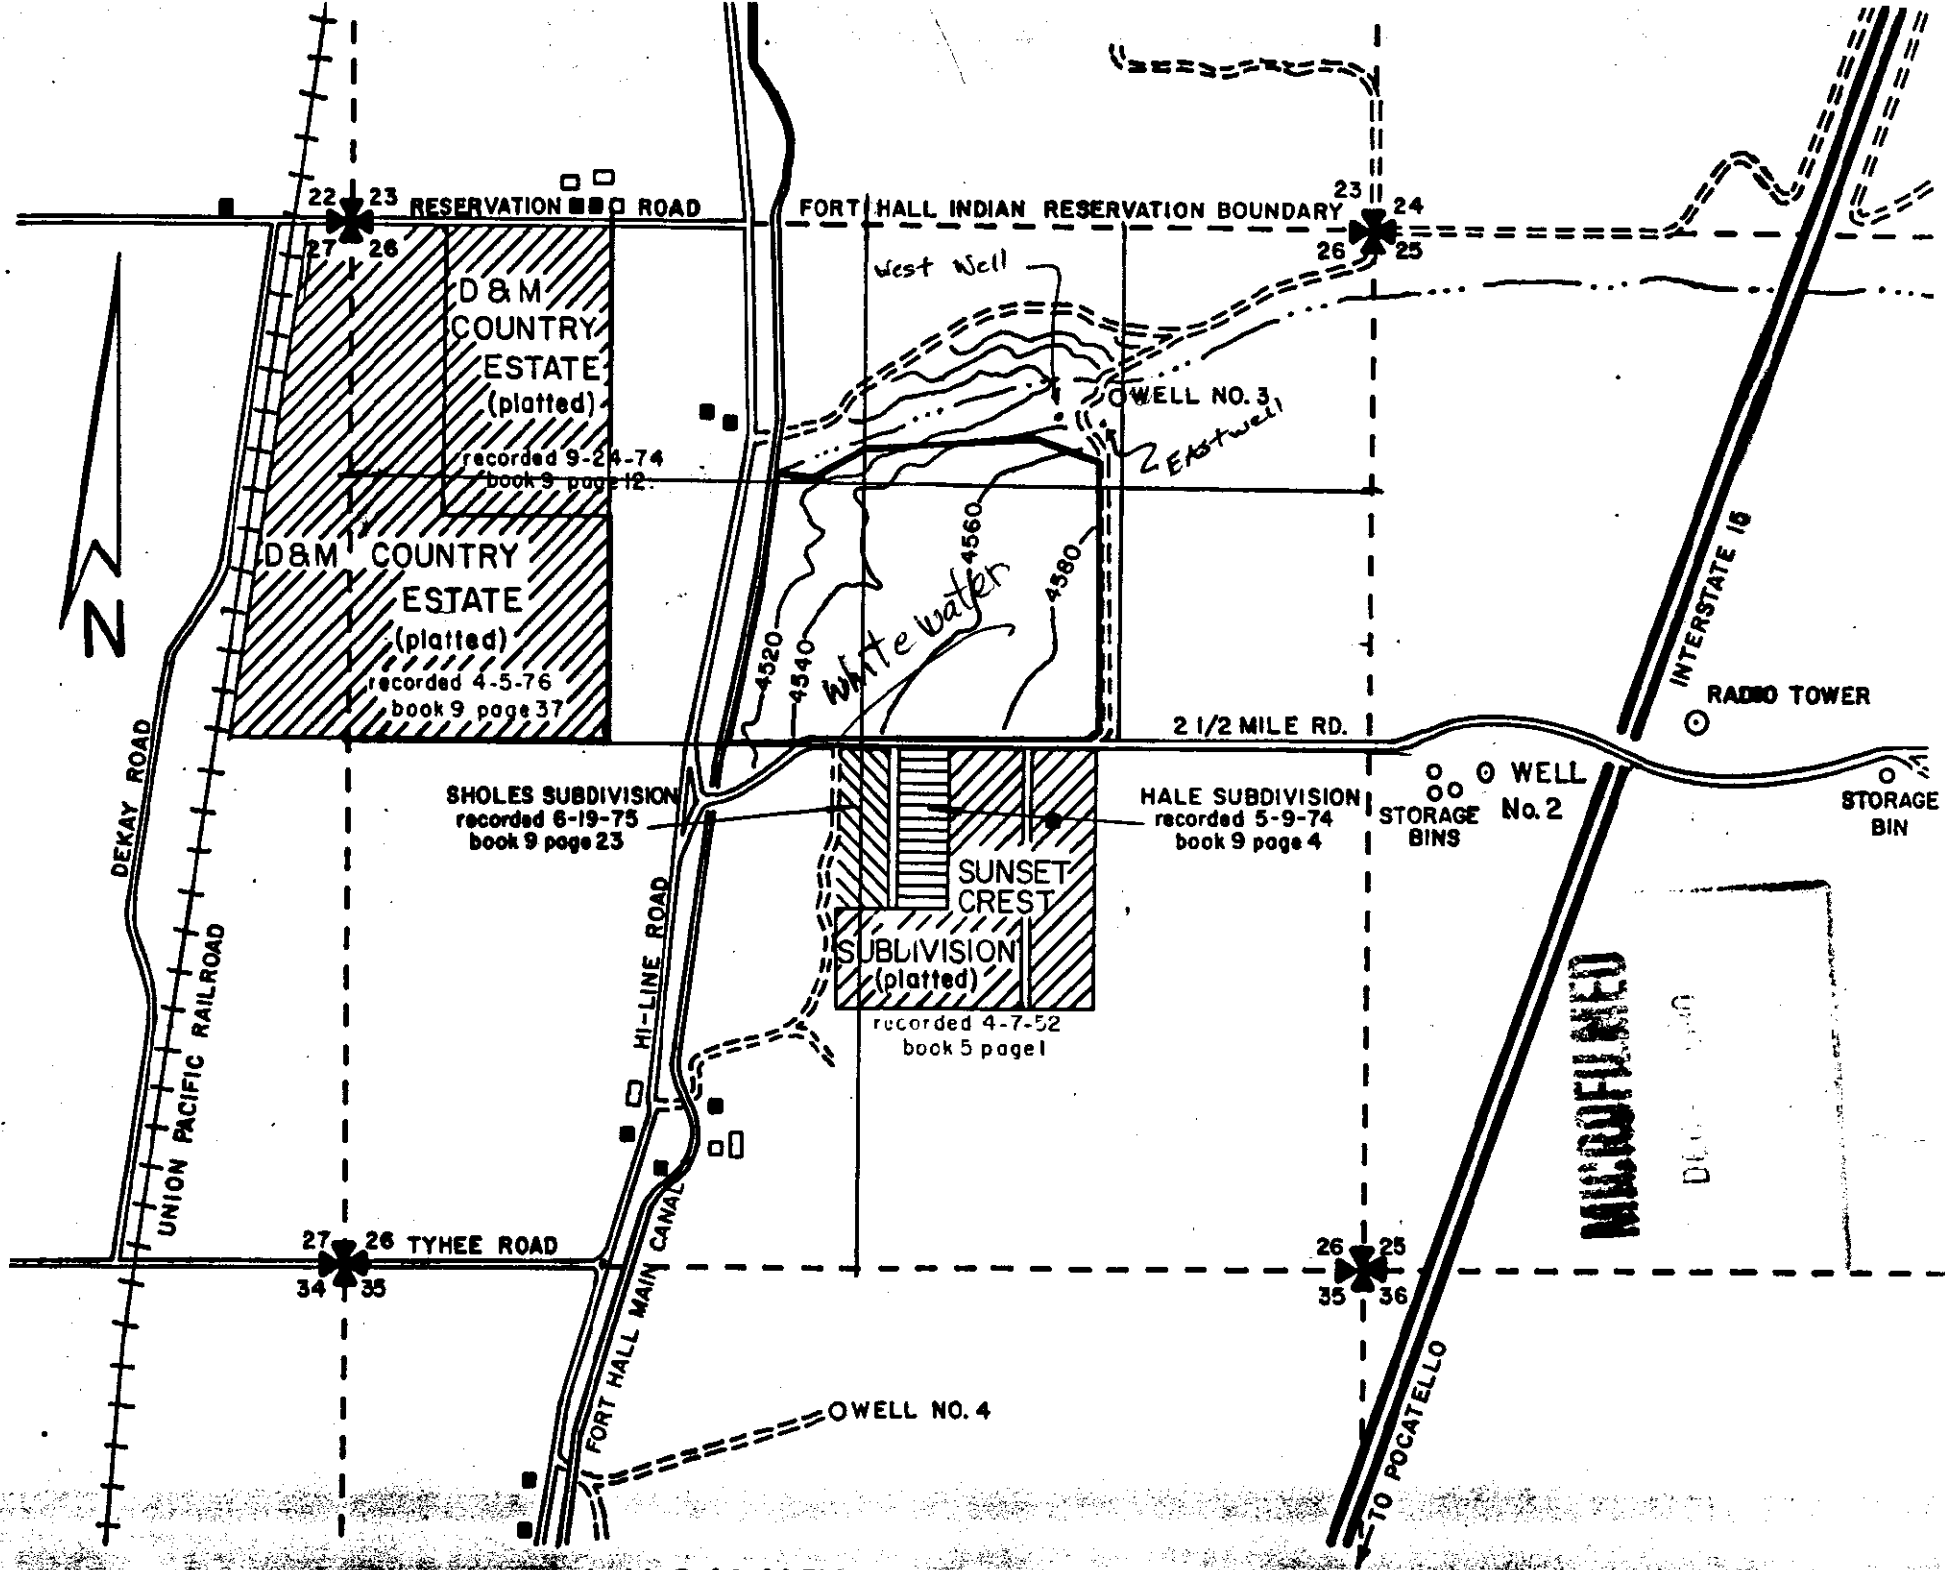

VICINITY SKETCH

46 occupied
2 under const.
5 vacant

PLY/STORAGE SUMMARY NEEDS

Previous System	Existing System
--------------------	--------------------

NOTES:

o - ALL WORK DONE IN ACCORDANCE W/THE

POOR QUALITY

Form 22b, 7
1/78

STATE OF IOWA
DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORT

USE TYPEWRITER OR
BALLPOINT PEN

Submit this report to the State Engineer, Department of Water Resources
within 30 days after the completion or abandonment of the well.

1. WELL OWNER

Name Whitewater Development
Address Table Rock, IO Pocahontas IO
Owner's Permit No. _____

7. WATER LEVEL

Static water level 15 feet below land surface.
Flowing? ☐ Yes ☐ No G.P.M. flow _____
Artesian closed or pressure _____
Regulated by: ☐ Valve ☐ Dam ☐ Plug
Temperature 52 °F. Quality Good

2. NATURE OF WORK

☒ New well ☐ Deepened ☐ Reconditioned
☐ Abandoned (describe method of abandonment) _____

8. WELL TEST DATA

☐ Pump ☐ Sucker ☐ Air ☐ Other _____

Discharge G.P.M. _____ Pumping hours _____ 24 hours discharge _____

3. PROPOSED USE

☒ Domestic ☐ Irrigation ☐ Test ☐ Municipal
☐ Industrial ☐ Stock ☐ Waste Disposal or Injection
☐ Other _____ (specify type)

9. LITHOLOGIC LOG

Well Diam.	Depth From	To	Material	Other Notes
12	0	5	Surface	
	3	12	light brown sand	
	12	14	light brown sand, some chert nodules	
	14	21	light brown sand, some chert nodules	
	21	24	light brown sand, some chert nodules	
	24	26	light brown sand, some chert nodules	
	26	27	light brown sand, some chert nodules	
	27	32	light brown sand, some chert nodules	
	32	35	light brown sand, some chert nodules	
	35	37	light brown sand, some chert nodules	
	37	38	light brown sand, some chert nodules	
	38	39	light brown sand, some chert nodules	
	39	40	light brown sand, some chert nodules	
	40	41	light brown sand, some chert nodules	
	41	42	light brown sand, some chert nodules	
	42	43	light brown sand, some chert nodules	
	43	44	light brown sand, some chert nodules	
	44	45	light brown sand, some chert nodules	
	45	46	light brown sand, some chert nodules	
	46	47	light brown sand, some chert nodules	
	47	48	light brown sand, some chert nodules	
	48	49	light brown sand, some chert nodules	
	49	50	light brown sand, some chert nodules	
	50	51	light brown sand, some chert nodules	
	51	52	light brown sand, some chert nodules	
	52	53	light brown sand, some chert nodules	
	53	54	light brown sand, some chert nodules	
	54	55	light brown sand, some chert nodules	
	55	56	light brown sand, some chert nodules	
	56	57	light brown sand, some chert nodules	
	57	58	light brown sand, some chert nodules	
	58	59	light brown sand, some chert nodules	
	59	60	light brown sand, some chert nodules	
	60	61	light brown sand, some chert nodules	
	61	62	light brown sand, some chert nodules	
	62	63	light brown sand, some chert nodules	
	63	64	light brown sand, some chert nodules	
	64	65	light brown sand, some chert nodules	
	65	66	light brown sand, some chert nodules	
	66	67	light brown sand, some chert nodules	
	67	68	light brown sand, some chert nodules	
	68	69	light brown sand, some chert nodules	
	69	70	light brown sand, some chert nodules	
	70	71	light brown sand, some chert nodules	
	71	72	light brown sand, some chert nodules	
	72	73	light brown sand, some chert nodules	
	73	74	light brown sand, some chert nodules	
	74	75	light brown sand, some chert nodules	
	75	76	light brown sand, some chert nodules	
	76	77	light brown sand, some chert nodules	
	77	78	light brown sand, some chert nodules	
	78	79	light brown sand, some chert nodules	
	79	80	light brown sand, some chert nodules	
	80	81	light brown sand, some chert nodules	
	81	82	light brown sand, some chert nodules	
	82	83	light brown sand, some chert nodules	
	83	84	light brown sand, some chert nodules	
	84	85	light brown sand, some chert nodules	
	85	86	light brown sand, some chert nodules	
	86	87	light brown sand, some chert nodules	
	87	88	light brown sand, some chert nodules	
	88	89	light brown sand, some chert nodules	
	89	90	light brown sand, some chert nodules	
	90	91	light brown sand, some chert nodules	
	91	92	light brown sand, some chert nodules	
	92	93	light brown sand, some chert nodules	
	93	94	light brown sand, some chert nodules	
	94	95	light brown sand, some chert nodules	
	95	96	light brown sand, some chert nodules	
	96	97	light brown sand, some chert nodules	
	97	98	light brown sand, some chert nodules	
	98	99	light brown sand, some chert nodules	
	99	100	light brown sand, some chert nodules	

4. METHOD DRILLED

☒ Rotary ☐ Air ☐ Hydraulic ☐ Steam rotary
☐ Cable ☐ Dig ☐ Other _____

5. WELL CONSTRUCTION

Casing schedule: ☒ Steel ☐ Concrete ☐ Other

Thickness	Diameter	Weight	Length	To
5.25 inches	8 inches	1.2	100 feet	100 feet
5.25 inches	12 inches	1.2	100 feet	100 feet
5.25 inches	12 inches	1.2	100 feet	100 feet
5.25 inches	12 inches	1.2	100 feet	100 feet

Was casing drive shoe used? ☒ Yes ☐ No

Was a packer or seal used? ☐ Yes ☒ No

Perforated? ☐ Yes ☒ No

How perforated? ☐ Factory ☐ Knife

Size of perforation _____ inches by _____ inches

Number _____

perforations _____

perforations _____

perforations _____

Well screen installed? ☐ Yes ☒ No

Manufacturer's name _____

Type _____

Diameter _____ Slot size _____ Set from _____ feet to _____ feet

Diameter _____ Slot size _____ Set from _____ feet to _____ feet

Gravel packed? ☐ Yes ☒ No ☐ Size of gravel _____

Spaced from _____ feet to _____ feet

RECEIVED
DEC 07 1990

POOR QUALITY

☒ Casing
☐ Drive
☐ Other

E. WELL CONSTRUCTION

Casing schedule: ☒ Steel ☐ Concrete ☐ Other

Position	From	To	Notes
1st	0	1.5	1st
2nd	1.5	3.0	2nd
3rd	3.0	4.5	3rd
4th	4.5	6.0	4th

Was casing drive done used? ☒ Yes ☐ No
 Was a pulley or end used? ☐ Yes ☒ No
 Performance? ☐ Yes ☒ No

Was perforated? ☐ Perforated ☐ Solid ☐ Trench
 Size of perforation: _____ inches by _____ inches

Perforation	From	To	Notes
1st	0	1.5	1st
2nd	1.5	3.0	2nd
3rd	3.0	4.5	3rd

Wall casing located? ☐ Yes ☒ No
 Manufacturer's name: _____

Type: _____ Model No.: _____
 Diameter: _____ Size: _____ Test to: _____

Gravel packed? ☐ Yes ☒ No ☐ Size of gravel: _____
 Paved from: _____ test to: _____

Surface seal depth: 20' Material used in seal: ☐ Cement grout ☒ Bentonite

Sealing procedure used: ☒ Sherry pit ☐ Temp. surface casing ☐ Overbore to seal depth


Method of joining casing: ☐ Threaded ☒ Welded ☐ Solvent Weld

☐ Completed between steps

Describe on an as part

F. LOCATION OF WELL

Show map location next page with address location



Location Name: _____

Lot No.: _____ Block No.: _____

County: Bernhardt

SW x SW x Sec 25 T. 5 S. R. 39 E.

Well No.	Depth	Notes
17	1.5	1st
21	3.0	2nd
22	4.5	3rd
23	6.0	4th
24	7.5	5th
25	9.0	6th
26	10.5	7th
27	12.0	8th
28	13.5	9th
29	15.0	10th
30	16.5	11th
31	18.0	12th
32	19.5	13th
33	21.0	14th
34	22.5	15th
35	24.0	16th
36	25.5	17th
37	27.0	18th
38	28.5	19th
39	30.0	20th
40	31.5	21st
41	33.0	22nd
42	34.5	23rd
43	36.0	24th
44	37.5	25th
45	39.0	26th
46	40.5	27th
47	42.0	28th
48	43.5	29th
49	45.0	30th
50	46.5	31st

Work started 11-22-77 ended 1-23-80

G. QUALITY CERTIFICATION

I hereby certify that all minimum well construction standards were complied with at the time the rig was run.

Firm Name: Boyle & Boyle Firm No. 291

Address: Boyle & Boyle Box 2

Signed by Firm Official: [Signature]
 and
 Operator: [Signature]

USE ADDITIONAL SHEETS IF NECESSARY - FORWARD THE WHITE COPY TO THE DEPARTMENT

MICROFILMED

DEC 17 1980

WELL DRILLER'S REPORT

State law requires that this report be filed with the Director, Department of Water Resources within 30 days after the completion or abandonment of the well.

[illegible]

State law requires that this report be filed with the Director, Department of Water Resources within 30 days after the completion or abandonment of the well.

1. WELL OWNER

Name White Water Development Corp.

Address Pocatello, Idaho 83201

Owner's Permit No. _____

2. NATURE OF WORK

☒ New well

☐ Deepened

☐ Replacement

☐ Abandoned (describe abandonment procedures such as materials, plug depths, etc. in lithologic log)

3. PROPOSED USE

☐ Domestic☐ Irrigation☐ Test☐ Municipal

☐ Industrial☐ Stock☐ Waste Disposal or Injection

☒ Other Subdivision (specify type)

4. METHOD DRILLED

☐ Rotary☐ Air☐ Hydraulic☐ Reverse rotary

☒ Cable☐ Dug☐ Other _____

5. WELL CONSTRUCTION

Casing schedule: ☒ Steel ☐ Concrete ☐ Other _____

Thickness

Diameter

From

To

.250 inches 12 inches + 2 feet 310 feet

_____ inches _____ inches _____ feet _____ feet

_____ inches _____ inches _____ feet _____ feet

_____ inches _____ inches _____ feet _____ feet

Was casing drive shoe used?

☒ Yes ☐ No

Was a packer or seal used?

☐ Yes ☒ No

Perforated?

☐ Yes ☒ No

How perforated?

☐ Factory ☐ Knife ☐ Torch

Size of perforation _____ inches by _____ inches

Number

From

To

_____ perforations _____ feet _____ feet

_____ perforations _____ feet _____ feet

_____ perforations _____ feet _____ feet

Well screen installed?

☐ Yes ☒ No

Manufacturer's name _____

Type _____ Model No. _____

Diameter _____ Slot size _____ Set from _____ feet to _____ feet

Diameter _____ Slot size _____ Set from _____ feet to _____ feet

Gravel packed?

☐ Yes ☒ No ☐ Size of gravel _____

Placed from _____ feet to _____ feet

Surface seal depth 25 Material used in seal: ☐ Cement grout

☒ Bentonite ☐ Puddling clay ☐ _____

Sealing procedure used: ☐ Slurry pit ☐ Temp. surface casing

☒ Overbore to seal depth

Method of joining casing: ☐ Threaded ☒ Welded ☐ Solvent

☐ Cemented between strata

Describe access port well cap

7. WATER LEVEL

Static water level 120 feet below land surface.

Flowing? ☐ Yes ☒ No G.P.M. flow _____

Artesian closed-in pressure _____ p.s.i.

Controlled by: ☐ Valve ☐ Cap ☐ Plug

Temperature 55 °F. Quality _____

Describe artesian or temperature zones below.

8. WELL TEST DATA

☒ Pump☐ Bailer☐ Air☐ Other _____

Discharge G.P.M.

Pumping Level

Hours Pumped

420

255

8

9. LITHOLOGIC LOG

Bore Diam.	Depth		Material	Water	
	From	To		Yes	No
14"	0	16	brown clay		X
14"	16	17	sand & gravel		X
12"	17	36	yellow clay		X
12"	36	37	sand & 2" gravel		X
12"	37	59	yellow clay		X
12"	59	124	yellow clay & layers of gravel		X
12"	124	150	sandy red clay		X
12"	150	158	sand & 1" gravel	X	
12"	158	177	soft red sandstone		X
12"	177	188	sand & 4" gravel	X	
12"	188	204	course sand & pea gravel	X	
12"	204	225	sand & some gravel	X	
12"	225	237	sand & trace of gravel	X	
12"	237	310	cemented gravel		X
12"	310	311	hard red sandstone		X
12"	311	317	red & black cinders	X	
12"	317	325	hard gray lava		X
12"	325	370	layers of hard & soft sandstone	X	

RECEIVED

SEP 8 1986

Department of Water Resources

Eastern District Office

10.

Work started 7-3-86 finished 8-26-86

6. LOCATION OF WELL

Sketch map location must agree with written _____

N

W

E

S

X

Subdivision Name Whitewater

Development Corp.

Lot No. _____ Block No. _____

County Bannock

NE $\frac{1}{4}$ NE $\frac{1}{4}$ Sec. 26, T. 5 N., R. 34 E.

11. DRILLERS CERTIFICATION

I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

Firm Name Dan's Pump & Service Firm No. 339

P.O. Box 190

Address American Falls, Idaho Date 9-3-86

83211

Signed by (Firm Official) [Signature]

and

(Operator) Daniel Allen

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORT.

USE TYPEWRITER OR

RECEIVED

State law requires that this report be filed with the Director, Department of Water Resources within 30 days after the completion or abandonment of the well.

SEP 26 1949

1. WELL OWNER

Forsgren & Perkins Engineering

Name Whitewater Development

1084 North Skyline Drive

Address Idaho Falls, ID 83401

Owner's Permit No.

2. NATURE OF WORK

☒ New well ☐ Deepened ☐ Replacement

☐ Abandoned (describe method of abandoning)

3. PROPOSED USE

☐ Domestic ☐ Irrigation ☐ Test ☐ Municipal

☐ Industrial ☐ Stock ☐ Waste Disposal or Injection

☒ Other Housing Development (specify type)

4. METHOD DRILLED

☒ Rotary ☐ Air ☐ Hydraulic ☐ Reverse rotary

☐ Cable ☐ Dug ☐ Other

5. WELL CONSTRUCTION

Casing schedule: ☒ Steel ☐ Concrete ☐ Other

Thickness Diameter From To

.250 inches 8 inches + 1 feet 277 feet

inches inches feet feet

inches inches feet feet

inches inches feet feet

Was casing drive shoe used? ☒ Yes ☐ No

Was a packer or seal used? ☐ Yes ☒ No

Perforated? ☐ Yes ☒ No

How perforated? ☐ Factory ☐ Knife ☐ Torch

Size of perforation inches by inches

Number From To

perforations feet feet

perforations feet feet

perforations feet feet

Well screen installed? ☐ Yes ☒ No

Manufacturer's name

Type Model No.

Diameter Slot size Set from feet to feet

Diameter Slot size Set from feet to feet

Gravel packed? ☐ Yes ☒ No ☐ Size of gravel

Placed from feet to feet

Surface seal depth 18' Material used in seal: ☐ Cement grout

☒ Puddling clay ☐ Well cuttings

Sealing procedure used: ☐ Slurry pit ☐ Temp. surface casing

☐ Overbore to seal depth

Method of joining casing: ☐ Threaded ☒ Welded ☐ Solvent Weld

☐ Cemented between strata

Describe access port

7. WATER LEVEL

Static water level 120 feet below land surface.

Flowing? ☐ Yes ☒ No G.P.M. flow

Artesian closed-in pressure p.s.i.

Controlled by: ☐ Valve ☐ Cap ☐ Plug

Temperature °F. Quality

8. WELL TEST DATA

☐ Pump ☐ Bailer ☐ Air ☐ Other NO Test

Discharge G.P.M. Pumping Level Hours Pumped

Undetermined

9. LITHOLOGIC LOG

Hole Diam.	Depth		Material	Water	
	From	To		Yes	No
8	0	54	Clay		x
	54	102	Sand, Gravel		x
	102	148	Soft Sandstone & Clay		x
	148	160	Sand & Gravel	x	
	160	175	Soft sandstone		x
	175	186	Hard Sandstone		x
	186	195	Sand & Gravel		x
	195	224	Hard Sandstone	x	
	224	228	Sand & Gravel		x
	228	230	Sand & Clay		x
	230	270	Layers of Hard & Soft sandstone		x
	270	331	Layers of Sand & Gravel	x	

10.

Work started 7/28/79 finished 8/10/79

6. LOCATION OF WELL

Sketch map location must agree with written location.

N

W E

S

Bannock

Subdivision Name

Lot No. Block No.

NW ¼ NE ¼ Sec. 26, T. 5, R. 34 E/WX

MICROFILMED

DECEMBER 7 1990

DRILLERS CERTIFICATION

I/We certify that all minimum well construction standards were applied with at the time the rig was removed.

DOUG CUSHMAN

Firm Name DRILLING COMPANY Firm No. 72

445 South Broadway

Address Blackfoot, ID 83221 Date 9/20/79




Signed by (Firm Official)



and

(Operator)

1275

USE ADDITIONAL SHEETS IF NECESSARY — FORWARD THE WHITE COPY TO THE DEPARTMENT

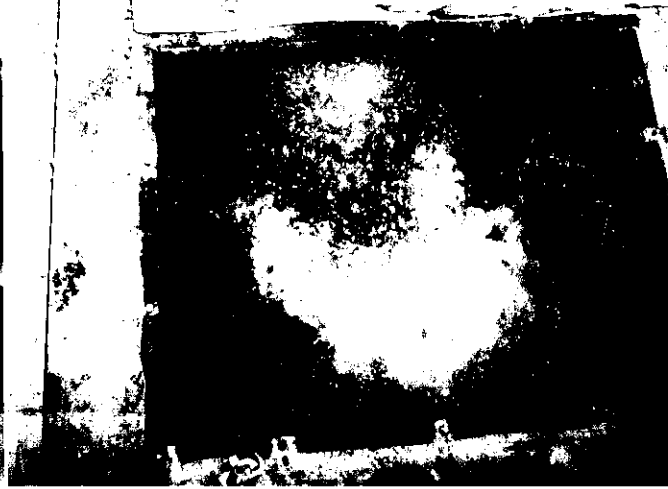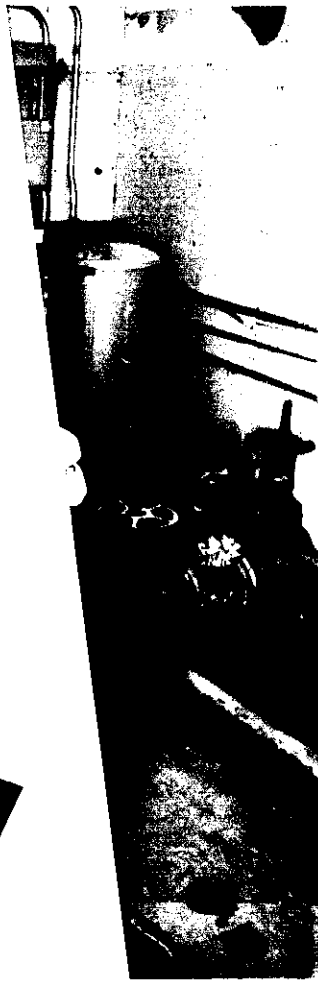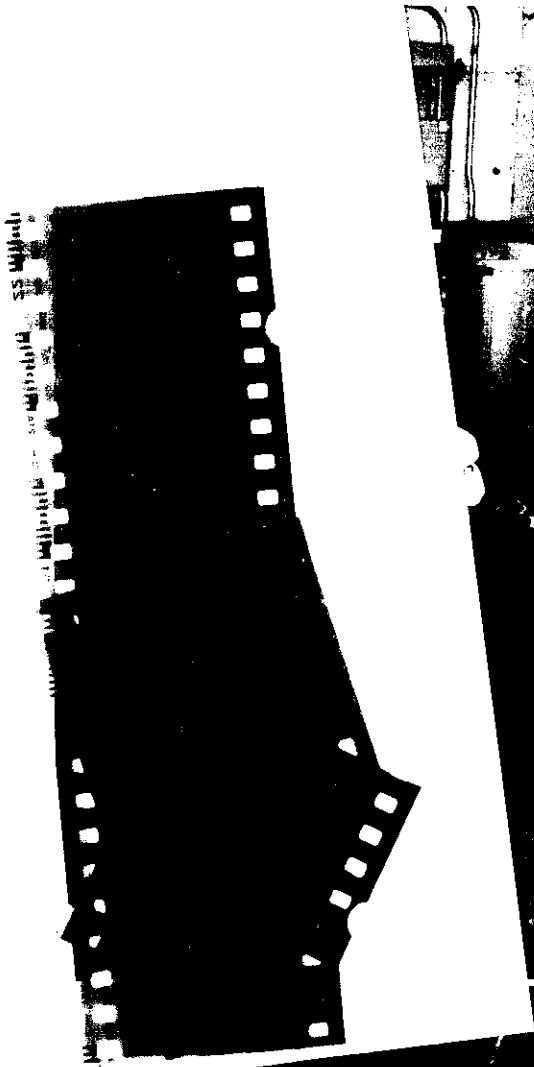

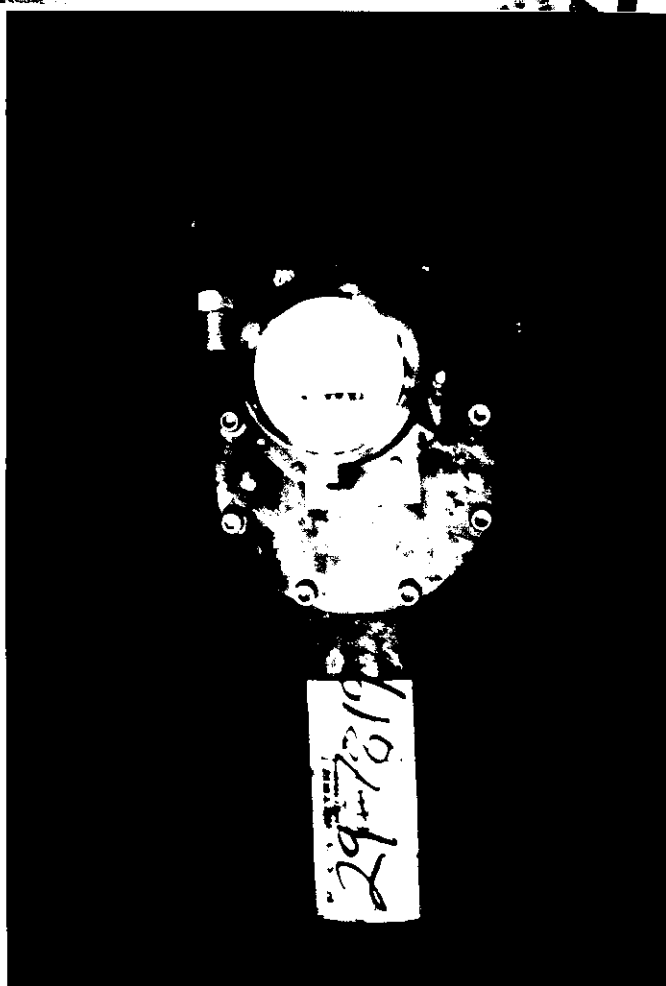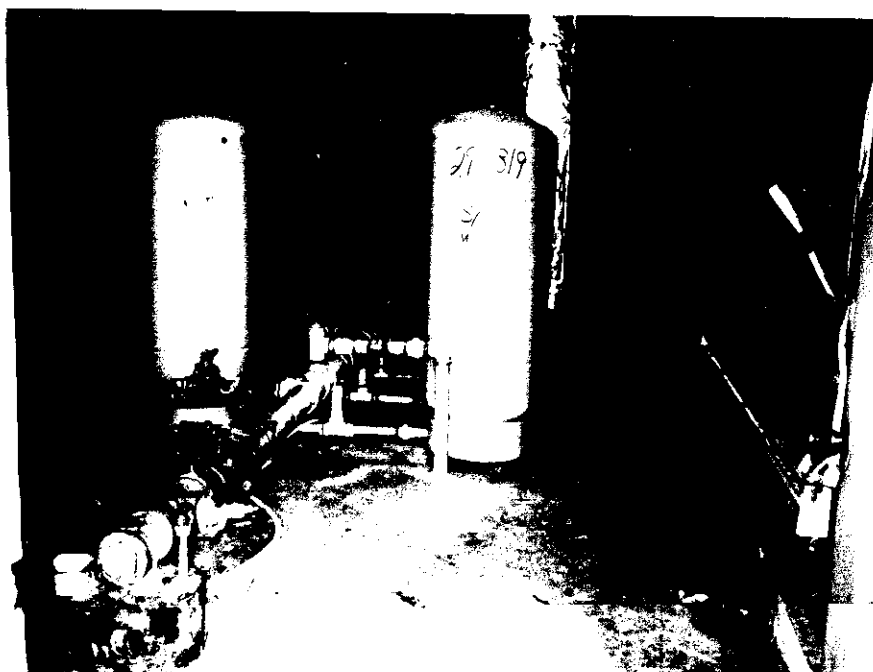

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
COMMENCEMENT OF WORKS

Culinary

Permit No. 27-7135
Name(s) of Permit Holder(s): Whitewater Development
Post Office Address: 350 No 2nd St
Bearburg, Idaho Tel. No. 208-352-9201

☒ I hereby certify that construction of diversion works for the above referenced permit began on July 1, 1983. I understand that I must continue to develop the water system with due diligence to maintain a valid permit.

☐ I hereby certify that construction of diverting works on the above referenced project has not yet begun due to the following reason beyond my control:

*Note: A financing difficulty is not an acceptable reason.


4-14-83
Date

Clayton J. Ferguson
Signature of Permit Holder

Play E screen

350 No 200 Ea

Rexburg, Idaho 83440



MICROFILMED

DEC 07 1990



RECEIVED

APR 21 1983

IDAHO DEPARTMENT OF WATER RESOURCES
STATEHOUSE
BOISE, IDAHO 83720

MEMORANDUM

DATE: December 12, 1986
TO: File 29-7819
FROM: L. Glen Saxton *LS*
RE: Submittal of License Exam

Permit holder submitted a license exam fee of \$100.00 for 1.0 cfs of water on April 29, 1986. The submittal was within the 60-day period allowed by the Examination Fee Notice letter dated April 17, 1986 which was sent to the permit holder.

For whatever reason, on November 10, 1986, permit holder submitted an additional fee of \$25.00 and an amended proof of beneficial use form showing a maximum rate of diversion of 1.25 cfs.

The statutes make no provision for submitting an amended proof. However, since a field examination has not yet been conducted, the amended proof of beneficial use can be considered as correspondence forwarding the additional fee.

The penalty provision of rule 8,1,3. of the Beneficial Use Exam Rules and Regulations isn't applicable until after the exam has been conducted. Thus, the penalty provisions isn't applicable to the late fee submittal. The fee submitted (\$100 + \$25) is the total amount which would be required for a rate of flow of 1.25 cfs.

The priority advancement provision of rule 8,1,3. cited above must be used in this case, however. The priority must be advanced the number of days late between June 16 (determined by adding 60 days to April 17) and November 10.

Nothing needs to be returned to the permit holder.

RECEIVED

JAN 29 1987

Form 217
03/86

RECEIVED
NOV 27 1986
Department of Water Resources
Eastern District Office

RECEIVED
NOV 27 1986
Department of Water Resources
STATE OF IDAHO

\$100⁰⁰ received
4/25/86
#35599
\$25⁰⁰ Due
OK
HWS

For Office Use Only
Fee Received 25
Date 11-13-86
Receipt # 39983
Receipt by IND
Reviewed by _____
Sent to region 11-14-86

Amended PROOF OF BENEFICIAL USE

The Idaho Department of Water Resources will consider this form as a statement that the permit holder(s) has completed all development that will occur under this permit and that water has been applied according to the provisions of the permit for the beneficial use(s) described below. This form must be accompanied by a license examination fee or a completed field examination report prepared by a certified water right examiner who has been appointed by the department.

Permit No. 29-7818 ^{SN 1986} 29-7819

Name(s) of Permit Holder: White Water Development Co.

Post Office Address: 350 North 200 East, Rexburg, Idaho 83440

Telephone No. (208) 356-9201

Source of Water: Groundwater

Extent of Use:

Domestic 50 (number of households) Stockwater _____ (number and type of stock)

Irrigation _____ (acres) Other/Remark _____

Total rate and/or volume for which proof is submitted 1.25 cfs _____ acre-feet

Show the date water was first diverted and beneficially used under this permit: July 1979

Measuring Device: Required? ☐ Yes ☐ No
Installed? ☐ Yes ☐ No

Fee enclosed \$ 25⁰⁰ additional
(See License Examination Fee Schedule)

Flow Measurement Port: Required? ☒ Yes ☐ No
Installed? ☐ Yes ☐ No

Person to contact to accompany the Department representative during the field examination:

White Water Develop - Clayton Forsgren 356-9201
(Name) (Telephone Number)

350 No 200 Ea, Rexburg Idaho
(Address)

The above information is my true statement of the extent to which the above numbered permit has been developed and I relinquish any undeveloped portion of the permit to the state of Idaho.

11/6/86
Date

Clayton Forsgren Major Gen Partner
Signature of Permit Holder (and title, if appropriate)

JAN 20 1987

4/86

RECEIVED
APR 29 1986

For Office Use Only
Fee Received \$100.00
Date 4-25-86
Receipt # 35599
Receipt by MD
Sent to S.O. 4-28-86

STATE OF IDAHO Department of Water Resources

DEPARTMENT OF WATER RESOURCES

EXAMINATION FEE INFORMATION

1. Permit No. 27-7135

ONE OF THE FOLLOWING BOXES SHOULD BE MARKED TO DESIGNATE YOUR CHOICE:

☒ I choose to have the department make the field examination of this permit; attached is the examination fee. (If this box is marked, complete items 1 thru 8.)

2. Permit Holder: WHITEWATER DEVELOPMENT CO.

3. Post Office Address: 350 North 200 East, Rexburg, Idaho 83440
Telephone No. (208) 356-9201

4. Source of Water: Deep Well

5. Extent of Use:

Domestic 45 (No. of households) Stockwater 0 (No. and type of stock)

Irrigation 45-1 Acre lots (acres) Other/Remark this serves one
subdivision - 45 1 Acre lots

6. Total rate &/or volume for which proof is submitted 1 cfs 100 acre-feet

7. Show the date water was first diverted and beneficially used under this permit:

1979

8. Person to contact to accompany the department representative during the field examination:

Clayton F. Forsgren
(Name)

MICROFILMED

350 No 200 Ea, Rexburg, Idaho
(Address)

JAN 29 1986
(Telephone Number)

☐ I choose to have the field examination conducted by a certified water right examiner. Attached is a statement from the certified examiner I have selected verifying that he has been retained to conduct the examination. (If this box is marked, complete items 1 thru 7.)

Date

4/23/86

Clayton F. Forsgren, Gen Partner
Signature of Permit Holder (and title, if appropriate)

copy retained for file

4/23/86

C. AYTER F. FORSGREN
Chief Executive Officer

Gentlemen

Enclosed is a check for \$100 for the required
well examination for Permit No 27-7135.

Within the next 3-months we will be
installing an in line flow meter to measure
the flow from this well to the storage tank.

It would obviously be easier to do at that time

RECEIVED
APR 29 1986

Department of Water Resources

Clay Forsgren
RECEIVED
APR 29 1986

Department of Water Resources
Eastern District Office

FORSGREN PERKINS ENGINEERING, P.A.

350 NORTH 200 EAST, REXBURG, IDAHO 83440 (208) 356-9201
Rexburg • Idaho Falls • Pocatillo • Preston • Logan • Salt Lake City • Wenatchee

JAN 29 1987



State of Idaho

DEPARTMENT OF WATER RESOURCES

STATE OFFICE, 450 W. State Street, Boise, Idaho

JOHN V. EVANS
Governor

Mailing address:
Statehouse
Boise, Idaho 83720

A. KENNETH DUNN

27-7135
WHITEWATER DEVELOPMENT CO.
350 NORTH 200 EAST
REXBURG, ID 83440

138151

April 17, 1986

CERTIFIED MAIL

EXAMINATION FEE NOTICE

Dear Permit Holder:

Department records show that proof of beneficial use has been submitted for the above-referenced permit, but that a field examination has not yet been conducted to determine the extent of beneficial use of the water for licensing purposes.

House Bill 671 (effective April 4, 1986) enacted by the 1986 Idaho Legislature requires the payment of a fee before this department can conduct the field examination needed to issue a license confirming use of water under the permit. This letter is notification that the license examination fee is due within sixty (60) days of the date of this letter. The examination fee information sheet (enclosed) must be returned with the fee.

As an alternative to submitting the fee, the department will accept a field examination report completed by a certified water right examiner from the private sector. If you choose to have the examination done by a certified water right examiner, you need not submit the license examination fee to the department, but you must within sixty (60) days of the date of this letter return to the department, the examination fee information sheet showing appropriate information together with a statement from the certified examiner to verify that you have retained a certified examiner to conduct the field examination. If you choose this alternative, a completed field examination report must be submitted within one year of the date of this letter. You cannot later change your decision to use this alternative and submit the fee needed for the department to conduct the field examination, but you may change to another certified examiner.

Certified water right examiners are licensed engineers, geologists, or land surveyors certified by the department to conduct water right examinations. The procedure for certifying examiners is derived from the recently enacted HB 671 and is being developed. A listing

JAN 29 1987

of certified water right examiners will be available from this department when examiners have been certified.

If your permitted use, in fact, has already been examined by the department and you have not asked to have the examination repeated, the fee requirement is not applicable to your permit. If you believe this is the case, please contact the department.

The license examination fee is to be based on the amount of water you indicate you have developed, as listed in item 6 on the examination fee information sheet. The amount of water on which the examination fee is based can be less than the permitted amount, if less water has been diverted and beneficially used. The licensed amount of water, however, will not exceed the amount you claim on the examination fee information sheet. The enclosed license examination fee schedule shows a listing of applicable fees.

FAILURE TO SUBMIT WITHIN THE SIXTY (60) DAY PERIOD, THE FEE OR THE STATEMENT THAT A CERTIFIED EXAMINER HAS BEEN RETAINED TO MAKE THE FIELD EXAMINATION, WILL BE CAUSE TO ADVANCE THE PRIORITY OF THE PERMIT ONE DAY FOR EACH DAY THAT THE FEE SUBMITTAL IS LATE.

FAILURE TO SUBMIT THE FEE OR THE COMPLETED FIELD EXAMINATION REPORT WITHIN A YEAR WILL BE CAUSE TO CONSIDER THE PROOF OF BENEFICIAL USE TO BE INCOMPLETE AND TO LAPSE THE PERMIT.

The attached examination fee information sheet and the fee may be submitted to the following department offices.

Northern Region

Idaho Dept. of Water Resources
4055 Government Way
Coeur d'Alene, ID 83814
Phone: 765-4639

Eastern Region

Idaho Dept. of Water Resources
150 Shoup Ave., Suite 15
Idaho Falls, ID 83401
Phone: 525-7161

Southern Region

Idaho Dept. of Water Resources
1041 Blue Lakes Blvd. North
Twin Falls, ID 83301
Phone: 734-3578

Western Region

Idaho Dept. of Water Resources
450 W. State St., (Third Floor)
Boise, ID 83720
Phone: 334-2190

Sincerely,



L. GLEN SAXTON
Chief, Operations Bureau

Enclosures

MICROFILMED

JAN 29 1987

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Eastern Region

150 Shoup, Suite 15
Idaho Falls, Idaho 83402
(208) 525-7161

AUGUST 13, 1984

WHITENATER DEVELOPMENT
330 N. 200 E.
REXBURG ID 83440

RE: Permit No. 27-7135

Dear Permit Holder:

We acknowledge receipt of your statement submitted as proof of beneficial use for the above referenced permit.

Before a license can be issued, a field examination must be made by a representative of this department.

A field examiner will contact you to arrange to examine your system.

If you have any questions regarding the field examination, please contact this office by phone at 525-7161 or in person in the third floor State Office Building, 150 Shoup, Idaho Falls, Idaho.

Sincerely,

s/HAROLD W. JONES
Sr. Resource Agent

MICROFILMED

JAN 29 1987

DEPARTMENT OF WATER RESOURCES

The Idaho Department of Water Resources will consider this card as a statement that the permit holder(s) has completed development to the extent shown below of Permit No. 27-7135

Name(s) of Permit Holder: White Water Development

Post Office Address: 383 No. 200 E.

Rexburg, Idaho 83440 Tel. No. 208-356-9201

Source of Water:

Extent of Use: ☒ Domestic 41 - 45 (number of households)
☐ Stockwater (number and type of stock)
☒ Irrigation 45 (acres)
☐ Other

Measuring Device: Required? ☐ Yes ☒ No Installed? ☐ Yes ☐ No

Access Port: Required? ☒ Yes ☐ No Installed? ☐ Yes ☐ No

The above information is a true statement of the extent to which the above numbered permit has been developed.

5/11/84
Date

Claudia F. Fournier
Signature of Permit Holder

Clay Forsgren

SSD No 200 E4

Rexburg, Ida 83740

PLACE
13 CENT
STAMP
HERE

RECEIVED



MAY 14 1964

IDAHO DEPARTMENT OF WATER RESOURCES
STATEHOUSE

BOISE, IDAHO 83720

MICROFILMED

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

STATEHOUSE
BOISE, IDAHO 83720
(208) 334-4440
CERTIFIED MAIL

138554

WHITEWATER DEVELOPMENT COMPANY
350 NORTH 2ND EAST
REXBURG, ID 83440

PROOF DUE NOTICE

MARCH 31, 1984

DEAR PERMIT HOLDER:

ONE OF THE CONDITIONS OF APPROVAL OF YOUR WATER PERMIT NO. 27-7135 WAS THAT PROOF OF THE EXTENT OF YOUR BENEFICIAL USE MUST BE SUBMITTED TO THIS OFFICE ON OR BEFORE JUNE 01, 1984. (SEE LAST PAGE OF YOUR APPROVED PERMIT OR YOUR LAST APPROVED EXTENSION REQUEST). ENCLOSED IS A POSTCARD WHICH MAY BE USED TO SUBMIT THE REQUIRED PROOF.

IF YOU HAVE NOT FULLY COMPLETED YOUR PROJECT, AND YOU OR A PREVIOUS OWNER OF THIS PERMIT HAVE NOT RECEIVED A PRIOR EXTENSION OF TIME, YOU MAY REQUEST AN EXTENSION OF TIME IF THE DELAY IS FOR REASONABLE CAUSE AS PROVIDED IN SECTION 42-204, IDAHO CODE. IF YOU HAVE BEEN PREVENTED FROM PROCEEDING BY A GOVERNMENTAL AGENCY OR BY LITIGATION, MORE THAN ONE EXTENSION OF TIME CAN BE GRANTED. AN EXTENSION OF TIME REQUEST FORM IS ENCLOSED FOR YOUR CONVENIENCE.

EITHER THE BENEFICIAL USE POSTCARD OR A REQUEST FOR AN EXTENSION OF TIME MUST BE RECEIVED BY THIS DEPARTMENT ON OR BEFORE THE ABOVE DESCRIBED PROOF DUE DATE. IF NEITHER IS RECEIVED, THE DEPARTMENT WILL SEND YOU A LAPSE NOTICE. WITHIN SIXTY (60) DAYS OF THE MAILING OF THE LAPSE NOTICE, THE PERMIT WILL NO LONGER BE OF ANY FORCE NOR EFFECT.

SINCERELY,

RITA FLECK
SECRETARY/RECORDS MANAGER

ENCLOSURES

RECEIVED
MARCH 31 1984



State of Idaho
DEPARTMENT OF WATER RESOURCES
STATE OFFICE, 373 W. Franklin Street, Boise, Idaho

JOHN V. EVANS
Governor

C. STEPHEN ALLRED
Director

Mailing address:
Statehouse
Boise, Idaho 83720
(208) 384-2215

June 14, 1979

Re: Permit No. 27-7135

Whitewater Development Co.
350 N. 2nd E.
Rexburg, Idaho 83440

Gentlemen:

Enclosed is a copy of your approved Application for Permit. We direct your attention to the conditions of approval as listed on the fourth page.

Be sure to note the special condition requiring you to install an access port or other device to provide for the installation of measuring equipment by the Department. Enclosed are specifications for the installation of the access port, as well as a list of measuring device options.

Sincerely,

David R. Tuthill Jr.

DAVID R. TUTHILL, JR.
Supervisor, Water Allocations Section

DRT:lr

Enclosures

MICROFILMED



STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
EASTERN REGION

John V. Evans
Governor

C. Stephen Allred
Director

1515 Lincoln Road
Idaho Falls, Idaho 83401
(208) 523-7186

May 30, 1979

Idaho State Journal
Legals Department
P. O. Box 431
Pocatello, Idaho 83201

Gentlemen:

Re: Application for Permit No. 27-7135 - Whitewater
Application for Permit No. 27-7136 - Whittewater
Application for Permit No. 29-7484 - Wallace
Application for Permit No. 29-7485 - Davis
Application for Permit No. 29-7486 - Davis

Please send affidavits of publication and certified bills for
the above referenced applications as soon as possible.

Thank you,

DONNA HENRIQUES
Secretary

MICROFILMED



STATE OF IDAHO

DEPARTMENT OF HEALTH AND WELFARE

RECEIVED

MAY 11 1979

DIVISION OF ENVIRONMENT

636 Pershing
Pocatello, Idaho
83201

Department of Water Resources
Eastern District Office

10 May 1979

Whitewater Development Co.
350 N. 2nd East
Rexburg, Idaho 83440

Re: Application #27-7135
(Bannock County)

Gentlemen:

We have been apprised of your application for a permit to appropriate the public waters of the State of Idaho in order to provide domestic water for approximately 350 families. Title 39, Chapter 100, Idaho Code, defines such water systems as public and, therefore, compliance with the Idaho Regulations for Public Drinking Water Systems is required. The regulations set up minimum requirements for engineering, construction, water quality, monitoring, and maintenance and operation.

A copy of these regulations is enclosed for your information. If you have any questions, or need clarification of our requirements, please do not hesitate to contact our office.

Yours very truly,

Henry L. Moran, P.E.
Rgnl. Environmental Supervisor

HLM/md
Enc.

CC: Ron Carlson ✓

May 7, 1979

Henry L. Moran, Supervisor
Division of Environment
636 Pershing
Pocatello, Idaho 83201

Dear Mr. Moran:

Re: Application for Permit No. 27-7135 - WHITEWATER

We are enclosing a copy of an application that may be of interest to your agency. Please review the application and submit any comments you may have to our Department as soon as possible. The last date of protest is May 29, 1979 and we are required to take final action shortly thereafter.

If we may be of further assistance, please feel free to contact us.

Very truly yours,

RONALD D. CARLSON
Supervisor
Eastern Region

RDC: dh

Enclosure

SECRET

collected & analyzed
3/4/8

54 27-7135
55 WHITEWATER DEVELOPMENT
56 COMPANY
57 350 NORTH 2ND EAST, REX-
58 BURG, ID 83440
59 Source: GROUNDWATER
60 Date Filed: 04/26/1979
61 Amount: 2.00 CFS
62 Diversion Point: NWNE Sec 26 T
63 05S R 36E, BANNOCK CO.
64 Use: DOMESTIC (2.00 CFS) from
65 01/01 to 12 / 31
66 COMMERCIAL (0.40 CFS) from
67 01/01 to 12 / 31
68 Place of Use: SWNW NWSW
69 SWSW Sec 25 T 05S R 36E
70 NESW NENW NUNW SENW
71 Sec 25 T 05S R 36E NENE
72 NWNE SWNE SENE NENW
73 SENW
74 Sec. 26 T 05S R 36E
75 Diversion Means: WELL, PUMP
76 & PIPELINES

OK
A

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
Eastern Region

1515 Lincoln Road
Idaho Falls, ID 83401
(208) 523-7186

MAY 4, 1979

Idaho State Journal
Box 431
Pocatello, Idaho 83201

Gentlemen:

Enclosed you will find a legal notice which we wish to have published on the dates indicated (once a week for two consecutive weekly issues) in your newspaper. We have allowed ample time for you to submit a galley proof to this office for review before the first publication date. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Department of Water Resources

Please send the affidavit of publication and publication billing to this office before MAY 29, 1979.

Yours truly,

RONALD D. CARLSON
Supervisor

Encl.

May 7 1979
J. H. H.

RECEIVED

NOTICE OF APPLICATION FOR WATER RIGHT

Notice is hereby given that the following application(s) have been submitted for permit to appropriate the public waters of the State of Idaho:

27-2125

WHITEWATER DEVELOPMENT COMPANY

350 NORTH 2ND EAST, REXBURG, ID 83440

Source: GROUNDWATER

Date Filed: 04/26/1979

Amount: 2.00 CFS

Diversion Point: NAME See 26 T 005 R 30E, BARNOCK Co.

Use: DOMESTIC (2.00 CFS) from 01/01 to 12/31
INDUSTRIAL (0.40 CFS) from 01/01 to 12/31

Place of Use: SEEN NEEN SEEN See 26 T 005 R 30E NEEN NEEN NEEN SEEN
See 26 T 005 R 30E NEEN NEEN SEEN SEEN NEEN SEEN
See 26 T 005 R 30E

Diversion Means: WELL, PUMP & PIPELINES

If issued, the permit(s) will be subject to all prior water rights. Protests against the granting of any permit must be filed with the Director of the Idaho Department of Water Resources, 1515 Lincoln Rd., Idaho Falls, Idaho 83401 on or before MAY 29, 1979.

C. STEPHEN ALLRED

Director

Published 5/10 & 5/17/79.

MICROFILMED

22-2135

WHITEWATER DEVELOPMENT COMPANY

350 NORTH 2ND EAST, REXBURG, ID 83440

Source: GROUNDWATER

Date Filed: 04/26/1979

Amount: 2.00 CFS

Diversion Point: NWNE Sec 26 T 05S R 36E, BANNOCK Co.

Use: DOMESTIC	(2.00 CFS)	from 01/01 to 12/31
COMMERCIAL	(0.40 CFS)	from 01/01 to 12/31

Place of Use: SWNW NWSW SWSW Sec 25 T 05S R 36E NESW NENW NWNW SENW
Sec 25 T 05S R 36E NENE NWNE SWNE SENE NENW SENW
Sec 26 T 05S R 36E

Diversion Means: WELL, PUMP & PIPELINES

MICROFILMED

State of Idaho
Department of Water Resources

APPLICATION FOR PERMIT ANALYSIS SHEET

INITIAL REVIEW BY: Ernest

APPLICATION NUMBER: _____

CHECK:

- ☒ Source g.w.
☒ Point of diversion.
☒ County ant
☒ Description of diverting works.
☒ Time required for beneficial use of water.
☒ Place of use or acres irrigated.
☒ Map.
☒ Signature.
☒ Fee.
☐ Yes ☒ No Field check required.
☐ Yes ☒ No Critical groundwater area.
☐ Yes ☒ No Request dam safety information. Sent by: _____ Date: _____
☒ Yes ☐ No* In form to receipt.

Field check by: _____

Date: _____

Comments: _____

*REQUEST THE FOLLOWING ADDITIONAL INFORMATION FROM THE APPLICANT: _____

SEND COPIES TO:

- ☒ Idaho State Health Department.
☐ Idaho Fish and Game Department.
☐ Idaho Department of Lands.
☐ U.S. Bureau of Land Management.
☐ U.S. Forest Service.
☐ Other _____

Copies sent by: _____ Date: 5/7/79

PROCESSING:

- ☐ Yes ☐ No
N/A ☐ Yes ☐ No

Platted by: one Map No. Geo 55 36E
Other rights on same place of use. _____

- ☐ Yes ☐ No* In form for advertising.

☐ Yes ☒ No Final date for protests: MAY 29, 1979
Protests received. If yes, record information on 4th page of application.

FINAL REGIONAL PROCESSING REVIEW:

- ☒ Affidavit of publication received. Date: 6-4-79
☒ Application published correctly. If not, record action taken: _____
☒ Fee amount, receipt date & number, recorded on application.
☒ Publication dates and paper, recorded on application.
☒ Protests, dates, withdrawal, etc., recorded on application.
☒ Recommendation & initial, recorded on application.

- ☐ Yes ☒ No Measuring device required.

- ☒ Yes ☐ No Access port required.

- ☐ Yes ☒ No Will water be delivered by watermaster? If yes, what district? _____

4/26/79 Date of priority recommended.

Special conditions of approval or cover letter. _____

By: Ernest Carlson

Date: 6/6/79

STATE OFFICE REVIEW:

ADD → A, OIC

- ☐ See attached sheet for more information.

By: J.S.

Date: 6/13/79

