

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

TRANSFER OF WATER RIGHT

TRANSFER NO. 5452
WATER RIGHT NO(S). 29-02274/29-02338/29-07375

This is to certify that: CITY OF POCA TELLO
PO BOX 4169
POCA TELLO ID 83205

has requested a change to the above captioned water right(s). This change in water right(s) is authorized pursuant to the provisions of Section 42-222, Idaho Code, provided the conditions listed below are met.

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>
Right No. 29-02274 :		
MUNICIPAL	01/01 to 12/31	21.00 CFS
Priority: 06/15/1948		
Right No. 29-02338 :		
MUNICIPAL	01/01 to 12/31	14.76 CFS
Priority: 09/01/1953		
Right No. 29-07375 :		
MUNICIPAL	01/01 to 12/31	3.34 CFS
Priority: 02/24/1977		
TOTAL:		* 39.10 CFS

SOURCE
GROUNDWATER

LOCATION OF POINT(S) OF DIVERSION:

NESE , Sec. 10, Township 06S, Range 33E
BANNOCK County
NESE , Sec. 12, Township 06S, Range 33E
POWER County
SWNE , Sec. 15, Township 06S, Range 33E
NWSW , Sec. 15, Township 06S, Range 34E
NENW , Sec. 26, Township 06S, Range 34E
NWSE , Sec. 27, Township 06S, Range 34E
SENE , Sec. 35, Township 06S, Range 34E
SENE , Sec. 35, Township 06S, Range 34E
NWSE , Sec. 35, Township 06S, Range 34E
SESE , Sec. 1, Township 07S, Range 34E
SWSW , Sec. 16, Township 07S, Range 35E
BANNOCK County

SCANNED
APR 30 2001


MICROFILMED
AUG 09 1999

TRANSFER NO. 5452
WATER RIGHT NO(S). 29-02274/29-02338/29-07375

CONDITIONS OF APPROVAL AND REMARKS

1. Right holder shall comply with the drilling permit requirements of Section 42-235, Idaho Code.
2. Use of water under this approval shall comply with applicable water quality standards of the Division of Environmental Quality of the Idaho Department of Health and Welfare.
3. The right holder shall accomplish the change authorized by this transfer within one (1) year of the date of this approval.
4. Failure of the right holder to comply with the conditions of this transfer is cause for the Director to rescind approval of the transfer.
5. Approval of this transfer does not preclude the opportunity for review of the validity of the water right(s) in the ongoing Snake River Basin Adjudication.
6. The right holder shall measure and annually report diversions of water and/or other pertinent hydrologic and system information as required by Section 42-701, Idaho Code.
7. Prior to diversion of water under this approval, the right holder shall provide a means of measurement acceptable to the Department from all authorized points of diversion which will allow determination of the total rate of diversion.
- * 8. The total instantaneous diversion of water from all points of diversion under Transfer 5452 shall not exceed 39.10 cfs.
9. The well(s) previously used under these rights shall be abandoned in a manner which complies with Department well abandonment rules.
10. Place of use is located within the City of Pocatello and the surrounding service area.
11. Two (2) points of diversion are located within SENE, and three (3) points of diversion are located within NWSE, of S35, T06S, R34E.

Dated this 28th day of June, 19 99

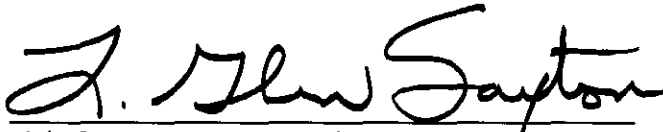
Chief, Water Allocation Bureau

MICROFILMED

AUG 09 1999

PART 1

6. General Information:

a. Description of diversion system wells & pumps for the city municipal system

b. Are the lands from which you propose to transfer the water right subject to any liens, deeds of trust, mortgages, or contracts? _____ Yes _____ No. If yes, provide a notarized statement from the holder of the lien, deed of trust, mortgage or contract agreeing to the proposed changes.

c. Describe the affect on the land now irrigated if the place of use is changed pursuant to this transfer:

d. Remarks:

Because of the groundwater pollution problems the City of Pacatello is forced to seek a new well location as a replacement well. It also must pump additional water from existing wells to make up the water from the wells that have been closed. Several wells now in use are in the path of the plume.

ACTION OF THE DIRECTOR, DEPARTMENT OF WATER RESOURCES

This is to certify that I have examined Application for Transfer of Water Rights No. _____

And said application is hereby _____, subject to the following limitations and conditions:

Witness my hand this _____ day of _____, 19 _____

MICROFILMED

AUG 09 1999

3 87

T5452

POINTS OF DIVERSION

NESE, SEC 10, T6S R33E BANNOCK CO.
NESE, SEC 12, T6S R33E POWER CO.
SWNE, SEC 15, T6S R33E BANNOCK CO.
NWSW, SEC 15, T6S R34E
NENW, SEC 26, T6S R34E
NWSE, SEC 27, T6S R34E
SENE, SEC 35, T6S R34E
NWSE, SEC 35, T6S R34E 3 POINTS OF DIVERSION
SENE, SEC 35, T6S R34E 2 POINTS OF DIVERSION
SESE, SEC 1, T7S R34E

MICROFILMED
AUG 09 1999

A. DESCRIPTION OF RIGHT AS RECORDED:

Water Right No. 29-02274

STAGE: LICENSE

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>
MUNICIPAL	to	21.00 CFS

SOURCE

GROUNDWATER

Priority: 06/15/1948

LOCATION OF POINT(S) OF DIVERSION:

NWSW , Sec. 15, Township 06S, Range 34E
NENW , Sec. 26, Township 06S, Range 34E
NWSE , Sec. 27, Township 06S, Range 34E
NWSE , Sec. 35, Township 06S, Range 34E
SENE , Sec. 1, Township 07S, Range 34E
BANNOCK County

PLACE OF USE: See RemarksCONDITIONS/REMARKS:

1. 2 P/D IN SENE, S1, T7S, R34E.
2. 4 P/D IN NWSE, SEC. 35, T6S, R34E.
3. P/D'S WERE DETERMINED FROM FIELD REPORT.
4. P/U WITHIN CITY OF POCA TELLO & VICINITY.

MICROFILMED

AUG 09 1999

A. DESCRIPTION OF RIGHT AS RECORDED:

Water Right No. 29-02338

STAGE: LICENSE

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>
MUNICIPAL	to	14.76 CFS

SOURCE

GROUNDWATER

Priority: 09/01/1953

LOCATION OF POINT(S) OF DIVERSION:

NESE , Sec. 10, Township 06S, Range 33E
NESE , Sec. 12, Township 06S, Range 33E
SWNE , Sec. 15, Township 06S, Range 33E
SENE , Sec. 35, Township 06S, Range 34E
SESE , Sec. 1, Township 07S, Range 34E
NWSE , Sec. 6, Township 07S, Range 35E
BANNOCK County

PLACE OF USE: See RemarksCONDITIONS/REMARKS:

1. P/D ALSO IN POWER CO.
2. P/U WITHIN CITY OF POCA TELLO & VICINITY.

MICROFILMED
AUG 09 1999

A. DESCRIPTION OF RIGHT AS RECORDED:

Water Right No. 29-07375

STAGE: LICENSE

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>
MUNICIPAL	01/01 to 12/31	3.34 CFS

SOURCE

GROUNDWATER


Priority: 02/24/1977

LOCATION OF POINT(S) OF DIVERSION:NWSE , Sec. 6, Township 07S, Range 35E.
BANNOCK CountyPLACE OF USE: See RemarksCONDITIONS/REMARKS:

1. P/U WITHIN CITY LIMITS OF POCA TELLO.

MICROFILMED

AUG 09 1999

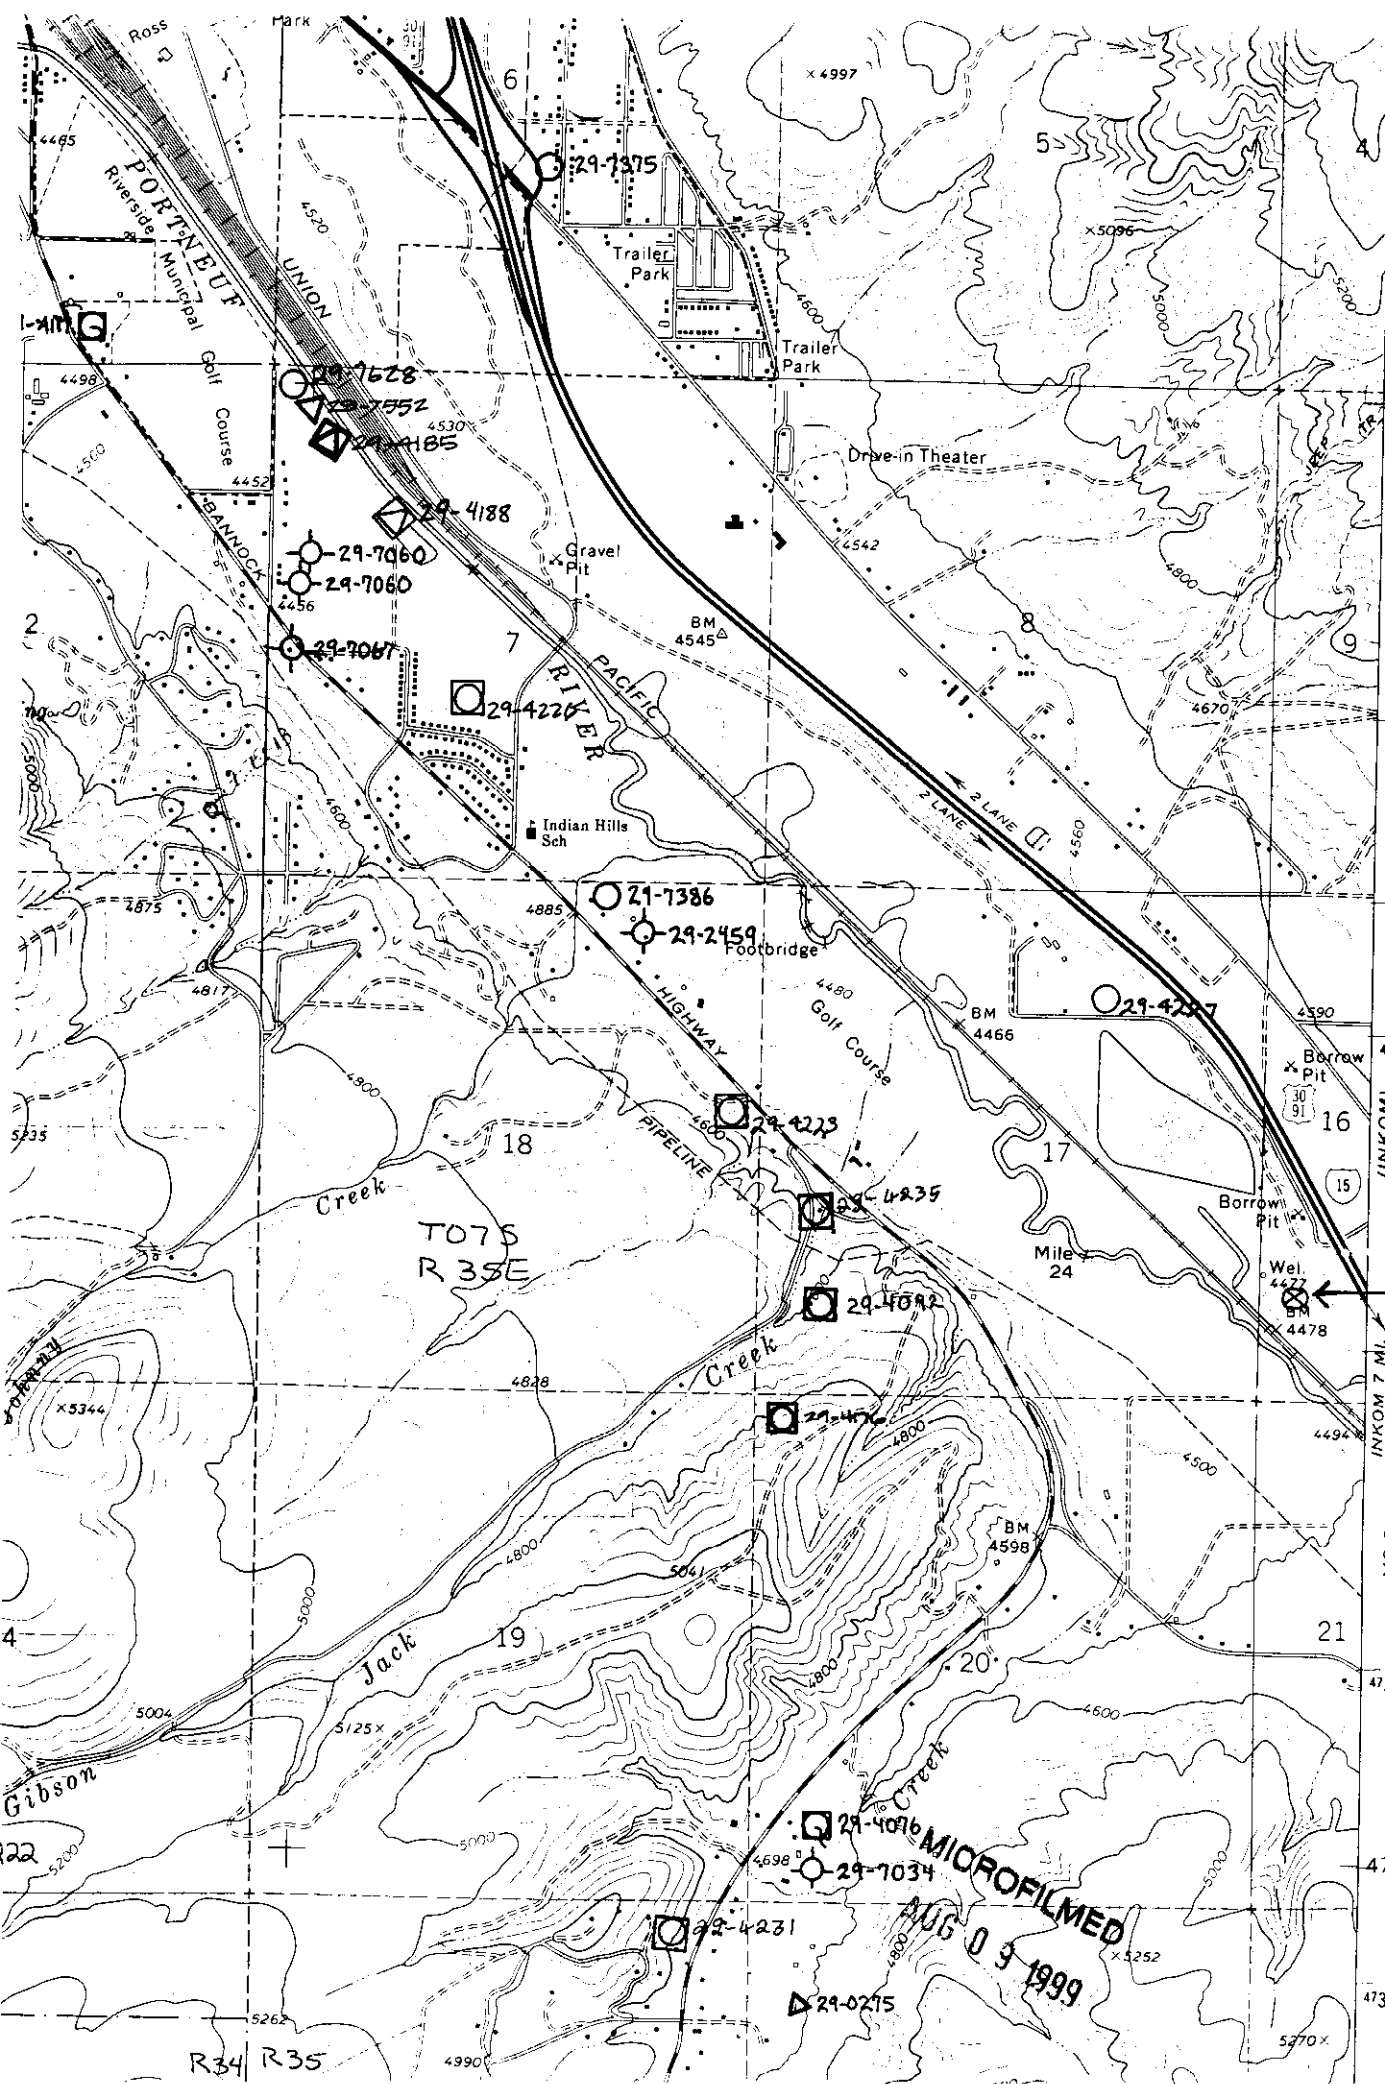

29-7375

29-4177(2)

29-7628
29-7552

29-4185
29-4188

29-7060

29-7067

29-4226

29-7386

29-2459

29-4227

29-4223

99-4235

29-4092

29-4176
Well Site
for proposed
new P/O on
Transfer
5452
per D.D. @ Eastern
SWSW, S16
T07S R35E

29-4076

29-7034

29-4222

29-4231

29-0275

T5452

MICROFILMED
AUG 09 1999

PART 3

B. CHANGES IN NATURE OF USE

1	New Nature of Use	Amount (cfs/ac-ft)	Hours/days/year	Period of Use
				to
				to

2. Quantity and quality of return flows and location of discharge:


3. Describe effects on other water uses resulting from the proposed change:

I hereby assert that no one will be injured by such change and that the change does not constitute an enlargement in use of the original right. The information contained in this application is true to the best of my knowledge.

I understand that any willful misrepresentations made in this application may result in voiding its approval.



(Signature of Applicant)

Subscribed and sworn to before me this 19th day of April, 19 99.

(Notary Public)

My commission expires 1-22-04

FOR DEPARTMENT USE ONLY

Transfer contains 7 pages and _____ attachments

Received by _____ Date _____ Protest filed by _____

Prelim. check by _____ Fee \$100~~00~~Receipted by DN Date April 20, 1999 E024925Published in Idaho State Journal - Statewide! Copies of protest forwarded by _____Pub. dates May 6 & 13, 1999 Hearing held by _____ Date _____Watermaster recommendation requested on _____ Recommended for ☒ approval ☐ denial_____ rec'd. _____ by RDC

Copy of transfer sent to lien holder _____

MICROFILMED
AUG 09 1999

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
APPLICATION FOR TRANSFER OF WATER RIGHT
PART 3

- A. Draw a map or attach a USGS map indicating the new point(s) of diversion and/or the new place of use for rights described in part 1. Clearly depict the land by section, township and range number.

State of Idaho
License and Certificate of Water Right

Water License No. 20611

Amount 21 c.f.s.

Water District No.

Priority June 15, 1948

THIS IS TO CERTIFY that CITY OF POCATELLO, A Municipal Corporation
of Pocatello, Idaho, made application for a permit to appropriate the
public waters of the State of Idaho, dated June 15, 1948; that Permit No. 20611
was issued under said application; that Certificate of Completion of works, with a carrying capacity of
21 second feet, was issued thereunder on May 13, 1954, showing that said works
were completed on the 2nd day of September, 1953; and that on the 17th
day of September, 1958, CITY OF POCATELLO

By: W. B. Webb, City Manager

of Pocatello, State of Idaho, made proof to the satisfaction of the
State Reclamation Engineer of Idaho, of the right to use the waters of nine wells
, a tributary of subterranean, for the purpose of DOMESTIC USE (Municipal)
, under Use Permit No. 20611 of the Department of Reclamation
and that said right to the use of said waters has been perfected in accordance with the laws of Idaho,
and is hereby confirmed by the State Reclamation Engineer of Idaho and entered of record in Volume

11 of Licenses at page 6562, on the 12th day of December, 1958;

The right hereby confirmed dates from

June 15, 1948;

The Point of Diversion is located (see below)

in the 1/4 Sec. 1, T. 1 N., R. 1 E., B. M. County Blaine

That the amount of water to which such right is entitled and hereby confirmed, for the purposes
aforesaid, is limited to an amount actually needed and beneficially used for said purposes, and shall
not exceed 21 cubic feet per second.

Description and location of use:

DOMESTIC USE FOR CITY OF POCATELLO & ADJACENT AREA

Twp.	Range	Sec.	Location	Wells
7 S.	34 E.	1	Center of NE 1/4	Ross Park #243
8 S.	34 E.	35	NW 1/4 SE 1/4	Hainey Park #15, 16, 17
6 S.	34 E.	15	NW 1/4 SW 1/4	No. Pocatello Park #8
			Blk. 557	Original Pocatello #9
			Blk. 519	Original Pocatello #10
				Townsite-Tydenah Field

The right to the use of the water aforesaid hereby confirmed is restricted to the lands or place
of use herein described, as provided by the laws of Idaho.

WITNESS the seal and signature of the State Reclamation Engineer, affixed at Boise, Idaho, this

10th day of September, 1958.

State Reclamation Engineer.

SCANNED

APR 30 2001

(SEAL)

29 2274

the p/d's shown
on computer
were determined
by review of
exam. kw
3/5/85

APPLICATION FOR PERMIT

To Appropriate the Public Waters of the State of Idaho

29-227

Date of Notice 7-13 1948
Date of Publication 7-24 1948
Last Date for Protest 8-22 1948

IF PROTESTED

Notice of Hearing 19
19
19

APPLICATION No. 28180
PERMIT No. 20611
DISTRICT No.

1. Name of Applicant: CITY OF POCATELLO, A Municipal Corporation

Postoffice address: Pocatello

County: Bannock

State: Idaho

I. If applicant is a corporation, give:

(a) Date and place of incorporation: 1892

(b) Amount of capital stock:

(c) Amount paid in:

(d) Names and addresses of directors: Mayor and City Council: George R. Phillips, J. P. Halliwell, James Hopper, Harold Hinckley, James Bowns

II. The financial resources of the applicant are:

(a) Cash on hand:

(b) Treasury stock:

(c) Bonds to be issued:

(d) Other resources: Through taxation

2. Quantity of water claimed: 54

cubic feet per second.

3. Source of water supply: Subterranean, under City of Pocatello, on City owned property

4. Location of point of diversion: See map attached feet distant from the

Center corner of Section 1, T7 S., R. 34 E., B.M., and is in the
NW 1/4 SW 1/4 15 T 6 S. E. 34 E.
NW 1/4 SE 1/4 of Section 35, T. 6 S., R. 34 E., B.M., County of Bannock
NW 1/4 SE 1/4 " 27 T. 6 S. R. 34 E.

5. Water is to be used for Domestic supply for City of Pocatello and adjacent area

6. If for mining, milling, power or manufacturing purposes, give:

(a) Point of use of water: feet distant from corner of Section

T. , R. , B.M., in the of Section , T. , R. , B.M.

(b) Amount of power generated: H.P., under feet head.

(c) Water is to be returned to at a point feet

distant from the corner of Section , T. , R. , B.M., in the
of Section , T. , R. , B.M.

7. Estimated cost of works: \$ 2,000,000.00

8. Kind of works: Wells, pumps, Reservoir and pipe system

9. Height of dam feet; length of dam at top feet; length of dam at bottom

feet; material used in dam:

10. Size of headgate: Width feet; height feet.

11. Ditch: Width at bottom feet; width at water line feet; depth of water feet;

dimensions of flume:

Diameter of pipe inches; length of conduit miles.

Average grade per mile feet.

12. The time required for the completion of such work is Five (5) years.

13. The time required for the complete application of the water to the proposed use is Six (6) additional years.

14. The land to be irrigated is described in the following tabulation: See remarks.

15. Existing water rights and/or valid permits appurtenant to the lands to be irrigated are:

- BE IT KNOWN THAT The undersigned hereby makes application for permit to appropriate the public water of the State of Idaho as herein set forth.

By George R. Phillips Agent.
Mayor of Pocatello

Returned to applicant for correction:

Corrected application received:

The number of this permit is 20611
Recorded in Book 74 Page 20611 Approved September 2, 1948
This is to certify that I have examined the within application for a permit to appropriate the public waters of the State of Idaho, and
hereby approve the same, subject to the following limitations and conditions:
Bond in the sum of \$ 1,000.00 to be filed on or before November 2, 1948
Work to begin on or before _____ and to continue diligently and uninterruptedly to completion,
unless temporarily interrupted by circumstances over which permit holder has no control.
One-fifth of the work above specified to be completed on or before March 2, 1951
The whole of said work to be completed on or before September 2, 1953
Beneficial use of water appropriated in accordance herewith, to be made on or before September 2, 1959

MARK R. KULP
State Reclamation Engineer.

Countersigned:

(SEAL) By J. D. "CY" PRICE *Secretary of State.*

By C. A. ROBINS *Governor.*

REMARKS: The City of Pocatello, from the years 1928 to 1930, developed three wells at an area known as Ross Park. These wells are designated as No. 1, 2 and 3, and have the following capacity: No. 1- 1100 g.p.m., No. 2- 1100 g.p.m., No. 3- 2200 g.p.m. (Continued below)

14.

Twp.	Range	Sec.	NE $\frac{1}{4}$				NW $\frac{1}{4}$				SW $\frac{1}{4}$				SE $\frac{1}{4}$				Totals
			NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	NE $\frac{1}{4}$	NW $\frac{1}{4}$	SW $\frac{1}{4}$	SE $\frac{1}{4}$	
REMARKS	(Continued)		Further development of the subterranean water took place in an area known as Rainey Park. In 1930 and 1931 two wells were drilled in this area and are designated as Wells No. 4 and 5. No 4 has a rated capacity of 2100 g.p.m., No. 5 has a rated capacity of 1100 g.p.m. In 1934 an additional well was drilled in this area and is designated Well No. 6. Its capacity is 1100 g.p.m. In 1940 a fourth well was drilled in this area and is designated as Well No. 7, having a capacity of 2110 gal. per minute. In 1947 additional development was made in an area known as North Pocatello Park. The well here is designated as Well No. 8 and has a rated capacity of 3000 g.p.m. In 1948 another well will be drilled in an area known as Raymond Park and this well will be designated as Well No. 9, and will have a rated capacity of 2000 g.p.m. In the next five years it is expected to develop one more well in the Raymond Park area and two more wells in the North Pocatello area. These will be designated as Well No. 10, 11, and 12, and each will be developed for a rated capacity of 2000 g.p.m. The total of the above now in use and those contemplated is approximately 44 second feet. This is the definite amount we would like to file on at this time; however, for the eleven year period, we believe future growth may require an additional 10 second feet, and, therefore, would like to file on a total of 54 second feet of subterranean water for present use and future use of the City of Pocatello.																

APPLICATION FOR AMENDMENT
TO PERMIT TO APPROPRIATE THE PUBLIC WATERS
OF THE STATE OF IDAHO, NO. 20611

Comes now City of Pocatello and represents to the State Reclamation Engineer of the State of Idaho:

That it is the owner and holder of Permit to appropriate the Public Waters of the State of Idaho, No. 20611.

That the point of diversion or location of Well No. 10 is described in the permit as being in the Raymond Park.

That it now requests that the point of diversion or location of said wells be changed as follows: Well No. 10 to Tydeman Field,

That the reasons for desiring to make such changes are as follows: The previous location at Raymond Park proved to be an unfavorable well field and a point of diversion was needed at the old Airport.

That no one will be injured by such change, and that such change will be made at Permit Holder's own risk.

Signed at Pocatello, Idaho this 18 day of July 1953.

CITY OF POCAHELLO

W. B. WEBB
City Manager

Date of receipt at Department of Reclamation July 20, 1953

APPROVAL OF STATE RECLAMATION ENGINEER

I, Mark R. Kulp, State Reclamation Engineer of the State of Idaho, hereby approve the above and foregoing application for amendment to Permit to appropriate the Public Waters of the State of Idaho, No. 20611. This approval constitutes a new permit and is issued as an amendment to the original permit, to which it refers, and of which it becomes a part, and said application is approved only insofar as the rights of others will not be adversely affected thereby.

MARK R. KULP
State Reclamation Engineer

Permit No. 20611
CERTIFICATE OF COMPLETION OF WORKS

TO ALL WHOM IT MAY CONCERN:

THIS is to certify that City of Pocatello, a municipal corporation of Pocatello, County of Bannock and State of Idaho, the holder of Permit No. 20611, issued upon Application No. 28180 bearing date of priority of June 15, 1948 authorizing the diversion of 54 second feet of the waters of ten wells (subterranean flow) County of Bannock, State of Idaho, for municipal water supply purposes, has fully complied with the provisions of the laws of the State of Idaho relating to the proof of completion of the works of diversion set out and described in said Permit; that said works are adequate for diverting and conveying to the place of intended use twenty-one (21) second feet of the waters of said wells; that the points of diversion of said waters are as follows: No. 1-Ross Park; Nos. 2 & 3-Ross Park; Nos. 4, 5, 6, 7-Rainey Park; No. 8-North Pocatello Park; No. 9-Raymond Park; No. 10-Tydeman Field, and that the place of use of said water is the City of Pocatello and adjacent area.

Witness my hand this 13th day of May, A. D. 1954.

MARK R. KULP
State Reclamation Engineer

Proof of completion of works made September 2, 1953
Certificate of Completion of Works issued May 13, 1954

CERTIFICATE ISSUED FOR 21 SEC. 51.

Page 6562

1. WELL TAG NO. D 0006983
 DRILLING PERMIT NO. 29-91-E-0074
 Other IDWR No. T5452
 WR 29-02274

2. OWNER:
 Name City of Pocatello
 Address P.O. Box 4169
 City Pocatello State ID Zip 83205

Sketch map location must agree with written location.



Twp. 7 North ☐ or South ☒
 Rge. 35 East ☒ or West ☐
 Sec. 16 SW $\frac{1}{4}$ SW $\frac{1}{4}$ $\frac{1}{4}$
10 acres 40 acres 160 acres
 Gov't Lot _____ County Barnack
 Lat. : : Long. : :
 Address of Well Site Highway Pond
 City Pocatello
 Area _____
 (Give at least name of road + Distance to Road or Landmark)

Lt.	Blk.	Sub.	Name
-----	------	------	------

☐ Domestic ☒ Municipal ☐ Monitor ☐ Irrigation
☐ Thermal ☐ Injection ☐ Other

5. TYPE OF WORK check all that apply (Replacement etc.)
☒ New Well ☐ Modify ☐ Abandonment ☐ Other _____

☐ Air Rotary ☒ Cable ☐ Mud Rotary ☐ Other _____

SEAL/FILTER PACK			AMOUNT	METHOD
Material	From	To	Sacks or Pounds	
Bentonite	5'	30'		Slurry

Was drive shoe used? ☒ Y ☐ N Shoe Depth(s) _____
Was drive shoe seal tested? ☐ Y ☒ N How? _____

Diameter	From	To	Gauge	Material	Casing	Liner	Welded	Threaded
18"	26'	80'	3/8"	Steel	☐	☐	☒	☐
					☐	☐	☐	☐
					☐	☐	☐	☐

Length of Headpipe _____ Length of Tailpipe _____

Perforations _____ Method _____
Screens _____ Screen Type Johnson

From	To	Slot Size	Number	Diameter	Material	Casing	Liner
36	66	100				☐	☒
						☐	☐
						☐	☐

23 ft. below ground Artesian pressure _____ lb.
Depth flow encountered _____ ft. Describe access port or
control devices:

☒ Pump ☐ Bailer ☐ Air ☐ Flowing Artesian

Yield gal./min.	Drawdown	Pumping Level	Time
2,000	19'	32'	11 hrs

Water Temp. very cold Bottom hole temp. ✓
Water Quality test or comments: _____

12. LITHOLOGIC LOG: (Describe repairs or abandonment) water

[illegible]

Completed Depth 80 (Measurable)
Date: Started Aug 10 99 Completed Aug 10 99

I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

Company Name Colman W. H. Miller Firm No. 55

Firm Official Kim Hall Date 09/07/09

Driller or Operator [Signature] Date Feb 17 99

(Sign once if Firm Official & Operator)



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. Box 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

June 29, 1999

DIRK KEMPTHORNE
GOVERNOR

KARL J. DREHER
DIRECTOR

CITY OF POCATELLO
PO BOX 4169
POCATELLO ID 83205

RE: Water Rights 29-02274/29-02338/29-07375 (Transfer 5452)

Dear Water Right Holder(s):

Enclosed is the copy of your approved Transfer of Water Right for the above referenced water rights (Transfer 5452). Please be sure to thoroughly read the Conditions and Remarks listed on the transfer. Also, please be advised that the accompanying transfer approval should be considered and treated as a **preliminary order** of the department issued pursuant to section 67-5243, Idaho Code. Enclosed are instructions for responding to **Preliminary Orders** if you are in disagreement with the approved transfer.

Please note that as of July 1, 1996, water right owners are required to report any change of water right ownership and any change of mailing address of the owner of a water right to the department. Notice of the change must be provided to the department within 120 days of the change. Change reporting forms are available from any office of the department.

Please feel free to contact the department if you have questions.

Sincerely,

LGS L. GLEN SAXTON, Chief
Water Allocations Bureau

LGS:klt

Enclosures

MICROFILMED

AUG 09 1999

CERTIFICATE OF MAILING

I hereby certify that on the 29th day of June, 1999 I mailed a true and correct copy, postage prepaid, of the foregoing **TRANSFER APPROVAL** to the person(s) listed below:

RE: WATER RIGHTS 29-02774/29-02338/29-07375 (Transfer 5452)

**CITY OF POCATELLO
PO BOX 4169
POCATELLO ID 83205**


Kari Lynn Townsend
Secretary

MICROFILMED

AUG 09 1999

SCANNED
APR 30 2001

Responding to Preliminary Orders Issued by the Idaho Department of Water Resources

The Idaho Department of Water Resources (Department) issues water right permits, licenses, and transfers as preliminary orders pursuant to section 67-5243, Idaho Code. A preliminary order can and will become a final order without further action of the department unless a party petitions for reconsideration or files an exception and/or brief as further described below:

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the Department within fourteen (14) days of the service date of the order. The Department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See section 67-5243(3), Idaho Code.

EXCEPTIONS AND BRIEFS

Within twenty-one (21) days after (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from a preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding. Otherwise, a preliminary order will become a final order of the Department.

If any party appeals or takes exceptions to a preliminary order, opposing parties shall have twenty-one (21) days to respond to any party's appeal. Written briefs in support of or taking exceptions to the preliminary order shall be filed with the Department. The Department retains the right to review the preliminary order on its own motion.

ORAL ARGUMENT

If the Department grants a petition to review a preliminary order, the Department shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Department will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Department orders otherwise, all oral arguments will be heard in Boise, Idaho.

MICROFILMED

AUG 09 1999

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Department in connection with a preliminary order shall be served on all other parties to the proceedings in accordance with Rules of Procedure 302 and 303.

FINAL ORDER

The Department will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Department may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

Unless a different date is stated in a final order, the order is effective fourteen (14) days after its issuance if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:

- (a) the petition for reconsideration is disposed of; or
- (b) the petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

- i. A hearing was held,
- ii. The final agency action was taken,
- iii. The party seeking review of the order resides, or
- iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

MICROFILMED
AUG 09 1999

MEMORANDUM

TO: Files 29-02274, 29-02338 & 29-07375

FROM: Pam Skaggs^{OS}/State Office

SUBJECT: Transfer 5452

DATE: June 18, 1999

Transfer 5452 changes and adds points of diversion under Rights 29-02274, 29-02338 and 29-07375. The city has closed some of their well due to groundwater pollution. The transfer identifies all the wells currently used and the addition of a new well under these combined municipal use rights.

A map identifying the specific locations of the points of diversion has been requested from region staff. Recommended conditions include drilling permit requirements, well abandonment requirements, water quality, multiple points of diversion/measuring devices, annual measuring & reporting, and standard transfer conditions.

MICROFILMED

AUG 09 1999


Proof of Publication

The Post Register


State of Idaho
County of Bonneville

I, S. Bob Bright or Robert Park, first being duly sworn, depose and say: That I am the Production Supervisor or Asst. Prod. Supervisor of The Post Company, a corporation of Idaho Falls, Bonneville County, Idaho, publishers of The Post Register, a newspaper of general circulation, published daily at Idaho Falls, Idaho; said Post Register being a consolidation of the Idaho Falls Times, established in the year 1890, The Idaho Register, established in the year 1880 and the Idaho Falls Post, established in 1903, such consolidation being made on the First day of November, 1931, and each of said newspapers have been published continuously and uninterruptedly, prior to consolidation, for more than twelve consecutive months and said Post Register having been published continuously and uninterruptedly from the date of such consolidation, up to and including the last publication of notice hereinafter referred to.

That the notice, of which a copy is hereto attached and made a part of this affidavit, was published in said Post Register for two consecutive (days) weeks, first publication having been made on the 6th day of May, 1999, last publication having been made on the 13th day of May, 1999, and that the said notice was published in the regular and entire issue of said paper on the respective dates of publication, and that such notice was published in the newspaper and not in a supplement.



Subscribed and sworn to before me, this 19th day of May, 1999.

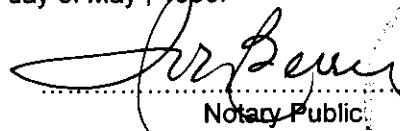
Notary Public

My commission expires January 16, 2003

NOTICE OF PROPOSED CHANGE OF A WATER RIGHT

Notice is hereby given that City of Pocatello, P.O. Box 4169, Pocatello, ID 83205, has applied to the Department of Water Resources to add a point of diversion and to change a point of diversion of a groundwater source. The rights to be changed are evidenced by license and recorded as follows:

License No.: 29-02274
Source: Groundwater
Amount: 21.00 cfs
Priority: 06/15/1948
License No.: 29-02338
Source: Groundwater
Amount: 14.76 cfs
Priority: 09/01/1953
License No.: 29-07375
Source: Groundwater
Amount: 3.34 cfs
Priority: 02/24/1977
The water is used for municipal within the city limits of Pocatello and vicinity.

AS FOLLOWS

The applicant intends to add all the existing wells plus one new one in the SWSW SEC 16 T07S R35E as points of diversion for their existing rights. Several other existing wells will also be abandoned.

Any protests against approval of the proposed changes must be filed with the Idaho Department of Water Resources, 900 N Skyline Dr. Ste A, Idaho Falls, ID 83402, together with a protest fee of \$25.00 on or before May 24, 1999. The protestant must also send a copy of the protest to the applicant.

KARL J. DREHER
Director
Published: May 6, 13, 1999

RECEIVED
MAY 21 1999
Department of Water Resources
Eastern Region
MICROFILMED
AUG 09 1999


Proof of Publication

The Post Register


State of Idaho
County of Bonneville

I, S. Bob Bright or Robert Park, first being duly sworn, depose and say: That I am the Production Supervisor or Asst. Prod. Supervisor of The Post Company, a corporation of Idaho Falls, Bonneville County, Idaho, publishers of The Post Register, a newspaper of general circulation, published daily at Idaho Falls, Idaho; said Post Register being a consolidation of the Idaho Falls Times, established in the year 1890, The Idaho Register, established in the year 1880 and the Idaho Falls Post, established in 1903, such consolidation being made on the First day of November, 1931, and each of said newspapers have been published continuously and uninterruptedly, prior to consolidation, for more than twelve consecutive months and said Post Register having been published continuously and uninterruptedly from the date of such consolidation, up to and including the last publication of notice hereinafter referred to.

That the notice, of which a copy is hereto attached and made a part of this affidavit, was published in said Post Register for two consecutive (days) weeks, first publication having been made on the 6th day of May, 1999, last publication having been made on the 13th day of May, 1999, and that the said notice was published in the regular and entire issue of said paper on the respective dates of publication, and that such notice was published in the newspaper and not in a supplement.



Subscribed and sworn to before me, this 19th day of May, 1999.

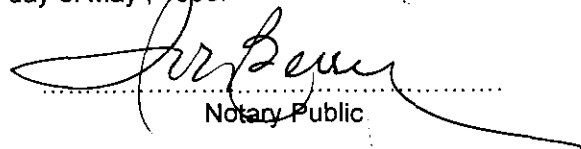

Notary Public

My commission expires January 16, 2003

NOTICE OF PROPOSED CHANGE OF A WATER RIGHT

NO. 15452

Notice is hereby given that City of Pocatello, PO Box 4169, Pocatello ID 83205, has applied to the Department of Water Resources to add a point of diversion and to change a point of diversion of a groundwater source. The rights sought to be changed are evidenced by licenses and recorded as follows:

License No.: 29-02274
Source: Groundwater
Amount: 21.00 cfs
Priority: 06/15/1948
License No.: 29-02338
Source: Groundwater
Amount: 14.76 cfs
Priority: 09/01/1953
License No.: 29-07375
Source: Groundwater
Amount: 3.34 cfs
Priority: 02/24/1977
The water is used for municipal within the city limits of Pocatello and vicinity.

AS FOLLOWS

The applicant intends to add all the existing wells plus one new one in the SWSW SEC. 16 T07S R35E as points of diversion for their existing rights. Several other existing wells will also be abandoned.

Any protests against approval of the proposed changes must be filed with the Idaho Department of Water Resources, 900 N Skyline Dr. Ste A, Idaho Falls, ID 83402, together with a protest fee of \$25.00 on or before May 24, 1999. The protestant must also send a copy of the protest to the applicant.

KARL J. DREHER

Director

Published: May 6, 13, 1999

RECEIVED
MAY 21 1999

Department of Water Resources
Eastern Region
MICROFILMED

AUG 09 1999

401K plan,
fuel/safety
bonuses.

Assembly type work in fin-
DC, call 423-4269.
OFFICIAL RECORD

Affidavit of Publication

STATE OF IDAHO }
COUNTY OF TWIN FALLS } SS.

No 31768

I, Carole Williams being first duly sworn upon oath, depose
and say that I am principal clerk of the TIMES-NEWS, published daily, at
Twin Falls, Idaho, and do solemnly swear that a copy of the notice of advertisement, as per
clipping attached, was published in the regular and entire issue of said newspaper, and not in any
supplement thereof, for two consecutive weeks,
commencing with the issue dated May 6, 19 99,
and ending with the issue dated May 13, 19 99.

And I do further certify that said newspaper is a consolidation, effective February 16, 1942, of the Idaho
Evening Times, published theretofore daily except Sunday, and the Twin Falls News, published theretofore daily except
Monday, both of which newspapers prior to consolidation had been published under said names in said city and county
continuously and uninterruptedly during a period of more than twelve consecutive months, and said TIMES-NEWS, since
such consolidation, has been published as a daily newspaper except Saturday, until July 31, 1978, at which time said
newspaper began daily publication under said name in said city and county continuously and uninterruptedly.

And I further certify that pursuant to Section 60-108 Idaho Code, Thursday of each week has been designated
as the day on which legal notice by law or by order of any court of competent jurisdiction within the state of Idaho, to be
published weekly, will be published; and that at the head of the editorial column of said combined newspapers, and in each
issue thereof, Thursday is announced as the day on which said legal notices will be published.

STATE OF IDAHO
COUNTY OF TWIN FALLS

On this 13th day of May in the year of 1999, before me,
a Notary Public, personally appeared Carole Williams,
known or identified to me to be the person whose name subscribed to the within instrument, and being by me first duly
sworn, declared that the statements therein are true, and acknowledged to me that he executed the same.

RECEIVED
MICROFILMED
MAY 14 1999
AUG 09 1999
Department of Water Resources
Eastern Region

Ineva R. Feltman
Notary Public for Idaho
Residing at Twin Falls, Idaho.
My commission expires: 5/19/2000

NOTICE OF PROPOSED CHANGE OF A
WATER RIGHT NO. T5452

Notice is hereby given that the City of Pocatello, PO Box 4169, Pocatello, ID 83205, has applied to the Department of Water Resources to add a point of diversion and to change a point of diversion of a groundwater source. The rights sought to be changed are evidenced by licenses and recorded as follows:

License No.: 29-02274 Source: Groundwater
Amount: 21.00 cfs Priority: 06/15/1948

License No.: 29-02388 Source: Groundwater
Amount: 14.76 cfs Priority: 09/01/1953

License No.: 29-07375 Source: Groundwater
Amount: 3.34 cfs Priority: 02/24/1977

The water is used for municipal within the city limits of Pocatello and vicinity.

TO BE CHANGED AS FOLLOWS:

The applicant intends to add all the existing wells plus one new one in the SWSW SEC 16 T07S R35E as points of diversion for their existing rights. Several other existing wells will also be abandoned.

Any protests against approval of the proposed changes must be filed with the Idaho Department of Water Resources, 900 N Skyline Dr. Ste A, Idaho Falls, ID 83402, together with a protest fee of \$25.00 on or before May 24, 1999. The protestant must also send a copy of the protest to the applicant.

Karl J. Dreher, Director

PUBLISH: May 6 and 13, 1999

Publication

HO
WIN FALLS } SS.

No 31768

Williams being first duly sworn upon oath, depose
municipal clerk of the TIMES-NEWS, published daily, at
Pocatello, Idaho, and do solemnly swear that a copy of the notice of advertisement, as per
was published in the regular and entire issue of said newspaper, and not in any
if, for two consecutive weeks,
the issue dated May 6, 19 99,
the issue dated May 13, 19 99.

further certify that said newspaper is a consolidation, effective February 16, 1942, of the Idaho
published theretofore daily except Sunday, and the Twin Falls News, published theretofore daily except
Sundays. Prior to consolidation had been published under said names in said city and county
continuously and uninterruptedly during a period of more than twelve consecutive months, and said TIMES-NEWS, since
consolidation has been published as a daily newspaper except Saturday, until July 31, 1978, at which time said
publication under said name in said city and county continuously and uninterruptedly.
I further certify that pursuant to Section 60-108 Idaho Code, Thursday of each week has been designated
for the publication of legal notice by law or by order of any court of competent jurisdiction within the state of Idaho, to be
published; and that at the head of the editorial column of said combined newspapers, and in each
issue is announced as the day on which said legal notices will be published.

WIN FALLS

On this 13th day of May in the year of 1999, before me,
a Notary Public, personally appeared Carol Williams,
known or identified to me to be the person whose name subscribed to the within instrument, and being by me first duly
sworn, declared that the statements therein are true, and acknowledged to me that he executed the same.

MICROFILMED
RECEIVED

MAY 14 1999

306 0 9 1999

Department of Water Resources
Eastern Region

Shirley R. Feltman
Notary Public for Idaho

Residing at Twin Falls, Idaho.

My commission expires: 5/19/2000

The Idaho Statesman

P.O. BOX 40, BOISE, IDAHO 83707-0040

LEGAL ADVERTISING INVOICE

Account # /Trans #	Identification	Amount:
100564 #28944	CHANGE OF WATER RIGHT - CITY OF POCA TELLO	\$81.00
Ordered by:	P.O. Number	Rate
SHARLA		TT
ID DEPARTMENT OF WATER RESOURCES EAST 900 N. SKYLINE DR, STE. A IDAHO FALLS, ID 83402		Run Dates: MAY 6, 13, 1999
		Estimated Inches 26 X 2 LINES
		Affadavit: 1
		Legal Number: 3908


JANICE HILDRETH, being duly sworn, deposes and says: That she is the Principal Clerk of The Idaho Statesman, a daily newspaper printed and published at Boise, Ada County, State of Idaho, and having a general circulation therein and which said newspaper has been continuously and uninterruptedly published in said County during a period of twelve consecutive months prior to the first publication of the notice, a copy of which is attached hereto; that said notice was published in The Idaho Statesman in conformity with Section 60-108, Idaho Code as amended for TWO

X consecutive weekly single
 consecutive daily odd skip

insertion(s) beginning with the issue of: MAY 6, 1999
and ending with the issue of: MAY 13, 1999

STATE OF IDAHO)
COUNTY OF ADA)
SS. Janice Hildreth

On this 14 day of MAY in the year
of 1999, before me, a Notary Public, personally appeared Janice Hildreth
known or identified to me to be the person whose name subscribed to the
within instrument, and being by me first duly sworn, declared that the
statements therein are true, and acknowledged to me that she executed
the same.

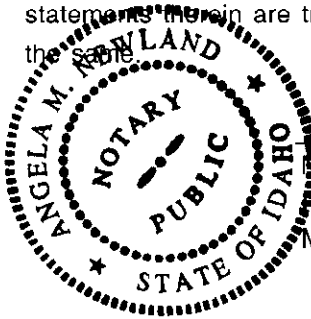

 Angela M Newland
Notary Public for Idaho
Residing at: Boise, Idaho
My commission expires: 2/12/05

MICROFILMED

AUG 09 1993

RECEIVED

MAY 17 1999

Department of Water Resources
Eastern Region

LEGAL NOTICE
NOTICE OF PROPOSED CHANGE OF A WATER RIGHT
NO. 15452

Notice is hereby given that City of Pocatello, PO Box 4169, Pocatello ID 83205, has applied to the Department of Water Resources to add a point of diversion and to change a point of diversion of a groundwater source. The rights sought to be changed are evidenced by licenses and recorded as follows:

License No.:	29-02274	Source:	Groundwater
Amount:	21.00 cfs	Priority:	06/15/1948
License No.:	29-02338	Source:	Groundwater
Amount:	14.76 cfs	Priority:	09/01/1953
License No.:	29-07375	Source:	Groundwater
Amount:	3.34 cfs	Priority:	02/24/1977

The water is used for municipal within the city limits of Pocatello and vicinity.

The applicant intends to add all the existing wells plus one new one in the SWSW SEC 16 T07S R35E as points of diversion for their existing rights. Several other existing wells will also be abandoned.

Any protests against approval of the proposed changes must be filed with the Idaho Department of Water Resources, 900 N Skyline Dr. Ste A, Idaho Falls, ID 83402, together with a protest fee of \$25.00 on or before May 24, 1999. The protest must also send a copy of the protest to the applicant.

KARL J. DREHER
Director

Pub. May 6, 13, 1999

RECEIVED

MAY 14 1999

Department of Water Resources
Eastern Region

PROOF OF PUBLICATION

STATE OF IDAHO }
County of Bannock } ss.

KAREN GROVER

NOTICE OF PROPOSED
CHANGE OF A WATER
RIGHT
NO. T5452

Notice is hereby given that City of Pocatello, PO Box 4169, Pocatello ID 83205, has applied to the Department of Water Resources to add a point of diversion and to change a point of diversion of a groundwater source. The rights sought to be changed are evidenced by licenses and recorded as follows:

License No.: 29-02274
Source: Groundwater
Amount: 21.00 cfs
Priority: 06/15/1948

License No.: 29-02338
Source: Groundwater
Amount: 14.76 cfs
Priority: 09/01/1953

License No.: 29-07375
Source: Groundwater
Amount: 3.34 cfs
Priority: 02/24/1977

The water is used for municipal within the city limits of Pocatello and vicinity.

TO BE CHANGED AS
FOLLOWS:

The applicant intends to add all the existing wells plus one new one in the SWSW SEC 16 T07S R35E as points of diversion for their existing rights. Several other existing wells will also be abandoned.

Any protests against approval of the proposed changes must be filed with the Idaho Department of Water Resources, 900 N Skyline Dr. Ste A, Idaho Falls, ID 83402, together with a protest fee of \$25.00 on or before May 24, 1999. The protestant must also send a copy of the protest to the applicant.

KARL J. DREHER
Director
May 6, 13, 1999
LN4681

being first duly sworn on oath deposes and says: That SHE was at all times herein mentioned a citizen of the United States of America, more than 21 years of age, and the Principal Clerk of THE IDAHO STATE JOURNAL, a daily newspaper, printed and published at Pocatello, Bannock County, Idaho, and having a general circulation therein.

That the document or notice, a true copy of which is attached, was published in the said IDAHO STATE JOURNAL, on the following dates, to-wit:

MAY 6	19 99	19
MAY 13	19 99	19
	19	19
	19	19
	19	19

That said paper has been continuously and uninterruptedly published in said County for a period of seventy-eight weeks prior to the publication of said notice or advertisement and is a newspaper within the meaning of the laws of Idaho.

Karen Grover

STATE OF IDAHO

COUNTY OF

BANNOCK

On this 13TH day of MAY in the year of 1999, before me, a Notary Public, personally appeared

KAREN GROVER

known or identified to me

to be the person whose name subscribed to the within instrument, and being by me first duly sworn, declared that the statements therein are true, and acknowledged to me that he executed the same.

Fori A. Schot
Notary Public for Idaho

Residing at POCATELLOMy commission expires: FEBRUARY 2003

MICROFILMED
AUG 09 1999

TRIBUNE PUBLISHING COMPANY, INC.
The Lewiston Morning Tribune
505 C St., P.O.Box 957
Lewiston, Idaho 83501
(208) 743-9411

LEGAL ADVERTISING INVOICE

Date 05/13/99 INVOICE NO. 200692
Account No. 446600
Description 200392NOTICEOFPROPOSED
Times 2 Lines 24
Tab. Lines _____

SOLD TO: IDAHO DEPT. OF WATER RESOURCES
900 N. SKYLINE
IDAHO FALL ID 83402

\$ 72.00

NOTICE: This is an invoice of Purchase made by you. Statement will be rendered the first of the month.
Please Retain This Invoice as Your Statement Will Refer to Invoice by No. Only.

AFFIDAVIT OF PUBLICATION

STATE OF IDAHO, ss.
County of Nez Perce

Karen Lewis, being duly sworn, deposes and says, I am the Legal Clerk of the Tribune Publishing Company, a corporation organized and existing under and by virtue of the laws of the State of Idaho, publishers of the LEWISTON MORNING TRIBUNE, a newspaper of general circulation published at Lewiston, Nez Perce County, Idaho; That the said Lewiston Morning Tribune is an established newspaper and has been published regularly and issued regularly at least once a day for more than 21 consecutive years next immediately preceding the first publication of this notice, and has been so published uninterrupted for said period; that the 200392NOTICEOFP attached hereto and which is made a part of this affidavit was published in the said Lewiston Morning Tribune, 2 time(s). Publication being on 05/06, or once a WEEK for 2 consecutive WEEK, the first publication thereof being on the 05/06/99, and the last publication thereof being on the 05/13/99, and said 200392NOTICEOFP was so published in the regular and entire issue of said newspaper and was not in a supplement thereof and was so published in every issue and number of the said paper, during the period and times of publication as set forth above.

Karen J. Lewis

SUBSCRIBED AND SWORN BEFORE ME THIS THE 13

day of May 1999

MICROFILMED

Notary Public in and for the State of Idaho,
residing at Lewiston, therein
Commission Expires 7/1/00

2006 05 1999

200392
NOTICE OF PROPOSED CHANGE OF A WATER RIGHT
NO. TS452
Notice is hereby given that City of Pocatello, PO Box 4169, Pocatello ID 83205, has applied to the Department of Water Resources to add a point of diversion and to change a point of diversion of a groundwater source. The rights sought to be changed are evidenced by licenses and recorded as follows:
License No.: 29-02274
Amount: 21.00 cfs
Priority: 06/15/1948
License No.: 29-02338
Amount: 14.76 cfs
Priority: 09/01/1953
License No.: 29-07375
Amount: 3.34 cfs
Priority: 02/24/1977
The water is used for municipal within the city limits of Pocatello and vicinity.
TO BE CHANGED AS FOLLOWS:
The applicant intends to add all the existing wells plus one new one in the SWSW SEC 16 T07S R35E as points of diversion for their existing rights. Several other existing wells will also be abandoned.
Any protests against approval of the proposed changes must be filed with the Idaho Department of Water Resources, 906 N Skyline Dr, Ste A, Idaho Falls, ID 83402, together with a protest fee of \$25.00 on or before May 24, 1999. The protestant must also send a copy of the protest to the applicant.
KARL J. DREHER Director
Published in the Lewiston Morning Tribune on May 6 and 13, 1999.

RECEIVED

MAY 17 1999

Department of Water Resources
Eastern Region



State of Idaho
DEPARTMENT OF WATER RESOURCES

900 N. Skyline Dr., Suite A, Idaho Falls, Idaho 83402-1718 - (208) 525-7161- Fax (208) 525-7177

EASTERN REGION

April 27, 1999

= DIRK KEMPTHORNE
GOVERNOR

KARL J. DREHER
DIRECTOR

CITY OF POCA TELLO
PO BOX 4169
POCA TELLO ID 83205

RE: Application for Transfer #5452

Dear Applicant:

This office is currently in the process of advertising the application in the Idaho State Journal on May 6 and 13, 1999. The advertisement will be published once a week for two consecutive weeks, and a period of ten days following the second publication will be allowed for the submittal of protests.

If the application is protested, you will be sent a copy of the protest. The protest must be resolved before the application is approved or denied. If the protest is not resolved voluntarily, this Department will conduct a conference and/or hearing on the matter.

Please feel free to contact this office if you have any questions regarding this procedure.

Sincerely,

Harold W. Jones
Water Right Supervisor

HWJ::sc

MICROFILMED

AUG 09 1999



**State of Idaho
DEPARTMENT OF WATER RESOURCES**

900 N. Skyline Dr., Suite A, Idaho Falls, Idaho 83402-1718 - (208) 525-7161- Fax (208) 525-7177

EASTERN REGION

DIRK KEMPTHORNE
GOVERNOR

KARL J. DREHER
DIRECTOR

April 27, 1999

LEWISTON MORNING TRIBUNE
PO BOX 957
LEWISTON ID 83501


Dear Publisher:

Enclosed you will find a legal notice which we wish to have published on the dates indicated in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before May 24, 1999.

Respectfully submitted,

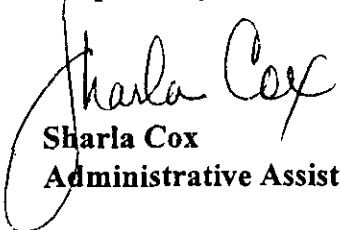
Sharla Cox
Administrative Assistant

Enc.

MICROFILMED

AUG 09 1999



State of Idaho
DEPARTMENT OF WATER RESOURCES

900 N. Skyline Dr., Suite A, Idaho Falls, Idaho 83402-1718 - (208) 525-7161- Fax (208) 525-7177

EASTERN REGION

~ DIRK KEMPTHORNE
GOVERNOR

KARL J. DREHER
DIRECTOR

April 27, 1999

TIMES NEWS
PO BOX 548
TWIN FALLS ID 83303

Dear Publisher:

Enclosed you will find a legal notice which we wish to have published on the dates indicated in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before May 24, 1999.

Respectfully submitted,

Sharla Cox
Administrative Assistant

Enc.

MICROFILMED

AUG 09 1999



State of Idaho
DEPARTMENT OF WATER RESOURCES

900 N. Skyline Dr., Suite A, Idaho Falls, Idaho 83402-1718 - (208) 525-7161- Fax (208) 525-7177

EASTERN REGION

- DIRK KEMPTHORNE
GOVERNOR

KARL J. DREHER
DIRECTOR

April 27, 1999

POST REGISTER
PO BOX 1800
IDAHO FALLS ID 83403


Dear Cathy:

Enclosed you will find a legal notice which we wish to have published on the dates indicated in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before May 24, 1999.

Respectfully submitted,

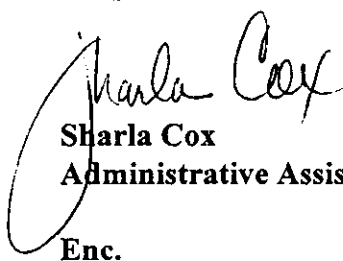
Sharla Cox
Administrative Assistant

Enc.

MICROFILMED

AUG 03 1999



**State of Idaho
DEPARTMENT OF WATER RESOURCES**

900 N. Skyline Dr., Suite A, Idaho Falls, Idaho 83402-1718 - (208) 525-7161- Fax (208) 525-7177

EASTERN REGION

- DIRK KEMPTHORNE
GOVERNOR

KARL J. DREHER
DIRECTOR

April 27, 1999

IDAHO STATE JOURNAL
PO BOX 431
POCATELLO ID 83204

Dear Publisher:

Enclosed you will find a legal notice which we wish to have published on the dates indicated in your newspaper. If you cannot publish the notice on the proposed dates, please contact us immediately.

An affidavit of publication must be submitted to the Department along with the publication bill. Your cooperation is appreciated.

Please send the affidavit of publication and publication billing to this office before May 24, 1999.

Respectfully submitted,

Sharla Cox
Administrative Assistant

Enc.

MICROFILMED

AUG 3 9 1999

Cox, Sharla

From: Cox, Sharla
Sent: Tuesday, April 27, 1999 11:46 AM
To: Janice Hildreth (E-mail)
Subject: Another Ad

Hi Janice:

Enclosed is the other legal ad for your paper for May 6 and 13, 1999. Also, please send me the affidavit of publication and publication billing to my office before May 24, 1999.

If you have any questions, please call me.



Thanks again
Sharla Cox

MICROFILMED

2008 03 19 1999

NOTICE OF PROPOSED CHANGE OF A WATER RIGHT
NO. T5452

Notice is hereby given that City of Pocatello, PO Box 4169, Pocatello ID 83205, has applied to the Department of Water Resources to add a point of diversion and to change a point of diversion of a groundwater source. The rights sought to be changed are evidenced by licenses and recorded as follows:

License No.:	29-02274	Source:	Groundwater
Amount:	21.00 cfs	Priority:	06/15/1948

License No.:	29-02338	Source:	Groundwater
Amount:	14.76 cfs	Priority:	09/01/1953

License No.:	29-07375	Source:	Groundwater
Amount:	3.34 cfs	Priority:	02/24/1977

The water is used for municipal within the city limits of Pocatello and vicinity.

TO BE CHANGED AS FOLLOWS:

The applicant intends to add all the existing wells plus one new one in the SWSW SEC 16 T07S R35E as points of diversion for their existing rights. Several other existing wells will also be abandoned.

Any protests against approval of the proposed changes must be filed with the Idaho Department of Water Resources, 900 N Skyline Dr. Ste A, Idaho Falls, ID 83402, together with a protest fee of \$25.00 on or before May 24, 1999. The protestant must also send a copy of the protest to the applicant.

KARL J. DREHER
Director

Published in the Idaho Statesman, Times News, Lewiston Morning Tribune, Idaho State Journal and the Post Register on May 6 and 13, 1999.

MICROFILMED

AUG 23 1999

October 14, 1971

Re: Permit No. 20611/29-2274 - City of Pocatello

Safeco Insurance Companies
Surety Department
Northwest Division
4347 Brooklyn Avenue, N.E.
Seattle, Washington 98105

ATTENTION: Millie Sullivan

Dear Mrs. Sullivan:

This office has received many requests for a compilation of the statutory water laws of the state. Prior to this time, the only source of such information was in the various volumes and annual supplements to the Idaho Code for the Annual Session Laws. The switch to annual Legislative Sessions will further complicate the matter because of the difficulty in up-dating the Idaho Code and its indexes.

As a result of these requests from Attorneys, water users and others, we have made arrangements with the Aspen Systems Corporation of Pittsburgh, Pennsylvania, who has prepared a compilation of the State's water laws. We will publish these laws in two volumes. The first contains the statutes pertaining to water rights or water use organizations dealing with water. Publication of the second volume will depend upon the success we have in distribution of the first volume.

The book is in loose-leaf form and will contain the applicable water statutes and the rules, regulations and minimum standards that have been adopted by this Department in compliance with those statutes. The statutes comprise approximately 100 pages of text and approximately 40 pages of index. The index is of the key-word type and will be referenced to context phrases. The volume is desk book size (6½" x 9½").

The price of the first volume is \$10.00, which includes an automatic up-dating service for a period of five years. After that time, amendments and changes will be available, for those desiring them, at a modest subscription price. We have printed only limited numbers of the volume. If you are interested in obtaining a copy, you should return the enclosed post card immediately.

If you have any questions, please feel free to contact us.

Very truly yours,

Donald W. McEldowney
Appropriation Supervisor

DWM:CS

29-2274

October 14, 1971

Re: Permit No. 20611/29-2274 - City of Pocatello

Safeco Insurance Companies
Surety Department
Northwest Division
4347 Brooklyn Avenue, N.E.
Seattle, Washington 98105

ATTENTION: Millie Sullivan

Dear Mrs. Sullivan:

This office has received many requests for a compilation of the statutory water laws of the state. Prior to this time, the only source of such information was in the various volumes and annual supplements to the Idaho Code for the Annual Session Laws. The switch to annual Legislative Sessions will further complicate the matter because of the difficulty in up-dating the Idaho Code and its indexes.

As a result of these requests from Attorneys, water users and others, we have made arrangements with the Aspen Systems Corporation of Pittsburgh, Pennsylvania, who has prepared a compilation of the State's water laws. We will publish these laws in two volumes. The first contains the statutes pertaining to water rights or water use organizations dealing with water. Publication of the second volume will depend upon the success we have in distribution of the first volume.

The book is in loose-leaf form and will contain the applicable water statutes and the rules, regulations and minimum standards that have been adopted by this Department in compliance with those statutes. The statutes comprise approximately 100 pages of text and approximately 40 pages of index. The index is of the key-word type and will be referenced to context phrases. The volume is desk book size (6½" x 9½").

The price of the first volume is \$10.00, which includes an automatic up-dating service for a period of five years. After that time, amendments and changes will be available, for those desiring them, at a modest subscription price. We have printed only limited numbers of the volume. If you are interested in obtaining a copy, you should return the enclosed post card immediately.

If you have any questions, please feel free to contact us.

Very truly yours,

Donald W. McEldowney
Appropriation Supervisor

DWM:CS

29-2274

October 14, 1971

Re: Permit No. 20611/29-2274 - City of Pocatello

Safeco Insurance Companies
Surety Department
Northwest Division
4347 Brooklyn Avenue, N.E.
Seattle, Washington 98105

ATTENTION: Millie Sullivan

Dear Mrs. Sullivan:

Prior to 1967, Section 42-204 of the Idaho Code provided that within sixty (60) days after a permit was issued from the Department of Water Administration, projects appropriating more than 25 cubic feet per second were required, as conditions of approval, to supply a bond not exceeding \$10,000 surety, to the Department that the permit holder would faithfully carry to completion, the works of diversion as specified in said permit. Therefore, once the Department had issued a certificate of completion of works, the bond requirement imposed under the approval was no longer in force and a bond did not need to be maintained.

The 1967 Session of the Idaho Legislature revised Section 42-204 of the Idaho Code and any mention to bond was deliberately deleted. Any permit that contained a bond requirement not having a completion of works certificate issued, was subject to modification by administrative order, to in addition to other requirements, relieve the bond requirement. The Department started through its 32,000 outstanding permits and we have not yet completed this task.

In the case of the City of Pocatello, their bond requirement was fulfilled and a bond was not required after May 13, 1954. Understandably, we did not have a print-out of each statute. The only reproduction of Idaho water laws is available at at \$10.00 cost. Please find enclosed an informational letter on this book and a card in case you should wish to purchase one.

If you should have any further questions in reference to this matter, please do not hesitate to contact this Department.

Very truly yours,

Donald W. McEldowney
Appropriation Supervisor

DWM:cs

29-2074

GENERAL INSURANCE COMPANY OF AMERICA

Home Office: 4347 Brooklyn Ave. N.E., Seattle, Washington 98105



~~XXXXXXXXXXXX~~ State of Idaho
Commissioner of Reclamation
Boise, Idaho

NOTICE OF CANCELLATION

OF BOND

City of Pocatello
Pocatello, Idaho

You are hereby notified that GENERAL INSURANCE COMPANY OF AMERICA, Surety on the bond described below, desires to cancel and does hereby cancel said bond, in accordance with the cancellation provisions contained therein or in applicable laws or regulations:

BOND NO. 155052

PRINCIPAL City of Pocatello

EFFECTIVE DATE October 13, 1948

DESCRIPTION Permit No. 20611 - Appropriate Public Waters

This notice is mailed to you on October 11, 19 71, and becomes effective immediately

Cancellation Acknowledged:

I, State Rept. of Idaho Admin.

By Mildred W. Sullivan

Dated Oct 13, 19 71

GENERAL INSURANCE COMPANY OF AMERICA

By Mildred W. Sullivan

Mildred W. Sullivan

Attorney-in-fact

Address 4347 Brooklyn N. E.
Seattle, WA

PLEASE SIGN THE DUPLICATE OF THIS NOTICE AND RETURN IT
IN THE ENCLOSED SELF-ADDRESSED ENVELOPE





SAFECO INSURANCE COMPANIES

GENERAL INSURANCE COMPANY OF AMERICA

SURETY DEPARTMENT • NORTHWEST DIVISION 4347 BROOKLYN AVENUE N.E., SEATTLE, WASHINGTON 98105 - TELEPHONE ME 3-0622

October 11, 1971

State of Idaho
Commissioner of Reclamation
Boise, Idaho

Gentlemen:

Please furnish pertinent information concerning the Legislature in regard to captioned bond. We understand this was repealed in 1967. We would appreciate this information for our file.

Thank you for your cooperation.

Very truly yours,

Millie Sullivan
Northwest Division Surety
Bond Department

29-2274

December 12, 1958

Re: Permit No. 20611

Mr. W. B. Webb, City Manager
City of Pocatello
P. O. Box 1489
Pocatello, Idaho

Dear Mr. Webb:

Enclosed is the License and Certificate of Water Right issued
under Permit No. 20611, and, departmental receipt #29398 for fee.

Very truly yours,

GEO. N. CARTER
State Reclamation Engineer
By

Chief Clerk

EPR:nls
Enc.

20611

November 14, 1958

Re: Permit No's. G-24451 and 20611

City of Pocatello
City Clerk
P. O. Box 1489
Pocatello, Idaho

Dear Sir:

Enclosed are vouchers on Permit No. G-24451 and 20611
signed, as requested.

Very truly yours,

GEO. N. CARTER
State Reclamation Engineer
By

(Mrs.) Edna P. Rutledge
Chief Clerk

EPR/lw
Enclosures (2)

20611

November 6, 1958

Re: Permit No. 20611
City of Pocatello, Idaho

Mr. W. B. Webb, City Manager
City of Pocatello
P. O. Box 1489
Pocatello, Idaho

Dear Mr. Webb:

Our field engineer's report on his inspection of the beneficial use of the water under the terms of Permit No. 20611 shows that wells number 2, 3, 4, 5, 6, 7, 8, 9, and 10 are capable of conveying 1050 miners inches (21 c.f.s.) of water for domestic use for City of Pocatello, as follows:

Wells	Point of Diversion	Cubic Feet Per Second
2	Ross Park--Center of NE $\frac{1}{4}$ Sec. 1, T7S-R34E.BM	3.1
3		1.4
4,5,6,7	Rainey Park NW $\frac{1}{4}$ SE $\frac{1}{4}$ Sec.35,T6S-R34E.BM	8.
8	No.Pocatello Park NW $\frac{1}{4}$ SW $\frac{1}{4}$ Sec.15,T6S-R34E.BM	2.66
9	Raymond Park--Blk 557 Original Pocatello Townsite	.8
10	Tydemann Field, Lot 1,Blk 219 Original Pocatello Townsite	5.04

Upon receipt of the statutory fee of \$5.00, we will issue the License and Certificate of Water Right confirming the right with priority of June 15, 1948 to the use of 21 second feet of subterranean water for domestic supply for City of Pocatello and adjacent area, with points of diversion as described above.

Very truly yours,

GEO. N. CARTER
State Reclamation Engineer
By

EPR:nls

Chief Clerk

Running Jamb.

#2 40' to 40'8" 1100g 2.44g

#3 32' ——— 4.44g

#4 41'6" ——— 2.44g

#5 27' ——— 2.22g

#6 25'8" ——— 2.22g
170

#7 31'-33' — 2.44g

#8 38'-39' — 2.66g

#9 22'-34' — 1.11g

#10 44' — 5.34g

#11 65 1/2' — 1.11g
31.42

#12 44' — 6.20g
32.62

13 - 20' 2.22%

15 - 65' 1.11%

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
BOISE, IDAHO

Permit No. 20611

Proof of Application of Water to Beneficial Use

Deposition of Holder

Ques. 1. State your name, residence, occupation and postoffice address.

Ans. W. B. Webb, City Manager, City of Pocatello, P. O. Box 1489,
Pocatello, Idaho

Ques. 2. If acting in behalf of corporation, state its name, principal place of business (if a foreign corporation, give name of postoffice of statutory agent), your position with reference to same, and your authority for appearing in its behalf.

Ans. See Question 1

Ques. 3. State number and date of permit, and date of priority you propose to establish under the permit.

Ans. Permit 20611 June 15, 1948 Sept. 2, 1948

Ques. 4. State source of water supply and give exact location of point of diversion.

Ans. See Enclosure

Ques. 5. Describe your works of diversion, and state amount of water they are capable of conveying from point of diversion to place of use, and give name of canal or ditch or other works by which water is conducted to such place of use. If a well, state depth of well, depth and size of casing and depth to water. If pump is used, state capacity of pump and whether it is motor or determined. If sprink-

Ans. See enclosure

Ques. 6. State for what purpose water is used and describe place of use. (If for irrigation, name each subdivision in which used, and number of acres in each subdivision that have actually been irrigated with said water.) State whether cultivated or natural meadow land and the nature of all improvements which have been made as a direct result of said use.

Ans. Domestic Water Supply, City of Pocatello, Idaho

20611

JD

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
BOISE, IDAHO

Permit No. 20611

Proof of Application of Water to Beneficial Use

Deposition of Holder

Ques. 1. State your name, residence, occupation and postoffice address.

Ans. R. J. Smith, 1111 N. 1st St., Boise, Idaho, 83702

Ques. 2. If acting in behalf of corporation, state its name, principal place of business (if a foreign corporation, give name of postoffice of statutory agent), your position with reference to same, and your authority for appearing in its behalf.

Ans. See Question 1

Ques. 3. State number and date of permit, and date of priority you propose to establish under the permit.

Ans. Permit 20611 June 15, 1948

Ques. 4. State source of water supply and give exact location of point of diversion.

Ans. See Enclosure

Ques. 5. Describe your works of diversion, and state amount of water they are capable of conveying from point of diversion to place of use, and give name of canal or ditch or other works by which water is conducted to such place of use. If a well, state depth of well, depth and size of casing and depth to water. If pump is used, state discharge of pump and tell how it was measured or determined. If sprinkler irrigation, give number and size of nozzles and operating pressure.

Ques. 6. State for what purpose water is used and describe place of use. (If for irrigation, name each subdivision in which used, and number of acres in each subdivision that have actually been irrigated with said water.) State whether cultivated or natural meadow land and the nature of all improvements which have been made as a direct result of said use.

Ans. Domestic Water Supply, City of Pocatello, Idaho

20611

Ques. 7. If for other than irrigation purposes; state how applied, amount of horse power generated, etc.

Ans. Domestic Water Supply, City of Pocatello, Idaho

Ques. 8. What is the minimum amount of water required for the purpose specified above?

Ans. 9.3 cfs (yr av) Min 2.1 cfs Max 32.0 cfs 1958

Ques. 9. If you are not the person or representative of the corporation to whom above mentioned permit was originally issued, please state how ownership was acquired by present holder.

Ans. Not app

Ques. 10. State when, how, in what amount and to what extent the water diverted under above mentioned permit has been used.

Ans. City of Pocatello Domestic Water Supply

Est Min 1.9 cfs Est Max 27 cfs 1958

Ques. 11. State when, how, in what amount and to what extent waters other than those diverted under the above mentioned permit have been diverted and applied to beneficial use upon the lands herein described. Give full particulars regarding such other appropriations and rights claimed thereunder.

Ans. Surface waters from Mink, Gibson Jack, and Cusick Creeks, under Idaho decree

Waters under pending permit G24451

(Sign)

W. B. Webb, City Manager

I hereby certify that the foregoing testimony was read to the above subscribed before its signing, that I believe him to be the person he represents himself to be, and that said testimony was subscribed and sworn to before me, at my office in POCATELLO, County of BANNOCK,

State of Idaho, on this 217th day of SEPTEMBER, A. D. 1958.

NOTARY PUBLIC

My commission expires JULY 21, 1960

20611

PROOF OF PUBLICATION

STATE OF IDAHO
County of Bannock

ss.

Darlene Rice

being first duly sworn on oath deposes and says: That.....She.....
was at all times herein mentioned a citizen of the United States of
America, more than 21 years of age, and the Principal Clerk of THE
IDAHO STATE JOURNAL, a daily newspaper, printed and published at
Pocatello, Bannock County, Idaho, and having a general circulation
therein.

That the document or notice, a true copy of which is attached, was
published in the said IDAHO STATE JOURNAL, on the following dates,
to-wit:

June 26....., 19 58....., 19.....
July 3....., 19 58....., 19.....
July 10....., 19 58....., 19.....
July 17....., 19 58....., 19.....
....., 19....., 19.....

That said paper has been continuously and uninterruptedly pub-
lished in said County for a period of seventy-eight weeks prior to the
publication of said notice or advertisement and is a newspaper within
the meaning of the laws of Idaho.

Darlene Rice

Subscribed and sworn to before me this.....17th.....

day of.....July....., 19 58

G. G. Green

Notary Public, State of Idaho
Residence: Pocatello, Idaho

20611

PROOF OF PUBLICATION

STATE OF IDAHO
County of Bannock

SS.

Legal Advertisement

NOTICE OF PROOF APPLICATION OF WATER TO BENEFICIAL USE

Notice is hereby given that at 10 A.M. on the 15th day of September, 1958, at Pocatello, County of Bannock, State of Idaho, before B. D. Reese, Notary Public, proof will be submitted of the application to beneficial use of 27 cubic feet per second of the waters of Subterranean origin in accordance with the terms and conditions of Permit No. 20611 heretofore issued by the Reclamation Engineer of the State of Idaho.

The name and postoffice address of the person or corporation holding said permit are City of Pocatello, Pocatello, Idaho.

The use to which said water has been applied is Domestic, Municipal Water System.

The amount applied to beneficial use is 27 cfs.

The place where said water is used (if for irrigation, give full and accurate description of the lands irrigated) City of Pocatello, Pocatello, Idaho, with points of diversion as follows: Wells No. 4, 5, 6 & 7 in NW1/4 Sec. 35, No. 8 in NW1/4 SW1/4 Sec. 18; No. 9 in NW1/4 Sec. 27; No. 10 in NE1/4 NW1/4 Sec. 24; all in Twp. 6 So., Rge. 34 E.B.M.; No. 1 in NW1/4 NE1/4 No. 2 & 3 in SW1/4 NE1/4; all in Sec. 1, Twp. 7 So., Rge. 34 E., B.M.

The name of the canal or ditch or other works by which said water is conducted to such place of use is Municipal Water System.

The right to take water from such works is based upon Permit No. 20611.

The source of supply from which such water is diverted is Subterranean origin.

The date of priority which said user is prepared to establish is June 15, 1949.

E. N. HUMPHREY
Deputy State
Reclamation Engineer
June 26, July 3, 10, 17, 1958.

Darlene Rice

being first duly sworn on oath deposes and says: That.....She..... was at all times herein mentioned a citizen of the United States of America, more than 21 years of age, and the Principal Clerk of THE IDAHO STATE JOURNAL, a daily newspaper, printed and published at Pocatello, Bannock County, Idaho, and having a general circulation therein.

That the document or notice, a true copy of which is attached, was published in the said IDAHO STATE JOURNAL, on the following dates, to-wit:

June 26	19.58	19
July 3	19.58	19
July 10	19.58	19
July 17	19.58	19
	19	19

That said paper has been continuously and uninterruptedly published in said County for a period of seventy-eight weeks prior to the publication of said notice or advertisement and is a newspaper within the meaning of the laws of Idaho.

Darlene Rice

Subscribed and sworn to before me this.....17th.....

day of.....July....., 19.58

J. J. [Signature]

Notary Public, State of Idaho
Residence: Pocatello, Idaho

1064

City of Pocatello

POCATELLO, IDAHO

MUNICIPAL BUILDING
P. O. BOX 1489

OFFICE OF
City Manager

September 25, 1958

SEP 26 1958
Department of Reclamation

George N. Carter
State Reclamation Engineer
Boise, Idaho

Re: Your letter of 9-19-58: Discrepancies
in dispositions on Permits 20611 and G 24451

George N. Carter
State Reclamation Engineer
Boise, Idaho

Dear Sir:

The descriptions in the "Disposition of Holder" were
in error, as follows:

1. Descriptions of locations of wells 4, 5, 6, and 7
were reversed with the description of the location
of well #8.
2. (a) The SW NE $\frac{1}{4}$ of Sec. 15, T6S, R33EBM is correct.
2. (b) #13 well at the Golf Course is in the SE $\frac{1}{4}$
of the SE $\frac{1}{4}$ of Sec 1, T7S, R34EBM. The well was
moved during drilling a short distance easterly and
it wasn't realized that a quarter section line had
been crossed.
2. (c) well #15 is correctly located in the ammended permit
as NW $\frac{1}{4}$ SE $\frac{1}{4}$ of Sec 6, T7S, R35EBM.

We are very sorry the forms were not checked more carefully
before they were sent to you.

Thank you,

W. B. Webb
W. B. Webb
City Manager

20611

Enclosures: Corrected Forms
Affidavit from the Notary Public
Proofs of Publication
Amendment to correct location of #13 well

September 30, 1958

Re: Permits No. 20611 and G-24451
City of Pocatello, A Municipal Corporation

Mr. W. B. Webb, City Manager
City of Pocatello
P. O. Box 1489
Pocatello, Idaho

Dear Mr. Webb:

This acknowledges receipt of the Depositions of Holder and two Witnesses, the Affidavits of the Notary Public, and the Affidavits of Publication in The Idaho State Journal in proof of beneficial use under Permit No. 20611 and completion of works and beneficial use under Permit No. G-24451.

Before these permits are licensed, the law requires that a field examination be made by an engineer from this department. At this time we cannot say just when this will be made but our field engineer will contact you prior to the time he is to make the inspection so that you can arrange for someone to accompany him.

Enclosed is the Application for Amendment to Permit No. G-24451 as approved by the State Reclamation Engineer and recorded in the Department of Reclamation in Book 87 of Permits at Page 24451 amending the point of diversion described in permit as in the NW $\frac{1}{4}$ NE $\frac{1}{4}$ of Section 12, Township 7 South, Range 34 East, B.M. to be changed to location in the SE $\frac{1}{4}$ SE $\frac{1}{4}$ of Section 1, Township 7 South, Range 34 East, B.M. This amendment should now be attached to the original permit to which it refers and of which it becomes a part.

Very truly yours,

GEO. W. CARTER
State Reclamation Engineer
By

Chief Clerk

EFR:nls
Enc.

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
BOISE, IDAHO
REPORT OF ENGINEER

Permit No. 20611

This proof is for Beneficial Use

In Water District No. _____

1. Name of applicant City of Pocatello, Idaho

2. Source of water supply: Subterranean

3. Location of point of diversion: Is in the _____ of Section _____

T. _____ R. _____ County of _____

4. Describe works as they exist, giving dimensions and capacities of same: _____

5. Water is used for: Domestic supply for City of Pocatello and adjacent area ✓

6. State whether or not water has been turned into works of diversion: _____

7. List legal subdivisions of lands to be irrigated. If proof is for beneficial use, give exact number of acres under cultivation in each forty-acre tract. (Describe manner and place of use if other than irrigation):

Domestic Water Supply - City of Pocatello ✓

(Submit map on attached plat, showing location and details of above description.)

8. What large stream would the water here appropriated finally reach? _____

Remarks: _____

See Permit G-24427

This examination was made on the 10 day of October, 1958

(Signed) E. N. Humphrey Examiner.

20611

City of Pocatello
W. B. Webb, City Manager

Permit No. 20611

Ex. 1st Lewis 4 blocks west of 5th
Examination for Beneficial Use

County Bannock
See list inside

Qr 54.0 c.f.s.

S = Wells

P.D. = See list inside

Use = Domestic (Municipal)

20611

Filed = June 15, 1948

Due = Sept. 2, 1959

C/W = 5-13-54

INSTRUCTIONS TO EXAMINERS

1. Always carefully note the location of the point of diversion and accurately plat same.
2. When proof is for beneficial use, carefully check up the number of acres actually irrigated in each forty and accurately plat same.
3. Make a map showing the correct location of streams and ditches, and the irrigated lands, and any adjacent permanent landmarks, such as towns, lakes, large streams and public roads.
4. If any unusual conditions are discovered, make plain statement of them under remarks.
5. Always see the holder, if possible, and go over the whole ground with him and make your report only upon actual existing facts and conditions.
6. Give general characteristics of soils, topography, and crops raised.

RECEIVED
OCT 30 1958

Department of Irrigation

**1 abandoned. May want to
change P.D. To*

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
BOISE

REPORT OF ENGINEER

PERMIT NO. 20611

REPORT ON PROOF OF BENEFICIAL USE

City of Pocatello, A Municipal Corporation
P. O. Box 1489
Pocatello, Idaho

Appl. 54 c.f.s.
C/W.. 21 c.f.s.

20611

R-34E.

15

⊙ No. 8

US Highway 191

22

⊙ No. 10

T.
6
S.

27

⊙ No. 9

26

35

Nos. 4, 5, 6, 7

36

T.
7
S.

3

2

No. 1. ⊙
No. 2. ⊙
No. 3. ⊙

C/W has been issued for 21 cfs on May 15-1954
allow license for 21 cfs.

REPORT OF ENGINEER

Permit No. 20611

This proof is for Beneficial Use

In Water District No. _____

1. Name of applicant City of Pocatello, Idaho

2. Source of water supply: Subterranean

Points of Diversion - City of Pocatello

✓ Wells #1, 2 & 3 - Ross Park -
Center of NE $\frac{1}{4}$ Section 1, Township 7 South, Range 34 East, B.M.

✓ Wells # 4, 5, 6 & 7 - Rainey Park -
NW $\frac{1}{4}$ SE $\frac{1}{4}$ Section 35, Township 6 South, Range 34 East, B.M.

✓ Well #8 - No. Pocatello Park
NW $\frac{1}{4}$ SW $\frac{1}{4}$ Section 15, Township 6 South, Range 34 East, B.M.

✓ Well #9 - Raymond Park
Blk. 557 Original Pocatello Townsite
NW. SE., Sec. 27, T. 6 S., R. 34 E.

✓ Well #10 - Tydeman Field
Lot 1, Blk 219, Original Pocatello Townsite
NE. NW., Sec. 26, T. 6 S., R. 34 E.

As shown on map attached to depositions. 9/10

or acres under cultivation in each forty-acre tract. (Describe manner and place of use if other than irrigation):

Domestic Water Supply - City of Pocatello

(Submit map on attached plat, showing location and details of above description.)

8. What large stream would the water here appropriated finally reach? _____

Remarks: _____

See Permit G-24427

This examination was made on the 10 day of October, 1958

(Signed) E. N. Humphrey Examiner.

20611

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
BOISE, IDAHO

Permit No. 20611

Proof of Application of Water to Beneficial Use

Deposition of Witness

The deposition of two witnesses, on this form, taken separately, required in each case.

Ques. 1. State your name, age, residence, occupation and postoffice address.

Ans. John D. Perkins, Age 40, 248 South 11th, Pocatello, Idaho
Chief of Police, Pocatello, Idaho

Ques. 2. Are you acquainted with City of Pocatello, the holder of Permit No. 20611? How long have you known him and where does he reside?

Ans. Yes

Ques. 3. Have you read or heard read said Permit No. 20611, and are you familiar with its provisions and conditions?

Ans. Yes

Ques. 4. State source of water supply, place of diversion, and describe works for conveying water from point of diversion to place of use.

Ans. Waters of subterranean origins, Wells and pumps into the City of Pocatello Water Distribution System

(See disposition of holder)

Ques. 5. How many second feet of water do you estimate said works will safely conduct to place of use, and how much water have you seen being so conveyed?

Ans. Varies with demand, exceeds 27 cfs

Ques. 6. (Pumps) How much water in cubic feet per second, miner's inches, or gallons per minute have you seen the pump deliver, and how did you measure or estimate the amount?

Ans. 27 cfs (metered)

20611

Ques. 7. State for what purpose water is used and at what place. (If for irrigation, give each subdivision in which water has been used and number of acres irrigated in each subdivision.) State whether cultivated or natural meadow land and the nature of all improvements which have been made as a direct result of said use.

Ans. City of Pocatello domestic water supply

Ques. 8. If for power or other purposes than irrigation, state how water has been applied and to what extent.

Ans. City of Pocatello domestic water supply

Ques. 9. (If for irrigation) state character of land that has been reclaimed, and give your estimate of the amount of water required for its profitable cultivation.

Ans. Not app

Ques. 10. Have you any interest in the works, water or lands above mentioned? If so, in what way and to what extent?

Ans. As a resident of Pocatello and user of water only

Ques. 11. State when, how, in what amount and to what extent you have witnessed the application to beneficial use of water diverted under said permit.

Ans. Have seen pumps in operation etc.

(Signed)

John Perkins

I hereby certify that the foregoing testimony was read to the above subscriber before its signing, that I believe him to be the person he represents himself to be, and that said testimony was subscribed and sworn to before me in POCATELLO, County of BANNOCK, State of Idaho, on this 17 day of September, A. D. 19 58.

[Signature]

Notary Public.

My commission expires July 21, 1960

20611

**STATE OF IDAHO
DEPARTMENT OF RECLAMATION
BOISE, IDAHO**

Permit No. 20611

Proof of Application of Water to Beneficial Use

Deposition of Witness

The deposition of two witnesses, on this form, taken separately, required in each case.

Ques. 1. State your name, age, residence, occupation and postoffice address.

Ans. Glenn Hadley, Age 44, 408 N 10, Pocatello, Idaho
Chief of Detectives, City Police, Pocatello, Idaho

Ques. 2. Are you acquainted with City of Pocatello, the holder of Permit No. 20611? How long have you known him and where does he reside?

Ans. Yes

Ques. 3. Have you read or heard read said Permit No. 20611, and are you familiar with its provisions and conditions?

Ans. Yes

Ques. 4. State source of water supply, place of diversion, and describe works for conveying water from point of diversion to place of use.

Ans. Waters of subterranean origins. Wells and pumps into the
City of Pocatello water distribution system

(See disposition of holder)

Ques. 5. How many second feet of water do you estimate said works will safely conduct to place of use, and how much water have you seen being so conveyed?

Ans. Varies with demand exceeds 27 cfs

Ques. 6. (Pumps) How much water in cubic feet per second, miner's inches, or gallons per minute have you seen the pump deliver, and how did you measure or estimate the amount?

Ans. 27 cfs (metered)

20611

Ques. 7. State for what purpose water is used and at what place. (If for irrigation, give each subdivision in which water has been used and number of acres irrigated in each subdivision.) State whether cultivated or natural meadow land and the nature of all improvements which have been made as a direct result of said use.

Ans. City of Pocatello Domestic Water Supply

Ques. 8. If for power or other purposes than irrigation, state how water has been applied and to what extent.

Ans. City of Pocatello Domestic Water Supply

Ques. 9. (If for irrigation) state character of land that has been reclaimed, and give your estimate of the amount of water required for its profitable cultivation.

Ans. Not app

Ques. 10. Have you any interest in the works, water or lands above mentioned? If so, in what way and to what extent?

Ans. As a resident of Pocatello and user of water only

Ques. 11. State when, how, in what amount and to what extent you have witnessed the application to beneficial use of water diverted under said permit.

Ans. Have seen pumps in operation etc.

(Signed)

Glenn Hadley

I hereby certify that the foregoing testimony was read to the above subscriber before its signing, that I believe him to be the person he represents himself to be, and that said testimony was subscribed and sworn to before me in POCATELLO, County of BANNOCK, State of Idaho, on this 17th day of September, A. D. 1958.

[Signature]
Notary Public.

My commission expires JULY 21, 1960

20611

Permit 20611

Wells		Location	Output	Trans	Wks	Depth	Static Lvl	Casing	Metered?
City of	Poca #1	Center of	2.22 cfs	City of		74'	35'	16"	Yes
"	"	# 2 { NE $\frac{1}{4}$ of Sec 1,	3.12	Pocatello		82	34-35	16	Yes
"	"	# 3 { T7S, R34EBM	3.12	Dist Sys		106	35	18-16	Yes
"	"	# 4 { NW $\frac{1}{4}$ SE $\frac{1}{4}$ of	2.22	Line to		120	30-34	16	Yes
"	"	# 5 { 35-6-34	2.22	City of		85 $\frac{1}{2}$	25-30	16	Yes
"	"	# 6 {	2.22	Pocatello		87 $\frac{1}{2}$	25 $\frac{1}{2}$	20	Yes
"	"	# 7 {	2.22	Reservoir		105	22-27	20	Yes
"	"	# 8 NW $\frac{1}{4}$ SW $\frac{1}{4}$ 15-6-34	3.33	City Dist Sys		320	35-38	20-16	Yes
"	"	# 9 Poca orig twnte	1.00	"	"	100	11-14	20	Yes
		Block # 557							
"	"	# 10 Lot 1, Blk 219,							
		orig Poca Tste	5.33	"	"	350	38-44	20	Yes

AFFIDAVIT

I, B. D. REESE, NOTARY PUBLIC FOR STATE OF IDAHO, RESIDING
AT POCA TELLO, IDAHO DO HEREBY CERTIFY THAT MY OFFICE WAS OPEN
DURING THE HOURS OF 9:00 AM TO 5:00 PM SEPTEMBER 16, 1958, FOR
THE FILING OF PROTESTS IN CONNECTION WITH PERMITS NO. 20611 AND
G-24451, "TO APPROPRIATE THE SUBTERRANEAN WATER OF THE STATE OF
IDAHO", BY THE CITY OF POCA TELLO, AND THAT NO PROTESTS WERE FILED
EITHER ORALLY OR IN WRITING.

(SIGNED)


B. D. REESE

POCA TELLO, IDAHO
SEPT 24, 1958

20611

September 19, 1958

Re: Permit No's - 20611 and G-24451

Mr. W. B. Webb
City Manager
P. O. Box 1489
Pocatello, Idaho

Dear Mr. Webb:

Reference is made to your letter of September 17, 1958, enclosing depositions in Proof of Beneficial Use on Permit No. 20611 and Completion of Works and Beneficial Use on Permit No. G-24451.

In checking these depositions, we find the following discrepancies.

1. Permit No. 20611 describes the location of wells 4, 5, 6 and 7 in the NW $\frac{1}{4}$ SE $\frac{1}{4}$ Section 35, Township 6 South, Range 34 East, B. M., and well No. 8 in the NW $\frac{1}{4}$ SW $\frac{1}{4}$ of Section 15, Township 6 South, Range 34 East. These descriptions seem to be reversed in Question 4 and 6 in the deposition of holder.
- 2(a) Permit No. G-24451 describes the well at the Army Air Base as in the SW $\frac{1}{4}$ NE $\frac{1}{4}$ of Section 15, Township 6 South, Range 33 East, whereas your depositions give it in the SW $\frac{1}{4}$ NE $\frac{1}{4}$ of Section 10, Township 6 South, Range 33 East, B. M.
- 2(b) Permit No. G-24451 describes well No. 13 (Golf Course) in the NW $\frac{1}{4}$ NE $\frac{1}{4}$ of Section 12, Township 7 South, Range 34 East, B. M., but the map with the permit shows it in the NE $\frac{1}{4}$ NE $\frac{1}{4}$ of Section 12 - (which is correct)?
- 2(c) The permit shows well No. 15 (Palmer Tracts) in the NW $\frac{1}{4}$ SE $\frac{1}{4}$ of Section 6, Township 7 South, Range 35 East, B. M., whereas your depositions show it in Township 33 South. We note that this is an amended tract and we are enclosing a form of Application for Amendment herewith, to be executed and returned to this department for approval and record.

20611

W. B. Webb

-2-

September 19, 1958

C
O
P
Y

If the other discrepancies mentioned are errors in the depositions they may be corrected, otherwise amended applications will also be necessary.

Question (4) of the depositions of the witnesses are incomplete in that they do not give the points of diversion, however, since this is answered in detail in the depositions of the holder, all that is necessary will be to have the depositions of the witnesses refer to the answers of the holder.

Affidavit of publication in the Idaho Journal are a part of the publication and should accompany the depositions.

Since the published notice set September 16th as the date set for making proofs, and the depositions are dated September 17th, it will be necessary for the Notary Public to furnish affidavits to the effect that his office was open at the time set for proofs and that no protests were filed (if such is the case).

Very truly yours,

GEO. N. CARTER
State Reclamation Engineer
By

Mrs. Edna P. Rutledge
Chief Clerk

EPR:lw
Enclosures

Depositions of Holder & 2 Witnesses - Permit No. 20611
Depositions of Holder & 2 Witnesses - Permit No. G-24451
Application for Amendment

20611

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
BOISE, IDAHO

Date: June 20, 1958

Re: Permit No. 20611
City of Pocatello
Idaho State Journal
Pocatello, Idaho

Gentlemen:

Enclosed you will find notice for publication once a week for four consecutive weeks prior to **September 16, 1958** the date set for proof; the expense of the publication is to be paid by the applicant,

City of Pocatello of Pocatello, Idaho **W. B. Webb**
City Manager
to whom you should furnish proof of publication on or prior to the date set for proof.

Please acknowledge receipt of this notice and furnish this office with a copy of the first publication.

Very truly yours,

E. N. Humphrey
Deputy State Reclamation Engineer
By

Roy W. Thompson
Office Manager

20611
RWT:lw
Encls.

June 20, 1958

Re: Permit No. 20611
City of Pocatello

Mr. A. B. Webb
City Manager
City of Pocatello
Pocatello, Idaho

20611

Dear Mr. Webb:

This acknowledges the Notice of Proof of Application of Water to Beneficial Use under Permit No. 20611. This proof is to be made on the 16th day of September, 1958, at 10:00 A. M., before B. D. Reese, Notary Public.

As of this date, we have mailed the Notice to the Idaho State Journal, with instructions to publish it once a week for four consecutive weeks prior to the date set for final proof and then to mail the affidavit of publication and statement of costs to you.

It is important that the enclosed depositions be executed by you and two disinterested witnesses, who are familiar with the terms of the Permit and the work done thereunder, at the place, on the date, at the time and before the Notary as advertised. It is very important and necessary that each question be answered in detail.

In returning the depositions to this office, be sure that all copies have been signed, the Notary's seal has been placed on each and all depositions (holder and two witnesses) are being returned. Also be sure to enclose the Affidavit of Publication.

Very truly yours,

E. N. HUMPHREY
Deputy State Reclamation Engineer
By

Roy W. Thompson
Office Manager

RWT:lx

Encls. -3

cc: B. D. Reese, Notary Public

June 20, 1958

Re: Permit No. 20611
City of Pocatello

Mr. W. B. Webb
City Manager
City of Pocatello
Pocatello, Idaho

Dear Mr. Webb:

In reply to your inquiry under date of July 13, 1958, we are enclosing herewith, four Form No. 3's for your use in filing on subterranean water. We are sending a few extra in case you may be needing them.

In connection with your Well N . 3 which you say that you requested of this department to have same increased from 3.12 cubic feet per second to 4.0 cubic feet per second, stating that at the time you made application for the increase of water from this well that you amendment was denied due to the fact your Proof of Completion of Works had already been made.

You may file on excess water on this well along with the waters of the new well which you anticipate filing on, however, we cannot give you the priority date of June 15, 1948 on excess water in this well, therefore it will be necessary for you to take a priority of the date your new application for filing is received in this department.

Very truly yours,

E. W. HUMPHREY
Deputy State Reclamation Engineer
By

Roy W. Thompson
Office Manager

RWT:lw
Enclosures

20611

RECEIVED
JUN 19 1958
Department of Reclamation

NOTICE TO ACCOMPANY THIS LETTER MUST BE MADE IN DUPLICATE

(Date) June 13, 1958

(P. O.) Pocatello, Idaho

TO THE STATE RECLAMATION ENGINEER:

Boise, Idaho

Dear Sir:

You are hereby authorized to have the attached notice published at my expense in the

IDAHO STATE JOURNAL of POCATELLO, IDAHO published in

the county in which the works are situated.

Bannock Co. ✓

W. B. Webb
W. B. Webb, City Manager
City of Pocatello, Idaho

(In case of canals or other works designed to divert and carry more than 50 cubic feet of water per second, the following certificate must be signed by a well known and competent engineer.)

I hereby certify that the facts set forth in the attached notice are true.

Engineer.

20611

RECEIVED

JUN 19 1958

NOTICE FOR PUBLICATION NOTICE OF PROOF APPLICATION OF WATER TO BENEFICIAL USE

Notice is hereby given that at 10 A. M. on the 16th day of September, 1958
at Pocatello, County of Bannock, State of Idaho, before
B. D. Reese, Notary Public, proof will be submitted of the
application to beneficial use of 27 ⁽⁵⁴⁾ cubic feet per second of the waters of Subterranean
origin in accordance with the terms and conditions of Permit No. 20611
heretofore issued by the State Reclamation Engineer of the State of Idaho.

The name and postoffice address of the person or corporation holding said permit are _____

City of Pocatello, Pocatello, Idaho

The use to which said water has been applied is Domestic, Municipal Water System

The amount applied to beneficial use is 27 cfs

The place where said water is used (if for irrigation, give full and accurate description of the lands irrigated)

City of Pocatello, Pocatello, Idaho

CITIZEN'S WATER SYSTEM
→ Wells #4, 5, 6, 7 in NW⁴SE⁴ Sec. 35; #8 in NW⁴SW⁴ Sec. 15; #9 in NW⁴SE⁴ Sec. 27;
#10 in NE⁴NW⁴ Sec. 26, all in T. 6 S. - R. 34 E.; #1 in NW⁴NE⁴; #2, 3 in SW⁴NE⁴, all in Sec. 1, T. 7 S. - R. 34 E.

The name of the canal or ditch or other works by which said water is conducted to such place of use is _____

Municipal Water System

The right to take water from such works is based upon Permit No. 20611

The source of supply from which such water is diverted is Subterranean origins

The date of priority which said user is prepared to establish is June 15, 1948

State Reclamation Engineer.

20611

not

March 28, 1958

Re: Permits Nos. 20611 and G-24451

Mr. W. B. Webb
City Manager
P. O. Box 1489
City of Pocatello
Pocatello, Idaho

Dear Mr. Webb:

In reply to your letter of March 24th, requesting what procedure to follow in showing Proof of Beneficial Use on Permit No. 20611. The status of Permit No. 20611 from the records of this department shows a filing of 54 cubic feet per second. Certificate of Completion of Works was issued in connection with this permit on May 13, 1954. Proof of Beneficial Use is due September 2, 1959.

Before these proofs can be made, the statutory requirement is that notice of intention of proof be published once a week for four consecutive weeks in the County newspaper. For this required information, we have enclosed Form 10, in duplicate, which you are to complete and return. In filling out this form, be sure to include the time of day, the date (allowing for four weeks publication), the name of the town, the address of the place where the depositions will be taken, and, the name of the notary public before whom you will appear to take the depositions of proof (any place convenient for you and your two witnesses), the quantity of water filed on, for what purpose it is to be used, the point or points of diversion and the place of use--by legal land description.

Also enclosed is Form 11, which is the authorization for us to have the notice of proof published in the designated county newspaper at your expense. This is to be returned with Forms 10.

At the time we send the notice to the newspaper, we will also send to you the forms for the depositions of holder and two disinterested witnesses, which are to be executed at the time, on the date set, at the place and before the notary public, as was advertised in the publication of notice.

20611

Mr. W. B. Webb

-2-

March 27, 1958

In completing the Notice of proof for publication, the information should be taken from your permit, including any amendments made in connection with a change of point of diversion or land list which has been recorded in this department. If changes have been made and no amendments are on record, we advise that you request a form for this purpose before your notice is published.

Under Permit No. G-24451, you state that you would like to complete filing on the completed wells which includes wells No. 1, 2, 11, 12, 13, 15 and 18. You state well No. 18, in all probability, will be completed by September 17, 1958, which is the due date for Completion of Works and Beneficial Use. The point of diversion can be amended under Permit No. G-24451 and a form of amendment is enclosed herewith for that purpose.

Since Permit No. G-24451 was approved on September 17, 1953, we have given the maximum time that the work under the terms of this permit is to be completed, therefore, no extension of time in connection with this permit can be granted. The wells not completed by September 17, 1958 can not be proved up on under this permit, therefore, your other alternative would be to re-file.

We wish to explain why different forms are to be used in proving up on Permit No. 20611 and Permit No. G-24451. Under Permit No. 20611, which was that Completion of Works and Beneficial Use proofs could be made separate and a time limit given of five years for making Completion of Works and six additional years for making Beneficial Use Proofs. Under the new statute, (the underground water law), on "G" Permits, Completion of Works and Beneficial Use Proofs are to be made at the same time and on the same forms and the maximum time allowed for making these proofs is five years.

The preliminary steps for making proofs under Permit No. G-24451 is publishing the intent of the applicant to make proofs in four weekly issues of a county newspaper. We are therefore enclosing Form 36 in duplicate and also Form No. 11, which should be filled out and returned to this department at least 40 days prior to the time you wish to make said proofs.

The same procedure appertains to the preparation of these forms as given in the forepart of the letter.

Very truly yours,

MARK R. KUIP
State Reclamation Engineer
By

Roy W. Thompson
Office Manager

PWT:lw

Encls. Amendment
Form 11 (2)
Form 36 (2)
Form 10 (2)

20611

City of Pocatello

POCATELLO, IDAHO

MUNICIPAL BUILDING
P. O. BOX 1489

OFFICE OF

RECEIVED
MAR 25 1958

Department of Reclamation

W. B. Webb
City Manager
March 24, 1958

Mark R. Kulp
State Reclamation Engineer
Boise, Idaho
Dear Sir;

According to our records, filing under permit number G20611 is completed except for the proof of beneficial use which is due on September 2, 1959. What procedure do we follow in showing proof of beneficial use under the permit?

Under permit number G24451, we would like to complete filing on the completed wells which include;

Army Airbase wells 1 and 2

Old Airport well (#11)


City of Pocatello well # 12 (amended location)

Golf Course well (#13)

City of Pocatello Well # 15 (amended location)

In relation to this, the City of Pocatello is now receiving bids for the drilling of a new well at a location approximately 3600' northwestwardly from the diversion point of Well # 18 in permit number G24451. This well may be completed by the completion of works due date, September 17, 1958. Can this diversion point be amended and the well be included under G24451 and an extension of time be secured for the proof of completion of works, if needed, and for the proof of beneficial use?

Very truly yours,



W. B. Webb
City Manager

20611

March 14, 1955

RE: Permits Nos. 20611 and G-24451

City of Pocatello
Municipal Building
220 East Center
Pocatello, Idaho

ATTENTION: Mr. A. W. Probart
Water Department

Dear Mr. Probart:

Reference is made to your letter of March 12 in regard to amendments which you wish to make in the above numbered Permits.

Since proof of completion of works has already been submitted and Certificate of Completion of Works issued on Permit No. 20611 showing a total of 70 inches from Well #3, the amount cannot be changed at the present time.

The location of Well #12 in your Permit No. G-24451 can be amended and we enclose a form of application for such amendment herewith. So far as the amount from this well is concerned, since no definite amount is shown from each well in the Permit application, no amendment will be necessary, but the amount will be determined when proof is submitted and inspection is made by an engineer from this Department.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

Ashll
Enc.

20611

✓
May 11, 1954

RE: Permit No. 20611

Mr. W. B. Webb, City Manager
Pocatello
Idaho

Dear Mr. Webb:

We enclose Certificate of Completion of Works issued on Permit No. 20611 of the City of Pocatello for the diversion of 21 second feet of water from 10 wells for the municipal water supply for the City of Pocatello and adjacent area.

We also enclose departmental receipt No. 26659 for the \$8.30 fee in connection with completion of works.

Very truly yours,

MARK J. KULP
State Reclamation Engineer
By

Chief Clerk

A:hll
Enc.

20611

✓
20611

May 3, 1954

Mr. J. E. Fuger
Water Superintendent
Municipal Building
Pocatello, Idaho

Dear Mr. Fuger:

Thank you very much for the logs of wells No. 4 and No. 5.

Yours truly,

MARK R. KULP
State Reclamation Engineer
By

E. N. Humphrey
Deputy State Reclamation Engineer

H:hll

20611

City of Pocatello

POCATELLO, IDAHO

MUNICIPAL BUILDING
220 EAST CENTER

OFFICE OF Water Supt.

April 29, 1954

RECEIVED
APR 30 1954
Department of Reclamation

Mr. Humphries
State of Idaho
Department of Reclamation
Boise, Idaho


20611

Dear Sir:

Enclosed you will find a summary of well data on the City of Pocatello Wells No. 4 and 5 that you asked for. I hope this information is sufficient.

Yours truly,

CITY OF POCATELLO

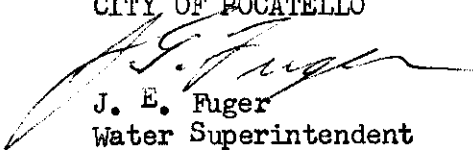
J. E. Fuger
Water Superintendent

20611

✓
April 27, 1954

RE: Permit No. 20611

Mr. W. B. Webb, City Manager
Pocatello
Idaho

Dear Mr. Webb:

We return voucher for the \$8.30 fee in connection with completion of works proof on Permit No. 20611, which has been signed by the State Reclamation Engineer.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A:hl1
Enc.

20611

SUMMARY OF DATA PERTAINING TO CITY OF POCA TELLO WELL NO. 4

April 13, 1954

INTRODUCTION

Well No. 4 is owned and operated by the City of Pocatello Water Department. The water is used for municipal purposes in the City distribution system.

WELL DATA

Location of Well: NW $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 35 (Idaho Street Well Yard)

Well Drilled: June to August, 1931

Well Drilled By: Stephenson Bros.

The Well was drilled to a depth of 120 ft., struck water 28' below surface.

A pit 12' x 14' was dug to a depth of 28 ft. The pit is now filled with gravel and the casing has been extended to within 5' of the surface.

Casing Installed:

<u>From</u>	<u>To</u>	<u>Length</u>	<u>Description</u>
5'	28'	23'	16" O. D.
28'	120'	92'	16" O.D. 70% perforated with mills perforator.

Strata Encountered

<u>From</u>	<u>To</u>	<u>Thickness</u>	<u>Description</u>
0'	20'	20'	Clay with few large boulders and sand streaks.
20'	50'	30'	Coarse gravel and boulders with clay streaks, large quantity of water.
50'	75'	25'	Streaks of clay and boulders, occasional thin layer of sand. Slow drilling.
75'	100'	25'	Soft clay with boulders carrying considerable water. Some streaks of pea gravel
100'	120'	20'	Streaks of clay and gravel, considerable water.

When Well No. 4 is being pumped water in Well No. 5 drops 5" rapidly, then slowly to a total of 1' 2" below its static level.

20611

SUMMARY OF DATA PERTAINING TO CITY OF POCATELLO WELL NO. 5

INTRODUCTION

Well No. 5 is owned and operated by the City of Pocatello Water Department. The Water is used for municipal purposes in the City distribution system.

WELL DATA

Location of Well: NW $\frac{1}{4}$, SE $\frac{1}{4}$ Sec. 35 (Idaho Street Well Yard)
Well Drilled: August to October, 1933.
Well Drilled By: Stephenson Bros.

The Well was drilled to a depth of 100', struck water August 16 at 25' 7" below surface.

Water stands 2 $\frac{1}{2}$ '-2" below surface when Well No. 4 is not being pumped. When No. 4 Well is being pumped water in Well No. 5 drops 5" rapidly then slowly to a total of 1'-2" below its static level.

Casing Installed

Originally	9 $\frac{1}{4}$ ' 8"	16" O. D.	70#
At Present	100'	16" O. D.	

Perforation

72' casing perforated with cutting torch
10 slots $\frac{3}{4}$ " x 3' every 6"

Strata Encountered

<u>From</u>	<u>To</u>	<u>Thickness</u>	<u>Description</u>
0'	20'	20'	Clay with occasional streaks of sand and boulders
20'	25'	5'	Coarse sand and gravel.
25'	36'	11'	Loose boulders and gravel-large quantities of water
36'	59'	23'	Clay and boulders - very hard drilling
59'	67'	8'	Clay and gravel
67'	72'	5'	Streaks pea gravel.
72'	76'	4'	Soft clay
76'	86'	10'	Harder clay and boulders
86'	100'	14'	Softer clay, gravel and boulders, considerable water

20611

✓
April 10, 1954

RE: Permit No. 20611

Mr. W. B. Webb, City Manager
Pocatello
Idaho

Dear Mr. Webb:

We now have on file the report of our field engineer on examination for Completion of Works on Permit No. 20611, and Certificate of Completion of works can be issued for 21 cubic feet per second of water from your wells upon receipt of the statutory fee which amounts to \$8.30 which is at the rate of \$5.00 for the first 10 second feet and thirty cents for each additional second foot.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A:hll

206

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
BOISE, IDAHO
REPORT OF ENGINEER

Permit No. 20611

This proof is for Completion of Works

In Water District No.....

1. Name of applicant City of Pocatello, W. B. Webb, City Manager, Pocatello, Idaho
2. Source of water supply: Subterranean from wells.
3. Location of point of diversion: Is in the See Below of Section _____
T. _____ R. _____ County of Bannock
4. Describe works as they exist, giving dimensions and capacities of same: _____

5. Water is used for: Municipal water supply for Pocatello and adjacent territory.
6. State whether or not water has been turned into works of diversion: _____

7. List legal subdivisions of lands to be irrigated. If proof is for beneficial use, give exact number of acres under cultivation in each forty-acre tract. (Describe manner and place of use if other than irrigation):

Wells are located as follows: No. 1- Ross Park- also Nos. 2 and 3;
Nos. 4,5,6,7,, Rainey Park; No. 8, North Bocatello Park; No. 9- Raymond Park;
No. 10- Tydeman Field.

(Submit map on attached plat, showing location and details of above description.)

8. What large stream would the water here appropriated finally reach?.....

Remarks:.....

This examination was made on the 6 day of April, 1957

(Signed) E. M. Humphrey Examiner

20611

#1 well no pump.
not used since 1933.
18' x 24' x 12' h - rag house
9 windows 2 doors (plastered)
38' 3" = 5.H.

- INSTRUCTIONS TO EXAMINERS**
1. Always carefully note the location of the point of diversion and accurately plat same.
 2. When proof is for beneficial use, carefully check up the number of acres actually irrigated in each forty and accurately plat same.
 3. Make a map showing the correct location of streams and ditches, and the irrigated lands, and any adjacent permanent landmarks, such as towns, lakes, large streams and public roads.
 4. If any unusual conditions are discovered, make plain statement of them under remarks.
 5. Always see the holder, if possible, and go over the whole ground with him and make your report only upon actual existing facts and conditions.
 6. Give general characteristics of soils, topography, and crops raised.

#10 34' x 42' 11"
F.M. notes 250hp.
440V, 292A, 1725rpm.
#376501
96' 2' 6 stage 12"
12" d. col
P.M. 7187 F.M. Pump.
12" dcl. into line
Cutler Hammer Controls
in bldg. 14' x 18' x 10' h.
Concrete & steel bldg
#3. U.S. 75hp. 440V 90a.
1800rpm #215727
Sterling Pump #9317
1760rpm - 1000rpm @ 200'
12' x 12' x 10' h. plastered bldg.
See D panel control
54' 32'
611

City of Pocatello
Pocatello, Idaho
Permit No. 20611
Examination for Completion of Works
County - Blain
15, 26, 27, 35 - 65 - 34E.
- 75 - "

Q = 540 c.f.s.
8 - Wells
#1, 2, 3, in Rose Park, Sec. 1, T. 7S - R. 34E
P.D. - #4, 5, 6, 7 - Ramsey, " 35, 65 -
#8 - " " " " " 15, " "
#9 - " Raymond, " 27, " "
#10 - " " " " " 2, " "

We = Sonnetica

Priority = June 15, 1948
Due = Sept. 2, 1959

Pop. 28000 people.
3306 acres.
Fryer, J. E. water supply.
#2. 76' x 8" col. bridge 8"
G.E. 100hp 440V 120a.
1765rpm - WD6637502
PM 8496 F.M. Pump. Tank.
1000rpm.
8" dcl. to N. inst system
House - wood. 14' x 16' x 8' h. (connect floor. 326' S.S.H.
Weather controls 39' 1/2" mm
91' 500

#9, 14'x14'x18', conc. block
S.H. = 10'10"

Reming Pump, #4492
size 6"-12" stage 73' col.

504hp U.S. Motors 359814

4400V. 61A. 1800 rpm

3500rpm = 4491

4" del. into system

Ag. D & Carter Insurance
contract

#8. 76' col. 6 stage 8"

8" del

1000hp. 440V 121A.

U.S. 1800 rpm 87372A

H. M. Pump.

P.M. 4081

1000gpm pump.

conc. block 16'x16'x10'

373' on new 1-5-4 = S.H.

374' today

5000 000
60

84. approx. 400 inches for
44. (2.66") 200 " #8
S.H. 251 " #10
2.2 " #2 mine
2.2 " #3 1400 ft
22.24 #9

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
BOISE

REPORT OF ENGINEER

PERMIT NO. 20611

new well for

not running #7, 4096

150 hp. V.E. Production

440V, 170A, 1160 rpm

#4809822

well house 14'x14'x14'
S.H. = 213' concrete block
H = 231' now -

Turnbull switches
and controls

74 stage 14"

10" col. 70'

S.H. = 22'2" #6,
23'10" now

Hyson Jackson Pump

BY 16297

G.E. 150hp. 1750 rpm

440V, 175A. Production
5313369

6' col. 6 stage 10"
10" "

Summary No 5 12'x12'x10' concrete block
S.H. = 239' 37'1" depth

Concrete floor.

G.E. motor 440V, 120 amp

100 hp. #W06637504

1765 rpm

Pump = H. M. 6 stage 8"
76' col.

PH 3457 8" col.

8" del to 12" into system
No. 4. not running 1100 rpm

S.H. = 31'6" now 4-5-4
S.H. = 31'6" now 4-5-4

G.E. Production motor

150 hp. 1155 rpm

440V 174A. #4532872

depth 8' 7"

#4025 = Hyson Pump

5' well on for four wells
in 24 hrs. 4-5-6-7.

G.E. Controls

House = deep of #5.

R-34E.

Well #1 = 00."

#2 = 155"

#3 = 70"

#4 =

#5 = } 800"

#6 = }

#7 = }

#8 = 133"

#9 = 40"

#10 = $\frac{252"}{10.50'}$ or 21 # cfs.

15
P.D.
Well No. 8

P.D.
Well No. 10

For Map see filing map.

27
P.D.
Well No. 9

26

27 26
35

26
35

35

P.D. Nos. 4, 5, 6, 7

35

21 36

36

21

16

P.D. Nos. 1 → 0
" 2 → 0
" 3 → 0
Sec.
1

See detail map in permit packet.

T.
6
S.

T.
7
S.

20611.

April 6-54

Points of diversion are correct as listed and shown on their filing map.

All water is used for domestic-industrial-or irrigation within City of Pocatello. Population is listed as over 26000 in census. "Poky" claims 28000.

Area is 3306 acres.

Well #1.

No pump in well - unused since 1930.

Well house is regular dwelling house construction.

Wood - 10' x 24' x 12' h. Seven windows, two doors - plastered
Slaters H is 38' 5". Concrete floor.

Well #2. Operating.

76' x 8" column - 6 stages 8" bowls. Slaters H = 32' 6"
Running H = 39' 1 1/2"

Pump house is wooden construction

Size 14' x 16' x 8' h. Concrete floor.

100 hp. G.E. Motor, 440v., 120 amps, 1765 rpm. # WD 6637502

Fairbanks ~~man~~ well turbine. 8" delivery pipe

1400 gpm. allow 155 inches.

Well #3.

Well house - plastered building - concrete floor. Size 12' x 12' x 10' h.
Slaters H = 32'

75 hp. U.S. Motor - 440v. - 90 amps. 1800 rpm. # 215727

Sterling Pump - turbine # 9317.

Square D panel control.

allow 70 inches

20611

April 6-54

Well #4.

Wells #4-5-6-7 are located close together
and will be rated together. They interfere.

150 hp. G.E. Induction Motor 1155 rpm.

Static H. = 29'8" Mar 4-54

440V. 174A. 453-2872.

operating H. = 31'6" today.

house is 12'x12'x10' h. stucco bldg.

Layne Pump #4025.

14 stage, 14" bowls, 10" x 70' column.

Well #5. Operating

Well house is 12'x12'x10' h. stucco building. Concrete floor.

100 hp. G.E. Motor 440V, 120A.

Static H. = 23'9"

1765 rpm, #W86637504

operating H. = 31'1 3/4"

Fairbanks Morse Pump. #PH 3457

6 stage, 8" bowls, 8" x 76' column. 8" delivery.

Well #6

Static H. = 22'2"

150 hp. G.E. Motor, 440V, 175A., 1750 rpm.

" " = 23'10" now

#5313369.

Byron Jackson Pump. #BY 10297. 6 stages 10" bowls.
10" x 66' column.

Well #7.

Static H. = 21'5"

" " = 23'1" now.

100 hp. G.E. Induction Motor

440V., 170 amps., 1160 rpm, #4009922.

Layne Pump #4096. 14 stages 14" bowls. 10" x 70' column.

Well house is 14'x14'x14' h. concrete floor.

use 75,810,000 gal. in 13 1/6 hrs.

to figure rate.

allow 428" for all four. ??

actually slightly less than 200 inches

4 cfs is max. for one month.

20611

April 6-54

ANNUAL SUMMARY
OF
WATER PRODUCTION
FOR
1953

By: James M. Scardino

INDEX

- A. General Summary of Water Production All Sources
- B. Well Water Monthly Production of Each Source of Supply
- C. Surface Water Monthly Production.
- D. Percent of Each Source of Supply Contribution To Monthly Production
- E. Pump Data Based On 1953 Installations and Well Ratings Based On "Ground Water Filings."
- F. Average Gallon Per Day Production And Potential Gallon Per Day Increase For Each Month With Present Facilities
- G. Storage Facilities Classified

20611

A. General Summary of Water Production All Sources.

<u>Month</u>	<u>Surface Water</u>	<u>Well Water</u>	<u>Total</u>
January	47,124,000	75,455,000	122,579,000
February	54,256,000	55,500,000	109,756,000
March	54,234,000	71,163,000	125,397,000
April	61,388,000	98,800,000	160,188,000
May	79,877,000	113,374,000	193,251,000
June	98,732,000	158,567,000	257,299,700
July	100,494,000	275,333,500	375,827,500
August	77,029,000	270,226,300	347,255,300
September	55,017,000	196,967,700	251,984,700
October	54,830,000	103,222,100	158,052,100
November	52,522,000	48,843,000	101,365,000
December	65,237,000	48,970,000	114,207,000
Totals	800,740,000	1,516,422,300	2,317,162,300

B. Well Water Monthly Production of Each Source of Supply.

WELL NO. 1

Rated Capacity 1000 gpm

Inactive Since 1950.

WELL NO. 2

Rated Capacity 1400 gpm

<u>Month</u>	<u>Actual Production Gal. Per Month</u>	<u>Hours Pumped</u>	<u>Rated Capacity Gal. Per Month</u>
January	45,196,000	739	62,496,000
February	40,873,000	684	56,448,000
March	45,415,000	744	62,496,000
April	44,803,000	720	60,480,000
May	47,604,000	744	62,496,000
June	46,143,000	720	60,480,000
July	48,064,000	744	62,496,000
August	47,764,000	744	62,496,000
September	45,858,000	720	60,480,000
October	46,582,000	744	62,496,000
November	43,578,000	720	60,480,000
December	44,993,000	744	62,496,000
Totals	546,873,000	8767	735,840,000

20611

WELL NO. 3

Rated Capacity 1400 gpm

<u>Month</u>	<u>Actual Production Gal. Per Month</u>	<u>Hours Pumped</u>	<u>Rated Capacity Gal. Per Month</u>
January	None		62,496,000
February	None		56,448,000
March	None		62,496,000
April	None		60,480,000
May	6,364,000	150	62,496,000
June	9,966,000	312	60,480,000
July	24,339,000	744	62,496,000
August	27,335,000	720	62,496,000
September	13,013,000	450	60,480,000
October	None		62,496,000
November	None		60,480,000
December	None		62,496,000
Totals	81,017,000	2376	735,840,000

Wells Nos. 4, No. 5, No. 6, No. 7
Rated Capacity 4000 gpm

<u>Month</u>	<u>Actual Production Gal. Per Month</u>	<u>Hours Pumped</u>	<u>Rated Capacity Gal. Per Month</u>
January	30,259,000	456	178,560,000
February	14,627,000	216	161,280,000
March	25,748,000	432	178,560,000
April	53,997,000	960	172,800,000
May	57,073,000	928	178,560,000
June	49,612,000	822	172,800,000
July	75,810,000	1316	178,560,000
August	74,693,000	1308	178,560,000
September	50,895,000	940	172,800,000
October	32,572,000	534	178,560,000
November	5,265,000	87	172,800,000
December	3,977,000	72	178,560,000
Totals	474,528,000	8071	2,102,400,000

20611

WELL NO. 8
Rated Capacity 1500 gpm

<u>Month</u>	<u>Actual Production Gal. Per Month</u>	<u>Hours Pumped</u>	<u>Rated Capacity Gal. Per Month</u>
January	None		66,960,000
February	None		60,480,000
March	None		66,960,000
April	None		64,800,000
May	None		66,960,000
June	5,666,700	105	64,800,000
July	41,901,500	700	66,960,000
August	44,609,300	744	66,960,000
September	38,905,700	640	64,800,000
October	10,756,100	180	66,960,000
November	None		64,800,000
December	None		66,960,000
Totals	141,839,300	2369	788,400,000

WELL NO. 9
Rated Capacity 450 gpm

<u>Month</u>	<u>Actual Production Gal. Per Month</u>	<u>Hours Pumped</u>	<u>Rated Capacity Gal. Per Month</u>
January	None		20,088,000
February	None		18,144,000
March	None		20,088,000
April	None		19,440,000
May	2,333,000	72	20,088,000
June	11,530,000	432	19,440,000
July	17,173,000	744	20,088,000
August	17,170,000	720	20,088,000
September	None		19,440,000
October	None		20,088,000
November	None		19,440,000
December	None		20,088,000
Totals	48,206,000	1968	236,520,000

20611

WELL NO. 10

Rated Capacity 2400 gpm

<u>Month</u>	<u>Actual Production Gal. Per Month</u>	<u>Hours Pumped</u>	<u>Rated Capacity Gal. Per Month</u>
January	None		107,136,000
February	None		96,768,000
March	None		107,136,000
April	None		103,680,000
May	None		107,136,000
June	35,650,000	285	103,680,000
July	68,046,000	500	107,136,000
August	58,655,000	430	107,136,000
September	48,296,000	402	103,680,000
October	13,312,000	112	107,136,000
November	None		103,680,000
December	None		107,136,000
Totals	223,959,000	1729	1,261,440,000

NOTATION: Actual production in gal. per month and hours pumped are based on Merrill Fore's monthly water production reports. Rated Capacity in gal. per month is based on State of Idaho "Ground Water Filings."

C. Surface Water Monthly Production

	<u>Gal. Per Mo.</u>	<u>Production Gal. Per Min.</u>
January	47,124,000	1055 gpm
February	54,256,000	1345 "
March	54,234,000	1215 "
April	61,388,000	1420 "
May	79,877,000	1790 "
June	98,732,000	2285 "
July	100,494,000	2250 "
August	77,029,000	1725 "
September	55,017,000	1270 "
October	54,830,000	1230 "
November	52,522,000	1215 "
December	65,237,000	1460 "
Total	800,740,000	18,260
Average	66,730,000	1520 GPM

20617

D. Percent Each Source of Supply Contributes to Monthly Production

	<u>Surface Waters</u>	<u>Well No. 2</u>	<u>Well No. 3</u>	<u>Wells Nos. 4, 5, 6 & 7</u>	<u>Well No. 8</u>	<u>Well No. 9</u>	<u>Well No. 10</u>
January	38%	37%		25%			
February	49%	37%		14%			
March	43%	36%		21%			
April	38%	28%		34%			
May	41%	25%	3%	29%		2%	
June	38%	18%	4%	19%	2%	5%	14%
July	26%	13%	7%	20%	11%	5%	18%
August	22%	13%	9%	21%	13%	5%	17%
September	22%	18%	5%	20%	11%		19%
October	35%	29%		21%	7%		8%
November	52%	43%		5%			
December	57%	39%		4%			
Average	38%	28%	6%	22%	9%	4%	15%
Maximum	57%	39%	9%	34%	13%	5%	18%
Minimum	22%	13%	3%	4%	2%	2%	8%

E. Pump Data Based On 1953 Installation and Well Ratings Based on "Ground Water Filings."

	<u>Horsepower</u>	<u>Pump Rating</u>	<u>Capacity</u>	<u>Well Rating</u>
Well No. 1	Inactive			1000 gpm
Well No. 2	100 HP Fairbanks Morse		1000 gpm	1400 gpm
Well No. 3	75 HP Sterling		1000 gpm	1400 gpm
Well No. 4	150 HP Layne Bowler		1100 gpm	1000 gpm
Well No. 5	100 HP Fairbanks Morse		1000 gpm	1000 gpm
Well No. 6	150 HP Byron Jackson		1000 gpm	1000 gpm
Well No. 7	150 HP Layne Bowler		1100 gpm	1000 gpm
Well No. 8	100 HP Fairbanks Morse		1000 gpm	1500 gpm
Well No. 9	50 HP Deming		450 gpm	450 gpm
Well No. 10	250 HP Fairbanks Morse		2400 gpm	2400 gpm

Fremont Street Pumping Station

- 1 ea. 100 HP Fairbanks Morse - Capacity 1000 gpm
- 2 ea. 60 HP Fairbanks Morse - Capacity 500 gpm

NOTATION: Pump installations in wells are deep well turbine type pumps and the installations at Fremont Street are centrifugal type pumps

20611

F. Average Gallon Per Day Production and Potential Gallon Per Day Increase For Each Month With Present Facilities.

<u>Month</u>	<u>Average Production Gal. Per Day</u>	<u>Potential Increase Gal. Per Day</u>
January	3,950,000	10,990,000
February	3,920,000	11,020,000
March	4,060,000	10,880,000
April	5,340,000	9,600,000
May	6,230,000	8,710,000
June	8,580,000	6,360,000
July	12,120,000	2,820,000
August	11,200,000	3,740,000
September	8,400,000	6,540,000
October	5,100,000	9,840,000
November	3,380,000	11,560,000
December	3,680,000	11,260,000

Notation: The Potential Increase GPD represents average amount of water that was available over the demand for each month during 1953.

G. Storage Facilities Classified

1. Open Reservoir No. 1	Capacity	900,000 gallons
2. Open Reservoir No. 2	Capacity	1,500,000 Gallons
3. Open Reservoir No. 3	Capacity	2,000,000 gallons
4. Open Reservoir No. 4	Capacity	11,000,000 gallons
5. West Bench Steel Tank	Capacity	300,000 gallons
6. East Bench Steel Tank	Capacity	300,000 gallons

20611

March 27, 1954

RE: Permit No. 20611

City of Pocatello
Pocatello
Idaho

Gentlemen:

State law requires an inspection of any permit being brought to license. I intend to make inspection in connection with this permit No. 20611 on April 6.

Please have your City Engineer or someone familiar with the works accompany me on this inspection.

Yours truly,

MARK R. KULP
State Reclamation Engineer
By

Elmer Humphrey
Deputy State Reclamation Engineer

H:hll

20611

✓
February 10, 1954

RE: Permit Nos. 20611 & G-24451

Mr. J. N. Scardino
Water Department
City of Pocatello
Pocatello, Idaho

Dear Mr. Scardino:

In reply to your letter of February 9, our records show the following:

Permit No. - 20611
Application No.-28180
Priority date-June 15, 1948
Proof of completion of Works due-September 2, 1953
Proof of Beneficial Use due-September 2, 1959

Permit No. - G-24451
Application No.-G-32248
Priority date-September 1, 1953
Proof of Completion of Works due-September 17, 1958
Proof of Beneficial Use Due- September 17, 1958

These permits contain no reference to the district number.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A:hll

20611

City of Pocatello

POCATELLO, IDAHO

MUNICIPAL BUILDING
220 EAST CENTER

OFFICE OF

February 9, 1954

Mr. Mark R. Kulp
State Reclamation Engineer
Boise, Idaho

Dear Mr. Kulp:

Please forward the following information regarding applications for permits to appropriate subterranean waters:

Application for Permit - June 15, 1948
Application No. - Unknown 24180
Permit No. 20611
District No. - Unknown ✓
Priority Date - June 15, 1948
Proof of Completion of Works Due - Sept. 2, 1953 —
Proof of Beneficial Use Due - Sept. 2, 1959

Application for Permit - August, 1953 9-1-53
Application No. - Unknown 9 322.18
Permit No. - Unknown 4 2115-1
District No. - Unknown
Priority Date - Unknown 9-1-53
Proof of Completion of Works Due - Unknown 9-17-58
Proof of Beneficial Use Due - Unknown "

Please check the information that we have listed in addition to sending the remaining data.

Thank you.

Yours truly,

J. N. Scardino
J. N. Scardino
Water Department

RECEIVED
FEB 10 1954
Department of Reclamation

20611

SUMMARY OF DATA PERTAINING TO
CITY OF POCASTELLO WELL NO. 10
JANUARY 1954

By: James N. Scardino

INTRODUCTION

The City of Pocatello Well No. 10 (Tydeman Field Well) is owned and operated by the Pocatello Water Department. The water is used for domestic purposes in the City distribution system.

The well site proved to be a very satisfactory location, establishing a potential productive well field. (See test pumping data).

The drilling in the water bearing coarse gravel and boulders was very difficult. The hole was started 3 times, summarized as follows:

- 5-10-52 First drilling started.
- 5-20-52 First drilling stopped because bottom of casing broke.
All but the bottom 16 feet recovered.
- 5-25-52 Second drilling started, relocated approximately 5 ft.
north of first drilling.
- 5-28-52 Second drilling stopped at 40 ft. because casing going
in at an angle. The casing was pulled and hole caved in.
- 6-12-52 Third drilling started in same location and continued down
to complete the well.

Notation: Casing was slightly out of line in completed well.

The following is a summary of the data pertaining to Well No. 10.

WELL DATA

Location of Well: NE corner of Block 219 Original Pocatello Townsite, in N $\frac{1}{2}$ NE $\frac{1}{4}$
NW $\frac{1}{4}$ Sec. 26; T. 6 S.; R. 31 E.B.M.

Well drilled by: A. J. Schoonover.

Well started May 10, 1952 and completed September 15, 1952.

The Well was drilled to a depth of 350 feet and cased to a depth of 339 feet.

28.6.11

Casing installed:

<u>From</u>	<u>To</u>	<u>Length</u>	<u>Description</u>
0'	100'	100'	20" O.D. 3/8" wall thickness standard seamless steel pipe.
94'	100'	6'	20" & 16" casing overlaps
94'	339'	245'	16" O.D. 3/8" wall thickness standard seamless steel pipe.

Perforated casing:

<u>From</u>	<u>To</u>	<u>Remarks</u>
57'	90'	33' of 470 perforations in 20" casing cut 1/2" x 6" 10 to a round of 47 sets.
90'	98'	8' of no perforations allowed for casing overlap.
98'	107'	9' of 80 perforations in 16" casing cut 1/2" x 6" 8 to a round of 10 sets.
107'	119'	12' of no perforations allowed for clay horizon
119'	155'	36' of 336 perforations in 16" casing cut 1/2" x 6" 8 to a round of 42 sets.

Static level of water was recorded at 38 ft. 7-3/4 inches below floor level or at an elevation of 4424.1 September 13, 1952.

(Note: All measurements are referenced to pump house floor level elevation 4462.7 feet).

DEVELOPMENT AND TEST PUMP

The development and test pumping of the well consisted of a continuous 12 hour pumping period, a 35 hour rest period, and a second continuous 12 hour pumping period. Results were as follows:

Sept. 13, 1952 First continuous 12 hour pumping period averaged 2075 gallons per minute with a 4-3/4" drawdown.
Sept. 15, 1952 Second continuous 12 hour pumping period averaged 1835 gallons per minute with a 3 1/2" drawdown

Maximum water pumped recorded 2240 gallons per minute with a 5 1/4" drawdown.

210611

RECORD OF FIRST CONTINUOUS PUMPING PERIOD
SEPTEMBER 13, 1952

<u>Time</u>	<u>Rate of Discharge</u>	<u>Static Level</u>	<u>Running Level</u>	<u>Drawdown</u>
8:20 AM	2240 gpm	38' 7-3/4"		
8:38	" "			
8:50	" "		39' 1/2"	4-3/4"
9:02	" "		"	"
9:10	" "		"	"
9:21	" "		39' - 1"	5-1/4"
9:32	2220 gpm		39'	4-1/4"
10:00	" "		39' - 1"	5-1/4"
10:37	" "		39'	4-1/4"
10:58	2240 gpm		39' - 1/2"	4-3/4"
11:32	" "		39'	4-1/4"
12:06 PM	" "		39'	4-1/4"
12:24	2220 gpm		39'	4-1/4"
12:48	" "		39'	4-1/4"
1:05	2240 gpm		39' - 1/2"	4-3/4"
1:41	2220 gpm		39'	4-1/4"
2:00	2240 gpm		39'	4-1/4"
2:45	2220 gpm		39' - 1/2"	4-3/4"
3:00	" "		39' - 1/2"	4-3/4"
3:34	" "		39' - 1/2"	4-3/4"
3:47	" "		39' - 1/2"	4-3/4"
4:48	" "		39' - 1"	5-1/4"
5:14	" "		39' - 1"	5-1/4"
6:02	" "		39' - 1/2"	4-3/4"
6:44	" "		39' - 1"	5-1/4"
7:00	" "		39' - 1 1/4"	5-1/2"

RECORD OF SECOND CONTINUOUS PUMPING PERIOD
SEPTEMBER 15, 1952

7:32 AM	2050 gpm	38' 7-3/4"	38' - 11 1/2"	3-3/4"
7:51	" "	"	"	"
7:57	" "	"	39'	4-1/4"
8:54	1980 gpm	"	38' - 11 1/2"	3-3/4"
9:42	" "	"	39'	4-1/4"
10:00	" "	"		
10:45	" "	"	38' - 11 1/2"	3-3/4"
11:08	" "	"	"	"
11:30	1900 gpm	38' 7-3/4"		
11:37	" "	"	38' - 11 1/4"	3-1/2"
11:45	" "	"	38' - 11-3/8"	3-5/8"
11:51	" "	"	38' - 11-1/8"	3-3/8"
11:55	" "	"	"	"
12:03 PM	1775 gpm	"	38' - 10-7/8"	3-1/8"
12:06	" "	"	38' - 10-5/8"	2-7/8"
12:53	" "	"	38' - 10-3/4"	3"
1:03	" "	"	38' - 10-5/8"	2-7/8"
1:09	" "	"	38' - 10 1/2"	2-3/4"

RECORD OF SECOND CONTINUOUS PUMPING PERIOD
SEPTEMBER 15, 1952

<u>Time</u>	<u>Rate of Discharge</u>	<u>Static Level</u>	<u>Running Level</u>	<u>Drawdown</u>
1:11 PM	1900 gpm	38' - 7-3/4"	38' - 11-1/8"	3-3/8"
1:16	" "	38' - 7-3/4"		
1:32	" "	38' - 7-3/4"		
2:04	" "	" "	38' - 11-1/8"	3-3/8"
2:12	" "	" "	" "	"
2:25	" "	" "	38' - 11-3/8"	3-5/8"
3:20	" "	" "	38' - 11-1/4"	3-1/2"
4:20	" "	" "	38' - 11-3/8"	3-5/8"
4:36	" "	" "	" "	"
5:07	" "	" "	38' - 11-1/4"	3-1/2"
5:42	" "	" "	" "	"
5:49	" "	" "	38' - 11-1/4"	3-3/4"
5:55	" "	" "	" "	"
6:00	" "	" "	" "	"
6:05	1725 gpm	" "	38' - 10-3/4"	3"
6:47	" "	" "	38' - 10-5/8"	3-1/8"
6:52	" "	" "	" "	"
7:01	" "	" "	38' - 10-3/4"	3-1/4"
7:10	" "	" "	38' - 11-3/8"	3-5/8"
7:15	1980 gpm	" "	38' - 11-3/4"	4"

Test Pump Installation Included:

1. Deep well turbine pump (capacity 2000 gpm) with
90 feet 10" I. D. column
5-1/6 feet 12" O.D. bowl
95-1/6 feet bottom of bowl setting
2. Rate of discharge was measured with an 8 inch sharp edge free
flowing orifice attached to the end of a 10 inch discharge
pipe and a Pitot tube.
3. Water elevations were measured with a steel tape.

GROUND WATER PILING

The City of Pocatello Well No. 10 has a ground water priority as a point of diversion to appropriate subterranean waters of the State of Idaho under

1. Application No. 28180
2. Permit No. 20611
3. Priority Date June 15, 1948
4. Proof of Completion of Work Due Sept. 2, 1953 for 5.33 c.f.s.
5. Proof of Beneficial Use Due Sept. 2, 1959 for 5.33 c.f.s.

26411

STRATA ENCOUNTERED

<u>From</u>	<u>To</u>	<u>Thickness</u>	<u>Description</u>
0'	11'	11'	Clayey top soil
11'	20'	14'	Sand
20'	32'	12'	Coarse Gravel
32'	110'	78'	Boulders, Coarse Gravel & water bearing
110'	115'	5'	Clay
115'	158'	43'	Boulders, coarse gravel & water bearing
158'	185'	27'	Grey sandy clay
185'	188'	3'	Gravel & water bearing
188'	194'	6'	Grey Clay
194'	195'	1'	Gravel
195'	207'	12'	Grey sandy clay
207'	211'	4'	Gravel
211'	219'	8'	Grey sandy clay
219'	287'	68'	Tan clay & streaks gravel & sand
287'	302'	15'	Blue-grey sandy clay
302'	350'	48'	Blue-grey sandy clay & streaks of gravel.

1953 PRODUCTION RECORD

Well No. 10 was put into production June 1952. The well was in operation during the 5 month peak demand period (June to October). The following is a summary of water produced for each month.

<u>Month</u>	<u>Actual Production Gallon Per Month</u>	<u>Hours Pumped</u>	<u>Potential Production Gallons Per Month</u>
June	35,650,000	285	103,680,000
July	68,046,000	500	107,136,000
August	58,655,000	430	107,136,000
September	48,296,000	402	103,680,000
October	13,312,000	112	107,136,000
Totals	223,950,000	1729	528,768,000

The efficiency of production based upon the number of hours the pump was in operation would be 47 per cent during this period. However, the East Bench Reservoir will increase the effectiveness of the well.

CONCLUSION

Well No. 10 established this area as a potential prolific well field. Future developments could include the drilling of additional wells at this location. Diversion points will probably be:

Well No. 21 capacity 3,450,000 GPD
Well No. 22 capacity 3,450,000 GPD
Well No. 23 capacity 3,450,000 GPD

The drilling of these wells will not have to exceed 200 feet, water bearing horizons occurring as follows:

<u>From</u>	<u>To</u>	<u>Thickness</u>	<u>Description</u>
32'	110'	78'	Boulders & coarse gravel
115'	153'	43'	Boulders & coarse gravel

The factor limiting the development of this well field will be the size of water main to distribute the water. The planning of wells to be drilled and size of water mains to be installed should be carefully examined and integrated into the future maximum developments.

20611

SUMMARY OF DATA PERTAINING TO CITY OF POCATELLO
WELL NO. 8

March 1954

By: James N. Scardino

Introduction

The City of Pocatello Well No. 8, located in the Valleyview Tract, is owned and operated by the Pocatello Water Department. The water is used for municipal purposes in the City distribution system.

The well was originally drilled to a depth of 105 feet. Later it was deepened to 350 feet. The following data briefly summarizes the original drilling according to the well driller's report.

1. The first drilling of Well No. 8 was started on August 1, 1947 and completed October 31, 1947 by A. J. Schoonover, Burley, Idaho.
2. The well was drilled to a depth of 105 feet and cased to a depth of 100 feet.
3. The 20 inch casing has 17/ perforations from 35' to 51', size of cut 5/16" x 6".
4. Strata Encountered:

<u>From</u>	<u>To</u>	<u>Thickness</u>	<u>Description</u>
0'	5'	5'	Topsoil
5'	31'	26'	Sand, Gravel, Dirt & Boulders
31'	40'	9'	Gravel & Boulders
40'	55'	15'	Gravel
55'	64'	9'	Clay
64'	105'	41'	Packed sand & Small Boulders

5. Static level of water is 31 feet from the surface of the ground, October 31, 1947.

The following is data pertaining to the deepening of Well No. 8 and also includes the well driller's data. (Well driller's data will be noted with asterisks).

WELL DATA

Location: Well No. 8 is located in Valleyview Park on 300 Block West Eldredge, in NW $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 35, T. 6 S., R. 34 E.B.M.

Well Drilled by: A. J. Schoonover, Burley, Idaho

Well Drilled:

*First drilling started: Aug. 1, 1947 completed Oct. 31, 1947.

Second drilling started: Jan. 27, 1953 completed April 25, 1953

The well was drilled to a total depth of 320 feet and cased to a depth of 270 feet.

Elevation: 4450.85 feet. Reference Point floor level

Casing Installed:

<u>Date</u>	<u>From</u>	<u>To</u>	<u>Length</u>	<u>Description</u>
* 10-31-47	0'	100'	100'	20" O.D.-3/8" Std. Steel pipe
3-22-53	0'	116'	116'	16" O.D.-5/16" Std. Steel pipe
2-10-53	116'	270'	154'	16" O.D.-3/8" Std. Steel pipe

Notations: The first 100 ft. is overlap of 16" casing inside the 20" casing.

At 270 ft. the casing was reduced to 12-3/4" O.D. casing and drilling continued to a depth of 320 feet. Drilling was stopped April 10, 1953 and all of the 12-3/4" casing pulled out.

Favorable Water Bearing Horizons:

<u>From</u>	<u>To</u>	<u>Thickness</u>	<u>Description</u>
* 31'	40'	9'	Gravel & boulders - Water Bearing
* 40'	55'	15'	Gravel - water bearing
105'	126'	21'	Sandy Gravel - water bearing
126'	151'	25'	Sandy Gravel & boulders - water bearing
201'	220'	19'	Sandy Gravel - water bearing
228'	251'	23'	Sandy Gravel - water bearing

Notation: Average Sieve Analysis of the sandy gravel was as follows:

Silt & less	1/2%
Fine Sand	12%
Medium Sand	18%
Coarse Sand	12%
Granule	19%
Pebbles & Greater	39%

20611

Perforated Casing Records:

<u>From</u>	<u>To</u>	<u>Length</u>	<u>Number</u>	<u>Description</u>
* 35'	52'	17'	177	cuts 5/16" x 6" in the 20" casing
35'	95'	60'	480	cuts 1/2" x 6" in the 16" casing
114'	119'	35'	280	" " " " " " "
201'	220'	19'	160	" " " " " " "
228'	251'	23'	184	" " " " " " "

Notation: The reason for the perforations in the 16 inch casing from 35' to 95' was to give the water a better opportunity to enter from the 20 inch casing (perforated from 35' to 52') into the 16 inch casing.

Strata Encountered:

<u>From</u>	<u>To</u>	<u>Thickness</u>	<u>Description</u>
* 0'	5'	5'	Topsoil
* 5'	31'	26'	Sand, gravel, dirt & boulders
* 31'	40'	9'	Gravel & boulders - water bearing
* 40'	55'	15'	Gravel - water bearing
* 55'	64'	9'	Clay
* 64'	105'	41'	Packed sand & small boulders
105'	126'	21'	Sandy gravel - water bearing
126'	151'	25'	Sandy gravel & boulders - water bearing
151'	195'	44'	Sandy gravel, boulders & clay
195'	201'	6'	Clayey gravel
201'	220'	19'	Sandy gravel - water bearing
220'	228'	8'	Sandy clay & boulders
228'	251'	23'	Sandy gravel - water bearing
251'	320'	69'	Clayey gravel & boulders

Test Pumping of the Well:

The test pumping of the well consisted of pumping continuously 12 hours, 4-19-53, 4-21-53 and 4-25-53.

The test pump setting was as follows:

- 10 feet of 10" I. D. Suction Pipe
- 5 feet of 1 1/2" O. D. Bowl Assembly (5 stages)
- 135 feet of 10" O. D. Column Pipe
- Deep Well Turbine Pump capacity 2000 gpm - diesel power.

The first and second test periods pumped water from water bearing horizons from 114 ft. to 251 ft. (See perforated areas for various horizons of water).
The third test period included all water bearing horizons.

20611

First Continuous 12 Hour Test Period

Test pumping started at 6:55 A.M. and ended 6:55 P. M. April 19, 1953

<u>Time</u>	<u>Rate of Discharge</u>	<u>Static Level</u>	<u>Running Level</u>	<u>Draw-Down</u>	<u>Remarks</u>
6:55 AM		37.6			
7:10 "	1675 GPM				
7:25 "	1700 "				
7:45 "		39.8			Cut Motor
7:50 "	1725 "				Static level did not completely recover
8:00 "			125.5	87.9	Started Motor
8:15 "			123	85.4	
9:35 "			122.5	84.9	
10:01 "			122.5	84.9	
10:01 "	Recorded Rate of Recovery				Cut Motor
10:02 "	Approx. 1 min. to recover to 55'				
10:03 "		(47'			
10:09 "		(44'			
10:11 "		(43'			
10:13 "		(42.6'			
10:15 "		(41.6'			
10:19 "		(40.3'			
10:22 "		(40.3'			
10:25 "		(39.2'			
10:30 "		(39.5'			
10:32 "		(39.8'			
10:37 "		(38.9'			
10:39 "		(38.9'			
10:40 "	Recorded Rate of Drawdown				Start Motor
10:41 "			(105'	67.4'	
10:42 "			(110'	72.4'	
10:43 "	1725 GPM		(115'	77.4'	
10:46 "	" "		(119'	81.4'	
10:47 "	" "		(120'	82.4'	
10:52 "	" "		(123.6'	86.0'	
11:37 "	" "		(122.8	85.2'	
11:38 "					Cut Motor
11:55 "	1750 GPM		122.0	84.4	Start Motor
12:11 PM			122.4	84.8	
1:01 "	1675 "		121.0	83.4	
1:45 "	1700 "		122.8	85.2	
2:03 "	1700 "		122.8	85.2	
2:06 "	to(Started & stopped pump periodically to surge well)				
2:53 "	1700 GPM		122.8	85.2	
3:30 "	1675 "		122.8	85.2	
4:10 "	1675 "		123.0	85.4	
4:30 "	1700 "		122.5	84.9	
5:15 "	1700 "		123.6	86.0	
5:45 "	1700 "		123.8	86.2	
5:46 "	to(Started & Stopped Pump periodically to Surge Well.				
6:24 "					
6:25 "	1750 GPM		124	86.4	

20611

<u>Time</u>	<u>Rate of Discharge</u>	<u>Static Level</u>	<u>Running Level</u>	<u>Draw Down</u>	<u>Remarks</u>
6:40 PM	1675 GPM		124	86.4	
6:55 "	1675 "		124	86.4	
7:30 "		38.9			

April 20, 1953 at 1:15 PM static level recorded at 38.2 ft.

Summary of first test period:

Maximum Rate of Discharge 1750 GPM drawdown 84.4 ft.

Minimum Rate of Discharge 1675 GPM drawdown 83.4

Rate of drawdown from static level 38.9 ft. to running level of 123.6 ft. was recorded at 11 minutes (see rate of drawdown for additional data). Rate of Recovery from running level of 122.5 ft. to static level of 38.9 ft. was recorded at 38 minutes. In addition it took the static level to recover from 38.9 ft. to 37.6 ft. approximately 35½ hours. (See rate of recovery for additional data).

Note: The first test period pumped water from water bearing horizons from 114 ft. to 251 ft. (the 16 inch casing was not perforated from 35 ft. to 90 ft.)

Second Continuous 12 Hour Test Period

Test pumping started at 6:55 A.M. and ended 6:55 P.M. April 21, 1953.

<u>Time</u>	<u>Rate of Discharge</u>	<u>Static Level</u>	<u>Running Level</u>	<u>Draw Down</u>	<u>Remarks</u>
6:55 AM		37.6'			
to 10:14 "	Started & stopped pump periodically to surge well It would take the water 6 to 7 min. to clear				
10:16 "	1725 GPM		119.0	81.4'	
10:21 "	1000 GPM		82.0	44.4	
10:34 "	1000 GPM		80.0	42.4	
10:59 "	1000 "		79.5	41.9	
11:10 "	1000 "		79.5	41.9	
11:41 "	Started & Stopped pump periodically to surge well				
to 12:48 PM	& took water sample #8A				
12:46 "	1725 GPM		121.0	83.4	
1:25 "	"		121.5	83.9	
1:25 "					Stopped Motor
2:42 "	Recorded rate of drawdown				
1:41 "		38'			
1:42 "			(100'	62.4	(Started Motor
1:43 "	1725 GPM		(105'	67.4	(pulled down
1:44 "	1725 "		(110'	72.4	(immediately
1:46 "	1675 "		(115'	77.4	(to 100 ft.
1:50 "	" "		(117'	79.4	
1:52 "	" "		(118'	80.4	
1:57 "	" "		(119'	81.4	
2:07 "	" "		(120'	82.4	
2:20 "	" "		(121'	83.4	
2:30 "	Started & stopped pump periodically to surge well				
to 6:09 "					

20611

<u>Time</u>	<u>Rate of Discharge</u>	<u>Static Level</u>	<u>Running Level</u>	<u>Draw Down</u>	<u>Remarks</u>
6:15 PM	Started Pump Recorded Rate of Drawdown				
6:15 "			(100'	62.4	(Drawdown Immediately to 100'
6:15 ¹ "	1725 GPM		(105'	67.4	
6:16 "	" "		(110'	72.4	
6:20 "	" "		(115'	77.4	
6:22 ¹ "	" "		(116'	78.4	
6:26 "	" "		(117'	79.4	
6:30 ¹ "	" "		(118'	80.4	
6:38 "	" "		(119'	81.4	
6:52 ¹ "	" "		(120'	82.4	
7:12 "	" "		(120.5	82.9	
7:13 "	Cut motor recorded rate of recovery				
7:14 "	Recovered to 55' immediately (15 to 45 sec.)				
7:16 "		50'			
7:19 ¹ "		45'			
7:26 "		42'			
7:30 "		41'			
7:34 "		40.5'			
7:37 "		40'			
8:10 "		39'			

April 22, 1953 at 8:30 AM static level recorded at 38.2'

Summary of Second Test Period

Maximum Rate of Discharge 1725 GPM drawdown 83.9 ft.

Minimum Rate of Discharge 1000 GPM drawdown 41.9 ft.

Rate of drawdown from static level 38 ft. to running level of 121 ft. was recorded at 39 minutes (see rate of drawdown for additional data). Rate of recovery from running level of 120 ft. to static level of 39 ft. was recorded at 57 minutes (see rate of recovery for additional data). In addition, it took the static level to recover from 39 ft. to 37 ft. approximately 36 hours.

NOTE: The Second Test Period pumped water from water bearing horizons from 114 ft. to 251 ft.. (the 16 inch casing was not perforated from 35 ft. to 90 ft.).

THIRD CONTINUOUS 12 HOUR TEST PERIOD

Test pumping started at 8:00 A.M. and ended 7:40 P. M. April 25, 1953.

20611

<u>Time</u>	<u>Rate of Discharge</u>	<u>Static Level</u>	<u>Running Level</u>	<u>Draw Down</u>	<u>Remarks</u>
8:00 AM		37'			
8:30 "	2025 GPM				
9:10 "	2075 "		80'	43'	
	Surge well				
10:27 "	2025 GPM		80.5'	43.5'	
10:35 "	" "		83'	46'	
	Surge well				
11:41 "	2125 GPM		79'	42'	
11:55 "	" "		79'	42'	
12:10 PM	" "		76'	39'	
12:14 "	1150 "		55'	18'	
12:26 "	" "		53.5'	16.5'	
1:38 "	1000 "		42.1'	4.9'	
2:11 "	975 "		41.9'	4.1'	
2:31 "	1275 "		61'	24.0'	
2:51 "	2150 "		62'	25'	
3:02 "	1525 "		56.5'	19.5'	
3:12 "	1525 "		57'	20'	
3:24 "	1525 "		56.3'	19.3'	
	Surge well Sample #8 B				
4:36 "	Cut Motor				
4:51 "	Started motor	recorded rate of drawdown			
4:51 "	1700 GPM	37'			
4:52 "	" "		49'	12'	
4:54 "	1600 "		53.5'	16.5'	
5:02 "	1875 "		53.8'	16.8'	
5:05 "	1850 "		59'	22'	
5:10 "	1825 "		59'	22'	
5:24 "	1825 "		59.5'	22.5'	
	Surge Well				
6:49 "	1100 "		42.1'	5.1'	
6:58 "	1050 "		42.8'	5.8'	
7:11 "	1275 "		45.4'	8.1'	
7:23 "	1275 "		46'	9.0'	
7:28 "	1825 "		57.1'	20.1'	
7:33 "	1825 "		56'	19'	Cut motor
	Record Rate of Recovery				
	10 sec. to recover to 50'				
7:35 "		38.5'			
7:37 "		38.0'			
7:40 "		37.6'			

Summary of Third Test Period

Maximum Rate of Discharge 2150 GPM Drawdown 44 ft.
Minimum Rate of Discharge 1000 GPM Drawdown 6 ft.

Drawdown rate from static level 37 ft. to running level of 59.5 ft. was recorded at 23 minutes. Rate of Recovery from running level 56 ft. to static level 37.6 ft. recorded at 7 minutes.

20611

NOTE: The 16 inch casing was perforated from 35 ft. to 90 ft. during the third test period. This test period included all water bearing horizons.

GROUND WATER PRIORITY RIGHT

The City of Pocatello Well No. 8 has a ground water priority as a point of diversion to appropriate the subterranean waters of the State of Idaho under

Application No. 28180

Permit No. 20611

Priority Date June 15, 1948

Proof of Completion of Work due Sept. 2, 1953 for 3.33 cubic feet
per second

Proof of Beneficial Use due Sept. 2, 1959 for 3.33 cubic feet
per second

Quantity of water claimed 3.33 cubic feet per second or 1500 gallon per minute.

CONCLUSION

The capacity of the well was increased from 500 GPM to 1200 GPM by the additional drilling. A summary of the third test pumping period for various rates of discharge as follows:

<u>Rate of Discharge</u>	<u>Drawdown</u>	<u>Condition of Pumped Water</u>
2075 GPM	43 ft.	Visual turbidity was very noticeable for 11 to 15 minutes each time pumping started, grading from a dirty to cloudy color.
1525 GPM	18.5 ft.	Visual turbidity was noticeable for 6 to 7 minutes each time pumping started, grading from a slightly dirty to cloudy color.
1000 GPM	5 ft.	Visual turbidity was at a minimum each time pumping started, being slightly cloudy for 1 to 2 minutes.

Summarized the suggested capacity of this well would be a maximum of 1200 GPM. Capacities greater than 1200 GPM or drawdowns greater than 6 ft. presents the problem of a high degree of turbidity. However, with additional pumping the well may possibly be developed to greater capacities.

20611

Points of diversion are correct as listed and shown on their filing map.
All water is used for domestic-industrial or irrigation within City of Pocatello.
Population is listed as over 26,000 in census. "Poky" claims 28,000.

Area is 3306 acres.

Well No. 1

No pump in well. Unused since 1950. Well house is regular dwelling house construction, wood-- size 18' x 24' x 12' high. Seven windows, two doors, plastered, concrete floor. Static Height is 38' 3".

Well No. 2

Operating. 76' x 8" column, 6 stages 8" bowls. Static H=32' 6" Running H=39' 1 $\frac{1}{2}$ ". Pump house is wooden construction, size 14' x 16' x 8' high with a concret floor. 100 H.P., G. E. Motor, 440 V., 120 AMP. 1765 RPM No. WD6637502. Fairbanks Morse deep well turbine. 8" delivery pipe, 1400 GPM. Allow 155 inches.

Well No. 3

Well house is a plastered building, concrete floor, size 12' x 12' x 10' high Static H= 32'. 75 H.P. U. S. Motor, 440 V., 90 AMPS. 1800 RPM. No. 215727 Sterling Pump turbine No. 9317. Square D panel control. Allow 70 inches.

Wells No. 4, 5, 6, and 7 are located close together and will be rated together. They interfere.

Well No. 4

150 H.P. G. E. Induction Motor, 1155 RPM., 440 V. 174 AMP. No. 4552872 Static H.= 29' 8" March 4, 1954.
Static H.= 31' 6" today
House is 12' x 12' x 10' high stucco building. Layne Pump No. 4025, 14 Stage, 14" bowls, 10" x 70' column.

Well No. 5

Operating.

Well house is 12' x 12' x 10' high stucco building, concrete floor. Static H.= 23' 9"
Operating H.= 31' 1 $\frac{3}{4}$ "
100 H.P., G. E. Motor 440 V., 120 AMP. 1765 RPM No. WD 6637504. Fairbanks Morse Pump No. PH 3457, 6 stage, 8" bowls, 8" x 76' column. 8" delivery.

Well No. 6

150 H.P. G. E. Motor, 440 V. 175 Amp., 1750 RPM, No. 5313369.
Static H.= 22' 2"
Static H.= 23' 10" now
Byron Jackson Pump No. BY 10297, 6 stages 10" bowls 10" x 66' column.

20611

Well No. 7

150 H.P. G. E. Induction Motor, 440 V., 170 Amps., 1160 RPM, No. 4809922. Static H.= 21' 3", Static H.= 23' 1" now. Layne Pump No. 4096, 14 stages, 14" bowls. 10" x 70' column. Well house is 14' x 14' x 14' high concrete floor 75,810,000 gallons to figure rate. Actually slightly less than 200 inches. 4 cubic feet per second is maximum for one month.

Well No. 8

Well house is concrete block construction 16' x 16' x 10' high. Static H.= 37' 4". 6 stages, 8" bowls 76' x 8" column. 8" delivery pipe 100 H.P. U. S. Motor 440 V., 121 Amps. 1800 RPM. Serial No. 873720. Fairbanks Morse pump Serial No. PM 4081. Allow 112 gallons per minute or 133 inches. 2.66 cubic feet per second.

Well No. 9

Concrete block building 14' x 14' x 18' high. Static H.= 10' 10". A Deming Pump No. T4992 size 6" bowls 12 stages 73' of column 4" delivery pipe connects to the city system. 50 H.P. U. S. Motor 440 V., 61 Amps. 1800 RPM. No. 359814. Allow 40 inches or .8 cubic feet per second.

Well No. 10

Concrete and steel building size 14' x 18' x 10' high. Static H.= 42' 11". 6 stage, 12" bowls, 96' 12" diameter column. Fairbanks Morse Pump No. PN 7187 Motor is a Fairbanks Morse 250 H.P. 440 V., 292 AMP. 1775 RPM Serial No. 376501. Allow 252 inches or 5.05 cfs.

Accompanied on this inspection by Merrill Fore and J. E. Fuger, City Water Superintendent.

20611

✓
September 11, 1953

Re: Permit No. 20611

City of Pocatello
Box 1489,
Pocatello, Idaho

ATT: Mr. W. Webb, City Manager

Dear Mr. Webb:

We acknowledge receipt of your letter of September 10th, enclosing affidavit of publication from the Idaho State Journal, in connection with your proof of Completion of Works on Permit No. 20611.

This completes the proof, but before final action is taken the law requires that a field examination be made by an engineer from this department.

We cannot say when this examination will be made, but our field engineer will try and contact you at the time he makes the examination so that arrangements may be made to show him over the project.

Very truly yours,

MARK R. KULP
State Reclamation Engineer,
By

Chief Clerk

A:re

20611

City of Pocatello

POCATELLO, IDAHO

September 10, 1953

MUNICIPAL BUILDING
220 EAST CENTER

OFFICE OF

City Manager

RE: Permit No. 20611

RECEIVED
SEP 11 1953
Department of Reclamation


State of Idaho,
Department of Reclamation,
Boise, Idaho.

Gentlemen:

Reference is made to your letter September 9, above
subject.

It was our understanding that proof of publication
would be mailed you direct by the Idaho State Journal. However,
copy of the publication together with certification is attached.

Yours very truly,
CITY OF POCATELLO



W.B. Webb
City Manager

20611

NOTICE FOR PUBLICATION

Notice is hereby given that at 10 A.M., on the 2nd day of September 1953, at Pocatello, County of Bannock, State of Idaho, before B. D. Reese a Notary Public proof will be submitted of the completion of works for the diversion of 28 cubic feet per second of the waters of subterranean origin from the following wells in accordance with the terms and conditions of a certain permit heretofore issued by the Department of Reclamation of the State of Idaho.

Ross Park Wells (Nos. 1, 2, 3) the center of ^{NE 1/4} Sec. 1,
T. 7S, R. 34E., B.M.

Rainey Park Wells (Nos. 4, 5, 6, 7) the NW¹/₄ SW¹/₄ Sec. 1
15, T. 6S., R. 34E., B.M.

North Pocatello Park Wells (No. 8) the NW¹/₄ SE¹/₄ Sec.
35, T. 6S., R. 34E., B.M.

Raymond Park Well (No. 9) Blk. 557 Pocatello Original
Townsite in NW¹/₄ SE¹/₄ Sec. 27, T. 6S. R 34E., B.M.

Tydeman Field Well (No. 10) Blk. 219 Original Pocatello
Townsite in N¹/₂ NE¹/₄ NW¹/₄ Sec. 26, T. 6S., R 34E., B.M.

~~Old Airport Well (No. 11) near U.S. 30 North in the SE¹/₄
SW¹/₄ NE¹/₄ SE¹/₄ Sec. 12, T. 6S., R. 33E., B.M.~~

1. The name of the person or corporation holding said permit is City of Pocatello.
2. The postoffice address of such person or principal place of business of such corporation is P.O. Box 1469 Pocatello, Idaho, County of Bannock, State of Idaho.
3. The number of such permit is 20611, and the date set for the completion of such work is September 2, 1953.
4. Said water is to be used for domestic supply for City of Pocatello and adjacent area.
5. Said works of diversion will be fully completed on the date set for such completion, and the amount of water which said works are capable of conducting to the place of intended use, in accordance with the plans accompanying the application for such permit, is 28 cubic feet per second.

MARK R. KULP
State Reclamation Engineer

20611

PROOF OF PUBLICATION

STATE OF IDAHO
County of Bannock

ss.

Edith Berosek

being first duly sworn on oath deposes and says: That she
was at all times herein mentioned a citizen of the United States of
America, more than 21 years of age, and the Principal Clerk of THE
IDAHO STATE JOURNAL, a daily newspaper, printed and published at
Pocatello, Bannock County, Idaho, and having a general circulation
therein.

That the document or notice, a true copy of which is attached, was
published in the said IDAHO STATE JOURNAL, on the following dates,
to-wit:

Aug 4, 19 53, 19
Aug 11, 19 53, 19
Aug 18, 19 53, 19
Aug 25, 19 53, 19
19, 19

That said paper has been continuously and uninterruptedly pub-
lished in said County for a period of seventy-eight weeks prior to the
publication of said notice or advertisement and is a newspaper within
the meaning of the laws of Idaho.

Edith Berosek

Subscribed and sworn to before me this she

day of Aug 25, 19 53

Muriel L. Ruggles

Notary Public, State of Idaho
Residence: Pocatello, Idaho

20611

PROOF OF PUBLICATION

STATE OF IDAHO
County of Bannock

ss.

Legal Advertisement

NOTICE FOR PUBLICATION

Notice is hereby given that at 10 A.M., on the 2nd day of September 1953, at Pocatello, County of Bannock, State of Idaho, before B. D. Reese a Notary Public proof will be submitted of the completion of works for the diversion of 27 cubic feet per second of the waters of suoterranean origin from the following wells in accordance with the terms and conditions of a certain permit heretofore issued by the Department of Reclamation of the State of Idaho.

Ross Park Wells (Nos. 1, 2, 3) the center of NE $\frac{1}{4}$ Sec. 1, T. 7S, R. 34E., B.M.

Rainey Park Wells (Nos. 4, 5, 6, 7) the NW $\frac{1}{4}$ SW $\frac{1}{4}$ Sec. 15, T. 6S, R. 34E., B.M.

North Pocatello Park Well (No. 8) NW $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 35, T. 6S, R. 34 E.B.M.

Raymond Park Well (No. 9) Blk. 557 Pocatello Original Townsite in NW $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 27, T. 6S, R. 34E., B.M.

Tydemar Field Well (No. 10) Blk. 219 Original Pocatello Townsite in N $\frac{1}{2}$ NE $\frac{1}{4}$ NW $\frac{1}{4}$ Sec. 26, T. 6S, R. 34 E. B.M.

1. The name of the person or corporation holding said permit is City of Pocatello.

2. The postoffice address of such person or principal place of business of such corporation is P. O. Box 1489 Pocatello, Idaho, County of Bannock, State of Idaho.

3. The number of such permit is 20611, and the date set for the completion of such work is September 2, 1953.

4. Said water is to be used for domestic supply for City of Pocatello and adjacent area.

5. Said works of diversion will be fully completed on the date set for such completion, and the amount of water which said works are capable of conducting to the place of intended use, in accordance with the plans accompanying the application for such permit, is 27 cubic feet per second.

MARK R. KULP
State Reclamation
Engineer

Aug 4, 11, 18, 25. 20611

Edith Berosek

being first duly sworn on oath deposes and says: That she was at all times herein mentioned a citizen of the United States of America, more than 21 years of age, and the Principal Clerk of THE IDAHO STATE JOURNAL, a daily newspaper, printed and published at Pocatello, Bannock County, Idaho, and having a general circulation therein.

That the document or notice, a true copy of which is attached, was published in the said IDAHO STATE JOURNAL, on the following dates, to-wit:

Aug 4, 19 53	19
Aug 11, 19 53	19
Aug 18, 19 53	19
Aug 25, 19 53	19
19	19

That said paper has been continuously and uninterruptedly published in said County for a period of seventy-eight weeks prior to the publication of said notice or advertisement and is a newspaper within the meaning of the laws of Idaho.

Edith Berosek

Subscribed and sworn to before me this 25 day of AUG, 19 53

Muriel L. Ruggles

Notary Public, State of Idaho

Residence: Pocatello, Idaho

20611

✓
September 9, 1953

RE: Permit No. 20611

Mr. W. B. Webb, City Manager
City of Pocatello
Box 1489
Pocatello, Idaho

Dear Mr. Webb:

We acknowledge receipt of your letter of September 2, 1953, enclosing depositions of yourself and two witnesses in proof of completion of works on Permit No. 20611.

However, the affidavit of publication is an essential part of this proof and the Idaho State Journal was instructed to send same to you. If you have not received it we suggest you take the matter up with them at once.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A:fg

20611

City of Pocatello

POCATELLO, IDAHO

MUNICIPAL BUILDING
220 EAST CENTER

September 2, 1953

OFFICE OF City Manager

RECEIVED
SEP 3 1953
Department of Reclamation

RE: Permit No. 20611

State of Idaho,
Department of Reclamation,
Boise, Idaho.


Attention Mr. Mark R. Kulp,
State Reclamation Engineer.

Gentlemen:

Reference is made to your letter July 31, with regard to
completion of works proof to be made on 10 wells

"Proof of Completion of Works" forms signed and notarized
are attached hereto, for your further handling.

Yours very truly,
CITY OF POCATELLO



W.B. Webb
City Manager

Idaho State Journal

20611



LEN JORDAN
GOVERNOR

STATE OF IDAHO
DEPARTMENT OF RECLAMATION

MARK R. KULP, RECLAMATION ENGINEER

BOISE

August 6, 1953

RE: Permit No. 20611

RECEIVED
AUG 8 1953
Department of Reclamation

Idaho State Journal
Pocatello
Idaho

Gentlemen:

We have checked notice of completion of works proof on Permit No. 20611 of the City of Pocatello, and find it to be correct with one exception.

In Paragraph 2, the correct address is P. O. Box 1469, instead of 1489.

Please make this correction in your subsequent issues.

Very truly yours,

MARK R. KULP
State Reclamation Engineer

By

Jeanne L. Anderson
Chief Clerk

fg

Checked with the City Office and they tell us Box 1489 is correct.

Idaho State Journal

E.B.

20611

The Depositions of two Witnesses, in this form, taken separately, required in each case.

Permit No. 20611

Proof of Completion of Works**DEPOSITION OF WITNESS**

Ques. 1. State your name, residence, occupation and postoffice address.

Ans. JAMES N. SCARDINO GEOLOGIST

TOURAIN HOTEL POCA TELLO, IDAHO

Ques. 2. Are you acquainted with CITY OF POCA TELLO, the holder of Permit No. 20611, authorizing the diversion of 27 second-feet of the waters of SUBTERRANEAN ORIGIN, at POCA TELLO for DOMESTIC purposes? How long have you known him, and where does he reside?

Ans.

Ques. 3. Have you read or heard read said Permit No. 20611, and are you familiar with its terms and conditions?

Ans. YES. I AM FAMILIAR WITH ITS TERMS AND CONDITIONS

Ques. 4. (If for irrigation purposes). Are you acquainted with the land proposed to be irrigated under said permit? If so, describe same, state its character, and give your estimate of the amount of water required for its profitable cultivation.

Ans.

Ques. 5. Are the works of diversion fully completed and of sufficient capacity to convey the entire amount of water set out in the permit from point of diversion to place of use?

Ans. YES

Ques. 6. Describe the works of diversion as they now exist, and give your estimate of their capacity.

Ans. THE CITY OF POCA TELLO HAS NINE ACTIVE WELLS AND ONE

WELL NOT IN USE. THE PRODUCTIVE CAPACITY OF ALL THE

WELLS IS 12,150 GALLONS PER MINUTE OR 27 CUBIC FEET PER

SECOND

(Sign here.)

James N. Scardino

I hereby certify that the foregoing testimony was read to the above subscriber before its signing, that I believe him to be the person he represents himself to be, and that said testimony was subscribed and sworn to before me, at my office in Pocatello

County of Bannock, State of Idaho, on this 2nd day of September, A. D. 1953

Notary Public

My Commission expires 7-21-56

20611

The Depositions of two Witnesses, in this form, taken separately, required in each case.

Permit No. 20611

Proof of Completion of Works

DEPOSITION OF WITNESS

Ques. 1. State your name, residence, occupation and postoffice address.

Ans. W. J. SPEIR SALESMAN
1338 EAST CENTER POCATELLO, IDAHO

Ques. 2. Are you acquainted with CITY OF POCATELLO, the holder of Permit No. 20611, authorizing the diversion of 27 second-feet of the waters of SUBTERRANEAN ORIGIN, at POCATELLO for DOMESTIC purposes? How long have you known him, and where does he reside?

Ans.

Ques. 3. Have you read or heard read said Permit No. 20611, and are you familiar with its terms and conditions?

Ans. YES, I AM FAMILIAR WITH ITS TERMS AND CONDITIONS.

Ques. 4. (If for irrigation purposes). Are you acquainted with the land proposed to be irrigated under said permit? If so, describe same, state its character, and give your estimate of the amount of water required for its profitable cultivation.

Ans.

Ques. 5. Are the works of diversion fully completed and of sufficient capacity to convey the entire amount of water set out in the permit from point of diversion to place of use?

Ans. YES, TO THE BEST OF MY KNOWLEDGE

Ques. 6. Describe the works of diversion as they now exist, and give your estimate of their capacity.

Ans. THE CITY OF POCATELLO HAS NINE ACTIVE WELLS AND ONE WELL NOT IN USE. THE PRODUCTIVE CAPACITY OF ALL THE WELLS IS 12,150 GALLONS PER MINUTE

(Sign here.)

W. J. Speir
1338 E. Center
Pocatello, Idaho

I hereby certify that the foregoing testimony was read to the above subscriber before its signing, that I believe him to be the person he represents himself to be, and that said testimony was subscribed and sworn to before me, at my office in Pocatello

County of Bannock, State of Idaho, on this 2nd day of SEPTEMBER, A. D. 1953.

Notary Public

My Commission expires 7-21-56

20611

PERMIT NO. 20611

Proof of Completion of Works

DEPOSITION OF HOLDER

Ques. 1. State your name, residence, occupation and postoffice address.

Ans. W. B. WEBB CITY MANAGER
121 VALLEYVIEW DRIVE POCATELLO, IDAHO

Ques. 2. If acting in behalf of a corporation, state its name, principal place of business, your position with reference to same, and your authority for appearing in its behalf.

Ans. CITY OF POCATELLO, P. O. BOX 1489
W. B. WEBB CITY MANAGER

Ques. 3. State number and date of permit, amount of water you are authorized to divert, source, and point of diversion.

Ans. 20611 JUNE 15, 1948 27 CUBIC FEET PER SECOND OF
SUBTERRANEAN ORIGIN FROM 10 DEEP WELLS

Ques. 4. State purpose for which water is to be used, and, if for irrigation, state the number of acres and give description of the land you intend to reclaim.

Ans. THE WATER IS TO BE USED FOR DOMESTIC PURPOSES.

Ques. 5. State whether or not the water has been turned into your works of diversion, and, if so, when and to what extent.

Ans. THE 10 WELLS ARE TIED INTO THE CITY OF POCATELLO
WATERWORKS SYSTEM.

Ques. 6. State whether or not the works of diversion are fully completed, and whether or not they comply in all respects with the terms of the permit.

Ans. ALL 10 WELLS ARE FULLY COMPLETED.

Ques. 7. If the works of diversion do not comply with all the terms of your permit, state fully those particulars in which there is any variance.

Ans. ONE WELL NO. 1 IS NOT ACTIVE. AND AMENDED PERMIT DESCRIPTIONS INCLUDE
WELL NO 10 LOCATED ON TYDEMAN FIELD INSTEAD OF RAYMOND PARK.

Ques. 8. Give description of works, state dimensions and capacity of each part, and

WELL NUMBER	LOCATION	DATE WELL COMPLETED	SIZE OF CASING	DEPTH	CAPACITY C.F. S.	ESTIMATED COST
1	ROSS PARK	1926)	16"	120'	2.22	\$15,000.00
2	"	TO)	16"	96'	3.12	12,000.00
3	"	1930)	16"	208'	3.12	26,000.00
4	RAINEY PARK	1930	16"	120'	2.22	15,000.00
5	"	1930	16"	100'	2.22	12,500.00
6	"	1936	16"	100'	2.22	12,500.00
7	"	1940	20"	100'	2.22	12,500.00
8	NO. POO. PARK	1953	20"	320'	3.33	30,000.00
9	RAYMOND PARK	1948	20"	100'	1.00	12,500.00
10	TYDEMAN FIELD	1952	20"	350'	5.33	35,000.00
					27.00	\$183,000.00

20611

20611

PERMIT NO. 20611

Proof of Completion of Works

DEPOSITION OF HOLDER

Ques. 1. State your name, residence, occupation and postoffice address.

Ans. W. B. WEBB CITY MANAGER

121 VALLEYVIEW DRIVE POCATELLO, IDAHO

Ques. 2. If acting in behalf of a corporation, state its name, principal place of business, your position with reference to same, and your authority for appearing in its behalf.

Ans. CITY OF POCATELLO, P. O. BOX 1489

W. B. WEBB CITY MANAGER

Ques. 3. State number and date of permit, amount of water you are authorized to divert, source, and point of diversion.

Ans. 20611 JUNE 15, 1948 27 CUBIC FEET PER SECOND OF

SUBTERRANEAN ORIGIN FROM 10 DEEP WELLS

Ques. 4. State purpose for which water is to be used, and, if for irrigation, state the number of acres and give description of the land you intend to reclaim.

Ans. THE WATER IS TO BE USED FOR DOMESTIC PURPOSES.

Ans.

(Sign here.)

City of Pocatello, Idaho
W. B. Webb

I hereby certify that the foregoing testimony was read to the above subscriber before its signing, that I believe him to be the person he represents himself to be, and that said testimony was subscribed and sworn to before me, in Pocatello,

County of Bannock, State of Idaho, on this 2nd

day of SEPTEMBER A. D. 1953.

[Signature]

Notary Public.

My Commission expires 7-21-56

August 6, 1953

RE: Permit No. 20611

Idaho State Journal
Pocatello
Idaho

Gentlemen:

We have checked notice of completion of works proof on Permit No. 20611 of the City of Pocatello, and find it to be correct with one exception.

In Paragraph 2, the correct address is P. O. Box 1469, instead of 1489.

Please make this correction in your subsequent issues.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

fg

20611

August 3, 1953

RE: Permit No. 20611

Idaho State Journal
Pocatello
Idaho

Gentlemen:

On July 31, 1953, we sent you notice for publication in connection with proof of completion of works on Permit No. 20611 of the City of Pocatello.

This notice calls for the diversion of 28 cubic feet per second. We are this morning advised that it should be for only 27 cubic feet per second.

Will you please make this change in the notice.

Very truly yours,

JOHN R. KULP
State Reclamation Engineer
By

Chief Clerk

A:fg
cc: City of Pocatello

20611

CITY OFFICES

EAST CENTER STREET

TELEPHONE 993

CITY OF POCA TELLO

Idaho's Industrial Center

Pocatello, Idaho

August 1, 1953

RECEIVED
AUG 3 1953

Department of Reclamation

Mr. Mark R. Kulp
State Reclamation Engineer
Boise, Idaho

Dear Mr. Kulp:

In reference to the "Notice For Publication For Completion of Works". With the elimination of Well No. 11 as a point of diversion in Permit No. 20611 the total of 28 cubic feet per second has to be revised to 27 cubic feet per second as follows:

<u>Well Number</u>	<u>G. P. M.</u>	<u>C. f. S.</u>
1	1000	2.22
2	1400	3.12
3	1400	3.12
4.	1000	2.22
5	1000	2.22
6	1000	2.22
7	1000	2.22
8	1500	3.33
9	450	1.00
10	2400	5.33
	12,150	27.00

Yours truly,

CITY OF POCA TELLO

W. B. Webb

W. B. Webb
City Manager

20611

✓
August 1, 1953

RE: Permit No. 20611

City of Pocatello
Pocatello
Idaho

ATTN: Mr. W. B. Webb

Dear Mr. Webb:

Following up our letter of yesterday, we return your application for amendment to point of diversion of well No. 10 which has been approved by the State Reclamation Engineer and recorded in this Department.

We are also sending you under separate cover two other forms of application for Permit to Appropriate subterranean water. This is in accordance with your letter of July 30, 1953, saying you wish to make other filing.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A:pj
Enc.

20611

✓
July 31, 1953

RE: Permit No. 20611

City of Pocatello
Pocatello
Idaho

ATT: Mr. W. B. Webb, City Manager

Dear Mr. Webb:

In accordance with your letter of July 30, 1953, we have eliminated Well No. 11 from your application for a amendment to the points of diversion in Permit No. 20611 and this will be approved and recorded and sent you shortly.

Meanwhile, we have sent to the Idaho State Journal notice of completion of works proof to be made on the other 10 wells at 10:00 a.m., September 2, 1953, at Pocatello, before B. D. Reese, Notary Public. This is in accordance with the notice originally sent us and we are enclosing you a copy herewith. The paper has been instructed to publish it once a week for four weeks prior to September 2, and to send you the affidavit of publication together with statement of costs.

If for any reason there should be any change in this notice, will you please notify us at once and also notify the State Journal to hold up publication awaiting further advice.

We enclose the necessary forms of deposition to be used in making this proof consisting of one for the permit holder and one for each of two disinterested witnesses.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A:fg
Enc.

20611

CITY OFFICES

EAST CENTER STREET

TELEPHONE 993

CITY OF POCATELLO

Idaho's Industrial Center

Pocatello, Idaho

July 30, 1953

RECEIVED
JUL 31 1953

Department of Reclamation

Mr. Mark R. Kulp
State Reclamation Engineer
Boise, Idaho

Dear Mr. Kulp:

Reference is made to your letter July 28 regarding the withdrawal of application for amendment for Well No. 11. (Permit No. 20611).

The City of Pocatello accepts your suggestion to withdraw our application for amendment to change the point of diversion of Well No. 11. However, we want to establish a priority date for subterranean water with points of diversions in this area located at the Old Airport and Phillips Field. These wells will be designated as follows:

City of Pocatello Well No. 11	located at Old Airport
Army Airbase Well No. 1	located at Phillips Field
Army Airbase Well No. 2	located at Phillips Field

In addition to filings of these wells we would like to make application for future well developments designated as City of Pocatello Wells Nos. 12, 13, 14, 15, 16 and 17.

Please send the necessary forms and pertinent information.

Yours very truly,

CITY OF POCATELLO



W. B. Webb
City Manager

20611

STATE OF IDAHO
DEPARTMENT OF RECLAMATION

BOISE, IDAHO

Re: Permit No. 20611

Date: July 31, 1953

Idaho State Journal

Pocatello, Idaho

Gentlemen:

Enclosed you will find notice for publication once a week for four consecutive weeks prior to **September 2, 1953** the date set for proof, the expense of the publication to be paid by the applicant, **City of Pocatello** of **Pocatello,** **Idaho**, to whom you should furnish proof of publication on or prior to the date set for proof.

Please acknowledge receipt of this notice, and furnish this office with a copy of the first publication, in order that we may check same.

Very truly yours,

MARK R. KULP

State Reclamation Engineer
By

Chief Clerk

20611

Notice for Publication

Notice is hereby given that at 10 A M., on the 2 ND day of SEPTEMBER
 1953, at POCATELLO, County of BANNOCK, State of Idaho,
 before B. D. Reese a NOTARY PUBLIC proof will be submitted of the completion of works
 for the diversion of 28 cubic feet per second of the waters of SUBTERRANEAN ORIGIN

in accordance with the terms and conditions of a
 certain permit heretofore issued by the DEPT. OF RECLAMATION of the State of Idaho.

1. The name of the person or corporation holding said permit is CITY OF POCATELLO
2. The postoffice address of such person or principal place of business of such corporation is P. O. Box 1469 POCATELLO, IDAHO, County of BANNOCK, State of Idaho.
3. The number of such permit is 29611 20611, and the date set for the completion of such work is SEPTEMBER 2, 1953
4. Said water is to be used for DOMESTIC purposes.
5. Said works of diversion will be fully completed on the date set for such completion, and the amount of water which said works are capable of conducting to the place of intended use, in accordance with the plans accompanying the application for such permit, is 28 cubic feet per second.
6. The amount of lands for which said water is available is _____ acres, particularly described as follows:
THE WATER IS FOR THE CITIZENS OF POCATELLO AND VICINITY

5710
 Commissioner of Reclamation.
 20611

✓
July 28, 1953

RE: Permit No. 20611

City of Pocatello
Box 1469
Pocatello, Idaho

ATT: Mr. W. B. Webb, City Manager

Dear Mr. Webb:

In reference to your application for amendment to Permit No. 20611 to change the point of diversion of Wells Nos. 10 and 11.

The change in Well No. 10 can be approved as both locations are in the same vicinity and presumably from the same subterranean source, but Well No. 11 from North Pocatello Park to the Old Airport cannot be approved as the distance is some six or seven miles and there is no assurance or valid presumption that the source of water is the same. Also, there are intervening permits.

We suggest withdrawal of application for amendment as far as Well No. 11 is concerned.

Very truly yours,

MARK R. KULP
State Reclamation Engineer

K:fg

20611

✓
July 17, 1953

RE: Permit No. 20611

City of Pocatello
Box 1469
Pocatello, Idaho

ATT: Mr. W. B. Webb, City Manager

Dear Mr. Webb:

Thank you very much for your letter of July 16, 1953, giving detailed location of the several wells on which proof of completion of works is to be made.

Since the location of Wells Nos. 10 and 11 has been changed, an application for amendment should be filed in this department for approval and record. We enclose a form of application for such amendment which should be signed and returned to this department.

Meanwhile, we have written a notice for publication, a copy of which is enclosed herewith. If this meets with your approval, please return and we shall send a copy to whatever newspaper you may designate, for publication.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A:fg
Enc.

20611

CITY OFFICES

EAST CENTER STREET

TELEPHONE 993

CITY OF POCATELLO

Idaho's Industrial Center

Pocatello, Idaho

July 16, 1953

RECEIVED
JUL 17 1953
Department of Reclamation

Mr. Mark R. Kulp
State Reclamation Engineer
Boise, Idaho

Dear Mr. Kulp:

Reference is made to your letter July 10, with regard to the discrepancy in descriptions of well locations.

It is our intention to make proof on wells that have been completed. The description given, letter July 8, was put together hurriedly and may have been misleading. However, I would like to point out that wells Nos. 8, 9, 10, 11 and 12 were in the stage of future planning when the permit was taken out. Therefore, amended permit descriptions will include well No. 10 located on Tydeman Field instead of Raymond Park and well No. 11 located at the Old Airport instead of North Pocatello Park.

The following is a revised description of wells for proof of completion of works due September 2, 1953. (see map also).

For Ross Park Wells (Nos. 1, 2, 3)
the center of Sec. 1, T. 7S., R. 34E., B.M.

For Rainey Park Wells (Nos. 4, 5, 6, 7)
the NW $\frac{1}{4}$ SW $\frac{1}{4}$ Sec. 15, T. 6S., R. 34E., B.M.

For North Pocatello Park Wells (No. 8)
the NW $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 35, T. 6S., R. 34E., B.M.

For Raymond Park Well (No. 9)
Blk. 557 Pocatello Original Townsite
in NW $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 27, T. 6S. R. 34E., B.M.

For Tydeman Field Well (No. 10)
Blk. 219 Original Pocatello Townsite
in N $\frac{1}{2}$ NE $\frac{1}{4}$ NW $\frac{1}{4}$ Sec. 26, T. 6S., R. 34E., B.M.

For Old Airport Well (No. 11)
near U.S. 30 North in the SE $\frac{1}{4}$ SW $\frac{1}{4}$ NE $\frac{1}{4}$ SE $\frac{1}{4}$
Sec. 12, T. 6S., R. 33E., B.M.

20611


Summary of data pertaining to the City of Pocatello water wells on which proof is to be made.

Well Number	Location	Date Well Completed	Capacity*	
			GPM	CGS
1.	Ross Park	1926	1000	2.22
2.	Ross Park	to	1400	3.12
3.	Ross Park	1930	1400	3.12
4.	Rainey Park	1930	1000	2.22
5.	Rainey Park	1930	1000	2.22
6.	Rainey Park	1936	1000	2.22
7.	Rainey Park	1940	1000	2.22
8.	North Pocatello Park	April 1953	1500	3.33
9.	Raymond Park	1948	450	1.00
10.	Tydeman Field	Sept. 1952	2400	5.33
11.	Old Airport	July 1952	450	1.00
			<u>12600</u>	<u>28.00</u>

* NOTE: The capacity of the wells is the maximum rate of discharge based on production records.

Yours very truly,

CITY OF POCATELLO



W. B. Webb
City Manager

WBW:mb
encl

20611

✓
July 10, 1953

RE: Permit No. 20611

City of Pocatello
Box 1469
Pocatello, Idaho

ATT: Mr. W. B. Webb, City Manager

Dear Mr. Webb:

We have your letter of July 8, 1953, giving locations of the several wells on which proof of completion of works is to be made.

However, this description does not exactly tie in to the description on the permit, although doubtless it is just another way of describing the same locations.

The permit describes three wells (Nos. 1, 2, and 3) in Ross Park; four wells (Nos. 4, 5, 6, and 7) in Rainey Park; two wells (Nos. 9 and 10) in Raymond Park; and three wells (Nos. 8, 11 and 12) in North Pocatello Park.

Is it your intention to make proof on all of these? If not, please indicate the wells to be proved up on.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A:fg

20611

CITY OFFICES

EAST CENTER STREET

TELEPHONE 993

CITY OF POCA TELLO

Idaho's Industrial Center

Pocatello, Idaho

July 8, 1953

RECEIVED
JUL 9 1953
Department of Reclamation

Mr. Mark R. Kulp,
State Reclamation Engineer,
Boise, Idaho.

Dear Mr. Kulp:

Reference is made to your letter July 7, with regard to duplicate notice for publication in connection with completion of works proof on Permit No. 20611.

Additional information required is as follows:

<u>Number of Well on which Proof is to be made</u>	<u>Location</u>	<u>G.P.M.</u>	<u>Second Feet</u>
1	Ross Park	1000	2.22
2	" "	1400	3.12
3	" "	1400	3.12
4	Idaho Street	1000	2.22
5	" "	1000	2.22
6	" "	1000	2.22
7	" "	1000	2.22
8	Valley View	1500	3.33
9	Raymond Park	450	1.00
10	North 8th Ave	2400	5.33
Old Airport	West of City	450	1.00
		12600	28.00

Yours very truly,
CITY OF POCA TELLO

W.B. Webb

W.B. Webb
City Manager

20611

✓
July 7, 1953

RE: Permit No. 20611

City of Pocatello
Box 1469
Pocatello, Idaho

ATT: Mr. W. B. Webb, City Manager

Dear Mr. Webb:

We acknowledge receipt of duplicate notice for publication in connection with completion of works proof on Permit No. 20611.

However, you have not indicated which wells proof is to be made on and since the permit calls for 54 second feet and proof is only being made on 28 second feet, it is necessary that the notice state definitely the location of the wells on which proof is to be made.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A:fg

20611

NOTICE TO ACCOMPANY THIS LETTER MUST BE MADE IN DUPLICATE

(Date) JULY 2, 1953

(P. O.) Box 1469 CITY OF POCA TELLO POCA TELLO, IDAHO

TO THE STATE RECLAMATION ENGINEER:

Boise, Idaho.

Dear Sir:

You are hereby authorized to have the attached notice published at my expense in the
NEWSPAPERS of BANNOCK COUNTY published in
the county in which the works are situated.

CITY OF POCA TELLO

H. B. Webb

City Manager

(In case of canals or other works designed to divert and carry more than 50 cubic feet of water per second, the following certificate must be signed by a well-known and competent engineer.)

I hereby certify that the facts set forth in the attached notice are true.

James N. Scudine
Engineer.
Ecologist

20611

State of Idaho
DEPARTMENT OF RECLAMATION
BOISE

July 1, 1953

INSTRUCTIONS

City of Pocatello
Pocatello
Idaho

PROOF OF COMPLETION OF WORKS

Boise, Idaho,

Dear Sir:—

I enclose herewith blank form upon which to give notice that you are prepared and desire to submit proof of completion of works under your permit No. 20611.

This form should be filled out and mailed to the Department of Reclamation, at least 60 days before the date upon which proof is to be submitted, which proof MUST be on or before September 2, 1953. Upon receipt of the blank properly filled out, notice of publication will be sent to the paper direct from this office, which notice must be published a period of four weeks prior to the date of proof.

The proof may be submitted at any place convenient to you and two witnesses, where there is a notary public or other officer authorized to administer oaths.

The certificate that shall be issued under this proof does not give you a perpetual right to the use of the water for which application is made, as it only confirms the completion of the works of a capacity to divert and convey to the place of intended use a certain amount of water. The law requires that another proof be submitted when the water has been fully applied to a beneficial use, at which time license is issued for the amount of water actually in use. Information in regard to this last proof will be furnished on request.

Very truly yours,

MARK R. KULP

State Reclamation Engineer

20611

September 24, 1949

Re: Permit No. 20611

City of Pocatello
Mr. B. M. Reese, City Clerk
Pocatello, Idaho

Dear Mr. Reese:

In answer to your inquiry of September 21, 1949, requesting if Bond filed in connection with Permit No. 20611 for Completion of Works is to remain in effect permanently, we wish to state that the Bond shall remain in force until Completion of Works is made by the applicant, according to the terms of the Permit.

Quoting from said Bond "the above bonded principle shall faithfully carry to completion the said works of diversion as specified in said Permit No. 20611, in the manner and form prescribed therein and within the time therein allowed, then the above obligation to be void, otherwise to remain in full force and effect."

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Roy W. Thompson
Supervisor of Water Distribution

RWT:bh

20611

W. W. HALSEY
MAYOR

CITY OF POCA TELLO

J. P. HALLIWELL, PRES OF COUNCIL
JAMES HOPPER, COUNCILMAN
R. J. DAVIS, COUNCILMAN
C. A. CARMACK, COUNCILMAN

CITY OFFICES

EAST CENTER STREET
TELEPHONE 993

ADDRESS REPLY TO

POCA TELLO, IDAHO

September 21, 1949



Mr. Mark R. Kulp
State Reclamation Engineer
Deaprtment of Reclamation
Boise, Idaho

Dear Sir:

Reference is made to permit No. 20611~~2~~ filed by the City of Pocatello in connection with subterranean water and particularly with regard to Bond form in amount of \$1,000 required in connection with this permit. We would like to know whether or not this Bond form is to remain in effect permanently in order that we may arrange for yearly renewal of the Bond.

Very truly yours,

CITY OF POCA TELLO


B.D. Reese
City Clerk

BDR:m

20611

October 19, 1948

Re: Permit No. 20611

Mr. B. D. Reese
City Clerk
Pocatello, Idaho

Dear Mr. Reese:

We acknowledge receipt of your letter of October 14 enclosing bond of the General Casualty Company in connection with Permit No. 20611 of the City of Pocatello, which has been duly placed on file.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A/st

20611

GEORGE R. PHILLIPS
MAYOR

OFFICE OF

CITY OF POCA TELLO


The Gateway to the Industrial Northwest

POCA TELLO, IDAHO

J. P. HALLIWELL, PRESIDENT OF THE COUNCIL
JAMES HOPPER, COUNCILMAN
JAMES H. BOWNS, COUNCILMAN
W. C. HINCKLEY, COUNCILMAN

City Clerk

October 14, 1948

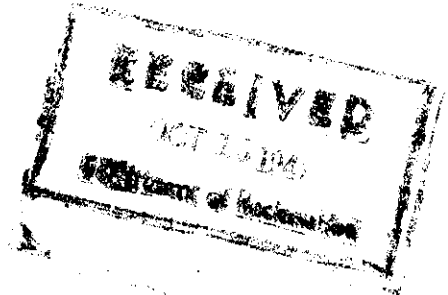

Mr. Mark R. Kulp,
State Reclamation Engineer,
Department of Reclamation,
State of Idaho,
Boise, Idaho.

Permit No. 20611, City of Pocatello.

Dear Mr. Kulp:

Reference is made to your letter of September 7th, in connection with Permit No. 20611, issued to the City of Pocatello for 54 cubic feet per second of subterranean water.

Attached hereto is bond in the sum of \$1,000, in accordance with conditions of the above mentioned permit.

Yours very truly
CITY OF POCA TELLO

B.D. Reese
City Clerk

20611

✓
September 23, 1948

Re: Permit No. 20611

Mr. F. E. Tydeman
Dietrich Building
Pocatello, Idaho

Dear Mr. Tydeman:

In reply to your letter of September 22
in regard to the bond to be furnished in connection
with Permit No. 20611:

Application was filed June 15, 1948, and
approved September 15, 1948; recorded in Book 74 of
Permits in the State Department of Reclamation.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A/et

20611

F. E. TYDEMAN
ATTORNEY AT LAW
DIETRICH BUILDING
POCATELLO, IDAHO

September 22, 1948.

Department of Reclamation
Boise
Idaho

Re: Permit No. 20611

Gentlemen:

I thank you for the form that you
mailed on the 21st inst.

So that I may have all of the inform-
ation to complete the form of bond, I would appreciate
having you give me the following information:

Date of filing of application for permit.
Book and page of recording in the
office of the Commissioner.

When I have received this information
I shall have the bond prepared and sent to you.


FET:ML

Yours very truly,

F. E. Tydeman

Subd. 6-15-48
app. 9-2-48

RK 74

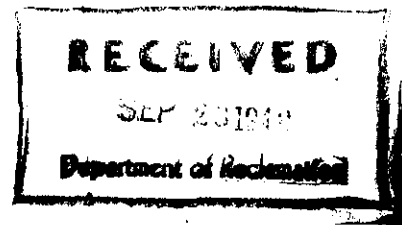

20611

September 21, 1948

Re: Permit No. 20611

Mr. F. E. Tydeman
Dietrich Building
Pocatello, Idaho

Dear Mr. Tydeman:

We acknowledge receipt of your letter of September 16 enclosing a form of bond to be submitted in connection with Permit No. 20611 in the name of the City of Pocatello.

This form does not exactly fit the conditions as the bond is really in connection with the completion of works as described in the permit.

We enclose a printed form of bond which was formerly used when a personal bond was required and which we think will give you an idea as to the form of surety bond to be used.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk


A/gt

Enc.

20611

F. E. TYDEMAN
ATTORNEY AT LAW
DIETRICH BUILDING
POCATELLO, IDAHO

September 17, 1948

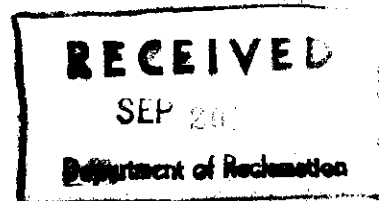

Mr. Mark R. Kulp, Engineer
Department of Reclamation
Boise, Idaho

Dear Sir:

Mr. William J. Spier, Superintendent of the Water Department of the city of Pocatello, advises me that the city will be required to post a bond in the sum of \$1,000.00 in connection with the application for the right to use subterranean water for city purposes.

I have prepared a form of bond which is enclosed. If this form is not satisfactory I would appreciate having you change the same to conform with your requirements, and return the same to me.

We expect to have the bond issued by a surety company authorized to do business in the State of Idaho.

FET:ML
Encl.

Yours very truly,
F. E. Tydeman

20611

September 7, 1948

Re: Permit No. 20611

Mr. W. J. Speir
Water Superintendent
Pocatello, Idaho

Dear Mr. Speir:

We enclose Permit No. 20611 issued to the City of Pocatello for 54 cubic feet per second of subterranean water.

As you will note one of the conditions of this permit is that a bond in the sum of \$1,000 be filed with this Department on or before December 2, 1948.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A/gt

Enc.

20611

BOND

KNOW ALL MEN BY THESE PRESENTS, That the City of Pocatello, a municipal corporation of Bannock County, State of Idaho, as principal, and General Casualty Company, as surety, are held and firmly bound unto the State of Idaho, in the full and just sum of One Thousand Dollars (\$1,000.00), lawful money of the United States, to the payment of which sum, well and truly to be made, said principal and surety bind themselves, and their successors and assigns, jointly and severally, under the terms and conditions hereinafter set forth.

The terms of this obligation are such that, whereas the above named principal on the 15th day of June, 1948, filed in the office of the Commissioner of Reclamation in Boise, Idaho, a certain application for permit to appropriate the public waters of the State of Idaho, the said application being thereupon numbered No. 20611, in accordance with which said application the Commissioner of Reclamation granted and issued to the said principal herein a certain permit numbered No. 20611, a full, true and complete copy of which application No. 20611, and permit No. 20611, is of record in the office of the Commissioner of Reclamation in Book 74 of Permits, at page 20611.

Now if the above bounden principal shall faithfully carry to completion the said works of diversion as specified in said application No. 20611, and permit No. 20611, in the manner and form prescribed therein and within the time therein allowed, then the above obligation to be void, otherwise to remain in full force and effect.

IN WITNESS WHEREOF, the said principal and surety have hereunto set their hands and seals this 7 day of September, 1948.

ATTEST:

[Signature]
Clerk

CITY OF POCA TELLO, IDAHO,
a Municipal corporation.

By

[Signature]
Mayor.

20611

Countersigned:
BRYAN AND COMPANY

A. R. Cael
Agent.

GENERAL CASUALTY COMPANY
BRYAN AND COMPANY

By A. R. Cael
Its Attorney in Fact.

20611

NUMBER

165052

GENERAL CASUALTY COMPANY OF AMERICA

SEATTLE, WASHINGTON

Bond

ON BEHALF OF

CITY OF POCAHONTO

TO

STATE OF IDAHO

Effective September 7, 1948

Expires , 19

BREAN & COMPANY

GEORGE R. PHILLIPS
MAYOR

OFFICE OF

City Clerk

CITY OF POCA TELLO

The Gateway to the Industrial Northwest
POCA TELLO, IDAHO

August 25, 1948

J. P. HALLIWELL, PRESIDENT OF THE COUNCIL
JAMES HOPPER, COUNCILMAN
JAMES H. BOWNS, COUNCILMAN
C. D. GARRISON, COUNCILMAN

RECEIVED

AUG 27 1948

Department of Reclamation

Re: Application No. 28180

Mr. Mark Kulp,
State Reclamation Engineer,
State of Idaho,
Boise, Idaho.

Dear Mr. Kulp:

Reference is made to your letter August 24, above file.

Attached hereto is "Proof of Publication" as issued by the
Pocatello Tribune, in connection with our request to appropriate public
waters.

Yours very truly,
CITY OF POCA TELLO

B.D. Reese
City Clerk

20611

August 24, 1948

Re: Application No. 28180

Mr. B. D. Reese
City Clerk
Pocastello, Idaho

Dear Mr. Reese:

There have been no protests filed against the application of the City of Pocastello to appropriate 54 second feet of subterranean water.

Therefore upon receipt of the affidavit of publication, which the Pocastello Tribune was instructed to send you, the application will be approved and permit issued.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A/gt

20611

PROOF OF PUBLICATION

STATE OF IDAHO
County of Bannock

} ss.

Mary Sievers

being first duly sworn on oath deposes and says: That she
was at all times herein mentioned a citizen of the United States of
America, more than 21 years of age, and the Principal Clerk of THE
POCATELLO TRIBUNE, a daily newspaper, printed and published
at Pocatello, Bannock County, Idaho, and having a general circula-
tion therein.

That the document or notice, a true copy of which is attached,
was published in the said POCATELLO TRIBUNE, on the follow-
ing dates, to-wit:

July 26	, 19 48	, 19
August 2	, 19 48	, 19
August 9	, 19 48	, 19
	, 19	, 19
	, 19	, 19

That said paper has been continuously and uninterruptedly pub-
lished in said County for a period of seventy-eight weeks prior to the
publication of said notice or advertisement and is a newspaper within
the meaning of the laws of Idaho.

Mary Sievers

Subscribed and sworn to before me this 12th

day of August, 19 48.

Muriel L. Ruggles

Notary Public, State of Idaho

Residence: Pocatello, Idaho

20611

PROOF OF PUBLICATION

STATE OF IDAHO }
County of Bannock } ss.

Legal Advertisement

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
NOTICE OF APPLICATION TO APPROPRIATE THE PUBLIC WATERS OF THE STATE OF IDAHO IN ACCORDANCE WITH THE PROVISIONS OF SECTION 41-203, IDAHO CODE ANNOTATED.

NOTICE IS HEREBY GIVEN That on the 15th day of June, 1948, The City of Pocatello, a municipal corporation, made application to appropriate Fifty-four (54) cubic feet per second of subterranean water under the City of Pocatello, on City owned property, for domestic supply for the City of Pocatello and adjacent area.

That the points of diversion, or location of the wells from which this water is to be obtained, are in Sections 15, 35 and 27, Township 6 South, Range 34 East, B. M., and Section 1, Township 7 South, Range 34 East, B. M.

That any protests against the approval of this application must be filed in the Department of Reclamation, at Boise, Idaho, within forty (40) days from the date of this notice; and such protest shall state the name and address of the protestant, and shall clearly set forth his objections to the approval of the said application.

Dated this 13th day of July, 1948.

MARK R. KULP
State Reclamation
Engineer

Date of first publication: July 26, 1948.

Date of last publication: Aug. 9, 1948

Last date for protest: August 22, 1948.

SERVICE of the foregoing, by copy, is hereby acknowledged, this 15th day of July, 1948.

CITY OF POCATELLO
By George R. Phillips
Its Mayor.

20611 J. 26.-Aug. 2.-9

being first duly sworn on oath deposes and says: That _____
was at all times herein mentioned a citizen of the United States of America, more than 21 years of age, and the Principal Clerk of THE POCATELLO TRIBUNE, a daily newspaper, printed and published at Pocatello, Bannock County, Idaho, and having a general circulation therein.

That the document or notice, a true copy of which is attached, was published in the said POCATELLO TRIBUNE, on the following dates, to-wit:

_____, 19____, _____, 19____
_____, 19____, _____, 19____
_____, 19____, _____, 19____
_____, 19____, _____, 19____
_____, 19____, _____, 19____

That said paper has been continuously and uninterruptedly published in said County for a period of seventy-eight weeks prior to the publication of said notice or advertisement and is a newspaper within the meaning of the laws of Idaho.

Mary Livers

Subscribed and sworn to before me this _____, 19____

day of _____, 19____

Notary Public, State of Idaho

Residence: Pocatello, Idaho

20611

✓
July 27, 1948

RE: Application No. 28180

Pocstello Tribune
Pocstello, Idaho

Gentlemen:

We acknowledge receipt of a copy of your issue of July 26 containing notice of application of the City of Pocstello for a water right.

We find this to be correct with the exception that the name of the State Reclamation Engineer should be spelled Kulp instead of Culp.

Please make this correction in your other publications.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A/st

70611

UNDERTAKING IN CONNECTION WITH
APPLICATION FOR WATER PERMIT

WHEREAS, the City of Pocatello, Idaho, a municipal corporation, located in Bannock County, State of Idaho, desires to give an undertaking in connection with an application for a permit to be issued by the Department of Reclamation of the State of Idaho, as provided by Section 41-204 Idaho Codes Annotated;

NOW, THEREFORE, we, the undersigned sureties, do hereby obligate ourselves to the State of Idaho, under said statutory obligation, in the amount fixed by the Department of Reclamation of the State of Idaho, in the sum of \$1,000.00.

Dated September _____, 1948.

Countersigned:

A Corporation.

Agent.

20611

July 24, 1948

Re: Application No. 28180

Pocastello Tribune
Pocastello, Idaho

Gentlemen:

We enclose copy of notice to be published once a week for three consecutive weeks beginning with your next issue.

The expense of the publication is to be paid by the City of Pocastello to whom you will please send an affidavit of publication when same is copied.

Please acknowledge receipt of this notice and send us a copy of your first issue containing same.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A/gt

Enc.

20611

July 24, 1948

Mr. B. D. Reese
City Clerk
Pocatello, Idaho

Dear Mr. Reese:

We acknowledge receipt of your letter of July 21 returning "Notice of Application" together with authority to have same published in the Pocatello Tribune.

A copy of the notice is being sent to the Tribune today with instructions to publish it once a week for three consecutive weeks beginning with the next issue and to send you the affidavit of publication together with statement of costs.

If no protest is filed, the application will be approved and permit issued upon receipt from you of the affidavit of publication. Should there be any protests you will be duly notified before final action is taken.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A/gt

20611

GEORGE R. PHILLIPS
MAYOR

OFFICE OF City Clerk


CITY OF POCA TELLO

The Gateway to the Industrial Northwest

POCA TELLO, IDAHO

July 21, 1948

J. P. HALLIWELL, PRESIDENT OF THE COUNCIL
JAMES HOPPER, COUNCILMAN
JAMES H. BOWNE, COUNCILMAN
O. D. GARRISON, COUNCILMAN

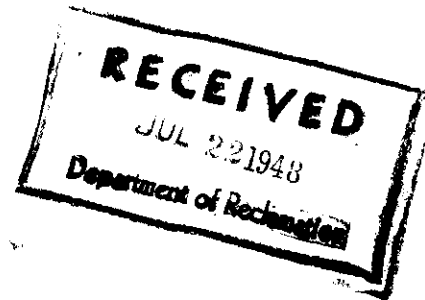

Mark L. Kulp , State Reclamation Engineer
State Department of Reclamation
Boise, Idaho

Re: Application No. 28180

Dear Mr. Kulp:

Reference is made to your letter July 13 regarding
the above subject.

Attached hereto is "Notice of Application" together
with notice authorizing publication at our expense.

Yours very truly,

CITY OF POCA TELLO

B. D. Reese
City Clerk

BDR:ts
Enc.

20611

NOTICE TO ACCOMPANY THIS LETTER MUST BE MADE IN DUPLICATE

(Date) _____

(P. O.) _____

July 21, 1948
Pocatello, Idaho

STATE RECLAMATION ENGINEER
TO THE ~~COMMISSIONER OF RECLAMATION~~

Boise, Idaho.

Dear Sir:

You are hereby authorized to have the attached notice published at my expense in the
Pocatello Tribune of *Pocatello, Idaho*, published in
the county in which the works are situated.

George F. Phillips
CITY OF POCATELLO

Mayor

(In case of canals or other works designed to divert and carry more than 50 cubic feet of water
per second, the following certificate must be signed by a well-known and competent engineer)

I hereby certify that the facts set forth in the attached notice are true.

Engineer.

20611

STATE OF IDAHO

DEPARTMENT OF RECLAMATION

NOTICE OF APPLICATION TO APPROPRIATE THE PUBLIC WATERS OF THE STATE OF IDAHO
IN ACCORDANCE WITH THE PROVISIONS OF SECTION 41-203, IDAHO CODE ANNOTATED.

NOTICE IS HEREBY GIVEN That on the 15th day of June, 1948, The City of Pocatello, a municipal corporation, made application to appropriate Fifty-four (54) cubic feet per second of subterranean water under the City of Pocatello, on City owned property, for domestic supply for the City of Pocatello and adjacent area.

That the points of diversion, or location of the wells from which this water is to be obtained, are in Sections 2, 15, 35 and 37, Township 8 South, Range 34 East, B. M., and Section 1, Township 7 South, Range 34 East, B. M.

That any protests against the approval of this application must be filed in the Department of Reclamation, at Boise, Idaho, within forty (40) days from the date of this notice; and such protest shall state the name and address of the protestant, and shall clearly set forth his objections to the approval of the said application.

Dated this 15th day of July, 1948.

Mark R. Kulp
MARK R. KULP
State Reclamation Engineer

Date of first publication: _____
Date of last publication: _____
Last date for protest: August 22, 1948.

SERVICE of the foregoing, by copy, is hereby acknowledged, this
_____ day of July, 1948.

CITY OF POCA TELLO
By

Its _____

20611

STATE OF IDAHO

DEPARTMENT OF RECLAMATION

NOTICE OF APPLICATION TO APPROPRIATE THE PUBLIC WATERS OF THE STATE OF IDAHO
IN ACCORDANCE WITH THE PROVISIONS OF SECTION 41-203, IDAHO CODE ANNOTATED.

NOTICE IS HEREBY GIVEN That on the 15th day of June, 1948, The City of Pocatello, a municipal corporation, made application to appropriate Fifty-four (54) cubic feet per second of subterranean water under the City of Pocatello, on City owned property, for domestic supply for the City of Pocatello and adjacent area.

That the points of diversion, or location of the wells from which this water is to be obtained, are in Sections 2, 15, 35 and 27, Township 6 South, Range 34 East, B. M., and Section 1, Township 7 South, Range 34 East, B. M.

That any protests against the approval of this application must be filed in the Department of Reclamation, at Boise, Idaho, within forty (40) days from the date of this notice; and such protest shall state the name and address of the protestant, and shall clearly set forth his objections to the approval of the said application.

Dated this 13th day of July, 1948.

Mark R. Kulp
MARK R. KULP
State Reclamation Engineer

Date of first publication: _____
Date of last publication: _____
Last date for protest: August 22, 1948.

15 SERVICE of the foregoing, by copy, is hereby acknowledged, this
day of July, 1948.

CITY OF POCATELLO
By *George Phillips*
Its Mayor

20661

July 13, 1948

Re: Application No. 28180

Mr. W. J. Speir
Water Superintendent
Pocatello, Idaho

Dear Mr. Speir:

We enclose Departmental Receipt No. 20737 for the filing fee of \$18.25 on your application for permit to appropriate 54 second feet of subterranean water for domestic water supply.

As mentioned in our letter of June 12, 1948, three weeks' publication is required on filings of this size, and we enclose duplicate copies of such notice herewith. Please acknowledge service on the original, retaining the copy for your own files.

In returning same, please also return Form 11, enclosed, which is your authorization for us to have the notice published at your expense in the designated county newspaper.

We shall then send a copy of the notice to the newspaper, with instructions in regard to publishing.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

K: A
Encl.

20611

June 15, 1948

Mr. W. J. Speir,
Water Superintendent
Pocatello, Idaho

Dear Mr. Speir:

We return the voucher for the \$18.25 filing fee on
your permit application which has been duly signed by the
State Reclamation Engineer.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A/dm
Enc.

20611

City of Pocatello

The Gateway to the Industrial Northwest


GEORGE R. PHILLIPS
MAYOR

POCATELLO, IDAHO

June 14, 1948

OFFICE OF Water Superintendent

J. P. HALLIWELL, PRESIDENT OF THE COUNCIL
JAMES HOPPER, COUNCILMAN
JAMES H. BOWNS, COUNCILMAN
O. D. GARRISON, COUNCILMAN

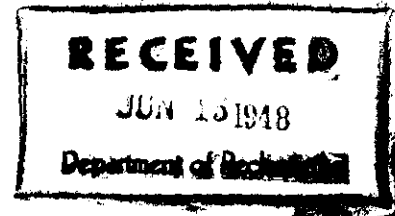

Mark R. Kulp, State Reclamation Engineer
Idaho Department of Reclamation
Boise, Idaho


Dear Mr. Kulp:

Enclosed you will find City of Pocatello claim form
in the amount of \$18.25 for statutory filing fee for permit to
appropriate subterranean water for domestic supply.

Will you please sign this form and return to us
for payment.

Yours very truly,

CITY OF POCATELLO


W. J. Speir
Water Superintendent

WJS:ts
Enc.

20611

June 12, 1948

Mr. W. J. Speir,
Water Superintendent
Pocatello, Idaho

Dear Mr. Speir:

Your letter of May 28, 1948 reached us on June 10th enclosing application for permit to appropriate subterranean water for domestic supply for the City of Pocatello.

This application will be placed on file upon receipt of the statutory fee of \$18.25, being at the rate of \$5.00 for the first second foot and twenty-five cents for each additional second foot.

As you no doubt know applications of this size require three weeks publication and the proper form of notice will be made and sent you upon receipt of the filing fee.

Very truly yours,

MARK R. KULP
State Reclamation Engineer
By

Chief Clerk

A/dm

20611

City of Pocatello

The Gateway to the Industrial Northwest

GEORGE R. PHILLIPS
MAYOR

POCATELLO, IDAHO

May 28, 1948

J. P. HALLIWELL, PRESIDENT OF THE COUNCIL
JAMES HOPPER, COUNCILMAN
JAMES H. BOWNS, COUNCILMAN
O. D. GARRISON, COUNCILMAN

OFFICE OF

Water Superintendent


Mr. Mark Kulp
State Reclamation Engineer
State of Idaho
Boise, Idaho


Dear Mr. Kulp:

Attached is our Application for Permit to Appropriate
Public Water for the use of the City of Pocatello. Also
attached are two copies of the map which you suggested
be included with the application.

We would appreciate any information you have relative
to your success in getting the Idaho State Reclamation
Association to adopt the resolution backing the retirement
system which we are sincerely developing.

Very truly yours,

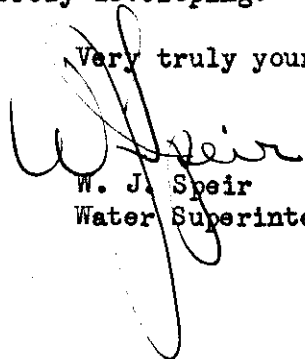
W. J. Speir
Water Superintendent

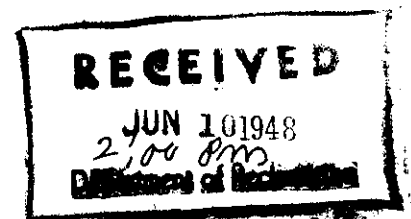

20611

April 1, 1948

Mr. W. J. Speir
Water Superintendent
City of Pocatello
Pocatello, Idaho

Dear Mr. Speir:

In reply to your letter of March 26, 1948:

We would suggest that you estimate the water requirements for the City of Pocatello eleven years in advance, or even further, and make application to this department for permit to appropriate, asking the maximum time of five years for completion of works, and the maximum additional time of six years for proof of beneficial use.

The location of the wells, and the anticipated yield of each, should be as definite as can be determined at this time, and amended as necessary during the development period.

As the source of supply would be the same for all the wells, i. e. subterranean, they could be made on one permit, with as many points of diversion as there are wells.

The city can always condemn and purchase other water rights for domestic water supply, but the cheapest and most logical method would be to appropriate through the statutory procedure.

The subterranean sources of supply all over the state are being rapidly developed.

We are enclosing the necessary forms and instructions for filing.

Very truly yours,

MARK H. KUIP

State Reclamation Engineer

R:1A
Encls.

20611

City of Pocatello

The Gateway to the Industrial Northwest

GEORGE R. PHILLIPS
MAYOR

POCATELLO, IDAHO

March 26, 1948

J. P. HALLIWELL, PRESIDENT OF THE COUNCIL
JAMES HOPPER, COUNCILMAN
JAMES H. BOWNS, COUNCILMAN
O. D. GARRISON, COUNCILMAN

OFFICE OF
Water Superintendent


Mr. Mark Kulp
State Reclamation Engineer
State of Idaho
Boise, Idaho

Dear Sir:

The future of the water supply to meet the requirements for the City of Pocatello lies in obtaining water from underground sources by drilling wells in the valley.

We have been discussing the need for filing of water rights on this underground water source to insure our present supply and also the future. We would appreciate your thoughts regarding this and also advice as to the procedure.

Very truly yours,


W. J. Speer
Water Superintendent



20611

Legal Advertisement

STATE OF IDAHO
DEPARTMENT OF RECLAMATION
NOTICE OF APPLICATION TO APPROPRIATE THE PUBLIC WATERS OF THE STATE OF IDAHO IN ACCORDANCE WITH THE PROVISIONS OF SECTION 41-203, IDAHO CODE ANNOTATED.

NOTICE IS HEREBY GIVEN That on the 15th day of June, 1948, The City of Pocatello, a municipal corporation, made application to appropriate Fifty-four (54) cubic feet per second of subterranean water under the City of Pocatello; on City owned property, for domestic supply for the City of Pocatello and adjacent area.

That the points of diversion, or location of the wells from which this water is to be obtained, are in Sections 15, 35 and 27, Township 6 South, Range 34 East, B. M., and Section 1, Township 7 South, Range 34 East, B. M.

That any protests against the approval of this application must be filed in the Department of Reclamation, at Boise, Idaho, within forty (40) days from the date of this notice; and such protest shall state the name and address of the protestant, and shall clearly set forth his objections to the approval of the said application.

Dated this 13th day of July, 1948.

MARK R. CULP
State Reclamation
Engineer

Date of first publication: July 26, 1948.

Date of last publication: Aug. 9, 1948.

Last date for protest: August 22, 1948.

SERVICE of the foregoing, by copy, is hereby acknowledged, this 15th day of July, 1948.

CITY OF POCATELLO
By George R. Phillips
Its Mayor.

J. 26.-Aug. 2,-9

Litt

Legal Advertisement

NOTICE OF APPLICATION FOR WATER TO BENEFICIAL USE

Notice is hereby given that at 10 A.M. on the 16th day of September, 1958, at Pocatello, County of Bannock, State of Idaho, before H. D. Reese, Notary Public, proof will be submitted of the application to beneficial use of 27 cubic feet per second of the waters of Subterranean origin in accordance with the terms and conditions of Permit No. 20611 heretofore issued by the Reclamation Engineer of the State of Idaho.

The name and postoffice address of the person or corporation holding said permit are City of Pocatello, Pocatello, Idaho.

The use to which said water has been applied is Domestic, Municipal Water System.

The amount applied to beneficial use is 27 cfs.

The place where said water is used (if for irrigation, give full and accurate description of the lands irrigated) City of Pocatello, Pocatello, Idaho, with points of diversion as follows—Wells No. 4, 5, 6 & 7 in NW $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 35; No. 8 in NW $\frac{1}{4}$ SW $\frac{1}{4}$ Sec. 15; No. 9 in NW $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 27; No. 10 in NE $\frac{1}{4}$ NW $\frac{1}{4}$ Sec. 26; all in Twp. 6 So., Rge. 34 E.B.M.; No. 1 in NW $\frac{1}{4}$ NE $\frac{1}{4}$; No. 2 & 3 in SW $\frac{1}{4}$ NE $\frac{1}{4}$; all in Sec. 1, Twp. 7 So., Rge. 34 E. B.M.

works is based upon Permit No. 20611.

The source of supply from which such water is diverted is Subterranean origins.

The date of priority which said user is prepared to establish is June 15, 1948.

E. N. HUMPHREY
Deputy State
Reclamation Engineer
June 26, July 3, 10, 17, 1958.

NOTICE FOR PUBLICATION

Notice is hereby given that at 10 A.M., on the 2nd day of September 1953, at Pocatello County of Bannock, State of Idaho, before H. D. Reese, a Notary Public proof will be submitted of the completion of works for the diversion of 27 cubic feet per second of the waters of subterranean origin from the following wells in accordance with the terms and conditions of a certain permit heretofore issued by the Department of Reclamation of the State of Idaho.

Ross Park Wells (Nos. 1, 2, 3) the center of NE $\frac{1}{4}$ Sec. 1, T. 7S, R. 34E., B.M.

Rainey Park Wells (Nos. 4, 5, 6, 7) the NW $\frac{1}{4}$ SW $\frac{1}{4}$ Sec. 15, T. 6S., R. 34E., B.M.

North Pocatello Park Well (No. 8) NW $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 35, T. 6S, R. 34 E.B.M.

Raymond Park Well (No. 9) Blk. 557 Pocatello Original Townsite in NW $\frac{1}{4}$ SE $\frac{1}{4}$ Sec. 27, T. 6S, R. 34E., B.M.

Tydemann Field Well (No. 10) Blk. 219 Original Pocatello Townsite in N $\frac{1}{2}$ NE $\frac{1}{4}$ NW $\frac{1}{4}$ Sec. 26, T. 6S, R. 34 E, B.M.

1. The name of the person or corporation holding said permit is City of Pocatello.

2. The postoffice address of such person or principal place of business of such corporation is P. O. Box 1489 Pocatello, Idaho, County of Bannock, State of Idaho.

3. The number of such permit is 20611, and the date set for the completion of such work is September 2, 1953.

4. Said water is to be used for domestic supply for City of Pocatello and adjacent area.

5. Said works of diversion will be fully completed on the date set for such completion, and the amount of water which said works are capable of conducting to the place of intended use, in accordance with the plans accompanying the application for such permit, is 27 cubic feet per second.

MARK R. KULP
State Reclamation
Engineer

Aug 4, 11, 18, 25.