State of Idaho
Department of Water Resources

Water Right License

Water Right No. 63-34796

Priority: September 19, 2019

Maximum Diversion Rate: 0.11 CFS
Maximum Diversion Volume: 17.1 AF

It is hereby certified that:

KIRBY D VICKERS PO BOX 237 HUSTON ID 83630-0237

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated September 19, 2019, and has submitted Proof of Beneficial Use on April 18, 2022. An examination confirms water is diverted from:

Source : GROUND WATER

Beneficial Use	Period of Use	Rate of Diversion	Annual Volume
IRRIGATION	03/01 to 11/15	0.11 CFS	17.1 AF

Location of Point(s) of Diversion
GROUND WATER SW¼ NW¼, Sec. 14, Twp 03N, Rge 04W, B.M. CANYON County

Place of Use: IRRIGATION

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
03N	04W	14					1.6			2.2									3.8

Total Acres: 3.8

Conditions of Approval

1. This right when combined with all other rights shall provide no more than 0.03 cfs per acre nor more than 4.5 afa per acre at the field headgate for irrigation of the place of use.
2. After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to use power records to determine the amount of water diverted and shall annually report the information to the Department.
3. When ordered by the Director, the right holder shall provide mitigation acceptable to the Director to offset depletion of lower Snake River flows needed for migrating anadromous fish. The amount of water required for mitigation, which is to be released into the Snake River or a tributary for this purpose, will be determined by the Director based upon the reduction in flow caused by the use of water pursuant to this right. Any order of the Director issued in accordance with this paragraph shall be in conformance with applicable rules allowing the right holder due process as the need for mitigation and the amount of mitigation are determined.

SCANNED
MAY 18 2023

State of Idaho
Department of Water Resources

Water Right License

Water Right No. 63-34796

This license is issued pursuant to the provisions of Idaho Code § 42-219. The water right confirmed by this license is subject to all prior water rights and shall be used in accordance with Idaho law and applicable rules of the Department of Water Resources.

Signed this 16th day of May, 2023.

SCOTT STORMS
Water Rights Supervisor


SCANNED
MAY 18 2023

State of Idaho
Department of Water Resources

Attachment to Water Right

63-34796

This map depicts the IRRIGATION place of use boundary for this water right at the time of this approval and is attached to the approval document solely for illustrative purposes.

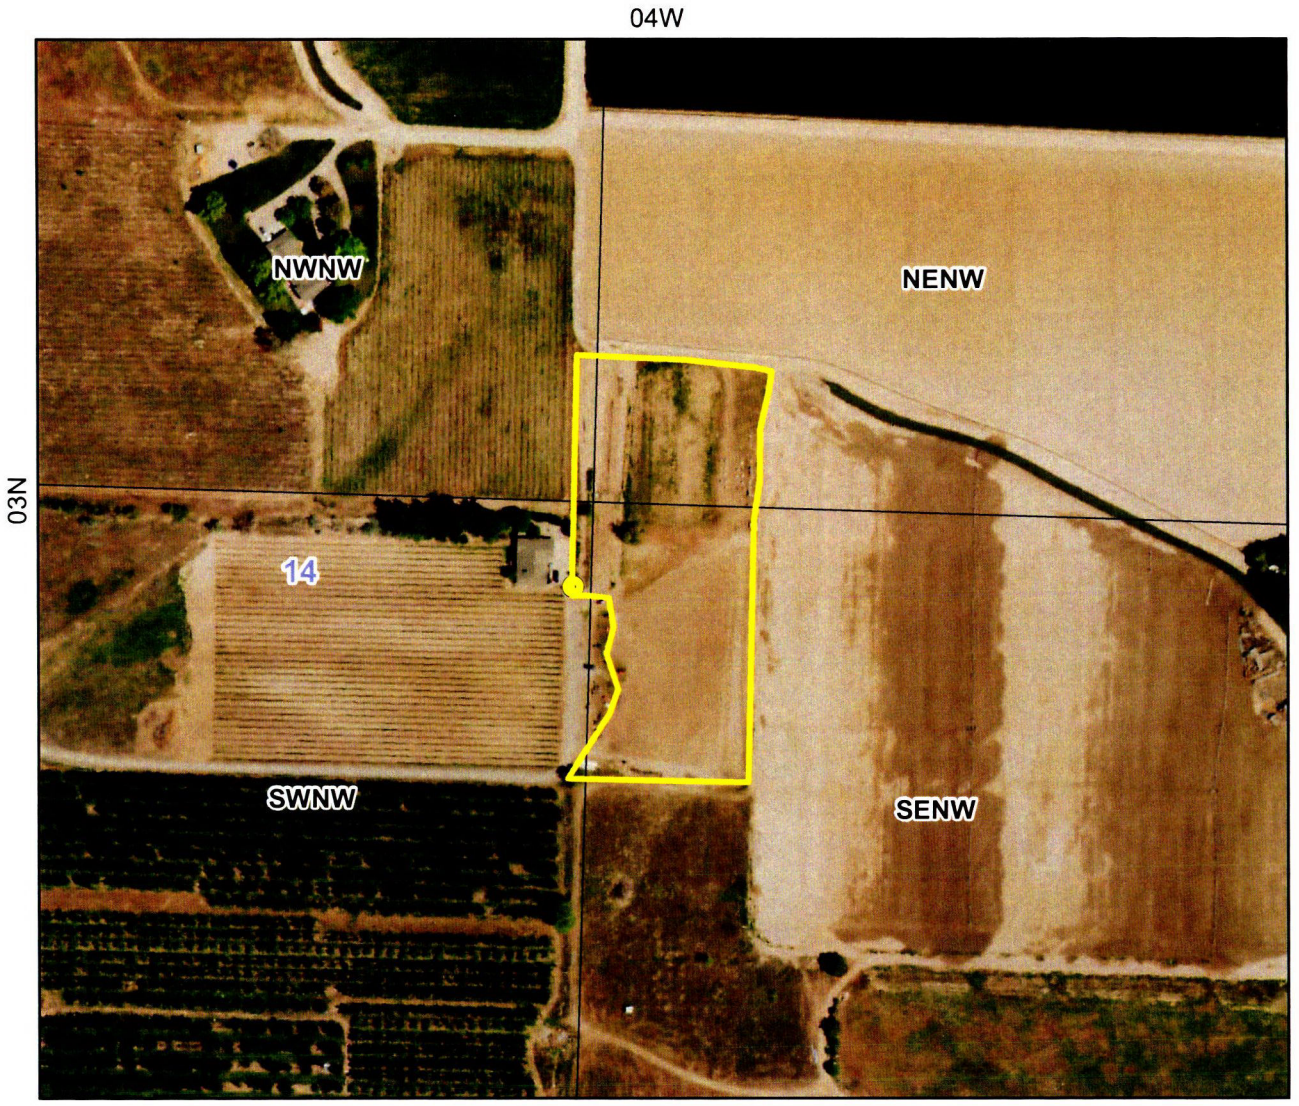

SCANNED
MAY 18 2023

CERTIFICATE OF SERVICE

I hereby certify that on May 17, 2023, I served a true and correct copy of Water Right License No. 63-34796 by U.S. Mail, postage prepaid, to the following:

KIRBY D VICKERS
PO BOX 237
HUSTON ID 83630-0237

Lynne Evans
Administrative Assistant I

SCANNED
MAY 18 2023

EXPLANATORY INFORMATION TO ACCOMPANY A PRELIMINARY ORDER

(To be used in connection with actions when a hearing was **not** held)

(Required by Rule of Procedure 730.02)

The accompanying order or approved document is a "**Preliminary Order**" issued by the department pursuant to section 67-5243, Idaho Code. **It can and will become a final order without further action of the Department of Water Resources ("department") unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:**

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. **Note: the petition must be received by the department within this fourteen (14) day period.** The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after: (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the Department or the Water Resource Board is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the Department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

SCANNED
MAY 18 2023

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01303 (Rules of Procedure 302 and 303).

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

> Unless a different date is stated in a final order, the order is effective fourteen (14) days after its service date if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:
>
> (a) The petition for reconsideration is disposed of; or
> (b) The petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

i. A hearing was held,
ii. The final agency action was taken,
iii. The party seeking review of the order resides, or
iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

SCANNED
MAY 18 2023

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No: 63-34796
Exam Date: 04/26/2023

1. Current Owner:
KIRBY D VICKERS PO BOX 237 HUSTON ID 83630-0237

2. Accompanied by: Kirby Vickers
Phone No: 208-376-7330
Address: 5646 SUNNYSLOPE RD CALDWELL, ID 83605
Relationship to permit Holder: Permit holder.

3. **SOURCE:**
GROUND WATER

Method of Determination: **Field observation/exam performed**

B. OVERLAP REVIEW

1. Other water rights with the same place of use: YES Overlap

Water Right No.	Source	Purpose of Use	Basis
63-11286	Ground Water	Irrigation	License

Comments: at the time of this field exam it was discovered that 63-11286 was incorrectly described in the license and is now known to overlap a portion of the place of use for this permit. A transfer is to be filed to correctly describe the place of use of 63-11286.

2. Other water rights with the same point-of-diversion: NO Overlap

Water Right No.	Source	Purpose of Use	Basis
None			

Comments: _____

C. DIVERSION AND DELIVERY SYSTEM

1. **LOCATION OF POINT(S) OF DIVERSION:**
GROUND WATER SW¼ NW¼, Sec. 14, Twp 03N, Rge 04W, B.M. CANYON County

Method of Determination: Garmin Handheld GPS Coordinates: N 43.5597 / W 116.78755

PLACE OF USE: IRRIGATION

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
03N	04W	14					1.6			2.2									3.8

Total Acres: 3.8

SCANNED
MAY 18 2023

Method of Determination: Field observation, ArcGIS tools, coupled with review of aerial images taken during the development period.

3.

Delivery System Diagram Attached (required). Indicate all major components and distances between components.
X Indicate weir size/pipe as applicable.

Map Attached Showing Location(s) of point(s) of diversion and place(s) of use (required). Scale must be
X 1:24,000 or greater.

n/a Aerial Photo Attached (required for irrigation of 10+ acres).

X Photo of Diversion and System Attached

4.

Well or Diversion ID No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
D0087790		5HP			2" DISCHARGE

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
Closed Conduit Meter	Ultra-Sonic	GE Panametric	PT878	281888	2.0 MHz transducers	April 5, 2023

2. Measurements: Used the Panametric PT878 to collect measurements during field exam

E. FLOW CALCULATIONS

_____ Additional Computation Sheets Attached

Measured Method: Transducer, ultra-sonic.
69255.30 – 68717.69 = 534.602 / 448.83 = 1.191101308 x .1 = 0.11911 = 0.12 cfs
69255.30 – 68717.69 = 534.602 x .1 = 53 gpm

Measured Irrigation Rate	0.12 cfs.
Standard rate/acres 0.03 x 3.8 ac =	0.11 cfs.
Permitted Total Rate	0.18 cfs.
License Recommendation	0.11 cfs.

SCANNED
MAY 18 2023

F. VOLUME CALCULATIONS

1. Volume Calculations for irrigation:

$V_{I.R}$ = (Acres Irrigated) x (Irrigation Requirement) = 3.8 ac x 4.5 af/ac y = 17.1af/y
$V_{D.R}$ = [Diversion Rate (cfs)] x (Days in Irrigation season) x 1.9835 = (0.12cfs) x (185 days) x 19835 = 44.0
V = Smaller of $V_{I.R}$ and $V_{D.R}$ = 17.1

2. Volume Calculations for Other Uses: None

G. NARRATIVE/REMARKS/COMMENTS

IDWR staff Clint Lindow and Justin Shearer conducted a field exam on Thursday, April 26, 2023, accompanied by Kirby Vickers (the permit holder). Current tax lot data represents that the permit holder owns the land at the permitted Place of Use (POU) and the Point of Diversion (POD) in SW ¼ NW ¼, NE ¼ NW ¼, and SE ¼ NW ¼ of Section 14.

The permit authorized irrigation of up to a total of 9.2 acres, including up to 5.0 acres within the SWNW of Section 14. However, based on a review of IDWR records and discussions with Mr. Vickers, it is clear Mr. Vickers had been developed water right 63-11286 in the SWNW prior to applying for permit 63-34796. It appears water right 63-11286 was incorrectly described in the 1993 license and so the overlap was not noticed by IDWR staff during the permitting process for 63-34796. As a result, Mr. Vickers did not develop a new use in the SWNW under the permit for 63-34796. During the field examination, IDWR staff confirmed the well drilled in 1990 for water right 63-11286 delivers water to the irrigated land in the SWNW of Section 14 only, and the well drilled in 2021 for permit 63-34796 delivers water only to the permitted place of use in the NENW and SENW of Section 14. Mr. Vickers is expected to file an application for transfer to change the legal description of the place of use and point of diversion for 63-11862 to reflect the land and well in the SWNW. The license for 63-34796 should reflect only the 3.8 acres of irrigation development to the east of the road that is irrigated from the 2021 well.

Note that at the time of this writing, IDWR GIS records appear to be slightly misaligned as Mr. Vickers's property boundary and the western extent of irrigation under this permit display as being west of the centerline of the NW quarter-section, yet Mr. Vickers's parcel descriptions suggest they lie entirely east of that centerline. The license is being recommended with the place of use in the NE and SE of the NW quarter section of Section 14.

Supplemental Discussion

Surface water that supplies irrigation to the Place of Use (POU) is only associated with Water Right 63-11286 and not to the Place of Use (POD) recommended for Water Right 63-34796. There is no surface water associated with the Place of Use (POU) for 63-34796, only groundwater.

The 2021 well is the permitted POD for this permit. At time of the exam a 5hp submersible pump was being used to deliver water via open discharge from the POD to the Place of Use (POU) in the NENW and SENW of Section 14. POD analysis found that no overlapping water rights exist at the POD.

A Panametrics PT878 that had recently (April 5, 2023) been calibrated was used to measure the discharge from the POD during the field exam. The discharge was measured to be 0.12 CFS (53 gpm). The license is being recommended with a

SCANNED
MAY 18 2023

diversion rate of 0.11 CFS (50 gpm) to reflect the maximum rate per acre (0.03 cfs) that can be licensed for 3.8 acres of irrigation.

Condition Descriptions

Conditions 943, WB7, and R61 all were dropped because the permit was not developed as supplemental ground water. Condition R69 was added when the right combined with other rights shall not exceed no more than 0.03 cfs per acre and no more than 4.5 afa per acre at the field headgate for irrigation of the place of use.

Have conditions of permit approval been met? __X__ Yes ____ No

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use	Rate of Diversion	
IRRIGATION	03/01 to 11/15	0.11 CFS	

Totals: 0.11 CFS

2. Recommended Amendments

____ Change P.D. as reflected above ____ Add P.D. as reflected above __X__ None

____ Change P.U. as reflected above ____ Add P.U. as reflected above __X__ None

I. AUTHENTICATION

Clint Lindow -

Field Examiner's Name Clint Lindow Date 5/16/2023

Reviewer _____ Date 5/16/2023

SCANNED

MAY 18 2023

State of Idaho
Department of Water Resources

Attachment to Water Right

63-34796

This map depicts the IRRIGATION place of use boundary for this water right at the time of this approval and is attached to the approval document solely for illustrative purposes.



SCANNED
MAY 18 2023

Field exam **63-34796 - Vickers**

time: 04/26/2023	Velocity ft/s	volume Gallons/min	fwd totalizer fwd Gallons
11:11:10	5.91	55.6	68717.698
11:12:10	5.82	54.8	68772.885
11:13:10	5.75	54.1	68828.538
11:14:11	5.77	54.2	68880.345
11:15:10	5.74	54	68935.801
11:16:10	5.65	53.2	68989.36
11:17:10	5.59	52.5	69043.434
11:18:11	5.52	51.9	69095.447
11:19:11	5.56	52.3	69146.109
11:20:10	5.59	52.6	69198.073
11:21:10	5.64	53.1	69252.3

Panametric Pt878 s/n 281888 data: 68717.698 - 69252.300 = 534.602/448.83= 1.19110 = 1.2 cfs

IDAHO DEPARTMENT OF WATER RESOURCES
SCANNED
MAY 18 2023

Form 238-7
6/07

63

IDAHO DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORT

1. WELL TAG NO. D 0087790
Drilling Permit No. 896327 ✓
Water right or injection well # 63-34796

2. OWNER: Kirby D. Vickers
Name
Address P.O. Box 237
City Huston State ID Zip 83630

3.WELL LOCATION:
Twp. 03 North ☒ or South ☐ Rge. 04 East ☐ or West ☒
Sec. 14 ____ (10 acres) 1/4 SW (40 acres) 1/4 NW (160 acres) 1/4
Gov't Lot ____ County Canyon
Lat. 43 ° 35.94942 (Deg. and Decimal minutes)
Long. -116 ° 47.25654 (Deg. and Decimal minutes)
Address of Well Site 15646 Sunnyslope Rd
City Caldwell
(Give at least name of road + Distance to Road or Landmark)
Lot. ____ Blk. ____ Sub. Name ____

4. USE:
☐ Domestic ☐ Municipal ☐ Monitor ☒ Irrigation ☐ Thermal ☐ Injection
☐ Other ____

5. TYPE OF WORK:
☒ New well ☐ Replacement well ☐ Modify existing well
☐ Abandonment ☐ Other ____

6. DRILL METHOD:
☐ Air Rotary ☐ Mud Rotary ☐ Cable ☒ Other Reverse Rotary

7. SEALING PROCEDURES:

Seal material	From (ft)	To (ft)	Quantity (lbs or ft³)	Placement method/procedure
Bentonite chips	0	181	20,000 lbs	Dry pour

8. CASING/LINER:

Diameter (nominal)	From (ft)	To (ft)	Gauge/ Schedule	Material	Casing	Liner	Threaded	Welded
8	+2	203	.322	Steel	☒	☐	☐	☒
8	233	255	.322	Steel	☒	☐	☐	☒
					☐	☐	☐	☐
					☐	☐	☐	☐

Was drive shoe used? ☐ Y ☒ N Shoe Depth(s) ____

9. PERFORATIONS/SCREENS:
Perforations ☐ Y ☒ N Method ____
Manufactured screen ☒ Y ☐ N Type Wire Wrap
Method of installation Lower in one string

From (ft)	To (ft)	Slot size	Number/ft	Diameter (nominal)	Material	Gauge or Schedule
203	233	.025		8	Stainless	
255	265	.020		8	Stainless	

Length of Headpipe ____ Length of Tailpipe 5'
Packer ☐ Y ☒ N Type ____

10.FILTER PACK:

Filter Material	From (ft)	To (ft)	Quantity (lbs or ft³)	Placement method
#8x16 Sand	181	270	15,000 lbs	Dry pour
3/8"pea gravel	270	295	7,000 lbs	Dry pour

11. FLOWING ARTESIAN:
Flowing Artesian? ☐ Y ☒ N Artesian Pressure (PSIG) ____
Describe control device ____

12. STATIC WATER LEVEL and WELL TESTS:
Depth first water encountered (ft) 76 Static water level (ft) 76
Water temp. (°F) 72° Bottom hole temp. (°F) ____
Describe access port Sanitary Well Cap

Well test:

Drawdown (feet)	Discharge or yield (gpm)	Test duration (minutes)
26	120	240

Test method:

Pump	Bailer	Air	Flowing artesian
☒	☐	☐	☐
☐	☐	☐	☐

Water quality test or comments: ____

13. LITHOLOGIC LOG and/or repairs or abandonment:

Bore Dia. (in)	From (ft)	To (ft)	Remarks, lithology or description of repairs or abandonment, water temp.	Water Y	Water N
17.5	0	10	Top soil		X
17.5	10	32	Gray clay		X
17.5	32	40	Hard sandstone		X
17.5	40	50	Medium brown sand		X
17.5	50	55	Brown clay		X
17.5	55	61	Medium brown sand		X
17.5	61	65	Brown and gray sandy clay		X
17.5	65	115	Tan clay w/ sm sand layer		X
17.5	115	129	Fine-medium sand	X	
17.5	129	144	Brown clay		X
17.5	144	155	Fine-medium sand		
17.5	155	159	Brown clay		X
17.5	159	200	Blue clay w/sand streaks	X	X
17.5	200	233	Medium-coarse sand	X	
17.5	233	260	Blue clay		X
17.5	260	263	Fine sand	X	
17.5	263	275	Blue sandy clay		X
17.5	275	295	Blue clay		X

RECEIVED
DEC 09 2020
WATER RESOURCES
WESTERN REGION

Completed Depth (Measurable): 270'
Date Started: Oct 20, 2020 Date Completed: Nov 10, 2020

14. DRILLER'S CERTIFICATION:
I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

Company Name Riverside Inc Co. No. 333
*Principal Driller ____ Date 12-3-20
*Driller ____ Date ____
*Operator I ____ Date 12-3-20
Operator I ____ Date 12/3/20

* Signature of Principal Driller and rig operator are required.

SCANNED
MAY 18 2023

IDAHO DEPARTMENT OF
WATER RESOURCES

Western Region • 2735 W Airport Way • Boise, ID 83705-5082
Phone: 208-334-2190 • Fax: 208-334-2348 • Email: westerninfo@idwr.idaho.gov • Web: idwr.idaho.gov

Governor Brad Little

Director Gary Spackman

July 15, 2022

Kirby D Vickers
PO Box 237
Huston, Idaho 83630-0237

COPY

RE: Scheduling Field Exam for Water Right Permit No. 63-34796

Dear Permit Holder (Kirby D Vickers):

We are planning to conduct water right examinations in the vicinity of the above-referenced permit **this season.** An examination is needed to verify the water use to issue a water right license.

The above-referenced permit authorizes **0.180 CFS** of **ground water** for **irrigation use**. **If you have developed a beneficial use of water and still own the place of use property, please contact me at your earliest convenience to schedule an examination.**

If you did not develop a beneficial use of water under the permit during the beneficial use period, a license cannot be issued, and the permit should be relinquished. If that use was developed but you have ceased using the water and currently carry no interest in it, please relinquish the permit by submitting the enclosed Relinquishment of Permit form (no fee required).

If you developed a beneficial use of water under the permit but no longer own the place of use property identified in the permit, please submit the enclosed Assignment of Permit form with the applicable $25 processing fee.

Please contact me within the next thirty (30) days at (208) 605-4630 to either schedule an examination or submit a relinquishment or assignment form. If you no longer own the place of use property and/or do not respond to this letter, the department will work with the current property owner to issue a license or void the permit.

Sincerely,

Clint Lindow
Water Resource Agent

Enclosure: Relinquishment of Permit Form
Notice of Change of Water Right Ownership Form
Proof Report and Map

SCANNED
MAY 18 2023



Fig. 1 – Location of the well. Located in the SENW QQ. View looking North.

GPS'd at:

43° 59' 9.17" N

116° 78 7.55" W

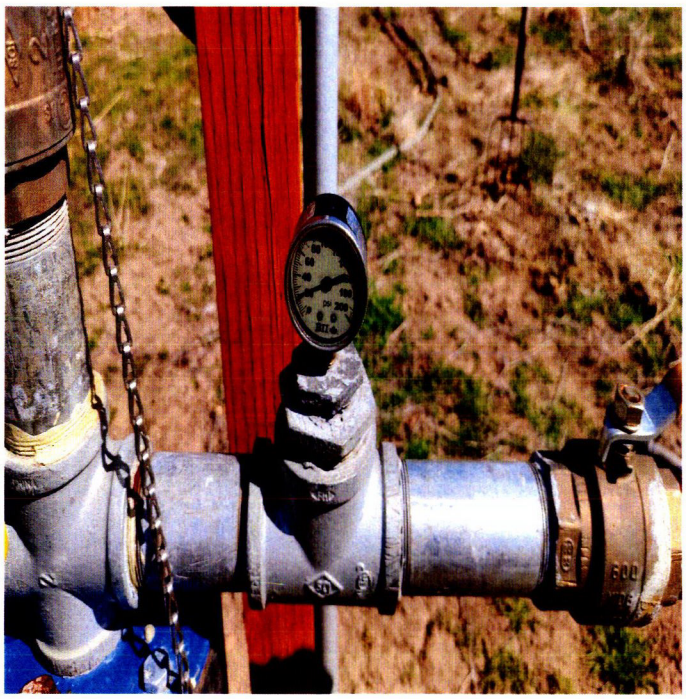


Fig. 2 – Picture of the Delivery system Pressure gauge reading approximately 20 PSI at time of exam. Facing North

SCANNED

MAY 18 2023



Fig. 3 - Picture of well and delivery system located in NW SW QQ. Facing Northwest.



Fig. 4 - Picture of irrigated Place of Use looking Northwest in SE NW QQ.

SCANNED
MAY 18 2023



Fig. 5 – Picture of drip line located irrigable in the SENW QQ. View looking SW.



Fig. 6 – Irrigated acres within the SENW QQ Place of Use. Facing South.

SCANNED
MAY 18 2023

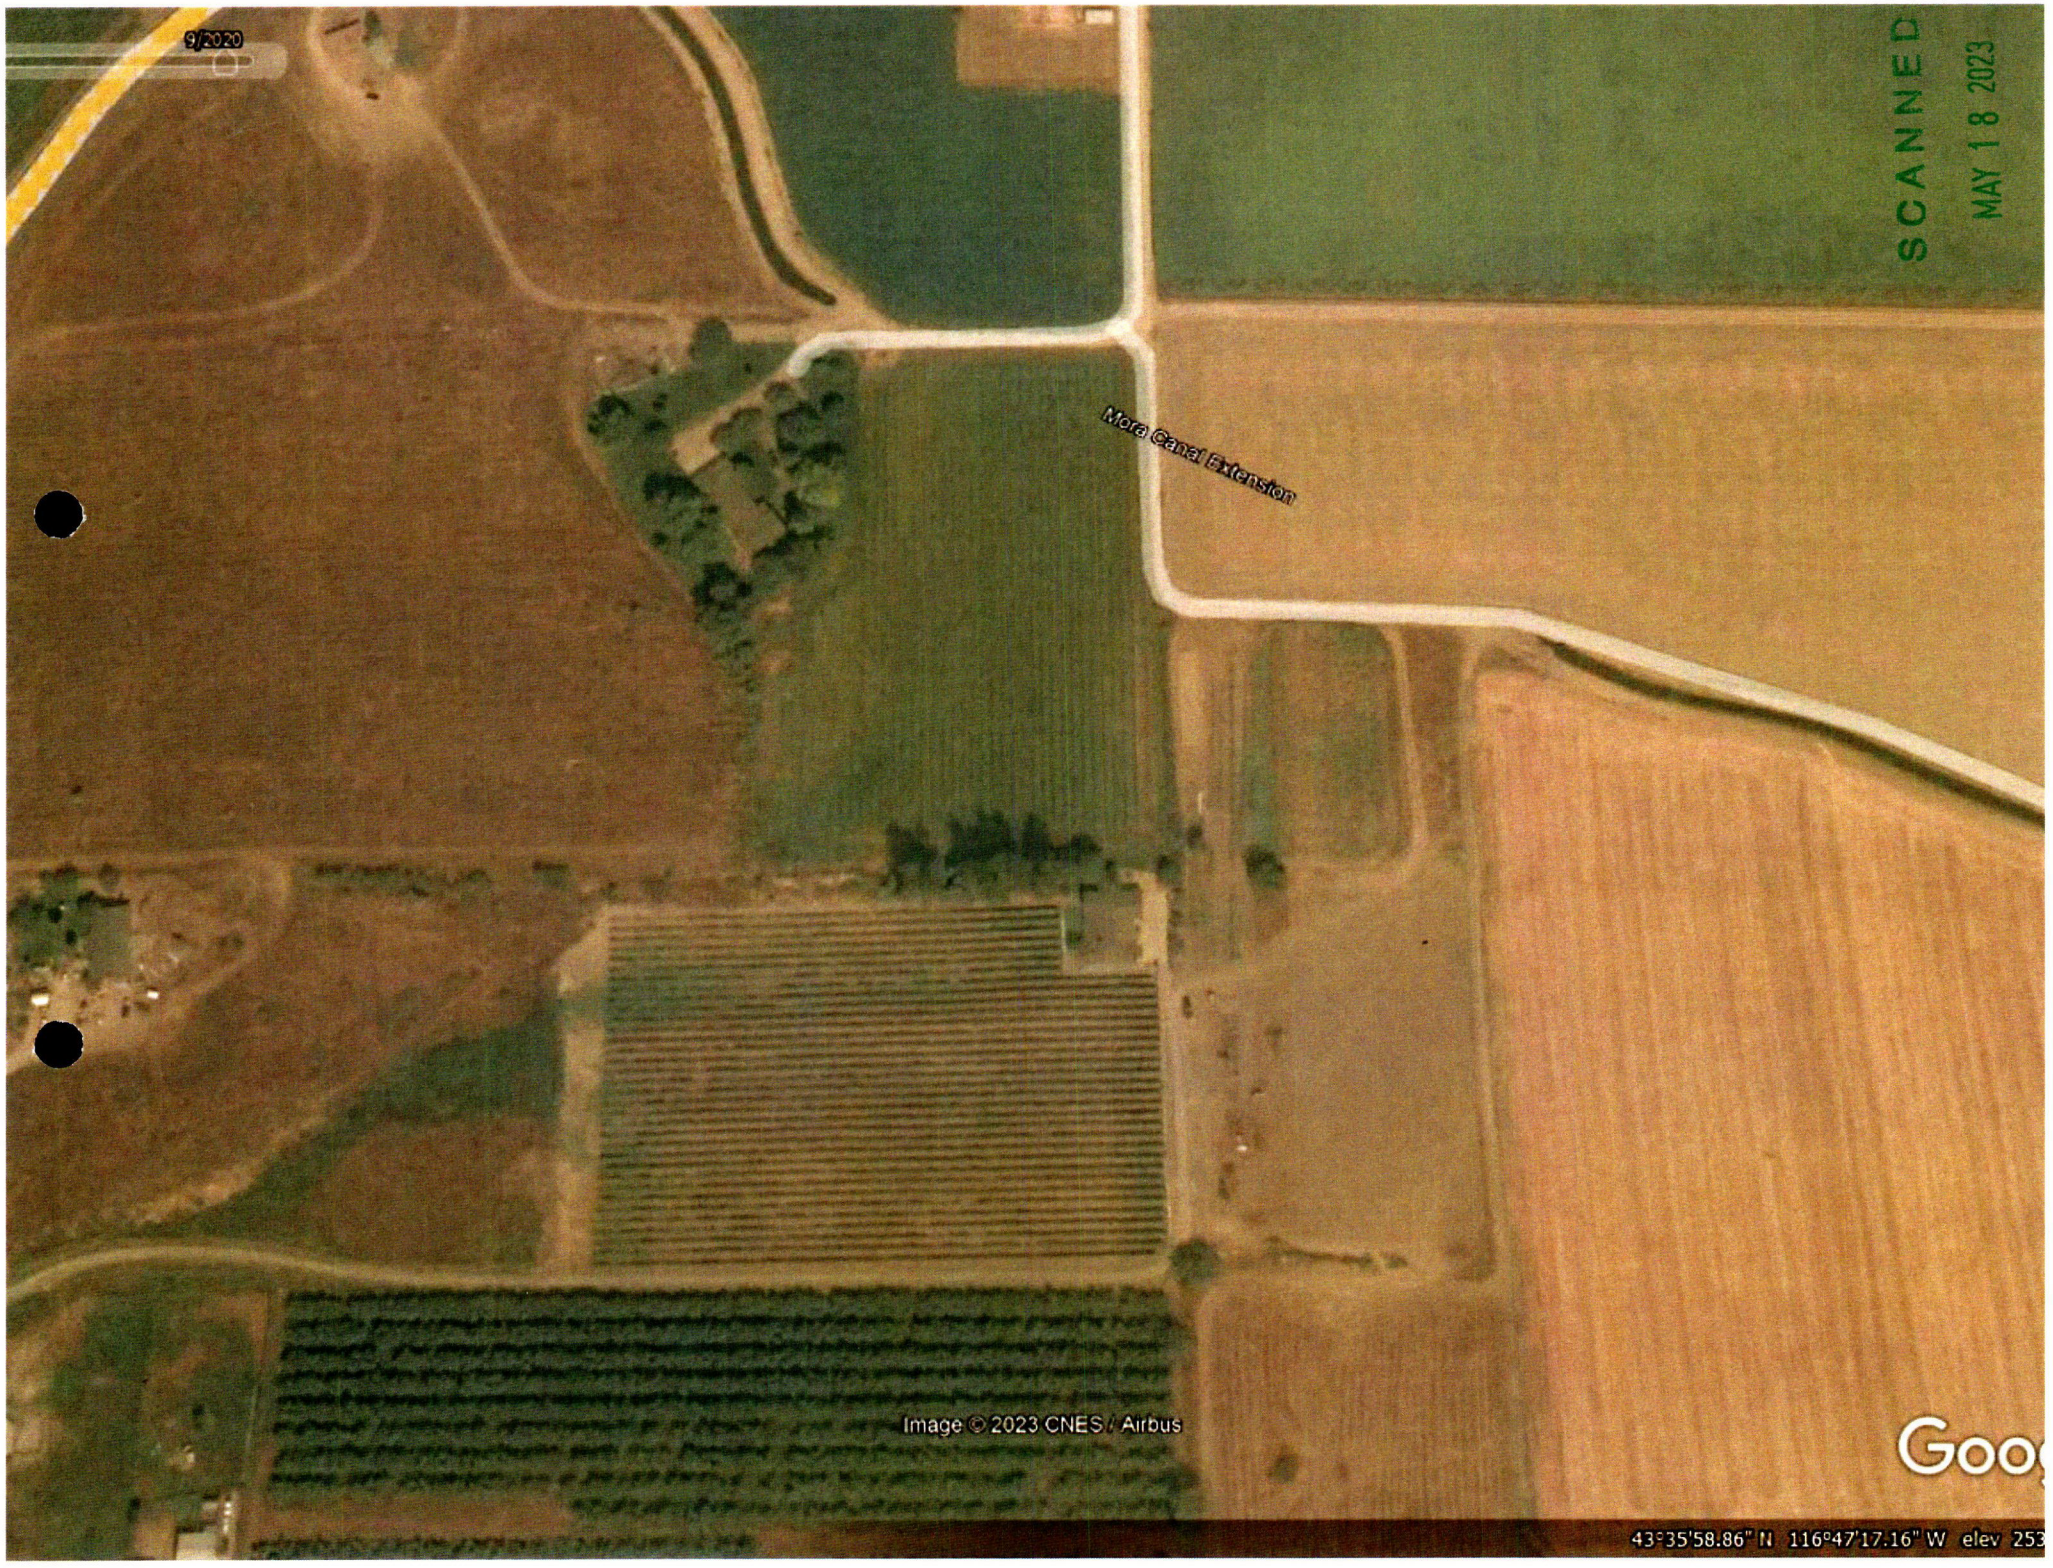


Fig. 7 – Drip line irrigated agriculture in the SW area of the POU. View looing. Looking North



Fig. 8 – More drip line irrigation in the SW area of the POU. View looking S.

SCANNED
MAY 18 2023



SCANNED
MAY 18 2023


9/2021
Image © 2023 Airbus
Imagery Date: 9/10/2021 43°35'56.39" N 116°47'13.66" W elev 2545

Form 238-7
6/07

63

IDAHO DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORT

1. WELL TAG NO. D 0087790
Drilling Permit No. 896327
Water right or injection well # 63-34796

2. OWNER: Kirby D. Vickers
Name
Address P.O. Box 237
City Huston State ID Zip 83630

3.WELL LOCATION:
Twp. 03 North ☒ or South ☐ Rge. 04 East ☐ or West ☒
Sec. 14 ____ 1/4 (10 acres) SW 1/4 (40 acres) NW 1/4 (160 acres)
Gov't Lot ____ County Canyon
Lat. 43 ° 35.94942 (Deg. and Decimal minutes)
Long. -116 ° 47.25654 (Deg. and Decimal minutes)
Address of Well Site 15646 Sunnyslope Rd
City Caldwell
(Give at least name of road + Distance to Road or Landmark)
Lot. ____ Blk. ____ Sub. Name ____

4. USE:
☐ Domestic ☐ Municipal ☐ Monitor ☒ Irrigation ☐ Thermal ☐ Injection
☐ Other ____

5. TYPE OF WORK:
☒ New well ☐ Replacement well ☐ Modify existing well
☐ Abandonment ☐ Other ____

6. DRILL METHOD:
☐ Air Rotary ☐ Mud Rotary ☐ Cable ☒ Other Reverse Rotary

7. SEALING PROCEDURES:

Seal material	From (ft)	To (ft)	Quantity (lbs or ft³)	Placement method/procedure
Bentonite chips	0	181	20,000 lbs	Dry pour

8. CASING/LINER:

Diameter (nominal)	From (ft)	To (ft)	Gauge/ Schedule	Material	Casing	Liner	Threaded	Welded
8	+2	203	.322	Steel	☒	☐	☐	☒
8	233	255	.322	Steel	☒	☐	☐	☒
					☐	☐	☐	☐
					☐	☐	☐	☐

Was drive shoe used? ☐ Y ☒ N Shoe Depth(s) ____

9. PERFORATIONS/SCREENS:
Perforations ☐ Y ☒ N Method ____
Manufactured screen ☒ Y ☐ N Type Wire Wrap
Method of installation Lower in one string

From (ft)	To (ft)	Slot size	Number/ft	Diameter (nominal)	Material	Gauge or Schedule
203	233	.025		8	Stainless	
255	265	.020		8	Stainless	

Length of Headpipe ____ Length of Tailpipe 5'
Packer ☐ Y ☒ N Type ____

10.FILTER PACK:

Filter Material	From (ft)	To (ft)	Quantity (lbs or ft³)	Placement method
#8x16 Sand	181	270	15,000 lbs	Dry pour
3/8"pea gravel	270	295	7,000 lbs	Dry pour

11. FLOWING ARTESIAN:
Flowing Artesian? ☐ Y ☒ N Artesian Pressure (PSIG) ____
Describe control device ____

12. STATIC WATER LEVEL and WELL TESTS:
Depth first water encountered (ft) 76 Static water level (ft) 76
Water temp. (°F) 72° Bottom hole temp. (°F) ____
Describe access port Sanitary Well Cap

Well test:

Drawdown (feet)	Discharge or yield (gpm)	Test duration (minutes)
26	120	240

Test method:

Pump	Bailer	Air	Flowing artesian
☒	☐	☐	☐
☐	☐	☐	☐

Water quality test or comments: ____

13. LITHOLOGIC LOG and/or repairs or abandonment:

Bore Dia. (in)	From (ft)	To (ft)	Remarks, lithology or description of repairs or abandonment, water temp.	Water Y	Water N
17.5	0	10	Top soil		X
17.5	10	32	Gray clay		X
17.5	32	40	Hard sandstone		X
17.5	40	50	Medium brown sand		X
17.5	50	55	Brown clay		X
17.5	55	61	Medium brown sand		X
17.5	61	65	Brown and gray sandy clay		X
17.5	65	115	Tan clay w/ sm sand layer		X
17.5	115	129	Fine-medium sand	X	
17.5	129	144	Brown clay		X
17.5	144	155	Fine-medium sand		
17.5	155	159	Brown clay		X
17.5	159	200	Blue clay w/sand streaks	X	X
17.5	200	233	Medium-coarse sand	X	
17.5	233	260	Blue clay		X
17.5	260	263	Fine sand	X	
17.5	263	275	Blue sandy clay		X
17.5	275	295	Blue clay		X

RECEIVED
DEC 09 2020
WATER RESOURCES
WESTERN REGION

Completed Depth (Measurable): 270'
Date Started: Oct 20, 2020 Date Completed: Nov 10, 2020

14. DRILLER'S CERTIFICATION:
I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

Company Name Riverside Inc Co. No. 333
*Principal Driller ____ Date 12-3-20
*Driller ____ Date ____
*Operator I ____ Date 12-3-20
Operator I ____ Date 12/3/20

* Signature of Principal Driller and rig operator are required.

SCANNED
MAY 18 2023

IDAHO DEPARTMENT OF
WATER RESOURCES

Western Region • 2735 W Airport Way • Boise, ID 83705-5082
Phone: 208-334-2190 • Fax: 208-334-2348 • Email: westerninfo@idwr.idaho.gov • Web: idwr.idaho.gov

Governor Brad Little **Director Gary Spackman**

May 17, 2023

KIRBY D VICKERS
PO BOX 237
HUSTON ID 83630-0237

RE: License No. 63-34796

ISSUANCE OF LICENSE

Dear Water Right Holder(s):

The Department of Water Resources ("Department") has issued the enclosed Water Right License confirming that a water right has been established in accordance with your permit. Please be sure to thoroughly review all the conditions of approval listed on your license. The conditions may include ongoing requirements, such as maintenance of a measuring device or implementation of mitigation, as well as information about how your water use may be administered, such as regulation by a watermaster in a water district.

The license is a PRELIMINARY ORDER issued by the Department pursuant to Rule 730 of the Department's Rules of Procedure (IDAPA 37.01.01.730). It can and will become a final order without further action by the Department unless a party petitions for reconsideration, files exceptions, or requests a hearing as described in the enclosed information sheet.

Also, please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Water right forms are available from any office of the Department or on the Department's website at idwr.idaho.gov

If you have any questions concerning the enclosed information, please contact me at (208) 605-4624.

Sincerely,

Lynn Evans

Scott Storms
Water Rights Supervisor

Enclosure(s)

SCANNED
MAY 18 2023

Western Memo Notes

Kirby Vickers visited our Western Regional Office in Boise, Idaho on April 25, 2023, at 2:00pm Tuesday and met with me and Western Regional Director Nick Miller. In our discussion, we discussed that we found that Mr. Vickers's other water right 63-11286 place of use (POU) was recorded in the wrong ¼ ¼. Investigating the field exam in the back file for Water right 63-11286 revealed through a drawing and other pertinent information was not correctly displayed. The correct quarter/quarter is in T03N R04W S14 SW/NW for water right 63-11286 and not T03N R04W S14 NW/NW which is listed currently on water right. Kirby Vickers is aware of the situation and has filed a transfer to correct the water right 63-1186 where the wrong Point of Use is located on our records. Mr. Kirby Vickers is also aware that a reduction of acreage on water right license on water right 63-34796 from 9.2 acres, which was initially applied for, to 3.8 acres due to the correction of place of use (POU). I am recommending, after visually inspecting the site, reducing the acreage to 3.8 acres in T03N R04W S14 NE/NW and SE/NW. As a result, I am recommending a license for 0.11 CFS and 17.1 AF for irrigation purposes.

SCANNED

MAY 18 2023