State of Idaho
Department of Water Resources

Water Right License

Water Right No. 65-23629

Priority: December 24, 2015

Maximum Diversion Rate: 0.17 CFS
Maximum Diversion Volume: 61.3 AF

It is hereby certified that:

MOUNTAIN VIEW WATER & ROAD ASSN INC C/O KRAIG WEES
39 PACKER CT GARDEN VALLEY ID 83622-8143

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated December 24, 2015, and has submitted Proof of Beneficial Use on May 12, 2021. An examination confirms water is diverted from:

Source : GROUND WATER

Beneficial Use	Period of Use	Rate of Diversion	Annual Volume
DOMESTIC	01/01 to 12/31	0.17 CFS	61.3 AF
FIRE PROTECTION	01/01 to 12/31	0.17 CFS	

Location of Point(s) of Diversion

GROUND WATER SW¼ NW¼, Sec. 15, Twp 09N, Rge 04E, B.M. BOISE County
GROUND WATER SW¼ NW¼, Sec. 15, Twp 09N, Rge 04E, B.M. BOISE County

Place of Use: DOMESTIC

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
09N	04E	15							X			X							

Place of Use: FIRE PROTECTION

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
09N	04E	15							X			X							

Conditions of Approval

1. Rights 65-23629 and 65-13030 when combined shall not exceed a total diversion rate of 0.28 cfs, a total annual maximum diversion volume of 64.8 af at the field headgate.
2. This right does not grant any right-of-way or easement across the land of another.
3. After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to use power records to determine the amount of water diverted and shall annually report the information to the Department.
4. Water shall not be diverted for fire protection use under this right except to fight or repel an existing fire.
5. Domestic use is for up to 50 homes and 4 commercial lots.
6. Points of diversion are located within a portion of Lot 38 or Tax 53, Crouch Mountain View Subdivision No. 1.
7. Place of use is located within Mountain View Subdivision.

SCANNED
FEB 03 2023

State of Idaho
Department of Water Resources

Water Right License

Water Right No. 65-23629

8. When ordered by the Director, the right holder shall provide mitigation acceptable to the Director to offset depletion of lower Snake River flows needed for migrating anadromous fish. The amount of water required for mitigation, which is to be released into the Snake River or a tributary for this purpose, will be determined by the Director based upon the reduction in flow caused by the use of water pursuant to this right. Any order of the Director issued in accordance with this paragraph shall be in conformance with applicable rules allowing the right holder due process as the need for mitigation and the amount of mitigation are determined.

This license is issued pursuant to the provisions of Idaho Code § 42-219. The water right confirmed by this license is subject to all prior water rights and shall be used in accordance with Idaho law and applicable rules of the Department of Water Resources.

Signed this 30th day of January, 2023.

SCOTT STORMS
Water Rights Supervisor


SCANNED
FEB 03 2023

State of Idaho
Department of Water Resources

Attachment to Water Right License

65-23629

This map depicts the DOMESTIC place of use boundary for this water right at the time of this approval and is attached to the approval document solely for illustrative purposes.

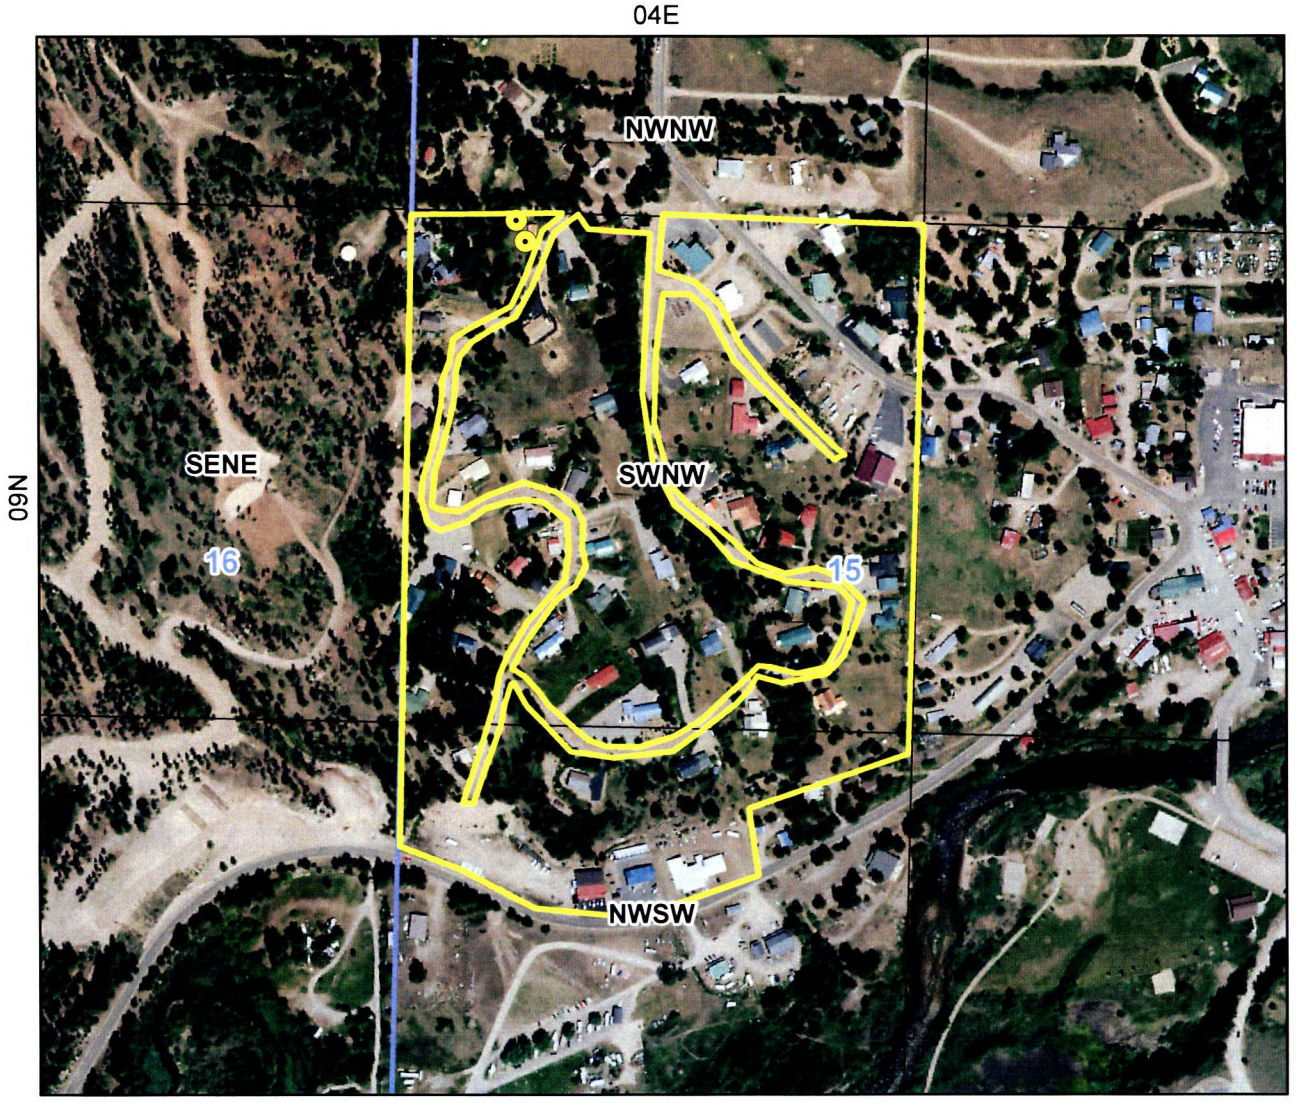

Place Of Use Boundary
Townships
PLS Sections
Quarter Quarters
Point of Diversion

0 0.05 0.1 0.2 Miles

N


SCANNED
FEB 03 2023

State of Idaho
Department of Water Resources

Attachment to Water Right License

65-23629

This map depicts the FIRE PROTECTION place of use boundary for this water right at the time of this approval and is attached to the approval document solely for illustrative purposes.

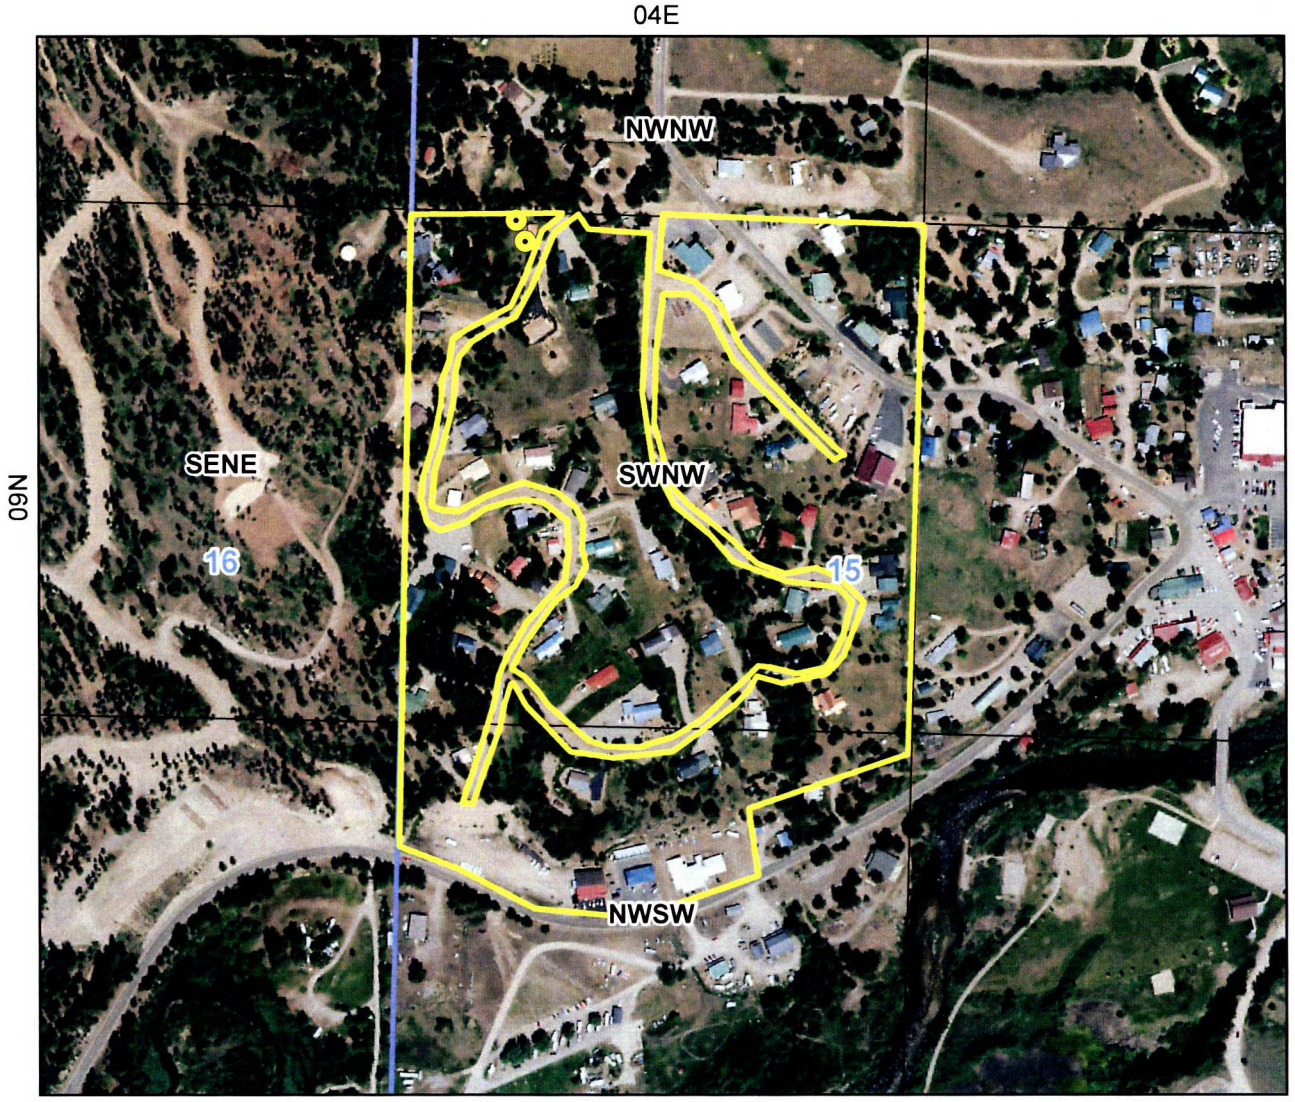

Place Of Use Boundary
Townships
PLS Sections
Quarter Quarters
Point of Diversion

0 0.05 0.1 0.2 Miles

N

SCANNED
FEB 03 2023

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No: 65-23629
Exam Date: 04/26/2022

1. Current Owner:
   MOUNTAIN VIEW WATER & ROAD ASSN INC C/O KRAIG WEES
   15 PACKER CT GARDEN VALLEY ID 83622

2. Accompanied by: Kraig Wees
   Phone No: 208-340-9824
   Address:
   Relationship to permit Holder: President of the organization

3. **SOURCE:**
GROUND WATER

Method of Determination: Site visit, aerial imagery

B. OVERLAP REVIEW

1. Other water rights with the same place of use: YES Overlap

Water Right No.	Source	Purpose of Use	Basis
65-13030	Ground Water	Domestic & Fire Protection	Licensed

Comments: Above water right is used to service the same neighborhood

2. Other water rights with the same point-of-diversion: YES Overlap

Water Right No.	Source	Purpose of Use	Basis
65-13030	Ground Water	Domestic & Fire Protection	Licensed

Comments: Damage occurred to one of two PODs in water right 65-13030 and was replaced with a new well. The original wells were wells #1 and #2 and the new well is referenced as well #3.

C. DIVERSION AND DELIVERY SYSTEM

1. **LOCATION OF POINT(S) OF DIVERSION:**
GROUND WATER SW¼ NW¼, Sec. 15, Twp 09N, Rge 04E, B.M. BOISE County
GROUND WATER SW¼ NW¼, Sec. 15, Twp 09N, Rge 04E, B.M. BOISE County

Method of Determination: Well's GPS'd at 115°58'36.721"W 44°7'2.5"N & 115°58'35.94"W 44°7'2.352"N

2.

PLACE OF USE: DOMESTIC

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
09N	04E	15							X			X							

PLACE OF USE: FIRE PROTECTION

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
09N	04E	15							X			X							

Method of Determination: Field photos and aerial photography taken to verify domestic and fire protection use.

SCANNED
FEB 03 2023

3.

x Delivery System Diagram Attached (required). Indicate all major components and distances between components. Indicate weir size/pipe as applicable.

x Map Attached Showing Location(s) of point(s) of diversion and place(s) of use (required). Scale must be 1:24,000 or greater.

N/A Aerial Photo Attached (required for irrigation of 10+ acres).

x Photo of Diversion and System Attached

4.

Well or Diversion ID No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
0070268	Franklin	5	N/A	Grundfos 40S50-12 & Hydro Mulit- B	N/A
E0006240	Franklin	7.5	N/A	Grundfos 40S50-12 & Hydro Mulit- B	N/A

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
N/A	N/A	N/A	N/A	N/A	N/A	N/A

2. Measurements: None taken due to the conveyance system not having suitable circumstances to directly measure the diversion rate.

E. FLOW CALCULATIONS

x Additional Computation Sheets Attached

Measured Method: Pump specifications and performance curve information provided by the applicant were used to estimate flow. Performance curve at maximum performance at 210' total head yields 76.1 GPM (0.17 cfs) capacity. When a booster with 5HP is added to the system the capacity increases to 126.9 GPM (0.28 cfs).

System Capability	0.28 cfs
Domestic 50 homes & 4 commercial	0.33 cfs
Permitted Total Rate	0.25 cfs
Overlapping Water Right	0.11 cfs
License Recommendation	0.17 cfs

SCANNED
FEB 03 2023

F. VOLUME CALCULATIONS

1. Volume Calculations for irrigation: N/A
2. Volume Calculations for Other Uses:

50 Domestic Internal and External Use

50 Homes X 1.2 AF = **60 AFA**

4 Commercial

Fire Station: 5 gpd x 365 days/325,850 gallons = **0.006 AFA**

Senior Center: 60 people x 5 gpd/person x 2 meetings/wk x 52 weeks/325,850 gallons = **0.10 AFA**

Bar and Restaurant: 100 people max/day x 10 gpd/person x 365 days/ 325,850 gallons = **1.12 AFA**

Thrift Store: 1 person x 15 gpd x 365 days/325,850 gallons = **0.02 AFA**

Total Required Volume: 61.25 AFA

Volume calculated using Application Processing Memo No. 22 Definition of Domestic and Field Examiners Handbook documents misc. Non-Irrigation Water Requirements.pdf

G. NARRATIVE/REMARKS/COMMENTS

Field exam was conducted on 04/26/22 by Water Right Agent, Marcelina Williams and was accompanied by Mr. Wees the president of organization that holds the permit. Additionally, Terry Tucker, the water system operator was present. The application for permit was submitted on December 24, 2014, and proof of beneficial use was submitted on April 03, 2021.

Two points of diversions (POD) were confirmed by ground water well heads in the SWNW QQ. The newest well (well #3) is located at the gate entry of the pump house and uses an underground 7.5 hp Franklin motor and a submersible Grundfos Model 40S50-12 pump. The older well (well #2) is located to the west of the gated area of the pump house and uses a Franklin 5 hp motor. Both wells hook into the same booster pump that leads to a 4" main line lifting the water about 35 vertical feet to a 30,000-gallon storage tank. From the storage tank a gravity fed system uses 4" and 6" mainline to distribute water for 50 homes and 4 commercial lots. Water right overlap review shows that license number 65-13030 is used for the same POU and one overlapping POD. Both water rights cover the same subdivision and businesses.

The permit authorizes 0.25 cfs for fire protection and domestic use within SWNW, NWSW of Sec 15, T09N, R04W. ArcMap tools and aerial imagery, supported by visiting the property during a field exam, were used to verify the POU area of the domestic use. Fire protection was originally added to the application with the intention of having a fire hydrant the volunteer fire station could access. This was not developed but due to fire protection being able to be accesses from any point in the system it will be left on the permit. No amendment required for the POU.

Additionally, water right 63-13030 overlaps this water right. They share the same POU and 1 POD thus being the same system serving the same homes and business. This water right was applied for due to an update in their water system in response to damage done in an earthquake. They added a booster and new well allowing the system to be capable of producing a higher rate of water from the old system. This right is the result of the new system and represents the additional amount of water in the system.

Condition 103 replaced condition 121 per department standards. Conditions 26A and 046 were removed per department standards. Condition X04 was changed to reflect how many homes and commercial lots are present. X35 was added. Conditions 01M,077, 004, X59, and X60 were carried over to the license.

SCANNED

FEB 03 2023

Have conditions of permit approval been met? __x__ Yes ____ No

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use	Rate of Diversion	Annual Volume
DOMESTIC	01/01 to 12/31	0.17 CFS	61.3 AF
FIRE PROTECTION	01/01 to 12/31	0.17CFS	
	Totals:	0.17 CFS	61.3 AF

2. Recommended Amendments

____ Change P.D. as reflected above ____ Add P.D. as reflected above __x__ None

____ Change P.U. as reflected above ____ Add P.U. as reflected above __x__ None

I. AUTHENTICATION **Marcelina Williams**

Field Examiner's Name Marcelina Williams Date 01/26/23

Reviewer _____ Date 2/3/23

SCANNED

FEB 03 2023

Rev. 02/14

RECEIVED
JAN 11 2023
WATER RESOURCES
WESTERN REGION

For Office Use Only
Updated by _____
Date _____

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

CHANGE IN ADDRESS

This form can be used to notify the Department of a change in address of the owners of record for the listed water rights.
(Please print or type)

Water Right Number(s): 65-23629 and 65-13030

Name(s): Kraig Wees - New President
Lorea Brazell - Old President

Old Mailing Address: Mountain View Road and Water Association
15 Packer Court
Garden Valley, ID. 83622

New Mailing Address: Kraig Wees, President
Mountain View Road and Water Association
39 Packer Ct., Garden Valley, ID. 83622

Telephone Number: 208-340-9824

Email: kraigwees@msn.com

Signature(s) of Owner(s) Kraig Wees, President
Mountain View Subdivision
(Include your title if on behalf of company or organization.)

Date: 1.11.23

Send a signed original to your closest regional office:

IDWR Northern Region
7600 N. Mineral Dr., Suite 100
Coeur d'Alene, ID 83815-7763
(208) 762-2800

IDWR Western Region
2735 Airport Way
Boise, ID 83705-5082
(208) 334-2190

IDWR Eastern Region
900 N. Skyline Dr., Suite A
Idaho Falls, ID 83402-1718
(208) 525-7161

IDWR Southern Region
650 Addison Ave W, Suite 500
Twin Falls, ID 83301-5858
(208) 736-3033

SCANNED
FEB 03 2023

DELIVERY SYSTEM DIAGRAM

Water Right No.65-23629



RECEIVED
FEB 09 2023

THEORETICAL EQUATION WORKSHEET

Water Right No.: 65-23629
Examiner: Marcelina Williams
Date of Field Exam: 4/26/2022

Domestic Use

	OPTION 1	OPTION 2	OPTION 3	
POD: Well #1				
PUMP HORSEPOWER	5	5	5	
BOOSTER HORSEPOWER	5	5	5	
PUMPING LEVEL	225	225	225	
DISCHARGE PRESSURE	20	25	30	
FRICTION	4	5	6	
				AVE
RATE OF FLOW (cfs)	0.22	0.21	0.21	0.21
(gpm)	100.5	96.1	92.1	

The above calculates the formula = $Q = \frac{8.8 * (\text{Efficiency}) * hp}{\text{depth to water} + 2.31*(\text{psi}) + \text{friction}}$

Assumptions: %70 efficiency

Examiners Notes: Booster is used when the demand is higher. Lift from well#3 to surface is ~175 ft . Lift from well#1 to surface is ~190 ft. Additional lift to storage tank ~35 vertical feet. Well #3 is the main well used while well #1 is only used in case of emergency.

SCANNED
FEB 03 2023

THEORETICAL EQUATION WORKSHEET

Water Right No.: 65-23629
Examiner: Marcelina Williams
Date of Field Exam: 4/26/2022

Domesic Use

POD : Well #3	OPTION 1	OPTION 2	OPTION 3	
PUMP HORSEPOWER	7.5	7.5	7.5	
BOOSTER HORSEPOWER	5	5	5	
PUMPING LEVEL	210	210	210	
DISCHARGE PRESSURE	20	25	30	
FRICTION	4	5	6	
				AVE
RATE OF FLOW (cfs)	0.30	0.28	0.27	0.28
(gpm)	132.8	126.7	121.1	

The above calculates the formula = $Q = \frac{8.8 * (\text{Efficiency}) * hp}{\text{depth to water} + 2.31*(\text{psi}) + \text{friction}}$

Assumptions: %70 efficiency

Examiners Notes: Booster is used when the demand is higher. Lift from well#3 to surface is ~175 ft . Lift from well#1 to surface is ~190 ft. Additonal lift to storage tank ~35 vertaical feet. Well #3 is the main well used while well #1 is only used incase of emergency.

SCANNED
FEB 03 2023

C

Form 238-7
3/85-C96

IDAHO DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORT 66076

Office Use Only
Inspected by
Twp ____ Rge ____ Sec ____
____ 1/4 ____ 1/4 ____ 1/4
Lat: : : Long: : :

1. DRILLING PERMIT NO. 65 -97 -C -0196 -000
Other IDWR No. 65-13030

2. OWNER:
Name Mountain View Water & Road Assoc.
Address P.O. Box 644
City Garden Valley State ID Zip 83622

3. LOCATION OF WELL by legal description:
Sketch map location must agree with written location

N / W / E / S

Twp. 9 ☒ North ☐ South
Rge. 4 ☒ East ☐ West
Sec. 15 1/4 (10 acres) SW 1/4 (40 acres) NW 1/4 (160 acres)
Gov't lot ____ County Boise
Lat: : : Long: : :
Address of Well Site 50' NW on Packer John Dr. City Garden Valley
(Give at least name of road + Distance to Road or Landmark)
Lt. 38 Blk. ____ Sub. Name Mtn View
Water - Sewer - Road

4. USE:
☐ Domestic ☐ Municipal ☐ Monitor ☐ Irrigation
☐ Thermal ☐ Injection ☒ Other Subdivision

5. TYPE OF WORK check all that apply (Replacement etc.)
☒ New Well ☐ Modify ☐ Abandonment ☐ Other ____

6. DRILL METHOD
☒ Air Rotary ☐ Cable ☐ Mud Rotary ☐ Other ____

7. SEALING PROCEDURES

SEAL/FILTER PACK Material	From	To	AMOUNT Sacks or Pounds	METHOD
bentonite	0	110	55	overbore

Was drive shoe used? ☒ Y ☐ N Shoe Depth(s) ____
Was drive shoe seal tested? ☐ Y ☒ N How? ____

8. CASING/LINER:

Diameter	From	To	Gauge	Material	Casing	Liner	Welded	Threaded
6"	+3	185	250	steel	☒	☐	☒	☐
					☐	☐	☐	☐
					☐	☐	☐	☐

Length of Headpipe 15' Length of Tailpipe ____

9. PERFORATIONS/SCREENS
☐ Perforations Method pulled back
☒ Screens Screen Type telescoping

From	To	Slot Size	Number	Diameter	Material	Casing	Liner
192	207	.020		5"	st.st	☐	☐
						☐	☐
						☐	☐

10. STATIC WATER LEVEL OR ARTESIAN PRESSURE:
156 ft. below ground Artesian Pressure ____ lb
Depth flow encountered ____ ft. Describe access port or control devices: ____

11. WELL TESTS:
☐ Pump ☐ Bailer ☒ Air ☐ Flowing Artesian

Yield gal/min	Drawdown	Pumping Level	Time
30		200'	2 hrs.

Water Temp. ____ Bottom hole temp. ____
Water Quality test or comments: ____
Depth first Water Encountered 90

12. LITHOLOGIC LOG: (Describe repairs or abandonment)

Bore Dia.	From	To	Remarks: Lithology, Water Quality & Temp.	Water Y	Water N
10"	0	6	brown clay		☒
10"	6	10	brown clay & decomposed granite		☒
10"	10	36	brown sand & gravel		☒
10"	36	44	brown soft granite		☒
10"	44	50	brown clay		☒
10"	50	86	brown granite boulders in decomposed		
			granite		☒
10"	86	90	brown clay		☒
10"	90	102	brown decomposed granite (seep)	☒	
10"	102	110	brown clay		☒
6"	110	114	brown clay		☒
6"	114	129	clear/brown quartz sand (seep)	☒	
6"	129	135	light brown clay		☒
6"	135	140	cemented brown sand & small gravel		☒
6"	140	161	brown clay w/gravel		☒
6"	161	165	brown gravel & sand	☒	
6"	165	175	cemented quartz sand	☒	
6"	175	184	white sand & gravel	☒	
6"	184	186	brown clay		☒
6"	186	190	white course sand	☒	
6"	190	194	white course sand cemented	☒	
6"	194	200	white course sand & gravel	☒	
6"	200	208	white course sand cemented	☒	
6"	208	210	brown clay		☒
			4 ½ hrs. pour bent. seal		
			3 ½ hrs. develop screen		
			18 gpm @ 184'		
			24 gpm @ 190'		
			30 gpm @ 200'		

Completed Depth: 210 (Measurable)
Date: Started 08-25-97 Completed 08-29-97

RECEIVED
SEP 11 1997
Department of Water Resources

13. DRILLER'S CERTIFICATION
I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

MICROFILMED
JAN 09 1998

Firm Name SOS Welldrilling & Pump Co Firm No. 212
Firm Official [signature] Date 9-5-97
Supervisor or Operator [signature] Date 9-5-97
(Sign only if Firm Official is not present)

Date: 09/04/97 Time: 10:06 AM

RECEIVED
SEP - 9 1997
WATER RESOURCES
WESTERN REGION

SCANNED
FEB 03 2023

65-73674

Location Corrected by IDWR To:
T09N R04E Sec. 15 SWNW
By: bserrano 2016-10-07

Form 238-7
6/07

IDAHO DEPARTMENT OF WATER RESC
WELL DRILLER'S REPORT

1. WELL TAG NO D 0070268
Drilling Permit No 97-0464-876721
Water right or injection well # 65-13030

2. OWNER:
Name Mountain View Water & Road Assoc.
Address P.O. Box 644
City Garden Valley State Id. Zip 83622

3. WELL LOCATION:
Twp 9 North ☒ or South ☐ Rge 4 East ☒ or West ☐
Sec 15 ____ 1/4 (10 acres) N.W. 1/4 (40 acres) S.W. 1/4 (160 acres)
Gov't Lot ____ County Boise
Lat 44 ° 02.342 (Deg and Decimal minutes)
Long 115 ° 58.612 (Deg and Decimal minutes)
Address of Well Site 600' west of Middlefork Rd. on Packer John Dr. City Crouch
(Give at least name of road + Distance to Road or Landmark)
Lot 38 Blk. ____ Sub Name Mountain View

4. USE:
☐ Domestic ☒ Municipal ☐ Monitor ☐ Irrigation ☐ Thermal ☐ Injection
☐ Other ____

5. TYPE OF WORK:
☒ New well ☒ Replacement well ☐ Modify existing well
☐ Abandonment ☐ Other ____

6. DRILL METHOD:
☐ Air Rotary ☒ Mud Rotary ☐ Cable ☐ Other ____

7. SEALING PROCEDURES:

Seal material	From (ft)	To (ft)	Quantity (lbs or ft³)	Placement method/procedure
Cement	22'	140'	320 gal.	Pumped
Bentonite chip	0'	22'	13 sacks	Poured

8. CASING/LINER:

Diameter (nominal)	From (ft)	To (ft)	Gauge/ Schedule	Material	Casing	Liner	Threaded	Welded
8"	+2'	180	.322	Steel	☒	☐	☐	☒
					☐	☐	☐	☐
					☐	☐	☐	☐
					☐	☐	☐	☐

Was drive shoe used? ☐ Y ☒ N Shoe Depth(s) ____

9. PERFORATIONS/SCREENS:
Perforations ☐ Y ☒ N Method ____
Manufactured screen ☒ Y ☐ N Type Johnson Vee Wire
Method of installation ____

From (ft)	To (ft)	Slot size	Number/ft	Diameter (nominal)	Material	Gauge or Schedule
180'	190'	.030	10'	8"	Stainless	
190'	200'	.025	10'	8"	Stainless	
200'	210'	.020	10'	8"	Stainless	

Length of Headpipe ____ Length of Tailpipe ____
Packer ☐ Y ☒ N Type ____

10. FILTER PACK:

Filter Material	From (ft)	To (ft)	Quantity (lbs or ft³)	Placement method
3/8" gravel	140'	210'	1.2 Yard	Poured

11. FLOWING ARTESIAN:
Flowing Artesian? ☐ Y ☒ N Artesian Pressure (PSIG) ____
Describe control device ____

12. STATIC WATER LEVEL and WELL TESTS:
Depth first water encountered (ft) 152' Static water level (ft) 152'
Water temp. (°F) 66° Bottom hole temp. (°F) ____
Describe access port Well Cap

Well test:

Drawdown (feet)	Discharge or yield (gpm)	Test duration (minutes)	Test method: Pump	Bailer	Air	Flowing artesian
11.96	91	350	☒	☐	☐	☐
16.63	125	140	☒	☐	☐	☐

Water quality test or comments: ____

13. LITHOLOGIC LOG and/or repairs or abandonment:

Bore Dia. (in)	From (ft)	To (ft)	Remarks, lithology or description of repairs or abandonment, water temp.	Water Y	Water N
12"	0'	1'	Topsoil		X
	1'	12'	Hardpan		X
	12'	99'	Decomposed granite		X
	99'	130'	Cemented granite sand with wood		X
	130'	152'	Cemented granite sand		X
	152'	215'	Granite sand with gray clay streaks	X	

RECEIVED
OCT 19 2015
WATER RESOURCES
WESTERN REGION

Completed Depth (Measurable) 210' 8"
Date Started Sep 18, 2015 Date Completed Oct 6, 2015

14. DRILLER'S CERTIFICATION:
I/We certify that all minimum well construction standards were complied with at the time the rig was removed.
Company Name Stevens & Sons Co No 153
*Principal Driller [signature] Date Oct 10, 2015
*Driller ____ Date Oct 10, 2015
*Operator II ____ Date ____
Operator I ____ Date ____
* Signature of Principal Driller and rig operator are required

SCANNED
FEB 03 2023

FERGUSON

Home Pumps Circulator Pumps Booster Pumps

GRUNDFOS

Grundfos

Hydro Multi-B 3 in. 208/230V 5 hp Three Phase Booster Pump

Part #G91149118 Item #5109347 Manufacturer Part #91149118



Call for Pricing

Log In / Create Account

HORSEPOWER:

5 hp

Packaging Info:
Quantity Per Each: **1**, Inner pack: **1**

How to get it:

Pick Up Not Available
0 in BOISE, ID - N LOCUST GROVE RD

Shipping Not Available
Unavailable at this time

Product Details

System is completely assembled, tested and, ready to pump

Stainless steel manifold

Isolating valve

Non-return valve

Suction manifold is secured to the base frame by special supports that keep the manifold in the right position

CU 323 controller

The inlet pressure, level in the tank, and flow rate are monitored to ensure reliable operation

Documents

Installation
Cad Drawing
Pump Flow Chart

Specifications

AMP: 26.8

ANSI Specifications: ANSI 372, ANSI 61

Application: Industrial

Collection: Hydro Multi-B

Discharge Pressure: 10

End Connection 1: Flanged

End Connection 2: Flanged

End Connections: Flanged

Fitting Size 1: 3 in

Fitting Size 2: 3 in

Fitting Sizes: 3 in

Flow Rate: 179.6 gpm

Height: 51-3/5 in

Horsepower: 5 hp

Length: 27-3/5 in

Material: Stainless Steel

Maximum Feet of Head: 163

Maximum Pressure: 145 psi

SCANNED
FEB 03 2023

Maximum Temperature: 140

NSF Certified: Yes

NSF Specifications: NSF 372, NSF 61

Phase: Three Phase

Power Source: Hardwired

Pump Application: Pressure Booster

Pump Body Material: Cast Iron

Pump Motor Type: Permanent Magnetic

Pump Mounting: Horizontal

Pump Phase: 3

Pump Stage: 2

UL Listed: No

VAC at 60 Hz: 230

Volts: 208/230V

Weight: 422

Width: 30-1/5 in

Entire Collection View All

1 - 6 of 27 items



Grundfos Hydro Multi-B 2 in. Booster Pump



Grundfos Hydro Multi-B 8.7A Booster Pump



Grundfos Hydro Multi-B 2 in. 17.8A Booster Pump



Grundfos Hydro Multi-B 2-1/2 in. 8.5A Booster...



Grundfos Hydro Multi-B Booster Pump



Grundfos Hydro Multi-B 2 in. 11.2A Booster Pump

www.ferguson.com

LEAD LAW WARNING: In accordance with the US Federal or other States laws It is illegal to install products that are not "lead free" certified in potable water systems anticipated for human consumption. Refer to your local plumbing inspector or manufacturer for more details.

SCANNED

FEB 03 2023

40S (40 gpm)

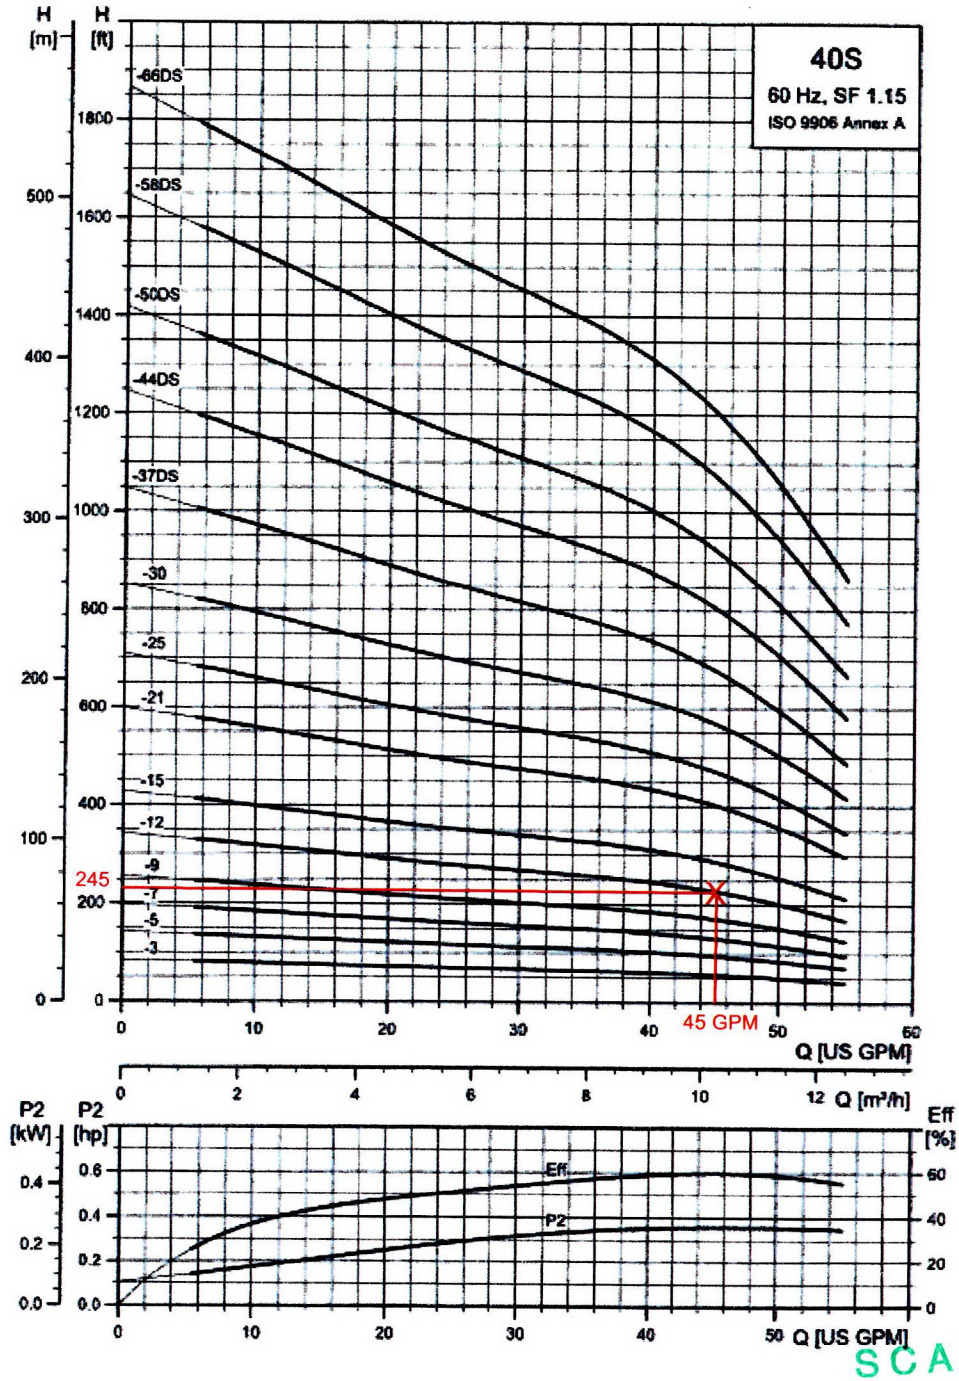


Figure 4: Well Pump Curve, Grundfos Model 40S50-12 (45 gpm @ 245 feet TDH)


SCANNED
FEB 03 2023

JACUZZI.

"The Most Trusted Name In Water"

SandHandler™ High Capacity 60 GPM

Performance Curves

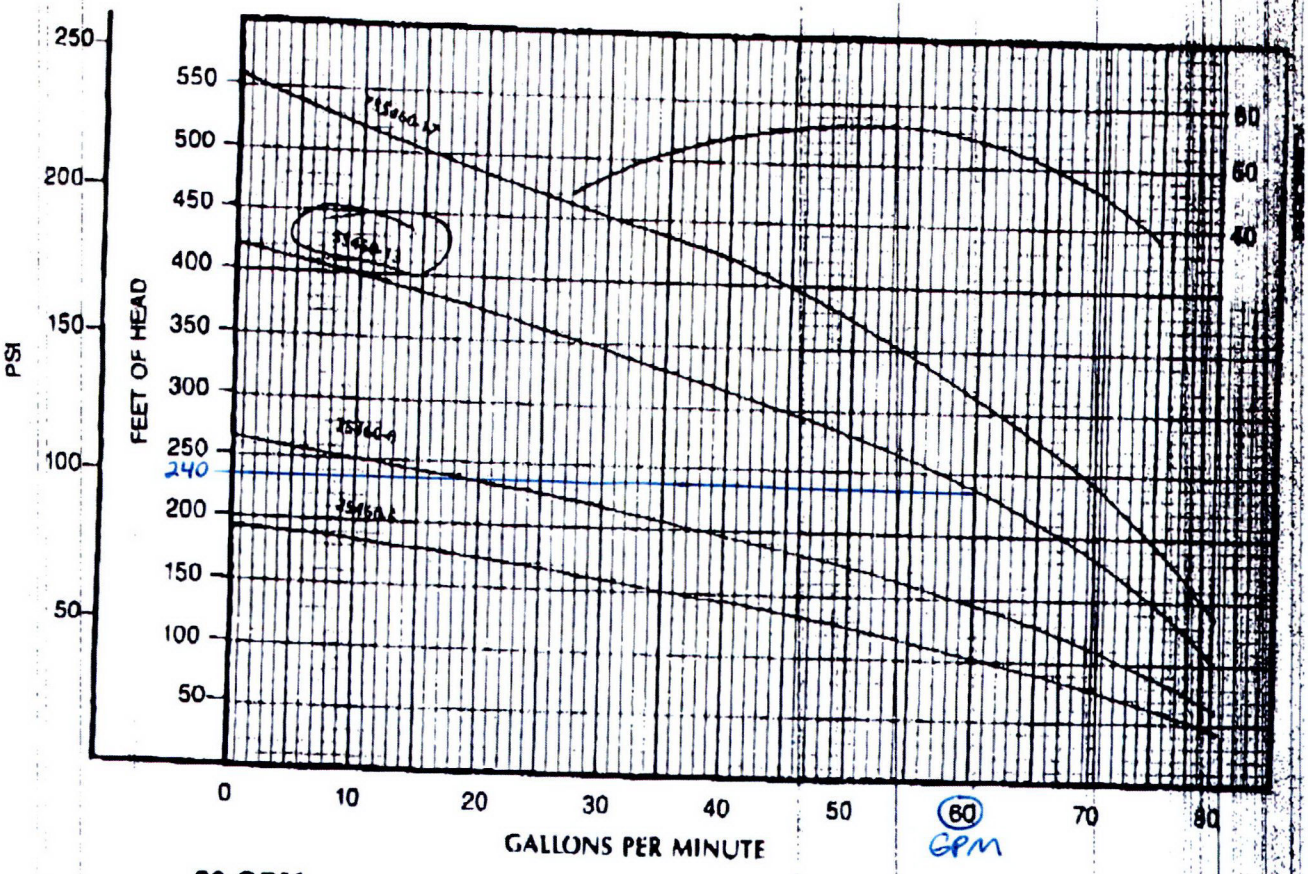

60 GPM

Order No.	Model No.	HP	Phase	Volts	Amps	Weight	Price	w/control box
9252-4602	2S4606-S2	2	1	230	13.2	48	$ 1070.00	$ 1215.00
9252-4610	3S4608-S2	3	1	230	17.0	74	1691.00	1775.00
9252-4628	5S46013-S2	5	1	230	27.5	114	2017.00	2250.00
9252-4636	2S4606-T2	2	3	230	8.1	55	1009.00	"
9252-4644	3S4608-T2	3	3	230	10.9	63	1496.00	"
9252-4651	5S46013-T2	5	3	230	17.8	109	1916.00	"
9252-4669	2S4606-T4	2	3	460	4.1	55	1010.00	"
9252-4677	3S4608-T4	3	3	460	5.5	64	1496.00	"
9252-4685	5S46013-T4	5	3	460	8.9	100	1916.00	"

60 GPM Pump Ends

Order No.	Model No.	HP	Weight	Price
9252-0055	S4606	2	15	$ 609.00
9252-0063	S4608	3	17	795.00
9252-0089	S46013	5	21	1024.00
9252-0097	S46017	7-1/2	25	1141.00

Notes: 1) All motors are 60 cycle.
2) Single and three phase units require a control box or magnetic starter, which must be ordered separately. See pages 54 - 57.
3) 7 1/2 HP units are available as pump ends only. Motor must be ordered separately. See page 60.
4) Check valve must be ordered separately. See page 59 for ordering information.
5) Discharge size is 2" FNPT.

MICROFILMED JUN 05 2003

SCANNED FEB 03 2023



Fig. 1 – Location of well house. Located in the SWNW QQ. View looking south.



Fig. 2 – Location of Well #3 the newest well. View looking west.

GPS'd at:

44°7'2.5"N

115°58'36.721"W

SCANNED

FEB 03 2023



Fig. 3 – Location of Well #2. View looking south.

GPS'd at:

44°7'1.958"N

115°58'36.274"W



Fig. 4 – Location of the 30,000-gallon holding tank that feeds homes via a gravity fed system.

SCANNED

FEB 03 2023

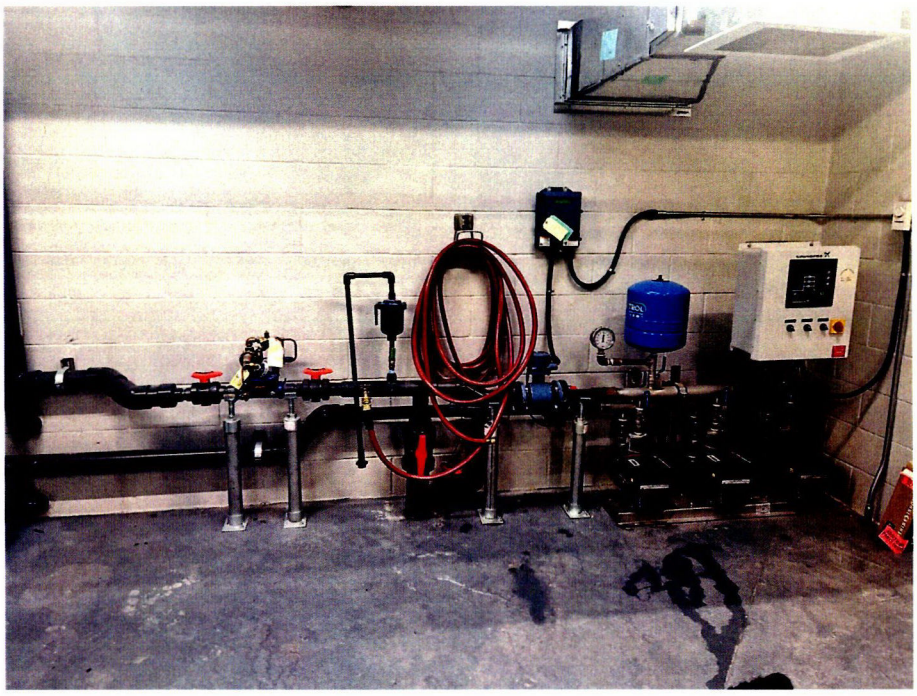


Fig. 5 – Grundfos pumping system inside well house.



Fig. 6 – Continuation of diversion system in well house.

SCANNED
FEB 03 2023



Fig. 9 – Grundfos pumping system that is hooked up to well #2 and well #3 . Well #2 is only used for emergency. Located inside well house.

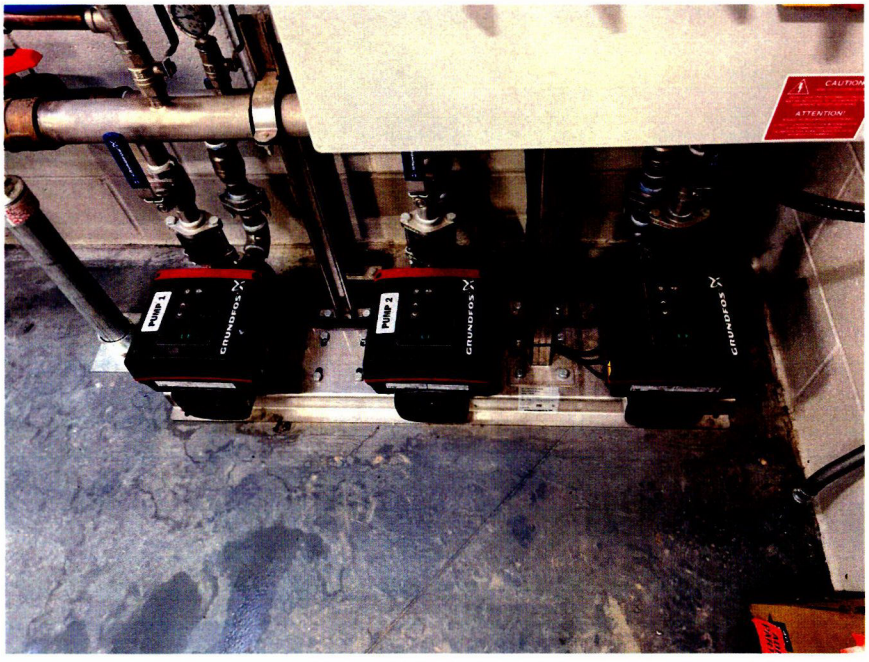


Fig. 10 – Grundfos pumping system that is hooked up to well #2 and well #3. Located inside well house.

SCANNED
FEB 03 2023



Fig. 8 – Power system linked to Grundfos pumps . Location right outside of pump house.

SCANNED
FEB 03 2023

IDAHO DEPARTMENT OF WATER RESOURCES **10/27/2022**

Proof Report

Water Right 65-13030

Owner Type	**Name and Address**
Current Owner	MOUNTAIN VIEW WATER & ROAD ASSN INC C/O LOREN BRAZELL 15 PACKER CT GARDEN VALLEY, ID 83622 (208) 462-8012

Priority Date: 3/3/1989
Basis: License
Status: Active

Source	**Tributary**
GROUND WATER	

Beneficial Use	**From**	**To**	**Diversion Rate**	**Volume**
DOMESTIC	01/01	12/31	0.110 CFS	64.8 AF
FIRE PROTECTION	01/01	12/31	0.110 CFS	
	Total Diversion		0.110 CFS	64.8 AF

Source and Point(s) of Diversion:

GROUND WATER	SWNW	Sec. 15, Twp 09N, Rge 04E, BOISE County
GROUND WATER	SWNW	Sec. 15, Twp 09N, Rge 04E, BOISE County

Place Of Use:
DOMESTIC within BOISE County

			NE				NW				SW				SE				
Twp	Rng	Sec	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	Totals
09N	04E	15							X			X							

FIRE PROTECTION Same as DOMESTIC

Conditions of Approval:

1.	077	Water shall not be diverted for fire protection use under this right except to fight or repel an existing fire.
2.	X59	Points of diversion are located within Lot 38, Mountain View Subdivision.
3.	X60	Place of use is located within Lots 1-57, Mountain View Subdivision.
4.	X01	Domestic use is for 53 homes, a senior citizen center, backhoe service, fire station and restaurant/bar.
5.	004	The issuance of this right does not grant any right-of-way or easement across the land of another.

SCANNED
FEB 03 2023

Comments:

1 kwalker 5/20/2003 Place of Use

I contacted Mr. Loren Brazell today to find out which lots were using water from the wells under this system. Mr. Brazell stated that all 57 lots are stubbed into the wells and at this time there are 24 existing homes out there. Since all 57 lots are stubbed in, I recommend we license the permit for all the lots in the subdivision as applied for and as permitted. Note: Application for permit stated all 57 lots were stubbed into system when it was submitted. To determine volume I recommend 53 lots @1.2 af/lot plus 1.2 af for the 4 lots with commercial uses. Total = 64.8 af which is less than the 68.4 af that could have been developed. Also, the place of use is located within the SWNW and NWSW per GIS shape of subdivision.

2 mciscell 4/19/2011 POD

Updated Shape

Dates and Other Information:

Licensed Date: 5/22/2003
Water District Number: EXC
Mitigation Plan: False

Combined Use Limits:

N/A

Verification Log

SubCase:

N/A

Water Supply Bank:

N/A

SCANNED
FEB 03 2023

IDAHO DEPARTMENT OF
WATER RESOURCES

Western Region • 2735 W Airport Way • Boise, ID 83705-5082
Phone: 208-334-2190 • Fax: 208-334-2348 • Email: westerninfo@idwr.idaho.gov • Web: idwr.idaho.gov

Governor Brad Little

Director Gary Spackman

January 31, 2023

MOUNTAIN VIEW WATER & ROAD ASSN INC
C/O KRAIG WEES
39 PACKER CT
GARDEN VALLEY ID 83622-8143

RE: License No. 65-23629

ISSUANCE OF LICENSE

Dear Water Right Holder(s):

The Department of Water Resources ("Department") has issued the enclosed Water Right License confirming that a water right has been established in accordance with your permit. Please be sure to thoroughly review all the conditions of approval listed on your license. The conditions may include ongoing requirements, such as maintenance of a measuring device or implementation of mitigation, as well as information about how your water use may be administered, such as regulation by a watermaster in a water district.

The license is a PRELIMINARY ORDER issued by the Department pursuant to Rule 730 of the Department's Rules of Procedure (IDAPA 37.01.01.730). It can and will become a final order without further action by the Department unless a party petitions for reconsideration, files exceptions, or requests a hearing as described in the enclosed information sheet.

Also, please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Water right forms are available from any office of the Department or on the Department's website at idwr.idaho.gov

If you have any questions concerning the enclosed information, please contact me at (208) 605-4624.

Sincerely,

Scott Storms
Water Rights Supervisor

Enclosure(s)

SCANNED
FEB 03 2023

CERTIFICATE OF SERVICE

I hereby certify that on January 31, 2023, I served a true and correct copy of Water Right License No. 65-23629 by U.S. Mail, postage prepaid, to the following:

MOUNTAIN VIEW WATER & ROAD ASSN INC (Current Owner)
C/O KRAIG WEES
39 PACKER CT
GARDEN VALLEY ID 83622-8143

Scott Storms
Water Rights Supervisor

SCANNED
FEB 03 2023

EXPLANATORY INFORMATION TO ACCOMPANY A PRELIMINARY ORDER

(To be used in connection with actions when a hearing was **not** held)

(Required by Rule of Procedure 730.02)

The accompanying order or approved document is a "**Preliminary Order**" issued by the department pursuant to section 67-5243, Idaho Code. **It can and will become a final order without further action of the Department of Water Resources ("department") unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:**

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. **Note: the petition must be received by the department within this fourteen (14) day period.** The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after: (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the Department or the Water Resource Board is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the Department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

SCANNED

FEB 03 2023

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01303 (Rules of Procedure 302 and 303).

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

> Unless a different date is stated in a final order, the order is effective fourteen (14) days after its service date if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:
>
> (a) The petition for reconsideration is disposed of; or
> (b) The petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

i. A hearing was held,
ii. The final agency action was taken,
iii. The party seeking review of the order resides, or
iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

SCANNED
FEB 03 2023