State of Idaho
Department of Water Resources

Water Right License

Water Right No. 65-23918

Priority: April 13, 2020

Maximum Diversion Rate: 0.01 CFS
Maximum Diversion Volume: 2.3 AF

It is hereby certified that:

LINNAH NEIDEL PO BOX 666 ARROYO HONDO NM 87513-0666

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated April 13, 2020, and has submitted Proof of Beneficial Use on July 26, 2021. An examination confirms water is diverted from:

Source : SOUTH FORK PAYETTE RIVER **Tributary:** PAYETTE RIVER

Beneficial Use	Period of Use	Rate of Diversion	Annual Volume
IRRIGATION	03/15 to 10/31	0.01 CFS	2.3 AF

Location of Point(s) of Diversion
SOUTH FORK PAYETTE RIVER L6 (NE¼ SW¼), Sec. 10, Twp 08N, Rge 05E, B.M. BOISE County

Place of Use: IRRIGATION

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
08N	05E	10									0.5 L6								0.5

Total Acres: 0.5

Conditions of Approval

1. This right when combined with all other rights shall provide no more than 0.03 cfs per acre nor more than 4.5 afa per acre at the field headgate for irrigation of the place of use.
2. Use of water under this right may be regulated by a watermaster with responsibility for the distribution of water among appropriators within a water district. At the time of this approval, this water right is within State Water District No. 65.
3. The right holder shall contact the watermaster by June 15 each year for authorization to continue diverting and using water. The right holder shall not divert water after June 15 each year unless the watermaster authorizes continued diversion and use of water under this water right. When the watermaster informs the right holder that water is not available to fill this right, the right holder shall cease diversion, shall rent water from the Payette River Rental Pool, or shall otherwise mitigate for the depletion of water caused by this water use. The department may amend the contact date listed in this administrative provision to more closely coincide with the date when water is not available to fill this water right.
4. Upon specific notification by the Department, the right holder shall install a lockable device of a type acceptable to the Department in a manner that will provide the watermaster suitable control of the diversion.
5. When notified by the Department, the right holder shall install and maintain a measuring device of a type acceptable to the Department as part of the diverting works.
6. This right is subordinate to the capture and retention of water in existing on-stream storage reservoirs operated for storage and flood control purposes during and following flood control operations until the date of allocation

SCANNED
DEC 02 2022

State of Idaho
Department of Water Resources

Water Right License

Water Right No. 65-23918

7. The diversion works shall be limited to a pump installation that does not create an obstruction in the river.
8. The diversion and use of water described in this right may be subject to additional conditions and limitations agreed to by the protestant and the right holder under a separate agreement to which the Department is not a party. Because the Department is not a party, the Department is not responsible for enforcement of any aspect of the agreement not specifically addressed in other conditions herein. Enforcement of those portions of the agreement not specifically addressed in other conditions shall be the responsibility of the protestant and the water right holder.
9. When ordered by the Director, the right holder shall provide mitigation acceptable to the Director to offset depletion of lower Snake River flows needed for migrating anadromous fish. The amount of water required for mitigation, which is to be released into the Snake River or a tributary for this purpose, will be determined by the Director based upon the reduction in flow caused by the use of water pursuant to this right. Any order of the Director issued in accordance with this paragraph shall be in conformance with applicable rules allowing the right holder due process as the need for mitigation and the amount of mitigation are determined.

This license is issued pursuant to the provisions of Idaho Code § 42-219. The water right confirmed by this license is subject to all prior water rights and shall be used in accordance with Idaho law and applicable rules of the Department of Water Resources.

Signed this 28th day of November, 2022.

SCOTT STORMS
Water Rights Supervisor

SCANNED
DEC 02 2022

State of Idaho
Department of Water Resources

Attachment to Water Right License

65-23918

This map depicts the IRRIGATION place of use boundary for this water right at the time of this approval and is attached to the approval document solely for illustrative purposes.



Place Of Use Boundary
Townships
PLS Sections
Quarter Quarters
Point of Diversion
Taxlots

0 0.035 0.07 0.14 Miles

N

SCANNED
DEC 02 2022

IDAHO DEPARTMENT OF
WATER RESOURCES

Western Region • 2735 W Airport Way • Boise, ID 83705-5082
Phone: 208-334-2190 • Fax: 208-334-2348 • Email: westerninfo@idwr.idaho.gov • Web: idwr.idaho.gov

Governor Brad Little Director Gary Spackman

November 29, 2022

LINNAH NEIDEL
PO BOX 666
ARROYO HONDO NM 87513-0666

RE: License No. 65-23918

ISSUANCE OF LICENSE

Dear Water Right Holder(s):

The Department of Water Resources ("Department") has issued the enclosed Water Right License confirming that a water right has been established in accordance with your permit. Please be sure to thoroughly review all the conditions of approval listed on your license. The conditions may include ongoing requirements, such as maintenance of a measuring device or implementation of mitigation, as well as information about how your water use may be administered, such as regulation by a watermaster in a water district.

The license is a PRELIMINARY ORDER issued by the Department pursuant to Rule 730 of the Department's Rules of Procedure (IDAPA 37.01.01.730). It can and will become a final order without further action by the Department unless a party petitions for reconsideration, files exceptions, or requests a hearing as described in the enclosed information sheet.

Also, please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Water right forms are available from any office of the Department or on the Department's website at idwr.idaho.gov

If you have any questions concerning the enclosed information, please contact me at (208) 605-4624.

Sincerely,

for Scott Storms
Water Rights Supervisor

Enclosure(s)

SCANNED
DEC 02 2022

CERTIFICATE OF SERVICE

I hereby certify that on November 29, 2022, I served a true and correct copy of Water Right License No. 65-23918 by U.S. Mail, postage prepaid, to the following:

LINNAH NEIDEL (Current Owner)
PO BOX 666
ARROYO HONDO NM 87513-0666

WATER DISTRICT #65
NEIL SHIPPY - WD 65 (Watermaster)
102 N MAIN ST
PAYETTE ID 83661-2522

Lynne Evans
Administrative Assistant I

SCANNED
DEC 02 2022

EXPLANATORY INFORMATION TO ACCOMPANY A PRELIMINARY ORDER

(To be used in connection with actions when a hearing was **not** held)

(Required by Rule of Procedure 730.02)

The accompanying order or approved document is a "**Preliminary Order**" issued by the department pursuant to section 67-5243, Idaho Code. **It can and will become a final order without further action of the Department of Water Resources ("department") unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:**

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. **Note: the petition must be received by the department within this fourteen (14) day period.** The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after: (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the Department or the Water Resource Board is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the Department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

SCANNED
DEC 02 2022

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01303 (Rules of Procedure 302 and 303).

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

> Unless a different date is stated in a final order, the order is effective fourteen (14) days after its service date if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:
>
> (a) The petition for reconsideration is disposed of; or
> (b) The petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

i. A hearing was held,
ii. The final agency action was taken,
iii. The party seeking review of the order resides, or
iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

SCANNED
DEC 02 2022

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No: 65-23918
Exam Date: 09/15/2022

1. Current Owner:
LINNAH NEIDEL PO BOX 666 ARROYO HONDO NM 87513-0666

2. Accompanied by: Julia Beruaga
Phone No: 208-462-3838
Address:
Relationship to permit Holder: Neighbor

3. **SOURCE:** SOUTH FORK PAYETTE RIVER

Tributary PAYETTE RIVER

Method of Determination: Site visit, aerial imagery

B. OVERLAP REVIEW

1. Other water rights with the same place of use: None
2. Other water rights with the same point-of-diversion: None

C. DIVERSION AND DELIVERY SYSTEM

1. **LOCATION OF POINT(S) OF DIVERSION:**
SOUTH FORK PAYETTE RIVER L6 (NE¼ SW¼), Sec. 10, Twp 08N, Rge 05E, B.M. BOISE County

Method of Determination: GPS at 44° 02' 38.48" N, 115° 51' 9.36" W

PLACE OF USE: IRRIGATION

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
08N	05E	10									0.5 L6								0.5

Total Acres: 0.5

Method of Determination: Field photos and aerial photography used to verify irrigation use site.

3.

x Delivery System Diagram Attached (required). Indicate all major components and distances between components. Indicate weir size/pipe as applicable.

x Map Attached Showing Location(s) of point(s) of diversion and place(s) of use (required). Scale must be 1:24,000 or greater.

N/A Aerial Photo Attached (required for irrigation of 10+ acres).

x Photo of Diversion and System Attached

SCANNED
DEC 02 2022

4.

Well or Diversion ID No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
		1.5		Franklin	#FEC20FA15S4

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
N/A	N/A	N/A	N/A	N/A	N/A	N/A

2. Measurements: The submersed pump and conveyance system did not provide suitable circumstances to directly measure the diversion rate. Direct measurement not required per IDAPA Beneficial Use Rule §35.01r.

E. FLOW CALCULATIONS

Y Additional Computation Sheets Attached

Measured Method: Pump specification information provided by the applicant were used to estimate flow. Using the theoretical horsepower equation worksheet, the maximum pump performance at approximately 60' total head and 1.5hp yields 22.4 gpm (0.05 cfs) capacity.

Theoretical Irrigation Use = 0.05 cfs

Permitted Total Rate 0.01 cfs
License Recommendation 0.01 cfs

F. VOLUME CALCULATIONS

1. Volume Calculations for irrigation:

$V_{I.R.}$ = (Acres Irrigated) x (Irrigation Requirement) = 0.5 acres x 4.5 AFA = 2.3 AF
$V_{D.R.}$ = [Diversion Rate (cfs)] x (Days in Irrigation season) x 1.9835 = 0.01 cfs x 230 days x 1.9835 = 4.6 AF
V = Smaller of $V_{I.R.}$ and $V_{D.R.}$ = 2.3 AF

G. NARRATIVE/REMARKS/COMMENTS

A field exam was conducted on 09/15/22 by Senior Water Right Agent Laura McSherry and was accompanied by Ms. Julia Beruaga. Julia Beruaga is the applicant's next-door neighbor. The permit was approved on January 28, 2021, and proof of beneficial use was submitted on July 26, 2021.

The point of diversion (POD) location was confirmed on the South Fork Payette River in the Govt Lot 6 NESW QQ and is accurately described by the permit. A 1.5 hp Franklin submersed pump diverts water from the South Fork Payette River up an approximately 60ft steep slope using a 1" water hose. From the 1" mainline hose a metal hose connector connects to four handlines or 4 5/8" water hoses diverting water to small, stationary lawn sprinklers that irrigate the place of use (POU). Water right overlap did not discover any other water rights associated with the POD on the South Fork Payette River. No amendment required to correct the legal description.

SCANNED
DEC 02 2022

The permit authorizes 0.5 acre for irrigation within the Govt Lot 6 NESW QQ. ArcMap tools and aerial imagery, supported by photos taken during the field exam, were used to verify the area of irrigated lands. No amendment required to correct the legal description of the POU.

The POD is located on the perimeter of the POU that borders the South Fork Payette River. As a result, there is approximately 60 ft of head between where the water is diverted and where it is used on land. Pump and motor information was provided by the applicant. Using pump specifications for the 1.5 hp Franklin submersible pump with likely discharge pressure of 40-60 psi, 60 ft of head, and assuming 70% efficiency, a theoretical flow rate of 0.05 cfs was calculated which is more than the permitted rate. The recommended licensed flow rate for irrigation use is 0.01 cfs. The maximum diversion volume for irrigation use is 2.3 AF.

Condition 103 replaced condition 121 per department standards. Condition 01P replaced condition 01H with written watermaster permission (see file). Conditions R69, R05, 185, 01R, 948, and 020 were carried forward to license.

Have conditions of permit approval been met? __x__ Yes _____ No

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use	Rate of Diversion	Annual Volume
IRRIGATION	03/15 to 10/31	0.01 CFS	2.3 AF
	Totals:	0.01 CFS	2.3 AF

2. Recommended Amendments

_____ Change P.D. as reflected above _____ Add P.D. as reflected above __x__ None

_____ Change P.U. as reflected above _____ Add P.U. as reflected above __x__ None

I. AUTHENTICATION

Laura McSherry – Senior Water Resource Agent

Field Examiner's Name _____ Date 11.28.2022

Reviewer _____ Date _____

SCANNED

DEC 02 2022

DELIVERY SYSTEM DIAGRAM


Water Right No. 65-23918




NESW
10
08N05E
NESW 6


- IMPELLER DESIGN: Floating Stack
- IMPELLER MATERIAL: Acetal
- BODY MATERIAL: Stainless Steel
- MAXIMUM LIQUID TEMPERATURE: 120°F/49°C

Franklin Electric 4400 Tri-Seal 20 GPM Submersible Pump Curve

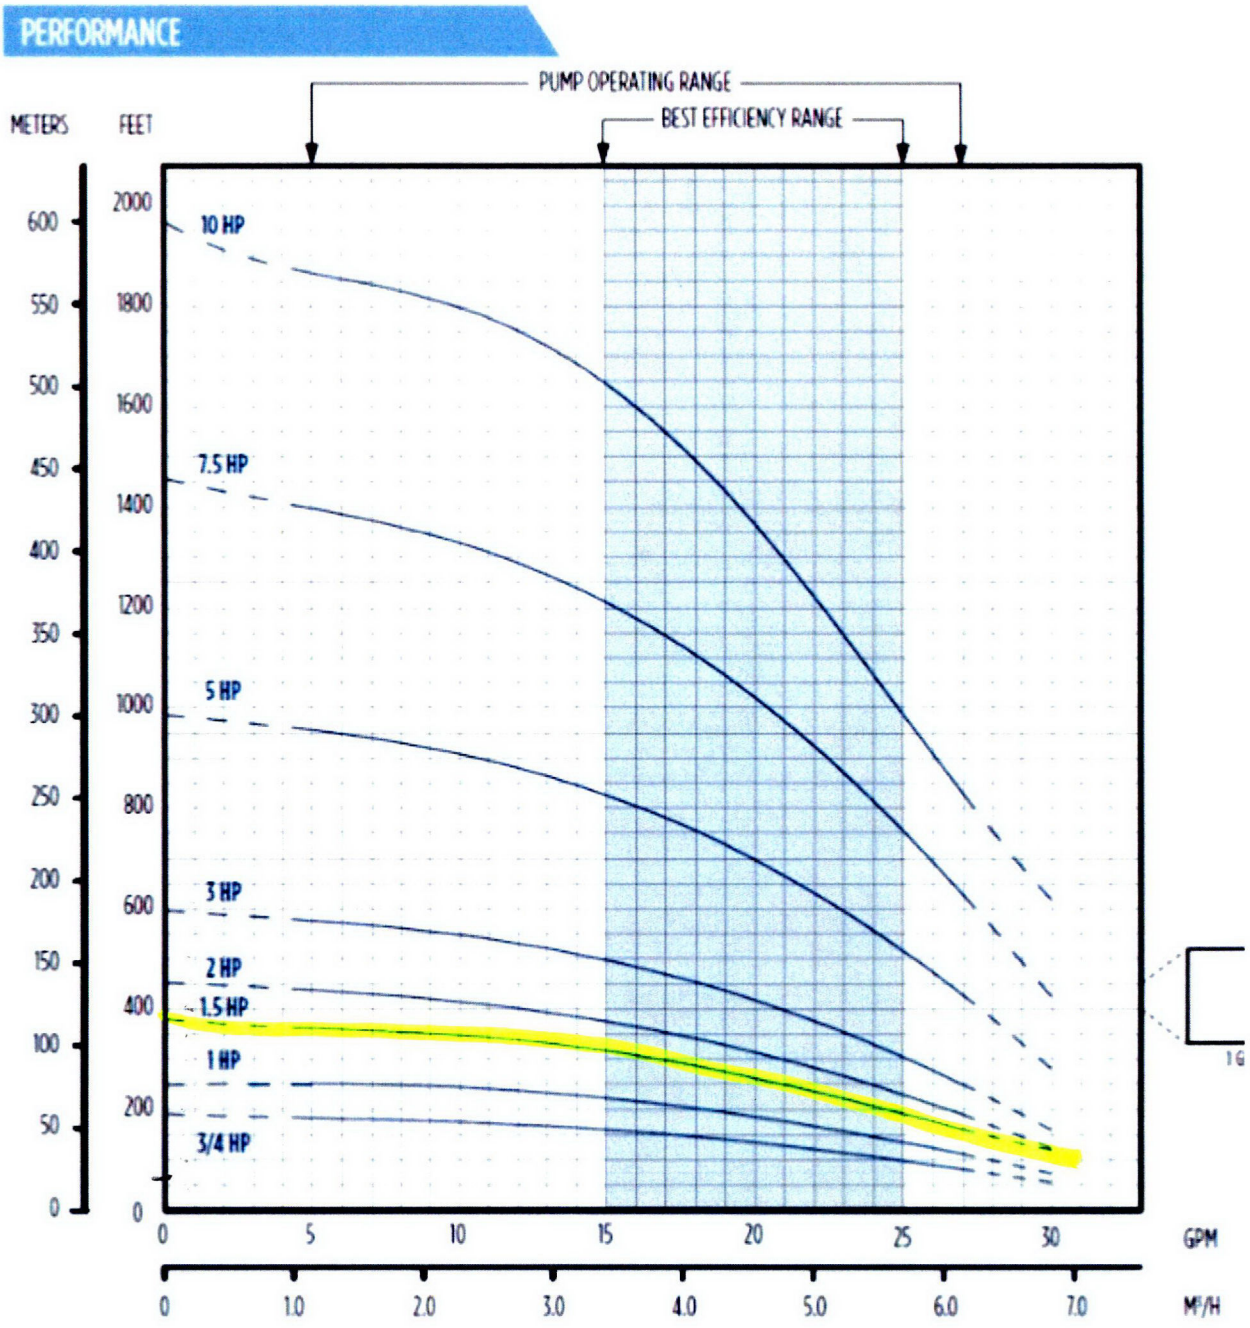

SCANNED
DEC 02 2022

PERFORMANCE

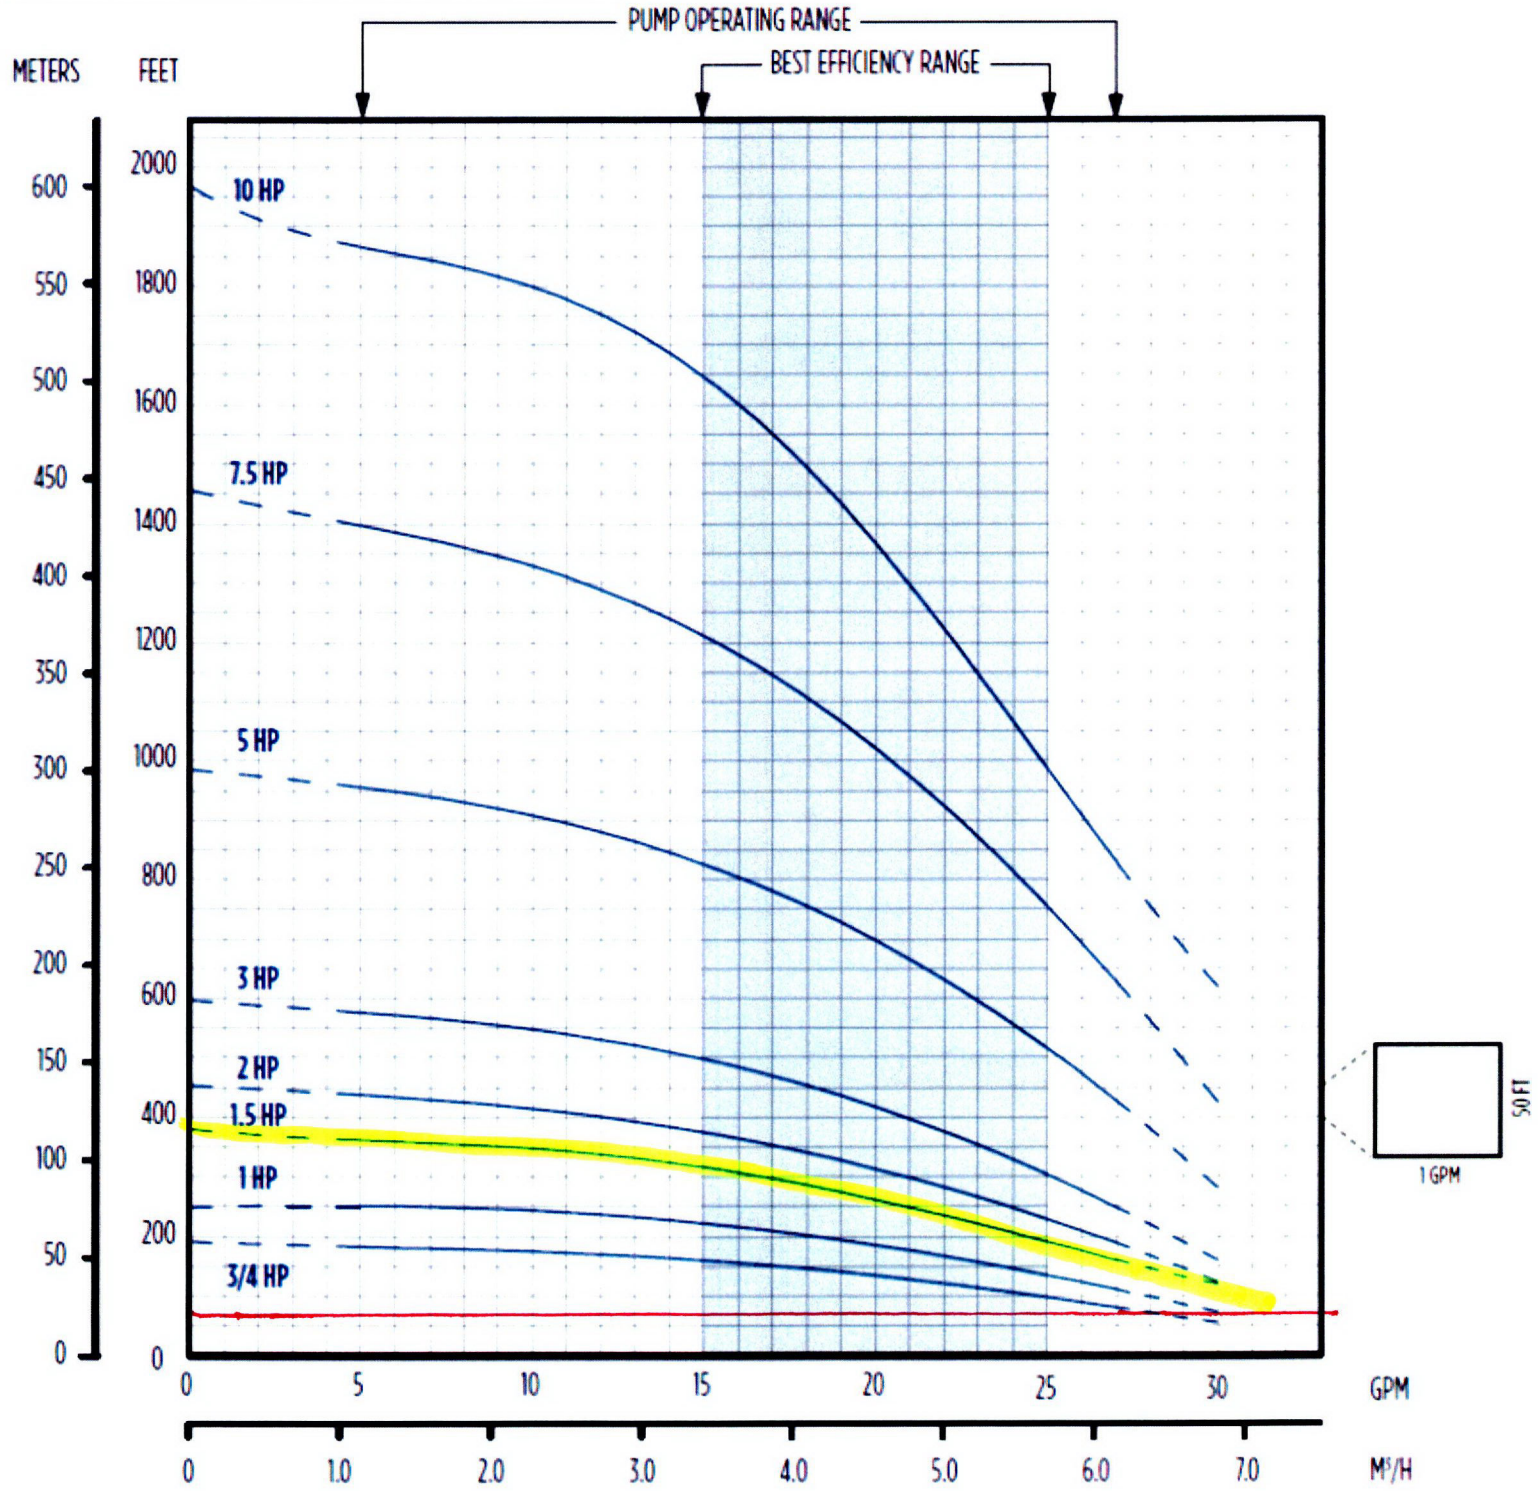

SCANNED
DEC 02 2022

THEORETICAL HORSEPOWER EQUATION WORKSHEET

Water Right No.: 63-23918
Examiner: Laura M
Date of Field Exam: 9/15/2022

Irrigation Use

	OPTION 1	OPTION 2	OPTION 3	
P/D No.:				
PUMP HORSEPOWER	1.5	1.5	1.5	
BOOSTER HORSEPOWER	0	0	0	
PUMPING LEVEL (LIFT)	55	60	65	
DISCHARGE PRESSURE	40	50	60	
FRICTION	0	0	0	
				AVE
RATE OF FLOW (cfs)	0.06	0.05	0.05	0.05
(gpm)	28.1	23.6	20.4	

The above calculates the formula =

$$Q = \frac{8.8 * (\text{Efficiency}) * hp}{\text{depth to water} + 2.31*(\text{psi}) + \text{friction}}$$

Assumptions: %70 efficiency

Lift was estimated from field observation. A standard 40-60 psi for sprinkler irrigation use was used to estimate the pressure against the pump.

SCANNED
DEC 02 2022



Fig. 1 – POD is ~60 feet down the steep slope in the South Fork of the Payette River. View looking NE.

GPS'd at:

44° 02' 38.48" N

115° 51' 9.36" W



Fig. 2 – Close up view of identical POD. Franklin Electric Submersible Pump, 1.5hp.

SCANNED

DEC 02 2022



Fig. 3 – 1" mainline hose diverts water from POD. View looking S towards domestic dwelling.



Fig. 4 – 5/8" water hoses connect to the mainline hose via metal hose connector.

SCANNED
DEC 0 2 2022



Fig. 5 – 5/8' water hose. Multiple hoses within the POU.



Fig. 6 – The water hoses connect to small, stationary lawn sprinklers. View looking NW.

SCANNED

DEC 02 2022



Fig. 7 – The water hoses connect to small, stationary lawn sprinklers. View looking N.



Fig. 8 – The water hoses connect to small, stationary lawn sprinklers. View looking E.

SCANNED
DEC 02 2022



Fig. 9 – Small, stationary lawn sprinklers irrigate within the POU.

SCANNED
DEC 02 2022

McSherry, Laura

From: McSherry, Laura
Sent: Tuesday, October 25, 2022 10:24 AM
To: Linnah Neidel; Neil Shippy
Subject: RE: Site visit Wednesday 10:30 586 Southfork Rd, Garden Valley

Neil,

Your comment on the condition waiver/modification via email will suffice and be added to the water right file. Thanks for your quick reply.

Best,
Laura

From: Linnah Neidel <linnahlou@gmail.com>
Sent: Tuesday, October 25, 2022 10:14 AM
To: Neil Shippy <neil.waterdistrict65@gmail.com>
Cc: McSherry, Laura <Laura.McSherry@idwr.idaho.gov>
Subject: Re: Site visit Wednesday 10:30 586 Southfork Rd, Garden Valley

CAUTION: **This email originated outside the State of Idaho network. Verify links and attachments BEFORE you click or open, even if you recognize and/or trust the sender. Contact your agency service desk with any concerns.**

Thank you Neil. Can you fill out the waiver and return it to Laura? Much appreciated. Linnah Neidel

On Tue, Oct 25, 2022, 9:42 AM Neil Shippy <neil.waterdistrict65@gmail.com> wrote:

WM CONDITION COMMENT

Good morning,

I have no problem with waiving this requirement as long as we reserve the right to require it in the future if problems arise.

On Tue, Oct 25, 2022 at 9:21 AM Linnah Neidel <linnahlou@gmail.com> wrote:

Hello Mr Shippy.

I am writing to see if you would be willing to work with me on my water rights request. Please see the email above. Laura McSherry from the ID Water Resources Department is working with me to issue my water rights, and I am lacking the required lockbox feature. She suggested that you could waive that requirement since we are asking for absolute minimal flow. Please let me know if you can fulfill this request by filling out the attached waiver and returning to Ms. McSherry. Thank you for considering this. Linnah Neidel (505) 980-9104

On Wed, Oct 19, 2022, 8:34 AM McSherry, Laura <Laura.McSherry@idwr.idaho.gov> wrote:

Linnah,

SCANNED
DEC 02 2022

Thanks for the update.

There is an option to request that the district watermaster waive that specific condition on water right #65-23918 being as the flow rate (0.01 cfs) allowed is minimal.

The watermaster in your area is Neil Shippy. You can reach him at 208-642-4465 or neil.waterdistrict65@gmail.com.

You can contact him and ask him to officially waive the "lockable device" condition by completing the attached form.

If a waiver can be obtained, return it to me, and I can draft the water right license.

Just making you aware of options. If you have any questions, please reach out.

Thanks,

Laura

From: Linnah Neidel <linnahlou@gmail.com>
Sent: Monday, October 17, 2022 8:07 AM
To: McSherry, Laura <Laura.McSherry@idwr.idaho.gov>
Subject: Re: Site visit Wednesday 10:30 586 Southfork Rd, Garden Valley

CAUTION: This email originated outside the State of Idaho network. Verify links and attachments BEFORE you click or open, even if you recognize and/or trust the sender. Contact your agency service desk with any concerns.

Hello Laura,

Thanks for the update. I have been in close contact with Julia about this. We are having a hard time lining up an electrician up here, but we are actively trying to get this done. We will send pictures ASAP. Much appreciated, Linnah Neidel

SCANNED
DEC 02 2022

On Fri, Oct 14, 2022, 3:50 PM McSherry, Laura <Laura.McSherry@idwr.idaho.gov> wrote:

Hello Linnah,

I successfully performed the field exam accompanied by Julia on September 15.

Confirmation of a specific condition requirement is needed before I can draft a water right license.

The permit has a condition (4.) which requires a "lockable device". This can be a valve or switch that would allow for the system to be turned off and easily accessible by a watermaster. Julia explained that a box attached to the front of the house with an on/off switch would be installed within the next month. Photos of this box would satisfy compliance with the permit condition if it remains easily accessible, meaning the box could not be locked or inside of the house.

Please provide photos of the box on the house and the valve or switch.

Once the photos are received, I can begin drafting the water right license.

If you have any questions, please reach out.

Thanks,

Laura McSherry

From: McSherry, Laura
Sent: Tuesday, September 13, 2022 10:04 AM
To: Linnah Neidel <linnahlou@gmail.com>
Subject: RE: Site visit Wednesday 10:30 586 Southfork Rd, Garden Valley

Great, thanks Linnah!

SCANNED
DEC 02 2022

I'll look forward to meeting Julia on Thursday.

From: Linnah Neidel <linnahlou@gmail.com>
Sent: Tuesday, September 13, 2022 9:58 AM
To: McSherry, Laura <Laura.McSherry@idwr.idaho.gov>
Subject: Re: Site visit Wednesday 10:30 586 Southfork Rd, Garden Valley

CAUTION: **This email originated outside the State of Idaho network. Verify links and attachments BEFORE you click or open, even if you recognize and/or trust the sender. Contact your agency service desk with any concerns.**

Good Morning Laura, Julia has confirmed for Thursday. Linnah Neidel

On Mon, Sep 12, 2022, 4:46 PM McSherry, Laura <Laura.McSherry@idwr.idaho.gov> wrote:

Linnah,

I will put the exam on my calendar and wait for confirmation.

Thanks,

Laura

From: Linnah Neidel <linnahlou@gmail.com>
Sent: Monday, September 12, 2022 4:32 PM
To: McSherry, Laura <Laura.McSherry@idwr.idaho.gov>
Subject: Re: Site visit Wednesday 10:30 586 Southfork Rd, Garden Valley

CAUTION: **This email originated outside the State of Idaho network. Verify links and attachments BEFORE you click or open, even if you recognize and/or trust the sender. Contact your agency service desk with any concerns.**

SCANNED
DEC 02 2022

Hello Laura, go ahead and plan to go on thursday? I hope to reach Julia this evening, and will confirm with you as soon as I talk to her. Thanks, Linnah Neidel

On Mon, Sep 12, 2022, 1:03 PM McSherry, Laura <Laura.McSherry@idwr.idaho.gov> wrote:

Hello Linnah,

Is Julia available this Thursday, September 15 at 10:30 am? If not, please let me know when she has time to meet me. The exam shouldn't take longer than 1 hour.

I'd like to get your field exam on the calendar soon.

Thanks again for your patience,

Laura

208-605-4633

From: Linnah Neidel <linnahlou@gmail.com>
Sent: Sunday, September 4, 2022 10:32 AM
To: McSherry, Laura <Laura.McSherry@idwr.idaho.gov>
Subject: Site visit Wednesday 10:30 586 Southfork Rd, Garden Valley

CAUTION: This email originated outside the State of Idaho network. Verify links and attachments BEFORE you click or open, even if you recognize and/or trust the sender. Contact your agency service desk with any concerns.

Hello Laura,

SCANNED
DEC 02 2022

I am confirming that my neighbor Julia Uberuaga will be available for your visit to my property on Wednesday at 10:30. Please direct any questions or comments to me.

The pump is a Franklin Electric Submersible Pump: 1.5 horsepower, 20gpm, 3 wire, 230V. Model # FEC20FA15S4. I got this information from Burgess Pumps where the pump was purchased. The pump is encased and submersed currently and I don't recall seeing any additional information on it when I last looked at it.

The pump has a control box that is on the side of the cabin. I don't have a current picture of it, but you will see it during your visit. I imagine the electrical can be disabled and then the box can be locked by the water master. If not, and there is an issue with the lockable feature, please let me know and I will work to remedy that immediately.

Looking forward to hearing back from you after your visit. Much appreciated, Linnah Neidel 505-980-9104

--
Neil Shippy
Watermaster
Water District #65
Cell 208-454-5678
Office 208-642-4465

SCANNED
DEC 02 2022

McSherry, Laura

From: Linnah Neidel <linnahlou@gmail.com>
Sent: Sunday, September 4, 2022 10:32 AM
To: McSherry, Laura
Subject: Site visit Wednesday 10:30 586 Southfork Rd, Garden Valley

CAUTION: **This email originated outside the State of Idaho network. Verify links and attachments BEFORE you click or open, even if you recognize and/or trust the sender. Contact your agency service desk with any concerns.**

Hello Laura,

I am confirming that my neighbor Julia Uberuaga will be available for your visit to my property on Wednesday at 10:30. Please direct any questions or comments to me.

The pump is a Franklin Electric Submersible Pump: 1.5 horsepower, 20gpm, 3 wire, 230V. Model # FEC20FA15S4. I got this information from Burgess Pumps where the pump was purchased. The pump is encased and submersed currently and I don't recall seeing any additional information on it when I last looked at it.

The pump has a control box that is on the side of the cabin. I don't have a current picture of it, but you will see it during your visit. I imagine the electrical can be disabled and then the box can be locked by the water master. If not, and there is an issue with the lockable feature, please let me know and I will work to remedy that immediately.

Looking forward to hearing back from you after your visit. Much appreciated, Linnah Neidel 505-980-9104

SCANNED
DEC 02 2022