State of Idaho
Department of Water Resources

Water Right License

Water Right No. 95-17392

Priority: December 14, 2017

Maximum Diversion Rate: 0.16 CFS
Maximum Diversion Volume: 6.9 AF

It is hereby certified that:

JOHN MATTHEW KOLAR 3201 HIGHWAY 5 PLUMMER ID 83851-8614

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated December 14, 2017, and has submitted Proof of Beneficial Use on April 17, 2023. An examination confirms water is diverted from:

Source : GROUND WATER

Beneficial Use	Period of Use	Rate of Diversion	Annual Volume
COMMERCIAL	01/01 to 12/31	0.16 CFS	3.9 AF
IRRIGATION	04/01 to 10/31	0.03 CFS	3.0 AF
FIRE PROTECTION	01/01 to 12/31	0.16 CFS	

Location of Point(s) of Diversion
GROUND WATER NE¼ NW¼, Sec. 15, Twp 46N, Rge 04W, B.M. BENEWAH County

Place of Use: COMMERCIAL and FIRE PROTECTION

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
46N	04W	15					X	X											

Place of Use: IRRIGATION

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
46N	04W	15					0.6	0.4											1.0

Total Acres: 1.0

Conditions of Approval

1. This right when combined with all other rights shall provide no more than 0.03 cfs per acre nor more than 3.0 afa per acre at the field headgate for irrigation of the place of use.
2. Commercial use is for 100 recreational vehicle lots and convience store.
3. Water shall not be diverted for fire protection use under this right except to fight or repel an existing fire.

This license is issued pursuant to the provisions of Idaho Code § 42-219. The water right confirmed by this license is subject to all prior water rights and shall be used in accordance with Idaho law and applicable rules of the Department of Water Resources.

Signed this 25th day of August, 2023.

PHILL HUMMER
Water Rights Supervisor


SCANNED
AUG 28 2023

State of Idaho
Department of Water Resources

Attachment to Water Right

95-17392

This map depicts the DOMESTIC, IRRIGATION, and FIRE PROTECTION place of use boundary for this water right at the timeof this approval and is attached to the approval document solely for illustrative purposes.

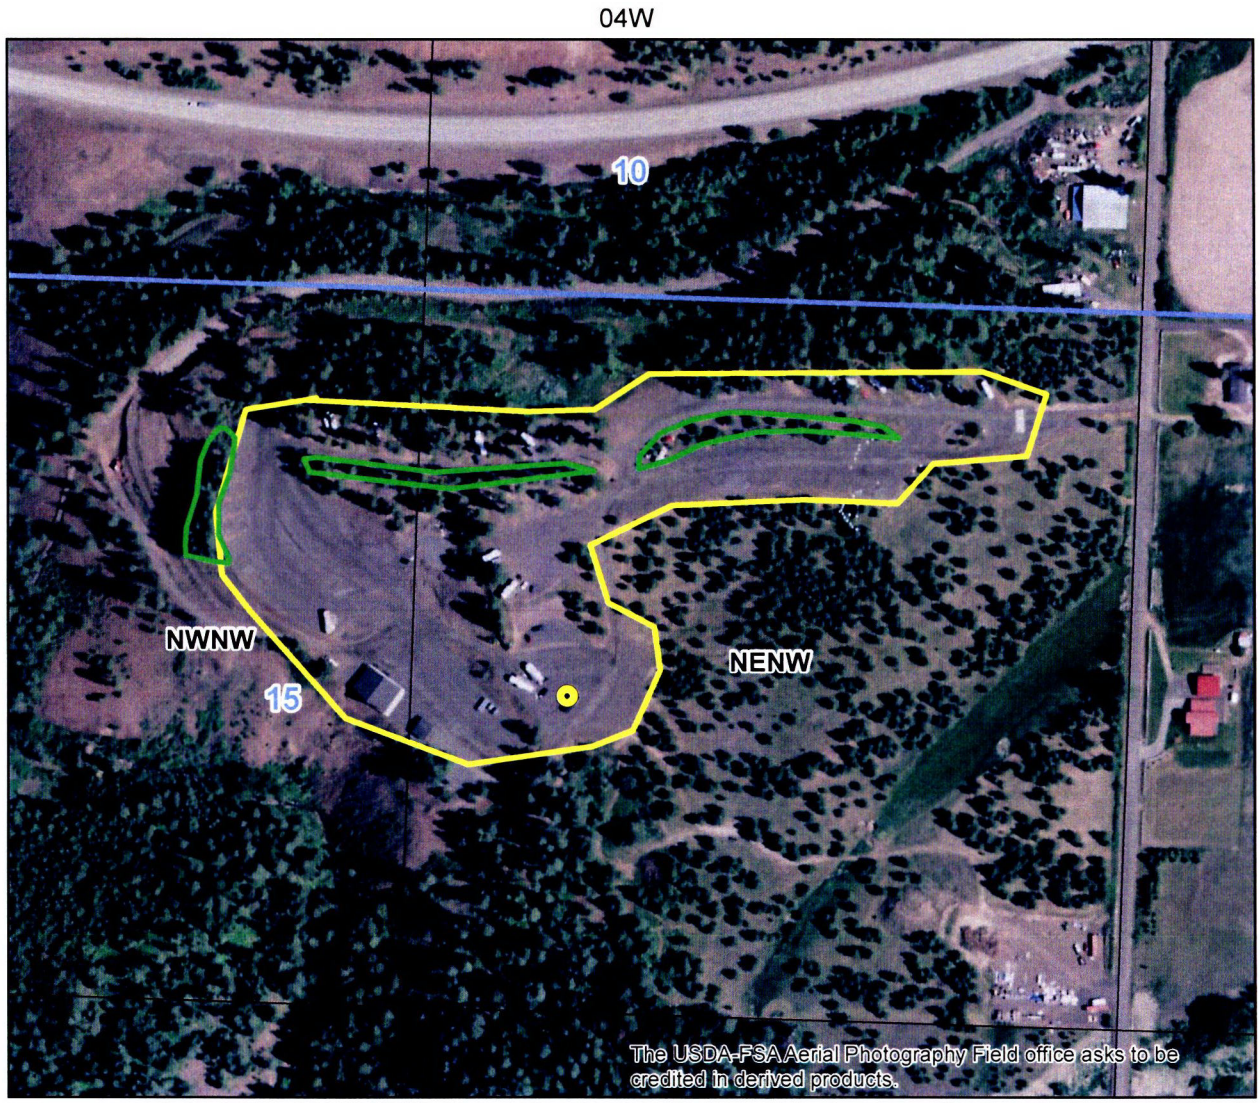

0 0.0425 0.085 0.17 Miles

- Domestic and Fire Protection Place Of Use Boundary
- Irrigation Place Of Use Boundary
- Townships
- PLS Sections
- Quarter Quarters
- Point of Diversion

N

SCANNED
AUG 2 9 2023

RECEIVED
APR 20 2023
DEPARTMENT OF WATER RESOURCES

Form 42-217 Rev. 6-22

RECEIVED
APR 17 2023
IDWR / NORTH

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

STATEMENT OF COMPLETION

FOR SUBMITTING PROOF OF BENEFICIAL USE

FOR OFFICE USE ONLY
Amt. of Fee $ 100.00
Receipt No. NO043101
Receipted By
Date Receipted 4-17-23

The Idaho Department of Water Resources (Department) considers this form a statement that the permit holder(s) applied water to beneficial use and completed development of a water right to the extent described below. **This form must be accompanied by an examination fee, when necessary, or by a completed Beneficial Use Field Report prepared by a certified water right examiner (CWRE).** Please refer to the instructions and fee schedule for this form. If ownership of the permit has changed, complete a Notice of Change in Water Right Ownership form. If you wish to relinquish your permit because you have not established the authorized water use and are not applying for an extension, please notify the Department in writing.

1. Permit No. 95-17392 Name of Permit Holder(s) John Mathew kolar

Telephone No. (503) 307-4479 Email matt@turnerlumber.com

Mailing Address 3201 Hwy 5 City Plummer State ID Zip 83851

2. Source of Water Ground Water If Ground Water (well), Date Drilled mo. May / yr. 2018

Drilling Permit/Tag No. D0076641 Drilling Company's Name H2O Well Service Inc.

3. Extent of use(s) completed **as authorized by the water right permit:**

Domestic (No. households) _____ Irrigation (No. acres) _____ Stockwater (No. and stock type) _____

Other Irigation 0.10 CFS Domestic (RV Spots & Buildings) 0.20 CFS Fire Protection 0.10 CFS

4. Total diversion rate or volume (storage only) for which proof is submitted 0.40 cfs OR _____ af

If the total developed water use is 5 acres of irrigation or less, is stockwater storage of 14.6 acre-feet or less, or has a diversion rate of less than 0.24 cfs, attach a map of the place of use and point of diversion and photographs showing beneficial use.

5. Describe the diversion and delivery system from the water source to the use (pump, lift, irrigation method, etc.)

Pump supplies water to 4 inch main distribution line which feeds buildings and hydrants for RV spaces.

6. Permit condition compliance. Refer to the permit approval conditions and check all the items required, then check "Yes" or "No" to indicate whether the required items were established, submitted, and/or installed:

Required?	Yes	No	(If "Yes", attach required data, evidence of compliance, or evidence of installation)
☐	☐	☐	Ground water level data, pumping information, or other diversion data
☐	☐	☐	Mitigation plan
☐	☐	☐	Lockable controlling works
☐	☑	☐	Measuring device
☐	☐	☐	Fish screen
☐	☐	☐	Other requirements of the water right permit _____
	☐	☐	Reasonably Anticipated Future Needs ("RAFN") Municipal use

If RAFN Municipal use, additional increment of beneficial use developed? ☐ Yes (attach CWRE report) ☐ No

7. Fee Enclosed $100.00 or ☐ CWRE field report attached or ☐ No fee required

See fee schedule on page 3 of the instructions. Proof statements filed without an appropriate fee are incomplete.

8. Person to contact to accompany a Department representative during the field examination of the water system:

Name: Luke A Kolar Telephone No. (208)691-4795 Email lkolar@hotmail.com

Mailing Address 835 Shay Hill Rd City St. Maries State ID Zip 83861

The information given on this form is my true statement of the extent to which the above numbered permit has been developed and water has been diverted and applied to beneficial use. I understand that any undeveloped portion of the permit is relinquished to the State of Idaho.

John Mathew Kolar 4/10/2023

SIGNATURE OF PERMIT HOLDER* PRINTED NAME AND TITLE DATE

* Attach power of attorney if completing on behalf of permit holder.

IDAHO DEPARTMENT OF
WATER RESOURCES

322 E Front Street, Suite 648, Boise ID 83702 • PO Box 83720, Boise ID 83720-0098
Phone: 208-287-4800 • Fax: 208-287-6700 • Email: idwrinfo@idwr.idaho.gov • Website: idwr.idaho.gov

Governor Brad Little

Director Gary Spackman

August 28, 2023

JOHN MATTHEW KOLAR
3201 HIGHWAY 5
PLUMMER ID 83851-8614

RE: License No. 95-17392

ISSUANCE OF LICENSE

Dear Water Right Holder(s):

The Department of Water Resources ("Department") has issued the enclosed Water Right License confirming that a water right has been established in accordance with your permit. Please be sure to thoroughly review all the conditions of approval listed on your license. The conditions may include ongoing requirements, such as maintenance of a measuring device or implementation of mitigation, as well as information about how your water use may be administered, such as regulation by a watermaster in a water district.

The license is a PRELIMINARY ORDER issued by the Department pursuant to Rule 730 of the Department's Rules of Procedure (IDAPA 37.01.01.730). It can and will become a final order without further action by the Department unless a party petitions for reconsideration, files exceptions, or requests a hearing as described in the enclosed information sheet.

Also, please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Water right forms are available from any office of the Department or on the Department's website at idwr.idaho.gov

If you have any questions concerning the enclosed information, please contact me at (208) 287-4925.

Sincerely,

Jean Hersley

For
Phill Hummer
Water Rights Supervisor

Enclosure(s)

SCANNED
AUG 29 2023

CERTIFICATE OF SERVICE

I hereby certify that on August 28, 2023, I served a true and correct copy of Water Right License No. 95-17392 by U.S. Mail, postage prepaid, to the following:

JOHN MATTHEW KOLAR (Current Owner)
3201 HIGHWAY 5
PLUMMER ID 83851-8614

LUKE KOLAR (Representative)
835 SHAY HILL ROAD
SAINT MARIES ID 83861

Jean Hersley
Technical Records Specialist 2

SCANNED
AUG 29 2023

EXPLANATORY INFORMATION TO ACCOMPANY A PRELIMINARY ORDER

(To be used in connection with actions when a hearing was **not** held)

(Required by Rule of Procedure 730.02)

The accompanying order or approved document is a "**Preliminary Order**" issued by the department pursuant to section 67-5243, Idaho Code. **It can and will become a final order without further action of the Department of Water Resources ("department") unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:**

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. **Note: the petition must be received by the department within this fourteen (14) day period.** The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after: (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the Department or the Water Resource Board is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the Department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

SCANNED
AUG 29 2023

CERTIFICATE OF SERVICE

All exceptions, briefs, requests for oral argument and any other matters filed with the Director in connection with the preliminary order shall be served on all other parties to the proceedings in accordance with IDAPA Rules 37.01.01302 and 37.01.01303 (Rules of Procedure 302 and 303).

FINAL ORDER

The Director will issue a final order within fifty-six (56) days of receipt of the written briefs, oral argument or response to briefs, whichever is later, unless waived by the parties or for good cause shown. The Director may remand the matter for further evidentiary hearings if further factual development of the record is necessary before issuing a final order. The department will serve a copy of the final order on all parties of record.

Section 67-5246(5), Idaho Code, provides as follows:

> Unless a different date is stated in a final order, the order is effective fourteen (14) days after its service date if a party has not filed a petition for reconsideration. If a party has filed a petition for reconsideration with the agency head, the final order becomes effective when:
>
> (a) The petition for reconsideration is disposed of; or
> (b) The petition is deemed denied because the agency head did not dispose of the petition within twenty-one (21) days.

APPEAL OF FINAL ORDER TO DISTRICT COURT

Pursuant to sections 67-5270 and 67-5272, Idaho Code, if this preliminary order becomes final, any party aggrieved by the final order or orders previously issued in this case may appeal the final order and all previously issued orders in this case to district court by filing a petition in the district court of the county in which:

i. A hearing was held,
ii. The final agency action was taken,
iii. The party seeking review of the order resides, or
iv. The real property or personal property that was the subject of the agency action is located.

The appeal must be filed within twenty-eight (28) days of this preliminary order becoming final. See section 67-5273, Idaho Code. The filing of an appeal to district court does not itself stay the effectiveness or enforcement of the order under appeal.

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No: 95-17392
Exam Date: 06/27/2023

1. Current Owner:
   JOHN MATTHEW KOLAR 3201 HIGHWAY 5 PLUMMER ID 83851-8614

2. Accompanied by: Luke Kolar
   Phone No: 208 691-4795
   Address:
   Relationship to permit Holder: Representative

3. **SOURCE:**
GROUND WATER

Method of Determination: Well construction log and photographs, D Tag match from field observation

B. OVERLAP REVIEW

1. Other water rights with the same place of use: NO Overlap

Water Right No.	Source	Purpose of Use	Basis
N/A			
N/A			

Comments: N/A

2. Other water rights with the same point-of-diversion: NO Overlap

Water Right No.	Source	Purpose of Use	Basis
N/A			
N/A			

Comments: N/A

C. DIVERSION AND DELIVERY SYSTEM

1. **LOCATION OF POINT(S) OF DIVERSION:**
GROUND WATER NE¼ NW¼, Sec. 15, Twp 46N, Rge 04W, B.M. BENEWAH County

Method of Determination: GPS confirmation (see attachments)

PLACE OF USE: IRRIGATION

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
46N	04W	15					0.6	0.4											1.0

Total Acres: 1.0

PLACE OF USE: COMMERCIAL

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
46N	04W	15					X	X											

SCANNED
AUG 29 2023

PLACE OF USE: FIRE PROTECTION

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
46N	04W	15					X	X											

Method of Determination: GIS and confirmation of irrigation via field examination

3.

x Delivery System Diagram Attached (required). Indicate all major components and distances between components. Indicate weir size/pipe as applicable.

x Map Attached Showing Location(s) of point(s) of diversion and place(s) of use (required). Scale must be 1:24,000 or greater.

x Aerial Photo Attached (required for irrigation of 10+ acres).

x Photo of Diversion and System Attached

4.

Well or Diversion ID No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
993797		**5**		**Franklin Electric**	

D. FLOW MEASUREMENTS

1.

Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
N/A						

2. Measurements: A flow meter measurement was not possible at this exam. A bucket test was performed at one of the RV spaces, repeated 3 times. It took approximately 30 seconds to fill a 5-gallon bucket, which is approximately 10 GPM/0.02 CFS.

E. FLOW CALCULATIONS

_____ Additional Computation Sheets Attached

Measured Method: Pressure tank analysis

SCANNED
AUG 29 2023

P/D No.:	Secenario #1	Scenario #2	Based On Pump Performance Data Sheet	
PUMP HORSEPOWER	6	6	6	
BOOSTER HORSEPOWER	0	0	0	
PUMPING LEVEL	224	65	137.5	
DISCHARGE PRESSURE	70	70	70	
RATE OF FLOW (cfs)	0.10	0.16	0.12	AVE 0.13
RATE OF FLOW (gpm)	43	73	55	57.2

The above calculates the formula = $Q = \frac{8.8 * (\text{Efficiency}) * hp}{\text{depth to water} + 2.31*(psi)+\text{friction}}$

Above show three scenarios for recharging the permit holder's pressure tank. The diversion system has a VFD installed that keeps the 119-gallon pressure tank (Water Worker HT-119B) at 70 PSI. Therefore, to add water to the pressure tank, the "discharge pressure" from the well to the pressure tank is 70 PSI. Kolar said the VFD allows the pump to operate at 120% capacity, so I am assuming this to mean the pump can produce 6 HP of power (5 * 1.2 = 6). The pumping levels chosen are:

1) The Well Construction Log static water level
2) The water level recorded by the installed meter (see attachments)
3) ½ the distance between the static water level and the total depth of the well

Friction has been ignored, but it can be assumed to be minimal given the pressure tank is adjacent to the well casing. If the installed water level meter is to be trusted, the diversion system is not capable of delivering the permitted flow rate to the storage tank. Due to this analysis, I am recommending the licensed flow rate to be 0.16 cfs to represent the system's best-case scenario.

Permitted Rate: 0.20 cfs
Proof of Beneficial Use Rate: 0.40 cfs
Recommended Rate: 0.16 cfs

F. VOLUME CALCULATIONS

1. Volume Calculations for irrigation:

$V_{I.R}$ = (Acres Irrigated) x (Irrigation Requirement) = 1 acre * 3 acre-ft/acre = 3 acre-ft
$V_{D.R}$ = [Diversion Rate (cfs)] x (Days in Irrigation season) x 1.9835 = 0.03 cfs * 214 * 1.9835 = 12.7 acre-ft
V = Smaller of $V_{I.R}$ and $V_{D.R}$ = 3 acre-ft

2. Volume Calculations for Other Uses:

COMMERCIAL USE:

Soaring Hawk RV Park is open from April 1 – Oct 1 = 184 Days

SCANNED
AUG 29 2023

Recreation Area Use Type	Current design flow (gallons of water per day)	Recommended design flow (gallons of water per day)
Camping Facility		
Without flush toilets	5	10
With flush toilets	20-30	20-30
With flush toilets and showers	25-50	20-40
Individual site water and sewer connections	50	30
Day use		
With flush toilets	5	5
Wastewater Dump Station	20-30	40 (gallons per vehicle)
Visitor Center	—	2-3

SOURCE: https://www.fs.usda.gov/t-d/pubs/pdfpubs/pdf07732326/pdf07732326dpi72.pdf

Facilities with RV dumps stations are represented on the higher end of the recommended rates. Soaring Hawk has 100 connections, 3 flush bathrooms, a laundromat with 4 washers and 6 dryers, and 2 showers. Given this RV park has a laundromat, I am recommending a volume based on the current design volume of 50 gallons per day.

100 connections * 50 gallons/day * 184 days/year = 920,000 gallons/year = 2.82 acre-ft/year

RV Dump Station volume: Kolar's estimated average stay duration is 4 days. Assuming a full season, each connection can have 184/4 = 46 unique stays.

100 connections * 46 uses/connection-year * 40 gallons/vehicle = 184,000 gallons/yr = 0.56 acre-ft/year

Soaring Hawk also has a "convenience store" that functions as an even center and a lobby to confirm reservations. The standard for a "store" is 400 gallons per day per restroom. There were two restrooms in the building.

2 restrooms * 400 * 184 days = 0.45 acre ft, rounded up to 0.5 acre-ft

2.82 acre-ft/year + 0.56 acre-ft/year + 0.5 acre-ft/year = 3.88 acre-ft/year = 3.9 acre-ft/year

TOTAL= Irrigation volume + Commercial volume = 6.9 acre-ft/year

G. NARRATIVE/REMARKS/COMMENTS

John and Luke Kolar, siblings, submitted an application for permit for their co-owned RV Park, "Soaring Hawk RV Park" on October 23, 2017. John is the owner of the water right permit and Luke is listed as a representative. Initially deemed unacceptable due to conflicting rates and incorrect beneficial use designation, an amended permit was accepted December 14, 2017, advancing their priority date to the amended application filing date. After 5 years of development, they submitted Proof of Beneficial Use on April 17, 2023 for 0.40 cfs, which should be considered an error given that it is greater than the permitted rate. A beneficial use exam was conducted on June 27, 2023 by Blake Burkard and Justin Shearer. Both John and Luke were present.

The POD's PLS location was confirmed via field inspection and GPS to be NE¼ NW¼, Sec. 15, Twp 46N, Rge 04W. The well drillers report documents that the well was drilled to 340 ft in 2018 (attached) (Well ID: 451089). The pumphouse has a real-time water level meter read-out that read 65 ft during the exam. A flow measurement was not achievable in the field, so a theoretical calculation was performed as part of the exam using information requested about the submersible pump, VFD,

SCANNED
AUG 29 2023

and the pressure tank set-up. Only the pump brand and horsepower was known by the permit holder, so I applied the standard 70% efficiency. See the attached calculation sheet for rate justification. I am recommending a flow rate of 0.16 cfs.

The POU for water right permit 95-17392 was confirmed to be NE¼ NW¼, Sec. 15, Twp 46N, Rge 04W and NW¼ NW¼, Sec. 15, Twp 46N, Rge 04W via field observation and satellite imagery. Tax Parcel data confirms that the permit holders own the RV park parcel. The permit allowed for irrigation of up to 10 acres of land, but the permit holders stated that they only irrigate the newly planted or young pine trees that provide shade to the RV slots. Attached photographs show young trees. Selecting the areas that the Kolars stated was irrigated amounted to 1 acre, which is the acreage I have used for recommending an irrigation flow rate and annual volume. I am recommending the standard rate of 0.03 cfs for irrigation.

The fire prevention use listed on the permit has also been developed, as the permit holders have installed two fire hydrants at opposite ends of the RV park to put out existing fires. The fire hydrants and the hoses stationed next to them are 2" lines. Since I believe that the hydrants are capable of diverting water at the commercial rate, I am recommending increasing the fire protection rate to 0.16.

During the application process, the Northern Region had changed the nature of use from commercial to domestic. Since I believe that RV parks can be better described as commercial use, I am recommending changing the use back to commercial.

IDWR does not have standard rates or volumes for RV parks. USFS published *Water Use in Forest Service Recreation Areas: Guidelines for Water System Designers* in 2007 to be used for designing distribution systems in campgrounds and RV parks. My recommended volume for the permit's commercial use references this report for calculating a volume to represent Soaring Hawk RV Park at a maximum capacity, which is 7 acre-ft per year.

Conditions 046 and 26A used on the permit should be removed given the project has been completed and the well has been constructed to Idaho Code. Condition 132 explaining the commercial use as 100 RV connections, 1 convenience store, excluding irrigation from this component should be changed to a text condition to describe the commercial use as the volume is heavily dependent on the number of connections. Condition 077 detailing the fire protection use of the permit should also remain. R62 should be changed to R66 because the standard rate changed from 0.02 cfs to 0.03 cfs due to the scale of the irrigation system being less than 5 acres. Condition 004 should also be removed as there is confirmed that that the POD and POU are owned by the permit holders.

Have conditions of permit approval been met? _X_ Yes ____ No

H. RECOMMENDATIONS

1. Recommended Amounts

Beneficial Use	Period of Use	Rate of Diversion	Volume
IRRIGATION	04/01 to 10/31	0.03 CFS	3.0 AF
COMMERCIAL	01/01 to 12/31	0.16 CFS	3.9 AF
FIRE PROTECTION	01/01 to 12/31	0.16 CFS	
	Totals:	0.16 CFS	6.9 AF

SCANNED
AUG 29 2023

2. Recommended Amendments

____ Change P.D. as reflected above ____ Add P.D. as reflected above __x__ None

____ Change P.U. as reflected above ____ Add P.U. as reflected above __x__ None

I. **AUTHENTICATION** Blake Burkard -

Field Examiner's Name _____ Date 8/25

Reviewer _____ Date 8/25/23

SCANNED
AUG 29 2023

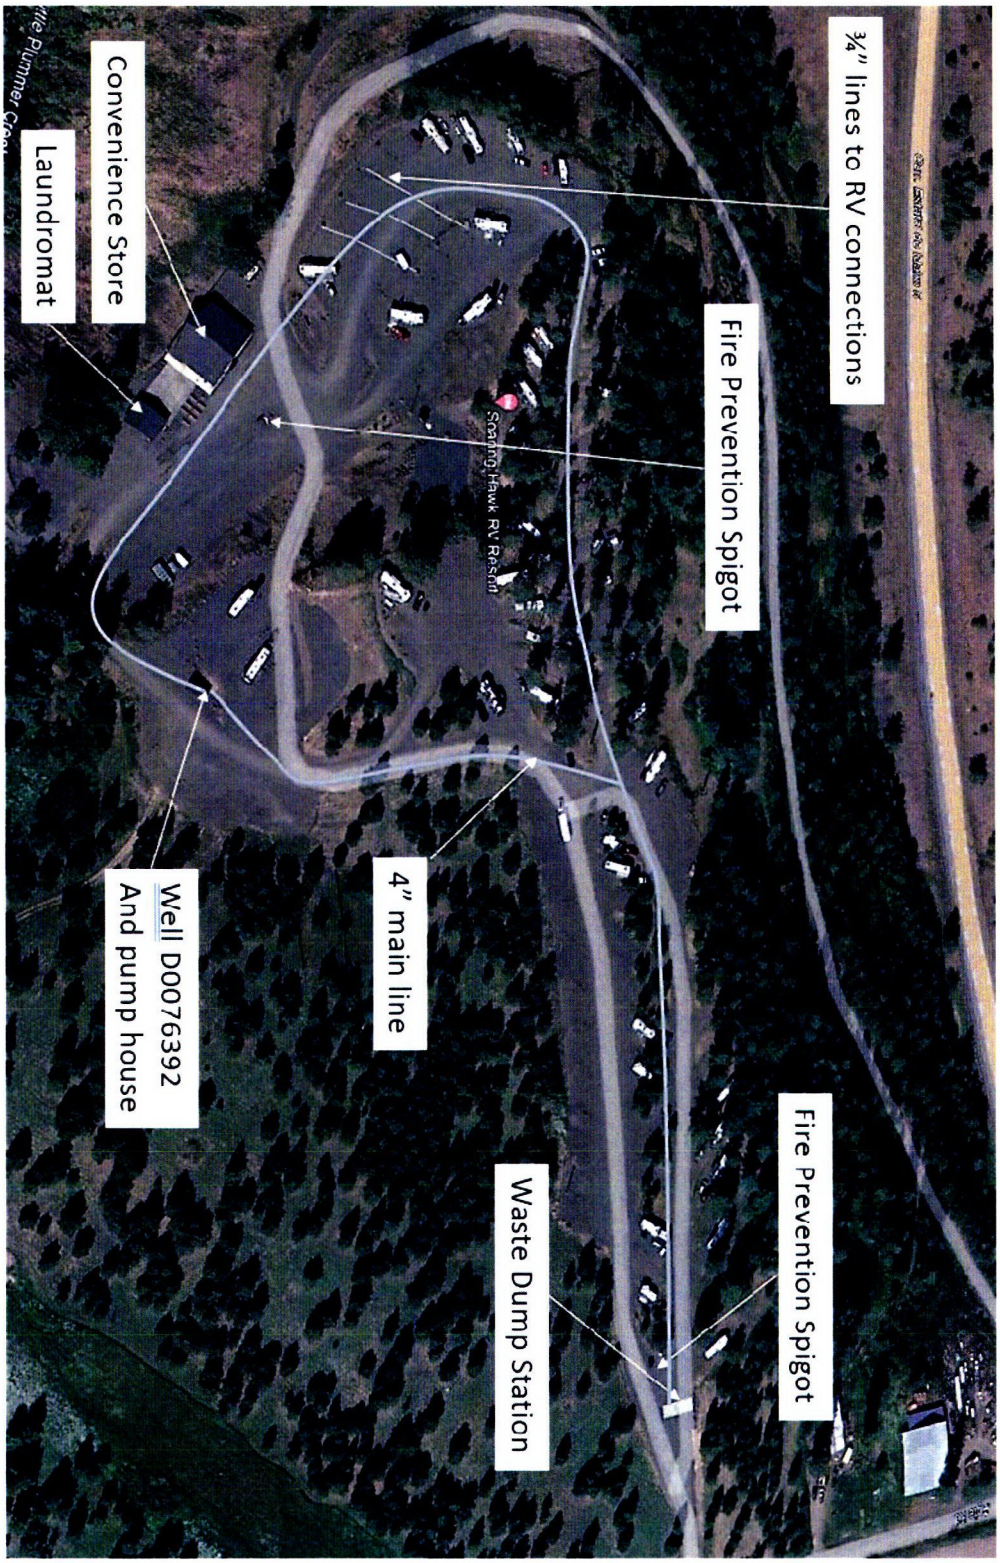


Figure 1: System Diagram

SCANNED
AUG 29 2023

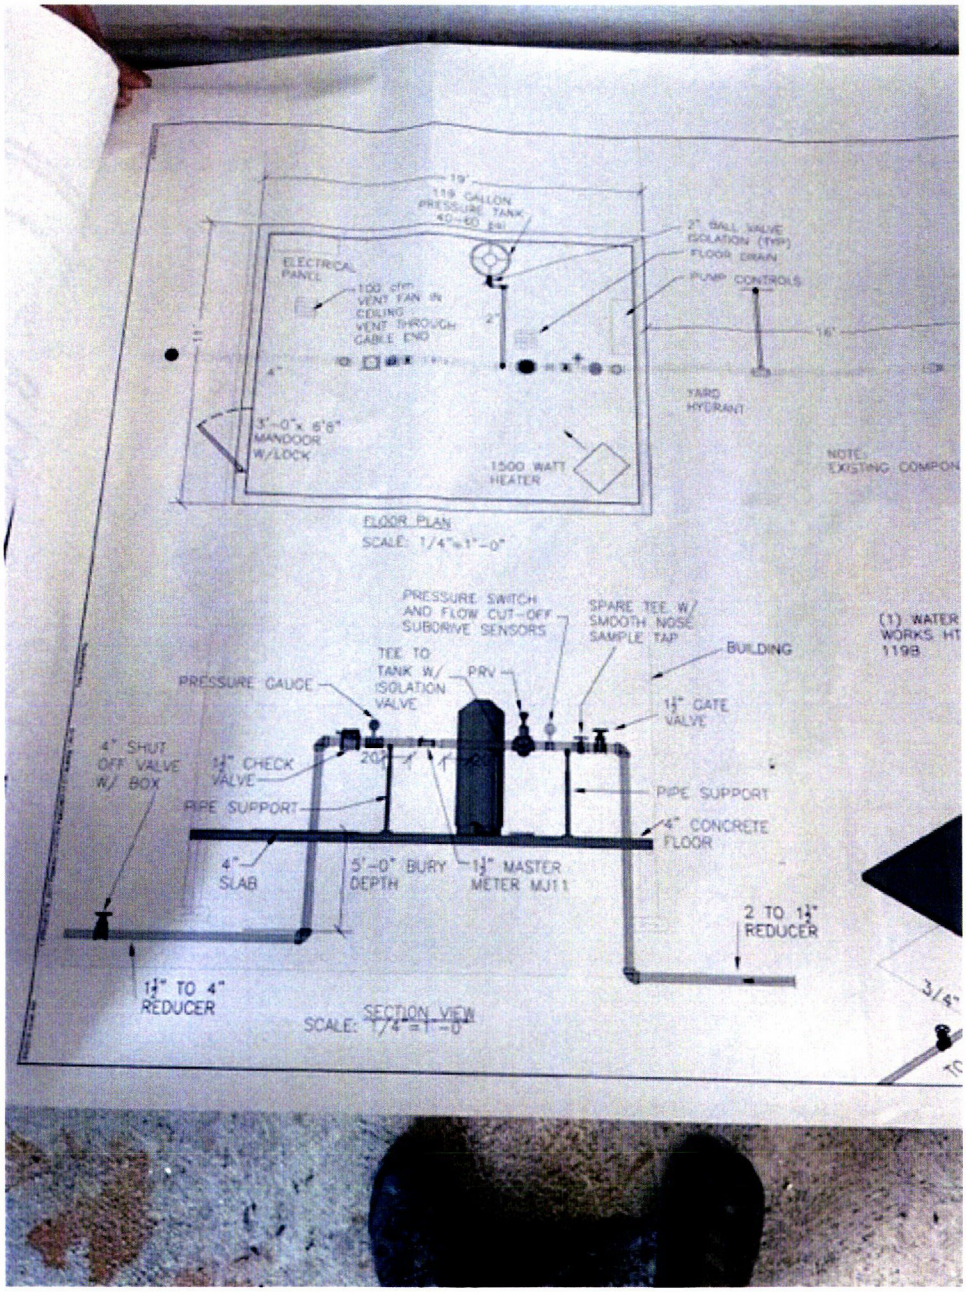


Figure 2: Pumphouse as-built schematics

SCANNED
AUG 29 2023



Figure 3: 119 gallon pressure tank and piping

SCANNED
AUG 2 9 2023

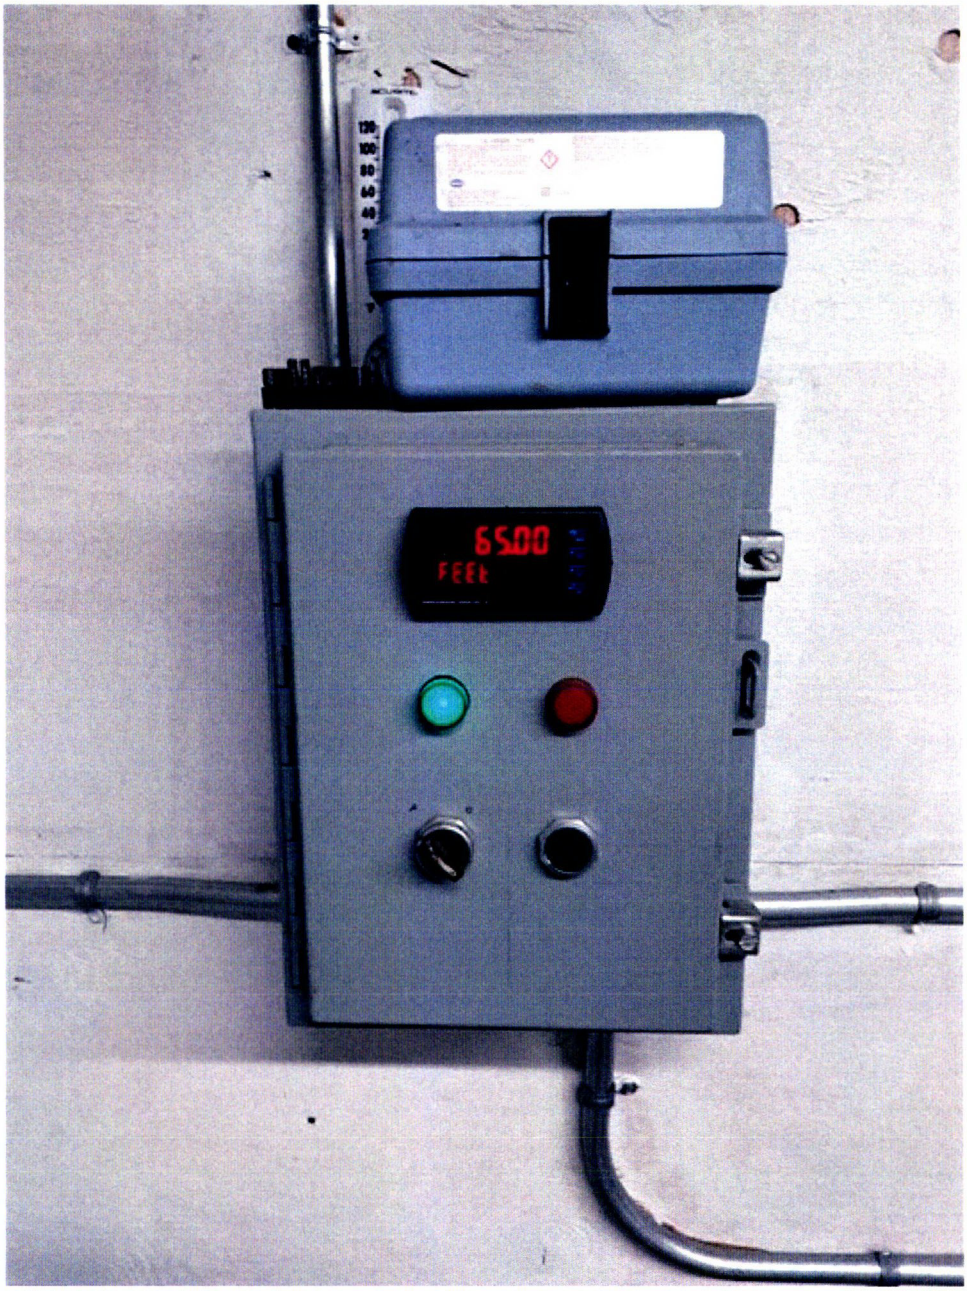


Figure 4: Static Water Level Meter

SCANNED
AUG 29 2023

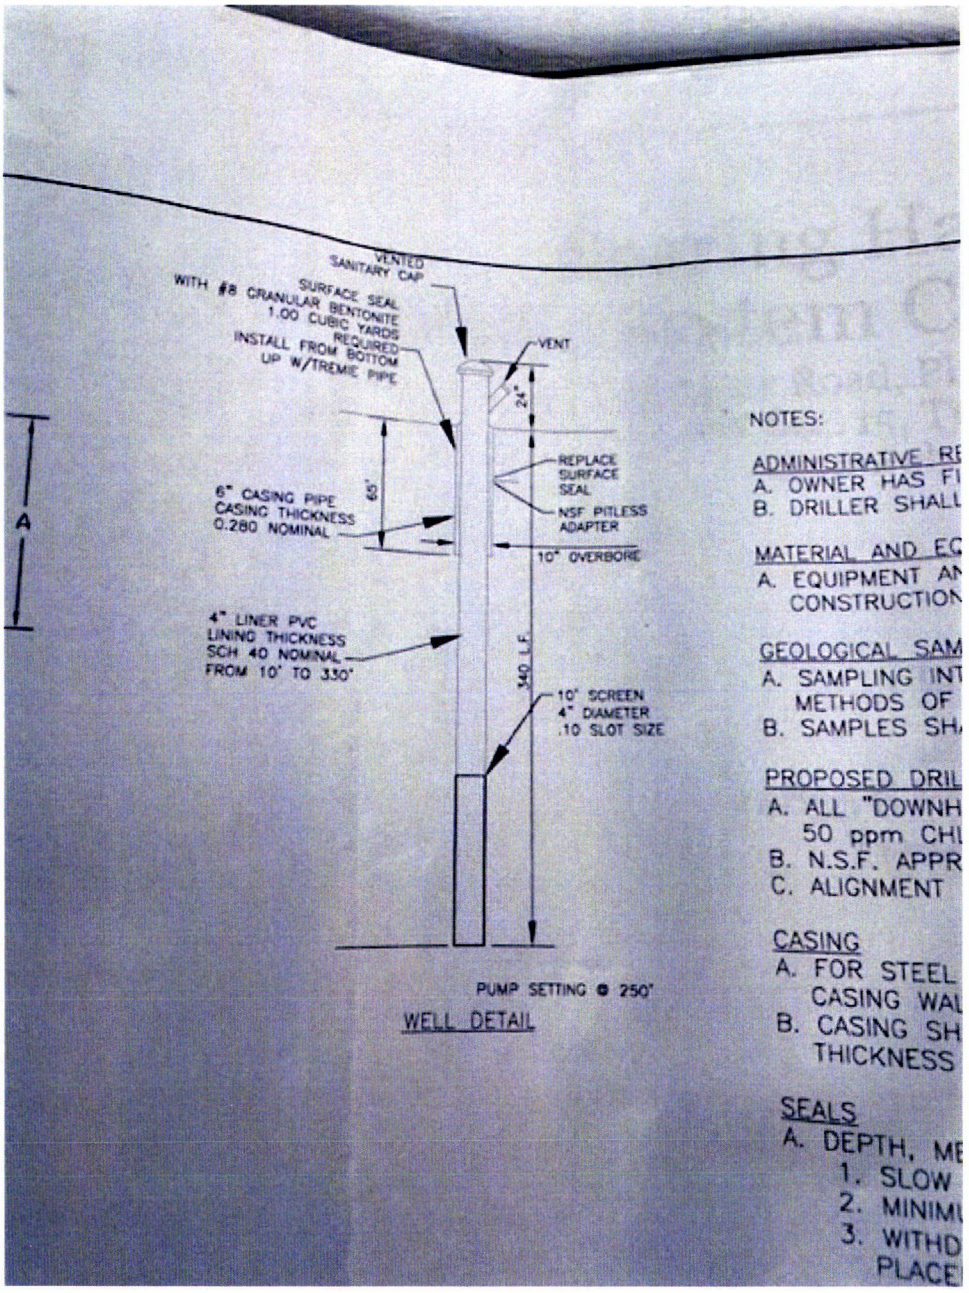


Figure 5: Well construction diagram

SCANNED
AUG 29 2023

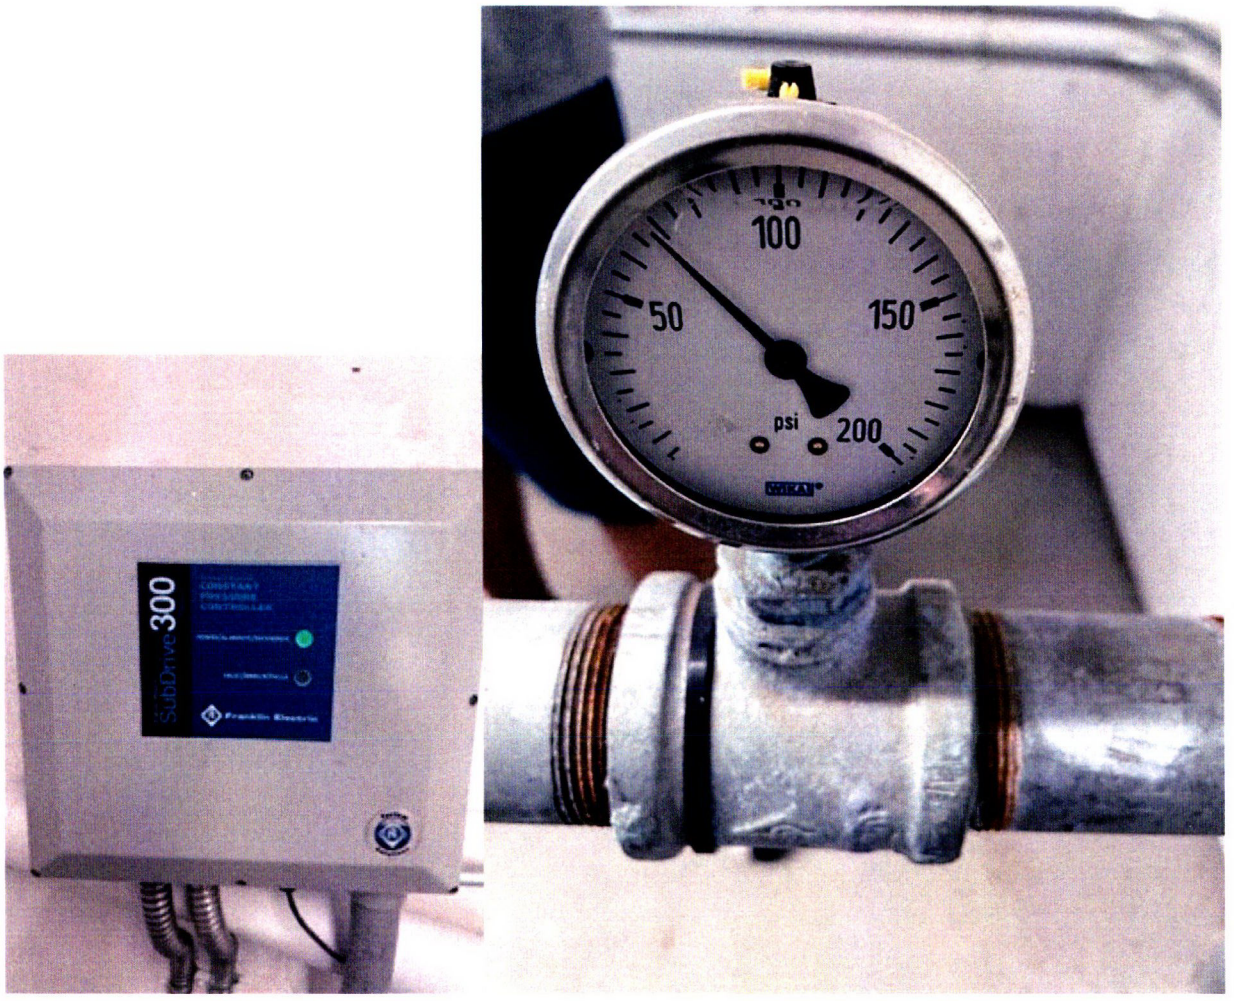


Figure 6: VFD and pressure of main lines

SCANNED
AUG 29 2023



Figure 7: GPS coordinates and D-Tag of well

SCANNED
AUG 2 9 2023



Figure 8: Frost-free spigot at each connection. Merrill C-1000

SCANNED
AUG 2 9 2023



Figure 9: Fire hydrant

SCANNED
AUG 2 9 2023



Figure 10: Event center / convenience store

SCANNED
AUG 2 9 2023







Figure 11: Laundromat and bathroom facilities

SCANNED
AUG 2 9 2023



Figure 12: RV connection stalls with power and water hookups

SCANNED
AUG 2 9 2023

Form 238-7
6/07

IDAHO DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORT

1. WELL TAG NO. D D0076641

Drilling Permit No. ___

Water right or injection well # 95-17392

2. OWNER: Soaring Hawk RV Park

Name John Kolar

Address 929 College Ave.

City St. Maries State ID Zip 83861

3.WELL LOCATION:

Twp. 46N North ☒ or South ☐ Rge. 04W East ☐ or West ☒

Sec. 15 ___ 1/4 (10 acres) NE 1/4 (40 acres) NW 1/4 (160 acres)

Gov't Lot ___ County Benewah

Lat. N47 ° 20 . 116 (Deg. and Decimal minutes)

Long. W116 ° 49 . 528 (Deg. and Decimal minutes)

Address of Well Site 99 Agte Rd. City Plummer

(Give at least name of road + Distance to Road or Landmark)

Lot. ___ Blk. ___ Sub. Name ___

4. USE:

☐ Domestic ☐ Municipal ☐ Monitor ☐ Irrigation ☐ Thermal ☐ Injection

☒ Other Campground

5. TYPE OF WORK:

☒ New well ☐ Replacement well ☐ Modify existing well

☐ Abandonment ☐ Other ___

6. DRILL METHOD:

☒ Air Rotary ☐ Mud Rotary ☐ Cable ☐ Other ___

7. SEALING PROCEDURES:

Seal material	From (ft)	To (ft)	Quantity (lbs or ft³)	Placement method/procedure
Bentonite	0	65	1500 lbs.	Overbore

8. CASING/LINER:

Diameter (nominal)	From (ft)	To (ft)	Gauge/ Schedule	Material	Casing	Liner	Threaded	Welded
6"	+2	65	.280	Steel	☒	☐	☐	☒
4"	-10	330	40	PVC	☐	☒	☐	☐
					☐	☐	☐	☐
					☐	☐	☐	☐

Was drive shoe used? ☒ Y ☐ N Shoe Depth(s) 330'

9. PERFORATIONS/SCREENS:

Perforations ☐ Y ☒ N Method ___

Manufactured screen ☒ Y ☐ N Type Stainless steel

Method of installation ___

From (ft)	To (ft)	Slot size	Number/ft	Diameter (nominal)	Material	Gauge or Schedule
330	340	.10	10'	4"	SS	

Length of Headpipe 0 Length of Tailpipe 0

Packer ☐ Y ☒ N Type ___

10.FILTER PACK:

Filter Material	From (ft)	To (ft)	Quantity (lbs or ft³)	Placement method

11. FLOWING ARTESIAN:

Flowing Artesian? ☐ Y ☒ N Artesian Pressure (PSIG) ___

Describe control device ___

12. STATIC WATER LEVEL and WELL TESTS:

Depth first water encountered (ft) 287 Static water level (ft) 244

Water temp. (°F) Cold Bottom hole temp. (°F) Cold

Describe access port welded cap

Well test:

Drawdown (feet)	Discharge or yield (gpm)	Test duration (minutes)
	25	60

Test method:

Pump	Bailer	Air	Flowing artesian
☐	☐	☒	☐
☐	☐	☐	☐

Water quality test or comments: ___

13. LITHOLOGIC LOG and/or repairs or abandonment:

Bore Dia. (in)	From (ft)	To (ft)	Remarks, lithology or description of repairs or abandonment, water temp.	Water Y	Water N
10	0	4	Backfill		x
10	4	9	Clay & Broken Basalt		x
10	9	65	Black Med. Basalt		x
6	65	123	Black Med. Basalt		x
6	123	126	Basalt w/ Green Clay		x
6	126	283	Black Med. Basalt		x
6	283	287	Brown Hard Clay		x
6	287	315	Broken Basalt w/ Some Sand	x	
6	315	340	Basalt		x
			Revised Static Water Level		

RECEIVED
AUG 14 2018
IDWR / NORTH

Completed Depth (Measurable): 340'

Date Started: May 22, 2018 Date Completed: May 24, 2018

14. DRILLER'S CERTIFICATION:

I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

Company Name H2O Well Service Inc. Co. No. 448

*Principal Driller [signature] Date 7-16-18

*Driller [signature] Date 7-16-18

*Operator II ___ Date ___

Operator I [signature] Date 7-16-18

* **Signature of Principal Driller and rig operator are required.**

SCANNED
AUG 29 2023

Beneficial Use Proof Evaluation

Permit Number: 95-17392 Reviewer: AVeibell Review Date: 4/25/2023

Acceptability

1) Is the contact on the request the current permit holder? Yes
2) Does the address of record need to be updated? No
3) Proof Submitted Date: 4/17/2023
4) Proof Due Date: 5/1/2023
5) Days added for weekend due date?
6) Days added for holiday due date?
7) Number of days late: -16
8) Proof received timely? Yes

Analysis

1) Are the water uses correct? Yes
2) Are one of the following items required?
    a. Measuring Device -- No
    b. Lockable Device --No
    c. Fish Screen -- No
3) Are the required items installed? Yes
    a. Measuring Device -- No
    b. Lockable Device --No
    c. Fish Screen -- No
4) Is there a request to waive the required items? No
5) Drilling Permit Number: D0076641
6) Is a drilling permit upgrade needed? No
7) Was a well drillers report filed? No
8) Is proof accepted? Yes

Fees

1) Is a licensing exam fee required? Yes
2) Was proof submitted with an exam report from a CWE? No
3) Filing fee due: $50.00
4) Filing fee submitted: $100.00
5) Remaining fee or (refund): ($50.00)

Receipt IDs

N033005

Comments

Proof deemed acceptable. Gave file to water right agent for in-house license review. Water right agent will enter the proof made date in AdHoc at the time of licensing.

IDAHO DEPARTMENT OF
WATER RESOURCES

322 E Front Street, Suite 648, Boise ID 83702 • PO Box 83720, Boise ID 83720-0098
Phone: 208-287-4800 • Fax: 208-287-6700 • Email: idwrinfo@idwr.idaho.gov • Website: idwr.idaho.gov

Governor Brad Little
Director Gary Spackman

February 28, 2023

JOHN MATTHEW KOLAR
14855 SW CHARDONNAY AVE
TIGARD OR 97224

NOTICE: STATEMENT OF COMPLETION DUE

RE: Permit No. 95-17392

IMPORTANT: A response from you is required to maintain the active status of the referenced water right permit. If no response is received from you, the permit will lapse and your authorization to develop and/or use this water right will be cancelled.

Dear Permit Holder:

One of the conditions of approval of the above referenced water permit was that proof of the extent of your beneficial use must be submitted to this office on or before **May 01, 2023**. Please complete and return the enclosed Statement of Completion for Submitting Proof of Beneficial Use (proof) if you have completed the water project authorized by your permit. The proof statement must be accompanied by either the appropriate license examination fee or a field examination report prepared by a certified water right examiner.

If you have not fully completed your project, and you or a previous owner of this permit have not received a prior extension of time, you may request an extension of time if the delay is for reasonable cause as provided in Idaho Code § 42-204. If you have been delayed by a government agency or by litigation that brings title to the water in question, an extension of time may be granted if appropriate documentation is provided at the time of filing. An extension request must be accompanied by a $50.00 filing fee and signed by the appropriate authorized permit holder(s) or authorized representative with a power of attorney.

Either an acceptable proof or an acceptable extension request must be received by this Department on or before the above proof due date. If neither is received, the Department will send you a lapse notice and the permit will no longer be of any force or effect.

Sincerely,

Debbi Judd
Technical Records Specialist

Enclosures

c: LUKE KOLAR – *via email*

CERTIFIED MAIL
7016 1370 0000 2018 4493
NO
SCANNED
MAR 01 2023