State of Idaho
Department of Water Resources

Water Right License

Water Right No. 96-9664

Priority: July 31, 2017 **Maximum Diversion Rate:** 0.04 CFS

It is hereby certified that:

HARVEST VALLEY WORSHIP CENTER PO BOX 2059 SANDPOINT ID 83864-0906

has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated July 28, 2017, and has submitted Proof of Beneficial Use on November 04, 2022. An examination confirms water is diverted from:

Source : GROUND WATER

Beneficial Use	Period of Use	Rate of Diversion
DOMESTIC	01/01 to 12/31	0.04 CFS

Location of Point(s) of Diversion
GROUND WATER NW¼ SW¼, Sec. 25, Twp 58N, Rge 02W, B.M. BONNER County

Place of Use: DOMESTIC

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
58N	02W	25										X							

Conditions of Approval

1. Domestic use is for 1 church.
2. The daily diversion volume for the domestic use authorized under this right shall not exceed 2,500 gallons per day.

This license is issued pursuant to the provisions of Idaho Code § 42-219. The water right confirmed by this license is subject to all prior water rights and shall be used in accordance with Idaho law and applicable rules of the Department of Water Resources.

Signed this 15th day of March, 2023.

PHILL HUMMER
Water Rights Supervisor

SCANNED
MAR 17 2023

State of Idaho
Department of Water Resources

Attachment to Water Right

96-9664

This map depicts the DOMESTIC place of use boundary for this water right at the time of this approval and is attached to the approval document solely for illustrative purposes.



0 0.035 0.07 0.14 Miles

Place Of Use Boundary
Townships
PLS Sections
Quarter Quarters
Point of Diversion

SCANNED
MAR 17 2023

N

BEFORE THE DEPARTMENT OF WATER RESOURCES
OF THE STATE OF IDAHO

IN THE MATTER OF PERMIT NO. 96-9664 IN THE NAME OF HARVEST VALLEY WORSHIP CENTER	)))	**PRELIMINARY ORDER** **REINSTATING A PERMIT**

This matter having come before the Idaho Department of Water Resources ("Department"), the Department finds, concludes and orders as follows:

FINDINGS OF FACT

1. On October 25, 2017, the Department issued Permit No. 96-9664 ("Permit") in the name of Harvest Valley Worship Center ("Permit Holder") authorizing the diversion of 0.04 cubic feet per second of ground water for domestic use in the NW¼SW¼ of Section 25 of Township 58 North, Range 02 West, B.M., Bonner County. A condition of permit approval required the Permit Holder to submit proof of beneficial use of water to the Department on or before November 1, 2022.

2. On August 31, 2022, the Department notified the Permit Holder by certified mail that proof of beneficial use was due and instructed the Permit Holder of the steps to be taken to submit a *Statement of Completion for Submitting Proof of Beneficial Use* ("Proof"), or a *Request for Extension of Time* ("Extension Request").

3. On November 1, 2022, the Permit lapsed because the Department had not received an acceptable Proof or Extension Request.

4. On November 4, 2022, the Permit Holder filed an acceptable Proof.

CONCLUSIONS OF LAW

Idaho Code § 42-218a(1) states, in pertinent part:

> A permit upon which the proof of beneficial use…, has not been submitted, or a request for extension of time has not been received on or before the date set for such proof or incremental statement, shall lapse and be of no further force nor effect… . Notice of said lapsing shall be sent by the department to the permit holder at the address of record by regular mail.

Idaho Code § 42-218a(2) states, in pertinent part:

> Within sixty (60) days after such notice of lapsing the department may, upon a showing of reasonable cause, reinstate the permit with the priority date advanced a time equal to the number of days that said showing is subsequent to the date set for proof.

SCANNED
DEC 12 2022

By submitting an acceptable Proof, the Permit Holder has shown reasonable cause why this Permit should be reinstated. The Permit should be reinstated based upon the November 4, 2022 filing date.

ORDER

IT IS HEREBY ORDERED that Permit No. 96-9664 is **REINSTATED** and the Permit's priority date is advanced to July 31, 2017.

DATED this 25th day of November, 2022.

Shelley W. Keen

Shelley W. Keen, Chief
Water Allocation Bureau

SCANNED
DEC 02 2022

Form 42-217 Rev. 6/22

RECEIVED
NOV 04 2022
DEPARTMENT OF WATER RESOURCES

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

STATEMENT OF COMPLETION

FOR SUBMITTING PROOF OF BENEFICIAL USE

FOR OFFICE USE ONLY
Amt. of Fee $ _____
Receipt No. _____
Receipted By _____
Date Receipted _____

The Idaho Department of Water Resources (Department) considers this form a statement that the permit holder(s) applied water to beneficial use and completed development of a water right to the extent described below. **This form must be accompanied by an examination fee, when necessary, or by a completed Beneficial Use Field Report prepared by a certified water right examiner (CWRE).** Please refer to the instructions and fee schedule for this form. If ownership of the permit has changed, complete a Notice of Change in Water Right Ownership form. If you wish to relinquish your permit because you have not established the authorized water use and are not applying for an extension, please notify the Department in writing.

1. Permit No. ~~10902~~ 96-9664 Name of Permit Holder(s) Harvest Valley Worship Center

Telephone No. (208) 263-2637 Email admin@HVWC.com

Mailing Address PO Box 2059 City Sandpoint State ID Zip 83864

2. Source of Water Well If Ground Water (well), Date Drilled mo. Nov 15 / yr. 2015

Drilling Permit/Tag No. 877238 Drilling Company's Name Universal Drilling

3. Extent of use(s) completed **as authorized by the water right permit**:

Domestic (No. households) [redacted] Irrigation (No. acres) _____ Stockwater (No. and stock type) _____

Other 1 Church

4. Total diversion rate or volume (storage only) for which proof is submitted .04 cfs OR _____ af

If the total developed water use is 5 acres of irrigation or less, is stockwater storage of 14.6 acre-feet or less, or has a diversion rate of less than 0.24 cfs, attach a map of the place of use and point of diversion and photographs showing beneficial use.

5. Describe the diversion and delivery system from the water source to the use (pump, lift, irrigation method, etc.)

Pump, buried pipe into building.

6. Permit condition compliance. Refer to the permit approval conditions and check all the items required, then check "Yes" or "No" to indicate whether the required items were established, submitted, and/or installed:

Required?	Yes	No	(If "Yes", attach required data, evidence of compliance, or evidence of installation)
☐	☐	☐	Ground water level data, pumping information, or other diversion data
☐	☐	☐	Mitigation plan
☐	☐	☐	Lockable controlling works
☐	☒	☐	Measuring device
☐	☐	☐	Fish screen
☒	☒	☐	Other requirements of the water right permit Water quality monitoring
	☐	☐	Reasonably Anticipated Future Needs ("RAFN") Municipal use

If RAFN Municipal use, additional increment of beneficial use developed? ☐ Yes (attach CWRE report) ☐ No

7. Fee Enclosed $ NA _____ or ☐ CWRE field report attached or ☒ No fee required

See fee schedule on page 3 of the instructions. Proof statements filed without an appropriate fee are incomplete.

8. Person to contact to accompany a Department representative during the field examination of the water system:

Name: NA - No field examination req. per instruction sheet, items 4, Telephone No. _____ Email _____

Mailing Address _____ City _____ State _____ Zip _____

The information given on this form is my true statement of the extent to which the above numbered permit has been developed and water has been diverted and applied to beneficial use. I understand that any undeveloped portion of the permit is relinquished to the State of Idaho.

[signature] CHRIS BASSETT PASTOR 10/31/2022

SIGNATURE OF PERMIT HOLDER* PRINTED NAME AND TITLE DATE


*Attach power of attorney if completing on behalf of permit holder.


SCANNED
DEC 02 2022

HARVEST VALLEY WORSHIP CENTER
AS BUILT PUBLIC WELL

AS-BUILT

ECTION 25, TOWNSHIP 58 NORTH, RANGE 2 W, BOISE MERIDIAN, BONNER COUNTY, IDAHO

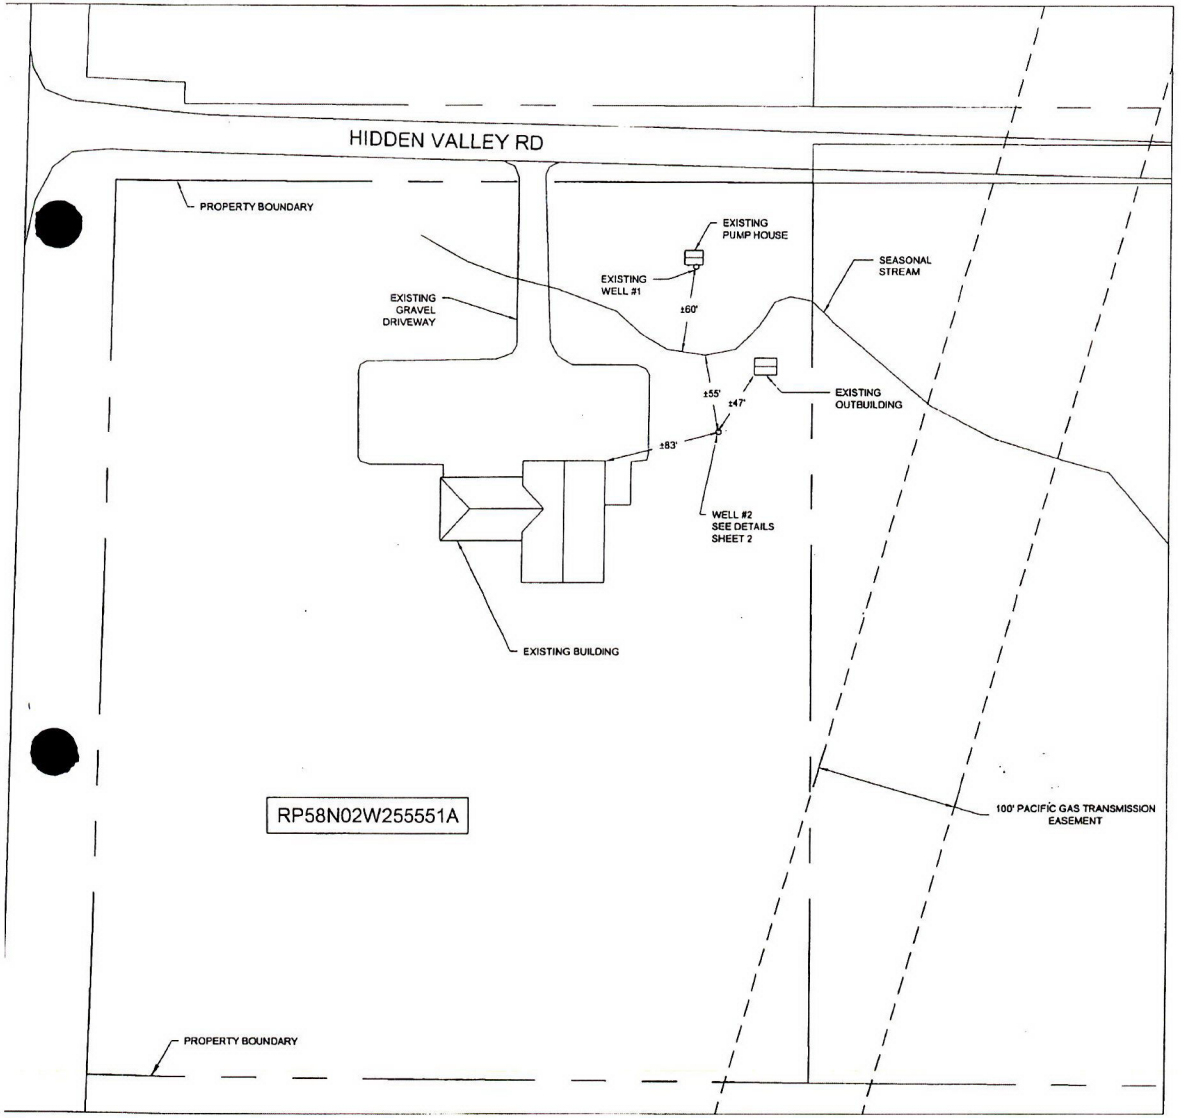

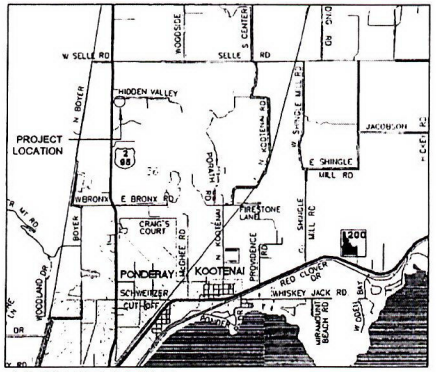

VICINITY MAP

NOT TO SCALE

MINIMUM DISTANCES FROM A PUBLIC WATER SYSTEM WELL	
SETBACK OBJECTS	MIN. DIST.
GRAVITY WASTEWATER LINE	50'
ANY POTENTIAL SOURCE OF CONTAMINATION	50'
PRESSURE WASTEWATER LINE	100'
CLASS A MUNICIPAL RECLAIMED WASTEWATER PRESSURE DISTRIBUTION LINE	50'
INDIVIDUAL HOME SEPTIC TANK, DISPOSAL FIELD, SEEPAGE PIT	100'
PRIVIES	100'
LIVESTOCK	50'
DRAINFIELD - STANDARD SUBSURFACE DISPOSAL MODULE	100'
ABSORPTION MODULE - LARGE SOIL ADSORPTION SYSTEM	150'-300'
SURFACE WATER & NON-POTABLE SUBSTANCE STORAGE TANKS	50'
STORMWATER DISPOSAL FACILITIES	50'
MUNICIPAL OR INDUSTRIAL WASTEWATER TREATMENT PLANT	500'
BIOSOLIDS APPLICATION SITE	1,000'

*SEE IDAPA 58.01.08.900 FOR THE MOST CURRENT SETBACK DISTANCES

PROFESSIONAL ENGINEER — 9992 — STATE OF IDAHO — TIM C. BLANKENSHIP

11-2-17

NO.	DATE	REVISION	DRN/CHK

James A. Sewell and Associates, LLC
1319 NORTH DIVISION
SANDPOINT, IDAHO 83864
(208) 263-4160

SHEET TITLE: OVERALL SITE LAYOUT AND VICINITY MAP

PROJECT: HARVEST VALLEY WORSHIP CENTER
BONNER COUNTY, IDAHO

DATE:	11-2-17
SCALE:	AS SHOWN
DESIGNED:	TCB
DRAWN	TCB
CHECKED:	TCB
PROJ NO.:	08248-17-001
CAD FILE	E-HVWC-PWS


SHEET 1 OF 2

SCANNED
DEC 12 2022

Panhandle Health District
Photographic Documentation for Hidden Valley Worship Center



Photograph 1: Well #1

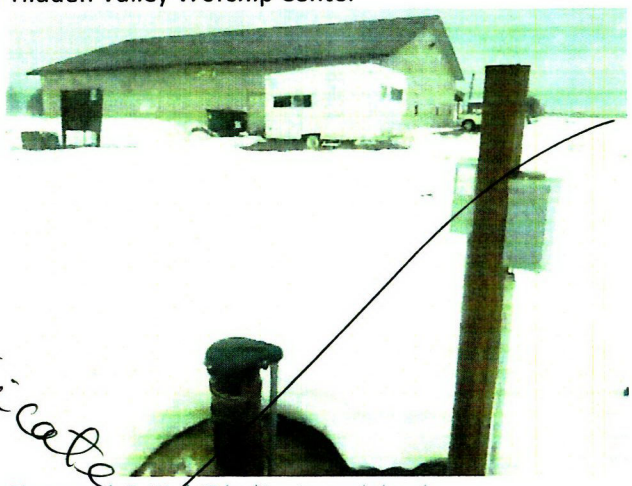

Photograph 2: Well #2 looking toward church



Photograph 3: Well #2 with pump control box




Photograph 4: Well #2 (DEQ well tag# E0010051)

Duplicate

SCANNED
DEC 12 2022

NOTE: TRENCH SIDE WALLS SHALL BE SLOPED AND/OR BRACED TO PROTECT WORKERS, ADJACENT PROPERTY, AND THE WORK

WATER PIPING AND SEWER PIPING SHALL MAINTAIN A 10' MINIMUM HORIZONTAL SEPARATION. WATER MAIN AND SEWER MAIN SHALL NEVER BE IN THE SAME TRENCH.



NOTES FOR TRENCH DETAIL

(N1) BACKFILL WITH NATIVE MATERIAL TO DENSITY AS SPECIFIED.

(N2) IN ROCK EXCAVATION, 12" ABOVE AND 6" BELOW PIPE SHALL BE BEDDED W/SAND.

(N3) BURIED PIPELINE

(N4) AREA WITHIN 4" BELOW PIPE AND 6" ABOVE SHALL BE BEDDED WITH 3/4" MINUS CRUSHED AGGREGATE, PEA GRAVEL, OR SAND BEDDING.

(N5) 12 GA. TONING WIRE FOR TRACING PURPOSES. ATTACH TO THE TOP OF THE PIPE.

(N6) BLUE MARKER TAPE LABELED "WATER"

4.1 WATER MAIN TRENCH


SCALE: N.T.S.



CALL
2 WORKING DAYS
BEFORE YOU DIG!

Bonner Boundary One Call
1-800-626-4950

VERTICAL SEPARATION REQUIREMENTS



NOTE: THE TERM "LINE" APPLIES TO BOTH MAIN LINES AND SERVICE LINES.

ZONE 1: A). POTABLE WATER AND NON-POTABLE MAINS AND SERVICE LINES MUST BE SEPARATED BY AT LEAST 18 INCHES, AND

B). ONE FULL, UNCUT LENGTH OF NON-POTABLE PIPE MUST BE CENTERED ON THE CROSSING SO THAT THE JOINTS ARE AS FAR AS POSSIBLE FROM THE CROSSING.

ZONE 2: POTABLE LINE <18" OVER TOP OF NON-POTABLE LINE.

A). ONE FULL, UNCUT LENGTH OF NON-POTABLE WATER PIPE MUST BE CENTERED ON THE CROSSING SO THAT THE JOINTS ARE AS FAR AS POSSIBLE FROM THE NON-POTABLE LINE, AND EITHER

B). NON-POTABLE LINE MUST BE CONSTRUCTED TO POTABLE WATER PIPE STANDARDS AND PRESSURE TESTED FOR WATER TIGHTNESS FOR A HORIZONTAL DISTANCE OF 10 FEET ON BOTH SIDES OF THE CROSSING, OR


C). NON-POTABLE OR POTABLE LINE MUST BE CASED IN A LARGER DIAMETER CARRIER PIPE FOR A HORIZONTAL DISTANCE OF 10 FEET ON BOTH SIDES OF THE CROSSING, WITH NO JOINTS.

ZONE 3: SAME REQUIREMENTS AS ZONE 2 EXCEPT THE NON-POTABLE LINE MUST ALSO BE SUPPORTED ABOVE THE CROSSING TO PREVENT SETTLING.

ZONE 4: SAME REQUIREMENTS AS ZONE 1 EXCEPT THE NON-POTABLE LINE MUST ALSO BE SUPPORTED ABOVE THE CROSSING TO PREVENT SETTLING.

SEWAGE FORCE MAINS SHALL HAVE AT LEAST EIGHTEEN INCHES OF CLEARANCE FROM POTABLE WATER MAINS AND ZONE 2 AND 3 PLACEMENTS ARE PROHIBITED. SEPARATION REQUIREMENTS ALSO APPLY TO POTABLE AND NON-POTABLE SERVICE LINES CONTROLLED BY THE SYSTEM OWNER AND EXTENDING TO THE PROPERTY LINE, SERVICE METER, OR CLEANOUT. REFER TO IDAPA 58.01.08.542.07: IDAHO RULES FOR PUBLIC DRINKING WATER SYSTEMS AND IDAPA 58.01.16.430.0: IDAHO WASTEWATER RULES.

HORIZONTAL SEPARATION REQUIREMENTS



NOTES:
1. THE TERM "LINE" APPLIES TO BOTH MAIN LINES AND SERVICE LINES.
2. SITE SPECIFIC APPROVAL BY THE DEPARTMENT IS REQUIRED BEFORE SEPARATION LESS THAN 6 FEET (ZONE 3) IS INSTALLED.

ZONE 1: MORE THAN 10 FEET APART:
A). NO SPECIAL REQUIREMENTS.

ZONE 2: FROM 6 TO 10 FEET APART:
A). NO SPECIAL REQUIREMENTS FOR SERVICE LINES.
B). POTABLE AND NON-POTABLE MAINS SEPARATED BY AT LEAST 6 FEET AT OUTSIDE WALLS, AND
C). POTABLE MAINS HIGHER IN ELEVATION THAN THE NON-POTABLE MAINS, AND
D). NON-POTABLE MAINS CONSTRUCTED WITH POTABLE WATER CLASS PIPE AND PRESSURE TESTED FOR WATER-TIGHTNESS.

ZONE 3: CLOSER THAN 6 FEET APART:
A). FOR MAINS AND SERVICES, DESIGN ENGINEER TO SUBMIT DATA TO DEPARTMENT FOR REVIEW AND APPROVAL THAT THIS INSTALLATION WILL PROTECT PUBLIC HEALTH AND ENVIRONMENT AND NON-POTABLE LINE CONSTRUCTED WITH POTABLE WATER CLASS PIPE.

FOR DETAILS REFER TO IDAPA 58.01.08.542.07: IDAHO RULES FOR PUBLIC DRINKING WATER SYSTEMS OR IDAPA 58.01.16.430.0: IDAHO WASTEWATER RULES.

SEWAGE FORCE MAINS SHALL HAVE AT LEAST TEN FEET OF HORIZONTAL SEPARATION FROM POTABLE MAINS - ZONE 2 AND ZONE 3 PLACEMENTS ARE PROHIBITED.

HORIZONTAL SEPARATION REQUIREMENTS ALSO APPLY TO POTABLE AND NON-POTABLE SERVICE LINES CONTROLLED BY THE SYSTEM OWNER AND EXTENDING THE MAIN LINE TO THE PROPERTY LINE, SERVICE METER, OR CLEANOUT.

4.3 SEPARATION REQUIREMENTS

SCALE: N.T.S.

GENERAL NOTES

WELL CONSTRUCTION SHALL CONFORM TO THE MUNICIPAL WELL CONSTRUCTION REQUIREMENTS OF THE IDEQ,IDAPA 37.03.09, IDAPA 58.01.08.510 AND THE IDWR, . THE MORE RESTRICTIVE REQUIREMENTS SHALL GOVERN.

AS-BUILT

WELL CONSTRUCTION SHALL COMPLY WITH IDWR DRILLING PERMIT REQUIREMENTS.

WELL CONSTRUCTION SHALL BE INSPECTED BY THE RECORD ENGINEER OR REPRESENTATIVE TO CONFIRM MATERIAL COMPLIANCE WITH APPROVED PLANS.

MATERIAL AND EQUIPMENT

1. ALL EQUIPMENT AND MATERIALS, INCLUDING DRILLING FLUIDS, USED IN WELL CONSTRUCTION SHALL CONFORM TO APPLICABLE AMERICAN WATER WORKS ASSOCIATION (AWWA) STANDARDS AND ARE CERTIFIED BY AN ACCREDITED ANSI CERTIFICATION BODY TO MEET APPLICABLE ANSI/NSF STANDARDS.
2. MATERIALS SHALL BE TRANSPORTED, HANDLED, STORED AND PROTECTED TO INSURE THAT NO DAMAGE OR CONTAMINATION OCCURS TO THE MATERIALS.

GEOLOGICAL SAMPLING

1. GEOLOGIC DATA SHALL BE COLLECTED AT EACH PRONOUNCED CHANGE IN FORMATION AND RECORDED IN THE DRILLERS LOG.
2. GEOPHYSICAL LOGS SHALL BE RECORDED AND MAINTAINED, INCLUDING RESITIVITY, GAMMA, SONIC, ETC.

DRILLING

1. ALL DRILLING FLUIDS TO BE ANSI/NSF 60 CERTIFIED DRILLING FLUID.
2. LOCATIONS AND APPROXIMATE VOLUME OF DRILLING MUD LOSSES SHALL BE RECORDED.
3. ALL TOOLS, BITS, PIPES, AND OTHER MATERIALS TO BE INSERTED IN THE BORCHOLE SHALL BE CLEANED AND DISINFECTED IN ACCORDANCE WITH THE WELL CONSTRUCTION STANDARDS AND PERMITTING REQUIREMENTS OF THE IDAHO WATER RESOURCES BOARD (IDAPA 58.01.08.510.04.)

CASING

1. PLUMBNESS TOLERANCE - THE MAXIMUM ALLOWABLE HORIZONTAL DEVIATION (DRIFT) OF THE WELL FROM THE VERTICAL SHALL NOT EXCEED 0.0067 TIMES THE SMALLEST INSIDE DIAMETER OF THAT PART OF THE WELL BEING TESTED PER FOOT OF DEPT. (PER AWWA A100-06 SECTION 4.7.9.2)
2. ALIGNMENT TOLERANCE - THE MAXIMUM MISALIGNMENT PERMISSIBLE IS ONE THAT WILL ALLOW A 40 FT LONG SECTION OF PIPE TO PASS FREELY THROUGH IT. THE OUTSIDE DIAMETER OF THE PIPE SHOULD BE NO SMALLER THAN 1/2" LESS THAN THE INSIDE DIAMETER OF THE CASING OR HOLE BEING TESTED. (PER AWWA A100-06 SECTION 4.7.9.3)
3. CASING WELDS SHALL BE AT LEAST AS THICK AS THE CASING AND PENETRATE THE FULL THICKNESS OF THE CASING WALL.. WELDING RODS OR FLUX CORE WIRE MUST BE EQUAL OR GREATER QUALITY TO THE CASING METAL. ALL STICK WELDED JOINTS MUST HAVE A MINIMUM OF TWO (2) PASSES AND HAVE MINIMAL UNDERCUT WHEN COMPLETE.
4. WELL SHALL NOT BE CONSIDERED COMPLETED UNTIL ALL TEMPORARY CASINGS HAVE BEEN REMOVED FROM THE SUMP

SEALS

1. BENTONITE GROUT SHALL HAVE A SOLIDS CONTENT NOT LESS THAN TWENTY-FIVE (25) PERCENT BY WEIGHT WHEN MIXED WITH WATER AND BE SPECIFICALLY MANUFACTURED FOR USE IN SEALING OF WELL CASING.
2. BENTONITE GROUT SHALL NOT CONTAIN WEIGHTING AGENTS TO INCREASE SOLIDS CONTENT. BENTONITE GROUT SHALL NOT BE USED ABOVE THE WATER TABLE.
3. ALL BENTONITE GROUT SHALL BE INSTALLED BY POSITIVE DISPLACEMENT FROM THE BOTTOM UP THROUGH A TREMMIE OR FLOAT SHOE UP TO THE WATER TABLE. FROM THE WATER TABLE TO THE GROUND SURFACE, #8 MESH GRANULAR BENTONITE SHALL BE USED.
4. MINIMUM OF 50% EXCESS SEAL MATERIAL SHALL BE ON SITE DURING WELL CONSTRUCTION.
5. PLACEMENT OF ALL SEAL MATERIAL IS TO BE DONE IN A SLOW AND CONTINUOUS MANNER.
6. ANY TEMPORARY CASING OR TREMMIE PIPES SHALL BE WITHDRAWN AS THE SEAL IS PLACED.
7. THE IDWR SHALL BE CONTACTED FOUR HOURS PRIOR TO SEAL PLACEMENT. THE RECORD ENGINEER OR REPRESENTATIVE SHALL BE PRESENT DURING SEAL PLACEMENT.
8. VOLUME AND TYPE OF MATERIAL SHALL BE RECORDED AND CHECKED AGAINST THESE SPECIFICATIONS EVERY 5 TO 10 FEET.
9. INTERMEDIATE SEALS SHALL BE INSTALLED TO SEPARATE AQUIFERS THAT ARE/OR MAY BE CONTAMINATED OR THAT YIELD UNDESIRABLE WATER.
10. WORK ON WELL WILL BE DISCONTINUED UNTIL THE CEMENT OR CONCRETE GROUT HAS PROPERLY SET.

FILTER PACK

THE WELL SHALL REQUIRE A FILTER PACK IF THE SAND PRODUCTION EXCEEDS FIVE (5) PPM DURING THE SAND PRODUCTION TEST. CONSULT THE ENGINEER OF RECORD FOR DESIGN OF FILTER PACK AFTER DETERMINATION OF NEED.

WELL DEVELOPMENT

1. WELL SHALL BE DEVELOPED TO REMOVE THE NATIVE SILTS AND CLAYS, DRILLING MUD OR FINER FRACTION OF THE GRAVEL PACK.
2. DEVELOPMENT SHALL CONTINUE UNTIL THE MAXIMUM SPECIFIC CAPACITY IS OBTAINED FROM THE COMPLETED WELL.
3. WELL DRILLING SHALL INCLUDE A PRELIMINARY PRODUCTION TEST.

FINAL PRODUCTION TESTS

1. THE WELL SHALL BE TEST PUMPED AT THE DESIRED YIELD (~50 GPM) OF THE WELL FOR AT LEAST (24) CONSECUTIVE HOURS OR 150% OF THE DESIGN CAPACITY FOR (8) HOURS AFTER THE DRAWDOWN TREND HAS STABILIZED, AS DETERMINED BY THE SUPERVISING ENGINEER OR GEOLOGIST PER IDAPA (58.01.08.510.06.a).
2. ALL PUMPING DATA IS TO BE RECORDED BY THE INSTALLER AND PROVIDED TO THE ENGINEER OF RECORD AND THE DEQ UPON COMPLETION.
3. BACTERIAL AND CHEMICAL WATER QUALITY TESTING SHALL BE CONDUCTED PER DEQ CRITERIA, TEST RESULTS SHALL INCLUDE AT A MINIMUM; IRON, MANGANESE, CORROSIVENESS, TOTAL COLIFORMS, NITRATE AND NITRITE.
4. UPON COMPLETION OF WELL DEVELOPMENT, THE WELL SHALL BE TESTED FOR SAND PRODUCTION. FIFTEEN (15) MINUTES AFTER THE START OF THE TEST PUMPING (AT OR ABOVE THE DESIGN PRODUCTION RATE) THE SAND CONTENT OF A NEW WELL SHALL NOT BE MORE THAN FIVE (5) PARTS PER MILLION. SAND PRODUCTION SHALL BE MEASURED BY A CENTRIFUGAL SAND SAMPLER. IF SAND PRODUCTION EXCEEDS FIVE (5) PPM, THE WELL SHALL BE SCREENED GRAVEL PACKED, OR REDEVELOPED.
5. FINAL DISINFECTION AND FLUSHING SHALL BE CONDUCTED IN ACCORDANCE WITH AWWA C654 AND IDAPA 37.03.09.025.

WELL COMPLETION REPORT

A WELL COMPLETION REPORT CONTAINING THE FOLLOWING ITEMS WILL BE SUBMITTED BY THE INSTALLER TO THE ENGINEER OF RECORD AND THE DEQ:

1. STATIC WATER LEVEL IN WELL PRIOR TO TEST PUMPING
2. WELL YIELD IN GPM AND DURATION OF THE PUMP TEST
3. WATER LEVEL IN THE WELL RECORDED AT REGULAR INTERVALS DURING PUMPING
4. PROFILE OF WATER LEVEL RECOVERY FROM THE PUMPING LEVEL PROJECTED TO THE ORIGINAL STATIC WATER LEVEL.
5. DEPTH AT WHICH THE TEST PUMP WAS POSITIONED IN THE WELL
6. TEST PUMP CAPACITY AND HEAD CHARACTERISTICS
7. SAND PRODUCTION DATA.
8. RESULTS OF ANALYSIS BASED ON THE DRAWDOWN AND RECOVERY TEST PERTAINING TO AQUIFER PROPERTIES, LONG-TERM SUSTAINED YIELD, AND BOUNDARY CONDITIONS AFFECTING DRAWDOWN.

SITE CONTROL

1. DISCHARGE WATER MUST BE PIPED AN ADEQUATE DISTANCE TO PREVENT RECHARGE OF THE WELL DURING THE TEST. IF THE WELL FAILS THE TEST PROTOCOL, DESIGN OF THE WATER SYSTEM SHALL BE RE-EVALUATED AND SUBMITTED TO THE DEPARTMENT FOR APPROVAL.
2. WATER LEAVING THE SITE SHALL NOT CONTAIN DRILLING FLUID ADDITIVES, DRILL FOAM, CHLORINE SOLUTIONS, OR SEALANT MATERIALS.
3. HOLES, PITS, EQUIPMENT AND CHEMICALS SHALL BE SAFELY STORED AND FENCED PER OSHA STANDARDS.
4. WELL CASING SHALL BE CAPPED BEFORE REMOVING DRILLING EQUIPMENT FROM THE SITE.

NOTE

ALL INFORMATION SHOWN ON THESE AS-BUILT DRAWINGS WAS PROVIDED BY ONE OF THE FOLLOWING PARTIES:

- OWNERS REPRESENTATIVE
- UNIVERSAL DRILLING (WELL DRILLER)
- PANHANDLE PUMP (PUMP INSTALLER)

JAMES A. SEWELL AND ASSOCIATES, LLC HAS COLLECTED AND PRESENTED THE INFORMATION ON THIS PLAN SET TO ACCORDING TO THE DATA PROVIDED. JAMES A. SEWELL AND ASSOCIATES, LLC ACCEPTS NO RESPONSIBILITY OR LIABILITY FOR THE ACCURACY OF THE INFORMATION PROVIDED.

4.4 SPECIFICATIONS

SCALE: N.T.S.

PROFESSIONAL ENGINEER 9992 STATE OF IDAHO TIM C. BLANKENSHIP

11.2.17

NO.	DATE	REVISION	DR/CHK

James A. Sewell and Associates, LLC
1319 NORTH DIVISION
SANDPOINT, IDAHO 83864
(208) 263-4160

SHEET TITLE: WELL DETAILS AND SPECIFICATIONS


PROJECT: HARVEST VALLEY WORSHIP CENTER
BONNER COUNTY, IDAHO

DATE:	11-2-17
SCALE:	AS SHOWN
DESIGNED:	TCB
DRAWN:	TCB
CHECKED:	TCB
PROJ NO.:	08248-17-001
CAD FILE:	E-HVWC-PWS


SHEET 2 OF 2

SCANNED DEC 12 2022

Panhandle Health District
Photographic Documentation for Hidden Valley Worship Center

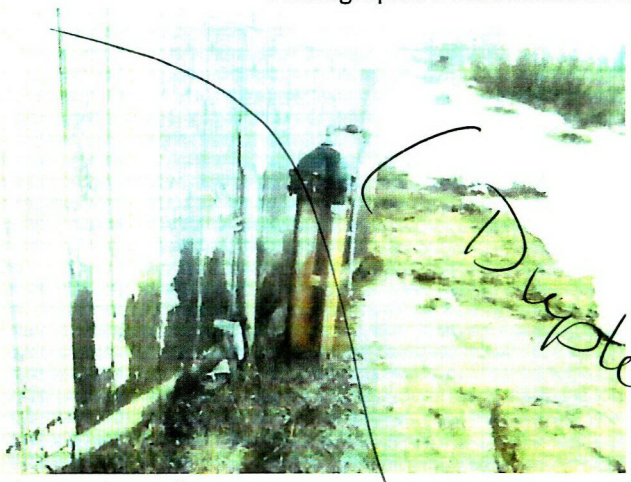


Photograph 1: Well #1

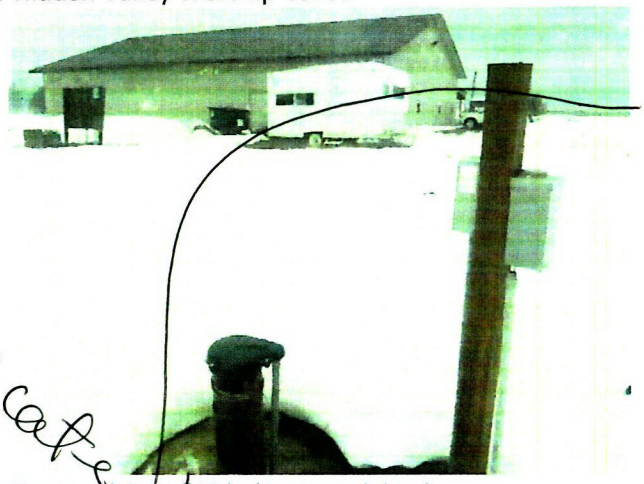

Photograph 2: Well #2 looking toward church



Photograph 3: Well #2 with pump control box

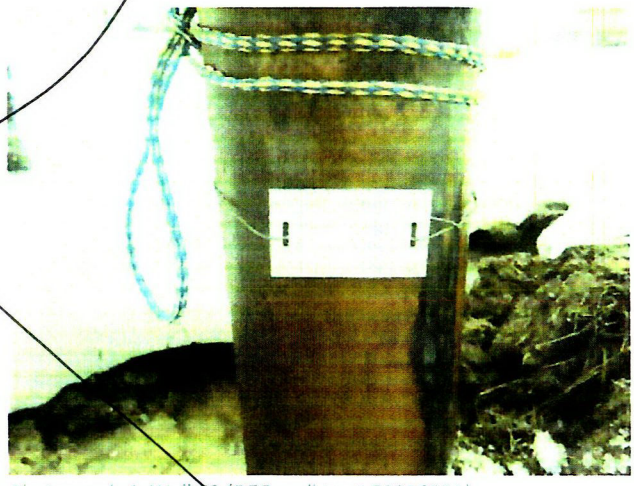

Photograph 4: Well #2 (DEQ well tag# E0010051)

SCANNED
DEC 02 2022

Invoice

1307 Sunrise Rd
Bonners Ferry, ID 83805
(208)290-1069 or (406)293-1151
universalwelldrilling@live.com
www.universalwelldrilling.com

Bill To
Church of God 90 Hidden Valley Rd Sandpoint, Id 83864

Date	Invoice No.	P.O. Number	Terms	Project
01/18/16	647		Due on receipt	


Description	Quantity	Rate	Amount
Idaho Dept. of Water Resources Permit/Tag	1	100.00	100.00
60' Surface Seal	1	2,500.00	2,500.00
Discount Surface Seal		-1,500.00	-1,500.00
Drive Shoe	1	200.00	200.00
778 Feet Drilling Service	778	36.00	28,008.00
Well Cap	1	50.00	50.00
10' Screen	1	2,000.00	2,000.00

Happy New Year!

Subtotal	$31,358.00
Sales Tax (6.0%)	$0.00
Total	$31,358.00

SCANNED
DEC 12 2022

Panhandle Health District
Photographic Documentation for Hidden Valley Worship Center

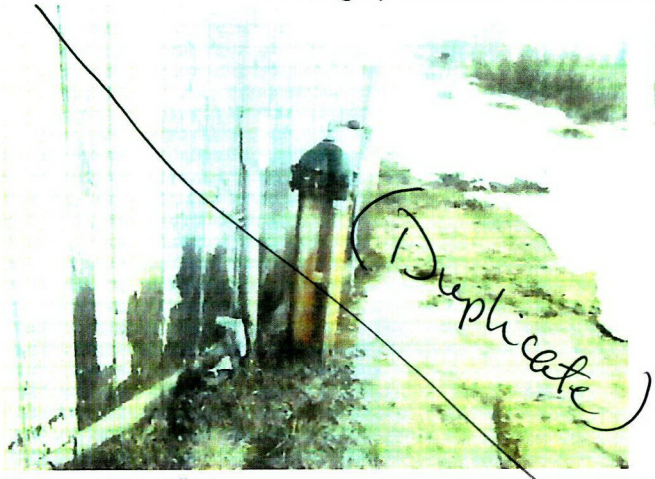


Photograph 1: Well #1



Photograph 2: Well #2 looking toward church



Photograph 3: Well #2 with pump control box

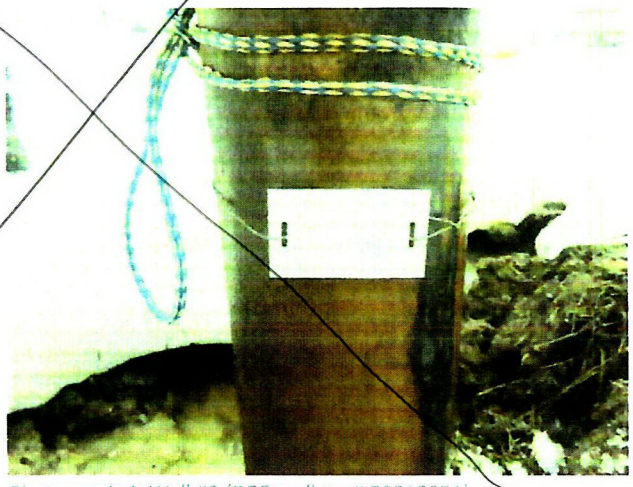

Photograph 4: Well #2 (DEQ well tag# E0010051)

Panhandle Health District
Photographic Documentation for Hidden Valley Worship Center



Photograph 1: Well #1



Photograph 2: Well #2 looking toward church



Photograph 3: Well #2 with pump control box



Photograph 4: Well #2 (DEQ well tag# E0010051)

SCANNED
DEC 12 2022




Photograph 5: Well #2 looking toward pump house



Photograph 6: Pump house




Photograph 7: Inside pump house

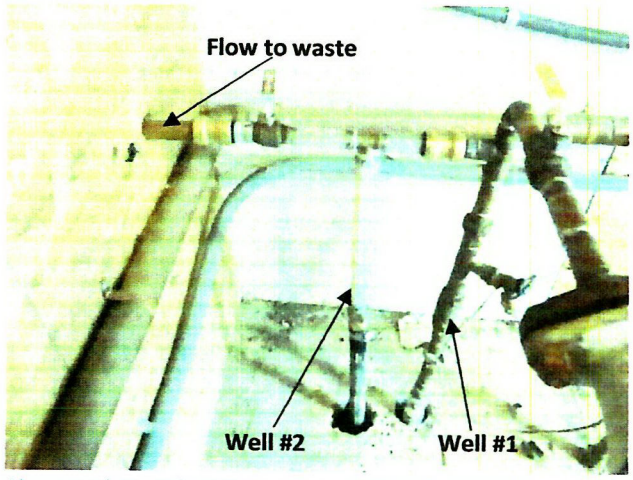

Photograph 8: Well discharge lines and flow to waste line



Photograph 9: Well discharge lines

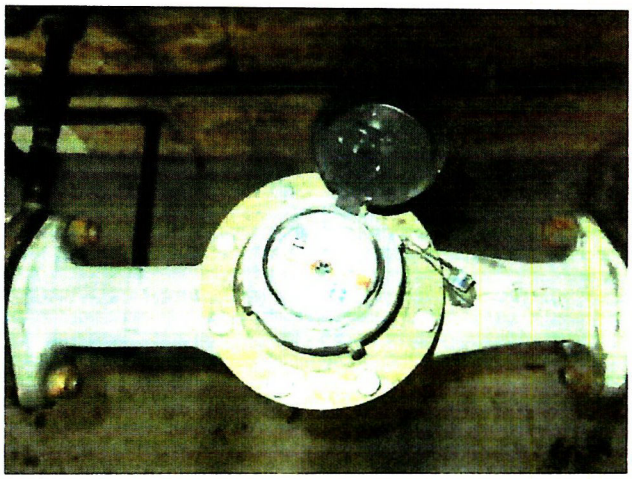

Photograph 10: Flow meter


SCANNED
DEC 12 2022




Photograph 11: Pressure tanks



Photograph 12: Pressure gauge, pressure switch, and smooth tap

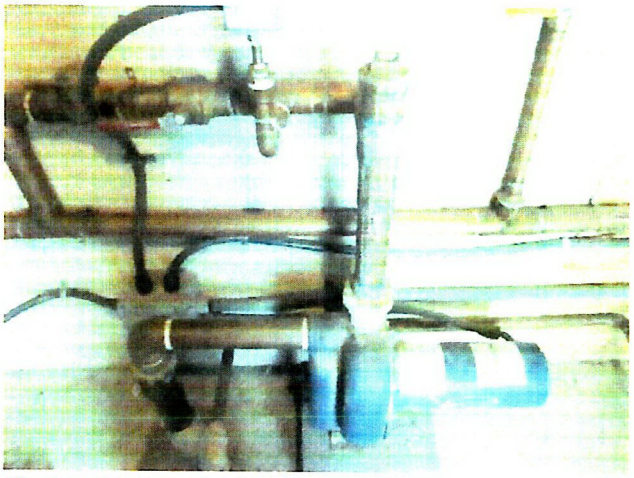

Photograph 13: Inactive booster pump

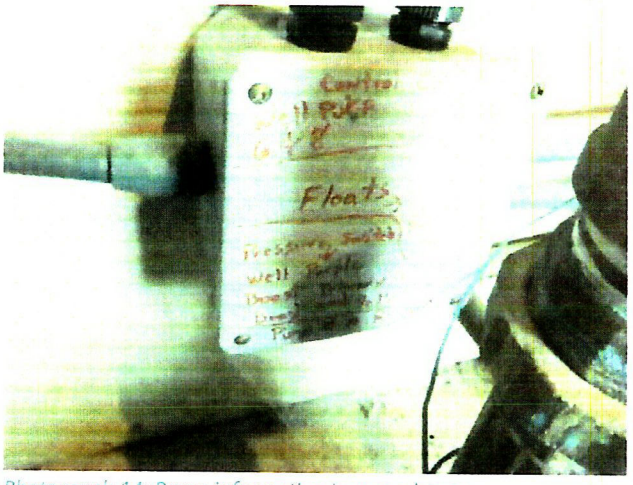

Photograph 14: Pump information in pump house




Photograph 15: Backflow assembly on line to fire suppression tanks




Photograph 16: Pump house floor drain discharge

SCANNED
DEC 12 2022

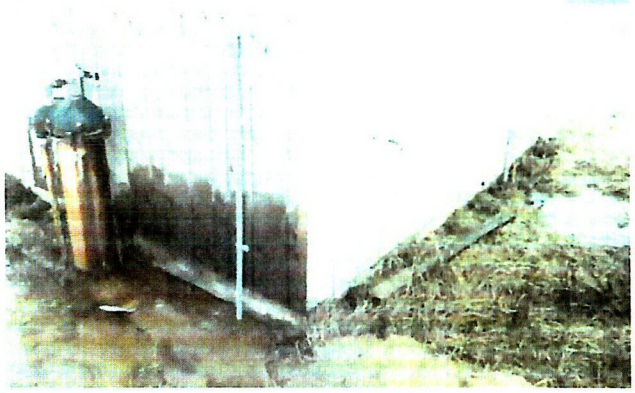

Photograph 17: Flow to waste discharge

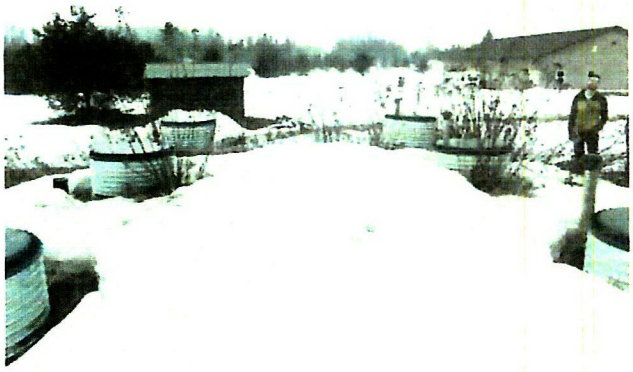

Photograph 18: Storage tank risers and vents



Photograph 19: Storage tanks



Photograph 20: Looking toward church from storage tanks



Photograph 21: Fire storage tanks and pump house

SCANNED
DEC 12 2022

Form 238-7
6/07

48° 20.967 116° 32.723 GPS amended to match WR POD

IDAHO DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORT

OFFICE USE ONLY
Inspected by Per GPS
Twp 58N Rge 2W Sec 25
1/4 NW 1/4 SW 1/4

1. WELL TAG NO. D 0069686
Drilling Permit No. 677238
Water right or injection well #

2. OWNER: Church of God
Name Church of God
Address 90 Hidden Valley Road
City Sandpoint State Id Zip 83864

3. WELL LOCATION:
Twp. 58 North ☒ or South ☐ Rge. 02W East ☐ or West ☒
Sec. 25 ~~NW~~ 1/4 (10 acres) NW 1/4 (40 acres) NW 1/4 (160 acres)
Gov't Lot ____ County Bonner
Lat. ____ ° 48.3492 (Deg and Decimal minutes)
Long. ____ ° -116.5750 (Deg and Decimal minutes)
Address of Well Site Hidden Valley Road City Sandpoint
(Give at least name of road + Distance to Road or Landmark)
Lot. ____ Blk. ____ Sub. Name ____

4. USE:
☒ Domestic ☐ Municipal ☐ Monitor ☐ Irrigation ☐ Thermal ☐ Injection
☐ Other ____

5. TYPE OF WORK:
☒ New well ☐ Replacement well ☐ Modify existing well
☐ Abandonment ☐ Other ____

6. DRILL METHOD:
☒ Air Rotary ☐ Mud Rotary ☐ Cable ☐ Other ____

7. SEALING PROCEDURES:

Seal material	From (ft)	To (ft)	Quantity (lbs or ft³)	Placement method/procedure
Bentonite	0	60	pour 30 bags	pour

8. CASING/LINER:

Diameter (nominal)	From (ft)	To (ft)	Gauge/ Schedule	Material	Casing	Liner	Threaded	Welded
6	-2	760	.25	Steel	☒	☐	☐	☒
					☐	☐	☐	☐
					☐	☐	☐	☐
					☐	☐	☐	☐

Was drive shoe used? ☒ Y ☐ N Shoe Depth(s) 760

9. PERFORATIONS/SCREENS:
Perforations ☐ Y ☐ N Method ____
Manufactured screen ☒ Y ☐ N Type Johnson
Method of installation Set

From (ft)	To (ft)	Slot size	Number/ft	Diameter (nominal)	Material	Gauge or Schedule
778	768	.16	20	5in	Stainless	.25

Length of Headpipe 20Feet Length of Tailpipe ____
Packer ☒ Y ☐ N Type K

10. FILTER PACK:

Filter Material	From (ft)	To (ft)	Quantity (lbs or ft³)	Placement method

11. FLOWING ARTESIAN:
Flowing Artesian? ☐ Y ☒ N Artesian Pressure (PSIG) ____
Describe control device well cap

12. STATIC WATER LEVEL and ~~WELL TESTS:~~
Depth first water encountered (ft) 75 Static water level (ft) 5
Water temp. (°F) Cold Bottom hole temp. (°F) Cold
Describe access port well cap

Well test:

Drawdown (feet)	Discharge or yield (gpm)	Test duration (minutes)	Test method: Pump	Bailer	Air	Flowing artesian
775	5gpm	24hours	☐	☐	☒	☐
			☐	☐	☐	☐

Water quality test or comments: good - With Color

13. LITHOLOGIC LOG and/or repairs or abandonment:

Bore Dia. (in)	From (ft)	To (ft)	Remarks, lithology or description of repairs or abandonment, water temp.	Water Y	Water N
10	0	60	Seal		X
6	0	70	Fine Silt		X
6	70	85	flowing Fine Silt	X	
6	85	740	Blue Clay		X
6	740	780	Sand with water	X	

Completed Depth (Measurable): 778
Date Started: 10-28-15 Date Completed: 10-2-15

14. DRILLER'S CERTIFICATION:
I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

Company Name Universal Drilling Co. No. 650
*Principal Driller [signature] Date 11-15-15
*Driller [signature] Date 11-15-15
*Operator II [signature] Date 11-15-15
Operator I ____ Date ____

* Signature of Principal Driller and rig operator are required.

SCANNED
DEC 12 2022

One Government Gulch - PO Box 929
Kellogg, ID 83837-0929
(208) 784-1258
www.svl.net

Harvest Valley Worship Center
PO Box 2059
Sandpoint, ID 83864

Work Order: **X2G0063**
Reported: 07-Jul-22 15:06

ANALYTICAL REPORT FOR SAMPLES

Sample ID	Laboratory ID	Matrix	Date Sampled	Sampled By	Date Received	Notes
Women's RR	X2G0063-01	Drinking Water	05-Jul-22 21:03	Chris Bassett	06-Jul-2022	

Solid samples are analyzed on an as-received, wet-weight basis, unless otherwise requested.
Sample preparation is defined by the client as per their Data Quality Objectives.
This report supercedes any previous reports for this Work Order. The complete report includes pages for each sample, a full QC report, and a notes section.
Analyses were performed in accordance with SVL standard operating procedures and calibrations were performed and met SVL internal QC criteria.
The results presented in this report relate only to the samples, and meet all requirements of the NELAC Standards unless otherwise noted.
This report shall not be reproduced except in full, without the written approval of SVL Analytical, Inc.

SCANNED
DEC 12 2022

One Government Gulch - PO Box 929
Kellogg, ID 83837-0929
(208) 784-1258
www.svl.net

Harvest Valley Worship Center
PO Box 2059
Sandpoint, ID 83864

Work Order: **X2G0063**
Reported: 07-Jul-22 15:06

Client Sample ID: **Women's RR**
SVL Sample ID: **X2G0063-01 (Drinking Water)**

Sample Report Page 1 of 1

Sampled: 05-Jul-22 21:03
Received: 06-Jul-22
Sampled By: Chris Bassett

Method	Analyte	Result	Units	RL	MDL	Dilution	Batch	Analyst	Analyzed	Notes
Microbiological Parameters										
SM 9223B-PA-CT	Coliform, total	Absent	/100 mL				X228097	CTB	07/07/22 11:20	
SM 9223B-PA-CT	E. coli	Absent	/100 mL				X228097	CTB	07/07/22 11:20	

This data has been reviewed for accuracy and has been authorized for release by the Laboratory Director or designee.

Jessica Banaszak
Project Manager

SCANNED
DEC 02 2022

One Government Gulch - PO Box 929
Kellogg, ID 83837-0929
(208) 784-1258
www.svl.net

Harvest Valley Worship Center		
PO Box 2059	Work Order:	**X2G0063**
Sandpoint, ID 83864	Reported:	07-Jul-22 15:06

Notes and Definitions

LCS	Laboratory Control Sample (Blank Spike)
RPD	Relative Percent Difference
UDL	A result is less than the detection limit
0.30R>S	% recovery not applicable; spike level is less than 30% of the sample concentration
<RL	A result is less than the reporting limit
MRL	Method Reporting Limit
MDL	Method Detection Limit
N/A	Not Applicable

SCANNED
DEC 12 2022

Chain of Custody

Public Water System

Work Order: **X2G0063**
Harvest Valley Worship Center

Person Transporting Sample to Lab:
Report Results To:
Name: HARVEST VALLEY WORSHIP CENTER
Email: ADMIN@HVWC.COM
Phone: 208-263-2637

SAMPLES SUBMITTED ON FRIDAYS INCUR AN ADDITIONAL CHARGE FOR WEEKEND PROCESSING.

Payment is submitted with the sample unless credit has been established. Call 208-784-1258 for credit card payment.

☐ Cash ☐ Check ☐ Credit

One Government Gulch
Kellogg, ID 83837 · 208-784-1258
www.svl.net · svlinfo@svl.net
Certification ID 00965

							Field Data				TESTS REQUESTED		
PWS NAME	**PWS #**	**Sample Type Code***	**Sample Location**	**Date Collected**	**Time Collected**	**Collected by**	**Chlorine Residual Results** Total	Free	Coliform	Pb & Cu	Nitrate		
HARVEST VALLEY WORSHIP CENTER	1090264	RP	Women's RR	7/5/22	9:03pm	CHRIS BASCH							

***Sample Type Code:** **RS** – Routine Sample **RP** – Repeat Sample (At original Tap) **W** – Untreated (Source) **X** – Other
C – Construction/Special **U** – Upstream Repeat **D** – Downstream Repeat **E** – Enforcement (chain of custody required)

Notes: Failed COC on last Test.

SCANNED
DEC 02 2022

Relinquished by:	Date:	Time:	Received by:	Relinquished by:	Date:	Time:	Received by:
					7/6/22	1145	

SAMPLE RECEIPT CHAIN-OF-CUSTODY CHECKLIST

The following items were checked for completeness, correctness, and compliance to project specifications using the Chain-of-Custody (COC) and other supporting information

Date of acceptance: 7/6/22 By: M DiGiovanni

SVL Work No. X2600063

Item	Description	V	NA	Comments
1	Client or project name	✓		Harvest Valley Worship Center
2	Date and time of receipt at lab	✓		7/6/22 1045
3	Received by	✓		M DiGiovanni
4	Temperature blank or cooler temperature	✓		Temp 6.9 °C T098/T126
5	Were the sample(s) received on ice	✓		
6	Custody tape/bottle seals	✓		
7	Shipper's air bill	.	✓	Rush
8	Condition of samples upon receipt (leaking; bubbles in VOA vials)	✓		
9	Analysis requested for each sample	✓		
10	Sample matrix description	✓		
11	The correct preservative for the analysis requested	✓		
12	Did an SVL employee preserve sample(s) upon receipt		✓	
13	Additional Information		✓	

V- Verified NA- Not Applicable

Comments:

SCANNED
DEC 07 2022

IDAHO DEPARTMENT OF
WATER RESOURCES

322 E Front Street, Suite 648, Boise ID 83702 • PO Box 83720, Boise ID 83720-0098
Phone: 208-287-4800 • Fax: 208-287-6700 • Email: idwrinfo@idwr.idaho.gov • Website: idwr.idaho.gov

Governor Brad Little
Director Gary Spackman

March 16, 2023

HARVEST VALLEY WORSHIP CENTER
PO BOX 2059
SANDPOINT ID 83864-0906

RE: License No. 96-9664

ISSUANCE OF LICENSE

Dear Water Right Holder:

The Department of Water Resources ("Department") has issued the enclosed Water Right License confirming that a water right has been established in accordance with your permit. Please be sure to thoroughly review all the conditions of approval listed on your license. The conditions may include ongoing requirements, such as maintenance of a measuring device or implementation of mitigation, as well as information about how your water use may be administered, such as regulation by a watermaster in a water district.

The license is a PRELIMINARY ORDER issued by the Department pursuant to Rule 730 of the Department's Rules of Procedure (IDAPA 37.01.01.730). It can and will become a final order without further action by the Department unless a party petitions for reconsideration, files exceptions, or requests a hearing as described in the enclosed information sheet.

Also, please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Water right forms are available from any office of the Department or on the Department's website at idwr.idaho.gov

If you have any questions concerning the enclosed information, please contact me at (208) 287-4925.

Sincerely,

for Phill Hummer
Water Rights Supervisor

Enclosures

SCANNED
MAR 17 2023

CERTIFICATE OF SERVICE

I hereby certify that on March 16, 2023, I served a true and correct copy of Water Right License No. 96-9664 by U.S. Mail, postage prepaid, to the following:

HARVEST VALLEY WORSHIP CENTER (Current Owner)
PO BOX 2059
SANDPOINT ID 83864-0906

Debbi Judd
Technical Records Specialist

SCANNED
MAR 17 2023

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
IN-OFFICE REVIEW/BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No: 96-9664
Exam Date: 3/14/2023

1. Does this qualify for an in-office field exam (IDAPA 035.02.r)? __X__Y ____N
   a. Irrigation of 5 acres or less
   b. Storage of up to 14.6 AF for stockwater purposes only
   c. Any use other than irrigation or storage, if the combined diversion rate is 0.24 cfs or less
   d. Other < >

2. Current Owner: Name: Harvest Valley Worship Center
   Owner of Record Correct? __X__Y ____N
   Address of Record Correct? __X__Y ____N
   If No: Address

According to Tax Parcel Data the property is owned by the Harvest Valley Worship Center.

3. Beneficial Use Fees have been paid: __X__Y ____N Receipt No: N/A
4. **SOURCE** **TRIBUTARY**
   Groundwater N/A

   Method of Determination: GIS and Tax Parcel Data
   Change in Source: ____Y ___X__N

B. OVERLAP REVIEW

1. Other water rights with the same place of use: No Overlap

Water Right No.	Source	Purpose of Use	Basis
N/A			

Comments: N/A

2. Other water rights with the same point of diversion: No Overlap

Water Right No.	Source	Purpose of Use	Basis
N/A			

Comments: N/A

C. DIVERSION AND DELIVERY SYSTEM

1. **LOCATION OF POINT(S) OF DIVERSION:**

Source	Govt. Lot	¼	¼	¼	Sec.	Twp.	Rge.		County
Groundwater			NW	SW	25	58N	02W	B.M.	Bonner
								B.M.	
								B.M.	

Method of Determination: GIS and Tax Parcel Data.

Change in POD? ____Y __X__N Amendment Required? ____Y __X__N

SCANNED
MAR 17 2023

2. **PLACE OF USE:** Use: Domestic

TWP	RGE	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
58N	02W	25										D							N/A
		Lot #																	N/A
																Total Acres =			N/A

Method of Determination: GIS and Tax Parcel Data

Change in POU? ____Y __X__N Amendment Required? ____Y __X__N

__ Delivery System Diagram Attached (required). Indicate all major components and distances between components.

Indicate weir size/pipe as applicable.

__ Aerial Photo Attached (required for irrigation of 10+ acres).

__ Photo of Diversion and System Attached

4. Well or Diversion Identification No.*	Motor Make	Hp	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
N/A					

**Code to correspond with No. on map and aerial photo*

D. FLOW MEASUREMENTS

1.Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
N/A						

2. Measurements: Since the permit holder did not provide a pump horsepower a diversion rate calculation was not possible.

E. FLOW CALCULATIONS _____Additional Computation Sheets Attached

Measured Method: **The permit holder did not provide a pump horsepower. Therefore, a diversion rate calculation was not possible. The permit is limited to 2,500 gallons per day. Under Idaho Code § 42-111(1b) any other use falls under the umbrella of domestic if the diversion rate does not exceed 0.04 cfs or 2,500 gallons per day. This permit authorized 0.04 cfs. I am recommending a 0.04 cfs diversion rate.**

F. VOLUME CALCULATIONS

2. Volume Calculations for Other Uses: **According the approved permit domestic use is limited to 2,500 gallons per day. Under the IDAPA Beneficial Use Examination Rules 37.03.02.35. 01j.ii a volume is not required if the authorized use meets the definition of domestic as described in Idaho Code § 42-111.**

G. PURPOSE OF USE

Irrigation __X__Y ____N # Stock_____N/A_____ Domestic # of Homes ___1 Church___

Other: < >

Change in Purpose of Use? ____Y __X__N

SCANNED
MAR 17 2023

Method of Determination: GIS, Tax Parcel Data and Google Earth Imagery.

If Yes: From Use _____ To Use _____ Amount _____ CFS _____ AFA_____

H. NARRATIVE/REMARKS/COMMENTS

This permit qualifies for an in-house examination. The permit authorizes domestic use for 1 Church and up to ½ acres of yard irrigation. Although the permit does not specify irrigation is authorized, condition 187, the usual condition to indicate irrigation is authorized, is intended to be used in restricted areas; GWMA's, CGWMA's, etc. In this case there are no such restrictions, so irrigation can occur based on the definition of domestic as described in Idaho Code § 42-111. Google Earth imagery seems to indicate irrigation occurred in 2019. Another Well can be seen in photographs provided by the applicant with their Statement of Completion for Proof of Beneficial Use. However, in the permit holder's application for permit they explain that well has been capped off and is not connected to the system developed in this permit.

The permit holder did not provide a pump horsepower. Therefore, a diversion rate calculation was not possible. The permit is limited to 2,500 gallons per day. Under Idaho Code § 42-111(1b) any other use can fall under domestic if it does not exceed 0.04 cfs or 2,500 gallons per day. Under the IDAPA Beneficial Use Field Exam Rules 37.03.02.35.01j.ii a diversion volume is not required for domestic use as defined under Idaho Code § 42-111. All of the conditions have been met and it is believed the permit holder is using water for the beneficial use authorized on their permit. Therefore, I am recommending a 0.04 cfs diversion rate,

Conditions X08, and X03 should remain on the license. Condition 106 should be removed from the license because the permit holder complied with the water quality monitoring and/or permitting administered by the Idaho Department of Environmental Quality or the Department of Agriculture. Condition 046 should be removed because the permit holder has complied with drilling permit requirements. Condition 004 should be removed from the license because there are no legal access concerns to the point of diversion. All other conditions should be removed as standard with licensing.

Have conditions of permit approval been met? __X___Yes _____No

I. RECOMMENDATIONS

1. Recommended Amounts

BENEFICIAL USE	PERIOD OF USE	DIVERSION RATE
Domestic	1/1 to 12/31	0.04 CFS
	Totals:	0.04 CFS

2. Recommended Amendments

___Change P.D. as reflected above ___Add P.D. as reflected above __X_None

___Change P.U. as reflected above ___Add P.U. as reflected above __X_None

Other: < >

J. AUTHENTICATION Skyler Cheever, Water Resource Agent

Field Examiner's Name Skyler Cheever Date 3/14/23

Reviewer pbarnum Date 3/15/23

SCANNED
MAR 17 2023

Field Exam Map:

The orange border shows the place of use, and the yellow point shows the point of diversion.



SCANNED
MAR 17 2023

IDAHO DEPARTMENT OF
WATER RESOURCES

322 E Front Street, Suite 648, Boise ID 83702 • PO Box 83720, Boise ID 83720-0098
Phone: 208-287-4800 • Fax: 208-287-6700 • Email: idwrinfo@idwr.idaho.gov • Website: idwr.idaho.gov

Governor Brad Little
Director Gary Spackman

December 2, 2022

HARVEST VALLEY WORSHIP CENTER
PO BOX 2059
SANDPOINT ID 83864-0906

PROOF ACKNOWLEDGEMENT LETTER

RE: Permit No. 96-9664

Dear Permit Holder:

The Department acknowledges receipt of the Proof of Beneficial Use form ("proof") and license examination fee for the above-referenced water right permit. Enclosed is an order that reinstates this permit since proof and the license examination fee were submitted after the proof deadline. Please note that the priority date for this permit has been advanced to **July 31, 2017**, pursuant to Idaho Code § 42-218a(2).

The next step in the process of developing a water right is for the Department to conduct a field examination to determine and confirm the use being made of the water according to the conditions of the permit.

Please be advised that Idaho Code § 42-248, requires you or the owner of this water right to maintain current ownership and address records on file with the Department. Forms to file a change of ownership of a water right and/or a change in the address of the water right owner are available from any Department office or at the Department's website at www.idwr.idaho.gov.

If you have any questions concerning this permit, please contact the State Office of the Department located in Boise at (208) 287-4800.

Sincerely,

Debbi Judd
Technical Records Specialist

Enclosures

SCANNED
DEC 12 2022

CERTIFICATE OF SERVICE

I hereby certify that on **December 2, 2022** I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER **(PRELIMINARY ORDER REINSTATING A PERMIT)** to the person listed below:

RE: Preliminary Order in the Matter of Permit No. **96-9664**

HARVEST VALLEY WORSHIP CENTER
PO BOX 2059
SANDPOINT ID 83864-0906

Debbi Judd
Technical Records Specialist

SCANNED
DEC 02 2022

Beneficial Use Proof Evaluation

Permit Number: 96-9664 Reviewer: djudd Review Date: 11/15/2022

Acceptability

1) Is the contact on the request the current permit holder? Yes
2) Does the address of record need to be updated? No
3) Proof Submitted Date: 11/4/2022
4) Proof Due Date: 11/1/2022
5) Days added for weekend due date? 0
6) Days added for holiday due date? 0
7) Number of days late: 3
8) Proof received timely? No

Analysis

1) Are the water uses correct? Yes
2) Are one of the following items required?
    a. Measuring Device -- No
    b. Lockable Device --No
    c. Fish Screen -- No
3) Are the required items installed?
    a. Measuring Device --
    b. Lockable Device --
    c. Fish Screen --
4) Is there a request to waive the required items?
5) Drilling Permit Number: 877238
6) Is a drilling permit upgrade needed? No
7) Was a well drillers report filed? Yes
8) Is proof accepted? Yes

Fees

1) Is a licensing exam fee required? No
2) Was proof submitted with an exam report from a CWE? No
3) Filing fee due: $0.00
4) Filing fee submitted: $0.00
5) Remaining fee or (refund): $0.00

Receipt IDs

N032828

Comments

Proof received 3 days late. Reinstate permit and advance priority date to July 31, 2017.

Reinstate Evaluation

Permit Number: 96-9664 Reviewer: djudd Review Date: 11/15/2022

Analysis

1) Proof/extension request received date: 11/4/2022
2) Number of days proof/extension request received late: 3
3) Was a lapsed notice sent? No
4) Date lapsed notice sent:
5) Number of days between proof/extension request received date and date lapsed notice was sent: 0
6) Was the proof or extension request received more than 60 days after the lapsed notice was sent? No
7) Priority date: 7/28/2017
8) New priority date: 7/31/2017
9) New status: Active

Comments

Proof received 3 days late. Reinstate permit and advance priority date to July 31, 2017.