

RECEIVED

AUG 28 2023

DEPARTMENT OF
WATER RESOURCES

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
STATEMENT OF COMPLETION
FOR SUBMITTING PROOF OF BENEFICIAL USE

FOR OFFICE USE ONLY

Amt. of Fee \$ _____

Receipt No. _____

Received By _____

Date Received _____

The Idaho Department of Water Resources (Department) considers this form a statement that the permit holder(s) applied water to beneficial use and completed development of a water right to the extent described below. **This form must be accompanied by an examination fee, when necessary, or by a completed Beneficial Use Field Report prepared by a certified water right examiner (CWRE).** Please refer to the instructions and fee schedule for this form. If ownership of the permit has changed, complete a Notice of Change in Water Right Ownership form. If you wish to relinquish your permit because you have not established the authorized water use and are not applying for an extension, please notify the Department in writing.

1. Permit No. 72-17015 Name of Permit Holder(s) Idaho Dept. of Fish and Game Commission
Telephone No. 208-334-3700 Email thomas.bassista@idfg.idaho.gov
Mailing Address P.O.Box 25, 600 S. Walnut City Boise State ID Zip 83707

2. Source of Water Bayhorse Creek If Ground Water (well), Date Drilled mo. n/a / yr. _____
Drilling Permit/Tag No. n/a Drilling Company's Name n/a

3. Extent of use(s) completed as authorized by the water right permit:

Domestic (No. households) n/a Irrigation (No. acres) n/a Stockwater (No. and stock type) n/a
Other fish propagation (non-consumptive)

4. Total diversion rate or volume (storage only) for which proof is submitted .80 cfs OR _____ af
If the total developed water use is 5 acres of irrigation or less, is stockwater storage of 14.6 acre-feet or less, or has a diversion rate of less than 0.24 cfs, attach a map of the place of use and point of diversion and photographs showing beneficial use.

5. Describe the diversion and delivery system from the water source to the use (pump, lift, irrigation method, etc.)
Steel, modular, single rotary drum (24-inch x 6-foot perforated plate) fish screen in ditch with 10-inch fish bypass pipe
that provides safe passage for fish entrained in ditch back to Bayhorse Creek; paddle-wheel powered; lockable headgate.

6. Permit condition compliance. Refer to the permit approval conditions and check all the items required, then check "Yes" or "No" to indicate whether the required items were established, submitted, and/or installed:

Required? Yes No (If "Yes", attach required data, evidence of compliance, or evidence of installation)

☐ ☐ ☒ Ground water level data, pumping information, or other diversion data☐ ☐ ☒ Mitigation plan☒ ☒ ☐ Lockable controlling works☒ ☒ ☐ Measuring device☒ ☒ ☐ Fish screen☐ ☐ ☒ Other requirements of the water right permit _____☐ ☒ Reasonably Anticipated Future Needs ("RAFN") Municipal useIf RAFN Municipal use, additional increment of beneficial use developed? ☐ Yes (attach CWRE report) ☐ No

7. Fee Enclosed \$ 100.00 or ☐ CWRE field report attached or ☐ No fee required
See fee schedule on page 3 of the instructions. Proof statements filed without an appropriate fee are incomplete.

8. Person to contact to accompany a Department representative during the field examination of the water system:

Name: Mike Demick Telephone No. 208-756-6022 Email mike.demick@idfg.idaho.gov
Mailing Address 97 Highway 93 North City Salmon State ID Zip 83467

The information given on this form is my true statement of the extent to which the above numbered permit has been developed and water has been diverted and applied to beneficial use. I understand that any undeveloped portion of the permit is relinquished to the State of Idaho.

[Signature]
SIGNATURE OF PERMIT HOLDER*

KRAN HILTON - REGIONAL SUPERVISOR
PRINTED NAME AND TITLE

8/1/23
DATE


*Attach power of attorney if completing on behalf of permit holder.

SCANNED

SEP 29 2023

Permit Number 72-17015

- Bayhorse Creek-01 Fish Screen; Source: Bayhorse ; Tributary of Salmon River
- .80 cfs, Fish Propagation (non-consumptive)

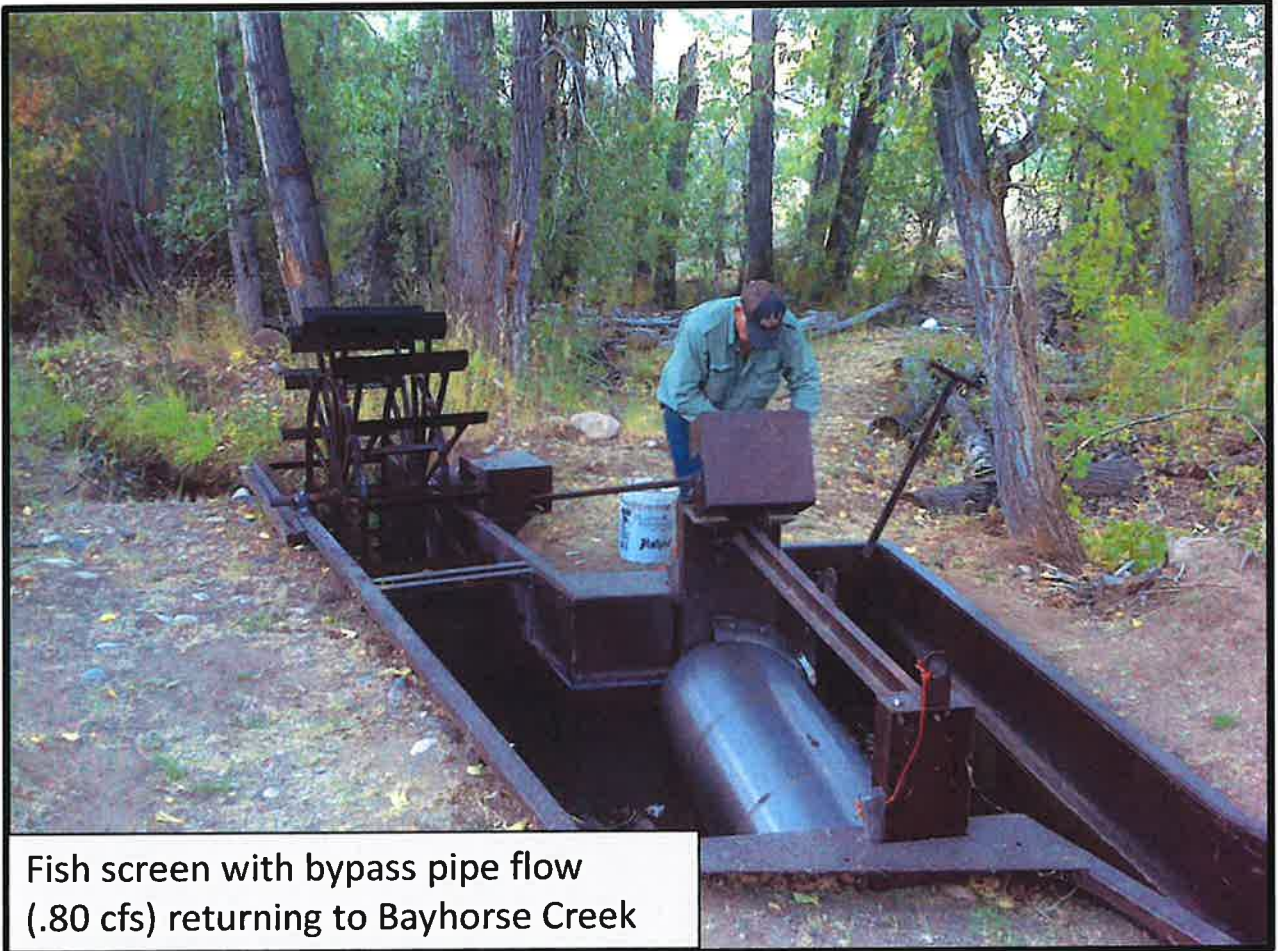

Fish screen with bypass pipe flow
(.80 cfs) returning to Bayhorse Creek

SCANNED

SEP 29 2023