STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

TRANSFER OF WATER RIGHT
TRANSFER NO. 89710

This is to certify that: CITY OF HOMEDALE
PO BOX 757
HOMEDALE, ID 83628

has requested a change to the water right(s) listed below. This change in water right(s) is authorized pursuant to the provisions of Section 42-222, Idaho Code. A summary of the changes is also listed below. The authorized change for each affected water right, including conditions of approval, is shown on the following pages of this document.

Summary of Water Rights Before the Proposed Changes

Water Right	Origin/Basis	Priority Date	Diversion Rate	Diversion Volume	Acre Limit	Total Acres	Source
63-31235	WR/LICENSE	3/31/2001	1.410 cfs	N/A	N/A	N/A	GROUND WATER

Associated Water Rights Also Included in the Transfer Approval (Conditions Updated)

Water Right	Origin/Basis	Priority Date	Diversion Rate	Diversion Volume	Acre Limit	Total Acres	Source
57-7656	WR/LICENSE	1/16/1998	0.240 cfs	N/A		N/A	GROUND WATER
57-7048	WR/DECREED	4/16/1971	0.040 cfs	9.0 af		2.0	GROUND WATER
57-7027	WR/DECREED	1/7/1969	0.670 cfs	N/A		N/A	GROUND WATER
57-10393	WR/DECREED	1/1/1940	0.890 cfs	N/A		N/A	GROUND WATER
63-9260	WR/DECREED	7/3/1979	1.000 cfs	N/A		N/A	GROUND WATER
57-11752	WR/LICENSE	9/15/2008	0.490 cfs	N/A		N/A	GROUND WATER

Purpose of Transfer (Changes Proposed)

Current Number	Split	POD	POU	Add POD	Period of Use	Nature of Use
63-31235	NO	NO	NO	YES	NO	NO

Summary Of Water Rights After the Approved Change

Existing Right	New No. (Changed Portion)	Transfer Rate	Transfer Volume	Acre Limit	Total Acres	New No. (remaining portion)	Remaining Rate	Remaining Volume	Remaining Acre Limit	Remaining Total Acres
63-31235	63-31235	1.410 cfs	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
COMBINED TOTALS		**1.410 cfs**	**N/A**	**N/A**	**N/A**		**N/A**	**N/A**	**N/A**	**N/A**

SUPPORT DATA
IN FILE # 63-31235

SCANNED

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

TRANSFER OF WATER RIGHT
TRANSFER NO. 89710

This water right(s) is subject to all prior water rights and shall be administered in accordance with Idaho law and applicable rules of the Department of Water Resources. Detailed Water Right Description(s) attached.

Dated this 23 day of June, 2025.

Cody Parker, Water Resources Supervisor

WATER RIGHT NO. 63-31235

As Modified by Transfer No. 89710

In accordance with the approval of Transfer No. 89710, Water Right No. 63-31235 is now described as follows:

Right Holder: CITY OF HOMEDALE
PO BOX 757
HOMEDALE, ID 83628

Priority Date: 3/31/2001

Source: GROUND WATER

BENEFICIAL USE	From	To	Diversion Rate
MUNICIPAL	01/01	to 12/31	1.410 cfs
			1.410 cfs

LOCATION OF POINT(S) OF DIVERSION

GROUND WATER	SESW	Sec 34 Twp 04N Rge 05W CANYON County
GROUND WATER	SESW	Sec 34 Twp 04N Rge 05W CANYON County

CONDITIONS OF APPROVAL

1. The right holder shall not provide water diverted under this right for the irrigation of land having appurtenant surface water rights as a primary source of irrigation water except when the surface water rights are not available for use. This condition applies to all land with appurtenant surface water rights, including land converted from irrigated agricultural use to other land uses but still requiring water to irrigate lawns and landscaping.

2. Rights 57-7027, 57-7048, 57-7656, 57-10393, 57-11752, 63-9260, and 63-31235 when combined shall not exceed a total diversion rate of 3.87 cfs.

3. A map depicting the place of use boundary for this water right at the time of this approval is attached to this document for illustration purposes.

4. Place of use is within the service area of the City of Homedale municipal water supply system as provided for under Idaho Law.

5. After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to determine the amount of water diverted from power records and shall annually report the information to the Department.

6. When ordered by the Director, the right holder shall provide mitigation acceptable to the Director to offset depletion of lower Snake River flows needed for migrating anadromous fish. The amount of water required for mitigation, which is to be released into the Snake River or a tributary for this purpose, will be determined by the Director based upon the reduction in flow caused by the use of water pursuant to this right. Any order of the Director issued in accordance with this paragraph shall be in conformance with applicable rules allowing the right holder due process as the need for mitigation and the amount of mitigation are determined.

WATER RIGHT NO. 63-31235

As Modified by Transfer No. 89710

CONDITIONS OF APPROVAL

7. The issuance of this right does not grant any right-of-way or easement across the land of another.
8. Right holder shall comply with the drilling permit requirements of Idaho Code § 42-235 and applicable Well Construction Rules of the Department.
9. The right holder shall accomplish the change authorized by this transfer within one year of the date of this approval.
10. Failure of the right holder to comply with the conditions of this transfer is cause for the Director to rescind approval of the transfer.

WATER RIGHT NO. 57-7656

As Modified by Transfer No. 89710

In accordance with the approval of Transfer No. 89710, Water Right No. 57-7656 is now described as follows:

Right Holder: CITY OF HOMEDALE
PO BOX 757
HOMEDALE, ID 83628

Priority Date: 1/16/1998

Source: GROUND WATER

BENEFICIAL USE	From		To	Diversion Rate
MUNICIPAL	1/01	to	12/31	0.240 cfs
				0.240 cfs

LOCATION OF POINT(S) OF DIVERSION

GROUND WATER L8 (NWSW) Sec 3 Twp 03N Rge 05W OWYHEE County

CONDITIONS OF APPROVAL

1. Place of use is within the service area of the City of Homedale municipal water supply system as provided for under Idaho Law.
2. A map generally depicting the service area for this water right at the time of this approval is attached to this document for illustrative purposes.
3. After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to use power records to determine the amount of water diverted and shall annually report the information to the Department.
4. When ordered by the Director, the right holder shall provide mitigation acceptable to the Director to offset depletion of lower Snake River flows needed for migrating anadromous fish. The amount of water required for mitigation, which is to be released into the Snake River or a tributary for this purpose, will be determined by the Director based upon the reduction in flow caused by the use of water pursuant to this right. Any order of the Director issued in accordance with this paragraph shall be in conformance with applicable rules allowing the right holder due process as the need for mitigation and the amount of mitigation are determined.
5. The right holder shall accomplish the change authorized by this transfer within one year of the date of this approval.
6. Failure of the right holder to comply with the conditions of this transfer is cause for the Director to rescind approval of the transfer.

WATER RIGHT NO. 57-7048

As Modified by Transfer No. 89710

In accordance with the approval of Transfer No. 89710, Water Right No. 57-7048 is now described as follows:

Right Holder: CITY OF HOMEDALE
PO BOX 757
HOMEDALE, ID 83628

Priority Date: 4/16/1971

Source: GROUND WATER

BENEFICIAL USE	From		To	Diversion Rate	Diversion Volume
IRRIGATION	4/01	to	10/15	0.040 cfs	9.0 af
				0.040 cfs	9.0 af

LOCATION OF POINT(S) OF DIVERSION

GROUND WATER L8 (SWNWSW) Sec 3 Twp 03N Rge 05W OWYHEE County

PLACE OF USE: IRRIGATION

			NE				NW				SW				SE				
Twp	Rng	Sec	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	Totals
03N	05W	3										2.0							2.0
												L 8							

POU Total Acres: 2.0

CONDITIONS OF APPROVAL

1. The period of use for the irrigation described in this approval may be extended to a beginning date of 03/01 and an ending date of 11/15 provided that beneficial use of the water can be shown and other elements of the right are not exceeded. The use of water before 04/01 and after 10/15 is subordinate to all water rights having no subordinated early or late irrigation use and a priority date earlier than 02/21/2003.

2. After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to use power records to determine the amount of water diverted and shall annually report the information to the Department.

3. The right holder shall accomplish the change authorized by this transfer within one year of the date of this approval.

4. Failure of the right holder to comply with the conditions of this transfer is cause for the Director to rescind approval of the transfer.

WATER RIGHT NO. 57-7048

As Modified by Transfer No. 89710

CONDITIONS OF APPROVAL

5. Pursuant to Idaho Code § 42-1412(6), this water right is subject to such general provisions necessary for the definition of the rights or for the efficient administration of water rights as determined by the Snake River Basin Adjudication court in the final unified decree entered 08/26/2014.

WATER RIGHT NO. 57-7027

As Modified by Transfer No. 89710

In accordance with the approval of Transfer No. 89710, Water Right No. 57-7027 is now described as follows:

Right Holder: CITY OF HOMEDALE
PO BOX 757
HOMEDALE, ID 83628

Priority Date: 1/7/1969

Source: GROUND WATER

BENEFICIAL USE	From	To	Diversion Rate
MUNICIPAL	1/01	to 12/31	0.670 cfs
			0.670 cfs

LOCATION OF POINT(S) OF DIVERSION

GROUND WATER	NWNENE	Sec 9	Twp 03N Rge 05W OWYHEE County
GROUND WATER	NWSENE	Sec 9	Twp 03N Rge 05W OWYHEE County

CONDITIONS OF APPROVAL

1. After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to use power records to determine the amount of water diverted and shall annually report the information to the Department.
2. Place of use is within the service area of the City of Homedale municipal water supply system as provided for under Idaho Law.
3. A map generally depicting the service area for this water right at the time of this approval is attached to this document for illustrative purposes.
4. The right holder shall accomplish the change authorized by this transfer within one year of the date of this approval.
5. Failure of the right holder to comply with the conditions of this transfer is cause for the Director to rescind approval of the transfer.

WATER RIGHT NO. 57-10393

As Modified by Transfer No. 89710

In accordance with the approval of Transfer No. 89710, Water Right No. 57-10393 is now described as follows:

Right Holder: CITY OF HOMEDALE
PO BOX 757
HOMEDALE, ID 83628

Priority Date: 1/1/1940

Source: GROUND WATER

BENEFICIAL USE	From	To	Diversion Rate
MUNICIPAL	1/01	to 12/31	0.890 cfs
			0.890 cfs

LOCATION OF POINT(S) OF DIVERSION

GROUND WATER	NWNENE	Sec 9	Twp 03N Rge 05W OWYHEE County
GROUND WATER	NWSENE	Sec 9	Twp 03N Rge 05W OWYHEE County

CONDITIONS OF APPROVAL

1. Place of use is within the service area of the City of Homedale municipal water supply system as provided for under Idaho Law.
2. A map generally depicting the service area for this water right at the time of this approval is attached to this document for illustrative purposes.
3. After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to use power records to determine the amount of water diverted and shall annually report the information to the Department.
4. The right holder shall accomplish the change authorized by this transfer within one year of the date of this approval.
5. Failure of the right holder to comply with the conditions of this transfer is cause for the Director to rescind approval of the transfer.

WATER RIGHT NO. 63-9260

As Modified by Transfer No. 89710

In accordance with the approval of Transfer No. 89710, Water Right No. 63-9260 is now described as follows:

Right Holder: CITY OF HOMEDALE
PO BOX 757
HOMEDALE, ID 83628

Priority Date: 7/3/1979

Source: GROUND WATER

BENEFICIAL USE	From	To	Diversion Rate
MUNICIPAL	1/01	to 12/31	1.000 cfs
			1.000 cfs

LOCATION OF POINT(S) OF DIVERSION

GROUND WATER NWSE Sec 3 Twp 03N Rge 05W CANYON County

CONDITIONS OF APPROVAL

1. Place of use is within the service area of the City of Homedale municipal water supply system as provided for under Idaho Law.
2. A map generally depicting the service area for this water right at the time of this approval is attached to this document for illustrative purposes.
3. After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to use power records to determine the amount of water diverted and shall annually report the information to the Department.
4. The right holder shall accomplish the change authorized by this transfer within one year of the date of this approval.
5. Failure of the right holder to comply with the conditions of this transfer is cause for the Director to rescind approval of the transfer.
6. Pursuant to Idaho Code § 42-1412(6), this water right is subject to such general provisions necessary for the definition of the rights or for the efficient administration of water rights as determined by the Snake River Basin Adjudication court in the final unified decree entered 08/26/2014.

WATER RIGHT NO. 57-11752

As Modified by Transfer No. 89710

In accordance with the approval of Transfer No. 89710, Water Right No. 57-11752 is now described as follows:

Right Holder: CITY OF HOMEDALE
PO BOX 757
HOMEDALE, ID 83628

Priority Date: 9/15/2008

Source: GROUND WATER

BENEFICIAL USE	From	To	Diversion Rate
MUNICIPAL	01/01	to 12/31	0.490 cfs
			0.490 cfs

LOCATION OF POINT(S) OF DIVERSION

GROUND WATER L6 (NESE) Sec 4 Twp 03N Rge 05W OWYHEE County

CONDITIONS OF APPROVAL

1. The right holder shall not provide water diverted under this right for the irrigation of land having appurtenant surface water rights as a primary source of irrigation water except when the surface water rights are not available for use. This condition applies to all land with appurtenant surface water rights, including land converted from irrigated agricultural use to other land uses but still requiring water to irrigate lawns and landscaping.

2. Rights 57-7027, 57-7048, 57-7656, 57-10393, 57-11752, 63-9260, and 63-31235 when combined shall not exceed a total diversion rate of 3.87 cfs.

3. Place of use is within the service area of the City of Homedale municipal water supply system as provided for under Idaho Law.

4. A map depicting the place of use boundary for this water right at the time of this approval is attached to this document for illustration purposes.

5. After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to use power records to determine the amount of water diverted and shall annually report the information to the Department.

6. When ordered by the Director, the right holder shall provide mitigation acceptable to the Director to offset depletion of lower Snake River flows needed for migrating anadromous fish. The amount of water required for mitigation, which is to be released into the Snake River or a tributary for this purpose, will be determined by the Director based upon the reduction in flow caused by the use of water pursuant to this right. Any order of the Director issued in accordance with this paragraph shall be in conformance with applicable rules allowing the right holder due process as the need for mitigation and the amount of mitigation are determined.

WATER RIGHT NO. 57-11752

As Modified by Transfer No. 89710

CONDITIONS OF APPROVAL

7. The right holder shall accomplish the change authorized by this transfer within one year of the date of this approval.


8. Failure of the right holder to comply with the conditions of this transfer is cause for the Director to rescind approval of the transfer.

State of Idaho
Department of Water Resources

Attachment to Transfer No. 89710

Water Right(s): 63-31235

This map depicts the lands served by the MUNICIPAL place of use at the time of this approval and is attached to the approval document solely for illustrative purposes.

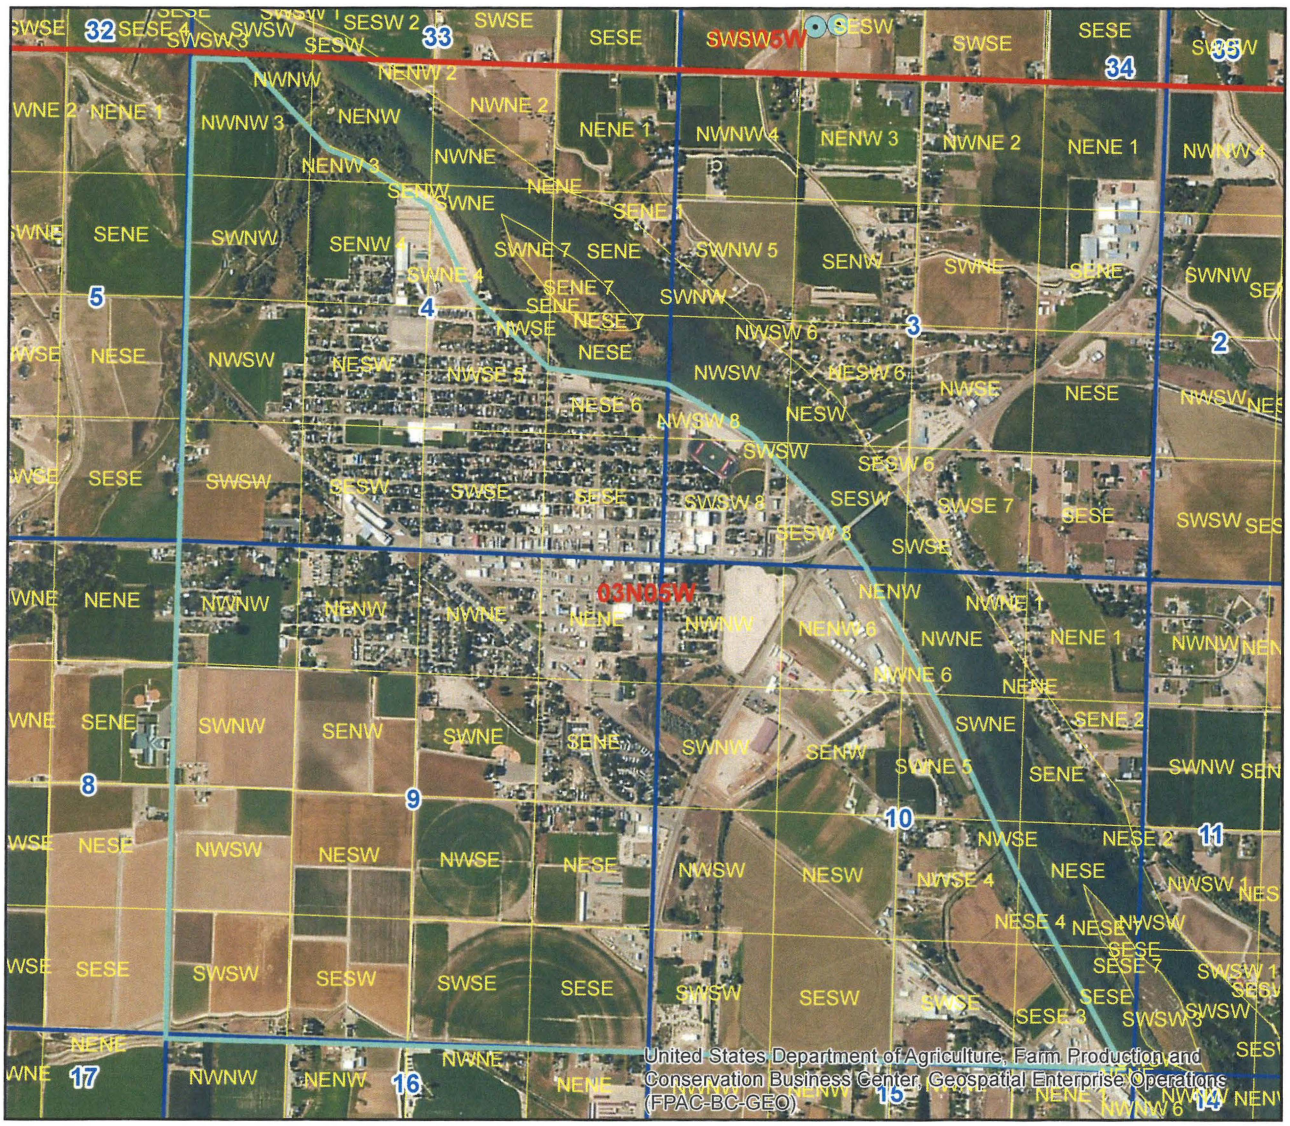

Rev. 11/24

RECEIVED
APR 14 2025
WATER RESOURCES
WESTERN REGION

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES

APPLICATION FOR TRANSFER OF WATER RIGHT

GENERAL INFORMATION AND INSTRUCTIONS

Pursuant to Section 42-222(1), *Idaho Code*, a transfer application may be filed to change the point of diversion, place of use, period of use, or nature of use of all or part of an established water right. Any person proposing to make such a change is required to file a transfer application with the Department. "Such application shall be upon forms furnished by the department and shall describe the [water right] to be changed and the changes which are proposed and shall be accompanied by the statutory filing fee." *Idaho Code* § 42-222(1).

The Department has developed this application form to assist applicants in satisfying the requirements of Section 42-222(1). This application form requests information about the applicant's authority to file (Part 1), information about the current elements of the water right(s) to be changed (Part 2), information about the proposed changes (Part 3), information about the validity of the water right(s) and the effects of the proposed changes (Part 4), and confirmation that the information provided is truthful (Part 5).

The applicant or their representative must provide a response for all applicable questions, any additional information required, and the proper filing fee before this application will be considered complete. If an application is incomplete or more information is required, the Department will notify the applicant or representative and allow time for the application to be completed. An application that remains incomplete will be returned to the applicant and the filing fee will be refunded.

An application for transfer is limited to the changes proposed for a single water distribution system. A proposal to change two or more separate water distribution systems, that will remain separate after the transfer, must be filed as separate applications. Applicants may provide additional pages to supplement their responses to the questions posed on this application form. Supplemental forms for listing additional water rights, points of diversion, or places of use can be found on the Department's website (idwr.idaho.gov). If you need assistance understanding the questions on this form, generating current water right reports, determining legal descriptions, or accessing water measurement records feel free to contact the nearest regional office of the Department.

PART 1 – CONTACT INFORMATION, OWNERSHIP RECORDS, AUTHORITY TO FILE

Name(s) of Applicant(s) City of Homedale

Mailing Address PO Box 757 Homdedale ID, 83628

Email* alicep@cityofhomedale.org **Phone** _____

Name of Representative (if any) _____

Mailing Address _____

Email* _____ **Phone** _____

*If an email address is provided, Department staff will use email as the primary method for corresponding with the applicant and representative about the application.

A. Representative. If the representative is authorized to sign or amend the application on behalf of the applicant, attach documents confirming that authority. Label documents as Attachment 1A.

B. Current Owner. If the applicant is not the current owner of record for all water rights included in this application, attach documents showing that the applicant has the authority to make the proposed changes. Label documents as Attachment 1B.

C. Updating Ownership Records. Applicants needing to update the ownership records for any of the water rights included in this application must attach documents supporting the ownership change. Such documents must trace ownership of the subject water rights or the current place of use for the subject water rights from the current owner of record for the water rights to the applicant. Label documents as Attachment 1C.

D. Business Entities. If the applicant is a business entity (corporation, LLC, partnership, trust, etc.), is the entity currently registered with the Idaho Secretary of State?

☐ Yes. If this application is signed by someone other than a person listed on the most recent annual report filed with the Idaho Secretary of State, attach documents confirming the authority of the signer to sign on behalf of the business entity. Label documents as Attachment 1D.

☐ No. Attach documents confirming the authority of the signer to sign on behalf of the business entity. Label documents as Attachment 1D.

E. Approval of Irrigation Delivery Entity. Section 42-108, *Idaho Code*, states that a transfer application proposing to change water rights held by an irrigation company or district requires the consent of the irrigation entity. If this application proposes to change water rights held by an irrigation entity, attach a letter of consent from the entity (labeled as Attachment 1E) or have an authorized representative of the entity co-sign the application.

F. Encumbered Properties. If the current place of use for the water rights included in this application is subject to a lien, deed of trust, mortgage, or contract and the application proposes to change the nature of use of the water rights or to move water rights off the current place of use, attach a statement of consent for the change signed by the lien holder, trustee, mortgagor or contract holder. Label documents as Attachment 1F.

G. Legal Access. If the applicant is not the current owner of the proposed point(s) of diversion, conveyance system, or place(s) of use, provide evidence of legal access to the land or infrastructure not owned by the applicant. Label documents as Attachment 1G. For example, an applicant may provide a letter of consent from the owner of the land or conveyance system or may have the owner co-sign the application. For applications proposing to divert water on or convey water across federal land, an applicant is not required to demonstrate legal access to the federal land prior to approval. Instead, if the transfer application is approved, the applicant must obtain access authorization from the relevant federal agency prior to diverting water under the subject water rights.

PART 2 – WATER RIGHTS BEFORE PROPOSED CHANGES

A. Current Water Rights. For each water right proposed to be changed, attach a current water right report obtained from any Department office or from the Department's website (idwr.idaho.gov). Label water right reports as Attachment 2A.

B. Map of Current System. Attach a map of the current point(s) of diversion and place(s) of use for the water rights to be changed. The map should clearly depict the elements of the water rights to be changed. For example, if the application proposes to change the point of diversion for a water right, the map should display the current location of the point of diversion. For irrigation water rights, the map should also identify the location of the irrigated acres to be changed. Label map as Attachment 2B.

C. Current Location of Irrigated Acres. If this application proposes to change the place of use or nature of use for only a portion of an irrigation water right, use the following table to identify the current location of the irrigated acres to be changed. If additional pages are required, label additional pages as Attachment 2C. If this application proposes to change or rearrange the entire place of use for irrigation water right(s), skip to Part 3.

☑ **N/A. This application does not propose to change the place of use or nature or use of an irrigation water right or this application proposes to change the place of use or nature of use for an entire irrigation right.**

Current Location of Irrigated Acres to be Changed

Twp	Rge	Sec	NE ¼				NW ¼				SW ¼				SE ¼				Acre Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	

Total Irrigated Acres to be Changed: _____

PART 3 – DESCRIPTION OF PROPOSED CHANGES

A. Purpose of Transfer. Section 42-222(1), *Idaho Code*, states that transfer applications may only be filed to change the point of diversion, place of use, period of use, or nature of use of an established water right. Section 42-248(3), *Idaho Code*, authorizes water right ownership changes to be described on a transfer application. Identify the changes proposed in this application:

- ☐ Change point(s) of diversion
- ☑ Add point(s) of diversion
- ☐ Change nature of use
- ☐ Change place of use
- ☐ Change period of use
- ☐ Update water right ownership records

B. Proposed Changes. Describe the proposed changes in narrative form:

The new Point of Diversion (POD) will discharge into a municipal water system. It will be placed approximately 25 feet away from the existing POD for Water Right 63-31235. The existing POD will remain as a redundancy to the water system.

C. Summary of Proposed Changes.

1. Water Rights. Use the following table to list all water rights, or portions thereof, that are proposed to be changed as they would appear after the proposed changes. In the Amount column, list the volume in acre-feet (af) for storage uses or the rate in cubic feet per second (cfs) for all other uses.

All	Part	Right Number	Amount (cfs/af)	Nature of Use	Period of Use		Source
☐	☑	63-31235	1.41 CFS	Municipal	1/01	to 12/31	Ground Water
☐	☐					to	
☐	☐					to	
☐	☐					to	
☐	☐					to	
☐	☐					to	
☐	☐					to	
☐	☐					to	
☐	☐					to	
☐	☐					to	

2. Total Amounts. Calculate the total quantity, in cfs or af, of water rights that are proposed to be changed through this application. For an application proposing to only change the place of use for irrigation rights, the total quantity of water is calculated by comparing the current place of use to the proposed place of use, summing the number of acres increased in each legal subdivision, and quantifying the proportional amount of diversion rate for the increased acres. For an application proposing to change or add points of diversion for irrigation or any other beneficial use, the total amount is the total diversion rate for the changed portion of the right.

Total Amount of Water Rights Proposed to be Changed: 0 **cfs and/or** _____ **af.**

3. Point(s) of Diversion. Use the following table to list all the proposed points of diversion for the water rights to be changed, including any current points of diversion that will continue to be used as part of the proposed water distribution system.

The legal description for the proposed point(s) of diversion must be to the nearest 40-acre subdivision (QQ) or U.S. Government Lot of the Public Land Survey System (PLSS). PLSS information is typically available from USGS topo maps, property deeds, tax bills or various mapping tools on the Department's website.

For points of diversion within platted subdivisions, list the lot and block number in the "Diversion Name/Number" column. An application proposing an injection into a stream and a re-diversion from that stream must list the source for the original diversion as the source for the injection and re-diversion points. If this application proposes construction of a new diversion structure (for example, a new ground water well or a new pump station on a creek), please indicate the status in the appropriate column.

☐ **N/A. This application does not propose to add or change any points of diversion.**

Proposed Points of Diversion

New?	Twp	Rge	Sec	Lot	1/4	1/4	1/4	County	Source	Diversion Name/Number
NO	04N	05W	34			SE	SW	CANYON	GROUND WATER	EXISTING WELL
YES	04N	05W	34			SE	SW	CANYON	GROUND WATER	NEW WELL

4. Place of Use. The proposed place of use must be described to the nearest 40-acre subdivision (QQ) or U.S. Government Lot of the Public Land Survey System. Government lot numbers can be noted in parenthesis below the approximate quarter-quarter location of the government lot. For water rights held by irrigation districts, municipal providers or irrigation companies, the proposed place of use may be generally described as authorized by Sections 42-202B, 42-219 and 42-222B, *Idaho Code*.

☑ **N/A. This application does not propose to change the place of use.**

Proposed Place of Use

Twp	Rge	Sec	NE ¼				NW ¼				SW ¼				SE ¼				Acre Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	

Total Irrigated Acres: _____

5. Map of Proposed System. Attach a map showing the location of the points of diversion, reservoirs, dams, canals, ditches, pipelines and other works proposed to divert and convey water. Also show the location of the place of use, including any lands to be irrigated. The map should delineate the legal subdivisions including townships, ranges, sections, quarter-quarters and government lots. Label map as Attachment 3C.

PART 4 – ADDITIONAL INFORMATION

Section 42-222(1), *Idaho Code*, establishes the criteria used to evaluate transfer applications. An applicant bears the burden of demonstrating that the water right to be changed is a valid right, that the proposed use is a beneficial use, and that the proposed changes will not injure other water rights, will not enlarge the use of the original rights, are in the local public interest, and are consistent with the conservation of water resources within the state of Idaho. To satisfy this burden, an applicant must provide sufficient data and information for the

Department to evaluate the effects of the proposed change. The Department may deny an application if the applicant fails to provide sufficient data and information to determine whether the criteria from Section 42-222(1) are satisfied. In addition to the information requested in Parts 1-3 of this application, the following information must be provided for an application to be considered complete. Department staff may request additional information or clarification as the application is processed.

A. Validity of Water Rights

1. If one or more of the water rights proposed to be changed is a statutory claim, established pursuant to Section 42-248, *Idaho Code*, attach evidence supporting the priority date claimed. Label documents as Attachment 4A-1. For statutory claims, the Department may conduct a field inspection as part of the application review process to evaluate the water right elements listed on the statutory claim.

2. Has any portion of the water right(s) proposed to be changed undergone a period of five or more consecutive years of non-use?

☐ Yes. Attach a statement describing the portion of the right(s) that were not used and the length of time of the non-use. In addition, identify any exception or defense to forfeiture and provide a detailed description as to why the water rights have not been lost and forfeited for non-use. Label documents as Attachment 4A-2. Statutory exceptions or defenses to forfeiture are set forth in Section 42-223, *Idaho Code*.

☑ No.

B. Injury to Other Water Rights

1. Identify any other water right(s) diverted at the current point(s) of diversion.

_____

_____

2. Identify any other water right(s) diverted at the proposed point(s) of diversion.

_____

_____

3. Is the proposed point of diversion within a state water district? ☐ Yes. Water District #_____. ☑ No.

4. If already constructed and in use, are the proposed points of diversion equipped with Department-approved measuring devices? ☐ Yes. ☐ No.

5. If this application proposes to divert a surface water right from a ground water well, attach a technical analysis evaluating the hydraulic connection between the proposed ground water point of diversion and the source of water listed on the right to be changed. Label technical analysis as Attachment 4B-5.

6. If this application proposes changing the point of diversion for a ground water right in the Eastern Snake Plain Aquifer (ESPA), attach a technical analysis of the anticipated depletions to reaches of the Snake River that are hydraulically connected to the ESPA using the Department's current ground water model for the ESPA. The technical analysis must evaluate depletion impacts in a time-series format at transient and steady state time steps. To assist applicants in preparing the required technical analysis, the Department has developed a transfer tool interface for the ESPA model. The transfer tool and user instructions can be downloaded from the Department's website (idwr.idaho.gov). If the proposed and current points of diversion are in the same or adjacent model cells, no technical analysis is required, unless specifically requested by the Department. Label technical analysis as Attachment 4B-6.

C. Enlargement in Use

1. Identify any other water rights used at the current place of use, including the number of shares in a canal company or acres assessed by an irrigation district.

57-7027, 57-7048, 57-7656, 57-10393, 57-11752, 63-9260

2. Identify any other water rights used at the proposed place of use, including the number of shares in a canal company or acres assessed by an irrigation district.

3. If this application proposes changing the place of use or nature of use for irrigation water rights, will the current place of use, for the portion of the right to be changed, continue to be irrigated?

☐ Yes. Identify the water right(s) to be used for the continued irrigation.

☐ No. The place of use for the portion to be changed will no longer be irrigated.

☑ N/A. The application does not propose to change the place of use for irrigation rights.

4. Unstacking Water Rights for Irrigation. If this application proposes to change the place of use for an irrigation water right that is combined with other irrigation rights at the current place of use but does not propose to change the place of use for all the stacked irrigation rights, attach evidence of the historical consumptive use occurring under all water rights at the current place of use. For irrigation rights, this should include at least five years of diversion data and/or crop data and estimates of evapotranspiration. Label the information as Attachment 4C-4. Evapotranspiration data may be available on the Department's website (http://et-idwr.idaho.gov)

5. If the application proposes to change the nature of use for a water right, attach evidence of the historical consumptive use occurring under the portion of the water right to be changed. For irrigation rights, this should include diversion data, crop data and estimates of evapotranspiration. Label the information as Attachment 4C-5. Evapotranspiration data may be available on the Department's website (http://et-idwr.idaho.gov)

6. If the application proposes to change the nature of use of a water right to municipal use for reasonably anticipated future needs, complete the form titled "Municipal Water Right Application Checklist" found on the Department's website (idwr.idaho.gov). Label the form as Attachment 4C-6.

7. To your knowledge, are any portions of the water rights proposed to be changed:

Yes	No	
☐	☑	currently leased to the Water Supply Bank? If yes, complete the form titled "Application for Transfer of Water Right Attachment WSB" found on the Department's website (idwr.idaho.gov). Label the Form as Attachment 4C-7.
☐	☑	currently used in a mitigation plan limiting the use of water under the right?
☐	☑	subject to an agreement not to divert (CREP)?
☐	☑	currently enrolled in a federal set-aside program (CRP)?

D. Local Public Interest

The department must consider whether the proposed changes are in the local public interest as defined in Section 42-202B(3), *Idaho Code*. Some of the local public interest factors that may be considered in conjunction with a transfer application are (1) Recreation, fish, and wildlife impacts, (2) Water quality or contamination concerns, (3) Local and state ordinances, regulations, or policies related to water use, (4) Goals, requirements and limits set forth in the State Water Plan. If you choose to provide information about local public interest factors, label the information as Attachment 4D.

E. Conservation of Water Resources

Describe the diversion works and water delivery system. This may include sizes and dimensions of pumps, pipelines, headgates, ditches, dams, impoundments and irrigation equipment.

The new well will be a nominal 12" casing approximately 305' below ground surface. The well pump will be sized to produce 950 gpm. The well will discharge into the municipal system for the City of Homedale. It will be equipped with a totalizing flow meter, and can be locked at the control panel.

PART 5 – FILING FEE AND SIGNATURE

A. Filing Fee. Filing fees for transfer applications are set forth in Section 42-221.O, *Idaho Code*. A table summarizing the filing fees for transfer applications is also found on the Department's website (idwr.idaho.gov). Any application proposing to change the nature of use for one or more rights requires an additional filing fee of $250. Applications proposing to update the ownership records for water rights must also include the appropriate filing fee to update the ownership records. For any application relying on the filing fee set forth in Section 42-221.O.8, *Idaho Code*, attach a statement describing how the application qualifies under Section 42-221.O.8. Label documents as Attachment 5A.

B. Affidavit of Applicant or Representative:

I hereby assert that no one will be injured by the proposed changes and that the proposed changes do not constitute an enlargement in use of the original right(s). The information contained in this application is true to the best of my knowledge. I understand that any willful misrepresentations made in this application may result in rejection of the application or cancellation of an approval.

Signature of Applicant or Representative*	Print Name and Title, if applicable	Date
Sheen Christofferson	Sheen Christofferson, Mayor	04/01/2025

*If water rights included in this application are owned by multiple people or entities, each owner must sign the application form.

FOR DEPARTMENT USE ONLY

Fee Paid: $ 580.00 Receipt #: W052477 Date: 4/14/25 Receipted by: MB

Add'l Paid: $ _____ Receipt #: _____ Date: _____ Receipted by: _____

Transfer No. 89710 **Page** 8

State of Idaho
Department of Water Resources

Water Right License

WATER RIGHT NO. 63-31235

Priority: March 31, 2001 Maximum Diversion Rate: 1.41 CFS

It is hereby certified that CITY OF HOMEDALE
PO BOX 757
HOMEDALE ID 83628 has complied with the terms and conditions of the permit, issued pursuant to Application for Permit dated March 09, 2001; and has submitted Proof of Beneficial Use on July 23, 2003. An examination confirms water is diverted from:

SOURCE
GROUND WATER

and a water right has been established as follows:

BENEFICIAL USE	PERIOD OF USE	DIVERSION RATE
MUNICIPAL	01/01 to 12/31	1.41 CFS

LOCATION OF POINT(S) OF DIVERSION:
GROUND WATER SE1/4SW1/4 Sec. 34, Twp 04N, Rge 05W, B.M. CANYON County

CONDITIONS OF APPROVAL

1. A map depicting the place of use boundary for this water right at the time of this approval is attached to this document for illustration purposes.
2. Place of use is within the service area of the City of Homedale municipal water supply system as provided for under Idaho Law.
3. After specific notification by the Department, the right holder shall install a suitable measuring device or shall enter into an agreement with the Department to determine the amount of water diverted from power records and shall annually report the information to the Department.
4. The issuance of this right does not grant any right-of-way or easement across the land of another.
5. The right holder shall not provide water diverted under this right for the irrigation of land having appurtenant surface water rights as a primary source of irrigation water except when the surface water rights are not available for use. This condition applies to all land with appurtenant surface water rights, including land converted from irrigated agricultural use to other land uses but still requiring water to irrigate lawns and landscaping.
6. When ordered by the Director, the right holder shall provide mitigation acceptable to the Director to offset depletion of lower Snake River flows needed for migrating anadromous fish. The amount of water required for mitigation, which is to be released into the Snake River or a tributary for this purpose, will be determined by the Director based upon the reduction in flow caused by the use of water pursuant to this right. Any order of the Director issued in accordance with this paragraph shall be in conformance with applicable rules allowing the right holder due process as the need for mitigation and the amount of mitigation are determined.
7. Rights 57-7027, 57-7048, 57-7656, 57-10393, 57-11752, 63-9260, and 63-31235 when combined shall not exceed a total diversion rate of 3.87 cfs.

This license is issued pursuant to the provisions of Section 42-219, Idaho Code. The water right confirmed by this license is subject to all prior water rights and shall be used in accordance with Idaho law and applicable rules of the Department of Water Resources.

Signed this 18th day of March, 2015.

Shelley W. Keen
for GARY SPACKMAN
Director

89716


SCANNED
MAR 23 2015

City Of Homedale

Attachment To Water Right License

63-31235

This map depicts the MUNICIPAL place of use boundary for this water right at the time of this approval and is attached to the approval document solely for illustrative purposes.

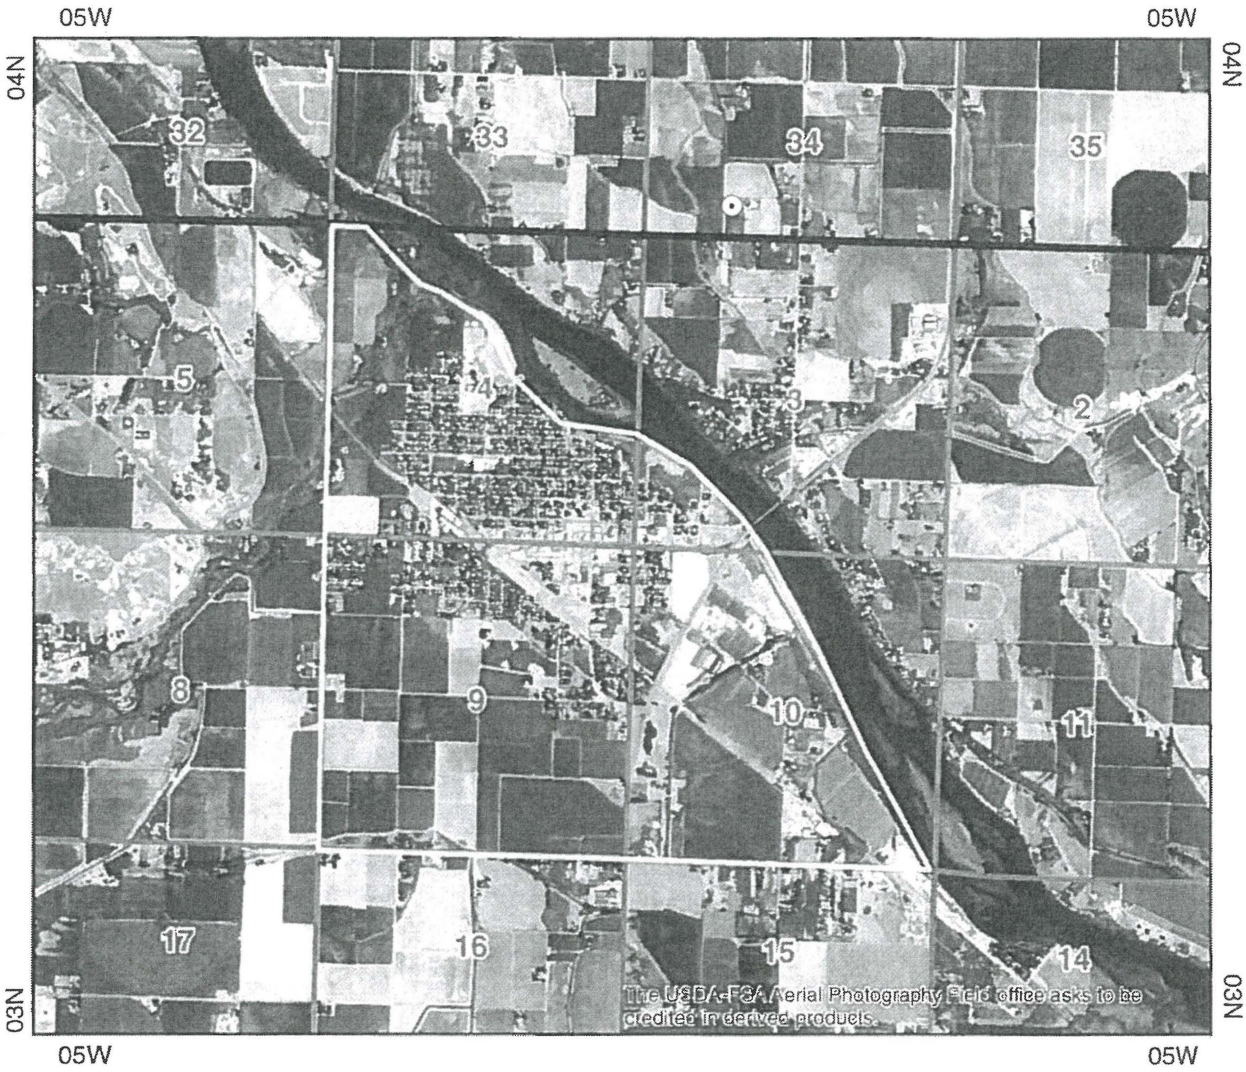

0 0.375 0.75 1.5 Miles

Point of Diversion

Water Service Area Boundary

Townships

PLS Sections

N

SCANNED
MAR 2 3 2015

89710

State of Idaho
DEPARTMENT OF WATER RESOURCES
322 East Front Street • P.O. Box 83720 • Boise, Idaho 83720-0098
Phone: (208) 287-4800 • Fax: (208) 287-6700 • Website: www.idwr.idaho.gov

C.L. "BUTCH" OTTER
Governor

GARY SPACKMAN
Director

March 19, 2015

CITY OF HOMEDALE
PO BOX 757
HOMEDALE ID 83628

RE: License Nos. 57-11752 & 63-31235

Issuance of Licenses

Dear Water Right Holder(s):

The Department of Water Resources has issued the enclosed Water Right Licenses confirming that water rights have been established in accordance with your permits. Please be sure to thoroughly review the conditions of approval and remarks listed on your licenses. Also enclosed is a copy of the approved application for amendment.

The licenses are PRELIMINARY ORDERS issued by the Department pursuant to section 67-5243, Idaho Code. They can and will become final orders without further action by the Department unless a party petitions for reconsideration or files an exception and/or brief within fourteen (14) days of the service date as described in the enclosed information sheet.

Please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Failure to report these changes could result in a $100 late filing fee. Contact any office of the Department or visit the Department's homepage on the Internet to obtain the proper forms and instructions.

If you have any questions, please contact me at 208-287-4951.

Sincerely,

Pamela Skaggs

Pamela Skaggs
Water Rights Supervisor

Enclosure(s)

SCANNED
MAR 23 2015

89710

CERTIFICATE OF SERVICE

I hereby certify that on March 20, 2015, I mailed true and correct copies, postage prepaid, of the foregoing PRELIMINARY ORDERS (Approved Licenses) to the person(s) listed below:

RE: WATER RIGHT NOS. 57-11752 & 63-31235

CITY OF HOMEDALE
PO BOX 757
HOMEDALE ID 83628

Darla Block

Darla Block
Technical Records Specialist

SCANNED
MAR 2 3 2015

89710

EXPLANATORY INFORMATION TO ACCOMPANY A PRELIMINARY ORDER

(To be used in connection with actions when a hearing was **not** held)

(Required by Rule of Procedure 730.02)

The accompanying order or approved document is a "**Preliminary Order**" issued by the department pursuant to section 67-5243, Idaho Code. **It can and will become a final order without further action of the Department of Water Resources ("department") unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:**

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. **Note: the petition must be received by the department within this fourteen (14) day period.** The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after: (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the Department or the Water Resource Board is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the Department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

89710

MEMORANDUM

TO: File 63-31235

FROM: Daniel Nelson – Staff Hydrologist

DATE: March 6, 2015

SUBJECT: Licensing Review for 63-31235

This is the licensing review of the field exam submitted by Sandy Hemenway formerly in our state office. The field exam was done on August 2, 2012. The system associated with this permit allowed for a single well located in the SESW quarter of Section 34, Township 4 North, Range 5 West, BM. The field exam has some issues that need to be addressed to prior to licensing of the permit.

Diversion Rate:

Ms. Hemenway used a theoretical calculation and actual measurement to determine the flow rate of this well. Unfortunately, Ms. Hemenway did not provide any information or data to back up her calculations, and did not measure the well at the full capacity of the well. Ms. Hemenway did supply pictures showing the variable speed drive that stated it was operating at 59.4% capacity. With this information, I worked through the attached theoretical flow rates, which show a maximum capacity of this well of 1.41 cfs. I am recommending a diversion rate of 1.41 cfs. Please see attached sheet for my justification for this recommendation.

Diversion Volume:

This permit is for a municipal use for the City of Homedale, so no volume will be assigned to this permit.

Points of Diversion:

Ms Hemenway used GPS to locate the well for this system. I agree with Ms. Hemenway's well location site.

Conditions:

Most of the conditions were carried over to the license from the permit. Ms. Hemenway did add condition 075 restricting the ability to irrigate parks and other open areas, however, this condition is only for municipal water rights in restricted areas. The restricted area for Basin 63 no longer goes this far south, so this condition is not pertinent to this permit and should not be added to the license.

8970

This water right had a condition that limited the water bearing zone to 244 to 285 feet. The actual water bearing zone that was used was 255 to 305 feet. The reason for this discrepancy is that the monitoring well used had a water bearing zone of 235 to 285 feet. I believe they just estimated the water bearing zone too closely. There are 50 wells within ½ mile of the well in question, but all but 6 of the wells use a much shallower water bearing zone. Of the wells deeper than 200 feet, 4 of the wells are domestic wells, 1 is another City of Homedale well, and the other is a geothermal well that is drilled twice as deep if not more to tap into low temperature geothermal water. With the general closeness of the water bearing zone being tapped, it is reasonable to remove this condition from the license, since it no longer applies to this specific well.

This system has several wells that have been abandoned, or that are part of well rotation. Instead of having designated back up wells, the City uses all of the wells on a rotation to ensure that they are all used and maintained. This provides better maintenance on all of the wells.

Where all of the wells are not used at the same time, administration has asked us to determine to the best of our ability the maximum instantaneous diversion rate for the entire city system. A combined condition would then need to be added to prevent creating a water right similar to a reasonably anticipated needs right without going through the process.

The City supplied information that states that the maximum that they divert into their culinary system at one time is 1739 gpm or 3.87 cfs. According to the average hourly demand, this rate it does seem reasonable that they would divert the 3.87 cfs for their entire system. Therefore, water rights 57-7027, 57-7048, 57-7656, 57-11752, 63-9260, and 63-31235 when combined should be limited to the Reported Actual Peak Flow of 3.87 cfs. The condition should be as follows:

> Rights 57-7027, 57-7048, 57-7656, 57-11752, 63-9260, and 63-31235 when combined shall not exceed a total diversion rate of 3.87 cfs.

Please see attached spreadsheet for analysis of this right.

89710

File: 63-31235 and 57-11752
Agent: Dan Nelson
Date: 3/6/2015

CITY OF HOMEDALE MAXIMUM DIVERSION ANALYSIS

MDD	Low MDD Ratio	High MDD Ratio	Low ADD	High ADD	Low PHD Ratio	High PHD Ratio	Low 1 PHD	Low 2 PHD	High 1 PHD	High 2 PHD
839	1.5	3	559.3	279.7	2.25	4.5	1258.5	629.3	2517	1258.5

Reported Actual Flow (PID) = 1739 /448.8= 3.87 cfs

Estimated PID = 629.3 to 2517

Determining the actual peak instantaneous diversion rate for municipal system is difficult at best. The City of Homedale states that the Maximum Daily Diversion(MDD) is 839 gpm and the Peak Instantaneous Diversion (PID) is 1739 gpm. According to general estimations of the ratios between the MDD and the Peak Hourly Diversion (PHD) found on page 13 of the Reasonably Anticipated Needs Administrative Memo, you can calculate the PHD from the MDD by using a set of ratios that convert the MDD to the Average Daily Diversion(ADD) and then back to the PHD. The PHD is the closest diversion rate we can estimate using this method, but it should be reasonably close to the PID. The Reported PID is within the range of the Estimated PID. Taking this information into account, I would assume that the City's PID is very close to the 1739 submitted.

Water Right	Water Right Diversion Rate in cfs	Already Licensed Rate	
63-9260 57-10393 57-7027	2.56	2.56	
57-7048	0.04	0.04	
57-7656	0.24	0.24	
57-11752	0.49		Permit
63-31235	1.41		Permit
TOTAL	4.74	2.84	

The only licensed or decreed water rights listing the City of Homedale as part of the culinary system are water rights 63-9260, 57-10393, 57-7027, 57-7048, and 57-7656. The two new permits only add 1.03 cfs of water to the entire system. The combined rate of diversion when water rights 57-11752, 63-31235, 63-9260, 57-10393, 57-7027, 57-7048, and 57-7656 will need to be limited to 3.87 cfs.

89710

THEORETICAL HORSEPOWER EQUATION WORKSHEET (cjh 1/92)

Water Right No.: 63-31235
Reviewer: Dan Nelson
Date of Review: 11/26/2014

P/D No.:	Well at 59.4% of load on 60 Hp motor	Well At Full HpField Exam Numbers
PUMP HORSEPOWER	35.64	60
BOOSTER HORSEPOWER	0	0
PUMPING LEVEL	142	142
DISCHARGE PRESSURE	52	52
RATE OF FLOW (cfs)	0.84	1.41
	376	633

calculates the formula =

$$Q = \frac{8.8 * (\text{Efficiency}) * hp}{\text{depth to water} + 2.31*(psi) + \text{friction}}$$

Assumptions: %70 efficiency.
No Friction

Examiners Notes: My first review of this system, the numbers supplied by the field examiner didn't make any sense. Upon further review of the field exam and the photos for the field exam, I discovered that the well was on a variable speed drive. In the photo of the variable speed drive read out, it appears as though the well is operating at 59.4% of the Hp for the pump. Taking this information into account, the 60 Hp pump would be operating at 35.64 Hp (60 Hp X 0.594 = 35.64 adjusted Hp). Once you use the adjusted Hp, the numbers supplied by the field examiner make more sense. When this pump operates at 59.4 % of the Hp rating, the flow according to the theoretical calculations is 376 gpm. The flow meter reading taken by the field examiner was between 300 and 400 gpm, and she estimated the flow at 390 gpm from the meter. The 376 gpm from the adjusted Hp theoretical and the 390 gpm measured at the time of the exam are very close. The problem with this situation is that the pump system was not operating at full capacity. To operate at full capacity, the pump would need to be operating at 60 Hp. I created a theoretical calculation based on the full capacity of the pump, and found that at full capacity the flow rate would be 633 gpm or 1.41 cfs. I recommend that this system be licensed at 1.41 cfs.

Please Note:

The highest average daily flow in 2011 was 0.66 cfs or 296 gpm. This has to qualifiied to state that the pump may or may not have run all day long. Therefore, this number cannot be used. The maximum flow of the system shoulld be used.

89710

-174243

Form 238-7
11/97

IDAHO DEPARTMENT OF WATER RESOURCES
WELL DRILLER'S REPORT

870327-774243

Office Use Only
Inspected by _____
Twp ____ Rge ____ Sec ____
____ 1/4 ____ 1/4 ____ 1/4
Lat: : : Long: : :

1. WELL TAG NO. D _____
DRILLING PERMIT NO. 19697
Other IDWR No. 63-31235

2. OWNER:
Name City of Homedale
Address 31 West Wyoming
City Homedale State ID Zip 83628

3. LOCATION OF WELL by legal description:
Sketch map location must agree with written location.

N / W / E / S

Twp. 4 North XX or South ☐
Rge. 5 East ☐ or West XX
Sec. 34 ____ 1/4 S/E ____ 1/4 S/W ____ 1/4
(10 acres / 40 acres / 160 acres)
Gov't Lot ____ County Canyon
Lat: : : Long: : :
Address of Well Site approximately 900' west of Batt & Ustick
(Give at least name of road + Distance to Road or Landmark)
City between Wilder & Homedale

Lt. _____ Blk. _____ Sub. Name _____

4. USE:
☐ Domestic ☒ Municipal ☐ Monitor ☐ Irrigation
☐ Thermal ☐ Injection ☐ Other _____

5. TYPE OF WORK check all that apply (Replacement etc.)
☒ New Well ☐ Modify ☐ Abandonment ☐ Other _____

6. DRILL METHOD
☐ Air Rotary ☐ Cable ☒ Mud Rotary ☐ Other _____

7. SEALING PROCEDURES

SEAL/FILTER PACK Material	From	To	AMOUNT Sacks or Pounds	METHOD
bentonite chips	0	30	28 sk	poured
bentonite grout	30	220	50 sk	pumped
#6-9 sand	200	305	6000#	poured

Was drive shoe used? ☐Y ☒N Shoe Depth(s) _____
Was drive shoe seal tested? ☐ Y ☐ N How? _____

8. CASING/LINER:

Diameter	From	To	Gauge	Material	Casing	Liner	Welded	Threaded
12"	+2	255	375	steel	XX	☐	XX	☐
					☐	☐	☐	☐
					☐	☐	☐	☐

Length of Headpipe 0 Length of Tailpipe 0

9. PERFORATIONS/SCREENS
Perforations Method _____
Screens Screen Type Johnson stnls

From	To	Slot Size	Number	Diameter	Material	Casing	Liner
~~255~~	~~305~~	~~40~~		~~10~~	~~stnls~~	XX	☐
						☐	☐
						☐	☐

10. STATIC WATER LEVEL OR ARTESIAN PRESSURE:
20.4 ft. below ground Artesian pressure ____ lb.
Depth flow encountered ____ ft. Describe access port or control devices: _____

11. WELL TESTS:
☒ Pump ☐ Bailer ☐ Air ☐ Flowing Artesian

Yield gal./min.	Drawdown	Pumping Level	Time
825	100.2	120.6	12 hrs

Water Temp. _____ Bottom hole temp. _____
Water Quality test or comments: _____
Depth first Water Encounter _____

12. LITHOLOGIC LOG: (Describe repairs or abandonment)

Bore Dia.	From	To	Remarks: Lithology, Water Quality & Temperature	Water Y	Water N
18	0	6	silty topsoil		X
	6	23	coarse black sand & pea grvl		X
165	23	35	sandy brown clay		X
	35	150	blue clay		X
	150	177	black sand, pea gravel & sandstone	X	
	177	194	blue clay		X
	194	200	black sand	X	
	200	230	blue clay		X
	230	255	blue clay with sandy streaks		X
	255	303	black sand, pea gravel & sandstone	X	
	303	310	blue clay		X

RECEIVED
JAN 09 2003
WATER RESOURCES
WESTERN REGION

Completed Depth 305' (Measurable)
Date: Started 3/11/02 Completed 4/15/02


13. DRILLER'S CERTIFICATION
I/We certify that all minimum well construction standards were complied with at the time the rig was removed.

Company Name Stevens & Sons Firm No. 153
Firm Official Ron Stevens Date 4/22/02
and
Driller or Operator _____ Date 4/22/02
(Signature of Firm Officials Required)

89710

FORWARD WHITE COPY TO WATER RESOURCES

The following is a copy of the City of Homedale's current webpage as of 1/30/2015. This confirms that Gheen Christoffersen is the mayor of the City of Homedale. Mr. Christoffersen signed the amendment of permit and corrected the address on the amendment. The address will be corrected in Workflow.

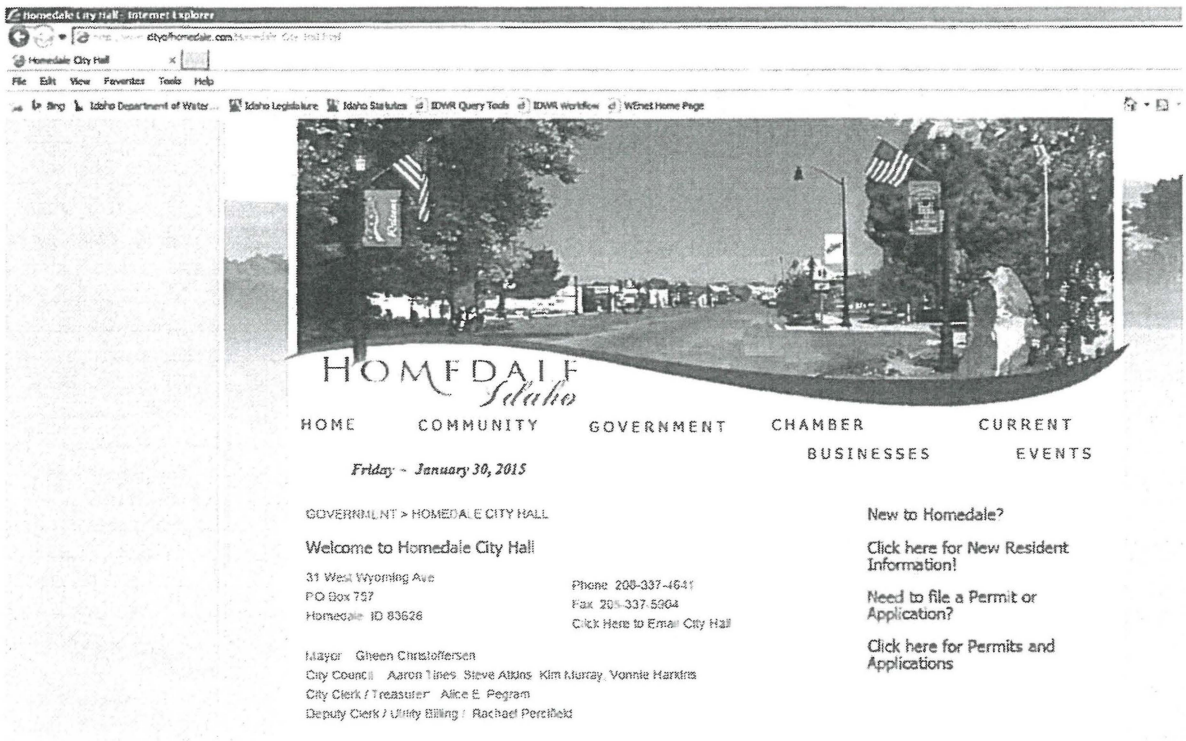

89710

63-31235

Gheen Christoffersen
Mayor

Alice E. Pegram
City Clerk-Treasurer

City of Homedale

P.O. Box 757
Homedale, Idaho 83628
cityofhomedale@cableone.net
Phone 208-337-4641
Fax 208-337-5904

RECEIVED
JAN 21 2015
DEPARTMENT OF
WATER RESOURCES

January 15, 2014

State of Idaho Department of Water Resources
322 East Front Street
P.O. Box 83720
Boise, ID 83720-0098

RE: Water Right Permit No. 57-11752 and 63-31235

To Whom It May Concern:

I have compiled the information on the City of Homedale's water system you requested in the December 18, 2014 letter.

Maximum average daily diversion (MADD): 839 g.p.m.
This information was obtained from Well Flow Logs on file.
Peak Instantaneous Demand (PID): 1739 g.p.m.

This information was obtained from a Sanitary Survey conducted on May 5, 2011.
With this, I hope you can move forward with our water right licensing.

Thank you and if you require any further information, please let me know.

Sincerely,

Bret Smith
City of Homedale
Public Works Supervisor

89710

Nelson, Dan

From: Nelson, Dan
Sent: Tuesday, January 13, 2015 7:25 AM
To: 'Bret Smith'
Subject: RE: Homedale Water Rights information

Bret,

I apologize for taking so long to respond to you. I was out of the office all day Friday and half the day Monday. You can use the Sanitary Surveys to show the capacity of each pump. To attain the Peak Instantaneous Demand (PID), we would then need to know the maximum number of pumps that have operated in the past at one time. For example, on March 2011, Pumps 1, 3, 4, 6 and 8 were in operation. We could then use the capacities for pumps 1, 3, 4, 6, and 8 from the sanitary survey to provide a reasonable estimate of the PID.

The Maximum Average Daily Diversion (MADD) should be relatively simple to calculate. You need to find the day that had the most total gallons per day and divide that down to an average gallon per minute rate. For example: On July 30, 2010, the city used a total of 2,750,000 gallons. 2,750,000 gallons/ 24 hours/60 minutes = 1,909.7 gpm

I hope this helps. If there is anything else that I can do please let me know.

I appreciate your cooperation on this issue.

Daniel Nelson
Staff Hydrologist
Idaho Department of Water Resources
Telephone (208) 287-4856
Fax (208) 287-6700 (attn: Dan Nelson)

From: Bret Smith [mailto:homedalepublicwks@cableone.net]
Sent: Thursday, January 08, 2015 2:50 PM
To: Nelson, Dan
Subject: Homedale Water Rights information

Daniel,

Thanks for taking the time to answer my questions. I'll be working on gathering the information IDWR has requested over the next few days, and I hope to submit it Tuesday or Wednesday of next week. Is it acceptable to submit via email?

Just to review our conversation, it is sufficient to submit PID rates based on pump capacity information from recently conducted Sanitary Surveys (5/5/2011).

Secondly, I will scour my paper records and SCADA system capabilities to determine MADD data.

If this sounds acceptable, please let me know.

89710

Thank you,

--
Bret Smith
City of Homedale
Public Works Supervisor
Office: 208-337-4641

89710

State of Idaho
DEPARTMENT OF WATER RESOURCES
322 East Front Street • P.O. Box 83720 • Boise, Idaho 83720-0098
Phone: (208) 287-4800 • Fax: (208) 287-6700 • Website: www.idwr.idaho.gov

C.L. "BUTCH" OTTER
Governor

GARY SPACKMAN
Director

December 18, 2014

CITY OF HOMEDALE
313 W WYOMING AVE
PO BOX 757
HOMEDALE ID 83628

RE: Water Right Permit No. 57-11752 and 63-31235

Ladies and Gentlemen:

On December 1, 2014, I sent you a letter requesting an amendment for water right 57-11752. That amendment was received, and the water right was submitted for licensing. However, the files were returned, and I have been asked to attain the answers to two questions concerning the City of Homedale's total water use needs before we can complete the licensing of the above two water rights. Please supply the following information:

1.) Our office will need the maximum average daily diversion (MADD) for the City of Homedale's system. This amount can be supplied in gallons per minute (gpm) or cubic feet per second (cfs). This flow rate is for the entire City of Glenn's Ferry from all of their water sources including springs, ground water, and the Snake River.

2.) Our office will also need the Peak Instantaneous Demand (PID) diversion rate that is required for the entire city. Once again this can be submitted in gpm or cfs, and must be for the entire City of Homedale's water system. This rate would be the absolute maximum rate of flow that is required to supply the City of Homedale during its highest period of use.

Once I receive the above information, I can move forward with the licensing of these two water rights. I do have to ask that this information be submitted within 30 days. If I do not receive the requested information from you by January 19, 2014, I will be forced to take action to void your permits under the provision of Section 42-219(8) of the Idaho Code.

Sincerely,

Daniel A. Nelson
Staff Hydrologist
Planning Bureau
Idaho Department of Water Resources
Telephone # (208) 287-4856
Email – dan.nelson@idwr.idaho.gov

89710

Hemenway, Sandy

From: Hemenway, Sandy
Sent: Sunday, April 13, 2014 12:05 PM
To: 'cityofhomedale@cableone.net'
Cc: Hemenway, Sandy; Saxton, Craig
Subject: City of Homedale (63-31235 and 57-11752) Attention: Larry Bauer

Importance: High

Larry,

We are currently in the process of conducting the licensing review for water rights 63-31235 (Ustick Well), and 57-11752 (well #7).

Please send a copy of an entire year's worth of daily/monthly flow records for the City of Homedale:


(1) The flow records should show flow records for each individual well that is on the City of Homedale's water system (each back-up well, and primary wells).

If these records are emailed or mailed after 4/17/2014, please send them to the attention of Craig Saxton (craig.saxton@idwr.idaho.gov or to IDWR PO Box 83720, Boise, ID 83720-0098). If you have any questions, Craig's phone number is (208) 287-4916.

Thank you so much,

Sandy Hemenway
Sr. Water Resource Agent
IDWR State Office, Boise
(208)287-4920
Sandy.hemenway@idwr.idaho.gov

89710

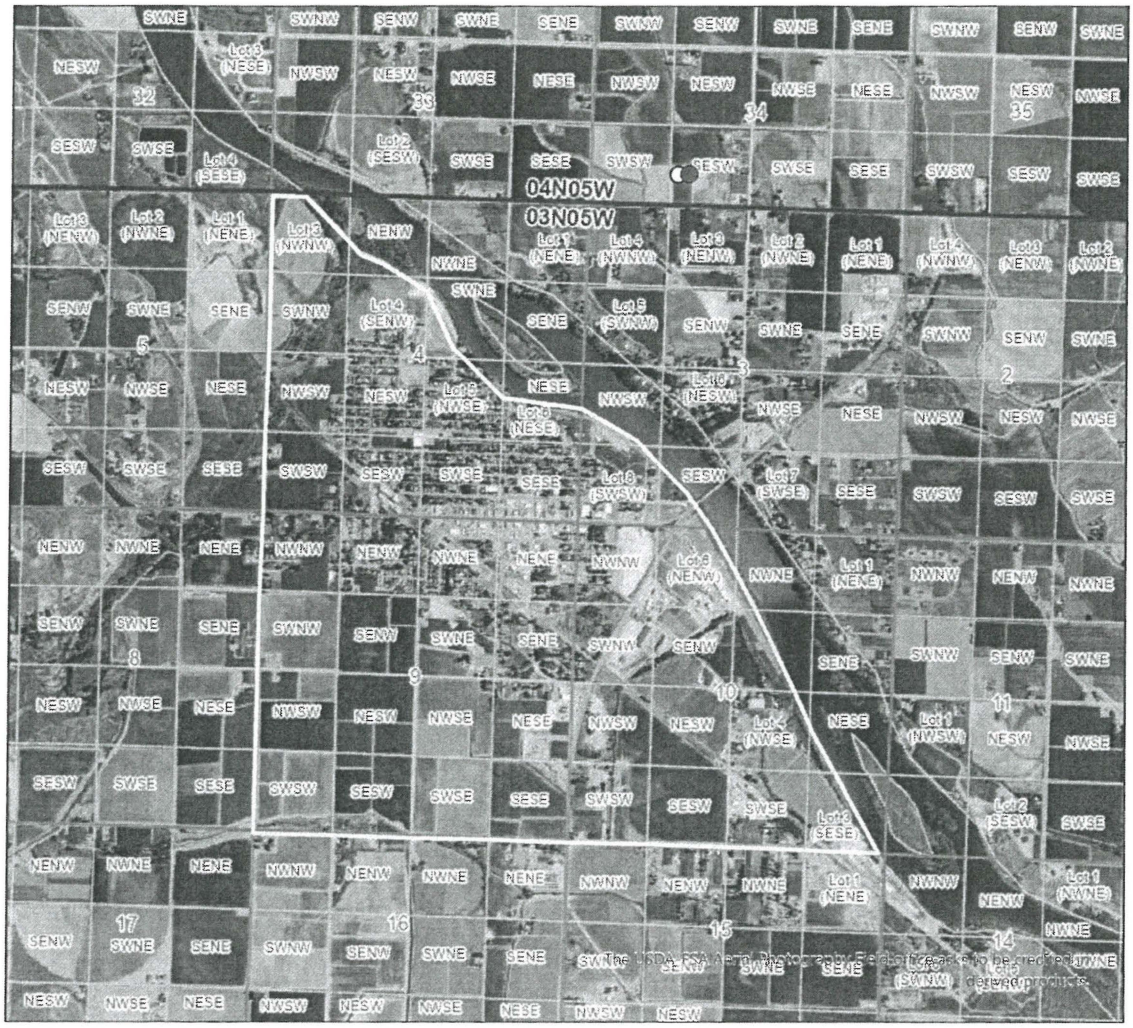

LEGEND

- QUARTER QUARTERS
- PLS SECTIONS
- TOWNSHIPS
- EXISTING POINT OF DIVERSION
- NEW POINT OF DIVERSION
- PLACE OF USE BOUNDARY

NORTH

GreatWest ENGINEERING

89710

POD APPLICATION MAP
WATER RIGHT 63-31235

CITY OF HOMEDALE
HOMEDALE WATER IMPROVEMENTS

y:\Shared\Boise Projects\4-23124-Homedale Water Improvements 2024\CADD 4-23124\Exhibits\POD Application\POD Application Map.dwg

Application for Transfer or Exchange Fee Schedule

Applications for changes pursuant to Idaho Code § 42-221.O.8 require a filing fee of $50 per water right. **All other application fees** are based on the storage volume (acre-feet per year or AFY) or on the diversion rate (cubic feet per second or CFS) being transferred, not necessarily on the amount of the entire right. For applications proposing a change in the diversion rate and storage volume, determine each fee separately and pay the greater of the two. See Transfer Processing Memo No. 23.

(CFS = cubic feet per second; AF = acre-feet per year)

Flow Rate (CFS)	Storage Volume (AF)	Fee	Flow Rate (CFS)	Storage Volume (AF)	Fee
0.00 – 0.20	0.0 – 20.0	**$200**	11.01 – 12.00	1,100.1 – 1,200.0	**$1,380**
0.21 – 1.00	20.1 – 100.0	**$500**	12.01 – 13.00	1,200.1 – 1,300.0	**$1,460**
1.01 – 2.00	100.1 – 200.0	**$580**	13.01 – 14.00	1,300.1 – 1,400.0	**$1,540**
2.01 – 3.00	200.1 – 300.0	**$660**	14.01 – 15.00	1,400.1 – 1,500.0	**$1,620**
3.01 – 4.00	300.1 – 400.0	**$740**	15.01 – 16.00	1,500.1 – 1,600.0	**$1,700**
4.01 – 5.00	400.1 – 500.0	**$820**	16.01 – 17.00	1,600.1 – 1,700.0	**$1,780**
5.01 – 6.00	500.1 – 600.0	**$900**	17.01 – 18.00	1,700.1 – 1,800.0	**$1,860**
6.01 – 7.00	600.1 – 700.0	**$980**	18.01 – 19.00	1,800.1 – 1,900.0	**$1,940**
7.01 – 8.00	700.1 – 800.0	**$1,060**	19.01 – 20.00	1,900.1 – 2,000.0	**$2,020**
8.01 – 9.00	800.1 – 900.0	**$1,140**	20.01 – 100.00	2,000.1 – 10,000.0	*
9.01 – 10.00	900.1 – 1,000.0	**$1,220**	100.01 – 500.00	10,000.1 – 50,000.0	**
10.01 – 11.00	1,000.1 – 1,100.0	**$1,300**	500.01 & over	50,000.1 & over	***

For an application including a **change in nature of use** of water under one (1) or more right(s):
Additional fee of $250 per application.

For any application including a **change in ownership** of water right(s) as required per Idaho Code § 42-248:
Additional fee of $25 per undivided right requiring an ownership change and/or
Additional fee of $100 per divided right requiring an ownership change.

* **$2,020 plus $40** for each additional 1.0 cfs or part thereof or 100 acre-feet or part thereof over the first 20.0 cfs or 2,000 acre-feet.

** **$5,220 plus $20** for each additional 1.0 cfs or part thereof or 100 acre-feet or part thereof over the first 100.0 cfs or 10,000 acre-feet.

*** **$13,220 plus $4** for each additional 1.0 cfs or part thereof or 100 acre-feet or part thereof over the first 500.0 cfs or 50,000 acre-feet.

89710

From: Hobson, Susy
To: alicep@cityofhomedale.org
Subject: Transfer Approval 89710
Date: Tuesday, June 24, 2025 12:00:00 PM
Attachments: City of Homedale Transfer Approval 89710.pdf
image001.png

Good morning,

Attached you will find the transfer approval 89710 which affected these water rights:

63-31235
57-7656
57-7048
57-7027
57-10393
63-9260
57-11752

A hard copy is in the mail.

Regards,

Susy

Susy Hobson
Technical Records Specialist
IDAHO DEPARTMENT OF WATER RESOURCES
Western Region
2735 W. Airport Way, Boise ID 83705
(208) 605-4631 susy.hobson@idwr.idaho.gov

IDAHO DEPARTMENT OF
WATER RESOURCES

Western Region • 2735 W Airport Way • Boise, ID 83705-5082
Phone: 208-334-2190 • Fax: 208-334-2348 • Email: westerninfo@idwr.idaho.gov • Web: idwr.idaho.gov

Governor Brad Little Director Mathew Weaver

June 23, 2025

CITY OF HOMEDALE
PO BOX 757
HOMEDALE ID 83628

Re: Transfer No: 89710
Water Right Nos: 57-7027, 57-7048, 57-7656, 57-10393, 57-11752, 63-9260, 63-31235

Transfer Approval Notice

Dear Water Right Holder:

The Department of Water Resources has issued the enclosed approved Transfer of Water Rights. Please be sure to thoroughly review the conditions of approval and remarks listed on the approval document.

The Transfer of Water Rights is a PRELIMINARY ORDER issued by the Department pursuant to section 67-5243, Idaho Code. It can and will become a final order without further action by the Department unless the APPLICANT petitions for reconsideration or files an exception and/or brief within fourteen (14) days of the service date as described in the enclosed information sheet.

ANY PERSON aggrieved by any decision, determination, order or action of the Department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Department and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

If the transfer approval includes a condition requiring measuring and recording devices, such devices shall comply with specifications established by the Department. Detailed specifications are available on the Department's home page on the internet, or you can request a copy by contacting any office of the Department. Please be sure to thoroughly review the specifications to avoid unnecessary costs for reinstallation or modification due to non-conforming or improper installation.

Please note that water right owners are required to report any change of water right ownership and/or mailing address to the Department within 120 days of the change. Failure to report these changes could result in a $100 late filing fee. Contact any office of the Department or visit the Department's homepage on the Internet to obtain the proper forms and instructions.

If you have any questions, please contact me at (208) 334-2190.

Sincerely,

Susan E. Hobson

Susy Hobson
Technical Records Specialist

Enclosures

CERTIFICATE OF SERVICE

I hereby certify that on June ~~23~~ 24, 2025 I mailed a true and correct copy, postage prepaid, of the foregoing PRELIMINARY ORDER (Approved Transfer) to the person(s) listed below:

Re: Transfer No: 89710
Water Right Nos: 57-7027, 57-7048, 57-7656, 57-10393, 57-11752, 63-9260, 63-31235

CITY OF HOMEDALE
PO BOX 757
HOMEDALE ID 83628

Susan E Hobson

Susy Hobson
Technical Records Specialist

EXPLANATORY INFORMATION TO ACCOMPANY A PRELIMINARY ORDER

(To be used in connection with actions when a hearing was **not** held)

(Required by Rule of Procedure 730.02)

The accompanying order or approved document is a "**Preliminary Order**" issued by the department pursuant to section 67-5243, Idaho Code. **It can and will become a final order without further action of the Department of Water Resources ("department") unless a party petitions for reconsideration, files an exception and brief, or requests a hearing as further described below:**

PETITION FOR RECONSIDERATION

Any party may file a petition for reconsideration of a preliminary order with the department within fourteen (14) days of the service date of this order. **Note: the petition must be received by the department within this fourteen (14) day period.** The department will act on a petition for reconsideration within twenty-one (21) days of its receipt, or the petition will be considered denied by operation of law. See Section 67-5243(3) Idaho Code.

EXCEPTIONS AND BRIEFS

Within fourteen (14) days after: (a) the service date of a preliminary order, (b) the service date of a denial of a petition for reconsideration from this preliminary order, or (c) the failure within twenty-one (21) days to grant or deny a petition for reconsideration from this preliminary order, any party may in writing support or take exceptions to any part of a preliminary order and may file briefs in support of the party's position on any issue in the proceeding with the Director. Otherwise, this preliminary order will become a final order of the agency.

REQUEST FOR HEARING

Unless a right to a hearing before the Department or the Water Resource Board is otherwise provided by statute, any person aggrieved by any final decision, determination, order or action of the Director of the Department and who has not previously been afforded an opportunity for a hearing on the matter may request a hearing pursuant to section 42-1701A(3), Idaho Code. A written petition contesting the action of the Director and requesting a hearing shall be filed within fifteen (15) days after receipt of the denial or conditional approval.

ORAL ARGUMENT

If the Director grants a petition to review the preliminary order, the Director shall allow all parties an opportunity to file briefs in support of or taking exceptions to the preliminary order and may schedule oral argument in the matter before issuing a final order. If oral arguments are to be heard, the Director will within a reasonable time period notify each party of the place, date and hour for the argument of the case. Unless the Director orders otherwise, all oral arguments will be heard in Boise, Idaho.

MEMORANDUM

TO Water Right 63-31235

FROM Cody Parker

RE Evaluation of Application for Transfer 89710

DATE June 23, 2025

On April 14, 2025, Gheen Christoffersen submitted application for transfer 89710, which proposes to add a point of diversion to a single municipal water right (63-31235) owned by the City of Homedale. The proposed location of the new well is 25 feet from the existing point of diversion in the same legal description (the SESW of Sec 34, Twp 02N Rge 05W).

The changes proposed in the application do not change the effect on the source or hydraulically connected sources and do not cause injury to other water users. The application is processed without legal notice.

AUTHORITY TO FILE

The current owner of record for water right 63-31235 is the City of Homedale. Gheen Christoffersen signed the application and is the mayor for the City. The applicant has the authority to request the change to the water right.

WATER RIGHT VALIDITY

Water right 65-31235 authorizes the use of ground water for municipal purposes. The City provides water to users within its service area. It is unlikely the City provides less water than is needed by the consumers. There are no concerns with validity of the water right.

INJURY TO OTHER WATER RIGHTS

The addition of a well in substantially the same location as the existing well should not cause injury to other water users as long as enlargement does not occur (see below). Neither the original, nor the proposed well are in any areas of concern including the Basin 63 groundwater restricted area. Well construction should not impact existing water rights on the Boise River.

Standard APOD conditions do not seem necessary in this case since both the original well and the new well are within the same legal description and no other wells are authorized.

ENLARGEMENT

Water right 63-31235, when combined with rights 57-7027, 57-7048, 57-7656, 57-10393, 57-11752, and 63-9260 is limited to 3.87 cfs. The original well associated with 63-31235 does not appear to be shared with any of these other water rights.

According to *Memo Re: Licensing Review for 63-31235* (2015) by Dan Nelson, the combined limit is based on the maximum diversion rate the City used at any one time from all the City's municipal wells during the development period.

The current data entry for water rights 63-31235 and 57-11752 show the limit to be 3.57 cfs rather than 3.87 cfs. The records for these water rights do not give any reason why the limit would have been changed since licenses were issued. The rights have not been transferred, nor were they split. On approval of transfer 89710, the combined-limit condition will be corrected in data entry. This is not an enlargement of the water rights.

Condition 01M will be added to all transferred and associated rights to require measurement upon notification by the Department. The condition will help to ensure the City is complying with the combined limits of the water rights.

LOCAL PUBLIC INTEREST

The use of groundwater for non-irrigation municipal water uses is in the local public interest. The water right was licensed with condition 102, which requires the use of available surface water before the ground water may be used for irrigation.

Adding condition 102 to the associated water rights is not appropriate because it is not necessary to ensure the change proposed by the transfer meets the criteria of § 42-222.

BENEFICIAL USE / CONSERVATION OF WATER RESOURCES

The application proposes to continue the use of water for municipal purposes within the quantities confirmed by water right license 63-31235.

DISCUSSION

Water rights 57-7027, 57-7048, 57-7656, 57-10393, 57-11752, and 63-9260 are brought into the transfer as associated rights due to the combined limit discussed in the Enlargement section above.

Water right 63-9260 has a separate condition limiting its use, when combined with 57-7027 and 57-10393 to 2.56 cfs. This condition does not limit the water rights to a rate below their face-value diversion rates. This condition will be removed from 63-9260 on approval of the transfer.