

RECEIVED

NOV 26 2024

IDWR / NORTH

STATE OF IDAHO

DEPARTMENT OF WATER RESOURCES

STATEMENT OF COMPLETION

FOR SUBMITTING PROOF OF BENEFICIAL USE

RECEIVED

DEC 02 2024

FOR OFFICE USE ONLY

Amt. of Fee \$ 50.00Receipt No. N045104Received By MBDate Received 11/26/24

The Idaho Department of Water Resources (Department) considers this form a statement that the permit holder(s) applied water to beneficial use and completed development of a water right to the extent described below. **This form must be accompanied by an examination fee, when necessary, or by a completed Beneficial Use Field Report prepared by a certified water right examiner (CWRE).** Please refer to the instructions and fee schedule for this form. If ownership of the permit has changed, complete a Notice of Change in Water Right Ownership form. If you wish to relinquish your permit because you have not established the authorized water use and are not applying for an extension, please notify the Department in writing.

1. Permit No. 95-17891 Name of Permit Holder(s) Michelle Gilkey Jewett; Ben Jewett

Telephone No. 425-344-5588 Email jewettm18@me.com

Mailing Address 904 W. Riverside Ave. #2141 City Spokane State WA Zip 99201

2. Source of Water Hayden Lake If Ground Water (well), Date Drilled mo. N/A / yr. N/A

Drilling Permit/Tag No. N/A Drilling Company's Name N/A

3. Extent of use(s) completed as authorized by the water right permit:

Domestic (No. households) 1 Irrigation (No. acres) <1 (0.83 acre) Stockwater (No. and stock type) N/A

Other N/A .06 MGJ

4. Total diversion rate or volume (storage only) for which proof is submitted 5779 cfs OR af
If the total developed water use is 5 acres of irrigation or less, is stockwater storage of 14.6 acre-feet or less, or has a diversion rate of less than 0.24 cfs, attach a map of the place of use and point of diversion and photographs showing beneficial use.

5. Describe the diversion and delivery system from the water source to the use (pump, lift, irrigation method, etc.)

SUBMERSIBLE LAKE PUMP (3HP, 35GPM) IF 30GPM CFS WOULD BE .0668

6. Permit condition compliance. Refer to the permit approval conditions and check all the items required, then check "Yes" or "No" to indicate whether the required items were established, submitted, and/or installed:

Required? Yes No (If "Yes", attach required data, evidence of compliance, or evidence of installation)

- | | | | |
|--------------------------|-------------------------------------|-------------------------------------|---|
| ☐ | ☐ | ☐ | Ground water level data, pumping information, or other diversion data |
| ☐ | ☐ | ☒ | Mitigation plan |
| ☐ | ☐ | ☒ | Lockable controlling works |
| ☐ | ☐ | ☒ | Measuring device |
| ☐ | ☒ | ☐ | Fish screen <u>(PVC ENCLOSURE)</u> |
| ☐ | ☐ | ☐ | Other requirements of the water right permit |
| ☐ | ☐ | ☐ | Reasonably Anticipated Future Needs ("RAFN") Municipal use |

If RAFN Municipal use, additional increment of beneficial use developed? ☐ Yes (attach CWRE report) ☐ No

7. Fee Enclosed \$ 50.00 or ☐ CWRE field report attached or ☐ No fee required
See fee schedule on page 3 of the instructions. Proof statements filed without an appropriate fee are incomplete.

8. Person to contact to accompany a Department representative during the field examination of the water system:

Name: Michelle Gilkey Jewett Telephone No. 425-344-5588 Email jewettm18@me.com

Mailing Address 904 W. Riverside Ave. #2141 City Spokane State WA Zip 99201

The information given on this form is my true statement of the extent to which the above numbered permit has been developed and water has been diverted and applied to beneficial use. I understand that any undeveloped portion of the permit is relinquished to the State of Idaho.

Michelle Gilkey Jewett
SIGNATURE OF PERMIT HOLDER*

Michelle Gilkey Jewett
PRINTED NAME AND TITLE


11/26/2024
DATE

*Attach power of attorney if completing on behalf of permit holder.


property owner

LAKE WATER PUMPING SYSTEM WITH IN-PIPE HEAT TAPE


DRAWING
L2

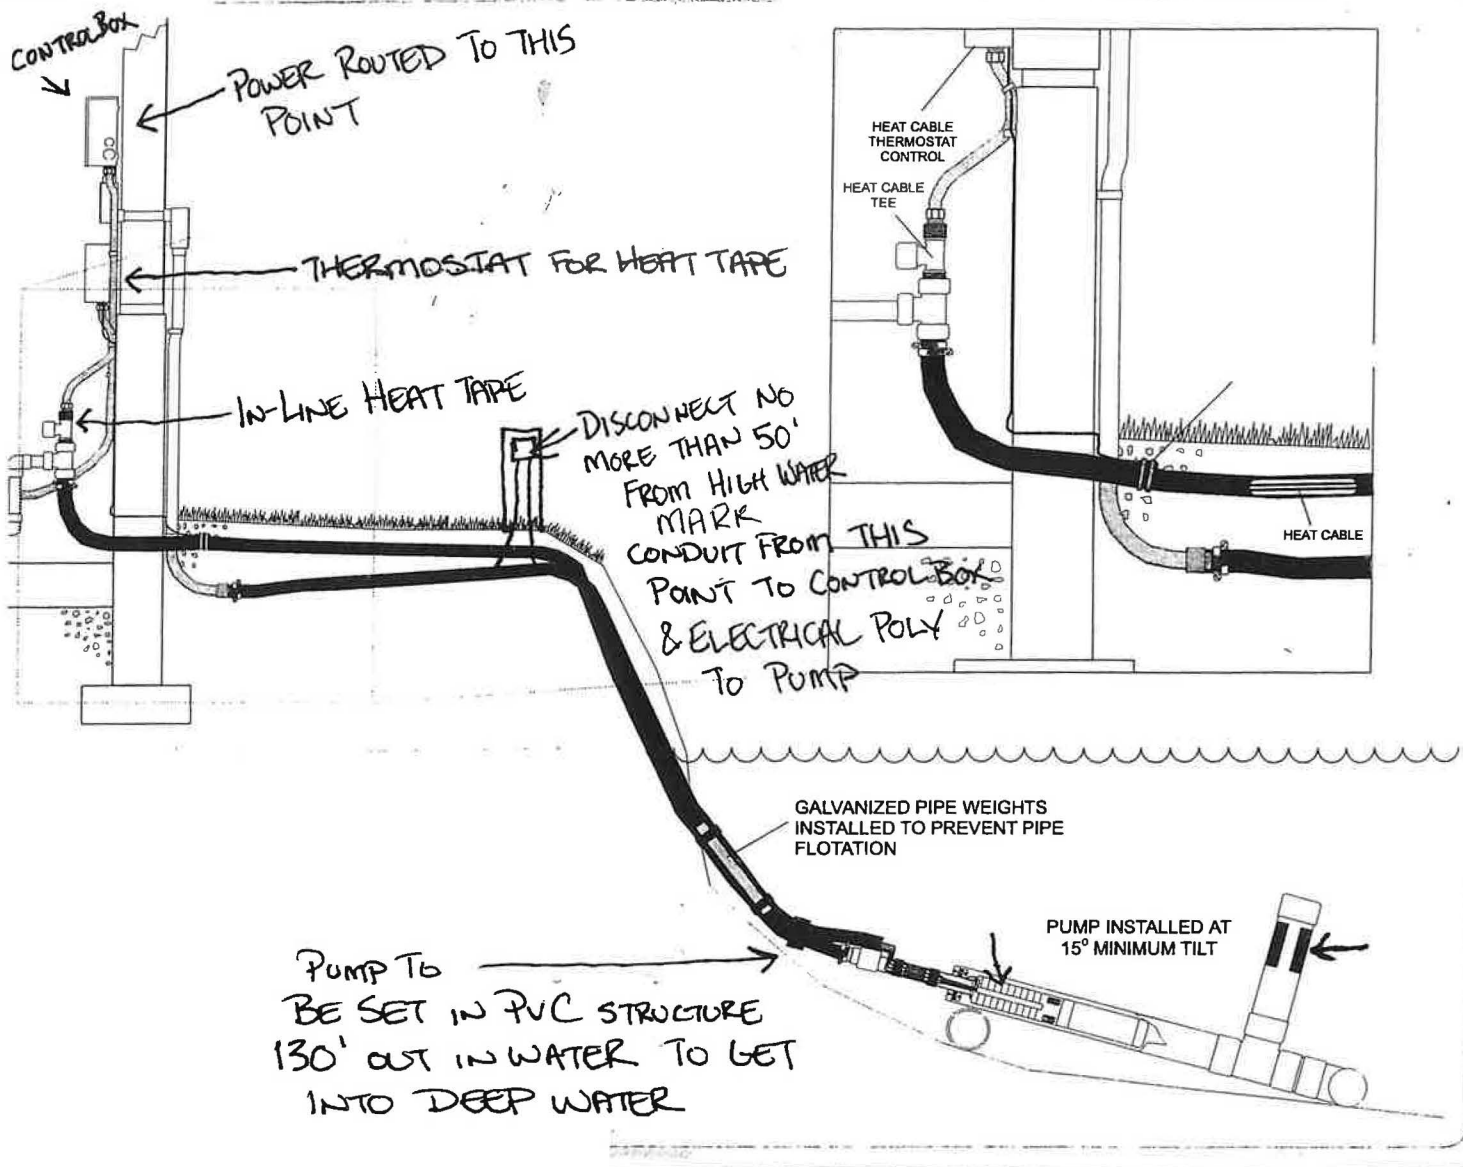

Rev 2/10/2000

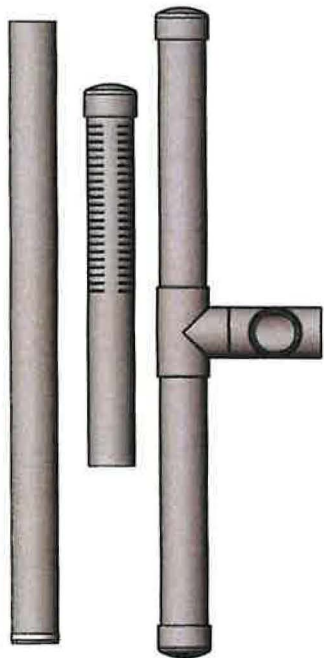

SHIPPING SUB-ASSEMBLIES

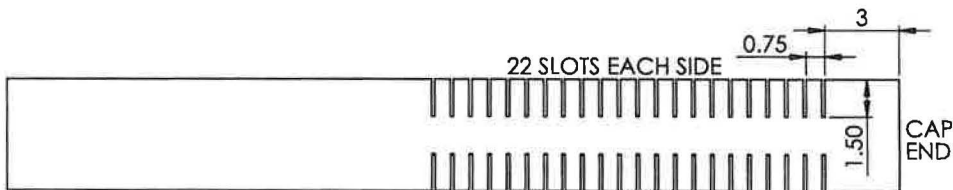

SLOT LAYOUT

NO.	QTY	PART NUMBER	DESCRIPTION
1	1	RCWSI40	1/8" SLOTS 4" BARREL
			3' PVC PIPE SCH40 BELL END 4"/44 EA 1/8" X 5.5" SLOTS
2	2	PVC401040	PVC 40 TEE SSS 4"
3	3	PVC447040	PVC 40 CAP S 4"
4	1	PVCP12540	60" PVC PIPE CL125 BELL END 4"
5	1	PVCP4040	4" PVC PIPE SCH40 BELL END 4"
6	2	PVCP4040	28" PVC PIPE SCH40 BELL END 4"
7	1	BITCP050	BAND-IT CLAMP SS 5" (5/8")
8	.5	WON705P025	WELD-ON CEMENT PVC CLR PT 1/4
9	.5	WONP70C025	WELD-ON PRIMER CLEAR PINT 1/4

