

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
IN-OFFICE REVIEW/BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Exam Date: 4/29/2025

1. Does this qualify for an in-office field exam (IDAPA 37.03.02.035.01.r)? ☒Y ☐N
- a. ☐ Irrigation of 5 acres or less
- b. ☐ Storage of up to 14.6 AF for stockwater purposes only
- c. ☒ Any use other than irrigation or storage, if the combined diversion rate is 0.24 cfs or less
- d. ☐ Other < >
2. Current Owner:
- Owner of Record Correct? ☒Y ☐N
- Address of Record Correct? ☒Y ☐N
- If No Explain:
3. Beneficial Use Fees have been paid: ☐Y ☐N Receipt No: No fee required per Idaho Code section 42.221.
4. Source: Ground Water Tributary: N/A

Method of Determination: GIS ArcMap Tools

Change in Source: ☐Y ☒N**B. OVERLAP REVIEW**

1. Other water rights with the same place of use:
- ☒
- X No Overlap

Water Right No.	Source	Purpose of Use	Basis
N/A	N/A	N/A	N/A

Comments:

2. Other water rights with the same point of diversion:
- ☒
- X No Overlap

Water Right No.	Source	Purpose of Use	Basis
N/A	N/A	N/A	N/A

Comments:

C. DIVERSION AND DELIVERY SYSTEM

1. Location of Point(s) of Diversion:

Source	Govt. Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.		County
Ground Water	4		NW	NW	2	46N	03W		Benewah

Method of Determination: GIS, Well D0082389

Change in POD? ☐Y ☒X ☐N Amendment Required? ☐Y ☒X ☐N

Place of Use: Domestic

TWP	RGE	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
46N	03W	2						X											
		Lot #						L4											

Method of Determination: GIS, Submitted map with permit showing location of residence.

Change in POU? ☐Y ☒X ☐N Amendment Required? ☐Y ☒X ☐N

3. Diversion System Information:

Description:

___ Delivery System Diagram Attached. (mark all major components and distances between components)

X Map Attached Showing Location(s) of point(s) of diversion and place(s) of use (required).

X Aerial Photo Attached (required)

___ Photo of Diversion and System Attached

3. Diversion Id No.*	Motor Make	HP	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
N/A	N/A	N/A	N/A	N/A	N/A

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1. Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
N/A	N/A	N/A	N/A	N/A	N/A	N/A

2. Measurement Comments: No measurement is required for an in-office examination per IDAPA 37.03.02.035.01.r.iii.

E. FLOW CALCULATIONS

___ Additional Computation Sheets Attached

Measured Method:

Domestic: 0.04 cfs is standard for domestic use for one home per Application Processing Memo #22.

Comments:

No measurement is required for an in-office examination per IDAPA 37.03.02.035.01.r.

F. VOLUME CALCULATIONS

Domestic: 1.2 acre-feet is standard for one home when irrigation is included per Application Processing Memo #22.

G. PURPOSE OF USE

Irrigation ___Y___X___N # Stock _____ Domestic # of Homes ___1___

Other: < >

Change in Purpose of Use? ___Y___X___N

Method of Determination: GIS and the permit holders Statement of Completion for Proof of Beneficial Use.

If Yes: From Use _____ To Use _____ Amount _____ CFS _____ AFA _____

H. NARRATIVE/REMARKS/COMMENTS

This permit qualifies for an in-office exam because it is for one home and domestic use and the total diversion is less than 0.24 cfs. The exam was conducted April 29, 2025 by Collin Macheel. At the time of the exam, ownership of the permit is in the name of Rustin and Tina Young. Benewah County tax lot data represents the permit holders own the land appurtenant to the place of use (POU) and point of diversion (POD). Proof of Beneficial Use was submitted on April 25, 2025.

The original application for permit was submitted for an existing well, identified as the POD. The POU was identified as a domestic supply for the planned residence and for irrigation of less than 0.5 acres of the surrounding area within the parcel. The residential structure was completed prior to the Beneficial Use Proof date. Irrigation of less than 0.5 acres is included in domestic use per Idaho Code section 42.111. Therefore, I am recommending 0.04 cfs for the diversion rate and 1.2 acre-feet for the annual volume of domestic use.

Conditions 26A and 046 were removed as they pertain to drilling activities which have been completed prior to the Beneficial Use Proof date. Condition 004 will also be removed because property concerns do not appear to be an issue. All other conditions on the permit will be carried over to the license.

Have conditions of permit approval been met? ☒ Yes ☐ No

I. RECOMMENDATIONS

1. Recommended Amounts:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL VOLUME</u>
Domestic	01/01-12/31	0.04 cfs	1.2 AF
<u>Totals:</u>		0.04 cfs	1.2 AF

2. Recommended Amendments:


☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None

☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☒ None

Other: < >

J. AUTHENTICATION – Collin Macheel

Field Examiner's



Date

4-29-25

Reviewer



Date

9/5/25



Figure 1 Benewah County Parcel viewer showing parcel. 2023 Imagery.

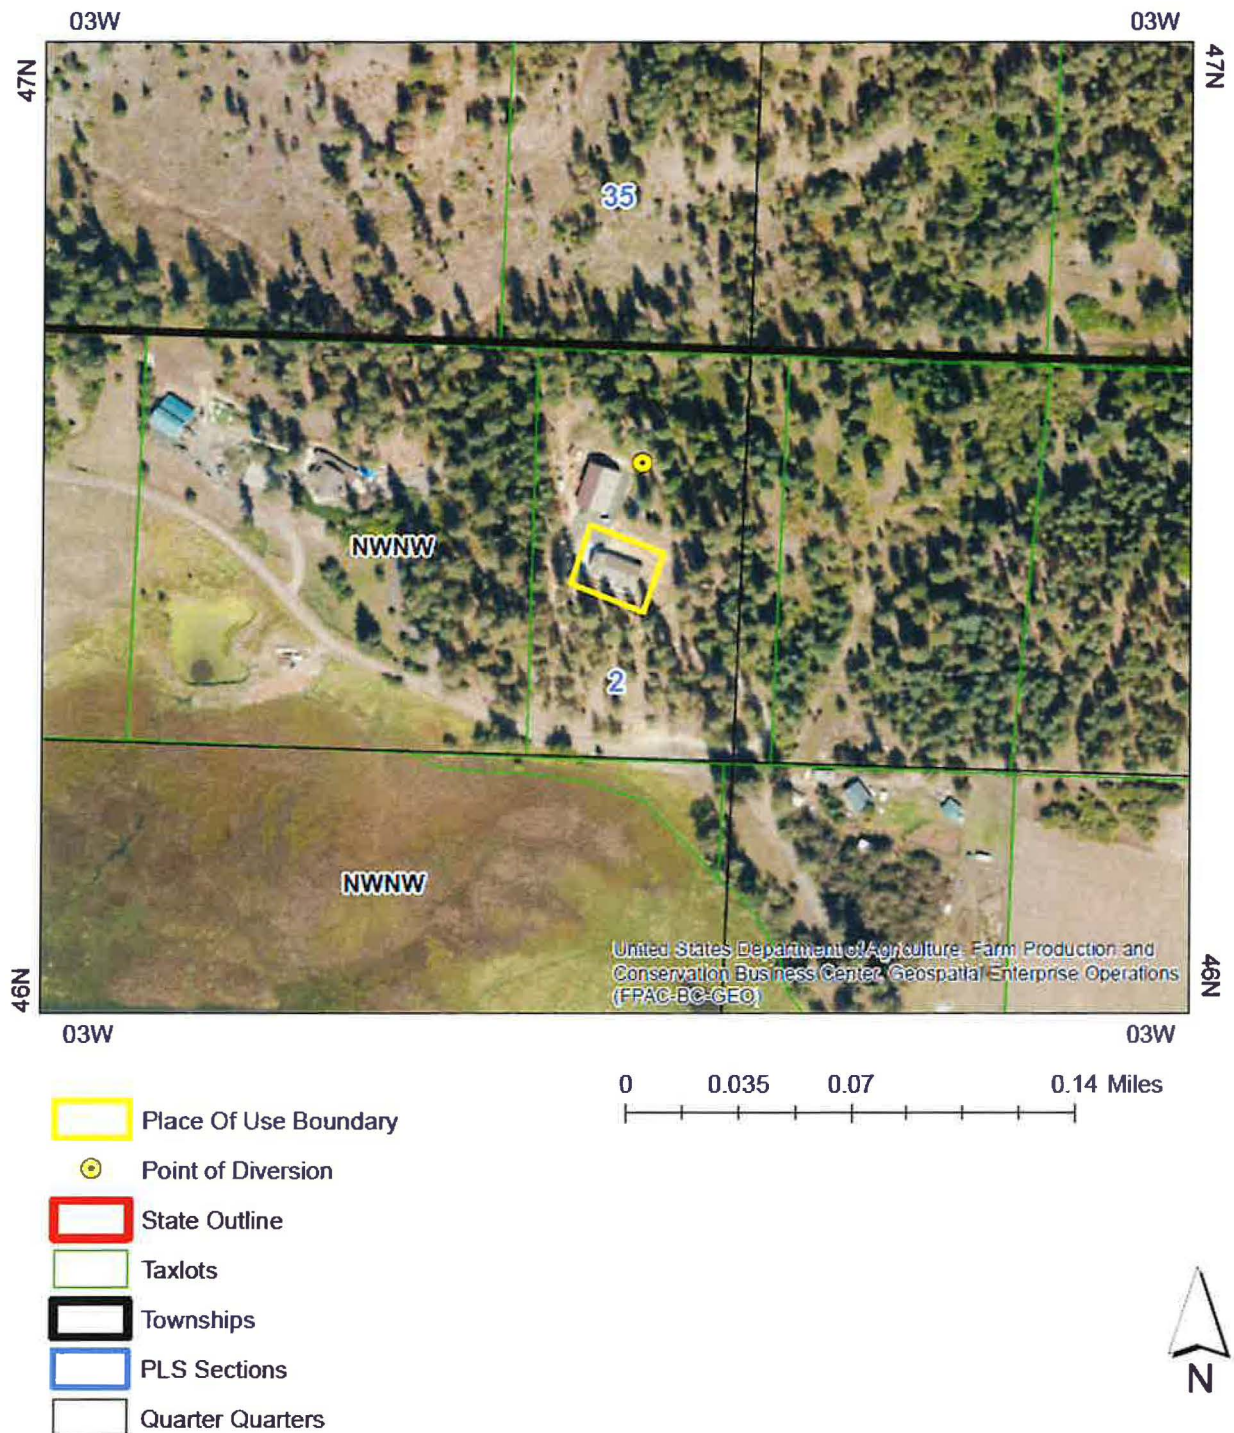


Figure 2 Map showing the authorized point of diversion (yellow point) and place of use (yellow outline).