

# Preparation of SRBA Water Right Recommendations for Municipal Claims in the Treasure Valley

Dave Tuthill  
IDWR Adjudication Bureau Chief

May 14, 2004





# Outline

- ◆ Principles of Municipal Water Rights
- ◆ Unique Aspects of Municipal Water Rights
- ◆ Legal Considerations for Municipal Water Rights
- ◆ Review Process for City of Pocatello
- ◆ What Happens to the Municipal Water Right for an Unused System?
- ◆ Review Process for Treasure Valley Municipalities
- ◆ Timeline
- ◆ Discussion

# Principles of Municipal Use Water Rights

- ◆ Are measured by rate of flow (diversion periods can increase from periodic to continuous under one water right)
- ◆ Do not have a defined volume parameter
- ◆ Have a place of use “Service Area”
  - Defined by the IPUC statutes and rules for a utility
  - Defined by city boundary or service agreement for a municipality
  - Shown as a GIS shape file for SRBA recommendations
  - Can be changed without a transfer

# Adjudication

Internet Map Server

**Map Tools**

- Home
- Back
- Forward
- Stop
- Search
- Print
- Full Screen
- Help

**Water Resources**

Disclaimer

**Layers Legend**

Visible Active


- ☐ ☐ Point of Diversion - Recommended
- ☒ ☒ Place of Use - Recommended
- ☐ ☐ Point of Diversion - Claim
- ☐ ☐ Place of Use - Claim
- ☒ ☐ Cities
- ☒ ☐ Administrative Basins
- ☐ ☐ quarter/quarter
- ☐ ☐ sections
- ☐ ☐ Township and Range
- ☐ ☐ Ground Water Management Areas
- ☐ ☐ Critical Ground
- ☐ ☐ Water Management Areas
- ☐ ☐ 1:100k DRG
- ☒ ☐ Adjudication Imagery
- ☐ ☐ Irrigation Companies (1975)

Refresh Map

| Place of Use - Recommended |           |       |              |        |         |          |            |            |           |                 |              |               |           |
|----------------------------|-----------|-------|--------------|--------|---------|----------|------------|------------|-----------|-----------------|--------------|---------------|-----------|
| Rec                        | Shape     | Basin | Sequence No. | Suffix | Version | Use Code | Acre Limit | First Name | Last Name | Organization    | Source       | Priority Date | Right No. |
| 1                          | [polygon] | 37    | 4080         |        | 1       | 40       |            |            |           | CITY OF GOODING | GROUND WATER | Sep 28 1928   | 555718    |

**Zoom Out**

Point of Diversion and Place of Use data last updated January 22, 2002.

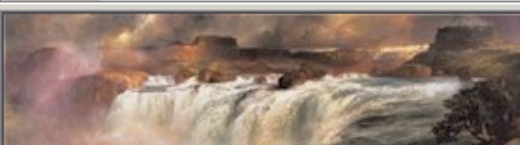

## Idaho Department of Water Resources

Internet Map Server



|                                 |  |                 |
|---------------------------------|--|-----------------|
| IDWR - created with ESRI ArcGIS |  |                 |
|                                 |  | CITY OF GOODING |
|                                 |  | CITY OF GOODING |
|                                 |  | CITY OF GOODING |
|                                 |  | CITY OF GOODING |

## Layers Legend

- ☐ ☐ Point of Diversion - Recommended
- ☒ ☒ Place of Use - Recommended
- ☐ ☐ Point of Diversion - Claim
- ☐ ☐ Place of Use - Claim
- ☒ ☐ Cities
- ☒ ☐ Administrative Basins
- ☐ ☐ sections
- ☐ ☐ Township and Range
- ☐ ☐ Ground Water Management Areas
- ☐ ☐ Critical Ground Water Management Areas
- ☐ ☐ 1:100k DRG
- ☒ ☐ Adjudication Imagery
- ☐ ☐ Irrigation Companies (1975)

Refresh Map

Find

Point of Diversion and Place of Use records last updated 06/24/02




Internet

# Unique Aspects of Municipal Water Rights

- ◆ Have unusual flexibility
  - “Growing Community Doctrine”
  - “Water Planning Horizons”
- ◆ Can be shown to be interconnected in the SRBA, to the extent a common system was developed by November 19, 1987, and claimed as an accomplished transfer

Result: Two water rights,  
each has two points of diversion  
serving a common place of use

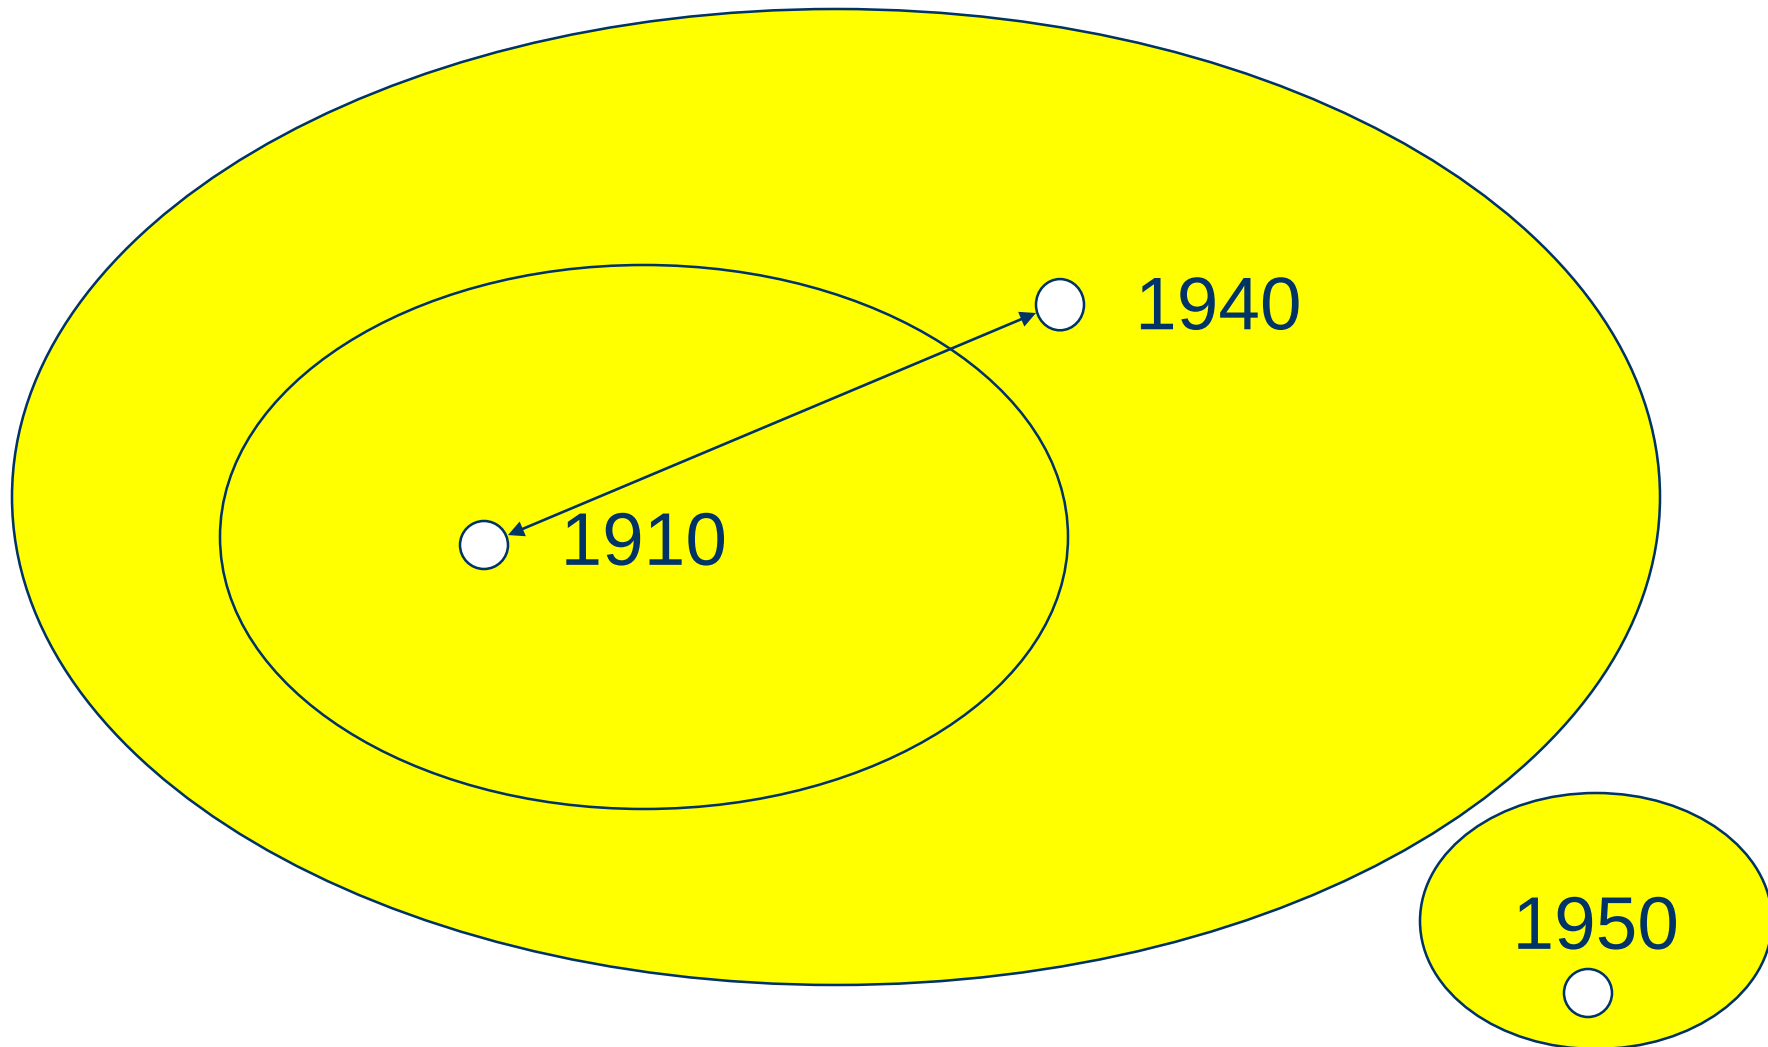

# Legal Considerations

- ◆ Reasonable Anticipated Future Needs” *City of Pocatello v. Murry*, 206 F. 72, (D. Idaho 1913) – recognized the elastic needs of a growing municipality
- ◆ *Beus v. City of Soda Springs*, 62 Idaho 1, 107 P.2d 151 (1940), upheld right to purchase water rights from agricultural uses and the city may hold them for future municipal needs. Did not need to maintain an irrigation use in the meantime to avoid forfeiture.
- ◆ *Village of Peck v. Denison*, 92 Idaho 747 (1969) -- Court upheld the right of the village to obtain an unquantified water right for “all the source.”

# Statutory Considerations

- ◆ Municipal Water Rights Act of 1996 42-202(2), 202B, 217(4), 219, 222(1), 223(2), 43-335 & 338.
- ◆ Codified the growing communities doctrine and established specific procedures and limitations governing a municipality's ability to acquire water rights (by appropriation or transfer) for long term growth (does not apply retroactively to SRBA recommendations)

# Section 42-202

- (2) An application proposing an appropriation of water by a municipal provider for **reasonably anticipated future needs** ...

Such applications are beyond the scope of the SRBA and review of these applications is not addressed in this presentation. The SRBA is intended to quantify the *historic* water rights – prior to the SRBA commencement.

# Section 42-202b

- (4) "**Municipality**" means a city incorporated under section 50-102, Idaho Code, a county, or the state of Idaho acting through a department or institution. (5) "**Municipal provider**" means: (a) A municipality that provides water for municipal purposes to its residents and other users within its service area; (b) Any corporation or association holding a franchise to supply water for municipal purposes, or a political subdivision of the state of Idaho authorized to supply water for municipal purposes, and which does supply water, for municipal purposes to users within its service area; or (c) A corporation or association which supplies water for municipal purposes through a water system regulated by the state of Idaho as a "public water supply" as described in section 39-103(10), Idaho Code.

## Section 42-202b (cont.)

- 6) "Municipal purposes" refers to water for residential, commercial, industrial, irrigation of **parks and open space**, and related purposes, excluding use of water from geothermal sources for heating, which a municipal provider is entitled or obligated to supply to all those users within a service area, including those located outside the boundaries of a municipality served by a municipal provider.

## Section 42-202b (cont.)

- (9) "Service area" means that area within which a municipal provider is or becomes entitled or obligated to provide water for municipal purposes. For a municipality, the service area shall correspond to its corporate limits, or other recognized boundaries, including changes therein after the permit or license is issued. The service area for a municipality may also include areas outside its corporate limits, or other recognized boundaries, that are within the municipality's established planning area if the constructed delivery system for the area shares a common water distribution system with lands located within the corporate limits. For a municipal provider that is not a municipality, the service area shall correspond to the area that it is authorized or obligated to serve, including changes therein after the permit or license is issued.

# Accomplished Change in Nature of Use

## ◆ Example

- Water right acquired by individual for irrigation of 10 acres
- Municipal provider acquires right in 1980 and continues to irrigate parcel
- Water right claimed in SRBA as municipal use
- Recommendation: Depends on use. If used for irrigation of “parks and open space” then recommend as municipal. If use remains as agriculture, then recommend as irrigation.

# Review Process Used for City of Pocatello

- ◆ The city was required to provide:
  - documentation of the priority date and flow rate of the claimed water use if not covered by a licensed right.
  - the history of the development of the municipal water system segregating new development from replacement facilities
  - the history of the development of water systems acquired by the municipal provider but developed by another entity
  - a map of the service area
  - historic pumping records

# Review Process Used for City of Pocatello

- ◆ The city was required to provide
  - A map showing the location of each point of diversion and the distribution system as it existed on November 19, 1987. This was because the city claimed all of their points of diversion on all of their rights as accomplished transfers under Section 42-1425, Idaho Code.

# Review Process Used for City of Pocatello

- ◆ A theme in the City of Pocatello ArcView project was created for all of the points of diversion that were interconnected as of November 19, 1987.
- ◆ Additional themes were added to the City of Pocatello project for the non-interconnected points of diversion.
- ◆ Water rights that were licensed or transferred after November 19, 1987 were recommended as licensed or transferred.
- ◆ Multiple Excel spreadsheets and Word documents were created to assist in the analysis of the data provided by the city



# Analysis Spreadsheets



- ◆ Applications
- ◆ Permits
- ◆ Licenses
- ◆ Beneficial Use Rights
- ◆ Claimed Points of Diversion
- ◆ Active Wells
- ◆ Interconnected Wells
- ◆ Recommendations

## Excel Spreadsheet Analysis Information

[illegible]



# Claim Investigation Tools

- ◆ Claims
- ◆ Aerial Photos
- ◆ Information Provided by the Claimant
- ◆ Information Obtained from the Internet
- ◆ GIS information (exchanged)

# Information Obtained from the Internet (sample)

## **The Need for Water in a Semi-Desert City**

Early Pocatello used the Portneuf River for all its water needs. Hemmed in by the reservation, and severely so until 1888, the railroad junction had other problems than a pure source of water. Since the site was a barren sagebrush flat and covered with fine loess soil, the perennial late summer winds made it a dusty and scruffy place.

## **Pocatello Portrait and the Water System**

The book "Pocatello Portrait" by H. Leigh Gittins, chronicles the early history of the city and especially the water system. A group supported by banker James A. Murray of Butte, Montana developed the first water supply in Pocatello in 1892, from Gibson Jack and Mink Creeks. Parts of the flume can be still seen on the north side of Mink Creek. A reservoir was built on the West Bench, and trees were planted. After fifteen years, this had become a "beautiful park-like area." In 1893, the city attempted to buy the system from Murray, but the matter was defeated by the city council. As was predicted at the time, this was an expensive mistake for the growing city. Murray was never anxious to spend his money to upgrade the system and conflict continued for twenty years. In 1898, an outbreak of typhoid fever caused alarm, as did the customary finding of dead gophers, toads, and rotting debris in the screens in the reservoir. In 1898 the City Council established water rates favorable to Mr. Murray, and for a time he and his water superintendent George Winter took better care of his system. In 1899, the city council passed an ordinance to contract for sprinkling of parts of the downtown streets. Since no one had water meters, excessive use could not be controlled, and summertime water shortages were standard procedure. A fire during a time of low water pressure would have been disastrous. The Union Pacific Railroad provided water from Batiste Springs west of town during emergencies.

# Well Interconnection Analysis (part)

## CITY OF POCATELLO 1987 INTERCONNECTED WELLS

To the extent necessary for administration, water was first appropriated or used from:

Pocatello Well No. 2 located in T07S, R34E, S01, NWNE,  
on 12/31/1926 in the amount of 3.12 cfs

Pocatello Well No. 3 located in T07S, R34E, S01, SWNE,  
on 12/31/1926 in the amount of 4.23 cfs.

Pocatello Well No. 7 located in T06S, R34E, S35, NWNE,  
on 12/31/1940 in the amount of 4.46 cfs.

Pocatello Well No. 10 located in T06S, R34E, S26, NENW,  
on 6/15/1948 in the amount of 5.35 cfs.

Pocatello Well No. 12 located in T06S, R34E, S35, SENE,  
on 9/1/1953 in the amount of 6.20 cfs.

Pocatello Well No. 13 located in T07S, R34E, S01, SESE,  
on 9/1/1953 in the amount of 2.22 cfs, and on 10/16/1958 for an additional amount of 0.89 cfs.

Pocatello Well No. 14 located in T07S, R35E, S07, NESW,  
on 12/31/1955 in the amount of 0.22 cfs.


Pocatello Well No. 15 located in T07S, R35E, S06, NWSE,  
on 9/1/1953 in the amount of 1.11 cfs, and on 2/24/1977 for an additional amount of 2.23 cfs.


Pocatello Well No. 16 located in T06S, R34E, S26, SWSE,  
on 10/16/1958 in the amount of 6.67 cfs.

Pocatello Well No. 18 located in T06S, R34E, S15, NENW,  
on 10/16/1958 in the amount of 4.66 cfs.

**To the extent necessary for  
administration between points of  
diversion for ground water; and  
between points of diversion for  
ground water and hydraulically  
connected surface sources, water  
was first appropriated or used  
(diverted) from:**

# Map Supplied by the City of Pocatello

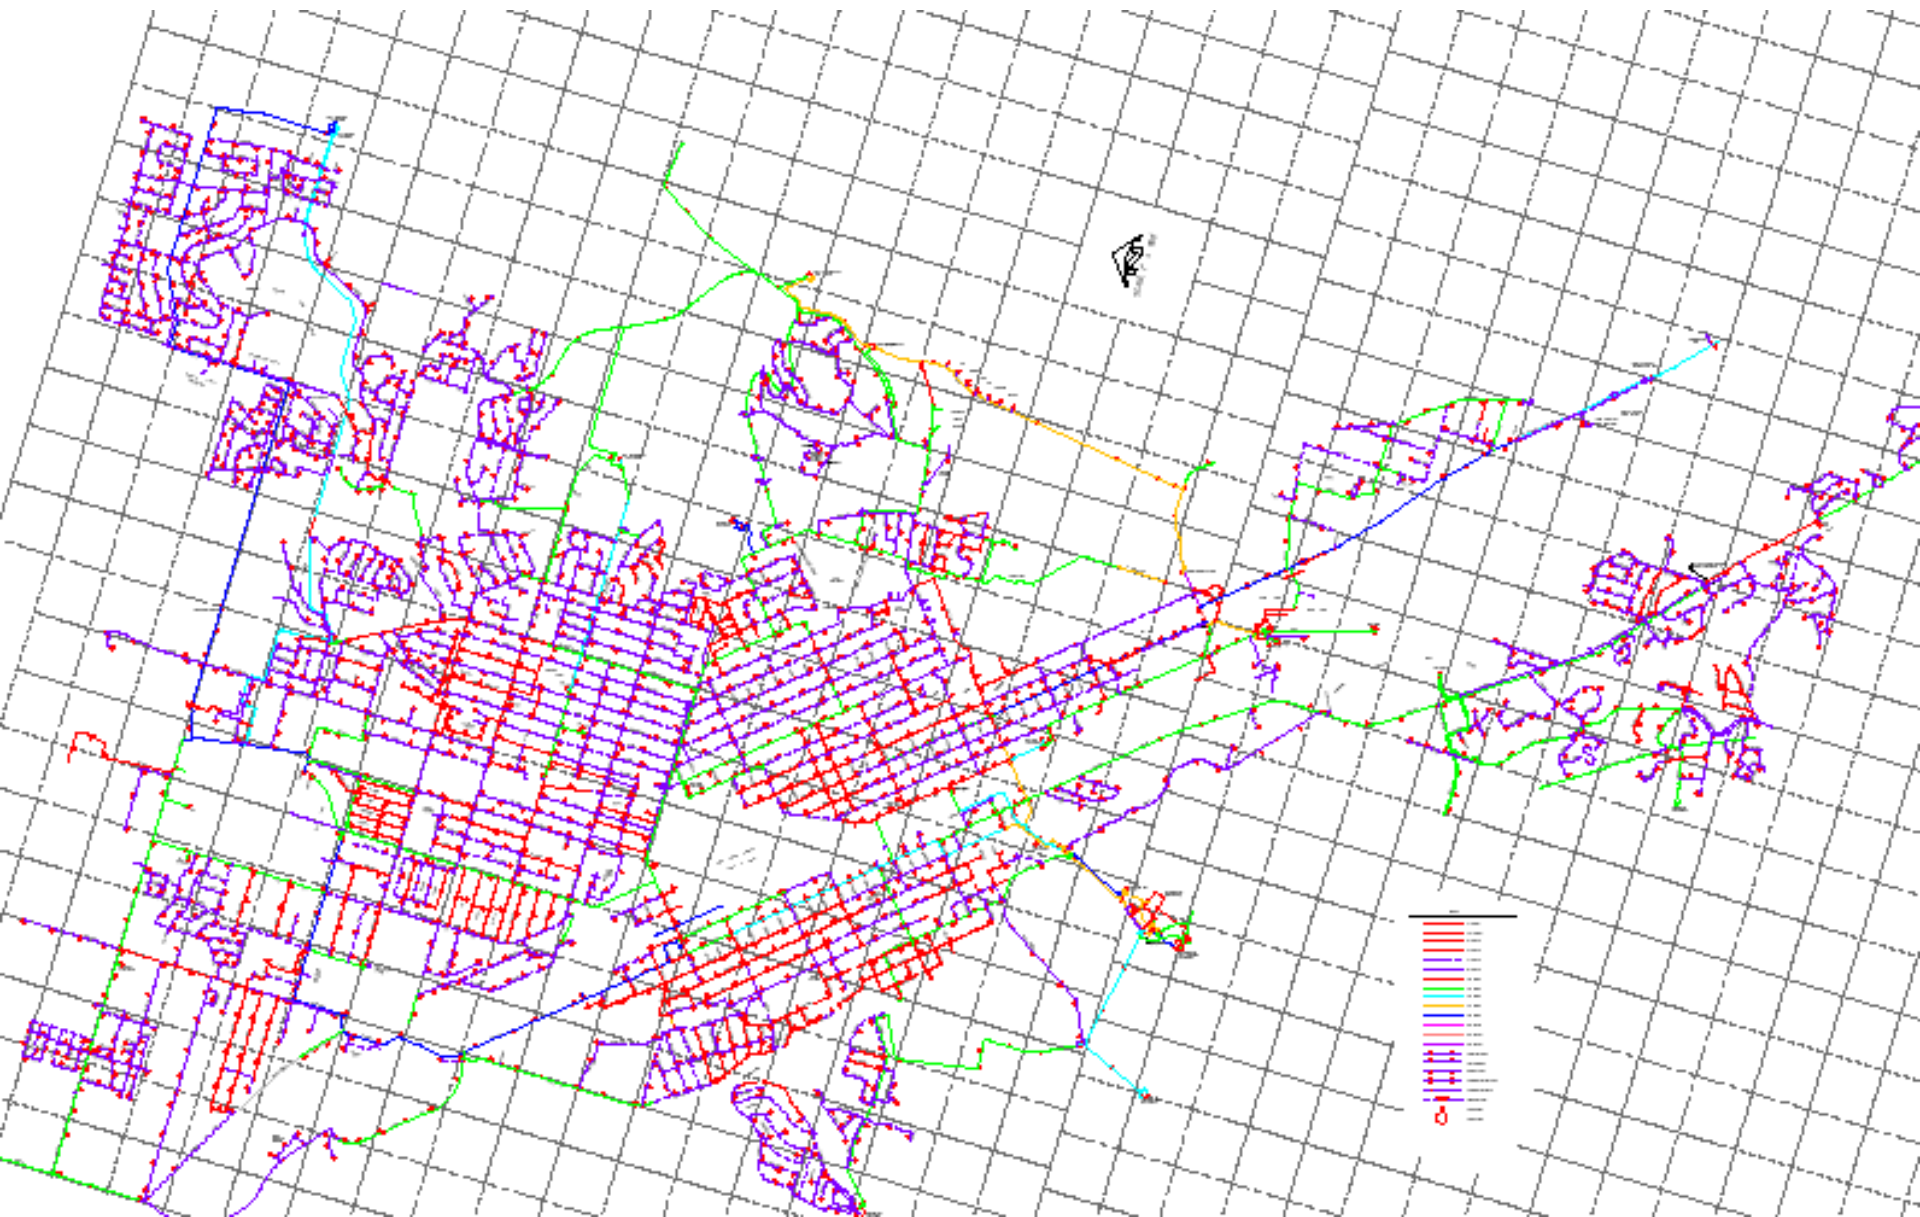


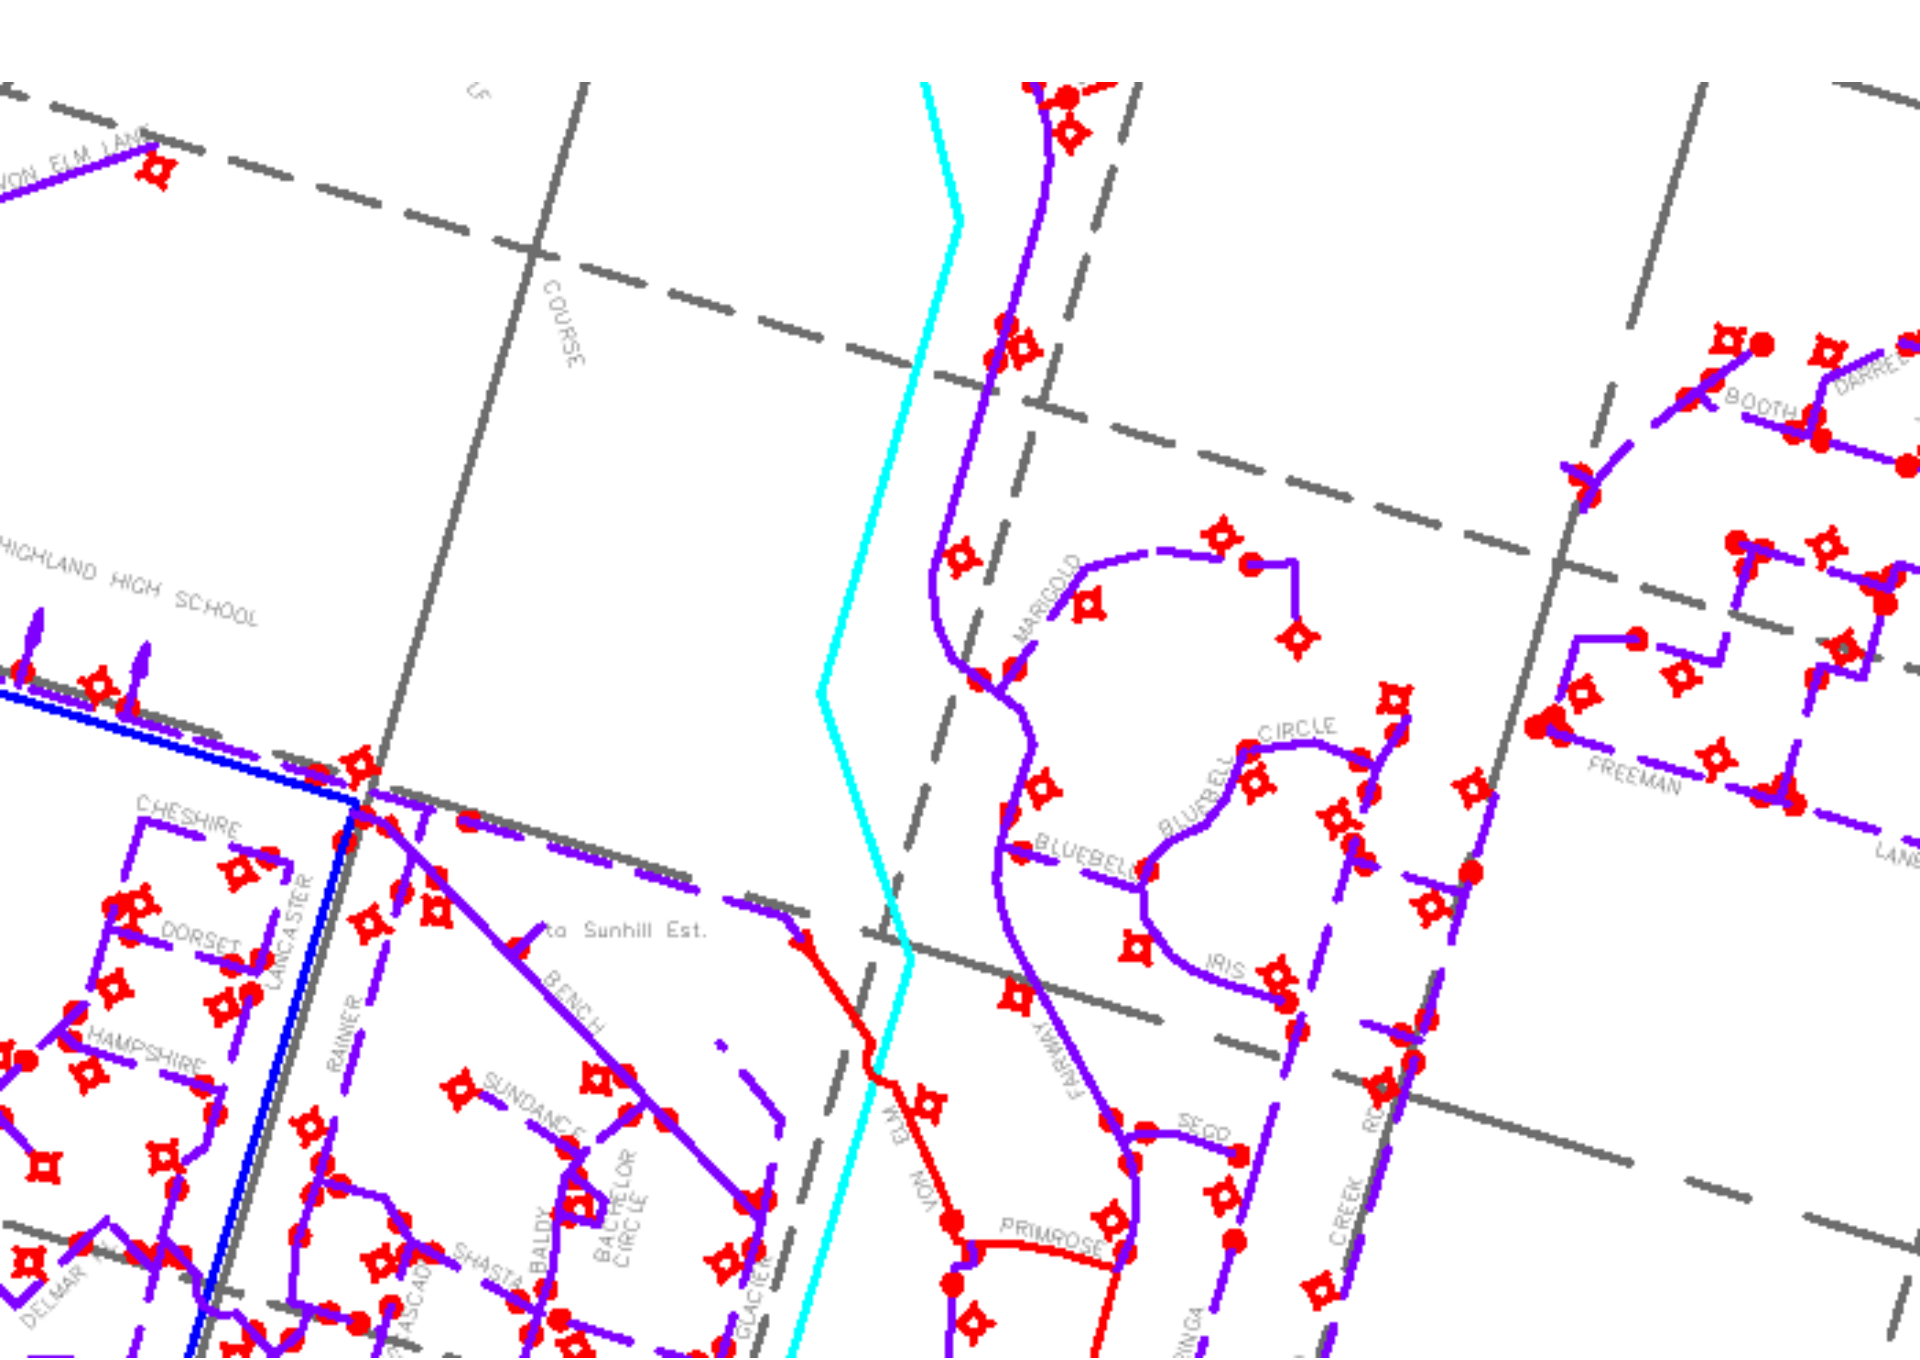

# Information Provided by the City of Pocatello

| City of Pocatello Ground Water Development Timeline<br>April 25, 2003 |                          |                         |                                                                                       |                               |                                                                                                                                                                                                                                                                                                                                                                            |
|-----------------------------------------------------------------------|--------------------------|-------------------------|---------------------------------------------------------------------------------------|-------------------------------|----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Priority date                                                         | Amount by priority (cfs) | Cumulative amount (cfs) | IDWR Reference                                                                        | Well #                        | Explanation showing ground water use development over time                                                                                                                                                                                                                                                                                                                 |
| 1905                                                                  | 1.34                     | 1.34                    | 29-2324                                                                               | A 1                           | Alameda well 1 (replaced by well #29 in 1972)                                                                                                                                                                                                                                                                                                                              |
| 1925                                                                  | 0.96                     | 2.3                     | 29-2324                                                                               | A 2                           | Alameda well 2 (replaced by well #29 in 1972)                                                                                                                                                                                                                                                                                                                              |
| 1926                                                                  | 9.13                     | 11.43                   | 29-2274                                                                               | 1, 2, 3                       | Establish capacity and demonstrate use of facilities on Pocatello wells # 1 (2.45 cfs), 2 (2.45 cfs), 3 (4.23 cfs)                                                                                                                                                                                                                                                         |
| Aug. 31 1931                                                          | 4.23                     | 15.66                   | 29-2274                                                                               | 4                             | Establish additional capacity: Pocatello well # 4 (4.23 cfs, using pump from # 3 with no intent to abandon well #3). Continue use of Pocatello wells # 1, 2                                                                                                                                                                                                                |
| 1934-1936                                                             | 0                        | 15.66                   | 29-2274                                                                               | 5                             | No change in capacity: abandon well # 1 and replace with well # 5; using wells # 4 (transfer pump # 1), 5 (transfer pump # 2 with no intent to abandon well # 2); pump 3 sold to Idaho Falls                                                                                                                                                                               |
| 1936                                                                  | 2.45                     | 18.11                   | 29-2274                                                                               | 6                             | Establish additional capacity: well # 6 (2.45 cfs with new pump); continue use of wells # 4, 5                                                                                                                                                                                                                                                                             |
| 1939                                                                  | 0                        | 18.11                   |                                                                                       |                               | No change in capacity: well # 3 reactivated                                                                                                                                                                                                                                                                                                                                |
| Dec. 31 1940                                                          | 10.34                    | 28.45                   | 29-2274<br>29-2338<br>29-2324                                                         | 7,<br>39 (Ph 1),<br>22 (A 3)  | Establish additional capacity: well # 7 completed (pump capacity of 2000 gpm or 4.46 cfs); well #39 or Phillips 1 (2.2 cfs); well #22 or Alameda well 3 (3.68 cfs)                                                                                                                                                                                                         |
| Dec. 31 1942                                                          | 1.92                     | 30.37                   | 29-2338                                                                               | 40 (Ph 2)                     | Establish additional capacity: Well #40 or Phillips 2 (1.92 cfs; Report of Eng for amount; Evidence binder supports priority date)                                                                                                                                                                                                                                         |
| June 1 1943                                                           | 2.67                     | 33.04                   | 29-4221                                                                               | PIP                           | Establish additional capacity: well PIP (2.67 cfs; Evidence binder supports priority date)                                                                                                                                                                                                                                                                                 |
| 1947                                                                  | 0                        | 33.04                   |                                                                                       |                               | No change in capacity: well # 8 drilled but infrastructure completed and well put into use in 1948                                                                                                                                                                                                                                                                         |
| June 15 1948                                                          | 9.69                     | 42.73                   | 29-2274: 1948 Permit; 1953 Proof of C/W due; 1959 Notice of BU due; 1954 Field Report | 2 (add'l cfs)<br>8<br>9<br>10 | Establish additional capacity: well # 2 reactivated (additional .67 cfs for total of 3.12 cfs); well # 8 (2.67 cfs; larger pump installed before Notice of Completion of Works due [4/25/53] on 1948 permit; see 1954 field exam); well # 9 drilled in 1948 (450 gpm pump by 1952 = 1 cfs); well # 10 (5.35 cfs pump capacity). Well # 3 redrilled; no change in capacity. |


# City of Pocatello Wells

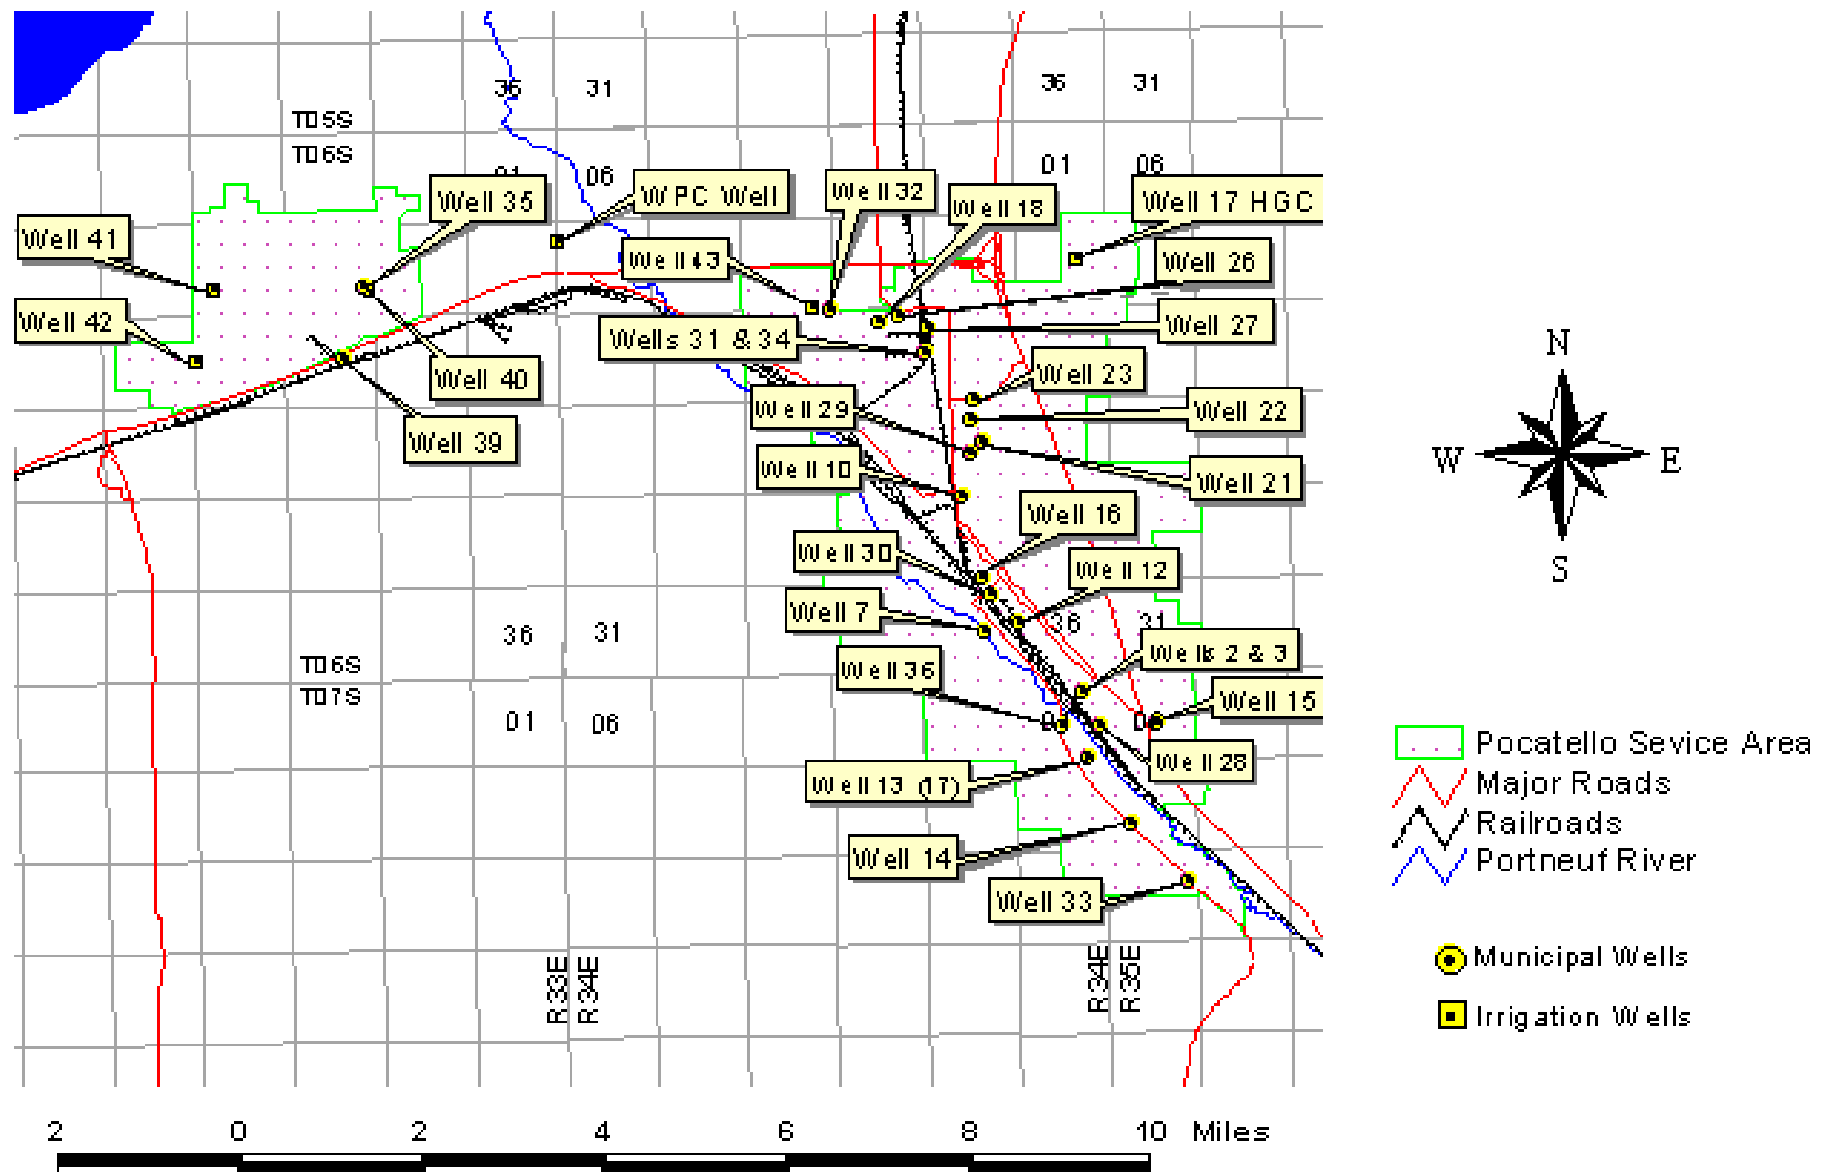


# Recommended Rights – Diversion Rate by Well

| Recommendation    | Rate | Recommendation      | Rate | Well ID | Use - 1987         | 1987 Map | 988 Rate | Well AKA               | Trans. No. 5 | Claimed Div. F | Claim No.          | Notes                        |
|-------------------|------|---------------------|------|---------|--------------------|----------|----------|------------------------|--------------|----------------|--------------------|------------------------------|
| 29-13560          | 2.2  |                     |      | Well01  | None               | No       |          |                        |              |                |                    | Well 01 abandoned in 195     |
| 29-13560          | 3.1  |                     |      | Well02  | Municipal          | Yes      | 2.82     | Ross Park              |              | 2.45 + 0.67    | 29-13560 & 29-2274 | Well 02 metered at 3.12 cfr  |
| 29-13560          | 3.1  |                     |      | Well03  | Municipal          | Yes      | 3.89     | Ross Park              |              | 4.23           | 29-13560           | Well 03 metered at 3.12 cfr  |
| 29-13561          | 2.2  |                     |      | Well04  | None               | No       |          |                        |              |                |                    | Well 04 metered at 3.12 cfr  |
| See 29-13560      |      |                     |      | Well05  | None               | No       |          |                        |              |                |                    | Replaced Well 01. Well 05    |
| 29-13562          | 2.2  |                     |      | Well06  | None               | No       |          |                        |              |                |                    | Well 06 metered at 2.22 cfr  |
| 29-11343          | 2.2  |                     |      | Well07  | None               | No       |          |                        |              |                |                    | Well 07 metered at 2.22 cfr  |
| 29-2274           | 3.3  |                     |      | Well08  | None               | No       |          |                        |              |                |                    | Well 08 metered at 3.34 cfr  |
| 29-2274           | 1    |                     |      | Well09  | None               | No       |          |                        |              |                |                    | Well 09 metered at 1.00 cfr  |
| 29-2274           | 5.4  |                     |      | Well10  | Municipal          | Yes      | 7.62     |                        | Yes          | 5.35           | 29-2274            | Well 10 metered at 5.35 cfr  |
| 29-11342          |      |                     |      | Well11  | Irrigation         | No       |          |                        |              |                |                    | Well 11 metered at 1.00 cfr  |
| 29-2338           | 6.2  |                     |      | Well12  | Municipal          | Yes      | 6.26     |                        | Yes          | 6.2            | 29-2338            |                              |
| 29-2338           | 2.2  | 29-2401             |      | Well13  | Municipal          | Yes      |          | Well 17 Riverbide G.O. | Yes          | 2.22 + 0.89    | 29-2338 & 29-2401  | 2.22 cfr of 29-2338 is from  |
| 29-4226           |      |                     |      | Well14  | Municipal          | Yes      | 0.86     | Cross                  |              | 1.22           | 29-4226            |                              |
| 29-2338           | 1.1  |                     |      | Well15  | Municipal          | Yes      |          |                        |              | 1.11 + 2.23    | 29-2338 & 29-7375  | 1.11 cfr of 29-2338 is from  |
| 29-2401           |      |                     |      | Well16  | Municipal          | Yes      | 5.05     |                        |              | 6.67           | 29-2401            |                              |
| 29-2382           |      |                     |      | Well17  | Irrigation         | Yes      |          | Highland G.O.          |              | 3.82           | 29-2382            |                              |
| 29-2401           |      |                     |      | Well18  | Municipal          | Yes      | 4.87     |                        |              | 4.66           | 29-2401            |                              |
| 29-2401           |      |                     |      | Well19  | ?                  | No       |          | Souage Disposal Plant  |              | 0.8            | 29-2401            |                              |
|                   |      |                     |      | Well20  |                    |          |          | See Well 28            |              |                |                    |                              |
| 29-4224           |      |                     |      | Well21  | Municipal          | Yes      | 3.52     | Alameda Well 04        |              | 3.89           | 29-4224            |                              |
| 29-11343          |      |                     |      | Well22  | Municipal          | Yes      | 1.94     | Alameda Well 03        |              |                |                    |                              |
| 29-4225           |      |                     |      | Well23  | Municipal          | Yes      |          | Alameda Well 05        |              | 4.44           | 29-4225            |                              |
| ?                 |      |                     |      | Well24  |                    | No       |          |                        |              |                |                    |                              |
| ?                 |      |                     |      | Well25  |                    | No       |          |                        |              |                |                    |                              |
| 29-4221           |      |                     |      | Well26  | Municipal          | Yes      | 2.65     | PIP                    |              | 2.67           | 29-4221            |                              |
| 29-2499           |      |                     |      | Well27  | Municipal          | Yes      | 3.62     |                        |              | 4.1            | 29-2499            |                              |
| 29-11348          |      |                     |      | Well28  | Municipal          | Yes      | 4.03     | Well 20 Turner         |              | 4.9            | 29-11348           |                              |
| 29-7106           |      |                     |      | Well29  | Municipal          | Yes      | 5.56     |                        |              | 3.9            | 29-7106            | 6.20 cfr - 1.34 cfr for 29-  |
| 29-7322           |      |                     |      | Well30  | Municipal          | Yes      | 4.75     |                        |              | *              | 29-7322            | 17.07 cfr from Wells 30, 3   |
| 29-7322           |      |                     |      | Well31  | Municipal          | Yes      | 7.29     | H.O.P. Park            |              | *              | 29-7322            | 17.07 cfr from Wells 30, 3   |
| 29-7322           |      |                     |      | Well32  | Municipal          | Yes      | 3.57     |                        |              | *              | 29-7322            | 17.07 cfr from Wells 30, 3   |
| 29-4223           |      |                     |      | Well33  | Municipal          | Yes      | 2.44     | Call Well              |              | 2.67           | 29-4223            |                              |
| 29-7782           | 7    |                     |      | Well34  | Municipal          | Yes      | 7.28     | H.O.P. Park            |              | 7              | 29-7782            | Limited to 7.00 cfr by lic   |
| 29-7450           |      |                     |      | Well35  | Municipal          | No       | 3.72     | Phillips 3             | Yes          | 3.34           | 29-7450            |                              |
| See 29-8036*      | 4    | *Claim not required |      | Well36  | Drilled after 1987 | No       |          |                        |              |                | None               | Licensed POD for 29-803      |
| ?                 |      |                     |      | Well37  |                    | No       |          |                        |              |                |                    |                              |
| ?                 |      |                     |      | Well38  |                    | No       |          |                        |              |                |                    |                              |
| 29-11343          |      |                     |      | Well39  | ?                  | No       |          | Phillips 1             |              | 2.2            | 29-11343           | 4.46 cfr of 29-11343 is from |
| 29-11344          |      |                     |      | Well40  | Irrigation         | No       |          | Phillips 2             |              | 1.92           | 29-11344           |                              |
| 29-7119           | 4    |                     |      | Well41  | Irrigation         | No       |          | Airport 2              |              | 4.01           | 29-7119            |                              |
| 29-7118           | 6    |                     |      | Well42  | Irrigation         | No       |          | Airport 1              |              | 6              | 29-7118            |                              |
| 29-7222           | 1    |                     |      | Well43  | Irrigation         | No       |          | Ward Park              |              | 1              | 29-7222            |                              |
| See Transfer 5452 | ?    |                     |      | Well44  | Drilled after 1987 | No       |          |                        | Yes          |                | Transfer No. 5452  |                              |
| 29-7770           | 4.5  |                     |      |         | Irrigation         | No       |          | WFO Plant              |              | 4.46           | 29-7770            |                              |
| 29-2354           | 0.3  | 29-7502             | 0.1  |         | Irrigation         | No       |          | Roxlaun                |              | 0.28 & 0.10    | 29-2354 & 29-7502  | 0.28 cfr for 29-2354 & 0.    |

# Water Rights v. Installed Capacity

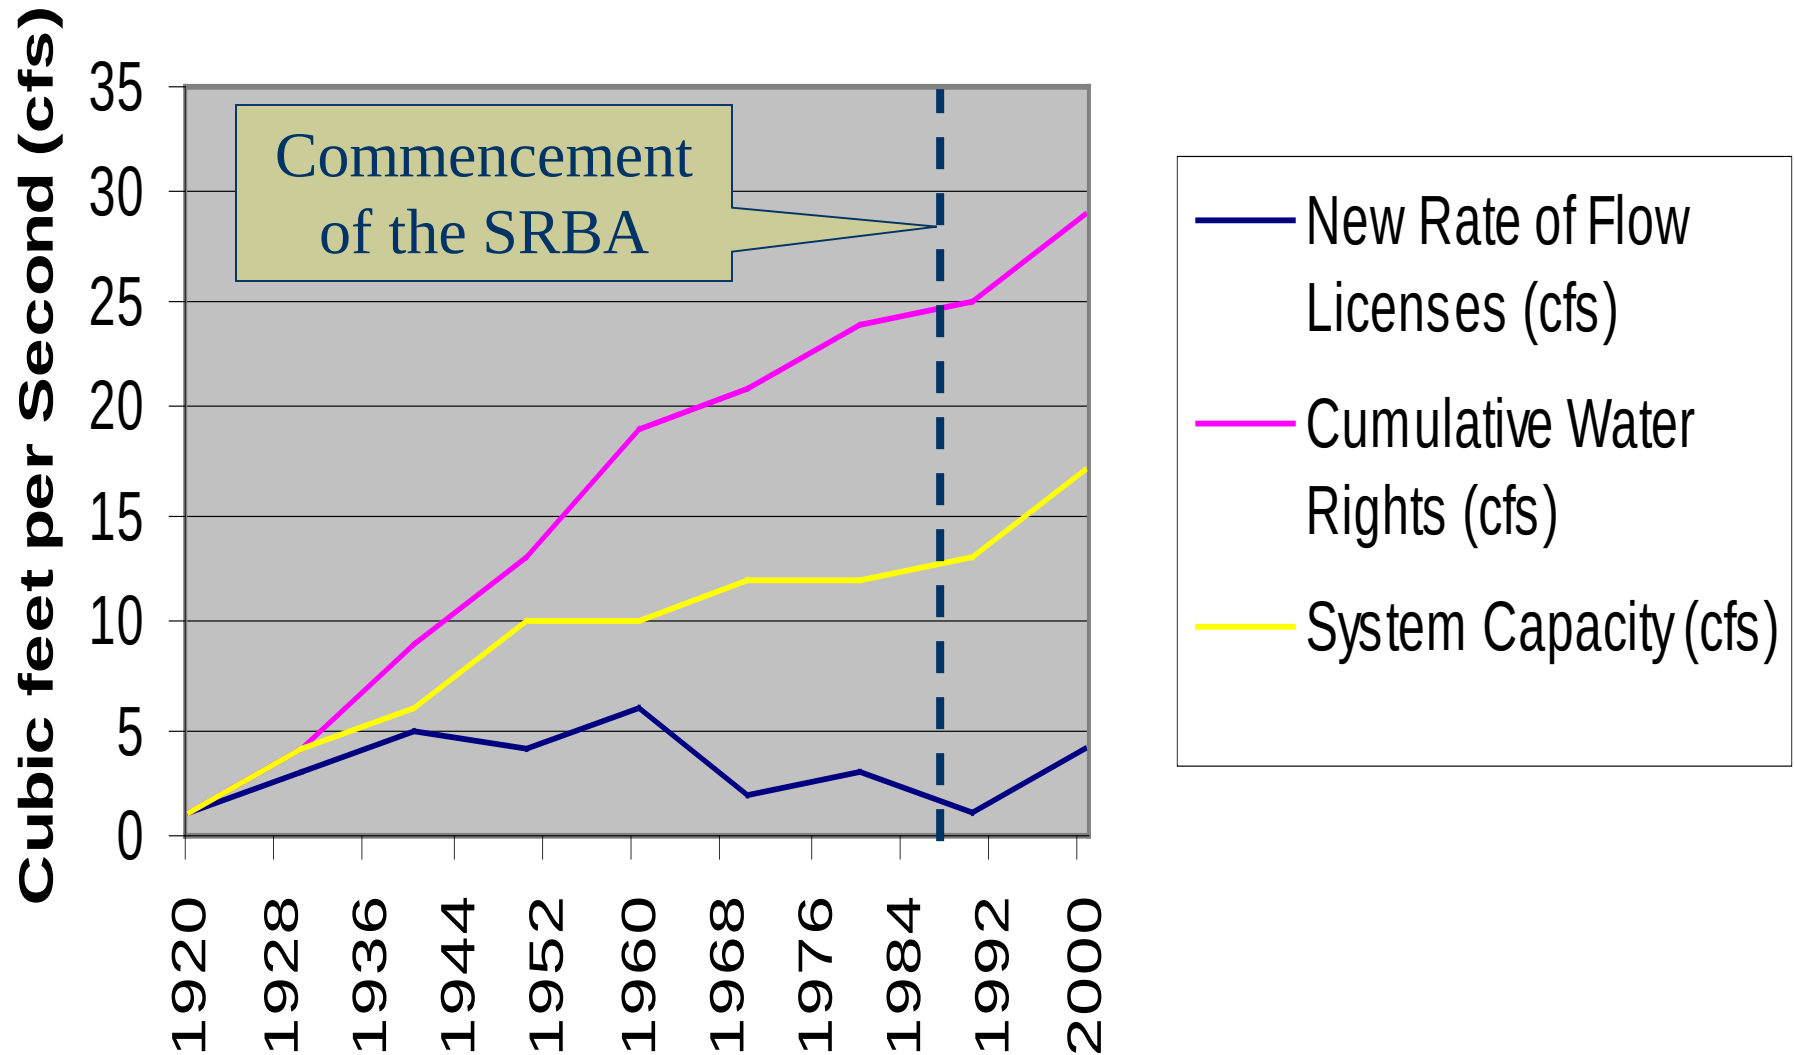

1940 well is a replacement well for the 1910 well – both are licensed, but only the 1940 well is pumped

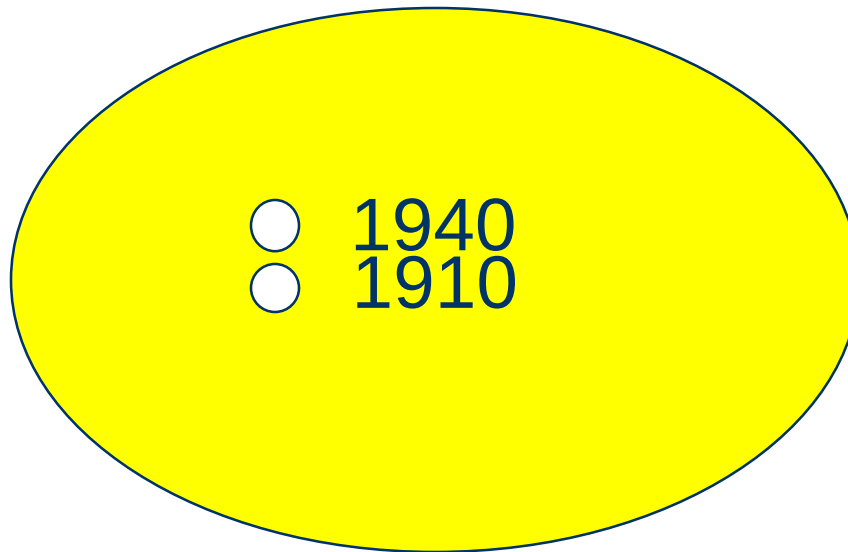

# Wells with Interference Potential

1910 for 3 cfs at 1940 well


1940 for 4 cfs at 1940 well

diversion rate limit at well = 4 cfs

remark: recognizes ability to seek a transfer for  
up to 7 cfs from this well to another  
location if there is water  
available at the new point and if there  
is no injury

CFS

## City of Meridian Claims

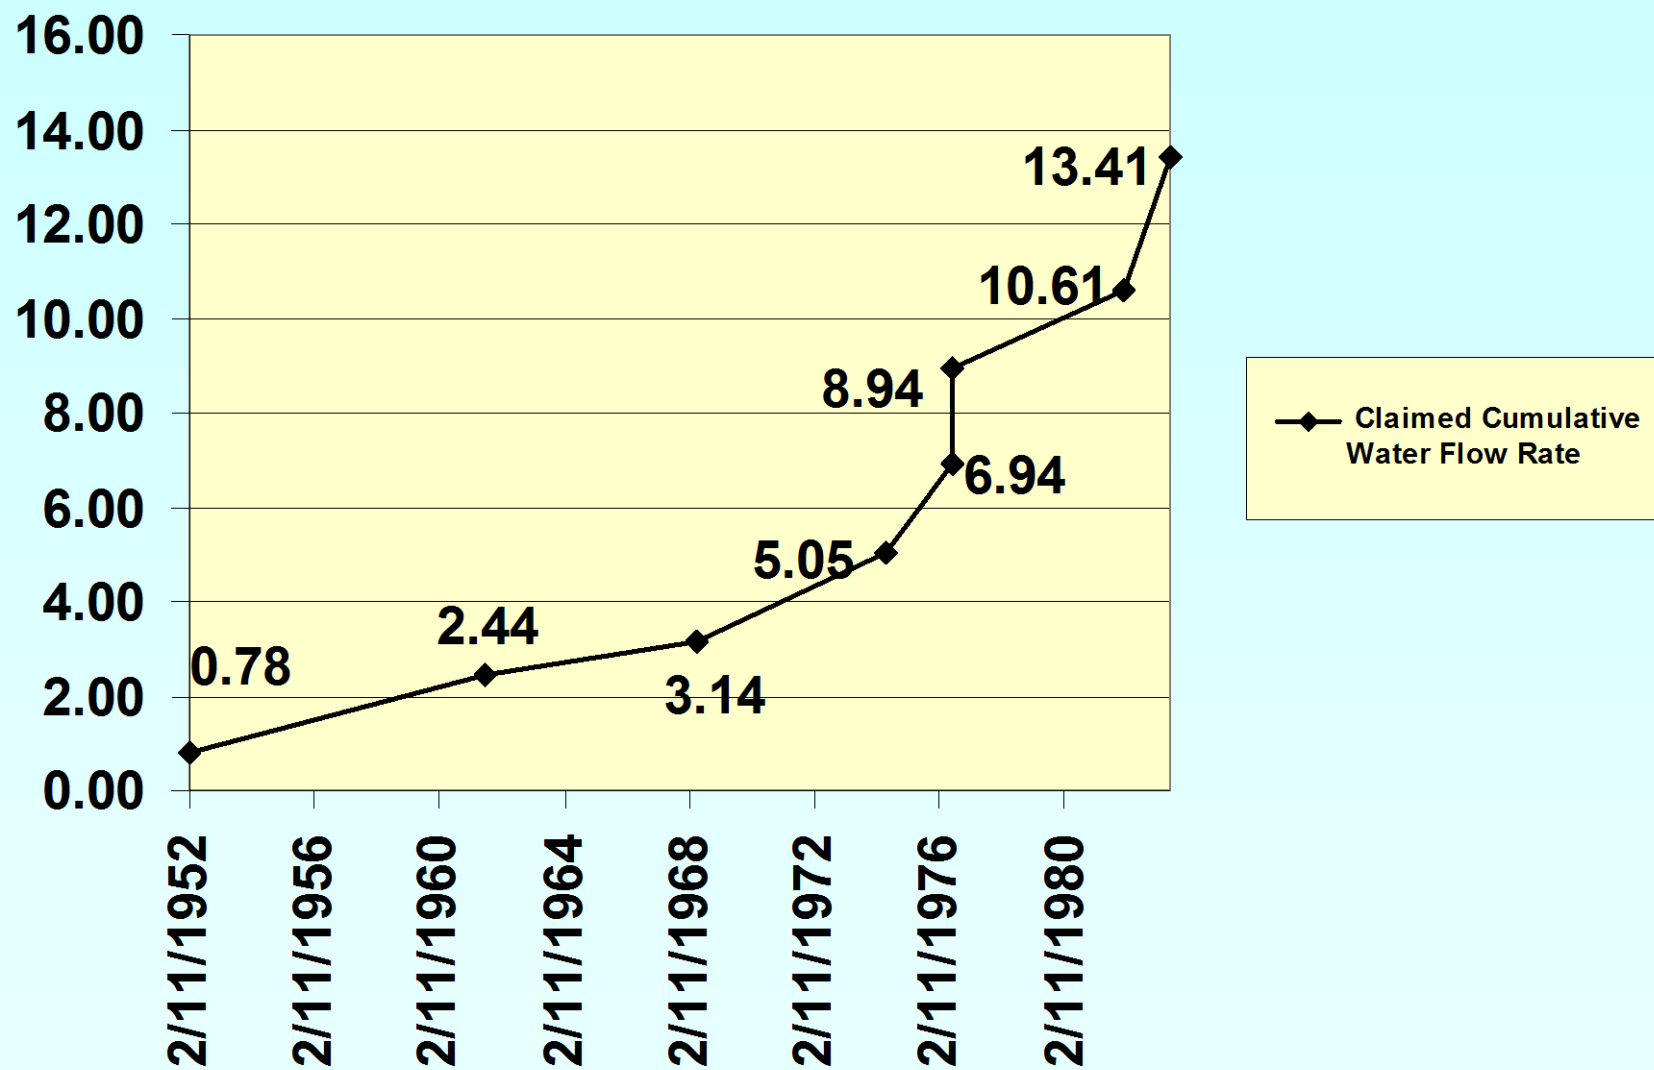

# Needed from Treasure Valley Municipalities

- ◆ Repeat Pocatello info
  1. documentation of the priority date and flow rate of the claimed water use if not covered by a licensed right.
  2. the history of the development of the municipal water system segregating new development from replacement facilities
  3. the history of the development of water systems acquired by the municipal provider but developed by another entity
  4. a map of the service area
  5. historic pumping records



# Timeline for Basin 63 Municipal Water Rights



- ◆ Feb 3 Conduct meeting
- ◆ Mar 1 Provide info to IDWR
- ◆ May 1 Prepare Preliminary  
Recommendations for Part 2 (Ada  
County)



# Discussion