

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATION

Permit No: 74-16220
Exam Date: 9/23/2025

1. Current Owner:
EVR LLC 446 BOHANNON CREEK RD SALMON ID 83467-5045 AND
EVR II LLC 446 BOHANNON CREEK RD SALMON ID 83467-5045
2. Accompanied by: Jen Vogel
Phone No:
Address:
Relationship to permit Holder:

3. **SOURCE:**
SPRING

Tributary
SINKS

Method of Determination: Site Inspection

B. OVERLAP REVIEW

1. Other water rights with the same place of use: YES Overlap

Comments: EVR LLC and EVR II LLC have seven irrigation rights on the field where the stock water troughs under this right are operated.

2. Other water rights with the same point-of-diversion: NO Overlap

C. DIVERSION AND DELIVERY SYSTEM1. **LOCATION OF POINT(S) OF DIVERSION:**

SPRING NW¼ NE¼ NW¼, Sec. 28, Twp 21N, Rge 23E, B.M. LEMHI County

Method of Determination:

PLACE OF USE: STOCKWATER

Twp	Rng	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
21N	23E	28		X					X	X		X							
21N	23E	29													X				

Method of Determination:

3. Delivery System Diagram Attached (required). Indicate all major components and distances between components.
X Indicate weir size/pipe as applicable.
- Map Attached Showing Location(s) of point(s) of diversion and place(s) of use (required). Scale must be 1:24,000 or greater.
X
- X Aerial Photo Attached (required for irrigation of 10+ acres).
- X Photo of Diversion and System Attached

E. FLOW CALCULATIONS

Additional Computation Sheets Attached


Measured Method:

F. VOLUME CALCULATIONS

2. Volume Calculations for Other Uses:

 $400 \text{ cattle} \times 12 \text{ GPD} \times 365 \text{ days} = 1752000 \text{ gallons} = \mathbf{5.4 \text{ AF}}$ **G. NARRATIVE/REMARKS/COMMENTS**

The point of diversion collects water from a hillside spring complex through a drain tile system. Water flows through gravity through buried pipe to several stock water troughs located in the middle of the irrigated fields.

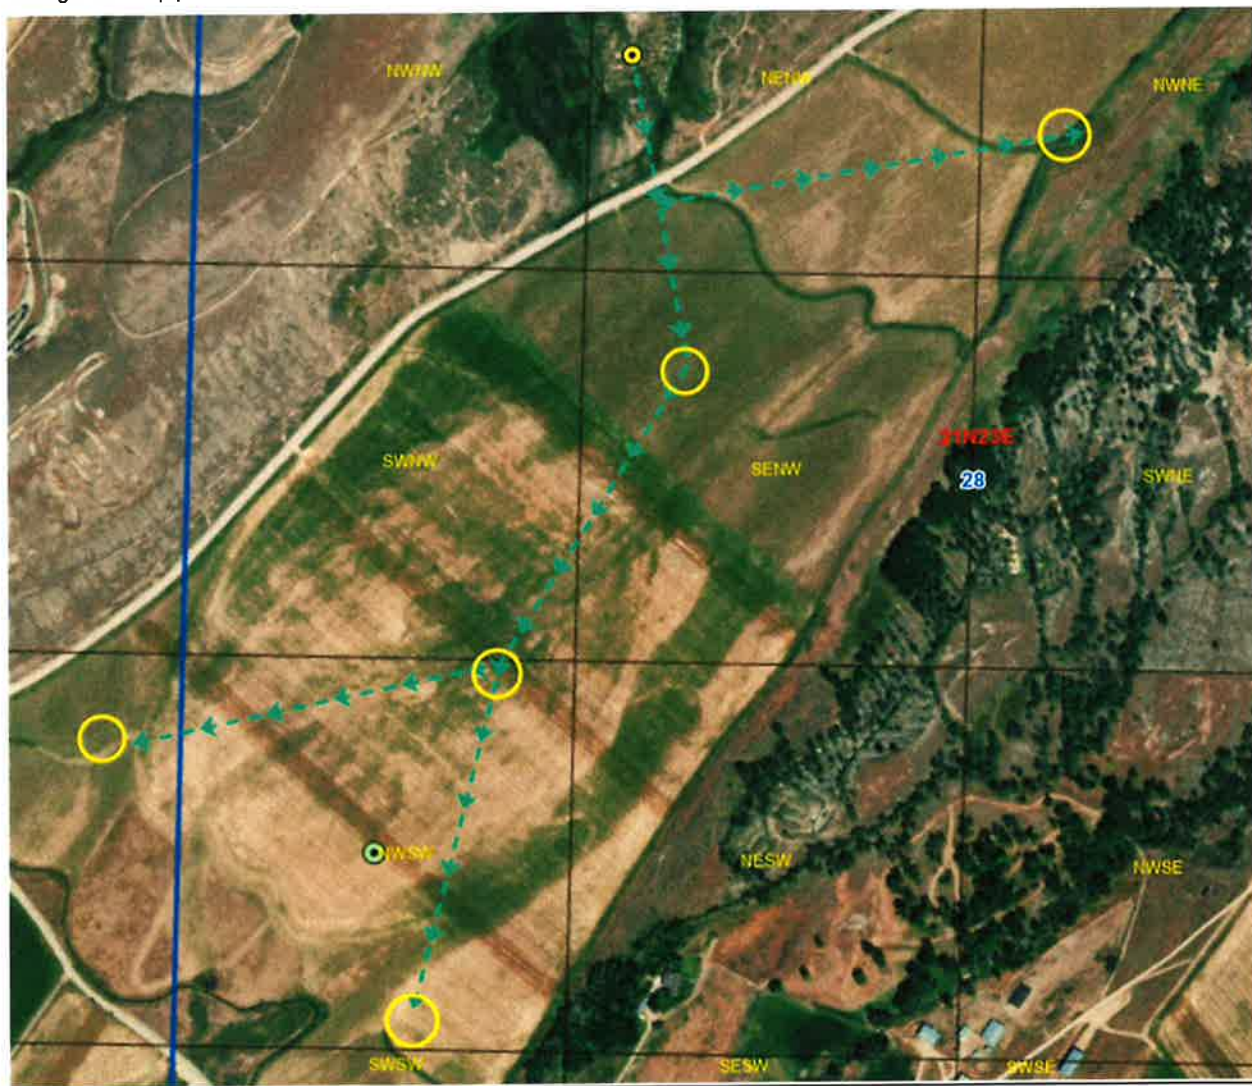

Have conditions of permit approval been met? X Yes No

H. RECOMMENDATIONS

1. Recommended Amounts

<u>Beneficial Use</u>	<u>Period of Use</u>	<u>Rate of Diversion</u>	<u>Annual Volume</u>
STOCKWATER	01/01 to 12/31	0.07 CFS	5.4 AF

Totals: 0.07 CFS 5.4 AF

2. Recommended Amendments

Change P.D. as reflected above Add P.D. as reflected above ✓ None
 Change P.U. as reflected above Add P.U. as reflected above ✓ None

I. AUTHENTICATION Christian Stewart - Water Resource Agent

Field Examiner's Name

Christian J Stewart

Date

11/19/25

Reviewer

Blake Jordan

Date

12/1/2025

Spring collection system valve



[illegible]

10:45 AM Sep 23, 2025
Tues
Salmon, ID 83467
Company: IDWP
Photo: Timemark