

STATE OF IDAHO
DEPARTMENT OF WATER RESOURCES
IN-OFFICE REVIEW/BENEFICIAL USE FIELD REPORT

A. GENERAL INFORMATIONExam Date: 4/1/2026

1. Does this qualify for an in-office field exam (IDAPA 37.03.02.035.01.q)? X Y N
- a. Irrigation of 5 acres or less
- b. Storage of up to 14.6 AF for stockwater purposes only
- c. X Any use other than irrigation or storage, if the combined diversion rate is 0.24 cfs or less
- d. Other < >

Comment: N/A

2. Current Owner: Derrick Parker

Owner of Record Correct? X Y NAddress of Record Correct? X Y NIf No Explain: N/A

3. Beneficial Use Fees have been paid:
- X
- Y
-
- N Receipt No: C124832

4. Source: Priest Lake
- Tributary: Priest River

Method of Determination: GIS, Idaho Tax Parcel Data, and the Permit Holders Statement of Completion for Proof of Beneficial Use (Proof Statement).

Change in Source: X Y N**B. OVERLAP REVIEW**

1. Other water rights with the same place of use: Overlap ?
-
- Yes
- X
- No

Water Right No.	Source	Purpose of Use	Basis
N/A			

Comments: There are no other Water Rights (WR) overlapping the permitter place of use (POU).

2. Other water rights with the same point of diversion: Overlap ?
-
- Yes
- X
- No

Water Right No.	Source	Purpose of Use	Basis
N/A			

Comments: There are no other WR overlapping the proposed point of diversion (POD).**C. DIVERSION AND DELIVERY SYSTEM**

1. Location of Point(s) of Diversion:

Source	Govt. Lot	1/4	1/4	1/4	Sec.	Twp.	Rge.		County
Priest Lake	2		NW	NE	3	59N	04W	B.M.	Bonner

Method of Determination: GIS, Idaho Tax Parcel Data and the permit holders Proof Statement.Change in POD? Y X N Amendment Required? Y X N

2. Place of Use: Domestic

TWP	RGE	Sec	NE				NW				SW				SE				Totals
			NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	NE	NW	SW	SE	
59N	04W	3		D															D
		Lot #		2															

Method of Determination: GIS, Idaho Tax Parcel Data, 2025 Bonner County Aerial Imagery, and 2025 NAIP Aerial Imagery.Change in POU? Y X N Amendment Required? Y X N

3. Diversion System Information

Description: N/A Delivery System Diagram Attached. (mark all major components and distances between components) X Aerial Photo indicating the location of the recommended POD and POU. X Aerial Photo Attached (required) Photo of Diversion and System Attached

3. Diversion Id No.*	Motor Make	HP	Motor Serial No.	Pump Make	Pump Serial No. or Discharge Size
N/A					

*Code to correspond with No. on map and aerial photo

D. FLOW MEASUREMENTS

1. Measurement Equipment	Type	Make	Model No.	Serial No.	Size	Calib. Date
N/A						

2. Measurement Comments: No measurement is required for permits qualifying for an in-office examination according to the IDAPA Beneficial Use Examination Rules.

E. FLOW CALCULATIONS

 Additional Computation Sheets AttachedMeasured Method: According to Administrative Application Processing Memo #22 the standard diversion rate for a single home is 0.04 cfs. I am recommending a 0.04 cfs diversion rate.

Administrative Application Processing Memo #22 Standard = 0.04 cfs

Permit allowed = 0.04 cfs

Total Recommendation = 0.04 cfs

F. VOLUME CALCULATIONS

1. Volume Calculations for Irrigation:

$$V_{I.R.} = (\text{Acres Irrigated}) \times (\text{Irrigation Requirement}) = \underline{N/A}$$
$$V_{D.R.} = [\text{Diversion Rate (cfs)}] \times (\text{Days in Irrigation season}) \times 1.9835 = \underline{N/A}$$
$$V = \text{Smaller of } V_{I.R.} \text{ and } V_{D.R.} = \underline{N/A}$$
2. Volume Calculations for Other Uses: According to Administrative Application Processing Memo #22 the standard diversion volume for a single domestic use is 0.6 af for in-house use and 0.6 af for up to ½ an acre of yard irrigation. I am recommending a 1.2 af diversion volume.

G. PURPOSE OF USE

Irrigation Y X N # Stock N/A Domestic # of Homes 1 (internal and external)Change in Purpose of Use? Y X NMethod of Determination: GIS, Idaho Tax Parcel Data, 2025 Bonner County Aerial Imagery, 2025 NAIP Aerial Imagery, and the permit holders Proof Statement.

H. NARRATIVE/REMARKS/COMMENTS

This permit qualifies for an in-office licensing examination. The permit authorized domestic use for 1 home including in-house use and up to ½ acre of yard irrigation. 2025 Bonner County and NAIP Aerial Imagery confirmed the development of domestic use for 1 home and up to ½ acre of yard irrigation. A condition on the permit requires the permit holder to install a fish screen meeting the fish screening and passage requirements of the Idaho Dept. of Fish and Game. However, the permit holder did not indicate on their Proof Statement a fish screen was installed. After an email conversation with the permit holder on April 1st, 2026, they confirmed a screening device was installed on the pump intake. The standards set in Administrative Application Processing Memo #22 was utilized to make a diversion rate and volume recommendation. All

conditions of permit approval have been met, and development of beneficial use was confirmed within authorization on the permit. Therefore, I am recommending a 0.04 cfs diversion rate and 1.2 af diversion volume.

Conditions X01, 187, 227, and 004 should remain on the license. Condition 029 should be removed because the permit holder confirmed a fish screen was installed on the pump intake meeting the fish screening and permit requirements of the Idaho Dept. of Water Resources.

Have conditions of permit approval been met? ☒ Yes ☐ No

I. RECOMMENDATIONS

1. Recommended Amounts:

<u>BENEFICIAL USE</u>	<u>PERIOD OF USE</u>	<u>DIVERSION RATE</u>	<u>ANNUAL VOLUME</u>
Domestic	01/01-12/31	0.04 CFS	1.2 AF
	Totals:	0.04 CFS	1.2 AF

2. Recommended Amendments:

☐ Change P.D. as reflected above ☐ Add P.D. as reflected above ☒ None

☐ Change P.U. as reflected above ☐ Add P.U. as reflected above ☒ None

J. AUTHENTICATION


Field Examiner: **Skyler Cheever – Water Resource Agent, Sr – State Office**

Field Examiner's  Date 4/11/2026

Reviewer  Date 4/2/2026

Field Exam Map

Map showing the authorized point of diversion (yellow point) and place of use (orange outline).

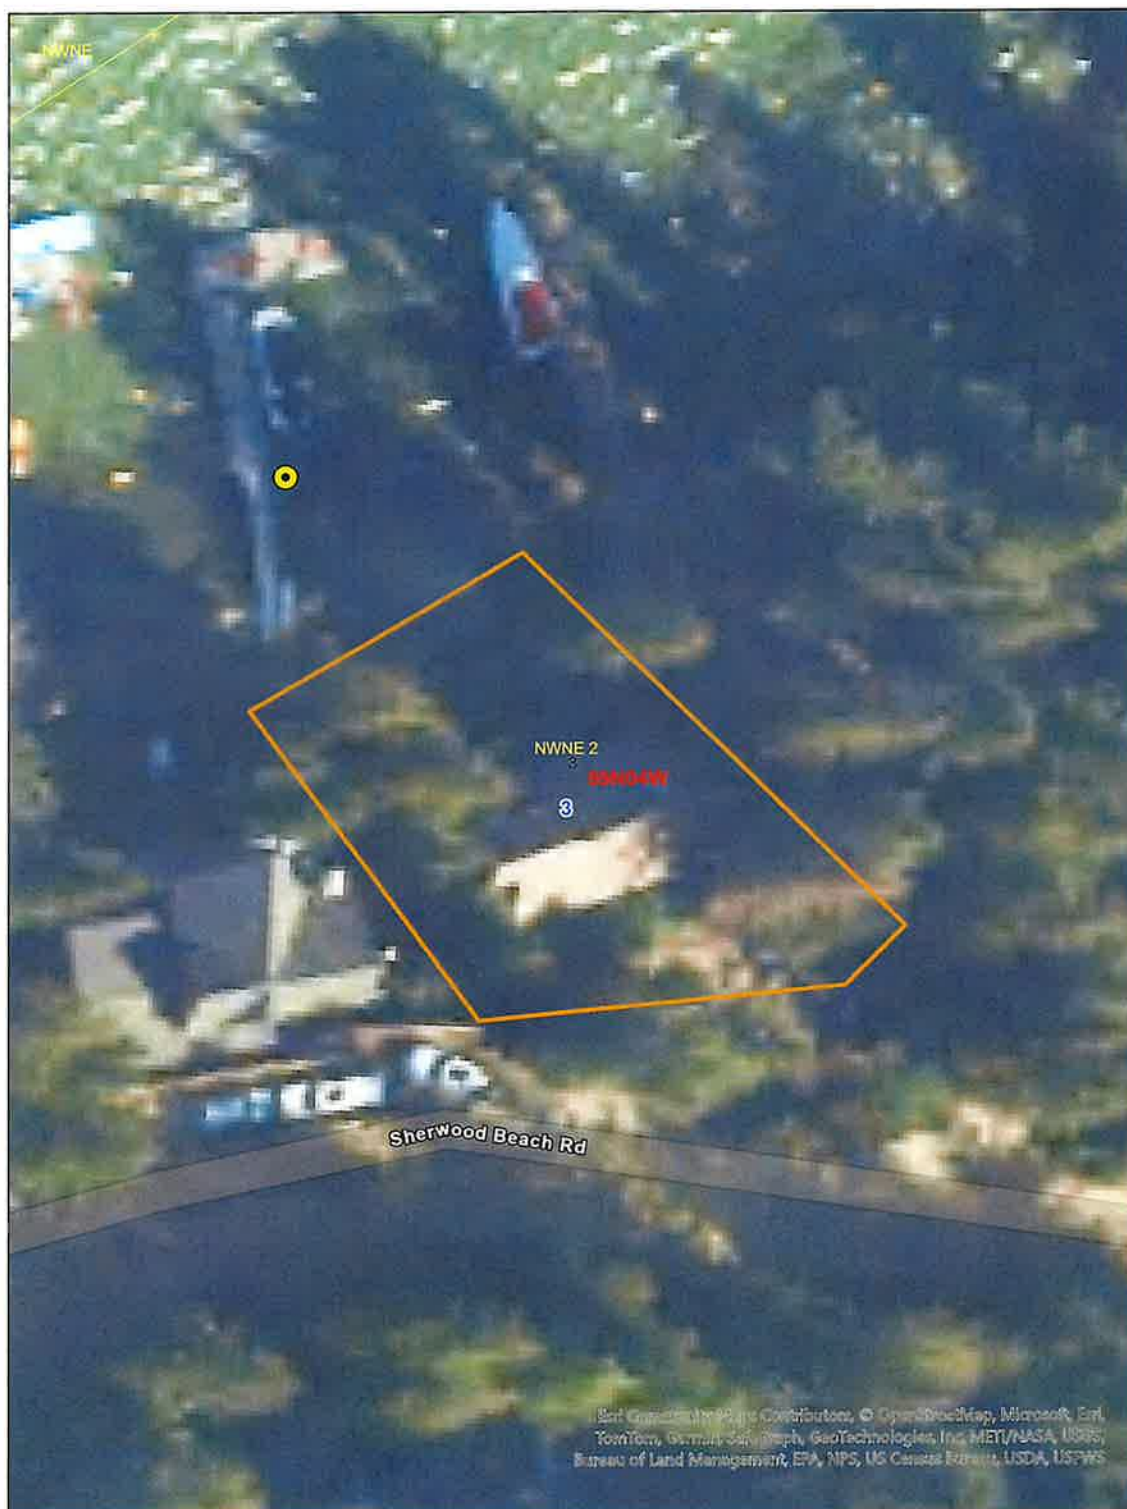

2025 Boner County Aerial Imagery

97-9866



Cheever, Skyler

From: Derrick Parker <derricklparker@gmail.com>
Sent: Wednesday, April 1, 2026 2:15 PM
To: Cheever, Skyler
Subject: Re: Licensing Examination for Water Permit 97-9866

CAUTION: This email originated outside the State of Idaho network. Verify links and attachments BEFORE you click or open, even if you recognize and/or trust the sender. Contact your agency service desk with any concerns.

Hello Skylar -

Yes, the pump is inside of a protective pipe with small wholes to protect it and to keep fish and debris away from the pump.

Please let me know if you need any other information, thank you.

Derrick Parker

On Apr 1, 2026, at 12:52 PM, Cheever, Skyler <Skyler.Cheever@idwr.idaho.gov> wrote:

Hello Mr. Parker,

I am currently reviewing Water Permit 97-9866 for licensing. A condition on the permit requires the permit holder to install a fish screen on the pump intake. You did not indicate on your Statement of Completion for Submitting Proof of Beneficial Use a fish screen was installed. Once I have confirmation any fish screening device has been installed on the diversion system, I will be able to complete the licensing examination. If you have any questions or concerns, please let me know.

Best,

Skyler

<image001.png>