

Dave  
Nick —

Enc:  
Plat

Fred R Stewart  
Rt 4, Box 4826  
Jerome, ID 83338

March 23, 2007

RECEIVED

APR 05 2007

DEPARTMENT OF  
WATER RESOURCES

*DM*  
Director  
Dept. of Water Resources  
322 E Front St.  
P. O. Box 83720  
Boise, ID 83720-0098

Re: Order Requiring Measuring Devices and Head Gates Water District 170.


Subject: Request for exemption to above order .

Dear Sir;



The small piece of land that I water with a sprinkler system is less  
five acres. The source of the water is a combined irrigation runoff of  
pasture land and a small amount of spring water. This amount varies greatly  
and it is only when there is enough water that I run my pump. I do not see  
any way of measuring this.

Thank you for your kind consideration of the above request .

Yours

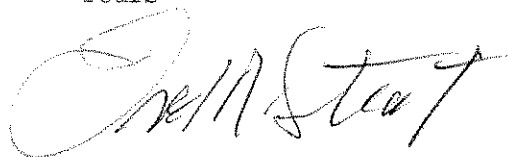

Response 4/24/07

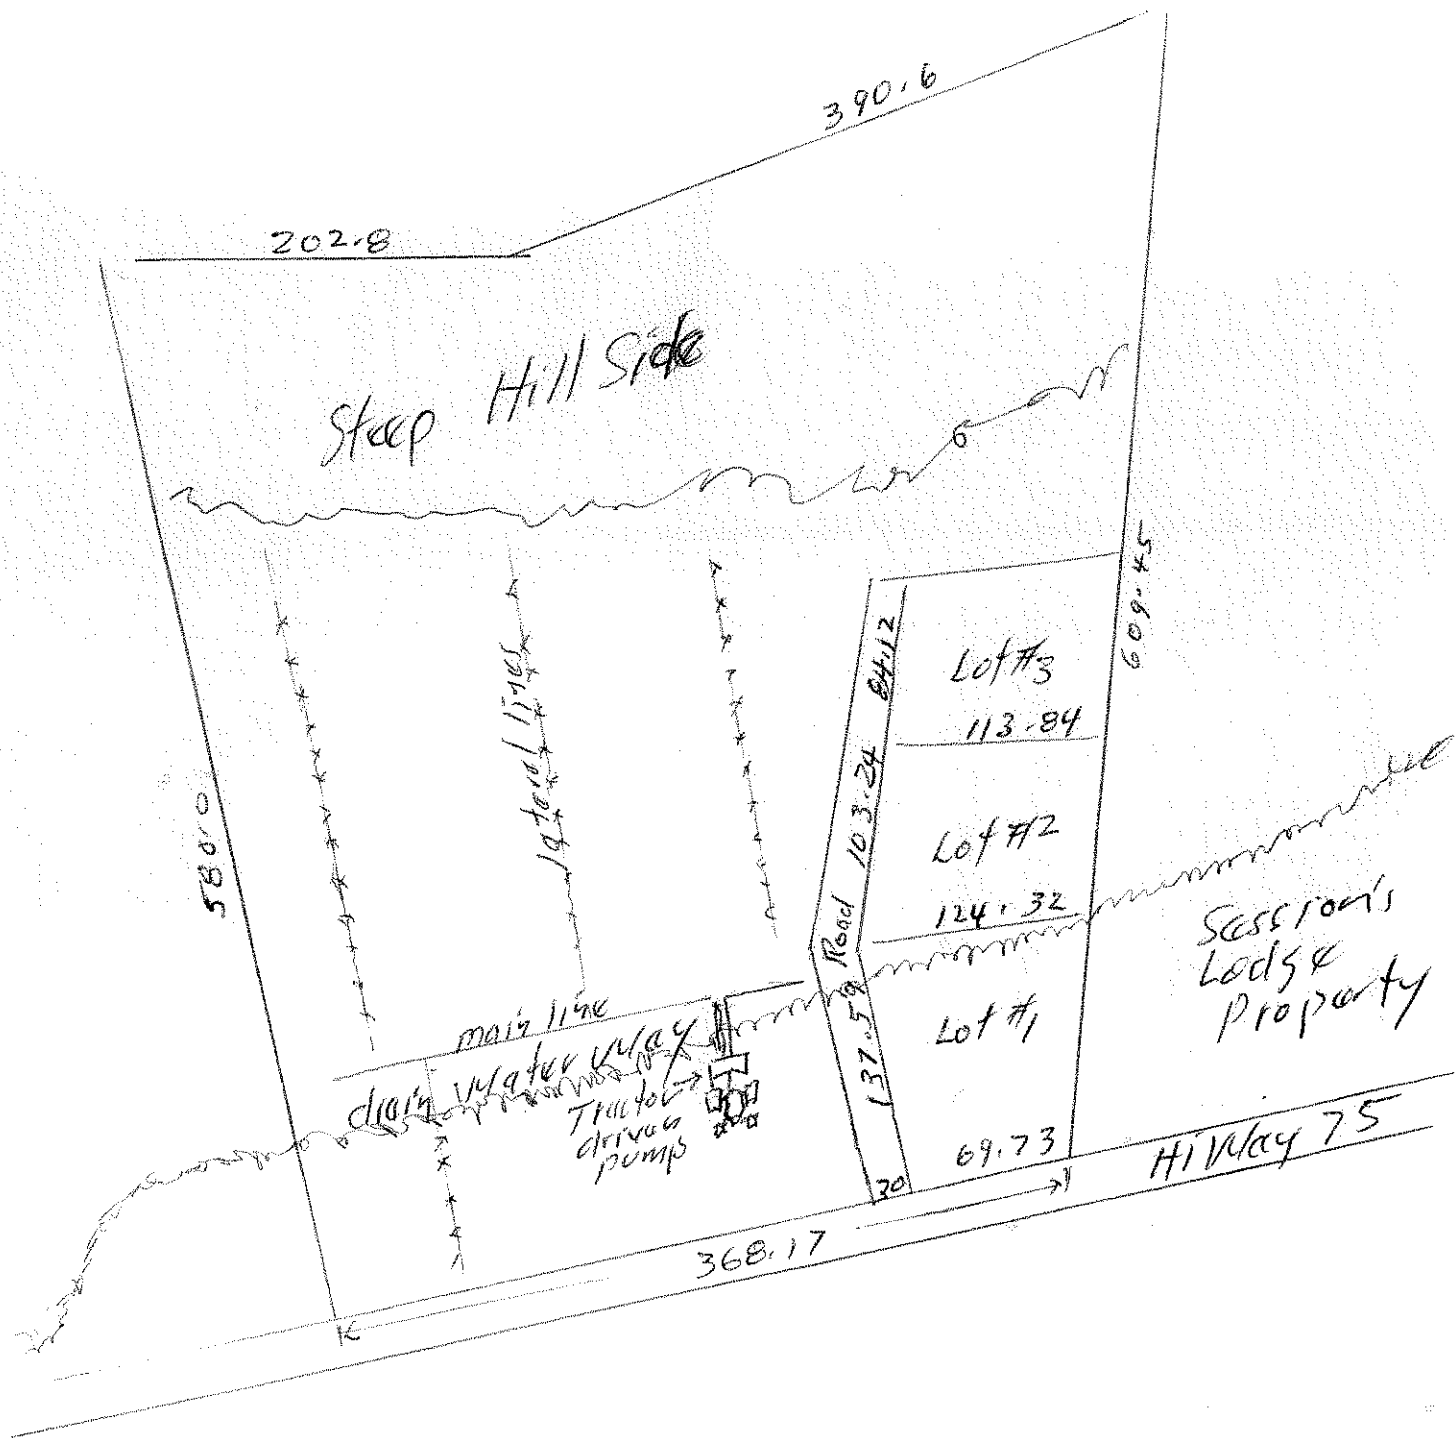

Sawtooth Valley

Fred R Stewart  
 Rt 4, Box 4826  
 Jerome, ID 83338